

Bellefonte Nuclear Plant, Units 3 & 4
 COL Application
 Part 3, Environmental Report

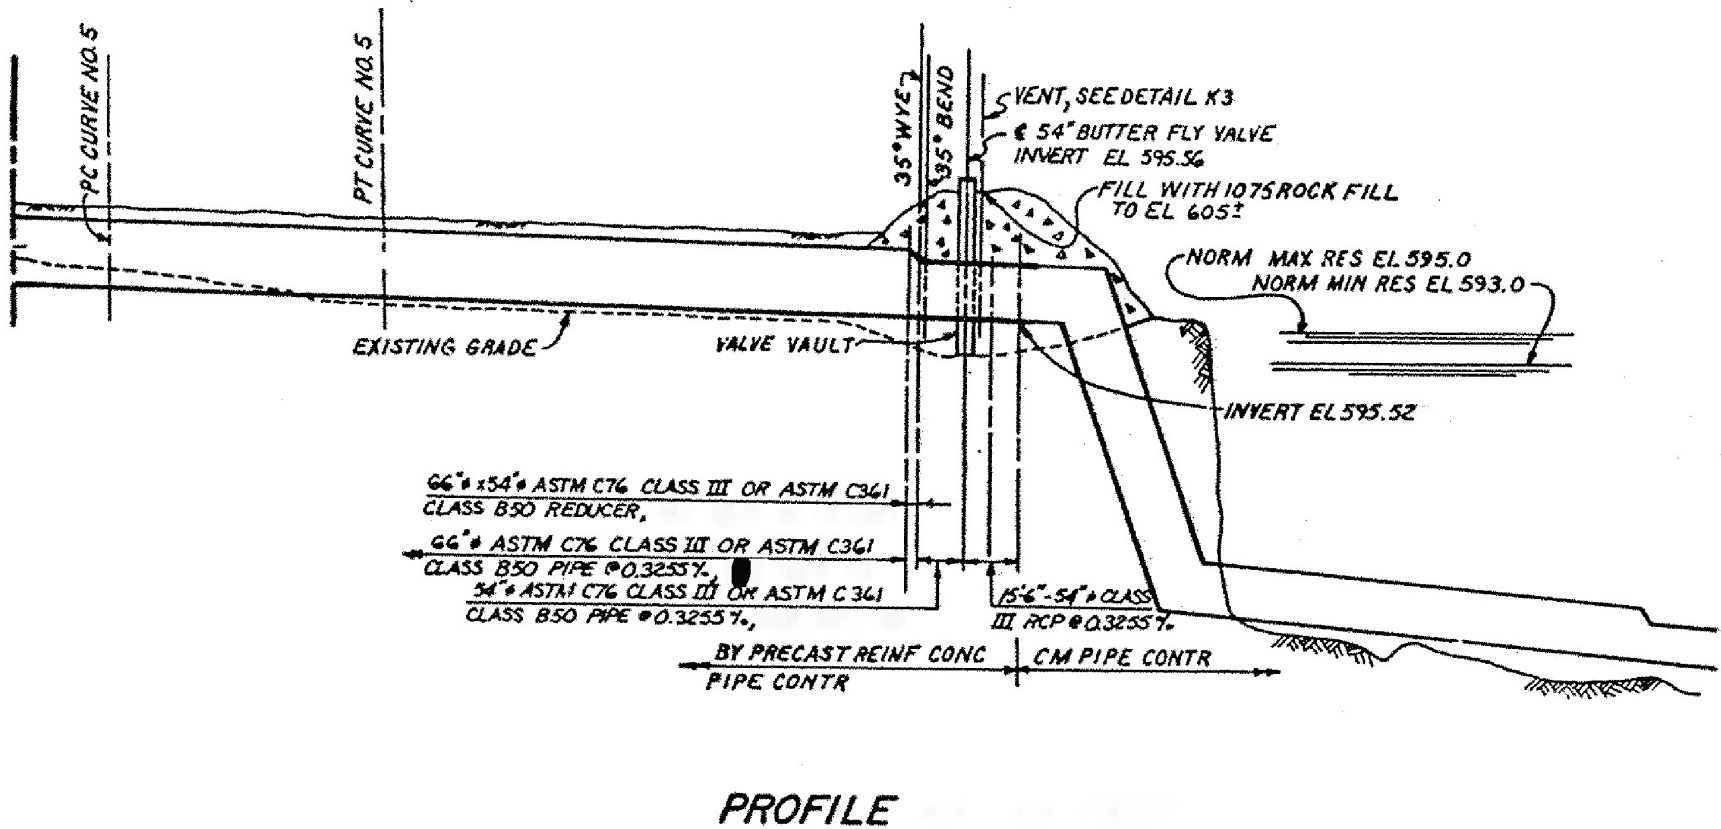


FIGURE 3.4-3
 Cooling Tower Blowdown Pipe Profile at Discharge