

Bellefonte Nuclear Plant, Units 3 & 4  
COL Application  
Part 3, Environmental Report

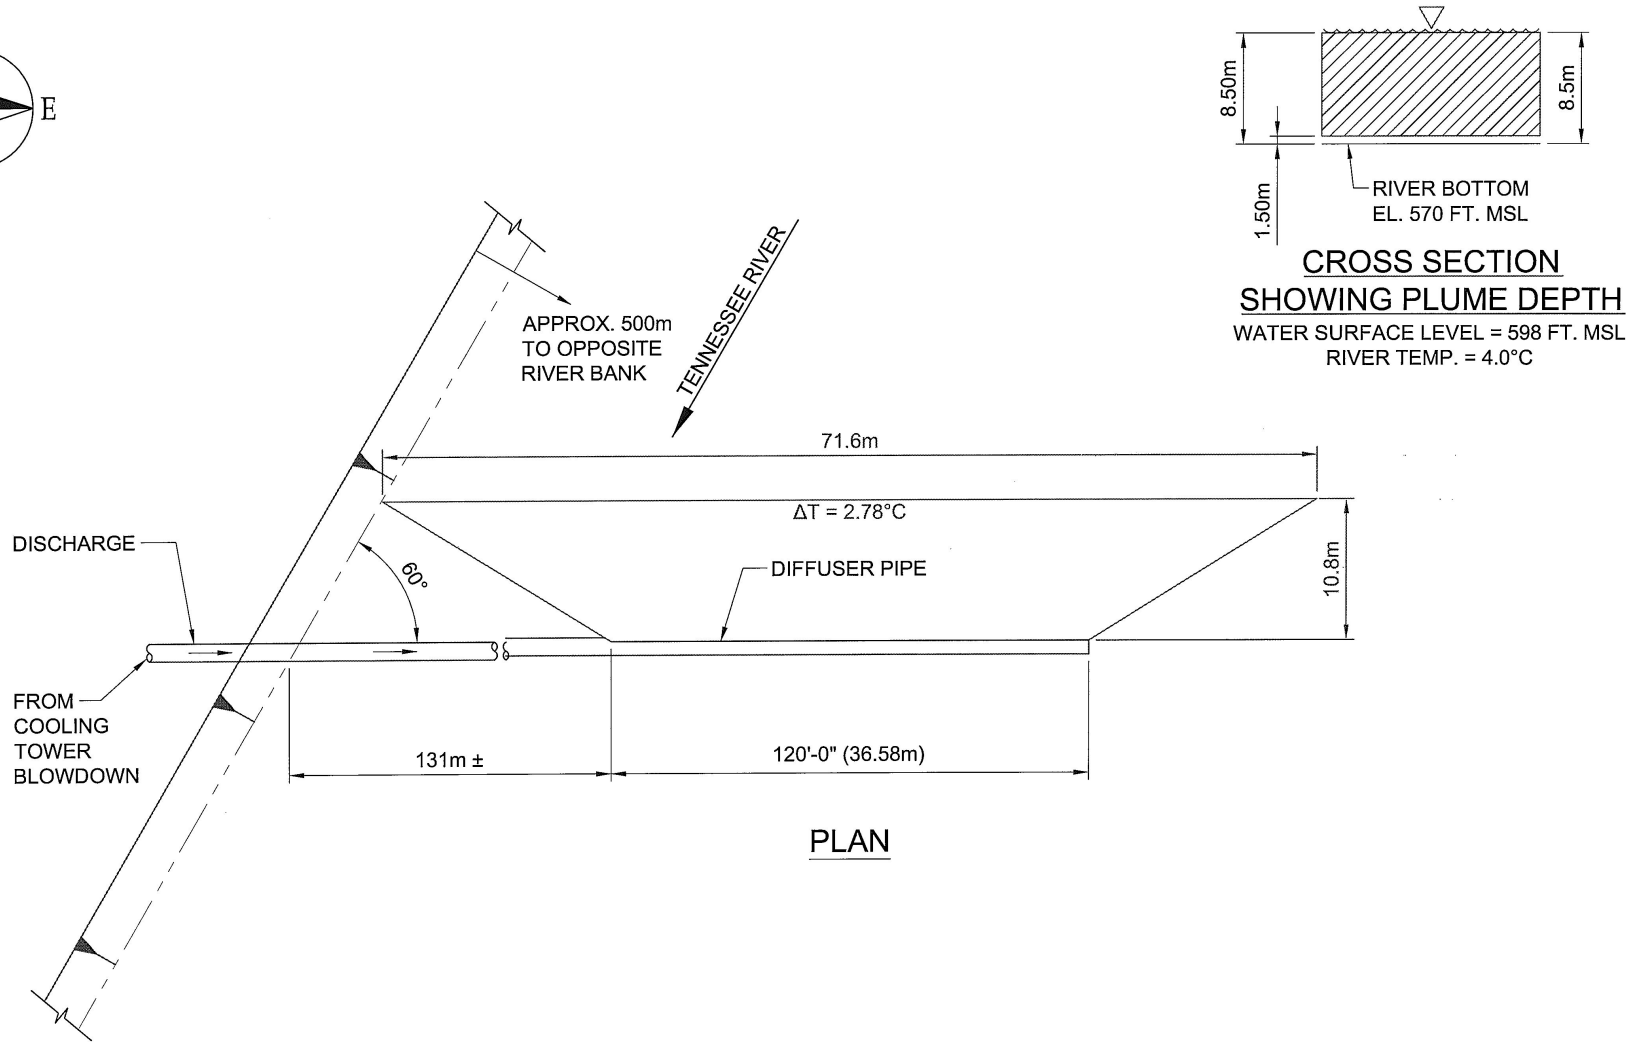



FIGURE 5.3-9  
Low River Temperature, Maximum Reverse River Flow