



**UNITED STATES
NUCLEAR REGULATORY COMMISSION**
WASHINGTON, D.C. 20555-0001

April 5, 2011

LICENSEES: STP Nuclear Operating Company

FACILITIES: South Texas Project, Units 1 and 2

SUBJECT: SUMMARY OF FEBRUARY 22, 2011, CATEGORY 1 MEETING WITH STP NUCLEAR OPERATING COMPANY – MEETING TO DISCUSS A PROPOSED RISK-INFORMED APPROACH TO RESOLUTION OF GENERIC SAFETY ISSUE 191 FOR SOUTH TEXAS PROJECT, UNITS 1 AND 2 (TAC NOS. ME5358 AND ME5359)

On February 22, 2011, the U.S. Nuclear Regulatory Commission (NRC) staff held a public meeting with representatives of STP Nuclear Operating Company (STPNOC, the licensee), at NRC Headquarters, One White Flint North, 11555 Rockville Pike, Rockville, Maryland. The purpose of the meeting was for STPNOC to discuss a proposed risk-informed approach to resolution of Generic Safety Issue (GSI)-191, "Assessment of Debris Accumulation on Pressurized-Water Reactor (PWR) Sump Performance," for South Texas Project (STP), Units 1 and 2. A list of meeting attendees is provided in Enclosure 1.

The licensee discussed its desired outcomes of the meeting, which included an overview of the technical models that are under consideration for resolution of GSI-191, establishing NRC points of contact for performance of the necessary reviews, and establishing the next steps for developing a pilot program for risk-informed resolution of GSI-191. The licensee's viewgraphs are provided in Enclosure 2.

There was a considerable discussion regarding the licensee's technical analyses to be performed, probabilistic models to be developed, and integrated uncertainty considerations to be incorporated in the models. The licensee presented its milestones plan, which indicated that the GSI-191 resolution project can be completed in approximately 3 years.

Specifically, the licensee would develop an emergency core cooling system recirculation model which would address location-specific phenomena of in-vessel effects, debris generation and transport, and sump performance. The licensee plans to define the success criteria including the effect of the new sump on the core damage frequency and large early release frequency, and improve probabilistic risk assessment (PRA) technology by integrating multidimensional uncertainties into the PRA model. The licensee expects to use mechanistic models of sump clogging.

The licensee may request an exemption to Title 10 of the Code of *Federal Regulations* (10 CFR) paragraph 50.46(a)(1) and Appendix K to 10 CFR Part 50, to the extent they require use of an acceptable evaluation model to determine the effects of debris accumulation in the calculation of long-term cooling pursuant to 10 CFR 50.46(b)(5), and/or it may request an amendment to the Updated Final Safety Analysis Report. The licensee plans to redefine the

applicable loss-of-coolant accident break size spectrum for sump clogging, based on probabilistic considerations.

In addition, the licensee is collecting the data obtained from industry sump testing to use in deterministic and probabilistic modeling.

If there are any questions, please direct inquiries to me at (301) 415-1476 or mohan.thadani@nrc.gov.

Sincerely,

A handwritten signature in black ink, reading "Mohan C. Thadani". The signature is fluid and cursive, with the first name "Mohan" being more prominent.

Mohan C. Thadani, Senior Project Manager
Plant Licensing Branch IV
Division of Operating Reactor Licensing
Office of Nuclear Reactor Regulation

Docket Nos. 50-498 and 50-499

Enclosures:

1. List of Attendees
2. Presentation Viewgraphs

cc w/encls: Distribution via Listserv

ENCLOSURE 1

LIST OF MEETING ATTENDEES AND BRIDGE LINE PARTICIPANTS

FEBRUARY 22, 2011, PUBLIC MEETING WITH

STP NUCLEAR OPERATING COMPANY

LIST OF MEETING ATTENDEES AND BRIDGE LINE PARTICIPANTS

FEBRUARY 22, 2011, PUBLIC MEETING

U.S. NUCLEAR REGULATORY COMMISSION AND

STP NUCLEAR OPERATING COMPANY

NAME	AFFILIATION
Mohan Thadani	Nuclear Regulatory Commission
Michael Markley	Nuclear Regulatory Commission
Michael Snodderly	Nuclear Regulatory Commission
Donnie Harrison	Nuclear Regulatory Commission
Stewart Bailey	Nuclear Regulatory Commission
Ralph Architzel	Nuclear Regulatory Commission
Ernie Kee	STP Nuclear Operating Company
Jamie Paul	STP Nuclear Operating Company
Rick Grantom	STP Nuclear Operating Company
Elmira Popova	University of Texas Austin
John Butler	Nuclear Energy Institute
Biff Bradley	Nuclear Energy Institute
David Johnson	ABS Consulting Company
Yassin Hassan	Texas A&M University
Rodolfo Vagmetto	Texas A&M University
Joseph Gasper*	Omaha Public Power District
Bruce Letellier*	Los Alamos National Laboratories

*Bridge line participant

ENCLOSURE 2

PROPOSED APPROACH TO RISK-INFORMED RESOLUTION OF GSI-191

DISCUSSED AT FEBRUARY 22, 2011, PUBLIC MEETING WITH

STP NUCLEAR OPERATING COMPANY

Risk Informed GSI-191 NRC Kick-Off Meeting

NRC Public Meeting
February 22, 2011

South Texas Project
C. Rick Grantom P.E.
Project Manager

Kick-Off Meeting Desired Outcomes

- Gain alignment and better understanding with NRC on risk informed approach
- Overview the technical models that will be used in performing the risk informed approach
- Establish NRC points of contact for performing necessary reviews
- Establish next steps for pilot designation
- Establish communication & milestone plan

Rick Grantom, PE
Project Lead

Mike Golay, PhD
Oversight Lead

TBD

Independent Oversight

Jamie Paul
STP Licensing

Define Licensing
Approach

Identify required
Licensing Needs

Regulatory Interface
Support

Shawn Rodgers
STP PRA

PRA Model
Development

Identify required
Distributions/Data

PRA Model
Quantification

Ernie Kee
STP Technical

Uncertainty Model
Development

Identify Required
Modeling Needs

Produce Required
Distributions & Success
Criteria

Wes Schultz
STP Design

Piping Configuration

Insulation and Coating
Loadings, etc.

Containment
Configuration/Design

Equipment
Configuration/Design

Todd Anselmi
Deterministic Analysis Lead

David Johnson, ScD
PRA Lead

Jim Liming
ABS Consulting

Event tree
Model Development

Probabilistic pipe break
Model Development

PRA Quantification
CDF, ERF

Bob Lutz
PWORG Lead

TBD
Lead PWORG

Chemical Effects
Testing

Sump Blockage
Testing

Coordination
PWORG

Elmira Popova, PhD
DTSB Lead

Julia Day
UT Austin

Bruce Letellier, PhD
Los Alamos National Laboratory

Debris Generation
Model Development

Debris Transport
Model Development

Sump Performance
Model Development

Containment Performance
Model Development

Erich Schneider, PhD
UT Austin

DTSB DEM TH
Model Integration

Stochastic Wrapper (Model
Integration for Uncertainty)

Uncertainty
Quantification

ZOI
E/LOCA/SLOCA

Yassin Hassan, PhD
TH, DEM Lead

Rodolfo Vaghetto
Texas A&M University

Ryan McCalamien, PhD
Texas A&M University

TH Response
Model Development

Downstream Effects
Model Development

Bob Lutz
PWORG Lead

TBD
Lead PWORG

Piping Fracture
Mechanics

2/22/2011

Slide 3

Team Assignments

- Texas A&M
 - RCS full-power simulation and transient system response (boundary conditions for break simulation)
 - Fuel temp parameterizations
- University of Texas
 - Uncertainty Quantification (break frequency, etc)
 - Sampling and propagation strategies (CASA Grande)
 - Break Zone Simulation (CTH)
 - Pool velocity simulation (if needed)

Team Assignments

- Los Alamos National Laboratory
 - Containment response (if needed)
 - Sump screen performance
 - Develop CASA Grande analysis tool
- ABS
 - PRA modification and evaluation
 - Consultation regarding Risk-Informed implications
- Massachusetts Institute of Technology
 - Internal review of PRA and accident seq interface

Team Assignments

- Alion
 - As-built CAD
 - Compilation of test data report
 - Consultation on debris transport and sump performance
- STP
 - Plant data interface
 - Licensing strategy
 - Project management
 - Plant operations configuration and flexibility

Technical Analyses Overview

2/22/2011

Slide 7

Deterministic Evaluation Attributes

Predetermined scenarios are analyzed assumed to be “worst case” .

Decision-making is “absolute” - no uncertainty in the decision-making process.

Need for detailed analysis and full phenomenology understanding is avoided by assuming “conservative” values for parameters.

Probabilistic Evaluation Attributes

Full spectrum of scenarios is analyzed that covers wider range of possibilities. There is solid evidence in the scientific literature that probability is the best measure of uncertainty.


Uncertainty is integral to decision-making. Risk-based methods quantify both the uncertainty of the state of our knowledge and the variability in physical phenomena.

Detailed modeling and analysis is needed to properly characterize uncertainty.

Primary Project Objectives

- Obtain core damage frequency distribution for hypothesized LOCAs that require ECCS recirculation.
- Compare core damage frequency & large, early release frequency results for Potentially Sump Blocking Insulation & Non-Sump Blocking Insulation designs against the criteria of RG1.174
- Employ RG 1.174 strategy to provide risk informed closure of GSI-191
- Finalize plan for GSI-191 closure by mid 2012 for STP
- Develop a repeatable risk informed GSI-191 Closure Method

PRA Perspective

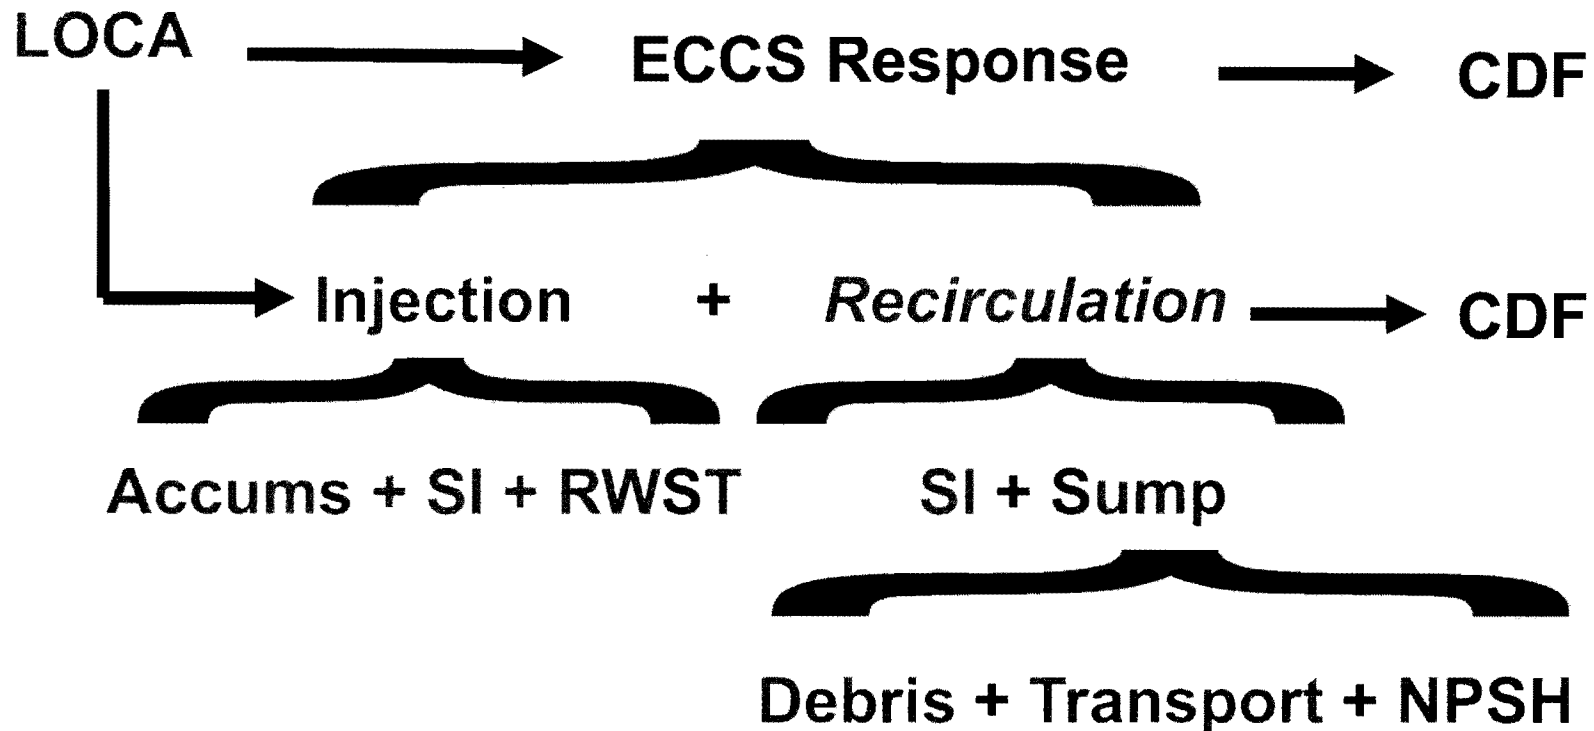

□ Documented probabilistic basis for risk quantifications

■ Area of uncertainty, need probabilistic distributions and commensurate technical basis

Technical Overview

- The risk-informed approach to GSI-191 closure requires development and integration of five major elements. Each of these elements has one or more technically challenging subtasks.
 - **DTSB**: generation and transport of debris to the sump. Resulting sump differential pressure
 - **TH**: RCS thermal-hydraulic response.
 - **DEM**: Downstream effects of debris getting through the sump screens and into the core, SI components.
 - **PRA**: A logic model that develops and quantifies the scenarios leading to core damage.
 - **Uncertainty Quantification (UQ)**: The propagation of uncertainty in the physics-based models, analysis of existing experimental data, expert elicitation, and formation of the input needed by the PRA.

Multiple Physics Models

Reactor TH
 Plant State Point
 Internal
 Obstructions
 Transient Blow

Down
 EOP Response

ZOI Formation
 Probability of
 Break
 Fracture
 Mechanics
 Jet Expansion

Jet Reflection

Containment
 Blow Down
 Transport
 Spray Actuation
 Environment P&T
 Wash Down

Transport

Sump Pool
 Debris Transport
 Debris Degradation
 Chemical Product
 Formation

Temperature History

Sump Screen
 Debris Accumulation
 Thin-Bed Formation
 Screen Penetration
 Face Velocity
 Porous Media Head
 Loss

NPSH_{margin}

Injection Systems
 Recirculation Demand
 NPSH_{reqd}
 Degraded Pump
 Performance
 Valve Wear
 Operability

Plant PRA
 LOCA Probability by
 Size/System
 Probable Loss of
 Recirculation

CDF and LERF

2/22/2011

Slide 12

PRA Model Overview

Overview of Approach

David Johnson

ABS Consulting Inc

ABS Consulting

AN ABS GROUP COMPANY


2/22/2011

Slide 13

Near term PRA Activities

- Develop expanded LOCA Event Trees
 - Detailed sequence of events associated with potential sump performance phenomena
 - Develop necessary logic structures to represent results from other team members
 - Support uncertainty calculation
- Integration of New Analyses
 - Utilize analyses from other team members
 - Use PRA framework to assist in technical direction of specialized analyses
- Use existing PRA model to identify potential analysis boundaries

LLOCA Event Sequence Diagram

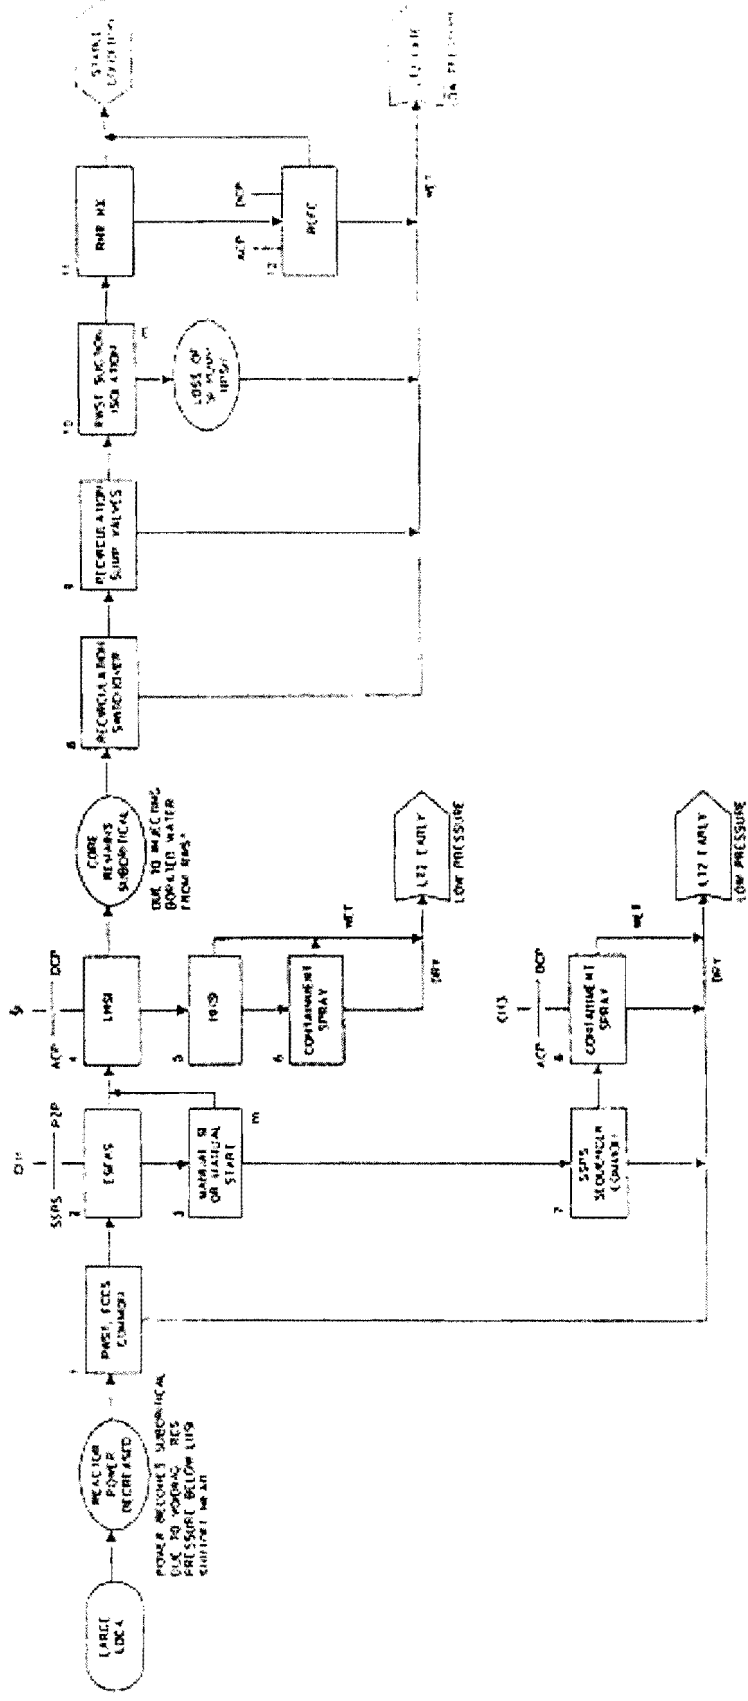

SI Recirculation Fault Tree (Top)

SI Recirculation System Fails
Top Event SIREC

G00MBA

Emergency Sump Plugs

SI PUMPS FAIL DURING
RECIRCULATION

SR SUMP_PLG_0001

G00MCB

SI RECIRC TRAIN A FAILS

SI RECIRC TRAIN B FAILS

SI RECIRC TRAIN C FAILS

G00MBC

G00MCC

G00MDC

1

2

3

G01MBA

From Page
4

G02MBA

From Page
3

G03MBA

From Page
2

Current and Future PRA Models

- Existing PRA
 - Does not explicitly address sump plugging phenomena
 - Does include a basic event ($1\text{E-}5$) to represent unavailability of sump; required for all sequences involving recirculation
 - At-power importance:
 - FV $4.1\text{E-}03$; RAW: $4.1\text{E+}02$ [CDF]
 - FV $2.4\text{E-}07$; RAW: $1.0\text{E+}00$ [LERF]
 - Does not address in-core phenomena of material passing strainer
- Current Effort
 - New model will depict detailed representation of phenomena
 - Aid in investigation
 - Assist in documentation of effort
 - Eventual incorporation into PRA model of record
 - Model may be higher level, as appropriate
 - Could result in revised initiator groupings

Example Source Material

- NUREG/CR-6771 GSI-191: The Impact of Debris Introduced Loss of ECCS Recirculation on PWR Core Damage Frequency; LANL (2002)
- ECCS Recirculation Performance Following Postulated LOCA Event: GSI-191 Expected Behavior; NEI (2009)




Considerations Include:

- Break characteristics
 - Location, size, failure mode, opening time, scenario timing
- Zone of influence
- Debris Characterization
 - Debris from insulation
 - Other debris
- Debris Transport and chemistry
- Accumulation at strainer/head loss
- Downstream Effects


Debris Transport & Sump Blockage (DTSB), Jet Formation Physics, and Uncertainty Quantification (UQ)

Elmira Popova, Erich Schneider: University of Texas at Austin
Bruce Letellier: Los Alamos National Laboratory

Accident Progression Overview

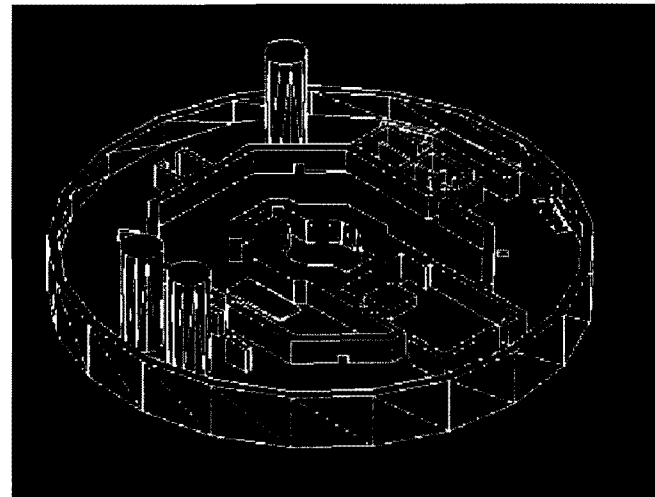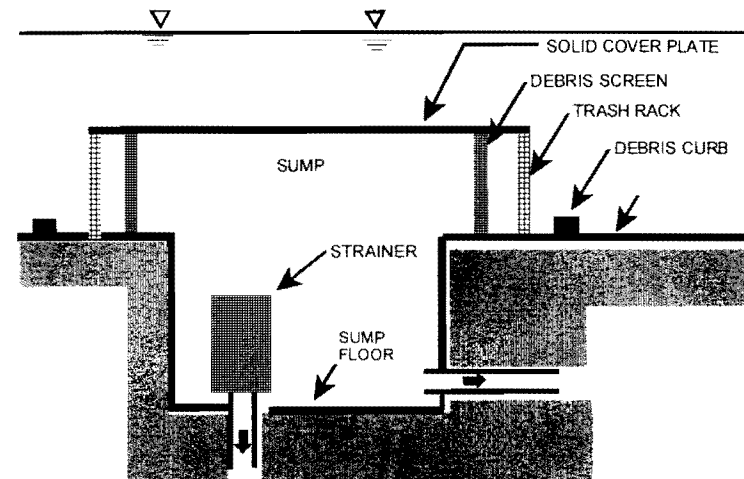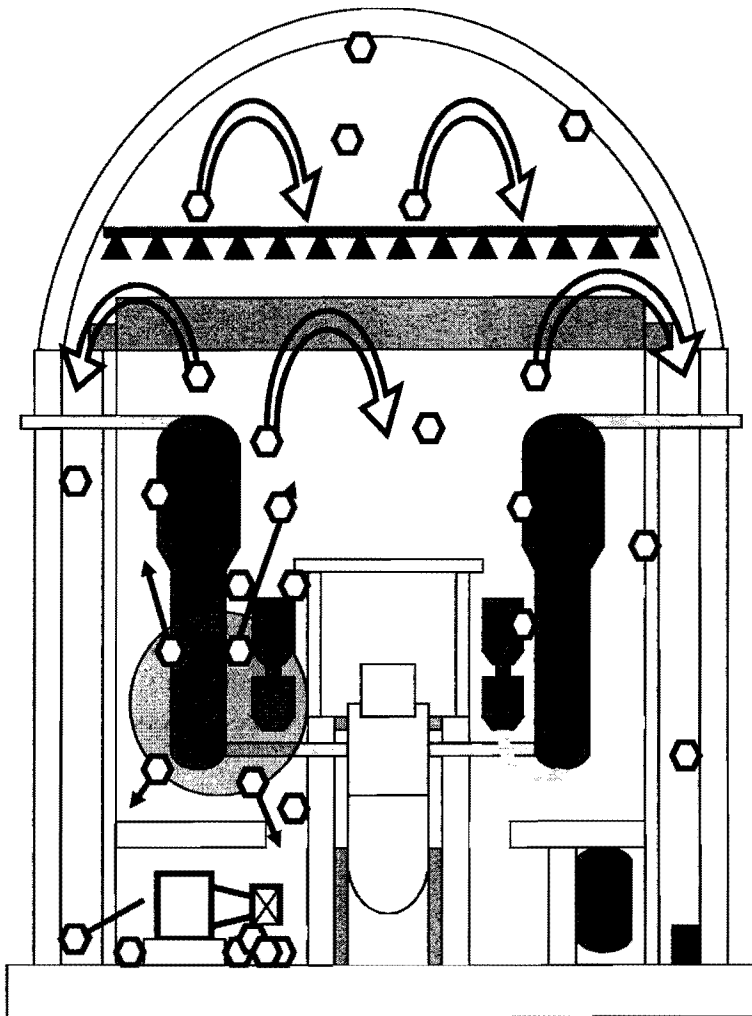


Conceptual Accident Propagation

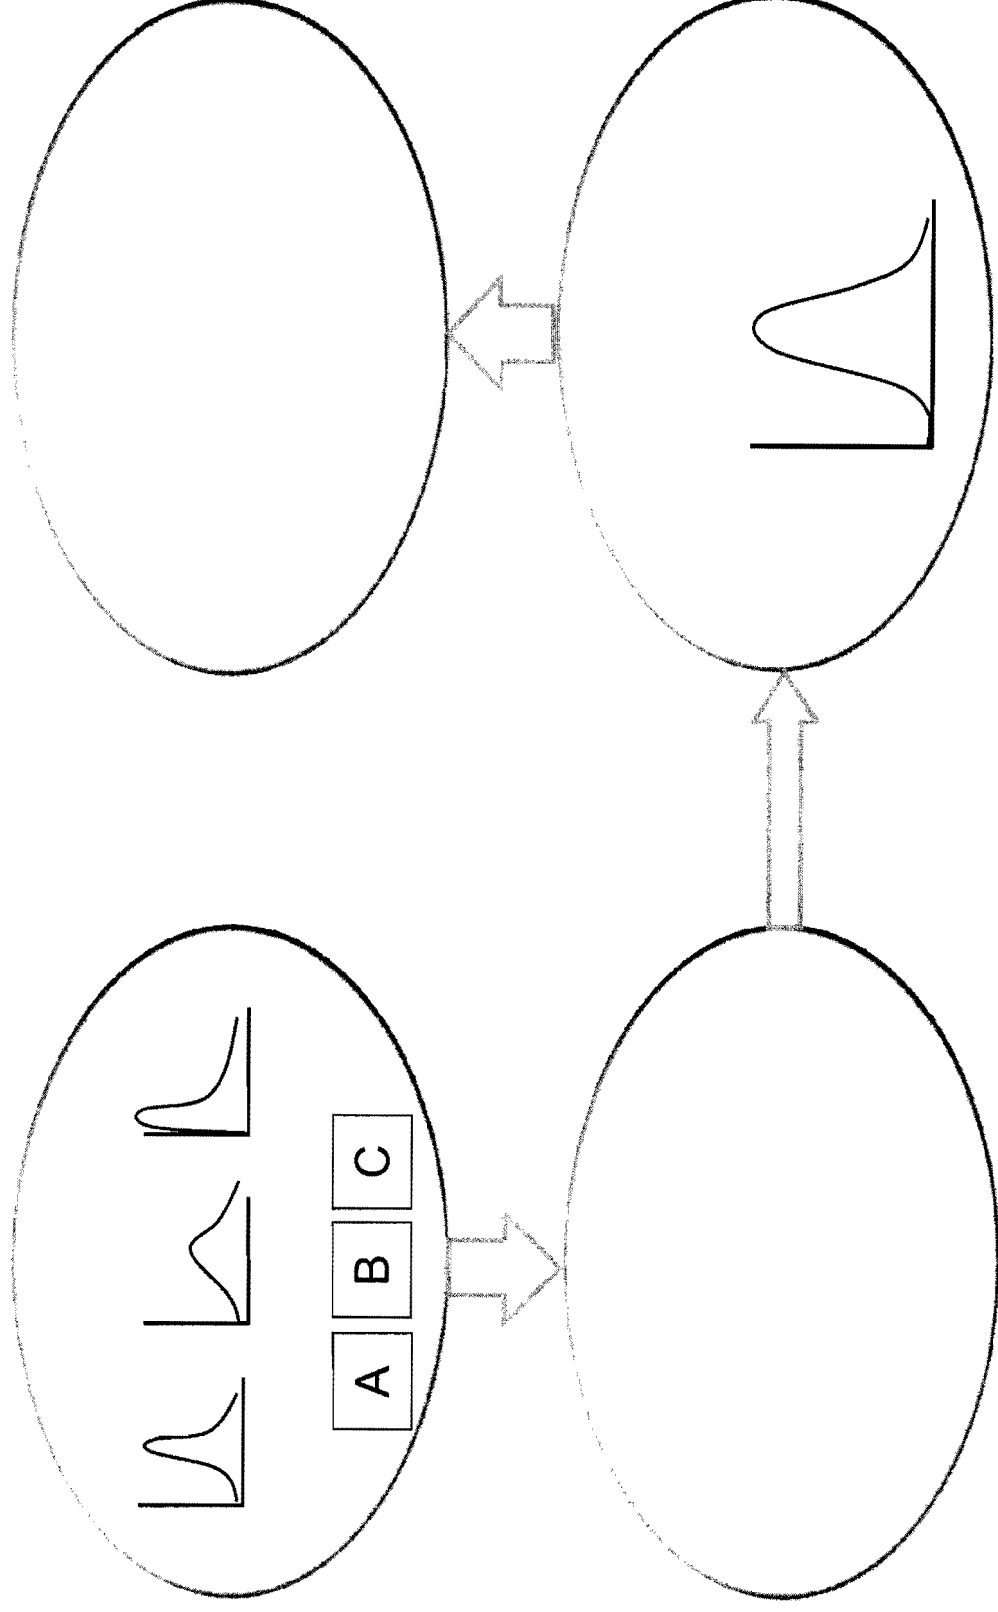

Interface to PRA

- Present PRA has only one top event directly related to GSI-191 (Recirculation Cooling)
- Traditionally assume recirculation failure leads directly to core damage
- Use physics models to define distributions and/or required split fractions (analogous to fault trees)
- Key Performance Metric (fixed NPSH margin):

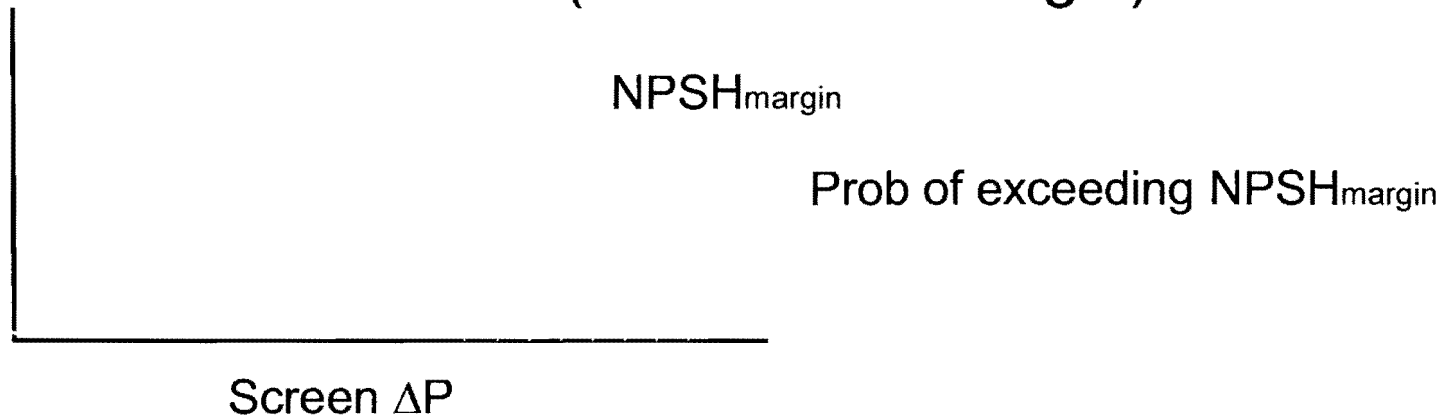

Refined PRA


- Downstream effects now raise additional Core Damage states
 - Channel-specific loss of cooling
 - Core average temp
 - Core pressure drop
- Must add top event for reactor flow effects
 - Need operational definition of Core Damage
 - Licensing basis
 - Alternate source term

Technical Strategies

1. Break frequency refinement
2. ZOI estimation
 - Implement spherical approx while improving jet model
3. Sump screen performance
 - Conservatively ignore overpressure credit
4. Degraded pump performance
 - Assume licensing basis failure
5. Reactor flow metrics
 - Parameterize core-wide and fuel assembly blockage
6. PRA refinement for rotating trains
7. PRA refinement for core damage states

Jet Formation Physics: Spherical Approximation

- Conservation of volume enclosed by stagnation pressure isobars (e.g. via ANSI standard ANS88) leads to spherical ZOI approximation
 - ANSI standard addresses freely-expanding jets
 - exhibits (conservative) inconsistencies for small or off-center targets, discontinuities in pressure gradient

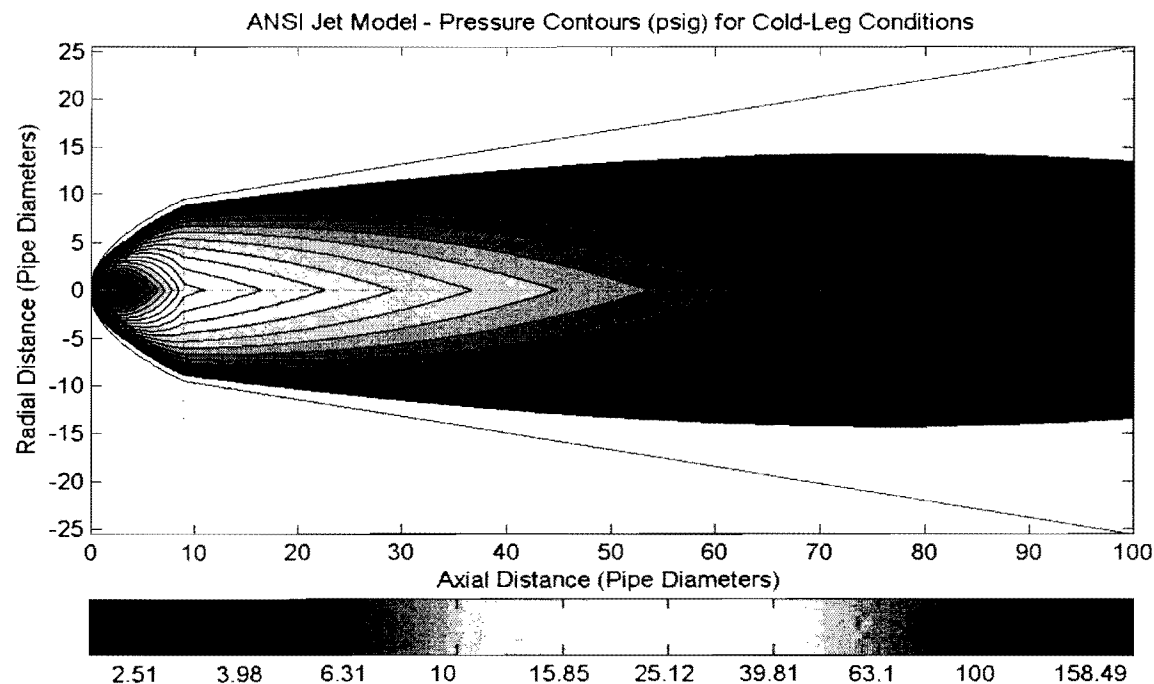

01/27/2011

Slide 27

Jet Formation Physics: CFD-Guided Parameterization

- CFD can depict velocity field, two-phase jet characteristics that are beyond scope of ANSI model
 - conventional CFD codes cannot simulate important shock and multiphase phenomena
 - **CTH** (SNL) treats the strong-shock, high-pressure, liquid-vapor regime
- Will allow time-dependent break effects and jet impingement / deflection to be investigated
- Use response surface methodology to obtain **ZOI reduced order model (ROM)**
 - quantify boundaries of reliability of the ANSI model
 - correlate a minimal set of explanatory variables to the response (pressure contours)

ZOI Reduced Order Model (ROM): Summary

- Seek Improvements to ANSI Standard – Simplistic and free expansion only.
- Two-phase CFD computationally expensive
- Limited test data (STP + Westinghouse)
- TH state points will vary by break location
- Rupture time and extent will control jet development
- Debris generation controls sequence outcome
- Reflected jet cases will be run to confirm conservatism of equal pressure-volume mapping
- ROM for free jet will facilitate hundreds of break evaluations

UQ – main research directions

- Modeling and propagation of uncertainty in the physics-based models
- Collection and analysis of existing experimental data
- Elicitation and analysis of experts' opinion for cases when there are no real data or published results
- Locating areas where further experimentation and/or analysis is needed

UQ in physics models

- Initially the models will be conservatively approximated and refined as needed to address dominant uncertainties. The framework to address the UQ in physics models will consists of four parts:
 - Uncertainty analysis: quantification of the overall uncertainty in model outputs.
 - Sensitivity analysis and value of information: how the model outputs respond to inputs. How much each uncertain factor impacts the decision-making.
 - Calibration and data assimilation: the process of adjusting the uncertain model parameters to match the model to observed data.
 - Validation



Uncertainty Propagation Tools

- Dakota and Psuade noninvasive sampling tools
- Objective directed Latin Hypercube Sampling
- Create our own sampling and analysis tools if necessary

Multivariate uncertainties and their mapping to PRA models

- This problem might have many multivariate uncertainties possibly important to uncertainty quantification
 - Uncertainty in containment pressure is dependent on the uncertainty in break flow rate.
 - Uncertainty in sump differential pressure is dependent on the uncertainty in fluid temperature (in turn, is dependent on containment temperature - break flow).
 - Uncertainty in fuel pin failures is dependent on uncertainty in ECCS flow and uncertainty in sump screen particulate penetration.

Multivariate uncertainties and their mapping to PRA models

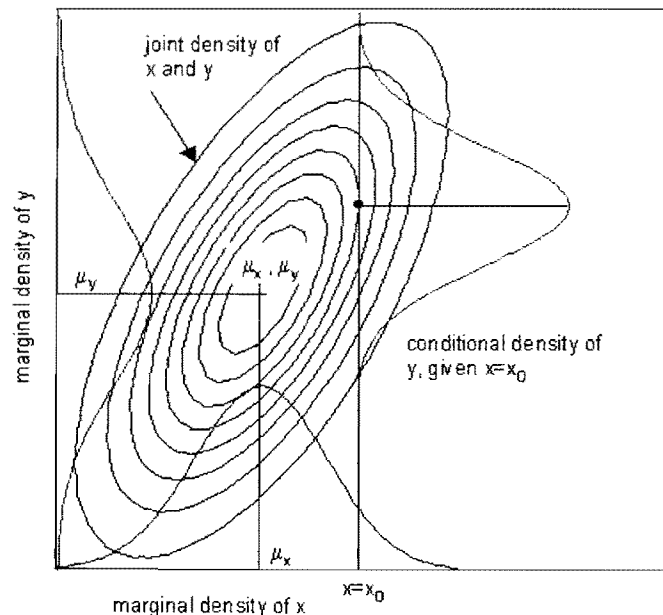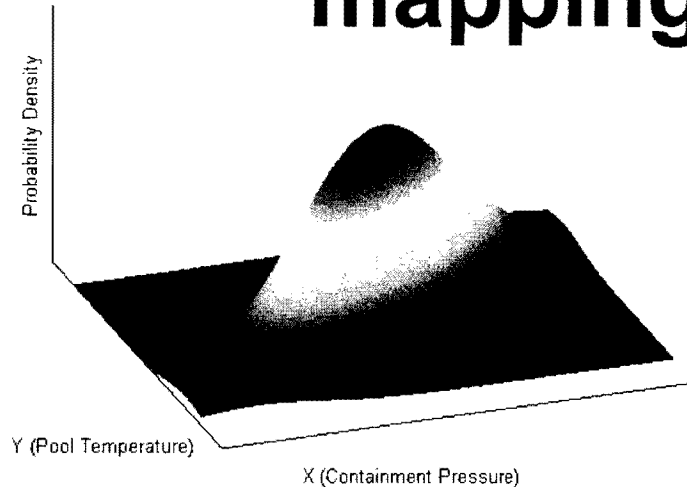

- Standard inputs for PRA analysis are discrete conditional probabilities
- They are computed from conditional distributions (densities)
- Conditional densities are computed from the joint distribution function (density)
- Example shows two uncertain variables with a positive correlation
- We propose conditional probability of NPSH_{margin} loss as one important interface to the PRA

Performance Measures

- Computable as point values:
 - Continuous, ex. screen head loss, max pin temp
 - Categorical, ex. low, med, hi debris penetration
 - Binomial, ex. spray trip (yes/no)
- Can view as joint prob. of plant response
 - Marginalize to isolate any subset of 1 or more
 - Diagnose sensitivity to plant variables
 - Exploit correlations

Performance Measures

- CDF and LERF are top-level desired metrics, but intermediate measures are regulated and may serve as “pinch points” for aggregation and resampling to propagate variability

- | | |
|---|-------------------------------|
| 1. Loss of $NPSH_{Req}$ | 7. Valve failure from erosion |
| 2. Loss of adequate flow | 8. PRA failures |
| 3. Pump Cavitation | Pump start |
| 4. ΔP_{core} because of internal debris | Recirculation alignment |
| 5. Peak pin temp | Spray actuation |
| 6. Failed cladding | 9. Air ingestion |
| | Vortexing |
| | Deaeration |

- Can imagine a joint probability distribution function for all of these

Stochastic Wrapper – CASA Grande


Containment Accident Stochastic Analysis

- Develop a “stochastic wrapper” that would integrate the different models developed in the core damage frequency analysis in such a way that the appropriate distributions are made available to the event tree logic structure.
- Containment Accident Stochastic Analysis (CASA) Grande will function as a supplementary event tree to track debris fate
- CASA Grande will combine all uncertainties:
 - From the uncertainty propagation in the physics models
 - From statistical analysis of available experimental data
 - From analysis of information elicited from experts
 - We will use Bayesian methods and analysis to perform the above tasks
- Bayes Context:
 - Prior space of uncertain parameters is mapped by physical Likelihood into Posterior plant performance measures


CASA Grande


- Grounded in plant CAD visualization
 - CAD defines spatial coordinates of:
 - Energized piping runs – potential break locations
 - Plant system, diameter, temp, pressure
 - Insulation – debris formation targets
 - Product, thickness, jacketing, banding
 - Coatings – thickness, quality
 - Concrete barriers – jet redirection
 - Gratings – debris retention
 - Pool geometry
 - Sump screen location, configuration

CASA Grande Prototype

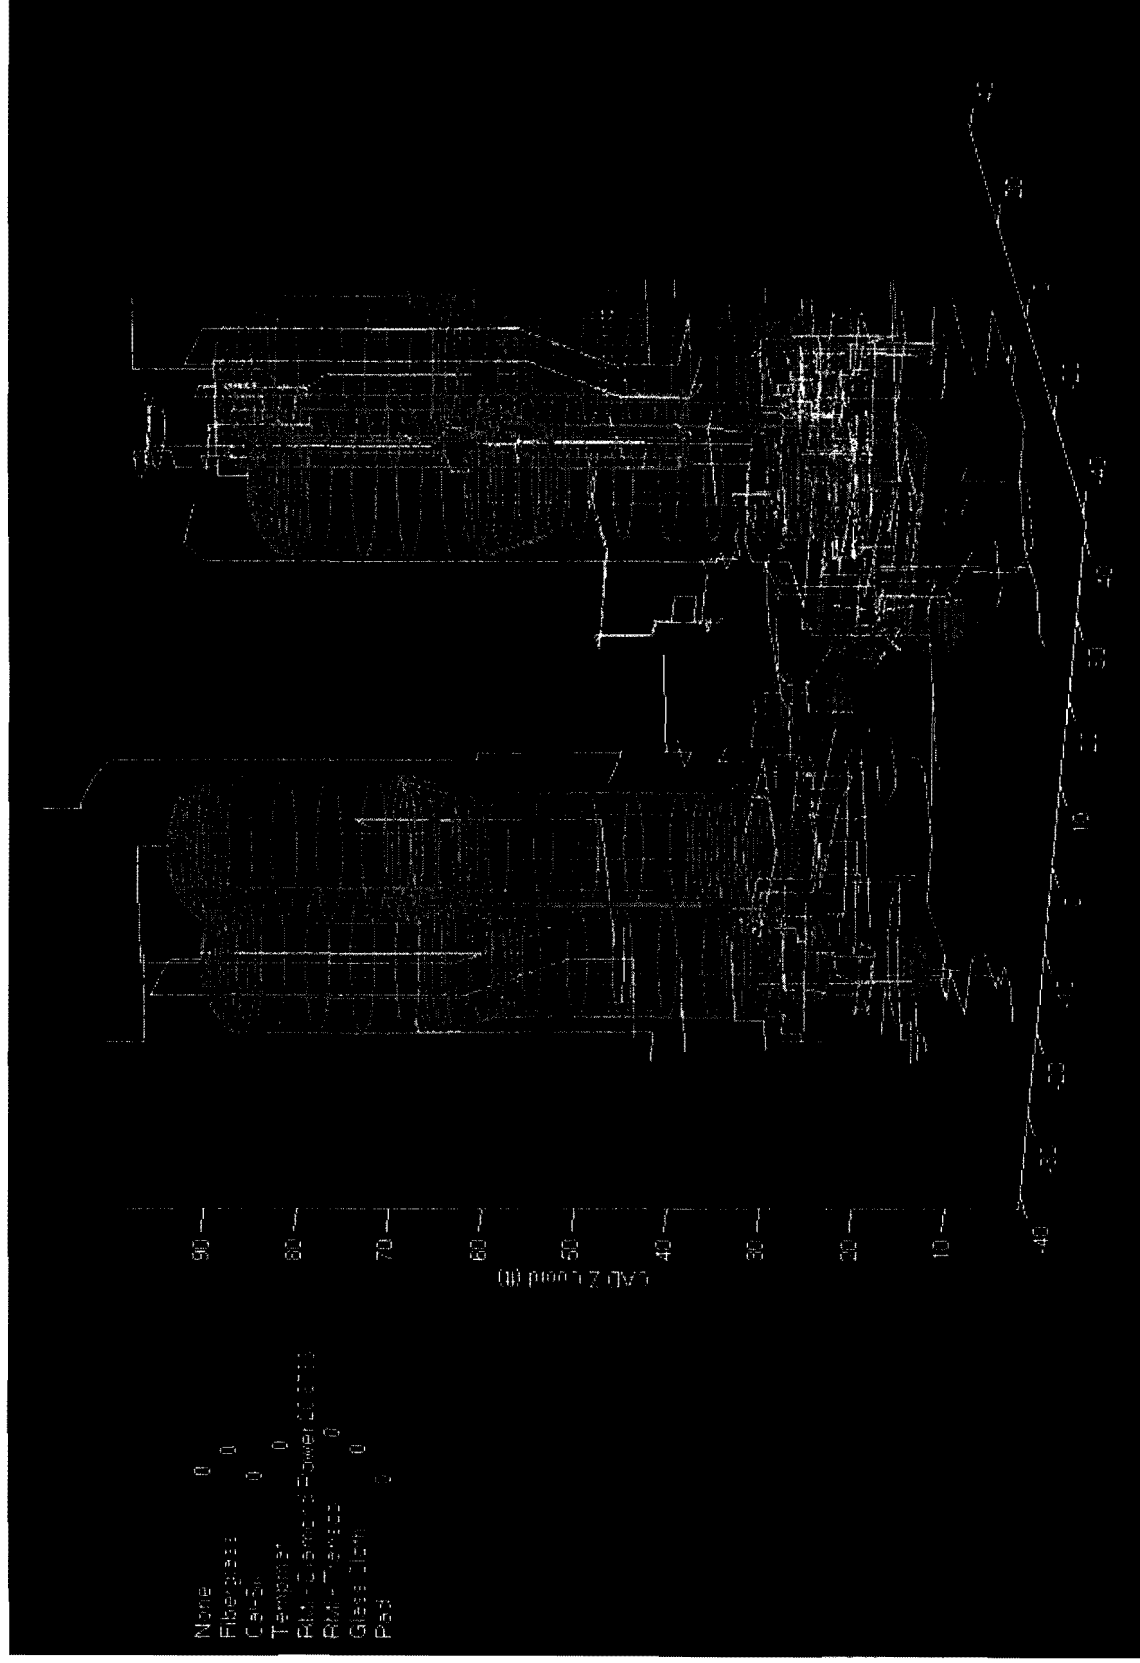

Prototypical Debris Distribution from Spherical ZOI

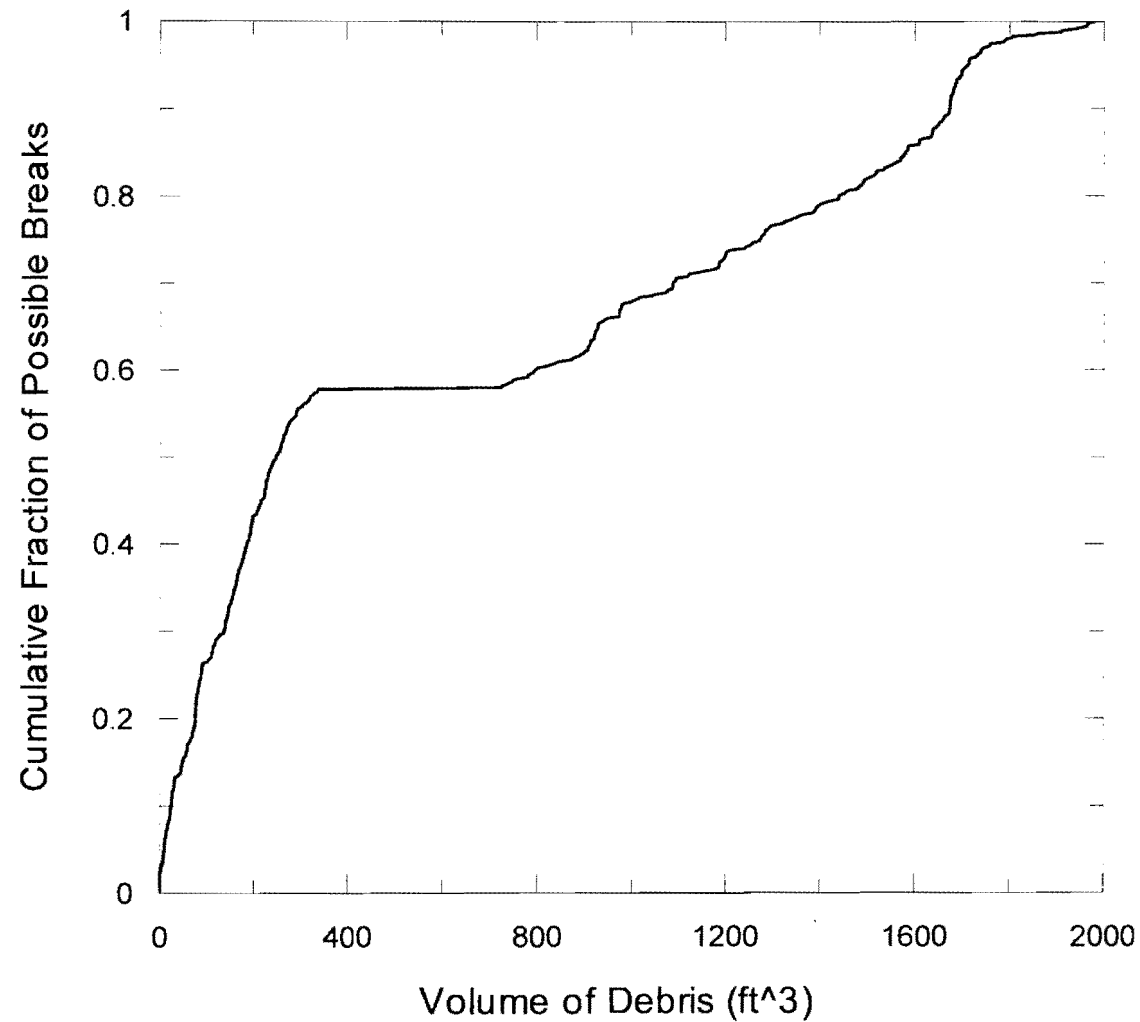



Thermohydraulic (T/H) and Downstream Effects Analyses Overview

Dr. Y. Hassan
Texas A&M University

Thermal-Hydraulic Analysis – Project Requirements

- Analysis of the System Response during Loss of Coolant Accident (LOCA)
 - 1) Different Break Locations
 - 2) Different Break Sizes
 - 3) ECCS and Plant system response
- Sensitivity Analysis (SA):
 - Range of Conditions at which Recirculation is required
 - Time to Recirculation
 - Time to Containment Spray Initiation
- Uncertainty Quantification (UQ)
- Providing Boundary Conditions for the Jet Model Development


Thermal-Hydraulic Analysis – Tools

- **RELAP5-3D** will be mainly used to perform the Thermo-Hydraulic Calculations
 - ✓ Basic STP Plant Nodalization Already Available
 - ✓ Steady-State Analysis already Started
- **RELAP5-3D** will be Coupled with **DAKOTA** in order to perform Sensitivity Analysis (SA) and Uncertainty Quantification (UQ)

Thermal-Hydraulic Analysis – Tools

- **DAKOTA** is a tool that will allow batch processing of a large number of RELAP5-3D calculations
 - This is accomplished via modifying RELAP5-3D input files to change parameters of calculation (e.g. break size, break location)
 - As a result we obtain the range of conditions that require recirculation.
- **DAKOTA** is a tool with wide usage at the DOE-NNSA labs and the wider community.
 - It has a strong foundation of verification and validation.

RELAP5-3D Primary System Nodalization (Steady-State)

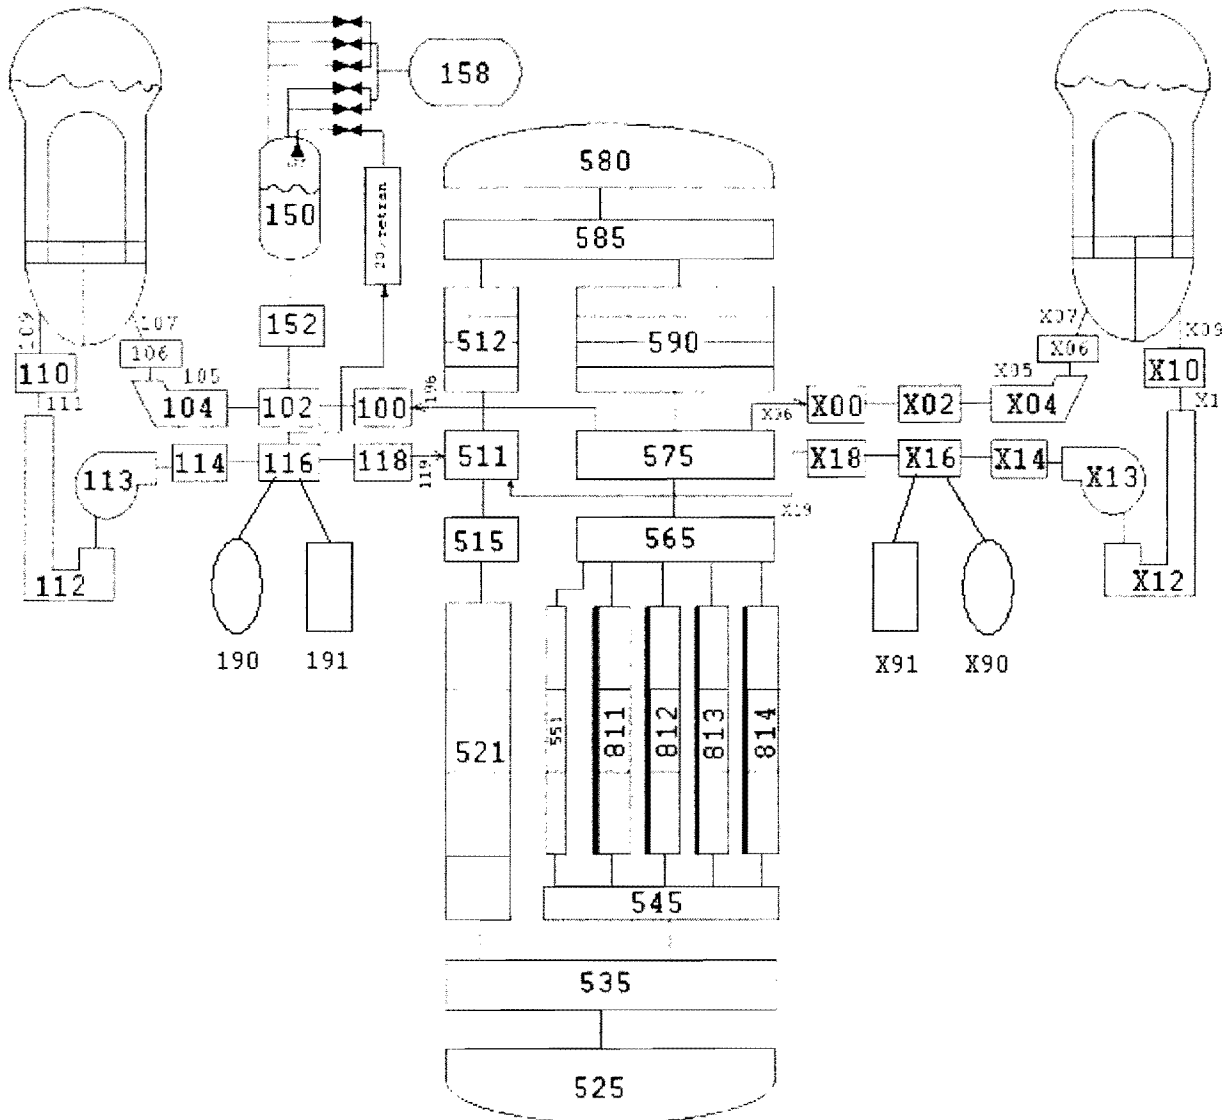

4 Independent Loops:

12 Components

27 Nodes

1 Heat Structure

Reactor Vessel:

17 Components

32 Nodes

4 Heat Structures

of which in *Active Core*:

4 Pipes

4 Heat Structures

Point Reactor Kinetic

Pressurizer:


2 Components

4 Nodes

Tot. Components: 67

Tot. Nodes: 144

Tot. Heat Structures: 8

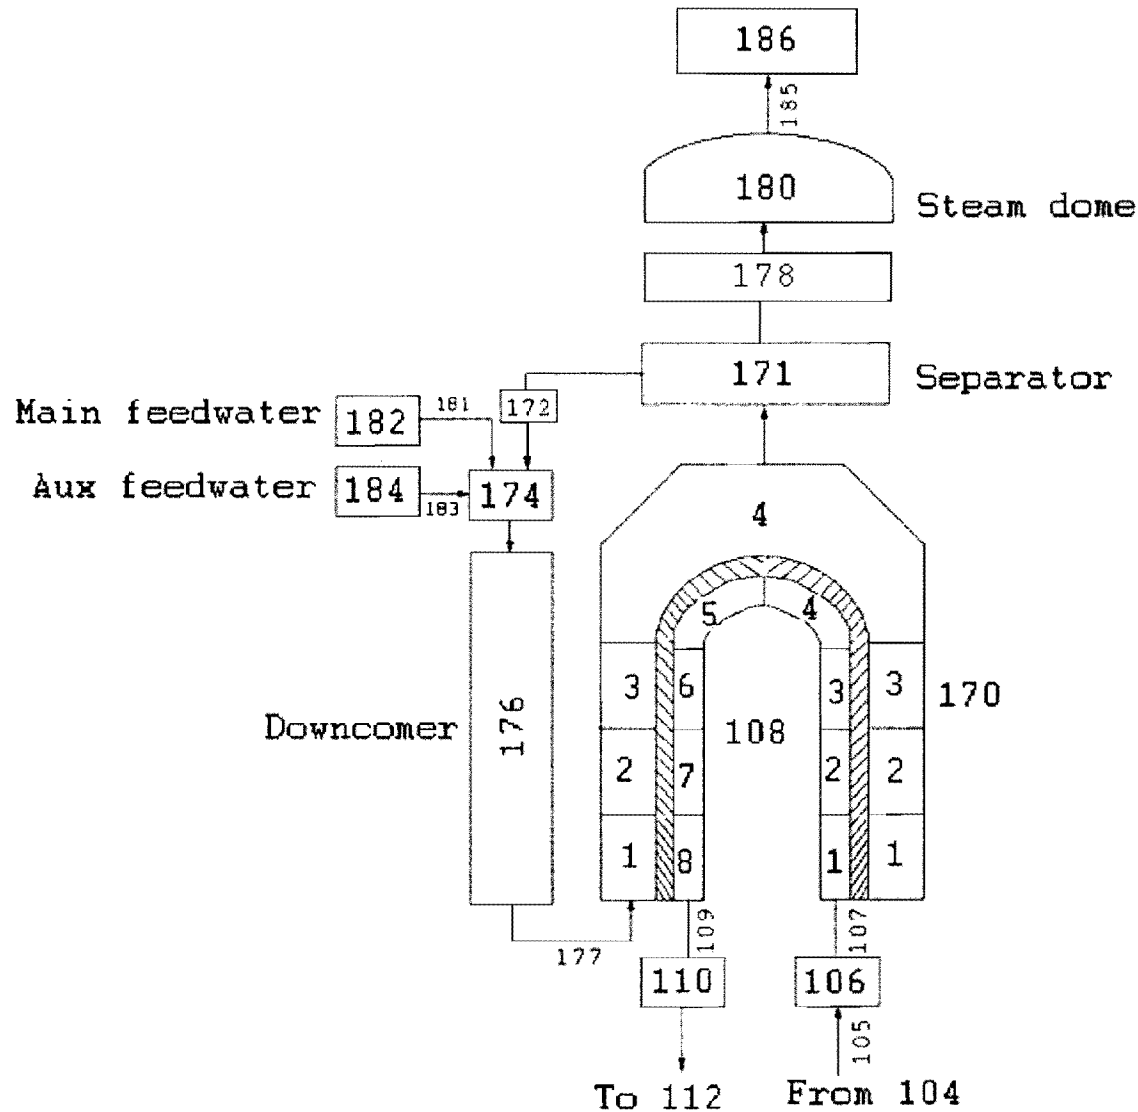

Secondary Section (x4):

10 Components

13 Nodes

Full Plant Nodalization Summary:

Tot. Components: 109

Tot. Nodes:	196
--------------------	-----

Tot. Junctions: 49**Tot. Heat Structures: 8**

RELAP5-3D / RETRAN Steady-State Comparison

	PLANT	RETRAN	RELAP5-3D
Reactor Coolant Pressure [psia]	2250	2244	2271
Loop Mass Flow Rate [lbm/s]	10084	10016	10108
Vessel Outlet Coolant Temperature [°F]	623	597	624
Vessel Intlet Coolant Temperature [°F]	561	526	561

Downstream Effects Analysis – Project Requirements

- Analysis of the Effects induced by Debris Deposition and Accumulation in the Primary System
- Identify Success Criteria (i.e. Failed Fuel Pins)
- Other issues (for example ECCS component reliability will be considered)

Downstream Effects Analysis – Tools

- Computational Fluid Dynamics (**CFD**)
- Overall System Response Analysis will be performed using **RELAP5-3D**
- **DAKOTA** can be used in both the CFD and system response portions of this analysis

Communication & Milestone Plan

2/22/2011

Slide 50

Milestone Plan

- **2010 October - November**
 - *Meet with Regulator to propose risk-based licensing strategy**
 - *Obtain plant stakeholder buy-in to risk approach*
 - *Presented plan to PRT*
- **2010 December 2010**
 - *Project Plan developed, contract negotiation for 2011 work.*
 - *Contract negotiations for work in 2011 commenced*
 - *Project Team meeting to develop work breakdown and best-guess schedule.*
 - *NRC Commission issues SRM recommending risk informed approach to complete resolution of GSI-191*
- **2011 January – February**
 - Final Contract negotiations completed
 - *Project Team meeting to finalize inter-model communication (TH, DTSB, DEM)*
 - ***NRC Public Meeting January 27th at NRC HQ***
 - Formal Kick-Off Meeting with NRC to communicate risk-based approach plan
 - Licensing strategy finalized (Regulator concurrence).
 - Data & Information from STP to Project Team (FSAR data, latent debris loading, water balance, etc.)
 - TH model development (jet boundary condition, downstream effects models)

*Italics indicates actual completion

Milestone Plan (continued)

- **2011 March – April**
 - Review Report of available literature - pipe fracture mechanics (**Deliverable**)
 - Best estimate of pipe failure distribution (opening rate, size, geometry)
 - Provide break characterization to TH group.
- **2011 May - June**
 - CAD Model description of containment/piping with insulation burden
 - Pipe failure distribution (locations, rates, likelihoods) input development for DTSB model.
 - Containment response finalized (primarily sump fluid temperature).

Milestone Plan (continued)

- **2011 May - August**
 - Minimum break size requiring recirculation phase
 - TH response spectrum complete (**Deliverable**)
 - Complete uncertainty distributions for all supporting analyses
 - Complete all preliminary TH/DEM calculations
 - Revise LOCA break frequencies based on the above
- **2011 September – November**
 - PRA Model incorporation complete.
 - **INITIAL QUANTIFICATION (DELIVERABLE).**
 - Evaluate results & recommend path forward (risk informed or not)
- **2011 December**
 - Incorporate feedback from internal reviews.
 - Executive report for Regulator/Industry review.

2012 - 2013 Plan

- Will be based on 2011 initial quantification results and interactions with NRC
- Emphasis and scope will be on areas where highest uncertainties remain
- May require additional testing and/or experiments

Requirements for a Robust Risk Analysis

- Realistic models are needed to properly characterize uncertainty in our state of knowledge and variability in phenomenology.
- Additional effort is required to identify and subsequently reduce uncertainty (if possible) in otherwise acceptable (mean value) failure scenarios with large “tails”.
- An enormous number of scenarios (as opposed to a single deterministic methodology) are required to be analyzed and understood for a complete risk analysis.
- Additional information (important measurements, ranges, types) may be required to focus on phenomenology contributing most to uncertainty and/or levels of risk.

SUMMARY

- A risk informed approach for closing GSI-191 has been developed which will employ robust probabilistic methods
- A highly qualified and specialized team has been assembled to undertake this project
- A project plan has been developed with milestones for regulatory/industry communication and project completion
- The intent of the project will be to develop a risk informed GSI-191 closure process that can be replicated by others

ACTIONS

<u>Action</u>	<u>Responsibility</u>	<u>Date Needed</u>

TECHNICAL BACKUP SLIDES

2/22/2011

Slide 58

Closure Strategy

- Place GSI-191 related risk contributors in context of plant-wide PRA. *Then*, interpret Δ CDF and Δ LERF using RG 1.174
- Describe accident sequence phenomena in probabilistic terms based on present state of knowledge and variability in available data
- Propagate uncertainty to distributions of plant performance that link naturally to a refined PRA
 - LOCA frequency to credit fracture mechanics and inspection procedures
 - Introduce operator option to rotate between trains

Team Assignments

- Texas A&M
 - RCS full-power simulation and transient system response (boundary conditions for break simulation)
 - Fuel temp parameterizations
- University of Texas
 - Uncertainty Quantification (break frequency, etc)
 - Sampling and propagation strategies (CASA Grande)
 - Break Zone Simulation (CTH)
 - Pool velocity simulation (if needed)

Team Assignments

- Los Alamos National Laboratory
 - Containment response (if needed)
 - Sump screen performance
 - Develop CASA Grande analysis tool
- ABS
 - PRA modification and evaluation
 - Consultation regarding Risk-Informed implications
- Massachusetts Institute of Technology
 - Internal review of PRA and accident seq interface

Team Assignments

- Alion
 - As-built CAD
 - Compilation of test data report
 - Consultation on debris transport and sump performance
- STP
 - Plant data interface
 - Licensing strategy
 - Project management
 - Plant operations configuration and flexibility

Biographical Backgrounds

- Project Management
- Technical Team

C. R. (Rick) Grantom

Mr. C.R. (Rick) Grantom is the Manager of Risk Management Projects at the South Texas Project Electric Generating Station in Wadsworth, Texas. Mr. Grantom has been responsible for the development, application, implementation, and overall management of STP's Risk Management programs, the STP PRA, and the station's risk and reliability analysis programs. He is currently focused on developing a risk informed approach supporting GSI-191 closure as well as other strategic risk initiatives. He has over 30 years of nuclear power plant experience, 27 of which are directly related to risk management methods and their application to nuclear power plants.

In the past Mr. Grantom has had direct involvement in the development, approval, and implementation of several key risk informed initiatives at the South Texas Project. These risk informed application areas include: Plant Configuration Risk Management; Exemption from Special Treatment Requirements (Prototype Pilot); Risk Managed Technical Specifications, 4B (Industry Pilot); Owner Controlled Surveillance Frequency Program, 5B.

In addition to his duties at the South Texas Project, he is the Co-Chairman of the ASME/ANS Joint Committee on Nuclear Risk Management, an ex-officio member of the ASME Board on Nuclear Codes and Standard, the Vice-Chair of the EPRI Risk and Safety Management Technical Advisory Committee, and the STARS Risk Management Team Leader.

Mr. Grantom holds a B.S. Degree in Nuclear Engineering from Texas A&M University and is a registered Professional Nuclear Engineer in the State of Texas.

Technical Team

Principal Investigator Backgrounds

Dr Elmira Popova

Dr. Elmira Popova is Robert and Jane Mitchell Endowed Professor in Mechanical Engineering at University of Texas at Austin. She graduated with MS in Mathematics from University of Sofia, Bulgaria in 1985, and PhD in Operations Research from Case Western Reserve University, Cleveland, OH in 1995. In 2008 she was named a Fulbright Scholar and in 1999 she was given the Halliburton/Brown & Root young faculty excellence award in teaching and research. Dr. Popova specializes in stochastic processes, computational Bayesian statistics, and stochastic optimization. She is interested in reliability analysis and design of optimal maintenance strategies for randomly failing systems.

Since 2004 she has collaborated with the Risk Management group at South Texas Project Nuclear Operating Company on designing and developing a new risk-informed system for reliability estimation and preventive maintenance scheduling. The main objective of the Risk Informed Asset Management program is: to make optimal risk-informed decisions at both operational and executive management levels by taking into account budget, internal project dependencies, outage duration, and regulatory safety constraints; to appropriately model and include the uncertainty related to rates of return on investments, energy prices, failure mechanisms, and costs for replacement and spare parts; and to provide decision-makers quantified feedback on decision-making performance. A preliminary version of the system is currently being tested by their systems engineers. Dr. Popova's research has been funded by NSF, DND, NRC, DOE, STPNOC, EPRI, and several other industrial sponsors.

Dr. Bruce Letellier

Dr Letellier has been employed at Los Alamos National Laboratory for 21 years as a member of the Probabilistic Risk Analysis (PRA) Group where he has performed accident-phenomenology and health-consequence modeling for weapon-system and facility safety studies including both commercial and research nuclear reactors. He recently served as team leader of a multidisciplinary effort to support the U.S. NRC in the research and regulatory resolution of generic safety issue (GSI) 191 that involves loss of recirculation sumps during a LOCA. GSI research included (1) integrated chemical effects testing involving a series of 30-day, closed-loop, simulations of reactor accident environments, (2) measurement and theoretical prediction of pressure loss in prototypical debris beds, (3) computational fluid dynamics (CFD) simulations of complex flow geometries in pressurized-water-reactor containment buildings, and (4) reactor system risk assessments to quantify the impacts of operator recovery actions in response to loss of a primary recirculation system. Modeling and simulation experience relevant to this project include containment transient accident analysis using MELCOR, thermal hydraulic jet expansion using CTH, and CFD studies using both FLUENT and FLOW-3D. Present work includes uncertainty quantification and PRA for complex engineered systems associated with capture and sequestration of carbon dioxide. Letellier holds B.S., M.S. and PhD degrees in nuclear engineering from Kansas State University where he completed his dissertation on Bayesian inversion of gamma-ray spectra to determine contamination profiles in soil.

Dr. Erich Schneider

Dr Schneider received his PhD from Cornell University in 2002 and joined the UT-Austin faculty in 2006. He has been involved in nuclear fuel cycle systems analysis under Fuel Cycle Research and Development and its predecessors since he joined the staff at Los Alamos in 2002. While at LANL, he contributed to zone of influence (ZOI) model development and characterization for NRC Generic Safety Issue 191, "Assessment of Debris Accumulation on PWR Sump Performance." He has been a RELAP5 user for over 15 years, beginning with RSCS model implementation and loss of offsite power scenario analyses for the proposed Advanced Neutron Source Reactor at ORNL. He co-developed a methodology for characterizing coupled neutronic-thermal performance of experiments in the ATR National Scientific User Facility. Most recently, he mentored an IAEA Fellow who implemented a TRACE model of the 1.1 MW TRIGA research reactor at UT-Austin. Dr. Schneider has presented to the ANTT Subcommittee of NERAC, been invited to brief NE-1 Dr. Pete Miller, and testified before the fuel cycle subcommittee of the Blue Ribbon Commission on America's Nuclear Future.

Dr Yassin Hassan

Yassin Hassan is Professor and Associate Department Head of the Department of Nuclear Engineering and also Professor of the Department of Mechanical Engineering at Texas A&M University. He received his Ph.D. and MS in nuclear engineering from University of Illinois, and MS in mechanical engineering from University of Virginia. Prior to joining Texas A&M September 1986, he worked for seven years at Nuclear Power Division, Babcock & Wilcox Company, Lynchburg, Virginia. His research is in computational and experimental thermal hydraulics, reactor safety, laser-based flow visualization and diagnostic imaging techniques, system modeling, transient and accident analyses, advanced nuclear reactors and aerosol dynamics. He is the editor-in-chief of the premier Nuclear Engineering and Design Journal.

He serves as a technical expert for the International Atomic Energy Agency, national laboratories and a number of other technical review panels. He has served as adjunct professor at several international universities. He is awarded the 2008 American Nuclear Society Seaborg Medal, the 2003 George Westinghouse Gold Medal award, and the 2004 Thermal Hydraulics Technical Achievement award.

David Johnson, Vice President, Quantitative Risk Analysis and Management

David Johnson, ScD, is the Vice President leading the Quantitative Risk Analysis and Management Competency Center. He has more than 30 years experience in providing risk-informed information to decision-makers.

Prior to joining ABS Consulting, Dr. Johnson was Vice President and Chief Scientist of PLG, one of the world's leading risk management firms. He led the development of probabilistic risk models for commercial nuclear power plants as well as for several research reactors. He has contributed to the development of risk management methods. He was also actively involved in the adaptation and use of quantitative risk analysis to DOE and DoD applications.

Prior to PLG, Dr. Johnson was a Fellow of the Advisory Committee on Reactor Safeguards where he contributed to the Committee's evaluation of the use of operational experience in risk management and the development of the ACRS quantitative safety goals. He currently serves on the Board of Directors of the International Association for Probabilistic Safety Assessment and Management. Dr. Johnson received his bachelor's degree in Nuclear Engineering Sciences from the University of Florida and his masters and doctorate degrees from the Massachusetts Institute of Technology in Nuclear Engineering with a specialty in Applied Radiation Physics.

Ernie Kee

Mr Kee has spent twenty five years in light water reactor operations, research, performance evaluation, and maintenance. His operation experience includes commercial pressurized water reactor and US Navy applications. The research experience includes experiment design and analysis support using reactor safety codes such as TRAC and RELAP5 for transient analyses on commercial and experimental reactors in the US and abroad. Performance evaluation experience includes routine field measurements of reactor operating parameters using installed plant instrumentation, plant chemistry data analysis for fuel performance, and special test support for trouble shooting fuel modifications. Maintenance experience includes trouble shooting, corrective maintenance, and overhaul on US Navy nuclear submarine mechanical systems. Currently supervise four full time engineering (two undergraduate, one Master's, and one PhD) and one graduate (mathematics) employees in the Risk Management group at STP. The group develops, implements, and trains (STP Operations, Maintenance, and Engineering staff) on the methodologies used at STP to evaluate on-line configuration risk. These methodologies implement quantitative analysis for NRC Initiative 4b, Initiative 5b, NRC Maintenance Rule, INPO Mitigating Systems Performance Indicators (MSPI), and internal risk measures (Risk Index and Work Week Risk). Also regularly supervise University interns (both graduate and undergraduate) during the summer break. Indirectly supervise a post-doctoral employee in cooperation under TEES grants funded by STP.

Risk Informed GSI-191 NRC Kick-Off Meeting

NRC Public Meeting
February 22, 2011

South Texas Project
C. Rick Grantom P.E.
Project Manager

Kick-Off Meeting Desired Outcomes

- Gain alignment and better understanding with NRC on risk informed approach
- Overview the technical models that will be used in performing the risk informed approach
- Establish NRC points of contact for performing necessary reviews
- Establish next steps for pilot designation
- Establish communication & milestone plan

Rick Grantom, PE
Project Lead

Mike Golay, PhD
Oversight Lead

TBD

Independent Oversight

Jamie Paul
STP Licensing

Define Licensing
Approach

Identify required
Licensing Needs

Regulatory Interface
Support

Shawn Rodgers
STP PRA

PRA Model
Development

Identify required
Distributions/Data

PRA Model
Quantification

Ernie Kee
STP Technical

Uncertainty Model
Development

Identify Required
Modeling Needs

Produce Required
Distributions & Success
Criteria

Wes Schultz
STP Design

Piping Configuration

Insulation and Coating
Loadings, etc.

Containment
Configuration/Design

Equipment
Configuration/Design

Todd Anselmi
Deterministic Analysis Lead

David Johnson, ScD
PRA Lead

Jim Liming
ABS Consulting

Event tree
Model Development
Probabilistic pipe break
Model Development

PRA Quantification
CDF/LELF

Bob Lutz
PWORG Lead

TBD
Lead PWORG

Chemical Effects
Testing

Sump Blockage
Testing

Coordination
PWORG

Elmira Popova, PhD
DTSB Lead

Julia Day
UT Austin

Bruce Letellier, PhD
Los Alamos National Laboratory

Debris Generation
Model Development

Debris Transport
Model Development

Sump Performance
Model Development

Containment Performance
Model Development

Erich Schneider, PhD
UT Austin

DTSB, DEM, TH
Model integration

Stochastic Wrapper (Model
Integration for Uncertainty)

Uncertainty
Quantification

ZOI
LLOCA/SLOCA

Yassin Hassan, PhD
TH, DEM Lead

Rodolfo Vaghetto
Texas A&M University

Ryan McCalamien, PhD
Texas A&M University

TH Response
Model Development

Downstream Effects
Model Development

Bob Lutz
PWORG Lead

TBD
Lead PWORG

Piping Fracture
Mechanics

2/22/2011

Slide 3

Team Assignments

- Texas A&M
 - RCS full-power simulation and transient system response (boundary conditions for break simulation)
 - Fuel temp parameterizations
- University of Texas
 - Uncertainty Quantification (break frequency, etc)
 - Sampling and propagation strategies (CASA Grande)
 - Break Zone Simulation (CTH)
 - Pool velocity simulation (if needed)

Team Assignments

- Los Alamos National Laboratory
 - Containment response (if needed)
 - Sump screen performance
 - Develop CASA Grande analysis tool
- ABS
 - PRA modification and evaluation
 - Consultation regarding Risk-Informed implications
- Massachusetts Institute of Technology
 - Internal review of PRA and accident seq interface

Team Assignments

- Alion
 - As-built CAD
 - Compilation of test data report
 - Consultation on debris transport and sump performance
- STP
 - Plant data interface
 - Licensing strategy
 - Project management
 - Plant operations configuration and flexibility

Technical Analyses Overview

2/22/2011

Slide 7

Deterministic Evaluation Attributes

Predetermined scenarios are analyzed assumed to be “worst case” .

Decision-making is “absolute” - no uncertainty in the decision-making process.

Need for detailed analysis and full phenomenology understanding is avoided by assuming “conservative” values for parameters.

Probabilistic Evaluation Attributes

Full spectrum of scenarios is analyzed that covers wider range of possibilities. There is solid evidence in the scientific literature that probability is the best measure of uncertainty.


Uncertainty is integral to decision-making. Risk-based methods quantify both the uncertainty of the state of our knowledge and the variability in physical phenomena.

Detailed modeling and analysis is needed to properly characterize uncertainty.

Primary Project Objectives

- Obtain core damage frequency distribution for hypothesized LOCAs that require ECCS recirculation.
- Compare core damage frequency & large, early release frequency results for Potentially Sump Blocking Insulation & Non-Sump Blocking Insulation designs against the criteria of RG1.174
- Employ RG 1.174 strategy to provide risk informed closure of GSI-191
- Finalize plan for GSI-191 closure by mid 2012 for STP
- Develop a repeatable risk informed GSI-191 Closure Method

PRA Perspective

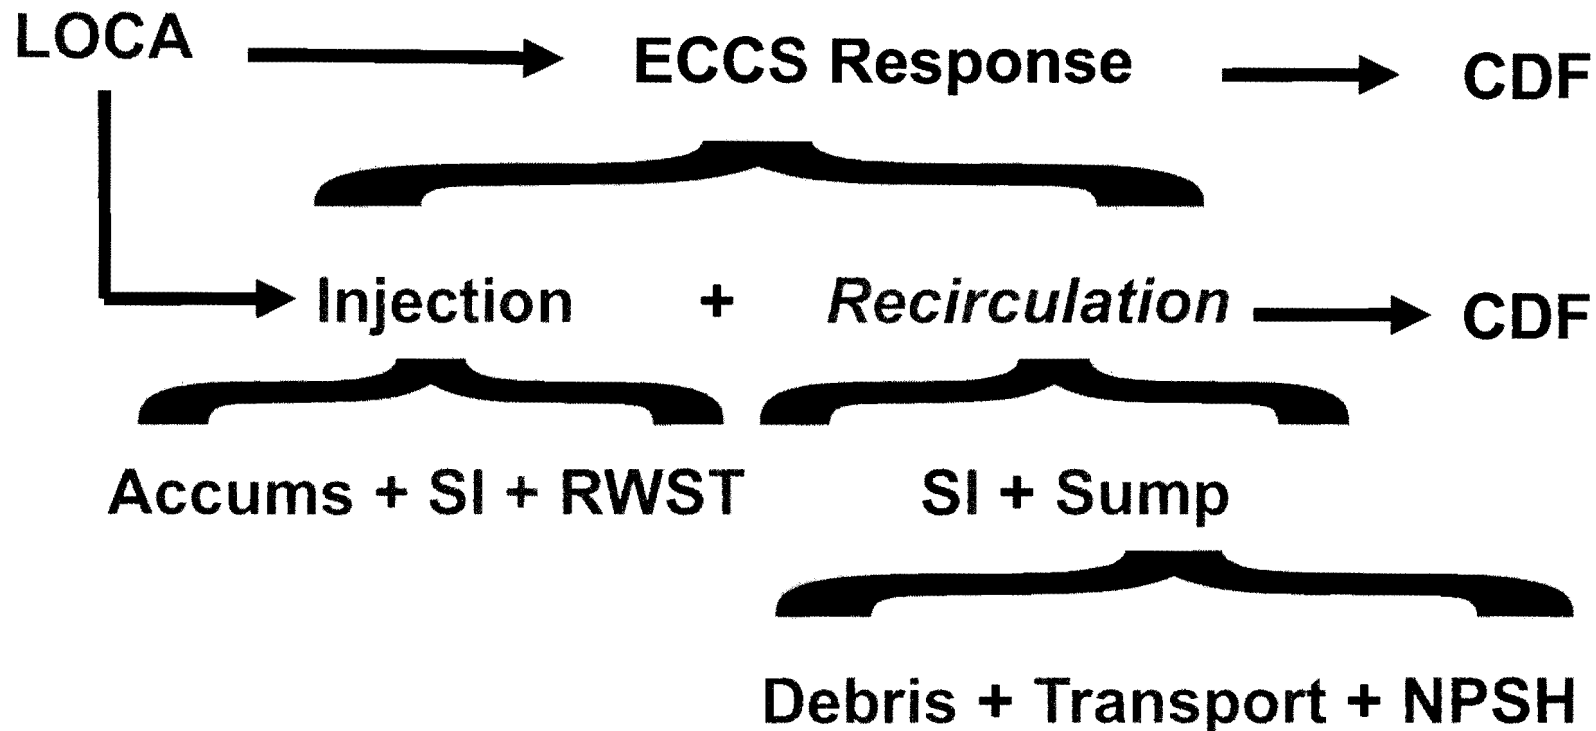

□ Documented probabilistic basis for risk quantifications

■ Area of uncertainty, need probabilistic distributions and commensurate technical basis

Technical Overview

- The risk-informed approach to GSI-191 closure requires development and integration of five major elements. Each of these elements has one or more technically challenging subtasks.
 - **DTSB**: generation and transport of debris to the sump. Resulting sump differential pressure
 - **TH**: RCS thermal-hydraulic response.
 - **DEM**: Downstream effects of debris getting through the sump screens and into the core, SI components.
 - **PRA**: A logic model that develops and quantifies the scenarios leading to core damage.
 - **Uncertainty Quantification (UQ)**: The propagation of uncertainty in the physics-based models, analysis of existing experimental data, expert elicitation, and formation of the input needed by the PRA.

Multiple Physics Models

Reactor TH

Plant State Point
Internal
Obstructions
Transient Blow

Down

EOP Response

ZOI Formation

Probability of
Break
Fracture
Mechanics

Jet Expansion

Jet Reflection

Containment

Blow Down
Transport
Spray Actuation
Environment P&T

Wash Down

Transport

Sump Pool

Debris Transport
Debris Degradation
Chemical Product
Formation

Temperature History

Sump Screen

Debris Accumulation
Thin-Bed Formation
Screen Penetration
Face Velocity
Porous Media Head
Loss

NPSH_{Margin}

Injection Systems

Recirculation Demand

NPSH_{reqd}

Degraded Pump
Performance
Valve Wear
Operability

Plant PRA

LOCA Probability by
Size/System
Probable Loss of
Recirculation

CDF and LERF

2/22/2011

Slide 12

PRA Model Overview

Overview of Approach

David Johnson

ABS Consulting Inc

ABS Consulting

AN ABS GROUP COMPANY


2/22/2011

Slide 13


Near term PRA Activities

- Develop expanded LOCA Event Trees
 - Detailed sequence of events associated with potential sump performance phenomena
 - Develop necessary logic structures to represent results from other team members
 - Support uncertainty calculation
- Integration of New Analyses
 - Utilize analyses from other team members
 - Use PRA framework to assist in technical direction of specialized analyses
- Use existing PRA model to identify potential analysis boundaries

LLOCA Event Sequence Diagram

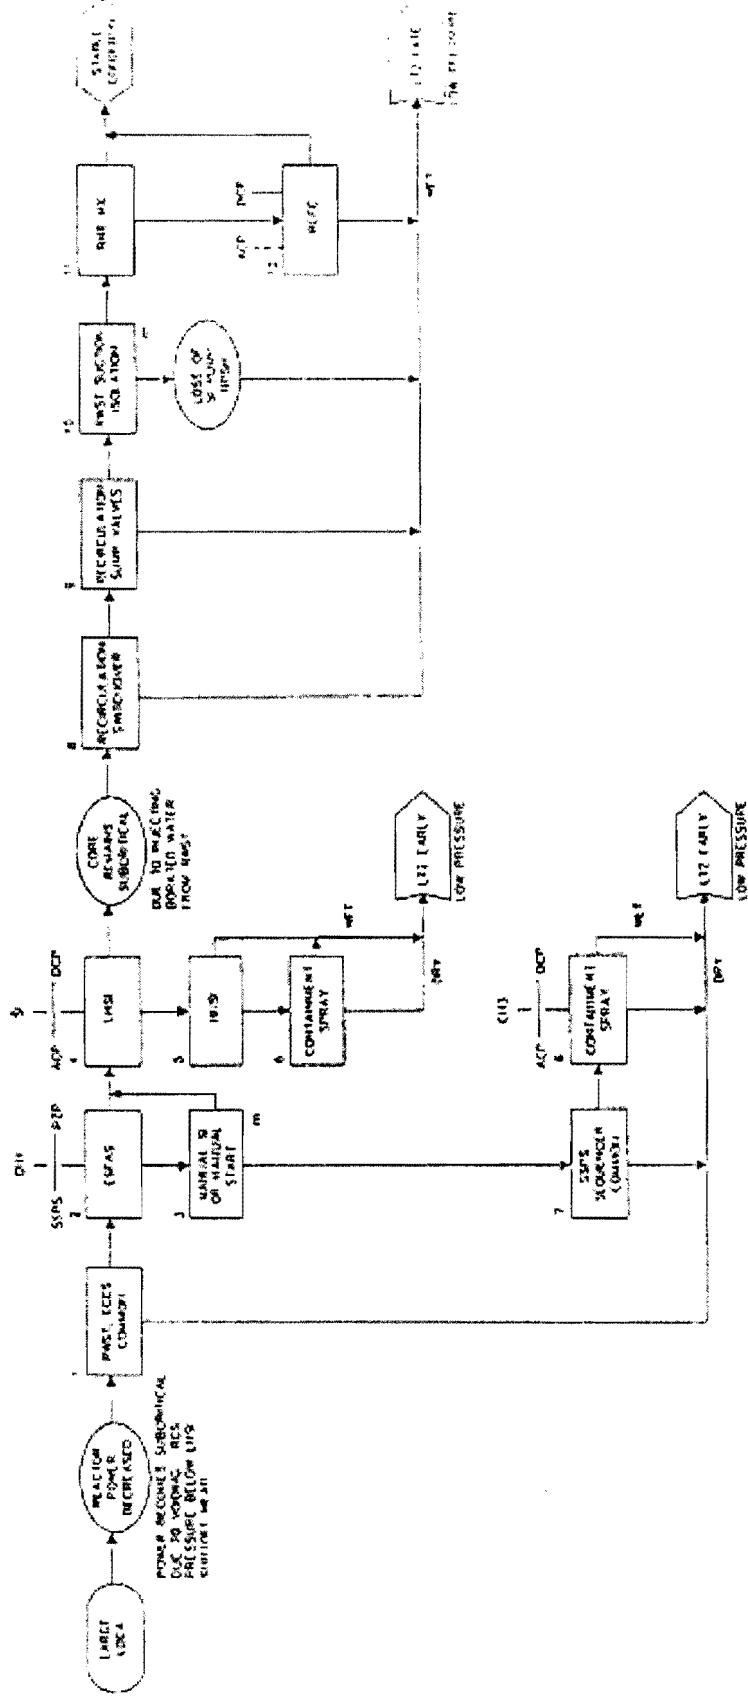

LLOCA Event Tree

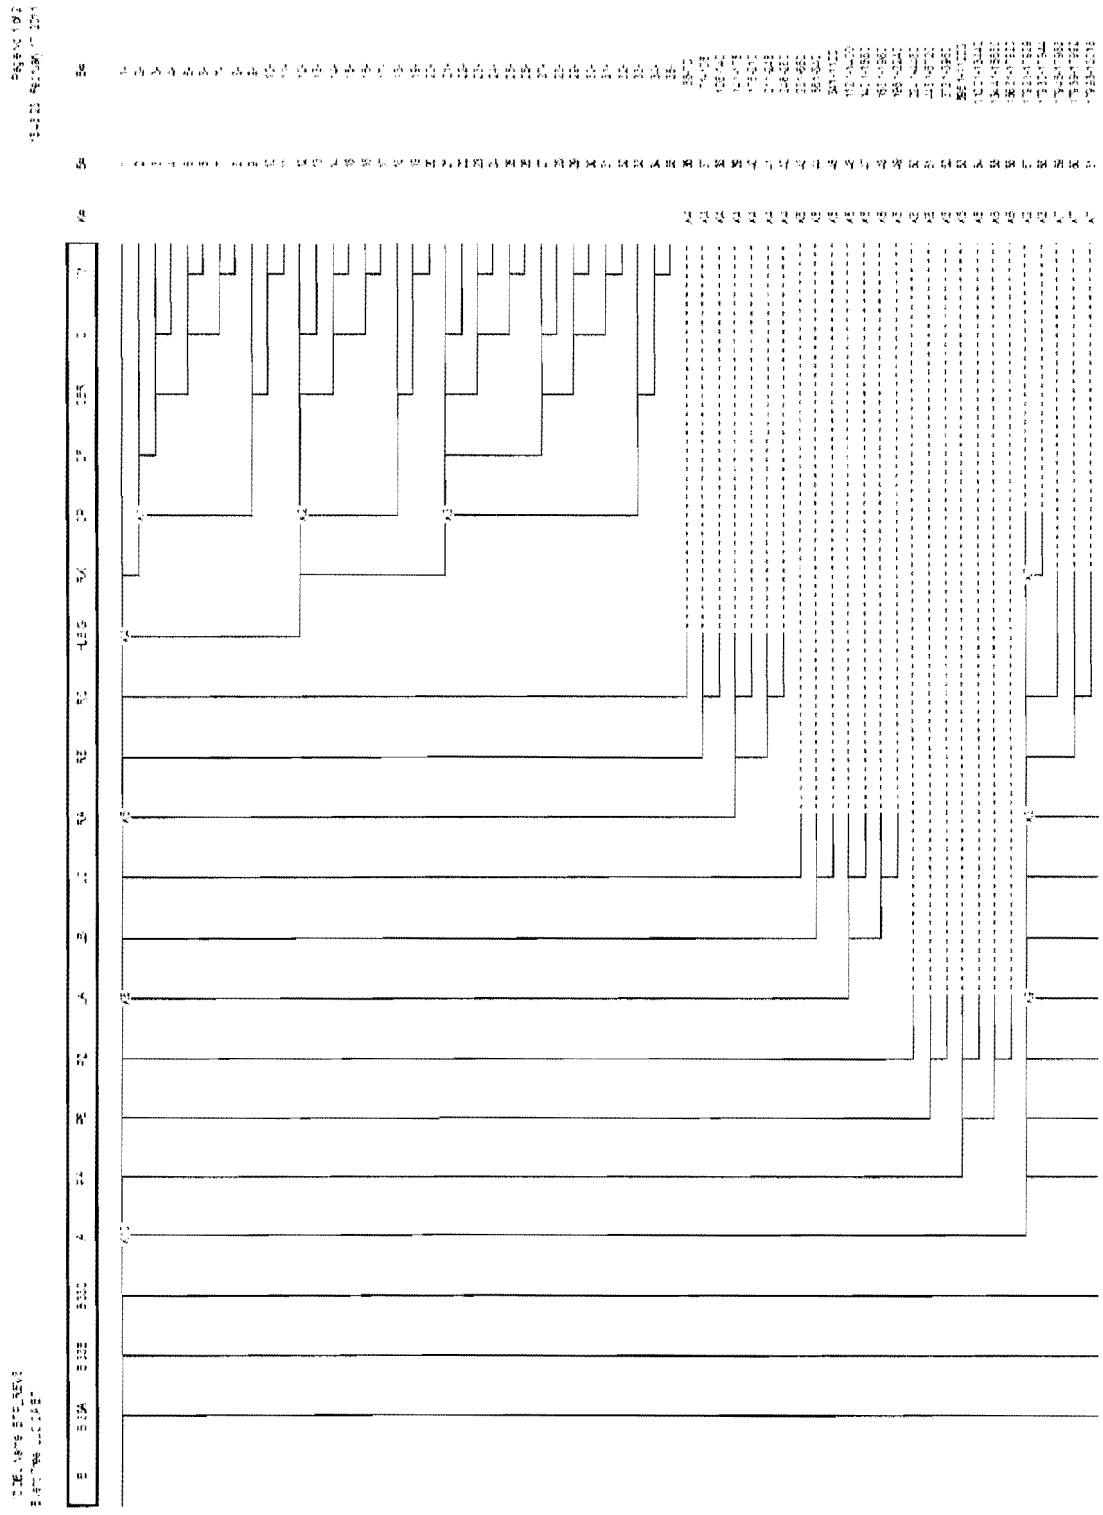

SI Recirculation Fault Tree (Top)

SI Recirculation System Fails
Top Event SIREC

G00MBA

Emergency Sump Plugs

SI PUMPS FAIL DURING
RECIRCULATION

SR_SUMP_PLG_0001

G00MCB

SI RECIRC TRAIN A FAILS

SI RECIRC TRAIN B FAILS

SI RECIRC TRAIN C FAILS

G00MBC

G00MCC

G00MDC

1

2

3

G01MBA

From Page
4

G02MBA

From Page
3

G03MBA

From Page
2

Current and Future PRA Models

- Existing PRA
 - Does not explicitly address sump plugging phenomena
 - Does include a basic event ($1\text{E-}5$) to represent unavailability of sump; required for all sequences involving recirculation
 - At-power importance:
 - FV $4.1\text{E-}03$; RAW: $4.1\text{E+}02$ [CDF]
 - FV $2.4\text{E-}07$; RAW: $1.0\text{E+}00$ [LERF]
 - Does not address in-core phenomena of material passing strainer
- Current Effort
 - New model will depict detailed representation of phenomena
 - Aid in investigation
 - Assist in documentation of effort
 - Eventual incorporation into PRA model of record
 - Model may be higher level, as appropriate
 - Could result in revised initiator groupings

Example Source Material

- NUREG/CR-6771 GSI-191: The Impact of Debris Introduced Loss of ECCS Recirculation on PWR Core Damage Frequency; LANL (2002)
- ECCS Recirculation Performance Following Postulated LOCA Event: GSI-191 Expected Behavior; NEI (2009)




Considerations Include:

- Break characteristics
 - Location, size, failure mode, opening time, scenario timing
- Zone of influence
- Debris Characterization
 - Debris from insulation
 - Other debris
- Debris Transport and chemistry
- Accumulation at strainer/head loss
- Downstream Effects


Debris Transport & Sump Blockage (DTSB), Jet Formation Physics, and Uncertainty Quantification (UQ)

Elmira Popova, Erich Schneider: University of Texas at Austin
Bruce Letellier: Los Alamos National Laboratory

Accident Progression Overview

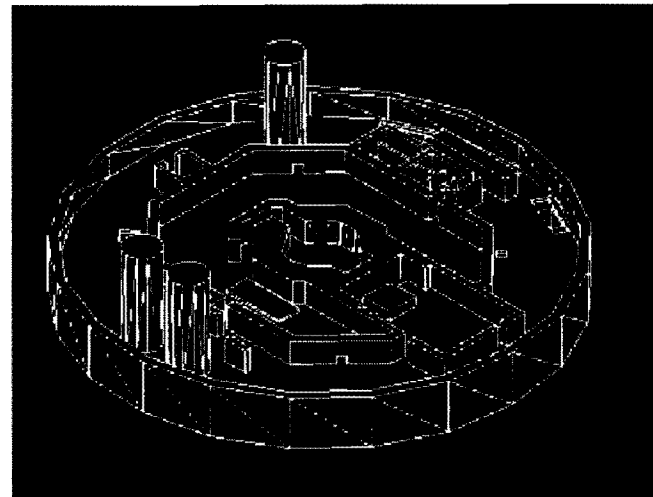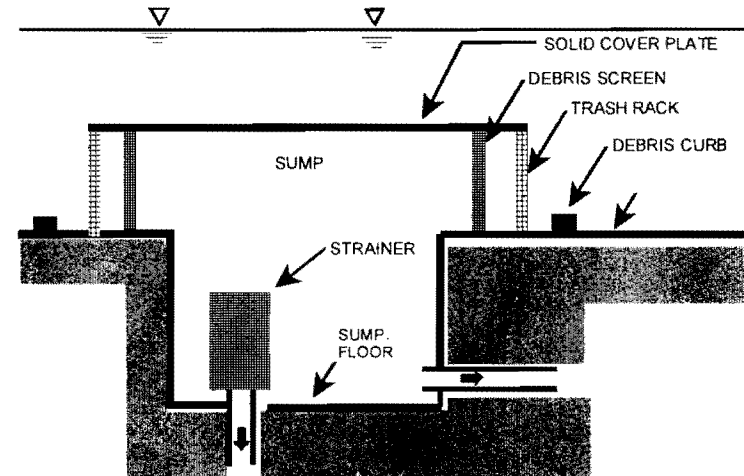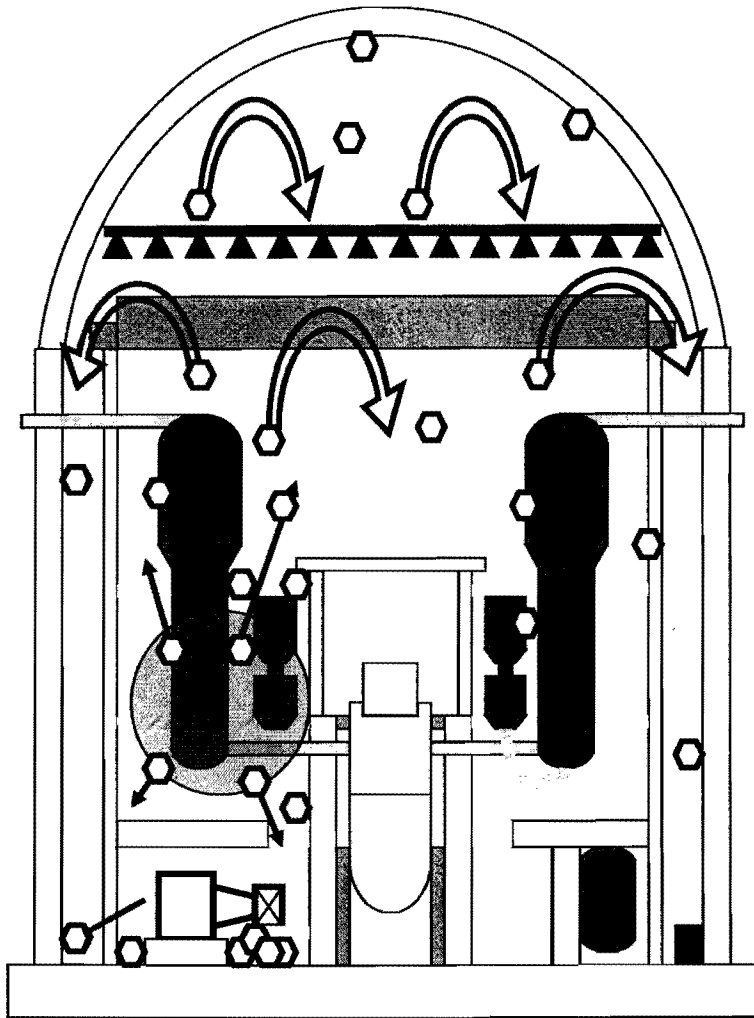


Conceptual Accident Propagation

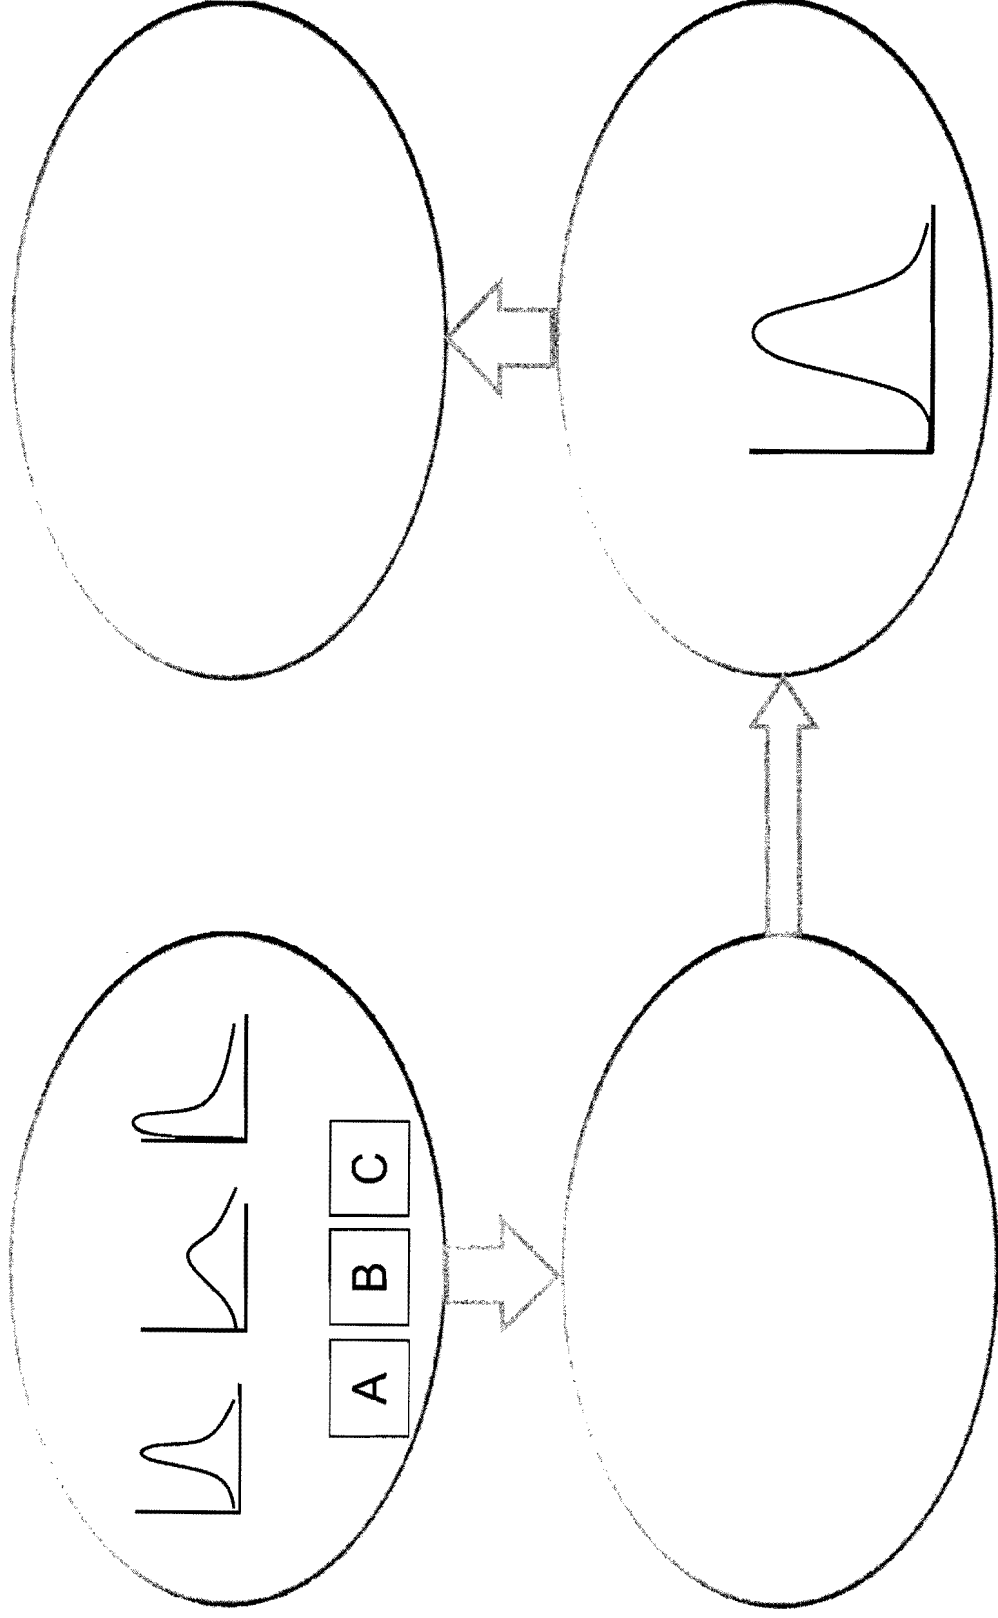

Interface to PRA

- Present PRA has only one top event directly related to GSI-191 (Recirculation Cooling)
- Traditionally assume recirculation failure leads directly to core damage
- Use physics models to define distributions and/or required split fractions (analogous to fault trees)
- Key Performance Metric (fixed NPSH margin):

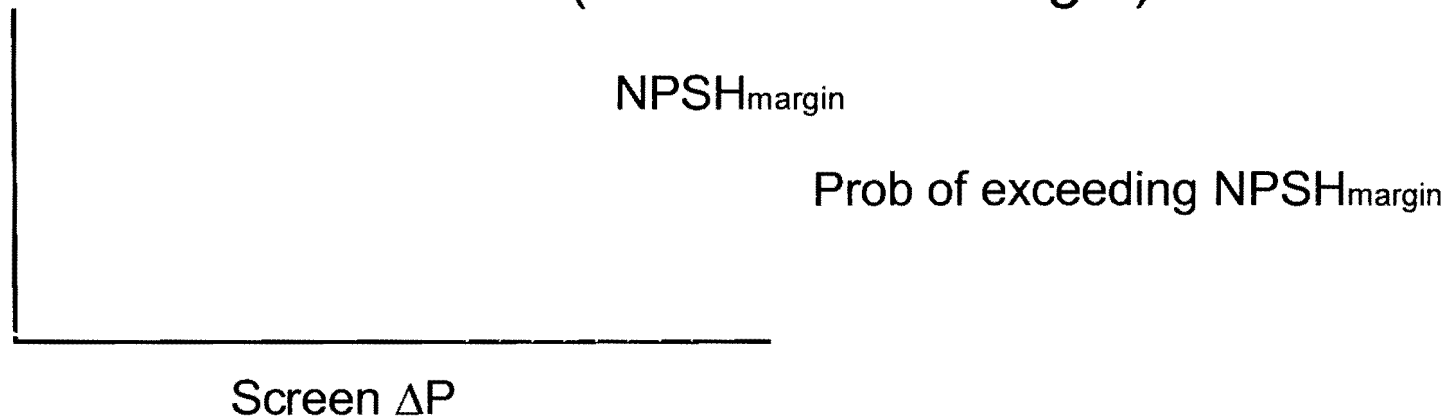

Refined PRA


- Downstream effects now raise additional Core Damage states
 - Channel-specific loss of cooling
 - Core average temp
 - Core pressure drop
- Must add top event for reactor flow effects
 - Need operational definition of Core Damage
 - Licensing basis
 - Alternate source term

Technical Strategies

1. Break frequency refinement
2. ZOI estimation
 - Implement spherical approx while improving jet model
3. Sump screen performance
 - Conservatively ignore overpressure credit
4. Degraded pump performance
 - Assume licensing basis failure
5. Reactor flow metrics
 - Parameterize core-wide and fuel assembly blockage
6. PRA refinement for rotating trains
7. PRA refinement for core damage states

Jet Formation Physics: Spherical Approximation

- Conservation of volume enclosed by stagnation pressure isobars (e.g. via ANSI standard ANS88) leads to spherical ZOI approximation
 - ANSI standard addresses freely-expanding jets
 - exhibits (conservative) inconsistencies for small or off-center targets, discontinuities in pressure gradient

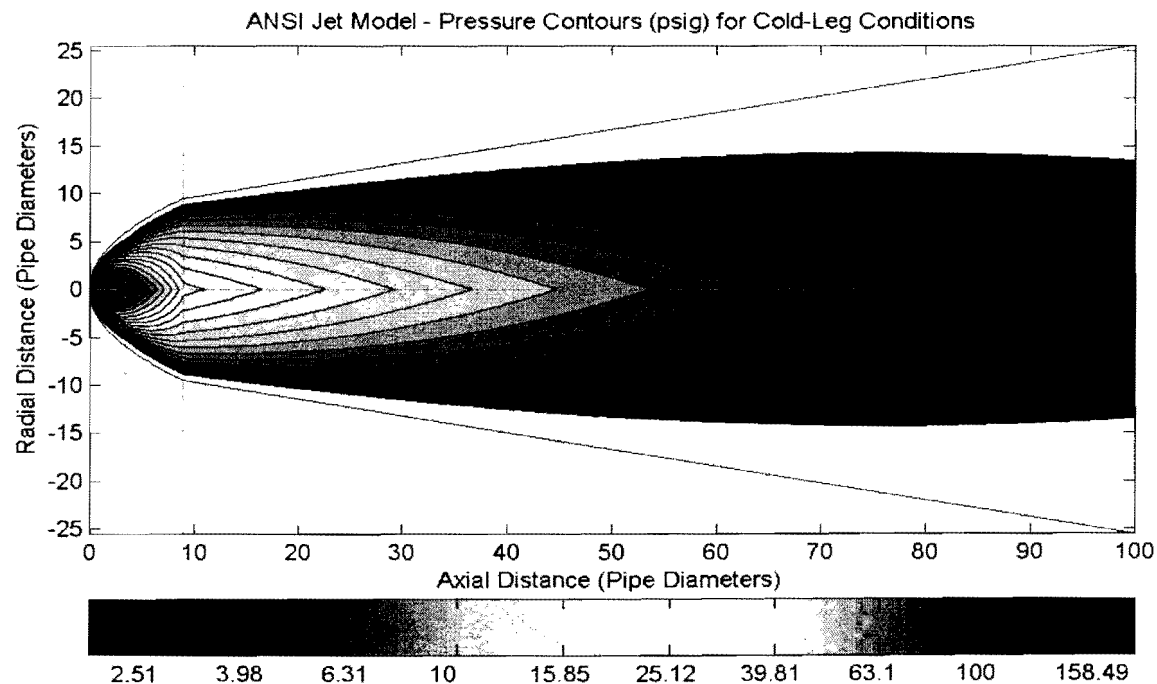

01/27/2011

Slide 27

Jet Formation Physics: CFD-Guided Parameterization

- CFD can depict velocity field, two-phase jet characteristics that are beyond scope of ANSI model
 - conventional CFD codes cannot simulate important shock and multiphase phenomena
 - **CTH** (SNL) treats the strong-shock, high-pressure, liquid-vapor regime
- Will allow time-dependent break effects and jet impingement / deflection to be investigated
- Use response surface methodology to obtain **ZOI reduced order model (ROM)**
 - quantify boundaries of reliability of the ANSI model
 - correlate a minimal set of explanatory variables to the response (pressure contours)

ZOI Reduced Order Model (ROM): Summary

- Seek Improvements to ANSI Standard – Simplistic and free expansion only.
- Two-phase CFD computationally expensive
- Limited test data (STP + Westinghouse)
- TH state points will vary by break location
- Rupture time and extent will control jet development
- Debris generation controls sequence outcome
- Reflected jet cases will be run to confirm conservatism of equal pressure-volume mapping
- ROM for free jet will facilitate hundreds of break evaluations

UQ – main research directions

- Modeling and propagation of uncertainty in the physics-based models
- Collection and analysis of existing experimental data
- Elicitation and analysis of experts' opinion for cases when there are no real data or published results
- Locating areas where further experimentation and/or analysis is needed

UQ in physics models

- Initially the models will be conservatively approximated and refined as needed to address dominant uncertainties. The framework to address the UQ in physics models will consists of four parts:
 - Uncertainty analysis: quantification of the overall uncertainty in model outputs.
 - Sensitivity analysis and value of information: how the model outputs respond to inputs. How much each uncertain factor impacts the decision-making.
 - Calibration and data assimilation: the process of adjusting the uncertain model parameters to match the model to observed data.
 - Validation



Uncertainty Propagation Tools

- Dakota and Psuade noninvasive sampling tools
- Objective directed Latin Hypercube Sampling
- Create our own sampling and analysis tools if necessary

Multivariate uncertainties and their mapping to PRA models

- This problem might have many multivariate uncertainties possibly important to uncertainty quantification
 - Uncertainty in containment pressure is dependent on the uncertainty in break flow rate.
 - Uncertainty in sump differential pressure is dependent on the uncertainty in fluid temperature (in turn, is dependent on containment temperature - break flow).
 - Uncertainty in fuel pin failures is dependent on uncertainty in ECCS flow and uncertainty in sump screen particulate penetration.

Multivariate uncertainties and their mapping to PRA models

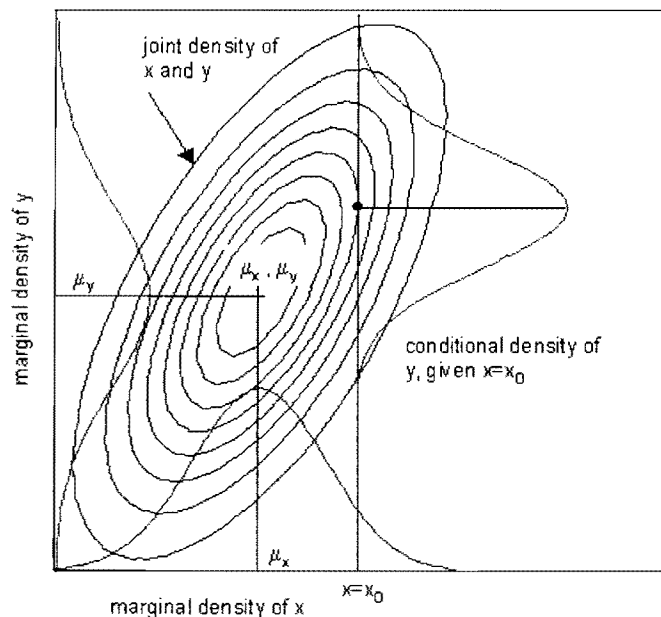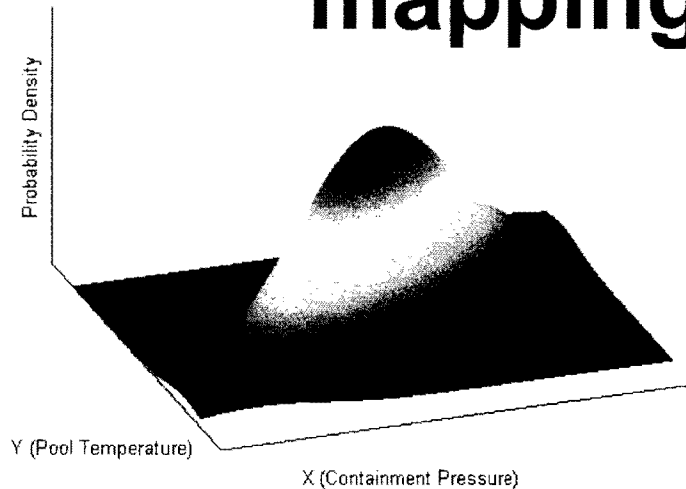

- Standard inputs for PRA analysis are discrete conditional probabilities
- They are computed from conditional distributions (densities)
- Conditional densities are computed from the joint distribution function (density)
- Example shows two uncertain variables with a positive correlation
- We propose conditional probability of NPSH_{margin} loss as one important interface to the PRA

01/27/2011

Slide 34

applicable loss-of-coolant accident break size spectrum for sump clogging, based on probabilistic considerations.

In addition, the licensee is collecting the data obtained from industry sump testing to use in deterministic and probabilistic modeling.

If there are any questions, please direct inquiries to me at (301) 415-1476 or mohan.thadani@nrc.gov.

Sincerely,

/RA/

Mohan C. Thadani, Senior Project Manager
Plant Licensing Branch IV
Division of Operating Reactor Licensing
Office of Nuclear Reactor Regulation

Docket Nos. 50-498 and 50-499

Enclosures:

1. List of Attendees
2. Presentation Viewgraphs

cc w/encls: Distribution via Listserv

DISTRIBUTION:

PUBLIC

LPLIV Reading

RidsAcrsAcnw_MailCTR Resource

RidsNrrDorl Resource

RidsNrrDorlLpl4 Resource

RidsNrrDraApla Resource

RidsNrrDssSsib Resource

RidsNrrLAJBurkhardt Resource

RidsNrrPMSouthTexas Resource

RidsOgcRp Resource

RidsOpaMail Resource

RidsRgn4MailCenter Resource

JTrapp, EDO RIV

VDricks, OPA RIV

CSteger, NRR

MThadani, NRR/DORL/LPL4

RArchitzel, NRR/DSS/SSIB

MSnodderly, COMM/OCMGA

SDinsmore, NRR/DRA/APLA

ADAMS Accession No. ML110770005

OFFICE	NRR/LPL4/PM	NRR/LPL4/LA	NRR/DSS/SSIB/BC	NRR/DRA/APLA/BC	NRR/LPL4/BC	NRR/LPL4/PM
NAME	MThadani	JBurkhardt	SBailey	DHarrison (SDinsmore for)	MMarkley	MThadani
DATE	3/24/11	3/24/11	3/28/11	4/5/11	4/5/11	4/5/11

OFFICIAL RECORD COPY