



Exelon Generation®

Larry D. Smith
Manager-Regulatory Assurance

Calvert Cliffs Nuclear Power Plant
1650 Calvert Cliffs Parkway
Lusby, MD 20657

410-495-5219 Office
www.exeloncorp.com
Larry.smith2@exeloncorp.com

May 5, 2016

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, DC 20555

Calvert Cliffs Nuclear Power Plant; Unit Nos. 1 & 2;
Renewed Facility Operating License Nos. DPR-53 and DPR-69
Docket Nos. 50-317 & 50-318

Independent Spent Fuel Storage Installation;
Material License No. SNM-2505
NRC Docket No. 72-8

Subject: Annual Radiological Environmental Operating Report

References: 1. Calvert Cliffs Nuclear Power Plant Technical Specification 5.6.2
2. Calvert Cliffs Independent Spent Fuel Storage Installation Technical Specification 6.2

In accordance with References 1 and 2, Calvert Cliffs Nuclear Power Plant is submitting the Annual Radiological Environmental Operating Report (Attachment 1).

There are no regulatory commitments contained in this correspondence.

Should you have questions regarding this matter, please contact me at (410) 495-5219 or Ms. Brittney O'Connor at (410) 495-4913.

Respectfully,

Larry D. Smith
Manager-Regulatory Assurance

LDS/PSF/bjm

Attachment: (1) Annual Radiological Environmental Operating Report for the Calvert Cliffs Nuclear Power Plant Units 1 and 2 and the Independent Spent Fuel Storage Installation

cc: NRC Project Manager, Calvert Cliffs
NRC Regional Administrator, Region I

NRC Resident Inspector, Calvert Cliffs
S. Gray, MD-DNR

IE25
NM5326
NRR
NM55

ATTACHMENT (1)

**ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT
FOR THE CALVERT CLIFFS NUCLEAR POWER PLANT
UNITS 1 AND 2
AND THE INDEPENDENT SPENT FUEL STORAGE INSTALLATION**

**Calvert Cliffs Nuclear Power Plant
May 5, 2016**

**ANNUAL RADIOLOGICAL ENVIRONMENTAL
OPERATING REPORT
FOR THE
CALVERT CLIFFS NUCLEAR POWER PLANT
UNITS 1 AND 2
AND THE
INDEPENDENT SPENT FUEL STORAGE INSTALLATION**

January 1 - December 31, 2015

A. M. Barnett
R. V. Ihnacik

EXELON GENERATION, LLC

MAY 2016

TABLE OF CONTENTS

LIST OF FIGURES	ii
LIST OF TABLES	iii
I. SUMMARY	1
<u>II. CALVERT CLIFFS NUCLEAR POWER PLANT RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM</u>	3
<u>II.A. INTRODUCTION</u>	3
<u>II.B. PROGRAM</u>	3
<u>II.B.1 Objectives</u>	3
<u>II.B.2 Sample Collection</u>	4
<u>II.B.3 Data Interpretation</u>	4
<u>II.B.4 Program Exceptions</u>	4
<u>II.C. RESULTS AND DISCUSSIONS</u>	4
<u>II.C.1 Aquatic Environment</u>	4
<u>II.C.1.a Bay Water</u>	4
<u>II.C.1.b Aquatic Organisms</u>	5
<u>II.C.1.c Shoreline Sediment</u>	5
<u>II.C.2 Atmospheric Environment</u>	8
<u>II.C.2.a Air Particulate Filters</u>	8
<u>II.C.2.b Air Iodine</u>	8
<u>II.C.3 Terrestrial Environment</u>	10
<u>II.C.3.a Vegetation</u>	10
<u>II.C.3 Direct Radiation</u>	10
<u>II.D. CONCLUSION</u>	12
<u>III. INDEPENDENT SPENT FUEL STORAGE INSTALLATION RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM</u>	18
<u>III.A. INTRODUCTION</u>	18
<u>III.B. PROGRAM</u>	18
<u>III.B.1 Objectives</u>	18
<u>III.B.2 Sample Collection</u>	19
<u>III.B.3 Data Interpretation</u>	19
<u>III.B.4 Program Exceptions</u>	19
<u>III.C. RESULTS AND DISCUSSIONS</u>	19
<u>III.C.1 Atmospheric Environment</u>	19
<u>III.C.1.a Air Particulate Filters</u>	19
<u>III.C.2 Terrestrial Environment</u>	20
<u>III.C.2.a Vegetation</u>	20
<u>III.C.2.b Soils</u>	20
<u>III.C.3 Direct Radiation</u>	21
<u>III.D. CONCLUSION</u>	21
IV. REFERENCES	25
<u>APPENDIX A Sample Locations for the REMP and the ISFSI</u>	26
<u>APPENDIX B Analysis Results for the REMP and the ISFSI</u>	35
<u>APPENDIX C Quality Assurance Program</u>	56
<u>APPENDIX D Land Use Survey</u>	73
<u>APPENDIX E Additional Samples and Analysis Results</u>	74

LIST OF FIGURES

Figure Title	Page
1 Tritium in Chesapeake Bay Water.....	6
2 Silver-110m and Potassium-40 in Chesapeake Bay Oysters.....	7
3 Nuclear Fallout in the Calvert Cliffs Area.....	9
4 Mean TLD Gamma Dose, Calvert Cliffs Nuclear Power Plant.....	11
5 Atmospheric Dispersion Around CCNPP Average Relative Air Concentrations (X/Q).....	14
6 Atmospheric Dispersion Around CCNPP Average Relative Ground Deposition (D/Q).....	15
7 Mean TLD Gamma Dose, ISFSI.....	22
A-1 Map of Southern Maryland and Chesapeake Bay Showing Location of Calvert Cliffs Nuclear Power Plant.....	29
A-2 Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-2 Miles.....	30
A-3 Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-10 Miles.....	31
A-4 Independent Spent Fuel Storage Installation Sampling Locations.....	33
A-5 Enlarged Map of the Independent Spent Fuel Storage Installation Sampling Locations.....	34
E-1 Site Map Groundwater Monitoring Wells.....	90

LIST OF TABLES

Table	Title	Page
1	Synopsis of 2015 Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program.....	16
2	Annual Summary of Radioactivity in the Environs of the Calvert Cliffs Nuclear Power Plant Units 1 and 2.....	17
3	Synopsis of 2015 Calvert Cliffs Nuclear Power Plant Independent Spent Fuel Storage Installation Radiological Environmental Monitoring Program	23
4	Annual Summary of Radioactivity in the Environs of the Calvert Cliffs Nuclear Power Plant Independent Spent Fuel Storage Installation	24
A-1	Locations of Environmental Sampling Stations for the Calvert Cliffs Nuclear Power Plant..	28
A-2	Locations of Environmental Sampling Stations for the Independent Spent Fuel Storage Installation at Calvert Cliffs.....	32
B-1	Concentration of Tritium and Gamma Emitters in Bay Water	37
B-2	Concentration of Gamma Emitters in the Flesh of Edible Fish	38
B-3	Concentration of Gamma Emitters in Oyster Samples	39
B-4	Concentration of Gamma Emitters in Shoreline Sediment.....	40
B-5	Concentration of Iodine-131 in Filtered Air	41
B-6	Concentration of Beta Emitters in Air Particulates.....	43
B-7	Concentration of Gamma Emitters in Air Particulates	47
B-8a	Concentration of Gamma Emitters in Vegetation Samples	48
B-8b	Concentration of Gamma Emitters in Vegetation From Locations Around the ISFSI.....	49
B-9	Concentration of Gamma Emitters in Soil Samples From Locations Around the ISFSI	50
B-10	Typical MDA Ranges for Gamma Spectrometry	51
B-11	Typical LLDs for Gamma Spectrometry	52
B-12	Direct Radiation	53
C-1	Results of Participation in Cross Check Programs	58
C-2	Results of Quality Assurance Program	61
C-3	Teledyne Brown Engineering's Typical MDAs for Gamma Spectrometry	72
D-1	Land Use Survey.....	73
E-1	Locations of Non-Tech Spec Environmental Sampling Stations for Calvert Cliffs Nuclear Power Plant	76
E-2	Synopsis of 2015 Calvert Cliffs Nuclear Power Plant Non-Tech Spec Radiological Environmental Monitoring Program.....	77
E-3	Annual Summary for Calvert Cliffs Nuclear Power Plant Units 1 & 2 Non-Tech Spec Radiological Environmental Monitoring Program	78
E-4	Concentration of Gamma Emitters in Bottom Sediment.....	79
E-5	Concentration of Iodine-131 in Filtered Air	80
E-6	Concentration of Beta Emitters in Air Particulates.....	82
E-7	Concentration of Gamma Emitters in Air Particulates	84
E-8	Concentration of Tritium and Gamma Emitters in TaylorsIsland Well Water.....	85

E-9	Direct Radiation	86
E-10	Direct Radiation from Resin Storage Area	87
E-11	Concentration of Tritium in Groundwater	88
E-12	Gross Concentration of Gamma Emitters in Groundwater	89

I. SUMMARY

During 2015, Calvert Cliffs Nuclear Power Plant (CCNPP) Units 1 and 2, a total of 3460 radiological analyses were performed and the analytical results reviewed. Most of these analyses were performed to satisfy the requirements of the Offsite Dose Calculation Manual (ODCM) (Ref. 6), the Environmental Technical Specifications (Ref. 5) and the Independent Spent Fuel Storage Installation (ISFSI) Technical Specifications (Ref. 10). Some of these samples, although not required by either the ODCM or the Technical Specifications, were collected to maintain our commitments to the surrounding community and to maintain historical continuity of the CCNPP Radiological Environmental Monitoring Program (REMP) that started in 1970. The entire monitoring program in place around CCNPP is divided into three parts: the original REMP, the ISFSI monitoring program, and the Non-ODCM Radiological Environmental Monitoring. The following paragraphs describe each of these parts in more detail.

A total of 653 radiochemical analyses were performed on 585 environmental samples and 552 thermoluminescent dosimeters (TLDs) were analyzed for ambient radiation exposure rates as part of the original REMP. These analyses were performed to satisfy the requirements of the ODCM (Ref. 6) and the Environmental Technical Specifications (Ref. 5).

For the ISFSI monitoring program, 360 radiochemical analyses were performed on 300 environmental samples, 64 of which were in common with the original REMP. In addition, 480 TLDs, 24 in common with the original REMP, were analyzed for ambient radiation exposure rates. These analyses were performed to satisfy the requirements of the ODCM (Ref. 6) and the ISFSI Technical Specifications (Ref. 10).

In addition, 608 analyses were performed on 542 additional environmental samples, and 480 additional TLDs were analyzed for ambient radiation exposure rates.

And lastly, 283 radiochemical analyses were performed on 217 quality assurance samples and 132 quality assurance TLDs were analyzed as part of an internal and external quality assurance program associated with Teledyne Brown Engineering. Laboratory intercomparison samples obtained from Environmental Resource Associates (ERA) and Analytics' Inc. were also analyzed.

Samples collected from the aquatic environment included bay water, fish, oysters, and shoreline sediment. Bay water was analyzed for tritium and gamma emitters. Fish, oysters, and shoreline sediments were analyzed for gamma emitting radionuclides.

Monitoring the atmospheric environment involved sampling the air at various locations surrounding CCNPP and the ISFSI. Air particulates and gaseous iodine were collected on glass fiber filters and charcoal cartridges, respectively. The particulate filters were analyzed for beta activity and gamma emitting nuclides. The charcoal cartridges were analyzed for airborne gaseous radioiodine.

Samples from the terrestrial environment consisted of vegetation and soil samples collected and analyzed for gamma emitters. Vegetation samples for the original REMP were also analyzed for I-131.

Measurements of direct radiation, as required by the ODCM, were performed by analyzing TLDs from forty-two locations surrounding CCNPP and the ISFSI.

Natural radioactivity was detected in essentially all 3460 radiological analyses performed. Low levels of man-made fission products were also observed in 15 of these analyses for the CCNPP REMP. All of these observations were attributed to fallout from past atmospheric weapons testing. Detailed discussions about the results of these analyses are contained in the body of this report.

To assess the plant's contribution to the radiation levels of the ambient environment, dose calculations were performed using 2015 data from the plant's effluent releases, 2015 on-site meteorological data, and appropriate pathways. The results of these dose calculations indicate:

- a. a maximum thyroid dose of 2.92×10^{-2} mrem via liquid and gaseous pathways, which is about 0.039% of the acceptable limit of 75 mrem/yr as specified in 40CFR190 "Environmental Radiation Protection Standards for Nuclear Power Operations" and 10CFR72.104, "Licensing Requirements for the Independent Storage of Spent Nuclear Fuel and High-Level Radioactive Waste";
- b. a maximum whole body dose of 3.92×10^{-2} mrem via liquid and gaseous pathways, which is about 0.157% of the acceptable limit of 25 mrem/yr as specified in both 40CFR190 and 10CFR72.104; and
- c. a maximum calculated dose to all other organs via liquid and gaseous pathways was equal to 5.78×10^{-2} mrem to the skin. This dose is about 0.231% of the allowable limit of 25 mrem/yr as specified in both 40CFR190 and 10CFR72.104.

Compared to the previous three years, a slightly higher amount of radioactivity was released from CCNPP in 2015. This resulted in a proportionately higher calculated offsite dose. However, as indicated by the results of the station's environmental monitoring, there was no increase in radioactivity detected in environmental samples. Thus, it is concluded based upon the levels of radioactivity observed and the various dose calculations performed, that CCNPP Units 1 and 2 and the ISFSI did not cause any significant radiological impact on the surrounding environment.

II. CALVERT CLIFFS NUCLEAR POWER PLANT RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

II.A. INTRODUCTION

The REMP has been conducted in the vicinity of CCNPP since the summer of 1970. The Calvert Cliffs site is an operating nuclear generating station consisting of two pressurized water reactors. Unit 1 achieved criticality on October 7, 1974 and commenced commercial operation in May 1975. Unit 2 achieved criticality on November 30, 1976 and went into commercial operation April 1, 1977. The location of the plant in relation to local metropolitan areas is shown on Figure A-1.

Results of the monitoring program for the pre-operational period have been reported in a series of documents (Ref. 1-4). The results from previous operational periods are contained in annual reports submitted to the Nuclear Regulatory Commission (NRC) as required.

Results of the monitoring program for the current operational period are included in this report. The report presents the content of the REMP (Table 1), the sampling locations (Appendix A), the summary of the analytical results (Table 2), a compilation of the analytical data (Appendix B), the results of the Interlaboratory Comparison Program and the Quality Assurance Program (Appendix C), the results of the Land Use Survey (Appendix D), and a compilation of the analytical data for extra samples collected (Appendix E). Interpretation of the data and conclusions are presented in the body of the report.

The environmental surveillance data collected during this reporting period were compared with that generated in previous periods whenever possible to evaluate the environmental radiological impact of CCNPP Units 1 and 2.

II.B. PROGRAM

II.B.1 Objectives

The objectives of the REMP for the Calvert Cliffs Nuclear Power Plant are:

- a. To verify that radioactivity and ambient radiation levels attributable to plant operation are within the limits specified in the ODCM (Ref. 6) and the Environmental Radiation Protection Standards as stated in 40CFR190,
- b. To detect any measurable buildup of long-lived radionuclides in the environment,
- c. To monitor and evaluate ambient radiation levels, and
- d. To determine whether any statistically significant increase occurs in the concentration of radionuclides in important pathways.

II.B.2 Sample Collection

The locations of the individual sampling stations are listed in Table A-1 and shown in Figures A-2 and A-3. All samples were collected by contractors to, or personnel of Exelon Generation, according to CCNPP Procedures (Ref. 7, 8 and 12).

II.B.3 Data Interpretation

Many results in environmental monitoring occur at or below the minimum detectable activity (MDA). In this report, all results at or below the relevant MDA are reported as being "less than" the MDA value.

II.B.4 Program Exceptions

There were no program exceptions.

II.C. RESULTS AND DISCUSSIONS

All the environmental samples collected during the year were analyzed using Exelon Industrial Services laboratory procedures (Ref. 8) with the exception of Tritium analyzed by Gel Laboratories LLC. (Ref. 14). The analytical results for this reporting period are presented in Appendix B and are also summarized in Table 2. For discussion, the analytical results are divided into four categories. The categories are the Aquatic Environment, the Atmospheric Environment, the Terrestrial Environment, and Direct Radiation. These categories are further divided into subcategories according to sample type (e.g., Bay Water, Aquatic Organisms, etc., for the Aquatic Environment).

II.C.1 Aquatic Environment

The aquatic environment surrounding the plant was monitored by analyzing samples of bay water, aquatic organisms, and shoreline sediment. These samples were obtained from various sampling locations on the Chesapeake Bay near the plant.

II.C.1.a Bay Water

Monthly bay water samples were taken from two locations during the year. These locations are the Intake Area (sample code WA1) and the Discharge Area (sample code WA2). Composite samples were obtained from each location for the entire sampling period. These samples were analyzed for tritium and gamma emitters as shown in Table B-1.

The tritium analyses, performed on quarterly composites of the monthly bay water samples, revealed no evidence of tritium in any of the samples taken from either site throughout the year.

Figure 1 compares tritium observed in the plant discharge and intake with annual effluent releases as reported in the Radioactive Effluent Release Report.

Monthly analyses of bay water samples from both locations for gamma emitters exhibited no detectable concentrations of any plant-related radionuclides.

II.C.1.b Aquatic Organisms

Twelve samples of aquatic organisms were obtained from four locations during the year. Samples of fish, when in season, are normally collected from the Discharge Area (sample codes IA1 and IA2) and from the Patuxent River (sample codes IA4 and IA5). As shown in Table B-2, two species of fish were sampled at both the plant discharge and the control point in the Patuxent River. Oyster samples were obtained quarterly from Camp Conoy (sample code IA3) and Kenwood Beach (IA6) as shown in Table B-3.

Figure 2 compares K-40 and Ag-110m observed in oysters from Camp Conoy (IA3) with annual effluent releases of Ag-110m as reported in the Radioactive Effluent Release Report.

Edible portion of the fish and oyster samples were analyzed for gamma emitters.

Gamma spectrometric analyses of the fish exhibited naturally occurring K-40 but no detectable concentrations of any plant-related radionuclides. Oyster samples likewise exhibited naturally occurring K-40 but no detectable concentrations of any plant-related radionuclides.

II.C.1.c Shoreline Sediment

Semiannual shoreline sediment samples are taken from one location during the year. This location is Shoreline at Barge Road (sample code WB1). The semiannual shoreline sediment samples obtained from this location were analyzed for gamma emitters.

Gamma spectrometric analyses of these samples exhibited naturally occurring radionuclides, but no detectable concentration of any plant-related radionuclides, as shown in Table B-4.

FIGURE 1
Tritium in Chesapeake Bay Water


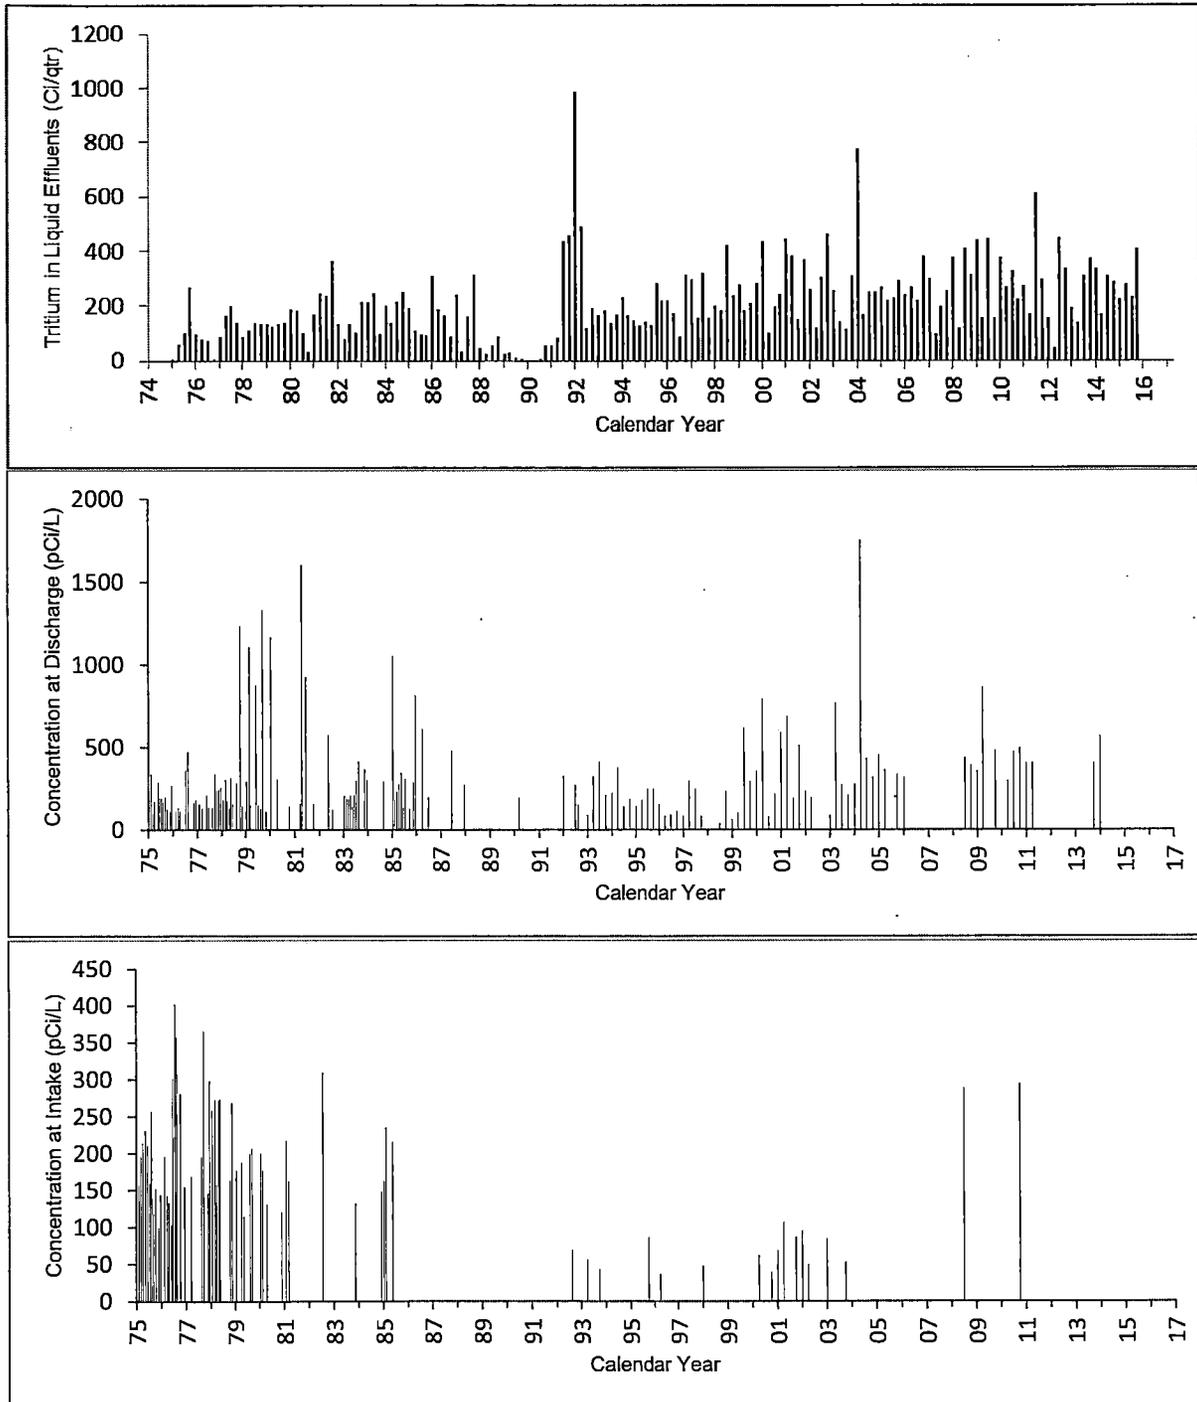


FIGURE 2
Silver-110m and Potassium-40 in Chesapeake Bay Oysters

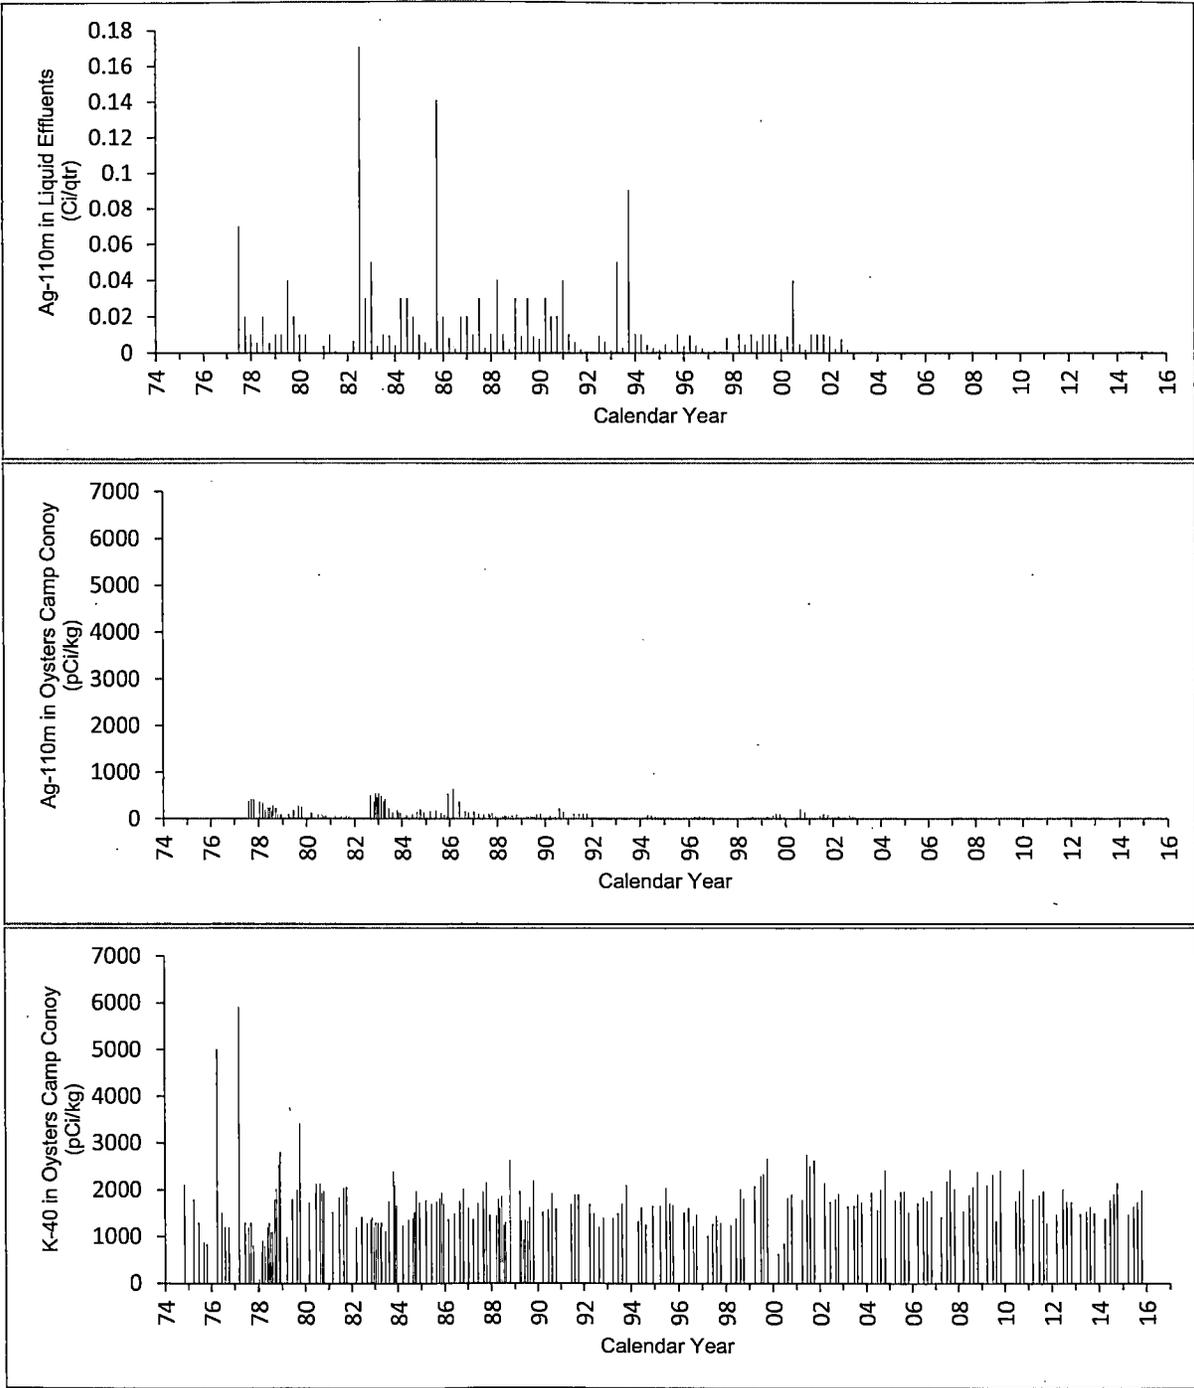

II.C.2 Atmospheric Environment

The atmospheric environment was monitored by analyzing air particulate filters and charcoal cartridges (for trapping radioiodine species). These samples were collected from five locations surrounding the plant. These locations are On Site before the Entrance to Camp Conoy (sample code A1), Camp Conoy Road at the Emergency Siren (sample code A2), Bay Breeze Road (sample code A3), Route 765 at Lusby (sample code A4), and at the Emergency Operations Facility (sample code A5).

II.C.2.a Air Particulate Filters

Weekly composite air particulate filter samples were collected from the five locations during the year. These samples were analyzed for beta activity and gamma emitters.

Weekly analyses for beta activity on air particulate filters collected from all five locations showed values characteristic of background levels. The values ranged from 0.7×10^{-2} to 4.7×10^{-2} pCi/m³ for the indicator locations and 0.8×10^{-2} to 4.7×10^{-2} pCi/m³ at the control location, as shown in Table B-6. The location with the highest overall mean of 2.1×10^{-2} pCi/m³ was A5, Emergency Offsite Facility, the control location, and the mean for indicator locations was 2.0×10^{-2} pCi/m³, as shown in Table 2.

Gamma spectrometric analyses of monthly composited air particulate samples exhibited no detectable concentrations of any plant-related radionuclides in any of these samples, as shown in Table B-7. Naturally occurring radionuclides, such as Be-7, were detected in nearly all samples.

Figure 3 depicts the historical trends of beta activity.

II.C.2.b Air Iodine


Weekly composited charcoal cartridges (for trapping radioiodine species) were collected from the five locations during the year. These samples were analyzed for radioiodine species.

Weekly radioiodine analyses of charcoal cartridges collected from all five locations exhibited no detectable concentrations of I-131, as shown in Table B-5.

Figure 3 depicts the historical trends of radioiodine.

FIGURE 3
Nuclear Fallout in the Calvert Cliffs Area

SURFACE AIR VAPORS, LUSBY, MD (A4)

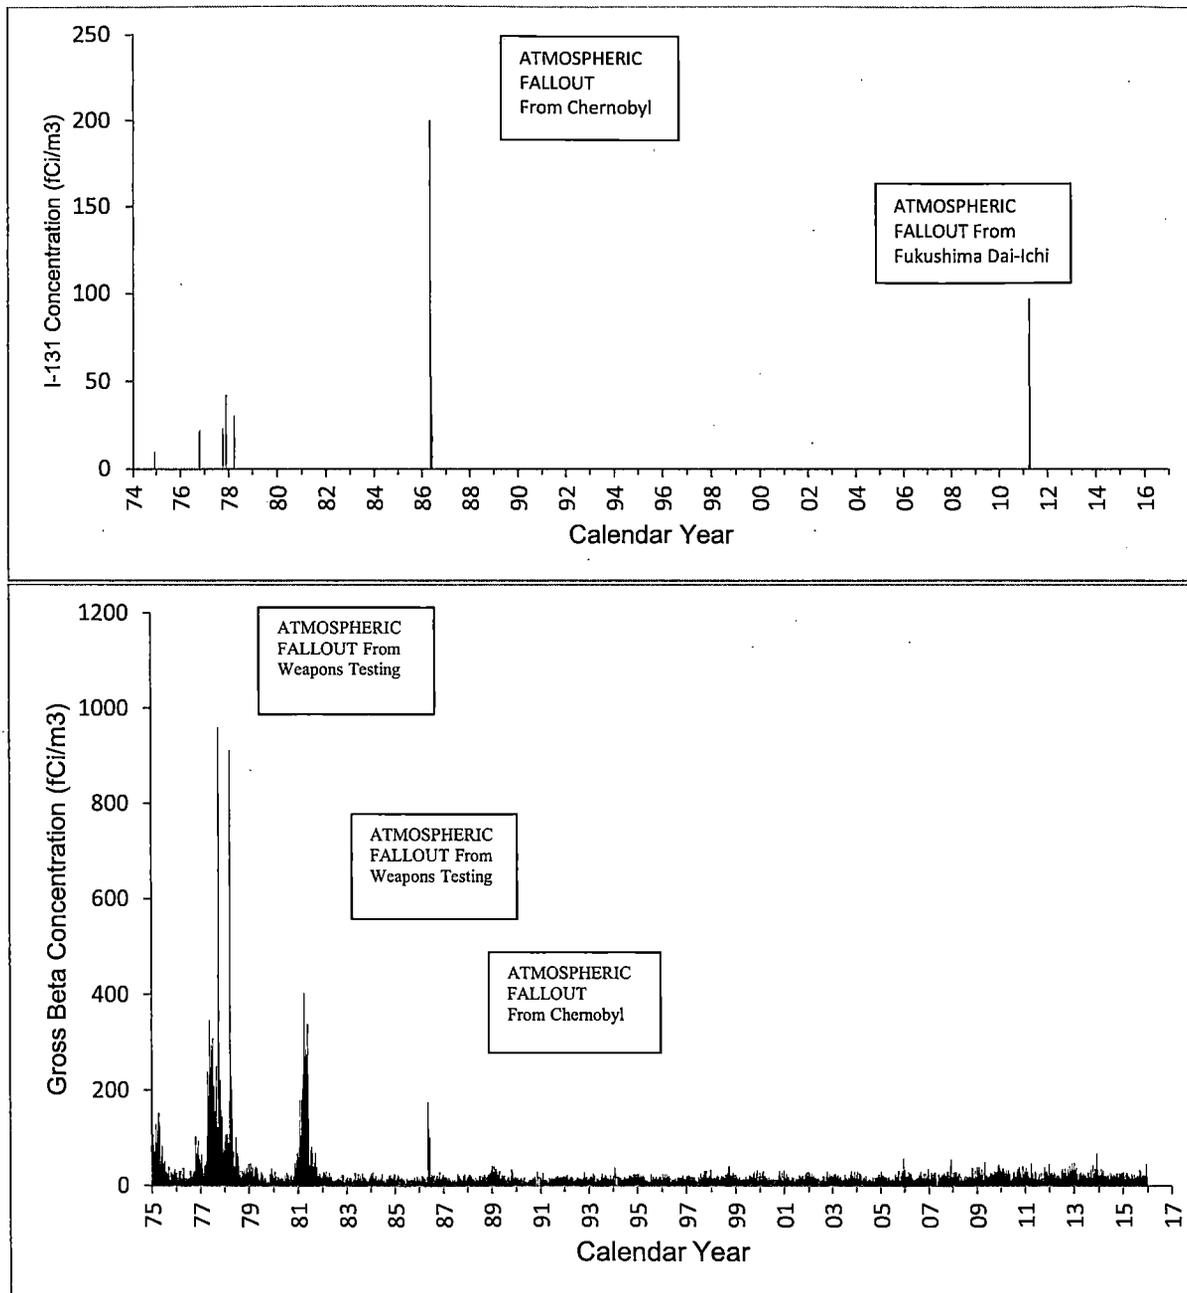

II.C.3 Terrestrial Environment

The terrestrial environment was monitored by analyzing samples of vegetation collected monthly, when available, from various sampling locations near the plant during the normal growing season.

II.C.3.a Vegetation

Vegetation samples were collected from three locations during the year. These locations are Garden Plot off Bay Breeze Road (sample codes IB1, IB2, and IB3), On Site before the Entrance to Camp Conoy (sample codes IB4, IB5, and IB6), and the Emergency Operations Facility (sample codes IB7, IB8, and IB9). These samples were analyzed for gamma emitters, including analyses for I-131, as shown in Table B-8a.

All samples showed detectable amounts of naturally occurring K-40 and Be-7. No plant related radionuclides were found in any of these samples.


II.C.4 Direct Radiation

Direct radiation is measured by a network of TLDs in each overland sector surrounding the Plant both at the plant boundary and at 4 miles from the Plant.

TLDs were collected quarterly from twenty-three locations surrounding the plant. The twenty indicator locations are On Site Along the Cliffs (sample code DR1), Route 765 Auto Dump (sample code DR2), Giovanni's Tavern (sample code DR3), Route 765 across from White Sands Drive (sample code DR4), John's Creek (sample code DR5), Lusby (sample code DR6), On Site before the Entrance to Camp Conoy (sample code DR7), On Site at Emergency Siren (sample code DR8), Bay Breeze Road (sample code DR9), Decatur and Calvert Beach Roads (sample code DR10), Dirt Road off Mackall and Parran Roads (sample code DR11), Mackall and Bowen Roads (sample code DR12), Wallville (sample code DR13), Rodney Point (sample code DR14), Mill Bridge and Turner Roads (sample code DR15), Appeal School (sample code DR16), Cove Point and Little Cove Point Roads (sample code DR17), Cove Point (sample code DR18), Long Beach (sample code DR19), and On Site Near Shore (sample code DR20). The three control locations are the Emergency Operations Facility (sample code DR21), Solomons Island (sample code DR22), and Taylors Island, Anderson's Property (sample code DR23).

At REMP locations the mean 90 day ambient radiation measured at the indicator locations was 12.01 mR and ranged from 9.63 to 15.39 mR as reported in Table 2. The control locations showed a 90 day mean of 13.46 mR with ranges from 11.24 to 16.55 mR. The location with the highest overall mean of 16.18 was Taylors Island, Anderson's Property (sample code DR23) which ranged from 15.68 to 16.55 mR. Figure 4 shows the historical comparison of the average monthly radiation levels per calendar year for TLDs on site, at four miles, and at the control locations. A comparison of the means and ranges of the current TLD data with those of both the historical data and the regional data shows no plant-related contribution to the measured direct radiation exposure.

FIGURE 4
Mean TLD Gamma Dose, Calvert Cliffs Nuclear Power Plant

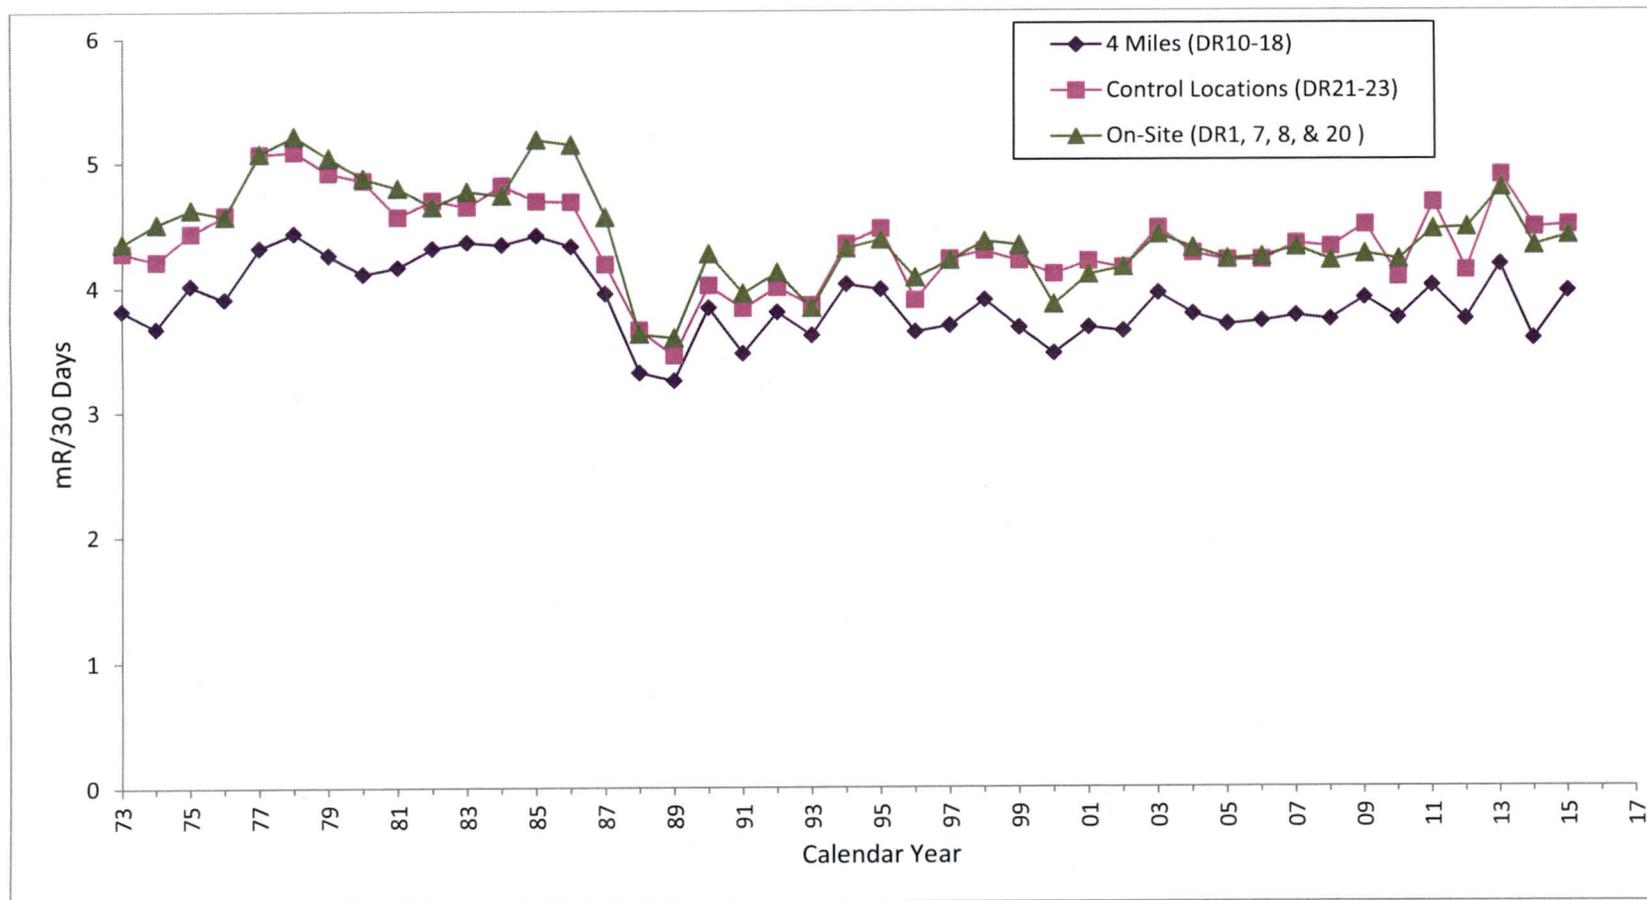

II.D. CONCLUSION

No man-made fission or activation by-products attributable to plant operations were observed in the environment surrounding the plant during the year.

Historical trends for tritium in bay water, Ag-110m and K-40 in oyster samples, nuclear fallout in the Calvert Cliffs area, and TLD data are depicted in Figures 1 through 4. As can be seen from these figures, the plant made no adverse radiological contributions to the surrounding environment.

To assess the plant's contribution to the ambient radiation levels of the surrounding environment, dose calculations were performed using the plant's 2015 effluent release data, on site meteorological data (see X/Q and D/Q values presented in Figures 5 and 6), and appropriate pathways. The results of these dose calculations indicate:

Gaseous Pathways

A maximum thyroid dose of 1.39×10^{-3} mrem to a child via the plume, ground, vegetable, and inhalation pathways at 1.1 km SW of the containments at Calvert Cliffs. This is about 0.002% of the acceptable limit of 75 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum whole body gamma dose of 4.34×10^{-4} mrem to a child at 1.1 km SW of the containments at Calvert Cliffs. This is about 0.002% of the acceptable dose limit of 25 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum dose to any other organ, in this case the skin, of 5.14×10^{-4} mrem to a child at 1.1 km SW of the containments at Calvert Cliffs. This is about 0.002% of the acceptable dose limit of 25 mrem/yr as specified in 40CFR190 and 10CFR72.104.

Liquid Pathways

A maximum thyroid dose of 2.78×10^{-2} mrem to a teen for all liquid pathways, which is about 0.037 % of the acceptable dose limit of 75 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum whole body dose of 3.88×10^{-2} mrem to a teen via all liquid pathways, which is about 0.155 % of the acceptable dose limit of 25 mrem/yr as stated in 40CFR190 and 10CFR72.104.

A maximum dose to any other organ, in this case liver, of 5.73×10^{-2} mrem to a teen for all pathways, which is 0.229% of the acceptable dose limit of 25 mrem/yr specified in 40CFR190 and 10CFR72.104.

Gaseous and Liquid Pathways Combined

A maximum thyroid dose of 2.92×10^{-2} mrem via liquid and gaseous pathways, which is about 0.039% of the acceptable limit of 75 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum whole body gamma dose of 3.92×10^{-2} mrem via liquid and gaseous pathways, which is about 0.157% of the acceptable limit of 25 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum calculated dose to all other organs via liquid and gaseous pathways was equal to 5.78×10^{-2} mrem to the skin. This dose was about 0.231% of the allowable limit of 25 mrem/yr as specified in 40CFR190 and 10CFR72.104.

In all cases, the calculated doses are a small fraction of the applicable limits specified in 40CFR190 and 10CFR72.104.

Therefore, it is concluded that the operation of Calvert Cliffs Units 1 and 2 produced radioactivity and ambient radiation levels significantly below the limits of the ODCM, 40CFR190, and 10CFR72.104. There was no significant buildup of plant-related radionuclides in the environment due to the operation of the CCNPP in 2015.

FIGURE 5

Atmospheric Dispersion Around CCNPP Average Relative Air Concentrations (X/Q)

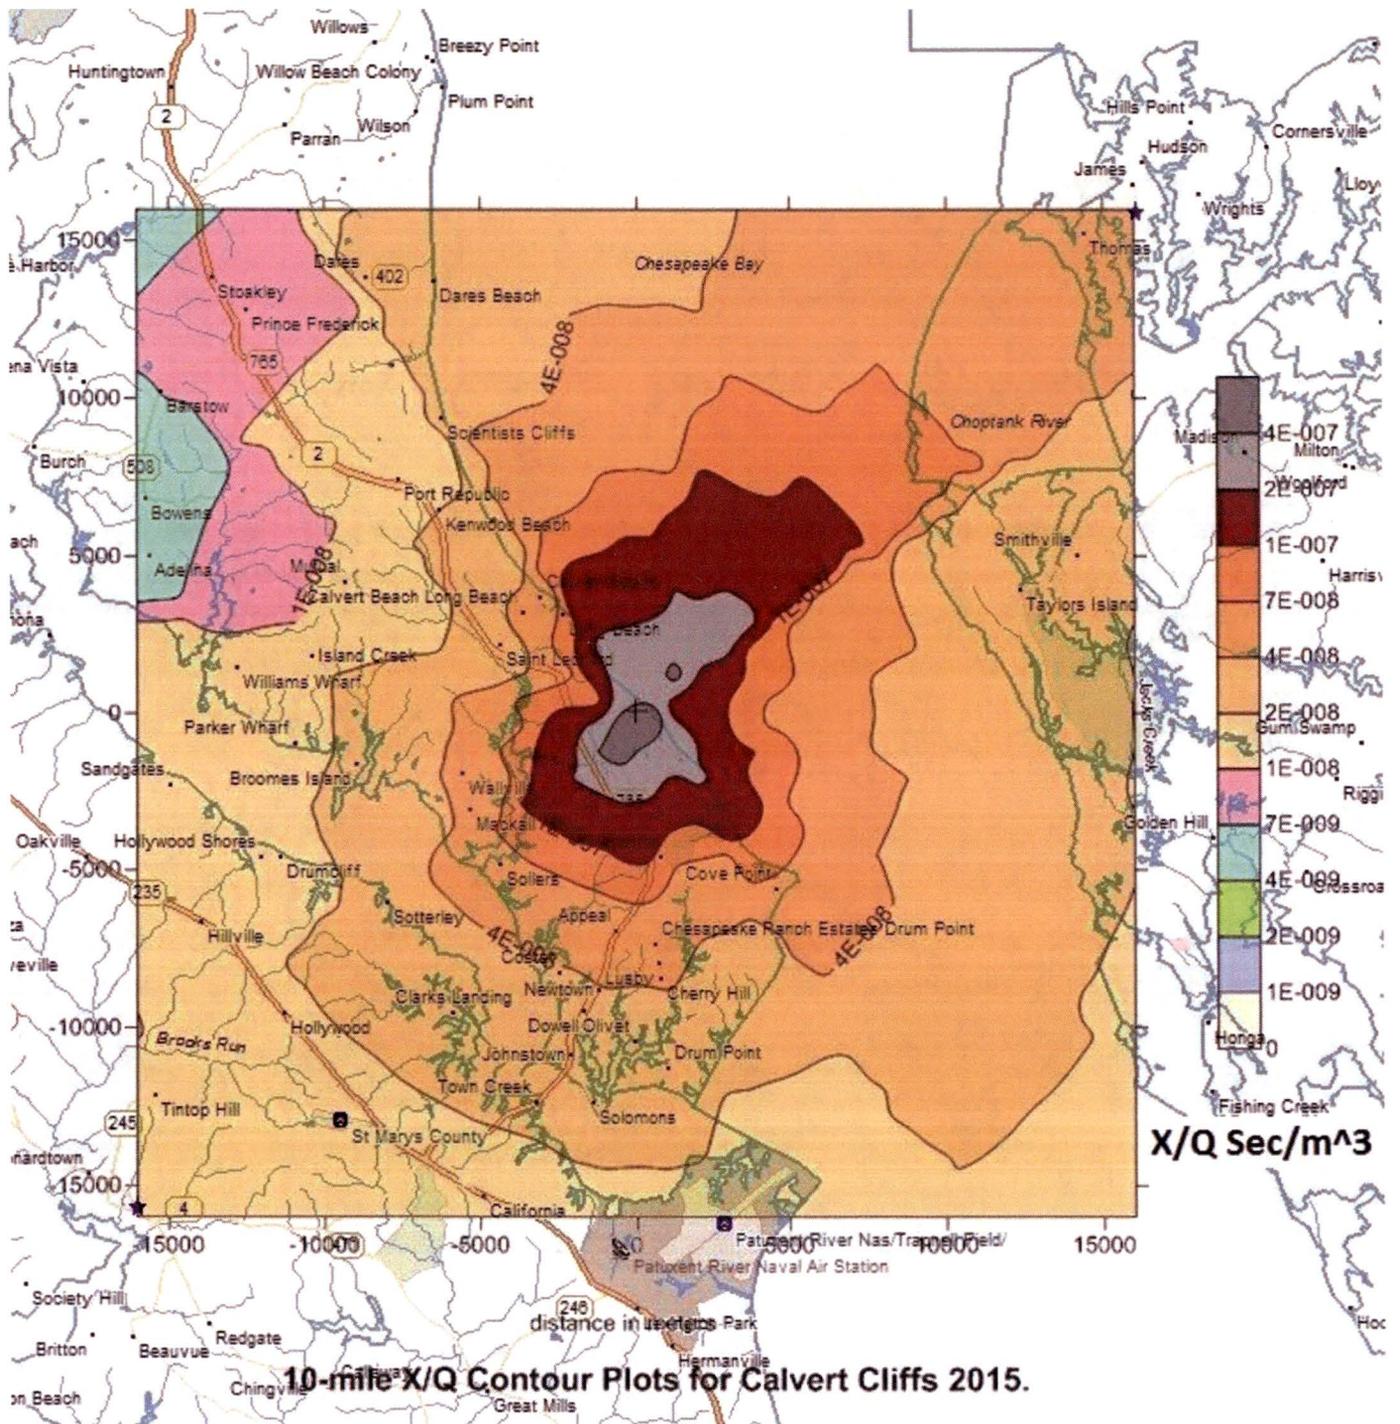


FIGURE 6

Atmospheric Dispersion Around CCNPP Average Relative Ground Deposition (D/Q)

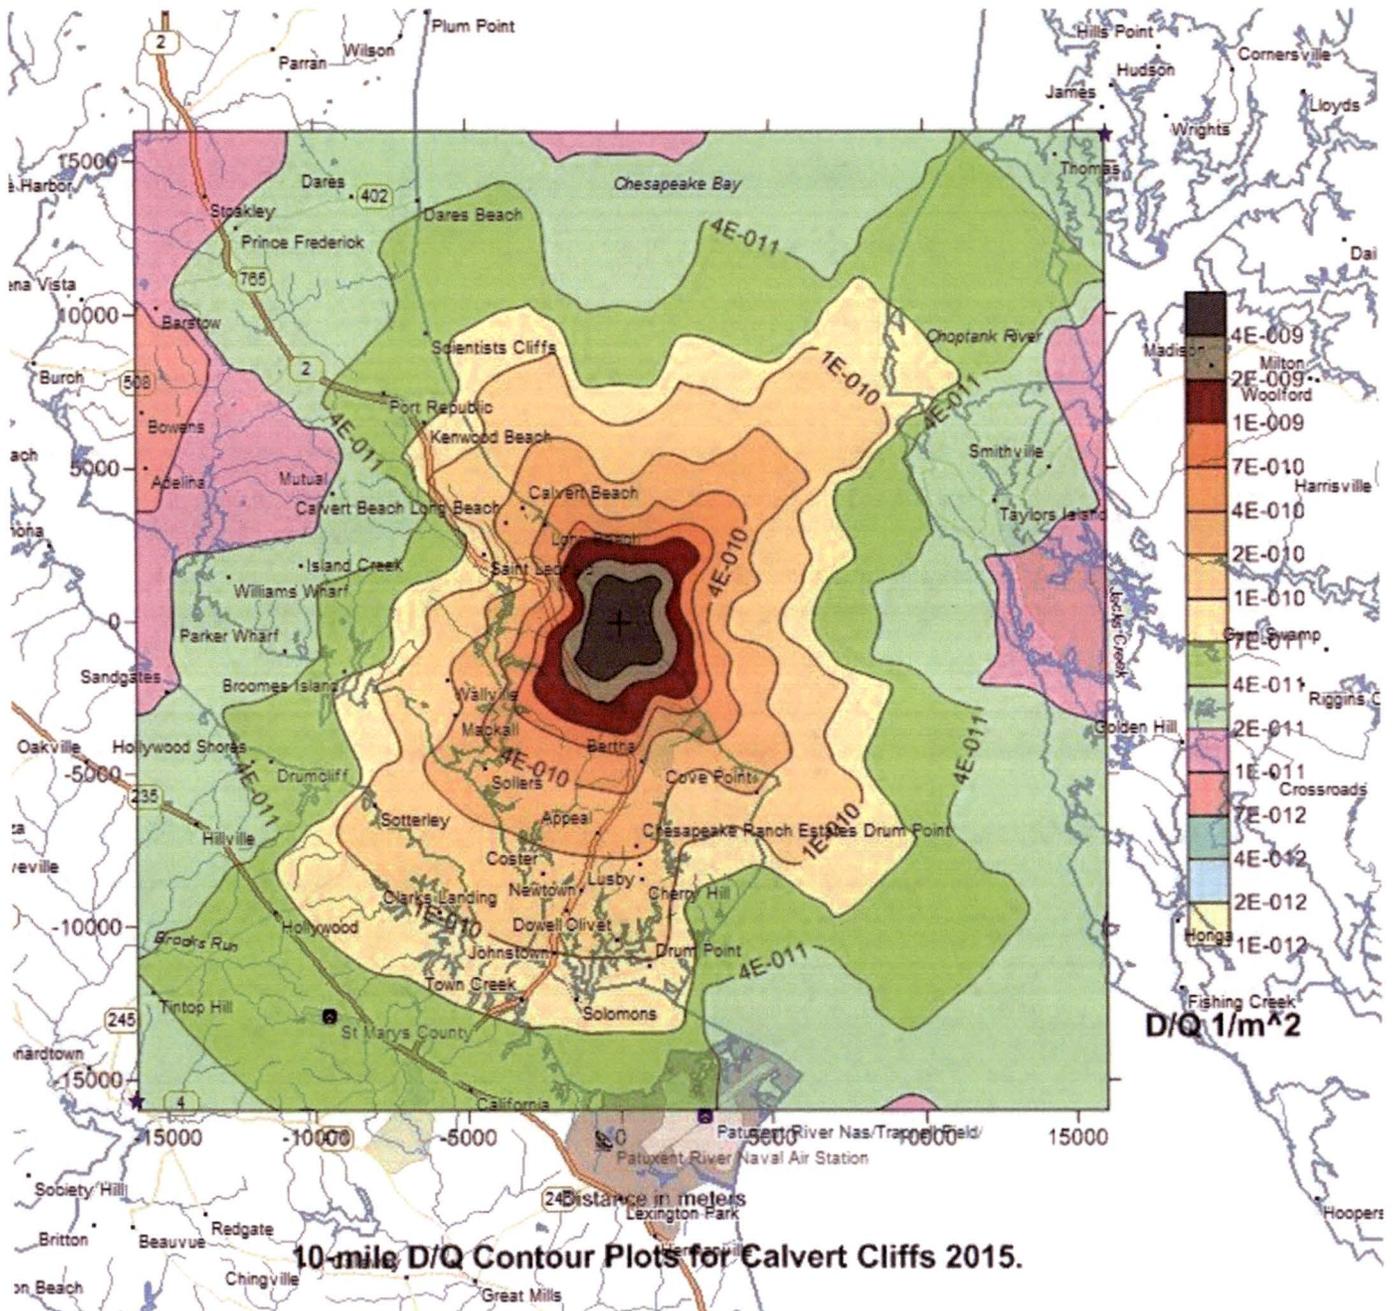


Table 1

Synopsis of 2015 Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program

Sample Type	Sampling Frequency ¹	Number of Locations	Number Collected	Analysis	Analysis Frequency ¹	Number Analyzed
Aquatic Environment						
Bay Water, Surface Water, Drinking Water	MC	2	24	Gamma	MC	24
				H3	QC	8
Fish ²	A	4	4	Gamma	A	4
Oysters	Q	2	8	Gamma	Q	8
Shoreline Sediment	SA	1	2	Gamma	SA	2
Atmospheric Environment						
Air Iodine ³	W	5	260	I-131	W	260
Air Particulates ⁴	W	5	260	Gross Beta	W	260
				Gamma	MC	60
Direct Radiation						
Ambient Radiation	Q	23	552	TLD	Q	552
Terrestrial Environment						
Vegetation ⁵	M	3	27	Gamma	M	27

¹ W=weekly, M=monthly, Q=quarterly, SA=semiannual, A=annual, C=composite

² Once in Season, July through September

³ The collection device contains Charcoal

⁴ Beta counting is performed after >72 hour decay, Gamma spectroscopy performed on monthly composites of weekly samples

⁵ Monthly during growing season when available

Table 2

**Annual Summary of Radioactivity in the Environs of the
Calvert Cliffs Nuclear Power Plant Units 1 and 2**

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (F)/Range ¹	Location with Highest Annual Mean Name/Distance & Direction ²	Highest Annual Mean (F) / Range ¹	Control Locations Mean (F)/Range
Atmospheric Environment						
Air Particulates (10 ⁻² pCi/m ³)	Gross Beta (260)	0.5	2.0 (208/208) (0.7-4.7)	EOF A5 19.3 km WNW	2.1 (52/52) (0.8-4.7)	2.1 (52/52) (0.8-4.7)
Direct Radiation						
Ambient Radiation (mR/90 days)	TLD (552)	--	12.01 (480/480) (9.63-15.39)	Taylor's Island DR23 12.6 km ENE	16.18 (24/24) (15.68-16.55)	13.46 (72/72) (11.24-16.55)

¹ Mean and range based upon detectable measurements only. Fraction (F) of detectable measurements at specified location is indicated in parentheses.

² Distance and direction from the central point between the two containment buildings.

III. INDEPENDENT SPENT FUEL STORAGE INSTALLATION RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

III.A. INTRODUCTION

In August 1990 BGE initiated a program of additional radiological environmental monitoring around the site for the Independent Spent Fuel Storage Installation (ISFSI). The first dry fuel storage canister was loaded into the ISFSI in November of 1993 with more canisters being loaded in subsequent years. During 2015, two additional canisters of spent fuel were transferred to the ISFSI.

Results of the monitoring program for the ISFSI for the current period are included in this report.

This report presents the content of the ISFSI REMP (Table 3), the ISFSI sampling locations (Appendix A), the summary of the analytical results of the period (Table 4), and a compilation of the analytical data for the period (Appendix B). Interpretation of the data and conclusions are presented in the body of the report.

The ISFSI monitoring program is as described in this section of the report.

The results were compared with that generated during the previous ISFSI pre-operational periods (Ref.11) and the current and previous CCNPP REMP periods. These results are discussed in more detail in Section III. C.

III.B. PROGRAM

III.B.1 Objectives

The objectives of the radiological environmental monitoring program for the ISFSI are:

- a. To satisfy the community concern regarding the impact of the ISFSI on the environment,
- b. To verify that radioactivity and ambient radiation levels attributable to operation of the ISFSI are within the limits specified in the Environmental Radiation Protection Standards as stated in 40CFRPart190 and 10CFR72.104,
- c. To detect any measurable buildup of long-lived radionuclides in the environment due to the ISFSI,
- d. To monitor and evaluate ambient radiation levels around the ISFSI, and
- e. To determine whether any statistically significant increase occurs in the concentration of radionuclides near the ISFSI.

III.B.2 Sample Collection

The locations of the individual sampling sites are listed in Table A-2 and shown in Figures A-4 and A-5. All samples were collected by contractors to, or personnel of, Exelon Industrial Services personnel according to Exelon Industrial Services Laboratory Procedures (Ref. 7, 8, 12).

III.B.3 Data Interpretation

Many results in environmental monitoring occur at or below the minimum detectable activity (MDA). In this report, all results at or below the relevant MDA are reported as being "less than" the MDA value.

III.B.4 Program Exceptions

There were no program exceptions during this operating period.

III.C. RESULTS AND DISCUSSIONS

All the environmental samples collected were analyzed using Exelon Industrial Services laboratory procedures (Ref. 8). The analytical results for this reporting period are presented in Appendix B and are also summarized for the period in Table 4. For discussion, the analytical results are divided into three categories. The categories are the Atmospheric Environment, the Terrestrial Environment, and Direct Radiation. These categories are further divided into subcategories according to sample type (e.g., Vegetation and Soil for Terrestrial Environment).

III.C.1 Atmospheric Environment

The atmospheric environment was monitored by analyzing air particulate filters. These samples were collected from five locations surrounding the ISFSI.

No source of airborne radioiodine exists for the ISFSI. Airborne radioiodine is, therefore, not considered in assessing the radiological impact of the ISFSI.

III.C.1.a Air Particulate Filters

Weekly composite air particulate filter samples were collected from five locations during the period. These locations are On Site before the Entrance to Camp Conoy (sample code A1; in common with the CCNPP REMP), Meteorological Station (SFA1), CCNPP Visitor's Center (SFA2), NNW of the ISFSI (SFA3), and SSE of the ISFSI (SFA4). These samples were analyzed for beta radioactivity, as shown in Table B-6 and gamma emitting radionuclides, as shown in Table B-7.

Weekly analyses for beta activity on air particulate filters collected from all five locations showed values characteristic of levels routinely observed in the REMP. As shown in Table 4, these values ranged from 0.7×10^{-2} to 4.7×10^{-2} pCi/m³ for the indicator locations and 0.7×10^{-2} to 4.3×10^{-2} pCi/m³ for the control location. The location with the highest overall mean of 2.0×10^{-2} pCi/m³ was SFA2, Visitors Center.

Gamma spectrometric analyses of monthly composited air particulate samples exhibited no detectable concentrations of any plant-related radionuclides in any of these samples. Naturally occurring radionuclides, such as Be-7, were detected in nearly all samples.

III.C.2 Terrestrial Environment

The terrestrial environment was monitored by analyzing samples of vegetation and soil collected quarterly from the vicinity of the air sampling locations for the ISFSI.

III.C.2.a Vegetation

Vegetation samples were collected quarterly from five locations during the year. These locations are: Meteorological Station (sample code SFB1), CCNPP Visitor's Center (sample code SFB2), NNW of the ISFSI (sample code SFB3), SSE of the ISFSI (sample code SFB4), and On Site before the Entrance to Camp Conoy (sample code SFB5).

Vegetation samples were analyzed for gamma emitting radionuclides, as shown in Table B-8b. Cesium-137 was detected in two samples at an indicator location. The Cs-137 concentration was 51 ± 30 pCi/kg on 03/16/2015 and 192 ± 45 pCi/kg on 10/27/2015, both at On Site before the Entrance to Camp Conoy (sample code SFB5). While the presence of Cs 137 in these samples may be plant-related, this range is consistent with that found to be due to the residual fallout from past atmospheric nuclear weapons testing. The activities of this radionuclide are well below the federal limits established in 40CFR190 and 10CFR72.104. These results are comparable to those observed in previous annual reporting periods for the CCNPP REMP and in the earlier pre-operational data for the ISFSI. No detectable concentrations of plant-related radionuclides were found in any of these samples. Naturally occurring radionuclides such as K-40 were detected in all samples.

III.C.2.b Soils

Soil samples were collected quarterly from five locations surrounding the ISFSI in the vicinity of the air samplers. These locations are: Meteorological Station (sample code SFS1), CCNPP Visitor's Center (sample code SFS2), NNW of the ISFSI (sample code SFS3), SSE of the ISFSI (sample code SFS4), and On Site before the Entrance to Camp Conoy (sample code SFS5).

Soil samples were analyzed for gamma emitting radionuclides, as shown in Table B-9. Cesium-137 was detected in ten quarterly samples from both indicator and control locations. The Cs-137 concentrations ranged from 49 ± 29 to 171 ± 51 pCi/kg. While the presence of Cs 137 in these samples may be plant-related, this range is consistent with that found to be due to the residual fallout from past atmospheric nuclear weapons testing. The activities of this radionuclide are well below the federal limits established in 40CFR190 and 10CFR72.104. These are comparable

to those observed in previous annual reporting periods for the CCNPP REMP and in the earlier pre-operational data for the ISFSI. No detectable concentrations of plant-related radionuclides were found in any of these samples. Naturally occurring radionuclides such as K-40 were also detected in all these samples.

III.C.3 Direct Radiation

Direct radiation is measured by a network of TLDs surrounding the ISFSI. These TLDs are collected quarterly from nineteen locations surrounding the ISFSI, plus one control TLD location at the Visitor's Center (sample code SFDR7). The locations include On Site before the Entrance to Camp Conoy (sample code DR7, common to both the CCNPP Program and the ISFSI Program) and the Meteorological Station (sample code DR30, previously a location maintained for historical continuity.) The other sampling locations are: SW of ISFSI, (sample code SFDR1); NNW of ISFSI, (sample code SFDR2); North of ISFSI, (sample code SFDR3); NE of ISFSI, (sample code SFDR4); East of ISFSI, (sample code SFDR5); ESE of ISFSI, (sample code SFDR6); NNW of ISFSI, (sample code SFDR8); SSE of ISFSI, (sample code SFDR9); NW of ISFSI, (sample code SFDR10); WNW of ISFSI, (sample code SFDR11); WSW of ISFSI, (sample code SFDR12); South of ISFSI, (sample code SFDR13); SE of ISFSI, (sample code SFDR14); ENE of ISFSI, (sample code SFDR15); SSW of ISFSI, (sample code SFDR16); NNE of ISFSI, (sample code SFDR17) and West of ISFSI, (sample code SFDR18). Sampling locations are shown on Figures A-4 and A-5.

The mean 90 day ambient radiation measured at the ISFSI indicator locations was 28.39 mR and ranged from 10.45 to 46.36 mR, as shown in Table 4. The control location showed a 90 day mean of 12.88 mR and ranged from 12.34 to 13.44 mR. The location with the highest overall mean of 44.01 mR with a range of 41.09 to 46.29 mR was SFDR18, West of ISFSI. These readings are consistent with those expected from the storage of spent fuel in the ISFSI. A comparison of the average monthly radiation levels per calendar year of the ISFSI TLD data from the indicator locations with the ISFSI control location at the Visitor's Center, SFDR7, can be seen in Figure 7.

III.D. CONCLUSION

Low levels of Cs-137 were observed in the environment surrounding the ISFSI during the period. The Cs-137 observations were attributed to fallout from past atmospheric weapons testing. No plant-related radionuclides were observed in the environs of the ISFSI.

In general, the results in the following tables continue the historical trends previously observed at the official sites of the CCNPP REMP.

FIGURE 7
Mean TLD Gamma Dose, ISFSI

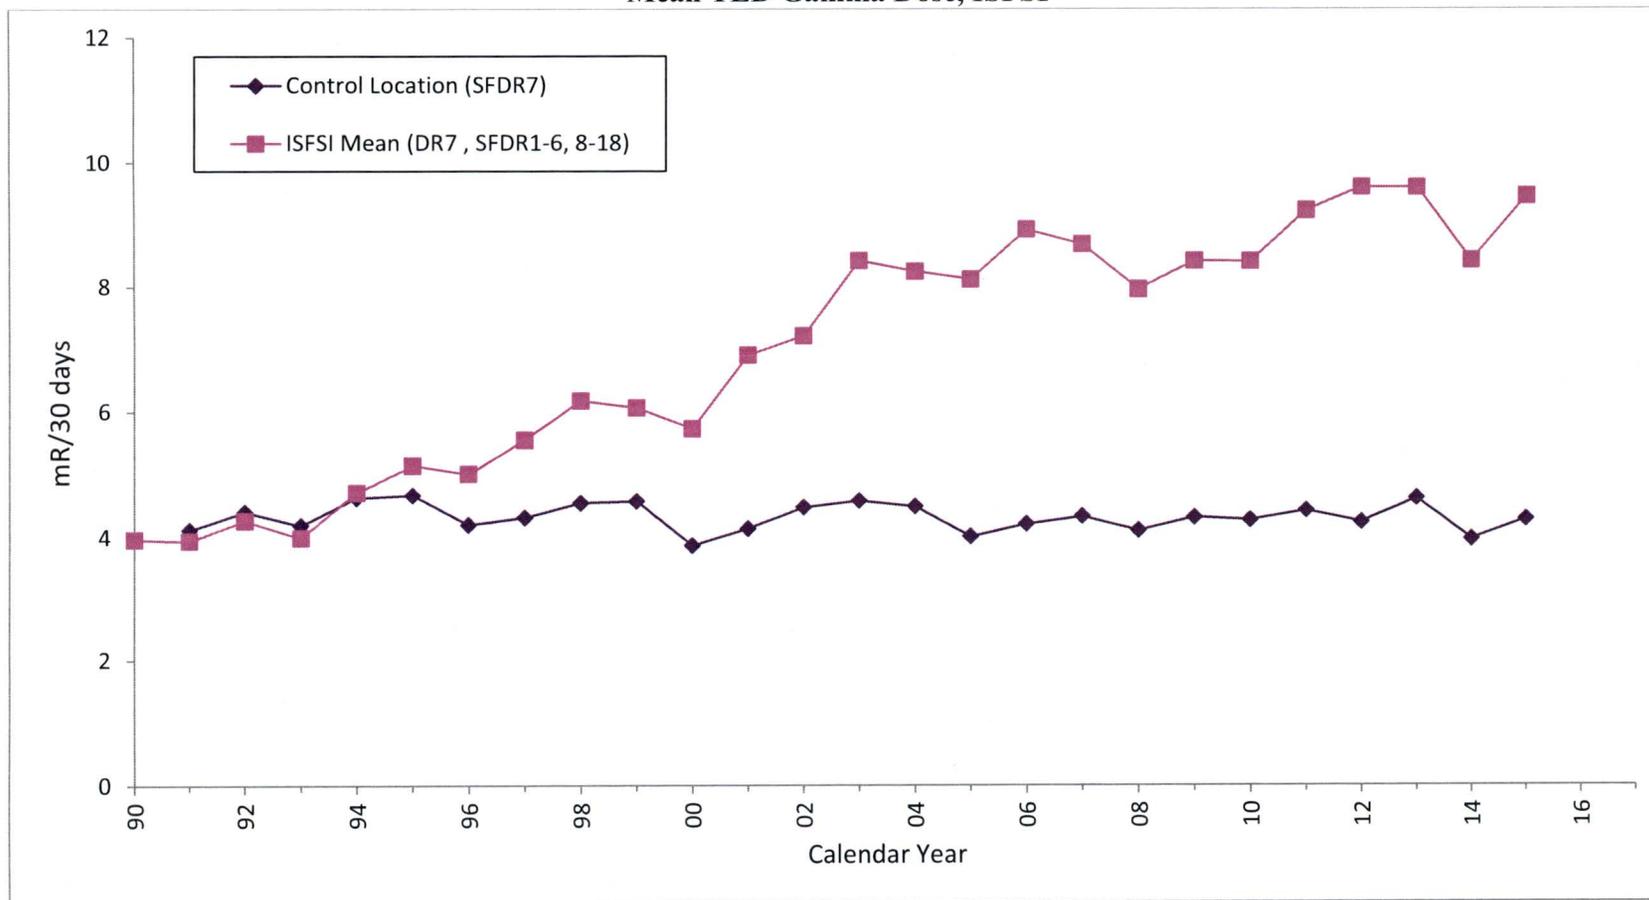


Table 3

**Synopsis of 2015 Calvert Cliffs Nuclear Power Plant
Independent Spent Fuel Storage Installation
Radiological Environmental Monitoring Program**

Sample Type	Sampling Frequency ¹	Number of Locations	Number Collected	Analysis	Analysis Frequency ¹	Number Analyzed
Atmospheric Environment						
Air Particulates ²	W	5	260	Gross Beta	W	260
				Gamma	MC	60
Direct Radiation						
Ambient Radiation	Q	20	480	TLD	Q	480
Terrestrial Environment						
Vegetation	Q	5	20	Gamma	Q	20
Soil	Q	5	20	Gamma	Q	20

¹ W=weekly, M=monthly, Q=quarterly, SA=semiannual, A=annual, C=composite

² Beta counting is performed after >72 hour decay, Gamma spectroscopy performed on monthly composites of weekly samples

Table 4
Annual Summary of Radioactivity in the Environs of the
Calvert Cliffs Nuclear Power Plant Independent Spent Fuel Storage Installation

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (F)/Range ¹	Location with Highest Annual Mean Name/Distance & Direction ²	Highest Annual Mean (F) / Range ¹	Control Locations Mean (F)/Range
Atmospheric Environment						
Air Particulates (10 ⁻² pCi/m ³)	Gross Beta (260)	0.5	2.0 (208/208) (0.7-4.7)	Visitors Center SFA2 0.7 km NNE	2.0 (52/52) (0.7-4.3)	2.0 (52/52) (0.7-4.3)
Direct Radiation						
Ambient Radiation (mR/90 days)	TLD (480)	--	28.39 (456/456) (10.45-46.36)	West of ISFSI SFDR18 0.1 km W	44.01 (24/24) (41.09-46.29)	12.88 (24/24) (12.34-13.44)
Terrestrial Environment						
Vegetation (pCi/L)	Gamma (20) Cs-137	27	122 (2/16) (51-192)	On Site Before Entrance to Camp Conoy SFB5 0.7 km ESE	122 (2/4) (51-192)	--
Soil (pCi/kg)	Gamma (20) Cs-137	17	125 (6/16) (58-171)	Entrance to Camp Conoy SFS5 0.7 km ESE	136 (4/4) (101-171)	61 (4/4) (49-71)

¹ Mean and range based upon detectable measurements only. Fraction (F) of detectable measurements at specified location is indicated in parentheses.

² Distance and direction from the central point between the two containment buildings.

IV. REFERENCES

- (1) Cohen, L. K., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 882 Semiannual Report January-June 1971, December 1971; NUS No. 1025 Annual Report 1971, March 1973.
- (2) Cohen, L. K., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 1137 Annual Report 1972, December 1973.
- (3) Cohen, L. K. and Malmberg, M.S., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 1188, Annual Report 1973, October 1974.
- (4) Malmberg, M. S., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 1333, Data Summary Report, September 1970 to September 1974, July 1975
- (5) Calvert Cliffs Nuclear Power Plant, Units 1 and 2, License Nos. DPR-53 and DPR-69, Technical Specification 5.6.2; Annual Radiological Environmental Operating Report.
- (6) Offsite Dose Calculation Manual for the Calvert Cliffs Nuclear Power Plant.
- (7) CP-234, Specification and Surveillance for the Radiological Environmental Monitoring Program.
- (8) Exelon Industrial Services Quality Assurance Program Manual
- (9) Constellation Energy Nuclear Group, "Land Use Survey Around Calvert Cliffs Nuclear Power Plant, August 2015."
- (10) Calvert Cliffs Independent Spent Fuel Storage Installation Technical Specifications, Appendix A to Materials License SNM-2505
- (11) Baltimore Gas and Electric Company, Radiological Environmental Monitoring Program Pre-Operational Report for the Calvert Cliffs Independent Spent Fuel Storage Installation, August 1990 - November 1993, February 1994.
- (12) CP-501, Liquid and Steam Sampling Techniques
- (13) CY-AA-170-1000, Radiological Environmental Monitoring Program (REMP) and Meteorological Program Implementation.
- (14) GEL 2015 Annual Quality Assurance Report for the Radiological Environmental Monitoring Program (REMP)

APPENDIX A

Sample Locations for the REMP and the ISFSI

Appendix A contains information concerning the environmental samples which were collected during this operating period.

Sample locations and specific information about individual locations for the CCNPP REMP are given in Table A-1. Figure A-1 shows the location of the CCNPP in relation to Southern Maryland and the Chesapeake Bay. Figures A-2 and A-3 show the locations of the power plant sampling sites in relation to the plant site at different degrees of detail.

Sample locations and specific information about individual locations for the ISFSI radiological environmental monitoring program are given in Table A-2. Figures A-4 and A-5 show the locations of the ISFSI sampling sites in relation to the plant site at different degrees of detail.

TABLE OF CONTENTS - SAMPLING LOCATIONS

Table	Title	Page
A-1	Locations of Environmental Sampling Stations for the Calvert Cliffs Nuclear Power Plant..	28
A-2	Locations of Environmental Sampling Stations for the Independent Spent Fuel Storage Installation at Calvert Cliffs.....	32

Figure	Title	Page
A-1	Map of Southern Maryland and Chesapeake Bay Showing Location of Calvert Cliffs Nuclear Power Plant	29
A-2	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-2 Miles	30
A-3	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-10 Miles	31
A-4	Independent Spent Fuel Storage Installation Sampling Locations	33
A-5	Enlarged Map of the Independent Spent Fuel Storage Installation Sampling Locations	34

TABLE A-1

**Locations of Environmental Sampling Stations
for the Calvert Cliffs Nuclear Power Plant**

Station	Description	Distance ¹		Direction ¹ (Sector)
		(KM)	(Miles)	
A1 ²	On Site Before Entrance to Camp Conoy	0.7	0.4	S
A2	Camp Conoy Rd, at emergency siren	2.5	1.6	SSE
A3	Bay Breeze Rd	2.6	1.6	SE
A4	Route 765, Lusby	2.9	1.8	SSW
A5	Emergency Operations Facility	19.3	12.0	WNW
DR01	On Site, along Cliffs	0.6	0.4	NW
DR02	Route 765, Auto Dump	2.7	1.7	WNW
DR03	Route 765, Giovanni's Tavern (Knotty Pine)	2.3	1.4	W
DR04	Route 765, White Sands Drive	2.0	1.2	WSW
DR05	Route 765, John's Creek	2.4	1.5	SW
DR06	Route 765, Lusby	2.9	1.8	SSW
DR07 ²	On Site Before Entrance to Camp Conoy	0.7	0.4	S
DR08	Camp Conoy Rd at Emergency Siren	2.5	1.6	SSE
DR09	Bay Breeze Rd	2.6	1.6	SE
DR10	Calvert Beach Rd and Decatur Street	6.4	4.0	NW
DR11	Dirt road off Mackall & Parren Rd	6.6	4.1	WNW
DR12	Mackall & Bowen Rds	6.7	4.2	W
DR13	Mackall Rd, near Wallville	6.1	3.8	WSW
DR14	Rodney Point	6.4	4.0	SW
DR15	Mill Bridge & Turner Rds	6.2	3.9	SSW
DR16	Across from Appeal School	6.5	4.0	S
DR17	Cove Point & Little Cove Point Rds	5.9	3.7	SSE
DR18	Cove Point	7.1	4.4	SE
DR19	Long Beach	4.4	2.7	NW
DR20	On site, near shore	0.4	0.2	NNW
DR21	Emergency Operations Facility (EOF)	19.3	12.0	WNW
DR22	Solomons Island	12.5	7.8	S
DR23	Taylor's Island, Anderson's Property	12.6	7.8	ENE
IA1	Discharge Area	0.3	0.2	N
IA10	Hog Island	15.3	9.5	SSE
IA2	Discharge Vicinity	0.3	0.2	N
IA3	Camp Conoy	0.9	0.6	E
IA4	Patuxent River	0.0	0.0	Various
IA5	Patuxent River	0.0	0.0	Various
IA6	Kenwood Beach	10.7	6.7	NNW
IB1	Garden Off Bay Breeze Rd	2.6	1.6	SSE
IB2	Garden Off Bay Breeze Rd	2.6	1.6	SSE
IB3	Garden Off Bay Breeze Rd	2.6	1.6	SSE
IB4	On site, before entrance to Camp Conoy	0.7	0.4	S
IB5	On site, before entrance to Camp Conoy	0.7	0.4	S
IB6	On site, before entrance to Camp Conoy	0.7	0.4	S
IB7	Emergency offsite facility	19.3	12.0	WNW
IB8	Emergency offsite facility	19.3	12.0	WNW
IB9	Emergency offsite facility	19.3	12.0	WNW
WA1	Intake area	0.2	0.1	NNE
WA2	Discharge area	0.3	0.2	N
WB1	Shoreline at Barge Rd.	0.6	0.4	ESE

¹ Distance and direction from the central point between the two containment buildings

² Common to both the REMP and ISFSI monitoring program

Figure A-1

Map of Southern Maryland and Chesapeake Bay Showing Location of Calvert Cliffs Nuclear Power Plant

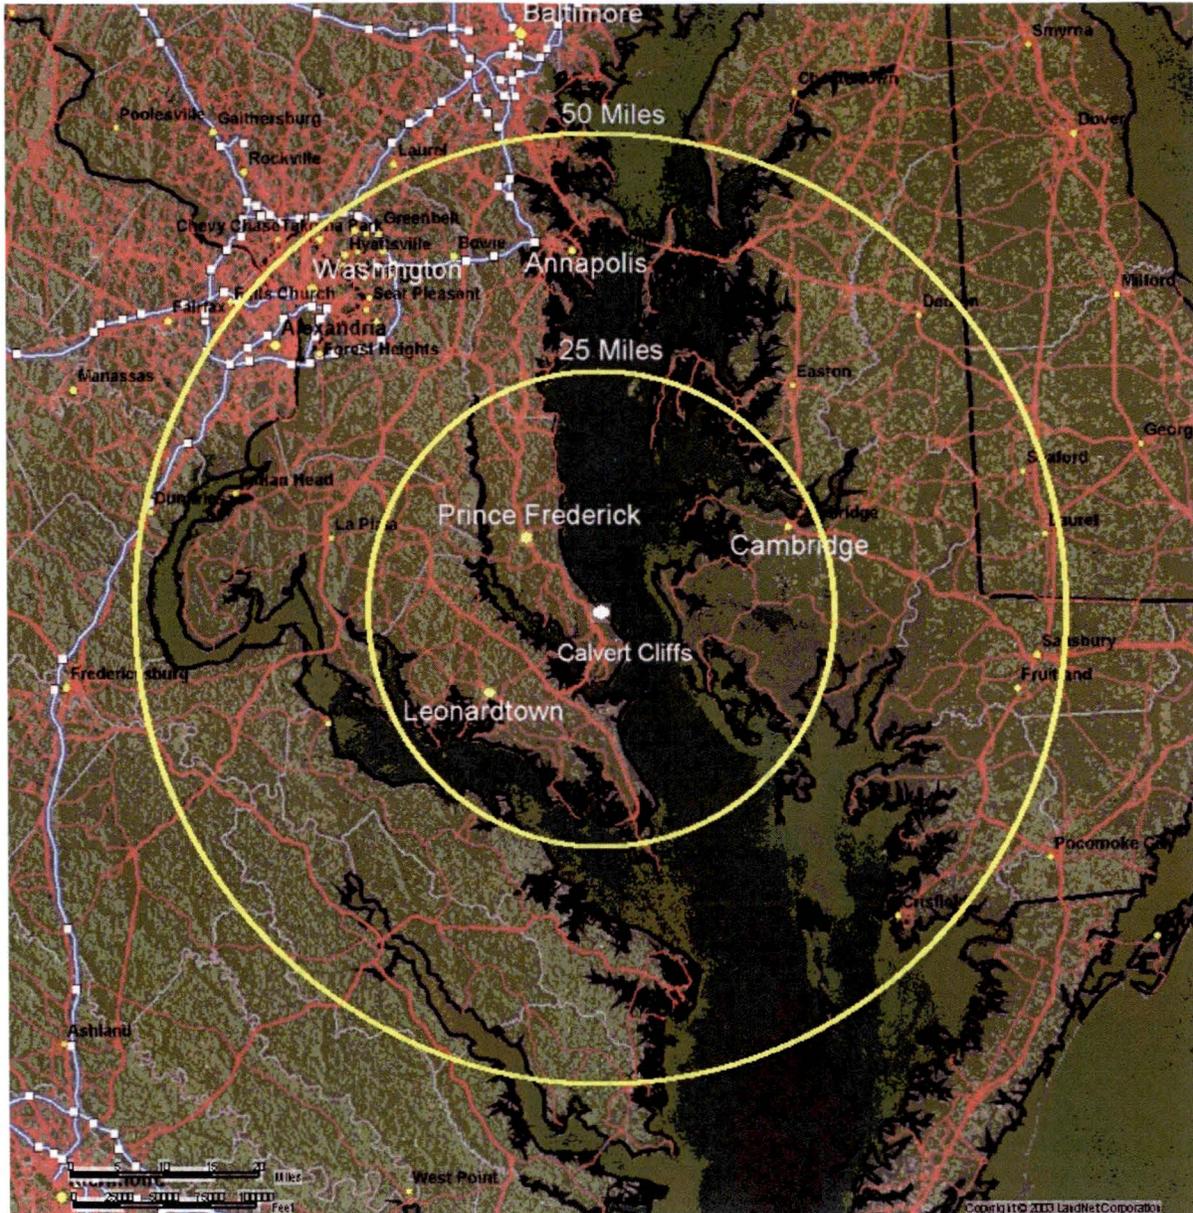


Figure A-2
Calvert Cliffs Nuclear Power Plant Sampling Locations
0-2 Miles

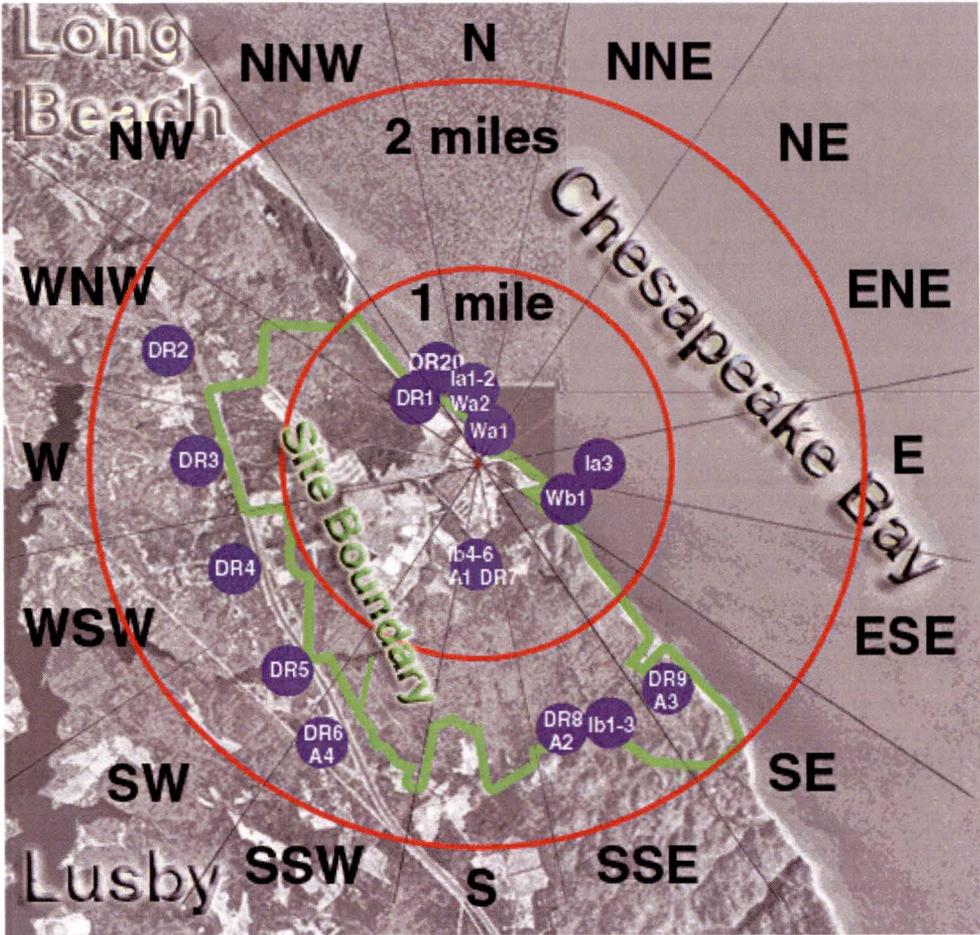


Figure A-3

Calvert Cliffs Nuclear Power Plant Sampling Locations
0-10 Miles



Table A-2

**Locations of Environmental Sampling Stations for the
Independent Spent Fuel Storage Installation at Calvert Cliffs**

Station	Description	Distance ¹	Direction ¹
		(KM)	(Sector)
Air Particulate			
A1 ²	On Site Before Entrance to Camp Conoy	0.7	S
SFA1	Meteorological Station	0.4	NW
SFA2	CCNPP Visitor's Center	0.7	NNE
SFA3	NNW of ISFSI	0.1	NNW
SFA4	SSE of ISFSF	0.1	SSE
Direct Radiation			
DR07 ²	On Site Before Entrance to Camp Conoy	0.7	S
DR30	Meteorological Station	0.4	NW
SFDR01	SW of ISFSI	0.1	SW
SFDR02	NNW of ISFSI	0.1	N
SFDR03	North of ISFSI	0.1	N
SFDR04	NE of ISFSI	0.1	NE
SFDR05	East of ISFSI	0.1	E
SFDR06	ESE of ISFSI	0.1	ESE
SFDR07	CCNPP Visitor's Center	0.7	NNE
SFDR08	NNW of ISFSI	0.1	NNW
SFDR09	SSE of ISFSI	0.1	SSE
SFDR10	NW of ISFSI	0.1	NW
SFDR11	WNW ISFSI	0.1	WNW
SFDR12	WSW of ISFSI	0.1	WSW
SFDR13	South of ISFSI	0.1	S
SFDR14	SE of ISFSI	0.1	SE
SFDR15	ENE of ISFSI	0.1	ENE
SFDR16	SSW of ISFSI	0.1	SW
SFDR17	NNE of ISFSI	0.1	NNE
SFDR18	West of ISFSI	0.1	W
Vegetation			
SFB1	ISFSI Vegetation Met Station	0.4	NW
SFB2	ISFSI Vegetation Visitors Center	0.7	NNE
SFB3	ISFSI Vegetation NNW of ISFSI	0.1	NNW
SFB4	ISFSI vegetation SSE of ISFSI	0.1	SSE
SFB5	On Site Before Entrance to Camp Conoy	0.7	ESE
Soil			
SFS1	ISFSI Soil Meteorological Station	0.4	NW
SFS2	ISFSI Soil CCNPP Visitors Center	0.7	NNE
SFS3	ISFSI Soil NNW of ISFSI	0.1	NNW
SFS4	ISFSI Soil SSE of ISFSI	0.1	SSE
SFS5	ISFSI Soil On Site Before entrance to Camp Conoy	0.7	ESE

¹ Distance and direction from the central point of the ISFSI

² Common to both the REMP and ISFSI monitoring program

Figure A-4

Independent Spent Fuel Storage Installation Sampling Locations


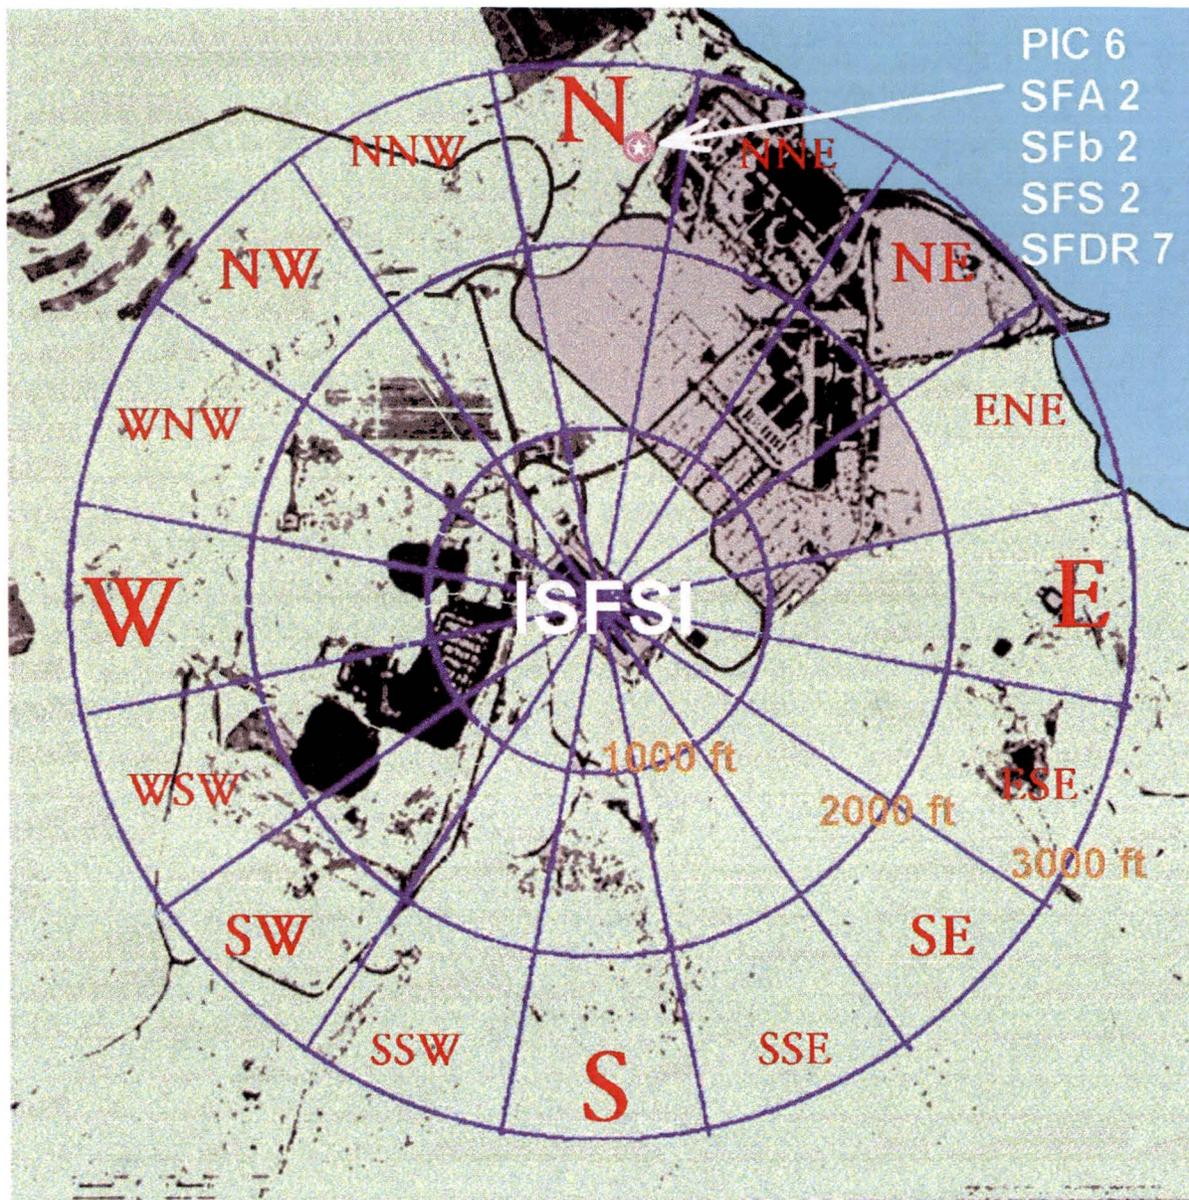


Figure A-5

Enlarged Map of the Independent Spent Fuel Storage Installation
Sampling Locations

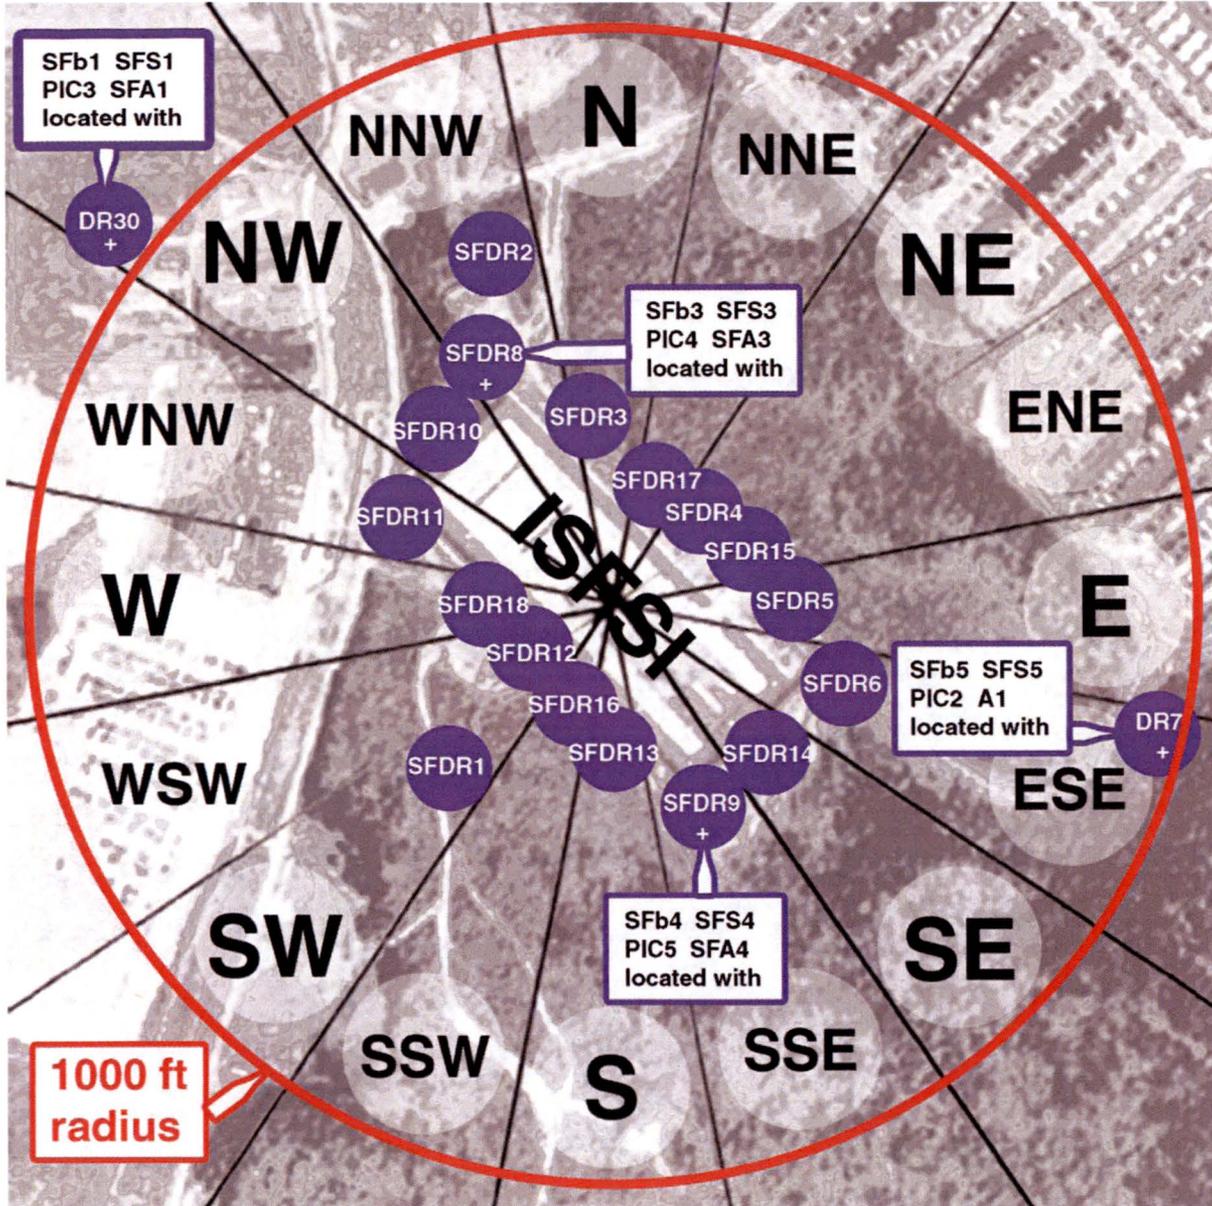

APPENDIX B
Analysis Results for the REMP and the ISFSI

Appendix B is a presentation of the analytical results for the CCNPP and the ISFSI radiological environmental monitoring programs.

TABLE OF CONTENTS - ANALYTICAL RESULTS

Table	Title	Page
B-1	Concentration of Tritium and Gamma Emitters in Bay Water	37
B-2	Concentration of Gamma Emitters in the Flesh of Edible Fish	38
B-3	Concentration of Gamma Emitters in Oyster Samples	39
B-4	Concentration of Gamma Emitters in Shoreline Sediment.....	40
B-5	Concentration of Iodine-131 in Filtered Air	41
B-6	Concentration of Beta Emitters in Air Particulates.....	43
B-7	Concentration of Gamma Emitters in Air Particulates	47
B-8a	Concentration of Gamma Emitters in Vegetation Samples	48
B-8b	Concentration of Gamma Emitters in Vegetation From Locations Around the ISFSI.....	49
B-9	Concentration of Gamma Emitters in Soil Samples From Locations Around the ISFSI	50
B-10	Typical MDA Ranges for Gamma Spectrometry	51
B-11	Typical LLDs for Gamma Spectrometry	52
B-12	Direct Radiation	53

Table B-1

**Concentration of Tritium and Gamma Emitters in Bay Water
(Results in units of pCi/L +/- 2σ)**

Sample Code	Sample Date	Gamma Emitters	H-3
WA1			
Intake Vicinity	1/2/2015	*	
	2/2/2015	*	
	3/4/2015	*	
	4/3/2015	*	<155
	5/3/2015	*	
	6/1/2015	*	
	7/3/2015	*	<180
	8/3/2015	*	
	9/2/2015	*	
	10/3/2015	*	<179
	11/2/2015	*	
	12/3/2015	*	
	12/31/2015	*	<109
WA2			
Discharge Vicinity	1/2/2015	*	
	2/2/2015	*	
	3/4/2015	*	
	4/3/2015	*	<156
	5/3/2015	*	
	6/1/2015	*	
	7/3/2015	*	<179
	8/3/2015	*	
	9/2/2015	*	
	10/3/2015	*	<173
	11/2/2015	*	
	12/3/2015	*	
	12/31/2015	*	<110

* All Non-Natural Gamma Emitters <MDA

Table B-2

**Concentration of Gamma Emitters in the Flesh of Edible Fish
(Results in units of pCi/kg (wet) +/- 2σ)**

Sample Code	Sample Date	Sample Type	Gamma Emitters
IA1 Discharge Area	8/18/2015	Bluefish	*
IA2 Discharge Area	9/24/2015	Perch	*
IA4 ¹ Patuxent River	8/18/2015	Bluefish	*
IA5 ¹ Patuxent River	9/24/2015	Perch	*

¹ Control Location

* All Non-Natural Gamma Emitters <MDA

Table B-3

**Concentration of Gamma Emitters in Oyster Samples
(Results in units of pCi/kg (wet) +/- 2σ)**

Sample Code	Sample Date	Gamma Emitters
IA3 Camp Conoy	3/24/2015	*
	6/16/2015	*
	8/18/2015	*
	10/21/2015	*
IA6 ¹ Kenwood Beach	3/24/2015	*
	6/16/2015	*
	8/18/2015	*
	10/21/2015	*

¹ Control Location

* All Non-Natural Gamma Emitters <MDA

Table B-4

**Concentration of Gamma Emitters in Shoreline Sediment
(Results in units of pCi/kg (dry) +/- 2 σ)**

Sample Code	Sample Date	Gamma Emitters
WB1		
Shoreline at Barge Rd.	3/31/2015	*
	10/27/2015	*

* All Non-Natural Gamma Emitters <MDA

Table B-5

Concentration of Iodine-131 in Filtered Air
(Results in units of 10^{-3} pCi/m³ +/- 2σ)

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
12/29/2014	1/5/2015	*	*	*	*	*
1/5/2015	1/12/2015	*	*	*	*	*
1/12/2015	1/19/2015	*	*	*	*	*
1/19/2015	1/26/2015	*	*	*	*	*
1/26/2015	2/2/2015	*	*	*	*	*
2/2/2015	2/9/2015	*	*	*	*	*
2/9/2015	2/16/2015	*	*	*	*	*
2/16/2015	2/23/2015	*	*	*	*	*
2/23/2015	3/2/2015	*	*	*	*	*
3/2/2015	3/9/2015	*	*	*	*	*
3/9/2015	3/16/2015	*	*	*	*	*
3/16/2015	3/23/2015	*	*	*	*	*
3/23/2015	3/30/2015	*	*	*	*	*
3/30/2015	4/6/2015	*	*	*	*	*
4/6/2015	4/13/2015	*	*	*	*	*
4/13/2015	4/20/2015	*	*	*	*	*
4/20/2015	4/27/2015	*	*	*	*	*
4/27/2015	5/4/2015	*	*	*	*	*
5/4/2015	5/11/2015	*	*	*	*	*
5/11/2015	5/18/2015	*	*	*	*	*
5/18/2015	5/25/2015	*	*	*	*	*
5/25/2015	6/1/2015	*	*	*	*	*
6/1/2015	6/8/2015	*	*	*	*	*
6/8/2015	6/15/2015	*	*	*	*	*
6/15/2015	6/22/2015	*	*	*	*	*
6/22/2015	6/29/2015	*	*	*	*	*
6/29/2015	7/6/2015	*	*	*	*	*
7/6/2015	7/13/2015	*	*	*	*	*
7/13/2015	7/20/2015	*	*	*	*	*
7/20/2015	7/27/2015	*	*	*	*	*
7/27/2015	8/3/2015	*	*	*	*	*
8/3/2015	8/10/2015	*	*	*	*	*
8/10/2015	8/17/2015	*	*	*	*	*
8/17/2015	8/24/2015	*	*	*	*	*
8/24/2015	8/31/2015	*	*	*	*	*

Table B-5

**Concentration of Iodine-131 in Filtered Air
(Results in units of 10^{-3} pCi/m³ +/- 2 σ)**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
8/31/2015	9/7/2015	*	*	*	*	*
9/7/2015	9/14/2015	*	*	*	*	*
9/14/2015	9/21/2015	*	*	*	*	*
9/21/2015	9/28/2015	*	*	*	*	*
9/28/2015	10/5/2015	*	*	*	*	*
10/5/2015	10/12/2015	*	*	*	*	*
10/12/2015	10/19/2015	*	*	*	*	*
10/19/2015	10/26/2015	*	*	*	*	*
10/26/2015	11/2/2015	*	*	*	*	*
11/2/2015	11/9/2015	*	*	*	*	*
11/9/2015	11/16/2015	*	*	*	*	*
11/16/2015	11/23/2015	*	*	*	*	*
11/23/2015	11/30/2015	*	*	*	*	*
11/30/2015	12/7/2015	*	*	*	*	*
12/7/2015	12/14/2015	*	*	*	*	*
12/14/2015	12/21/2015	*	*	*	*	*
12/21/2015	12/28/2015	*	*	*	*	*

¹ Control Location

* All Non-Natural Gamma Emitters <MDA

Table B-6

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ +/- 2 σ)**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
12/29/2014	1/5/2015	2.8 +/- 0.1	2.7 +/- 0.1	2.5 +/- 0.1	2.8 +/- 0.1	2.6 +/- 0.1
1/5/2015	1/12/2015	2.3 +/- 0.2	2.6 +/- 0.2	2.4 +/- 0.2	2.5 +/- 0.2	2.6 +/- 0.2
1/12/2015	1/19/2015	2.4 +/- 0.2	2.3 +/- 0.2	2.1 +/- 0.2	2.1 +/- 0.1	2.5 +/- 0.2
1/19/2015	1/26/2015	1.6 +/- 0.1	1.5 +/- 0.1	1.5 +/- 0.1	1.7 +/- 0.1	2.0 +/- 0.1
1/26/2015	2/2/2015	1.6 +/- 0.1	1.6 +/- 0.1	1.7 +/- 0.1	1.3 +/- 0.1	1.7 +/- 0.1
2/2/2015	2/9/2015	2.3 +/- 0.1	2.4 +/- 0.1	2.2 +/- 0.1	2.3 +/- 0.1	2.5 +/- 0.1
2/9/2015	2/16/2015	2.5 +/- 0.2	2.3 +/- 0.2	2.3 +/- 0.2	2.6 +/- 0.2	2.6 +/- 0.2
2/16/2015	2/23/2015	2.3 +/- 0.1	2.4 +/- 0.1	2.8 +/- 0.2	2.5 +/- 0.1	2.5 +/- 0.1
2/23/2015	3/2/2015	2.5 +/- 0.1	2.5 +/- 0.1	2.5 +/- 0.1	2.6 +/- 0.2	2.8 +/- 0.2
3/2/2015	3/9/2015	2.3 +/- 0.1	2.2 +/- 0.1	2.2 +/- 0.1	2.2 +/- 0.1	2.3 +/- 0.1
3/9/2015	3/16/2015	2.0 +/- 0.1	1.9 +/- 0.1	1.9 +/- 0.1	1.9 +/- 0.1	2.0 +/- 0.1
3/16/2015	3/23/2015	1.7 +/- 0.1	1.6 +/- 0.1	1.6 +/- 0.1	1.6 +/- 0.1	1.8 +/- 0.1
3/23/2015	3/30/2015	1.9 +/- 0.1	1.8 +/- 0.1	2.1 +/- 0.1	1.9 +/- 0.1	1.9 +/- 0.1
3/30/2015	4/6/2015	1.4 +/- 0.1	1.6 +/- 0.1	1.6 +/- 0.1	1.6 +/- 0.1	1.6 +/- 0.1
4/6/2015	4/13/2015	1.6 +/- 0.1	1.4 +/- 0.1	1.4 +/- 0.1	1.2 +/- 0.1	1.4 +/- 0.1
4/13/2015	4/20/2015	1.5 +/- 0.1	1.5 +/- 0.1	1.4 +/- 0.1	1.5 +/- 0.1	1.5 +/- 0.1
4/20/2015	4/27/2015	1.6 +/- 0.1	1.5 +/- 0.1	1.6 +/- 0.1	1.5 +/- 0.1	1.6 +/- 0.1
4/27/2015	5/4/2015	1.1 +/- 0.1	1.1 +/- 0.1	1.1 +/- 0.1	1.0 +/- 0.1	1.0 +/- 0.1
5/4/2015	5/11/2015	2.1 +/- 0.1	2.1 +/- 0.1	2.2 +/- 0.1	2.4 +/- 0.2	2.4 +/- 0.2
5/11/2015	5/18/2015	1.6 +/- 0.1	1.5 +/- 0.1	1.6 +/- 0.1	1.8 +/- 0.1	1.8 +/- 0.1
5/18/2015	5/25/2015	2.0 +/- 0.1	1.9 +/- 0.1	2.1 +/- 0.1	2.0 +/- 0.1	2.1 +/- 0.1
5/25/2015	6/1/2015	1.6 +/- 0.1	1.6 +/- 0.1	1.8 +/- 0.1	1.5 +/- 0.1	1.7 +/- 0.1
6/1/2015	6/8/2015	0.7 +/- 0.1	0.7 +/- 0.1	0.8 +/- 0.1	0.8 +/- 0.1	0.9 +/- 0.1
6/8/2015	6/15/2015	2.2 +/- 0.1	2.2 +/- 0.1	2.2 +/- 0.1	2.3 +/- 0.1	2.2 +/- 0.1
6/15/2015	6/22/2015	1.6 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1	1.8 +/- 0.1
6/22/2015	6/29/2015	1.3 +/- 0.1	1.4 +/- 0.1	1.4 +/- 0.1	1.5 +/- 0.1	1.6 +/- 0.1
6/29/2015	7/6/2015	1.7 +/- 0.1	1.7 +/- 0.1	1.6 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1
7/6/2015	7/13/2015	1.8 +/- 0.1	1.7 +/- 0.1	1.6 +/- 0.1	1.7 +/- 0.1	1.9 +/- 0.1
7/13/2015	7/20/2015	1.6 +/- 0.1	1.7 +/- 0.1	1.8 +/- 0.1	1.7 +/- 0.1	1.8 +/- 0.1
7/20/2015	7/27/2015	1.9 +/- 0.1	1.9 +/- 0.1	1.9 +/- 0.1	2.0 +/- 0.1	2.1 +/- 0.1
7/27/2015	8/3/2015	2.2 +/- 0.1	2.0 +/- 0.1	2.3 +/- 0.1	2.2 +/- 0.1	2.4 +/- 0.1
8/3/2015	8/10/2015	1.9 +/- 0.1	1.9 +/- 0.1	1.9 +/- 0.1	1.9 +/- 0.1	2.4 +/- 0.2
8/10/2015	8/17/2015	1.8 +/- 0.1	1.9 +/- 0.1	1.9 +/- 0.1	1.8 +/- 0.1	2.0 +/- 0.1
8/17/2015	8/24/2015	2.1 +/- 0.1	2.1 +/- 0.1	2.2 +/- 0.1	2.1 +/- 0.1	2.5 +/- 0.1
8/24/2015	8/31/2015	2.4 +/- 0.1	2.5 +/- 0.1	2.3 +/- 0.1	2.5 +/- 0.1	2.9 +/- 0.1

Table B-6

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ +/- 2σ)**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
8/31/2015	9/7/2015	3.2 +/- 0.2	3.3 +/- 0.2	3.4 +/- 0.2	3.3 +/- 0.2	3.6 +/- 0.2
9/7/2015	9/14/2015	1.6 +/- 0.1	1.7 +/- 0.1	1.8 +/- 0.1	1.7 +/- 0.1	1.8 +/- 0.1
9/14/2015	9/21/2015	2.9 +/- 0.2	2.8 +/- 0.2	2.8 +/- 0.1	2.9 +/- 0.2	3.1 +/- 0.2
9/21/2015	9/28/2015	1.9 +/- 0.1	1.8 +/- 0.1	2.0 +/- 0.1	1.8 +/- 0.1	1.9 +/- 0.1
9/28/2015	10/5/2015	0.7 +/- 0.1	0.8 +/- 0.1	0.8 +/- 0.1	0.8 +/- 0.1	0.8 +/- 0.1
10/5/2015	10/12/2015	2.0 +/- 0.1	2.0 +/- 0.1	2.3 +/- 0.2	2.1 +/- 0.1	2.3 +/- 0.2
10/12/2015	10/19/2015	1.9 +/- 0.1	1.9 +/- 0.1	1.7 +/- 0.1	2.0 +/- 0.1	2.2 +/- 0.1
10/19/2015	10/26/2015	2.3 +/- 0.1	2.2 +/- 0.1	2.3 +/- 0.1	2.3 +/- 0.1	2.6 +/- 0.1
10/26/2015	11/2/2015	1.8 +/- 0.1	1.9 +/- 0.1	1.8 +/- 0.1	1.7 +/- 0.1	1.9 +/- 0.1
11/2/2015	11/9/2015	2.2 +/- 0.1	2.0 +/- 0.1	2.1 +/- 0.1	2.1 +/- 0.1	2.0 +/- 0.1
11/9/2015	11/16/2015	2.1 +/- 0.1	1.9 +/- 0.1	2.0 +/- 0.2	2.0 +/- 0.1	2.1 +/- 0.2
11/16/2015	11/23/2015	2.1 +/- 0.1	2.2 +/- 0.1	2.2 +/- 0.1	2.0 +/- 0.1	2.1 +/- 0.1
11/23/2015	11/30/2015	2.0 +/- 0.1	2.0 +/- 0.1	2.1 +/- 0.1	2.0 +/- 0.1	2.2 +/- 0.1
11/30/2015	12/7/2015	3.9 +/- 0.2	3.2 +/- 0.2	3.2 +/- 0.2	3.5 +/- 0.2	3.4 +/- 0.2
12/7/2015	12/14/2015	4.7 +/- 0.2	4.3 +/- 0.2	4.4 +/- 0.2	4.5 +/- 0.2	4.7 +/- 0.2
12/14/2015	12/21/2015	1.8 +/- 0.1	1.8 +/- 0.1	1.9 +/- 0.1	1.8 +/- 0.1	2.0 +/- 0.1
12/21/2015	12/28/2015	1.4 +/- 0.1	1.2 +/- 0.1	1.3 +/- 0.1	1.2 +/- 0.1	1.3 +/- 0.1

¹ Control Location

Table B-6 - Continued

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ +/- 2σ)**

Start Date	Stop Date	SFA1 MET Station	SFA2 ¹ Visitors Center	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI
12/29/2014	1/5/2015	2.6 +/- 0.1	2.8 +/- 0.1	2.5 +/- 0.1	2.6 +/- 0.1
1/5/2015	1/12/2015	2.6 +/- 0.2	2.5 +/- 0.2	2.2 +/- 0.1	2.3 +/- 0.1
1/12/2015	1/19/2015	2.7 +/- 0.4	2.6 +/- 0.2	2.1 +/- 0.2	2.3 +/- 0.2
1/19/2015	1/26/2015	1.1 +/- 0.1	1.8 +/- 0.1	1.5 +/- 0.1	1.6 +/- 0.1
1/26/2015	2/2/2015	1.7 +/- 0.1	1.6 +/- 0.1	1.5 +/- 0.1	1.5 +/- 0.1
2/2/2015	2/9/2015	2.2 +/- 0.1	2.4 +/- 0.1	2.0 +/- 0.1	2.2 +/- 0.1
2/9/2015	2/16/2015	2.6 +/- 0.2	2.8 +/- 0.2	2.3 +/- 0.2	2.6 +/- 0.2
2/16/2015	2/23/2015	2.7 +/- 0.2	2.7 +/- 0.2	2.6 +/- 0.2	2.6 +/- 0.1
2/23/2015	3/2/2015	2.7 +/- 0.2	2.6 +/- 0.1	2.7 +/- 0.2	2.5 +/- 0.1
3/2/2015	3/9/2015	2.3 +/- 0.1	2.2 +/- 0.1	2.2 +/- 0.1	2.0 +/- 0.1
3/9/2015	3/16/2015	1.9 +/- 0.1	1.9 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1
3/16/2015	3/23/2015	1.7 +/- 0.1	1.8 +/- 0.1	1.7 +/- 0.1	1.6 +/- 0.1
3/23/2015	3/30/2015	1.8 +/- 0.1	1.9 +/- 0.1	1.8 +/- 0.1	1.8 +/- 0.1
3/30/2015	4/6/2015	1.5 +/- 0.1	1.6 +/- 0.1	1.5 +/- 0.1	1.5 +/- 0.1
4/6/2015	4/13/2015	1.4 +/- 0.1	1.2 +/- 0.1	1.3 +/- 0.1	1.3 +/- 0.1
4/13/2015	4/20/2015	1.4 +/- 0.1	1.4 +/- 0.1	1.4 +/- 0.1	1.4 +/- 0.1
4/20/2015	4/27/2015	1.5 +/- 0.1	1.5 +/- 0.1	1.7 +/- 0.1	1.5 +/- 0.1
4/27/2015	5/4/2015	0.9 +/- 0.1	1.1 +/- 0.1	1.0 +/- 0.1	1.0 +/- 0.1
5/4/2015	5/11/2015	2.0 +/- 0.1	2.3 +/- 0.2	2.2 +/- 0.1	2.1 +/- 0.1
5/11/2015	5/18/2015	1.6 +/- 0.1	1.8 +/- 0.1	1.7 +/- 0.1	1.8 +/- 0.1
5/18/2015	5/25/2015	1.8 +/- 0.1	1.9 +/- 0.1	2.0 +/- 0.1	2.0 +/- 0.1
5/25/2015	6/1/2015	1.4 +/- 0.1	1.7 +/- 0.1	1.6 +/- 0.1	1.7 +/- 0.1
6/1/2015	6/8/2015	0.7 +/- 0.1	0.7 +/- 0.1	0.8 +/- 0.1	0.8 +/- 0.1
6/8/2015	6/15/2015	2.0 +/- 0.1	2.2 +/- 0.1	2.2 +/- 0.1	2.1 +/- 0.1
6/15/2015	6/22/2015	1.4 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1	1.6 +/- 0.1
6/22/2015	6/29/2015	1.3 +/- 0.1	1.5 +/- 0.1	1.4 +/- 0.1	1.5 +/- 0.1
6/29/2015	7/6/2015	1.6 +/- 0.1	1.7 +/- 0.1	1.9 +/- 0.1	1.8 +/- 0.1
7/6/2015	7/13/2015	1.7 +/- 0.1	2.0 +/- 0.1	2.0 +/- 0.1	1.8 +/- 0.1
7/13/2015	7/20/2015	1.6 +/- 0.1	1.7 +/- 0.1	1.6 +/- 0.1	1.8 +/- 0.1
7/20/2015	7/27/2015	1.9 +/- 0.1	2.1 +/- 0.1	2.0 +/- 0.1	1.9 +/- 0.1
7/27/2015	8/3/2015	2.1 +/- 0.1	2.2 +/- 0.1	2.3 +/- 0.1	2.2 +/- 0.1
8/3/2015	8/10/2015	1.8 +/- 0.1	1.9 +/- 0.1	2.0 +/- 0.1	1.8 +/- 0.1
8/10/2015	8/17/2015	1.8 +/- 0.1	2.0 +/- 0.1	2.1 +/- 0.1	2.0 +/- 0.1
8/17/2015	8/24/2015	2.1 +/- 0.1	2.2 +/- 0.1	2.3 +/- 0.1	2.2 +/- 0.1
8/24/2015	8/31/2015	2.6 +/- 0.1	2.7 +/- 0.1	2.6 +/- 0.1	2.6 +/- 0.1

Table B-6 - Continued

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ +/- 2 σ)**

Start Date	Stop Date	SFA1 MET Station	SFA2 ¹ Visitors Center	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI
8/31/2015	9/7/2015	3.4 +/- 0.2	3.4 +/- 0.2	3.6 +/- 0.2	3.2 +/- 0.2
9/7/2015	9/14/2015	1.6 +/- 0.1	1.7 +/- 0.1	1.8 +/- 0.1	1.7 +/- 0.1
9/14/2015	9/21/2015	2.8 +/- 0.2	3.0 +/- 0.2	3.2 +/- 0.2	2.9 +/- 0.2
9/21/2015	9/28/2015	1.7 +/- 0.1	1.7 +/- 0.1	1.8 +/- 0.1	1.7 +/- 0.1
9/28/2015	10/5/2015	1.3 +/- 0.1	0.9 +/- 0.1	0.9 +/- 0.1	0.8 +/- 0.1
10/5/2015	10/12/2015	2.2 +/- 0.2	2.3 +/- 0.2	2.4 +/- 0.2	1.9 +/- 0.1
10/12/2015	10/19/2015	1.8 +/- 0.1	2.0 +/- 0.1	2.0 +/- 0.1	1.8 +/- 0.1
10/19/2015	10/26/2015	2.2 +/- 0.1	2.3 +/- 0.1	2.4 +/- 0.1	2.3 +/- 0.1
10/26/2015	11/2/2015	1.6 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1
11/2/2015	11/9/2015	2.5 +/- 0.1	2.1 +/- 0.1	1.9 +/- 0.1	2.1 +/- 0.1
11/9/2015	11/16/2015	2.0 +/- 0.1	1.9 +/- 0.1	2.0 +/- 0.1	1.9 +/- 0.1
11/16/2015	11/23/2015	1.9 +/- 0.1	1.8 +/- 0.1	1.9 +/- 0.1	2.0 +/- 0.1
11/23/2015	11/30/2015	1.9 +/- 0.1	1.9 +/- 0.1	1.9 +/- 0.1	1.5 +/- 0.1
11/30/2015	12/7/2015	3.6 +/- 0.2	3.2 +/- 0.2	3.6 +/- 0.2	3.3 +/- 0.2
12/7/2015	12/14/2015	4.7 +/- 0.2	4.3 +/- 0.2	4.3 +/- 0.2	4.6 +/- 0.2
12/14/2015	12/21/2015	2.3 +/- 0.1	2.0 +/- 0.1	2.1 +/- 0.1	2.1 +/- 0.1
12/21/2015	12/28/2015	1.4 +/- 0.1	1.3 +/- 0.1	1.4 +/- 0.1	1.2 +/- 0.1

¹ Control Location

Table B-7

**Concentration of Gamma Emitters in Air Particulates
(Results in units of 10^{-3} pCi/m³ +/- 2 σ)**

Sample Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
2/2/2015	*	*	*	*	*
3/2/2015	*	*	*	*	*
3/30/2015	*	*	*	*	*
4/27/2015	*	*	*	*	*
6/1/2015	*	*	*	*	*
6/29/2015	*	*	*	*	*
8/3/2015	*	*	*	*	*
8/31/2015	*	*	*	*	*
9/28/2015	*	*	*	*	*
11/2/2015	*	*	*	*	*
11/30/2015	*	*	*	*	*
12/28/2015	*	*	*	*	*

Sample Date	SFA1 MET Station	SFA2 ¹ Visitors Center	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI
2/2/2015	*	*	*	*
3/2/2015	*	*	*	*
3/30/2015	*	*	*	*
4/27/2015	*	*	*	*
6/1/2015	*	*	*	*
6/29/2015	*	*	*	*
8/3/2015	*	*	*	*
8/31/2015	*	*	*	*
9/28/2015	*	*	*	*
11/2/2015	*	*	*	*
11/30/2015	*	*	*	*
12/28/2015	*	*	*	*

¹ Control Location

* All Non-Natural Gamma Emitters <MDA

Table B-8a

**Concentration of Gamma Emitters in Vegetation Samples
(Results in units of pCi/kg (wet) +/- 2σ)**

Sample Code	Sample Date	Sample Type	Gamma Emitters
IB1 Bay Breeze Rd	6/15/2015	Cabbage	*
	7/27/2015	Cabbage	*
	8/17/2015	Broccoli	*
IB2 Bay Breeze Rd	6/15/2015	Broccoli	*
	7/27/2015	Broccoli	*
	8/17/2015	Brussels sprouts	*
IB3 Bay Breeze Rd	6/15/2015	Brussels sprouts	*
	7/27/2015	Brussels sprouts	*
	8/17/2015	Eggplant Leaves	*
IB4 Camp Conoy Entrance	6/15/2015	Cabbage	*
	7/27/2015	Cabbage	*
	8/17/2015	Broccoli	*
IB5 Camp Conoy Entrance	6/15/2015	Broccoli	*
	7/27/2015	Broccoli	*
	8/17/2015	Brussels sprouts	*
IB6 Camp Conoy Entrance	6/15/2015	Brussels sprouts	*
	7/27/2015	Brussels sprouts	*
	8/17/2015	Eggplant Leaves	*
IB7 ¹ EOF	6/15/2015	Cabbage	*
	7/27/2015	Cabbage	*
	8/17/2015	Broccoli	*
IB8 ¹ EOF	6/15/2015	Broccoli	*
	7/27/2015	Broccoli	*
	8/17/2015	Brussels sprouts	*
IB9 ¹ EOF	6/15/2015	Brussels sprouts	*
	7/27/2015	Brussels sprouts	*
	8/17/2015	Eggplant Leaves	*

¹ Control Location

* All Non-Natural Gamma Emitters <MDA

Table B-8b

**Concentration of Gamma Emitters in Vegetation
From Locations Around the ISFSI
(Results in units of pCi/kg (wet) +/- 2σ)**

Sample Code	Sample Date	Cs-137	Gamma Emitters
SFB1			
MET Station	3/16/2015	1	*
	6/24/2015	1	*
	9/28/2015	1	*
	10/27/2015	1	*
SFB2 ²			
Visitor's Center	3/16/2015	1	*
	6/24/2015	1	*
	9/28/2015	1	*
	10/27/2015	1	*
SFB3			
NNW of ISFSI	3/16/2015	1	*
	6/24/2015	1	*
	9/28/2015	1	*
	10/27/2015	1	*
SFB4			
SSE of ISFSI	3/16/2015	1	*
	6/24/2015	1	*
	9/28/2015	1	*
	10/27/2015	1	*
SFB5			
On Site Before Entrance to Camp Conoy	3/16/2015	51 +/- 30	*
	6/24/2015	1	*
	9/28/2015	1	*
	10/27/2015	192 +/- 45	*

¹ This isotope <MDA

² Control Location

* All Non-Natural Gamma Emitters <MDA

Table B-9

**Concentration of Gamma Emitters in Soil Samples
From Locations Around the ISFSI
(Results in units of pCi/kg (dry) +/- 2σ**

Sample Code	Sample Date	Cs-137	Gamma Emitters
SFS1 MET station	3/16/2015	1	*
	6/24/2015	1	*
	9/28/2015	1	*
	10/27/2015	1	*
SFS2 ² Visitors Center	3/16/2015	63 +/- 29	*
	6/24/2015	71 +/- 35	*
	9/28/2015	61 +/- 31	*
	10/27/2015	49 +/- 29	*
SFS3 NNW of ISFSI	3/16/2015	148 +/- 64	*
	6/24/2015	58 +/- 36	*
	9/28/2015	1	*
	10/27/2015	1	*
SFS4 SSE of ISFSI	3/16/2015	1	*
	6/24/2015	1	*
	9/28/2015	1	*
	10/27/2015	1	*
SFS5 Entrance to Camp Conoy	3/16/2015	128 +/- 27	*
	6/24/2015	171 +/- 51	*
	9/28/2015	101 +/- 27	*
	10/27/2015	144 +/- 44	*

¹ This isotope <MDA

² Control Location

* All Non-Natural Gamma Emitters <MDA

Table B-10

Typical MDA Ranges for Gamma Spectrometry

Selected Nuclides	Air Particulates (10 ⁻² pCi/m ³)	Bay Water, Surface Water, Drinking Water (pCi/L)	Fish (pCi/Kg) Wet	Groundwater (pCi/L)	Milk (pCi/L)	Oysters (pCi/kg) Wet	Shoreline Sediment (pCi/kg) Dry	Soil (pCi/kg) Dry	Vegetation (pCi/L) Wet
Na-22	0 - .6	2.3 - 4.7	0 - 62.3	2.3 - 5.1	3.9 - 9.6	3.4 - 32.1	38.7 - 71.7	35.5 - 82.6	12.1 - 44.8
K-40	0 - 5.8	24.1 - 53.5	0 - 487.3	23.8 - 57.3	22.2 - 77.4	31.8 - 222	274 - 580	241 - 739	54.8 - 422
Cr-51	0 - 5.1	20.8 - 37.2	0 - 1576	20.7 - 37.6	27 - 55.6	0 - 479	195 - 733	289 - 643	53 - 276
Mn-54	0 - .4	2.1 - 4.2	0 - 58.1	2.1 - 4.6	2.9 - 7.2	5.4 - 44	32.8 - 58.1	30.1 - 73.9	9.2 - 35.4
Co-58	0 - .5	2.3 - 4.3	0 - 89.1	2.2 - 4.7	3 - 6.9	1.6 - 59.7	32.5 - 62.1	31 - 72.1	8.7 - 35.4
Fe-59	0 - 1.4	5.2 - 9.7	0 - 287	5 - 10	8.2 - 17.2	17.3 - 5439	51.8 - 188	74.5 - 164	22.9 - 78.1
Co-60	0 - .5	2.3 - 4.5	0 - 60.2	2.1 - 5	3.2 - 8.3	8.2 - 42.4	32.8 - 63.2	33.3 - 73.3	11.1 - 40.9
Zn-65	0 - 1.1	4.6 - 9.1	27.2 - 61.7	4.4 - 11.4	8.2 - 19	17.5 - 97.3	90.8 - 153	83.9 - 197	24.2 - 87
Nb-95	0 - .7	2.7 - 4.8	0 - 180	2.4 - 5.3	3.1 - 7.1	0 - 51.3	30.9 - 102	43.4 - 96.6	9.3 - 37.4
Zr-95	0 - .9	4.1 - 7.5	0 - 163	4.1 - 7.8	5.2 - 11.8	0 - 91.3	55.4 - 119	57.6 - 131	15.6 - 60.6
Ru-106	0 - 3.5	18.4 - 36.8	0 - 450	19.4 - 39.2	23.6 - 59.2	0 - 271	267 - 483	265 - 578	75 - 312
Ag-110m	0 - 0	2 - 4	0 - 63.8	2.1 - 4.4	2.6 - 6.7	.4 - 25.6	31.9 - 48.7	34.8 - 78.8	7.8 - 35.1
I-131 ¹	0 - 0.4	0.5 - 0.9	14.7 - 113	4.2 - 8.5	.3 - .9	0 - 463	52.3 - 1270	55 - 483	10.1 - 43.5
Cs-134	0 - .4	2.1 - 3.9	10.1 - 64.4	2 - 4.7	2.3 - 6.8	3.2 - 43.5	30.3 - 56.7	42.4 - 73.8	9.9 - 34.2
Cs-137	0 - .4	2.2 - 4.4	1.1 - 61.8	2.2 - 4.8	2.7 - 7.4	8.2 - 61.1	34.6 - 53.8	36.6 - 73.7	10.9 - 37.1
Ba-140	0 - 2.6	5.3 - 10.4	0 - 2304	4.7 - 8.9	1.6 - 9.4	0 - 151.4	56.1 - 440	63.1 - 216	11.1 - 53.7
La-140	0 - 2.6	5.1 - 10.3	0 - 2304	4.7 - 8.9	1.6 - 9.4	0 - 151	56.1 - 440	63.1 - 216	11.1 - 53.7
Ce-144	0 - 1.2	11.2 - 20.9	0 - 226	12.1 - 23.1	14.3 - 31.9	0 - 166	130 - 217	136 - 301	28.4 - 159

¹ This MDA range for I-131 on a charcoal cartridge is typically 4.00 x 10⁻³ to 5.70 x 10⁻²

Table B-11

Typical LLDs for Gamma Spectrometry

Selected Nuclides	Air Particulates 10 ⁻³ pCi/m ³	Bay Water, Surface Water, Drinking Water pCi/L	Fish pCi/kg (wet)	Ground water pCi/L	Oysters pCi/kg (wet)	Precipitation pCi/L	Soil pCi/kg (dry)	Vegetation pCi/kg (wet)
Na-22	2.9	2.9	22	2.9	22	2.9	24	35
Cr-51	12	17	88	17	88	17	110	162
Mn-54	2.1	2.4	17	2.4	17	2.4	18	27
Co-58	2	2.4	16	2.4	16	2.4	17	25
Fe-59	4.6	5.2	37	5.2	37	5.2	38	60
Co-60	2.7	2.8	22	2.8	22	2.8	21	33
Zn-65	2.8	5.6	23	5.6	23	5.6	54	66
Nb-95	1.9	2.2	15	2.2	15	2.2	18	25
Zr-95	3.3	3.8	27	3.8	27	3.8	29	44
Ru-106	17	20	135	20	135	20	146	223
Ag-110m	1.8	2.1	14	2.1	14	2.1	16	25
Te-129m	20	26	149	26	149	26	180	265
I-131*	1.5	2	11	2	11	2	14	20
Cs-134	1.9	2.2	15	2.2	15	2.2	20	24
Cs-137	1.8	2.3	15	2.3	15	2.3	17	27
Ba-140	6.1	7.3	48	7.3	48	7.3	54	80
La-140	3.4	4.1	26	4.1	26	4.1	25	41
Ce-144	5.5	12	43	12	43	12	75	101

* The LLD for I-131 measured on a charcoal cartridge is 2.0 x 10⁻³ pCi/m³

Table B-12

Direct Radiation
(Results in Units of mR/90 days +/- 2σ)

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
DR01	On Site, along Cliffs	13.36 +/- 0.62	12.83 +/- 1.97	13.48 +/- 1.95	13.64 +/- 0.53
DR02	Route 765, Auto Dump	11.89 +/- 0.75	11.28 +/- 0.81	11.14 +/- 1.03	11.30 +/- 1.06
DR03	Route 765, Giovanni's Tavern	11.35 +/- 0.81	11.18 +/- 1.29	10.84 +/- 0.61	11.00 +/- 0.88
DR04	Route 765, White Sands Drive	13.00 +/- 1.92	12.34 +/- 0.54	12.62 +/- 0.91	12.65 +/- 0.31
DR05	Route 765, John's Creek	12.30 +/- 0.87	12.58 +/- 1.21	12.61 +/- 0.82	12.82 +/- 0.82
DR06	Route 765 at Lusby	10.87 +/- 1.24	10.77 +/- 1.29	10.69 +/- 1.15	10.52 +/- 1.16
DR07	Entrance to Camp Conoy	10.45 +/- 0.69	10.50 +/- 1.01	10.51 +/- 0.79	10.71 +/- 0.90
DR08	Camp Conoy Rd at Emergency Siren	15.15 +/- 0.80	15.39 +/- 1.48	15.10 +/- 2.01	15.15 +/- 1.78
DR09	Bay Breeze Rd	11.09 +/- 1.37	11.05 +/- 1.17	11.08 +/- 1.19	11.23 +/- 0.66
DR10	Calvert Beach Rd and Decatur Street	11.22 +/- 1.14	10.79 +/- 1.12	10.63 +/- 0.39	11.16 +/- 0.64
DR11	Dirt road off Mackall & Parren Rd	11.48 +/- 0.61	11.14 +/- 0.70	11.59 +/- 1.80	11.56 +/- 0.70
DR12	Mackall & Bowen Rds	11.22 +/- 0.45	10.96 +/- 0.83	11.30 +/- 0.83	11.18 +/- 0.51
DR13	Mackall Rd, near Wallville	12.27 +/- 0.67	12.99 +/- 1.39	12.44 +/- 1.34	12.93 +/- 1.28
DR14	Rodney Point	13.94 +/- 1.98	13.67 +/- 0.99	13.96 +/- 1.42	12.61 +/- 0.75
DR15	Mill Bridge & Turner Rds	12.35 +/- 0.64	11.61 +/- 1.09	12.20 +/- 1.06	12.22 +/- 1.37

Table B-12
Direct Radiation
(Results in Units of mR/90 days +/- 2σ)

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
DR16	Across from Appeal School	12.54 +/- 0.62	10.63 +/- 0.93	11.14 +/- 1.29	11.00 +/- 0.97
DR17	Cove Point & Little Cove Point Rds	13.66 +/- 0.80	14.29 +/- 1.31	12.94 +/- 0.90	14.14 +/- 1.77
DR18	Cove Point	10.32 +/- 0.83	9.63 +/- 0.52	9.78 +/- 0.89	9.90 +/- 1.43
DR19	Long Beach	11.20 +/- 0.81	10.92 +/- 0.83	10.75 +/- 1.20	11.02 +/- 0.97
DR20	On site, near shore	13.90 +/- 0.90	13.47 +/- 1.51	13.88 +/- 0.80	13.94 +/- 0.98
DR21 ¹	EOF	12.23 +/- 1.47	12.51 +/- 0.51	12.81 +/- 1.34	12.62 +/- 0.40
DR22 ¹	Solomons Island	11.83 +/- 1.36	11.24 +/- 0.98	11.48 +/- 0.49	12.08 +/- 0.86
DR23 ¹	Taylor's Island	15.68 +/- 1.37	16.18 +/- 0.59	16.30 +/- 1.52	16.55 +/- 1.38
DR30	MET Station	11.97 +/- 0.79	11.92 +/- 0.77	12.25 +/- 0.66	12.36 +/- 0.85
SFDR01	SW of ISFSI	16.97 +/- 1.55	17.97 +/- 1.56	17.17 +/- 1.22	17.36 +/- 1.69
SFDR02	NNW of ISFSI	19.47 +/- 1.35	18.87 +/- 1.75	19.56 +/- 1.99	19.72 +/- 1.85
SFDR03	North of ISFSI	38.05 +/- 4.66	38.67 +/- 7.94	38.28 +/- 8.35	45.87 +/- 7.44
SFDR04	NE of ISFSI	35.66 +/- 6.55	36.21 +/- 3.75	31.96 +/- 4.06	35.14 +/- 8.82
SFDR05	East of ISFSI	20.64 +/- 3.14	24.64 +/- 3.44	22.91 +/- 2.67	22.08 +/- 3.03
SFDR06	ESE of ISFSI	18.71 +/- 0.79	19.28 +/- 2.55	18.86 +/- 0.60	20.52 +/- 1.38

Table B-12

**Direct Radiation
(Results in Units of mR/90 days +/- 2σ)**

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
SFDR07 ¹	Visitor's Center	13.05 +/- 0.37	13.44 +/- 1.90	12.34 +/- 0.63	12.70 +/- 0.75
SFDR08	NNW of ISFSI	28.30 +/- 4.90	26.78 +/- 3.23	27.57 +/- 5.48	28.83 +/- 5.85
SFDR09	SSE of ISFSI	16.60 +/- 1.73	17.41 +/- 1.70	17.30 +/- 2.07	22.93 +/- 1.91
SFDR10	NW of ISFSI	34.62 +/- 3.08	25.02 +/- 3.95	33.47 +/- 4.17	34.26 +/- 6.80
SFDR11	WNW ISFSI	26.47 +/- 3.26	23.78 +/- 1.48	30.42 +/- 3.02	25.05 +/- 3.49
SFDR12	WSW of ISFSI	45.00 +/- 12.49	42.40 +/- 6.81	39.76 +/- 6.08	42.51 +/- 1.59
SFDR13	South of ISFSI	27.24 +/- 6.46	26.26 +/- 6.93	22.24 +/- 2.61	31.06 +/- 6.93
SFDR14	SE of ISFSI	46.36 +/- 11.72	28.59 +/- 3.69	36.89 +/- 18.32	34.08 +/- 3.60
SFDR15	ENE of ISFSI	24.74 +/- 5.04	23.22 +/- 5.10	22.81 +/- 5.23	27.43 +/- 8.33
SFDR16	SSW of ISFSI	41.76 +/- 5.01	37.51 +/- 5.76	42.67 +/- 5.35	39.81 +/- 6.89
SFDR17	NNE of ISFSI	45.82 +/- 9.38	42.90 +/- 5.35	42.57 +/- 5.78	43.89 +/- 9.23
SFDR18	West of ISFSI	44.85 +/- 5.63	41.09 +/- 6.51	46.29 +/- 5.43	43.81 +/- 4.07

¹ Control Location

APPENDIX C

Quality Assurance Program

Appendix C is a summary of Exelon Industrial Services (EIS) Laboratory's quality assurance program. It consists of Table C-1 which is a compilation of the results of the EIS Laboratory's participation in an interlaboratory comparison program with Environmental Resource Associates (ERA) located in Arvada, Colorado and Analytics, Inc. located in Atlanta, Georgia. It also includes Table C-2, which is a compilation of the results of the EIS laboratory's participation in a split sample program with Teledyne Brown Engineering located in Knoxville, Tennessee, and Table C-3, which is a list of typical MDAs achieved by Teledyne Brown for Gamma Spectroscopy.

All the EIS Laboratory's results contained in Table C-1 generally agree with the intercomparison laboratory's results within the range of $\pm 2 \sigma$ of each other. Results for ERA RAD101 gamma emitters in water initially failed acceptable ranges. Upon investigation it was confirmed that an incorrect reference date had been used. When the correct reference date was used and data was reprocessed all results reported within acceptable ranges. This event has been entered into the Laboratory's Corrective Action Program and steps have been taken to prevent future occurrences. Results for Zinc and Cesium-134 in ERA RAD 103 were just outside the acceptable range but did pass the NRC Resolution Test Criteria. All other sets of intercomparison results in the table are also in full agreement when they were further evaluated using the NRC Resolution Test Criteria¹. The uncertainties for the EIS Laboratory's results and Analytics' results are $\pm 2\sigma$ while the ERA laboratory's uncertainty is based on USEPA guidelines².

All the results contained in Table C-2 agree within the range of $\pm 2 \sigma$ of each other with their respective EIS Laboratory original, replicate and/or Teledyne Brown Engineering's split laboratory samples, except for the comparisons of two samples involving Cs-137 results: bottom sediment samples from WBS2 collected on 06/15/2015 and WBS4 also collected 06/15/2015. In the case of WBS2 low levels of Cs-137 were observed in two of the results of the comparison set within $\pm 2 \sigma$ of each other and not observed in the split sample. The MDA of the split lab was within $\pm 2 \sigma$ of the original and replicate results. In the case of WBS4 the original and replicate results agree within $\pm 2 \sigma$ of each other and the high uncertainty of the split lab result puts this value within range of the original and replicate results. These minor discrepancies, occurring very close to or below the analyses MDA's, are most probably due to counting statistical fluctuations and/or the non-homogeneous nature of the sample-splitting process. Other samples whose nature generally precludes sample splitting are marked "***" in the Split Analysis column.

¹ NRC Inspection Manual, Inspection Procedure 84750, March 15, 1994

² National Standards for Water Proficiency Testing Studies Criteria Document, December 1998

TABLE OF CONTENTS - ANALYTICAL RESULTS

Table	Title	Page
C-1	Results of Participation in Cross Check Programs	58
C-2	Results of Quality Assurance Program	61
C-3	Teledyne Brown Engineering's Typical MDAs for Gamma Spectrometry	72

Table C-1

Results of Participation in Cross Check Programs

Sample Date	Sample Type and Units	Isotope Observed	Reported Laboratory's Results	Cross Check Lab Results
01/05/15	Air Iodine - pCi	I-131	22.7 +/- 6.6	22.3
01/05/15	Water - pCi/L	Cs-137	125 +/- 6.0	124
		Ba-133	60.0 +/- 4.0	67.6
		Cs-134	45.3 +/- 3.0	51.3
		Zn-65	109 +/- 10.0	98.7
		Co-60	64.1 +/- 4.0	62.4
03/19/15	Air Iodine - pCi	I-131	66.0 +/- 5.0	77.8 +/- 2.6
03/19/15	Milk - pCi/L	Cr-51	600 +/- 83.0	555 +/- 7.0
		Ce-141	239 +/- 17.0	211 +/- 7.0
		Cs-137	266 +/- 19.0	253 +/- 8.4
		I-131	102 +/- 14.0	97.5 +/- 3.3
		Cs-134	184 +/- 12.0	191 +/- 6.4
		Zn-65	543 +/- 43.0	453 +/- 15.1
		Co-60	536 +/- 20.0	498 +/- 16.6
		Co-58	286 +/- 19.0	272 +/- 9.1
		Fe-59	338 +/- 26.0	295 +/- 9.9
		Mn-54	276 +/- 20.0	240 +/- 8.0
03/19/15	Water - pCi/L	Gross Beta	239 +/- 6.4	280 +/- 9.34
04/06/15 ¹	Water - pCi/L	Co-60	86.3 +/- 5.0	84.5
		I-131	24.2 +/- 5.0	23.8
		Ba-133	78.4 +/- 6.0	82.5
		Cs-137	184.7 +/- 5.0	189.0
		Cs-134	66.0 +/- 5.0	75.7
		Zn-65	216 +/- 5.0	203

Table C-1

Results of Participation in Cross Check Programs

Sample Date	Sample Type and Units	Isotope Observed	Reported Laboratory's Results	Cross Check Lab Results
06/11/15	Air Filter - pCi	Cr-51	238 +/- 27.0	231 +/- 7.7
		Cs-134	121 +/- 3.0	136 +/- 4.6
		Cs-137	109 +/- 5.0	105 +/- 3.5
		Fe-59	145 +/- 7.0	127 +/- 4.2
		Co-58	59.0 +/- 4.0	57.2 +/- 1.9
		Co-60	173 +/- 5.0	161 +/- 5.4
		Zn-65	243 +/- 12.0	208 +/- 6.9
		Mn-54	91.0 +/- 5.0	84.2 +/- 2.8
06/11/15	Water - pCi/L	Cr-51	316 +/- 71.0	293 +/- 9.8
		Cs-137	148 +/- 9.0	133 +/- 4.4
		Cs-134	165 +/- 6.0	173 +/- 5.8
		I-131	107 +/- 28.0	93.4 +/- 3.1
		Zn-65	309 +/- 22.0	264 +/- 8.8
		Co-60	228 +/- 9.0	205 +/- 6.8
		Co-58	74.0 +/- 10.0	72.6 +/- 2.4
		Mn-54	119 +/- 10.0	107 +/- 3.6
		Fe-59	189 +/- 14.0	161 +/- 5.4
09/11/15	Air Filter - pCi/m ³	Gross Beta	108 +/- 2.0	98.3 +/- 3.28
09/21/15	Air Filter - pCi	Zn-65	783 +/- 36.0	685
		Cs-134	301 +/- 9.0	349
		Cs-137	616 +/- 19.0	613
		Co-60	527 +/- 14.0	521
		Am-241	33.0 +/- 5.5	36.8
10/05/15	Water - pCi	Zn-65	131 +/- 10.4	126
		Cs-134	50.0 +/- 2.8	62.0
		Cs-137	144 +/- 6.0	157
		Ba-133	22.5 +/- 2.8	32.5
		I-131	28.4 +/- 7.0	26.3

Table C-1

Results of Participation in Cross Check Programs

Sample Date	Sample Type and Units	Isotope Observed	Reported Laboratory's Results	Cross Check Lab Results
12/03/15	Air Iodine – pCi	I-131	86.0 +/- 7.0	79.7 +/- 2.6
12/03/15	Air Filter - pCi	Zn-65	189 +/- 23.0	173 +/- 5.8
		Cs-137	80.0 +/- 9.0	80.0 +/- 2.6
		Ce-141	94.0 +/- 7.0	89.8 +/- 3.0
		Cr-51	204 +/- 39.0	196 +/- 6.6
		Cs-134	98.0 +/- 7.0	112 +/- 3.8
		Mn-54	112 +/- 10.0	101 +/- 3.4
		Fe-59	85.0 +/- 12.0	75.1 +/- 2.6
		Co-58	75.0 +/- 9.0	76.9 +/- 2.6
		Co-60	157 +/- 10.0	149 +/- 5.0
12/03/15	Milk- pCi/L	I-131	108 +/- 18.0	91.2 +/- 3.0
		Cs-134	156 +/- 11.0	160 +/- 5.4
		Cs-137	125 +/- 25.0	115 +/- 3.8
		Ce-141	146 +/- 16.0	129 +/- 3.8
		Mn-54	159 +/- 17.0	145 +/- 4.8
		Zn-65	270 +/- 33.0	248 +/- 8.2
		Co-60	231 +/- 15.0	213 +/- 7.2
		Co-58	116 +/- 14.0	110 +/- 3.6
		Fe-59	123 +/- 20.0	108 +/- 3.6
Cr-51	303 +/- 87.0	281 +/- 9.4		

¹ See discussion at the beginning of the Appendix

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Iodine - A1	01/19/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	01/19/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	01/19/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	01/19/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	01/19/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Filter - A1	02/02/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - A1	02/02/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.5 +/- 0.1	**
Air Filter - A2	02/02/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - A2	02/02/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.7 +/- 0.1	**
Air Filter - A3	02/02/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - A3	02/02/15	Gross Beta	pCi/m ³	1.7 +/- 0.1	1.6 +/- 0.1	**
Air Filter - A4	02/02/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - A4	02/02/15	Gross Beta	pCi/m ³	1.3 +/- 0.1	1.5 +/- 0.1	**
Air Filter - A5	02/02/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - A5	02/02/15	Gross Beta	pCi/m ³	1.7 +/- 0.1	1.7 +/- 0.1	**
Air Filter - SFA1	02/02/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - SFA1	02/02/15	Gross Beta	pCi/m ³	1.7 +/- 0.1	1.5 +/- 0.1	**
Air Filter - SFA2	02/02/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - SFA2	02/02/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.7 +/- 0.1	**
Air Filter - SFA3	02/02/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - SFA3	02/02/15	Gross Beta	pCi/m ³	1.5 +/- 0.1	1.4 +/- 0.1	**
Air Filter - SFA4	02/02/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Filter - SFA4	02/02/15	Gross Beta	pCi/m ³	1.5 +/- 0.1	1.5 +/- 0.1	**
Air Filter - A1	02/09/15	Gross Beta	pCi/m ³	2.3 +/- 0.1	2.4 +/- 0.1	**
Air Filter - A2	02/09/15	Gross Beta	pCi/m ³	2.4 +/- 0.1	2.4 +/- 0.1	**
Air Filter - A3	02/09/15	Gross Beta	pCi/m ³	2.2 +/- 0.1	2.2 +/- 0.1	**
Air Filter - A4	02/09/15	Gross Beta	pCi/m ³	2.3 +/- 0.1	2.1 +/- 0.1	**
Air Filter - A5	02/09/15	Gross Beta	pCi/m ³	2.5 +/- 0.1	2.5 +/- 0.1	**
Air Filter - SFA1	02/09/15	Gross Beta	pCi/m ³	2.2 +/- 0.1	2.2 +/- 0.1	**
Air Filter - SFA2	02/09/15	Gross Beta	pCi/m ³	2.4 +/- 0.1	2.3 +/- 0.1	**
Air Filter - SFA3	02/09/15	Gross Beta	pCi/m ³	2.0 +/- 0.1	2.0 +/- 0.1	**
Air Filter - SFA4	02/09/15	Gross Beta	pCi/m ³	2.2 +/- 0.1	2.2 +/- 0.1	**
Air Iodine - A1	02/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	02/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	02/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	02/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	02/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Bay Water - WA1	03/04/15	Gamma	pCi/L	<MDA	<MDA	<MDA
Bay Water - WA2	03/04/15	Gamma	pCi/L	<MDA	<MDA	<MDA
Air Filter - A1	03/09/15	Gross Beta	pCi/m ³	2.3 +/- 0.1	2.4 +/- 0.1	**
Air Filter - A2	03/09/15	Gross Beta	pCi/m ³	2.2 +/- 0.1	2.3 +/- 0.1	**
Air Filter - A3	03/09/15	Gross Beta	pCi/m ³	2.2 +/- 0.1	2.2 +/- 0.1	**
Air Filter - A4	03/09/15	Gross Beta	pCi/m ³	2.2 +/- 0.1	2.1 +/- 0.1	**
Air Filter - A5	03/09/15	Gross Beta	pCi/m ³	2.3 +/- 0.1	2.3 +/- 0.1	**

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Filter - SFA1	03/09/15	Gross Beta	pCi/m ³	2.3 +/- 0.1	2.2 +/- 0.1	**
Air Filter - SFA2	03/09/15	Gross Beta	pCi/m ³	2.2 +/- 0.1	2.4 +/- 0.1	**
Air Filter - SFA3	03/09/15	Gross Beta	pCi/m ³	2.2 +/- 0.1	2.2 +/- 0.1	**
Air Filter - SFA4	03/09/15	Gross Beta	pCi/m ³	2.0 +/- 0.1	2.3 +/- 0.1	**
Air Iodine - A1	03/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	03/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	03/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	03/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	03/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Shoreline sediment - WB1	03/31/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Air Filter - A1	04/06/15	Gross Beta	pCi/m ³	1.4 +/- 0.1	1.5 +/- 0.1	**
Air Filter - A2	04/06/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.6 +/- 0.1	**
Air Filter - A3	04/06/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.8 +/- 0.1	**
Air Filter - A4	04/06/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.5 +/- 0.1	**
Air Filter - A5	04/06/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.6 +/- 0.1	**
Air Filter - SFA1	04/06/15	Gross Beta	pCi/m ³	1.5 +/- 0.1	1.5 +/- 0.1	**
Air Filter - SFA2	04/06/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.7 +/- 0.1	**
Air Filter - SFA3	04/06/15	Gross Beta	pCi/m ³	1.5 +/- 0.1	1.3 +/- 0.1	**
Air Filter - SFA4	04/06/15	Gross Beta	pCi/m ³	1.5 +/- 0.1	1.5 +/- 0.1	**
Air Iodine - A1	04/06/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	04/06/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	04/06/15	I-131	pCi/m ³	<MDA	<MDA	**

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Iodine - A4	04/06/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	04/06/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Filter - A1	05/04/15	Gross Beta	pCi/m ³	1.1 +/- 0.1	1.2 +/- 0.1	**
Air Filter - A2	05/04/15	Gross Beta	pCi/m ³	1.1 +/- 0.1	1.0 +/- 0.1	**
Air Filter - A3	05/04/15	Gross Beta	pCi/m ³	1.1 +/- 0.1	1.1 +/- 0.1	**
Air Filter - A4	05/04/15	Gross Beta	pCi/m ³	1.0 +/- 0.1	1.2 +/- 0.1	**
Air Filter - A5	05/04/15	Gross Beta	pCi/m ³	1.0 +/- 0.1	1.0 +/- 0.1	**
Air Filter - SFA1	05/04/15	Gross Beta	pCi/m ³	0.9 +/- 0.1	1.0 +/- 0.1	**
Air Filter - SFA2	05/04/15	Gross Beta	pCi/m ³	1.1 +/- 0.1	1.1 +/- 0.1	**
Air Filter - SFA3	05/04/15	Gross Beta	pCi/m ³	1.0 +/- 0.1	1.0 +/- 0.1	**
Air Filter - SFA4	05/04/15	Gross Beta	pCi/m ³	1.0 +/- 0.1	1.0 +/- 0.1	**
Air Iodine - A1	05/04/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	05/04/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	05/04/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	05/04/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	05/04/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Filter - A1	06/08/15	Gross Beta	pCi/m ³	0.7 +/- 0.1	0.8 +/- 0.1	**
Air Filter - A2	06/08/15	Gross Beta	pCi/m ³	0.7 +/- 0.1	0.8 +/- 0.1	**
Air Filter - A3	06/08/15	Gross Beta	pCi/m ³	0.8 +/- 0.1	0.8 +/- 0.1	**
Air Filter - A4	06/08/15	Gross Beta	pCi/m ³	0.8 +/- 0.1	0.7 +/- 0.1	**
Air Filter - A5	06/08/15	Gross Beta	pCi/m ³	0.9 +/- 0.1	0.8 +/- 0.1	**
Air Filter - SFA1	06/08/15	Gross Beta	pCi/m ³	0.7 +/- 0.1	0.8 +/- 0.1	**

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Filter - SFA2	06/08/15	Gross Beta	pCi/m ³	0.7 +/- 0.1	0.7 +/- 0.1	**
Air Filter - SFA3	06/08/15	Gross Beta	pCi/m ³	0.8 +/- 0.1	0.7 +/- 0.1	**
Air Filter - SFA4	06/08/15	Gross Beta	pCi/m ³	0.8 +/- 0.1	0.7 +/- 0.1	**
Air Iodine - A1	06/08/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	06/08/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	06/08/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	06/08/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	06/08/15	I-131	pCi/m ³	<MDA	<MDA	**
Broccoli - IB2	06/15/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Broccoli - IB5	06/15/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Broccoli - IB8	06/15/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Brussels sprouts - IB3	06/15/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Brussels sprouts - IB6	06/15/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Brussels sprouts - IB9	06/15/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Cabbage - IB1	06/15/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Cabbage - IB4	06/15/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Cabbage - IB7	06/15/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Bottom sediment – WBS2 ¹	06/16/15	Cs-137	pCi/kg	191 +/- 65.8	168 +/- 56.0	**
Bottom sediment – WBS4 ¹	06/16/15	Cs-137	pCi/kg	97.7 +/- 52.8	53.1 +/- 52.2	219 +/- 105
Oysters - IA3	06/16/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Oysters - IA6	06/16/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Air Filter - A1	07/06/15	Gross Beta	pCi/m ³	1.7 +/- 0.1	1.7 +/- 0.1	**

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Filter - A2	07/06/15	Gross Beta	pCi/m ³	1.7 +/- 0.1	1.6 +/- 0.1	**
Air Filter - A3	07/06/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.6 +/- 0.1	**
Air Filter - A4	07/06/15	Gross Beta	pCi/m ³	1.7 +/- 0.1	1.7 +/- 0.1	**
Air Filter - A5	07/06/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.8 +/- 0.1	**
Air Filter - SFA1	07/06/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.7 +/- 0.1	**
Air Filter - SFA2	07/06/15	Gross Beta	pCi/m ³	1.6 +/- 0.1	1.8 +/- 0.1	**
Air Filter - SFA3	07/06/15	Gross Beta	pCi/m ³	1.9 +/- 0.1	1.8 +/- 0.1	**
Air Filter - SFA4	07/06/15	Gross Beta	pCi/m ³	1.7 +/- 0.1	1.7 +/- 0.1	**
Air Iodine - A1	07/06/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	07/06/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	07/06/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	07/06/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	07/06/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Filter - A1	08/03/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - A2	08/03/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - A3	08/03/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - A4	08/03/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - A5	08/03/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - SFA1	08/03/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - SFA2	08/03/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - SFA3	08/03/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA
Air Filter - SFA4	08/03/15	Gamma	pCi/m ³	<MDA	<MDA	<MDA

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Filter - A1	08/10/15	Gross Beta	pCi/m ³	1.9 +/- 0.1	1.9 +/- 0.1	**
Air Filter - A2	08/10/15	Gross Beta	pCi/m ³	1.9 +/- 0.1	1.9 +/- 0.1	**
Air Filter - A3	08/10/15	Gross Beta	pCi/m ³	1.8 +/- 0.1	1.8 +/- 0.1	**
Air Filter - A4	08/10/15	Gross Beta	pCi/m ³	1.9 +/- 0.1	2.0 +/- 0.1	**
Air Filter - A5	08/10/15	Gross Beta	pCi/m ³	2.3 +/- 0.2	2.2 +/- 0.1	**
Air Filter - SFA1	08/10/15	Gross Beta	pCi/m ³	1.8 +/- 0.1	1.9 +/- 0.1	**
Air Filter - SFA2	08/10/15	Gross Beta	pCi/m ³	1.9 +/- 0.1	1.8 +/- 0.1	**
Air Filter - SFA3	08/10/15	Gross Beta	pCi/m ³	2.0 +/- 0.1	2.0 +/- 0.1	**
Air Filter - SFA4	08/10/15	Gross Beta	pCi/m ³	1.8 +/- 0.1	1.8 +/- 0.1	**
Air Iodine - A1	08/10/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	08/10/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	08/10/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	08/10/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	08/10/15	I-131	pCi/m ³	<MDA	<MDA	**
Bluefish - IA1	08/18/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Bluefish - IA4	08/18/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Oysters - IA3	08/18/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Oysters - IA6	08/18/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Air Filter - A1	09/07/15	Gross Beta	pCi/m ³	3.2 +/- 0.2	3.1 +/- 0.2	**
Air Filter - A2	09/07/15	Gross Beta	pCi/m ³	3.3 +/- 0.2	3.1 +/- 0.2	**
Air Filter - A3	09/07/15	Gross Beta	pCi/m ³	3.3 +/- 0.2	3.3 +/- 0.2	**
Air Filter - A4	09/07/15	Gross Beta	pCi/m ³	3.2 +/- 0.2	3.1 +/- 0.2	**

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Filter - A5	09/07/15	Gross Beta	pCi/m ³	3.6 +/- 0.2	3.6 +/- 0.2	**
Air Filter - SFA1	09/07/15	Gross Beta	pCi/m ³	3.3 +/- 0.2	3.1 +/- 0.2	**
Air Filter - SFA2	09/07/15	Gross Beta	pCi/m ³	3.4 +/- 0.2	3.4 +/- 0.2	**
Air Filter - SFA3	09/07/15	Gross Beta	pCi/m ³	3.5 +/- 0.2	3.4 +/- 0.2	**
Air Filter - SFA4	09/07/15	Gross Beta	pCi/m ³	3.2 +/- 0.2	3.2 +/- 0.2	**
Air Iodine - A1	09/07/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	09/07/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	09/07/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	09/07/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	09/07/15	I-131	pCi/m ³	<MDA	<MDA	**
Misc ground coverage - SFB1	09/28/15	Gamma	pCi/kg	<MDA	<MDA	**
Misc ground coverage - SFB3	09/28/15	Gamma	pCi/kg	<MDA	<MDA	**
Air Filter - A1	10/05/15	Gross Beta	pCi/m ³	0.7 +/- 0.1	0.7 +/- 0.1	**
Air Filter - A2	10/05/15	Gross Beta	pCi/m ³	0.7 +/- 0.1	0.8 +/- 0.1	**
Air Filter - A3	10/05/15	Gross Beta	pCi/m ³	0.8 +/- 0.1	0.8 +/- 0.1	**
Air Filter - A4	10/05/15	Gross Beta	pCi/m ³	0.8 +/- 0.1	0.8 +/- 0.1	**
Air Filter - A5	10/05/15	Gross Beta	pCi/m ³	0.8 +/- 0.1	0.9 +/- 0.1	**
Air Filter - SFA1	10/05/15	Gross Beta	pCi/m ³	1.3 +/- 0.1	1.2 +/- 0.1	**
Air Filter - SFA2	10/05/15	Gross Beta	pCi/m ³	0.8 +/- 0.1	0.9 +/- 0.1	**
Air Filter - SFA3	10/05/15	Gross Beta	pCi/m ³	0.9 +/- 0.1	0.8 +/- 0.1	**
Air Filter - SFA4	10/05/15	Gross Beta	pCi/m ³	0.8 +/- 0.1	0.9 +/- 0.1	**

Table C-2
Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Iodine - A1	10/05/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	10/05/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	10/05/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	10/05/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	10/05/15	I-131	pCi/m ³	<MDA	<MDA	**
Oysters - IA3	10/21/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Oysters - IA6	10/21/15	Gamma	pCi/kg	<MDA	<MDA	<MDA
Misc ground coverage - SFB2	10/27/15	Gamma	pCi/kg	<MDA	<MDA	**
Misc ground coverage - SFB4	10/27/15	Gamma	pCi/kg	<MDA	<MDA	**
Soil - SFS2	10/27/15	Cs-137	pCi/kg	49.4 +/- 29.2	33.2 +/- 31.4	**
Bay Water - WA1	11/02/15	Gamma	pCi/L	<MDA	<MDA	<MDA
Bay Water - WA2	11/02/15	Gamma	pCi/L	<MDA	<MDA	<MDA
Air Filter - A1	11/09/15	Gross Beta	pCi/m ³	2.2 +/- 0.1	2.4 +/- 0.1	**
Air Filter - A2	11/09/15	Gross Beta	pCi/m ³	2.0 +/- 0.1	2.2 +/- 0.1	**
Air Filter - A3	11/09/15	Gross Beta	pCi/m ³	2.1 +/- 0.1	2.5 +/- 0.1	**
Air Filter - A4	11/09/15	Gross Beta	pCi/m ³	2.1 +/- 0.1	2.3 +/- 0.1	**
Air Filter - A5	11/09/15	Gross Beta	pCi/m ³	2.0 +/- 0.1	2.3 +/- 0.1	**
Air Filter - SFA1	11/09/15	Gross Beta	pCi/m ³	2.5 +/- 0.1	2.6 +/- 0.1	**
Air Filter - SFA2	11/09/15	Gross Beta	pCi/m ³	2.1 +/- 0.1	2.4 +/- 0.1	**
Air Filter - SFA3	11/09/15	Gross Beta	pCi/m ³	1.9 +/- 0.1	2.0 +/- 0.1	**
Air Filter - SFA4	11/09/15	Gross Beta	pCi/m ³	2.1 +/- 0.1	2.2 +/- 0.1	**

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Air Iodine - A1	11/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	11/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	11/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	11/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	11/09/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Filter - A1	12/07/15	Gross Beta	pCi/m ³	3.9 +/- 0.2	3.9 +/- 0.2	**
Air Filter - A2	12/07/15	Gross Beta	pCi/m ³	3.2 +/- 0.2	3.4 +/- 0.2	**
Air Filter - A3	12/07/15	Gross Beta	pCi/m ³	3.2 +/- 0.2	3.2 +/- 0.2	**
Air Filter - A4	12/07/15	Gross Beta	pCi/m ³	3.5 +/- 0.2	3.5 +/- 0.2	**
Air Filter - A5	12/07/15	Gross Beta	pCi/m ³	3.4 +/- 0.2	3.6 +/- 0.2	**
Air Filter - SFA1	12/07/15	Gross Beta	pCi/m ³	3.6 +/- 0.2	4.1 +/- 0.2	**
Air Filter - SFA2	12/07/15	Gross Beta	pCi/m ³	3.2 +/- 0.2	3.5 +/- 0.2	**
Air Filter - SFA3	12/07/15	Gross Beta	pCi/m ³	3.6 +/- 0.2	3.8 +/- 0.2	**
Air Filter - SFA4	12/07/15	Gross Beta	pCi/m ³	3.3 +/- 0.2	3.6 +/- 0.2	**
Air Iodine - A1	12/07/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A2	12/07/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A3	12/07/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A4	12/07/15	I-131	pCi/m ³	<MDA	<MDA	**
Air Iodine - A5	12/07/15	I-131	pCi/m ³	<MDA	<MDA	**

Table C-2

Results of Quality Assurance Program

Sample Type and Location	Sample Date	Type of Analysis	Result Units	Original Analysis	Replicate Analysis	Split Analysis
Gamma field - DR05	07/07/15	TLD	mR/90 days	13.9 +/- 1.4	13.6 +/- 1.3	**
Gamma field - DR06	07/07/15	TLD	mR/90 days	11.9 +/- 1.4	11.3 +/- 1.1	**
Gamma field - DR07	07/07/15	TLD	mR/90 days	11.6 +/- 1.1	11.1 +/- 0.6	**
Gamma field - DR08	07/07/15	TLD	mR/90 days	17.0 +/- 1.6	16.2 +/- 1.6	**
Gamma field - DR09	07/07/15	TLD	mR/90 days	12.2 +/- 1.3	11.6 +/- 1.2	**
Gamma field - DR10	07/07/15	TLD	mR/90 days	12.0 +/- 1.2	11.6 +/- 1.2	**
Gamma field - DR11	07/07/15	TLD	mR/90 days	12.4 +/- 0.8	12.1 +/- 1.4	**
Gamma field - DR29	07/07/15	TLD	mR/90 days	17.2 +/- 1.5	15.8 +/- 1.4	**
Gamma field - DR31	07/07/15	TLD	mR/90 days	17.0 +/- 1.6	16.1 +/- 2.0	**
Gamma field - SFDR14	07/07/15	TLD	mR/90 days	31.7 +/- 4.0	40.1 +/- 2.8	**
Gamma field - SFDR15	07/07/15	TLD	mR/90 days	25.7 +/- 5.6	24.9 +/- 7.2	**
Gamma field - DR05	01/15/16	TLD	mR/90 days	13.2 +/- 0.8	13.0 +/- 1.4	**
Gamma field - DR06	01/15/16	TLD	mR/90 days	10.9 +/- 1.2	11.2 +/- 0.9	**
Gamma field - DR07	01/15/16	TLD	mR/90 days	11.1 +/- 0.9	11.0 +/- 1.0	**
Gamma field - DR08	01/15/16	TLD	mR/90 days	15.7 +/- 1.8	15.6 +/- 1.5	**
Gamma field - DR09	01/15/16	TLD	mR/90 days	11.6 +/- 0.7	11.2 +/- 0.8	**
Gamma field - DR10	01/15/16	TLD	mR/90 days	11.5 +/- 0.7	11.4 +/- 0.9	**
Gamma field - DR11	01/15/16	TLD	mR/90 days	12.0 +/- 0.7	11.8 +/- 1.3	**
Gamma field - DR29	01/15/16	TLD	mR/90 days	15.8 +/- 1.1	15.9 +/- 1.2	**
Gamma field - DR31	01/15/16	TLD	mR/90 days	16.3 +/- 1.1	16.2 +/- 1.6	**
Gamma field - SFDR14	01/15/16	TLD	mR/90 days	35.2 +/- 3.7	45.0 +/- 3.0	**
Gamma field - SFDR15	01/15/16	TLD	mR/90 days	28.4 +/- 8.6	29.7 +/- 7.8	**

¹ See discussion at the beginning of the Appendix

** The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-3

Teledyne Brown Engineering's Typical MDAs for Gamma Spectrometry

Selected Nuclides	Bay Water pCi/l	Fish pCi/kg	Shellfish pCi/kg	Sediment pCi/kg	Vegetation pCi/kg	Particulates 10 ⁻³ pCi/m ³
H-3	175	--	--	--	--	--
Na-22	1	8	3	12	6	5
Cr-51	12	105	4	104	50	63
Mn-54	1	9	3	12	5	4
Co-58	1	9	4	9	4	5
Fe-59	3	28	9	24	10	12
Co-60	1	9	4	12	5	6
Zn-65	2	20	8	25	10	9
Nb-95	1	12	7	14	6	9
Zr-95	2	18	8	20	9	9
Ru-106	9	75	30	90	41	40
Ag-110m	1	10	10	10	5	4
Te-129m	16	131	60	162	79	95
I-131	4	65	30	35	22	74
Cs-134	1	8	4	10	5	4
Cs-137	1	9	4	10	5	4
BaLa-140	3	32	15	25	14	36
Ce-144	7	40	16	54	26	18

APPENDIX D
Land Use Survey

Appendix D contains the results of a Land Use Survey conducted around Calvert Cliffs Nuclear Power Plant during this operating period. A table listing the raw data of this survey and a discussion of the results are included in this appendix.

Discussion

A Land Use Survey was conducted to identify, within a distance of 5 miles, the location of the nearest milk animal, the nearest residence, and the nearest garden greater than 50 m² in each of the nine sectors over land. A detailed description of the Land Use Survey is given in a separate document (Ref. 9). The position of the nearest residence and garden in each sector out to 5 miles is given in the adjacent table. There are no animals producing milk for human consumption within the 5 mile radius. The nearest garden location has changed in the S and SSE sectors since 2014 and are still located within the 5-mile radius.

Table D-1
Land Use Survey

Sector	Distance From Plant (miles)	
	Residence	Garden
SE	1.5	1.5
SSE	1.6	4.2
S	1.6	1.6
SSW	1.5	1.6
SW	1.1	1.1
WSW	1.3	1.4
W	1.3	1.6
WNW	2.7	2.7
NW	2.0	2.2

The closest residence is situated in the SW sector and the nearest garden is also in the SW sector, which is one of the least prevalent wind directions. In the S, SSE, and SE sectors, there is the highest probability of wind blowing from the direction of the plant. The two gardens used for vegetable samples by the REMP have been placed in the sectors with the highest X/Q. One sampling garden is located in the S sector at a distance of 0.4 miles, and another is situated near the site boundary in the SSE sector at a distance of 1.6 miles from the plant. These two sampling sites are considered good indicator locations for radioactive depositions around the plant.

The dose assessment using this operating period meteorological data was performed, and no significant impact from the plant was found.

APPENDIX E
Additional Samples and Analysis Results

Appendix E is a presentation of the analytical results for additional samples collected in the environs of CCNPP. These extra samples are not required by the ODCM (Ref. 6). Table E-1 lists the locations of all the additional samples and the remaining tables in this appendix provide the results. Some of these samples were collected and analyzed to maintain the historical continuity for samples and sampling pathways discontinued when the Environmental Technical Specifications were changed in March, 1985. Additionally, Table E-1 includes the PICs which were phased out in 2011. Dose is instead measured at these locations by TLDs. The TLDs are a more reliable method of measuring dose and the PICS were redundant.

Table E-4 through E-10 contain analytical results for samples taken from the various radiological pathways (i.e., aquatic, atmospheric, terrestrial, and direct radiation) surrounding the plant. In general these results continue the historical trends previously observed in the official sites of the CCNPP REMP and ISFSI.

Table E-10 shows the direct radiation readings from TLDs placed at the perimeter of the Resin Storage Area which is a temporary waste resin storage and cask transfer area located to the west of the ISFSI facility. The TLD values are somewhat higher than those in the REMP program due to their proximity to this source of the radiation. However, when the direct radiation readings for the Resin Storage Area are compared with those from the ISFSI and Site Boundary TLDs, it is apparent that temporary storage of spent resin and cask transfers are having no significant, measurable effect on the environs surrounding CCNPP.

The NEI Industry Groundwater Protection Initiative was established to determine the potential impact nuclear power plants may have on the surrounding environment due to unplanned releases of radioactive liquids. Under the Groundwater Protection Initiative, groundwater monitoring is accomplished through routine sampling of the water table around the plant and analysis for gamma and tritium.

Groundwater samples were collected from 17 on-site piezometer tubes and one subsurface man hole in 2015. These were identified as Piezometers 11 – 30 and MH24 on Figure E-1, Site Map Groundwater Monitoring Wells. A piezometer tube is a shallow monitoring well which allows access to groundwater at a depth of approximately 40 feet beneath the site. Of the piezometer tubes sampled, # 11 indicated tritium in all four quarterly samples from 2015. Tritium at this location was previously identified and evaluated in December of 2005. The tritium originated from normal radiological waste discharges and was previously reported in the CCNPP Annual Radioactive Effluent Release Reports. The contamination is contained on site. No drinking water has been affected; the groundwater at this location does not impact any drinking water pathway. Two additional samples, collected in the third quarter 2015 at piezometer #19 and at Manhole #24, had positive tritium results. The results were 147 pCi/l at #19 and 151 pCi/l at Manhole #24. These results are well below the investigation level required by station procedures (2000 pCi/l) and tritium was not identified in samples from these locations in the following quarter.

The 2015 analysis results for tritium are shown in Table E-11, and analysis results for gamma emitting radionuclides are shown in Table E-12.

TABLE OF CONTENTS - ANALYTICAL RESULTS

Table	Title	Page
E-1	Locations of Non-Tech Spec Environmental Sampling Stations for Calvert Cliffs Nuclear Power Plant	76
E-2	Synopsis of 2015 Calvert Cliffs Nuclear Power Plant Non-Tech Spec Radiological Environmental Monitoring Program	77
E-3	Annual Summary for Calvert Cliffs Nuclear Power Plant Units 1 & 2 Non-Tech Spec Radiological Environmental Monitoring Program	78
E-4	Concentration of Gamma Emitters in Bottom Sediment	79
E-5	Concentration of Iodine-131 in Filtered Air	80
E-6	Concentration of Beta Emitters in Air Particulates	82
E-7	Concentration of Gamma Emitters in Air Particulates	84
E-8	Concentration of Tritium and Gamma Emitters in TaylorsIsland Well Water	85
E-9	Direct Radiation	86
E-10	Direct Radiation from Resin Storage Area	87
E-11	Concentration of Tritium in Groundwater	88
E-12	Gross Concentration of Gamma Emitters in Groundwater	89

Figure	Title	Page
E-1	Site Map Groundwater Monitoring Wells	90

TABLE E-1

**Locations of Non-Tech Spec Environmental Sampling Stations
for Calvert Cliffs Nuclear Power Plant**

Station	Description	Distance ¹		Direction ¹
		(KM)	(Miles)	(Sector)
A6	Long Beach	4.4	2.7	NW
A7	Taylor's Island, Anderson's Property	12.6	7.8	ENE
A8	Cambridge, U of MD Estuarine Center	32.0	19.9	NE
DR24	Route 4 and Parran Road	3.0	1.9	SW
DR25	Camp Conoy Guard House	1.0	0.6	S
DR26	Route 235 & Clarks Landing Rd.	20.5	12.7	SW
DR27	Route 231 & Route 4	23.0	14.3	NW
DR28	Taylor's Island Emergency Siren #35	12.3	7.6	ENE
DR29	Taylor's Island Emergency Siren #38	12.5	7.8	E
DR31	Cambridge, U of MD Estuarine Center	32.0	19.9	NE
DR32	Twining Property, Taylor's Island	12.3	7.6	NE
DR33	P.A. Ransome Property, Taylor's Island	14.8	9.2	ESE
DR34	Shoreline at Barge Road	0.2	0.1	NE
OSGDR1	North of Old Steam Generator Storage Facility	0.3	0.2	SW
OSGDR2	West of Old Steam Generator Storage Facility	0.3	0.2	SW
PIC1 ²	Taylor's Island, Anderson's Property	12.6	7.8	ENE
PIC2 ²	On Site before Entrance to Camp Conoy	0.7	0.4	S
PIC3 ²	Meteorological Station	0.8	0.5	WSW
PIC4 ²	NNW of ISFSI	0.6	0.4	SW
PIC5 ²	SSE of ISFSI	0.6	0.4	SSW
PIC8 ²	CCNPP Visitor's Center	0.3	0.2	NW
RPDR5	Resin Storage Area – North Fence Lower	0.7	0.4	SW
RPDR6	Resin Storage Area – North Fence Upper	0.7	0.4	SW
RPDR7	Resin Storage Area – West Fence Right	0.7	0.4	SW
RPDR8	Resin Storage Area – West Fence Left	0.7	0.4	SW
RPDR9	Resin Storage Area – South Fence Upper	0.7	0.4	SW
RPDR10	Resin Storage Area – South Fence Lower	0.7	0.4	SW
RPDR11	Resin Storage Area – East Fence Left	0.7	0.4	SW
RPDR12	Resin Storage Area – East Fence Right	0.7	0.4	SW
WBS2	Discharge Area	0.3	0.2	N
WBS4	Camp Conoy/Rocky Point	3.0	1.9	SE
WW1	Taylor's Island, Anderson's Property	12.6	7.8	ENE

¹ Distance and direction from the central point between the two containment buildings.

² No longer in use. Refer to Appendix E Summary.

Table E-2

**Synopsis of 2015 Calvert Cliffs Nuclear Power Plant
Non-Tech Spec Radiological Environmental Monitoring Program**

Sample Type	Sampling Frequency ¹	Number of Locations	Number Collected	Analysis	Analysis Frequency ¹	Number Analyzed
Aquatic Environment						
Bottom Sediment	Q	2	4	Gamma	Q	4
Atmospheric Environment						
Air Iodine ²	W	7	358	I-131	W	358
Air Particulates ³	W	3	150	Gross Beta	W	150
				Gamma	MC	36
Direct Radiation						
Ambient Radiation	Q	20	480	TLD	Q	480
Terrestrial Environment						
Groundwater	M	1	12	Gamma	M	12
				H3	M	12

¹ W=weekly, M=monthly, Q=quarterly, SA=semiannual, A=annual, C=composite

² The collection device contains Charcoal

³ Beta counting is performed after >72 hour decay, Gamma spectroscopy performed on monthly composites of weekly samples

Table E-3

**Annual Summary for Calvert Cliffs Nuclear Power Plant Units 1 & 2
Non-Tech Spec Radiological Environmental Monitoring Program**

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (F)/Range ¹	Location with Highest Annual Mean Name/Distance & Direction ²	Highest Annual Mean (F) / Range ¹	Control Locations Mean (F)/Range
Aquatic Environment						
Bottom Sediment (pCi/kg)	Gamma (4) Cs-137	17	191 (1/2) (191)	Discharge Area WBS2 0.3 km N	191 (1/2) (191)	125 (2/2) (98-153)
Atmospheric Environment						
Air Particulates (10 ⁻² pCi/m ³)	Gross Beta (156)	0.5	2.1 (99/104) (0.7-4.9)	Cambridge CA 32.0 km NE	2.1 (51/52) (0.8-4.2)	1.9 (51/52) (0.7-4.7)
Direct Radiation						
Ambient Radiation (mR/90 days)	TLD (480)	--	21.15 (480/480) (9.45-75.99)	East Fence Left RPDR11 km	69.51 (24/24) (58.91-75.99)	--

¹ Mean and range based upon detectable measurements only. Fraction (F) of detectable measurements at specified location is indicated in parentheses.

² Distance and direction from the central point between the two containment buildings.

Table E-4

**Concentration of Gamma Emitters in Bottom Sediment
(Results in units of pCi/kg (dry) +/- 2σ)**

Sample Code	Sample Date	Cs-137	Gamma Emitters
WBS2			
Discharge Area	6/16/2015	191 +/- 66	*
	10/21/2015		*
WBS4 ¹			
Camp Conoy/ Rocky Point	6/16/2015	98 +/- 53	*
	10/21/2015	153 +/- 46	*

¹ Control Location

* All Non-Natural Gamma Emitters <MDA

Table E-5

Concentration of Iodine-131 in Filtered Air
(Results in units of 10^{-3} pCi/m³ +/- 2σ)

Start Date	Stop Date	CA Cambridge	LB LONG BEACH	SFA1 MET Station	SFA2 ¹ Visitors Center	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI	TI ¹ TAYLOR'S ISLAND
12/29/2014	1/5/2015	*	*	*	*	*	*	*
1/5/2015	1/12/2015	*	*	*	*	*	*	2
1/12/2015	1/19/2015	*	2	*	*	*	*	*
1/19/2015	1/26/2015	*	2	*	*	*	*	*
1/26/2015	2/2/2015	*	2	*	*	*	*	*
2/2/2015	2/9/2015	*	3	*	*	*	*	*
2/9/2015	2/16/2015	*	*	*	*	*	*	*
2/16/2015	2/23/2015	*	*	*	*	*	*	*
2/23/2015	3/2/2015	*	*	*	*	*	*	*
3/2/2015	3/9/2015	*	*	*	*	*	*	*
3/9/2015	3/16/2015	*	*	*	*	*	*	*
3/16/2015	3/23/2015	*	*	*	*	*	*	*
3/23/2015	3/30/2015	*	*	*	*	*	*	*
3/30/2015	4/6/2015	*	*	*	*	*	*	*
4/6/2015	4/13/2015	4	*	*	*	*	*	*
4/13/2015	4/20/2015	*	*	*	*	*	*	*
4/20/2015	4/27/2015	*	*	*	*	*	*	*
4/27/2015	5/4/2015	*	*	*	*	*	*	*
5/4/2015	5/11/2015	*	*	*	*	*	*	*
5/11/2015	5/18/2015	*	*	*	*	*	*	*
5/18/2015	5/25/2015	*	*	*	*	*	*	*
5/25/2015	6/1/2015	*	*	*	*	*	*	*
6/1/2015	6/8/2015	*	*	*	*	*	*	*
6/8/2015	6/15/2015	*	*	*	*	*	*	*
6/15/2015	6/22/2015	*	*	*	*	*	*	*
6/22/2015	6/29/2015	*	*	*	*	*	*	*
6/29/2015	7/6/2015	*	*	*	*	*	*	*
7/6/2015	7/13/2015	*	*	*	*	*	*	*

Table E-5

**Concentration of Iodine-131 in Filtered Air
(Results in units of 10^{-3} pCi/m³ +/- 2 σ)**

Start Date	Stop Date	CA Cambridge	LB LONG BEACH	SFA1 MET Station	SFA2 ¹ Visitors Center	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI	TI ¹ TAYLOR'S ISLAND
7/13/2015	7/20/2015	*	*	*	*	*	*	*
7/20/2015	7/27/2015	*	*	*	*	*	*	*
7/27/2015	8/3/2015	*	*	*	*	*	*	*
8/3/2015	8/10/2015	*	*	*	*	*	*	*
8/10/2015	8/17/2015	*	*	*	*	*	*	*
8/17/2015	8/24/2015	*	*	*	*	*	*	*
8/24/2015	8/31/2015	*	*	*	*	*	*	*
8/31/2015	9/7/2015	*	*	*	*	*	*	*
9/7/2015	9/14/2015	*	*	*	*	*	*	*
9/14/2015	9/21/2015	*	*	*	*	*	*	*
9/21/2015	9/28/2015	*	*	*	*	*	*	*
9/28/2015	10/5/2015	*	*	*	*	*	*	*
10/5/2015	10/12/2015	*	*	*	*	*	*	*
10/12/2015	10/19/2015	*	*	*	*	*	*	*
10/19/2015	10/26/2015	*	*	*	*	*	*	*
10/26/2015	11/2/2015	*	*	*	*	*	*	*
11/2/2015	11/9/2015	*	*	*	*	*	*	*
11/9/2015	11/16/2015	*	*	*	*	*	*	*
11/16/2015	11/23/2015	*	*	*	*	*	*	*
11/23/2015	11/30/2015	*	*	*	*	*	*	*
11/30/2015	12/7/2015	*	*	*	*	*	*	*
12/7/2015	12/14/2015	*	*	*	*	*	*	*
12/14/2015	12/21/2015	*	*	*	*	*	*	*
12/21/2015	12/28/2015	*	*	*	*	*	*	*

¹ Control Location
² Sampler malfunction/low flow
³ NCR, Lost Sample
⁴ Power Outage
* <MDA

Table E-6

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ +/- 2 σ)**

Start Date	Stop Date	CA Cambridge	LB LONG BEACH	T1 ¹ TAYLOR'S ISLAND
12/29/2014	1/5/2015	2.9 +/- 0.1	2.6 +/- 0.1	2.5 +/- 0.1
1/5/2015	1/12/2015	2.5 +/- 0.2	2.2 +/- 0.3	2 ²
1/12/2015	1/19/2015	2.5 +/- 0.2	2 ²	2.2 +/- 0.2
1/19/2015	1/26/2015	1.7 +/- 0.1	2 ²	1.7 +/- 0.1
1/26/2015	2/2/2015	1.6 +/- 0.1	2 ²	1.4 +/- 0.1
2/2/2015	2/9/2015	2.7 +/- 0.2	3 ³	2.5 +/- 0.2
2/9/2015	2/16/2015	2.3 +/- 0.1	2.8 +/- 0.2	2.2 +/- 0.1
2/16/2015	2/23/2015	2.0 +/- 0.2	2.7 +/- 0.1	2.5 +/- 0.1
2/23/2015	3/2/2015	2.6 +/- 0.1	2.8 +/- 0.2	2.6 +/- 0.1
3/2/2015	3/9/2015	2.2 +/- 0.1	2.2 +/- 0.1	2.1 +/- 0.1
3/9/2015	3/16/2015	1.8 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1
3/16/2015	3/23/2015	1.7 +/- 0.1	1.7 +/- 0.1	1.8 +/- 0.1
3/23/2015	3/30/2015	1.8 +/- 0.1	1.9 +/- 0.1	1.7 +/- 0.1
3/30/2015	4/6/2015	1.6 +/- 0.1	1.6 +/- 0.1	1.4 +/- 0.1
4/6/2015	4/13/2015	4 ⁴	1.3 +/- 0.1	1.1 +/- 0.1
4/13/2015	4/20/2015	1.4 +/- 0.2	1.4 +/- 0.1	1.6 +/- 0.1
4/20/2015	4/27/2015	1.5 +/- 0.1	1.5 +/- 0.1	1.5 +/- 0.1
4/27/2015	5/4/2015	1.1 +/- 0.1	1.0 +/- 0.1	1.0 +/- 0.1
5/4/2015	5/11/2015	2.8 +/- 0.2	2.3 +/- 0.2	2.2 +/- 0.2
5/11/2015	5/18/2015	2.1 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1
5/18/2015	5/25/2015	2.3 +/- 0.1	1.9 +/- 0.1	1.8 +/- 0.1
5/25/2015	6/1/2015	1.8 +/- 0.1	1.5 +/- 0.1	1.6 +/- 0.1
6/1/2015	6/8/2015	0.8 +/- 0.1	0.7 +/- 0.1	0.7 +/- 0.1
6/8/2015	6/15/2015	2.3 +/- 0.1	2.1 +/- 0.1	2.1 +/- 0.1
6/15/2015	6/22/2015	1.9 +/- 0.1	1.6 +/- 0.1	1.6 +/- 0.1
6/22/2015	6/29/2015	1.7 +/- 0.1	1.4 +/- 0.1	1.3 +/- 0.1
6/29/2015	7/6/2015	1.7 +/- 0.1	1.9 +/- 0.1	1.1 +/- 0.1
7/6/2015	7/13/2015	2.1 +/- 0.1	2.0 +/- 0.1	1.9 +/- 0.1
7/13/2015	7/20/2015	2.0 +/- 0.1	1.7 +/- 0.1	1.6 +/- 0.1
7/20/2015	7/27/2015	2.2 +/- 0.1	2.0 +/- 0.1	1.9 +/- 0.1
7/27/2015	8/3/2015	2.7 +/- 0.1	2.2 +/- 0.1	2.1 +/- 0.1
8/3/2015	8/10/2015	1.9 +/- 0.1	1.9 +/- 0.1	1.8 +/- 0.1
8/10/2015	8/17/2015	2.1 +/- 0.1	1.9 +/- 0.1	2.0 +/- 0.1
8/17/2015	8/24/2015	2.2 +/- 0.1	2.1 +/- 0.1	2.1 +/- 0.1
8/24/2015	8/31/2015	2.9 +/- 0.1	2.4 +/- 0.1	2.6 +/- 0.1
8/31/2015	9/7/2015	4.0 +/- 0.2	3.5 +/- 0.2	3.3 +/- 0.2
9/7/2015	9/14/2015	2.0 +/- 0.1	1.7 +/- 0.1	1.6 +/- 0.1
9/14/2015	9/21/2015	3.5 +/- 0.2	3.0 +/- 0.2	3.0 +/- 0.2
9/21/2015	9/28/2015	2.0 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1

Table E-6

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ +/- 2 σ)**

Start Date	Stop Date	CA Cambridge	LB LONG BEACH	TI ¹ TAYLOR'S ISLAND
9/28/2015	10/5/2015	0.9 +/- 0.1	0.9 +/- 0.1	0.9 +/- 0.1
10/5/2015	10/12/2015	2.1 +/- 0.1	2.2 +/- 0.1	2.0 +/- 0.1
10/12/2015	10/19/2015	1.7 +/- 0.1	2.1 +/- 0.1	1.8 +/- 0.1
10/19/2015	10/26/2015	2.0 +/- 0.1	2.3 +/- 0.1	2.4 +/- 0.1
10/26/2015	11/2/2015	1.5 +/- 0.1	1.7 +/- 0.1	1.7 +/- 0.1
11/2/2015	11/9/2015	2.0 +/- 0.1	2.2 +/- 0.1	2.0 +/- 0.1
11/9/2015	11/16/2015	1.8 +/- 0.1	1.9 +/- 0.1	2.1 +/- 0.1
11/16/2015	11/23/2015	1.8 +/- 0.1	1.9 +/- 0.1	2.0 +/- 0.1
11/23/2015	11/30/2015	1.9 +/- 0.1	2.0 +/- 0.1	1.9 +/- 0.1
11/30/2015	12/7/2015	2.8 +/- 0.2	3.5 +/- 0.2	2.9 +/- 0.2
12/7/2015	12/14/2015	4.2 +/- 0.2	4.9 +/- 0.2	4.7 +/- 0.2
12/14/2015	12/21/2015	1.8 +/- 0.1	2.1 +/- 0.1	2.0 +/- 0.1
12/21/2015	12/28/2015	1.4 +/- 0.1	1.0 +/- 0.1	1.1 +/- 0.1

¹ Control Location

² Sampler malfunction/low flow

³ NCR, Lost Sample

⁴ Power outage

⁵ Sampler Malfunction; Loss of Data

* <MDA

Table E-7

**Concentration of Gamma Emitters in Air Particulates
(Results in units of 10^{-3} pCi/m³ +/- 2 σ)**

Sample Date	CA Cambridge	LB LONG BEACH	TI ¹ TAYLOR'S ISLAND
2/2/2015	*	*	*
3/2/2015	*	*	*
3/30/2015	*	*	*
4/27/2015	*	*	*
6/1/2015	*	*	*
6/29/2015	*	*	*
8/3/2015	*	*	*
8/31/2015	*	*	*
9/28/2015	*	*	*
11/2/2015	*	*	*
11/30/2015	*	*	*
12/28/2015	*	*	*

¹ Control Location

* All Non-Natural Gamma Emitters <MDA

Table E-8

**Concentration of Tritium and Gamma Emitters
in Taylors Island Well Water
(Results in units of pCi/L +/- 2σ)**

Sample Date	Gamma Emitters	H3
1/20/2015	*	<156
2/23/2015	*	<156
3/17/2015	*	<157
4/20/2015	*	<181
5/26/2015	*	<182
6/30/2015	*	<178
7/27/2015	*	<177
8/24/2015	*	<178
9/21/2015	*	<175
10/20/2015	*	<111
11/10/2015	*	<109
12/21/2015	*	<110

* Non-Natural Gamma Emitters <MDA

Table E-9

Direct Radiation
(Results in units of mR/90 days +/- 2σ)

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
DR24	Rt. 4 and Parran Rd.	11.80 +/- 0.80	11.56 +/- 1.20	11.93 +/- 1.36	12.30 +/- 1.26
DR25	Camp Conoy Guard House	13.02 +/- 1.15	12.93 +/- 1.26	13.48 +/- 1.27	13.37 +/- 0.79
DR26	Rt. 235 and Clark's Landing Road	11.25 +/- 0.35	11.00 +/- 1.26	11.12 +/- 0.96	11.24 +/- 1.00
DR27	Rt. 231 and Rt. 4	12.15 +/- 1.01	11.99 +/- 0.92	11.85 +/- 1.20	12.46 +/- 1.09
DR28	Taylor's Is. Siren #35	13.69 +/- 0.35	13.58 +/- 1.28	14.14 +/- 1.47	14.95 +/- 1.69
DR29	Taylor's Is. Siren #38	14.80 +/- 1.72	15.56 +/- 1.43	14.22 +/- 1.15	15.28 +/- 1.05
DR31	Cambridge	15.49 +/- 1.57	15.05 +/- 0.63	15.75 +/- 0.67	15.81 +/- 1.09
DR32	Twining Property, Taylor's Island	14.82 +/- 1.45	14.16 +/- 1.69	16.00 +/- 1.45	15.65 +/- 1.12
DR33	P. A. Ransome Property	15.42 +/- 0.24	15.40 +/- 1.18	16.01 +/- 1.98	16.99 +/- 0.75
DR34	Shoreline at Barge Rd.	9.75 +/- 1.33	9.59 +/- 0.72	9.76 +/- 0.28	9.45 +/- 0.85
OSG1	North of Old Steam Generator Storage Facility	18.52 +/- 1.24	18.17 +/- 1.50	18.40 +/- 0.57	18.69 +/- 0.71
OSG2	West of Old Steam Generator Storage Facility	15.88 +/- 2.52	15.71 +/- 1.90	15.64 +/- 2.14	16.76 +/- 2.87

Table E-10

**Direct Radiation from Resin Storage Area
(Results in units of mR/90 days $\pm 2\sigma$)**

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
RPDR05	North Fence Lower	32.44 +/- 3.05	30.66 +/- 3.15	29.58 +/- 1.96	31.82 +/- 2.76
RPDR06	North Fence Upper	16.13 +/- 1.25	17.29 +/- 1.17	17.33 +/- 1.53	36.99 +/- 2.04
RPDR07	West Fence Right	25.40 +/- 1.51	27.39 +/- 1.32	18.77 +/- 0.87	24.74 +/- 1.02
RPDR08	West Fence Left	20.89 +/- 2.02	20.62 +/- 2.29	18.84 +/- 1.37	19.94 +/- 2.32
RPDR09	South Fence Upper	29.50 +/- 1.78	29.52 +/- 1.85	27.11 +/- 2.20	27.12 +/- 1.34
RPDR10	South Fence Lower	40.91 +/- 5.60	42.33 +/- 6.22	39.42 +/- 3.91	39.05 +/- 6.53
RPDR11	East Fence Left	73.56 +/- 11.24	75.99 +/- 9.50	69.58 +/- 2.71	58.91 +/- 4.88
RPDR12	East Fence Right	19.45 +/- 1.92	18.85 +/- 1.42	18.76 +/- 2.21	20.84 +/- 1.75

Table E-11
Concentration of Tritium in Groundwater
(Results in units of pCi/L +/- 2σ)
By Piezometer Tube Locations

Sample Date	11	12	13	15	18	19	20	21	22	23	24	25	26	27	28	29	30	MH24
02/25/2015	ND	ND	ND	ND	ND	ND	#	#	#	ND								
02/28/2015	ND	#	#	#	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
03/02/2015	708+/-149	ND	ND	ND	#	#	ND											
03/24/2015	ND	ND	ND	ND	ND	ND	ND	ND	ND	#	#	ND	#	#	#	#	ND	ND
03/25/2015	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	#	ND	ND	ND	ND	#	#
06/06/2015	ND	ND	#	#	#	#	#	#	#	ND	ND	ND	ND	#	ND	ND	ND	#
06/20/2015	1370+/-xxx	ND	ND	ND	ND	ND	ND	ND	ND	#	ND	ND	#	ND	#	ND	ND	ND
06/22/2015	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	#	#	ND	ND	ND	#	#	ND
06/29/2015	ND	#	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
07/25/2015	ND	ND	ND	ND	ND	ND	#	#	#	ND								
08/22/2015	2100+/-224	#	#	#	#	#	ND	ND	ND	ND	ND	#	ND	ND	ND	ND	ND	ND
09/19/2015	ND	ND	ND	ND	ND	ND	ND	ND	ND	#	#	#	#	#	#	#	#	ND
09/28/2015	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	151+/-97
11/07/2015	ND	ND	ND	#	#	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
11/09/2015	ND	ND	ND	ND	ND	147+/-96	ND											
11/15/2015	1570+/-222	#	#	ND	ND	ND	#	#	#	ND	ND	ND	#	#	#	ND	ND	ND
12/12/2015	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	#	#	ND	ND	ND	#	#	#
12/31/2015	ND	ND	ND	ND	ND	ND	ND	ND	ND	#	ND							

Tritium Less than minimum Detectable Activity(<MDA)

ND No Data - Quarterly sample obtained as required.

Table E-12


Gross Concentration of Gamma Emitters in Groundwater
(Results in units of pCi/L +/- 2σ)
By Piezometer Tube Locations

Sample Date	11	12	13	15	18	19	20	21	22	23	24	25	26	27	28	29	30	MH24
02/25/2015	ND	ND	ND	ND	ND	ND	*	*	*	ND								
02/28/2015	ND	*	*	*	ND													
03/02/2015	*	ND	ND	ND	*	*	ND											
03/24/2015	ND	*	*	ND	*	*	*	*	ND	ND								
03/25/2015	ND	*	ND	ND	ND	ND	*	*										
06/06/2015	ND	ND	*	*	*	*	*	*	*	ND	ND	ND	ND	*	ND	ND	ND	*
06/20/2015	*	ND	*	ND	ND	*	ND	*	ND	ND	ND							
06/22/2015	ND	*	*	ND	ND	ND	*	*	ND									
06/29/2015	ND	*	ND															
07/25/2015	ND	ND	ND	ND	ND	ND	*	*	*	ND								
08/22/2015	*	*	*	*	*	*	ND	ND	ND	ND	ND	*	ND	ND	ND	ND	ND	ND
09/19/2015	ND	*	*	*	*	*	*	*	*	ND								
09/28/2015	ND	*																
11/07/2015	ND	ND	ND	*	*	ND												
11/09/2015	ND	ND	ND	ND	ND	*	ND											
11/15/2015	*	*	*	ND	ND	ND	*	*	*	ND	ND	ND	*	*	*	ND	ND	ND
12/12/2015	ND	*	*	ND	ND	ND	*	*	*									
12/31/2015	ND	*	ND															

* All Non-Natural Gamma Emitters <MDA
ND No Data - Quarterly sample obtained as required.

Figure E-1

Site Map Groundwater Monitoring Wells

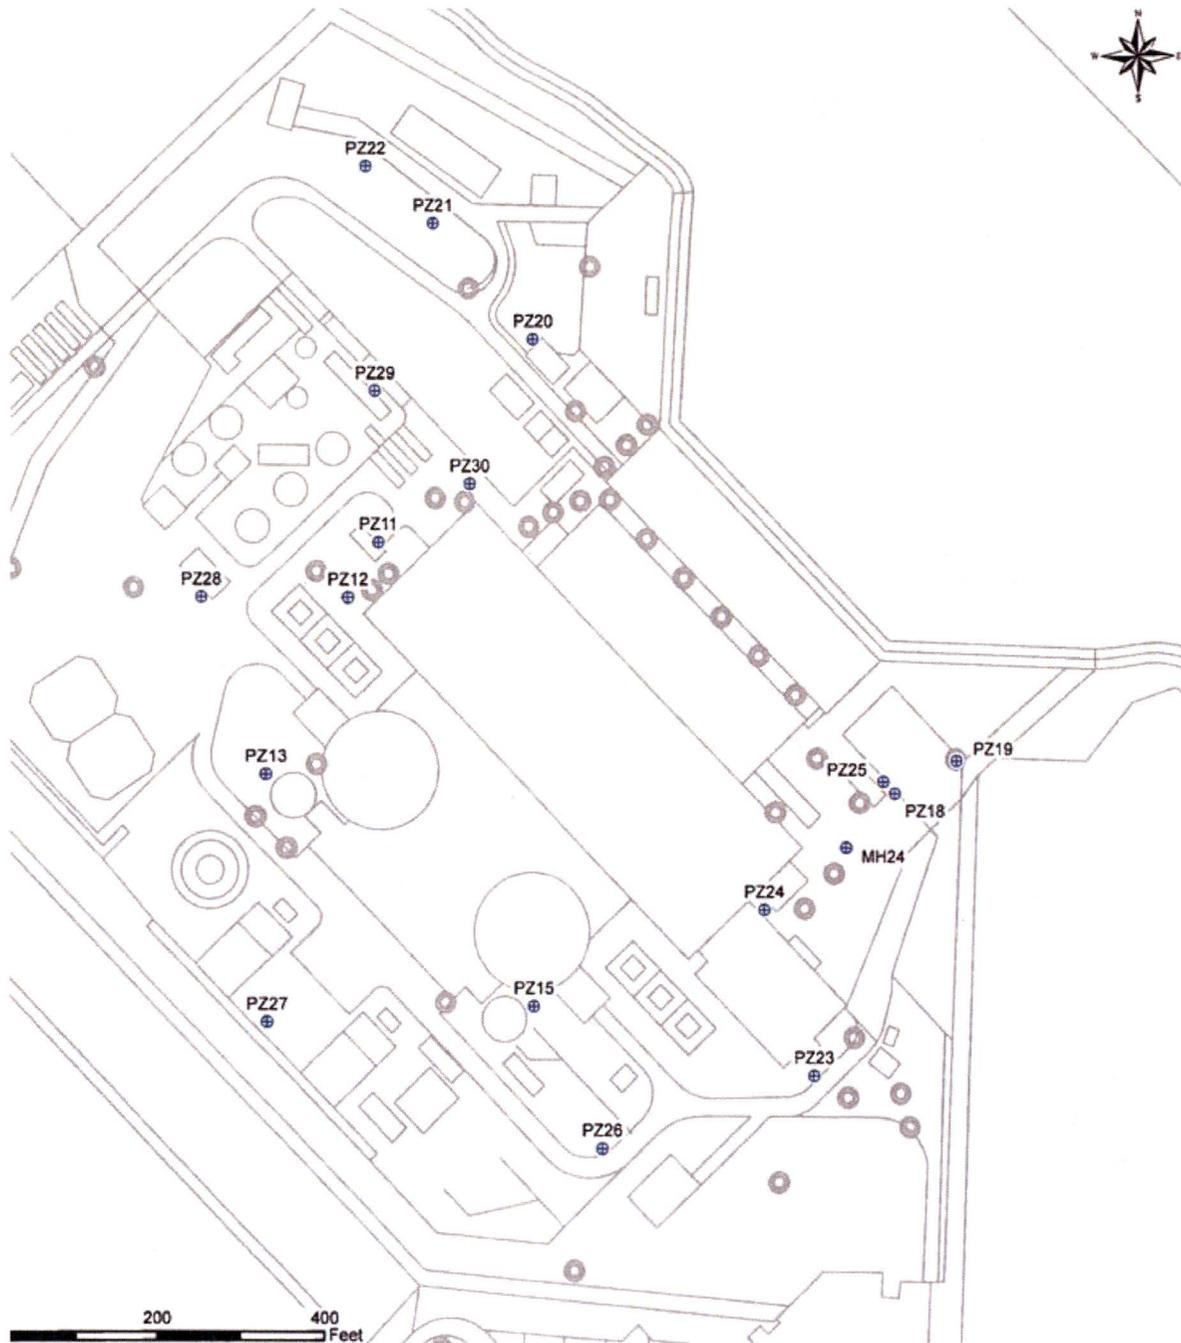

Explanation

⊕ RGPP Monitoring Locations