

Site-Specific Environmental Impact Statement for License Renewal of Nuclear Plants

Supplement 26, Second Renewal

Regarding Subsequent License Renewal for Monticello Nuclear Generating Plant, Unit 1

Draft Report for Comment

AVAILABILITY OF REFERENCE MATERIALS IN NRC PUBLICATIONS

NRC Reference Material

As of November 1999, you may electronically access NUREG-series publications and other NRC records at the NRC's Library at www.nrc.gov/reading-rm.html. Publicly released records include, to name a few, NUREG-series publications; *Federal Register* notices; applicant, licensee, and vendor documents and correspondence; NRC correspondence and internal memoranda; bulletins and information notices; inspection and investigative reports; licensee event reports; and Commission papers and their attachments.

NRC publications in the NUREG series, NRC regulations, and Title 10, "Energy," in the *Code of Federal Regulations* may also be purchased from one of these two sources:

1. The Superintendent of Documents

U.S. Government Publishing Office
Washington, DC 20402-0001
Internet: <https://bookstore.gpo.gov/>
Telephone: (202) 512-1800
Fax: (202) 512-2104

2. The National Technical Information Service

5301 Shawnee Road
Alexandria, VA 22312-0002
Internet: <https://www.ntis.gov/>
1-800-553-6847 or, locally, (703) 605-6000

A single copy of each NRC draft report for comment is available free, to the extent of supply, upon written request as follows:

Address: **U.S. Nuclear Regulatory Commission**
Office of Administration
Digital Communications and Administrative
Services Branch
Washington, DC 20555-0001
E-mail: Reproduction.Resource@nrc.gov
Facsimile: (301) 415-2289

Some publications in the NUREG series that are posted at the NRC's Web site address www.nrc.gov/reading-rm/doc-collections/nuregs are updated periodically and may differ from the last printed version. Although references to material found on a Web site bear the date the material was accessed, the material available on the date cited may subsequently be removed from the site.

Non-NRC Reference Material

Documents available from public and special technical libraries include all open literature items, such as books, journal articles, transactions, *Federal Register* notices, Federal and State legislation, and congressional reports. Such documents as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings may be purchased from their sponsoring organization.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at—

The NRC Technical Library

Two White Flint North
11545 Rockville Pike
Rockville, MD 20852-2738

These standards are available in the library for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from—

American National Standards Institute

11 West 42nd Street
New York, NY 10036-8002
Internet: www.ansi.org
(212) 642-4900

Legally binding regulatory requirements are stated only in laws; NRC regulations; licensee, including technical specifications; or orders, not in NUREG-series publications. The views expressed in contractor prepared publications in this series are not necessarily those of the NRC.

The NUREG series comprises (1) technical and administrative reports and books prepared by the staff (NUREG-XXXX) or agency contractors (NUREG/CR-XXXX), (2) proceedings of conferences (NUREG/CP-XXXX), (3) reports resulting from international agreements (NUREG/IA-XXXX), (4) brochures (NUREG/BR-XXXX), and (5) compilations of legal decisions and orders of the Commission and the Atomic and Safety Licensing Boards and of Directors' decisions under Section 2.206 of the NRC's regulations (NUREG-0750), (6) Knowledge Management prepared by NRC staff or agency contractors (NUREG/KM-XXXX).

DISCLAIMER: This report was prepared as an account of work sponsored by an agency of the U.S. Government. Neither the U.S. Government nor any agency thereof, nor any employee, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus, product, or process disclosed in this publication, or represents that its use by such third party would not infringe privately owned rights.

Site-Specific Environmental Impact Statement for License Renewal of Nuclear Plants

Supplement 26, Second Renewal

Regarding Subsequent License Renewal for Monticello Nuclear Generating Plant, Unit 1

Draft Report for Comment

Manuscript Completed: April 2024
Date Published: April 2024

Office of Nuclear Material Safety and Safeguards

1

COMMENTS ON DRAFT REPORT

2 **Proposed Action** Issuance of renewed facility operating license DPR-22 for Monticello
3 Nuclear Generating Plant, Unit 1, located in central Minnesota in
4 Sherburne and Wright Counties, Minnesota

5 **Type of Statement** Draft Supplemental Environmental Impact Statement

6 **Agency Contact** Jessica Umaña
7 U.S. Nuclear Regulatory Commission (NRC)
8 Office of Nuclear Material Safety and Safeguards
9 Mail Stop T-4B72
10 Washington, DC 20555-0001
11 Email: Jessica.Umana@nrc.gov

12 **Comments:**

13 Any interested party may submit comments on this draft site-specific environmental impact
14 statement. Please specify "NUREG-1437, Supplement 26, draft," in the subject or title line for
15 your comments. Comments on this draft EIS should be filed no later than 45 days after the date
16 on which the U.S. Environmental Protection Agency notice, stating that this draft environmental
17 impact statement has been filed with the U.S. Environmental Protection Agency, is published in
18 the *Federal Register*. Comments received after the expiration of the comment period will be
19 considered if it is practical to do so, but assurance of consideration of late comments cannot be
20 given. You may submit comments electronically by searching for Docket ID NRC-2023-0031 at
21 the website: [Regulations.gov](https://www.regulations.gov).

22 The NRC cautions you not to include identifying or contact information that you do not want to
23 be publicly disclosed in your comment submission. The NRC will post all comment submissions
24 into the NRC's Agencywide Documents Access and Management System. The NRC does not
25 routinely edit comment submissions to remove identifying or contact information.
26

1 **COVER SHEET**

2 **Responsible Agency:** U.S. Nuclear Regulatory Commission, Office of Nuclear Material Safety
3 and Safeguards

4 **Title:** Site-Specific Environmental Impact Statement for Subsequent License Renewal of
5 Monticello Nuclear Generating Plant, Unit 1, Second Renewal, Draft Report for Comment.

6 For additional information or copies of this document contact:

7 U.S. Nuclear Regulatory Commission
8 Office of Nuclear Material Safety and Safeguards
9 Mail Stop T-4B72
10 11555 Rockville Pike
11 Rockville, MD 20852
12 Email: Jessica.Umana@nrc.gov

13 **ABSTRACT**

14 The U.S. Nuclear Regulatory Commission (NRC) prepared this site-specific environmental
15 impact statement (EIS) as part of its environmental review of Xcel Energy’s request to renew the
16 operating license for Monticello Nuclear Generating Plant, Unit 1 (Monticello) for an additional
17 20 years. This EIS includes the site-specific evaluation of the environmental impacts of the
18 proposed action (Monticello subsequent license renewal [SLR]), and alternatives to SLR. As
19 alternatives, the NRC considered: (1) natural gas and renewables; (2) renewables and storage;
20 (3) new nuclear small modular reactors, and (4) the no-action alternative.

21 This EIS considers information contained in Xcel Energy’s January 9, 2023, submittal
22 (Agencywide Documents Access and Management System Accession No. ML23009A352). Xcel
23 Energy prepared the Monticello SLR application in accordance with Commission direction.
24 Specifically, in February 2022, the Commission issued three memoranda and orders:
25 Commission Legal Issuance (CLI)-22-02, CLI-22-03, and CLI-22-04 (NRC 2022-TN8182, NRC
26 2022-TN9844, and NRC 2022-TN9553), concerning SLR environmental reviews. In CLI-22-02,
27 the Commission found that the License Renewal Generic Environmental Impact Statement
28 (LR GEIS) did not cover the SLR period and that 10 CFR 51.53(c)(3) (TN250) does not apply to
29 SLR applicants and, therefore, the NRC staff may not exclusively rely on the 2013 License
30 Renewal Generic Environmental Impact Statement and Table B–1 for the evaluation of
31 Category 1 issues for SLR. In its decisions, the Commission directed the staff to revise the
32 LR GEIS and Title 10 of the *Code of Federal Regulations* Part 51 to address SLR and
33 determined that the NRC staff must address these impacts on a site-specific basis in an EIS if
34 an SLR applicant elects not to await the issuance of a revised GEIS and rule.

35 Following its receipt of Xcel Energy’s SLR application and site-specific environmental report, the
36 NRC staff issued a notice of the staff’s intent to conduct a scoping process and to publish a
37 site-specific EIS for Monticello SLR (88 FR 15103-TN9715). The NRC staff conducted the
38 scoping process, and then published a scoping summary report (NRC 2024-TN9817).

1 The NRC staff has prepared this site-specific EIS in accordance with CLI-22-02 (NRC
2 2022-TN8182) and CLI-22-03 (NRC 2022-TN9844). This EIS considers, among other things,
3 the information contained in Xcel Energy's January 9, 2023, SLR application submittal (Xcel
4 2023-TN9084), and evaluates all the environmental impacts applicable to Monticello SLR on a
5 site-specific basis.

6 Based on its evaluation of environmental impacts, the NRC staff's preliminary recommendation
7 is that the adverse environmental impacts of Monticello SLR are not so great that preserving the
8 option of SLR for energy planning decisionmakers would be unreasonable. The EIS also
9 considers the comments submitted during the NRC environmental scoping period conducted in
10 March 2023 as summarized in the NRC staff's scoping summary report (NRC 2024-TN9817).
11 The NRC staff based its preliminary recommendation on the following:

- 12 • Xcel Energy's environmental report
- 13 • consultation with Federal, State, Tribal, and local governmental agencies
- 14 • the NRC staff's independent environmental review
- 15 • the consideration of public comments received during the scoping process

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35

TABLE OF CONTENTS

ABSTRACT	iii
TABLE OF CONTENTS.....	v
LIST OF FIGURES.....	xv
LIST OF TABLES	xvii
EXECUTIVE SUMMARY	xix
ABBREVIATIONS AND ACRONYMS	xxvii
1 INTRODUCTION AND GENERAL DISCUSSION.....	1-1
1.1 Proposed Federal Action	1-2
1.2 Purpose and Need for the Proposed Action	1-2
1.3 Major Environmental Review Milestones	1-2
1.4 Environmental Issues Evaluated in this EIS	1-4
1.5 Structure of this EIS.....	1-5
1.6 Decision to Be Supported by the EIS.....	1-6
1.7 Cooperating Agencies	1-6
1.8 Consultations.....	1-6
1.9 Correspondence	1-7
1.10 Status of Compliance.....	1-7
1.11 Related State and Federal Activities	1-7
2 ALTERNATIVES INCLUDING THE PROPOSED ACTION	2-1
2.1 Description of Nuclear Power Plant Facility and Operation	2-1
2.1.1 External Appearance and Setting.....	2-1
2.1.2 Nuclear Reactor Systems.....	2-4
2.1.3 Cooling and Auxiliary Water Systems.....	2-4
2.1.3.1 Circulation and Plant Water Systems	2-4
2.1.3.2 Domestic Water System	2-6
2.1.4 Radioactive Waste Management Systems	2-6
2.1.5 Nonradioactive Waste Management Systems	2-6
2.1.6 Utility and Transportation Infrastructure.....	2-7
2.1.6.1 Electricity.....	2-7
2.1.6.2 Fuel.....	2-7
2.1.6.3 Water.....	2-7
2.1.6.4 Transportation Systems.....	2-7
2.1.6.5 Power Transmission Systems	2-7
2.1.7 Nuclear Power Plant Operations and Maintenance	2-8

1	2.2	Proposed Action	2-8
2	2.2.1	Nuclear Power Plant Operations during the Subsequent License	
3		Renewal Term.....	2-8
4	2.2.2	Refurbishment and Other Activities Associated with License	
5		Renewal.....	2-9
6	2.2.3	Termination of Nuclear Power Plant Operations and	
7		Decommissioning after the License Renewal Term.....	2-9
8	2.3	Alternatives.....	2-9
9	2.3.1	No-Action Alternative	2-10
10	2.3.2	Replacement Power Alternatives	2-10
11	2.3.2.1	Natural Gas and Renewables.....	2-12
12	2.3.2.2	Renewables and Storage	2-13
13	2.3.2.3	New Nuclear (Small Modular Reactor).....	2-13
14	2.4	Alternatives Considered but Eliminated	2-14
15	2.4.1	Solar Power	2-14
16	2.4.2	Wind Power.....	2-15
17	2.4.3	Biomass Power	2-15
18	2.4.4	Hydroelectric Power	2-16
19	2.4.5	Geothermal Power	2-16
20	2.4.6	Wave and Ocean Energy	2-17
21	2.4.7	Municipal Solid Waste-Fired Power.....	2-17
22	2.4.8	Natural Gas-Fired Power.....	2-18
23	2.4.9	Petroleum-Fired Power	2-18
24	2.4.10	Coal-Fired Power	2-18
25	2.4.11	Fuel Cells.....	2-19
26	2.4.12	Purchased Power.....	2-19
27	2.4.13	Delayed Retirement of Other Generating Facilities.....	2-19
28	2.4.14	Demand-Side Management	2-20
29	2.5	Comparison of Alternatives.....	2-20
30	3	AFFECTED ENVIRONMENT, ENVIRONMENTAL CONSEQUENCES, AND	
31		MITIGATING ACTIONS	3-1
32	3.1	Introduction.....	3-1
33	3.2	Land Use and Visual Resources.....	3-5
34	3.2.1	Land Use.....	3-5
35	3.2.1.1	Onsite Land Use.....	3-5
36	3.2.1.2	Coastal Zone.....	3-6
37	3.2.1.3	Offsite Land Use.....	3-6
38	3.2.2	Visual Resources	3-7
39	3.2.3	Proposed Action.....	3-7
40	3.2.3.1	Onsite Land Use.....	3-7
41	3.2.3.2	Offsite Land Use.....	3-8

1		3.2.3.3	Offsite Land Use in Transmission Line Right-of-Ways	3-8
2		3.2.3.4	Visual Resources	3-8
3	3.2.4		No-Action Alternative	3-8
4		3.2.4.1	Land Use	3-8
5		3.2.4.2	Visual Resources	3-9
6	3.2.5		Replacement Power Alternatives: Common Impacts	3-9
7		3.2.5.1	Land Use	3-9
8		3.2.5.2	Visual Resources	3-11
9	3.3		Meteorology, Air Quality, and Noise	3-11
10		3.3.1	Meteorology and Climatology	3-11
11		3.3.2	Air Quality	3-12
12		3.3.3	Noise	3-14
13		3.3.4	Proposed Action	3-14
14		3.3.4.1	Air Quality Impacts	3-14
15		3.3.4.2	Air Quality Effects of Transmissions Lines	3-15
16		3.3.4.3	Noise Impacts	3-16
17	3.3.5		No-Action Alternative	3-16
18		3.3.5.1	Air Quality	3-16
19		3.3.5.2	Noise	3-16
20	3.3.6		Replacement Power Alternatives: Common Impacts	3-16
21		3.3.6.1	Air Quality	3-16
22		3.3.6.2	Noise	3-17
23	3.3.7		Natural Gas and Renewables Alternative	3-17
24		3.3.7.1	Air Quality	3-17
25		3.3.7.2	Noise	3-18
26	3.3.8		Renewables and Storage Alternative	3-19
27		3.3.8.1	Air Quality	3-19
28		3.3.8.2	Noise	3-20
29	3.3.9		New Nuclear (Small Modular Reactor) Alternative	3-20
30		3.3.9.1	Air Quality	3-20
31		3.3.9.2	Noise	3-21
32	3.4		Geologic Environment	3-22
33		3.4.1	Physiography and Geology	3-22
34		3.4.2	Geologic Resources	3-22
35		3.4.3	Soils	3-23
36		3.4.4	Seismic Setting	3-23
37		3.4.5	Proposed Action	3-24
38		3.4.6	No-Action Alternative	3-25
39		3.4.7	Replacement Power Alternatives: Common Impacts	3-25
40		3.4.8	Natural Gas and Renewables Alternative	3-26
41		3.4.9	Renewables and Storage Alternative	3-26

1		3.4.10	New Nuclear (Small Modular Reactor) Alternative.....	3-26
2	3.5		Water Resources.....	3-27
3		3.5.1	Surface Water Resources	3-27
4		3.5.1.1	Surface Water Hydrology.....	3-27
5		3.5.1.2	Surface Water Use in the Last 5 Years.....	3-29
6		3.5.1.3	Surface Water Quality and Effluents.....	3-30
7		3.5.2	Groundwater Resources	3-35
8		3.5.2.1	Local and Regional Groundwater Resources.....	3-36
9		3.5.2.2	Local and Regional Water Consumption.....	3-38
10		3.5.2.3	Groundwater Quality.....	3-40
11		3.5.3	Proposed Action.....	3-48
12		3.5.3.1	Surface Water Resources.....	3-48
13		3.5.3.2	Groundwater Resources.....	3-54
14		3.5.4	No-Action Alternative	3-58
15		3.5.4.1	Surface Water Resources.....	3-58
16		3.5.4.2	Groundwater Resources.....	3-58
17		3.5.5	Replacement Power Alternatives: Common Impacts.....	3-58
18		3.5.5.1	Surface Water Resources.....	3-58
19		3.5.5.2	Groundwater Resources.....	3-60
20		3.5.6	Natural Gas and Renewables Alternative.....	3-61
21		3.5.6.1	Surface Water Resources.....	3-61
22		3.5.6.2	Groundwater Resources.....	3-61
23		3.5.7	Renewables and Storage Alternative	3-61
24		3.5.7.1	Surface Water Resources.....	3-61
25		3.5.7.2	Groundwater Resources.....	3-62
26		3.5.8	New Nuclear (Small Modular Reactor) Alternative.....	3-62
27		3.5.8.1	Surface Water Resources.....	3-62
28		3.5.9	Groundwater Resources	3-63
29	3.6		Terrestrial Resources	3-63
30		3.6.1	Ecoregion.....	3-63
31		3.6.2	Monticello Site.....	3-64
32		3.6.3	Important Species and Habitats	3-67
33		3.6.3.1	Federally Listed Species	3-67
34		3.6.3.2	State-Listed Species.....	3-67
35		3.6.3.3	Species Protected under the Bald and Golden Eagle	
36			Protection Act.....	3-69
37		3.6.3.4	Species Protected under the Migratory Bird Treaty Act	3-69
38		3.6.3.5	Invasive Species	3-70
39		3.6.3.6	Important Habitats	3-71
40		3.6.3.7	Culturally Important Species.....	3-71
41		3.6.4	Proposed Action.....	3-71

1		3.6.4.1	Effects on Terrestrial Resources (Non-cooling System Impacts)3-72
2			
3		3.6.4.2	Exposure of Terrestrial Organisms to Radionuclides3-73
4		3.6.4.3	Cooling System Impacts on Terrestrial Resources (Plants with Once-Through Cooling Systems or Cooling Ponds).....3-75
5			
6			
7		3.6.4.4	Cooling tower impacts on vegetation (plants with cooling towers)3-76
8			
9		3.6.4.5	Bird Collisions with Plant Structures and Transmission Lines3-78
10			
11		3.6.4.6	Water use conflicts with terrestrial resources (plants with cooling ponds or cooling towers using makeup water from a river)3-79
12			
13			
14		3.6.4.7	Transmission Line Right-of-Way Management Impacts on Terrestrial Resources3-80
15			
16		3.6.4.8	Electromagnetic Field [Impacts] on Flora and Fauna (Plants, Agricultural Crops, Honeybees, Wildlife, and Livestock)3-81
17			
18			
19		3.6.5	No-Action Alternative3-82
20		3.6.6	Replacement Power Alternatives: Common Impacts3-82
21		3.6.7	Natural Gas and Renewables (Solar and Wind) Alternative3-83
22		3.6.8	Renewables (Solar and Wind) and Storage Alternative3-86
23		3.6.9	New Nuclear (Small Modular Reactor) Alternative.....3-87
24	3.7	Aquatic Resources.....3-87	
25		3.7.1	Mississippi River3-87
26		3.7.1.1	Biological Communities of Mississippi River3-88
27		3.7.1.2	Important Species and Habitats of Mississippi River.....3-93
28		3.7.1.3	Invasive and Nuisance Species of Mississippi River.....3-94
29		3.7.2	Proposed Action.....3-95
30		3.7.2.1	Impingement and Entrainment of Aquatic Organisms (Plants with Once-Through Cooling Systems or Cooling Ponds).....3-95
31			
32			
33		3.7.2.2	Entrainment of Phytoplankton and Zooplankton (All Plants).....3-110
34			
35		3.7.2.3	Thermal Impacts on Aquatic Organisms (Plants with Once-Through Cooling Systems or Cooling Ponds).....3-112
36			
37		3.7.2.4	Infrequently Reported Thermal Impacts (All Plants).....3-115
38		3.7.2.5	Effects of Cooling Water Discharge on Dissolved Oxygen, Gas Supersaturation, and Eutrophication3-118
39			
40		3.7.2.6	Effects of Nonradiological Contaminants on Aquatic Organisms.....3-121
41			
42		3.7.2.7	Exposure of Aquatic Organisms to Radionuclides3-122
43		3.7.2.8	Effects of Dredging on Aquatic Organisms3-125

1		3.7.2.9	Water Use Conflicts with Aquatic Resources (Plants with Cooling Ponds or Cooling Towers Using Makeup Water from a River)	3-126
2				
3				
4		3.7.2.10	Effects on Aquatic Resources (Non-Cooling System Impacts)	3-128
5				
6		3.7.2.11	Impacts of Transmission Line Right-of-Way Management on Aquatic Resources	3-129
7				
8		3.7.2.12	Losses from Predation, Parasitism, and Disease Among Organisms Exposed to Sublethal Stresses.....	3-129
9				
10		3.7.3	No-Action Alternative	3-131
11		3.7.4	Replacement Power Alternatives: Common Impacts	3-131
12		3.7.5	Natural Gas and Renewables Alternative	3-132
13		3.7.6	Renewables and Storage Alternative	3-133
14		3.7.7	New Nuclear (Small Modular Reactor) Alternative.....	3-133
15	3.8		Federally Protected Ecological Resources.....	3-134
16		3.8.1	Endangered Species Act.....	3-134
17		3.8.1.1	Endangered Species Act: Action Area	3-134
18		3.8.1.2	Endangered Species Act: Federally Listed Species and Critical Habitats under U.S. Fish and Wildlife Service Jurisdiction.....	3-135
19				
20				
21		3.8.1.3	Endangered Species Act: Federally Listed Species and Critical Habitats Under NMFS Jurisdiction	3-142
22				
23		3.8.2	Magnuson–Stevens Act: Essential Fish Habitat	3-142
24		3.8.3	National Marine Sanctuaries Act: Sanctuary Resources.....	3-143
25		3.8.4	Proposed Action.....	3-143
26		3.8.4.1	Endangered Species Act: Federally Listed Species and Critical Habitats under U.S. Fish and Wildlife Service Jurisdiction.....	3-143
27				
28				
29		3.8.4.2	Endangered Species Act: Federally Listed Species and Critical Habitats under NMFS Jurisdiction.....	3-152
30				
31		3.8.4.3	Endangered Species Act: Cumulative Effects.....	3-152
32		3.8.4.4	Magnuson–Stevens Act: Essential Fish Habitat.....	3-152
33		3.8.4.5	National Marine Sanctuaries Act: Sanctuary Resources	3-152
34				
35		3.8.5	No-Action Alternative	3-152
36		3.8.6	Replacement Power Alternatives: Common Impacts	3-153
37		3.8.7	Natural Gas and Renewables Alternative	3-153
38		3.8.8	Renewables and Storage Alternative	3-154
39		3.8.9	New Nuclear (Small Modular Reactor) Alternative.....	3-154
40	3.9		Historic and Cultural Resources.....	3-154
41		3.9.1	Cultural Background.....	3-155
42		3.9.1.1	Paleoindian Period (prior to 7000 BC)	3-155
43		3.9.1.2	Archaic Period (7000 BC to 500 BC)	3-155

1		3.9.1.3	Woodland Period (500 BC to 1650 AD)	3-157
2		3.9.1.4	Contact Period/Mille Lacs Band of Ojibwe History	
3			(1600s AD to present)	3-157
4	3.9.2		Historic and Cultural Resources at Monticello	3-159
5	3.9.3		Procedures.....	3-161
6	3.9.4		Proposed Action.....	3-161
7		3.9.4.1	Consultation	3-162
8		3.9.4.2	Findings.....	3-163
9	3.9.5		Alternatives	3-164
10		3.9.5.1	No-Action Alternative	3-164
11		3.9.5.2	Replacement Power Alternatives: Common Impacts	3-164
12		3.9.5.3	Natural Gas and Renewables Alternative	3-165
13		3.9.5.4	Renewables and Storage Alternative.....	3-166
14		3.9.5.5	New Nuclear (Small Modular Reactor) Alternative	3-167
15	3.10		Socioeconomics	3-167
16		3.10.1	Nuclear Power Plant Employment.....	3-168
17		3.10.2	Regional Economic Characteristics	3-168
18		3.10.2.1	Regional Employment and Income	3-168
19		3.10.2.2	Unemployment	3-169
20		3.10.3	Demographic Characteristics	3-169
21		3.10.3.1	Transient Population.....	3-171
22		3.10.3.2	Migrant Farm Workers.....	3-171
23		3.10.4	Housing and Community Services	3-172
24		3.10.4.1	Housing	3-172
25		3.10.4.2	Education	3-172
26		3.10.4.3	Public Water Supply	3-172
27		3.10.5	Tax Revenues.....	3-172
28		3.10.6	Local Transportation	3-174
29		3.10.7	Proposed Action.....	3-174
30		3.10.7.1	Employment and Income, Recreation and Tourism	3-174
31		3.10.7.2	Tax Revenues	3-175
32		3.10.7.3	Community Service and Education.....	3-175
33		3.10.7.4	Population and Housing	3-175
34		3.10.7.5	Transportation	3-175
35		3.10.8	No-Action Alternative	3-176
36		3.10.8.1	Socioeconomics	3-176
37		3.10.8.2	Transportation	3-176
38		3.10.9	Replacement Power Alternatives: Common Impacts.....	3-176
39		3.10.9.1	Socioeconomics	3-177
40		3.10.9.2	Transportation	3-178
41	3.11		Human Health.....	3-179

1	3.11.1	Radiological Exposure and Risk.....	3-179
2	3.11.2	Chemical Hazards.....	3-180
3	3.11.3	Microbiological Hazards	3-181
4	3.11.4	Electromagnetic Fields	3-181
5	3.11.5	Other Hazards.....	3-182
6	3.11.6	Proposed Action.....	3-183
7	3.11.6.1	Radiation Exposures to the Public.....	3-183
8	3.11.6.2	Radiation Exposure to Plant Workers	3-184
9	3.11.6.3	Human Health Impact from Chemicals	3-185
10	3.11.6.4	Microbiological Hazards to the Public (Plants with	
11		Cooling Ponds or Canals or Cooling Towers That	
12		Discharge to a River).....	3-185
13	3.11.6.5	Microbiological Hazards to Plant Workers	3-186
14	3.11.6.6	Chronic Effects of EMFs	3-186
15	3.11.6.7	Physical Occupational Hazards	3-187
16	3.11.6.8	Electric Shock Hazards	3-187
17	3.11.6.9	Postulated Accidents.....	3-187
18	3.11.7	No-Action Alternative	3-188
19	3.11.8	Replacement Power Alternatives: Common Impacts.....	3-189
20	3.11.9	Natural Gas and Renewables Alternative.....	3-189
21	3.11.10	Renewables and Storage Alternative	3-190
22	3.11.11	New Nuclear (Small Modular Reactor) Alternative.....	3-191
23	3.12	Environmental Justice.....	3-191
24	3.12.1	Proposed Action.....	3-196
25	3.12.2	No-Action Alternative	3-198
26	3.12.3	Replacement Power Alternatives: Typical Impacts	3-198
27	3.13	Waste Management.....	3-199
28	3.13.1	Radioactive Waste	3-199
29	3.13.1.1	Radioactive Liquid Waste Management.....	3-200
30	3.13.1.2	Radioactive Gaseous Waste Management.....	3-202
31	3.13.1.3	Radioactive Solid Waste Management	3-203
32	3.13.1.4	Radioactive Waste Storage	3-203
33	3.13.1.5	Radiological Environmental Monitoring Program	3-204
34	3.13.2	Nonradioactive Waste	3-205
35	3.13.3	Proposed Action.....	3-206
36	3.13.3.1	Low-Level Waste Storage and Disposal	3-206
37	3.13.3.2	Onsite Storage of Spent Nuclear Fuel	3-207
38	3.13.3.3	Offsite Radiological Impacts of Spent Nuclear Fuel	
39		and High-Level Waste Disposal.....	3-207
40	3.13.3.4	Mixed-Waste Storage and Disposal.....	3-207
41	3.13.3.5	Nonradioactive Waste Storage and Disposal.....	3-208
42	3.13.4	No-Action Alternative	3-208

1	3.13.5	Replacement Power Alternatives: Common Impacts	3-209
2	3.13.6	Natural Gas and Renewables Alternative	3-209
3	3.13.7	Renewables and Storage Alternative	3-209
4	3.13.8	New Nuclear (Small Modular Reactor) Alternative.....	3-210
5	3.14	Impacts Common to All Alternatives	3-210
6	3.14.1	Fuel Cycle	3-210
7	3.14.1.1	Uranium Fuel Cycle	3-210
8	3.14.1.2	Replacement Nuclear Power Plant Fuel Cycles.....	3-212
9	3.14.2	Terminating Nuclear Power Plant Operations and Decommissioning	3-213
10	3.14.2.1	Existing Nuclear Power Plant	3-213
11	3.14.2.2	Replacement Power Plants	3-214
12	3.14.3	Greenhouse Gas Emissions and Climate Change.....	3-215
13	3.14.3.1	Greenhouse Gas Emissions from the Proposed Action	
14		and Alternatives.....	3-215
15	3.14.3.2	Observed Trends in Climate Change Indicators	3-218
16	3.14.3.3	Climate Change Projections	3-219
17	3.15	Cumulative Effects.....	3-221
18	3.15.1	Air Quality	3-223
19	3.15.2	Water Resources	3-223
20	3.15.2.1	Surface Water Resources.....	3-223
21	3.15.2.2	Groundwater Resources.....	3-225
22	3.15.3	Socioeconomics.....	3-226
23	3.15.4	Human Health	3-226
24	3.15.5	Environmental Justice	3-227
25	3.15.6	Waste Management and Pollution Prevention.....	3-228
26	3.16	Resource Commitments Associated with the Proposed Action	3-228
27	3.16.1	Unavoidable Adverse Environmental Impacts	3-228
28	3.16.2	Relationship between Short-Term Use of the Environment and	
29		Long-Term Productivity	3-229
30	3.16.3	Irreversible and Irrecoverable Commitment of Resources	3-230
31	4	CONCLUSION.....	4-1
32	4.1	Environmental Impacts of License Renewal.....	4-1
33	4.2	Comparison of Alternatives.....	4-1
34	4.3	Recommendation.....	4-1
35	5	REFERENCES	5-1
36	6	LIST OF PREPARERS.....	6-1
37	7	LIST OF AGENCIES, ORGANIZATIONS, AND PERSONS TO WHOM THE	
38		NRC SENDS COPIES OF THIS EIS	7-1

1 APPENDIX A COMMENTS RECEIVED ON THE MONTICELLO POWER
2 STATION, UNITS 1 AND 2 ENVIRONMENTAL REVIEW A-1

3 APPENDIX B APPLICABLE LAWS, REGULATIONS, AND OTHER
4 REQUIREMENTS..... B-1

5 APPENDIX C CONSULTATION CORRESPONDENCE..... C-1

6 APPENDIX D CHRONOLOGY OF ENVIRONMENTAL REVIEW
7 CORRESPONDENCE D-1

8 APPENDIX E PROJECTS AND ACTIONS CONSIDERED IN THE
9 CUMULATIVE IMPACTS ANALYSISE-1

10 APPENDIX F ENVIRONMENTAL IMPACTS OF POSTULATED ACCIDENTSF-1

11 APPENDIX G ENVIRONMENTAL ISSUES AND IMPACT FINDINGS
12 CONTAINED IN THE PROPOSED RULE, 10 CFR PART 51,
13 “ENVIRONMENTAL PROTECTION REGULATIONS FOR
14 DOMESTIC LICENSING AND RELATED REGULATORY
15 FUNCTIONS” G-1

16
17

LIST OF FIGURES

2 Figure 1-1 Environmental Review Process.....1-3

3 Figure 2-1 Monticello Nuclear Generating Plant Site 50 mi Radius Map2-2

4 Figure 2-2 Monticello Nuclear Generating Plant Layout and Surrounding Features2-3

5 Figure 3-1 Regional Surface Water Features Associated with the Monticello Nuclear

6 Generating Plant Site.....3-28

7 Figure 3-2 Federal Emergency Management Agency Floodplain Zones at Monticello3-32

8 Figure 3-3 Monticello Nuclear Generating Plant External National Pollutant Discharge

9 Elimination System Monitoring Locations.....3-34

10 Figure 3-4 Groundwater Elevation Contours and General Groundwater Flow Direction

11 in Shallow and Deep Aquifers in June and December 20203-37

12 Figure 3-5 Registered Groundwater Wells within 2 mi Radius of the Monticello power

13 block area3-38

14 Figure 3-6 Monticello Nuclear Generating Plant Onsite Supply Wells, 2020.....3-39

15 Figure 3-7 Tritium Concentrations at Well MW-9A between 2009–2022 from the 2022

16 Monticello Annual Radioactive Effluent Release Report.....3-42

17 Figure 3-8 Monthly and Total Cumulative Volume of Groundwater Pumped during

18 January–October 2023 for Tritium Recovery3-43

19 Figure 3-9 Updated Monticello Well Locations and Location of Storage Pond.....3-44

20 Figure 3-10 Extent of Tritium-impacted Groundwater and Locations of Monticello Wells

21 as of August 2023.....3-44

22 Figure 3-11 Measured Tritium Activities at Groundwater Monitoring Wells MW-9A and

23 MW-9B.....3-45

24 Figure 3-12 Groundwater Elevations in Response to Changes in River Stage3-46

25 Figure 3-13 Measured Tritium Activities at MW-10A3-47

26 Figure 3-14 Measured Tritium Activities in Selected Onsite Well.....3-48

27 Figure 3-15 Wetlands Located Within the Monticello Nuclear Generating Plant Site as

28 Mapped in National Wetlands Inventory.....3-66

29 Figure 3-16 Aquatic Communities of the Mississippi River by the Monticello Nuclear

30 Generating Plant.....3-89

31 Figure 3-17 Minority Block Groups Within a 50 mi Radius of Monticello3-194

32 Figure 3-18 Low-Income Block Groups Within a 50 mi Radius of Monticello3-195

33

34

LIST OF TABLES

2	Table 2-1	Summary of Environmental Impacts of the Proposed Action and	
3		Alternatives	2-21
4	Table 3-1	Summary of Site-Specific Conclusions Regarding Monticello Subsequent	
5		License Renewal.....	3-2
6	Table 3-2	Land Use/Land Cover, Monticello Nuclear Generating Plant Site.....	3-6
7	Table 3-3	Land Use Impacts of Replacement Power Alternatives	3-9
8	Table 3-4	Permitted Air Emission Sources at Monticello Nuclear Generating Plant	3-13
9	Table 3-5	Monticello Nuclear Generating Plant Reported Annual Air Emissions for	
10		years 2017–2021 and 2020 Annual Air Emissions for Wright and	
11		Sherburne County.....	3-15
12	Table 3-6	Mississippi River Daily Water Discharges Near the Monticello Nuclear	
13		Generating Plant by Month from 1988–2023.....	3-29
14	Table 3-7	Surface Water Withdrawals, Monticello Nuclear Generating Plant,	
15		2018–2022.....	3-30
16	Table 3-8	Monticello Nuclear Generating Plant’s National Pollutant Discharge	
17		Elimination System Monitoring Stations	3-35
18	Table 3-9	Wetlands and Surface Water Features on the Monticello Nuclear	
19		Generating Plant Site.....	3-65
20	Table 3-10	State-Listed Species (That Are Not Also Federally Listed) for Wright or	
21		Sherburne Counties, Potentially Occurring in the Vicinity of Monticello	
22		Nuclear Generating Plant.....	3-67
23	Table 3-11	Fish Species That Occur in the Mississippi River Near Monticello Nuclear	
24		Generating Plant.....	3-91
25	Table 3-12	Monticello Nuclear Generating Plant Cooling Modes	3-97
26	Table 3-13	Average Monthly Volume of the Mississippi River Drawn into the	
27		Monticello Cooling Water Intake System and Affected by the Hydraulic	
28		Zone of Influence, 2014–2018.....	3-102
29	Table 3-14	Estimated Annual Impingement from the Monticello Cooling Water Intake	
30		System from August 2005 to July 2006.....	3-103
31	Table 3-15	Estimated Annual Ichthyoplankton Entrainment Based on Actual Intake	
32		Flows at Monticello in 2017 and 2018	3-107
33	Table 3-16	Flow-Adjusted Ichthyoplankton Entrainment at Monticello, 2006.....	3-108
34	Table 3-17	Summary of Cold Shock Fish Kill Events at Monticello, 2022 and 2023	3-117
35	Table 3-18	Federally Listed Species under U.S. Fish and Wildlife Jurisdiction	
36		Evaluated for Monticello Nuclear Generating Plant Subsequent License	
37		Renewal.....	3-135
38	Table 3-19	Summary of the Potential for Federally Listed Species under the	
39		Jurisdiction of the U.S. Fish and Wildlife Service to Occur within the	
40		Action Area	3-143
41	Table 3-20	Effect Determinations for Federally Listed Species under U.S. Fish and	
42		Wildlife Service Jurisdiction.....	3-144
43	Table 3-21	Residence of Xcel Energy Permanent Employees	3-168
44	Table 3-22	Estimated Income Information for the Monticello Socioeconomic Region	
45		of Influence	3-169
46	Table 3-23	Population and Percent Growth in Monticello Socioeconomic Region of	
47		Influence Counties	3-170

1 Table 3-24 Demographic Profile of the Population in the Monticello Two-County
2 Region of Influence, 20203-170
3 Table 3-25 Demographic Profile of the Population in the Monticello Two-County
4 Region of Influence, 2017–20213-170
5 Table 3-26 Migrant Farm Workers and Temporary Farm Labor in Counties Located in
6 the Socioeconomic Region of Influence of Monticello3-171
7 Table 3-27 Housing in the Monticello Region of Influence.....3-172
8 Table 3-28 Monticello Property Tax Payments by Local Tax Jurisdiction, 2017–2022.....3-173
9 Table 3-29 Total Average Annual Daily Traffic Counts on County Road 753-174
10 Table 3-30 Socioeconomic and Transportation Impacts of Replacement Power
11 Alternatives3-177
12 Table 3-31 Annual Greenhouse Gas Emissions from Operation at Monticello Nuclear
13 Generating Plant, Unit 13-216
14 Table 3-32 Direct Greenhouse Gas Emissions from Facility Operations under the
15 Proposed Action and Alternatives3-218
16 Table 3-33 Surface Water Withdrawals from Wright and Sherburne Counties, 20153-224
17 Table 6-1 List of Preparers6-1

18
19

EXECUTIVE SUMMARY

Background

By letter dated January 9, 2023 (Xcel 2023-TN9084), Xcel Energy submitted an application requesting subsequent license renewal (SLR) for the Monticello Nuclear Generating Plant, Unit 1 (Monticello) operating license to the U.S. Nuclear Regulatory Commission (NRC). The Monticello renewed facility operating license for Unit 1 (DPR-22) expires at midnight on September 8, 2030. In its application, Xcel Energy requested a subsequent renewed operating license for a period of 20 years beyond the current renewed license expiration date (i.e., from September 8, 2030, to September 8, 2050).

The NRC's environmental protection regulations in Title 10 of the *Code of Federal Regulations* (10 CFR) Part 51, "Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions," (TN250) implement the National Environmental Policy Act of 1969, as amended (42 U.S.C. 4321 et seq.; TN661). This Act is commonly referred to as National Environmental Policy Act (NEPA). The regulations in 10 CFR Part 51 require the NRC to prepare an environmental impact statement (EIS) before deciding whether to issue an operating license or a renewed operating license for a nuclear power plant.

On February 24, 2022, the Commission issued three memoranda and orders that addressed SLR proceedings for five operating nuclear power plants. Two of these orders, Commission Legal Issuance (CLI)-22-02 (NRC 2022-TN8182) and CLI-22-03 (NRC 2022-TN9844), are relevant to the Monticello SLR environmental review. In these orders, the Commission concluded that the License Renewal Generic Environmental Impact Statement (LR GEIS), which the NRC staff relies on in part to meet its obligations under 10 CFR Part 51 (TN250) and NEPA, did not consider the impacts from operation during the SLR period of extended operations. Therefore, the Commission determined that the NRC staff's NEPA reviews for the affected nuclear power plants were inadequate.

In CLI-22-03 (NRC 2022-TN9844), the Commission directed the NRC staff to review and update the *Generic Environmental Impact Statement for License Renewal of Nuclear Plants*, Revision 1, Final Report (NUREG-1437; NRC 2013-TN2654; LR GEIS) so that it covers nuclear power plant operation during the SLR period. The Commission stated that it believed the most efficient way to proceed would be for the NRC staff to review and update the LR GEIS and then take appropriate action with respect to pending SLR applications to ensure that the environmental impacts for the period of SLR are considered. However, the Commission allowed that SLR applicants may submit a revised environmental report providing information on environmental impacts during the SLR period on a site-specific basis. In such a submittal, SLR applicants must evaluate the impacts of those environmental issues dispositioned in the LR GEIS and Table B-1 in Appendix B to Subpart A of 10 CFR Part 51 (TN250) as generic (Category 1) issues, as well as the impacts of site -specific (Category 2) issues. The NRC staff would then address the impacts of all such issues during the SLR period in site-specific EISs.

On January 9, 2023, Xcel Energy submitted an environmental report of the impacts of continued operations of Monticello during the SLR period (Xcel 2023-TN9084). The report addressed on a site-specific basis each environmental issue, including issues that were previously dispositioned as Category 1 issues in the 2013 LR GEIS. On March 10, 2023, the NRC staff published a notice of its intent to conduct a scoping process and to prepare a site-specific environmental impact statement for Monticello SLR (88 FR 15103-TN9715). The NRC staff then conducted an environmental scoping process and published a scoping summary report in March 2024 (NRC 2024-TN9817).

1 **Proposed Action**

2 The proposed Federal action (subsequent renewal of the Monticello renewed operating license)
3 was initiated by Xcel Energy’s submittal of an SLR application. The current renewed Monticello
4 operating license is set to expire at midnight on September 8, 2030. The NRC’s Federal action
5 is to determine whether to renew the Monticello operating license for an additional 20 years. If
6 the NRC renews the operating license, Xcel Energy would be authorized to operate Monticello
7 until September 8, 2050.

8 **Purpose and Need for Action**

9 The purpose and need for the proposed action (subsequent renewal of an operating license) is
10 to provide an option that allows for power generation capability beyond the term of a current
11 nuclear power plant operating license to meet future system generating needs, as such needs
12 may be determined by energy planning decisionmakers, such as State regulators, utility owners,
13 and, where authorized, Federal agencies other than the NRC. The definition of purpose and
14 need reflects the Commission’s recognition that, absent findings in the safety review required by
15 the Atomic Energy Act of 1954, as amended, or in the NEPA environmental analysis, that would
16 lead the NRC to reject a license renewal application, the NRC has no role in the energy
17 planning decisions of utility officials and State regulators as to whether a nuclear power plant
18 should continue to operate.

19 **Environmental Impacts of Subsequent License Renewal**

20 This site-specific EIS evaluates the potential environmental impacts of the proposed action and
21 reasonable alternatives to that action. The environmental impacts of the proposed action and
22 reasonable alternatives are designated as SMALL, MODERATE, or LARGE, which represent
23 three established significance levels for potential impacts, presented in a footnote to Table B-1
24 in Appendix B to Subpart A of 10 CFR Part 51 (TN250), and defined as follows:

25 **SMALL:** Environmental effects are not detectable or are so minor that they will neither
26 destabilize nor noticeably alter any important attribute of the resource.

27 **MODERATE:** Environmental effects are sufficient to alter noticeably, but not to destabilize,
28 important attributes of the resource.

29 **LARGE:** Environmental effects are clearly noticeable and are sufficient to destabilize important
30 attributes of the resource.

31 In this EIS, the NRC staff evaluates, on a site-specific basis, all environmental issues that are
32 applicable to Monticello SLR, including the impacts of license renewal issues that had been
33 determined to be site-specific (Category 2) in the LR GEIS, as well as issues that had been
34 determined to be generic (Category 1) in the LR GEIS. The LR GEIS and Table B–1 in
35 Appendix B to Subpart A of 10 CFR Part 51 (TN250) identify issues as either “generic”
36 (“Category 1”) or “site-specific” (“Category 2”). However, as explained under “Background,” the
37 Commission determined that the staff cannot rely on the LR GEIS and Table B-1 for its SLR
38 reviews pending updates to the LR GEIS and 10 CFR Part 51. Therefore, in this site-specific
39 EIS, the NRC addresses each of the environmental issues identified in the LR GEIS and
40 Table B-1 on a site-specific basis. As a result, the NRC staff conducted site-specific analyses
41 and made site-specific findings of SMALL, MODERATE, or LARGE for each of the applicable
42 environmental issues.

1 Table ES-1 lists the environmental issues applicable to Monticello SLR and the findings related
 2 to these issues. Footnotes denote those issues that were formerly addressed in the LR GEIS as
 3 Category 1 issues.

4 **Table ES-1 Summary of Site-Specific Conclusions Regarding Monticello Nuclear**
 5 **Generating Plant Subsequent License Renewal**

Resource Area	Environmental Issue	Impacts
Land Use	Onsite land use ^(a)	SMALL
Land Use	Offsite land use ^(a)	SMALL
Land Use	Offsite land use in transmission line right-of-ways (ROWs) ^(a)	SMALL
Visual Resources	Aesthetic impacts ^(a)	SMALL
Air Quality	Air quality impacts (all plants) ^(a)	SMALL
Air Quality	Air quality effects of transmission lines ^(a)	SMALL
Noise	Noise impacts ^(a)	SMALL
Geologic Environment	Geology and soils ^(a)	SMALL
Surface Water Resources	Surface water use and quality (non-cooling system impacts) ^(a)	SMALL
Surface Water Resources	Altered current patterns at intake and discharge structures ^(a)	SMALL
Surface Water Resources	Scouring caused by discharged cooling water ^(a)	SMALL
Surface Water Resources	Discharge of metals in cooling system effluent ^(a)	SMALL
Surface Water Resources	Discharge of biocides, sanitary wastes, and minor chemical spills ^(a)	SMALL
Surface Water Resources	Surface water use conflicts (plants with once-through cooling systems) ^(a)	SMALL
Surface Water Resources	Effects of dredging on surface water quality ^(a)	SMALL
Surface Water Resources	Temperature effects on sediment transport capacity ^(a)	SMALL
Groundwater Resources	Groundwater contamination and use (non-cooling system impacts) ^(a)	SMALL
Groundwater Resources	Groundwater use conflicts (plants that withdraw more than 100 gallons per minute [gpm])	SMALL
Groundwater Resources	Groundwater use conflicts (plants with closed-cycle cooling systems that withdraw makeup water from a river)	SMALL
Groundwater Resources	Radionuclides released to groundwater	SMALL to MODERATE
Terrestrial Resources	Effects on terrestrial resources (non-cooling system impacts)	SMALL
Terrestrial Resources	Exposure of terrestrial organisms to radionuclides ^(a)	SMALL
Terrestrial Resources	Cooling system impacts on terrestrial resources (plants with once-through cooling systems or cooling ponds) ^(a)	SMALL
Terrestrial Resources	Cooling tower impacts on vegetation (plants with cooling towers) ^(a)	SMALL

Table ES-1 Summary of Site-Specific Conclusions Regarding Monticello Nuclear Generating Plant Subsequent License Renewal (Continued)

Resource Area	Environmental Issue	Impacts
Terrestrial Resources	Bird collisions with plant structures and transmission lines ^(a)	SMALL
Terrestrial Resources	Water use conflicts with terrestrial resources (plants with cooling ponds or cooling towers using makeup water from a river)	SMALL
Terrestrial Resources	Transmission line right-of-way (ROW) management impacts on terrestrial resources ^(a)	SMALL
Terrestrial Resources	Electromagnetic fields on flora and fauna (plants, agricultural crops, honeybees, wildlife, livestock) ^(a)	SMALL
Aquatic Resources	Impingement and entrainment of aquatic organisms (plants with once-through cooling systems or cooling ponds)	SMALL
Aquatic Resources	Entrainment of phytoplankton and zooplankton (all plants) ^(a)	SMALL
Aquatic Resources	Thermal impacts on aquatic organisms (plants with once-through cooling systems or cooling ponds)	SMALL
Aquatic Resources	Infrequently reported thermal impacts (all plants) ^(a)	SMALL
Aquatic Resources	Effects of cooling water discharge on dissolved oxygen, gas supersaturation, and eutrophication ^(a)	SMALL
Aquatic Resources	Effects of nonradiological contaminants on aquatic organisms ^(a)	SMALL
Aquatic Resources	Exposure of aquatic organisms to radionuclides ^(a)	SMALL
Aquatic Resources	Effects of dredging on aquatic organisms ^(a)	SMALL
Aquatic Resources	Water use conflicts with aquatic resources (plants with cooling ponds or cooling towers using makeup water from a river)	SMALL
Aquatic Resources	Effects on aquatic resources (non-cooling system impacts) ^(a)	SMALL
Aquatic Resources	Impacts of transmission line right-of-way (ROW) management on aquatic resources ^(a)	SMALL
Aquatic Resources	Losses from predation, parasitism, and disease among organisms exposed to sublethal stresses ^(a)	SMALL
Special Status Species and Habitats	Threatened, endangered, and protected species and essential fish habitat	May affect but is not likely to adversely affect the northern long-eared bat, tricolored bat, whooping crane, and monarch butterfly; no effect on essential fish habitat; no effect on sanctuary resources of National Marine Sanctuaries

Table ES-1 Summary of Site-Specific Conclusions Regarding Monticello Nuclear Generating Plant Subsequent License Renewal (Continued)

Resource Area	Environmental Issue	Impacts
Historic and Cultural Resources	Historic and cultural resources	Would not adversely affect known historic properties or historic and cultural resources
Socioeconomics	Employment and income, recreation, and tourism ^(a)	SMALL
Socioeconomics	Tax revenues ^(a)	SMALL
Socioeconomics	Community services and education ^(a)	SMALL
Socioeconomics	Population and housing ^(a)	SMALL
Socioeconomics	Transportation ^(a)	SMALL
Human Health	Radiation exposures to the public ^(a)	SMALL
Human Health	Radiation exposures to plant workers ^(a)	SMALL
Human Health	Human health impact from chemicals ^(a)	SMALL
Human Health	Microbiological hazards to the public (plants with cooling ponds or canals or cooling towers that discharge to a river)	SMALL
Human Health	Microbiological hazards to plant workers ^(a)	SMALL
Human Health	Chronic effects of electromagnetic fields (EMFs)	Uncertain impact
Human Health	Physical occupational hazards ^(a)	SMALL
Human Health	Electric shock hazards	SMALL
Postulated Accidents	Design-basis accidents ^(a)	SMALL
Postulated Accidents	Severe accidents	See EIS Appendix F
Environmental Justice	Minority and low-income populations	No disproportionate and adverse human health and environmental effects on minority and low-income populations
Waste Management	Low-level waste storage and disposal ^(a)	SMALL
Waste Management	Onsite storage of spent nuclear fuel ^(a)	SMALL
Waste Management	Offsite radiological impacts of spent nuclear fuel and high-level waste disposal ^(a)	^(b)
Waste Management	Mixed-waste storage and disposal ^(a)	SMALL
Waste Management	Nonradioactive waste storage and disposal ^(a)	SMALL
Cumulative Impacts	Cumulative impacts	See EIS Section 3.15
Uranium Fuel Cycle	Offsite radiological impacts—individual impacts from other than the disposal of spent fuel and high-level waste ^(a)	SMALL
Uranium Fuel Cycle	Offsite radiological impacts—collective impacts from other than the disposal of spent fuel and high-level waste ^(a)	^(c)
Uranium Fuel Cycle	Nonradiological impacts of the uranium fuel cycle ^(a)	SMALL
Uranium Fuel Cycle	Transportation ^(a)	SMALL

Table ES-1 Summary of Site-Specific Conclusions Regarding Monticello Nuclear Generating Plant Subsequent License Renewal (Continued)

Resource Area	Environmental Issue	Impacts
Termination of Nuclear Power Plant Operations and Decommissioning	Termination of plant operations and decommissioning ^(a)	SMALL

EIS = environmental impact statement; EMF = electromagnetic fields; gpm = gallon(s) per minute; gps = gallon(s) per minute; ROW = right-of-way; SAMA = severe accident mitigation alternatives.

(a) Dispositioned as generic (Category 1) for initial license renewal of nuclear power plants in Table B-1 in Appendix B to Subpart A of Title 10 CFR Part 51 (TN250).

(b) The ultimate disposal of spent fuel in a potential future geologic repository is a separate and independent licensing action that is outside the regulatory scope of this site-specific review. Per 10 CFR Part 51 (TN250) Subpart A the Commission concludes that the impacts presented in NUREG-2157 (NRC 2014-TN4117) would not be sufficiently large to require the NEPA conclusion, for any plant, that the option of extended operation under 10 CFR Part 54 (TN4878) should be eliminated. Accordingly, while the Commission has not assigned a single level of significance for the impacts of spent nuclear fuel and high-level waste disposal, this issue is considered generic to all nuclear power plants and does not warrant a site-specific analysis.

(c) There are no regulatory limits applicable to collective doses to the general public from fuel-cycle facilities. The practice of estimating health effects on the basis of collective doses may not be meaningful. All fuel-cycle facilities are designed and operated to meet the applicable regulatory limits and standards. As stated in the 2013 LR GEIS, "The Commission concludes that these impacts are acceptable in that these impacts would not be sufficiently large to require the NEPA conclusion, for any plant, that the option of extended operation under 10 CFR Part 54 (TN4878) should be eliminated" (10 CFR Part 54-TN4878) (Section 3.13.3.3 of this EIS).

1 Alternatives

2 As part of its environmental review, the NRC is required to consider reasonable alternatives to
 3 SLR and to evaluate the environmental impacts associated with each alternative. These
 4 alternatives can include other methods of power generation (replacement energy alternatives),
 5 as well as not renewing the Monticello operating licenses (no-action alternative).

6 The NRC staff considered 17 alternatives to the proposed action and eliminated 14 from
 7 detailed study due to technical, resource availability, or commercial limitations that are likely to
 8 exist when the current renewed Monticello operating licenses expire. Three replacement energy
 9 alternatives were determined to be commercially viable, and include:

- 10 • combination of natural gas and renewables
- 11 • combination of renewables and storage
- 12 • new nuclear small modular reactor

13 These alternatives, along with the no-action alternative, were evaluated in detail in this EIS. In
 14 addition, the NRC staff also evaluated new and significant information that could alter the
 15 conclusions of the severe accident mitigation alternatives analysis previously performed for the
 16 Monticello initial license renewal in 2006, which authorized continued reactor operation for an
 17 additional 20 years beyond the original 40-year operating license term.

18 Preliminary Recommendation

19 The NRC staff's preliminary recommendation is that the adverse environmental impacts of
 20 Monticello SLR are not so great that preserving the option of SLR for energy planning
 21 decisionmakers would be unreasonable. The NRC staff based its preliminary recommendation
 22 on the following:

- 1 • Xcel Energy's environmental report
- 2 • consultation with Federal, State, Tribal, and local governmental agencies
- 3 • the NRC staff's independent environmental review
- 4 • the consideration of public comments received during the scoping process

1

ABBREVIATIONS AND ACRONYMS

2	µm	micrometer(s)
3	°C	degree(s) Celsius
4	°F	degree(s) Fahrenheit
5		
6	ac	acre(s)
7	AEA	Atomic Energy Act
8	ALARA	as low as reasonably achievable
9	APE	area of potential effect
10		
11	BEIR	Biological Effects of Ionizing Radiation
12	bgs	below ground surface
13	BMP	best management practice
14	BWR	boiling water reactor
15	BTA	best technology available
16		
17	CDF	core damage frequency
18	CEQ	Council on Environmental Quality
19	CFR	<i>Code of Federal Regulations</i>
20	cfs	cubic foot(feet) per second
21	CLB	current licensing basis
22	CLI	Commission Legal Issuance
23	ClIMAT	Minnesota Climate Mapping and Analysis Tool
24	cm	centimeter(s)
25	CO	carbon monoxide
26	CO ₂	carbon dioxide
27	CO ₂ eq	CO ₂ equivalent
28	CRD	control rod drive
29	CWA	Clean Water Act
30		
31	DBA	Design-Basis Accidents
32	DOE	U.S. Department of Energy
33		
34	EDA	Economic Development Authority
35	EFH	essential fish habitat
36	EI	exposure index
37	EIA	Energy Information Administration

1	EIS	Environmental impact statement
2	EMF	Electromagnetic field
3	EO	Executive Order
4	EPA	U.S. Environmental Protection Agency
5	EPU	extended power uprate
6	ER	environmental report
7	ESA	Endangered Species Act
8		
9	FPPA	Farmland Protection Policy Act
10	FR	<i>Federal Register</i>
11	ft	foot(feet)
12	ft ³	cubic foot(feet)
13	FWS	U.S. Fish and Wildlife Services
14		
15	g	gravity
16	gal	gallon(s)
17	GEIS	generic environmental impact statement
18	GHG	greenhouse gas
19	gpm	gallon(s) per minute
20	Gy/d	gray(s) per day
21		
22	ha	hectare(s)
23	HZI	Hydraulic Zone of Influence
24		
25	in.	inch(es)
26	IPaC	Information for Planning and Consultation
27	IPE	Individual Plant Examination
28	IPEEE	Individual Plant Examination -- External Events
29	ISFSI	independent spent fuel storage installation
30		
31	km	kilometer(s)
32	kV	kilovolt(s)
33		
34	LERF	large early release frequency
35	LOS	level-of-service
36	L/min	liter(s) per minute
37	LR	license renewal
38	LR GEIS	License Renewal Generic Environmental Impact Statement

1	m	meter(s)
2	m ³	cubic meter(s)
3	MACCS	MELCOR Accident Consequence Code System
4	MBTA	Migratory Bird Treaty Act
5	MDCT	mechanical draft cooling tower
6	MDNR	Minnesota Department of Natural Resources
7	MET	meteorological towers
8	mGy/hr	milligray(s) per hour
9	MHRA	Monticello Housing Redevelopment Authority
10	mi	mile(s)
11	mm	millimeter(s)
12	mph	mile(s) per hour
13	Monticello	Monticello Nuclear Generating Plant
14	MPCA	Minnesota Pollution Control Agency
15	MSA	Magnuson–Stevens Fisheries Conservation and Management Act
16	MSL	mean sea level
17	MT	metric ton(s)
18	MW	megawatt(s)
19	MWe	megawatt(s) electrical
20	MWd/MTU	megawatt-day(s) per metric ton uranium
21	MWt	megawatt(s) thermal
22		
23	NEPA	National Environmental Policy Act
24	NHPA	National Historic Preservation Act
25	NIEHS	National Institute of Environmental Health Sciences
26	NMC	Nuclear Management Company
27	NMFS	National Marine Fisheries Service
28	NMSA	National Marine Sanctuaries Act
29	NO	nitric oxide
30	NOAA	National Oceanic and Atmospheric Administration
31	NOV	notice of violation
32	NPDES	National Pollutant Discharge Elimination System
33	NRC	Nuclear Regulatory Commission
34	NRHP	National Register of Historic Places
35	NSPM	Northern States Power Company
36		
37	OSHA	Occupational Safety and Health Administration
38		

1	PCB	polychlorinated biphenyl
2	PM	particulate matter
3	PRA	probabilistic risk assessment
4	PV	photovoltaic
5		
6	rad/d	rad(s) per day
7	RAI	Request for Additional Information
8	RCP	representative concentration pathway
9	RG	Regulatory Guide
10	RKM	river kilometer(s)
11	RM	river mile(s)
12	ROI	region of influence
13	RCRA	Resources Conservation Recovery Act
14	REMP	radiological environmental monitoring program
15	ROW	right-of-way
16	RY	reactor-year
17		
18	s	second(s)
19	SAMA	severe accident mitigation alternative
20	SAR	safety analysis report
21	SEIS	supplemental environmental impact statement
22	SFP	Spent Fuel Pool
23	SLR	subsequent license renewal
24	SMR	small modular reactor
25	SO ₂	sulfur dioxide
26	SOARCA	state-of-art reactor consequence analysis
27	SPCC	Spill Prevention, Control, and Countermeasure
28	SSP	shared socioeconomic pathways
29	SWPPP	Stormwater Pollution Prevention Plan
30		
31	TMDL	total maximum daily load
32	TPY	ton(s) per year
33		
34	UCB	upper-confidence bounds
35	USACE	U.S. Army Corps of Engineers
36	U.S.C	U.S. Code
37	USCB	U.S. Census Bureau
38	USGCRP	United States Global Change Research Program

1	USGS	U.S. Geological Survey
2		
3	Xcel	Xcel Energy
4		
5	yd ³	cubic yard(s)
6	yr	year(s)
7		

1 INTRODUCTION AND GENERAL DISCUSSION

2 The U.S. Nuclear Regulatory Commission's (NRC's) environmental protection regulations in
3 Title 10 of the *Code of Federal Regulations* (10 CFR) Part 51 (TN250), "Environmental
4 Protection Regulations for Domestic Licensing and Related Regulatory Functions," implement
5 the National Environmental Policy Act of 1969 (NEPA), as amended (42 U.S.C. 4321 et seq.;
6 TN661). The regulations at 10 CFR Part 51 require, in part, the NRC to prepare an
7 environmental impact statement (EIS) before the issuance or renewal of a license to operate a
8 nuclear power plant.

9 The Atomic Energy Act (AEA) of 1954, as amended (42 U.S.C. 2011 et seq.; TN663), specifies
10 that licenses for commercial power reactors can be granted for up to 40 years. The initial
11 licensing period of 40 years was based on economic and antitrust considerations rather than on
12 technical limitations of the nuclear facility. The NRC regulations permit these licenses to be
13 renewed beyond the initial 40-year term for an additional period of time, limited to 20-year
14 increments per renewal. Renewal is based on the results of (1) the environmental review and
15 (2) the NRC staff's safety review (10 CFR 54.29, "Standards for Issuance of a Renewed
16 License"; TN4878). Neither the AEA nor the NRC regulations restrict the number of times a
17 license may be renewed. The decision to seek a renewed license rests entirely with nuclear
18 power plant owners and typically is based on the power plant's economic viability and the
19 investment necessary to continue to meet all safety and environmental requirements. The NRC
20 makes the decision to grant or deny license renewal based on whether the applicant has
21 demonstrated reasonable assurance that it can meet the environmental and safety
22 requirements in the agency's regulations during the period of extended operation.

23 On February 24, 2022, the Commission issued three memoranda and orders that addressed
24 subsequent license renewal (SLR) proceedings for five operating nuclear power plants. Two of
25 these orders, Commission Legal Issuance (CLI)-22-02 (NRC 2022-TN8182) and CLI-22-03
26 (NRC 2022-TN9844), are relevant to the Monticello SLR environmental review. In these orders,
27 the Commission concluded that the License Renewal Generic Environmental Impact Statement
28 (LR GEIS), which the NRC staff relies on in part to meet its obligations under 10 CFR Part 51
29 (TN250) and NEPA, did not consider the impacts from operations during the SLR period of
30 extended operations. Therefore, the Commission determined that the NRC staff's NEPA
31 reviews for the affected nuclear power plants were inadequate. In CLI-22-03, the Commission
32 directed the NRC staff to review and update the LR GEIS so that it covers nuclear power plant
33 operation during the SLR period (NRC 2022-TN9844). The Commission stated that it believed
34 the most efficient way to proceed would be for the NRC staff to review and update the LR GEIS
35 and then take appropriate action with respect to pending SLR applications to ensure that the
36 environmental impacts for the period of SLR are considered. However, the Commission allowed
37 SLR applicants to submit a revised environmental report (ER) providing information on
38 environmental impacts during the SLR period. In such a submittal, SLR applicants must
39 evaluate, on a site-specific basis, the impacts of those environmental issues dispositioned in
40 Table B-1 in Appendix B to Subpart A of 10 CFR Part 51 (TN250) and the LR GEIS as generic
41 (Category 1) issues. The NRC staff would then address the impacts of these issues during the
42 SLR period in site-specific EISs.

43 Pursuant to 10 CFR Part 51 (TN250), the NRC conducted an environmental review of Xcel
44 Energy's January 9, 2023, request for SLR (Xcel 2023-TN9084). Xcel Energy requested a
45 renewed facility operating license for Monticello Nuclear Generating Plant, Unit 1 (Monticello) for

1 a period of 20 years beyond the date when the current renewed facility operating license would
2 expire (i.e., until September 8, 2050). As part of its SLR application, Xcel Energy submitted an
3 ER (Xcel 2023-TN9084).

4 The NRC staff prepared this site-specific EIS in accordance with CLI-22-02 (NRC 2022-
5 TN8182) and CLI-22-03 (NRC 2022-TN9844), and requirements in 10 CFR 51.70 (TN250),
6 “Draft Environmental Impact Statements—General Requirements.” This EIS considers the
7 impacts of all license renewal (LR) issues applicable to Monticello SLR on a site-specific basis.
8 This EIS considers information in Xcel Energy’s SLR application; the NRC staff’s consultation
9 with Federal, State, Tribal, and local government agencies; consideration of comments received
10 during the scoping process; and other new information, as appropriate.

11 Table B–1 in Appendix B to Subpart A of 10 CFR Part 51 (TN250) and the 2013 LR GEIS
12 identify issues as either “generic” (“Category 1”) or “site-specific” (“Category 2.”). However, as
13 explained under “Background,” the Commission determined that the NRC staff cannot rely on
14 the LR GEIS for SLR reviews pending updates to the generic environmental impact statement
15 (GEIS) and 10 CFR Part 51. Therefore, in this EIS, each of these generic (Category 1)
16 environmental issues are addressed on a site-specific basis. In addition, this site-specific draft
17 EIS addresses the environmental issues that were addressed in Table B-1 of Appendix B to
18 Subpart A of 10 CFR Part 51 (TN250) and the LR GEIS as site-specific (Category 2) issues.
19 The NRC staff performed site-specific analyses and made site-specific findings of SMALL,
20 MODERATE, or LARGE for each of these issues.

21 **1.1 Proposed Federal Action**

22 Xcel Energy initiated the proposed Federal action (subsequent renewal of the Monticello
23 renewed operating license) by submitting an SLR request to the NRC. The initial renewed
24 Monticello facility operating license is set to expire at midnight on September 8, 2030 (License
25 No. DPR-22). The NRC’s Federal action is to decide whether to renew the license authorizing
26 an additional 20 years of operation. If the NRC issues the subsequent renewed license,
27 Monticello would be authorized to operate until September 8, 2050.

28 **1.2 Purpose and Need for the Proposed Action**

29 The purpose and need for the proposed action (subsequent renewal of the Monticello renewed
30 operating license) is to provide an option that allows for power generation capability beyond the
31 term of a current nuclear power plant operating license to meet future system generating needs,
32 as such needs may be determined by energy planning decision-makers, such as State
33 regulators, utility owners, and, where authorized, Federal agencies other than the NRC. The
34 definition of purpose and need reflects the Commission’s recognition that, absent findings in the
35 safety review required by the Atomic Energy Act of 1954, as amended, or in the NEPA
36 environmental analysis, that would lead the NRC to reject a license renewal application, the
37 NRC has no role in the energy planning decisions as to whether a nuclear power plant should
38 continue to operate.


39 **1.3 Major Environmental Review Milestones**

40 Xcel Energy submitted an ER as an appendix to its SLR application on January 9, 2023 (Xcel
41 2023-TN9084). The NRC published a notice of the receipt of the application in the *Federal*
42 *Register* (FR) on January 31, 2023 (Volume 88 of the FR, p. 6327 [88 FR 6327-TN9713]). After
43 reviewing the SLR application and ER, the NRC staff accepted the application for a detailed

1 technical review on February 23, 2023. The NRC staff published a FR notice of acceptability for
2 docketing and opportunity for hearing on March 3, 2023 (88 FR 13474-TN9714). On
3 March 10, 2023, the NRC published a notice in the FR (88 FR 15103-TN9715) informing the
4 public of the staff's intent to conduct an environmental scoping process, which began a 30 day
5 scoping comment period, and to prepare an environmental impact statement. The NRC staff
6 held an in-person public scoping meeting on March 22, 2023, followed by a virtual public
7 scoping meeting on March 29, 2023. In March 2024, the NRC issued a scoping summary report
8 for Monticello SLR (NRC 2024-TN9817), which included the comments received during the
9 2023 scoping process (Appendix A of this EIS).

10 The NRC staff conducted a hybrid in-person and virtual environmental and severe accident
11 mitigation alternatives (SAMAs) audit of Monticello during the week of August 7 and
12 August 14, 2023, respectively, to independently verify information in Xcel Energy's ER. During
13 the audit, the NRC staff held meetings with nuclear power plant personnel and reviewed site-
14 specific documentation and photos. The NRC staff summarized the audit in a letter dated
15 October 23, 2023 (NRC 2023-TN9723).

16 Figure 1-1 shows the major milestones of the NRC staff's environmental review of the
17 Monticello SLR application. Following the publication of this EIS, the EIS public comment
18 process provides a further opportunity for the incorporation of public comments and updating of
19 the EIS, as appropriate.

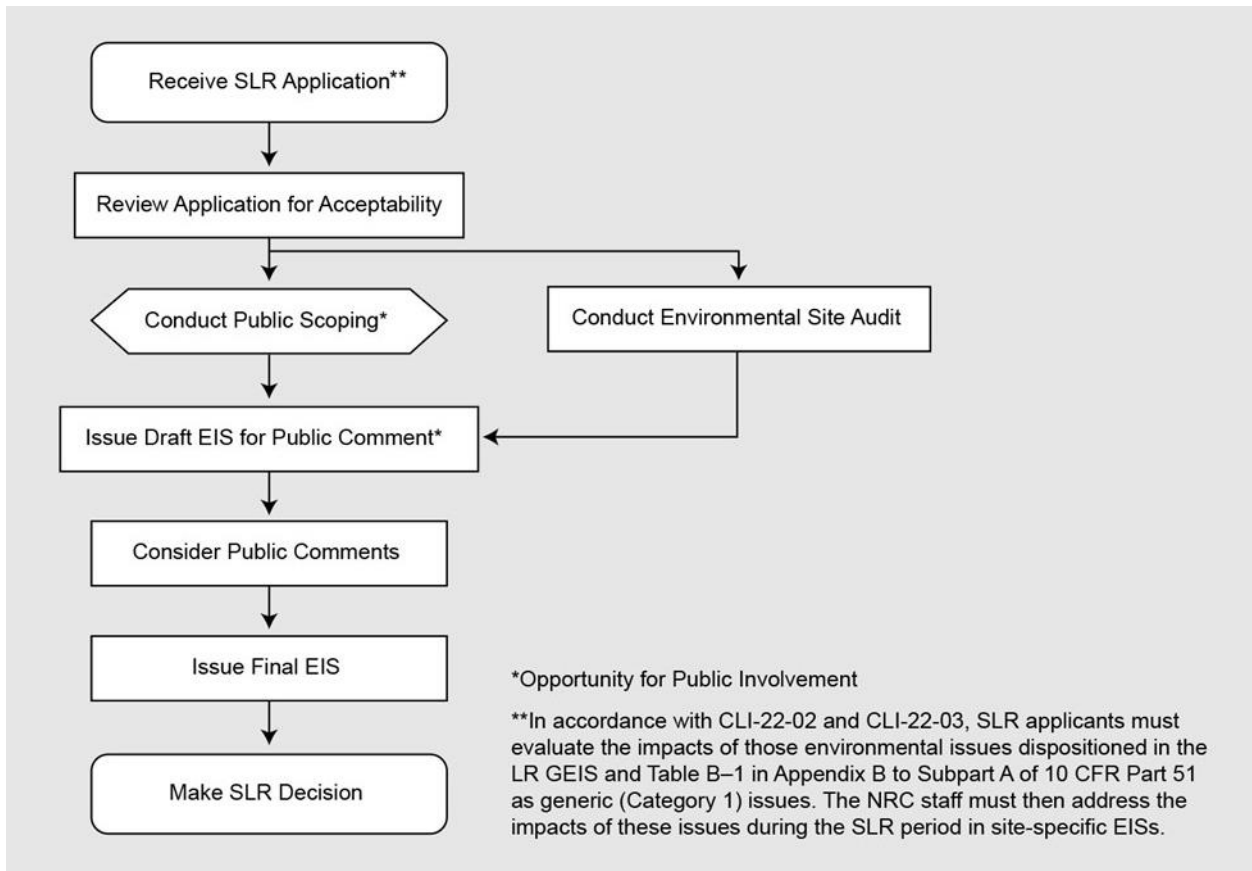

20
21

Figure 1-1 Environmental Review Process

1 The NRC has established a process that the NRC staff and LR applicants can complete in a
2 reasonable period of time, that includes clear requirements to assure safe nuclear power plant
3 operation for up to an additional 20 years of nuclear power plant life, pursuant to 10 CFR
4 Part 54 (TN4878), “Requirements for Renewal of Operating Licenses for Nuclear Power Plants.”
5 This process consists of separate safety and environmental reviews, which the NRC staff
6 conducts simultaneously and documents in two reports: (1) the safety evaluation report
7 documents the safety review and (2) the EIS documents the environmental review. Both reports
8 factor into the NRC’s decision to issue or deny a renewed license.

9 **1.4 Environmental Issues Evaluated in this EIS**

10 In 1996, as supplemented in 1999, and revised in 2013, the NRC generically assessed the
11 environmental impacts of license renewal of nuclear power plants in NUREG-1437, *Generic*
12 *Environmental Impact Statement for License Renewal of Nuclear Power Plants* (NRC 1996-
13 TN288, NRC 1999-TN289, NRC 2013-TN2654). The NRC undertook this generic review to
14 establish a systematic approach to evaluating the environmental consequences of renewing
15 individual nuclear power plant operating licenses for up to a 20-year period.

16 The 2013 revision of the LR GEIS (NRC 2013-TN2654) established 78 environmental impact
17 issues for LR. For each of these issues, the NRC determined whether the analysis of the
18 environmental issue in the LR GEIS could be applied to all nuclear power plants seeking LR and
19 whether additional mitigation measures would be warranted. Based on this determination, the
20 NRC designated each environmental issue as Category 1 (generic to all or a distinct subset of
21 nuclear power plants) or Category 2 (site-specific to certain nuclear power plants only). For
22 initial LR applications, a site-specific supplement to the LR GEIS is developed that considers the
23 applicable Category 1 and Category 2 issues for the site under review. For generic issues
24 (Category 1), the staff can adopt the LR GEIS’s analyses and conclusions unless new and
25 significant information that invalidates the GEIS conclusion is identified during a site-specific
26 review. For Category 2 issues, the staff performs a site-specific environmental review for each
27 license renewal application. The NRC codified the conclusions in the LR GEIS in Appendix B to
28 Subpart A of 10 CFR Part 51 (TN250), “Environmental Effect of Renewing the Operating
29 License of a Nuclear Power Plant.”

30 As discussed above, on February 24, 2022, the Commission issued three decisions that
31 addressed SLR proceedings for five operating nuclear power plants. Two of these orders,
32 CLI-22-02 (NRC 2022-TN8182) and CLI-22-03 (NRC 2022-TN9844) are relevant to the
33 Monticello SLR environmental review. In these orders, the Commission concluded that the
34 LR GEIS and Table B-1 of Appendix B to 10 CFR Part 51 (TN250) did not consider the impacts
35 from operations during the SLR period of extended operations. In CLI-22-03, the Commission
36 directed the NRC staff to review and update the LR GEIS so that it covers nuclear power plant
37 operation during the SLR period (NRC 2022-TN9844). However, the Commission allowed SLR
38 applicants to submit a revised ER providing information on the environmental impacts during the
39 SLR period, in which they must evaluate all such impacts on a site-specific basis. The NRC staff
40 would then address the impacts of these issues during the SLR period in site-specific EISs.

41 The NRC staff prepared this site-specific EIS in accordance with CLI-22-02 and CLI-22-03
42 (NRC 2022-TN8182; NRC 2022-TN9844) and requirements in 10 CFR 51.70 (TN250), “Draft
43 Environmental Impact Statements – General Requirements.” In this EIS, the impacts of all
44 environmental issues applicable to Monticello SLR were considered on a site-specific basis.
45 This EIS considers information in Xcel Energy’s SLR application; the staff’s consultation with

1 Federal, State, Tribal, and local government agencies; comments received during the scoping
2 process, and other new information, as appropriate.

3 The NRC staff has also considered whether any additional environmental issues exist beyond
4 the issues identified in the LR GEIS that would apply to Monticello during the SLR period of
5 extended operations. The NRC staff identified no such issues during its review of Xcel Energy's
6 ER, as supplemented, or as a result of the environmental scoping process, the environmental
7 site audit, or consultations with Federal, State, and local agencies and American Indian Tribes.
8 Generally, SLR would allow current operating conditions and environmental stressors to
9 continue rather than introduce new environmental impacts that did not exist during the original
10 license or the initial LR periods. Therefore, in this EIS, the NRC staff conducted a site-specific
11 analysis using the structure of environmental issues established in the LR GEIS.

12 The NRC's standard of significance for impacts uses the Council on Environmental
13 Quality (CEQ) terminology for "Determine the appropriate level of NEPA review"
14 (40 CFR 1501.3(b)-TN4876). In considering whether the effects of the proposed action are
15 significant, the NRC analyzes the potentially affected environment and degree of the effects of
16 the proposed action (subsequent license renewal). The potentially affected environment
17 consists of the affected area and its resources, such as listed species and designated critical
18 habitat under the Endangered Species Act (ESA) of 1973, as amended (16 U.S.C. 1531 et seq.-
19 TN1010). For a site-specific analysis, significance would depend on the effects in the local area,
20 including (1) both short- and long-term effects; (2) both beneficial and adverse effects;
21 (3) effects on public health and safety; and (4) effects that would violate Federal, State, Tribal,
22 or local law protecting the environment.

23 The NRC characterizes potential impacts according to three levels of significance for potential
24 impacts—SMALL, MODERATE, and LARGE.

25 **SMALL:** indicates that the environmental effects are not detectable or are so minor that they will
26 neither destabilize nor noticeably alter any important attribute of the resource.

27 **MODERATE:** indicates that the environmental effects are sufficient to alter noticeably, but not to
28 destabilize, important attributes of the resource.

29 **LARGE:** indicates that the environmental effects are clearly noticeable and are sufficient to
30 destabilize important attributes of the resource.

31 **1.5 Structure of this EIS**

32 This site-specific EIS presents the analysis of the environmental effects of the continued
33 operation of Monticello through the SLR term, reasonable alternatives to SLR, and mitigation
34 measures for minimizing adverse environmental impacts. Chapter 3, "Affected Environment,
35 Environmental Consequences, and Mitigating Actions," contains an analysis and comparison of
36 the potential environmental impacts from SLR and alternatives to SLR. Chapter 4, "Conclusion,"
37 presents the NRC staff's preliminary recommendation on whether the environmental impacts of
38 SLR are so great that preserving the option of SLR would be unreasonable. The NRC staff will
39 consider public comments that it receives on this draft site-specific EIS and will then issue its
40 final site-specific EIS. The NRC will make its final determination on Monticello's SLR in a record
41 of decision to be issued following issuance of the final site-specific EIS.

1 In preparing this draft EIS, the NRC staff carried out the following activities:

- 2 • reviewed Xcel Energy’s ER
- 3 • consulted with Federal agencies, State and local agencies, and American Indian Tribes
- 4 • conducted site-specific analysis of each environmental issue relevant to Monticello SLR
- 5 • performed environmental and SAMA site audits
- 6 • considered public comments received during the scoping comment period

7 New information can come from many sources, including the applicant, the NRC, other
8 agencies, or public comments. If new information reveals a new issue that the NRC was not
9 aware of, the staff will first analyze the issue to determine whether it is within the scope of the
10 license renewal environmental review. If the NRC staff determines that the new issue bears on
11 the proposed action or its impacts, the staff will then determine the significance of the issue for
12 the plant and address the issue in the EIS, as appropriate.

13 **1.6 Decision to Be Supported by the EIS**

14 This site-specific EIS provides information and analyses to support the NRC’s decision on
15 whether to renew the Monticello operating licenses for an additional 20 years. The regulation at
16 10 CFR 51.103(a)(5) (TN250) specifies the NRC’s decision standard as follows:

17 In making a final decision on a license renewal action pursuant to [10 CFR]
18 Part 54 of this chapter, the Commission shall determine whether or not the
19 adverse environmental impacts of license renewal are so great that preserving
20 the option of license renewal for energy planning decisionmakers would be
21 unreasonable.

22 There are many factors that the NRC takes into consideration when deciding whether to renew
23 the operating license of a nuclear power plant. The analysis of environmental impacts in this EIS
24 will provide the NRC’s decisionmakers (the Commission) with important environmental
25 information for consideration in deciding whether to renew the Monticello operating license.

26 **1.7 Cooperating Agencies**

27 During the scoping process, the NRC staff did not identify any Federal, State, local, or Tribal
28 agencies as cooperating agencies for this EIS.

29 **1.8 Consultations**

30 Certain Federal environmental statutes require Federal agencies to consult with other agencies,
31 Tribes, and organizations before taking an action that may affect protected environmental
32 resources, such as endangered species, habitat of managed fisheries, and historical and
33 cultural resources. The ESA (16 U.S.C. 1531 et seq.-TN1010), the Magnuson–Stevens
34 Fisheries Conservation and Management Act (MSA) of 1996, as amended (16 U.S.C. 1801
35 et seq.-TN7841); and the National Historic Preservation Act (NHPA) of 1966, as amended
36 (54 U.S.C. 300101 et seq.-TN4157) require Federal agencies to consult with applicable State
37 and Federal agencies and organizations before taking an action that may affect endangered
38 species, fisheries, or historic and archaeological resources, respectively. See Appendix C for a
39 list of the agencies and groups with which the NRC staff consulted.

1 **1.9 Correspondence**

2 During the review, the NRC staff contacted Federal, State, regional, local, and Tribal agencies
3 listed in Appendix C, which chronologically lists all correspondence the NRC staff sent and
4 received associated with the ESA, the MSA, and the NHPA. Appendix D chronologically lists all
5 other correspondence.

6 **1.10 Status of Compliance**

7 Xcel Energy is responsible for complying with all NRC regulations and other applicable Federal,
8 State, and local requirements. Appendix F, "Laws, Regulations, and Other Requirements," of
9 the LR GEIS, Revision 1, describes some of the major applicable Federal statutes. Numerous
10 permits and licenses are issued by Federal, State, and local authorities for activities at
11 Monticello. Appendix B of this EIS contains further information from the Monticello application
12 about Xcel Energy's status of compliance.

13 **1.11 Related State and Federal Activities**

14 The NRC staff reviewed the possibility that activities (projects) of other Federal agencies might
15 impact the renewal of the operating licenses for Monticello. Any such activities could result in
16 cumulative environmental impacts and the possible need for the Federal agency to become a
17 cooperating agency for preparing this EIS. The NRC staff has determined that there are no
18 Federal projects that would make it necessary for another Federal agency to become a
19 cooperating agency in the preparation of this EIS (10 CFR 51.10(b)(2)-TN250). Section 3.14
20 identifies the activities (projects) including State activities that were considered during the
21 cumulative environmental impacts review.

22 Section 102(2)(C) of NEPA (42 U.S.C. § 4332-TN4880) requires the NRC to consult with and
23 obtain comments from any Federal agency or designated authority that has jurisdiction by law or
24 special expertise with respect to any environmental impact involved in the subject matter of the
25 EIS. For example, during the preparation of this site-specific EIS, the NRC consulted with the
26 Minnesota State Historic Preservation Officer, among others. Appendix C provides a complete
27 list of consultation correspondence.

28 The NRC staff reviewed the Monticello status of compliance in Chapter 3 and Appendix B and
29 notes that some State or Federal permitting and certification activities could affect NRC license
30 renewal. In appropriate circumstances (not present here), construction of water intake
31 structures, access roads, or rail spurs may be required by other regulatory authorities. In such
32 instances, some nuclear power plant construction activities may require a license amendment
33 and an environmental review by the NRC. However, no such activities have been identified for
34 Monticello SLR.

2 ALTERNATIVES INCLUDING THE PROPOSED ACTION

The NRC's decision-making authority in license renewal is limited to deciding whether to renew a nuclear power plant's operating license; the agency's implementation of the NEPA (42 U.S.C. 4321 et seq.; TN661), requires consideration of the environmental impacts of that action as well as the impacts of reasonable alternatives to renewing a nuclear power plant's operating license. Although the ultimate decision on which alternative (or the proposed action) to carry out falls to the nuclear plant owner, State, or other non-NRC Federal officials, comparing the impacts of renewing the operating license to the environmental impacts of alternatives allows the NRC to determine whether the environmental impacts of LR are so great that it would be unreasonable for the agency to preserve the option of LR for energy planning decision-makers (10 CFR Part 51.71(d) footnote 3; TN250).

Energy planning decision-makers and utility owners ultimately decide whether the nuclear power plant will continue to operate, and economic and environmental considerations play important roles in this decision. In general, the NRC's responsibility is to ensure the safe operation of nuclear power facilities, not to formulate energy policy or promote nuclear power, or encourage or discourage the development of alternative power generation. The NRC does not engage in energy planning decisions, and it makes no judgment as to which replacement energy alternatives would be the most likely alternative selected in any given case.

This chapter describes (1) the Monticello Nuclear Generating Plant, Unit 1 (Monticello) site and its operation, (2) the proposed action (subsequent renewal of the current renewed Monticello operating license), (3) reasonable alternatives to the proposed action (including the no-action alternative), and (4) alternatives eliminated from detailed study.

2.1 Description of Nuclear Power Plant Facility and Operation

The physical presence of Monticello buildings and facilities, as well as the nuclear power plant's operations, are integral to creating the environment that currently exists at and around the site. This section describes certain nuclear power plant operating systems and certain nuclear power plant infrastructure, operations, and maintenance.


2.1.1 External Appearance and Setting

Monticello is located in the City of Monticello, Wright County, Minnesota, at 45° 20' N latitude and 93° 50' W longitude (Xcel 2023-TN9084). As shown in Figure2-1, Monticello is situated on the southern bank of the Mississippi River approximately 22 miles (mi) (35.4 kilometers [km]) southeast of St. Cloud and approximately 30 mi (48.2 km) northwest of the Twin Cities area of Minneapolis, St. Paul, and their surrounding suburbs.


As shown Figure2-2, the principal Monticello structures are the reactor building, a turbine building, a radioactive waste building and off-gas stack, and a diesel emergency generator building. Prominent features beyond the power block area include intake and discharge structures, two mechanical draft cooling towers (MDCTs), the Monticello training and conference center, technical and administrative support facilities, a firing range, meteorological towers, and the Monticello substation which includes 345, 230, 115, and 13.8 kilovolt (kV) switchyards (Xcel 2023-TN9084).



1
 2 **Figure 2-1 Monticello Nuclear Generating Plant Site 50 mi (80 km) Radius Map. Source:**
 3 **Xcel 2023-TN9084.**

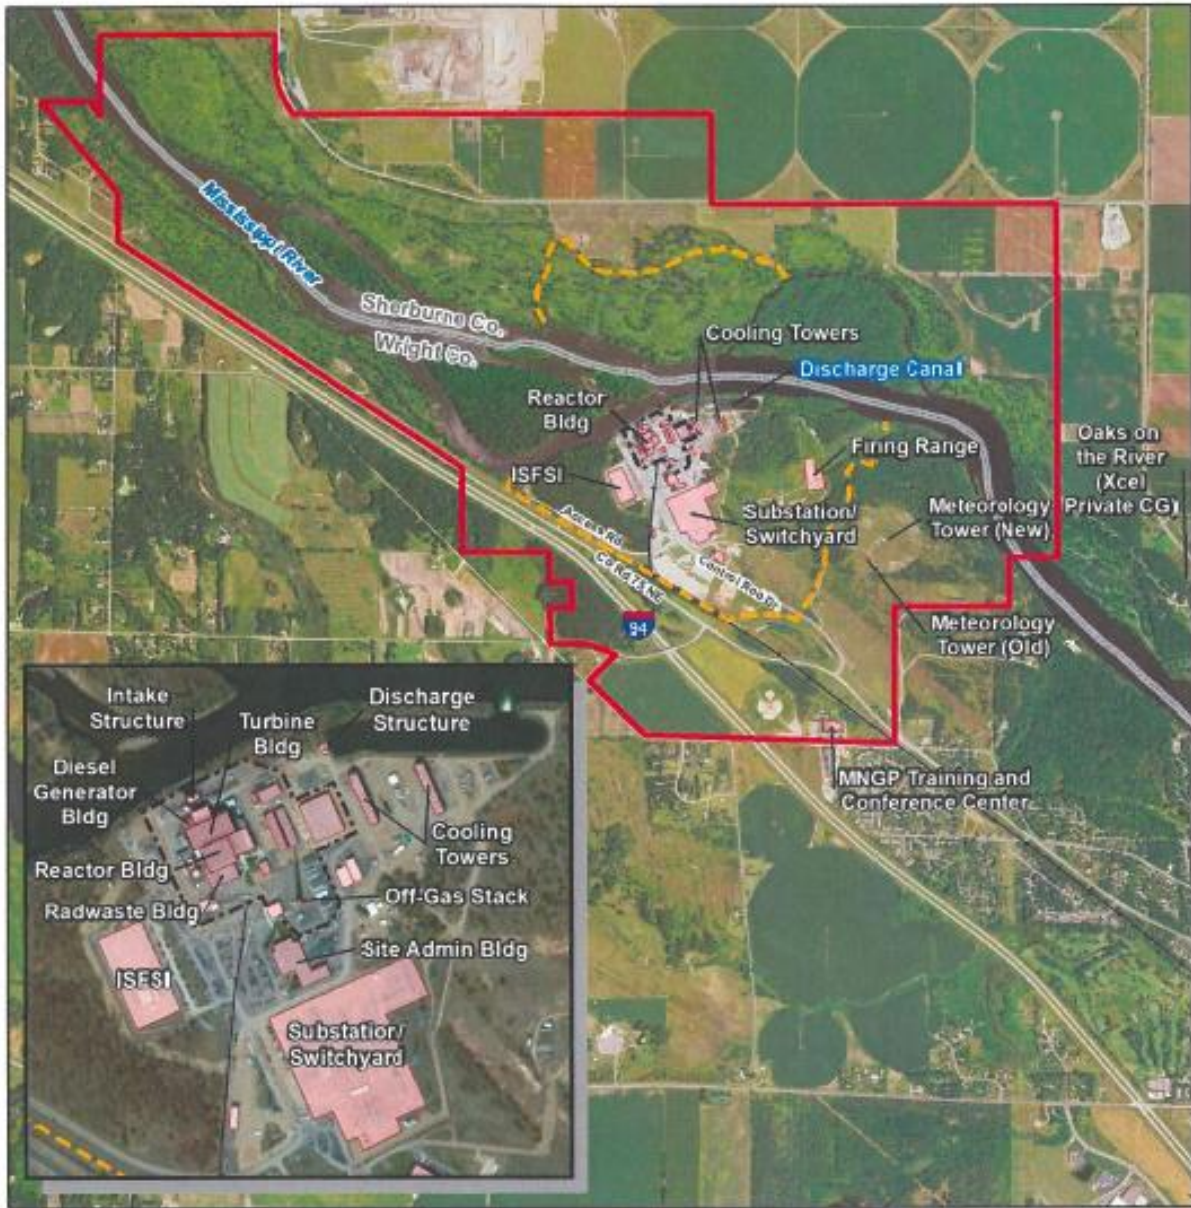

- Legend**
- Exclusion Area Boundary (EAB)
 - - - Protected Area Fence
 - Railroad
 - Building/Structure
 - MNGP Site Boundary



1
2
3

Figure 2-2 Monticello Nuclear Generating Plant Layout and Surrounding Features.
Source: Xcel 2023-TN9084.

1 **2.1.2 Nuclear Reactor Systems**

2 Monticello is a single-unit electric generating plant consisting of a single-cycle, forced-
3 circulation, General Electric boiling water reactor, BWR-3, that produces steam for direct use in
4 a steam turbine. The NRC issued the original Monticello operating license on January 9, 1971.
5 The first renewed license was issued on November 8, 2006.

6 The nuclear reactor was originally designed to produce up to 1,670 megawatts thermal (MWt)
7 and 545 megawatts electric (MWe). An uprate license amendment increasing the power to
8 1,775 MWt/600 MWe was approved in 1998, and a subsequent extended power uprate (EPU)
9 increasing the power up to 2,004 MWt/691 MWe was approved in 2013 (Xcel 2023-TN9084;
10 NRC 2006-TN7315, NRC 2013-TN9799).

11 **2.1.3 Cooling and Auxiliary Water Systems**

12 There are numerous systems moving water through components at Monticello. Primary among
13 them is the cooling system which consists of the circulating water system and the plant service
14 water system. Both systems withdraw and use water from the Mississippi River. Auxiliary water
15 systems include the domestic water system, which withdraws groundwater, and the fire
16 protection system which utilizes water from the Mississippi River.

17 Monticello surface water and groundwater withdrawals are governed by water appropriation
18 limits set by the Minnesota Department of Natural Resources (MDNR). Monticello is permitted to
19 withdraw a maximum of 645 cubic feet per second (cfs) of water from the Mississippi River
20 when the river flow is greater than 860 cfs. However, when the river flow is less than 860 cfs,
21 special withdrawal restrictions on the permitted withdrawal volume are applicable. Further
22 withdrawal restrictions apply if river flow is reduced to less than 240 cfs. Monticello may
23 withdraw up to a total of 20 million gallons per year (an average of 38 gallons per minute [gpm])
24 of groundwater via two onsite wells that supply raw water to the reverse osmosis/make-up
25 demineralizer system that is used to produce purified water for the plant primary systems
26 (Xcel 2023-TN9084).

27 **2.1.3.1 Circulation and Plant Water Systems**

28 The function of the Monticello circulating water system is to remove heat from the main steam-
29 cooling condenser. The circulating water system consists of two water pumps, each rated
30 140,000 gpm, mounted over each end of the intake structure connected to the Mississippi River.
31 These pumps are designed to circulate 292,000 gpm of cooling water through the main
32 condenser. The circulating water system operates under several modes based on prevailing
33 river flow, river temperature, status of critical plant equipment, and compliance with State water
34 use permits and National Pollutant Discharge Elimination System (NPDES) permit discharge
35 limits. These modes include: (1) Open Cycle or Once-Through where water is withdrawn from
36 and discharged directly to the Mississippi River, (2) Helper Cycle where two MDCTs are utilized
37 and the cooled water is discharged from the towers to the Mississippi River, (3) Partial
38 Recirculation where two MDCTs are utilized and the cooled water is recirculated to the intake
39 while the remainder is discharged to the Mississippi, and (4) Closed Cycle where two MDCTs
40 are utilized and all cooled water is recirculated to the intake except for cooling tower blowdown,
41 evaporation, and drift.

1 The two MDCTs, which were replaced in 2021 and 2022, are supplied by pumps operating in
2 series which deliver 151,000 gpm to each tower. The new cooling towers were equipped with
3 drift eliminators. They have historically operated between May and September (when river
4 temperatures exceed 68°F (20°C) and in recent years have operated between 129 to 179 days
5 annually (Xcel 2023-TN9084).

6 The plant service water system provides strained (free of suspended solids) Mississippi River
7 water to the reactor and turbine building to meet normal startup and shutdown requirements. It
8 consists of three service water pumps each with 6,000 gpm capacity (NRC 2006-TN7315). The
9 plant service water system supplies cooling water for several reactor related operations
10 including the plant main generator, reactor and turbine building air conditioner units, turbine lube
11 oil coolers, reactor building closed cooling water system heat exchangers, and reactor
12 feedwater system pumps (Xcel 2023-TN9084).

13 *Cooling Water Intake and Discharge*

14 The intake structure that captures Mississippi River water used by the circulating water system,
15 the plant service water system, and when needed, the fire protection system consists of an
16 approach channel formed by sheet pile structures that are 98 ft (29.9 m) apart and extend 59 ft
17 (17.9 m) into the river, angled at 81° to the shoreline. At the intake structure, the approach
18 channel reduces to approximately 63 ft (19.2 m) wide. Water enters the intake structure over an
19 approximately 63 ft (19.2 m) wide concrete sill that serves as a sediment barrier. At the center of
20 the sill is a 12.5 ft (3.8 m) wide stop log section that can be removed during low river levels to
21 allow water to flow unobstructed.

22 On the plant side of the sill is a concrete apron extending the width of the approach channel and
23 16 ft (4.9 m) upstream of the bar rack. The bar rack includes a motor-operated bar rack rake
24 that both prevents large debris from entering the intake structure and lifts debris into a trash
25 hopper to prevent the debris from re-entering the river. Following the bar rack, the water is
26 divided into two separate streams that flows through two parallel traveling screens located 10 ft
27 (3.05 m) behind the bar racks. The traveling screens have 3/8 in. (0.95 cm) mesh that removes
28 fine debris. The traveling screens are rotated and rinsed every 12 hours when the river
29 temperature is below 50°F (10°C). When the river temperature is above 50°F (10°C), certain
30 game fish populations tend to increase (e.g., smallmouth bass, walleye, and northern pike), and
31 the screens are continuously rotated to avoid fish being held against the screen for extended
32 periods. The debris, as well as any impinged organisms, are rinsed from the traveling screens
33 into a common sluiceway that extends back to the river downstream of the intake structures.
34 From the traveling screens, water passes through the service water pump bay and two parallel
35 motor-operated sluice gates before reaching the circulating water pumps (Xcel 2023-TN9084
36 and NRC 2006-TN7315)

37 In terms of discharge from the circulating water and plant service water systems, effluent is
38 piped approximately 600 ft (182.9 m) through two 108 in. (274.3 cm) steel pipes to the
39 discharge structure at the head of the discharge canal. The discharge structure is constructed of
40 reinforced concrete and measures 50 ft by 54 ft by 38 ft (15.2 m by 16.5 m by 11.6 m), with the
41 roof approximately 5 ft (1.5 m) above grade. The discharge structure includes two isolation and
42 two sluice gates. The motor-operated sluice gates can isolate the discharge flow from the
43 discharge canal. During open-cycle operation, the sluice gates are open, and the circulating
44 water is returned to the Mississippi River through the discharge canal. The bottom of the
45 discharge canal was constructed on a 0.25 percent slope in an easterly direction approximately
46 1000 ft (304.8 m) to where it enters the river. In 1980, an overflow weir was added to allow
47 normal outflow of cooling water from the discharge canal, re-establishing the previously existing

1 shoreline of the river. The weir inhibits fish from entering the canal. The discharge weir consists
2 of an earth filled dike and a vertical sheet-pile overflow section (Xcel 2023-TN9084).

3 **2.1.3.2 Domestic Water System**

4 The domestic water system is an auxiliary system that provides water for drinking and sanitary
5 use as well as supplying untreated water for the plant reverse osmosis/make-up demineralizer
6 system and seal water to pumps located at the plant intake structure. Seven on-site
7 groundwater wells are the source of water for the domestic water system. Two wells, which
8 provide raw water to the demineralizer system and seal water, are each equipped with a
9 100 gpm capacity pump. These two wells, which are connected at a manifold, and provide raw
10 water to the demineralizer system and seal water. The five other water supply wells provide
11 additional domestic water as needed to a warehouse and site administration building
12 (Xcel 2023-TN9084).

13 **Fire Protection System**

14 The Monticello fire protection system is an auxiliary system that uses the Mississippi River as its
15 water source. In addition to its use in fire protection, this water system can provide water, when
16 needed, to the service water system (administrative building computer room chillers), residual
17 heat removal service water system, and make-up water to the spent fuel pool if additional
18 makeup is needed. It consists of five pumps: a 1,500 gpm diesel-driven vertical centrifugal
19 pump, two 1,500 gpm electrical motor-driven vertical centrifugal pumps (the fire pumps), and a
20 50 gpm electrical motor-driven horizontal jockey (pressure maintenance) pump. The fire
21 protection system is a standby system during normal plant operations (Xcel 2023-TN9084).

22 **2.1.4 Radioactive Waste Management Systems**

23 The NRC licenses nuclear power plants with the expectation that they will release a limited
24 amount of radioactive material to both the air and water during normal operations. Monticello
25 uses liquid, gaseous, and solid waste processing systems to collect and treat, as needed,
26 radioactive materials produced as a byproduct of nuclear power plant operations. Section 2.2.6
27 of the Xcel Energy ER, submitted as part of its SLR application, provides an expanded
28 description of Monticello's radioactive waste management systems (Xcel 2023-TN9084:
29 Appendix E, Section 2.2.6, E-2-16 to E-2-24). The NRC staff discusses the radioactive waste
30 management systems in Section 3.13.1, "Radioactive Waste" of this EIS.

31 **2.1.5 Nonradioactive Waste Management Systems**

32 Monticello generates nonradioactive waste as a result of nuclear power plant maintenance,
33 cleaning, and operational processes. Monticello manages nonradioactive wastes in accordance
34 with applicable Federal and State regulations, as implemented through its corporate
35 procedures. Section 2.2.7 of the Xcel Energy ER, submitted as part of its SLR application,
36 provides an expanded description of Monticello's nonradioactive waste management systems
37 (Xcel 2023-TN9084: Appendix E, Section 2.2.7, E-2-24 to E-2-30). The NRC staff discusses the
38 nonradioactive waste management systems in Section 3.13.2, "Nonradioactive Waste" of this
39 EIS.

1 **2.1.6 Utility and Transportation Infrastructure**

2 The utility and transportation infrastructure at nuclear power plants typically interfaces with
3 public infrastructure systems available in the region. Such infrastructure includes utilities, such
4 as suppliers of electricity, fuel, and water, as well as roads and railroads that provide access to
5 the site. The following sections briefly describe the existing utility and transportation
6 infrastructure at Monticello. Site-specific information in this section is primarily derived from Xcel
7 Energy's ER (Xcel 2023-TN9084), unless otherwise cited.

8 *2.1.6.1 Electricity*

9 Nuclear power plants generate electricity for other users; however, they also use electricity to
10 operate. Offsite power sources provide power to engineered safety features and emergency
11 equipment in the event of a malfunction or interruption of power generation at the nuclear power
12 plant. Planned independent backup power sources provide power, if power from both the
13 nuclear power plant itself and offsite power sources is interrupted.

14 *2.1.6.2 Fuel*

15 Monticello utilizes low-enriched uranium dioxide fuel with enrichments below 5.0 percent by
16 weight uranium-235, with peak fuel-rod burn-up levels less than 62,000 megawatt-days per
17 metric ton uranium (MWd/MTU). Refueling of the reactor is performed every 22 to 24 months
18 with approximately 30 percent of the fuel being replaced during each refueling outage.
19 Monticello stores spent fuel in the spent fuel pool located in the reactor building or in dry cask
20 storage containers at the onsite independent spent fuel storage installation (ISFSI) (Xcel 2023-
21 TN9084).

22 *2.1.6.3 Water*

23 Monticello withdraws Mississippi River water for condenser cooling, service water cooling,
24 screen washing, and fire protection purposes. In addition, Monticello uses groundwater for
25 nuclear power plant potable, sanitary, and everyday water use activities (e.g., drinking,
26 showering, cleaning, doing laundry, operating toilets, and operating eye washes). In this EIS,
27 Section 2.1.3, "Cooling and Auxiliary Water Systems," describes the Monticello industrial water
28 systems.

29 *2.1.6.4 Transportation Systems*

30 Nuclear power plants are served by controlled access roads that are connected to U.S.
31 highways and Interstate highways. In addition to roads, many nuclear power plants also have
32 railroad connections for moving heavy equipment and other materials. Nuclear power plants
33 located on navigable waters may have facilities to receive and ship loads on barges.
34 Section 3.10.6, "Local Transportation," describes the Monticello transportation systems.

35 *2.1.6.5 Power Transmission Systems*

36 For LR and SLR actions, the NRC staff evaluates, as part of the proposed action, the continued
37 operation of those Monticello power transmission lines that connect to the substation where it
38 feeds electricity into the regional power distribution system. The transmission lines that are in
39 scope for the Monticello SLR environmental review are onsite and are not accessible to the
40 general public (Xcel 2023-TN9084). The NRC staff also considers, as part of the proposed

1 action, the continued operation of the transmission lines that supply outside power to the
2 nuclear plant from the grid. Section 3.11.4, “Electromagnetic Fields,” describes these
3 transmission lines.

4 **2.1.7 Nuclear Power Plant Operations and Maintenance**

5 Maintenance activities conducted at Monticello include inspection, testing, and surveillance to
6 maintain the current licensing basis of the facility and to ensure compliance with environmental
7 and safety requirements (Xcel 2023-TN9084). These activities include in-service inspections of
8 safety-related structures, systems, and components; quality assurance and fire protection
9 programs; and radioactive and nonradioactive water chemistry monitoring.

10 Additional programs include those implemented to meet technical specification surveillance
11 requirements and those implemented in response to NRC generic communications. Such
12 additional programs include various periodic maintenance, testing, and inspection procedures
13 necessary to manage the effects of aging on structures and components. Certain program
14 activities are performed during the operation of the units, whereas others are performed during
15 scheduled refueling outages (Xcel 2023-TN9084).

16 **2.2 Proposed Action**

17 As stated in Section 1.1, the proposed Federal action is to determine whether to renew the
18 Monticello operating license for an additional 20 years. Section 2.2.1 describes normal nuclear
19 power plant operations during the SLR term.

20 **2.2.1 Nuclear Power Plant Operations during the Subsequent License Renewal Term**

21 Nuclear power plant operation activities during the SLR term would be the same as, or similar
22 to, those occurring during the current license term.

23 Section 2.1, “Description of Nuclear Power Plant Facility and Operation,” describes the general
24 types of activities carried out during nuclear power plant operations. These include:

- 25 • reactor operation
- 26 • waste management
- 27 • cooling water intake and discharge
- 28 • nuclear fuel receipt and storage
- 29 • spent fuel storage security
- 30 • office and clerical work; possible laboratory analysis
- 31 • surveillance, monitoring, and maintenance
- 32 • refueling and other outages

33 As part of its SLR application, Xcel Energy submitted an ER stating that Monticello will continue
34 to operate during the SLR term in the same manner as it would during the current license term
35 except for additional aging management programs, as necessary (Xcel 2023-TN9084). Such
36 programs would address structure and component aging in accordance with 10 CFR Part 54
37 (TN4878), “Requirements for Renewal of Operating Licenses for Nuclear Power Plants.”

1 **2.2.2 Refurbishment and Other Activities Associated with License Renewal**

2 Refurbishment activities include replacement and repair of major structures, systems, and
3 components. Most major refurbishment activities are actions that would typically take place only
4 once in the life of a nuclear power plant, if at all. For example, reactor vessel head replacement
5 is a refurbishment activity. Refurbishment activities may have an impact on the environment
6 beyond those that occur during normal operations and may require evaluation, depending on
7 the type of action and the nuclear power plant-specific design.

8 In preparation for its license renewal application, Xcel Energy evaluated major structures,
9 systems, and components in accordance with 10 CFR 54.21 (TN4878), “Contents of
10 Application—Technical Information,” to identify major refurbishment activities necessary for the
11 continued operation of Monticello during the proposed 20-year period of extended operation
12 (Xcel 2023-TN9084).

13 Xcel Energy did not identify any major refurbishment or replacement activities necessary for the
14 continued operation of Monticello beyond the end of the current renewed operating license
15 period (Xcel 2023-TN9084).

16 **2.2.3 Termination of Nuclear Power Plant Operations and Decommissioning after the**
17 **License Renewal Term**

18 NUREG-0586, Supplement 1, Volumes 1 and 2, *Final Generic Environmental Impact Statement*
19 *on Decommissioning of Nuclear Facilities: Regarding the Decommissioning of Nuclear Power*
20 *Reactors* (the decommissioning GEIS) (NRC 2002-TN665), describes the environmental
21 impacts of decommissioning. The majority of nuclear power plant operation activities would
22 cease with reactor shutdown. Some activities (e.g., security and oversight of spent nuclear fuel)
23 would remain unchanged, whereas others (e.g., waste management, administrative work,
24 laboratory analysis, surveillance, monitoring, and maintenance) would continue at reduced or
25 altered levels. Systems dedicated to reactor operations would cease. However, if these systems
26 are not removed from the site after reactor shutdown, their physical presence may continue to
27 impact the environment. Impacts associated with dedicated systems that remain in place, or
28 with shared systems that continue to operate at normal capacities, could remain unchanged.

29 Decommissioning could occur whether Monticello is shut down at the end of its current renewed
30 operating license or at the end of subsequent license renewal period of extended operation
31 20 years later.

32 **2.3 Alternatives**

33 As stated above, NEPA requires the NRC to consider reasonable alternatives to the proposed
34 action of renewing the Monticello operating license. For a replacement energy alternative to be
35 reasonable, it must be either (1) commercially viable on a utility scale and operational before the
36 reactor’s operating license expires or (2) expected to become commercially viable on a utility
37 scale and operational before the reactor’s operating license expires.

38 The first alternative to the proposed action (renewing the Monticello operating license), is for the
39 NRC to not issue the license. This is called the no-action alternative and is described in
40 Section 2.3.1. In addition to the no-action alternative, this section discusses three reasonable
41 replacement energy alternatives. As described in Section 2.3.2, these alternatives would seek to
42 replace Monticello’s generating capacity by meeting the region’s energy needs through other
43 means or sources.

1 **2.3.1 No-Action Alternative**

2 At some point, all operating nuclear power plants will permanently cease operations and
3 undergo decommissioning. Under the no-action alternative, the NRC would not renew the
4 Monticello operating license, and the reactor unit would shut down at or before the expiration of
5 the current renewed license on September 8, 2030. The NRC staff expects the impacts to be
6 relatively similar, whether they occur at the end of the current renewed license term (i.e., after
7 60 years of operation) or at the end of a subsequent renewed license term (i.e., after 80 or more
8 years of operation).

9 After permanent reactor shutdown, nuclear power plant operators will initiate decommissioning
10 in accordance with 10 CFR 50.82, "Termination of License" (TN249). The decommissioning
11 GEIS (NUREG-0586) (NRC 2002-TN665) describes the environmental impacts from
12 decommissioning a nuclear power plant and related activities. The analysis in the
13 decommissioning GEIS bounds the environmental impacts of decommissioning when Xcel
14 Energy terminates reactor operations at Monticello. A licensee in decommissioning must assess
15 in its post-shutdown decommissioning activities report submitted to the NRC, whether there are
16 planned decommissioning activities with reasonably foreseeable environmental impacts that are
17 not bounded in previous EISs. Section 2.2.3, "Termination of Nuclear Power Plant Operations
18 and Decommissioning," describes the incremental environmental impacts of SLR on
19 decommissioning activities.

20 Termination of reactor operations would result in the total cessation of electrical power
21 production at Monticello. Unlike the replacement energy alternatives described in Section 2.3.2,
22 the no-action alternative does not meet the purpose and need of the proposed action, as
23 described in Section 2.3.1, because the no-action alternative does not provide a means of
24 delivering baseload power to meet future electric system needs. Assuming that a need currently
25 exists for the electrical power generated by Monticello, the no-action alternative would likely
26 create a need for replacement energy.

27 **2.3.2 Replacement Power Alternatives**

28 The following sections describe replacement power alternatives. The potential environmental
29 impacts of these alternatives are described in Chapter 3 of this EIS. Although NRC's authority
30 only extends to deciding whether to renew the Monticello operating license, replacement energy
31 alternatives represent possible options energy planning decisionmakers may need to consider if
32 the Monticello operating license is not renewed. In evaluating replacement power alternatives,
33 the NRC staff considered energy-generating technologies in commercial operation, as well as
34 technologies likely to be commercially available by the time the current Monticello renewed
35 operating license expires. Because energy-generating technologies continually evolve in
36 capability and cost, and because regulatory structures change to either promote or impede the
37 development of certain technologies, this evaluation considered which replacement power
38 alternatives would be available and commercially viable when the Monticello current renewed
39 operating license expires.

40 The Xcel Energy ER describes possible replacement power alternatives. In addition, information
41 from the following sources were considered in the replacement power analysis:

- 42 • Energy Information Administration (EIA)
- 43 • other Department of Energy (DOE) offices

- 1 • the U.S. Environmental Protection Agency (EPA)
- 2 • industry sources and publications

3 In total, 14 of 17 alternatives were eliminated from detailed study, leaving three replacement
4 power alternatives. The three replacement power alternatives and 14 eliminated alternatives
5 include the following:

- 6 • Alternatives to the proposed action:
 - 7 – natural gas and renewables
 - 8 – renewables and storage
 - 9 – new nuclear small modular reactor

- 10 • Alternatives eliminated from detailed study:
 - 11 – solar power
 - 12 – wind power
 - 13 – biomass power
 - 14 – hydroelectric power
 - 15 – geothermal power
 - 16 – ocean wave, current, and tide energy
 - 17 – municipal solid waste-fired power
 - 18 – natural gas-fired power
 - 19 – petroleum-fired power
 - 20 – coal-fired power
 - 21 – fuel cells
 - 22 – purchased power
 - 23 – delayed retirement of other power-producing facilities
 - 24 – demand-side management/energy conservation/energy efficiency

25 The three replacement power alternatives are described in Sections 2.3.2.1 through 2.3.2.3. As
26 part of its evaluation process to review replacement power alternatives, Xcel Energy established
27 as a criterion the continued generation of approximately 640 MWe net baseload power, which is
28 comparable to Monticello’s current generation of net baseload power. While these replacement
29 alternatives do not directly match the 691 MWe maximum output of Monticello’s current
30 generating capacity, the NRC staff considers them to be reasonably representative
31 replacements for Monticello’s net baseload power for the period beyond Monticello’s current
32 license term, to meet future system generating needs. Therefore, the NRC staff evaluated
33 alternatives using this Xcel Energy criterion. Alternatives that could not provide the equivalent of
34 Monticello’s current baseload generating capacity were eliminated from detailed study, as were
35 alternatives whose costs or benefits could not justify inclusion in the range of reasonable
36 alternatives. Alternatives not likely to be constructed and operational by the time the Monticello
37 operating license expires were also eliminated from detailed study.

38 To ensure that alternatives are consistent with State or regional energy policies, the NRC staff
39 reviewed energy-related statutes, regulations, and policies within the Monticello region.
40 Accordingly, alternatives that would conflict with these requirements were eliminated from
41 further consideration.

42 Section 2.4 briefly describes the 14 alternatives eliminated from detailed study and provides the
43 basis for each elimination. Section 2.5 summarizes key characteristics of the replacement
44 energy alternatives. The NRC assigns a significance level of SMALL, MODERATE, or LARGE
45 for most site-specific issues. For ecological resources subject to the ESA (16 U.S.C. 1531 et
46 seq.-TN1010) and the Magnuson–Stevens Fishery Conservation and Management Act of 1996,

1 as amended (16 U.S.C. 1801 et seq.-TN7841); and historic and cultural resources subject to the
2 NHPA (54 U.S.C. 300101 et seq.-TN4157), the impact significance determination language is
3 specific to the authorizing legislation. The order in which this EIS presents the different
4 alternatives does not imply increasing or decreasing level of impact; nor does the order imply
5 that an energy planning decisionmaker would be more (or less) likely to select any given
6 alternative.

7 2.3.2.1 *Natural Gas and Renewables*

8 This combination alternative involves the offsite construction and installation of a new
9 750 megawatt (MW) natural gas-fired, two-unit combustion turbine power plant, offsite
10 installation of 750 MW wind turbines, and 200 MW of solar panels both on and offsite of
11 Monticello (Xcel 2023-TN9084). Additional power generation would be provided by existing
12 natural gas-fired power plants operated by Xcel Energy in the region of influence (ROI), as well
13 as purchased power as needed.

14 Land Requirements: The natural-gas fired combustion turbine units would be co-located or
15 installed separately at an existing power plant or a greenfield site. Depending on the location
16 and design of the natural gas-fired power plant, cooling towers may or may not be necessary.
17 Minnesota law (MN Stat. 216B-TN9184) requires that each electric utility must generate or
18 procure sufficient energy generated from carbon-free sources to provide 100 percent of
19 electricity from carbon-free energy technologies that is equivalent to the electric utility's total
20 retail electric sales to retail customers in Minnesota by 2040 (MN Stat. 216B-TN9184, 2g). A
21 natural-gas fired combustion turbine unit would not qualify as a carbon-free energy technology,
22 but Xcel Energy may be able to meet the Minnesota carbon-free standard by generating
23 sufficient carbon-free electricity in its service area, procuring carbon-free energy from other
24 utilities, or purchasing renewable energy credits to satisfy the State carbon-free standard. The
25 new natural gas-fired combustion turbine power plant would likely be sited near the area where
26 its power could be sold without the need to purchase renewable energy credits to offset the
27 generation, and therefore would probably not be sited in Minnesota. However, the natural-gas
28 fired combustion turbine power plant could be sited in any of the States within the Xcel Energy
29 service area. Based on the estimated amount of land needed for each combustion turbine unit
30 (Leidos 2016-TN9183) up to 80 acres (ac) (32 hectares [ha]) of land would be needed for the
31 natural gas-fired power plant. In addition, up to 25 mi (40 km) of two new 345 kV transmission
32 lines in a 150 foot (ft) (45.7 meter [m]) wide corridor would be needed to transmit power from
33 each combustion turbine to the electrical grid, or an additional 900 acres (ac)
34 (364 hectares [ha]) of land.

35 The NRC staff notes that Xcel Energy has proposed to close fossil fuel-fired units to meet its
36 80 percent carbon reduction goal by 2030, This objective renders it unlikely that it would seek to
37 build new natural gas-fired combustion turbine units. Nonetheless, the NRC staff included
38 natural gas in this combination alternative, recognizing that Xcel Energy's stated goal could
39 change in the future, potentially rendering this combination alternative more reasonable.

40 Wind energy generating turbines would be installed offsite within Minnesota or elsewhere in the
41 Xcel Energy service area. Using DOE's estimates of land use for wind power projects (85 ac
42 [34 ha] per MW for wind farms, 2.47 ac [1 ha] per MW for the construction footprint, and 0.74 ac
43 [0.3 ha] per MW for permanent structures [DOE 2015-TN8757]), 750 MW of wind power
44 generation would require approximately 66,000 ac (26,709 ha) of land. Xcel Energy estimates
45 up to 150 mi (241 km) of new 345 kV transmission lines in a 150 ft (45.7 m) wide corridor would
46 be needed to transmit power to the electrical grid, or an additional 2,700 ac (1,093 ha) of land.

1 Solar panels would be installed at Monticello and Xcel Energy owned sites in the State of
2 Minnesota, or at a location within the Xcel Energy service area. Xcel Energy estimates that the
3 solar component of this alternative would be located at as many as three different project sites.
4 Based on land requirements for a nearby solar facility, Xcel Energy estimates that the solar
5 installations would require 7.6 ac (3 ha) of land per megawatt, or a combined total of
6 approximately 1,500 ac (607 ha) of land for the 200 MW of solar power considered in this
7 alternative. In addition, up to 25 mi (40 km) of one to three new 345 kV transmission lines in a
8 150 ft (45.7 m) wide corridor would be needed to transmit power to the electrical grid, or an
9 additional 1,450 ac (587 ha) of land.

10 2.3.2.2 *Renewables and Storage*

11 This alternative involves the offsite construction and installation of 950 MW of wind turbines,
12 700 MW of solar panels both on and offsite of Monticello, and 300 MW of offsite lithium-ion
13 battery storage at existing solar facility locations. This alternative also would be supplemented
14 by purchased power as needed, along with occasional and small amounts of additional power
15 generation from existing natural gas-fired power plants operated by Xcel Energy.

16 Land Requirements: Xcel Energy estimates that solar panels would be installed at as many as
17 three different project sites. Based on land requirements for a nearby solar facility, Xcel Energy
18 estimates that the solar installations would require approximately 7.6 ac (3 ha) of land per
19 megawatt, or a combined total of approximately 5,300 ac (2,145 ha) of land for the 700 MW of
20 solar power considered in this alternative. In addition, up to 25 mi (40 km) of up to 10 new
21 345 kV transmission lines in a 150 ft (45.7 m) wide corridor would be needed to transmit power
22 to the electrical grid, or an additional 4,500 ac (1,821 ha) of land.

23 Wind energy generating turbines would be installed offsite within Minnesota or in the Xcel
24 Energy service area. Using DOE's estimates of land use for wind power projects (85 ac [34 ha]
25 per MW for wind farms, 2.47 ac [1 ha] per MW for construction footprint, and 0.74 ac [0.3 ha]
26 per MW for permanent structures [DOE 2015-TN8757]), 950 MW of wind power generation
27 would require approximately 84,000 ac (33,994 ha) of land. Xcel Energy estimates up to 150 mi
28 (241 km) of new 345 kV transmission lines in a 150 ft (45.7 m) wide corridor would be
29 necessary to transmit power to the electrical grid, or an additional 2,700 ac (1,093 ha) of land.
30 A small amount of additional land would be needed to support the battery storage system; no
31 additional land would be required for any purchased power or the small amount of natural-gas
32 fired power necessary to supplement the solar and wind generation.

33 2.3.2.3 *New Nuclear (Small Modular Reactor)*

34 Construction of a new small modular reactor (SMR) nuclear power plant would be a reasonable
35 replacement energy alternative to Monticello's SLR. This alternative would involve the
36 construction and installation of a 12 unit NuScale design SMR power plant generating
37 approximately 880 MWe.

38 The SMR units would use a closed-cycle, MDCT cooling system. Surface water sources would
39 be used at an estimated 740 gallons per megawatt-hour. Total annual water consumption would
40 be approximately 5.7 billion gallons.

41 Minnesota Statute 216B.243, Subdivision 3b, prohibits the construction and operation of new
42 nuclear power plants in Minnesota (MN Stat. 216B-TN9184). Therefore, the SMR plant would
43 be constructed and installed outside of Minnesota in one of the other seven states in Xcel

1 Energy’s service area, although, to date, there have been no discussions with energy planning
2 decision-makers in these states regarding new nuclear power generation (Xcel 2023-TN9578).
3 The new SMR power plant would be constructed within 25 mi (40 km) of a transmission grid
4 with sufficient surface water to support the power plant cooling and water use.

5 Land Requirements: Xcel Energy assumes up to 130 ac (53 ha) of land would be needed to
6 support the construction of the SMR power plant, with approximately 30 ac (12 ha) for the power
7 plant footprint. Xcel Energy estimates up to 25 mi (40 km) of new 345 kV transmission lines in a
8 150 ft (45.7 m) wide corridor would be needed to transmit power to the electrical grid, or an
9 additional 450 ac (182 ha) of land.

10 **2.4 Alternatives Considered but Eliminated**

11 The NRC staff eliminated 14 alternatives from detailed study due to resource availability and
12 commercial or regulatory limitations. Many of these limitations will likely still exist when
13 the current renewed Monticello operating license expires. This section briefly describes these
14 14 alternatives as well as the reasons why they were eliminated from detailed study.

15 **2.4.1 Solar Power**

16 Solar power, including photovoltaic and concentrating solar power technologies, generates
17 power from sunlight. Solar photovoltaic components convert sunlight directly into electricity
18 using solar cells made from silicon or cadmium telluride. Concentrating solar power uses heat
19 from the sun to boil water and produce steam. Steam drives a turbine connected to a generator
20 to produce electricity (NREL Undated-TN7710).

21 In May 2023, Xcel Energy broke ground on a new 460 MW solar facility north of Monticello on
22 approximately 3,500 ac (1,416 ha) in Sherburne County, on agricultural land currently used for
23 cultivated crops. When completed, the Sherco Solar Project will be the fifth largest solar facility
24 in the nation. Xcel Energy recently proposed building another 250 MW solar farm adjacent to
25 the one under construction, pending approval by State regulators. Combined, the project would
26 total 710 megawatts (Marohn and Becker 2023-TN9857).

27 While Xcel Energy appears to be committed to the use of solar power to generate electricity, the
28 use of solar power to replace Monticello’s generating capacity would require a further
29 commitment of resources to solar, including substantial additional land use. In addition,
30 increased reliance on solar power to replace large amounts of baseload generating power may
31 introduce unnecessary risks, as solar power is subject to intermittent unavailability. Solar
32 generators are considered an intermittent electrical power resource because their availability
33 depends on exposure to the sun, also known as solar insolation. Further, to be viable, a utility-
34 scale solar alternative must replace the amount of electrical power that Monticello currently
35 provides. Assuming a capacity factor of 25 percent (DOE/EIA 2023-TN8821), approximately
36 2,560 MW of additional solar energy capacity would need to be installed to replace 640 MW of
37 electricity generated by Monticello. Based on Xcel Energy’s estimate of 7.6 ac (3 ha) of land per
38 MW, this would require approximately 19,500 ac (7,891 ha) of land.

39 If the Monticello operating license is not renewed, it is unlikely that Monticello’s generating
40 capacity would be replaced by a single type of intermittent electricity generation, including a
41 non-baseload resource such as utility-scale solar. A combination of energy sources, including
42 sources analyzed in Section 2.3.2 such as natural gas, wind, solar, and battery backup, would
43 complement each other and reduce issues such as the intermittency of wind and utility-scale
44 solar.

1 The impacts of utility-scale solar development are described in the two combination alternatives
2 described in Section 2.3.2. The types of impacts of a standalone solar energy alternative would
3 be similar to these alternatives, although the magnitude of such impacts may differ based on the
4 amount of solar energy capacity to be constructed. Given the intermittency of solar power, a
5 standalone solar alternative was considered but eliminated from detailed analysis. However, a
6 limited amount of solar power generation, in combination with other energy generating
7 technologies, could be a reasonable alternative to Monticello’s SLR, as explained in
8 Sections 2.3.2.1 and 2.3.2.2.

9 **2.4.2 Wind Power**

10 As is the case with other renewable energy sources, the feasibility of wind energy providing
11 baseload power depends on the location (relative to electricity users), value, accessibility, and
12 constancy of the resource. Wind energy must be converted to electricity at or near the point
13 where it is used, and there are limited energy storage opportunities available to overcome the
14 intermittency and variability of wind resources.

15 The American Clean Power Association reports a total of more than 122,000 MW of installed
16 wind energy capacity nationwide as of December 31, 2020 (DOE Undated-TN8431). To be
17 considered a reasonable replacement energy alternative to Monticello’s SLR, a wind power
18 alternative must replace the amount of electrical power that Monticello provides. Assuming a
19 capacity factor of 41.4 percent for onshore wind facilities (Xcel 2023-TN9084), land-based wind
20 energy facilities would need to generate approximately 1546 MW of electricity to replace
21 640 MWe of Monticello’s generating capacity. Using DOE metrics of 0.74 ac/MW for permanent
22 structures, 2.47 ac/MW for construction footprint, and 85 ac/MW for wind farm boundaries,
23 onshore wind farms could require approximately 132,000 total ac (53,419 ha) of land (DOE
24 2015-TN8757). Additionally, because wind is an intermittent energy source, energy storage
25 would be needed, increasing land requirements.

26 If the continued Monticello operating license were to be rejected, it is unlikely that Monticello’s
27 generating capacity would be replaced by a single type of intermittent electricity generation,
28 including a non-baseload resource such as wind power. A combination of energy sources,
29 including sources analyzed in Section 2.3.2 such as natural gas, wind, solar, and battery
30 backup, would complement each other and reduce issues such as the intermittency of wind
31 generation.

32 The impacts of utility-scale wind development are described in the two combination alternatives
33 described in Section 2.3.2. The types of impacts of a standalone wind energy alternative would
34 be similar to these alternatives, although the magnitude of such impacts may differ based on the
35 amount of wind energy capacity to be constructed. Given the intermittency of wind power, a
36 standalone wind alternative was considered but eliminated from detailed analysis. However, a
37 limited amount of wind power generation, in combination with other power generating
38 technologies, could be a reasonable alternative to Monticello’s SLR, as explained in
39 Sections 2.3.2.1 and 2.3.2.2.

40 **2.4.3 Biomass Power**

41 Biomass resources used for biomass fuel-fired power generation include agricultural residues,
42 animal manure, wood wastes from forestry and industry, residues from food and paper
43 industries, municipal green wastes, dedicated energy crops, and methane from landfills (IEA
44 2007-TN8436). Using biomass fuel-fired generation for baseload power depends on the

1 geographic distribution, available quantities, constancy of supply, and energy content of
2 biomass resources. For this analysis, biomass fuel would be combusted for power generation
3 in the electricity sector.

4 As of 2022, biomass in Minnesota powered approximately 2 percent of total State electricity,
5 most of that from wood fuel (EIA 2023-TN9786). For utility-scale biomass fuel-fired electricity
6 generation, technologies used for biomass energy conversion would be similar to the
7 technology used in other fossil fuel-fired power plants, including the direct combustion of
8 biomass fuel in a boiler to produce steam (NRC 2013-TN2654). Accordingly, biomass
9 generation is considered a carbon-emitting technology.

10 Biomass energy generation is generally more cost effective when co-located with coal-fired
11 power plants (IEA 2007-TN8436). However, most biomass fuel-fired power plants generally
12 only reach capacities of 50 MWe, which means replacing Monticello's generating capacity,
13 using only biomass fuel, would require the construction of 13 new power plants.

14 Increasing biomass fuel-fired generation capacity by expanding existing or constructing new
15 units by the time Monticello's current renewed operating license expires is unlikely. For these
16 reasons, biomass fuel-fired generation would not be a reasonable alternative to Monticello's
17 SLR.

18 **2.4.4 Hydroelectric Power**

19 There are about 2,000 hydroelectric facilities operate in the United States. Hydropower
20 technologies capture flowing water and directs it to turbines and generators to produce
21 electricity (NRC 2013-TN2654). There are three variants of hydroelectric power generation:
22 (1) run of the river (diversion) facilities that redirect the natural flow of a river, stream, or canal
23 through a hydroelectric power facility; (2) store and release facilities that block the flow of the
24 river by using dams that cause water to accumulate in an upstream reservoir; and (3) pumped
25 storage facilities that use electricity from other power sources to pump water to higher
26 elevations during off-peak hours to be released during peak load periods to generate electricity
27 (EIA 2020-TN8352, EIA 2021-TN8353).

28 Although EIA projects that hydropower will remain a leading source of renewable power
29 generation in the United States through 2040, there is little expected growth in large-scale
30 hydropower capacity (DOE/EIA 2013-TN2590). The potential construction of large new
31 hydropower facilities has diminished because of public concern over flooding, habitat alteration
32 and loss, and the impact on natural rivers (NRC 2013-TN2654).

33 Given the projected lack of growth in hydroelectric power, the competing demands for water
34 resources, and public opposition to the environmental impacts from the construction of large
35 hydroelectric power facilities, the use of hydroelectric power would not be a reasonable
36 alternative to Monticello's SLR.

37 **2.4.5 Geothermal Power**

38 Geothermal technologies extract heat from geologic formations to produce steam to drive steam
39 turbine generators. Electricity production from geothermal energy have demonstrated
40 95 percent or greater capacity factors, making geothermal energy a potential source of
41 baseload electric power. However, the feasibility of geothermal power generation to provide
42 baseload power depends on the regional quality and accessibility of geothermal resources.

1 Utility-scale power generation requires geothermal reservoirs with a temperature above 200°F
2 (93°C). Such utility-scale geothermal resources are concentrated in the western United States,
3 specifically Alaska, Arizona, California, Colorado, Hawaii, Idaho, Montana, Nevada, New
4 Mexico, Oregon, Utah, Washington, and Wyoming and most assessments of geothermal power
5 generation resources have been conducted in these States (DOE Undated-TN7698; USGS
6 2008-TN7697). There is currently no utility-scale geothermal power production in the region.
7 Given its low potential, geothermal power generation would not be a reasonable alternative to
8 Monticello's SLR.

9 **2.4.6 Wave and Ocean Energy**

10 Ocean waves, currents, and tides are generally predictable and reliable, making them attractive
11 candidates for potential renewable energy generation. Four major technologies can be used to
12 harness wave energy: (1) terminator devices that range from 500 kilowatts (kW) to 2 MW,
13 (2) attenuators, (3) point absorbers, and (4) overtopping devices (BOEM Undated-TN7696).
14 Point absorbers and attenuators use floating buoys to convert wave motion into mechanical
15 energy, driving generators to produce electricity. Overtopping devices trap a portion of a wave
16 at a higher elevation than the sea surface; waves enter a tube and compress air that is then
17 used to drive a generator producing electricity (NRC 2013-TN2654). Some of these
18 technologies are undergoing demonstration testing at commercial scales, but none are currently
19 used to provide baseload power (BOEM Undated-TN7696). In the United States, there are
20 currently several projects licensed or seeking permits, the largest of which is 20 MW (Duke
21 Energy 2021-TN8897).

22 While Minnesota borders Lake Superior and contains many thousands of smaller lakes,
23 application of wave energy technologies probably would not be viable, as wave and ocean
24 energy-generation technologies are still in their infancy and currently lack commercial
25 application (EPRI 2011-TN8442). For these reasons, wave and ocean energy power generation
26 would not be a reasonable alternative to Monticello's SLR.

27 **2.4.7 Municipal Solid Waste-Fired Power**

28 Energy recovery from municipal solid waste converts nonrecyclable waste materials into usable
29 heat, electricity, or fuel through combustion. Three types of municipal solid waste combustion
30 technologies include mass burning, modular systems, and refuse derived fuel systems. Mass
31 burning is the method used most frequently in the United States. The heat released from
32 combustion is used to convert water to steam, which is then used to drive turbine generators to
33 produce electricity. Ash is collected and taken to a landfill, and particulates are captured through
34 a filtering system (EPA 2023-TN8443).

35 Currently, 75 waste-to-energy power plants are in operation in 21 States, processing
36 approximately 29 million tons (26,308 kg) of waste per year. These waste-to-energy power
37 plants have an aggregate capacity of 2,725 MWe (Michaels and Krishnan 2019-TN7700).
38 Although some power plants have expanded to handle additional waste and to produce more
39 energy, only one new municipal solid waste combustion power plant has been built in the United
40 States since 1995 (Maize 2019-TN7699). The average waste-to-energy power plant produces
41 about 50 MWe, which is a very small fraction of the energy produced by Monticello.

1 The decision to burn municipal solid waste to generate electricity is usually driven by the
2 need for a waste disposal alternative to landfills, rather than a need to generate energy.
3 Stable supplies of municipal solid waste would be needed to support new waste-to-energy
4 power plants in the region. Based on this information, municipal solid waste-to-energy power
5 plants would not be a reasonable alternative to Monticello’s SLR.

6 **2.4.8 Natural Gas-Fired Power**

7 While a natural gas-fired combustion turbine was considered along with renewables as a
8 reasonable replacement power alternative, it was eliminated as a utility-scale standalone
9 replacement power alternative. Factors include Xcel Energy’s proposal to close fossil fuel-fired
10 units to meet its 80 percent carbon reduction goal by 2030 and stakeholder opposition (Xcel
11 2023-TN9578). Furthermore, a standalone natural-gas fired power plant would hinder Xcel
12 Energy’s ability to comply with the Minnesota Carbon-free standard which requires Xcel Energy
13 to generate, procure sufficient electricity generated from carbon-free energy technology to
14 provide 100 percent of the electric utility’s total retail electric sales to retail customers in
15 Minnesota by 2040, or purchase sufficient renewable energy credits to comply with this carbon-
16 free standard.

17 Based on this information, utility-scale natural gas-fired power generation would not be a
18 reasonable alternative to Monticello’s SLR. However, natural gas-fired power generation, in
19 combination with other carbon-free energy generating technologies, could be a reasonable
20 alternative to Monticello’s SLR, as explained in Section 2.3.2.1.

21 **2.4.9 Petroleum-Fired Power**

22 The variable costs and environmental impacts of petroleum-fired electrical power generation
23 tend to be greater than those of natural gas-fired generation. The historically higher cost of oil
24 also has resulted in a steady decline in its use for electricity generation, and the EIA forecasts
25 no growth in capacity using petroleum-fired power plants through 2040 (DOE/EIA 2013-TN2590,
26 DOE/EIA 2015-TN4585).

27 As stated in its ER, Xcel Energy is proposing to close fossil fuel-fired units to meet its 80 percent
28 carbon reduction goal by 2030. Therefore, based on this information, petroleum-fired electricity
29 generation would not be a reasonable alternative to Monticello’s SLR.

30 **2.4.10 Coal-Fired Power**

31 Although coal has historically been the largest source of electricity in the United States, both
32 natural gas generation and nuclear energy generation surpassed coal generation at the national
33 level in 2020. Coal-fired electricity generation in the United States has continued to decrease as
34 coal-fired units have been retired or converted to use other fuels and as the remaining units
35 have been used less often (DOE/EIA 2021-TN7718).

36 Baseload coal-fired power units have proven their reliability and can routinely sustain capacity
37 factors as high as 85 percent. Among the available technologies, pulverized-coal boilers
38 producing supercritical steam (supercritical pulverized-coal boilers) have become increasingly
39 common, given their generally high thermal efficiencies and overall reliability.

40 Supercritical pulverized-coal facilities are more expensive to build than subcritical coal-fired
41 power plants but consume less fuel per unit output. Integrated gasification combined cycle
42 combines modern coal gasification technology with both gas turbine and steam turbine power

1 generation. The technology is cleaner than conventional pulverized-coal plants because some
2 of the major pollutants are removed before combustion. Although several smaller, integrated
3 gasification combined-cycle power plants have been in operation since the mid-1990s, large
4 scale projects have experienced setbacks, and public opposition has hindered it from being fully
5 integrated into the energy market.

6 As stated in its ER, Xcel Energy is proposing to close fossil fuel-fired units to meet its 80 percent
7 carbon reduction goal by 2030. Based on these considerations, coal-fired power plants would
8 not be a reasonable alternative to Monticello's SLR.

9 **2.4.11 Fuel Cells**

10 Fuel cells oxidize fuels without combustion and, therefore, without the environmental side
11 effects of combustion. Fuel cells use a fuel (e.g., hydrogen) and oxygen to create electricity
12 through an electrochemical process. The only byproducts are heat, water, and carbon dioxide
13 (depending on the hydrogen fuel type) (DOE Undated-TN7695). Hydrogen fuel can come from a
14 variety of hydrocarbon resources, including natural gas. As of October 2020, the United States
15 had only 250 MW of fuel cell power generation capacity (EIA 2022-TN8955).

16 Currently, fuel cells are not economically or technologically competitive with other electricity
17 generating alternatives. The EIA estimates that fuel cells may cost \$6,639 per installed kilowatt
18 (total overnight capital costs in 2021 dollars), which is high compared to other replacement
19 energy alternatives (DOE/EIA 2022-TN7694). In June 2021, DOE launched an initiative to
20 reduce the cost of hydrogen production to spur fuel cell and energy storage development over
21 the next decade (DOE 2021-TN7693). However, it is unclear whether or to what degree this
22 initiative will lead to increased future development and deployment of fuel cell technologies.

23 More importantly, fuel cell units used for power production are likely to be small (approximately
24 10 MW). The world's largest industrial hydrogen fuel cell power plant is a 50 MWe plant in South
25 Korea (Larson 2020-TN8401). Using fuel cells to replace the power that Monticello provides
26 would require the construction of approximately 64 units. Given the limited deployment and high
27 cost of fuel cell technology, fuel cells would not be a reasonable alternative to Monticello's SLR.

28 **2.4.12 Purchased Power**

29 Power may be purchased and imported from outside the region. Although purchased power
30 would likely have little or no measurable impact, environmental impacts could occur where the
31 power is being generated, depending on the technologies used to generate the power.

32 Purchased power is generally economically adverse because, historically, the cost of generating
33 power has been less than the cost of purchasing the same amount of power from a third-party
34 supplier (NRC 2013-TN2654). Purchased power agreements also carry the inherent risk that the
35 supplier may not be able to deliver all the contracted power. Based on these considerations,
36 purchased power would not provide a reasonable alternative to Monticello's SLR.

37 **2.4.13 Delayed Retirement of Other Generating Facilities**

38 Delaying the retirement of a power plant enables it to continue supplying electricity. Because
39 some power generators are required to adhere to regulations requiring significant reductions in
40 power plant emissions, some owners may opt to retire older, less efficient units rather than incur
41 the cost for compliance. Retirements also may be driven by low competing commodity prices

1 (such as low natural gas prices), slow growth in electricity demand, and EPA Mercury and Air
2 Toxics Standards for fossil-fueled power plants (DOE/EIA 2015-TN4585; EPA 2020-TN8379).

3 Xcel Energy has an 80 percent carbon reduction goal by 2030 and has, therefore, proposed to
4 close all coal-fired plants in its service area. Continuing to operate these coal-fired plants would
5 result in increased air quality impacts. Because of these conditions, delayed retirement of older
6 power generating units would not provide a reasonable alternative to the Monticello SLR.

7 **2.4.14 Demand-Side Management**

8 Demand-side management refers to energy conservation and efficiency programs that do not
9 require the addition of new generating capacity. Demand-side management programs can
10 include reducing energy demand through consumer behavioral changes or through altering the
11 characteristics of the electrical load. These programs can be initiated by a utility, transmission
12 operators, the State, or other load serving entities. In general, residential electricity consumers
13 have been responsible for the majority of peak load reductions, and participation in most
14 demand-side management programs is voluntary (NRC 2013-TN2654).

15 The existence of a demand-side management program does not guarantee that reductions in
16 electricity demand will occur. The LR GEIS concludes that, although the energy conservation or
17 energy efficiency potential in the United States is substantial, there have been no cases in
18 which an energy efficiency or conservation program alone has been implemented expressly to
19 replace or offset a large baseload generation station (NRC 2013-TN2654). Therefore, demand-
20 side management programs alone would not be a reasonable alternative to the Monticello SLR.
21 However, in combination with other power generating technologies, demand-side management
22 could be a reasonable alternative to Monticello's SLR.

23 **2.5 Comparison of Alternatives**

24 This chapter presents the following three alternatives to the proposed action (Monticello's SLR):
25 (1) natural gas and renewables, (2) renewables and storage, and (3) new nuclear (SMR).
26 Chapter 3 describes the environmental impacts of the proposed action and the alternatives.
27 Table 2-1 summarizes the environmental impacts of the proposed action (Xcel 2023-TN9084)
28 and the alternatives to SLR considered in this EIS.

29 As discussed in detail in Chapter 3 of this EIS, the environmental impacts of the proposed
30 action (subsequent renewal of the Monticello operating license) would be SMALL for all impact
31 categories except groundwater resources has a SMALL to MODERATE impact. In comparison,
32 each of the three replacement power alternatives has environmental impacts that are greater
33 than the environmental impacts of the proposed subsequent license renewal action. In addition,
34 the replacement energy alternatives would also result in construction impacts. If the NRC does
35 not renew the Monticello operating license (no-action alternative), energy planning decision-
36 makers would have to choose a replacement power alternative like the ones evaluated in this
37 EIS. Based on the review of the replacement energy alternatives, the no-action alternative, and
38 the proposed action, the NRC staff concludes that the environmentally preferred alternative is
39 the proposed SLR action. Therefore, as discussed in Chapter 4 of this EIS, the NRC staff's
40 preliminary recommendation is to renew the Monticello operating license.

1 **Table 2-1 Summary of Environmental Impacts of the Proposed Action and Alternatives**

Impact Area (Resource)	Monticello Subsequent License Renewal (Proposed Action)	No-Action Alternative	Natural Gas and Renewables Alternative	Renewables and Storage Alternative	New Nuclear Alternative (Small Modular Reactor) Alternative
Land Use	SMALL	SMALL	MODERATE to LARGE	MODERATE to LARGE	SMALL to MODERATE
Visual Resources	SMALL	SMALL	SMALL to MODERATE	SMALL to MODERATE	SMALL to MODERATE
Air Quality	SMALL	SMALL	SMALL to MODERATE	SMALL to MODERATE	SMALL
Noise	SMALL	SMALL	SMALL to MODERATE	SMALL to MODERATE	SMALL to MODERATE
Geologic Environment	SMALL	SMALL	SMALL to MODERATE	SMALL to MODERATE	SMALL to MODERATE
Surface Water Resources	SMALL	SMALL	SMALL	SMALL	SMALL to MODERATE
Groundwater Resources	SMALL to MODERATE	SMALL	SMALL	SMALL	SMALL to MODERATE
Terrestrial Resources	SMALL	SMALL	MODERATE to LARGE	MODERATE to LARGE	SMALL to MODERATE
Aquatic Resources	SMALL	SMALL	SMALL to MODERATE	SMALL to MODERATE	SMALL to MODERATE
Special Status Species and Habitats	SEE NOTE ^(a)	SEE NOTE ^(b)	SEE NOTE ^(c)	SEE NOTE ^(c)	SEE NOTE ^(d)
Historic and Cultural Resources	SEE NOTE ^(e)	SEE NOTE ^(f)	SEE NOTE ^(g)	SEE NOTE ^(g)	SEE NOTE ^(g)
Socioeconomics	SMALL	SMALL to LARGE	SMALL to MODERATE	SMALL to MODERATE	SMALL to LARGE
Transportation	SMALL	SMALL	SMALL	SMALL	MODERATE to LARGE
Human Health	SMALL ^(h)	SMALL ^(h)	SMALL ^(h)	SMALL ^(h)	SMALL ^(h)
Environmental Justice	SEE NOTE ⁽ⁱ⁾	SEE NOTE ^(j)	SEE NOTE ^(k)	SEE NOTE ^(k)	SEE NOTE ^(k)
Waste Management	SMALL ^(l)	SMALL ^(l)	SMALL ^(l)	SMALL ^(l)	SMALL ^(l)

(a) May affect but is not likely to adversely affect northern long-eared bat, tricolored bat, whooping crane, and monarch butterfly. No effect on designated critical habitats or essential fish habitat (EFH) or sanctuary resources of National Marine Sanctuaries, because they do not occur within the action area.

(b) Overall, the effects on federally listed species would likely be smaller under the no action alternative than the effects under continued operation but would depend on the specific shutdown activities as well as the listed species present when the no-action alternative is implemented. No effect on designated critical habitats or EFH, because they do not occur within the action area.

1 **Table 2-1 Summary of Environmental Impacts of the Proposed Action and Alternatives**
 2 **(Continued)**

Impact Area (Resource)	Monticello Subsequent License Renewal (Proposed Action)	No-Action Alternative	Natural Gas and Renewables Alternative	Renewables and Storage Alternative	New Nuclear Alternative (Small Modular Reactor) Alternative
(c) The types and magnitudes of adverse impacts to species listed in the Endangered Species Act of 1973 (ESA), as amended (16 U.S.C. 1531 et seq.; TN1010), designated critical habitat, and EFH would depend on the proposed alternative site, as well as listed species and habitats present when the alternative is implemented. Therefore, the NRC staff cannot forecast a level of impact for this alternative.					
(d) The types and magnitudes of adverse impacts to species listed in the ESA, as amended (16 U.S.C. 1531 et seq.; TN1010), designated critical habitat, and EFH would depend on the proposed alternative site, nuclear power plant design and operation, as well as listed species and habitats present when the alternative is implemented. Therefore, the NRC staff cannot forecast a level of impact for this alternative.					
(e) Based on (1) the fact that Xcel Energy does not plan to alter operations, expand existing facilities, or disturb additional land during the subsequent license renewal period, (2) input from consulting parties, and (3) Xcel Energy's updates to procedures to identify, protect, and minimize the potential impact to cultural resources at Monticello, subsequent license renewal would not adversely affect historic properties or historic and cultural resources.					
(f) No immediate effect on historic properties or historic and cultural resources.					
(g) The potential for impacts on historic and cultural resources from construction and operation of the alternative would vary greatly depending on site locations and resources present.					
(h) The chronic effects of electromagnetic fields on human health associated with operating nuclear power and other electricity generating plants are uncertain.					
(i) Disproportionate and adverse human health and environmental effects to minority and low-income populations are not expected.					
(j) Not renewing the operating licenses and terminating reactor operations could have a noticeable impact on socioeconomic conditions in communities near Monticello, and a reduction in tax revenue resulting from nuclear power plant shutdown could decrease the availability of public services. Minority and low-income populations dependent on these services could be disproportionately affected.					
(k) The NRC staff identified common impacts from the construction and operation of replacement power facilities that could disproportionately affect minority and low-income populations. Construction and operations of replacement power alternatives would not likely have disproportionate or adverse human health and environmental effects on minority and low-income populations. However, this determination would depend on site location, nuclear power plant design, operational characteristics of the new facility, unique consumption practices and interactions with the environment of nearby populations, and the location of predominantly minority and low-income populations.					
(l) NUREG-2157, Generic Environmental Impact Statement for Continued Storage of Spent Nuclear Fuel (NRC 2014-TN4117), discusses the environmental impacts of spent fuel storage for the time frame beyond the licensed life for reactor operations.					

1 **3 AFFECTED ENVIRONMENT, ENVIRONMENTAL CONSEQUENCES,**
2 **AND MITIGATING ACTIONS**

3 **3.1 Introduction**

4 In conducting its review of the environmental effects of renewing the Monticello operating
5 license, the NRC staff describes the environment that could be affected by the proposed action
6 (renewing the operating license authorizing an additional 20 years of reactor operation). The
7 NRC staff also evaluates the environmental consequences of the proposed action as well as
8 reasonable alternatives to the proposed action.

9 In this chapter, the affected environment is the environment that currently exists at and around
10 the Monticello site. Because existing conditions are at least partially the result of past
11 construction and nuclear power plant operations, this chapter considers the nature and impacts
12 of past and ongoing operations and evaluates how, together, these actions have shaped the
13 current environment. This chapter also describes reasonably foreseeable environmental trends.
14 The effects of ongoing reactor operations at the site have become well established as
15 environmental conditions have adjusted to the presence of the facility.¹

16 Sections 3.2 through 3.13 describe the affected environment for each resource area, followed
17 by the NRC staff's evaluation of the environmental consequences of the proposed action and
18 alternatives to the proposed action. The NRC staff compares the environmental impacts of
19 license renewal (LR) with those of the no-action alternative and replacement power alternatives
20 to determine whether the adverse environmental impacts of LR are so great that it would be
21 unreasonable to preserve the option for energy-planning decision-makers.

22 The evaluation of environmental consequences includes the following:

- 23 • impacts associated with continued operations during the period of extended operations
- 24 • impacts of the reasonable power replacement alternatives to the proposed action and the
25 no-action alternative (not issuing the renewed licenses)
- 26 • impacts common to all alternatives: (1) fuel cycle including uranium fuel cycle,
27 (2) terminating power plant operations and decommissioning, and (3) greenhouse gas
28 emissions and climate change
- 29 • impacts associated with the uranium fuel cycle
- 30 • impacts of postulated accidents (design-basis accidents and severe accidents)
- 31 • cumulative impacts of the proposed action
- 32 • resource commitments associated with the proposed action, including unavoidable adverse
33 impacts, the relationship between short-term use and long-term productivity, and irreversible
34 and irretrievable commitment of resources
- 35 • new and potentially significant information about environmental issues related to the impacts
36 of operation during the renewal term.

¹ Where appropriate, the NRC staff has summarized referenced information (incorporated information by reference) in this EIS. This allows the staff to focus on new and potentially significant information identified since the initial Monticello EIS was issued in 1990.

1 As stated in Section 1.4 the NRC staff evaluated environmental issues applicable to Monticello's
 2 SLR. Table 3-1 lists the Monticello SLR environmental issues and the impact findings related to
 3 these issues. This EIS considers the environmental impacts of each license renewal issue on a
 4 site-specific basis. Section 1.4 provides the definitions of SMALL, MODERATE, and LARGE
 5 impact significance.

6 **Table 3-1 Summary of Site-Specific Conclusions Regarding Monticello Subsequent**
 7 **License Renewal**

Resource Area	Environmental Issue	Impacts
Land Use	Onsite land use ^(a)	SMALL
Land Use	Offsite land use ^(a)	SMALL
Land Use	Offsite land use in transmission line right-of-ways (ROWs) ^(a)	SMALL
Visual Resources	Aesthetic impacts ^(a)	SMALL
Air Quality	Air quality impacts (all plants) ^(a)	SMALL
Air Quality	Air quality effects of transmission lines ^(a)	SMALL
Noise	Noise impacts ^(a)	SMALL
Geologic Environment	Geology and soils ^(a)	SMALL
Surface Water Resources	Surface water use and quality (non-cooling system impacts) ^(a)	SMALL
Surface Water Resources	Altered current patterns at intake and discharge structures ^(a)	SMALL
Surface Water Resources	Scouring caused by discharged cooling water ^(a)	SMALL
Surface Water Resources	Discharge of metals in cooling system effluent ^(a)	SMALL
Surface Water Resources	Discharge of biocides, sanitary wastes, and minor chemical spills ^(a)	SMALL
Surface Water Resources	Surface water use conflicts (plants with once-through cooling systems) ^(a)	SMALL
Surface Water Resources	Effects of dredging on surface water quality ^(a)	SMALL
Surface Water Resources	Temperature effects on sediment transport capacity ^(a)	SMALL
Groundwater Resources	Groundwater contamination and use (non-cooling system impacts) ^(a)	SMALL
Groundwater Resources	Groundwater use conflicts (plants that withdraw more than 100 gallons per minute [gpm])	SMALL
Groundwater Resources	Groundwater use conflicts (plants with closed-cycle cooling systems that withdraw makeup water from a river)	SMALL
Groundwater Resources	Radionuclides released to groundwater	SMALL to MODERATE
Terrestrial Resources	Effects on terrestrial resources (non-cooling system impacts)	SMALL
Terrestrial Resources	Exposure of terrestrial organisms to radionuclides ^(a)	SMALL
Terrestrial Resources	Cooling system impacts on terrestrial resources (plants with once-through cooling systems or cooling ponds) ^(a)	SMALL

8

Table 3-1 Summary of Site-Specific Conclusions Regarding Monticello Subsequent License Renewal (Continued)

Resource Area	Environmental Issue	Impacts
Terrestrial Resources	Cooling tower impacts on vegetation (plants with cooling towers) ^(a)	SMALL
Terrestrial Resources	Bird collisions with plant structures and transmission lines ^(a)	SMALL
Terrestrial Resources	Water use conflicts with terrestrial resources (plants with cooling ponds or cooling towers using makeup water from a river)	SMALL
Terrestrial Resources	Transmission line right-of-way (ROW) management impacts on terrestrial resources ^(a)	SMALL
Terrestrial Resources	Electromagnetic fields on flora and fauna (plants, agricultural crops, honeybees, wildlife, livestock) ^(a)	SMALL
Aquatic Resources	Impingement and entrainment of aquatic organisms (plants with once-through cooling systems or cooling ponds)	SMALL
Aquatic Resources	Entrainment of phytoplankton and zooplankton (all plants) ^(a)	SMALL
Aquatic Resources	Thermal impacts on aquatic organisms (plants with once-through cooling systems or cooling ponds)	SMALL
Aquatic Resources	Infrequently reported thermal impacts (all plants) ^(a)	SMALL
Aquatic Resources	Effects of cooling water discharge on dissolved oxygen, gas supersaturation, and eutrophication ^(a)	SMALL
Aquatic Resources	Effects of nonradiological contaminants on aquatic organisms ^(a)	SMALL
Aquatic Resources	Exposure of aquatic organisms to radionuclides ^(a)	SMALL
Aquatic Resources	Effects of dredging on aquatic organisms ^(a)	SMALL
Aquatic Resources	Water use conflicts with aquatic resources (plants with cooling ponds or cooling towers using makeup water from a river)	SMALL
Aquatic Resources	Effects on aquatic resources (non-cooling system impacts) ^(a)	SMALL
Aquatic Resources	Impacts of transmission line right-of-way (ROW) management on aquatic resources ^(a)	SMALL
Aquatic Resources	Losses from predation, parasitism, and disease among organisms exposed to sublethal stresses ^(a)	SMALL
Special Status Species and Habitats	Threatened, endangered, and protected species and essential fish habitat	May affect but is not likely to adversely affect the northern long-eared bat, tricolored bat, whooping crane, and monarch butterfly; no effect on essential fish habitat; no effect on sanctuary resources of National Marine Sanctuaries

Table 3-1 Summary of Site-Specific Conclusions Regarding Monticello Subsequent License Renewal (Continued)

Resource Area	Environmental Issue	Impacts
Historic and Cultural Resources	Historic and cultural resources	Would not adversely affect known historic properties or historic and cultural resources
Socioeconomics	Employment and income, recreation, and tourism ^(a)	SMALL
Socioeconomics	Tax revenues ^(a)	SMALL
Socioeconomics	Community services and education ^(a)	SMALL
Socioeconomics	Population and housing ^(a)	SMALL
Socioeconomics	Transportation ^(a)	SMALL
Human Health	Radiation exposures to the public ^(a)	SMALL
Human Health	Radiation exposures to plant workers ^(a)	SMALL
Human Health	Human health impact from chemicals ^(a)	SMALL
Human Health	Microbiological hazards to the public (plants with cooling ponds or canals or cooling towers that discharge to a river)	SMALL
Human Health	Microbiological hazards to plant workers ^(a)	SMALL
Human Health	Chronic effects of electromagnetic fields (EMFs)	Uncertain impact
Human Health	Physical occupational hazards ^(a)	SMALL
Human Health	Electric shock hazards	SMALL
Postulated Accidents	Design-basis accidents ^(a)	SMALL
Postulated Accidents	Severe accidents	See EIS Appendix F
Environmental Justice	Minority and low-income populations	No disproportionate and adverse human health and environmental effects on minority and low-income populations
Waste Management	Low-level waste storage and disposal ^(a)	SMALL
Waste Management	Onsite storage of spent nuclear fuel ^(a)	SMALL
Waste Management	Offsite radiological impacts of spent nuclear fuel and high-level waste disposal ^(a)	^(b)
Waste Management	Mixed-waste storage and disposal ^(a)	SMALL
Waste Management	Nonradioactive waste storage and disposal ^(a)	SMALL
Cumulative Impacts	Cumulative impacts	See EIS Section 3.15
Uranium Fuel Cycle	Offsite radiological impacts—individual impacts from other than the disposal of spent fuel and high-level waste ^(a)	SMALL
Uranium Fuel Cycle	Offsite radiological impacts—collective impacts from other than the disposal of spent fuel and high-level waste ^(a)	^(c)
Uranium Fuel Cycle	Nonradiological impacts of the uranium fuel cycle ^(a)	SMALL
Uranium Fuel Cycle	Transportation ^(a)	SMALL

Table 3-1 Summary of Site-Specific Conclusions Regarding Monticello Subsequent License Renewal (Continued)

Resource Area	Environmental Issue	Impacts
Termination of Nuclear Power Plant Operations and Decommissioning	Termination of plant operations and decommissioning ^(a)	SMALL

EIS = environmental impact statement; EMF = electromagnetic fields; gpm = gallon(s) per minute; gps = gallon(s) per minute; ROW = right-of-way; SAMA = severe accident mitigation alternatives.

(a) Dispositioned as generic (Category 1) for initial license renewal of nuclear power plants in Table B-1 in Appendix B to Subpart A of Title 10 CFR Part 51 (TN250).

(b) The ultimate disposal of spent fuel in a potential future geologic repository is a separate and independent licensing action that is outside the regulatory scope of this site-specific review. Per 10 CFR Part 51 (TN250) Subpart A the Commission concludes that the impacts presented in NUREG-2157 (NRC 2014-TN4117) would not be sufficiently large to require the NEPA conclusion, for any plant, that the option of extended operation under 10 CFR Part 54 (TN4878) should be eliminated. Accordingly, while the Commission has not assigned a single level of significance for the impacts of spent nuclear fuel and high-level waste disposal, this issue is considered generic to all nuclear power plants and does not warrant a site-specific analysis.

(c) There are no regulatory limits applicable to collective doses to the general public from fuel-cycle facilities. The practice of estimating health effects on the basis of collective doses may not be meaningful. All fuel-cycle facilities are designed and operated to meet the applicable regulatory limits and standards. As stated in the 2013 LR GEIS, "The Commission concludes that these impacts are acceptable in that these impacts would not be sufficiently large to require the NEPA conclusion, for any plant, that the option of extended operation under 10 CFR Part 54 (TN4878) should be eliminated" (10 CFR Part 54-TN4878) (Section 3.13.3.3 of this EIS).

1 **3.2 Land Use and Visual Resources**

2 This section describes land use and visual resources in the vicinity of the Monticello site as well
 3 as the potential impacts from the proposed action of SLR and alternatives to the proposed
 4 action. Section E3.2 of Xcel Energy's ER (Xcel 2023-TN9084) describes current Monticello
 5 onsite and offsite land use conditions as well as visual resources.

6 **3.2.1 Land Use**

7 The Monticello site is located in central Minnesota on approximately 2,000 ac (809 ha) divided
 8 by the Mississippi River. The part of the site on the south bank of the river lies in Wright County,
 9 Minnesota and the part of the site on the north bank lies in Sherburne County, Minnesota. The
 10 nearest community is the city of Monticello, Minnesota, which according to the 2020 census has
 11 a population of 14,455. Both Sherburne and Wright Counties lie within the Minneapolis-St. Paul-
 12 Bloomington metropolitan statistical area.

13 The sections below describe onsite and offsite land use within a 6 mi (10 km) radius and also
 14 describe the Minnesota coastal zone and the regulations that govern its use.

15 **3.2.1.1 Onsite Land Use**

16 Although the Monticello site occupies approximately 2,000 ac (809 ha), the nuclear power plant
 17 structures occupy only about 50 ac (20 ha) of the site and is entirely located within the city limits
 18 of Monticello, Minnesota. Much of the 2,000 ac (809 ha) Monticello site is undeveloped, but
 19 portions are leased for agricultural and recreational use. As shown in Table 3-2, the
 20 predominant land cover at the Monticello site is deciduous forest (35 percent), cultivated
 21 cropland (18 percent), pasture (13 percent), and open water (14 percent). Approximately
 22 10.6 percent of the site is developed for industrial power plant use.

1 **Table 3-2 Land Use/Land Cover, Monticello Nuclear Generating Plant Site**

Category	Acres	Percentage
Open Water	284.4	13.9
Developed, Open Space	25.8	1.3
Developed, Low Intensity	58.9	2.9
Developed, Medium Intensity	77.4	3.8
Developed, High Intensity	54.3	2.6
Deciduous Forest	714.8	34.9
Evergreen Forest	16.9	0.8
Mixed Forest	2.7	0.1
Shrub/Scrub	8.2	0.4
Grassland/Herbaceous	32	1.6
Pasture/Hay	266	13
Cultivated Crops	373.6	18.2
Woody Wetlands	90.3	4.4
Emergent Herbaceous Wetlands	45.6	2.2
Total	2,050.9	100

Source: Xcel 2023-TN9084.

2 The City of Monticello has zoned the Monticello site as a “heavy industrial district (I-2)” for heavy
 3 industry and manufacturing away from residential or commercial land use. Access to the
 4 Monticello site is on County Road 75 NE, which runs parallel to Interstate 94 through the City of
 5 Monticello. The Monticello site also is served by a Burlington Northern Santa Fe railroad track
 6 spur that connects approximately 2,000 ft (610 m) south of the site. Although the site is located
 7 on the banks of the Mississippi River, the nearest navigable port is in Minneapolis, which is
 8 approximately 40 mi (64 km) to the southeast.

9 **3.2.1.2 Coastal Zone**

10 Section 307(c)(3)(A) of the Coastal Zone Management Act of 1972, as amended (16 U.S.C.
 11 1456(c)(3)(A)) (TN1243) requires that applicants for Federal licenses who conduct activities in a
 12 coastal zone provide a certification to the licensing agency (in this case the NRC) that the
 13 proposed activity complies with the enforceable policies of the State’s coastal zone program.
 14 The Federal regulations that implement the Coastal Zone Management Act indicate that this
 15 requirement is applicable to renewal of Federal licenses for actions not previously reviewed by
 16 the State (15 CFR 930.51(b)(1)) (TN4475).

17 The State of Minnesota’s Lake Superior Coastal Program was established in 1999 and
 18 comprises the counties in Minnesota’s Coastal Zone Management Program. It touches 189 mi
 19 (304 km) of shoreline along Minnesota’s north shore of Lake Superior and includes 31 local
 20 government units. Wright and Sherburne counties (which include the Monticello site are not
 21 within this area, and therefore, the Coastal Zone Management Act does not apply to the
 22 Monticello site or this SLR application.

23 **3.2.1.3 Offsite Land Use**

24 The Monticello site is in Wright and Sherburne counties, Minnesota. The predominant land
 25 covers within the 6 mi (9.7 km) radius of Monticello are cultivated crops (35 percent), deciduous
 26 forest (15 percent), pasture/hay (13 percent), wetlands (9 percent), and open water (6 percent)
 27 (NRC 2023-TN9084).

1 Wright County is approximately 423,000 ac (171,182 ha), of which 240,651 ac (97,388 ha)
2 (57 percent) is farmland. Sherburne County is approximately 277,000 ac (112,097 ha), of which
3 102,544 ac (41498 ha) (37 percent) is farmland. Wright County has a total of 1,338 farms and
4 Sherburne County has a total of 501 farms. Agricultural uses of farmland in these two counties
5 include crop production, pastures, and rangeland for livestock.

6 Wright and Sherburne Counties, along with the City of Monticello, have comprehensive land use
7 plans establishing “standards, regulations, and goals for future land development.” The City of
8 Monticello Comprehensive Plan was adopted on November 23, 2020, with a focus on providing
9 a 20-year strategic land use approach. The Comprehensive Plan designates Monticello as a
10 “special facility and land use with unique operational characteristics warranting a special
11 designation for long-term planning purpose.” This designation “is intended to safeguard the
12 operation of the facility so that it continues to provide essential utility services that contribute to
13 the local and regional economies.” Wright County’s comprehensive land use plan was adopted
14 in 1988, and was updated by designating three different geographic areas within the county
15 (Wright County Undated-TN9692). The Monticello site is located within the northeast quadrant
16 of Wright County. The Northeast Quadrant adopted its own quadrant specific land use plan in
17 2007 (Wright County Office of Planning and Zoning 2007-TN9693). A primary focus of this land
18 use plan includes urbanization, with substantial population growth. Sherburne County’s latest
19 comprehensive land use plan was adopted in 2011. A primary focus of the Sherburne County
20 comprehensive plan includes growth management to promote development while preserving
21 natural and agricultural resources.

22 In May 2023, Xcel Energy broke ground on a new 460 MW solar facility north of Monticello on
23 approximately 3,500 ac (1,416 ha) in Sherburne County, on agricultural land currently used for
24 cultivated crops. When completed, the Sherco Solar Project will be the fifth largest solar facility
25 in the nation. Building the facility will create 900 temporary construction jobs.

26 **3.2.2 Visual Resources**

27 As noted in Section 3.2.1, the 2,000 ac (809 ha) Monticello site is located on the Mississippi
28 River in central Minnesota. Visual features include the reactor, turbine, radiological waste
29 building, and emergency diesel generator buildings; off-gas stack, MDCTs and the associated
30 water vapor plume, and transmission lines. The tallest structure is the 328 ft (100 m) high
31 off-gas stack. As only portions of the plant structures are visible from surrounding areas such as
32 I-94, service roads, and the Mississippi River, the visual impacts of the Monticello site are
33 minimal.

34 **3.2.3 Proposed Action**

35 The following sections address the site-specific environmental impacts of the Monticello SLR on
36 environmental issues related to land use and visual resources.

37 *3.2.3.1 Onsite Land Use*

38 Operational activities during the SLR term would be similar to those already occurring at
39 Monticello. Industrial land use conditions would continue unchanged. However, Xcel Energy has
40 stated in its ER that Monticello will run out of dry storage capacity in 2030, therefore Xcel
41 Energy must expand the dry storage capacity by constructing a second pad in the fenced
42 ISFSI area to store spent nuclear fuel generated during SLR term. No new land would be
43 needed or disturbed outside of the fenced ISFSI area for construction of the second pad

1 (Xcel 2023-TN9084). If the ISFSI pad needs to be expanded, previously disturbed land near the
2 ISFSI is likely to be sufficient for the expansion with no significant environmental impact. Based
3 on this information, the NRC staff concludes that the impact of continued nuclear power plant
4 operations on onsite land use during the Monticello SLR term would be SMALL. In addition, the
5 NRC staff did not identify any new onsite land use information that would alter this conclusion.

6 3.2.3.2 *Offsite Land Use*

7 License renewal and subsequent license renewal activities have little to no effect on offsite land
8 use in communities near nuclear power plants. Operational activities during the SLR term,
9 including periodic nuclear refueling outages requiring temporary staff, would be similar to those
10 already occurring at the plant and would not affect offsite land use beyond what has already
11 been affected. Based on this information, the NRC staff concludes that the impact of continued
12 nuclear power plant operations on offsite land use during the Monticello SLR term would be
13 SMALL. In addition, the NRC staff did not identify any new offsite land use information that
14 would alter this conclusion.

15 3.2.3.3 *Offsite Land Use in Transmission Line Right-of-Ways*

16 Maintenance activities in transmission line rights-of-way (ROWs) during the subsequent license
17 renewal term would be the same as or similar to those already occurring and would not affect
18 offsite land use beyond what has already been affected. Transmission line ROWs do not
19 preclude the use of the land for other purposes, such as agriculture and recreation. However,
20 land use is limited to activities that do not endanger power line operation.

21 Based on this information, the NRC staff concludes that the impact of continued nuclear power
22 plant operations during the Monticello SLR term on offsite land use in transmission line ROWs
23 would be SMALL. In addition, the NRC staff did not identify any new land use information that
24 would alter this conclusion.

25 3.2.3.4 *Visual Resources*

26 The visual appearance of the Monticello nuclear power plant structures and associated
27 transmission lines has become well established over the plant's operating history and is not likely
28 to change during the SLR term. The NRC staff concludes that the visual impact of continued
29 nuclear power plant operations at Monticello during the SLR term would be SMALL because the
30 visual appearance of nuclear power plant structures, transmission lines, and vapor plume from
31 the cooling towers will not change appreciably. In addition, the NRC staff did not identify any
32 new information during the environmental review that would alter this conclusion.

33 **3.2.4 No-Action Alternative**

34 3.2.4.1 *Land Use*

35 Under the no-action alternative, the NRC would not issue a renewed Monticello operating
36 license, and reactor power generating operations would cease on or before the expiration of the
37 current renewed license. However, maintenance activities (e.g., maintaining, inspecting, and
38 testing plant equipment) would continue before and after the expiration of the license.
39 Decommissioning activities would begin after the expiration of the license. Under this
40 alternative, onsite land use would remain similar to onsite land use under the proposed SLR.

1 Plant structures and other facilities would remain in place until decommissioning. Transmission
2 lines and ROWs would remain in place after the cessation of reactor operations.

3 Shutdown of Monticello would not affect land use. Based on this information, the NRC staff
4 concludes that land use impacts under the no-action alternative would be SMALL.

5 **3.2.4.2 Visual Resources**

6 Termination of reactor operations because the operating license is not renewed under the no-
7 action alternative would not immediately change the visual appearance of the Monticello site.
8 The most visible structures are the reactor containment and other buildings, and they would
9 likely remain in place for some time during decommissioning until they are eventually
10 dismantled. There would be no further operational impacts such as the vapor plumes associated
11 with the cooling towers. As a result, the NRC staff concludes that the visual impacts from the
12 no-action alternative would be SMALL.

13 **3.2.5 Replacement Power Alternatives: Common Impacts**

14 **3.2.5.1 Land Use**

15 Land use impacts are determined by the change in use and the amount of land affected by the
16 construction and operation of a replacement power generating facility, infrastructure, and other
17 installations. Table 3-3 summarizes land use impacts of replacement power alternatives. In
18 addition, Minnesota Statute 216B.243, Subdivision 3b (TN9184), prohibits the construction and
19 operation of new nuclear power plants in Minnesota. This means that new nuclear alternatives
20 cannot be located on the Monticello site or in the State of Minnesota.

21 **Table 3-3 Land Use Impacts of Replacement Power Alternatives**

Alternative	Resource Requirements	Impacts	Discussion
Natural Gas and Renewables	Up to 80 ac (32.4 ha) for natural gas-fired power units. In addition, up to 25 mi (40.2 km) of two new 345 kV transmission lines in a 150 ft (45.7 m) wide corridor would be needed to transmit power from each combustion turbine unit to the electrical grid, or an additional 900 ac (364.2 ha).	MODERATE to LARGE	Natural gas-fired combustion turbine units could be co-located or installed separately at existing power plant or greenfield sites. The natural gas-fired combustion turbine power plant could be constructed onsite or offsite in the ROI for the Xcel Energy service area. Based on an estimate of 20-40 ac necessary for each combustion turbine unit (Leidos 2016-TN9183),
Natural Gas and Renewables	Approximately 1,500 ac (607 ha) for solar panels. In addition, up to 25 mi (40.2 km) of one to three new 345 kV transmission lines in a 150 ft (45.7 m) wide corridor would be needed to transmit power to the electrical grid, or an additional 1,450 ac (586.8 ha).	MODERATE to LARGE	Solar panels could be installed both on the Monticello site and offsite either elsewhere in Minnesota or in the ROI. Xcel Energy estimates that the solar component would encompass as many as three different project sites. Based on land requirements for a nearby solar project, Xcel Energy estimates that solar installations would require 7.6 ac per MW.

1 **Table 3-3 Land Use Impacts of Replacement Power Alternatives (Continued)**

Alternative	Resource Requirements	Impacts	Discussion
Natural Gas and Renewables	Approximately 66,000 ac (26,709.3 ha) for wind turbines. Xcel Energy estimates up to 150 mi (241.4 km) of new 345 kV transmission lines in a 150 ft (45.7 m) wide corridor would be needed to transmit power to the electrical grid, or an additional 2,700 ac (1,092.7 ha).	MODERATE to LARGE	Wind turbines would be installed offsite within Minnesota or the ROI. DOE estimates that wind power uses 85 ac per MW for wind farms, 2.47 ac (1 ha) per MW for construction footprint, and 0.74 ac (0.3 ha) per MW for permanent structures.
Renewables and Storage	Approximately 5,300 ac (2,144.8 ha) for solar panels. In addition, up to 25 mi (40.2 km) of one to ten new 345 kV transmission lines in a 150 ft (45.7 m) wide corridor would be needed to transmit power to the electrical grid, or an additional 4,500 ac (1,821.1 ha).	MODERATE to LARGE	Xcel Energy estimates that solar panels would be installed at as many as three different project sites. Based on land requirements for a nearby solar project, Xcel Energy estimates that solar installations would require approximately 7.6 ac (3.1 ha) per MW.
Renewables and Storage	Approximately 84,000 ac (33,993.6 ha) for wind turbines. Xcel Energy estimates up to 150 mi (241.4 km) of new 345 kV transmission lines in a 150 ft (45.7 m) wide corridor would be necessary to transmit power to the electrical grid, or an additional 2,700 ac (1,092.7 ha).	MODERATE to LARGE	Wind turbines would be installed offsite within Minnesota or the ROI. DOE estimates that wind power uses 85 ac (34.4 ha) per MW for wind farms, 2.47 ac (1 ha) per MW for construction footprint, and 0.74 ac (0.3 ha) per MW for permanent structures.
New Nuclear (SMR)	Up to 130 ac (52.6 ha) for a SMR nuclear power plant. Xcel Energy estimates up to 25 mi (40.2 km) of new 345 kV transmission lines in a 150 ft (45.7 m) wide corridor would be needed to transmit power to the electrical grid, or an additional 450 ac (182.1 ha).	SMALL to MODERATE	The SMR plant would be constructed and installed outside of Minnesota in one of the other seven states in the Xcel Energy's service area. The SMR power plant would be constructed within 25 mi (40.2 km) of a transmission grid with sufficient surface water to support the power plant cooling system and water use.

ac = acre(s); DOE = Department of Energy; ft = foot/feet; kV = kilovolt(s); mi = mile(s); MW = megawatt(s); ROI = region of influence; SMR = small modular reactor.

2 Construction

3 Construction of a replacement power facility would require the permanent commitment of land
 4 designated for industrial use and in addition, depending on the chosen site(s) of the
 5 replacement power alternatives, up to 150 mi (241.4 km) of new transmission lines in a 150 ft
 6 (0.3 m) wide transmission line corridor.

1 Operations

2 Operation of new power generating facilities would have no land use impacts beyond land
3 committed for the permanent use of the replacement power plant. Additional land may be
4 required to support power plant operations, including land for the mining, extraction, and waste
5 disposal activities associated with each alternative.

6 3.2.5.2 *Visual Resources*

7 Visual impacts are determined by the degree of contrast between the replacement power
8 generating facility and the surrounding landscape and the visibility of the new power plant.

9 Construction

10 Installation of power generating facilities and support structures at existing power plant sites
11 would be consistent with visual character of the industrial site. Land for any replacement energy
12 generating facility would require clearing, excavation, and the use of construction equipment.
13 Temporary visual impacts may occur during construction because of the use of cranes and
14 other construction equipment. If most of the components of this alternative are constructed at
15 existing power plant sites, new visual impacts may be minimal. However, construction at
16 greenfield sites may present new visual impacts. Construction of new wind turbines would likely
17 be visible across a large area regardless of their location. The tallest structure associated with
18 the SMR is the containment structure, up to 76 ft (23.2 m) in height. As such, the NRC staff
19 concludes that construction and installation of each of the replacement power alternatives would
20 have a SMALL to MODERATE visual impact.

21 Operations

22 Visual impacts during power plant operations of any of the replacement energy alternatives
23 would be similar in type and magnitude. Combustion and wind turbines would be tall enough
24 and solar panels could be seen off-site from a distance, depending on screening vegetation.
25 Transmission lines would be visible, unless screened. Vapor plumes from alternatives using
26 cooling towers would be the most noticeable visual impact and would likely be visible farther
27 from the site than other buildings and infrastructure. Aircraft warning lights on power plant
28 stacks, towers, or wind turbines would be visible at night. After completing construction and
29 installation, the NRC staff concludes that power plant operations for each of the replacement
30 power alternatives would have a SMALL visual impact.

31 **3.3 Meteorology, Air Quality, and Noise**

32 **3.3.1 Meteorology and Climatology**

33 Minnesota's climate is continental characterized by humid summers and frigid winters, and large
34 temperature variations across the seasons. The climate is influenced by cold air masses from
35 the Arctic in the winter, and humid air masses from the Gulf of Mexico in the summer. Winters
36 are cold in the south and frigid in the north, and summers are mild to occasionally hot in the
37 south and cool in the north. Minnesota's location between the humid climate of the eastern
38 United States and semiarid climate of the Great Plains creates large differences in average
39 precipitation across the state. Annual average precipitation (from 1985 to 2020) ranges
40 from 23 in. (58.4 cm) in the northwest to more than 35 in. (88.9 cm) in the southeast
41 (NOAA 2022-TN9565).

1 The NRC staff obtained climatological data from the St. Cloud, Minnesota, weather station.
2 This station is approximately 35 mi (56 km) from Monticello, and its data are used to
3 characterize the region’s climate because of its relative location and long period of record.
4 Xcel Energy also maintains a meteorological monitoring system comprised of two
5 meteorological towers. The primary tower is located southeast of Unit 1 and measures wind
6 speed and direction, ambient air temperatures, precipitation, and dewpoint/relative humidity.
7 The backup meteorological tower is located near the training center and measures wind speed
8 and wind direction. In its ER, Xcel Energy provided meteorological observations from the
9 meteorological monitoring system for the 1991–2020 period. However, due to data system
10 issues, only 22 years of data for this 30-year period of record is complete and available.

11 The mean annual temperature for the 125-year period of record (1897–2022) at the St. Cloud
12 weather station is 42°F (5.5°C), with mean monthly temperature ranging from a low of 10°F
13 (-12.2°C) in January and a high of 70.8°F (21.5°C) in July (NOAA 2024-TN9623). The mean
14 annual temperature from the Monticello onsite meteorological tower is 44.9°F (7.2°C) with a
15 mean monthly ranging from a low of 15.2°F (-9.3°C) in January and a high of 71.8°F (22.1°C) in
16 July (Xcel 2023-TN9084).

17 The average annual total precipitation for the 128-year period of record (1894–2022) at the
18 St. Cloud weather station is 27.1 in (68.8 cm), with a mean monthly precipitation ranging from a
19 low of 0.70 in (1.8 cm) in February and a high of 4.24 in (10.8 in) in June (NOAA 2024-TN9623).
20 The mean annual total precipitation from Monticello’s onsite meteorological tower is 31.2 in.
21 (79.2 cm), with a mean monthly precipitation ranging from a low of 0.7 in (1.8 cm) in February
22 and a high of 4.6 in (11.7 cm) in August (Xcel 2023-TN9084).

23 The mean annual wind speed for the 39-year period of record at the St. Cloud weather station is
24 8.2 mph (13.1 km/hr) with prevailing winds from the northwest (NOAA 2024-TN9623). The mean
25 annual wind speed from Monticello’s onsite meteorological tower is 6.1 mph (9.8 km/hr), with
26 prevailing wind from the northwest (Xcel 2023-TN9084).

27 Minnesota is subject to extreme weather events. The following number of severe weather
28 events have been reported in Wright and Sherburne County from January 1, 1950 through May
29 31, 2023 (NOAA NCEI 2023-TN9566):

- 30 • tornados: 39 events
- 31 • floods: 10 events
- 32 • blizzards: 5 events

33 **3.3.2 Air Quality**

34 The EPA has set primary and secondary National Ambient Air Quality Standards (NAAQS
35 40 CFR Part 50, “National Primary and Secondary Ambient Air Quality Standards” TN1089) for
36 six common criteria pollutants to protect sensitive populations and the environment. The
37 NAAQS criteria pollutants include carbon monoxide (CO), lead (Pb), nitrogen dioxide (NO₂),
38 ozone (O₃), sulfur dioxide (SO₂), and particulate matter (PM). PM is further categorized by
39 size—PM₁₀ (diameter of 10 micrometers [µm] or less) and PM_{2.5} (diameter of 2.5 µm or less).

40 The EPA designates areas of attainment and nonattainment with respect to meeting NAAQS.
41 Areas for which there are insufficient data to determine attainment or nonattainment are
42 designated as unclassifiable. Areas that were once in nonattainment, but are now in attainment,
43 are called maintenance areas; these areas are under a 10-year monitoring plan to maintain their

1 attainment designation status. States have primary responsibility for ensuring attainment and
 2 maintenance of the NAAQS. Under CAA Section 110 (42 U.S.C. 7410) (Clean Air Act-TN1141)
 3 and related provisions, States are to submit, for EPA approval, State implementation plans
 4 (SIPs) that provide for the timely attainment and maintenance of the NAAQS.

5 In Minnesota, air quality designations are made at the county level. For planning and
 6 maintaining ambient air quality with respect to NAAQS, EPA has developed air quality control
 7 regions (AQCRs). AQCRs are intrastate or interstate areas that share a common airshed.
 8 Monticello is located in Wright and Sherburne counties, which is part of the Central Minnesota
 9 AQCR (40 CFR 81.243 TN7226). With respect to NAAQS, EPA designates Wright County a
 10 maintenance area with respect to carbon monoxide and in attainment for other NAAQS;
 11 Sherburne County is in attainment for all NAAQS (EPA 2023-TN9567).

12 The Minnesota Pollution Control Agency (MPCA) regulates air emissions at Monticello under
 13 an air permit. MPCA issued its most recent air emissions permit, Permit No. 17100019-004, to
 14 Xcel Energy on November 15, 2013, authorizing the operation of air emissions sources at
 15 Monticello. Monticello’s permitted air emissions are listed in Table 3-4. In addition to the
 16 permitted air emission sources listed in Table 3-4, Monticello also has two MDCTs onsite.
 17 However, there is no requirement to include particulate air emissions from the cooling towers in
 18 the site’s air permit (Xcel 2023-TN9084). Monticello’s air permit expired on November 15, 2018,
 19 however, Xcel Energy applied to renew the permit over 180 days prior to its expiration (Xcel
 20 2023-TN9084). The air permit has been administratively extended and therefore remains in
 21 effect pending MPCA review and approval of the renewal application.

22 **Table 3-4 Permitted Air Emission Sources at Monticello Nuclear Generating Plant**

Emission Source	Permit Conditions
One heating boiler	Burn distillate fuel oil only. Fuel sulfur content less than or equal to 0.3 percent by weight Total particulate matter: less than or equal to 0.40 pounds/million British thermal units
Four diesel generators	Fuel type: Distillate fuel oil Sulfur content of fuel: less than or equal to 0.49 percent by weight
One fire pump diesel engine	Fuel type: Distillate fuel oil Sulfur content of fuel: less than or equal to 0.49 percent by weight
Three flexible diesel fired engine pumps	Fuel type: Distillate fuel CO: less than or equal to 5.0 grams/kilowatt-hour Total particulate matter: less than or equal 0.30 grams/kilowatt-hour NMHC + NO _x : less than or equal to 4.0 grams/kilowatt-hour. SO ₂ : less than or equal to 0.5 pounds/million British thermal units

NMHC = non-methane hydrocarbon(s); NO_x = nitrogen oxide(s).
 Source: MPCA 2023-TN9624.

23 Xcel Energy reports that it has not received any notices of violation (NOV) of non-compliance
 24 associated with Monticello’s air emissions permit between 2017–2022 (Xcel 2023-TN9084 and
 25 XCEL 2023- TN9578). The NRC staff’s review of EPA’s Enforcement and Compliance History
 26 Online system 3-year compliance history (October 2021–September 2023) revealed no NOV’s
 27 (EPA ECHO 2022-TN9568).

28 The EPA promulgated the Regional Haze Rule to improve and protect visibility in national parks
 29 and wilderness areas from haze, which is caused by numerous, diverse air pollutant sources
 30 located across a broad region (40 CFR Part 51-TN1090). Specifically, 40 CFR 81 Subpart D
 31 (TN7226), “Identification of Mandatory Class I Federal Areas Where Visibility Is an Important

1 Value,” lists mandatory Federal areas where visibility is an important value. The Regional Haze
2 Rule requires states to develop State Implementation Plans to reduce visibility impairment at
3 Class I Federal Areas. There are no Class 1 Federal Areas within 100 mi (160 km) of the
4 Monticello site.

5 **3.3.3 Noise**

6 Noise is unwanted sound and can be generated by many sources. Sound intensity is measured
7 in logarithmic units called decibels (dB). A dB is the ratio of the measured sound pressure level
8 to a reference level equal to a normal person’s threshold of hearing. Most people barely notice a
9 difference of 3 dB or less. Another characteristic of sound is frequency or pitch. Noise may be
10 composed of many frequencies, but the human ear does not hear very low or very high
11 frequencies. To represent noise as closely as possible to the noise levels people experience,
12 sounds are measured using a frequency-weighting scheme known as the A-scale. Sound levels
13 measured on this A-scale are given in units of A-weighted decibels (dBA). Levels can become
14 annoying at 80 dBA and very annoying at 90 dBA. To the human ear, each increase of 10 dBA
15 sounds twice as loud (EPA 1981-TN7412).

16 Several different terms are commonly used to describe sounds that vary in intensity over time.
17 The equivalent sound intensity level (Leq) represents the average sound intensity level over a
18 specified interval, often 1 hour. The day-night sound intensity level (LDN) is a single value
19 calculated from hourly Leq during a 24-hour period, with the addition of 10 dBA to sound levels
20 from 10 p.m. to 7 a.m. This addition accounts for the greater sensitivity of most people to
21 nighttime noise. Statistical sound level (Ln) is the sound level that is exceeded n Percent of the
22 time during a given period. For example, L90, is the sound level exceeded 90 percent of time
23 and is considered the background level.

24 Primary offsite noise sources in the vicinity of Monticello are associated with vehicular traffic,
25 boating access, and seasonal use of the river (Xcel 2023-TN9084). The nearest resident
26 (measured from the reactor building) is located approximately 0.52 mi (0.83 km). Primary noise
27 sources at Monticello include the firing range and emergency diesel generators. The emergency
28 diesel generators are tested monthly and reach noise levels of 101–103 dBA. Between 2017
29 and 2022, Xcel Energy has not received noise complaints because of operation of Monticello
30 (Xcel 2023-TN9084 and Xcel 2023-TN9578).

31 **3.3.4 Proposed Action**

32 *3.3.4.1 Air Quality Impacts*

33 The ambient air quality in the vicinity of Monticello is described in Section 3.3.2. Impacts on air
34 quality during normal plant operations can result from operations of fossil-fuel fired equipment
35 needed for various plant functions. Monticello’s permitted air emission sources are presented in
36 Table 3-4. Table 3-5 presents Monticello’s annual air emissions from 2017–2021. Table 3-5
37 presents 2020 annual air emissions from Wright and Sherburne counties (EPA 2020-TN9569).
38 The contributions of air emissions from sources at Monticello represent a fraction of the annual
39 emissions from either Wright County or Sherburne County. Federal land management agencies
40 that administer Federal Class I areas consider an air pollutant source that is located greater
41 than 31 mi (50 km) from a Class I area to have negligible impacts with respect to Class I areas if
42 the total SO₂, NO₂, PM₁₀, and sulfuric acid annual emissions from the source are less than
43 500 tons per year (70 FR 39104-TN8374; NPS 2010-TN7925). There are no Class 1 Federal
44 Areas within 100 mi (160 km) of the Monticello site. Therefore, operation of Monticello has a
45 negligible impact on Federal Class 1 areas.

1 **Table 3-5 Monticello Nuclear Generating Plant Reported Annual Air Emissions (TPY)**
 2 **for years 2017–2021 and 2020 Annual Air Emissions for Wright and**
 3 **Sherburne County**

Year	PM ₁₀	PM _{2.5}	SO ₂	NO _x	CO
2017	0.31	0.22	1.27	11.99	2.84
2018	0.17	0.07	0.97	4.91	1.28
2019	0.15	0.08	0.7	5.38	1.41
2020	0.32	0.23	0.90	4.89	1.24
2021	0.28	0.20	0.76	4.80	1.23
Sherburne County (2020)	6,960	1,990	51	1,890	16,070
Wright County (2020)	9,860	3,000	77.5	2,790	25,105

CO= carbon monoxide; NO_x = nitrogen oxides; PM₁₀ = particulate matter less than 10 µm; PM_{2.5}= particulate matter less than 2.5 µm; SO₂= sulfur dioxide; TPY = ton(s) per year.

Source for Monticello emissions: Xcel 2023-TN9084 and MPCA 2023-TN9625; Source for Sherburne and Wright County: EPA 2020-TN9569.

4 Xcel Energy does not anticipate future upgrades of air emission sources during the SLR term
 5 to support plant operations (Xcel 2023-TN9084). In Monticello’s air permit renewal application,
 6 Xcel Energy requested that two existing onsite gasoline engines be included in the air permit
 7 and all non-road engines be removed, but no additional equipment or emission sources are
 8 included (Xcel 2023-TN9578). SLR would continue current operating conditions and therefore,
 9 the impacts of current operations and SLR would be similar. Given, Monticello’s limited air
 10 emissions presented in Table 3-5, there is little likelihood that ongoing activities at Monticello
 11 during the SLR term would adversely affect air quality. Based on these considerations, the NRC
 12 staff concludes that the air quality impacts of continued nuclear plant operations at Monticello
 13 are SMALL.

14 **3.3.4.2 Air Quality Effects of Transmissions Lines**

15 Small amounts of ozone and substantially smaller amounts of oxides of nitrogen are produced
 16 during corona, a phenomenon that occurs when air ionizes near isolated irregularities on the
 17 conductor surface of transmission lines. During corona, ozone is approximately 90 percent of
 18 the oxidants generated, and 10 percent is NO_x (BLM 2010-TN9626). Xcel Energy has not
 19 conducted field tests of ozone or NO_x emissions generated by Monticello’s 115 kV and 345 kV
 20 in-scope transmission lines (Xcel 2023-TN9578). Several studies have quantified the amount of
 21 ozone generated and concluded that the amount produced by even the largest lines in operation
 22 (765 kilovolt [kV]) is insignificant (SNYPSC 1978-TN7478; Scott-Walton et al. 1979-TN7480;
 23 Janes 1978-TN7479; Varfalvy et al. 1985-TN7364). Monitoring of ozone levels for 2 years near
 24 a Bonneville Power Administration 1,200 kV prototype line revealed no increase in ambient
 25 ozone levels caused by the line (Lee et al. 1989-TN7481). Similarly, field tests conducted over a
 26 19-month period concerning ozone levels adjacent to Sequoyah Nuclear Plant transmission
 27 lines concluded that high-voltage lines up to 765 kV do not generate ozone concentrations
 28 above ambient measurements made at locations remote from transmission lines (TVA 2013-
 29 TN7899; NRC 2015-TN5842). The ozone concentrations generated by transmission lines are
 30 therefore too low to cause any significant effects. The minute amounts of NO_x produced are
 31 similarly insignificant. SLR would continue current operating conditions. Based on these
 32 considerations, the NRC staff concludes that the air quality impacts of transmission lines during
 33 the Monticello SLR term would be SMALL.

1 3.3.4.3 *Noise Impacts*

2 The ambient noise conditions in the vicinity of Monticello are described in Section 3.3.3. Xcel
3 Energy does not anticipate refurbishment activities during the proposed SLR term. Therefore,
4 there would be no noise generated by construction-related activities and equipment typically
5 associated with refurbishment. Nuclear power plant operations would not change appreciably
6 with time. The primary noise sources and levels currently at Monticello, as discussed in
7 Section 3.3.3, would be the same during the SLR term. Noise from diesel generators and the
8 firing range are intermittent. While noise levels from emergency diesel generators can reach
9 101–103 dBA, the noise levels from the generators are not expected to be noticeable after
10 accounting for building walls (generators are housed inside a building) as noise barriers and
11 dissipation given the distance to nearby residents (approximately 0.52 mi [0.83 km]). With each
12 doubling of sound source distance, sound intensity decreases by 6 dB (Zahorik and Kelly 2007-
13 TN9627). Xcel Energy does not anticipate any subsequent license related refurbishment and
14 therefore, noise levels are anticipated to remain the same during the SLR term. Furthermore, as
15 discussed in Section 3.3.3 of this EIS, Xcel Energy has not received noise complaints because
16 of operations at Monticello. Based on these considerations, the NRC staff concludes that noise
17 impacts from continued operations of Monticello during the SLR term would be SMALL.

18 **3.3.5 No-Action Alternative**

19 3.3.5.1 *Air Quality*

20 Under the no-action alternative, the permanent cessation of Monticello operations would reduce
21 overall air emissions (e.g., from boiler, diesel generators, and vehicle traffic). Therefore, the
22 NRC staff concludes that if emissions decrease, the impact on air quality from the shutdown of
23 Monticello would be SMALL.

24 3.3.5.2 *Noise*

25 The permanent cessation of Monticello operations would result in a reduction in noise from the
26 firing range, emergency diesel generators, and from vehicle traffic (e.g., workers, deliveries). As
27 site activities are reduced, the NRC staff expects the impact on ambient noise levels to be lower
28 than those from current plant operations; therefore, the NRC staff concludes that impacts on
29 noise levels from the no-action alternative would be SMALL.

30 **3.3.6 Replacement Power Alternatives: Common Impacts**

31 3.3.6.1 *Air Quality*

32 Construction

33 Construction of a replacement power alternative and associated transmission lines would result
34 in temporary impacts on local air quality. Air emissions include criteria air pollutants (PM, NO_x,
35 CO, and SO₂), volatile organic compounds, hazardous air pollutants, and greenhouse gases
36 (GHGs). Air emissions would be intermittent and would vary based on the level and duration of
37 specific activities throughout the construction phase. During the construction phase, the primary
38 sources of air emissions would consist of engine exhaust and fugitive dust emissions. Engine
39 exhaust emissions would be from heavy construction equipment and commuter, delivery, and
40 support vehicular traffic traveling to and from the facility as well as within the site. Fugitive dust
41 emissions would be from soil disturbances by heavy construction equipment (e.g., earthmoving,

1 excavating, and bulldozing), vehicle traffic on unpaved surfaces, concrete batch plant
2 operations, and wind erosion to a lesser extent.

3 Various mitigation techniques and best management practices (BMP) (e.g., watering disturbed
4 areas, reducing equipment idle times, and using ultra-low sulfur diesel fuel) could be used to
5 minimize air emissions and to reduce fugitive dust.

6 Operations

7 The impacts on air quality from operation of a facility for a replacement power alternative would
8 depend on the energy technology (e.g., nuclear or renewable). Worker vehicles, auxiliary power
9 equipment, and mechanical cooling towers will result in air emissions.

10 3.3.6.2 *Noise*

11 Construction

12 Construction of a replacement power facility and associated transmission lines would be similar
13 to construction of any industrial facility in that they all involve many noise-generating activities.
14 In general, noise emissions would vary during each phase of construction, depending on the
15 level of activity, types of equipment and machinery used, and site-specific conditions. Typical
16 construction equipment, such as dump trucks, loaders, bulldozers, graders, scrapers, air
17 compressors, generators, and mobile cranes, would be used, and pile-driving and blasting
18 activities could take place. Other noise sources include construction worker vehicle and truck
19 delivery traffic. However, noise from vehicular traffic would be intermittent. Noise impacts during
20 construction would not be limited to the immediate vicinity of the sites where each alternative is
21 located, since the construction of transmission corridors would be required for the replacement
22 power alternatives considered.

23 Operations

24 Noise generated during operations could include noise from transformers, industrial equipment,
25 speakers, and offsite sources, such as employees and delivery vehicular traffic. Noise
26 generated by vehicles would be intermittent.

27 **3.3.7 Natural Gas and Renewables Alternative**

28 3.3.7.1 *Air Quality*

29 Air emissions and sources for construction of the natural gas portion of this alternative would
30 include those identified as common to all replacement power alternatives in Section 3.3.6.1 of
31 this EIS. Air emissions from construction of a new natural gas-fired, two-unit combustion turbine
32 power plant would be intermittent, short-term, and temporary. The solar photovoltaic and wind
33 portion of this alternative would not have a power block building. Accordingly, the number of
34 heavy equipment and workforce, level of activities, and construction duration would be
35 substantially lower than that for other alternatives and, consequently, less air emissions would
36 result. Installation of wind turbines, however, require that a significant amount of land be
37 disturbed (up to 66,000 ac [26,709 ha]), as well as a significant amount of land required for
38 transmission lines (2,700 ac [1,093 ha]). These requirements can result in generation of
39 significant amounts of PM. This alternative would also consist of additional generation from
40 existing natural gas fired plants within Xcel Energy's system and purchased power to meet

1 energy demand. Air quality impacts can result from modifications needed at existing facilities.
2 For instance, plant modifications at an existing facility to support additional generation or
3 construction of new transmission lines would result in additional amounts of air emissions. Air
4 emissions associated with the construction of transmission lines would be from operation of the
5 earth-moving and material-handling equipment and exhaust emissions from worker vehicles and
6 construction equipment. These emissions include criteria pollutants and GHGs. However, these
7 impacts would be temporary and would not likely be high.

8 Operation of a 750 MW natural gas-fired, two-unit combustion turbine power plant would result
9 in emissions of criteria pollutants and GHGs. Additionally, for this alternative, existing natural
10 gas combustion turbines would be operated as a peaking plant to provide energy during
11 occasional extended periods of low renewable output (Xcel 2023-TN9084). Projected
12 generation for the existing combustion turbines would average 368,000 MWh annually (Xcel
13 2023-TN9084). The NRC staff estimated annual air emissions for the a 750 MW natural gas-
14 fired, two-unit combustion turbine power plant and the operation of existing natural gas
15 combustion turbines used as a peaking plant using emission factors for a gas turbine simple
16 cycle plant developed by the U.S. Department of Energy's National Technology Laboratory
17 (NETL 2014-TN9628):

- 18 • CO: 35 tons (32 metric tons [MT])
- 19 • NO_x: 340 tons (310 MT)
- 20 • SO₂: 9 tons (8.5 MT)
- 21 • PM₁₀: 8 tons (7 MT)

22 Emissions from nitrogen oxides would be significant. Operation of MDCTs of the natural gas
23 component and up to 150 worker vehicles would result in additional air emissions. Two new
24 natural gas fired units would need to secure a permit for air pollutants associated with its
25 operation. Direct air emissions associated with operation of the solar photovoltaic and wind
26 components of this combination alternative are negligible because no fossil fuels are burned to
27 generate electricity. Emissions from wind turbine arrays and solar photovoltaic installations
28 would include fugitive dust and engine exhaust from worker vehicles and heavy equipment
29 associated with site inspections, maintenance activities, and wind erosion from cleared lands
30 and access roads. Emissions would be localized and intermittent. Purchased power would result
31 in emissions of criteria pollutants and GHGs. Power generation would be on a as needed basis
32 and air quality impacts are expected to be negligible as there would be minimal change in
33 existing plant operations and emissions.

34 Overall, the NRC staff concludes that the air quality impacts from construction and operation of
35 the natural gas and renewable alternative is SMALL to MODERATE.

36 3.3.7.2 *Noise*

37 Sources of noise during the construction and operation of a natural gas and renewables
38 alternative would include those discussed for all replacement power alternatives as discussed in
39 Section 3.3.6.2. Construction of the natural gas fired power plants will require construction of a
40 natural gas pipeline to support operation and would result in noise along the pipeline corridor.
41 Noise generated during construction of the natural gas power plant, transmission lines, and
42 natural gas pipeline may be noticeable depending on the location and distance of nearby noise
43 sensitive receptors. The solar and wind portions of this alternative would have no power block
44 buildings requiring construction. The number of heavy equipment and workforce, level of
45 activities, and construction duration would be lower than for other alternatives. However, noise
46 levels generated by construction activities of a solar facility can range from 70 to 80 dBA at 50 ft

1 (15 m) (BLM 2019-TN8386). Blasting may be required during construction for turbine
2 foundations (WAPA/FWS 2015-TN8725; BLM 2013-TN8882). Noise levels during construction
3 to nearby sensitive receptors of the solar and wind components of this alternative would depend
4 on the distance from the site to nearby receptors and may be noticeable. Solar panels would be
5 located both on and offsite of the Monticello site and wind turbines would be located offsite. At
6 the Monticello site, the nearest nearby noise sensitive receptor is approximately 0.5 mi (0.8 km)
7 from the site. Accounting for noise dissipation with distance, the NRC staff does not anticipate
8 noise levels to be noticeable as result from construction of solar panels at the Monticello site.
9 However, noise levels may be noticeable to nearby noise sensitive receptors because of
10 construction of offsite solar panels and wind turbines and associated transmission lines. This
11 alternative would also consist of additional generation from existing natural gas fired plants and
12 purchased power. Noise impacts can result from necessary modifications at existing facilities to
13 support additional generation. Noise impacts can result from additional noise sources
14 associated with plant modifications at an existing facility or construction of new transmission
15 lines. The increase in noise levels would be dependent on the distance of noise sensitive
16 receptors to the noise sources.

17 Most of the noise-producing equipment (turbines, pumps, MDCTs) would be located inside the
18 power block during operations of the natural gas-fired, two-unit combustion turbine power plant.
19 However, offsite mechanical noise would result from compressor stations and pipeline
20 blowdowns. The Federal Energy Regulatory Commission requires that any new compressor
21 station or any modification, upgrade, or update of an existing station must not exceed day-night
22 sound intensity level of 55 dBA at the closest noise sensitive area (18 CFR 157.206-TN7483).
23 Day-night sound intensity level of 55 dBA was designated by the EPA as a noise level that is
24 adequate to protect against outdoor activities (EPA 1974-TN3941). Noise generated by wind
25 turbines would include aerodynamic noise from the blades and mechanical noise from turbine
26 drivetrain components (generator, gearbox). Depending on the location, layout, and proximity of
27 wind farms to noise sensitive receptors, noise associated with operation of the wind portion of
28 the combination alternative could be noticeable. Because the solar portion with battery storage
29 of this alternative would have no power block or cooling towers, a minimal number of noise
30 sources, such as transformers and vehicular traffic, would be associated with maintenance and
31 inspection activities. This alternative would be supplemented by purchased power (which could
32 include a mix of fossil fuel and renewable sources) and existing natural gas-fired power plants.
33 No significant changes in operation from these sources would occur. Therefore, noise levels
34 would be the same from routine operations at the existing facilities.

35 Overall, the NRC staff concludes that the noise impacts from the natural gas and renewable
36 combination alternative would be SMALL to MODERATE.

37 **3.3.8 Renewables and Storage Alternative**

38 *3.3.8.1 Air Quality*

39 Air emissions and sources for construction and operation of the renewable and storage
40 alternative would include those identified as common to all replacement power alternatives in
41 Section 3.3.6.1. The solar panels with battery storage and wind portions of this alternative would
42 not have power block buildings. Accordingly, the number of heavy equipment and workforce,
43 level of activities, and construction duration would be substantially lower than that for the other
44 alternatives and consequently less air emissions would be generated. Installation of wind
45 turbines, however, require that a significant amount of land be disturbed (up to 84,000 ac
46 [33,994 ha]), as well as a significant amount of land requirements for transmission lines
47 (2,700 ac [1,093 ha]). This can result in noticeable particulate air emissions during the

1 construction phase. This alternative also would consist of additional generation from existing
2 natural gas fired plants within Xcel Energy’s system and purchased power to meet energy
3 demand. Air quality impacts can result from necessary modifications at existing facilities. These
4 emissions include criteria pollutants and GHGs. However, these impacts would be temporary
5 and would not likely be significant.

6 Direct air emissions associated with operation of the solar with battery storage and wind
7 portions of this alternative are negligible because no fossil fuels are burned to generate
8 electricity. Emissions from wind turbine arrays and solar installations would include fugitive dust
9 and engine exhaust from worker vehicles and heavy equipment associated with site inspections,
10 maintenance activities, and wind erosion from cleared lands and access roads. Emissions
11 would be localized and intermittent.

12 This alternative would include purchased power and additional generation from existing natural
13 gas-fired power plants. Both purchased power and natural gas fired power plants would result in
14 emissions of criteria pollutants and GHGs. For this alternative, Xcel Energy projected an annual
15 peak of 204,000 MWh from natural gas fired generation. Purchased power would supplement
16 renewable generation on an as-needed basis (Xcel 2023-TN9084). Therefore, for this
17 alternative, emissions would primarily be from operation of existing natural gas fired plants. The
18 NRC staff estimated the following maximum annual air emissions from an additional
19 204,000 MWh from existing natural gas fired power plants using emission factors by the U.S.
20 Department of Energy’s National Technology Laboratory (NETL 2014-TN9628):

- 21 • CO: 1.0 tons (0.9 MT)
- 22 • NO_x: 10 tons (9.1 MT)
- 23 • SO₂: 0.3 tons (0.2 MT)
- 24 • PM₁₀: 0.2 tons (0.2 MT)

25 Criteria air emissions from operation of the natural gas component of this alternative are
26 comparable to those from operations at Monticello.

27 The NRC staff concludes that the overall air quality impacts from construction and operation of
28 the renewables and storage alternative would be SMALL to MODERATE.

29 3.3.8.2 *Noise*

30 The renewable and storage alternative would consist of wind turbines, solar panels with battery
31 storage, purchased power, and additional power generation from existing natural gas fired
32 plants. Therefore, the noise impacts from construction and operation of a renewable and
33 storage alternative would be similar to those discussed for the wind turbines, solar panels,
34 purchased power, and additional power generation from existing natural-gas fired plants
35 portions of the natural gas and renewable alternative in Section 3.3.6.2. Based on this
36 information, the NRC staff concludes that the noise impacts construction and operation of the
37 renewables and storage alternative would be SMALL to MODERATE.

38 **3.3.9 New Nuclear (Small Modular Reactor) Alternative**

39 3.3.9.1 *Air Quality*

40 Air emissions and sources associated with construction of the new nuclear alternative would
41 include those identified as common to all replacement power alternatives in Section 3.3.6.1. Air
42 emissions from construction of the new nuclear alternative would be intermittent, short term, and
43 temporary (NRC 2019-TN6136).

1 Operation of the new nuclear alternative would result in air emissions similar to those from
2 operation of Monticello. Sources of air emissions would include stationary combustion sources
3 (e.g., diesel generators, auxiliary boilers, and gas turbines), MDCTs, and mobile sources (e.g.,
4 worker vehicles, onsite heavy equipment, and support vehicles). MDCTs could contribute to
5 impacts associated with the formation of visible plumes, fogging, and subsequent icing
6 downwind of the towers. In general, most stationary combustion sources at a nuclear power
7 plant would operate only for limited periods, often during periodic maintenance testing.
8 Additional air emissions would result from the approximately 600 employees commuting to and
9 from the new nuclear facility. A new nuclear power plant would need to secure an air permit for
10 air pollutants associated with its operations (e.g., criteria pollutants, volatile organic compounds,
11 hazardous air pollutants).

12 In NUREG-2226 (NRC 2019-TN6136), the NRC staff conservatively estimated annual air
13 emissions from cooling towers, auxiliary boilers, diesel generators, and gas turbines as a result
14 of operating two or more small modular reactors with a maximum total electrical output of
15 800 MWe:

- 16 • NO_x: 37.6 ton (34 MT)
- 17 • CO: 4.8 ton (4.3 MT)
- 18 • SO₂: 20.8 ton (18.9 MT)
- 19 • PM₁₀: 7.4 ton (6.7 MT)

20 Given that the new nuclear alternative considered here consists of operation of a 12-unit small
21 modular reactor power plant generating approximately 880 MWe, air emissions would be similar
22 those estimated in NUREG-2226 and presented above. These air emissions are greater than
23 annual emissions from operation of Monticello, but are relatively minor. The NRC staff does not
24 expect air emissions from operation of a new nuclear alternative to contribute to NAAQS
25 violations.

26 The NRC staff concludes that the overall impacts of construction and operation of a new nuclear
27 alternative on air quality would be SMALL.

28 3.3.9.2 *Noise*

29 Sources of noise during the construction of a new nuclear power plant would include those
30 discussed for all replacement power alternatives as discussed in Section 3.3.6.2. Noise levels
31 generated by construction activities can reach 102 dBA measured 50 ft (0.3 m) from the source
32 (NRC 2019-TN6136). The new nuclear alternative would be located outside of Minnesota but
33 within Xcel Energy's service area at an existing power plant site or greenfield site. Noise levels
34 to nearby noise sensitive receptors (e.g., residence, school, park) would depend on the distance
35 from the construction site (e.g., plant site, transmission line corridors) to the receptors, while
36 short-term, noise can be noticeable.

37 Sources of noise during nuclear power plant operations would include those discussed for all
38 replacement power alternatives in Section 3.3.6.2. Noise would be primarily limited to the
39 immediate vicinity of the site. If the new nuclear alternative is located at an existing power plant
40 site, noise would be compatible and like that being generated at the existing site. However, if
41 the new nuclear alternative is located at a greenfield site, noise from cooling towers, turbines,
42 and equipment may be noticeable and would depend on the distance to nearby noise sensitive
43 receptors.

1 Overall, the NRC staff concludes that the noise impacts from construction and operation of a
2 new nuclear alternatives would be SMALL to MODERATE.

3 **3.4 Geologic Environment**

4 EIS Section 3.4 describes the geologic environment of the Monticello site and vicinity, including
5 the physiography, geology, geologic resources, soils, and seismic setting. The descriptions of
6 these facets of the geologic environment are followed by the NRC staff's analysis of the
7 potential site-specific environmental impacts on geology and soils from the proposed Monticello
8 SLR action and alternatives to that proposed action.

9 **3.4.1 Physiography and Geology**

10 Section 3.5 of the Xcel Energy ER (Xcel 2023-TN9084) describes the geologic environment of
11 the Monticello site and vicinity, including the regional geology, site geology, soils, and seismic
12 history. Except as otherwise cited for clarity, the NRC staff summarizes this information in the
13 following subsections. The staff did not identify any new and significant information regarding
14 the geologic environment during the site audit and the scoping process or as the result of its
15 review of available information as cited in this EIS.

16 Monticello is located in central Minnesota within the Central Lowlands physiographic province,
17 which covers approximately 585,000 square miles (mi²) (1,515,143 km²), of generally low relief
18 topography. Crystalline basement rocks in the region are Precambrian (>541 million years) in
19 age. Monticello is located approximately 20 mi (32 km) northwest of the Midcontinent Rift. The
20 Midcontinent Rift is a large (approximately 1,200 mi [2,000 km] in length) geologic feature that
21 formed during Precambrian rifting and subsequent volcanic activity. The rift zone comprises
22 dipping basins filled with old igneous (volcanic) rocks and younger sedimentary rocks (Stein et
23 al. 2016-TN9868). The region was glaciated, and the underlying lithologies are largely Paleozoic
24 age sandstones, shales, limestones, conglomerates, and coals (sedimentary rocks). The grade
25 level elevation of the Monticello site is approximately 930 ft (283 m) above mean sea level MSL
26 (Xcel 2023-TN9084).

27 The Monticello site is located on a bluff that forms the southwest bank of the Mississippi River.
28 The bluff slopes gently downhill to the south away from the river. Six stratigraphic units are
29 present at the site. Surficial deposits consist predominantly of fill (reworked natural material of
30 gravels and silts), river terrace deposits (sand and gravelly sand), sandy till (sand with gravel),
31 glacial outwash (sand with clay and trace gravel), and lower glacial till (clay with sand). The
32 lower glacial till extends to the bedrock surface. Geologic logs indicate that the bedrock beneath
33 the site is weathered sandstone at a depth of approximately 60 ft (18 m) below ground surface
34 (bgs) and granite at a depth of approximately 70 to 122 ft (21 to 37 m) bgs. Soil and rock units
35 at the site dip eastward.

36 **3.4.2 Geologic Resources**

37 Minnesota is the largest producer of iron ore (taconite) in the United States. However, current
38 and future iron ore mining operations are located in northeast Minnesota (IMA 2022-TN9086).
39 Sand and gravel deposits are quarried in Wright County (USGS 2023-TN9087). Nearby sites
40 include the active Martin Marietta Monticello Pit 3.1 mi (5 km) northwest of the Monticello site
41 and the Naaktgeboren Pit in Silver Creek 6.6 mi (10.6 km) southwest of the Monticello site. A
42 new sand and gravel prospect has been proposed in Buffalo Township approximately 11.7 mi
43 (18.8 km) south of the Monticello site (Knife River 2017-TN9088; Martin Marietta 2023-TN9089;
44 WCPZ 2022-TN9090).

1 **3.4.3 Soils**

2 Natural soils and weathered rock material across the Monticello site were graded and disturbed
3 during nuclear power plant construction. Where soils are present and undisturbed in the central
4 portion of the Monticello site, mapping by the Natural Resources Conservation Service shows
5 that they consist of loamy sand from the Hubbard–Mosford soil complex. Soils in the
6 northeastern corner of the site extending eastward toward the Mississippi River, where present
7 and undisturbed, consist of the fine sandy loam of the Elkriver complex. Before nuclear power
8 plant construction, the soils formed on slopes ranging from 0 to 3 percent from parent material
9 consisting of alluvium. Elkriver complex soils cover approximately 19 percent of the total site
10 area (as presented in Figure 3.1-2 of Xcel 2023-TN9084) and are designated as prime farmland
11 soils. Less than a quarter of the area of land indicated to contain Elkriver complex soils is
12 developed; therefore, the undisturbed areas of this complex would still be classified as prime
13 farmland.

14 Aside from areas of severe slopes, the Natural Resources Conservation Service rates the soils
15 of the Hubbard–Mosford and Elkriver complexes as somewhat to very limited for site
16 development with shallow excavations. The soils generally have slight erosion potential, except
17 for a band of loamy outwash (Dorset Two Inlets Complex) that borders the Mississippi River
18 west of the main site complex and has severe erosion potential. Stabilization measures have
19 been in place since Monticello became operational to prevent erosion and sedimentation
20 impacts. Additionally, as required by its State-issued NPDES general permit for stormwater
21 discharges associated with industrial activity (No. MN00000868) for Monticello, Xcel Energy has
22 also developed and implemented a stormwater pollution prevention plan (SWPPP). This plan
23 identifies BMPs, including nonstructural preventive measures and source controls and structural
24 (engineering) controls, to prevent erosion and to prevent or reduce pollutants, including total
25 suspended solids, in stormwater discharges (Xcel 2023-TN9084).

26 **3.4.4 Seismic Setting**

27 Earthquake activity in Minnesota has historically been low. The main mechanism for earthquake
28 activity in the region is interpreted to be the reactivation of ancient Precambrian faults as the
29 North American plate drifts westward away from the Mid-Atlantic ridge. Several of these ancient
30 fault zones cross the State in largely southwest to northeast orientations, including the Great
31 Lakes Tectonic Zone and the Leech Lake Structural Discontinuity. The nearest mapped fault to
32 the Monticello site is an unnamed feature of unknown displacement located approximately
33 2.9 mi (4.7 km) northwest of the site’s northern boundary (USGS 2023-TN9261). Between 1970
34 and October 1, 2023, five earthquakes with a magnitude equal to or greater than 3.0 have been
35 recorded within a 200 mi (322 km) radius of the Monticello site (USGS 2023-TN9263). Between
36 2014 and January 2023, 102 mining explosions have been recorded with a magnitude equal to
37 or greater than 3.0 within 200 mi (322 km) of the Monticello site (USGS 2023-TN9263).

38 The NRC evaluates the potential effects of natural hazards, including seismic events, on nuclear
39 power plants on an ongoing basis that is separate from the LR process. All nuclear power plants
40 in the United States are designed and built to withstand strong earthquakes based on their
41 location and nearby earthquake activity. The NRC’s understanding of seismic hazards for a
42 given nuclear power plant may change as the methods of assessing seismic hazards evolve
43 and the scientific understanding of earthquake hazards improves (NRC 2014-TN8997, NRC
44 2018-TN8998). In 2018, the U.S. Geological Survey published updated seismic hazard maps
45 that included the region encompassing the Monticello site (Petersen et al. 2020-TN7281).
46 Based on the 2018 seismic hazard maps, the Monticello site is in an area with a predicted peak

1 horizontal acceleration between 0.02–0.04 g (10–20 percent of standard gravity) for a 2 percent
2 probability of exceedance in 50 years (i.e., corresponding to a return time of about 2,500 years).
3 Previous peak horizontal acceleration estimates for the site were 0.04–0.08 g (USGS 2014-
4 TN6177).

5 Following the accident at the Fukushima Dai-ichi nuclear power plant resulting from the
6 March 11, 2011, Great Tohoku Earthquake and subsequent tsunami, the NRC established the
7 Near-Term Task Force to review regulatory insights from the Fukushima Dai-ichi accident as
8 directed by the Commission on March 21, 2011, in COMGBJ-11-0002 (NRC 2011-TN7448).
9 The Near-Term Task Force assessment resulted in the NRC issuing order EA-12-049 (NRC
10 2012-TN7947) on March 12, 2012 to nuclear power plant licensees requiring them to mitigate
11 beyond-design-basis external events, and issuing 10 CFR 50.54(f) (TN249) letters directing
12 licensees to conduct seismic and flooding reevaluations (NRC 2012-TN2198). In November
13 2020, the NRC staff issued its determination that Xcel Energy had completed its response to the
14 order and the 10 CFR 50.54(f) letter (NRC 2020-TN9695) for Monticello.

15 The impacts of natural phenomena, including geologic hazards, on nuclear power plant
16 systems, structures, and components are outside the scope of the NRC’s license renewal (LR)
17 environmental review. Monticello was originally sited, designed, and licensed in consideration of
18 applicable geological and seismic criteria, and seismic issues are assessed as part of the
19 nuclear power plant safety review. Further, the NRC requires all licensees to take seismic
20 activity into account in order to maintain safe operating conditions at all nuclear power plants.
21 When new seismic hazard information becomes available, the NRC evaluates the new
22 information to determine if any changes are needed at existing nuclear power plants. This
23 reactor oversight process, which considers seismic safety, is separate and distinct from the
24 NRC staff’s LR environmental review.

25 **3.4.5 Proposed Action**

26 This section addresses the site-specific environmental impacts of Monticello SLR on the
27 environmental issues identified in Table 3-1 that relate to geology and soils. Below, the NRC
28 staff analyzes the impacts at the Monticello site for the SLR term.

29 The impact of continued operation and any refurbishment associated with SLR at the Monticello
30 site on geologic and soil resources would consist of soil disturbance and potential excavations
31 for the anticipated ISFSI expansion and other projects (if any), such as replacing or adding
32 buildings, roads, parking lots, and belowground and aboveground utility structures. For such
33 projects, the licensee may also need to obtain geologic materials (e.g., soil or sand borrow or
34 backfill material, aggregate for road building or concrete production) from locations on the
35 nuclear power plant site or from offsite borrow areas or quarries. However, it is more likely that
36 these materials would be obtained from commercial vendors. Regardless, stabilization
37 measures to prevent erosion and sedimentation impacts on the Monticello site and surrounding
38 area have been in place since construction began in the early 1970s. In addition, the site
39 maintains an SWPPP (Xcel 2023-TN9084) that identifies BMPs to prevent or reduce soil erosion
40 and the subsequent impacts on surface water quality. These include nonstructural preventative
41 measures and structural controls to prevent erosion or treat stormwater impacted by potential
42 pollutants caused by erosion. Any construction activities at the Monticello site would be subject
43 to and managed by the current SWPPP, and any ground disturbance of one or more acres (or
44 less than one acre if the activity is scoped within a larger development plan of more than one
45 acre) would require a construction stormwater permit be obtained from the MPCA (MPCA 2023-
46 TN9266).

1 The Farmland Protection Policy Act of 1981 (FPPA; 7 U.S.C. 4201 et seq.-TN708) requires
2 Federal agencies to take into account agency actions affecting the preservation of farmland,
3 including prime and other important farmland soils, as described in Section 3.4.3. However, the
4 site is not subject to the FPPA because the FPPA does not apply to Federal permitting or
5 licensing for activities on private or nonfederal lands.

6 Based on the site-specific environmental review conducted by the NRC staff, to date, no
7 significant impact issues related to continued operations and refurbishment activities on geology
8 and soils have been identified.

9 The geologic and soil conditions at Monticello and the associated transmission lines have been
10 well established during the current licensing term. These conditions are expected to remain
11 unchanged during the 20-year SLR term. SLR would continue current operating conditions and
12 environmental stressors rather than introduce wholly new impacts. For these reasons, the
13 effects of continued operations on geologic and soil resources would be minor and would
14 neither destabilize nor noticeably alter any important attribute of this resource during the SLR
15 term. The NRC staff concludes that the impacts of SLR on geology and soils during the
16 Monticello SLR term would be SMALL.

17 **3.4.6 No-Action Alternative**

18 Under the no-action alternative, there would be few or no incremental impacts on site geology
19 and soils associated with the shutdown of Monticello. In this case, before beginning
20 decommissioning activities, little or no new ground disturbance would occur at the plant site
21 while operational activities were being reduced and eventually terminated. Therefore, the NRC
22 staff concludes that the impact of the no-action alternative on geology and soils would be
23 SMALL.

24 **3.4.7 Replacement Power Alternatives: Common Impacts**

25 Construction

26 During facility construction for the replacement power alternatives and associated components,
27 aggregate material (e.g., crushed stone, riprap, sand, and gravel) would be required to construct
28 buildings, foundations, roads, parking lots, pad sites, transmission lines, and other supporting
29 infrastructure, as applicable. The NRC staff considers that these resources would likely be
30 obtained from commercial suppliers using local or regional sources. Land clearing, grading, and
31 excavation work expose soils to erosion and alter surface drainage. The staff also expects that
32 BMPs would be implemented in accordance with applicable State and local permitting
33 requirements to reduce soil erosion and the associated offsite impacts. These practices would
34 include such measures as the use of sediment fencing, staked hay bales, check dams,
35 sediment ponds, riprap aprons at construction and laydown yard entrances, mulching and
36 geotextile matting of disturbed areas, and rapid reseeding of temporarily disturbed areas as
37 applicable. Standard construction practice dictates that the topsoil removed during construction
38 and any suitable excavated materials would be stored onsite for redistribution, e.g., as backfill,
39 at the end of construction.

40 Operations

41 Replacement power facilities would be built in accordance with applicable State and local
42 building codes and would consider such siting and design factors to mitigate potential impacts

1 from natural phenomena. Once facility construction is completed, the areas disturbed during
2 construction, whether on land or offshore, would be within the footprint of the completed
3 facilities, overlain by other impervious surfaces (such as roadways and parking lots), or
4 revegetated or stabilized as appropriate. Therefore, there would be no additional land
5 disturbance and no direct operational impacts on geology and soils. The consumption of
6 aggregate materials or topsoil for maintenance purposes during operations would be negligible.

7 **3.4.8 Natural Gas and Renewables Alternative**

8 The impacts on geologic and soil resources from construction and the operations associated
9 with the natural gas and renewables alternative would likely be similar to, but of lesser intensity,
10 than those described and assumed as common to all alternatives in Section 3.4.7. The impacts
11 are expected to be less than those associated with the new nuclear alternative. However, the
12 potential construction impacts of this alternative to soil resources at the Monticello site are
13 expected to be greater than those associated with the SMR component of the new nuclear
14 alternative because a larger area of land would be disturbed and converted to industrial use
15 (see Section 3.2.5.1 for more detail on land use for replacement power alternatives) Total land
16 use for the natural gas and renewables alternative is about 72,630 ac (29,392 ha), including
17 transmission lines and corridors (see Section 3.2.5.1). However, the intensity of the excavation
18 work for the power block of the natural-gas-fired combustion turbine power plant and the wind
19 turbine and solar panel foundations would be less under this alternative than for the new nuclear
20 alternative. In summary, the NRC staff concludes that the impacts on geology and soil
21 resources from the natural gas and renewables alternative would be SMALL to MODERATE.

22 **3.4.9 Renewables and Storage Alternative**

23 The impacts on geologic and soil resources from construction and the operations associated
24 with the renewables and storage alternative would likely be similar to those described and
25 assumed as common to all alternatives in Section 3.4.7 and those described in Section 3.4.8 for
26 the natural gas and renewables alternative. Total land use under this alternative is 96,500 ac
27 [39,052 ha], including transmission lines and corridors (see Section 3.2.5.1 for more detail on
28 land use for replacement power alternatives). While the construction impacts on surface soils
29 are likely to be elevated due to the large land-use requirement, the intensity of the excavation
30 work would be much less compared to that of the SMR. The NRC staff concludes that the
31 impacts on geology and soil resources from this alternative would be SMALL to MODERATE.

32 **3.4.10 New Nuclear (Small Modular Reactor) Alternative**

33 The impacts on geologic and soil resources from construction and the operations associated
34 with the new nuclear alternative would likely be similar to those described and assumed as
35 common to all alternatives in Section 3.4.7. Minnesota Statute 216B.243, Subdivision 3b,
36 prohibits the construction and operation of new nuclear power plants in Minnesota. Therefore,
37 without legislative change, the SMR plant would be constructed and installed outside
38 Minnesota, and the existing infrastructure at the Monticello site could not be used. Therefore,
39 the construction of the SMR plant could potentially increase the consumption of geologic
40 resources for new facility construction. However, total land use needed to support the
41 construction of the new SME power plant and transmission lines would be two orders of
42 magnitude less than that of the natural gas and renewables and the renewables and storage
43 alternatives (see Section 3.2.5.1 for more detail on land use for replacement power
44 alternatives).

1 Disturbance to geologic strata and soil erosion and loss under this alternative would generally
2 be localized to the construction sites, and offsite soil erosion impacts would be mitigated by
3 using BMPs. However, excavation work for the nuclear power block associated with the SMR
4 modules may extend to a depth of approximately 140 ft (43 m) below grade (NRC 2018-
5 TN7244). This would likely require excavation in weathered and sound rock and the application
6 of methods (e.g., grouting and dewatering) to stabilize the deep excavation during construction.
7 Because this alternative would require multiple excavations, including a deep excavation for the
8 SMR, and substantial soil disturbance, the NRC staff concludes that the overall impacts on
9 geology and soil resources from the new nuclear alternative would be SMALL to MODERATE.

10 **3.5 Water Resources**

11 This section describes surface water and groundwater resources at and around the Monticello
12 site. The description of the resources is followed by the staff's analysis of the potential impacts
13 on surface water and groundwater resources from the proposed action (SLR) and alternatives to
14 the proposed action.

15 **3.5.1 Surface Water Resources**

16 Surface water encompasses all water bodies that occur above the ground surface, including
17 rivers, streams, lakes, ponds, and manmade reservoirs or impoundments.

18 *3.5.1.1 Surface Water Hydrology*


19 The NRC staff previously considered the interaction of Monticello's cooling and auxiliary water
20 systems with the hydrologic environment in Sections 2.1.3, 2.2.2, and 2.2.3, of NUREG-1437,
21 Supplement 26 for initial license renewal of the nuclear power plant (NRC 2006-TN7315).

22 In Sections 2.2.3, 3.6.1 and 3.7.1 of its ER, Xcel Energy provides a detailed description of the
23 surface water environment of the Monticello site including the Mississippi River system, flooding
24 potential, and related operational interactions between the Monticello nuclear power plant and
25 surface water resources. The NRC staff incorporates this information here by reference. Except
26 as otherwise cited for clarity, the staff summarizes this information here and in the following
27 subsections. The NRC staff did not identify any new and significant information regarding the
28 surface water affected environment during the site audit, the scoping process, or as the result of
29 its review of available information as cited in this EIS.

30 Local and Regional Hydrology

31 The Mississippi River basin covers more than 1,245,000 mi² (3,224,535.2 km²) and includes all
32 or parts of 31 States and two Canadian provinces (USACE Undated-TN9629). The U.S.
33 Geological Survey (USGS) has divided the Mississippi River into six sub-basins: the Upper
34 Mississippi River, Lower Mississippi River, Arkansas Red-White River, Ohio River, Missouri
35 River, and Tennessee River sub-basins. Monticello is located in the Upper Mississippi River
36 drainage basin. The Mississippi River is the second longest river in North America, flowing
37 approximately 2,300 mi (3,701.5 km) from its source at Lake Itasca in northern Minnesota
38 through the center of the continental United States to the Gulf of Mexico (NPS 2022-TN9630).
39 The Monticello site is located in the City of Monticello, Wright County, Minnesota, on the
40 southern bank of the Mississippi River (River Mile [RM] 900) (NRC 2006-TN7315)). Figure 3-1
41 depicts the surface water features of the region in relation to Monticello. Near Monticello, the
42 Mississippi River is broad and turbulent. The main channel is approximately 980 ft (298.7 m)
43 wide, 6.2 ft (1.9 m) deep and river velocities can exceed 4.9 fps (Xcel 2023-TN9084).

1 The reach of the Mississippi River within the project area serves a variety of uses including
 2 recreation and domestic water supply. St. Cloud, located approximately 30 mi (48.2 km)
 3 upstream of Monticello, is the first city along the Mississippi River to obtain its drinking water
 4 from the river. The Minneapolis Water Works Reservoir also is supplied from the Mississippi
 5 River with its intake located approximately 37 mi (59.5 km) downstream of Monticello (Xcel
 6 2023-TN9084). All portions of the Mississippi River within 6 mi (9.7 km) of Monticello are
 7 classified as “Recreational” (Xcel 2023-TN9084).

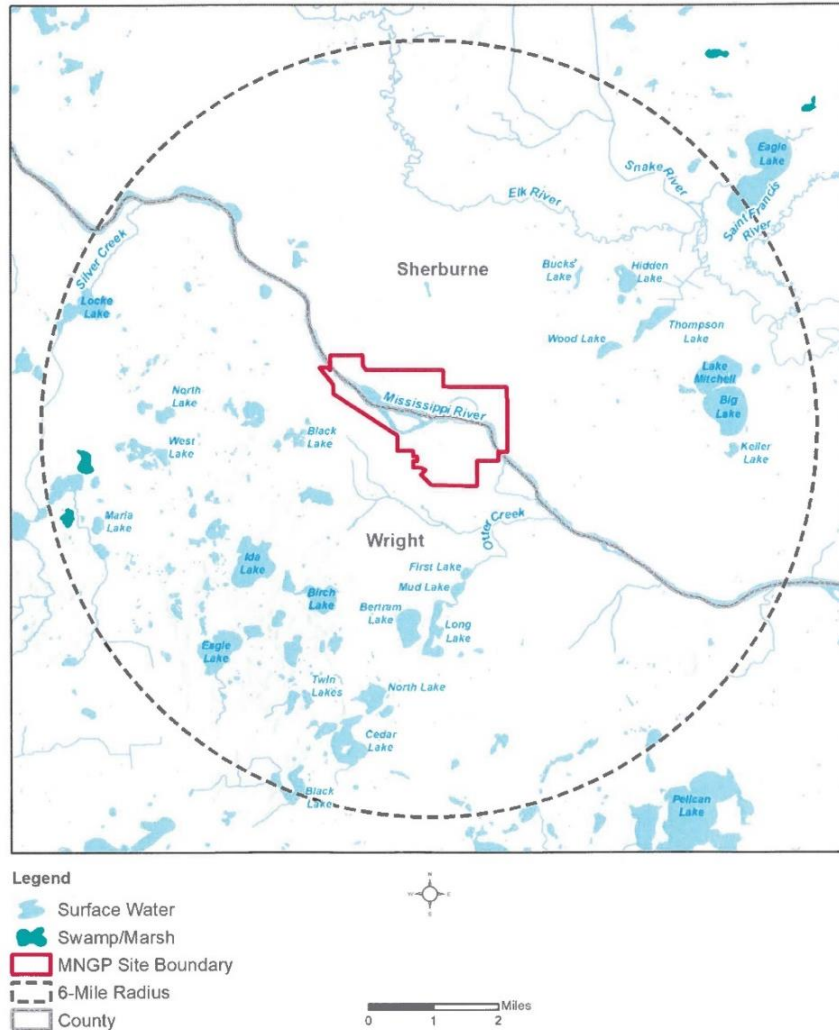

8
 9 **Figure 3-1 Regional Surface Water Features Associated with the Monticello Nuclear**
 10 **Generating Plant Site. Source: Xcel 2023-TN9084.**

11 Hydrological conditions (e.g., river stage, discharge, depth, surface area, temperature, turbidity)
 12 of the Mississippi River near the Monticello site are subject to considerable seasonal variations.
 13 As shown in Table 3-6, the average daily discharges during spring run-off (April–May) are
 14 approximately 3 times higher than during the lower flow months (e.g., August–September).
 15 Table 3-6 contains monthly summaries of daily mean discharge data for the period between
 16 1988 and 2023 from the USGS station (#05270700; St. Cloud) located 26 mi (41.8 km) upriver
 17 of the Monticello site (Xcel 2023-TN9084). The minimum daily flow recorded at this station of
 18 553 cfs occurred on August 19, 2021. As discussed further in Section 3.5.3.1 of this EIS, this
 19 flow was part of a 6-day low flow event.

1 **Table 3-6 Mississippi River Daily Water Discharges Near the Monticello Nuclear**
 2 **Generating Plant by Month from 1988–2023**

Month	Avg. (cfs)	Max. (cfs)	Min. (cfs)	Avg. (m ³ /s)	Max. (m ³ /s)	Min. (m ³ /s)
Jan	3,946	8,350	1,430	112	236	40
Feb	3,788	14,500	1,250	107	411	35
Mar	6,290	33,900	1,320	178	960	37
Apr	13,193	45,100	3,210	374	1,277	91
May	12,097	32,700	3,180	343	926	90
Jun	9,260	30,500	1,780	262	864	50
Jul	7,576	23,900	915	215	677	26
Aug	4,603	13,000	553	130	368	16
Sep	4,415	15,400	964	125	436	27
Oct	5,879	21,400	1,290	166	606	37
Nov	5,914	17,900	1,320	167	507	37
Dec	4,514	14,600	1,110	128	413	31

cfs = cubic feet per second; m³/s = cubic meters per second.

Source: USGS 2024-TN9631, USGS 2024-TN9632, USGS 2024-TN9634.

3 **3.5.1.2 Surface Water Use in the Last 5 Years**

4 The Mississippi River supports a variety of commercial–industrial, public, and recreational uses.
 5 These uses include thermoelectric power production, irrigation, mining, water-based recreation,
 6 and public water supply.

7 Monticello withdraws Mississippi River water through its intake canal and intake structure for
 8 condenser cooling, service water cooling, screen washing, and fire protection, and returns the
 9 noncontact cooling water and permitted effluents to the river through the plant’s discharge
 10 structure (see Section 2.1.3 and Figure2-2) (Xcel 2023-TN9084). Surface water withdrawals are
 11 governed by water appropriation limits set by the MDNR under Permit No. 66-1172.

12 Under typical river conditions, the circulating water system removes heat from the Monticello
 13 condenser by the once-through circulating water system. Under certain discharge canal
 14 temperature, river temperature, and river flow conditions, the circulating water system can use
 15 two mechanical draft cooling towers for partial or complete recirculation of the cooling water in
 16 compliance with permit limits. The operating modes for the circulating water system are required
 17 by the NPDES permit discharge limits and the Surface Water Appropriations Permit. The
 18 Surface Water Appropriations Permit allows Monticello to withdraw up to 645 cfs (or
 19 290,000 gpm) of water from the Mississippi River, with special operating conditions if the river
 20 flow is less than 860 cfs, and further restrictions if river flow is 240 cfs or less.

21 Xcel Energy estimates a worst-case maximum total water consumption of up to 12 cfs assuming
 22 150 days per year of cooling tower operation (Xcel Energy 2008-TN9536). Table 3-7 summarizes
 23 Monticello’s actual annual surface water withdrawals from 2018 to 2022. Xcel Energy monitors
 24 Monticello’s surface water withdrawals from the Mississippi River and submits annual reports to
 25 the MDNR. The data for 2021 and 2022 reflect withdrawals after the installation of new cooling
 26 towers. Xcel Energy determined that cooling tower use has an insignificant effect on the total
 27 consumptive use of surface water at Monticello (Xcel 2023-TN9084). The Water Appropriation
 28 Permit Program requires all users withdrawing more than 10,000 gallons (gal) of water per day or
 29 1 million gallons per year (3.8 million liters per year) to have a water appropriation (water use)
 30 permit, and to submit annual water use reports to the MDNR.

1 **Table 3-7 Surface Water Withdrawals, Monticello Nuclear Generating Plant, 2018–2022**

Year	Average Withdrawal Rate (MGD)
2018	346.7
2019	333.6
2020	357.4
2021	290.2
2022	339.8
2018–2022	333.5

MGD = million gallons per day.
 Source: Xcel 2023-TN9084, Xcel 2023-TN9578.

2 **3.5.1.3 Surface Water Quality and Effluents**

3 **Water Quality Assessment and Regulation**

4 In accordance with Section 303(c) of the Federal Water Pollution Control Act (i.e., Clean Water
 5 Act of 1972, as amended [CWA; 33 U.S.C. 1251-1387 TN662]), States have the primary
 6 responsibility for establishing, reviewing, and revising water quality standards for U.S. navigable
 7 waters. Such standards include the designated uses of a water body or water body segment,
 8 water quality criteria necessary to protect those designated uses, and an anti-degradation policy
 9 with respect to ambient water quality. As established under Section 101(a) of the CWA, water
 10 quality standards are intended to restore and maintain the chemical, physical, and biological
 11 integrity of the U.S. waters and to attain a level of water quality that provides for designated
 12 uses. The EPA reviews each State’s water quality standards to ensure they meet the goals of
 13 the CWA and Federal water quality standards regulations (40 CFR Part 131-TN4814).

14 Section 303(d) of the CWA requires states to identify all “impaired” waters for which effluent
 15 limitations and pollution control activities are not sufficient to attain water quality standards in
 16 such waters. Similarly, CWA Section 305(b) requires states to assess and report on the overall
 17 quality of waters in their state. States prepare a CWA Section 303(d) list that identifies the water
 18 quality limited stream segments that require the development of total maximum daily loads
 19 (TMDLs) to assure future compliance with water quality standards. The list also identifies the
 20 pollutant or stressor causing the impairment and establishes a priority for developing a control
 21 plan to address the impairment. The TMDLs specify the maximum amount of a pollutant that a
 22 water body can receive and still meet water quality standards. Once established, TMDLs often
 23 are implemented through watershed-based programs administered by the State, primarily
 24 through permits issued under the NPDES permit program, pursuant to Section 402 of the CWA,
 25 and associated point and nonpoint source water quality improvement plans and associated
 26 BMPs. States are required to update and resubmit their impaired waters list every 2 years,
 27 which ensures that impaired waters continue to be monitored and assessed by the State until
 28 applicable water quality standards are met.

29 Beginning in 2004, the MPCA began providing the Water Quality Integrated Report to the EPA.
 30 This report is intended to combine the requirements of CWA Sections 305(b) and 303(d)
 31 through a biennial abbreviated narrative report (MPCA 2021-TN9537).

32 The reach of the Mississippi River (between the Clearwater and Crow Rivers) where
 33 Monticello is located is classified as an “outstanding resource value water – restricted.” This
 34 classification is assigned to high-quality waters and waters that have exceptional recreation,

1 cultural, aesthetic, or scientific value for which new or expanded waste discharges are
2 restricted (Xcel 2023-TN9084). The designated beneficial uses of this reach of the river are as
3 follows (MPCA 2020-TN9538):

- 4 • domestic consumption (requires heavy treatment)
- 5 • aquatic life and recreation also protected as a source of drinking water – general warm
6 water habitat (lakes and streams)
- 7 • industrial consumption (heavy treatment)
- 8 • agriculture and wildlife (irrigation)
- 9 • agriculture and wildlife (livestock and wildlife)
- 10 • aesthetic enjoyment and navigation
- 11 • other uses


12 In addition, this reach is listed by the MPCA as impaired for fish consumption due to
13 polychlorinated biphenyls (PCBs) and mercury in fish tissue and impaired for aquatic recreation
14 due to the presence of fecal coliform bacteria (MPCA 2022-TN9539).

15 Flooding






16 The Monticello site is located on the southern bank of the Mississippi River within the Upper
17 Mississippi River drainage basin. Two types of flooding can occur within this drainage basin:
18 open-water flooding and backwater flooding. When open-water conditions prevail, flooding is
19 caused by runoff-producing rains or by melting snow, or by a combination of both. Backwater
20 flooding usually is caused by ice jams in the river. The most serious flooding throughout the
21 basin has been associated with excessive snowmelt and rainfall (Xcel 2021-TN9633).

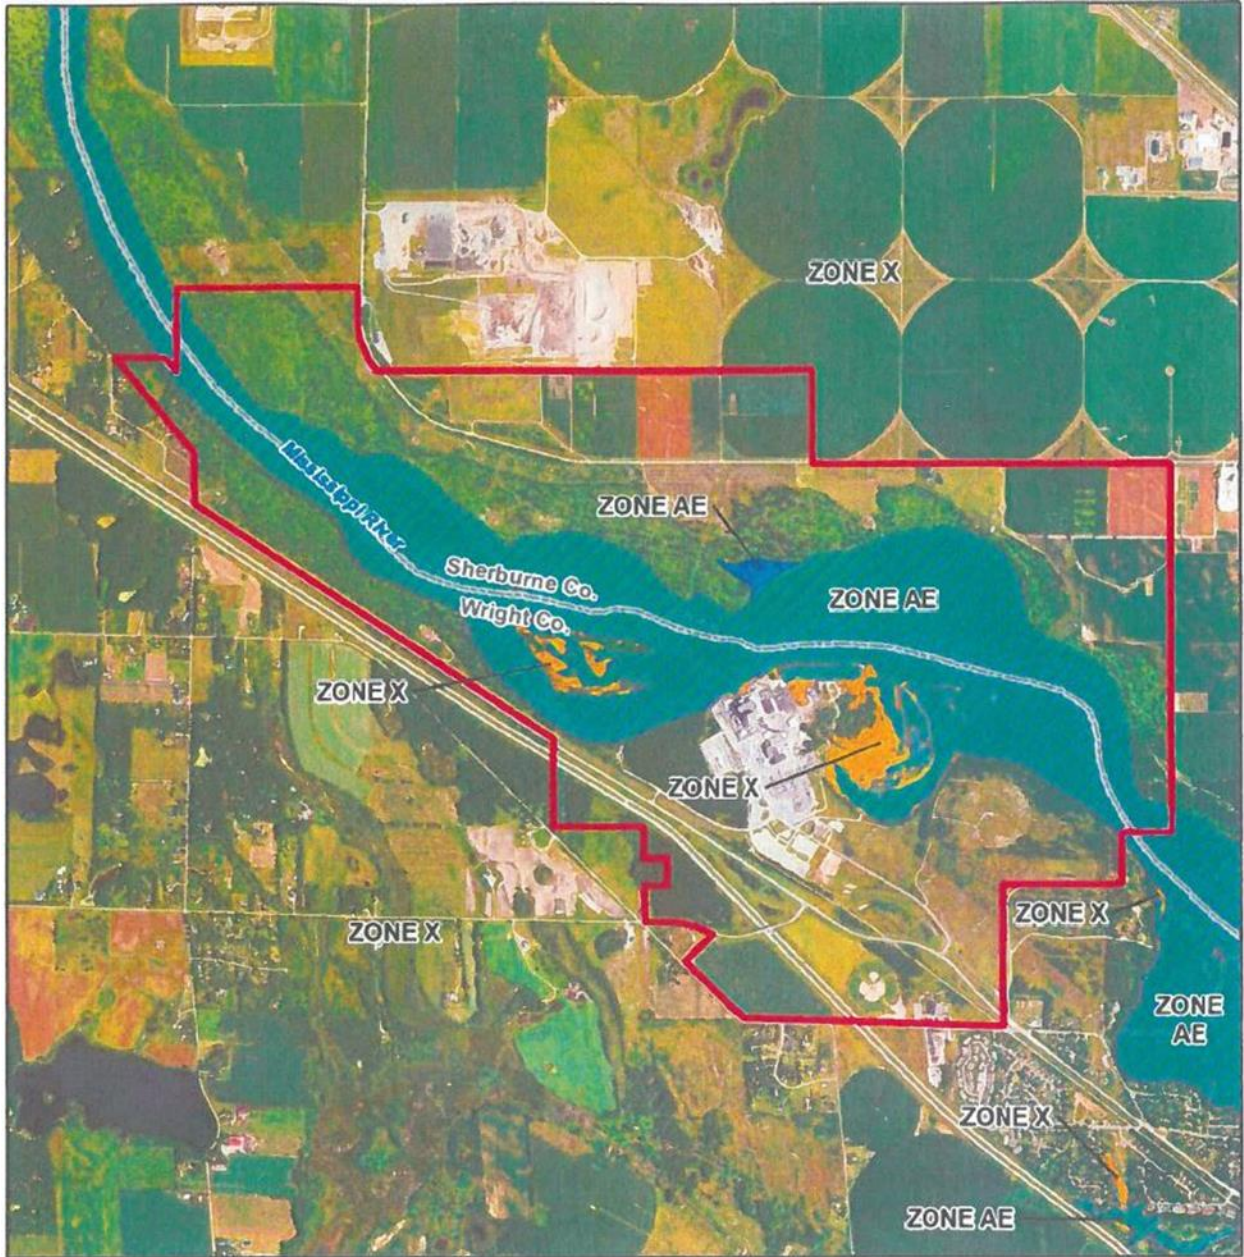22 As shown in Figure 3-2, the Federal Emergency Management Agency has delineated flood
23 hazard areas in the vicinity of the Monticello site. Federal Emergency Management Agency has
24 mapped most of the nuclear power plant site, including the entire main nuclear power plant
25 complex encompassing the nuclear island as Uncus X (unshaded), which represents areas of
26 minimal flood hazard and lies outside the 0.2 percent annual chance flood (500 year flood level).
27 The discharge canal area, the shoreline of the Mississippi River, and some areas to the
28 southeast of the Monticello complex are mapped as Zone AE (i.e., within the base floodplain,
29 1 percent annual chance flood). The finished plant grade (930 Mean Sea Level [MSL]) is about
30 25 ft (7.6 m) above the normal river level, 14 ft (4.3 m) above the highest recorded flood level,
31 which occurred in the spring of 1965, and 10 ft (3 m) above the predicted 1,000 year flood
32 (Xcel 2023-TN9084).

33 In accordance with the NRC's general design criteria (Appendix A, "General Design Criteria for
34 Nuclear Power Plants," to 10 CFR Part 50, "Domestic Licensing of Production and Utilization
35 Facilities"), nuclear power plant structures, systems, and components important to safety must
36 be designed to withstand the effects of natural phenomena, such as flooding, without loss of
37 capability to perform safety functions.



Legend

-  MNGP Site Boundary
-  ZONE AE - Special Flood Hazard Areas (Base Flood Elevation determined)
-  ZONE AE - Floodway areas in ZONE AE (Base Flood Elevation determined)
-  ZONE X - Areas of 0.2% annual chance flood hazard
-  ZONE X - Areas determined to be outside 0.2% annual chance floodplain



0 0.25 0.5 Miles

Note: Wright County FEMA data is considered preliminary as of June 22, 2011

1
2
3


Figure 3-2 Federal Emergency Management Agency Floodplain Zones at Monticello.
Source: Xcel 2023-TN9084.

1 Additionally, the NRC staff evaluates nuclear power plant operating conditions and physical
2 infrastructure to ensure ongoing safe operations through its Reactor Oversight Process, which is
3 separate from the NRC's license renewal review process. If new information about changing
4 environmental conditions becomes available, the NRC will evaluate the new information to
5 determine if any safety-related changes are needed. The NRC also evaluates new information
6 important to flood projections and independently confirms that a licensee's actions appropriately
7 consider potential changes in flooding hazards at the site.

8 To operate a nuclear power plant, NRC licensees must comply with provisions of the CWA,
9 including associated requirements imposed by the EPA or the State, as part of the NPDES
10 permitting system under Section 402 of the CWA. The Federal NPDES permit program
11 addresses water pollution by regulating point sources (i.e., pipes, ditches) that discharge
12 pollutants to waters of the United States. NRC licensees must also meet State water quality
13 certification requirements under Section 401 of the CWA. The EPA or the State, not the NRC,
14 sets the limits for effluents and operational parameters in plant-specific NPDES permits. Nuclear
15 power plants cannot operate without a valid NPDES permit and a current Section 401 Water
16 Quality Certification. The EPA authorized the State of Minnesota to administer the NPDES
17 program in 1974.

18 Xcel Energy's NPDES permit (No. MN0000868) (Xcel 2023-TN9084, Xcel 2023-TN9578)
19 provides a detailed description of the MPCA-permitted outfalls, effluent (water quality)
20 monitoring requirements and a description of the main processes that contribute flow to each
21 outfall. The NRC staff incorporates this information here by reference. NPDES permits are
22 normally issued on a 5-year cycle. MPCA reissued Monticello's NPDES permit in May 2023.
23 During its review of Monticello's application, MPCA determined that locations previously
24 identified as surface discharge stations SD 003, SD 004, and SD 006 are better represented by
25 designating these flows as internal waste streams WS 004, WS 005, and WS 006, respectively
26 (Xcel 2023-TN9578). Based on its review, NRC staff did not identify any substantial changes in
27 the 2023 permit conditions as compared to the previous issuance.

28 Surface discharge station SD 001 (see Figure 3-3) is an external outfall that represents the plant
29 discharge out of the discharge canal to the Mississippi River and contains combined waste
30 streams represented by monitoring stations WS 001, WS 002, WS 003, WS 004, and WS 006.
31 Monticello's NPDES monitoring stations are summarized in Table 3-8. Depending on the station,
32 Xcel Energy is required to monitor flow rate, pH, total suspended solids, oil and grease, total
33 residual chlorine, cooling water intake and discharge temperatures, and other specified
34 parameters. Xcel Energy's NPDES permit specifies the pollutant-specific discharge limitations and
35 monitoring requirements for effluents discharged through each outfall/monitoring station to ensure
36 that discharges from Monticello comply with applicable water quality standards. Xcel Energy must
37 notify and seek approval from the MPCA before using any new water maintenance chemicals or
38 to increase quantities used, because such changes could alter Monticello permitted effluent
39 quality. Over the period of 2016 to August 2022, there have been no NOV or non-compliances
40 associated with Monticello wastewater discharges to receiving surface waters (Xcel 2023-
41 TN9084).

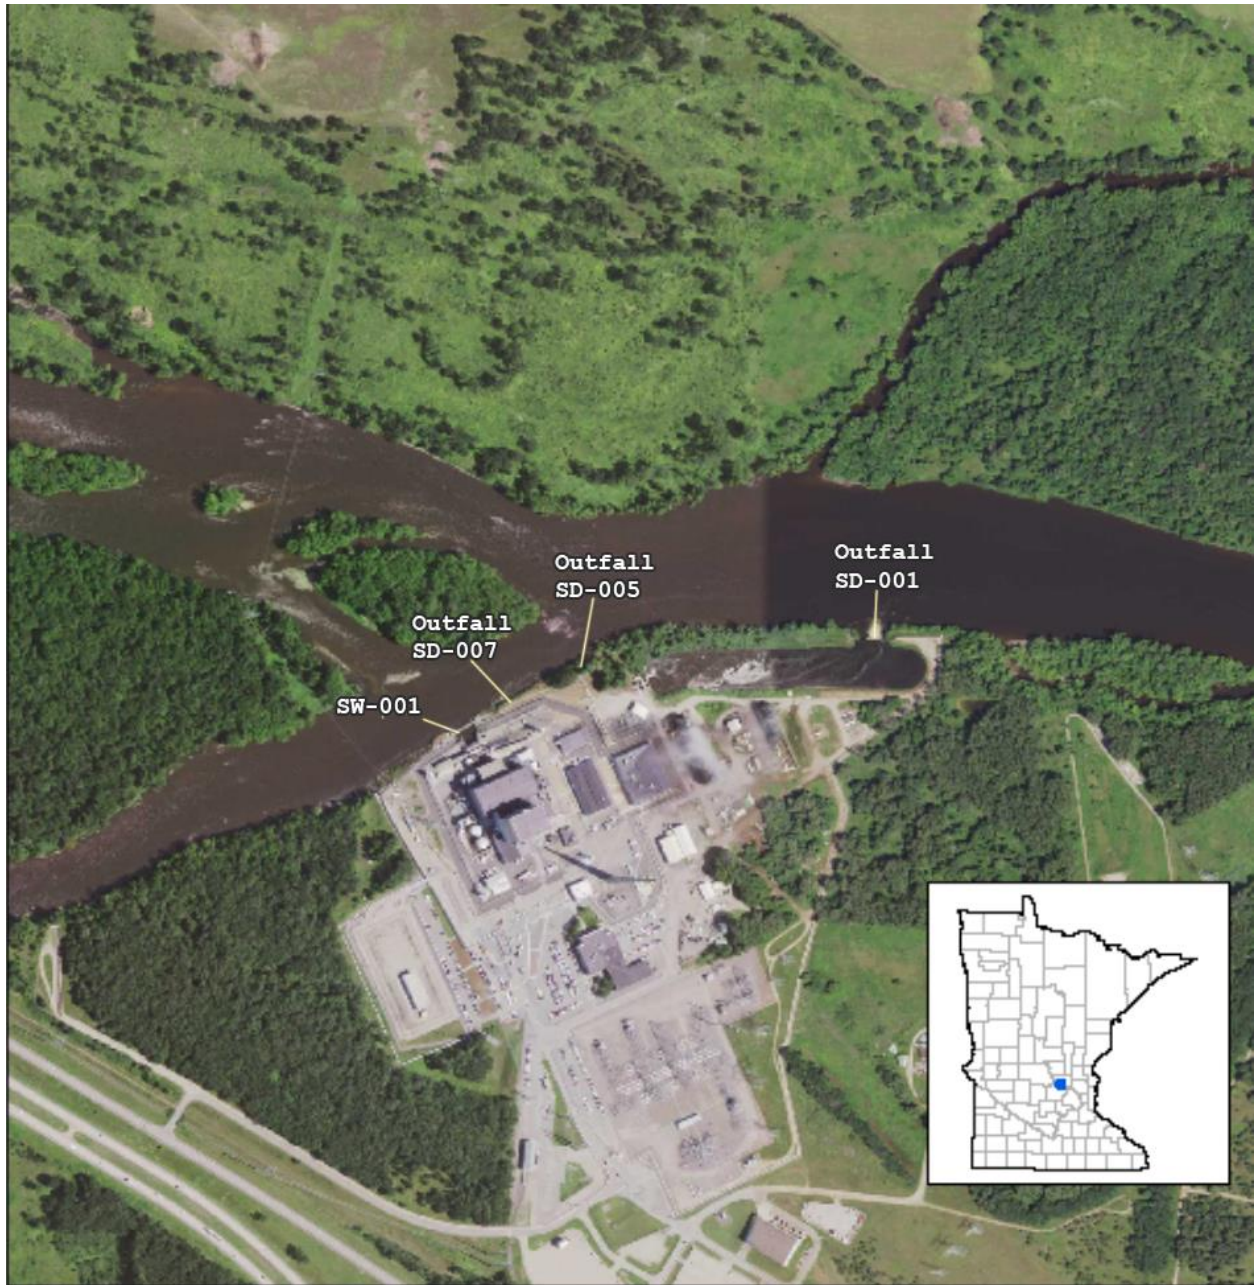

Map produced by: MPCA Staff, 8/12/2021
 Scale: 1:8,000

0 0.075 0.15 0.3 Miles

1
 2
 3
 4
 5

Figure 3-3 Monticello Nuclear Generating Plant External National Pollutant Discharge Elimination System Monitoring Locations. Adapted from: Xcel 2023-TN9084, Fig 3.6-3.

1 **Table 3-8 Monticello Nuclear Generating Plant’s National Pollutant Discharge**
 2 **Elimination System Monitoring Stations**

Station	Type of Station	Local Name
SD 001	Effluent To Surface Water (Mississippi River)	Plant Cooling Water Discharge
SD 005	Effluent To Surface Water (Mississippi River)	Screen Backwash Discharge
SD 007	Stormwater, Non-specific Runoff	Plant Yard (Intake)
SW 001	Stream/River/Ditch, Upstream	Plant Cooling Water Intake
WS 001	Internal Waste Stream	Mid-downstream Discharge Canal
WS 002	Internal Waste Stream	Condenser Cooling Water
WS 003	Internal Waste Stream	Service Water
WS 004	Internal Waste Stream	Retention Pond Effluent Discharge
WS 005	Internal Waste Stream	Turbine Building Sump and Miscellaneous Discharge
WS 006	Internal Waste Stream	Screen Backwash and Stormwater Roof/Yard Drain

Source: May 2023 NDPEs permit (Xcel 2023-TN9578).

3 Other Surface Water Resources Permits and Approvals

4 An applicant (in this case, Xcel Energy) for a Federal license to conduct activities that may
 5 cause a discharge of regulated pollutants into navigable waters of the United States is required
 6 by CWA Section 401 to provide the Federal licensing agency (in this case, the NRC) with water
 7 quality certification from the certifying authority (in this case, the State of Minnesota). This
 8 certification denotes that discharges from the project or facility to be licensed will comply with
 9 CWA requirements and will not cause or contribute to a violation of State water quality
 10 standards. If the applicant has not received Section 401 certification, the NRC cannot issue a
 11 renewed license, unless the State has otherwise waived the requirement.

12 In its ER, Xcel Energy provided copies of MPCA letters from 1973 and 1977 regarding CWA
 13 Section 401 certification. The 1973 MPCA letter issued the initial Section 401 certification to
 14 Monticello. The 1977 MPCA letter explicitly acknowledges that issuance of the NPDES permit
 15 by the State and compliance with that permit and any other applicable agreements by Monticello
 16 constitutes Section 401 certification. In a May 16, 2023, letter from MPCA to Xcel Energy,
 17 MPCA waived its Section 401 certification authority with respect to continued operations at
 18 Monticello during the SLR term; this letter also confirmed that the 1973 Section 401 certification
 19 remains valid for continued operations during the proposed SLR term (MPCA 2023-TN9835).

20 CWA Section 404 governs the discharge of dredge and fill materials to navigable waters,
 21 including wetlands, primarily through permits issued by the U.S. Army Corps of Engineers
 22 (USACE) and applicable state-level permitting programs. Monticello holds both a USACE
 23 regional general permit (RGP-003-MN) and a MDNR State dredge permit (1967-0743) to
 24 conduct maintenance dredging activities in the intake canal and Mississippi River. Monticello’s
 25 NPDES/SDS permit contains reporting requirements and additional details related to dredged
 26 material management.

27 **3.5.2 Groundwater Resources**

28 This section describes the groundwater flow systems (aquifers) and groundwater quality in and
 29 around Monticello. Aquifers are a geologic formation, group of formations, or part of a formation
 30 that contain sufficient saturated, permeable material to yield significant quantities of water to
 31 wells and springs.

1 3.5.2.1 *Local and Regional Groundwater Resources*


2 Sections 3.5.2 and 3.6.2 of the Xcel Energy ER (Xcel 2023-TN9084) describe the geology and
3 groundwater resources, respectively, in the vicinity of Monticello. The NRC staff also evaluated
4 information related to the groundwater resources during the site audit, the scoping process, and
5 during its review of other available information as cited in this EIS.

6 Monticello, located in Wright County, is in the central groundwater province of Minnesota
7 (MnDNR 2021-TN9636). The region was subject to multiple advances of continental glaciers
8 over the past 2.6 million years (USGS 1992-TN9637). The glacially deposited sediments
9 comprise the surficial aquifer system, which includes permeable layers of sands and gravels
10 that are the primary supply of groundwater in the region (Xcel 2023-TN9084). In this region of
11 Minnesota, glacial sediments are underlain by the Cambrian-Ordovician aquifer system
12 (consisting of one or more hydraulically connected aquifers) that regionally consists of a
13 sandstone and dolomite aquifer and two sandstone aquifers interbedded by less permeable
14 units (USGS 1992-TN9637). The Cambrian-Ordovician aquifer system is a major source of
15 groundwater in southeastern Minnesota for public, domestic, agriculture, and industrial uses
16 (USGS 1992-TN9637). The Cambrian-Ordovician aquifer system overlies a crystalline-rock
17 aquifer of low water-bearing capacity (USGS 1992-TN9637).

18 As described in Section 3.4.1 of this EIS, Monticello is underlain by unconsolidated sediments of
19 fill, river terrace deposits, an upper sandy till, glacial outwash, and a lower clay till. These
20 sediments range in depth from 40 to 110 ft bgs (12.2 to 33.5 m bgs) (Xcel 2023-TN9084).
21 Groundwater in the surficial aquifer occurs at a depth from 10–40 ft bgs (3.0–12.2 m bgs) at the
22 site and is typically found in the terrace or outwash sediments (Xcel 2021-TN9633). The
23 saturated thickness of the surficial aquifer is approximately 15 ft (4.6 m), terminating in the lower
24 clay till layer (Xcel 2023-TN9084). The low-permeability lower clay till confines the underlying
25 Mount Simon-Hinckley sandstone bedrock aquifer onsite (the lower most unit of the Cambrian-
26 Ordovician aquifer system). The sandstone aquifer ranges in thickness between 10 and 25 ft
27 (3.0–7.6 m) at the site (thickening to the east) and has been eroded variably, with some areas
28 completely eroded to the underlying granitic crystalline-rock aquifer (Xcel 2023-TN9084).

29 The outwash sediments (predominantly sands and gravels) that form the surficial aquifer in the
30 region of Monticello can yield up to 1,000 gpm with sufficient saturated thickness (Lindholm
31 1980-TN9703). Tests performed by the USGS in Benton, Sherburne, Stearns, and Wright
32 counties resulted in specific yield values ranging from 0.01–0.32 within the unconfined
33 sediments. The average specific yield of these tests was 0.17 and the nearest well tested to
34 Monticello (4 mi [6.4 km] northwest) resulted in a high specific yield of 0.29. The range of
35 specific yields for water table aquifers is expected to be 0.05–0.30 (Lindholm 1980-TN9703).

36 Within Wright County, spring snowmelt and precipitation are the primary sources of groundwater
37 recharge (Barry 2018-TN9638). Water generally flows toward the Mississippi River in the
38 surficial aquifers, while deeper bedrock groundwater flow tends to be to the southeast regionally
39 (Xcel 2021-TN9633). At Monticello, a similar trend in groundwater flow is observed with some
40 variation due to interference from plant structure foundations (Xcel 2023-TN9084). Typical
41 groundwater flow within the unconsolidated sediments is north toward the Mississippi River in
42 the western area of the site. In the central to eastern areas of the site, several factors cause
43 groundwater to flow in a more north-easterly direction, including shallow groundwater
44 intersecting the reactor and turbine buildings, the geologic transition from glacial outwash to
45 clayey till, and the natural curvature of the river (Xcel 2023-TN9084). Figure 3-4 depicts
46 groundwater contours and flow direction in June and December 2020.

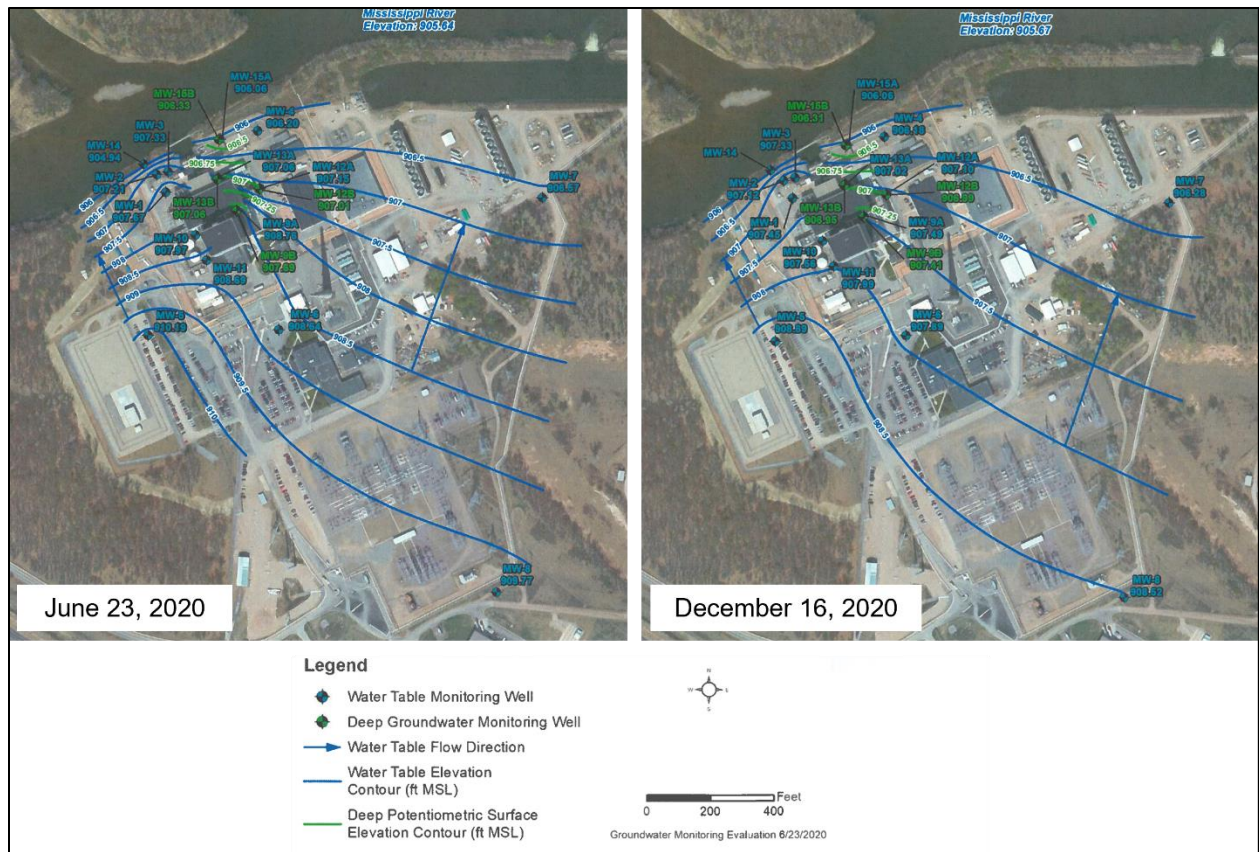

1
 2 **Figure 3-4 Groundwater Elevation Contours and General Groundwater Flow Direction**
 3 **in Shallow and Deep Aquifers in June and December 2020. Source: (Xcel**
 4 **2023-TN9084).**

5 Monitoring wells are screened in the unconsolidated sediments except for the deep (B-series)
 6 wells, which are screened in the upper weathered bedrock (Xcel 2023-TN9084). During high
 7 river stage periods, the direction of groundwater flow in the surficial aquifer near the river may
 8 reverse as river water flows into the shallow sediments (Xcel 2023-TN9084).

9 Hydraulic property data were collected in 14 Monticello monitoring wells and used to calculate
 10 groundwater flow velocities that ranged from 0.12–0.71 ft/day (0.037–0.22 m/day) in the surficial
 11 aquifer near the main plant structures and from 0.82–1.06 ft/day (0.25–0.32 m/day) in the
 12 deeper bedrock aquifer (Xcel 2023-TN9084: Table 3.6-2). These groundwater velocities were
 13 estimated using an average groundwater elevation gradient of 0.003. Based on the groundwater
 14 elevations shown in Figure 3-4, the average gradient between the main plant buildings and the
 15 river could be larger than 0.003, which would result in larger groundwater velocities. Estimated
 16 groundwater velocity in the bedrock aquifer is larger than in the surficial aquifer because the
 17 porosity of the sandstone is lower than that of the unconsolidated sediments comprising the
 18 surficial aquifer.


19 Monticello is not situated within the boundary of an EPA-designated sole source aquifer, the
 20 nearest of which is approximately 49 mi (78.9 km) to the north (EPA 2023-TN9841).

1 3.5.2.2 Local and Regional Water Consumption

2 The surficial aquifer system supplies the majority of groundwater (72 percent) in Wright County
3 (Barry 2018-TN9638). Potential well yields of the surficial aquifer system range from 10 to
4 500 gpm (38–1,900 Lpm) in the region depending on local saturated thickness and sand
5 content of the aquifer (USGS 1992). Bedrock aquifers provide the remaining groundwater use
6 in Wright County. Wells finished in the sandstone aquifer have been rated to pump up to
7 2,000 gpm (7571 Lpm) (Xcel 2021-TN9633). Municipal/public water supply is the predominant
8 use of groundwater in Wright County, followed by irrigation (Barry 2018-TN9638). The public
9 supply well nearest to Monticello is registered to the River Terrace Mobile Home Park, which
10 serves approximately 250 people and is approximately 2 mi (3.2 km) southeast of the plant,
11 (MnDH 2018-TN9640). The City of Monticello uses groundwater from the surficial aquifer
12 system and sandstone aquifer for public water supply (Barry 2018-TN9638).

13 There are approximately 178 registered groundwater wells within a 2 mi (3.2 km) radius of the
14 Monticello power block area, not including the onsite groundwater monitoring and supply wells
15 (Figure 3-5) (MnDH 2022-TN9641). The nearest registered well to Monticello is a domestic
16 water well, 0.6 mi (1 km) southwest of the center of the site, completed to a depth of 28 ft (85 m)
17 below ground level in fine sand (Xcel 2023-TN9084: Table 3-6.9). Most registered wells are
18 completed within the surficial aquifer system for domestic use. Shallow (less than 30 ft [9.1 m])
19 unregistered wells completed in the surficial aquifer and used for small amounts of domestic
20 water supply may be present within Wright County (Barry 2018-TN9638).

21

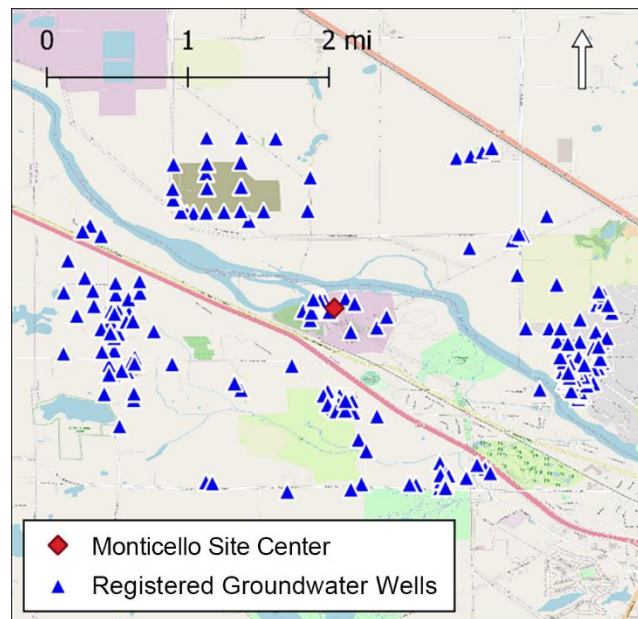


22 **Figure 3-5 Registered Groundwater Wells within 2 mi (3.2 km) Radius of the Monticello**
23 **power block area. Adapted from MnDH 2022-TN9641.**

24 Monticello withdraws onsite groundwater to provide water for potable use, purified water
25 production, and other plant system requirements (Xcel 2023-TN9084). Groundwater
26 withdrawals are regulated under MDNR water appropriations permit No. 67-0083 (Xcel 2023-
27 TN9084). The groundwater supply system is composed of two onsite wells, Well numbers 2 and
28 4 (alternate designations of Well #11 and Well #12, respectively), that are permitted to withdraw
29 up to 20 million gallons per year (75.7 million liters per year) at a maximum combined total rate


1 of 200 gpm (378.5 Lpm). From 2016–2022, withdrawals from the two onsite supply wells
 2 averaged approximately 11.2 million gallons per year (42.4 million liters per year), or 21.3 gpm
 3 (80.6 Lpm) total (Xcel 2023-TN9578). These wells withdraw water from the sandstone aquifer.

4 An additional five onsite groundwater wells actively supply domestic water, as needed, to a site
 5 warehouse and administration building. These wells each use less than 1 million gallons per
 6 year (3.8 million liters per year) and are not required to be permitted. Except for Well #3, which
 7 withdraws water from the sandstone aquifer, these wells access the surficial aquifer system.
 8 Locations of Monticello onsite water supply wells are shown in Figure 3-6.

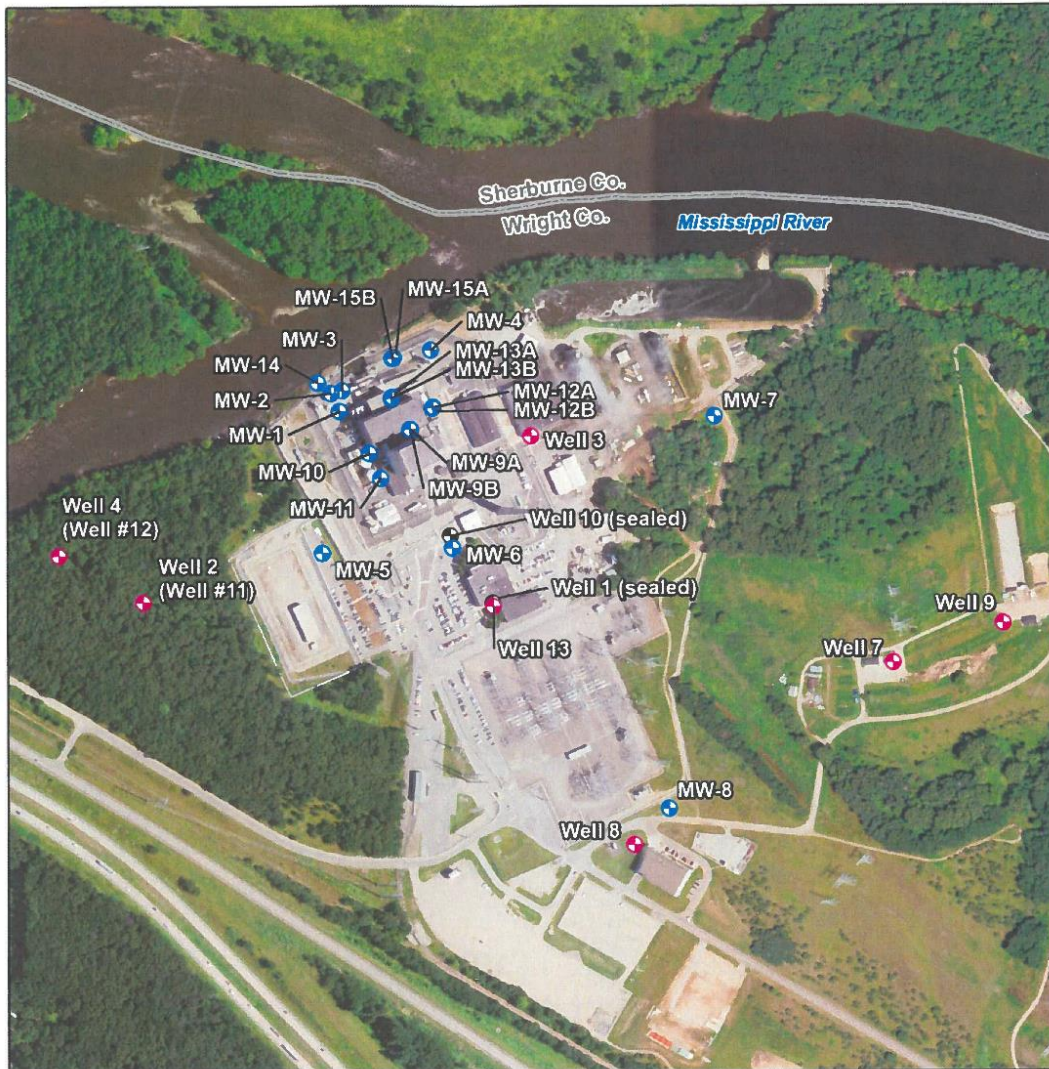

Legend

- ⊕ Monitoring Well
- ⊕ Water Supply Well
- ⊕ Sealed Water Supply Well



9
10
11

Figure 3-6 Monticello Nuclear Generating Plant Onsite Supply Wells, 2020 (Xcel 2023-TN9084). Note: Monitoring Wells Have Been Updated in 2022 and 2023.

1 3.5.2.3 *Groundwater Quality*

2 Groundwater in unconsolidated glacial deposits and the Mt. Simon-Hinckley Aquifer is typically
3 rich in calcium, magnesium, and bicarbonate. The dissolved solids concentration increases with
4 depth but is usually less than 500 mg/L (Albin and Bruemmer 1987-TN9643). Groundwater in
5 Minnesota is impacted locally by the predominant land use type. Urban areas are affected
6 by chloride, volatile organic carbon compounds, and emerging contaminants of concern
7 (e.g., persistent contaminants), while elevated nitrate concentrations are found in agricultural
8 areas (Kroening, and Vaughan 2019-TN9644).

9 *Nonradiological Releases*

10 Xcel Energy controls the use and storage of chemicals at Monticello in accordance with site-
11 specific spill prevention plans and best management practices in accordance with its NPDES
12 permit (No. MN0000868) (Xcel 2023-TN9578). From 2016 to July 18, 2023, Xcel Energy
13 reported two inadvertent nonradioactive releases (Xcel 2023-TN9578, Xcel 2023-TN9084).
14 On August 4, 2016, the Minnesota Department of Health issued an NOV for sampled carbon
15 tetrachloride concentrations (13.5 micrograms per liter [$\mu\text{g/L}$]) that exceed the maximum
16 contaminant level for drinking water (5 $\mu\text{g/L}$) (Xcel 2023-TN9084). The elevated carbon
17 tetrachloride levels were detected in Well #10, which supplied water to the security access
18 facility at Monticello. In response, a new connection to Well #1 was installed to replace the
19 water supply for the security access facility. Following a site investigation in 2018, no known
20 source of carbon tetrachloride was identified, and the impacted area was determined to be
21 limited to the vicinity of Well #10. In 2020, Well #10 was sealed, and Xcel Energy committed to
22 preventing the installation of new water supply wells in the vicinity of Well #10 (Xcel 2023-
23 TN9084). Well #1 was also sealed in 2020 due to low productivity, unrelated to the elevated
24 carbon tetrachloride levels detected in Well #10 (Xcel 2024-TN9860). Well #1 was replaced with
25 Well #13, which was installed in December 2020 (Figure 3-6)(Xcel 2023-TN9084).

26 On July 16, 2019, a flange between two valves in the service water sodium hypochlorite
27 injection system leaked approximately 300 gal (1136 L) of water into the building containing the
28 injection system. While most of the spill volume was contained within the building by a berm,
29 approximately 0.5 gal (1.9 L) drained to Outfall SD001, which returns to the Mississippi River. A
30 release sampling report was submitted to the MPCA. No further action was required by the
31 MPCA (Xcel 2023-TN9084).

32 *Groundwater Protection Program*

33 Based on the Industry Groundwater Protection Initiative (NEI 2019-TN6775), a Groundwater
34 Protection Program (GWPP) was implemented at Monticello in 2008 to ensure timely and
35 effective management of situations involving inadvertent releases of licensed material to
36 groundwater (Xcel 2023-TN9084). As part of the GWPP, Monticello monitors groundwater via
37 onsite monitoring wells for tritium, gamma-emitting nuclides, difficult to detect radionuclides,
38 environmental conditions, and groundwater elevation in accordance with their site-specific
39 procedures. Under normal conditions, monitoring locations are sampled monthly, quarterly, or
40 annually, with tritium and gamma-emitting nuclides tested quarterly at locations more prone to
41 leak or spill detection. Locations near to higher-risk systems, structures, and components are
42 monitored monthly for tritium and quarterly for gamma-emitting nuclides (Xcel 2023-TN9084:
43 Table 3.6-10). Results of the GWPP monitoring are submitted to the NRC in annual monitoring
44 reports and are discussed in the sections below.

1 *Radiological Releases*

2 The GWPP at Monticello established a baseline threshold for measured tritium concentrations
3 based on historical precedent. At monitoring locations where tritium is consistently measured
4 below limits of detection, the baseline threshold for a determination that tritium is above
5 background levels is set at 400 pCi/L. If concentrations meet or exceed 1,200 pCi/L (three times
6 the baseline) in these wells, additional action is taken to identify the source of the change in
7 activity and any corrective actions necessary (Xcel 2023-TN9084). By comparison, the EPA's
8 maximum contaminant level (the highest level of a contaminant that is allowed in drinking water)
9 for tritium is 20,000 pCi/L. As part of the GWPP, Monticello considers six monitoring wells (MW-2,
10 MW-3, MW-4, MW-14, MW-15A, and MW-15B) as "sentinel" wells that would act as a first
11 indication of radioactive material migrating offsite to the Mississippi River (Xcel 2023-TN9596)

12 Annual Radiological Effluent Release Reports are submitted to the NRC (per 10 CFR 50.36a) to
13 report the quantities of radionuclides released from liquid and gaseous effluents and the results
14 of groundwater monitoring under the GWPP (Xcel 2023-TN9596, Xcel 2022-TN9595, Xcel
15 2021-TN9597, Xcel 2020-TN9598, Xcel 2019-TN9599). The NRC staff reviewed 5 years of
16 available radiological release reports (2018–2022 monitoring results). While no radioactive
17 materials due to plant operations were detected in offsite samples from 2018–2022, elevated
18 tritium concentrations have been measured on site at well MW-9A since 2009 (Xcel Energy,
19 2019 - 2023 ARERRs). An additional release of effluent containing elevated tritium activity was
20 reported in November 2022. Incidents are summarized below.


21 *Historical Tritium Detection in Well MW-9A*

22 Monitoring well MW-9A was installed in September 2009, and initial sample results indicated
23 elevated tritium levels (average of 9,117 pCi/L, maximum of 21,727 pCi/L in 2009), see
24 Figure 3-7 (Certrec 2009-TN9840). Investigations into the source of the elevated activity
25 identified tritiated process water from the Turbine Building that likely migrated through the
26 building's concrete basemat into the groundwater (Xcel 2023-TN9084). Corrective actions were
27 taken in 2011, including installing sump linings and discontinuing the use of embedded piping.
28 After those corrective actions were completed, average tritium activity at MW-9A from
29 2012–2021 ranged between 306 and 4,147 pCi/L (Figure 3-7).

30 Prior to 2022, the plume of tritiated groundwater in the vicinity of MW-9A was considered to be
31 located under the turbine building and predominantly stagnant, evidenced by the lack of tritium
32 measured in down-gradient wells (Xcel 2023-TN9084). The hydraulic setting of Monticello along
33 the Mississippi River results in changes in hydraulic gradient depending on seasonal
34 fluctuations in groundwater and river stage, thus resulting in periods of groundwater flow
35 reversal that could cause fluctuations in the tritium activity measured in well MW-9A (Xcel 2023-
36 TN9084). As described in Section 3.5.2.1 of this EIS, groundwater flow patterns are affected by
37 building foundations that may affect the movement of tritium in the vicinity of MW-9A toward the
38 Mississippi River.

39 *2022 Tritium Release to Groundwater*

40 On November 23, 2022, Monticello notified the State of Minnesota and the NRC that a sample
41 result for tritium from an onsite monitoring well was above the ODCM and GWPP reporting
42 levels (NRC 2022-TN9600). As part of the environmental audit process, Xcel Energy provided a
43 timeline of events, including corrective actions taken and groundwater sample data covering the
44 interval from the initial identification of the leak to August 2023 (Xcel 2023-TN9609). The NRC
45 staff analyzed the provided information and publicly available information.

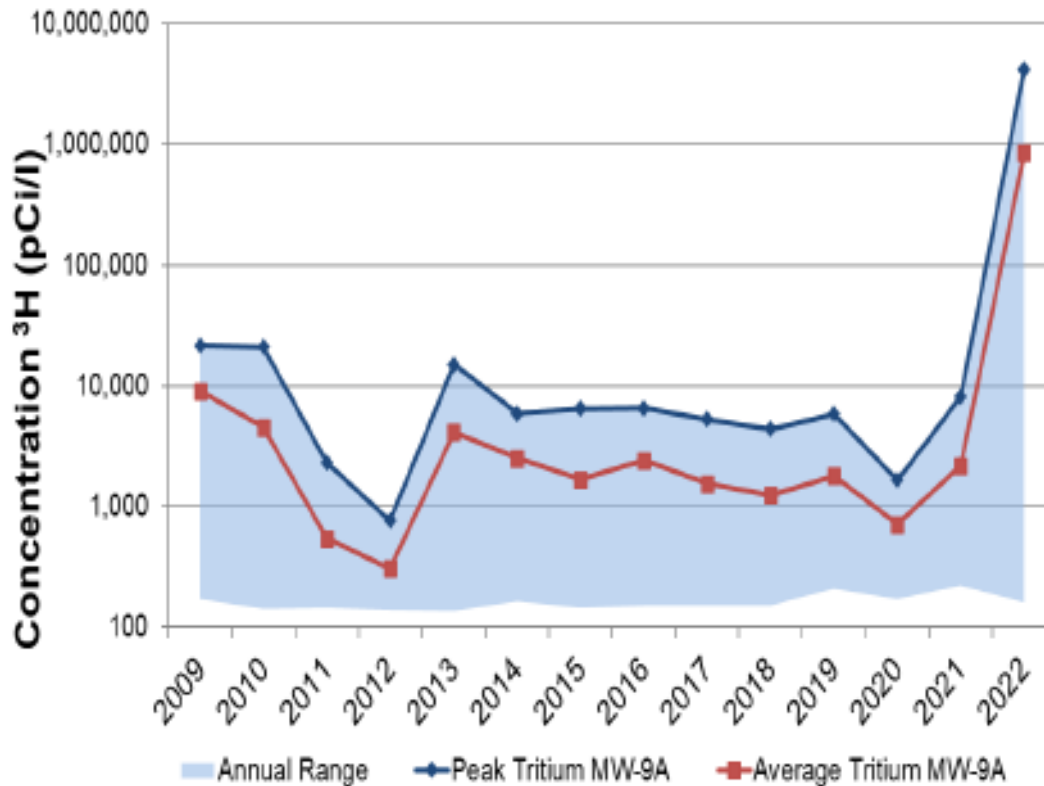

1


2 **Figure 3-7 Tritium Concentrations at Well MW-9A between 2009–2022 from the 2022**
 3 **Monticello Annual Radioactive Effluent Release Report (Xcel 2023-TN9596)**

4 On November 21, 2022, a sample from MW-9A recorded a tritium concentration of
 5 5,020,000 pCi/L (Xcel 2023-TN9609). Additional sampling the following day confirmed the
 6 elevated tritium level at MW-9A, and a voluntary notification was sent to the State of Minnesota
 7 and the NRC on November 22, 2023 (NRC 2022-TN9600). The notice states no impact to the
 8 health and safety of the public or plant personnel was identified. Samples from MW-9A were
 9 also analyzed for I-131, I-133, I-135, Xe-133, and Xe-135 (Xcel 2023-TN9609). The maximum
 10 non-tritium isotope activity recorded was 147 pCi/L for I-133. Additional groundwater sample
 11 results from March 28 to September 18, 2023, did not detect non-tritium radionuclides in
 12 groundwater.

13 On December 21, 2022, Xcel Energy identified the leak location as a 3 in. (7.62 cm) condensate
 14 to control rod drive (CRD) suction line pipe between the reactor building and the turbine
 15 building. Diversion of the leak effluent using a catchment system coupled with a groundwater
 16 recovery system (0.5–2 gpm) at wells MW-9A, MW-9B, and MW-12A was initiated in January
 17 2023. The effluent was directed to holding tanks, waste process systems, and/or reused onsite
 18 (Xcel 2024-TN9645). On March 23, 2023, sampling results indicated the effluent was no longer
 19 contained within the catchment system. The plant was fully shut down, and on March 25, 2023,
 20 the CRD suction pipe was removed and replaced (Xcel 2023-TN9609). Additionally, beginning
 21 in December 2022, Monticello expanded the network of onsite monitoring wells to better assess
 22 the extent of the tritium plume. As of August 2023, there were 55 onsite monitoring wells.


1 On May 23, 2023, Xcel Energy provided an additional notice to the State of Minnesota and the
 2 NRC to report a release of 300–600 gal of water with a tritium activity of 194,000 pCi/L from a
 3 holding tank associated with the ongoing remediation efforts (NRC 2023-TN9610; Xcel 2023-
 4 TN9609). The water was released back to the area from which it was pumped, and no impact to
 5 the health and safety of public or plant personnel was identified.

6 Corrective action measures are ongoing to recover the tritium plume in onsite groundwater and
 7 minimize the discharge of tritiated groundwater to the Mississippi River. Eight pumping wells for
 8 tritium extraction have been installed since the detection of the leak, two of which were
 9 monitoring wells that were over-drilled and converted to pumping wells (Xcel 2023-TN9609).
 10 A storage pond was constructed for managing recovered groundwater with elevated tritium
 11 activity. A water balance analysis estimated the volume of water released into the subsurface
 12 from the initial leak to be 829,000 ±68,100 gal (3,138,106 ± 257,786 L), with a total activity of
 13 14.0 ±1.2 Ci (99 percent of the activity from tritium) (Xcel 2023-TN9609). As of October 2023,
 14 approximately 6.6 million gal (25 million L) of tritium-contaminated groundwater had been
 15 pumped from onsite wells (Xcel 2023-TN9609) (see Figure 3-8). The overall average pumping
 16 rate across all wells from January–October 2023 was 1.3 gpm (4.9 Lpm). Monthly average
 17 pumping rates at individual wells did not exceed 16 gpm (60.6 Lpm) (Xcel 2023-TN9609).

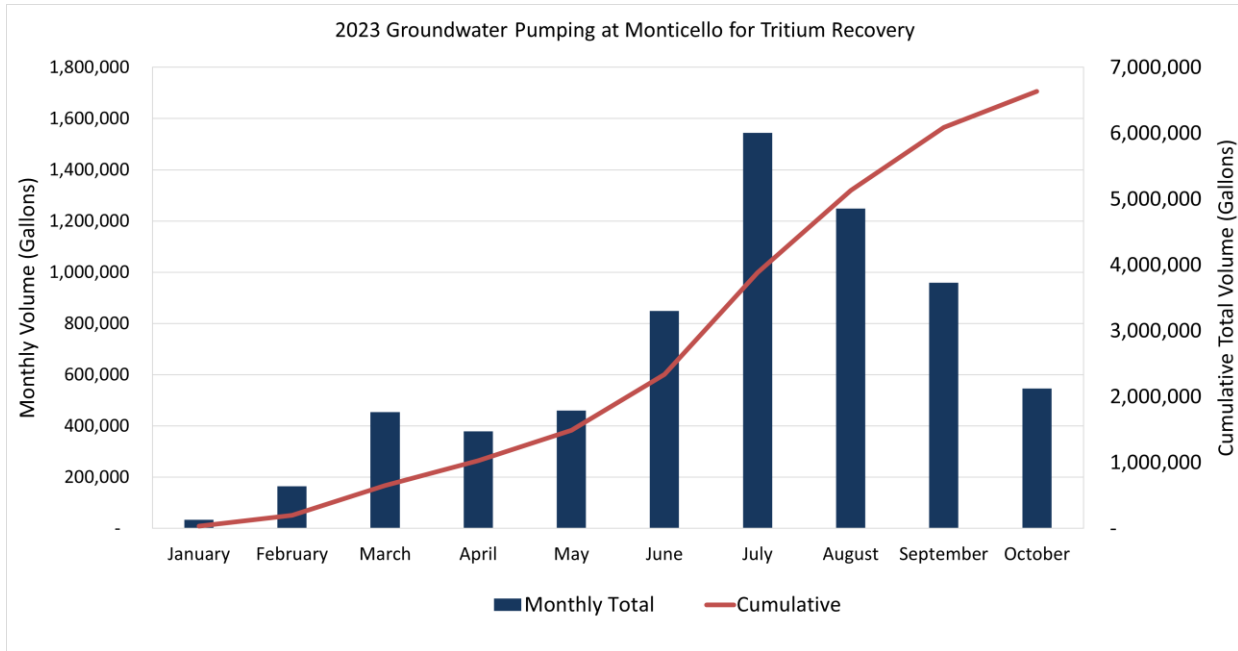


18
 19 **Figure 3-8 Monthly and Total Cumulative Volume of Groundwater Pumped during**
 20 **January–October 2023 for Tritium Recovery. Based on Data From (Xcel**
 21 **2023-TN9609).**

22 Figure 3-9 depicts the monitoring and pumping wells on site at Monticello as of August 18,
 23 2023, as well as the storage pond location. Figure 3-10 shows the locations of wells in greater
 24 detail along with the estimated extent of tritium-impacted groundwater as of August 2023.

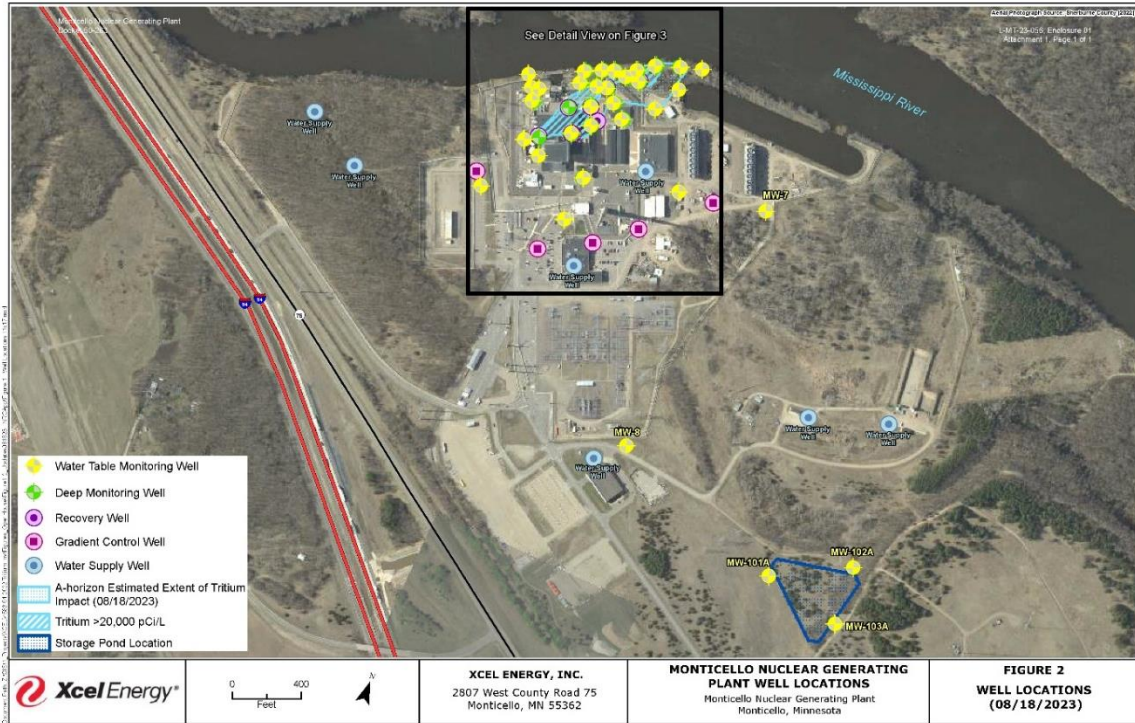


1
2 **Figure 3-9 Updated Monticello Well Locations and Location of Storage Pond (Xcel**
3 **2023-TN9609)**

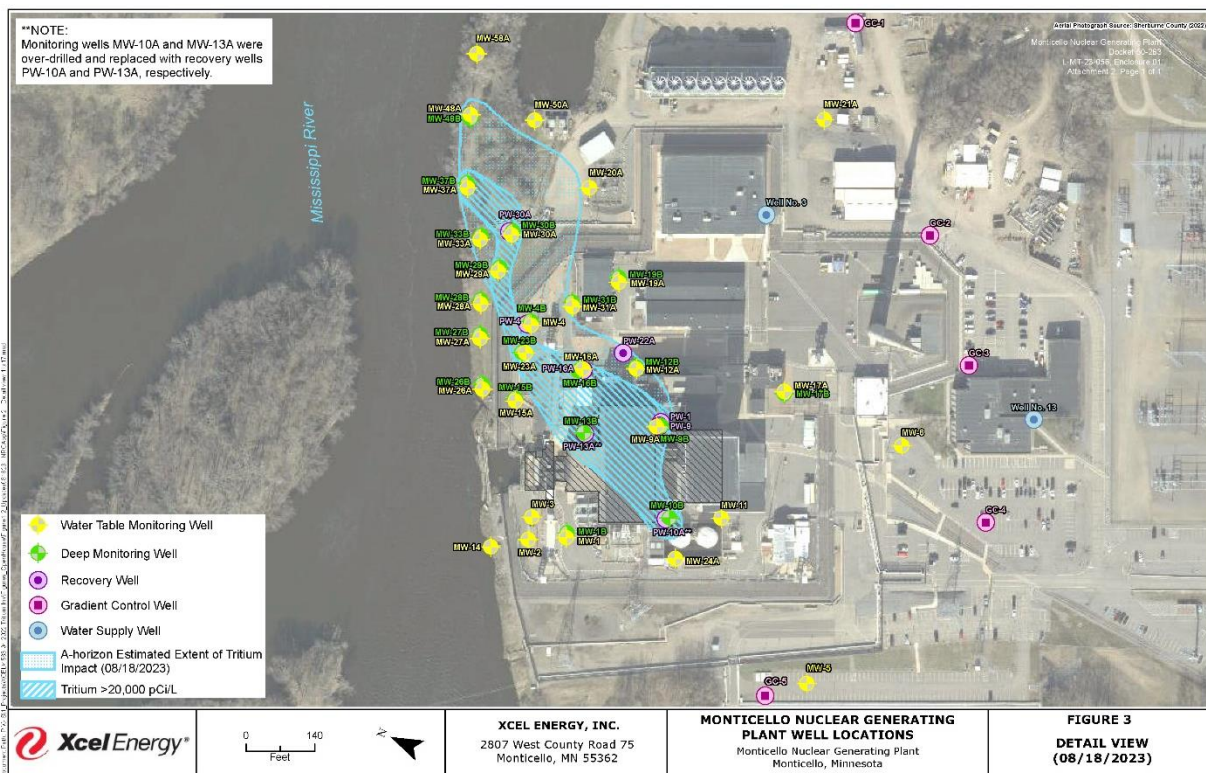

4
5 **Figure 3-10 Extent of Tritium-impacted Groundwater and Locations of Monticello Wells**
6 **as of August 2023 (Xcel 2023-TN9609)**

1 In addition to extracting tritiated groundwater, a sheet pile wall was constructed at Monticello
2 near the Mississippi riverbank to minimize tritium discharge from groundwater into the river
3 (Xcel 2024-TN9645). The sheet pile wall extends from the southern end of the discharge
4 structure to the intake canal. As of August 30, 2023, five gradient control wells have been
5 installed on the eastern boundary of the site (Figure 3-9). These wells are intended to intercept
6 clean, inflowing groundwater and maintain the onsite groundwater levels below the top of the
7 sheet pile wall to help contain tritium-contaminated water to the Monticello site. Pumping is not
8 intended to permanently draw down groundwater levels (Xcel 2024-TN9859) but is anticipated
9 to be needed only during those times when the groundwater levels are relatively high. The rate
10 of pumping from the gradient control wells will depend onsite groundwater levels, which are
11 expected to vary between 50 and 150 gpm (189–568 Lpm) at each well (Xcel 2024-TN9859).
12 Well GC-5 did not yield sufficient water during a pump test and was determined to be
13 infeasible for gradient control use (Xcel 2024-TN9859). Water Appropriation Permit No. 2023-
14 2958 specifies maximum withdrawal limits and monitoring and reporting requirements Xcel
15 2024-TN9859. Water pumped from the gradient control wells must be discharged to the intake
16 canal, or temporarily to the plant discharge canal.


17 Monitoring data from the initial leak detection on November 11, 2022, to August 2023 indicates
18 a downward trend in tritium activity for the groundwater most impacted by the release.
19 Figure 3-11 presents measured tritium concentrations at monitoring wells MW-9A (more shallow
20 groundwater) and MW-9B (deeper groundwater). Groundwater recovery pumping began at
21 both wells in January 2023. Pumping ceased first at MW-9B in April, followed by MW-9A in
22 June. By mid-May, tritium concentrations in MW-9B were consistently measured to be
23 below 20,000 pCi/L (the drinking water standard) but have not returned to background
24 levels. Concentrations at MW-9A have decreased overall, but remain elevated well above
25 20,000 pCi/L.

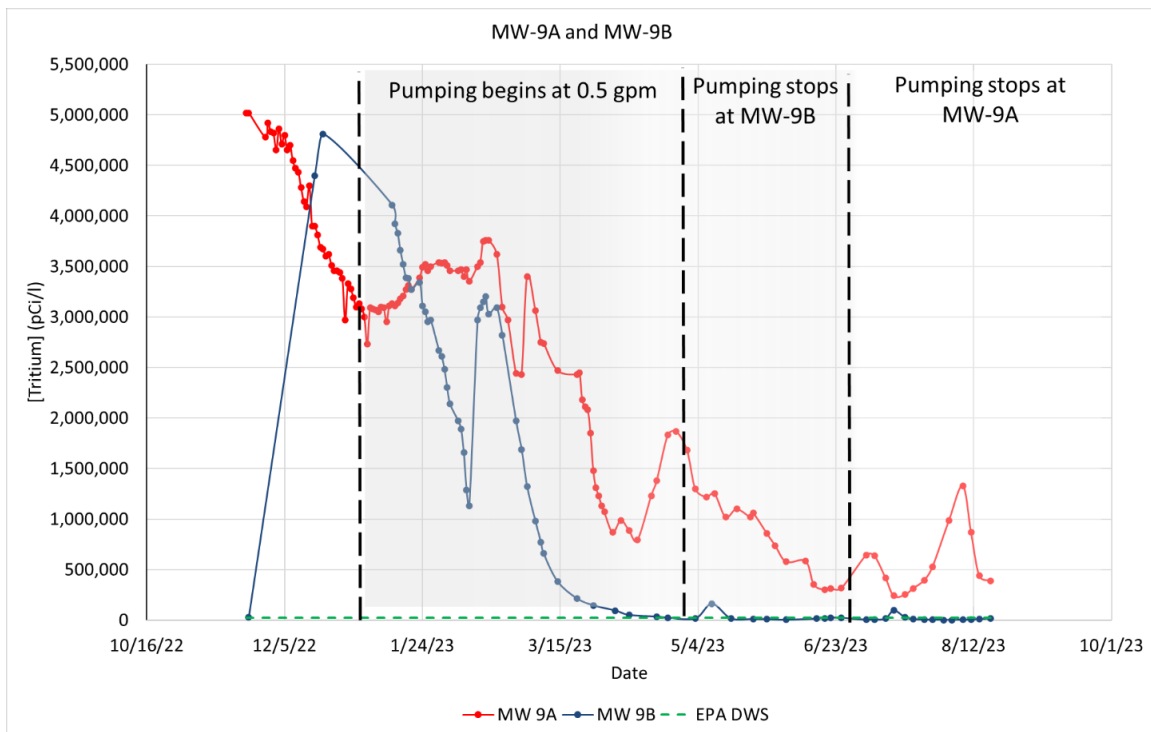


26

27 **Figure 3-11 Measured Tritium Activities at Groundwater Monitoring Wells MW-9A and**
28 **MW-9B. Based on Data from Xcel 2023-TN9609.**

1 Under normal site hydraulic conditions, groundwater flow is toward the Mississippi river, as
 2 described in Section 3.5.2.1. Onsite groundwater is hydraulically connected to the river;
 3 therefore, groundwater flow reversal can occur due to changes in hydraulic gradient during
 4 periods of high river stage. Hydraulic gradient reverses onsite when the river level rises above
 5 the groundwater table and river water flows into the aquifer. A period of groundwater reversal is
 6 highlighted in Figure 3-12. River stage rose 7.57 ft (2.3 m) between April 2 and April 10, 2023.
 7 As shown in Figure 3-12, groundwater levels in monitoring wells closer to the river (MW-2 and
 8 MW-1A) are more responsive to rising river levels than wells further away from the river
 9 (MW-10A). This indicates groundwater flow is temporarily occurring from the river toward the
 10 plant buildings. As the river level rapidly declines, the hydraulic gradient reverses back toward
 11 the river, resuming normal groundwater flow conditions from the plant towards the river.

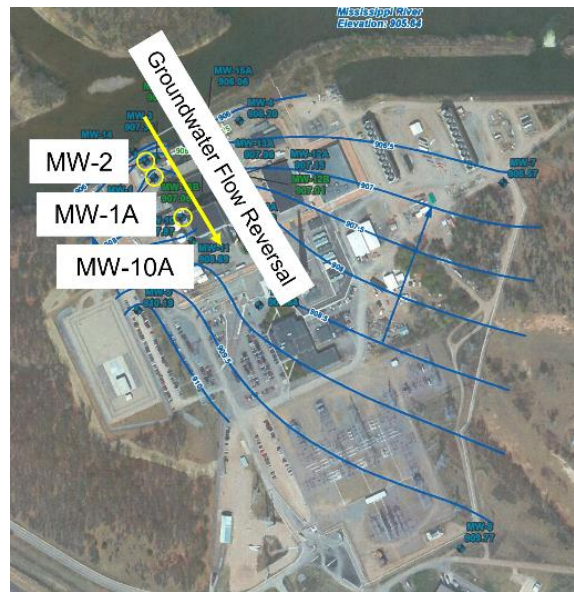

12

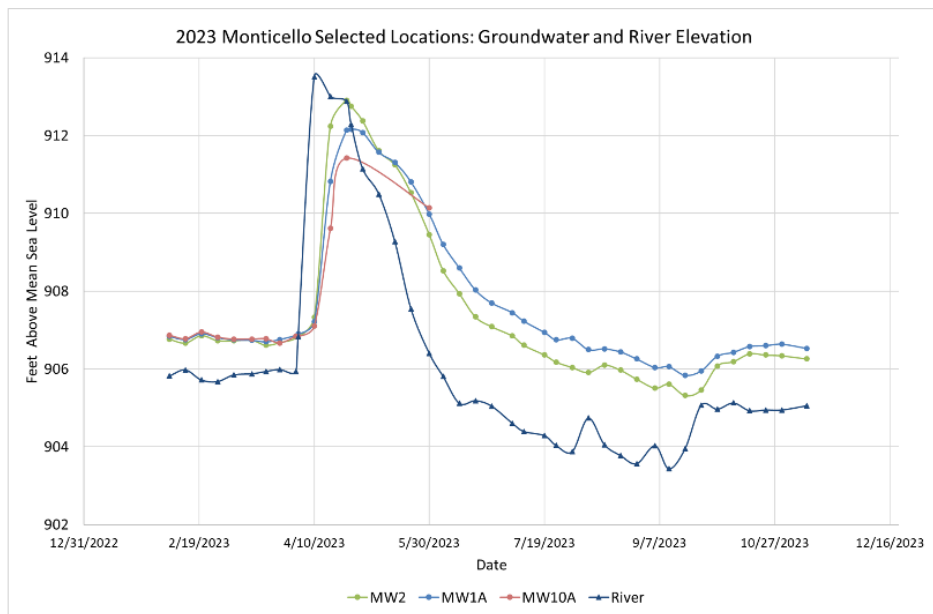


13

14 **Figure 3-12 Groundwater Elevations in Response to Changes in River Stage (Xcel 2023-**
 15 **TN9084; Xcel 2023-TN9609)**

1 The period of groundwater flow reversal in April and May 2023 helps explain some of the
 2 observed changes in tritium activities, like the explanation of the historical behavior of measured
 3 tritium concentrations at MW-9A from 2009–2021. During a groundwater flow reversal, tritium
 4 concentrations may increase in wells that are normally upgradient from the tritium plume.
 5 Figure 3-13 depicts the behavior of tritium concentrations at MW-10A, which is upgradient of the
 6 November 2022 tritium release location under normal groundwater flow conditions, in response
 7 to a groundwater gradient reversal. Tritium activity at MW-10A rapidly increased during the
 8 groundwater flow reversal and began to decline once normal flow was restored. As shown in
 9 Figure 3-10, the tritium plume does not extend further upgradient of MW-10A (i.e., no elevated
 10 tritium activity has been measured at MW-11).

11 Figure 3-10 depicts the area of tritium-impacted groundwater in August 2023. Following the
 12 initial release near MW-9A, impacted groundwater flowed to the northeast. Figure 3-14 presents
 13 tritium activities at monitoring wells in the impacted area where activities have been measured
 14 above background levels but below 120,000 pCi/L (as of August 2023). Tritium detections in
 15 wells near the Mississippi Riverbank (i.e., MW-29A, MW-33A, MW-37A, and MW-48A) in 2023
 16 indicate tritium-impacted groundwater likely discharged to the river. Minor levels (<100 pCi/L) of
 17 tritium were measured in river samples in March and April 2023. Further sampling, up to August
 18 2023, did not record tritium above detection limits in the river. From available sampling data
 19 (Xcel 2023-TN9609), tritium activity in wells MW-29A and MW-37A, which are near the river,
 20 were above the 20,000 pCi/L drinking water standard and trending in an upward direction as of
 21 August 2023 (see Figure 3-14). As described above, Monticello is pumping groundwater at eight
 22 wells for tritium recovery and has installed a sheet pile wall along the riverbank to minimize
 23 discharges of tritium-impacted water to the Mississippi River.

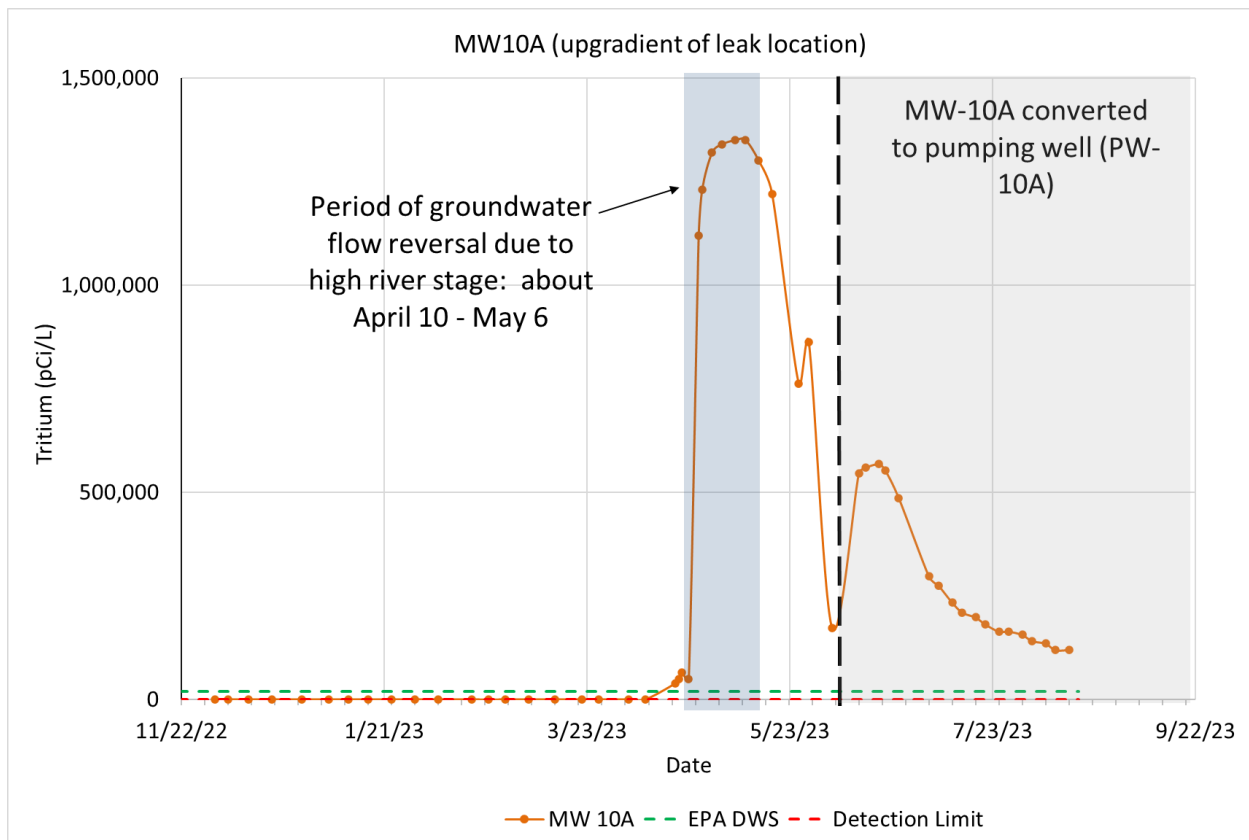

24
 25 **Figure 3-13 Measured Tritium Activities at MW-10A (Xcel 2023-TN9609)**

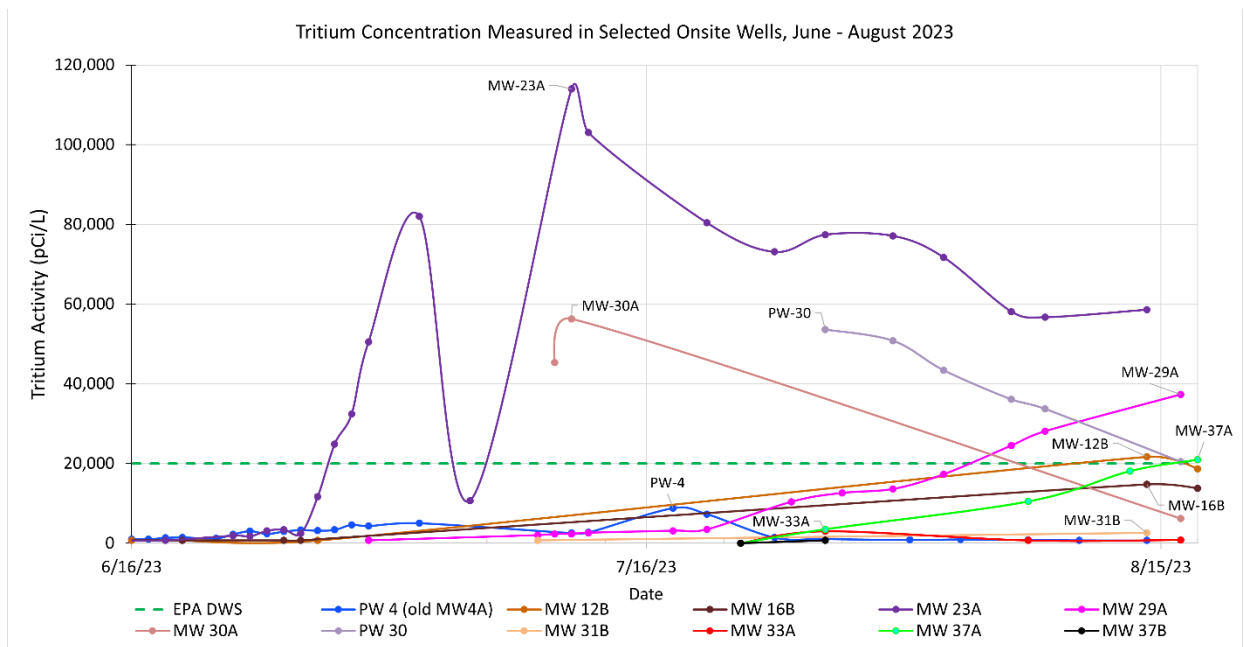


Figure 3-14 Measured Tritium Activities in Selected Onsite Well (Xcel 2023-TN9609)

3.5.3 Proposed Action

3.5.3.1 Surface Water Resources

The following sections address the site-specific environmental impacts of Monticello SLR on the environmental issues identified in Table 3-1 that relate to surface water resources.

Surface water use and quality (non-cooling system impacts)

During the SLR term, surface water may be used at a nuclear power plant for non-cooling systems (e.g., during refurbishment activities for concrete preparation, dust suppression, washing equipment, facility cleaning). Surface water quality could be degraded by stormwater runoff that may entrain pollutants from refurbishment-related land-disturbing activities or chemical and fuel spills.

Surface water use and quality are discussed and evaluated in Sections 3.6.3.1 and 3.6.4.1, respectively, of Xcel Energy's Xcel 2023-TN9084. Instead of relying on surface water, Monticello uses onsite groundwater wells to meet its potable and sanitary water demand, which reduces non-cooling water consumption at the plant. Surface water withdrawn from the Mississippi River is used at Monticello for condenser cooling, service water cooling, screen wash, and fire protection. Because onsite groundwater wells are used to meet domestic water demands, the volume of surface water used for non-cooling purposes is negligible compared to the volume used for cooling purposes.

Monticello discharges non-cooling water to the Mississippi River in accordance with its NPDES permit, which was re-issued in May 2023 (Xcel 2023-TN9578). To prevent and mitigate surface water impacts from pollutants in stormwater, and spills of oil and hazardous materials, Monticello has several plans and programs in place, including a SWPPP, an SPCC plan, a hazardous substance spill contingency plan, and a chemical control program. Additionally, Monticello identifies BMPs that will be used to prevent or reduce the pollutants in stormwater discharges. All stormwater management issues, and corrective measures taken throughout the

1 reporting period are documented in an annual report. Monticello has not proposed any
2 refurbishment activities related to SLR (Xcel 2023-TN9084).

3 As discussed in Section 3.5.2.3 of this EIS, on May 21, 2023, approximately 300–600 gal of
4 water, with an estimated tritium concentration of 1.94×10^5 pCi/L, overflowed a holding tank
5 associated with groundwater remediation efforts (Xcel 2023-TN9578). The overflow seeped into
6 the ground near the tank and did not discharge to surface water (Xcel 2023-TN9578).

7 The NRC staff has not identified new and significant information related to surface water use
8 and quality (non-cooling system impacts) during the audit, scoping process, or review of
9 available information cited in this EIS. Continued compliance with the NPDES permit and
10 stormwater regulatory requirements and permit conditions, implementation of the SWPPP, the
11 SPCC plan, and using BMPs, will minimize impacts on water quality. The NRC staff concludes
12 that the impacts on surface water use and quality from non-cooling water systems during the
13 proposed SLR term would be SMALL.

14 Altered Current Patterns at Intake and Discharge Structures

15 The intake and discharge of cooling system water has the potential to alter current patterns in a
16 surface water body. The degree of alteration depends on flow rates, characteristics of the
17 surface water body, and the design of the intake and discharge structures.

18 Cooling system water at Monticello is withdrawn from the Mississippi River through an approach
19 channel formed by sheet pile structures that extend approximately 59 ft (18 m) into the river.
20 The width of the approach is reduced from approximately 98 ft to 63 ft (29.9 m to 19.2 m), where
21 the water enters the intake over a concrete sill.

22 Cooling system water is returned to the Mississippi River through an approximately 1000 ft
23 (304.8 m) long discharge canal. The discharge canal has an easterly horizontal alignment, with
24 a bottom slope of approximately 0.25 percent. A 54 ft (16.5 m) wide weir structure is located at
25 the end of the discharge canal. Concrete and rip-rap aprons are located downstream of the weir
26 are to prevent scour.

27 Xcel Energy anticipates no modifications to the operation of the plant's cooling system
28 associated with the proposed SLR term that may change the existing current patterns at the
29 intake and discharge structures (Xcel 2023-TN9084). The NRC staff has not identified any new
30 information related to altered current patterns. The NRC staff expects that the effect on currents
31 near the intake and discharge structures are localized and would remain the same during the
32 proposed SLR term. The NRC staff concludes that the impacts on altered current patterns at
33 intake and discharge structures for the proposed SLR term would be SMALL.

34 Scouring Caused By Discharged Cooling Water

35 The high flow rate of water from a cooling system discharge structure has the potential to scour
36 sediments and redeposit them elsewhere. The degree of scouring depends on the design of the
37 discharge structure, the discharge flow rate, and the sediment characteristics. Scouring is
38 expected to occur only in the vicinity of the discharge structures where flow rates may be high.
39 While scouring is possible during reactor startup, operational periods would typically have
40 negligible scouring.

41 Withdrawal and discharge of water to and from the Mississippi River are discussed in
42 Section 2.2.3 of Xcel Energy's ER (Xcel 2023-TN9084). Cooling system water is returned to the
43 Mississippi river via a 54 ft (16.5 m) wide weir structure located at the end of the discharge

1 canal. A 20 ft (6.1 m) long concrete apron with a downstream 50 ft (15.2 m) long rip-rap apron is
2 located downstream of the weir to prevent scour. No plant operations or modifications are
3 planned for the Monticello cooling system that would alter discharge patterns during the SLR
4 term (Xcel 2023-TN9084). Because no changes in existing current patterns are expected,
5 changes in scouring impacts are also not anticipated.

6 The NRC staff identified no new information related to the Monticello's cooling system discharge
7 to the Mississippi River. The NRC staff concludes that the impacts on surface water quality due
8 to scouring caused by discharged cooling system water would be SMALL for the proposed SLR
9 term.

10 Discharge of Metals in Cooling System Effluent

11 Circulating cooling water can leach heavy metals such as copper, zinc, and chromium from
12 condenser tubing and other components of the heat exchange system. These metals are
13 normally addressed in NPDES permits because their presence in high concentrations can be
14 toxic to aquatic organisms.

15 The chemical additives approved by the MPCA to control microbiological activity and scale at
16 Monticello are described in Section 3.6.1.2.1 of Xcel Energy's ER (Xcel 2023-TN9084). The
17 Monticello NPDES permit does not have a metals limit or require monitoring for metals at the
18 circulating condenser cooling water outfall. The Monticello condenser tubes are made of
19 stainless steel and therefore would not contribute leached metals to the cooling water discharge
20 (Xcel 2023-TN9084).

21 The NRC staff has not identified any new and significant information related to discharge of
22 metals in cooling system effluent during the audit, scoping process, or review of available
23 information cited in this EIS. Based on compliance with current and future NPDES regulatory
24 requirements, permit conditions, and BMPs, the NRC staff concludes that the potential impacts
25 of metal discharge in the cooling system effluent for the proposed SLR term would be SMALL.
26 Discharge of biocides, sanitary wastes, and minor chemical spills

27 Biocides and other water treatment chemicals are commonly used in plant cooling systems to
28 control biofouling and nuisance organisms. The types of chemicals, concentrations, and
29 frequency of their use, however, are specific to each plant. Treated sanitary waste may be
30 released via onsite wastewater treatment facilities, a septic field, or through a connection to a
31 municipal sewage system. Minor chemical spills may be collected in floor drains. Each of these
32 activities or events has the potential to affect surface water quality.

33 Chemical additives and biocides are used to control scale, corrosion, and biofouling of
34 Monticello plant equipment. Monticello's NPDES permit governs the use of these chemical
35 additives and biocides. New chemical additives or dosage changes must be approved by MPCA
36 in accordance with Monticello's NPDES permit. Monticello has not been issued any NOV's
37 related to their NPDES permit in the past 5 years (Xcel 2023-TN9084, Xcel 2023-TN9578).

38 To prevent and mitigate surface water impacts from pollutants in stormwater, and spills of oil
39 and hazardous materials, Monticello has several plans and programs in place, including a
40 SWPPP, an SPCC plan, a hazardous substance spill contingency plan, and a chemical control
41 program. Monticello sanitary wastewater is discharged to the City of Monticello sanitary sewage
42 disposal system under an agreement with the City of Monticello. (Xcel 2023-TN9084).

1 Based on a review of site records over the last 5 years, there have been no releases at
2 Monticello that have triggered notification to the National Response Center and one release that
3 triggered notification to MPCA based on Minnesota Statute 115.061 (Xcel 2023-TN9084, Xcel
4 2023-TN9578).

5 A leak of approximately 300 gal of water from the service water sodium hypochlorite injection
6 system discovered on July 16, 2019, required notification to MPCA. The leak was contained
7 within a building berm except for approximately ½ gal of water that reached a floor drain that
8 returns to the Mississippi River through NPDES permitted Outfall SD 001 (Xcel 2023-TN9084).
9 MPCA did not provide any comment or requirements concerning the incident, and no recordable
10 spills or violations were reported in the NPDES permit compliance summary (Xcel 2023-
11 TN9084).

12 The NRC staff has not identified any new and significant information related to discharge of
13 biocides, sanitary wastes, and minor chemical spills. The NRC staff concludes that compliance
14 with current NPDES regulatory requirements and permit conditions along with the
15 implementation of SPCC, SWPPP, and BMPs will mitigate impacts from wastewater and
16 stormwater discharges. The NRC staff concludes that impacts from discharges of biocides,
17 sanitary wastes, and minor chemical spills would be SMALL during the SLR term.

18 Surface Water Use Conflicts

19 Nuclear power plant cooling systems may compete with other users relying on surface water
20 resources, including downstream municipal, agricultural, or industrial users. Once-through and
21 closed-cycle cooling systems have different water consumption rates. Once-through cooling
22 systems return most of their withdrawn water to the same surface water body, with evaporative
23 losses approximately 1 to 3 percent (Dieter et al. 2018-TN6681 and Solley et al. 1998-TN7508).
24 Plants using cooling towers need to replenish the consumptive loss of water to evaporation,
25 which can be 60 percent or more of the condenser flow rate by Solley et al. (1998-TN7508).

26 The typical water balance at Monticello is presented in ER Figure 2.2-1 (Xcel 2023-TN9084)
27 and is incorporated here by reference. Surface water withdrawn from the Mississippi River is
28 used at Monticello for service water cooling, screen washing, fire protection, and condenser
29 cooling (Xcel 2023-TN9084).

30 The Monticello cooling water system employs a flexible multicycle system with the capability of
31 once-through circulation of river water, recirculation in a closed cycle with two MDCTs, and
32 several variations of these basic modes. Given that Monticello operates in various modes, both
33 the Surface Water Use Conflicts (Plants with Cooling Ponds or Cooling Towers Using Makeup
34 Water from a River) and Surface Water Use Conflicts (Plants with Once-Through Cooling
35 Systems) issues are addressed jointly in this section.

36 Monticello has a surface water appropriation permit, No. 66-1172, that authorizes it to pump
37 water from the Mississippi River at a rate varying up to 645 cfs with a maximum total annual
38 appropriation of 467,000-acre feet. Monticello does not anticipate the need for an increased
39 surface water allocation during the SLR term (Xcel 2023-TN9084). The operating modes for the
40 circulating water system are specified by the NPDES permit (Xcel 2023-TN9578) discharge
41 limits and the surface water appropriations permit; these conditions are as follows (NMC 2005-
42 TN9345):

- 1 • A maximum of 645 cfs may be appropriated for cooling in an “open cycle” or “once through”
2 mode when river flows exceed 860 cfs and cooling of circulating water meets NPDES permit
3 limits.
- 4 • A maximum of 645 cfs may be appropriated for a “helper” cycle mode of operation that
5 utilizes cooling towers when river flow at the site exceeds 860 cfs and river temperatures
6 approach permit limits.
- 7 • A “partial recirculation” mode of operation recirculates cooling tower water to the intake, and
8 the appropriated flow shall not exceed 75 percent of the river flow when the river flow is less
9 than 860 cfs but greater than 240 cfs.
- 10 • A “closed cycle” mode of operation is authorized whenever the river flow is equal to or
11 greater than 240 cfs.
- 12 • At river flows less than 240 cfs, Monticello shall comply with special operating conditions
13 which the Commissioner of the MDNR may prescribe.

14 The NPDES permit requires Monticello to notify the MPCA if Monticello is required to operate in
15 partial recirculation or closed-cycle mode. To date, Monticello has not needed to operate in
16 closed cycle mode and has needed to operate in partial recirculation mode on only two
17 occasions (Xcel 2023-TN9578).

18 The thermal discharge limits vary by season as presented in the NPDES permit. Under typical
19 river conditions, the Monticello circulating water system operates in once-through mode. The
20 cooling towers are used as needed, approximately 130–150 days per year (Xcel 2023-TN9084).
21 Xcel Energy estimates a worst-case annual average water consumption of up to 12 cfs
22 assuming 150 days per year of cooling tower operation (Xcel 2008-TN9536). The new cooling
23 towers installed in 2021 and 2022 were equipped with drift eliminators to reduce consumptive
24 use (Xcel 2023-TN9578). As discussed below, this level of water consumption represents a
25 small fraction (less than 1 percent) of the annual average river flows.

26 The St. Cloud USGS gage station (Station 05270700, Mississippi River) is located
27 approximately 26 mi upstream from the Monticello site. This gage station has data available
28 since October 1988 and represents a conservative estimate of flow at Monticello because it
29 does not consider additional flow inputs between the gage station and the Monticello site.
30 Furthermore, there are no significant surface water withdrawals between the measuring station
31 and the intake at Monticello (MnDNR 2023-TN9863).

32 The annual average flow (1989–2022) recorded at USGS St. Cloud gage station 05270700 is
33 approximately 6,800 cfs (USGS 2024-TN9646).

34 From October 1988 through July 2023, the maximum and minimum daily flows at the St. Cloud
35 gage station were 45,100 cfs and 553 cfs, occurring on April 9, 1997, and August 19, 2021,
36 respectively (USGS 2024-TN9647).

37 During the period of record, only 6 days had measured flows of less than 860 cfs. These flows
38 were recorded on consecutive days from August 15 through August 20, 2021. Under these
39 conditions, Monticello is only allowed to withdraw 75 percent of the river flow. Conservatively
40 assuming a closed cycle mode of operation was used during this historic low-flow event, the
41 consumptive water use for makeup water would represent less than 10 percent of the 6-day
42 average river flow of approximately 650 cfs (Xcel 2023-TN9084). Under certain low-flow
43 conditions, the DNR is required by Minnesota law (Minnesota statutes 103G.285 -TN9648) to

1 limit consumptive appropriations of surface water to protect the environment and downstream
2 water users (MnDNR 2019-TN9650).

3 As discussed in Section 3.6.3.1 of the Xcel Energy ER, MDNR has issued 26 water
4 appropriation permits between Monticello and Minneapolis. The nearest permitted intake
5 downstream of Monticello that has actively been appropriating water over the last 10 years is
6 located approximately 20 miles downstream of Monticello and supports agricultural use.

7 The NRC staff has not identified any new and significant information related to surface water
8 conflicts during the audit, scoping process, or review of available information cited in this EIS.
9 Moreover, continued compliance with the surface water allocation and NPDES permits mitigates
10 water use impacts by protecting downstream users and ecological communities. Hence, the
11 NRC staff concludes that the surface water use conflicts for the proposed SLR term would be
12 SMALL.

13 Effects of Dredging on Surface Water Quality

14 Dredging in the vicinity of surface water intakes, canals, and discharge structures is undertaken
15 by some nuclear power plant licensees to remove deposited sediment and maintain the function
16 of plant cooling systems. Dredging also may be needed to maintain barge shipping lanes.
17 Whether accomplished by mechanical, suction, or other methods, dredging disturbs sediments
18 in the surface water body and affects surface water quality by temporarily increasing the
19 turbidity of the water column. In areas affected by industries, dredging also can mobilize heavy
20 metals, PCBs, or other contaminants in the sediments.
21 Monticello periodically conducts mechanical or hydraulic maintenance dredging in the area in
22 front of the plant's concrete intake apron and the Mississippi River. The material removed
23 consists primarily of silt, sand, and rocks.

24 Typically, a maximum of 600 cubic yards (yd³) of sediment from the intake bay is removed
25 approximately every 2 years, and a maximum of 350 yd³ of sediment is removed from the
26 traveling screen bay/service water bay area approximately every 12–18 months (Xcel 2023-
27 TN9084). Monticello holds both a USACE regional general permit (RGP-003-MN) and a MDNR
28 State dredge permit (1967-0743).

29 Once removed, the dredge material is dewatered and evaluated for possible contamination.
30 Water removed from the dredge material is routed to NPDES outfall SD 001. To date, dredged
31 material has met the criteria listed in Monticello's NPDES/SDS permit for beneficial reuse and
32 has been transported offsite (Xcel 2023-TN9084).

33 With Monticello's continued compliance with State and regional permits, the NRC staff
34 concludes that the impacts of dredging on surface water quality for the proposed SLR term
35 would be localized and temporary, and therefore SMALL.

36 Temperature Effects on Sediment Transport Capacity

37 Increased temperature and the resulting decreased viscosity have been hypothesized to change
38 the sediment transport capacity of water, leading to potential sedimentation problems, altered
39 turbidity of rivers, and changes in riverbed configuration.

40 Cooling system water at Monticello is returned to the Mississippi River via a 54 ft (16.5 m) wide
41 weir structure located at the end of the discharge canal. A 20 ft (6.1 m) long concrete apron with
42 a downstream 50 ft (15.2 m) long rip-rap apron is located downstream of the weir. Studies

1 conducted in 2009 for the extended power uprate indicate rapid mixing of thermal effluent within
2 the river, decreasing the temperature differential between the discharge location and the
3 ambient river (Xcel 2023-TN9084). Temperature discharge limits are established in Monticello's
4 NPDES permit. There have been no NOV's related to the NPDES permit in the past 5 years
5 (Xcel 2023-TN9084).

6 There are no planned changes or modifications for Monticello that would alter discharge
7 patterns for the proposed SLR term (Xcel 2023-TN9084). Because no change in operation of
8 the cooling system is expected during the proposed SLR term, no change in effects of sediment
9 transport capacity is anticipated. The NRC staff has not identified any new information related to
10 temperature effects on sediment transport capacity. The NRC staff concludes that, with
11 continued temperature discharge limit compliance, the temperature effects on sediment
12 transport capacity for the proposed SLR term would be SMALL.

13 3.5.3.2 *Groundwater Resources*

14 The following sections address the site-specific environmental impacts of Monticello SLR on the
15 environmental issues identified in Table 3-1 that relate to groundwater resources.

16 Groundwater Contamination and Use (Non-Cooling System Impacts)

17 This issue concerns the potential impacts on groundwater availability from dewatering a shallow
18 aquifer during continued operations and plant refurbishment activities, including operational
19 dewatering for control of contaminated groundwater. In addition, this issue concerns impacts on
20 groundwater quality that may occur from the release of contaminants to soil and groundwater
21 during general industrial activities at the plant, including the storage and use of solvents,
22 hydrocarbon fuels (diesel and gasoline), heavy metals, or other chemicals and operation of
23 wastewater treatment/disposal ponds or lagoons. Materials released from these activities all
24 have the potential to affect soils, sediments, and groundwater, and the contaminants that
25 migrate into the subsurface environment can cause a long-term impact on underlying
26 groundwater resources depending on the contaminant, quantity of the release, and site
27 hydrogeological conditions. This issue was expanded for consideration as part of the
28 groundwater review for license renewal in the 2013 GEIS revision (NRC 2013-TN2654) and was
29 not assessed in the 2006 supplemental environmental impact statement (SEIS) for Monticello
30 (NRC 2006-TN7315).

31 Onsite groundwater use is discussed and evaluated in Section 3.6.3.2 of the Xcel Energy ER
32 (Xcel 2023-TN9084), and no dewatering for refurbishment activities or continued operations is
33 described therein. New information regarding groundwater withdrawals for tritium plume
34 recovery and gradient control was identified during the audit, scoping, and review process and
35 is described in Section 3.5.2.3 of this EIS. In October 2023, Monticello pumped groundwater at
36 a rate of about 12 gpm (45 lpm) from eight onsite wells for tritium recovery and had extracted
37 approximately 6.6 million gal (25 million L) of groundwater in total in response to the November
38 2022 release. As part of the tritium release response, uncontaminated water from the surficial
39 aquifer is expected to be pumped from five gradient control wells to intercept inflowing
40 groundwater and maintain the onsite groundwater levels below the top of the sheet pile wall.
41 Groundwater withdrawals for gradient control could be as much as 150 gpm (568 Lpm) from
42 each of four wells (Xcel 2024-TN9859).

43 Because the combined rate of tritium recovery and gradient control pumping is expected to
44 exceed 100 gpm (378.5 lpm), the NRC staff evaluated the potential effects of these groundwater
45 withdrawals on other water users/uses. As discussed in Section 3.5.2.1 of this EIS, groundwater

1 flow in the surficial aquifer tends to be toward the Mississippi River. As a result, the groundwater
2 pumped for gradient control would otherwise naturally discharge into the Mississippi River.
3 Groundwater pumped for gradient control will be discharged to the intake structure for the plant
4 (Xcel 2024-TN9859), which would mitigate the effects of the reduced groundwater discharge to
5 the river resulting from the gradient control pumping.

6 The NRC staff considered the hydrogeological setting of the site when evaluating the potential
7 impacts to offsite groundwater users from groundwater withdrawals at Monticello for tritium
8 recovery and gradient control. The site is bounded to the north by the Mississippi River, which
9 limits the impacts of pumping to areas south of the river. The nearest offsite, registered water
10 wells are upgradient of ongoing and planned groundwater extractions (Figure 3-5), with the
11 closest well about 0.6 mi (1 km) from the center of the site. In evaluating the water appropriation
12 permit application, the Minnesota DNR determined that the gradient control withdrawals would
13 be unlikely to adversely affect the groundwater resource, and drawdowns in groundwater levels
14 resulting from the pumping would not affect offsite domestic wells (Xcel 2024-TN9859). The
15 NRC staff conducted an independent confirmatory analysis and determined that 2 months of
16 continuous gradient control pumping at the maximum rate would be likely to cause less than 1 ft
17 (0.3 m) of groundwater drawdown at the site boundary. Furthermore, the water appropriation
18 permit specifies that the withdrawals must cease if a water use conflict arises (Xcel 2024-
19 TN9859). The NRC staff assumes that gradient control pumping is temporary and will cease
20 once the tritium remediation is complete. Xcel Energy has stated that it will continue tritium
21 recovery until tritium in all onsite groundwater monitoring wells is below the EPA's maximum
22 contaminant level (20,000 pCi/L) (Xcel 2024-TN9645). The total duration of gradient control
23 pumping is thus unknown. However, the pumping is not intended to occur year-round, which will
24 allow affected groundwater levels to recover. Because gradient control pumping would be
25 discontinuous and temporary and offsite wells are located a significant distance from the site,
26 the NRC staff concludes that the onsite groundwater withdrawals for tritium recovery and
27 gradient control would not significantly affect groundwater levels in offsite wells.

28 The NRC staff also determined that the onsite drinking water supply wells are not likely to be
29 affected by the tritium recovery and gradient control pumping from the overlying surficial aquifer
30 because the water supply wells withdraw water from the sandstone aquifer, which is separated
31 from the surficial aquifer by the low-permeability sediments of the lower till. In addition, the
32 principal water supply wells for Monticello (Well numbers 2 and 4: alternate designations of
33 Well #11 and Well #12, respectively) and located more than 500 ft (150 m) from the nearest
34 gradient control well and are outside the gradient control area.

35 According to Section 3.6.4.2 of the Xcel Energy ER, industrial practices at the site generally
36 involve the use of chemicals associated with maintenance activities for plant, equipment,
37 buildings, and water treatment. Management of the chemicals is governed by Xcel Energy
38 procedures and site-specific spill prevention plans (Xcel 2023-TN9084).

39 The NRC staff has concluded that, over the SLR period of extended operation, potential
40 groundwater contamination would likely remain onsite, and no offsite wells are expected be
41 affected by onsite tritium recovery and gradient control groundwater pumping. Monticello
42 adheres to the appropriate State pollution prevention permits and maintains a robust monitoring
43 strategy to readily detect potential future releases of contamination to groundwater. Gradient
44 control withdrawals are regulated by the State water appropriation permit and are not expected
45 to affect groundwater availability for offsite users or receptors. Therefore, the NRC staff
46 concludes that the non-cooling system impacts on groundwater contamination and use during
47 the SLR term would be SMALL.

1 Groundwater Use Conflicts (Nuclear Power Plants that Withdraw More Than 100 gpm)

2 This issue addresses groundwater use conflicts that may occur due to plant potable and service
3 water and dewatering withdrawal. Historically, Monticello has withdrawn groundwater at a rate
4 less than 100 gpm, which has been determined by the NRC staff to be unlikely to result in water
5 use conflicts for offsite groundwater users (NRC 1996-TN288). Therefore, this issue was not
6 assessed in the 2006 SEIS (NRC 2006-TN7315). As presented in Section 3.5.2.3 of this EIS,
7 the response to a 2022 release of tritium resulted in new groundwater withdrawals for tritium
8 recovery and gradient control that could continue into the SLR term, depending on the duration
9 of tritium remediation activities. The maximum pumping rate for the gradient control wells is
10 150 gpm (568 Lpm), with rates adjusted based on the hydraulic conditions of the site
11 (Xcel 2024-TN9859). Rates of pumping for tritium recovery averaged 15.2 gpm (57.5 Lpm) in
12 2023. Pumping rates for tritium recovery are expected to decrease as tritium activity in
13 groundwater decreases. The impacts of tritium recovery and gradient control pumping were
14 evaluated in the Groundwater Contamination and Use (non-cooling system impacts) issue
15 above and were found to be SMALL. The combined impact of all onsite pumping is assessed
16 here.

17 As discussed in Section 3.5.2.2, seven onsite wells provide water for potable use, purified water
18 production, and other plant system requirements. The average total withdrawal is 23.2 gpm
19 (87.8 Lpm), but the majority of water use (92 percent) is from Well numbers 2 and 4 (alternate
20 designations of Well #11 and Well #12, respectively). Well numbers 2, 4, and 3 withdraw water
21 from the sandstone aquifer, which is separated from the surficial aquifer by a layer of low-
22 permeability clay till. Withdrawals from the sandstone aquifer are expected to continue to be
23 less than 100 gpm in the SLR term. Groundwater pumping for tritium recovery and gradient
24 control withdraws water from the surficial aquifer. Because the water supply and tritium
25 remediation wells withdraw from different aquifers that are hydraulically separated by an
26 intervening layer of low permeability sediments, the effects on offsite groundwater users from
27 tritium remediation withdrawals would not contribute to the effects resulting from water supply
28 withdrawals.

29 When evaluating the potential impacts resulting from groundwater use conflicts associated with
30 SLR, the NRC staff considers the existing groundwater resource conditions described in
31 Section 3.5.2 of this site-specific EIS as its baseline. These baseline conditions encompass the
32 existing hydrogeologic framework and conditions (including aquifers) potentially affected by
33 continued operations, as well as the nature and magnitude of groundwater withdrawals
34 compared to relevant appropriation and permitting standards. The baseline also considers other
35 potentially affected uses and users of the groundwater resources affected by the continued
36 operation of the nuclear power plant. Potential impacts to offsite groundwater users from tritium
37 recovery and gradient control withdrawals were assessed in Groundwater Contamination and
38 Use (non-cooling system impacts) and were determined to be SMALL. Water supply
39 withdrawals related to SLR at Monticello are expected to be much less than 100 gpm (380 lpm)
40 and are not expected to lower groundwater levels beyond the site boundary nor contribute to the
41 impacts from tritium plume remediation withdrawals. Therefore, the NRC staff concludes that
42 groundwater use impacts during the SLR term would be SMALL.

43 Groundwater Use Conflicts (Plants with Closed-Cycle Cooling Systems That Withdraw Makeup
44 Water from a River)

45 This issue addresses plants with cooling towers or cooling ponds that rely on a river for cooling
46 water makeup. Consumptive use of the river water, if significant enough to lower the river's

1 water level, would also influence water levels in an adjacent, connected aquifer, which could
2 reduce water levels in the wells of nearby groundwater users. The potential for groundwater use
3 conflicts is dependent on the site's hydrogeology, the decrease in river levels caused by the
4 consumptive water use of the plant, and on the locations, depths, and pumping rates of affected
5 wells.

6 As discussed in Section 3.5.3.1 of this EIS, the Monticello cooling water system uses a flexible,
7 multicycle system that is typically operated in once-through mode, but can also be operated in
8 partial recirculation and closed cycle modes that utilize the two MDCTs. The partial recirculation
9 and closed cycle modes of operation would be used when river flow is relatively low, as
10 specified by the Monticello surface water appropriations permit and NPDES permit discharge
11 limits. Since the plant began operation, the partial recirculation mode has only been used on two
12 occasions and the closed cycle mode has never been used (Xcel 2023-TN9578). In
13 Section 3.5.3.1 of this EIS, the NRC staff conservatively estimated that consumptive water use
14 for closed cycle operation would be less than 10 percent of the river's flow during a historic low-
15 flow event. This small reduction in the river's flow, occurring only rarely, would be unlikely to
16 cause a significant groundwater use conflict. In addition, the majority of registered groundwater
17 wells within 2 mi of Monticello are distant from the river, which would reduce the impact of river
18 water use on these wells. Accordingly, the NRC staff concludes that groundwater use conflicts
19 from water withdrawals for closed-cycle cooling at Monticello would have a SMALL impact
20 during the SLR term.

21 Radionuclides Released to Groundwater

22 This issue was added for consideration as part of the groundwater review for license renewal
23 in the 2013 LR GEIS revision (NRC 2013-TN2654) because of the accidental releases of liquids
24 containing radioactive material into the groundwater at a number of nuclear power plants. In
25 2006, the NRC released a report documenting lessons learned from a review of these incidents
26 that ultimately concluded that these releases had not adversely affected public health and safety
27 (*Liquid Radioactive Release Lessons Learned Task Force Report*, NRC 2006-TN1000). This
28 report concluded, in general, that affected groundwater is expected to remain onsite, but
29 instances of offsite migration have occurred. The LR GEIS (NRC 2013-TN2654) determined that
30 the impacts on groundwater quality from the release of radionuclides could be SMALL or
31 MODERATE, depending on the magnitude of the leak, the radionuclides involved,
32 hydrogeologic factors, distance to receptors, and response time of nuclear power plant
33 personnel to identify and stop the leak in a timely fashion.

34 This issue was discussed and evaluated in Sections 3.6.4.2 and 4.5.4 of the Xcel Energy ER
35 (Xcel 2023-TN9084). Additional details are provided in Section 3.5.2.3 of this EIS. Monticello
36 personnel monitor groundwater for inadvertent releases as part of its groundwater protection
37 program, which was implemented in 2008 under NEI 07-07. Tritium is the only radionuclide that
38 has been historically detected in the surficial aquifer onsite due to unplanned releases. Prior to
39 November 2022, average tritium activity in onsite groundwater had not been detected above the
40 drinking water standard of 20,000 pCi/L. A release of tritium was detected on November 21,
41 2022, due to a failed CRD suction line pipe between the reactor and turbine buildings. As
42 discussed in Section 3.5.2.3, peak tritium activity in groundwater was 5,020,000 pCi/L following
43 this release, and corrective actions have been taken to address affected groundwater. These
44 actions include groundwater pumping for tritium recovery; as described in Section 3.13 of this
45 EIS, the tritium-affected groundwater is stored onsite in above-ground tanks and in an in-
46 ground, lined pond. Remediation activities also include gradient control pumping and installation
47 of a cutoff wall to reduce the volume of contaminated groundwater reaching the river.

1 Ongoing monitoring indicates the tritium plume is migrating to the northeast, away from onsite
2 water supply wells, and overall concentrations are decreasing in the vicinity of the initial release
3 due to the tritium recovery activities. River samples collected upstream and downstream of the
4 site from May to August 2023 indicated tritium concentrations were below detection limits.

5 While tritium continues to be detected in onsite groundwater at levels that exceed the EPA's
6 maximum contaminant level for tritium, ongoing monitoring, tritium recovery pumping, and
7 hydraulic controls (i.e., gradient control groundwater pumping and the cutoff wall) reduce the
8 potential for offsite migration. Additionally, the nearest registered water wells are hydraulically
9 isolated from the site since there are either upgradient of groundwater flow to the site or are
10 buffered by the hydraulic boundary created by the Mississippi River. This isolates these wells
11 from the site groundwater contamination. Based on the information presented in Section 3.5.2 of
12 this EIS, the NRC staff concludes that inadvertent releases of tritium have moderately impaired
13 site groundwater quality but have not substantially affected offsite groundwater quality or
14 affected groundwater use near Monticello. The NRC staff expects that, with Xcel Energy's
15 continuation of the current remediation efforts, tritium levels in onsite groundwater will be
16 reduced below the EPA standard for drinking water. Because of uncertainty in the duration
17 required to complete the groundwater remediation, the NRC staff concludes that groundwater
18 quality impacts due to the release of radionuclides would be SMALL to MODERATE during the
19 SLR term.

20 **3.5.4 No-Action Alternative**

21 *3.5.4.1 Surface Water Resources*

22 Under the no-action alternative, surface water withdrawals would greatly decrease and
23 eventually cease. Stormwater would continue to be discharged from the site, but wastewater
24 discharges would be reduced considerably. As a result, shutdown of Monticello would reduce
25 the overall impacts on surface water use and quality. Therefore, the impact of the no-action
26 alternative on surface water resources would be SMALL.

27 *3.5.4.2 Groundwater Resources*

28 With the cessation of operations, there would be little or no additional impact on groundwater
29 quality. Water pumped for supply would be reduced, which would reduce impacts from onsite
30 water use. Contamination in onsite soil and groundwater, including tritium, would be assessed
31 during decommissioning, whether the plant is decommissioned at the end of the current
32 licensing period or at the end of the SLR period. A license termination plan will describe actions
33 needed for site remediation to meet NRC criteria for radiologic dose, and site specific clean up
34 criteria to be met before the release of the site. Therefore, dewatering for tritium and gradient
35 control would likely continue at current rates or be reduced as tritium contamination is removed
36 from the site groundwater. Therefore, the impact of the no-action alternative on groundwater
37 resources would be SMALL.

38 **3.5.5 Replacement Power Alternatives: Common Impacts**

39 *3.5.5.1 Surface Water Resources*

40 Construction

41 Construction activities associated with replacement power alternatives may cause temporary
42 impacts on surface water quality by increasing sediment loading to waterways. Construction
43 activities also may impact surface water quality by introducing pollutants in stormwater runoff

1 from disturbed areas and excavations, spills and leaks from construction equipment, and any
2 dredge and fill activities. These sources could potentially affect downstream surface water
3 quality.

4 Facility construction activities might alter surface water drainage features within the construction
5 footprints of replacement power facilities, including any wetland areas. Potential hydrologic
6 impacts would vary depending on the nature and acreage of land area disturbed and the
7 intensity of excavation work. Land disturbance may reduce infiltration and increase the potential
8 for greater and quicker surface runoff. Changes in stormwater runoff volume, timing, and quality
9 are typically controlled and managed with applicable Federal, State, and local permits and
10 implementation of BMPs.

11 The NRC staff assumes that construction contractors would implement BMPs for soil erosion
12 and sediment control to minimize water quality impacts in accordance with applicable Federal,
13 State, and local permitting requirements. These measures would also include spill prevention
14 and response procedures to avoid and respond to spills and leaks of fuels and other materials
15 from construction equipment and activities.

16 Surface water use during construction is generally related to concrete preparation, dust
17 suppression, and potable and sanitary water for the workforce and is limited to the construction
18 duration. These construction-related water needs are usually small compared to cooling water
19 needs during thermoelectric plant operation. Based on this analysis, the NRC staff concludes
20 that the impact from construction of replacement power alternative on surface water resources
21 would be SMALL.

22 Operation

23 Thermoelectric generation may require varying amounts of surface water for cooling plant
24 components depending on the selected cooling technology and, therefore, may require new
25 water use permits from and agreements with State and local agencies. Potable and sanitary
26 water use for the plant would depend on the workforce size and, therefore, also may require
27 new potable water use permits from and sanitary water disposal agreements with local agencies
28 or municipalities. Discharge of effluents including cooling system discharges would require
29 permits from Federal, State, and local agencies, including a certification that the discharges are
30 consistent with State water quality standards. Effluent discharges would be subject to treatment
31 and monitoring and reporting requirements of relevant permitting agencies. The NRC staff
32 assumes that plant operations would follow the requirements of any applicable Federal, State,
33 and local permits.

34 During operation of renewable energy facilities, only small amounts of water normally would be
35 needed by facility personnel to periodically clean solar panels and turbine blades and motors, as
36 part of routine servicing. Some water also may be used for dust control. The NRC staff assumes
37 that water for this use would be supplied from a municipal utility, onsite groundwater, or trucked
38 to the point of use and procured from nearby sources. The NRC staff assumes that all
39 thermoelectric and renewable energy sites would be designed and constructed with appropriate
40 drainage and stormwater management controls and implement an SWPPP, associated BMPs,
41 and procedures to minimize offsite water quality impacts in accordance with applicable State
42 and local regulations. Based on this analysis, the NRC staff concludes that the impact from
43 operation of a replacement power alternative on surface water resources would be SMALL to
44 MODERATE.

1 3.5.5.2 *Groundwater Resources*

2 Construction

3 Excavation dewatering for foundations and substructures during construction of replacement
4 power generation facilities, as applicable, may be required to stabilize slopes and permit
5 placement of foundations and substructures below the water table. Groundwater levels in the
6 immediate area surrounding an excavation may be temporarily affected, depending on the
7 duration of dewatering and the methods (e.g., cofferdams, sheet piling, sumps, and dewatering
8 wells) used for dewatering. The NRC staff expects that any impacts on groundwater flow and
9 quality caused by dewatering would be highly localized, of short duration, and would not affect
10 other groundwater users. Discharges resulting from dewatering operations would be released in
11 accordance with applicable State and local permits, as described above.

12 Although foundations, substructures, and backfill may alter onsite groundwater flow patterns,
13 local and regional trends would remain unaffected. Construction of replacement power
14 generating facilities may contribute to onsite changes in groundwater infiltration and quality due
15 to removal of vegetation and construction of buildings, parking lots, and other impervious
16 surfaces. The potential impacts of increased runoff and subsurface pollutant infiltration or
17 discharge to nearby water bodies would be prevented or mitigated through implementation of
18 BMPs and an SWPPP.

19 In addition to construction dewatering, onsite groundwater could be used to support construction
20 activities (e.g., dust abatement, soil compaction, and water for concrete batch plants).
21 Groundwater withdrawal during construction could temporarily affect local water tables or
22 groundwater flow, and these withdrawals and resulting discharges would be subject to
23 applicable permitting requirements. The NRC staff concludes that the impacts on groundwater
24 resources from construction and operation of a replacement power alternative would be SMALL.

25 Operation

26 Dewatering for building foundations and substructures may be required during the operational
27 life of the replacement power facility. Operational dewatering rates, if required, would likely be
28 lower than the rates required for construction and be managed subject to applicable permitting
29 requirements. Dewatering discharges and treatment would be properly managed in accordance
30 with applicable NPDES permitting requirements. The NRC staff expects that any impacts on
31 groundwater flow and quality affected by dewatering would be highly localized, and that there
32 would be no effects on other groundwater users due to the site location.

33 Effluent discharges (e.g., cooling water, sanitary wastewater, and stormwater) from a facility are
34 subject to applicable Federal, State, and other permits specifying discharge standards and
35 monitoring requirements. Adherence to proper procedures by replacement power facility
36 operators during all material, chemical, and waste handling and conveyance activities would
37 reduce the potential for any releases to the environment, including releases to the subsurface
38 and groundwater.

39 For replacement power alternatives, groundwater use during operation is assumed to be similar
40 to or less than current nuclear power plant use, where a water supply system, tritium recovery,
41 and gradient control withdrawals exceed 100 gpm (380 lpm). Site groundwater use was
42 determined to have a minimal impact on surrounding groundwater use or quality. Therefore, the
43 NRC staff concludes that the groundwater use during operation of a replacement power

1 alternative would result in a SMALL impact. Onsite groundwater withdrawals would be subject to
2 applicable State water appropriation, permitting, and registration requirements.

3 **3.5.6 Natural Gas and Renewables Alternative**

4 *3.5.6.1 Surface Water Resources*

5 This alternative includes 750 MW from new, offsite natural gas-fired generation; 750 MW from
6 new, offsite wind turbines; and 200 MW from new onsite and offsite solar panels. The hydrologic
7 and water quality assumptions and implications for construction and operations described in
8 Section 3.5.5.1 of this EIS as common to all replacement power alternatives also apply to this
9 alternative.

10 The natural gas combustion turbine units (with MDCTs) use of water resources for cooling tower
11 makeup and blowdown would be required to comply with appropriate NPDES permits. Because
12 natural gas units would be operated to provide energy during occasional extended periods of
13 low renewable output, it is anticipated that they would require a smaller volume of cooling water
14 (Xcel 2023-TN9084).

15 Construction of the solar and wind installations and their supporting transmission lines would
16 require water for dust suppression, equipment washing, and sanitary systems. The solar and
17 wind installations do not require a cooling system or process water for operation. Some water
18 would be needed for periodically washing the solar panels. Depending on the site locations,
19 construction and operational water demands could be met by municipal supply, trucked in
20 potable water, or onsite or nearby surface or groundwater resources.

21 Some water quality impacts could result from erosion and runoff associated with construction
22 and operations but should be controlled by implementation of BMPs and compliance with
23 stormwater permits and applicable regulations.

24 Based on this analysis, the NRC staff concludes that the overall impacts on surface water
25 resources from construction and operations under the natural gas and renewables alternative
26 would be SMALL.

27 *3.5.6.2 Groundwater Resources*

28 The hydrologic and water quality assumptions and implications for construction and operations
29 described in Section 3.5.5.2 as being common to all replacement power alternatives also apply
30 to this alternative. The NRC staff did not identify any impacts on groundwater resources for this
31 alternative beyond those discussed above as being common to all replacement power
32 alternatives. Therefore, the NRC staff concludes that the impacts on groundwater resources
33 from construction and operations under the natural gas and renewables alternative would be
34 SMALL.

35 **3.5.7 Renewables and Storage Alternative**

36 *3.5.7.1 Surface Water Resources*

37 This alternative is a mix of new construction and the use of existing generation and power
38 purchases. This alternative includes 950 MW from new wind turbines, 700 MW from new solar
39 panels, and 300 MW of new lithium-ion battery storage located at the solar locations. The
40 hydrologic and water quality assumptions and implications for construction and operations

1 described in Section 3.5.5.1 of this EIS as common to all replacement power alternatives also
2 apply to this alternative.

3 Construction of the solar and wind installations and their supporting transmission lines would
4 require water for dust suppression, equipment washing, and sanitary systems. The solar and
5 wind installations do not require a cooling system or process water for operation. Some water
6 would be needed for periodically washing the solar panels. Depending on the site locations,
7 construction and operational water demands could be met by municipal supply, trucked in
8 potable water, or onsite or nearby surface or groundwater resources.

9 Some water quality impacts could result from erosion and runoff associated with construction
10 and operations but should be controlled by implementation of BMPs and compliance with
11 stormwater permits and applicable regulations.

12 Based on this analysis, the NRC staff concludes that the overall impacts on surface water
13 resources from construction and operations under the renewables and storage alternative would
14 be SMALL.

15 3.5.7.2 *Groundwater Resources*

16 The hydrologic and water quality assumptions and implications for construction and operations
17 described in Section 3.5.5.2 as being common to all replacement power alternatives also apply
18 to this alternative. The NRC staff did not identify any impacts on groundwater resources for this
19 alternative beyond those discussed above as being common to all replacement power
20 alternatives. Therefore, the NRC staff concludes that the impacts on groundwater resources
21 from construction and operations under the renewables and storage alternative would be
22 SMALL.

23 **3.5.8 New Nuclear (Small Modular Reactor) Alternative**

24 3.5.8.1 *Surface Water Resources*

25 This alternative is a SMR plant based on the NuScale design. The plant would be sited outside
26 Minnesota because new nuclear power plants are prohibited by Minnesota State law. The
27 hydrologic and water quality assumptions and implications for construction and operations
28 described in Section 3.5.5.1 of this EIS as common to all replacement power alternatives also
29 apply to this alternative. Additionally, deep excavation work required to construct the nuclear
30 island could require groundwater dewatering (see Section 3.4.10 of this EIS). Water pumped
31 from excavations would be managed and discharged in accordance with NPDES permit
32 requirements. As a result, the NRC staff expects that dewatering would not impact surface
33 water quality.

34 The SMR plant would use a closed-cycle cooling system with MDCTs using a surface water
35 source for makeup water. The plant would be sited at a location with adequate inflow to
36 accommodate the plant's cooling system and water consumption (Xcel 2023-TN9084). When
37 operated with wet cooling, which provides direct contact between the cooling water and the air
38 passing through the tower, the annual water consumption rate for a 12-module SMR plant would
39 be approximately 24 cfs, or roughly twice the worst-case annual rate (12 cfs) of the currently
40 operating plant (Xcel 2023-TN9084).

41 The NRC staff assumes that the SMR plant would operate in compliance with a State issued
42 NPDES permit, any applicable industrial stormwater permit, State, and local surface withdrawal

1 requirements, and would have spill prevention and response procedures in place to minimize
2 impacts on surface water quality.

3 Given that the location of a potential new SMR is unknown, the impacts from this alternative are
4 uncertain prior to the selection of the site for the facility. However, based on the above analysis,
5 the NRC staff concludes that the overall impacts on surface water resources from construction
6 and operations under the new nuclear alternative would likely be SMALL to MODERATE.

7 **3.5.9 Groundwater Resources**

8 The hydrologic and water quality assumptions and implications for construction described in
9 Section 3.5.5.2 of this EIS as being common to all replacement power alternatives also apply to
10 this alternative. However, given that the location of a potential SMR is unknown, the impacts
11 from operation of this alternative are uncertain prior to the selection of a site for the facility.
12 Groundwater use for the operation of a SMR could be greater than or less than current
13 operational groundwater use rates depending on the hydraulic setting of the chosen site.
14 Operational dewatering rates, if required, would be managed subject to applicable permitting
15 requirements. Therefore, the NRC staff concludes that the impacts on groundwater resources
16 from construction and operation of a new SMR nuclear power plant complex would likely be
17 SMALL to MODERATE.

18 **3.6 Terrestrial Resources**

19 This section describes the terrestrial resources of the Monticello site and the surrounding
20 landscape. Following the description, NRC staff analyzes the potential impacts on terrestrial
21 resources from the proposed action of subsequent license renewal and alternatives to the
22 proposed action. Information here is based on the initial Monticello LR SEIS
23 (NRC 2006 TN7315), the applicant's ER, and other publicly available information.

24 **3.6.1 Ecoregion**

25 The Monticello site lies within the North Central Hardwood Forests Ecoregion (Xcel 2023-
26 TN9084: Section 3.7.2.2). The EPA (White 2020-TN9281) characterizes this ecoregion (Level III
27 Ecoregion 51) as transitional between northern forests and lakes to the north, the agriculture-
28 dominated plains to the west, and the Lake Agassiz Plain to the south. Topography ranges from
29 nearly level to rolling glacial till plains, lake basins, outwash plains, and rolling or hilly moraines.
30 In addition to urban land covers concentrated in Minneapolis and St. Paul, current land use and
31 land covers are a mosaic of deciduous forests, wetlands and lakes, cropland, pasture, and
32 dairies. Two Level IV ecoregions occur within 6 mi (10 km) of Monticello site: (1) Anoka Sand
33 Plain and Mississippi Valley Outwash and (2) Big Woods. Pre-settlement vegetation of the Big
34 Woods was oak openings and savannas, prairies, and wet prairies; for the Anoka Sand Plain
35 and Mississippi Valley Outwash, pre-settlement vegetation was oak, maple, basswood, and
36 other hardwoods surrounded by prairie and savanna.

37 The U.S. Army Corps of Engineers defines wetlands as areas either inundated or saturated by
38 surface or groundwater at a frequency and duration sufficient to support (and that under normal
39 circumstances do support) a prevalence of vegetation typically adapted for life in saturated soil
40 conditions. In its environmental report, Xcel Energy (Xcel 2023-TN9084) characterizes the
41 National Wetlands Inventory features in the vicinity surrounding the Monticello site as follows:

- 42 • freshwater emergent wetlands—4,253.76 ac (1,721.44 ha)
- 43 • freshwater forested/shrub wetlands—2,730.70 ac (1,105.08 ha)
- 44 • freshwater ponds—1,031.91 ac (417.60 ha)

- 1 • lakes—2,983.92 ac (1,207.55 ha)
- 2 • riverine waters—1,299.49 ac (525.88 ha)

3 **3.6.2 Monticello Site**

4 The Monticello site consists of about 2,000 ac (809 ha) of land along both banks off the
5 Mississippi River in Wright County (south bank) and Sherburne County (north bank) in central
6 Minnesota (Xcel 2023-TN9084). The Monticello site lies within the Anoka Sand Plain and
7 Mississippi Valley Outwash (Level IV Ecoregion 51h). This ecoregion is dominated by a sandy
8 lake plain and terraces along the Mississippi River.

9 Within the approximately 2,000 ac (809 ha) Monticello site, the Monticello plant and supporting
10 facilities are located on about a 50 ac (20.2 ha) industrial area along the southern bank of the
11 Mississippi River in Wright County, Minnesota. Because these facilities are mostly located on
12 previously cultivated areas, existing vegetation in the 50 ac (20.2 ha) industrial area around the
13 plant is mainly early successional grasses and forbs.

14 About 11 percent of the approximately 2,000 ac (809 ha) Monticello site consists of developed
15 land cover types, 14 percent is open water, and the remaining 75 percent of the site is
16 vegetated (Xcel 2023-TN9084: Table 3.2-1). Forests and agriculture are the dominant
17 vegetation types, covering about 36 percent and 31 percent of the site, respectively. Most of the
18 forest is deciduous forest (35 percent). Minor forest types (<1 percent each) are evergreen
19 forest and mixed forest. About 18 percent of the site consists of cultivated crops, and another
20 13 percent is pasture hay. Other minor vegetation types (<5 percent each) are woody wetlands
21 (4.4 percent), emergent herbaceous wetlands (2.2 percent), grassland/herbaceous
22 (1.6 percent), and shrub/scrub (0.4 percent).

23 The descriptions, presented in Xcel Energy's ER (Xcel 2023-TN9084: Section 3.7.2.3),
24 characterize the terrestrial habitats within the site boundary. Habitat descriptions of the
25 associated tree, shrub, and herbaceous strata are incorporated here by reference:

- 26 • upland forests
- 27 • forested wetlands
- 28 • floodplain forest
- 29 • silver maple–Virginia creeper floodplain forest
- 30 • bur oak woodland
- 31 • oak woodland–brushland
- 32 • willow swamp
- 33 • dry oak savanna
- 34 • dry prairie

35 Monticello site boundaries contain a total of 45.6 ac (18.45 ha) of wetlands, lakes, ponds, and
36 riverine waters (Xcel 2023-TN9084: Section 3.7.2.4). Table 3-9 summarizes the area and
37 percentage of wetlands and surface water features on the Monticello site as documented in the
38 National Wetlands Inventory. Figure 3-15 shows the location of National Wetlands Inventory
39 wetlands on a map of the Monticello site.


1 **Table 3-9 Wetlands and Surface Water Features on the Monticello Nuclear Generating**
 2 **Plant Site**

Wetland or Water Feature	Area	Percent of Onsite Wetland Habitat
Freshwater Forested/Shrub Wetlands	16.17 ac (6.54 ha)	35.46
Riverine Waters	27.58 ac (11.16 ha)	60.48
Freshwater Ponds	0.48 ac (0.19 ha)	1.05
Freshwater Emergent Wetlands	1.37 ac (0.55 ha)	3.01
Total	45.6 ac (18.45 ha)	100.00

3 Wildlife species occurring on the Monticello site consist of those species typically found in
 4 central Minnesota forests, croplands, developed areas, and riparian areas. Table 3.7-4 in the
 5 ER presents a list of the terrestrial wildlife species likely to occur in Wright or Sherburne
 6 counties; this list includes 23 mammals, 36 birds, 5 amphibians, and 5 reptiles. Common
 7 mammals include white-tailed deer (*Odocoileus virginianus*), raccoon (*Procyon lotor*), squirrels
 8 (*Tamiasciurus hudsonicus*, *Sciurus carolinensis*, *S. niger*, and *Ictidomys tridecemlineatus*),
 9 whitetailed jack rabbit (*Lepus townsendii*), coyote (*Canis latrans*), red and grey foxes
 10 (*Vulpes vulpes* and *Urocyon cinereoargenteus*), beaver (*Castor canadensis*), muskrat
 11 (*Ondatra zibethicus*), striped skunk (*Mephitis mephitis*), several weasel species
 12 (*Mustela ermina*, *M. vision*, *M. frenata*, *M. nivalis*), and many small mammals.


13 Birds on the Monticello site include a mix of resident bird species that may breed or overwinter,
 14 onsite seasonal residents, and birds that stop briefly during migration. The Monticello site is
 15 located within the Mississippi flyway, an important bird migration route which extends from the
 16 Gulf Coast to the Arctic Circle. Migrant birds often fly at night, landing to rest early in the
 17 morning. Suitable habitats that allow migratory birds to feed, rest, and avoid predators are called
 18 stopovers. Large natural barriers may create crowded stopover locations because flights over
 19 the barriers mean long stretches without opportunities to rest or feed. Along the Mississippi
 20 flyway, Hudson Bay and the Great Lakes are major barriers. Many species of migratory birds
 21 likely use the Monticello site and vicinity during the spring and fall migrations.

22 Important terrestrial species discussed further in this section include those protected by State
 23 and Federal laws, those that are culturally important, and those that are particularly affected by
 24 the continued operation of the nuclear power plant. In particular, peregrine falcons
 25 (*Falco peregrinus*) are known to nest on the Monticello off-gas stack (Xcel 2023-TN9084:
 26 Attachment B), and trumpeter swans (*Cygnus buccinator*) use the waters downstream of the
 27 concrete discharge structure as an important winter habitat. Section 3.6.3.4 discusses peregrine
 28 falcons and trumpeter swans in more detail. Section 3.6.3.7 describes culturally important
 29 species such as wild rice and red cedar.

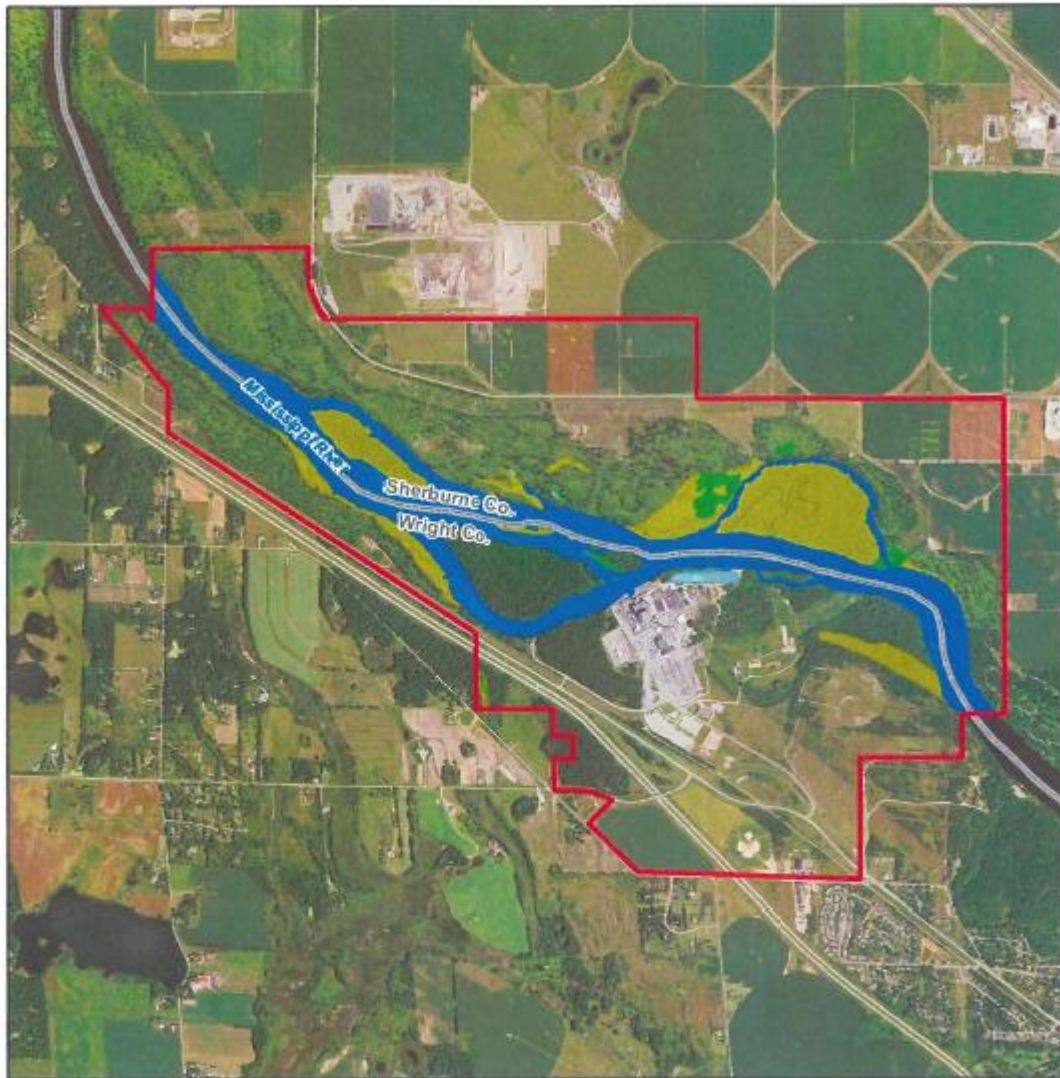

Legend

- MNGP Site Boundary
- Freshwater Emergent Wetland
- Freshwater Forested/Shrub Wetland
- Freshwater Pond
- Riverine



1
2
3
4

Figure 3-15 Wetlands Located Within the Monticello Nuclear Generating Plant Site as Mapped in National Wetlands Inventory. Source: Xcel 2023-TN9084, Figure 3.7-2.

1 **3.6.3 Important Species and Habitats**

2 3.6.3.1 *Federally Listed Species*

3 For a discussion of terrestrial species and habitats that are federally protected under the
 4 Endangered Species Act of 1973, as amended, see Section 3.7, “Federally Protected Ecological
 5 Resources,” of this document.

6 3.6.3.2 *State-Listed Species*

7 Xcel Energy (Xcel 2023-TN9084: Table 3.7-5) provided a list of species that the State of
 8 Minnesota has listed as threatened or endangered and that are known to occur or potentially
 9 occur in Wright or Sherburne counties. Of these State-listed species, three are also federally
 10 listed by the U.S. Fish and Wildlife Service as endangered, threatened, or candidates for
 11 Federal listing, and two are aquatic species. The NRC addresses all federally-listed species in
 12 Section 3.7 of this document and addresses State-listed aquatic species in Section 3.7.
 13 Table 3-10 summarizes the 20 terrestrial species that are State-listed as threatened or
 14 endangered (but not also federally listed) and are known to occur in Wright and Sherburne
 15 counties.

16 **Table 3-10 State-Listed Species (That Are Not Also Federally Listed) for Wright or**
 17 **Sherburne Counties, Potentially Occurring in the Vicinity of Monticello**
 18 **Nuclear Generating Plant**

Common Name	Scientific Name	Class	State Legal Status
Common Tern	<i>Sterna hirundo</i>	Bird	Endangered
Horned Grebe ^(a, b)	<i>Podiceps auratus</i>	Bird	Endangered
Loggerhead Shrike ^(a, b)	<i>Lanius ludovicianus</i>	Bird	Endangered
Eastern Spotted Skunk ^(a)	<i>Spilogale putorius</i>	Mammal	Threatened
Blanding’s Turtle ^(a, b)	<i>Emydoidea blandingii</i>	Reptile	Threatened
Uncus Skipper	<i>Hesparia uncas</i>	Insect	Endangered
Annual Skeletonweed	<i>Shinnersoseris rostrata</i>	Plant	Threatened
Beach Heather	<i>Hudsonia tomentosa</i>	Plant	Threatened
Blunt-Lobed Grapefern ^(a)	<i>Botrychium oneidense</i>	Plant	Threatened
Butternut ^(a)	<i>Juglans cinerea</i>	Plant	Endangered
Clinton’s Bulrush ^(a)	<i>Trichophorum clintonii</i>	Plant	Threatened
Cross-Leaved Milkwort ^(a)	<i>Polygala cruciata</i>	Plant	Endangered
Hooded Arrowhead	<i>Sagittaria calcyina</i> var. <i>calycina</i>	Plant	Threatened
Lance-Leaf Violet ^(a)	<i>Viola lanceolata</i> var. <i>lanceolata</i>	Plant	Threatened
Ram’s Head Orchid ^(a)	<i>Cypripedium arietinum</i>	Plant	Threatened
Rock Sandwort ^(a, b)	<i>Minuartia dawsonensis</i>	Plant	Threatened
Seaside Three-Awn ^(b)	<i>Aristida tuberculosa</i>	Plant	Threatened
Swamp Blackberry ^(a)	<i>Rubus semisetosus</i>	Plant	Threatened
Tall Nutrush ^(a)	<i>Scleria triglomerata</i>	Plant	Endangered
Tuberled Rein Orchid ^(a)	<i>Platanthera flava</i> var. <i>herbiola</i>	Plant	Threatened

(a) Species with potential habitat on the Monticello Nuclear Generating Plant Site.

(b) Species known within 6 mi (9.7 km) of Monticello site (Xcel 2023-TN9084: Section 3.7.8.2).

1 For all species in Table 3-10, Xcel Energy's ER contains full species descriptions and
2 occurrence information (Xcel 2023-TN9084: Section 3.7.8.2) which the NRC incorporates here
3 by reference. Of the 20 State-listed terrestrial species that are not also federally listed
4 (Table 3-10), three are birds, one is a mammal, one is a reptile, one is an insect, and 14 are
5 plants. None of the 20 State-listed terrestrial species (Table 3-10) are known to occur on the
6 Monticello site. However, 14 of these species do have potential habitat on the Monticello site.
7 Below, the NRC staff describes these 14 species. All species information is from Xcel Energy's
8 ER unless otherwise specified:

- 9 • Potential habitat for two of the three State-listed endangered bird species (horned grebe and
10 loggerhead shrike) exists within the Monticello site. These species, like most native birds,
11 are also protected under the Migratory Bird Treaty Act (TN3331; 50 CFR Part 10-TN5490).
12 According to the ER (Xcel 2023-TN9084), one occurrence of horned grebes and
13 12 occurrences of loggerhead shrikes are known from within 6 miles of the Monticello site.
14 However, neither species is known to occur on the Monticello site. Horned grebes are a
15 common migrant, but no persistent breeding populations are known in Minnesota. Horned
16 grebes could use marsh habitats on the Monticello site during migration. Loggerhead
17 shrikes use open habitats with short vegetation intermixed with shrubs or low trees,
18 particularly those with spines or thorns (FWS 2023-TN9571). Potential open habitat for
19 loggerhead shrikes occurs in the undeveloped parts of the Monticello site and along
20 roadsides.
- 21 • Eastern spotted skunk (also known as the civet cat) is a State-listed threatened mammal
22 that has experienced rapid population decline with no more than a few sightings in Minnesota
23 over the last several decades (MnDNR 2024-TN9710). Eastern spotted skunks generally
24 occur in open habitats with cover, including thickets, brush, riparian woodlands, and
25 fencerows. Xcel Energy reported no occurrences of the eastern spotted skunk onsite or
26 within 6 mi (10 km) of the site. Riparian woodlands and brush habitat on the Monticello site
27 could provide habitat for the eastern spotted skunk.
- 28 • Blanding's turtle is State listed as threatened. The Mississippi River and wetlands on the
29 Monticello site and in the vicinity provide suitable habitat for this turtle. Twenty observations
30 of Blanding's turtle have occurred within 6 mi (10 km) of the Monticello site.
- 31 • Rock sandwort, a State-listed threatened plant, has one occurrence within the vicinity of the
32 Monticello site. The species typically occurs in open, dry, sparsely vegetated sites. This
33 perennial plant with small white flowers establishes itself in the shallow cracks and crevices
34 of dry, sedimentary rock outcrops or occasionally in dry prairie sandy soils. Such habitat
35 could be present on the Monticello site.
- 36 • Wetland habitats for the following six State-listed plants are present within the vicinity and
37 the Monticello site boundary: Clinton's bulrush, cross-leaved milkwort, lance-leaved violet,
38 swamp blackberry, tall nutrush, and tubercled rein orchid. Xcel Energy reported no
39 occurrences of these species onsite or within 6 mi (10 km) of the site.
- 40 • Forest habitats for the following three State-listed plants occurs within the vicinity and the
41 Monticello site boundary: blunt nosed grapefern, butternut, and ram's head orchid. Xcel
42 Energy reported no occurrences of these species onsite or within 6 mi (10 km) of the site.

1 3.6.3.3 *Species Protected under the Bald and Golden Eagle Protection Act*

2 The Bald and Golden Eagle Protection Act (BGEPA; 16 U.S.C. 668 and 668c-TN1447) extends
3 regulatory protections to the bald eagle and golden eagle. The Act prohibits anyone without a
4 permit from the U.S. Secretary of the Interior from “taking” bald eagles or golden eagles,
5 including their parts, nests, or eggs.

6 Xcel Energy summarizes eagle occurrences and nesting in the vicinity and on the Monticello
7 site (Xcel 2023-TN9084: Section 3.7.8.3). Bald eagles are known to nest on the Monticello site
8 and in the vicinity. Although one bald eagle nest was known to occur on Cedar Island, upstream
9 from the power block, recent information about that individual’s nesting or nesting success is
10 unknown. Although golden eagles occur in Minnesota, they are not known to nest within the
11 State and do not have any known occurrences within 6 mi (10 km) of the Monticello site. No
12 surveys for eagles or eagle nests have been conducted on the Monticello site since the initial
13 license renewal (Xcel 2023-TN9084). Xcel Energy reports no eagle take permitting
14 requirements associated with Monticello site operations or in-scope transmission lines.

15 3.6.3.4 *Species Protected under the Migratory Bird Treaty Act*

16 The Migratory Bird Treaty Act (MBTA) makes it illegal for anyone to take, possess, import,
17 export, transport, sell, purchase, barter, or offer for sale any migratory bird or the parts, nests, or
18 eggs of such a bird except under the terms of a valid permit issued under Federal regulations.
19 Xcel Energy has a memorandum of understanding with U.S. Fish and Wildlife Service (FWS)
20 and MDNR to address migratory birds that may be present, injured, or killed on Xcel Energy
21 property (Xcel 2023-TN9084: Section 2.2.5.3).

22 Northern States Power - Minnesota (NSPM) maintains a Federal Migratory Bird Special
23 Purpose Utility Permit from the FWS (Xcel 2023-TN9084: Section 3.7.2.6). This permit can only
24 be issued to utility companies to collect, transport, and temporarily possess migratory birds
25 found dead on utility properties, structures, and rights-of-way (FWS Undated-TN9282). In
26 emergency circumstances, permit holders may relocate or destroy active nests.

27 In its ER, Xcel Energy lists 36 bird species that are likely to be observed in Wright and
28 Sherburne counties (Xcel 2023-TN9084: Table 3.7-4). Of these 36 bird species, 33 species are
29 protected by the MBTA (50 CFR Part 10-TN5490). One species, the cerulean warbler
30 (*Dendroica cerulea*), is also a Bird of Conservation Concern, an FWS designation for species of
31 highest conservation priority that are not already federally listed as threatened or endangered
32 (FWS 2021-TN8740). FWS (FWS 2023-TN9083) provided a list of 12 migratory birds that could
33 occur within the Monticello site and are of particular concern for the project because they are an
34 eagle or on the Bird of Conservation Concern list: bald eagle, black tern (*Chlidonias niger*),
35 Canada warbler (*Cardellina canadensis*), cerulean warbler, chimney swift (*Chaetura pelagica*),
36 golden-winged warbler (*Vermivora chrysoptera*), lesser yellowlegs (*Tringa flavipes*), long-eared
37 owl (*Asio otus*), red-headed woodpecker (*Melanerpes erythrocephalus*), rusty blackbird
38 (*Euphagus carolinus*), western grebe (*Aechmophorus occidentalis*), and wood thrush
39 (*Hylocichla mustelina*).

40 Another important bird species protected under the MBTA is the trumpeter swan
41 (*Cygnus buccinator*, also called *waabiziwag* in the Ojibwe language, Mille Lacs Band of Ojibwe
42 2023-TN9666). Heat discharges into the Mississippi River from Monticello operations have
43 warmed the water near the plant and created an important winter habitat for Minnesota
44 trumpeter swans (Xcel 2023-TN9084: Section 3.7.2.5). The information described here comes

1 from the following sources: MNBBA 2023-TN9572, MnDNR 2023-TN9573, Moriarty 2020-
2 TN9574, Partridge and Steigauf 2020-TN9575.

3 Trumpeter swans are large, wetland-dependent birds, with a length of 4.8–5.4 ft (1.5–1.6 m) and
4 a wingspan of 6–8 ft (1.8–2.4 m). During the breeding season, they select nesting sites in
5 smaller wetlands and with extensive forest cover along the shoreline. Occasionally, they select
6 sites along slow-moving rivers. After being overhunted in the late 1800s, trumpeter swans were
7 extirpated from Minnesota by the mid-1900s. Reintroduction in Minnesota began in 1966 and
8 continued up to 2012. The current breeding population in Minnesota is at least 25,000 birds.

9 In the winter, most of Minnesota’s breeding population of trumpeter swans migrate to locations
10 in central and southern Minnesota with warm open water and abundant food. Monticello
11 provides an important site with reliably warm water in the winter. Soon after Monticello’s
12 operations began, five trumpeter swans did not migrate south, but instead over-wintered
13 downstream of the plant in the City of Monticello (Partridge and Steigauf 2020-TN9575). Local
14 community members began feeding overwintering swans in Monticello, which attracted even
15 more swans to overwinter in subsequent years. Currently, more than 1,000 Asia overwinter in
16 Monticello. These swans have become a major tourist attraction (Partridge and Steigauf 2020-
17 TN9575).

18 Minnesota lists the peregrine falcon as a species of special concern (MnDNR 2024-TN9743).
19 According to the initial LR (NRC 2006-TN7315), peregrine falcons have nested at the site since
20 1995, and the MDNR notes this in its letter about relicensing (Xcel 2023-TN9084: Attachment
21 B). The State notes that about 70 percent of breeding peregrine falcons nest on tall buildings,
22 bridges, and smokestacks, while about 30 percent nest on cliffs. Threats to peregrine falcons
23 include human related factors (e.g., collisions with buildings and infrastructure, pollutants,
24 nesting habitat loss) and environmental factors (e.g., disease, predation).

25 3.6.3.5 *Invasive Species*

26 Invasive species are identified as non-native organisms whose introduction causes or is likely to
27 cause economic or environmental harm or to cause harm to human, animal, or plant health
28 (EO 13751, 81 FR 88609-TN8375). Executive Order (EO) 13112 (64 FR 6183-TN4477), as
29 amended by EO 13751, directs Federal agencies to not authorize, fund, or carry out actions
30 likely to cause or promote the introduction or spread of invasive species unless they determine
31 that the benefits of the action clearly outweigh the harm from invasive species and that all
32 feasible and prudent measures to minimize risk of harm are taken (64 FR 6183-TN4477:
33 Section 2). Minnesota lists 16 species of plants as noxious weeds (MnDA 2023-TN9344).

34 Xcel Energy noted important invasive species in the vicinity of the Monticello site (Xcel 2023-
35 TN9084: Section 3.7.5). Of these, none are terrestrial animals. The aquatic plant, Eurasian
36 milfoil, is covered in Section 3.7.1 of this document). The remaining invasive plant species (Xcel
37 2023-TN9084: Section 3.7.5.1 and Section 3.7.5.3) have the potential to occur within the site
38 and are addressed here as terrestrial species, with full species biology and occurrence
39 information incorporated by reference from the applicant’s ER. Only the following three invasive
40 terrestrial species are reported to occur onsite, as documented in records from MDNR (MnDNR
41 2023-TN9576, MnDNR 2023-TN9577):

- 42 • Common buckthorn (*Rhamnus cathartica*) is a tree or shrub that occurs in forests, wetlands,
43 prairies, and other natural habitats. This species is present within the site boundaries, on
44 islands in the Mississippi River.

- 1 • Bell's honeysuckle (*Lonicera x bella*) is a shrub that grows in disturbed areas with full sun or
2 partial shade. This species is present within the site boundaries, on islands in the
3 Mississippi River.
- 4 • Purple loosestrife (*Lythrum salicaria*) is a tall herbaceous perennial that grows in open
5 wetlands. This species is known to occur in the vicinity and on site. Minnesota aquatic
6 species data (MnDNR 2023-TN9576) show one location on the south of the meteorological
7 towers (MET) on the west side of the road.

8 3.6.3.6 *Important Habitats*

9 Important habitats include any wildlife sanctuaries, refuges, preserves, or habitats identified by
10 State or Federal agencies as unique, rare, prioritized for protection, wetlands and floodplains,
11 and land areas identified as critical habitat for species listed by the FWS as threatened or
12 endangered. Important habitats on and around the Monticello site include the wetlands
13 discussed above in Sections 3.6.1 and 3.6.2. In particular, the Mississippi River riparian habitats
14 provide important habitat, especially during very cold winters when heat released by station
15 operations maintains an ice-free body of water. In addition, nearby Federal lands provide
16 important terrestrial habitats (Xcel 2023-TN9084: Sections 3.7.4). Sherburne National Wildlife
17 Refuge provides mating and nesting habitat for bald eagles. The wildlife refuge also provides
18 overnight roosting for many migrating birds including up to 14,000 greater sandhill cranes
19 (*Grus canadensis tabida*) in October and November (FWS Undated-TN9744). State lands such
20 as Sand Dunes State Forest and Lake Maria State Park also provide important habitats.

21 3.6.3.7 *Culturally Important Species*

22 Two culturally important plant species, eastern red cedar (*Juniperus virginiana*) and wild rice
23 (*Zizania* spp.), occur in the vicinity of the Monticello site (iNaturalist 2023-TN9655). See
24 Section 3.9 in this EIS for more information about these culturally important species.

25 Eastern red cedar is an evergreen tree in the cypress family which grows well in rocky dry soils
26 and river bluffs and occurs on the Monticello site (Xcel 2024-TN9859). According to a letter from
27 the Mille Lacs Band of Ojibwe Department of Natural Resources to the NRC, rich red cedar
28 forests once lined the banks of the Mississippi River on what is now the Monticello site (Mille
29 Lacs Band of Ojibwe 2023-TN9666). The red cedar is an important cultural resource to the
30 Ojibwe who hewed dugout canoes from the tree trunks. These canoes were traditionally used to
31 harvest another culturally important plant species, natural wild rice (Milgroom 2023-TN9745).

32 Called *manoomin* in the Ojibwe language, wild rice is an aquatic grass that naturally occurs in
33 wetlands of Minnesota, Wisconsin, and parts of Canada. This food source is essential to the
34 creation story of the Ojibwe. It grows in shallow water (1 to 3 ft; 0.3 to 0.9 m) deep. In order to
35 germinate, the seeds require near freezing temperatures over 3–4 months on the bottom of
36 shallow lake beds (MnDNR 2008-TN9711). Warm water temperatures from climate change or
37 from thermal discharge can impact wild rice habitat. Wild rice beds are also very attractive to
38 migrating waterfowl (MnDNR 2024-TN9712). The applicant plans to conduct an onsite
39 survey for wild rice onsite in the summer of 2024 and will submit the results to the NRC
40 (Xcel 2024-TN9859).

41 **3.6.4 Proposed Action**

42 The following sections address the site-specific environmental impacts of the Monticello SLR on
43 the environmental issues related to terrestrial resources.

1 3.6.4.1 *Effects on Terrestrial Resources (Non-cooling System Impacts)*

2 According to the LR GEIS, non-cooling system impacts on terrestrial resources can include
3 impacts that result from site and landscape maintenance activities, stormwater management,
4 elevated noise levels, and other ongoing operations and maintenance activities that would occur
5 during the LR period on and near a plant site. The NRC staff based its analysis in this section
6 on information derived from Xcel Energy's ER (Xcel 2023-TN9084) unless otherwise cited. Xcel
7 Energy has not identified any refurbishment activities during the proposed relicensing term (Xcel
8 2023-TN9084). No further analysis of potential impacts from refurbishment activities is therefore
9 necessary.

10 In its ER (Xcel 2023-TN9084), Xcel Energy states that it will conduct ongoing operational and
11 maintenance activities at Monticello throughout the SLR term, including landscape maintenance
12 activities, stormwater management, piping installation, and fencing. The NRC staff expects that
13 physical disturbances would be limited to paved or disturbed areas or to areas of mowed grass
14 or early successional vegetation and not encroach into wetlands or into the remaining areas of
15 mixed forest. Xcel Energy maintains a special use permit from FWS and has procedures to
16 protect nests and nesting birds on the Monticello site. The NRC staff concludes that the
17 anticipated activities would have only minimal effects on terrestrial resources, based on
18 information presented in the ER and the staff's independent analysis.

19 Xcel Energy (Xcel 2023-TN9084) states that it has administrative controls in place at Monticello
20 to ensure that it reviews operational changes or construction activities and minimizes
21 environmental impacts through BMPs, permit modifications, or new permits, as needed. Xcel
22 Energy (Xcel 2023-TN9084) further states that regulatory programs for issues like stormwater
23 management, spill prevention, dredging, and herbicides further minimize impacts on terrestrial
24 resources. The NRC staff concludes that continued adherence to environmental management
25 practices and BMPs already established for Monticello would continue to protect terrestrial
26 resources during the SLR operational period.

27 Operational noise from the Monticello site facilities extends into the remaining natural areas on
28 the site. However, Monticello has exposed these habitats to similar operational noise levels
29 since it began operation in 1970. The NRC staff therefore expects that wildlife in the affected
30 habitats have long ago acclimated to the noise and human activity of Monticello operations and
31 adjusted their behavior patterns accordingly. Extending the same level of operational noise
32 levels during the 20-year SLR period is therefore unlikely to noticeably change the patterns of
33 wildlife movement and habitat use.

34 Based on its independent review, the NRC staff concludes that the landscape maintenance
35 activities, stormwater management, elevated noise levels, and other ongoing operations and
36 maintenance activities that Xcel Energy might undertake during the SLR term would primarily be
37 confined to already disturbed areas of the Monticello site. These activities would neither have
38 noticeable effects on terrestrial resources nor would they destabilize any important attribute of
39 the terrestrial resources on or in the vicinity of the site. The NRC staff expects that Xcel Energy
40 would continue to comply with the applicable requirements of Federal and State regulatory
41 programs and obtain any needed permits. Accordingly, the NRC staff concludes that
42 non-cooling system impacts on terrestrial resources during the SLR term would be SMALL.

1 3.6.4.2 *Exposure of Terrestrial Organisms to Radionuclides*

2 This issue concerns the potential impacts on terrestrial organisms from exposure to
3 radionuclides from routine radiological effluent releases. The NRC staff will first summarize how
4 this issue has been addressed historically, and then provide a site-specific evaluation of the
5 issue for the Monticello SLR term.

6 Radionuclides may be released from nuclear power plants into the environment through several
7 pathways. During normal operations, nuclear power plants can release gaseous emissions that
8 deposit small amounts of radioactive particulates in the surrounding environment. Gaseous
9 emissions typically include krypton, xenon, and argon (which may or may not be radioactive),
10 tritium, isotopes of iodine, and cesium. Emissions may also include strontium, cobalt, and
11 chromium. Nuclear power plants can also release radionuclides as liquid effluents into water.
12 From there, terrestrial plant roots can absorb radionuclides from shallow groundwater or surface
13 waters. Animals may experience exposure to ionizing radiation through inhalation, direct contact
14 (with air, water, or other media), inhalation, or ingestion (of contaminated food, water, or soil).

15 The 1996 LR GEIS (NRC 1996-TN288) did not address the impacts of the exposure of
16 terrestrial organisms to radionuclides released from routine plant operations during license
17 renewal. In 2007, the International Commission on Radiation Protection (ICRP) issued revised
18 recommendations for a system of protection to control exposure from radiation sources (ICRP
19 2007-TN422). The recommendations included a section about the protection of the environment
20 in which the ICRP found that a clearer framework for assessing the impact of radionuclide
21 exposure on non-human organisms was warranted. The ICRP indicated that it would develop a
22 set of reference animals and plants as the basis for relating exposure to dose, and dose to
23 radiation effects. This information would then provide a basis from which agencies and
24 responsible organizations could make policy and management decisions. Subsequently, the
25 ICRP developed and published a set of 12 reference animals and plants that included a large
26 and a small terrestrial mammal, an aquatic bird, a large and a small terrestrial plant, and several
27 other species. (ICRP 2008-TN7530, ICRP 2009-TN7531). The ICRP also issues publications
28 and information related to radiological effects and radiosensitivity in non-human biota
29 (Adam-Guillermin et al. 2018-TN7972).

30 In 2009, after the NRC staff conducted a review of the ICRP's 2007 recommendations, the
31 Commission found no evidence that the NRC's current (as of 2009) radiation protection controls
32 was not protective of the environment (NRC 2009-TN6651). For this reason, the Commission
33 determined that the NRC staff should not develop separate radiation protection regulations for
34 plant and animal species (NRC 2009-TN6651). Instead, the Commission charged the NRC staff
35 to monitor international developments on this issue and to keep the Commission informed.
36 Nonetheless, when preparing the 2013 LR GEIS, the NRC decided to address the radiological
37 exposure of non-human organisms after considering public concern about these impacts at
38 some nuclear power plants (NRC 2013-TN2654).

39 In the 2013 LR GEIS (NRC 2013-TN2654), the NRC staff adopted the U.S. Department of
40 Energy (DOE) standard for a graded approach for evaluating radiation doses to terrestrial and
41 aquatic biota (DOE 2019-TN6817). This DOE standard provides methods, models, and
42 guidance that can be used to characterize radiation doses to terrestrial and aquatic biota
43 exposed to radioactive material (DOE 2019-TN6817). The following DOE guidance dose rates
44 are the levels below which no adverse effects to resident populations are expected:

- 1 • riparian animal: 0.1 radiation-absorbed dose per day (rad/day) (0.001 Gray per day
- 2 (Gy/day))
- 3 • terrestrial animal: 0.1 rad/day (0.001 Gy/day)
- 4 • terrestrial plant: 1 rad/day (0.01 Gy/day)
- 5 • aquatic animal: 1 rad/day (0.01 Gy/day)

6 The NRC staff notes that in 1992, the International Atomic Energy Agency (IAEA 1992-TN712)
7 had concluded that chronic dose rates of 0.1 rad/day (0.001 Gy/day) or less do not appear to
8 cause observable changes in terrestrial animal populations. The United Nations Scientific
9 Committee on the Effects of Atomic Radiation concluded in 1996 and reaffirmed in 2008 that
10 chronic dose rates of less than 0.1 mGy/hr (0.24 rad/day or 0.0024 Gy/day) to the most highly
11 exposed individuals would be unlikely to have significant effects on most terrestrial communities
12 (UNSCEAR 2010-TN7974).

13 In the 2013 LR GEIS (NRC 2013-TN2654), the NRC estimated the total radiological dose that
14 four non-human receptors (riparian animal, terrestrial animal, terrestrial plant, and aquatic
15 animal) would be expected to receive during normal nuclear power plant operations based on
16 plant-specific radionuclide concentrations in water, sediment, and soils at 15 operating nuclear
17 power plants. The NRC found that total calculated dose rates for all terrestrial receptors at all
18 15 plants were significantly less than the DOE guideline values. As a result, the NRC
19 anticipated in the 2013 LR GEIS that normal operations of these facilities would not result in
20 negative effects on terrestrial organisms from radionuclide release. The 2013 LR GEIS
21 concluded that this is a Category 1 issue and that the impact of radionuclides on terrestrial biota
22 from past operations would be SMALL for all nuclear plants and would not be expected to
23 change appreciably during the initial license renewal period.

24 In the following discussion, the NRC staff analyzes the impact of radionuclides on terrestrial
25 organisms on a site-specific basis for the Monticello SLR term, in accordance with CLI-22-03,
26 that references CLI-22-02 (NRC 2022-TN8182, NRC 2022-TN9844).

27 As discussed in Section 2.1.4 of this site-specific EIS, the NRC requires nuclear power plants to
28 maintain a radiological environmental monitoring program (REMP) in accordance with NRC
29 regulations at 10 CFR Part 50, Appendix I (TN249); 10 CFR Part 20 (TN283); and
30 10 CFR Part 72 (TN4884); through plant-specific technical specifications, and through the
31 guidance in Regulatory Guide 4.1 (NRC 2009-TN3802). These collectively require that
32 licensees establish and implement a REMP to obtain data on measurable levels of radiation and
33 radioactive material. REMP monitoring confirms that radiation is below regulatory limits and any
34 increases are detected and addressed, as appropriate.

35 As part of its environmental review, the NRC staff reviewed the past 5 years (2018–2022) of
36 REMP reports (Xcel 2019-TN9621, Xcel 2020-TN9612, Xcel 2021-TN9613, Xcel 2022-TN9614,
37 Xcel 2023-TN9615). The NRC staff assumed that a 5-year period provides adequate coverage
38 to evaluate a broad range of Monticello operational and maintenance activities that could
39 influence the generation and release of radionuclides. The NRC staff looked for indications of
40 adverse trends (i.e., increasing radioactivity levels) over the 5-year review period.

41 Xcel Energy's REMP measures the terrestrial, aquatic, and atmospheric environment for
42 ambient radiation and radioactivity. Xcel Energy conducts monitoring for the following: direct
43 radiation, air, precipitation, well water, river water, surface water, food products and vegetation
44 (such as edible broad leaf vegetation), fish, silt, and shoreline sediment. The REMP also

1 measures background radiation (i.e., cosmic sources, global fallout, and naturally occurring
2 radioactive material, including radon).

3 For this issue, NRC staff evaluated REMP and groundwater monitoring data. As discussed in
4 Section 2.1.4 of this site-specific EIS, over the 5-year review period, NRC staff found no
5 apparent evidence in the REMP data showing an increasing trend in concentration or pattern of
6 radionuclide concentrations that would indicate potential ongoing inadvertent releases from
7 Monticello. However, the NRC staff's review of Monticello groundwater monitoring data did
8 show elevated levels of tritium concentration onsite at well MW-9A since 2009. The applicant
9 also reported an additional release of liquid effluent containing elevated tritium in
10 November 2022 (Xcel 2023-TN9084: ER Section 3.6.3.2). See Section 3.5.2.3 of this EIS for
11 new information regarding tritium plume recovery and gradient control identified during the
12 environmental review process. Additional sampling until August 2023 has not identified tritium
13 above detection levels in the Mississippi River. The NRC staff does not expect these
14 below-detectable levels of tritium in the river to negatively impact terrestrial resources, nor does
15 the staff expect them to negatively impact aquatic resources (Section 3.7.2.7 of this document).
16 If such a spill were to occur during the SLR term, the NRC staff expects that Xcel Energy would
17 take appropriate actions, as it has in this case, to mitigate and resolve the issue in accordance
18 with all relevant State and Federal requirements.

19 Plant operations during the SLR term would continue current operating conditions, site
20 management controls, and environmental stressors rather than introduce wholly new conditions
21 and stressors. Therefore, the impacts of radionuclide exposure on terrestrial biota during the
22 SLR term would likely be similar to impacts during current operations. For these reasons, the
23 effects of radionuclide exposure would be minor and would neither destabilize nor noticeably
24 alter any important attribute of this resource during the SLR term. The NRC staff concludes that
25 the impacts of exposure to radionuclides on terrestrial resources during the Monticello SLR term
26 would be SMALL.

27 *3.6.4.3 Cooling System Impacts on Terrestrial Resources (Plants with Once-Through*
28 *Cooling Systems or Cooling Ponds)*

29 This issue concerns the potential impacts of once-through cooling systems and cooling ponds at
30 nuclear power plants on terrestrial resources. Cooling system operation can alter the ecological
31 environment in a manner that affects terrestrial resources. Such alterations may include thermal
32 effluent additions to receiving water bodies, chemical effluent additions to surface water or
33 groundwater, impingement of waterfowl, disturbance of terrestrial plants and wetlands
34 associated with maintenance dredging, disposal of dredged material, and erosion of shoreline
35 habitat. In the following discussion, the NRC staff summarizes how this issue has been
36 addressed historically, and then presents a site-specific evaluation of the issue for Monticello
37 SLR.

38 The 2013 LR GEIS (NRC 2013-TN2654) states that many of the effects of cooling system
39 operations on terrestrial resources have only been identified at a small number of nuclear power
40 plants, and these plants have since modified their operations to reduce or eliminate the effects.
41 For instance, in a study of eight nuclear power plants with copper alloys in their cooling
42 systems, elevated concentrations of copper were discharged into the cooling systems from
43 condenser tubing. At one plant, copper released from the cooling system increased deformities
44 and reduced reproductive capacity in the resident bluegill sunfish population
45 (*Lepomis macrochirus*) (Harrison 1985-TN7579); At another plant, abalone (*Haliotis* spp.)
46 mortality was attributed to copper exposure in plant effluents (NRC 1996-TN288). Terrestrial

1 wildlife such as migratory birds that feed on these aquatic organisms could have also been
2 exposed to elevated copper levels and could have also experienced adverse effects. However,
3 these eight nuclear power plants subsequently replaced their copper alloy condenser tubes with
4 tubes made of different materials (e.g., titanium), which eliminated these impacts. This issue
5 has not since been reported at any other nuclear power plants. The 2013 LR GEIS identified
6 this as a Category 1 issue with a determination of SMALL impact.

7 In the following discussion, the NRC staff analyzes the effects of cooling system operations on
8 terrestrial resources on a site-specific basis for the Monticello SLR term, in accordance with
9 CLI-22-03, that references CLI-22-02 (NRC 2022-TN8182, NRC 2022-TN9844).

10 Section 3.5.3.1 of this document describes Monticello surface water withdrawals and plant
11 discharges. The cooling water source for the plant is the Mississippi River, and Monticello's
12 surface water withdrawal permit (MDNR permit 66-1172) establishes limits on withdrawals
13 under low-flow conditions. Xcel Energy's NPDES permit (MN0000868) authorizes discharge of
14 non-contact cooling water, stormwater, and other operations-related waters into the Mississippi
15 River. Xcel Energy reports no notices of violation relating to the NPDES permit over the last
16 5 years regarding increased water temperatures or contaminants in the surface water (Xcel
17 2023-TN9084: ER Section 4.6.8.2).

18 Between 2014 and 2023, Xcel Energy recorded 10 onsite bird deaths and injuries. None of
19 these bird deaths were attributed to impingement on intake screens (Xcel 2023-TN9578:
20 Enclosure 31). Xcel Energy states that it routinely maintains intake screens to remove
21 biofouling, which likely reduces the potential for avian foraging from organisms caught on the
22 intake screens. Discharges would continue to provide overwintering habitat for trumpeter swans
23 downstream of the Monticello plant.

24 Xcel Energy manages wetland and riparian areas for conservation by using BMPs to protect
25 streams from stormwater runoff and erosion. Maintenance dredging at the intake occurs for
26 plant operations as warranted (Xcel 2023-TN9084: Section 3.7.3). All dredging is conducted in
27 accordance with NPDES, USACE, and MDNR permits. The NRC staff assumes that periodic
28 dredging will be necessary during SLR term at similar frequencies, material volumes, and permit
29 requirements. Each permit-granting agency would conduct their own environmental reviews
30 prior to permitting dredging. The NRC staff further assumes that Xcel Energy would continue to
31 abide by all dredging permit requirements in order to minimize adverse impacts on the terrestrial
32 environment.

33 Xcel Energy has not identified any construction or change in cooling system operations during
34 the SLR period. Therefore, the impacts for continued cooling system operations would be
35 similar to current operating conditions. Xcel Energy plans to continue operating cooling water
36 systems as currently configured and authorized through its withdrawal permit and its NPDES
37 permit. The NRC staff concludes that the potential for cooling system impacts to terrestrial
38 organisms during the Monticello SLR term would be SMALL.

39 3.6.4.4 *Cooling tower impacts on vegetation (plants with cooling towers)*

40 The issue concerns the impact of nuclear power plant cooling towers on terrestrial vegetation. In
41 the following discussion, the NRC staff explains how this issue has been addressed historically
42 and then provides a site-specific evaluation for the Monticello SLR term.

1 The 1996 LR GEIS (NRC 1996-TN288) evaluated two cooling tower impacts on vegetation:
2 (1) impacts on crops and ornamental vegetation and (2) impacts on native plants. The 2013
3 LR GEIS (NRC 2013-TN2654) combined these two issues into one issue: cooling tower impacts
4 on vegetation. Both the 1996 and 2013 LR GEIS identified this as a Category 1 issue and
5 concluded that cooling impacts on vegetation would be SMALL during the initial LR. In the 2006
6 Monticello LR SEIS (NRC 2006-TN7315), the NRC staff found no new and significant
7 information concerning this issue and the NRC staff adopted the 1996 LR GEIS's conclusion of
8 SMALL impacts for Monticello initial license renewal.

9 Terrestrial vegetation in the vicinity of nuclear power plant cooling towers can be exposed to
10 increased humidity and have a higher risk of structural damage from freezing vapor plumes or
11 exposure to deposition of drift particulate and water droplets. However, most of the deposition
12 from cooling towers occurs in terrestrial vegetation located in relatively close proximity to the
13 towers. Generally, deposition rates from these cooling towers have been below those that are
14 known to result in measurable adverse impacts on terrestrial vegetation, and no deposition
15 effects on agricultural crops or other terrestrial vegetation communities have been observed at
16 most nuclear power plants. Terrestrial vegetation communities in the vicinity of cooling towers
17 that have been exposed to many years of cooling tower operations are unlikely to change during
18 the SLR term. Below, the NRC staff analyzes this issue site-specifically for the SLR term, in
19 accordance with CLI-22-02 and CLI-22-03 (NRC 2022-TN8182, NRC 2022-TN9844).

20 Xcel Energy operates two MDCTs at Monticello under certain conditions (Xcel 2023-TN9084:
21 Section 4.5). The cooling towers are located at the northeast corner of the plant's developed
22 industrial area just south of the Mississippi River (see Figure 3-15). In 2021 and 2022, Xcel
23 Energy replaced these cooling towers (Xcel 2023-TN9084: Attachment D). The new towers
24 have slightly greater cooling capacity. According to Xcel Energy, use of the new cooling towers
25 in the summer will result in lower discharge temperatures than the old cooling towers (Xcel
26 2023-TN9084: Section 3.10.1). The new cooling towers are also equipped with drift eliminators.
27 Xcel Energy stated that the design drift loss limit is 0.0005 percent (Xcel 2023-TN9578:
28 Enclosure 10). Because the source of water is the freshwater from Mississippi River, salt
29 deposition is not a potential impact from operating these cooling towers.

30 In its ER, Xcel Energy states that the new cooling towers use the same footprint as the existing
31 plant facility (Xcel 2023-TN9084: Section 3.1.4). The NRC staff compared Monticello plant site
32 images in Google Earth Pro (GEP 2024-TN9858) from 2011 to 2023 to confirm that the old and
33 new cooling towers generally occupy the same footprint in the plant industrial area; therefore,
34 potentially exposed, vegetation should be similar to as before tower replacement. Potentially
35 exposed vegetation occurs within a 6 mi (9.7 km) radius of the Monticello site (Xcel 2023-
36 TN9084 ER: Table 3.2-2). The most abundant vegetated land covers within the 6 mi (9.7 km)
37 radius of Monticello are cultivated crops (35 percent), deciduous forest (15 percent),
38 pasture/hay (13 percent), and wetlands (9 percent). Section 3.6.2 describes the terrestrial
39 habitats and dominant vegetation within the site boundaries; with about 75 percent of the
40 approximately 2,000 ac (809 ha) site being covered with terrestrial vegetation. Deciduous
41 forests (36 percent of site), cultivated crops (18 percent), and pasture/hay (13 percent) are the
42 main vegetation types. About 45.6 ac (18.4 ha; 2.2 percent) of the site is wetlands (Figure 3-15).

43 Because the new towers are equipped with drift eliminators, vegetation should be exposed to
44 less humidity and vapor plumes than before the towers were replaced. Particulate deposition
45 should be similar as before tower replacement. With the installation of drift eliminators, the
46 amount of particulates deposited on terrestrial vegetation is expected to be less than before the
47 towers were replaced.

1 Other than temporary ground disturbance in the already disturbed area, Xcel Energy has not
2 identified any impacts from replacing the cooling towers in 2021 and 2022, and it does not plan
3 any construction or change in nuclear plant cooling operations during the SLR period.
4 Therefore, the impacts of continued cooling system operations at Monticello would be less than
5 operational impacts prior to tower replacement, and the NRC staff concludes that the potential
6 for cooling system impacts on terrestrial vegetation during the Monticello SLR term would be
7 SMALL.

8 3.6.4.5 *Bird Collisions with Plant Structures and Transmission Lines*

9 Bird collisions and the potential for mortality are associated with tall structures such as cooling
10 towers, transmission structures, meteorological towers (MET), and other nuclear power plant
11 infrastructure. Bird mortality is of concern if the resulting reduction in population numbers
12 threatens the stability of the species or significantly impairs its function within the ecosystem.
13 The 2013 LR GEIS (NRC 2013-TN2654) identified this as a Category 1 issue with a
14 determination of SMALL impact. The NRC staff found that the available data on bird collision
15 mortality associated with nuclear power plant cooling towers and other structures suggest that
16 the number of bird mortality collisions is small and primarily occur during the spring and fall
17 migration of songbirds at night. In the following discussion, the NRC staff analyzes the impact of
18 bird collisions on a site-specific basis for the Monticello SLR term in accordance with CLI-22-02
19 and CLI-22-03 (NRC 2022-TN8182, NRC 2022-TN9844).

20 In its ER, Xcel Energy states that it plans no new construction of tall structures such as buildings
21 or transmission lines during the Monticello SLR term. Therefore, this analysis addresses
22 potential impacts of bird collisions with existing structures and transmission lines during the SLR
23 term. The tallest structures on the Monticello site are the off-gas stack and primary MET, both of
24 which are 328 ft (100 m) above ground level (Xcel 2023-TN9084: Sections 2.2.4 and 3.2.3). The
25 primary MET is guyed and lit with red flashing lights (FAA 2013-TN9579). Xcel Energy states
26 that swan diverters are installed on transmission lines in areas where incidents of bird collisions
27 have occurred to reduce the likelihood of collision (Xcel 2023-TN9084: Section 2.2.5.3).
28 However, in-scope transmission lines on the Monticello site do not have swan diverters (Xcel
29 2023-TN9578: Enclosure 14) because avian mortality on the Monticello site from all causes,
30 including in-scope transmission lines, is low. From 2014–2023, Xcel Energy reported 10 avian
31 deaths on the Monticello site (10 individuals; Xcel 2023-TN9578: Enclosure 31); only one of
32 these was determined to be a collision (with a building). This low number over a nearly 10-year
33 period suggests that avian mortality at the Monticello site is generally low and does not have the
34 potential to adversely affect bird populations.

35 Xcel Energy has an aviation protection plan detailing policies and procedures to avoid and
36 minimize risks of avian collision on its sites and infrastructure (Xcel 2023-TN9084:
37 Sections 2.5.6.3 and 3.7.2.6). Furthermore, NSPM holds a migratory bird special purpose utility
38 permit from FWS authorizing the permittee to carry out utility-specific management actions (Xcel
39 2023-TN9084: Section 2.5.6.3).

40 Under the proposed SLR, current operating conditions and environmental stressors would
41 continue to exist; no new impacts would be expected to occur. Therefore, the impacts of current
42 operations and SLR on bird collisions would be similar. For these reasons, the effects of bird
43 collisions with plant structures and transmission lines would likely be minor and would neither
44 destabilize nor noticeably alter any important attribute of bird populations during the SLR term.
45 The NRC staff concludes that the impacts of bird collisions with plant structures or transmission
46 lines during the Monticello SLR term would be SMALL.

1 3.6.4.6 *Water use conflicts with terrestrial resources (plants with cooling ponds or cooling*
2 *towers using makeup water from a river)*

3 Water use conflicts occur when the amount of water needed to support riparian communities is
4 diminished as a result of demand for agricultural, municipal, or industrial use or decreased water
5 availability due to droughts, or a combination of these factors. The NRC staff describes how this
6 issue has been addressed historically, and then provides a site-specific evaluation for the
7 Monticello SLR term.

8 In the 1996 LR GEIS (NRC 1996-TN288), the NRC evaluated water use conflicts as a surface
9 water quality issue and included all ecological impacts within this surface water quality issue.
10 The NRC rated water use conflicts as SMALL. The 2013 LR GEIS (NRC 2013-TN2654)
11 separated surface water quality issues from ecological water use conflicts. For terrestrial
12 resources, the NRC created a new issue of water use conflicts for plants with cooling ponds or
13 cooling towers using makeup water from a river, reasoning that riparian communities could be
14 impacted by reduced flows if the makeup water is from a river. For the Wolf Creek Generating
15 Station in Coffey County, Kansas, which withdraws makeup water from a small river with
16 especially low flow during drought conditions, the NRC staff concluded that the water use
17 conflict impacts on terrestrial resources were SMALL to MODERATE. For other plants, the NRC
18 staff concluded that the impact of water use conflicts with riparian communities is a
19 plant-specific issue and that the range of impacts at plants with cooling ponds or cooling towers
20 using make up water from a river could not be determined generically. In the 2006 Monticello
21 LR SEIS (NRC 2006-TN7315), the NRC staff found no new and significant information
22 concerning this issue and adopted the 1996 LR GEIS's conclusion of SMALL for Monticello
23 initial license renewal. In this EIS, the NRC staff analyzes surface water resource use conflicts
24 in Section 3.5.3.1 and water use conflicts regarding aquatic resources in Section 3.7.2.9. Below,
25 the NRC staff analyzes this site-specific issue for the SLR term.

26 Monticello's cooling water intake system has the flexibility to operate in one of four modes:
27 open-cycle (i.e., once-through), closed cycle using cooling towers, and two combinations of
28 these modes referred to as helper cycle mode and partial recirculation mode, respectively. Xcel
29 Energy chooses the mode in which to operate, based on water temperature and river flow
30 requirements specified in Monticello's NPDES permit (MN0000868) and Water Appropriation
31 Permit (#66-1172; MPCA 2023-TN9401; MnDNR 2023-TN9402).

32 Terrestrial riparian communities that could be impacted by diminished water availability are the
33 terrestrial resources associated with the wetlands and surface water habitats on the Monticello
34 site (Table 3-9, Figure 3-15). These riparian habitats total about 45.6 ac (18.4 ha) and consist
35 mostly of riverine wetlands (60 percent of onsite wetland habitats) and freshwater
36 forested/shrub wetlands (35 percent of onsite wetland habitats) along the channel and on oxbow
37 islands. Many of the important terrestrial biota (Section 3.6.3) onsite are associated with riparian
38 habitats.

39 In the NRC staff's analysis of surface water conflicts (Section 3.5.3.1), the staff estimated that
40 less than 1 percent of the Mississippi River flows are permanently removed by Monticello in an
41 average year. The NRC staff did identify one period of extreme low flows in the Mississippi
42 River during the past 25 years of record (1998–2023). The extreme low river flows occurred
43 over six consecutive days from August 15 to August 20, 2021, during which time the average
44 Mississippi River flow was 650 cfs (18.4 m³/s). This was the only period where Mississippi River
45 flows dropped below Monticello's Surface Water Appropriation Permit river-flow threshold of
46 860 cfs (24.4 m³/s) and triggered restrictive water appropriations (i.e., appropriations shall not

1 exceed 75 percent of flows). The water withdrawals during this 6-day period of extreme low river
2 flows resulted in the permanent removal of approximately 8 percent of the Mississippi River
3 flows.

4 In Section 3.5.3.1, the NRC staff concluded that surface water use conflicts would be SMALL
5 due to the Surface Water Appropriation Permit which contains conditions that control water
6 withdraws from the Mississippi River and can require use of cooling towers to stay within the
7 water appropriations. Additionally, Monticello's operations permanently remove only a small
8 portion of Mississippi River flows during an average year (less than 1 percent) and during
9 extreme lows (approximately 8 percent). Thus, a high percentage (92 to 99 percent) of
10 Mississippi River flows would remain in the river even during extreme low flows, which would
11 preserve terrestrial riparian habitats and resources.

12 The proposed SLR for Monticello would continue current operating conditions and
13 environmental stressors rather than introduce wholly new impacts. Therefore, the impacts of
14 current operations and SLR on terrestrial resources would be similar. For the reasons explained
15 above, water use conflicts with terrestrial resources from SLR either would not occur or would
16 be so minor that the effects on terrestrial resources would be undetectable. The NRC staff
17 concludes that water use conflicts with terrestrial resources during the Monticello SLR term
18 would be SMALL.

19 3.6.4.7 *Transmission Line Right-of-Way Management Impacts on Terrestrial Resources*

20 This issue concerns the effects of transmission line ROW management on terrestrial plants and
21 animals. Utilities maintain transmission line ROWs so that the ground cover is composed of
22 low-growing herbaceous or shrubby vegetation and grasses. Generally, ROWs are initially
23 established by clear-cutting during transmission line construction and are subsequently
24 maintained by physical (e.g., mowing and cutting) and chemical (e.g., herbicides or pesticides)
25 means. These activities alter the composition and diversity of plant communities and generally
26 result in lower-quality habitat for wildlife. Heavy equipment used for ROW maintenance can
27 crush vegetation and compact soils, which can affect soil quality and reduce infiltration to
28 shallow groundwater. This is especially of concern in sensitive habitats, such as wetlands.
29 Chemical herbicides can be transported to neighboring undisturbed habitats through
30 precipitation and runoff. Disturbed habitats often favor non-native or nuisance species and can
31 lead to their proliferation. Noise and general human disturbance during ROW management can
32 temporarily disturb wildlife and affect their behaviors, and the presence of ROWs can favor
33 wildlife species that prefer edge or early successional habitats.

34 Both the 1996 LR GEIS (NRC 1996) and the 2013 LR GEIS (NRC 2013) identified this as a
35 Category 1 issue and concluded that the impacts of transmission line ROW management on
36 terrestrial resources would be SMALL during the initial license renewal term. In the 2006
37 Monticello LR (NRC 2006-TN7315), the NRC staff found no new and significant information
38 concerning this issue and adopted the 1996 LR GEIS's conclusion of SMALL impacts.

39 In the following discussion, the NRC staff analyzes the issue of transmission line ROW
40 management impacts on terrestrial resources on a site-specific basis for the Monticello SLR
41 term, in accordance with CLI-22-03 and CLI-22-02 (NRC 2022-TN8182, NRC 2022-TN9844).

42 Xcel Energy proposes no additional transmission line expansion or construction under the
43 proposed action of subsequent license renewal. Therefore, during the SLR term, in-scope
44 transmission line ROWs would be the same as the current ROWs connecting turbine building to

1 switch yards. The current in-scope transmission lines mostly cross developed industrial land
2 covers such as parking lots, switchyards, and substations (Xcel 2023-TN9084: Section 3.7.2.6),
3 which are not vegetated. However, the ROWs also do cross some landscaped areas that
4 contain vegetation. Control measures to limit or discourage vegetation growth incompatible with
5 in-scope transmission lines include mowing, pruning, removal, and herbicide application.
6 Although Xcel Energy does not have site-specific procedures for herbicide application, the Xcel
7 Energy chemical control program is applicable to herbicide application.

8 During the SLR term, Xcel Energy's facility department would continue to maintain onsite
9 transmission line ROWs with current control measures. The SLR would continue current
10 operating conditions and environmental stressors rather than introduce wholly new conditions
11 and impacts. Therefore, the impacts of current operations and the impacts of the proposed SLR
12 on transmission line ROW maintenance impacts on terrestrial resources would be similar. For
13 these reasons, the effects of transmission line ROW maintenance would likely be minor and
14 would neither destabilize nor noticeably alter any important attribute of terrestrial resources
15 during the SLR term. The NRC staff concludes that the impacts of transmission line ROW
16 maintenance on terrestrial resources during the Monticello SLR term would be SMALL.

17 *3.6.4.8 Electromagnetic Field [Impacts] on Flora and Fauna (Plants, Agricultural Crops,*
18 *Honeybees, Wildlife, and Livestock)*

19 This issue concerns the effects of electromagnetic fields (EMFs) on terrestrial plants and
20 animals, including agricultural crops, honeybees, wildlife, and livestock. Operating transmission
21 lines produce electric and magnetic fields, collectively referred to as EMFs. EMF strength at the
22 ground level varies greatly but is generally stronger for higher-voltage lines. Corona is the
23 electrical discharge occurring in air from EMFs; it can be detected adjacent to phase
24 conductors. Corona is generally not an issue for transmission lines of 345 kV or less. Corona
25 results in audible noise, radio and television interference, energy losses, and ozone and
26 nitrogen oxide production. For the purpose of license renewal, in-scope transmission lines
27 include lines that connect the plant to the first substation that feeds into the regional power
28 distribution system. The first substation is usually (but not always) on plant property.

29 In the LR GEIS (2013-TN2654), the NRC staff found that with the exception of honeybee hives,
30 terrestrial biota located under and near the in-scope transmission lines do not experience
31 biologically or economically (in the case of agriculture) significant adverse effects from EMFs
32 during license renewal. Plant foliage and buds can sustain minor damage that reduces upward
33 and outward growth, but the damage does not interfere with overall plant growth or the health of
34 the lower parts of the plant (Miller 1983-TN1328). Studies on crop plants grown in electric fields
35 have shown either no effect or small reductions in germination or yield (2013-TN2654). Adverse
36 effects to honeybee hives under transmission lines include reduced growth, greater irritability,
37 increased production of propolis (a resin compound used as a sealant), and increased mortality.
38 These adverse effects can be reduced by shielding hives with a grounded metal screen or
39 moving hives so that they are no longer near transmission lines.

40 In the following discussion, the NRC staff analyzes the issue of EMF impacts on flora and fauna
41 on a site-specific basis for the Monticello SLR term, in accordance with CLI-22-03, and
42 referencing CLI-22-02 (NRC 2022-TN8182, NRC 2022-TN9844).

43 As stated earlier in this section (Section 3.6.4.5), Xcel Energy has planned no additional
44 transmission lines under the proposed SLR. Therefore, in-scope transmission lines and
45 rights-of-way in the SLR term would be the same as those that currently connect the Monticello

1 turbine building to the switchyards (Xcel 2023-TN9084: Figure 2.2-3). The current transmission
2 line ROWs mostly cross impervious surfaces or land with sparse vegetation; they do not cross
3 agricultural fields, pastures, or other habitats important for native wildlife or livestock. Therefore,
4 exposure of terrestrial flora and fauna to EMFs are minimal under current operating conditions.

5 During the SLR term, Xcel Energy would continue current operating conditions, site
6 management controls, and environmental stressors rather than introduce wholly new conditions.
7 Therefore, the EMF impacts of operations during the SLR period on flora and fauna would be
8 similar to current impacts, which are minor. The NRC staff concludes that the impacts of EMFs
9 on flora and fauna during the SLR term would be SMALL.

10 **3.6.5 No-Action Alternative**

11 Under the no-action alternative, the NRC would not issue a renewed license, and Monticello
12 would shut down on or before the expiration of the current operating licenses. Much of the
13 operational noise and human activity at Monticello would cease, thereby reducing disturbances
14 to wildlife in forest cover and other natural vegetation on and near the site. However, some
15 continued maintenance of Monticello would still be necessary. Human activity, noise, and
16 herbicide application would continue at the site with possible impacts resembling, but perhaps of
17 a lower magnitude than, those described for the proposed action of subsequent license renewal.
18 Shutdown itself is unlikely to noticeably alter terrestrial resources. Reducing human activity and
19 frequency of operational noise may constitute minor beneficial effects on wildlife inhabiting
20 nearby natural habitats.

21 If Monticello were to cease operating, some withdrawal of water from the Mississippi River
22 would continue during the shutdown period to provide cooling to spent fuel in the spent fuel pool
23 until that fuel could be transferred to dry storage. However, the amount of water withdrawn for
24 these purposes would be a small fraction of water withdrawals used during current operations.
25 Eventually, the amount of cooling water returned to the river would decrease over time and
26 would end within the first several years following shutdown. The expected decrease in the
27 amount of cooling water would lower the temperature of the river below the concrete discharge.
28 Eventually, the water in the river would return to pre-plant winter temperatures when discharges
29 completely end. As described earlier in this section (Section 3.6.3.4), a group of about 1,000
30 trumpeter swans stop migrating south during the winter and instead depend on the warm, open
31 water winter habitat produced by the Monticello plant. If the Monticello plant were to cease
32 operations under the no-action alternative, trumpeter swans (a species protected under the
33 Migratory Bird Treaty Act) that winter at Monticello would lose an important overwintering habitat
34 in central Minnesota (MNBBA 2023-TN9572). If the release of heated water were reduced in the
35 winter months, many of the overwintering trumpeter swans would probably migrate elsewhere;
36 however, some could die. The NRC staff concludes that the impacts of the no-action alternative
37 on terrestrial resources during the proposed SLR term would be SMALL.

38 **3.6.6 Replacement Power Alternatives: Common Impacts**

39 Under all the replacement power alternatives that the NRC staff seriously considered, additional
40 land would likely be temporarily disturbed for construction and laydown areas. If not already
41 previously disturbed, the licensee could mitigate the impact by later revegetating temporarily
42 disturbed land. All replacement power alternatives would also involve construction on developed
43 or undeveloped lands outside the vicinity of the Monticello site with indeterminate loss of offsite
44 forest, grasslands, desert, or wetlands.

1 Loss of habitat and increased noise generation during construction and operation of the new
2 facilities could cause terrestrial wildlife to move into other habitats in the surrounding landscape,
3 increasing demands on those habitats and competing with other wildlife. Erosion and
4 sedimentation from clearing, leveling, and excavating land could affect adjacent riparian and
5 wetland habitats. However, implementation of appropriate BMPs and the revegetation of
6 temporarily disturbed lands would minimize impacts. The operator of the natural gas plant would
7 develop and adhere to environmental management practices and BMPs protect terrestrial
8 resources for the generation facilities and associated transmission corridors.

9 All of the power replacement alternatives assume the construction and maintenance of new
10 transmission line corridors. Loss of habitat, habitat fragmentation, and increased noise
11 generation during construction and operation of the new transmission line corridor could cause
12 terrestrial wildlife to move into other habitats in the surrounding landscape, increasing demands
13 on those habitats and competing with other wildlife. As the corridor revegetates and routine
14 maintenance occurs, species favoring differing habitats could avoid or prefer the open habitat of
15 the corridor. Invasive plants may also colonize the newly created corridors. In a review of bird
16 mortality literature, Loss et al. (2014-TN9396) estimated that the median annual collision
17 mortality for birds is 23.2–29.6 birds/km of powerline. Biological, environmental, location, and
18 design factors influence the likelihood of collisions (APLIC 2012-TN6779; Bevanger 1994-
19 TN9619).

20 The MBTA makes it illegal to take any migratory bird (or parts, nests, or eggs), except under a
21 valid permit issued under Federal regulations. The utility may need to commission avian impact
22 studies and obtain a Federal migratory bird special purpose utility permit for take of
23 MBTA-protected bird species, in order to collect, transport, and temporarily possess migratory
24 birds found on utility property or to handle active nest (FWS Undated-TN9282).

25 **3.6.7 Natural Gas and Renewables (Solar and Wind) Alternative**

26 Xcel Energy's ROI includes Minnesota and seven other states: Colorado, Michigan,
27 New Mexico, North Dakota, South Dakota, Texas, and Wisconsin. This analysis assumes that
28 the natural gas-fired power plant would be constructed either onsite or offsite in one of the
29 states within Xcel Energy's ROI. Solar panels could be installed on the Monticello site, offsite
30 within Minnesota, or elsewhere within the ROI. Wind turbines would be installed offsite within
31 Minnesota or elsewhere within the ROI.

32 This alternative would require 72,630 ac (29,393 ha) of land within the ROI: 67,580 ac
33 (27,349 ha) for power generation facilities and an additional 5,050 ac (2,044 ha) of land for
34 transmission line corridors.

35 Natural Gas Generation

36 The LR GEIS (NRC 2013-TN2654, page 4-119) concludes that many of the impacts on
37 terrestrial resources from the operation of fossil-fuel energy alternatives would be essentially
38 similar to those from the continued operation of a nuclear power plant. These similar impacts
39 include cooling tower salt drift, noise, bird collisions with plant structures and transmission lines,
40 the impacts connected with herbicide application and landscape management, and the potential
41 water use conflicts connected with cooling water withdrawals. However, some impacts particular
42 to a natural gas plant would be from air emissions of GHGs such as nitrogen oxide, carbon
43 dioxide, and methane. Such GHGs can lead to consequences like climate change.

1 For the natural gas portion of the alternative, about 980 ac (396 ha) of land would be needed.
2 About 80 ac (32 ha) would be needed for the 750 MW natural-gas-fired plant, assuming
3 20–40 ac (8–16 ha) per combustion unit (Leidos 2016-TN9183). About 900 ac (364 ha) would
4 be needed for two new 345 kV transmission lines; each corridor would be 25 mi (45.7 km) long
5 and 150 ft (40.2 m) wide. The natural gas facility could be constructed on the Monticello site,
6 offsite in Minnesota, or offsite in another state in the ROI.

7 If the lands chosen for the plant to be built offsite were previously cleared and used for industrial
8 activity, the impacts on terrestrial resources would be less significant than if the lands were
9 virgin forest, grasslands, or desert containing important species and habitats. Vegetation
10 clearing, tree removal, and construction noise would displace wildlife to nearby habitats, but
11 some species would return at the end of construction when temporarily disturbed land is
12 restored.

13 Operation of the offsite natural gas facility would have similar impacts to the proposed action
14 regarding cooling tower salt drift, noise, bird collisions with plant structures and transmission
15 lines, potential water use conflicts connected with cooling water withdrawals, and management
16 of site and transmission corridors. Section 3.14.3.1 in this report discusses the effects of climate
17 change on terrestrial resources. Despite these impacts, operating the natural gas alternative
18 power plant would not likely destabilize any important attribute of the terrestrial environment.

19 The land requirement for construction of generation facilities and transmission corridors would
20 not necessarily lead to moderate amounts of habitat loss, depending on whether or not those
21 facilities and corridors are placed on already developed lands. Construction of new transmission
22 lines would cause loss of vegetation, change in habitats and wildlife habitat use, and would
23 pose an increased risk of bird collisions and mortality. The NRC staff concludes that the impacts
24 on terrestrial resources from the natural gas portion of this alternative would be SMALL to
25 MODERATE.

26 Solar Photovoltaic

27 About 2,950 ac (1,194 ha) of land would be needed for the solar portion of this alternative. DOE
28 estimates that the solar installation could occur on as many as three project sites and that they
29 require about 7.6 ac (3.1 ha)/MW. Because this alternative proposes to install 200 MW of solar
30 photovoltaic (PV), solar installations would require about 1,500 ac (607 ha). An additional
31 1,450 ac (587 ha) would be needed for one to three new 345 kV transmission lines; each
32 corridor would be 25 mi (45.7 km) long and 150 ft (40.2 m) wide. A small amount of additional
33 land would be needed to support the battery storage system at each site.

34 Impacts on terrestrial habitats and biota from the construction and operation of solar PV plants
35 would depend largely on the amount of land required and its location. The NRC staff assumes
36 that one of the solar plants would be located on the Monticello site, and the other two would be
37 located offsite. If the lands chosen for the plants offsite were previously cleared and used for
38 industrial activity, the impacts on terrestrial resources would be less significant than if the lands
39 were forest, grasslands, wetlands, or desert containing important species and habitats.
40 Vegetation clearing and tree removal would displace wildlife to nearby habitats, but some
41 species would return at the end of construction when temporarily disturbed land is restored.
42 Once in operation, solar plants pose special hazards to birds through collisions with PV
43 equipment and transmission lines, electrocution by substation and distribution lines, and
44 predation when injured and stunned on the ground after collision (Hathcock 2019-TN8470).
45 Another less understood cause of bird collisions is known as the lake effect theory. Birds,

1 especially migrating waterfowl and shorebirds, perceive the horizontally polarized light of PV
2 solar panels as bodies of water and are injured or killed when they attempt to land on the panels
3 as if they were water (Horvath et al. 2009-TN897). Water-seeking insects can also collide with
4 the panels for the same reasons. In large enough numbers, such insect deaths may affect food
5 webs. The Multiagency Avian-Solar Collaborative Working Group is a collection of Federal and
6 State agencies identifying information needs and best practices for reducing the avian impacts
7 of solar energy. Collaboration with government agencies on best practices in the construction
8 and siting of the solar installations can mitigate their impacts on birds.

9 The NRC staff concludes that the impacts on terrestrial resources from the solar portion of this
10 alternative would be MODERATE to LARGE based on the land requirement for solar generation
11 facilities and transmission corridors, resulting in the significant loss of wildlife, habitats, and
12 vegetation and the increased mortality risk to birds from collisions with solar PVs and new
13 transmission lines.

14 Wind

15 About 68,700 ac (27,812 ha) of land would be needed for the wind portion of this alternative.
16 DOE estimates that wind power generation disturbs up to 88.21 ac (35.70 ha)/MW. Because
17 this alternative proposes to install 750 MW of wind power, wind turbine installation would require
18 about 66,000 ac (26,709 ha). An additional 2,700 ac (1,093 ha) would be needed for 150 mi
19 (241.4 km) of new 345 kV transmission lines; each corridor would be 150 ft (40.2 m) wide. Wind
20 facilities could be located onshore or offshore (Section 2.4.2).

21 Impacts on terrestrial habitats and biota from the construction and operation of wind farms as
22 part of the combination alternative would depend largely on the amount of land required,
23 location of the land, and whether the facility is onshore or offshore. The NRC staff assumes that
24 the onshore wind portion of the alternative would be in the Xcel Energy ROI. If the lands chosen
25 for the plants were previously cleared and used for industrial activity, the impacts on terrestrial
26 resources would be less significant than if the lands were forests or grasslands containing
27 important species and habitats. Vegetation clearing and tree removal would displace wildlife to
28 nearby habitats, though some species would return at the end of construction when temporarily
29 disturbed land is restored.

30 Operation of wind farms would likely cause the injury and/or death of bats and birds that collide
31 with wind turbines (Allison et al. 2019-TN8847), with onshore collisions thought to be more
32 common than offshore collisions. However, accurately estimating collision fatalities requires
33 accounting for differences in search effort and area, scavenger removals, and searcher
34 efficiency.

35 For onshore wind turbine locations, species composition of deaths varies regionally for bats and
36 birds (Allison et al. 2019-TN8847, Thompson et al. 2017-TN8746). In some regions, bat
37 mortalities are greater than those of birds. Bat collision mortality appears to be lowest in areas
38 with the greatest grassland cover around the onshore wind farm. Three migratory tree roosting
39 bat species account for 72 percent of reported mortalities: hoary bat, eastern red bat, and
40 silver-haired bat. Most of the observed bird deaths at onshore wind farms are small songbirds
41 (57 percent of deaths) or diurnal raptors (9 percent), which include eagles and hawks.

1 For offshore wind turbine locations, collision impacts are difficult to accurately quantify because
2 of challenges in bird and bat fatality monitoring in the offshore environments (Allison et al. 2019-
3 TN8847). Offshore wind farms tend to use much larger turbines, include larger numbers of
4 turbines, and operate in areas where the background noise from wind and waves hamper bird
5 acoustic perceptions (Exo et al. 2003-TN8488). Lack of assessment tools, environmental
6 differences, and infrastructure make it difficult to use onshore wind turbine mortality rates as the
7 starting point for estimating offshore wind turbine bat or bird mortality rates.

8 Based on the preceding analysis, the NRC staff concludes that impacts on terrestrial resources
9 from construction and operation of the wind portion of this alternative would be MODERATE to
10 LARGE. Although construction of the wind farms would result in the alteration and loss of
11 vegetation and wildlife habitats, sites could be revegetated. Some species and habitats would
12 reestablish after the construction disturbance ends. Operational impacts would negatively
13 impact bird and bat populations.

14 Natural Gas and Renewables (Solar and Wind) Conclusion

15 The NRC staff concludes that the overall impacts on terrestrial resources for the Natural Gas
16 and Renewables (Solar and Wind) combination alternative could range from MODERATE to
17 LARGE. The NRC staff's conclusion is based primarily on the large area of land required for all
18 of the plants and the transmission corridors, the types of land that could permanently disturbed
19 for the solar PV portion, the operational impacts of the wind portion of the alternative on birds
20 and bats, and the increased likelihood of bird mortality from collisions with the new transmission
21 lines.

22 **3.6.8 Renewables (Solar and Wind) and Storage Alternative**

23 Under this alternative, 950 MW of wind turbines, 700 MW of solar panels both on and offsite of
24 Monticello, and 300 MW of offsite lithium-ion battery storage would be constructed. Xcel Energy
25 estimates that solar panels would be installed at as many as three different project sites within
26 the Xcel Energy ROI. Wind turbines would be installed offsite within Minnesota or the ROI.
27 Types of impacts to terrestrial species from the solar and wind energy facilities would be similar
28 to those described for the solar and wind portions of the previous alternative (Section 3.6.7) as
29 would permitting requirements from regulatory agencies. However, because the land
30 requirements are larger overall (96,500 ac; 39053 ha), the likelihood of negative impacts on
31 terrestrial species increases. Solar PV generation is 750 MW, which is estimated to require
32 (5,300 ac (2,145 ha). Wind power generation is 950 MW, which is estimated to require
33 (84,000 ac [33,994 ha]). These new generation facilities are estimated to require 400 mi of new
34 transmission corridors (7,200 ac [2,914 ha]). Operational impacts would be greater to birds and
35 bats, because more solar panels and wind turbines would be operational, and because more
36 transmission lines increase the likelihood of bird collisions. A small amount of additional land
37 would be needed to support the battery storage system at each site.

38 Under this alternative, construction would result in the significant loss of vegetation and wildlife
39 habitat, and operational impacts would negatively affect bird and bat populations. Based on the
40 preceding analysis, the NRC staff concludes that impacts on terrestrial resources from
41 construction and operation of solar PV and wind generation facilities as part of this alternative
42 would be MODERATE to LARGE.

1 **3.6.9 New Nuclear (Small Modular Reactor) Alternative**

2 For the new nuclear alternative, the NRC staff assumes that the applicant would replace
3 Monticello with a 12-unit NuScale design SMR power plant generating 880 MWe. Because
4 Minnesota prohibits the construction and operation of new nuclear power plants within the State,
5 the NRC staff assumes that the replacement plant would be constructed in one of the other
6 seven states within Xcel Energy’s service area (i.e., Colorado, Michigan, New Mexico, North
7 Dakota, South Dakota, Texas, or Wisconsin).

8 The 12-unit SMR facility would be sited and constructed on about 130 ac (53 ha) of land that is
9 within 25 mi of an existing transmission grid with sufficient surface water to support a plant
10 cooling system and water use. An additional 450 ac (182 ha) would be needed to construct a
11 25 mi-long, 150 ft-wide transmission corridor to transmit power to the electrical grid. The SMR
12 cluster will require the addition of new, tall structures to the landscape, including MDCTs, a
13 power block, and one or two meteorological towers less than 200 ft (61 m) tall. The construction
14 of tall structures may result in increased bird and bat mortality or injury from collisions. However,
15 the NRC staff expects that over time, bird and bat populations would become accustomed to the
16 presence of the new towers and avoid them.

17 Project construction would require clearing approximately 580 ac (235 ha) for the facility,
18 auxiliary structures, and new transmission corridor. Once the SMR and associated facilities are
19 built, the operational impacts on terrestrial resources would likely remain as expected for the
20 proposed action.

21 For the Monticello plant site, impacts to terrestrial resources are the same as the No-Action
22 alternative, because the site will be shut down. Because no nuclear facilities can be built in the
23 State of Minnesota, the new nuclear alternative would result in the eventual loss of the existing
24 overwintering swan habitat downstream of the Monticello plant on the Mississippi River in
25 Minnesota as described above in the No-Action alternative.

26 Based on the preceding analysis, the NRC staff concludes that the impacts on terrestrial
27 resources from the new nuclear option would be MODERATE for construction and SMALL for
28 operations.

29 **3.7 Aquatic Resources**

30 This section describes the aquatic resources of the affected environment, which is the stretch of
31 the Mississippi River by Monticello. The NRC staff previously characterized these resources in
32 Section 2.2.5 of the 2006 Monticello LR SEIS, which analyzed the environmental impacts of
33 initial license renewal (NRC 2006-TN7315). Section 3.7 of Xcel Energy’s 2023 Environmental
34 Report also contains a description of the aquatic environment (Xcel 2023-TN9084). This
35 information is incorporated herein by reference, with key and updated information summarized
36 below in the following subsections. Following the description of the aquatic environment, the
37 staff analyzes the potential impacts on these resources that would occur from the proposed
38 action (SLR) and alternatives.

39 **3.7.1 Mississippi River**

40 Monticello lies in central Minnesota along the southern bank of the Mississippi River at RM 900
41 (river kilometer [RKM] 1,448). Monticello withdraws cooling water from and discharges thermal
42 effluent to the Mississippi River. The reach of the Mississippi River in the vicinity of Monticello is

1 free flowing, shallow, and has swift currents and rapids (Xcel 2023-TN9084). The currents are
2 swift because the river loses approximately 10 ft (3.1 m) of elevation in the stretch that is 1.5 mi
3 (2.4 km) upstream and downstream of Monticello. The water velocity averages 1.5 to 2.5 fps
4 (0.46 to 0.76 m/s) and can exceed 4.9 fps (1.49 m/s) during high flows. The main channel is
5 approximately 980 ft (299 m) wide with an average depth of 6.2 ft (1.9 m). This region has
6 mixed riverbed substrate consisting of gravel, rubble, boulder, and sand. The backwaters and
7 shoreline areas are shallower with an average depth of 2 ft (0.6 m). These areas have finer
8 substrates of mixed silt and mud. Section 3.5.1 contains additional information on the
9 hydrological characteristics of the river.

10 The reach of the Mississippi River in the vicinity of Monticello is included in the Minnesota State
11 Wild and Scenic River System Program, and it is designated as a “restricted” Outstanding
12 Resource Value Water by the MPCA (see Section 3.7.1.2). While the portion of the Mississippi
13 River near Monticello is free-flowing, it lies between the Sartell Dam upriver in Saint Croix,
14 Minnesota, and the Coons Rapid Dam (a low sill dam) and the Lower Saint Anthony Falls Dam
15 (the last dam with a lock for barged transport) downstream. The Coon Rapids Dam (RM 866;
16 RKM 1,394) bars upstream fish migration, but fish can sometimes circumvent the dam during
17 floods (Hatch et al. 2003-TN9330). These dams prevent species below the dams, such as lake
18 sturgeon (*Acipenser fulvescens*) and paddlefish (*Polyodon spathula*), from accessing the reach
19 of the Mississippi River by Monticello (NRC 2006-TN7315); however, fish can migrate
20 downstream past the dams via spillways or powerhouses.


21 3.7.1.1 *Biological Communities of Mississippi River*

22 The local biological communities are those associated with riverine and backwater habitats
23 (Xcel 2023-TN9084). The trophic structure consists of primary producers that process organic
24 compounds from solar energy, which in turn feed primary and secondary consumers across the
25 other trophic levels (Figure 3-16). Even though the main primary producer is periphyton (a mix
26 of algae, diatoms, other microbes attached to the river bottom), floating phytoplankton (floating
27 algae) and macrophytes (aquatic plants) also contribute to primary production. Detritus, which
28 includes leaves, sticks, and other organic debris from the terrestrial environment, is another
29 important energy source in river systems.

30 Primary consumers mainly include benthic invertebrates (e.g., insects, snails, mussels,
31 crustaceans), along with zooplankton. Primary consumers support a diverse array of secondary
32 and tertiary consumers, such as forage fish and predatory fish, including species that are
33 popular in recreational fisheries. Primary consumers also provide food for aquatic snakes,
34 salamanders, and turtles.

35 Studies characterizing primary producers and primary consumers near Monticello were last
36 conducted between 1940 and 1976 (Xcel 2023-TN9084), which means that the discussions of
37 these organisms in the 2006 Monticello LR SEIS remain the best available information (NRC
38 2006-TN7315). With respect to fish in the higher trophic levels, Xcel Energy conducts annual
39 electrofishing and seining surveys to evaluate local fishery health. The most recently available
40 survey report includes data gathered in 2020 and 2021² (Xcel 2023-TN9578: Enclosure 24).

² Xcel Energy 2022. Monticello Nuclear Generating Plant Environmental Monitoring and Ecological Studies Program, 2020–2021 Biennial Report. Enclosure 24 Attachment 1 of Xcel 2023-TN9578.

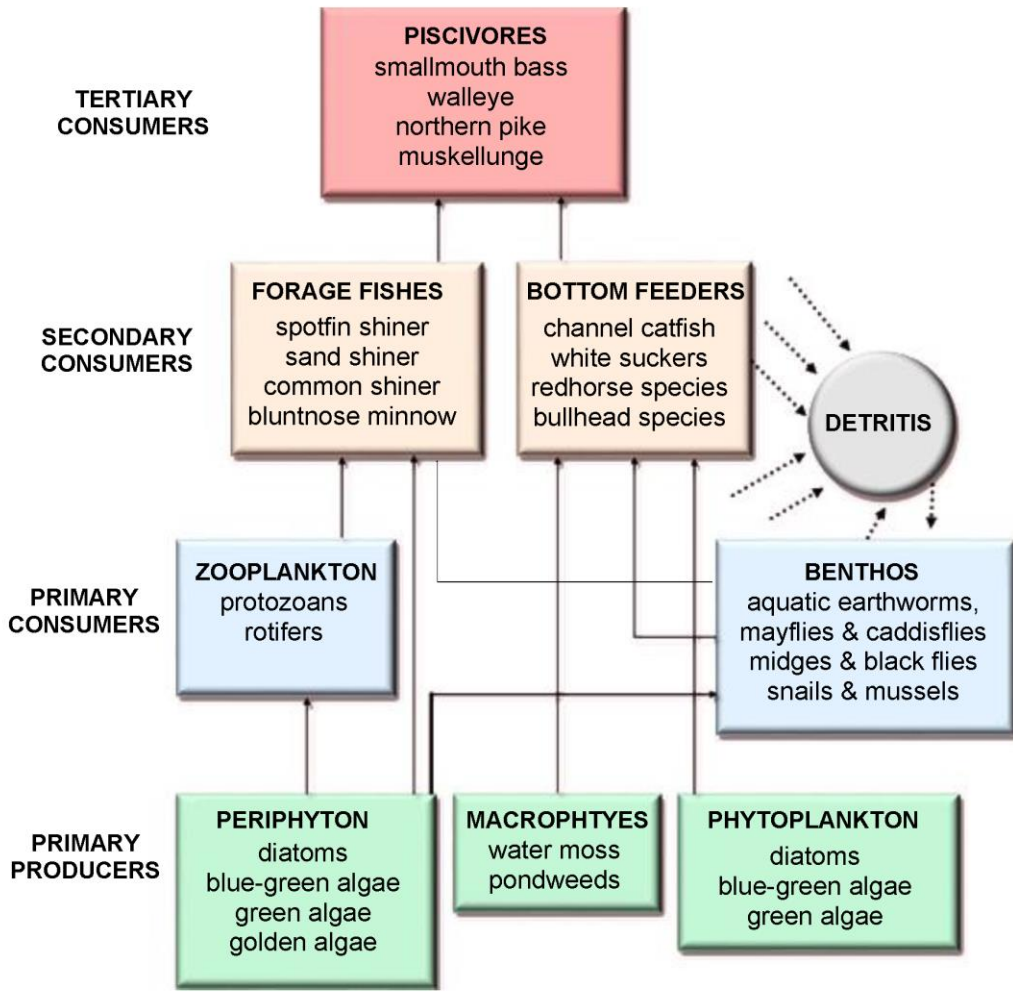

1
 2 **Figure 3-16 Aquatic Communities of the Mississippi River by the Monticello Nuclear**
 3 **Generating Plant**

4 Periphyton and Other Plankton

5 Periphyton is typically the main primary producer in river systems and serves as a main energy
 6 source. Periphyton is comprised of mixed groups of algae, diatoms (that conduct
 7 photosynthesis) and cyanobacteria that attach to a variety of substrates in the river systems.

8 In studies conducted in the Mississippi River near Monticello in the 1970s, researchers
 9 estimated that 60 to 82 percent of the total primary production of the Mississippi River that flows
 10 past Monticello is attributed to periphyton (Amish et al. 1978-TN9580). Analysis of plankton
 11 collections identified 149 taxa of algae. The diatom *Gomphonema olivaceum* dominated winter
 12 and spring collections. Other dominant spring diatoms included *Diatoma vulgare*, *Synedra ulna*,
 13 and *Navicula gracilis*. Diatoms such as *Cocconeis placentula* and *Cocconeis pediculus*
 14 dominated fall collections (see Table 3.7-1 in Xcel 2023-TN9084). Periphyton production was
 15 highest in the summer, since these organisms rely on sunlight, and was dominated by the
 16 diatoms listed above along with blue-green algae. In its LR SEIS (NRC 2006-TN7315), the NRC
 17 staff found that periphyton species composition was similar in preoperational and
 18 post-operational collections.

1 The same species of periphyton algae can also occur in rivers as “floating phytoplankton,” but at
2 a lower prevalence. Floating phytoplankton can be washed into rivers from reservoirs or
3 standing backwater areas. Floating plankton can also occur as pieces of periphyton that break
4 off and float to the surface. Researchers estimated that 18 to 40 percent of the primary
5 production in the aquatic ecosystem by Monticello is attributed to floating phytoplankton based
6 on surveys conducted from 1968 to 1970 (Amish et al. 1978-TN9580); however, the main
7 source was probably from fragments of periphyton (NRC 2006-TN7315; NMC 2005-TN9345).

8 Zooplankton are microscopic animals that drift in the open water and prey upon floating
9 phytoplankton. While zooplankton are an important contributor to aquatic ecosystems in oceans
10 and lakes, they are not prominent components of the riverine ecosystems since they are not
11 well adapted to fast currents. Zooplankton are present near Monticello but contribute a
12 negligible amount to the energy flow (NRC 2006-TN7315; NMC 2005-TN9345).

13 Macrophytes

14 Aquatic vascular plants (macrophytes) can also be important contributors to riverine habitats;
15 however, they are not abundant near Monticello because of the swift currents, shifting sands,
16 and gravel to rocky bottoms that make it difficult for macrophytes to anchor roots and take hold
17 (NRC 2006-TN7315; NMC 2005-TN9345). The three species of macrophytes found at low
18 abundances during early surveys near Monticello include: (1) water moss
19 (*Fontinalis antipyretica*); (2) American pondweed (*Potamogeton nodosus*); and (3) sago
20 pondweed (*Stuckenia pectinata*) (NRC 2006-TN7315; Amish et al. 1978-TN9580).

21 Benthic Invertebrates

22 Benthic invertebrates inhabit the bottom of rivers and mainly consume periphyton. They include
23 certain zooplankton and macroinvertebrates such as insects, mussels, crayfish, snails, clams,
24 and polychaetes. Benthic invertebrates are primary consumers and are an important indicator of
25 the health of an aquatic system. Table 3.7-2 of Xcel Energy’s 2023 Environmental Report (Xcel
26 2023-TN9084) contains a summary of benthic invertebrates found near Monticello.

27 Moyle (NMC 2005-TN9399) and students from Saint Cloud State University (Amish et al. 1978-
28 TN9580) conducted studies of invertebrates near Monticello in 1940 and 1968, respectively.
29 Researchers recorded over 100 taxa of benthic invertebrates during these surveys. Collections
30 were dominated by the following groups: (1) aquatic earthworms (oligochaetes); (2) insect
31 larvae (mayflies, beetles, caddisflies, midges, and blackflies) (3) snails (gastropods); and
32 (4) fingernail clams (*Sphaeriida* spp.). Freshwater insects are an abundant and important food
33 source for fish with millions passing a single sampling point in a single 24-hour period (Amish et
34 al. 1978-TN9580).

35 Freshwater Mussels

36 The upper portion of the Mississippi River (including the area by Monticello) once supported a
37 substantial mussel fishery, but the mussels were rapidly overfished by the 1930s and many
38 populations have struggled to recover (FWS 2003-TN9346). Mussels may be negatively
39 affected by riverbed disturbance, changes in water flow, and deterioration in water quality
40 including sedimentation/siltation, nutrient loading, and possibly temperature alterations.

41 In early surveys of the region, Moyle (NMC 2005-TN9399) and Saint Cloud State University
42 (Amish et al. 1978-TN9580) collected five species of mussels above Saint Anthony Falls:

1 (1) mucket (identified as *Actinonaias carinata* in early Monticello studies, although now known
 2 as *Actinonaias ligamentina*); (2) giant floater (*Anodonta grandis plana*); (3) black sandshell
 3 (*Ligumia recta*); (4) fatmucket (*Lampsilis siliquoidea*); and (5) plain pocketbook mussel
 4 (identified as *Lampsilis ventricose* in early Monticello studies, although now regarded as being
 5 the same species *Lampsilis caridium*) (NMC 2005-TN9399; Amish et al. 1978-TN9580). The
 6 MDNR Natural Heritage Review Team has indicated that black sandshell is a State-listed
 7 mussel species of special concern (MnDNR 2023-TN9338) that may continue to occur near
 8 Monticello.

9 Finfish

10 The Mississippi River near Monticello is home to approximately 50 fish species (Table 3-11)
 11 based on electrofishing, seining, and trotline surveys conducted by Xcel Energy, MDNR, and
 12 Saint Cloud State University. Students from Saint Cloud State University conducted
 13 electrofishing surveys in 1968 before Monticello began operating (Amish et al. 1978-TN9580).
 14 Xcel Energy has also conducted annual electrofishing and seining surveys since Monticello
 15 operations began (Xcel 2004-TN9581, Xcel 2023-TN9578). Xcel Energy’s survey reports
 16 contain species compositions, length compositions, catch-per-unit-effort by year, and weight
 17 trends for areas upriver and downriver of Monticello. Electrofishing surveys are better at
 18 capturing larger fish and seine surveys are better at capturing small fish, which is why both
 19 survey types are often used to evaluate fish populations. The most abundant species captured
 20 in Xcel Energy’s electrofishing surveys include shorthead redhorse
 21 (*Moxostoma macrolepidotum*), silver redhorse (*M. anisurum*), common carp (*Cyprinus carpio*),
 22 smallmouth bass (*Micropterus dolomieu*), northern hog sucker (*Hypentelium nigricans*), white
 23 sucker (*Catostomus commersoni*), channel catfish (*Ictalurus punctatus*), and walleye
 24 (*Sander vitreus*). The main species captured in Xcel Energy’s seining surveys include spotfin
 25 shiner (*Cyprinella spiloptera*), sand shiner (*Notropis stramineus*), common shiner
 26 (*Luxilus cornutus*), bluntnose minnow (*Pimephales notatus*), and other forage fishes
 27 (Table 3-11). In 2007, the MDNR conducted an electrofishing and trotline survey that compares
 28 catch-per-unit-efforts for areas upriver and downriver of Monticello (Stewig and Chapman 2009-
 29 TN9337). Section 3.8.1.2 discusses the results of this survey.

30 **Table 3-11 Fish Species That Occur in the Mississippi River Near Monticello Nuclear**
 31 **Generating Plant**

Family	Species	Common Name
Amiidae	<i>Amia calva</i>	bowfin
Antherinidae	<i>Labidesthes sicculus</i>	brook silverside
Catostomidae	<i>Catostomus commersoni</i>	white sucker
Catostomidae	<i>Hypentelium nigricans</i>	northern hogsucker
Catostomidae	<i>Ictiobus cyprinellus</i>	bigmouth buffalo
Catostomidae	<i>Moxostoma anisurum</i>	silver redhorse
Catostomidae	<i>Moxostoma macrolepidotum</i>	shorthead redhorse
Catostomidae	<i>Moxostoma valenciennesi</i>	greater redhorse
Centrarchidae	<i>Ambloplites rupestris</i>	rockbass
Centrarchidae	<i>Lepomis cyanellus</i>	green sunfish
Centrarchidae	<i>Lepomis gibbosus</i>	pumpkinseed
Centrarchidae	<i>Lepomis macrochirus</i>	bluegill
Centrarchidae	<i>Micropterus dolomieu</i>	smallmouth bass

1
2

Table 3-11 Fish Species That Occur in the Mississippi River Near Monticello Nuclear Generating Plant (Continued)

Family	Species	Common Name
Centrarchidae	<i>Micropterus salmoides</i>	largemouth bass
Centrarchidae	<i>Pomoxis annularis</i>	white crappie
Centrarchidae	<i>Pomoxis nigromaculatus</i>	black crappie
Cyprinidae	<i>Campostoma anomalum</i>	central stoneroller
Cyprinidae	<i>Cyprinella spiloptera</i>	spotfin shiner
Cyprinidae	<i>Cyprinus carpio</i>	common carp
Cyprinidae	<i>Hybognathus hankinsoni</i>	brassy minnow
Cyprinidae	<i>Nocomis biguttus</i>	hornyhead chub
Cyprinidae	<i>Notemigonus crysoleucas</i>	golden shiner
Cyprinidae	<i>Notropis blennioides</i>	river shiner
Cyprinidae	<i>Notropis dorsalis</i>	bigmouth shiner
Cyprinidae	<i>Notropis hudsonius</i>	spottail shiner
Cyprinidae	<i>Notropis stramineus</i>	sand shiner
Cyprinidae	<i>Notropis volucellus</i>	mimic shiner
Cyprinidae	<i>Pimephales notatus</i>	bluntnose minnow
Cyprinidae	<i>Pimephales promelas</i>	fathead minnow
Cyprinidae	<i>Puoxinus eos</i>	redbelly dace
Cyprinidae	<i>Rhinichthys atratulus</i>	blacknose dace
Cyprinidae	<i>Rhinichthys cataractae</i>	longnose dace
Cyprinidae	<i>Semotilus atromaculatus</i>	creek chub
Esocidae	<i>Esox lucius</i>	northern pike
Esocidae	<i>Esox masquinongy</i>	muskellunge
Fundulidae	<i>Fundulus diaphanus</i>	banded killifish
Gasterosteidae	<i>Culaea inconstans</i>	brook stickleback
Ictaluridae	<i>Amerius melas</i>	black bullhead
Ictaluridae	<i>Amerius natalis</i>	yellow bullhead
Ictaluridae	<i>Amerius nebulosus</i>	brown bullhead
Ictaluridae	<i>Ictalurus punctatus</i>	channel catfish
Ictaluridae	<i>Pylodictis olivaris</i>	flathead catfish
Lotidae	<i>Lota lota</i>	burbot
Percidae	<i>Etheostoma nigrum</i>	johnny darter
Percidae	<i>Perca flavescens</i>	yellow perch
Percidae	<i>Percina caprodes</i>	logperch
Percidae	<i>Percina maculata</i>	blackside darter
Percidae	<i>Sander vitreus</i>	walleye
Percopsidae	<i>Percopsis omiscomaycus</i>	trout-perch
Salmonidae	<i>Coregonus artedii</i>	cisco

Sources: Amish et al. 1978-TN9580; Xcel 2023-TN9578³; Xcel 2004-TN9581; Stewig and Chapman 2009-TN9337.

³ Xcel Energy 2023. Enclosure 24 RAI AQ-4 through AQ-7 Aquatic Resources Documents. Enclosure 24 in Xcel 2023-TN9578, page 59.

1 3.7.1.2 *Important Species and Habitats of Mississippi River*

2 This section summarizes State river designations, important fisheries, State-protected species,
3 and other special status species. Section 3.8.1 discusses federally listed species separately;
4 however, no federally protected aquatic species occur in the action area.

5 State River Designations

6 The reach of the Mississippi River by Monticello is included in the Minnesota State Wild and
7 Scenic River System Program due to an abundance of aquatic wildlife, a high-quality
8 smallmouth bass fishery, a series of unique bluffs and islands, and an area of high-quality
9 canoeing and kayaking (MnDNR 2023-TN9339, MnDNR 2004-TN9340). The MDNR classifies
10 this reach as “recreational” since it has been impacted by impoundment or other considerable
11 human activity. The MDNR manages this reach to preserve and protect its scenic, recreational,
12 natural, historical, and scientific values (MnDNR 2023-TN9341). This stretch of the river is not
13 included in the Federal National Wild and Scenic Rivers Act (National Wild and Scenic Rivers
14 System 2023-TN9342).

15 Tribal Fishing Rights

16 Under the 1837 treaty of St. Peters, 11 Ojibwe Tribes in Minnesota, Wisconsin, and Michigan
17 have reserved fishing rights in ceded Mississippi River tributaries (Minnesota Indian Affairs
18 Council-TN9662). Section 3.9 of this EIS discusses cultural and historic resources, including
19 Tribal treaty rights, in more detail.

20 Commercially Important Fisheries

21 There are no commercial fisheries in the reach of the Mississippi River by Monticello (NMC
22 2006-TN9677; Stewig and Chapman 2009-TN9337).

23 Recreationally Important Fisheries

24 The Mississippi River near Monticello is a popular angling destination that is supported by
25 natural production (i.e., fish species are not stocked). From May 12, 2007, through September
26 30, 2007, the MDNR conducted a fishery creel survey of the entire reach of the river from Saint
27 Cloud to Coon Rapids (i.e., upriver and downriver of Monticello (Altena 2008-TN9350). This
28 survey collected information from an estimated 67,685 angler trips from a boat and
29 50,783 angler trips from the shore. Nearby boat ramps include Ellison Park, Mississippi Park,
30 and Kadler Park (Stewig and Chapman 2009-TN9337). From data it collected, MDNR estimated
31 that a total of 80,650 fish were caught (harvested and released) during the survey period. These
32 included 57,809 smallmouth bass, 7,631 channel catfish, 6,142 carp, 2,792 northern pike, 1,477
33 walleye, and the remainder included black crappie, bowfin, rock bass, sunfish, bullhead, and
34 sucker species (Altena 2008-TN9350). The survey results also provided other information about
35 the health of the fisheries in the region (Altena 2008-TN9350). For instance, length-frequency
36 data (Table 9 in Altena 2008-TN9350) show that anglers caught a diversity of larger spawners
37 and younger recruitment classes that will populate future fisheries.

38 The Minnesota Department of Health has issued a consumption advisory for channel catfish
39 due to PCBs and mercury in a 40 mi (64 km) stretch of the Mississippi River that includes the
40 approximately 3 mi (5 km) reach of the Mississippi River by Monticello. This advisory is
41 unrelated to Monticello operations as it is a regional problem, and Monticello operations do not
42 release these chemicals (Xcel 2023-TN9084). This river reach is also under a recreational

1 advisory for fecal coliform. Monticello operations do not contribute to this issue since
2 Monticello's sanitary waste is discharged to the City of Monticello sanitary sewage disposal
3 system (Xcel 2023-TN9084).

4 State-Protected and Other Special Status Species

5 Minnesota's Endangered Species Statute (MN Stat. 084.0895; TN9583) authorizes the MDNR
6 to adopt regulations to protect endangered or threatened species. The MDNR also designates
7 species of special concern; however, this status does not afford species legal protections
8 (MnDNR 2023-TN9351).

9 The MDNR has not identified any State-endangered or threatened aquatic species in the
10 Mississippi River near Monticello⁴ (Xcel 2023-TN9084). The MDNR identified one species of
11 special concern, the black sandshell mussel (*Ligumia recta*), as possibly residing in the area.
12 The MDNR stated that the black sandshell is sensitive to habitat disturbance, changes in water
13 flow and temperature, and water quality deterioration, such as increases in sedimentation or
14 siltation and nutrient loading.

15 3.7.1.3 *Invasive and Nuisance Species of Mississippi River*

16 Nonnative species are those species that are present only because of introduction and that
17 would not naturally occur either currently or historically in an ecosystem. Invasive species are
18 nonnative organisms whose introduction causes or is likely to cause economic or environmental
19 harm or harm to human, animal, or plant health (81 FR 88609-TN8375). For purposes of this
20 discussion, nuisance species are nonnative species that alter the environment but do not rise to
21 the level of invasive.

22 Zebra mussels (*Dreissena polymorpha*) are the main invasive species of concern at Monticello
23 because a bed of mussels can clog water intake system pipes (Xcel 2023-TN9084). Xcel
24 Energy regularly monitors for zebra mussels at Monticello. Xcel Energy has observed only 11
25 individuals through 2021 (Xcel 2023-TN9084). Xcel Energy plans to continue monitoring zebra
26 mussels during the SLR term. If zebra mussels pose a potential problem in the future, Xcel
27 Energy could seek authorization from the MPCA to use biocides through the NPDES permitting
28 process. Currently, the MPCA authorizes biocides (e.g., sodium hypochlorite and sodium
29 bromide) to prevent fouling of the cooling water intake system from microbiological organisms in
30 the NPDES permit.

31 Asian clams (*Corbicula fluminea*) are an invasive species that is now widespread throughout the
32 United States. Like zebra mussels, Asian clams clog intake system pipes. Xcel Energy reports
33 infrequently capturing Asian clams in the Monticello traveling screen forebays. Xcel Energy has
34 not instituted any specific control measures. The warm effluent of Monticello is conducive to the
35 survival of localized populations of Asian clams which would otherwise be prone to mass die-
36 offs during winter months when the water temperature drops to less than 35.6°F (2°C) (Xcel
37 2023-TN9084). Localized populations of Asian clams are also found near other power plants in
38 Minnesota for the same reason. The population of Asian clams at Monticello is not likely to
39 spread because they need the warm water of the Monticello discharge to survive the winters
40 (Xcel 2023-TN9084).

⁴ Minnesota Department of Natural Resources. 2023. Natural Heritage Review of the proposed Monticello Nuclear Generating Plant SLR, T33N R28W Sections 17-21, 28, T122N R25W Sections 30, 32-34, and T121N R25W Sections 4-5; Sherburne and Wright Counties. Correspondence # MCR 2022-00475. Attachment B in Xcel 2023-TN9084. p. 2181.

1 Common carp (*Cyprinus carpio*), a species from Europe in the 1880s, is also found near
2 Monticello. Common carp negatively impacts aquatic habitats by uprooting aquatic vegetation
3 and disturbing sediment. Fisheries survey data show that common carp abundances have been
4 stable throughout time and have been similar upstream and downstream of Monticello (see
5 surveys discussed in Section 3.7.1.1; Xcel 2023-TN9578³).

6 During the public scoping process, the Mille Lacs Band of the Ojibwe expressed concern that
7 the invasive bighead carp (*Hypophthalmichthys nobilis*) could spread to the Mississippi River
8 near Monticello. Bighead carp, silver carp (*Hypophthalmichthys molitrix*), and black carp
9 (*Mylopharyngodon piceus*) are referred to as “Asian carp” and are invasive species of high
10 concern throughout the entire Mississippi River watershed including Minnesota (MnDNR 2023-
11 TN9352). The Asian carp can radically alter local ecosystems by outcompeting native
12 planktivores (e.g., larval fish of all species, paddlefish, shad, buffalos) and are rapidly spreading
13 (MnDNR 2023-TN9352). Asian carp are also a safety hazard to boaters since they are large (up
14 to 70 lb; 32 kg), jump into the air when frightened, and can strike boaters. While Asian carp
15 have not been detected near Monticello and have only been found downriver of Minneapolis,
16 the MDNR is concerned they could spread upriver. Accordingly, the Minnesota Invasive Carp
17 Action plan was created to better evaluate and minimize the spread of Asian Carp via a
18 partnership with State and Federal agencies, conservation groups, and universities (MnDNR
19 2014-TN9584).

20 **3.7.2 Proposed Action**

21 The following sections address the site-specific environmental impacts of Monticello SLR on the
22 environmental issues identified in Table 3-1 that relate to aquatic resources.

23 *3.7.2.1 Impingement and Entrainment of Aquatic Organisms (Plants with Once-Through* 24 *Cooling Systems or Cooling Ponds)*

25 This section evaluates the impacts of impingement and entrainment during the Monticello SLR
26 period on aquatic organisms. In 2006, the NRC staff evaluated the impacts of the initial
27 Monticello license renewal on aquatic organisms as two issues: “impingement of fish and
28 shellfish” and “entrainment of fish and shellfish in early life stages.” For both issues, the NRC
29 staff determined that the impacts of continued operation of Monticello would be SMALL during
30 the initial license renewal term (i.e., 2010–2030) (NRC 2006-TN7315). In 2013, the NRC staff
31 issued Revision 1 of the LR GEIS. In the revised LR GEIS, the staff combined the two aquatic
32 issues into a single site-specific issue: “impingement and entrainment of aquatic organisms
33 (plants with once-through cooling systems or cooling ponds).” This section evaluates this
34 consolidated issue as it applies to the continued operation of Monticello during the proposed
35 SLR term (i.e., 2030–2050).

36 Impingement occurs when organisms are trapped against the outer part of an intake structure’s
37 screening device (79 FR 48300-TN4488). The force of the intake water traps the organisms
38 against the screen, and individuals are unable to escape. Impingement can kill organisms
39 immediately or cause exhaustion, suffocation, injury, and other physical stresses that contribute
40 to mortality later. The potential for injury or death is generally related to the amount of time an
41 organism is impinged, its fragility (susceptibility to injury), and the physical characteristics of the
42 screen wash and fish return systems of the intake structure. The EPA has found that
43 impingement mortality is typically less than 100 percent if the cooling water intake system
44 includes fish return or backwash systems (79 FR 48300-TN4488). Because impingeable
45 organisms are typically fish with fully formed scales and skeletal structures and well-developed

1 survival traits, such as behavioral responses to avoid danger, many impinged organisms can
2 survive under proper conditions (79 FR 48300-TN4488).

3 Entrainment occurs when organisms pass through the screening device and travel through the
4 entire cooling system, including the pumps, condenser or heat exchanger tubes, and discharge
5 pipes (79 FR 48300-TN4488). Organisms susceptible to entrainment are of smaller size, such
6 as ichthyoplankton, larval stages of shellfish and other macroinvertebrates, zooplankton, and
7 phytoplankton. During travel through the cooling system, entrained organisms experience
8 physical trauma and stress, pressure changes, excess heat, and exposure to chemicals
9 (Mayhew et al. 2000-TN8458). Because organisms that get entrained generally possess fragile
10 life stages (e.g., eggs, which exhibit poor survival after interaction with cooling water intake
11 structure; or early larvae, which lack a skeletal structure and swimming ability), the EPA has
12 concluded that for purposes of assessing the impacts of a cooling water intake system on the
13 aquatic environment, all entrained organisms are assumed to die (79 FR 48300-TN4488).

14 Entrainment susceptibility is highly dependent on life history characteristics. For example,
15 broadcast spawners with non-adhesive, free-floating eggs that drift with the water current may
16 become entrained in a cooling water intake system. Nest-building species or species with
17 adhesive, demersal eggs are less likely to be entrained in early life stages. Susceptibility of
18 larval life stages to entrainment depends on body morphology and swimming ability.

19 A species can be susceptible to both impingement and entrainment if several life stages of the
20 species occupy the same source water. For instance, adults and juveniles of a given species of
21 fish may be impinged against the intake screens, while larvae and eggs may pass through the
22 screening device and be entrained through the cooling system. The susceptibility to either
23 impingement or entrainment relates to the size of the individual relative to the size of the mesh
24 on the screening device. The EPA considers aquatic organisms that can be collected or
25 retained on a sieve with 0.56 in. (1.4 cm) diagonal openings to be susceptible to impingement
26 (79 FR 48300-TN4488). This equates to screen device mesh openings of 0.5 in. × 0.25 in.
27 (1.3 cm × 0.635 cm), which is slightly larger than the openings on the typical 0.375 in. (0.95 cm)
28 square mesh found at many nuclear power plants. Organisms smaller than the 0.56 in. (1.4 cm)
29 mesh are considered susceptible to entrainment.

30 The magnitude of the impact that impingement and entrainment create on the aquatic
31 environment depends on the plant-specific characteristics of the cooling system as well as the
32 local aquatic community. Relevant nuclear power plant-based characteristics include location of
33 the cooling water intake structure, intake velocities, withdrawal volumes, screening device
34 technologies, and the presence or absence of a fish return system. Relevant characteristics of
35 the aquatic community include species present in the environment, life history characteristics,
36 population abundances and distributions, special species statuses and designations, and
37 regional management objectives.

38 Monticello Cooling Water Intake System

39 Monticello's cooling water intake system is a flexible system that can operate in four modes:
40 open-cycle (i.e., once-through), closed cycle using cooling towers, and two combinations of
41 these modes referred to as helper cycle mode and partial recirculation mode. Xcel Energy
42 chooses the mode in which to operate based on water temperature and river flow requirements
43 specified in Monticello's NPDES permit (MN0000868) and Water Appropriation Permit (#66-
44 1172) (MPCA 2023-TN9401; MnDNR 2023-TN9402). Table 3-12 summarizes these modes and
45 the conditions under which Xcel Energy is required to operate in each mode. Features relevant

1 to the impingement and entrainment analysis are summarized below. Section 2.1.3 of this EIS
 2 describes the Monticello cooling and auxiliary water systems in detail.

3 **Table 3-12 Monticello Nuclear Generating Plant Cooling Modes**

Mode	Conditions ^(a)
Open Cycle Mode: <ul style="list-style-type: none"> • Water withdrawn from intake canal • Once-through cooling occurs (no cooling towers) • Water discharged into the discharge canal • Gate at discharge weir is open to allow effluents to flow into Mississippi River 	#1: When river flow exceeds 860 cfs (24 m ³ /s), a maximum of 645 cfs (18.2 m ³ /s) may be appropriated for cooling #2: Ambient river temperature is below 68°F (20°C) #3: Cooling towers are not needed to keep the temperatures in the drainage canal are lower NPDES daily maximums: <ul style="list-style-type: none"> – 95°F (35°C) between April and October – 85°F (29.4°C) for November and March – 80°F (26.6°C) between December and February
Helper Cycle Mode: <ul style="list-style-type: none"> • Water withdrawn from the intake canal • Heated water routed to the discharge structure • A portion of the heated water is routed to the cooling towers before being discharged into the drainage canal • The remaining portion is discharged directly into the drainage canal • Gate at discharge weir is open to allow effluents to flow into Mississippi River 	#1: When river flow is above 860 cfs (24 m ³ /s), a maximum of 645 cfs (18.2 m ³ /s) may be appropriated for cooling #2: Ambient river temperatures start to consistently reach 68°F (20°C) or #3: Discharge temperatures are starting to approach the NPDES limits
Partial Recirculation Mode: <ul style="list-style-type: none"> • Similar to helper cycle mode except water that passes through cooling towers is routed back to the intake so it can be recirculated more than once • Gate at discharge weir is open to allow effluents to flow into Mississippi River 	#1: Ambient river temperatures start to consistently reach 68°F (20°C) #2: When river flow is between 240–860 cfs (6.8–24 m ³ /s), 75 percent of river flow may be appropriated for Monticello; partial recirculation mode may be used to help comply with that restriction
Closed Cycle Mode: <ul style="list-style-type: none"> • All cooling water recirculated through cooling towers • Gates at intake and discharge channel closed to Mississippi River • Make-up water drawn from intake structure due to evaporative water loss 	#1: Authorized when river flow is equal to or greater than 240 cfs (6.8 m ³ /s) Note: If river flows drop below 240 cfs (6.8 m ³ /s), the State of Minnesota would prescribe special operating conditions

(a) Conditions for operating each cooling mode are derived from the NPDES permit and Surface Water Appropriations permit, as cited below.

Sources: Xcel 2023-TN9084; MPCA 2023-TN9401; Water Appropriations Permit #No. 66-1172; Xcel 2023-TN9084.

4 In open cycle, helper, and partial recirculation modes, Monticello withdraws water from the
 5 Mississippi River via an approach channel located upstream of the plant. The approach channel
 6 is constructed of sheet pile structures and extends 59 ft (0.3 m) into the river and narrows to
 7 approximately 63 ft (19.2 m) wide. Water that enters the approach channel passes over a
 8 concrete sill that is designed to prevent sediment buildup during low flows. The concrete sill also
 9 contains a removable log stop that captures and removes logs.

1 Water then passes through a bar rack that prevents large debris from entering the intake
2 structure; a motorized rake removes the large debris from the bar rack, deposits it into a trash
3 hopper, and prevents it from re-entering the river (Xcel 2023-TN9084, Xcel 2023-TN9578³). The
4 trash racks are made of steel bars that are 0.75 in. (0.95 cm) wide and are spaced 3 in. (7.6 cm)
5 apart at the center.

6 Traveling screens, which have mesh openings of 0.375 in² (2.4 cm²), and a width of 10 ft
7 (3.05 m), are located approximately 10 ft (3.05 m) behind the bar racks (Xcel 2023-TN9084,
8 Xcel 2023-TN9578⁵). Xcel Energy normally operates the traveling screens continuously when
9 the river temperature is above 50°F (10°C) to limit the duration that fish are impinged on the
10 screen, and otherwise rotates and rinses the screens every 12 hours. Debris and aquatic
11 organisms that are rinsed off the traveling screens enter a sluiceway that returns debris and
12 organisms back to the Mississippi River downstream of the intake structures.

13 Organisms small enough to pass through the traveling screen mesh, such as fish eggs, larvae,
14 and other zooplankton, are entrained into the cooling water system. Entrained organisms pass
15 through the entire cooling system, enter the discharge channel, and can either become stranded
16 in the discharge channel or pass through it and re-enter the Mississippi River. During this
17 process, entrained organisms are subject to mechanical, thermal, and toxic stresses.

18 Clean Water Act Section 316(b) Requirements for Existing Facilities

19 Section 316(b) of the CWA addresses the adverse environmental impacts caused by the intake
20 of cooling water from waters of the United States. This section of the CWA grants the EPA the
21 authority to regulate cooling water intake structures to minimize adverse impacts on the aquatic
22 environment. Under CWA Section 316(b), the EPA has issued regulations for existing facilities,
23 such as Monticello, at 40 CFR Part 122 (TN2769) and 40 CFR Part 125 (TN254), Subpart J.
24 Existing facilities include power generation and manufacturing facilities that are not new facilities
25 as defined at 40 CFR 125.83 (TN254) and that withdraw more than 2 mgd (7.6 million liters per
26 day) of water from waters of the United States and use at least 25 percent of the water they
27 withdraw exclusively for cooling purposes.

28 Under the CWA Section 316(b) regulations, the location, design, construction, and capacity of
29 cooling water intake structures of regulated facilities must reflect the best technology available
30 (BTA) for minimizing impingement mortality and entrainment. The EPA, or authorized States
31 and Tribes, impose BTA requirements through NPDES permitting programs. In Minnesota, the
32 MPCA administers the NPDES program and issues NPDES permits to regulated facilities.

33 With respect to impingement mortality, the BTA standard requires that existing facilities comply
34 with one of the following seven alternatives per the rule that was adopted on October 14, 2014
35 (TN254):

- 36 1. operate a closed-cycle recirculating system, as defined at 40 CFR 125.92(c) (TN254)
- 37 2. operate a cooling water intake structure that has a maximum through-screen design
38 intake velocity of 0.5 fps (0.15 m/s)
- 39 3. operate a cooling water intake structure that has a maximum design through-screen
40 intake velocity of 0.5 fps (0.15 m/s)

⁵ Xcel Energy 2023. Monticello Nuclear Power Station 316(b) Impingement and Entrainment
Characterization Study Report, January 14, 2007. Enclosure 24 Attachment 2 of Xcel 2023-TN9578.

- 1 4. operate an offshore velocity cap, as defined at 40 CFR 125.92(v) (TN254) that was
2 installed on or before October 14, 2014
- 3 5. operate a modified traveling screen that the NPDES Permit Director determines meets
4 the definition at 40 CFR 125.92(s) (TN254) and that the NPDES Permit Director
5 determines is the BTA for impingement reduction at the site
- 6 6. operate any other combination of technologies, management practices, and operational
7 measures that the NPDES Permit Director determines is the BTA for impingement
8 reduction
- 9 7. achieve the specified impingement mortality performance standard

10 Options (1), (2), and (4) above are essentially preapproved technologies requiring either no
11 demonstration or only a minimal demonstration that the flow reduction and control measures are
12 functioning as the EPA envisioned. Options (3), (5), and (6) require more detailed information to
13 be submitted to the permitting authority before the permitting authority may specify it as BTA for
14 a given facility. Under Option (7), the permitting authority may also review site-specific data and
15 conclude that a de minimis rate of impingement exists; and, therefore, no additional controls are
16 warranted to meet the BTA impingement mortality standard.

17 With respect to entrainment, the CWA Section 316(b) regulations do not prescribe a single
18 nationally applicable entrainment performance standard, because the EPA did not identify a
19 technology for reducing entrainment that is effective, widely available, feasible, and does not
20 lead to unacceptable non-water-quality impacts (79 FR 48300-TN4488). Instead, the permitting
21 authority must establish the BTA entrainment requirement for each facility on a site-specific
22 basis. In establishing site-specific requirements, the regulations direct the permitting authority to
23 consider the following factors (40 CFR Part 125-TN254):

- 24 i. numbers and types of organisms entrained, including, specifically, the numbers
25 and species (or lowest taxonomic classification possible) of federally listed,
26 threatened and endangered species, and designated critical habitat (e.g., prey
27 base),
- 28 ii. impact of changes in particulate emissions or other pollutants associated with
29 entrainment technologies,
- 30 iii. land availability inasmuch as it relates to the feasibility of entrainment technology,
- 31 iv. remaining useful plant life, and
- 32 v. quantified and qualitative social benefits and costs of available entrainment
33 technologies when information on both benefits and costs is of sufficient rigor to
34 make a decision.

35 In support of entrainment BTA determinations, facilities must conduct site-specific studies and
36 provide data to the permitting authority to aid in its determination of if site-specific controls would
37 be required to reduce entrainment and which controls, if any, would be necessary.

38 Analysis Approach

39 When available, the NRC staff relies on the expertise and authority of the NPDES permitting
40 authority with respect to the impacts of impingement and entrainment. Therefore, if the NPDES
41 permitting authority has made BTA determinations for a facility pursuant to CWA Section 316(b)
42 in accordance with the current regulations specified in 40 CFR Part 122-TN2769 and 40 CFR

1 Part 125-TN254, which were promulgated in 2014 (79 FR 48300-TN4488), and that facility has
2 implemented any associated requirements or those requirements would be implemented before
3 the proposed SLR period; then, the NRC staff assumes that adverse impacts on the aquatic
4 environment will be minimized. In such cases, the NRC staff concludes that the impacts of
5 either impingement, entrainment, or both would be SMALL for the proposed SLR term.

6 In cases in which the NPDES permitting authority has not made BTA determinations, the NRC
7 staff analyzes the potential impacts of impingement, entrainment, or both using a
8 weight-of-evidence approach. In this approach, the staff considers multiple lines of evidence to
9 assess the presence or absence of ecological impairment (i.e., noticeable or detectable impact)
10 on the aquatic environment. For instance, as its lines of evidence, the NRC staff might consider
11 characteristics of the cooling water intake system design, the results of impingement and
12 entrainment studies performed at the facility, and trends in fish and shellfish population
13 abundance indices. The NRC staff then considers these lines of evidence together to predict the
14 level of impact (SMALL, MODERATE, or LARGE) that the aquatic environment is likely to
15 experience during the proposed SLR term.

16 Baseline Condition of the Resource

17 For the purposes of this analysis, the NRC staff assumes that the baseline condition of the
18 resource is the aquatic community of the Mississippi River by Monticello as it occurs today,
19 which is described in Section 3.7.1 of this EIS. All fish and benthic invertebrate populations are
20 self-sustaining. Electrofishing and seining sampling indicate no major upward or downward
21 trends in juvenile or adult fish populations. While species richness, evenness, and diversity
22 within the community may change or shift between now and when the proposed SLR period
23 would begin, the NRC staff finds the present aquatic community to be a reasonable surrogate in
24 the absence of fishery and species-specific projections.

25 *3.7.2.1.1 Impingement*

26 Impingement Mortality BTA

27 The MPCA has not made an impingement mortality or entrainment BTA determination for
28 Monticello. The current NPDES permit (MN0000868, MPCA 2023-TN9401), which was issued
29 on May 1, 2023, with an expiration date of April 30, 2028, was based on a permit renewal
30 application that Xcel Energy submitted in 2012 before the EPA issued the 2014 CWA
31 Section 316(b) final rule concerning existing facilities.

32 Xcel Energy has not submitted an updated CWA Section 316(b) for compliance for impingement
33 mortality BTA since 2019⁶ (Xcel 2023-TN9578). Instead, Xcel Energy has chosen to defer the
34 method of compliance for impingement mortality BTA until after the MPCA makes an
35 entrainment BTA determination (40 CFR 129.94(b)(1)-TN6409; Xcel 2023-TN9578).

36 The MPCA could determine that Monticello operations meet one of the impingement mortality
37 compliance alternatives listed previously in this section without Xcel Energy needing to modify
38 or upgrade any components of the cooling water intake system. When the MPCA makes the
39 impingement mortality BTA determination, it may also impose additional requirements to reduce

⁶ Xcel Energy 2023. Monticello Nuclear Generating Plant § 316(b) 40 CFR § 122.21(r)(2)-(r)(8) Information. Enclosure 24 Attachment 6 of Xcel 2023-TN9578.

1 or mitigate the effects of impingement mortality at Monticello. Such requirements would be
2 incorporated as conditions of a future renewed NPDES permit.

3 The NRC staff assumes that any additional requirements that the MPCA imposes would
4 minimize the impacts of impingement mortality over the course of the proposed SLR term in
5 accordance with CWA Section 316(b) requirements. However, because the MPCA has not
6 made an impingement mortality BTA determination at this time, the NRC staff also considers
7 other lines of evidence below, including the hydraulic zone of influence (HZI) and results of
8 impingement mortality studies, to more fully evaluate the magnitude of impact that impingement
9 would represent during the proposed SLR period.

10 Hydraulic Zone of Influence

11 MACTEC Engineering and Consulting, Inc (MACTEC) evaluated the Hydraulic Zone of
12 Influence (HZI) for the Monticello cooling water intake system, and the results appear in the
13 Monticello 2019 CWA Section 316(b) demonstration report (Xcel 2023-TN9578). The HZI is
14 defined as the portion of the source waterbody that is hydraulically affected by the cooling water
15 intake structure water withdrawal (40 CFR 125.83-TN254).

16 MACTEC (Xcel 2023-TN9578) determined the size of the HZI by reviewing hydrological data.
17 The Mississippi River near Monticello has two main channels that are separated by an island.
18 MACTEC focused its HZI analysis on the main channel that passes by the cooling water intake
19 canal, which contains 58 percent of the total river flow on average. The HZI extends beyond the
20 intake canal and into this main channel. During average flows, the HZI extends into one-quarter
21 of the width of the main channel and two-thirds of main channel under low conditions.

22 MACTEC also computed the average monthly volume of the Mississippi River that is affected by
23 the HZI from 2014–2018 (Table 3-13). The average percentage of the Mississippi River flow that
24 was affected by the HZI and was used for the Monticello cooling water intake system during that
25 time period was lowest during April and May (about 4.5 to 4.6) and was highest during August
26 (11.4 percent) and September (10.3 percent). The HZI and the cooling water intake system
27 influences a relatively small portion of the Mississippi River even during low flow months (Xcel
28 2023-TN9578: Attachment 6 of Enclosure 24 of Request for Additional Information [RAI]/RCI).

29 Within the HZI, fish and other aquatic organisms are only subject to impingement within a
30 smaller region of the HZI where the intake water velocity exceeds those individuals' ability to
31 swim against the draw of water into the cooling water intake system to escape impingement.
32 While Xcel Energy has not specifically evaluated this area, the NRC staff concludes that this
33 area is limited to the intake canal and not the Mississippi River because most impinged fish
34 (e.g., bluegills and black crappies) are associated with backwater habitats (not the river
35 channel).

36 Xcel Energy proposes no changes or modifications to the cooling water intake system as part of
37 the proposed SLR, therefore, this area would remain the same during the SLR term, and it is
38 considered further below as one component affecting the NRC staff's conclusion on
39 impingement mortality.

1 **Table 3-13 Average Monthly Volume of the Mississippi River Drawn into the Monticello**
 2 **Cooling Water Intake System and Affected by the Hydraulic Zone of**
 3 **Influence, 2014–2018**

Month	Monthly River Flow (cfs)	Design Intake (cfs)	Percent of River (Design)	Actual Intake (cfs)	Percent of River (Actual)
January	4,276.8	707.4	16.5	415.2	9.7
February	4,307.5	707.4	16.4	459.4	10.7
March	5,753.2	707.4	12.3	501.7	8.7
April	9,462.1	707.4	7.5	434.6	4.6
May	11,245.7	707.4	6.3	508.9	4.5
June	9,968.0	707.4	7.1	611.7	6.1
July	7,852.4	707.4	9.0	615.6	7.8
August	5,321.9	707.4	13.3	607.6	11.4
September	5,561.3	707.4	12.7	570.4	10.3
October	7,064.7	707.4	10.0	528.3	7.5
November	6,010.0	707.4	11.8	492.4	8.2
December	5,375.1	707.4	13.2	458.0	8.5

Source: Xcel 2023-TN9578.

4 Impingement Studies

5 *2005–2006 Impingement Characterization Study*

6 MACTEC conducted an impingement characterization study by Monticello from August 2005 to
 7 July 2006 (Xcel 2023-TN9578). The researchers conducted 48 sampling events, 4 per month, at
 8 a frequency to ensure sampling took place during the evening, morning, day, and night.

9 The researchers caught 31 fish species during the 2005–2006 impingement study (Table 3-14).
 10 The highest percentage of the total impingement catch was from bluegill (28.2 percent), channel
 11 catfish (21.1 percent), black crappie (19.2 percent), black bullhead (6.5 percent), with the rest of
 12 the species accounting for less than 3 percent. The size of these impinged fish corresponded
 13 with ages 0–2 years (Xcel 2023-TN9578).

14 The researchers did not find a correlation between the abundance of species in impingement
 15 samples compared to the abundance in electrofishing or seining surveys. For example,
 16 researchers found that bluegills accounted for 28.2 percent of impinged fish and 0.3 percent of
 17 fish collected in abundance surveys, as was the case for black crappie which represented
 18 19 percent of impinged fish and 0.02 percent of abundance in surveys (Xcel 2023-TN9578).

19 MACTEC estimated annual impingement at Monticello by applying catch rates during sampling
 20 (number per million gallons) to total water intake. The researchers estimated that the total
 21 impingement was 15,027 finfish per year, which mainly included bluegill (5,392 fish;
 22 35.8 percent), channel catfish (2,811 fish; 18.7 percent), and black bullhead (1,064 fish;
 23 7.1 percent) (Table 3-14). The remaining finfish species contributed no more than 3 percent each
 24 to the total catch of finfish. The researchers also estimated that the annual shellfish impingement
 25 was 1,950 crayfish, 41 freshwater mussels, and 6 Asian clams (Xcel 2023-TN9578).

26 Researchers found that approximately 63 percent of impinged fish were alive at the collection
 27 site in the sluiceway, which provides fish passage back to the Mississippi River.

1 **Table 3-14 Estimated Annual Impingement from the Monticello Cooling Water Intake**
 2 **System from August 2005 to July 2006**

Scientific Name	Common Name	Fish Collected	Percent of Total Fish Collected	Estimated Fish Impinged Per Year	Percent ^(a) of Estimated Total
<i>Lepomis macrochirus</i>	bluegill	216	28.2	5,392	35.88
<i>Ictalurus punctatus</i>	channel catfish	162	21.1	2,811	18.71
<i>Pomoxis nigromaculatus</i>	black crappie	147	19.2	2,086	13.88
<i>Ameiurus melas</i>	black bullhead	50	6.5	1,064	7.08
<i>Micropterus dolomieu</i>	smallmouth bass	19	2.5	431	2.87
<i>Ameiurus natalis</i>	yellow bullhead	18	2.3	194	1.29
<i>Moxostoma macrolepidotum</i>	shorthead redhorse	13	1.7	187	1.25
<i>Percina maculate</i>	blackside darter	13	1.7	249	1.66
<i>Cyprinus carpio</i>	common carp	12	1.6	258	1.72
<i>Cyprinella spiloptera</i>	spotfin shiner	12	1.6	238	1.58
<i>Percopsis omiscomaycus</i>	trout perch	11	1.4	271	1.80
<i>Ameiurus nebulosus</i>	brown bullhead	10	1.3	106	0.70
<i>Micropterus salmoides</i>	largemouth bass	9	1.2	150	1.00
<i>Notropis ludibundus</i>	sand shiner	8	1.0	179	1.19
<i>Stizostedion vitreum</i>	walleye	8	1.0	145	0.96
<i>Perca flavescens</i>	yellow perch	7	0.9	149	0.99
<i>Notropis hudsonius</i>	spottail shiner	7	0.9	152	1.01
<i>Noturus gyrinus</i>	tadpole madtom	7	0.9	157	1.04
<i>Pimephales promelas</i>	fathead minnow	5	0.7	109	0.73
<i>Rhinichthys cataractae</i>	longnose dace	5	0.7	101	0.67
N/A	Unidentifiable fish	4	0.5	134	0.89
<i>Catostomus commersoni</i>	white sucker	4	0.5	73	0.49
<i>Percina caprodes</i>	log perch	3	0.4	61	0.40
<i>Lepomis cyanellus</i>	green sunfish	2	0.3	44	0.29
<i>Nocomis biguttatus</i>	hornyhead chub	2	0.3	50	0.33
<i>Shiner spp.</i>	shiner species	2	0.3	0	0.00
<i>Ambloplites rupestris</i>	rock bass	2	0.3	45	0.30
<i>Ictalurid spp.</i>	several species of catfish	2	0.3	42	0.28
<i>Pomoxis sp.</i>	crappie species	1	0.1	10	0.07
<i>Labidesthes sicculus</i>	brook silverside	1	0.1	21	0.14
<i>Moxostoma spp.</i>	several species of redhorse	1	0.1	22	0.15
<i>Culaea iconstans</i>	brook stickleback	-	-	21	0.14
<i>Moxostoma anisurum</i>	silver redhorse	1	0.1	9	0.06
<i>Campostoma pullum</i>	central stoneroller	1	0.1	21	0.14
<i>Notemigonus crysoleucas</i>	golden shiner	1	0.1	21	0.14
<i>Luxilus cornutus</i>	common shiner	1	0.1	23	0.15
Total^(a)	-	767	100	15,027	100

N/A = not applicable.

No table entry has been denoted by “-”

(a) Totals and percents may not equate due to rounding.

Source: Xcel 2023-TN9578⁶: Attachment 2 of Enclosure 24 of the RAIs/RCIs, Tables 5-3 and 5-5.

1 Historical Impingement Studies

2 NUS Corporation Inc. (NUS) conducted impingement mortality studies in the 1970s shortly after
3 Monticello began operating (Amish et al. 1978-TN9580). As summarized in the 2006 Monticello
4 LR SEIS, the species, length, and age compositions in these studies were similar to the 2005 to
5 2006 study (NRC 2006-TN7315). Specifically, NUS estimated impingement to be:

- 6 • 2,952 fish between June and September 1972
- 7 • 18,030 fish between July and December 1973
- 8 • 16,343 fish in 1974
- 9 • 34,157 fish in 1975

10 Impingement Conclusion

11 Based on the NRC staff's review of the available information, the staff finds that impingement
12 from the Monticello cooling water intake system would have minor effects on aquatic resources
13 for several reasons: (1) the HZI is a relatively small area of the Mississippi River and
14 impingement appears to be mainly impacting species in the intake canal (Xcel 2023-TN9578:
15 Enclosure 24); (2) the majority of impingement is limited to bluegill, black crappie, channel
16 catfish, and black bullhead that are highly fecund species and are not species of concern per
17 the MDNR (MnDNR 2023-TN9585, MdDNR Undated-TN9588; Pauly and Froese 2023-
18 TN9590); (3) Xcel Energy and MDNR surveys indicate stable and diverse populations of fish in
19 the Mississippi River near Monticello (see Section 3.7.1.1); and (4) shellfish have a relatively
20 low vulnerability to impingement compared to finfish, and the majority of shellfish impingement
21 is attributed to crayfish, which are not a species of concern.

22 The NRC staff anticipates that impacts during the proposed SLR period would be similar
23 because water withdrawals, and the associated risk of impingement, would remain the same
24 under the proposed action. Further, the MPCA will make an impingement mortality BTA
25 determination as part of issuing a renewed NPDES permit. If the MPCA imposes any additional
26 requirements beyond those contained in the current permit, those requirements would likely
27 further reduce the impacts of impingement mortality during the proposed SLR term, in
28 accordance with CWA Section 316(b) requirements. For the reasons described above, the NRC
29 staff finds that the impacts of impingement mortality on aquatic resources during the proposed
30 SLR term would be SMALL.

31 *3.7.2.1.2 Entrainment*

32 Entrainment BTA

33 The MPCA has not made an entrainment BTA determination for Monticello. As explained in
34 Section 3.7.2.1.1, Xcel Energy submitted information concerning CWA Section 316(b)
35 entrainment BTA to the MPCA on January 9, 2023 (Xcel 2023-TN9578: Enclosure 24). MPCA
36 will make an entrainment BTA determination as one component of issuing a renewed NPDES
37 permit. When the MPCA makes its BTA determination, it could impose additional requirements
38 to reduce or mitigate the effects of entrainment at Monticello.

39 Such requirements would be incorporated as conditions of the renewed NPDES permit. The
40 NRC staff assumes that any additional requirements that MPCA may impose would minimize
41 the impacts of entrainment over the course of the proposed license renewal term in accordance
42 with CWA Section 316(b) requirements. However, because the MPCA has not made an

1 entrainment BTA determination at this time, the NRC staff also consider other lines of evidence
2 below, including the HZI and results of entrainment characterization studies, to more fully
3 evaluate the magnitude of impacts that entrainment would represent during the proposed SLR
4 period.

5 Hydraulic Zone of Influence

6 The HZI is described in the impingement mortality section above. As evaluated by MACTEC,
7 the HZI only affects that portion of the Mississippi River that flows past Monticello and not the
8 main channel that is separated by an island. The HZI is the area within which an organism may
9 be drawn to the intake rather than transported away in the ambient flow. For an organism to
10 become entrained, it must enter the HZI of the cooling water intake system. Organisms within
11 the HZI have a high probability of being withdrawn by the intake, but not all organisms within the
12 HZI will be entrained (Xcel 2023-TN9578). Entrainment studies are described in detail below.

13 Entrainment Studies

14 Xcel Energy's 2023 316(b) demonstration report summarizes entrainment performance studies
15 conducted at Monticello during 2017–2018, 2006, 1976, and 1973–1974 in accordance with
16 40 CFR 122.21(r)(7) (TN2769) requirements. The results of these entrainment studies are
17 described below.

18 2017–2018 Entrainment Characterization Study

19 Xcel Energy Environmental Services performed an entrainment characterization study from
20 March 2017 to December 2018 that evaluated the numbers and types of ichthyoplankton
21 entrained by the Monticello cooling water intake system (Xcel 2023-TN9578: Attachment 3 of
22 Enclosure 24).

23 Researchers collected entrainment samples by pumping water samples through an
24 ichthyoplankton net at three locations: (1) at the sluice gate area of the discharge structure; (2) at
25 the cooling tower discharge area; and (3) the cooling water system intake. Samples taken from
26 the intake area were used to assist with identification of organisms collected from the discharge
27 structure and cooling tower discharge. For samples from the discharge structure, researchers
28 mechanically pumped discharged water from the two outlet bays at two different water depths.
29 Water was pumped from the outlet bays to sampling containers with ichthyoplankton nets with
30 500 µm mesh openings and transported back to a laboratory for processing. Sampling was
31 performed twice a month during the peak spawning months (April to September) and once a
32 month for the rest of the year. One exception to this sampling schedule occurred over 30 days
33 between April and May in 2017 when the circulating water pumps were not in service due to a
34 refueling outage. Sampling was performed at four 6-hour intervals but was reduced to two 6-hour
35 intervals in the fall/winter months. For the cooling tower discharge, 1.6 ft (0.5 m) diameter
36 ichthyoplankton nets with 300–500 µm mesh openings were deployed at two different locations
37 at two depths (surface and mid-water column) within the cooling tower discharge area then
38 samples were taken back to a laboratory for processing. Sampling occurred twice a month from
39 June to September in 2017 and from May to September in 2018 to correspond when cooling
40 towers were in service. Sampling was performed at four 6-hour intervals. Although the cooling
41 towers were replaced in 2021-2022, this replacement did not change cooling tower operation in a
42 manner that would appreciably affect the results of this study. To estimate the total entrainment
43 due to Monticello operations, data from the discharge structure and cooling towers were
44 combined and adjusted based on sample volumes and intake flows.

1 Researchers collected a total of 2,022 fish eggs and larvae from 23 distinct taxa; 786 eggs and
2 larvae in 2017, and 1,236 eggs and larvae in 2018 (Xcel 2023-TN9578: Attachment 3 of
3 Enclosure 24). Based on actual intake flows, the researchers estimated that annual entrainment
4 of ichthyoplankton at Monticello was 19,616,797 fish and eggs in 2017, and 26,377,802 fish and
5 eggs in 2018. May and June had the highest estimated entrainment rates, which corresponds
6 with peak spawning months. Table 3-15 shows the breakdown of estimates by species, and
7 results are summarized as follows.

- 8 • The majority of the entrainment samples were larvae (2017: 69.0 percent; 2018: 99.3
9 percent).
- 10 • The highest amount of larvae from entrainment samples were from unidentified species
11 (2017: 33.7 percent; 2018: 42.7 percent).
- 12 • Cyprinidae species (2017: 5.8 percent; 2018: 26.0 percent) and white sucker
13 (*Catostomus commersonii*) (2017: 23.2 percent; 2018: 17.6 percent) were the most
14 abundant identified fish larvae in both 2017 and 2018, and no other species exceeded
15 4 percent.

16 With respect to different life stages, researchers were able to distinguish life stage for
17 49.9 percent of the larvae. Of the distinguishable life stages, the majority (57.1 percent) were
18 post-yolk sac larvae. No juvenile or adult life stages were collected, and no shellfish eggs or
19 larvae were identified.

20 Xcel Energy Environmental Services evaluated entrainment densities by sample depth strata
21 (i.e., surface and mid-column) and by time of day (i.e., daytime [0600–1800] and nighttime
22 [1800–0600]). Although densities were slightly higher in the mid-column samples, researchers
23 postulated that this may be attributable to ichthyoplankton sinking after passing through the
24 cooling water intake system. With respect to diel variation, entrainment densities were highest in
25 the daytime for 2017 and similar between the daytime and nighttime for 2018. However, due to
26 only 4 of the 34 sampling events exhibiting this relationship, Xcel Energy Environmental
27 Services concluded that there were no significant diel patterns for entrained organisms. Xcel
28 Energy Environmental Services did not draw any overall conclusions with respect to impacts of
29 entrainment on Mississippi River finfish populations.

30 2006 Entrainment Study

31 MACTEC conducted an entrainment study from April 2006 to September 2006 (Xcel 2023-
32 TN9578⁵: Attachment 2 of Enclosure 24). Researchers collected entrainment samples 1 day a
33 week at four diel periods by mechanically pumping water from the discharge pump well through
34 a sampling apparatus consisting of a 2 in. (5 cm) flex hose and pipe system with a flow control
35 valve and flow meter. Water moved through the sampling apparatus to a centralized sampling
36 container with an ichthyoplankton net with 300 µm mesh openings. All samples were collected
37 and preserved and then later processed in a laboratory. Results of this study are summarized in
38 an impingement and entrainment characterization report (Xcel 2023-TN9578⁵: Attachment 2 of
39 Enclosure 24). The information in this section is summarized from that report unless otherwise
40 indicated.

41 Researchers collected a total of 225 larvae and eggs during the study representing six taxa.
42 Overall, sucker larvae dominated collections (77.3 percent). Entrainment densities peaked in
43 mid to late May and in August. With respect to collection densities, collections peaked in May
44 with catostomid larvae and in August with eggs and unidentified larvae. MACTEC noted that
45 very few representative important species, as defined by prior electrofishing and seining surveys

1 conducted in the Mississippi River near Monticello, were collected during the entrainment
 2 sampling, suggesting that they are not commonly entrained.

3 **Table 3-15 Estimated Annual Ichthyoplankton Entrainment Based on Actual Intake**
 4 **Flows at Monticello in 2017 and 2018**

Taxa	2017 Total^(a)	2017 Percent^(a) of Total	2018 Total^(a)	2018 Percent^(a) of Total
Larvae — Unidentified	6,613,282	33.7	11,272,683	42.7
Cyprinidae	1,143,103	5.8	6,859,904	26.0
<i>Catostomus commersonii</i>	4,545,318	23.2	4,642,779	17.6
<i>Lota lota</i>	-	-	1,022,231	3.9
<i>Micropterus dolomieu</i>	135,092	0.7	391,353	1.5
<i>Moxostoma</i> spp.	503,598	2.6	288,110	1.1
<i>Lepomis</i> spp.	29,498	0.2	266,212	1.0
<i>Sander vitreus</i>	-	-	248,801	0.9
<i>Lepomis macrochirus</i>	-	-	236,931	0.9
Eggs — Unidentified	6,080,666	31.0	183,706	0.7
<i>Percina caprodes</i>	-	-	147,190	0.6
<i>Etheostoma</i> spp.	275,958	1.4	143,555	0.5
<i>Ictalurus punctatus</i>	68,398	0.3	109,300	0.4
<i>Esox</i> spp.	-	-	101,579	0.4
<i>Percopsis omiscomaycus</i>	-	-	91,205	0.3
<i>Pomoxis</i> spp.	-	-	85,022	0.3
<i>Micropterus salmoides</i>	-	-	77,739	0.3
<i>Percidae</i> spp.	88,580	0.5	63,214	0.2
<i>Lepomis cyanellus</i>	88,772	0.5	59,063	0.2
Catostomidae	-	-	27,547	0.1
Centrarchidae	-	-	27,547	0.1
<i>Cottus bairdi</i>	-	-	16,583	0.1
<i>Cyprinella spiloptera</i>	-	-	15,548	0.1
<i>Notropis</i> spp.	14,539	0.1	-	-
<i>Perca flavescens</i>	29,992	0.2	-	-
Total	19,616,797	100.0	26,377,801	100.0

No table entry has been denoted by “-”.

(a) Totals and percents may not equate to 100 percent due to rounding.

Source: Xcel 2023-TN9578⁶: Attachment 3 of Enclosure 24.

5 MACTEC used sample results and intake flows to estimate total entrainment for each entrained
 6 species. Table 3-16 provides the monthly intake flow-adjusted total entrainment by taxa.
 7 MACTEC estimated total entrainment to be 5,702,590 individuals comprised primarily of fish
 8 larvae (95 percent) with a small amount (5 percent) of fish eggs. Peak ichthyoplankton densities
 9 occurred in May (73.77 percent), August (11.39 percent), and June (7.38 percent). Suckers
 10 accounted for the majority of ichthyoplankton (73.83 percent), followed by unidentified larvae
 11 (11.65 percent). The dominate life stage for collected organisms varied by species. Only two
 12 adult sticklebacks were collected. With respect to diel patterns, MACTEC found no clear pattern
 13 or seasonal trend; however, in May with the peak entrainment density, densities were slightly
 14 higher in the morning and afternoon.

1 **Table 3-16 Flow-Adjusted Ichthyoplankton Entrainment at Monticello, 2006**

Species Grouping/ Taxa	April	May	June	July	August	September	Total ^(a)	Percent ^(a)
Cyprinidae	0	0	0	24,525	98,914	75,999	199,438	3.50
Cyprinidae/ flattened eye	0	24,059	0	0	0	0	24,059	0.42
Cyprinidae group/ mid-ventral stripe	0	0	123,637	0	0	41,237	164,874	2.89
Cyprinidae group/ outlined gut	0	0	0	0	24,654	20,658	45,312	0.79
suckers	0	4,061,326	148,904	0	0	0	4,210,230	73.83
brook stickleback	0	0	49,366	0	0	0	49,366	0.87
walleye	0	46,432	0	0	0	0	46,432	0.81
Eggs-fish other	0	0	0	75,047	223,209	0	298,256	5.23
Unidentified larvae	67,942	75,107	99,004	24,928	302,933	94,709	664,623	11.65
Total ^(a)	67,942	4,206,924	420,911	124,500	649,710	232,604	5,702,590	-
Percentage	1.19	73.77	7.38	2.18	11.39	4.08	-	100

"-" denotes no entry.

(a) Totals and percents may not equate due to rounding.

Source: Xcel 2023-TN9578⁵: Attachment 2 of Enclosure 24.

2 In addition, MACTEC also collected samples from the intake forebay to compare with
 3 entrainment samples. Researchers conducted sampling from the intake forebay once a month
 4 at four diel periods using a 1.6 ft (0.5 m), 300 µm mech conical net that was deployed at two
 5 locations at mid-water depth. All samples were collected and preserved and later processed in a
 6 laboratory. A total of 217 larvae were collected. Overall, cyprinids dominated collections
 7 (89 percent). In all sampled months except May total density was higher for the intake forebay
 8 samples than the entrainment samples. MACTEC postulated that these differences may be due
 9 to seasonal variation and the sampling regime missing the peak densities for entrained
 10 samples. Alternatively, MACTEC speculated that samples collected in the forebay could be
 11 residents and less vulnerable to entrainment.

12 Overall, MACTEC found that the estimated entrainment during the 2006 study was lower than
 13 but comparable to estimates made by NUS (1978-TN9580) and they postulated that differences
 14 may have in part been attributed to differences in Mississippi River flow rates. In addition,
 15 MACTEC noted that representative important species, including spotfin shiner, shorthead
 16 redhorse, black bullhead, channel catfish, bluegill, smallmouth bass, and black crappie were not
 17 commonly entrained. In addition, MACTEC concluded that based on historical annual
 18 electrofishing and seining surveys and the entrainment data, that there is no indication that
 19 entrainment due to Monticello operations is having a major impact on fish species composition
 20 or abundance.

21 Historical Entrainment Studies

22 Entrainment studies conducted by Knutson et al. (1976) and Amish et al. (1978-TN9580) are
 23 described in Section 4.1.2 of the 2006 Monticello LR SEIS and are summarized here (NRC

1 2006-TN7315). Knutson et al. (1976) collected entrainment samples at Monticello from
2 September 1973 to August 1974 (NRC 2006-TN7315). The researchers estimated that
3 entrainment rates for young-of-the-year fish to be 1,617/hr or 38,805/day for all fish.
4 Entrainment losses consisted of 23 species or species groups, which comprised of 96.5 percent
5 catostomids (suckers), 1.3 percent black crappie, 0.8 percent cyprinids, and 0.5 percent
6 walleye. Based on this data and data from regular fish surveys, the researchers concluded that
7 entrainment is not having an impact on sucker species.

8 NUS Corporation conducted entrainment monitoring in support of a CWA Section 316(b)
9 Demonstration. The monitoring was conducted from April to September 1976, which was a
10 low-flow year for the Mississippi River (Amish et al. 1978-TN9580). NUS Corporation estimated
11 the number of entrained organisms to be 1,076,000 eggs and 2,827,000 fish (less than one year
12 old). The primary entrained species were logperch (31.8 percent), shorthead redhorse
13 (22.4 percent), unidentified darters (13.7 percent), unidentified minnows (10.9 percent), white
14 sucker (5.3 percent), and several other species (16.7 percent) that individually constituted less
15 than 4 percent of total entrainment. NUS Corporation concluded that, similar to the 1974 study,
16 nearly all fish were entrained between May and August. Researchers estimated that the number
17 of equivalent adult fish lost due to entrainment was 250,124 fish which consisted of 218,000
18 logperch, 9,230 shorthead redhorse, 1,410 darters, and 13,600 minnows.

19 Entrainment Reduction Methods

20 As explained previously, the CWA Section 316(b) regulations direct the permitting authority to
21 establish BTA entrainment requirements for each facility on a site-specific basis. For Monticello,
22 MPCA will make that determination as one component of issuing a renewed NPDES permit. As
23 part of its NPDES permit renewal application. Xcel Energy conducted an evaluation (Xcel 2023-
24 TN9578: Attachment 8 and 9 of Enclosure 24)^{7,8} of fine mesh screens that could be installed
25 over the existing traveling screens to physically exclude a larger percentage of fish eggs, larvae,
26 and juveniles from entrainment than the system's current configuration. Instead of becoming
27 entrained, these organisms would instead be impinged on the fine mesh screens and would
28 then be washed off the screens into the sluiceway and returned back to the Mississippi River.
29 Xcel Energy estimated that fine mesh screens would reduce entrainment by 9.6 to 28.2 percent
30 for 0.02 in. (0.5 mm) mesh screen, 9.6 to 26.5 percent for 0.04 in. (1 mm) mesh screen, and
31 6.5 to 9.1 percent for a 0.08 in. (2 mm) mesh screen. Xcel Energy estimated that this method
32 would cost about \$15 million to install approximately \$440,000 per year to operate.

33 Xcel Energy also evaluated other potential options for reducing entrainment, but did not quantify
34 the expected reductions (Xcel 2023-TN9578: Attachment 8 and 9 of Enclosure 24)^{7,8}. These
35 other options included MDCTs to convert Monticello to a closed-cycle recirculation system,
36 using cylindrical screens attached to the front of water intake pipes, and using alternative
37 cooling water sources (e.g., wastewater or groundwater).

38 Entrainment Conclusion

39 Entrainment studies indicate that larval cyprinids and catostomids are the most susceptible
40 species to be entrained. Finfish monitoring trends, as described in Section 3.7.1.1, indicate no

⁷ Enclosure 24 Attachment 8 Non-water Quality Environmental and Other Impacts Study for Monticello Nuclear Generating Plant.

⁸ Enclosure 24 Attachment 9 Comprehensive Technical Feasibility and Cost Evaluation Study for the Monticello Nuclear Generating Plant pg. 654.

1 upward or downward trends in these taxa's populations over several decades of monitoring.
2 Further, the HZI covers a relatively small area of the Mississippi River that includes the intake
3 canal, a segment of the main channel, and a relatively low portion of Mississippi River flows.
4 Collectively, this information indicates that entrainment is unlikely to cause noticeable or
5 detectable impacts on aquatic populations in the Mississippi River near Monticello. Shellfish
6 were not specifically included in entrainment studies, so specific conclusions cannot be drawn
7 regarding impacts on shellfish.

8 Because water withdrawals, and the associated risk of entrainment, would remain the same
9 under the proposed action as under the current license, the NRC staff anticipates similar
10 (i.e., nondetectable) effects during the proposed SLR period. Further, the MPCA will make an
11 entrainment BTA determination as part of issuing a renewed NPDES permit (the current NPDES
12 permit expires in 2028). If the MPCA imposes any additional requirements beyond those
13 contained in the current permit, those requirements would likely further reduce the impacts of
14 entrainment over the course of the proposed SLR term, in accordance with CWA Section 316(b)
15 requirements. For instance, if MPCA requires Xcel Energy to institute fine mesh screens, such
16 as those described under "Entrainment Reduction Methods," the impacts of entrainment would
17 be further reduced from current levels.

18 For the reasons described above, the NRC staff finds that the impacts of entrainment of aquatic
19 organisms resulting from the proposed SLR of Monticello would be SMALL.
20 Impingement and Entrainment Conclusion

21 Based on the discussion summarized under "Impingement Conclusion" and "Entrainment
22 Conclusion," the NRC staff concludes that the impacts of impingement and entrainment on
23 aquatic organisms resulting from the proposed Monticello SLR of term would be SMALL.

24 3.7.2.2 *Entrainment of Phytoplankton and Zooplankton (All Plants)*

25 This issue concerns entrainment of phytoplankton and zooplankton from cooling water
26 withdrawal. Entrainment occurs when organisms pass through the cooling system's screening
27 device and travel through the entire system, including the pumps, condenser or heat exchanger
28 tubes, and discharge pipes (79 FR 48300-TN4488). Organisms susceptible to entrainment are
29 of smaller size, such as ichthyoplankton, zooplankton, and phytoplankton. During travel through
30 the cooling system, entrained organisms experience physical trauma and stress, pressure
31 changes, excess heat, and exposure to chemicals (Mayhew et al. 2000-TN8458). Because
32 entrainable organisms generally consist of fragile life stages (e.g., eggs, which exhibit poor
33 survival after interacting with a cooling water intake structure, and early larvae, which lack a
34 skeletal structure and swimming ability), the EPA has concluded that, for purposes of assessing
35 the impacts of a cooling water intake system on the aquatic environment, all entrained
36 organisms are assumed to die (79 FR 48300-TN4488). The NRC staff assesses the site-specific
37 impacts of entrainment of fish and shellfish during the Monticello SLR term in Section 3.7.2.1 of
38 this EIS. This issue concerns entrainment of phytoplankton and zooplankton.

39 Most nuclear power plants were required to monitor the entrainment effects during the initial
40 years of operation. The effects of entrainment on phytoplankton and zooplankton are of small
41 significance if monitoring indicates no evidence that the nuclear power plant operation has
42 reduced or otherwise affected populations of these organisms in the source waterbody. The
43 2013 LR GEIS (NRC 2013-TN2654) summarizes the results of entrainment monitoring at
44 several nuclear power plants. The 1996 LR GEIS (NRC 1996-TN288) and 2013 LR GEIS
45 concluded that this was a Category 1 issue and that nuclear power plants had not noticeably

1 altered phytoplankton or zooplankton abundance near these and other plants. As a result, NRC
2 staff concluded that the impacts of initial license renewal would be similar and SMALL. In the
3 2006 Monticello LR SEIS (NRC 2006-TN7315), the NRC staff found no new and significant
4 information concerning this issue, and the NRC staff adopted the 1996 LR GEIS's conclusion of
5 SMALL for Monticello initial license renewal. Below, the NRC staff analyzes this issue site-
6 specifically for the SLR term, in accordance with CLI-22-02 and CLI-22-03 (NRC 2022-TN8182,
7 NRC 2022-TN9844).

8 Phytoplankton and zooplankton inhabiting the Mississippi River may be entrained when water is
9 drawn from the Mississippi River into the intake structure under three operating modes:
10 open-cycle, helper cycle, and partial recirculation modes (see Sections 2.1.3 and 3.7.2.1). In
11 these operating modes, Monticello can withdraw up to 290,000 gpm of water from the
12 Mississippi River under the Water Appropriations Permit (No. 66-1172; Xcel 2023-TN9084). As
13 Monticello withdraws water from the Mississippi River, fish and other aquatic organisms that
14 cannot swim fast enough to escape the flow of water may be swept into the intake. Monticello
15 can also operate in a closed cycle mode, however, to date, it has not operated in this mode. If
16 closed cycle mode were used in the future, entrainment would be expected to be minimal as
17 Monticello would withdraw water from the Mississippi River through two makeup water pumps
18 that withdraw less water than the other operating modes (14,000 gpm) to replace water lost due
19 to evaporation, drift, and blowdown and entrainment.

20 Researchers conducted field studies in the 1960s and 1970s to characterize phytoplankton and
21 zooplankton in the Mississippi River (NRC 2006-TN7315; Amish et al. 1978-TN9580). As
22 discussed in Section 3.7.1.2, these studies found that phytoplankton is limited in the Mississippi
23 River and can likely be attributed to a few backwater areas with standing water, and most of the
24 phytoplankton caught during the studies was attributed to fragments of periphyton that broke off
25 the bottom. Researchers have found that zooplankton populations to be limited in the main
26 channel of the Mississippi River by Monticello due to the high gradients (NRC 2006-TN7315⁶;
27 Amish et al. 1978-TN9580). Although Xcel Energy conducted entrainment studies at Monticello,
28 these studies only considered ichthyoplankton and not phytoplankton or zooplankton. In the
29 absence of specific studies, the NRC staff considers the HZI and results of finfish monitoring to
30 reasonably characterize the effects of entrainment on phytoplankton and zooplankton in the
31 Mississippi River.

32 Although phytoplankton and zooplankton are likely limited in the reach of the Mississippi River
33 near Monticello, the HZI is an important factor for determining potential impacts. As described in
34 Section 3.7.2.1, researchers determined that most of the main channel is not influenced by the
35 withdrawal of water by Monticello (Xcel 2023-TN9578⁶: Attachment 6 of Enclosure 24).
36 Therefore, most phytoplankton and zooplankton moving past the Monticello intake system are
37 not at risk of entrainment due to the relatively small area influenced by the intake structure. The
38 HZI would remain the same during the proposed SLR period.

39 Finfish monitoring can provide insight into the health phytoplankton and zooplankton
40 communities inhabiting the reach of the Mississippi River near Monticello. As described in
41 Section 3.7.1.2, Xcel Energy conducts annual electrofishing and seining surveys of the reach of
42 the Mississippi River near Monticello to monitor the aquatic community. Survey results have not
43 shown major decreases in fish abundance or diversity. Although these studies do not directly
44 gather information on phytoplankton and zooplankton populations, it is reasonable to assume
45 that entrainment is not affecting these communities to a degree that causes trophic cascade or
46 monitoring would reveal downward trends or other shifts in the abundance and composition of
47 finfish species that are primary consumers in the trophic structure.

1 SLR would continue current operating conditions and environmental stressors rather than
2 introduce wholly new impacts. Therefore, the impacts of current operations and SLR on
3 phytoplankton and zooplankton would be similar. For these reasons, the effects of entrainment
4 of phytoplankton and zooplankton would be minor and would neither destabilize nor noticeably
5 alter any important attribute of these populations during the SLR term. The NRC staff concludes
6 that the impacts of entrainment of phytoplankton and zooplankton during the Monticello SLR
7 term would be SMALL.

8 *3.7.2.3 Thermal Impacts on Aquatic Organisms (Plants with Once-Through Cooling Systems*
9 *or Cooling Ponds)*

10 This section evaluates the thermal impacts of Monticello operations during the proposed SLR
11 term on aquatic organisms. In the 2006 Monticello LR SEIS (NRC 2006-TN7315), the NRC staff
12 evaluated the thermal impacts from “heat shock.” The NRC staff determined the impacts of
13 continued operation of Monticello would be SMALL during the initial license renewal term (i.e.,
14 2010–2030). In 2013, the NRC issued Revision 1 of the LR GEIS (NRC 2013-TN2654) and
15 renamed the issue of “heat shock” to “thermal impacts on aquatic organisms.” The renaming did
16 not affect the scope of the issue for license renewal. This section of the EIS evaluates thermal
17 impacts as they apply to continued operation of Monticello during the proposed subsequent
18 license renewal term (i.e., 2030–2050).

19 The primary form of thermal impact of concern at Monticello is heat shock. Heat shock occurs
20 when water temperature meets or exceeds the thermal tolerance of an aquatic species for some
21 duration of the exposure (NRC 2013-TN2654). In most situations, fish can avoid areas that
22 exceed their thermal tolerance limits, although some aquatic species or life stages lack such
23 mobility. Heat shock is typically observable only for fish because fish tend to float when dead. In
24 addition to heat shock, thermal plumes resulting from thermal effluent can create barriers to fish
25 passage, which is of particular concern for migratory species. Thermal plumes can also reduce
26 the available aquatic habitat or alter habitat characteristics in a manner that results in cascading
27 effects on the local aquatic community.

28 Monticello Effluent Discharge

29 As described in Section 2.1.3, Monticello’s NPDES permit establishes thermal limits for heated
30 effluent discharges into the Mississippi River (MPCA 2023-TN9690). Monticello discharges
31 heated effluent approximately through two 108 in. (274 cm) pipes to a concrete discharge
32 structure, which is located approximately 700 ft (213.4 m) downriver of the intake structure. The
33 concrete discharge structure is equipped with two isolation and sluice gates. During open cycle,
34 helper, and partial recirculation modes, the sluice gates are opened to allow the heated effluent
35 to enter into the discharge canal and return to the Mississippi River. The discharge canal is
36 approximately 1,000 ft (304.8 m) long. Heated effluent from the cooling towers is discharged to
37 the south bank of the discharge canal. Water that collects in the discharge canal then flows
38 downhill toward a discharge weir with a control gate. The discharge weir controls the amount of
39 water that is released into the Mississippi River and acts as a blockade that prevents fish from
40 the Mississippi River from entering the discharge canal. Water from the discharge canal pours
41 over the crest of the discharge weir, flows down a concrete apron to prevent scouring, and then
42 flows into the Mississippi River with a flow rate of up to 645 cfs (18.3 m/s).

43 Heated effluent entering the Mississippi River creates a distinct thermal plume (Xcel 2023-
44 TN9578⁹: Attachment 4 of Enclosure 24; NRC 2006-TN7315; NMC 2006-TN9677; Xcel 2023-
45 TN9084). The sections below summarize thermal plume studies.

1 Clean Water Act of 1972 Section 316(a) Requirements for Point Source Discharges

2 The CWA Section 316(a) addresses the adverse environmental impacts associated with thermal
3 discharges into waters of the United States. This section of the CWA grants the EPA the
4 authority to impose alternative, less-stringent, facility-specific effluent limits (called “variances”)
5 on the thermal component of point source discharges. To be eligible, facilities must
6 demonstrate, to the satisfaction of the NPDES permitting authority, that facility-specific effluent
7 limitations will assure the protection and propagation of a balanced, indigenous population of
8 shellfish, fish, and wildlife in and on the receiving body of water. CWA Section 316(a) variances
9 are valid for the term of the NPDES permit (i.e., 5 years). Facilities must reapply for variances
10 with each NPDES permit renewal application. The EPA issued regulations under CWA
11 Section 316(a) at 40 CFR 125, Subpart H (TN254).

12 Analysis Approach

13 When available, the NRC staff relies on the expertise and authority of the NPDES permitting
14 authority with respect to thermal impacts on aquatic organisms. Therefore, if the NPDES
15 permitting authority has made a determination under CWA Section 316(a) that thermal effluent
16 limits are sufficiently stringent to assure the protection and propagation of a balanced,
17 indigenous population of shellfish, fish, and wildlife in and on the receiving body of water, and
18 that facility has implemented any associated requirements; then, the NRC staff assumes that
19 adverse impacts on the aquatic environment will be minimized. In such cases, the NRC staff
20 concludes that thermal impacts on aquatic organisms would be SMALL for the proposed SLR
21 term.

22 In cases in which the NPDES permitting authority has not granted a CWA Section 316(a)
23 variance, the NRC staff analyzes the potential impacts of thermal discharges using a
24 weight-of-evidence approach. In this approach, the staff considers multiple lines of evidence to
25 assess the presence or absence of ecological impairment (i.e., noticeable or detectable impact)
26 on the aquatic environment. For instance, as its lines of evidence, the staff might consider
27 characteristics of the cooling water discharge system design, the results of thermal studies
28 performed at the facility, and trends in fish and shellfish population abundance indices. The staff
29 then considers these lines of evidence together to predict the level of impact (SMALL,
30 MODERATE, or LARGE) that the aquatic environment is likely to experience over the course of
31 the proposed SLR term.

32 Baseline Condition of the Resource

33 For the purposes of this analysis, the NRC staff assumes that the baseline condition of the
34 resource is the Mississippi River aquatic community as it occurs today, which is described in
35 Section 3.7.1 of this EIS. While species richness, evenness, and diversity within the community
36 may change or shift between now and when the proposed SLR period would begin, the NRC
37 staff finds the aquatic community as it occurs today to be a reasonable surrogate in the absence
38 of fishery and species-specific projections.

39 CWA 316(a) Thermal Variance

40 The MPCA has regulated thermal discharge temperatures at Monticello through the NPDES
41 permit since it began operating in 1975 (NMC 2006-TN9677; NRC 2006-TN7315; Xcel 2023-
42 TN9084). These temperature limits are not explicitly called thermal variances in the NPDES
43 permits. The MPCA and MDNR uses an adaptive permitting approach to ensure that aquatic

1 resources are protected during Monticello operations (see Sections 2.1.3, 3.7.2.1, and the
2 above summary in this section). The MPCA sets maximum thermal effluent temperatures in the
3 NPDES permit, and the MDNR limits surface water appropriations from the Mississippi River in
4 the Surface Water Appropriation Permit. The conditions for Monticello for both of these permits
5 are designed to be protective of aquatic and terrestrial life in accordance with State and Federal
6 regulations. The NPDES permit contains fishery monitoring requirements and biennial reporting
7 to MPCA as well as requirements for discharge sampling and testing for water quality
8 parameters. MPCA uses these water quality and fishery reports to assess the safety and
9 population stability of native shellfish and fish populations, and could require Xcel Energy to
10 conduct a Section 316(a) study if aquatic biota are impacted by surface water discharges (Xcel
11 2023-TN9084).

12 1971–1975 Thermal Plume Analyses

13 University of Minnesota researchers collected surface water temperature data between 1971
14 and 1973 and conducted an initial thermal plume analysis (Xcel 2023-TN9578: Attachment 4,
15 Enclosure 24). NUS Corporation further evaluated the thermal impacts from the Monticello
16 discharges in a Section 316(a) demonstration report from 1975. The NRC staff summarized the
17 main findings of the Section 316(a) demonstration report in the 2006 Monticello LR SEIS (NRC
18 2006-TN7315). The summary of the 1975 analysis that was prepared by NRC staff included
19 some findings similar to the earlier 1971–1973 study: (1) the main thermal plume was confined
20 to the southern and western river bank; (2) the plume extended to less than half the width of the
21 river during summer months (June through September); and (3) the temperature differentials of
22 the plume outside of the exit of the discharge location were similar for the 1975 study (4.2°F
23 [2.3°C]) and the 1971–1973 study (3°F [1.7°C]).

24 2009 Extended Power Uprate Evaluation

25 URS Corporation conducted a EPU Evaluation in 2009, and the modelers used the approach
26 from the 1971–1973 isotherm analysis to analyze thermal impacts for the EPU (Xcel 2023-
27 TN9084, Xcel 2023-TN9578: Attachment 4, Enclosure 24). The NRC approved a license
28 amendment authorizing Xcel Energy to operate at a higher license power rate that became
29 effective in 2013. The EPU increased the licensed power generation rate by 12.9 percent. The
30 researchers determined that the EPU could increase water temperatures in the discharge canal
31 by up to 4.5°F (2.5°C) during operations under the once-through cooling mode and by 2°F
32 (1.1°C) during operations under the helper and partial recirculation modes. The researchers
33 found that the size and shape of the thermal plume would remain similar to the
34 1971–1973 evaluation (Xcel 2023-TN9578⁹: Attachment 4, Enclosure 24).

35 URS Corporation also determined that the EPU could increase the temperatures of the thermal
36 plume in the Mississippi River. The researchers conducted this EPU evaluation by comparing
37 the predicted plume temperatures before the EPU and after the EPU during January (peak cold
38 months) and August (peak warm months). For August, the researchers predicted that the EPU
39 could increase plume temperatures by 2.8°F (1.5°C) near the exit of the discharge, by 2.2°F
40 (1.2°C) at a location 500 ft (152 m) downriver of the discharge canal, and by 1.1°F (0.6°C) at the
41 furthest location that they analyzed 17,540 ft (5,346 m) downriver. For January, the authors
42 predicted the EPU could increase plume temperatures by 3.3°F (1.8°C) near the exit of the

⁹ Xcel Energy 2023. Enclosure 24 Attachment 4 Thermal Effluent Discharge Analysis for Monticello Nuclear Generating Plant. Enclosure 24 in Xcel 2023-TN9578, page 345.

1 discharge canal, by 2.6°F (1.4°C) at a location 500 ft (152 m) downriver of the discharge canal,
2 and by 1.3°F (0.7°C) at a location 17,540 ft (5,346 m) downriver of the discharge canal.

3 Thermal Impacts Conclusion

4 The thermal plume studies demonstrate that the temperature differentials of the plume begin to
5 rapidly decrease downriver of the discharge canal, the plume does not cross the entire river,
6 and the plume is localized along the western bank downriver of Monticello. Mobile organisms
7 such as fish can therefore swim around the plume and the impacts to immobile organisms
8 would be limited the small area of peak temperature differentials by the exit of the discharge
9 canal. The electrofishing and seining surveys also demonstrate there have not been major
10 decreases in fish abundance or diversity for areas upriver and downriver of Monticello.

11 In addition, because MPCA has granted Xcel Energy multiple, sequential NPDES permits with
12 temperature limits that are designed to be protective of aquatic life under CWA Section 316(a)
13 and Minnesota Administrative Rules, the NRC staff finds that the adverse impacts on the
14 aquatic environment associated with thermal effluents are minimized. Because characteristics of
15 the thermal effluent would remain the same under the proposed action, the NRC staff
16 anticipates similar effects during the proposed SLR period. Further, MPCA will continue to
17 review the CWA Section 316(a) variance with each successive NPDES permit renewal and may
18 require additional mitigation or monitoring in a future renewed NPDES permit if it deems such
19 actions to be appropriate to assure the protection and propagation of a balanced, indigenous
20 population of shellfish, fish, and wildlife in the Mississippi River. The NRC staff assumes that
21 any additional requirements that MPCA imposes would further reduce the impacts of the
22 Monticello thermal effluent over the course of the proposed SLR term. For these reasons, the
23 NRC staff finds that thermal impacts during the proposed SLR period would neither destabilize
24 nor noticeably alter any important attribute of the aquatic environment and would, therefore,
25 result in SMALL impacts on aquatic organisms.

26 *3.7.2.4 Infrequently Reported Thermal Impacts (All Plants)*

27 This issue concerns the infrequently reported effects of thermal effluents. These effects include
28 cold shock, thermal migration barriers, accelerated maturation of freshwater aquatic insects,
29 and proliferated growth of aquatic nuisance species.

30 Cold shock occurs when an organism has been acclimated to a specific water temperature or
31 range of temperatures and is subsequently exposed to a rapid decrease in temperature. This
32 can result in a cascade of physiological and behavioral responses and, in some cases, death
33 (Donaldson et al. 2008-TN7515). Rapid temperature decreases may occur from either natural
34 sources (e.g., thermocline temperature variation and storm events) or anthropogenic sources
35 (e.g., thermal effluent discharges). The magnitude, duration, and frequency of the temperature
36 change, as well as the initial acclimation temperatures of individuals, can influence the extent of
37 the consequences of cold shock on fish and other aquatic organisms (Donaldson et al. 2008-
38 TN7515). At nuclear power plants, cold shock could occur during refueling outages, reductions
39 in power generation level, or other situations that would quickly reduce the amount of cooling
40 capacity required at the nuclear power plant. Cold shock is most likely to be observable in the
41 winter. The 1996 LR GEIS reports that cold shock events have only rarely occurred at nuclear
42 power plants. Fish mortalities usually involved only a few fish and did not result in
43 population-level effects. Gradual depowering or shutdown of nuclear power plant operations,
44 especially in winter months, can mitigate the effects of cold shock.

1 Thermal effluents have the potential to create migration barriers if the thermal plume covers an
2 extensive cross-sectional area of a river and temperatures within the plume exceed a species'
3 physiological tolerance limit. This impact has been examined at several nuclear power plants,
4 but it has not been determined to result in observable effects (NRC 1996-TN288, NRC 2013-
5 TN2654).

6 The 1996 LR GEIS (NRC 1996-TN288) and 2013 LR GEIS (NRC 1996-TN288) also considered
7 that the heated effluents of nuclear power plants could accelerate the maturation of aquatic
8 insects in freshwater systems and cause premature emergence. The maturation and
9 emergence of aquatic insects are often closely associated with water temperature regimes. If
10 insects develop or emerge early in the season, they may be unable to feed or reproduce or they
11 may die because the local climate is not warm enough to support them.

12 The 1996 LR GEIS and 2013 LR GEIS also considered that heated effluents could proliferate
13 the growth of aquatic nuisance organisms. Aquatic nuisance species are organisms that disrupt
14 the ecological stability of infested inland (e.g., rivers and lakes), estuarine, or marine waters
15 (EPA 2022-TN7519). The LR GEISs discuss the zebra mussel (*Dreissena polymorpha*) and
16 Asiatic clam (*Corbicula fluminea*), two bivalves that are of particular concern in many freshwater
17 systems because they can cause significant biofouling of industrial intake pipes at power and
18 water facilities. These species are also of ecological concern because they outcompete and
19 lead to the decline of native freshwater mussels. Nuclear power plants that withdraw water from
20 water bodies in which these species are known to occur often periodically chlorinate intake
21 pipes or have other procedures in place to mitigate the spread of these bivalves. There is no
22 evidence, however, that thermal effluent leads to these species' proliferation.

23 The 1996 LR GEIS (NRC 1996-TN288) and the 2013 LR GEIS (NRC 2013-TN2654) concluded
24 that these infrequently reported thermal impacts were a Category 1 issue and would be SMALL
25 during the initial license renewal term. The 1996 LR GEIS evaluated these concerns as five
26 issues; the 2013 LR GEIS consolidated them into one issue. In the 2006 Monticello LR SEIS
27 (NRC 2006-TN7315), the NRC staff found no new and significant information concerning these
28 issues, and the NRC staff adopted the 1996 LR GEIS's conclusion of SMALL impact for
29 Monticello initial license renewal. Below, the NRC staff analyzes this issue site-specifically for
30 the SLR term, in accordance with CLI-22-02 and CLI-22-03 (NRC 2022-TN8182, NRC 2022-
31 TN9844).

32 Cold Shock

33 Xcel Energy has reported two fish kill incidents due to cold shock in the past 5 years, both of
34 which were attributed to routine maintenance shutdowns, which reduced heat load in the
35 Mississippi River (Table 3-17; Xcel 2023-TN9578¹⁰: Enclosure 26). Xcel Energy estimated the
36 total fish mortality to be 1,577 fish in 2022 and 230 fish in 2023 (Table 3-17; Xcel 2023-
37 TN9578¹⁰: Enclosure 26). Most fish were smallmouth bass (48.6 percent combined across the
38 two events), channel catfish (22.9 percent), and shorthead redhorse (14.3 percent). Data on
39 length and age composition of the affected fish are not available.

¹⁰ Xcel Energy 2023. Enclosure 26, RAI AQ-1 Thermal Impacts on Aquatic Organisms. Xcel 2023-
TN9578 p. 1000.

1 **Table 3-17 Summary of Cold Shock Fish Kill Events at Monticello, 2022 and 2023**

Species	No. of Fish (January 2022)	No. of Fish (March 2023)	Total No. of Fish	Percent of Total Fish
smallmouth bass	825	54	879	48.6
channel catfish	384	29	413	22.9
shorthead redhorse	161	97	258	14.3
silver redhorse	96	19	115	6.4
northern hogsucker	34	1	35	1.9
white sucker	35	0	35	1.9
common carp	14	15	29	1.6
bluegill	7	10	17	0.9
rock bass	10	4	14	0.8
northern pike	3	1	4	0.2
walleye	4	0	4	0.2
black crappie	2	0	2	0.1
black bullhead	2	0	2	0.1
Total	1,577	230	1,807	100

Source = Xcel 2023-TN9578¹⁰: Enclosure 26.

2 Xcel Energy has observed cold shock-related fish kills since Monticello began operating (NMC
3 2006-TN9677). Between 1975 and 1979, Xcel Energy reported that eight winter shutdown
4 events caused the death of about 1,200 total fish (or an average of 150 fish per event). In
5 response to these events, Xcel Energy constructed a barrier weir at the mouth of the discharge
6 canal in 1980 to prevent fish from entering the warmest areas of the discharge canal, which
7 Xcel Energy expected would reduce the potential for cold shock events. From 1980 to 2004,
8 Xcel Energy observed eight cold shock-related fish kills resulting in a total mortality of 969 fish
9 (or an average of 121 total fish per event), which indicates that the barrier weir has likely
10 reduced the frequency of such events. However, the magnitude and periodicity of the cold
11 shock events in 2022 (1,577 total fish) and 2023 (230 total fish) are high compared to historical
12 events that occurred both before and after barrier weir construction. The NRC staff also does
13 not have information on the period from 2004 through 2021. Therefore, the NRC staff is
14 uncertain whether the 2022 and 2023 cold shock events were anomalies and whether any other
15 factors, such as extreme weather or climate change factors, contributed to these events.

16 As discussed in Section 3.7.2.1, Xcel Energy’s annual electrofishing and seining surveys
17 indicate that the local fish populations are healthy and diverse, and sampling indicates no major
18 upward or downward trends in juvenile or adult fish populations. For this reason, the NRC staff
19 concludes that fish mortality in connection with occasional cold shock events is not affecting fish
20 populations to an extent that changes in these populations are detectable.

21 Thermal Migration Barriers

22 With respect to thermal migration barriers, Section 3.7.2.3 observes that the thermal plume
23 does not span the entire river. Therefore, fish and other aquatic organisms can avoid areas of
24 heated water when migrating upriver and downriver. For this reason, the thermal plume is not
25 expected to create a barrier to migration.

1 Accelerated Maturation of Freshwater Aquatic insect and Proliferated Growth of Aquatic
2 Nuisance Species

3 Accelerated maturation of freshwater aquatic insects and proliferated growth of aquatic
4 nuisance species have not been documented to occur due to Monticello operations. The one
5 exception is that heated effluent released by Monticello has allowed a localized population of
6 invasive Asian clams to survive the cold Minnesota winters (see Section 3.7.1.3). The Asian
7 clam population has not proliferated to levels requiring Xcel Energy to implement control
8 measures. This population by Monticello is not expected to survive or spread outside the region
9 of warmer water directly in the vicinity of Monticello's thermal effluent because colder winter
10 water temperatures upstream or downstream of Monticello would kill them. Shipworms are not
11 of concern because Monticello does not discharge to coastal waters.

12 Conclusion

13 SLR would continue current operating conditions and environmental stressors rather than
14 introduce wholly new impacts. Therefore, the impacts of current operations and SLR would be
15 similar. The NRC staff concludes that fish mortality in connection with occasional cold shock
16 events would likely continue during the SLR period but that these events would not affect fish
17 populations to an extent that would be detectable at the population level. No other thermal
18 impacts discussed in this section have been found to be an issue at Monticello and, therefore,
19 the NRC staff does not expect that these issues would be of concern during the SLR period. For
20 these reasons, infrequently reported thermal impacts would be minor and would neither
21 destabilize nor noticeably alter any important attribute of the aquatic environment during the
22 SLR term. The NRC staff concludes that infrequently reported thermal impacts on aquatic
23 resources during the Monticello SLR term would be SMALL.

24 3.7.2.5 *Effects of Cooling Water Discharge on Dissolved Oxygen, Gas Supersaturation, and*
25 *Eutrophication*

26 This issue concerns the effects of thermal effluents on dissolved oxygen, gas supersaturation,
27 and eutrophication. Because nuclear power plant effluents are heated, discharged water can
28 change certain biological conditions in the receiving waterbody in a manner that affects the
29 characteristics of that habitat and the potential suitability of that habitat for local fish, shellfish,
30 and other aquatic organisms.

31 Aerobic organisms, such as fish, require oxygen, and the concentration of dissolved oxygen in a
32 waterbody is one of the most important ecological water quality parameters. Dissolved oxygen
33 also influences several inorganic chemical reactions. In general, dissolved oxygen
34 concentrations of less than 3 parts per million (ppm) in warmwater habitats, or less than 5 ppm
35 in coldwater habitats, can adversely affect fish (Morrow and Fischenich 2000-TN7351). Oxygen
36 dissolves into water via diffusion, aeration, and as a product of photosynthesis. The amount of
37 oxygen water can absorb depends on temperature; the amount of oxygen that can dissolve in a
38 volume of water (i.e., the saturation point) is inversely proportional to the temperature of the
39 water. Thus, when other chemical and physical conditions are equal, the warmer the water is,
40 and the less dissolved oxygen it can hold. Increased water temperatures also affect the amount
41 of oxygen that aquatic organisms need by increasing metabolic rates and chemical reaction
42 rates. The rate of many chemical reactions in water approximately doubles for every 18°F
43 (10°C) increase in temperature.

1 The thermal effluent discharges of nuclear power plants have the potential to stress aquatic
2 organisms by simultaneously increasing these organisms' need for oxygen and decreasing
3 oxygen availability. Aquatic organisms are more likely to experience adverse effects from
4 thermal effluents in ecosystems where dissolved oxygen levels are already approaching
5 suboptimal levels from other factors in the environment. This is most likely to occur in
6 ecosystems where increased levels of detritus and nutrients (e.g., eutrophication), low flow, and
7 high ambient temperatures already exist. These conditions can occur from drought conditions or
8 in hot weather, especially in lakes, reservoirs, or other dammed freshwater.

9 Although the thermal effluents of nuclear power plants may contribute to reduced dissolved
10 oxygen in the immediate vicinity of the discharge point, as the effluent disperses, diffusion and
11 aeration from turbulent movement introduces additional oxygen into the water. As the water
12 cools, the saturation point increases, and the water can absorb additional oxygen as it is
13 released by aquatic plants and algae through photosynthesis, which is a continuously ongoing
14 process during daylight hours. Therefore, lower dissolved oxygen is generally only a concern
15 within the thermal mixing zone, which is typically a small area of the receiving waterbody. Many
16 States address thermal mixing zones in State water quality criteria to ensure that mixing zones
17 provide a continuous zone of passage for aquatic organisms. Additionally, the EPA, or
18 authorized States and Tribes often impose conditions specifically addressing dissolved oxygen
19 through NPDES permits to ensure that receiving water bodies maintain adequate levels of
20 oxygen to support aquatic life. These conditions are established pursuant to CWA
21 Section 316(a), which requires that regulated facilities operate under effluent limitations that
22 ensure the protection and propagation of a balanced, indigenous population of shellfish, fish,
23 and wildlife in and on the receiving waterbody.

24 Rapid heating of cooling water can also affect the solubility and saturation point of other
25 dissolved gases, including nitrogen. As water passes through the condenser cooling system, it
26 can become supersaturated with gases. Once the supersaturated water is discharged in the
27 receiving waterbody, dissolved gas levels equilibrate as the effluent cools and mixes with
28 ambient water. This process is of concern if aquatic organisms remain in the supersaturated
29 effluent for a long enough period to become equilibrated to the increased pressure associated
30 with the effluent. If these organisms then move into water of lower pressure too quickly when,
31 for example, swimming out of the thermal effluent or diving to depths, the dissolved gases within
32 the affected tissues may come out of solution and form embolisms (bubbles). The resulting
33 condition is known as gas bubble disease. In fish, it is most noticeable in the eyes and fins.
34 Affected tissues can swell or hemorrhage and result in behavioral abnormalities, increased
35 susceptibility to predation or death. Mortality in fish generally occurs at gas supersaturation
36 levels above 110 or 115 percent (EPA 1986-TN7726). Aquatic insects and crustaceans appear
37 to be more tolerant of supersaturated water (Nebeker et al. 1981-TN7725).

38 The ability to detect and avoid supersaturated waters varies among species. A fish can avoid
39 supersaturated waters by either not entering the affected area or by diving to avoid the onset of
40 supersaturated conditions near the surface. Some species, however, may not avoid
41 supersaturated waters until symptoms of gas bubble disease occur; at that point, some fish may
42 already be lethally exposed. Other species may be attracted to supersaturated waters because
43 it is often warmer (Gray et al. 1983-TN7727).

44 An early concern about nuclear power plant discharges was that thermal effluents would cause
45 or speed eutrophication by stimulating biological productivity in receiving water bodies (NRC
46 1996-TN288). Eutrophication is the gradual increase in the concentration of phosphorus,
47 nitrogen, and other nutrients in a slow-flowing or stagnant aquatic ecosystem, such as a lake.

1 These nutrients enter the ecosystem primarily through runoff from agricultural land and
2 impervious surfaces. The increase in nutrient content allows alga to proliferate on the water's
3 surface, which reduces light penetration and oxygen absorption necessary for underwater life.
4 The 1996 LR GEIS reports that several nuclear power plants conducted long-term monitoring to
5 investigate this potential effect. No evidence of eutrophication was detected.

6 The 1996 LR GEIS (NRC 1996-TN288) and 2013 LR GEIS (NRC 2013-TN2654) report cases of
7 fish mortality from gas bubble disease at hydroelectric dams and coal-fired power plants.
8 Typically, gas bubble disease is of concern at facilities where the configuration of the discharge
9 allows organisms to reside in the supersaturated effluent for extended periods of time (e.g.,
10 discharge canals that fish can freely enter). However, fish mortality from gas bubble disease has
11 been observed in only one instance in the mid-1970s at a nuclear power plant that is no longer
12 operating.

13 The 1996 LR GEIS (NRC 1996-TN288) and the 2013 LR GEIS (NRC 2013-TN2654) concluded
14 that the effects of cooling water discharge on dissolved oxygen, gas supersaturation, and
15 eutrophication were a Category 1 issue and would be SMALL during the initial license renewal
16 term. The 1996 LR GEIS evaluated these concerns as three issues, while the 2013 LR GEIS
17 consolidated them into one issue. In the 2006 Monticello LR SEIS, the NRC staff found no new
18 and significant information concerning these issues, and the NRC staff adopted the 1996 LR
19 GEIS's conclusion of SMALL for Monticello initial license renewal. Below, the NRC staff
20 analyzes this issue site-specifically for the SLR term, in accordance with CLI-22-02 and
21 CLI-22-03 (NRC 2022-TN8182, NRC 2022-TN9844).

22 With respect to dissolved oxygen, Monticello's NPDES permit requires that Xcel Energy monitor
23 dissolved oxygen levels. The NRC staff reviewed Xcel Energy's biennial monitoring reports from
24 1995–2021. These reports indicate that there have not been any significant changes to the
25 water quality in cooling water discharges during this period. If the MDNR were to determine that
26 dissolved oxygen levels in Monticello's thermal discharge were of concern, it could impose limits
27 in a future renewed NPDES permit in accordance with CWA Section 316(a) requirements to
28 ensure that a balanced, indigenous population of fish and shellfish is maintained in the reach of
29 the river near Monticello. Additionally, as discussed in Section 3.7.2.1, Xcel Energy's annual
30 electrofishing and seining surveys indicate that the local fish populations are healthy and
31 diverse, and sampling indicates no major upward or downward trends in juvenile or adult fish
32 populations. For this reason, the NRC staff concludes that Monticello operations are not
33 affecting dissolved oxygen in the Mississippi River to an extent that is causing measurable
34 changes in local fish populations. Because SLR would continue current operating conditions
35 and because the site's NPDES permit would continue to require Xcel Energy to monitor
36 dissolved oxygen, reduced dissolved oxygen resulting from Monticello's thermal effluent is not
37 expected to be of concern during the SLR period.

38 With respect to gas supersaturation, Xcel Energy has not reported any instances of
39 gas-supersaturation-related fish kills at Monticello or any other information indicating that fish
40 may have experienced symptoms of gas bubble disease (Xcel 2023-TN9084). As described
41 above, gas supersaturation has only been reported at one nuclear power plant that is no longer
42 in service.

43 With respect to eutrophication, this is not a concern at Monticello since it lies along a
44 free-flowing section of the Mississippi River with swift currents and rapids. As discussed
45 previously in this section, eutrophication occurs in slow-flowing or stagnant ecosystems, such as
46 lakes and reservoirs.

1 In conclusion, the effects of cooling water discharge on dissolved oxygen, gas supersaturation,
2 and eutrophication during Monticello operations are minor. The SLR would continue current
3 operating conditions and environmental stressors rather than introduce wholly new impacts.
4 Therefore, the impacts of current operations and SLR on aquatic resources would be similar.
5 For these reasons, these effects would be minor and would neither destabilize nor noticeably
6 alter any important attribute of aquatic ecosystems during the SLR term. The NRC staff
7 concludes that the impacts of cooling water discharge on dissolved oxygen, gas
8 supersaturation, and eutrophication during the Monticello SLR term would be SMALL.

9 3.7.2.6 *Effects of Nonradiological Contaminants on Aquatic Organisms*

10 This issue concerns the potential effects of nonradiological contaminants on aquatic organisms
11 that could occur from nuclear power plant operations. This issue initially became a concern
12 because some nuclear power plants used heavy metals in condenser tubing that could leach
13 from the tubing and expose aquatic organisms to these contaminants. Because aquatic
14 organisms can bioaccumulate heavy metals, even when exposed at low levels, this can be toxic
15 to fish and other animals that consume contaminated organisms. Section 3.9.2 of the 2013
16 LR GEIS (NRC 2013-TN2654) describes instances in which copper contamination was an issue
17 at operating nuclear power plants. Heavy metals have not been found to be of concern other
18 than in these few instances. In all cases, the nuclear power plants eliminated leaching by
19 replacing the affected piping, and these changes were implemented during the initial operating
20 license terms. The NRC staff has not identified this issue to be of concern during any license
21 renewal reviews to date.

22 The 1996 LR GEIS (NRC 1996-TN288) and the 2013 LR GEIS (NRC 2013-TN2654) concluded
23 that the effects of nonradiological contaminants on aquatic organisms were a Category 1 issued
24 and would be SMALL during the initial license renewal term. In the 2006 Monticello LR SEIS
25 (NRC 2006-TN7315), NRC staff did not identify any nonradiological contamination impacts
26 beyond what was discussed in the 1996 LR GEIS (NRC 1996-TN288). Below, the NRC
27 staff analyzes this issue site-specifically for the SLR term, in accordance with CLI-22-02 and
28 CLI-22-03 (NRC 2022-TN8182, NRC 2022-TN9844).

29 With respect to heavy metals, Monticello has stainless steel condenser tubes that do not leach
30 metals to the cooling water discharge (Xcel 2023-TN9084).

31 With respect to nonradiological contaminants in effluent discharges, the MPCA regulates these
32 discharges through Monticello's NPDES permit (MPCA 2023-TN9401). For instance, the
33 NPDES permit authorizes Xcel Energy to use chloride and bromine biocides to control
34 biofouling in the cooling water system and specifies the conditions for doing so (e.g.,
35 dechlorination has to occur prior to discharging the treated water). During the proposed SLR
36 term, the MPCA would continue to regulate nonradiological contaminants through the NPDES
37 permit and could impose additional conditions and requirements if it identifies any concerns
38 regarding Monticello's effluent discharges in the future.

39 To prevent pollution from stormwater or chemicals spills from entering the Mississippi River,
40 Xcel Energy maintains a SWPPP, a spill prevention, control, and countermeasure (SPCC) plan,
41 a hazardous substance spill contingency plan, a chemical control program. In accordance with
42 these plans, Xcel Energy reports spills to the MPCA (Xcel 2023-TN9084). The NRC staff
43 reviewed records related to these plans as part of its environmental review. During the period of
44 2019 through 2022, Xcel Energy reported no chemical spills.

1 SLR would continue current operating conditions and environmental stressors rather than
2 introduce wholly new impacts. Therefore, the impacts of current operations and SLR would be
3 similar. For these reasons, the effects of nonradiological contaminants on aquatic organisms
4 would be minor and would neither destabilize nor noticeably alter any important attribute of the
5 aquatic environment during the SLR term. The NRC staff concludes that the effects of
6 nonradiological contaminants on aquatic organisms during the Monticello SLR term would be
7 SMALL.

8 3.7.2.7 *Exposure of Aquatic Organisms to Radionuclides*

9 This issue concerns the potential impacts on aquatic organisms from exposure to radionuclides
10 from routine radiological effluent releases. During normal operations, nuclear power plants can
11 release gaseous emissions that deposit small amounts of radioactive particulates in the
12 surrounding environment. Gaseous emissions typically include krypton, xenon, and argon
13 (which may or may not be radioactive), tritium, isotopes of iodine, and cesium. Emissions may
14 also include strontium, cobalt, and chromium. Radionuclides also may be released into water as
15 liquid effluent. Aquatic plants can absorb radionuclides that enter shallow groundwater or
16 surface waters through their roots. Aquatic animals can be exposed externally to ionizing
17 radiation from radionuclides in water, sediment, and other biota and can be exposed internally
18 through ingested food, water, and sediment and absorption through the integument and
19 respiratory organs.

20 The 1996 LR GEIS (NRC 1996-TN288) did not address this issue. In 2007, the International
21 Commission on Radiation Protection (ICRP) issued revised recommendations for a system of
22 protection to control exposure from radiation sources (ICRP 2007-TN422). The
23 recommendations included a section about the protection of the environment in which the ICRP
24 found that a clearer framework for assessing nonhuman organisms was warranted. The ICRP
25 indicated that it would develop a set of reference animals and plants as the basis for relating
26 exposure to dose, and dose to radiation effects, for different types of organisms. This
27 information would then provide a basis from which agencies and responsible organizations
28 could make policy and management decisions. Subsequently, the ICRP developed and
29 published a set of 12 reference animals and plants (ICRP 2008-TN7530, ICRP 2009-TN7531).
30 They include a large and small terrestrial mammal, an aquatic bird, and a large and small
31 terrestrial plant, among others. The ICRP also issues publications and information related to
32 radiological effects and radiosensitivity in non-human biota (Adam-Guillermin et al. 2018-
33 TN7972).

34 In 2009, following the NRC staff's review of the ICRP's 2007 recommendations, the
35 Commission found that there is no evidence that NRC's current set of radiation protection
36 controls is not protective of the environment (NRC 2009-TN6651). For this reason, the
37 Commission determined that the NRC staff should not develop separate radiation protection
38 regulations for plant and animal species (NRC 2009-TN6651). The Commission charged the
39 NRC staff with continuing to monitoring international developments on this issue and to keep the
40 Commission informed of any such developments. Nonetheless, the NRC addressed radiological
41 exposure of nonhuman organisms in the 2013 LR GEIS (NRC 2013-TN2654) due to public
42 concern about these impacts at some nuclear power plants.

43 In the 2013 LR GEIS, the NRC staff adopted DOE's standard on a graded approach for
44 evaluating radiation doses to terrestrial and aquatic biota (DOE 2019-TN6817). The DOE
45 standard provides methods, models and guidance that can be used to characterize radiation
46 doses to terrestrial and aquatic biota exposed to radioactive material (DOE 2019-TN6817).

1 The following DOE guidance dose rates are the levels below which no adverse effects to
2 resident populations are expected:

- 3 • riparian animal (0.1 radiation-absorbed dose per day [rad/d]; 0.001 gray per day [Gy/d])
- 4 • terrestrial animal (0.1 rad/d) (0.001 Gy/d)
- 5 • terrestrial plant (1 rad/d) (0.01 Gy/d)
- 6 • aquatic animal (1 rad/d) (0.01 Gy/d)

7 Previously, in 1992, the International Atomic Energy Agency (IAEA 1992-TN712) also
8 concluded that chronic dose rates of 0.1 rad/d (0.001 Gy/d) or less do not appear to cause
9 observable changes in terrestrial animal populations. The United Nations Scientific Committee
10 on the Effects of Atomic Radiation concluded in 1996 and re-affirmed in 2008 that chronic dose
11 rates of less than 0.1 mGy/hr (0.24 rad/d or 0.0024 Gy/d) to the most highly exposed individuals
12 would be unlikely to have significant effects on most terrestrial communities (UNSCEAR 2010-
13 TN7974).

14 In the 2013 LR GEIS, the NRC staff estimated the total radiological dose that the four
15 non-human receptors listed above (i.e., riparian animal, terrestrial animal, terrestrial plant, and
16 aquatic animal) would be expected to receive during normal nuclear power plant operations
17 based on plant-specific radionuclide concentrations in water, sediment, and soils at 15 operating
18 nuclear power plants using Argonne National Laboratory's RESRAD-BIOTA dose evaluation
19 model. The NRC staff found that total calculated dose rates for aquatic animals at all 15 plants
20 were all less than 0.2 rad/d (0.002 Gy/d), which is less than the guideline value of 1 rad/d
21 (0.01 Gy/d). As a result, the NRC staff anticipated in the 2013 LR GEIS that normal operations
22 of these facilities would not result in negative effects on terrestrial biota. The 2013 LR GEIS
23 concluded that the impact of radionuclides on terrestrial biota from past operations would be
24 SMALL for all nuclear plants and would not be expected to change appreciably during the initial
25 license renewal period.

26 The NRC staff did not specifically evaluate the exposure of aquatic organisms to radionuclides
27 during the initial license renewal period in the 2006 Monticello LR SEIS (NRC 2006-TN7315) as
28 the issue was not addressed in the 1996 LR GEIS. However, as explained above, the 2013
29 LR GEIS later addressed this issue generically for initial license renewal of all nuclear power
30 plants and concluded that impacts would be SMALL. Below, the NRC staff analyzes this issue
31 site-specifically for the SLR term, in accordance with CLI-22-02 and CLI-22-03 (NRC 2022-
32 TN8182, NRC 2022-TN9844).

33 The NRC requires nuclear power plants to maintain a REMP through its regulations at 10 CFR
34 Part 50, Appendix I (TN249), 10 CFR Part 20 (TN283), and 10 CFR Part 72 (TN4884), and
35 through plant-specific technical specifications (see Section 3.13 for more detail). These
36 collectively require that licensees establish and implement a REMP to obtain data on
37 measurable levels of radiation and radioactive material. The NRC provides guidance to
38 licensees on acceptance methods for establishing and conducting REMPs in Regulatory
39 Guide 4.1 (NRC 2009-TN3802).

40 Xcel Energy's REMP measures the aquatic, terrestrial, and atmospheric environment for
41 ambient radiation and radioactivity (links to REMP reports are provided below). Monitoring is
42 conducted for the following: direct radiation, air, well water, river water, surface water, food
43 products and vegetation (such as edible broad leaf vegetation), fish tissue, shoreline sediment.
44 The REMP also measures background radiation (i.e., cosmic sources, global fallout, and
45 naturally occurring radioactive material, including radon. For aquatic testing, Xcel Energy

1 obtains samples from fish tissue (smallmouth bass and shorthead redhorse), river water, and
2 river sediments at locations below Monticello to evaluate potential radiological contamination
3 and they also collect samples at upriver sites that serve as controls.

4 As part of its environmental review, the NRC staff reviewed the past 5 years of REMP reports
5 from 2018–2022 that Xcel Energy calls their Annual Radiological Environmental Operating
6 Reports (Xcel 2019-TN9621, Xcel 2020-TN9612, Xcel 2021-TN9613, Xcel 2022-TN9614, Xcel
7 2023-TN9615). A 5-year period provides a dataset that covers a broad range of activities that
8 occur at a nuclear power plant, such as refueling outages, routine operation, and maintenance
9 that can affect the generation and release of radioactive effluents into the environment. During
10 this period, all samples were below reportable limits for radionuclides in environmental samples.
11 Although the fish tissue samples did detect potassium-40 (e.g., 3.43 ± 0.13 pCi/g wet weight for
12 the four downstream samples in 2022), this is a common radioisotope that is naturally found in
13 nature and is not attributed to Monticello operations. Furthermore, the data from the 2018–2022
14 REMP reports consistently shows that the readings of potassium-40 are at similar levels in fish
15 tissue samples at the downriver and upriver sample sites.

16 NRC regulations require nuclear power plants to monitor radiation in the environment and to
17 report the results of such monitoring to the NRC through a REMP. REMP monitoring
18 demonstrates that levels of radiation are below regulatory limits. To date, Xcel Energy has not
19 detected levels of radioactivity attributable to Monticello operations that would result in
20 measurable radiological impacts on aquatic organisms.

21 2022 Tritium Leak

22 Section 3.5.2.3 describes the 2022 tritium release to groundwater that was due to a rupture of a
23 CRD suction pipe. In summary, Xcel Energy notified the State of Minnesota and the NRC on
24 November 23, 2022, that a tritium sample result for an onsite monitoring well was above the
25 ODCM and NEI Groundwater Protection Initiative reporting levels. In January 2023, after
26 identifying the leak, Xcel Energy implemented a recovery system for the contaminated
27 groundwater (i.e., effluent was directed to holding tanks, waste process systems, and/or reused
28 on site). In March 2023, Xcel Energy replaced the ruptured pipe. In May 2023, Xcel Energy
29 identified a second tritium leak that it attributed to a spill from a groundwater holding tank that
30 was being used for the remediation efforts. This spill was released back into the area where
31 remediation pumping was occurring, and Xcel Energy identified no health or safety concerns.

32 Section 3.5.2.3 describes Xcel Energy's remediation response for the tritium leak. In summary,
33 Xcel Energy has already added new groundwater monitoring wells and built a holding pond to
34 store the contaminated groundwater. Xcel Energy is also planning to build a sheet pile
35 containment structure to reduce groundwater flows into the Mississippi River. Xcel Energy has
36 also started to drill five gradient control wells that will help keep groundwater levels below the
37 top of the sheet pile containment structure to further reduce spread into the Mississippi River.

38 Minor concentrations (>100 pCi/L) of tritium were measured in river samples in March and April
39 2023. Further sampling, up until August 2023, has not identified tritium above detection limits in
40 the river. The NRC staff does not expect these low concentrations of tritium in the Mississippi
41 River to negatively impact aquatic resources. If such a spill were to occur during the SLR term,
42 the NRC staff expects that Xcel Energy would take appropriate action, as it has in this case, to
43 mitigate and resolve the issue, in accordance with all relevant State and NRC requirements.

1 Conclusion

2 In summary, NRC regulations require nuclear power plants to monitor radiation in the
3 environment and to report the results of such monitoring to the NRC through a REMP. REMP
4 monitoring ensures that levels of radiation are below regulatory limits and that any changes in
5 radionuclide concentrations are detected and addressed. To date, Xcel Energy has not detected
6 levels of radioactivity attributable to Monticello operations that would result in measurable
7 radiological impacts on aquatic organisms. SLR would continue current operating conditions
8 and environmental stressors rather than introduce wholly new impacts. For these reasons,
9 radiological impacts would be minor and would neither destabilize nor noticeably alter any
10 important attribute of the aquatic environment during the SLR term. The NRC staff concludes
11 that exposure of aquatic organisms to radionuclides during the Monticello SLR term would be
12 SMALL.

13 3.7.2.8 *Effects of Dredging on Aquatic Organisms*

14 This issue concerns the effects of dredging at nuclear power plants on aquatic resources.
15 Small-particle sediment, such as sand and silt, that enters water bodies through erosion can
16 subsequently deposit and accumulate along shorelines and in shallow water areas. If sediment
17 deposition affects cooling system function or reliability, a nuclear power plant may need to
18 periodically dredge to improve intake flow and keep the area clear of sediment. Nuclear power
19 plants where dredging may be necessary are typically located along fast-flowing waters with
20 sandy or silty bottoms, such as large rivers or the ocean. In some instances, dredging may be
21 performed to maintain barge slips for transport of materials and waste to and from the site.
22 Dredging entails excavating a layer of sediment from the affected areas and transporting that
23 sediment to onshore or offshore areas for disposal. The three main types of dredges are
24 mechanical dredges, hydraulic dredges, and airlift dredges. The selection of dredge type
25 generally is related to the sediment type, the size of the area to be dredged, and the aquatic
26 resources present.

27 Dredging results in the direct removal of soft bottom substrates along with in faunal and
28 epifaunal organisms of limited mobility inhabiting those substrates. Small organisms living within
29 and on the affected sediments are likely to be killed in the process. Smaller benthic
30 invertebrates, such as mollusks and crustaceans, may also be susceptible to entrainment into
31 the dredge head. Larger benthic individuals or those that are farther from the dredge head could
32 move away from the suction flow field to avoid being entrained. Thus, dredging can be expected
33 to cause short-term reductions in the biomass of benthic organisms. Dredging also creates
34 sediment plumes that increase water turbidity, which can adversely affect aquatic biota and
35 create short-term decreases in habitat quality during and after dredging. Turbidity primarily
36 affects liquid-breathing organisms, such as fish and shellfish, as well as aquatic plants, because
37 turbid conditions typically decrease photosynthetic capabilities. Turbidity levels associated with
38 the sediment plumes of cutterhead dredges typically range from 11.5 to 282.0 milligrams per
39 liter (mg/L) with decreasing concentrations at greater distances from the dredge head
40 (Nightingale and Simenstad 2001-TN7538). Studies of benthic community recovery following
41 dredging indicate that species abundance and diversity can recover within several years of
42 dredging (Michel et al. 2013-TN7838). Specifically, within temperate, shallow water regions
43 containing a combination of sand, silt, or clay substrate, benthic communities can recover in 1 to
44 11 months, according to studies reviewed by Wilber et al. (2006-TN7563). Recovery of benthic
45 communities following dredging also tends to be faster in areas exposed to periodic
46 disturbances, such as tidally influenced habitats (Diaz 1994-TN7773).

1 Sediments may be contaminated with a variety of pollutants from agricultural runoff and
2 stormwater runoff from impervious surfaces. These pollutants can also be introduced to
3 waterways from point sources, such as combined sewer overflows, municipal and industrial
4 discharges, and spills. Contaminants that have accumulated in buried layers of sediment are
5 often less readily bioavailable or less chemically active (EPA 2004-TN7739). Depending on the
6 concentrations of specific contaminants in accumulated sediments, dredging could increase the
7 bioavailability of those contaminants if they are resuspended in the water column (Petersen
8 et al. 1997-TN7740; Su et al. 2002-TN7742; EPA 2004-TN7739).

9 The 2013 LR GEIS (NRC 2013-TN2654) analyzed the effects of dredging on aquatic organisms
10 and concluded that the effects of this issue would be SMALL during the initial license renewal
11 term for all nuclear power plants. The 1996 LR GEIS did not address this issue and it was,
12 therefore, not specifically analyzed in the 2006 Monticello LR SEIS (NRC 2006-TN7315). Below,
13 the NRC staff analyzes this issue site-specifically for the SLR term, in accordance with
14 CLI-22-02 and CLI-22-03 (NRC 2022-TN8182, NRC 2022-TN9844).

15 Xcel Energy conducts periodic hydraulic and mechanical dredging to remove sediment from the
16 traveling screen bays, service water bays, and intake bay (Xcel 2023-TN9084). Dredging
17 typically removes up to 600 yd³ (459 m³) of sediment from the intake bay every 2 years and
18 350 yd³ (459 m³) of sediment from the joint bay for traveling screens and service water every
19 12 to 18 months. Xcel Energy dewateres and transports all dredged material inland to the Sherco
20 Power Plant, which is located approximately 3.9 mi (6.3 km) northwest of Monticello. Xcel
21 Energy uses the dredged material for fill purposes at this site. Xcel Energy routes water from the
22 dewatering process to the cooling tower basin. This water eventually reenters the Mississippi
23 River via the discharge canal. Xcel Energy anticipates that it will conduct periodic maintenance
24 dredging during the SLR period at a similar rate as it does currently (Xcel 2023-TN9084). Most
25 recently, Xcel Energy conducted dredging in 2022, which was authorized under a U.S. Army
26 Corps of Engineers Nationwide permit under CWA Section 404 and an MDNR dredging permit
27 (1967-0743) (Xcel 2023-TN9084). Additionally, the NPDES permit contains reporting
28 requirements for contaminants in dredge sediments. Taken together, these permits ensure that
29 Xcel Energy takes steps to minimize the impacts of dredging on the aquatic environment.

30 The proposed SLR would continue current operating conditions and environmental stressors
31 rather than introduce wholly new impacts. Therefore, the impacts of current operations and SLR
32 on would be similar. The NRC staff assumes that Xcel Energy would continue to implement site
33 environmental procedures and would obtain any necessary permits for dredging activities.
34 Implementation of such controls would further reduce or mitigate potential effects. For these
35 reasons, the effects of dredging on aquatic resources would be minor and would neither
36 destabilize nor noticeably alter any important attribute of aquatic resources during the SLR term.
37 The NRC staff concludes that the impacts of dredging on aquatic resources during the
38 Monticello SLR term would be SMALL.

39 *3.7.2.9 Water Use Conflicts with Aquatic Resources (Plants with Cooling Ponds or Cooling
40 Towers Using Makeup Water from a River)*

41 Water use conflicts occur when the amount of water needed to support aquatic resources is
42 diminished as a result of demand for agricultural, municipal, or industrial use or decreased water
43 availability due to droughts, or a combination of these factors.

44 In the 2006 Monticello LR SEIS (NRC 2006-TN7315), the NRC staff evaluated “water use
45 conflicts (plants with cooling towers and cooling ponds using make-up water from a small river

1 with low flow)” as a surface water quantity issue and included impacts on ecological resources,
2 including aquatic communities. The NRC staff determined that impacts of water use conflicts
3 would be SMALL during the initial license renewal term (i.e., 2010–2030). In 2013, the NRC
4 issued Revision 1 of the LR GEIS (NRC 2013-TN2654) and separated out ecological impacts
5 from surface water, expanded the issue to include cooling towers, and titled the issue “water
6 use conflicts with aquatic resources (plants with cooling ponds or cooling towers using makeup
7 water from a river)”. This section of the EIS evaluates water use conflicts as they apply to
8 continued operation of Monticello during the proposed subsequent license renewal term
9 (i.e., 2030–2050).

10 Section 3.5.3.1 describes surface water use conflicts that also apply to aquatic resources. In
11 summary, surface water appropriations are managed by the MDNR through the Surface Water
12 Appropriation Permit, which is designed to be protective of aquatic and terrestrial life in
13 accordance with Minnesota Clean Water Quality Standards. When river flows are above 860 cfs
14 (24.4 m³/s), a maximum of 645 cfs (18.2 m³/s) may be appropriated for cooling purposes. When
15 river flows are between 240 and 860 cfs (6.7 and 24.4 m³/s), the maximum water appropriation
16 is 75 percent, and cooling towers may be required to stay within surface water appropriations
17 and NPDES temperature limits. To date, Xcel Energy has not needed to operate in closed cycle
18 mode, and it has only been required to operate in partial recirculation mode on two occasions.
19 Xcel Energy can also use the cooling towers as needed on a voluntary basis, and it has done
20 this about 130 to 150 days per year on average.

21 The NRC staff also analyzed surface water conflicts in Section 3.5.3.1. The NRC staff did this
22 by evaluating the percentage of Mississippi River flows that are permanently removed from the
23 river due to Monticello operations (e.g., evaporative loss from cooling towers). The NRC staff
24 estimated that less than 1 percent of the Mississippi River flows are permanently removed in an
25 average year. The NRC staff also estimated that consumptive water use would represent
26 approximately 8 percent of the 6-day river flow during periods of extreme low flows in the past
27 25 years of record (1998–2023). These extreme low flows were from a period of six consecutive
28 days from August 15 to August 20, 2021. The average flow during these six days was 650 cfs
29 (18.4 m³/s) and this was the only time that flows had dropped below the 860 cfs (24.4 m³/s)
30 threshold from the Surface Water Appropriation Permit that triggers more restrictive water
31 appropriations (i.e., appropriations shall not exceed 75 percent of flows).

32 In Section 3.5.3.1, the NRC staff concluded that surface water use conflicts would be SMALL
33 due to the Surface Water Appropriation Permit, the permit conditions that can require use of
34 cooling towers to stay within the water appropriations, and because Monticello operations only
35 permanently remove a small portion of Mississippi River flows during an average year (less than
36 1 percent) and during extreme lows (approximately 8 percent). Thus, a high percentage (92 to
37 99 percent) of Mississippi River flows would remain in the river even during extreme low flows,
38 which would preserve aquatic habitats and aquatic resources.

39 The proposed SLR would continue current operating conditions and environmental stressors
40 rather than introduce wholly new impacts. Therefore, the impacts of current operations and SLR
41 on this resource category would be similar. For the reasons explained in this section, water use
42 conflicts with aquatic resources would either not occur from SLR or would be so minor that the
43 effects on aquatic resources would be undetectable. The NRC staff concludes that water use
44 conflicts with aquatic resources during the Monticello SLR term would be SMALL.

1 3.7.2.10 *Effects on Aquatic Resources (Non-Cooling System Impacts)*

2 This issue concerns the effects of nuclear power plant operations on aquatic resources during
3 SLR that are unrelated to operation of the cooling system. Such activities include landscape and
4 grounds maintenance, stormwater management, and ground-disturbing activities that could
5 directly disturb aquatic habitat or cause runoff or sedimentation. These impacts are expected to
6 be like past and ongoing impacts that aquatic resources are already experiencing at the nuclear
7 power plant site.

8 The 1996 LR GEIS (NRC 1996-TN288) and the 2013 LR GEIS (NRC 2013-TN2654) concluded
9 that the non-cooling system impacts on aquatic resources would be SMALL during the initial
10 license renewal term. In the 1996 LR GEIS, the NRC evaluated the impacts of refurbishment on
11 aquatic resources. In the 2013 LR GEIS, the NRC expanded this issue to include impacts of
12 other site activities, unrelated to cooling system operation, that may affect aquatic resources. In
13 the 2006 Monticello LR SEIS (NRC 2006-TN7315), the NRC staff found no new and significant
14 information concerning this issue and the NRC staff adopted the 1996 LR GEIS's conclusion of
15 SMALL for Monticello initial license renewal. Below, the NRC staff analyzes this issue
16 site-specifically for the SLR term, in accordance with CLI-22-02 and CLI-22-03 (NRC 2022-
17 TN8182, NRC 2022-TN9844).

18 Within the Monticello site, the Mississippi River is the only aquatic feature. As explained in
19 Section 3.6.4.2, environmental impacts from landscape maintenance, ground disturbing
20 activities, and other operational activities would be minimized because Xcel Energy maintains a
21 site excavation and trenching controls procedure for any ground disturbance greater than 6 in.
22 (15 cm). As part of this procedure, if personnel identify the potential for impacts to ecological
23 resources, Xcel Energy may be required to seek an environmental review by MPCA. However,
24 Xcel Energy does not plan on any ground disturbing activities in natural areas during the
25 proposed SLR term (Xcel 2023-TN9084).

26 With respect to stormwater management, stormwater runoff from impervious surfaces can
27 change the frequency or duration of inundation and soil infiltration within wetlands and
28 neighboring habitats. Effects of stormwater runoff may include erosion, altered hydrology,
29 sedimentation, and other changes in plant community characteristics. Runoff may contain
30 sediments, contaminants and oils from road or parking surfaces, or herbicides. At Monticello,
31 stormwater from the plant yard is collected and discharged to the Mississippi River through
32 NPDES-permitted outfalls SD006 and SD007 (Xcel 2023-TN9578).¹¹ Xcel Energy maintains a
33 SWPPP, which identifies potential sources of contamination that could affect stormwater
34 discharges and specifies BMPs that Xcel Energy uses to minimize the impacts of stormwater
35 discharges (Xcel 2023-TN9084). Monticello also maintains a spill prevention control and
36 countermeasure (SPCC) plan and hazardous substance spill contingency plan to further reduce
37 pollutants in stormwater discharges. Collectively, these measures ensure that the effects to
38 aquatic resources from pollutants carried by stormwater would be minimized during the SLR
39 term.

40 SLR would continue current operating conditions and environmental stressors rather than
41 introduce wholly new impacts. Therefore, the impacts of current operations and SLR on aquatic
42 resources would be similar. For these reasons, the non-cooling system impacts on aquatic
43 resources would be minor and would neither destabilize nor noticeably alter any important

¹¹ Xcel Energy 2023. Enclosure 24 Attachment 13, Final NPDES/SDS Permit, Monticello Nuclear Generating Facility. Enclosure 24 in Xcel 2023-TN9578, page 901.

1 attribute of aquatic resources during the SLR term. The NRC staff concludes that the
2 non-cooling system impacts on aquatic resources during the Monticello SLR term would be
3 SMALL.

4 *3.7.2.11 Impacts of Transmission Line Right-of-Way Management on Aquatic Resources*

5 This issue concerns the effects of transmission line ROW management on aquatic plants and
6 animals. Transmission line management can directly disturb aquatic habitats if ROWs traverse
7 aquatic features and heavy machinery is used in these areas. Heavy equipment can also
8 compact soils, which can affect soil quality and reduce infiltration to shallow groundwater,
9 resulting in runoff and erosion in nearby aquatic habitats. Chemical herbicides applied in ROWs
10 can be transported to nearby aquatic habitats through precipitation and runoff. For small
11 streams, trees may grow sufficiently between cutting cycles to provide shading and support
12 microhabitats. Tree removal to maintain appropriate transmission line clearance could alter the
13 suitability of habitats for fish and other aquatic organisms and locally increase water
14 temperatures.

15 The 2013 LR GEIS (NRC 2013-TN2654) concluded that the impacts of transmission line ROW
16 management on aquatic resources would be SMALL during the initial license renewal term. The
17 1996 LR GEIS did not address this issue and it was, therefore, not specifically analyzed in the
18 2006 Monticello LR SEIS (NRC 2006-TN7315). Below, the NRC staff analyzes this issue site-
19 specifically for the SLR term, in accordance with CLI-22-02 and CLI-22-03 (NRC 2022-TN8182,
20 NRC 2022-TN9844).

21 In-scope transmission lines are described in Section 2.1.6. These transmission lines mainly
22 cross industrial areas and some small patches of terrestrial vegetation on the site, but do not
23 cross any water bodies or aquatic features (Xcel 2023-TN9084). Therefore, maintenance of
24 these lines has no discernable effect on aquatic resources.

25 The SLR would continue current operating conditions and environmental stressors rather than
26 introduce entirely new impacts. Therefore, the impacts of current operations and SLR would be
27 similar. For these reasons, the effects of transmission line ROW maintenance on aquatic
28 resources would be minor and would neither destabilize nor noticeably alter any important
29 attribute of plant or animal populations during the SLR term. The NRC staff concludes that the
30 impacts of transmission line ROW maintenance on aquatic resources during the Monticello SLR
31 term would be SMALL.

32 *3.7.2.12 Losses from Predation, Parasitism, and Disease Among Organisms Exposed to*
33 *Sublethal Stresses*

34 This issue concerns the effects of nuclear power plant operation that can increase aquatic
35 organisms' susceptibility to predation, parasitism, and disease. Such sublethal effects can result
36 from impingement, if an organism is subsequently returned to the source waterbody, as well as
37 from exposure to thermal effluents. This issue does not apply to entrainment. Because
38 entrainable organisms generally consist of fragile life stages, all entrained organisms are
39 assumed to die (79 FR 48300-TN4488) and would, therefore, not survive entrainment to
40 subsequently experience sublethal effects.

41 The 1996 LR GEIS (NRC 1996-TN288) and the 2013 LR GEIS (NRC 2013-TN2654) concluded
42 that the losses from predation, parasitism, and disease among organisms exposed to sublethal
43 stresses would be SMALL during the initial license renewal term. In the 2006 Monticello

1 LR SEIS (NRC 2006-TN7315), the NRC staff found no new and significant information
2 concerning this issue, and the NRC staff adopted the 1996 LR GEIS's conclusion of SMALL for
3 Monticello initial license renewal. Below, the NRC staff analyzes this issue site-specifically for
4 the SLR term, in accordance with CLI-22-02 and CLI-22-03 (NRC 2022-TN8182, NRC 2022-
5 TN9844.

6 Sublethal Effects of Impingement

7 The regulations in the EPA's 2014 CWA Section 316(b) establish BTA standards for
8 impingement mortality. Impingement mortality considers the survival rate of impinged
9 organisms, rather than simply the total number of organisms impinged. Survival studies typically
10 consider latent mortality associated with stunning, disorientation, or injury. Such effects can
11 result from the injury itself or from increased susceptibility to predation, parasitism, or disease
12 that results from the sublethal effects of impingement. As explained in Section 3.7.2.1, the
13 Monticello intake system includes a fish return system and Xcel Energy has no plans to alter the
14 design or function of the cooling system under the proposed action. Latent mortality and other
15 sublethal effects that impinged fish may experience have not specifically been studied.

16 Sublethal Effects of Thermal Effluents

17 Fish and shellfish that are exposed to the thermal effluent of a nuclear power plant may
18 experience stunning, disorientation, or injury. These sublethal effects can subsequently affect
19 an organism's susceptibility to predation, parasitism, or disease.

20 With respect to susceptibility to predation, laboratory studies of the secondary mortality of fish
21 following exposure to heat or cold shock demonstrate increased susceptibility of these fish to
22 predation; however, field evidence of such effects is often limited to anecdotal information, such
23 as observations of increased feeding activity of seagulls and predatory fish near effluent outfalls
24 (e.g., Cada et al. 1981-TN7733). For example, Barkley and Perrin (1971-TN7734) and Romberg
25 et al. (1974-TN7891) reported increased concentrations of predators feeding on forage fish
26 attracted to thermal plumes. However, these studies did not quantify whether the observed
27 behaviors resulted in population-level effects on prey species.

28 With respect to susceptibility to parasitism and disease, Langford (1983-TN7676) found that the
29 tendency of fish to congregate in heated effluent plumes, the increased physiological stress that
30 higher water temperatures exert on fish, and the ability of some diseases and parasites to
31 proliferate at higher temperatures include all the factors that could contribute to increased rates
32 of disease or parasitism in exposed fish. Some studies have suggested that crowding of fish
33 within the thermal plume, rather than the thermal plume itself, may lead to an increased risk of
34 exposure to infectious diseases (Coutant 1987-TN7736).

35 The 1996 and 2013 LR GEISs reported that neither scientific literature reviews nor consultations
36 with agencies or utilities yielded clear evidence of nuclear power plant operation causing
37 sublethal effects that result in noticeable increases in the susceptibility of exposed organisms to
38 predation, parasitism, or disease. Xcel Energy (Xcel 2023-TN9084) reports no evidence of such
39 effects, and Xcel Energy's continued adherence to the thermal conditions in its NPDES permit
40 described in Section 3.7.2.3 would ensure that such effects would be minimized.

41 SLR would continue current operating conditions and environmental stressors rather than
42 introduce wholly new impacts. Therefore, the impacts of current operations and SLR would be
43 similar. For these reasons, losses from predation, parasitism, and disease among organisms

1 exposed to sublethal stresses would be minor and would neither destabilize nor noticeably alter
2 any important attribute of aquatic populations during the SLR term. The NRC staff concludes
3 that the impacts of losses from predation, parasitism, and disease among organisms exposed to
4 sublethal stresses during the Monticello SLR term would be SMALL.

5 **3.7.3 No-Action Alternative**

6 If Monticello were to cease operating, impacts on the aquatic environment would decrease or
7 stop following reactor shutdown. Some withdrawal of water from the Mississippi River would
8 continue during the shutdown period to provide cooling to spent fuel in the spent fuel pool until
9 that fuel could be transferred to dry storage. The amount of water withdrawn for these purposes
10 would be a small fraction of water withdrawals during operations, would decrease over time, and
11 would likely end within the first several years following shutdown. The reduced demand for
12 cooling water would substantially decrease the effects of impingement, entrainment, and
13 thermal effluent on aquatic organisms, and these effects would entirely cease following the
14 transfer of spent fuel to dry storage. A fish kill from cold shock might happen when the plant
15 stops producing power and heated effluent, but this would be a one-time event that would not
16 negatively impact the sustainability of local fish populations (see Section 3.7.2.4). The NRC staff
17 concludes that the impacts of the no-action alternative on aquatic resources would be SMALL.

18 **3.7.4 Replacement Power Alternatives: Common Impacts**

19 This section describes the common impacts for all three replacement power alternatives
20 described in Sections 3.7.5 through 3.7.7. The renewables (i.e., wind and solar), and battery
21 storage would be built partially on the Monticello site and partially offsite. The small modular
22 nuclear reactors would be built in a different State because Minnesota law (Minnesota Statute
23 216B.243, Subdivision 3b-TN9184) prohibits the construction and operation of new nuclear
24 power plants. The new natural gas plant would likely be built in a different State because
25 Minnesota law (MN Stat. 216B-TN9184) requires that a utility generate, procure sufficient
26 electricity generated from a carbon-free energy technology, or purchase renewable energy
27 credits equivalent to at least 100 percent of the electric utility's total retail sales to retail
28 customers in Minnesota by 2040.

29 Construction impacts for many components of all three replacement power alternatives would
30 be generally similar. Construction could result in aquatic habitat loss, alteration, or
31 fragmentation, disturbance and displacement of aquatic organisms, mortality of aquatic
32 organisms, and increase in human access. For instance, construction-related chemical spills,
33 runoff, and soil erosion could degrade water quality in aquatic environments by introducing
34 pollutants and increasing sedimentation and turbidity. Dredging and other in-water work could
35 directly remove or alter the aquatic environment and disturb or kill aquatic organisms. Because
36 construction effects would be short-term, associated habitat degradation would be relatively
37 localized and temporary. Effects could be minimized by the use of existing infrastructure, such
38 as the existing transmission lines, roads, parking areas, and certain existing buildings and
39 structures on the site. Aquatic habitat alteration and loss could be minimized by siting
40 components of the alternatives farther from waterbodies and away from drainages and other
41 aquatic features.

42 Operational impacts for the alternative would be qualitatively similar but would vary in intensity,
43 based on each alternative's water use and consumption. Natural gas plants are thermoelectric,
44 which means that they need water to produce and cool the steam that drives the turbines. Small
45 modular reactors also require water to produce steam, but use MDCTs to dissipate waste heat.

1 The NRC staff assumes cooling tower impacts, if applicable, would be similar to those of the
2 proposed action. As discussed in Sections 3.7.2.1 and 3.7.2.3 the staff determined that the
3 operations of the cooling towers would result in SMALL impacts on the aquatic environment.

4 Water quality permits required through Federal and State regulations would control, reduce, or
5 mitigate potential effects on the aquatic environment. Through such permits, the permitting
6 agencies could include conditions requiring Xcel Energy to follow BMPs or to take certain
7 mitigation measures if adverse impacts are anticipated. For instance, USACE oversees
8 Section 404 permitting for dredge and fill activities, and State water quality agencies (e.g.,
9 MPCA) oversees NPDES permitting and general stormwater permitting. Xcel Energy would
10 likely be required to obtain each of these permits to construct a new replacement power
11 alternative at the Monticello site or offsite locations. Notably, the EPA final rule under Phase I of
12 the CWA Section 316(b) regulations applies to new facilities and sets standards to limit intake
13 capacity and velocity to minimize impacts on fish and other aquatic organisms in the source
14 water (40 CFR 125.84-TN254). Any new replacement power alternative subject to this rule
15 would be required to comply with the associated technology standards. Water use conflicts
16 would be unlikely because the States also issue water rights permits (e.g., MDNR's Surface
17 Water Appropriation Permit) to comply with State and Federal Clean Water Act standards (e.g.,
18 to be protective of the aquatic and terrestrial environment).

19 **3.7.5 Natural Gas and Renewables Alternative**

20 This alternative would involve the construction and installation of a new 750 MW natural
21 gas-fired, two-unit combustion turbine power plant built either onsite or offsite within Xcel
22 Energy's ROI, 750 MW wind turbines located offsite, and 200 MW of solar panels located both
23 on and offsite (Xcel 2023-TN9084). Existing natural gas-fired power plants operated by Xcel
24 Energy would provide additional power generation.

25 The impacts of construction of new wind, solar, and natural gas of this alternative are discussed
26 in the section that describes common impacts on all alternatives (Section 3.7.4). These effects
27 would be SMALL to MODERATE, depending on the site(s) selected, the aquatic habitats
28 present, and the extent to which construction would degrade, modify, or permanently alter those
29 habitats.

30 The operation of the solar photovoltaic component would have no discernable effects on the
31 aquatic environment. The operation of the wind turbines could produce leaks of hydraulic fluid,
32 antifreeze, and grease, but the impacts would be SMALL since these leaks occur in relatively
33 small amounts and managed by State permitting authorities (e.g., spill response and prevention
34 plans). Impacts of operating a new natural gas power plant would be SMALL because the water
35 withdrawals and discharges would be regulated under the Clean Water Act and applicable State
36 regulations to ensure that impacts to the aquatic environment are minimal. Impacts of the
37 small amount of additional power generation from existing natural gas plants would be SMALL
38 since the water withdrawals and discharges would be managed by the MPCA and MDNR
39 permits or other State agencies if outside of Minnesota.

40 The NRC staff concludes that the impacts on aquatic resources for the natural gas and
41 renewables alternative would be SMALL to MODERATE during construction and SMALL during
42 operation. Impacts from the alternative would be managed and regulated by Federal and State
43 water quality permits.

1 **3.7.6 Renewables and Storage Alternative**

2 This alternative would involve the construction and installation of 950 MW of wind turbines
3 located offsite, 700 MW of solar panels located both on and offsite of Monticello, and 300 MW of
4 lithium battery storage at solar offsite locations. This alternative would be supplemented by
5 purchased power as needed, along with occasional additional power generation from existing
6 natural gas-fired power plants operated by Xcel Energy.

7 The impacts of construction of new wind, solar, and battery storage components of this
8 alternative are discussed in the section that describes common impacts on all alternatives (see
9 Section 3.7.4). These effects would be SMALL to MODERATE, depending on the site(s)
10 selected, the aquatic habitats present, and the extent to which construction would degrade,
11 modify, or permanently alter those habitats.

12 The operation of the solar photovoltaic component would have no discernable effects on the
13 aquatic environment. The operation of the wind turbines could produce leaks of hydraulic fluid,
14 antifreeze, and grease, but the impacts would be SMALL since these leaks occur in relatively
15 small amounts and managed by State permitting authorities (e.g., spill response and prevention
16 plans). Impacts of operating the battery storage systems would be SMALL because these
17 systems are regulated under the Resources Conservation Recovery Act (RCRA) and are stored
18 in liquid-tight containment systems. Impacts of the small amount of additional power generation
19 from existing natural gas plants would be SMALL since the water withdrawals and discharges
20 would be managed by the MPCA and MDNR permits to minimize impacts on the aquatic
21 environment.

22 The NRC staff concludes that the impacts on aquatic resources for the renewables and storage
23 alternative would be SMALL to MODERATE during construction and SMALL during operation.
24 Impacts from the alternative would be managed and regulated by Federal and State water
25 quality permits.

26 **3.7.7 New Nuclear (Small Modular Reactor) Alternative**

27 This alternative would involve the construction of a 12-unit SMR power plant generating
28 approximately 880 MWe power outside of Minnesota. The SMR units would use a closed-cycle
29 cooling system using MDCTs. This alternative would require an estimated 740 gal/MWh of
30 water from natural surface water sources. Total annual water consumption would be
31 approximately 5.7 billion gallons (see Section 2.3.2.3).

32 The types of impacts that the aquatic environment would experience from this alternative would
33 likely be similar to those described in the previous section discussing impacts common to all
34 replacement power alternatives. However, the SMR power plant would be built outside of
35 Minnesota and the existing Monticello infrastructure could not be used. The NRC staff
36 concludes that these effects would be SMALL to MODERATE, depending on the site(s)
37 selected, the aquatic habitats present, and the extent to which construction would degrade,
38 modify, or permanently alter those habitats. Required Federal and State water quality permits
39 would likely include conditions requiring BMPs and mitigation strategies to minimize
40 environmental effects, but there is uncertainty as to where the SMR power plant will be built.

41 With respect to operation, Federal and State water quality permits would control and mitigate
42 many of the potential effects on the aquatic environment, including water withdrawals and
43 discharges, such that the associated effects would be unlikely to noticeably alter or destabilize

1 any important attribute of the aquatic environment. The NRC staff finds that the impacts of
2 operation of a new nuclear (SMR) alternative would be SMALL.

3 The NRC staff concludes that the impacts on aquatic resources from construction and operation
4 of a new nuclear (SMR) alternative would be SMALL to MODERATE.

5 **3.8 Federally Protected Ecological Resources**

6 The NRC must consider the effects of its actions on the ecological resources protected under
7 several Federal statutes and must consult with the FWS or the National Oceanic and
8 Atmospheric Administration prior to acting in cases where an agency action may affect those
9 resources. These statutes include the following:

- 10 • ESA (16 U.S.C. § 1531 et seq.) (TN1010)
- 11 • MSA (16 U.S.C. § 1801 et seq.) (TN1061)
- 12 • National Marine Sanctuaries Act (NMSA) (16 U.S.C. § 1431 et seq.) (TN4482)

13 This section describes the species and habitats that are federally protected under these statutes
14 and analyzes how the proposed LR and alternatives may affect these resources.

15 **3.8.1 Endangered Species Act**

16 Congress enacted the ESA in 1973 to protect and recover imperiled species and the
17 ecosystems upon which they depend. The ESA provides a program for the conservation of
18 endangered and threatened plants and animals (collectively, “listed species”) and the habitats in
19 which they are found. The FWS and National Marine Fisheries Service (NMFS) are the lead
20 Federal agencies for implementing the ESA, and these agencies determine the species that
21 warrant listing. The following sections describe the Monticello action area and the species and
22 habitats that may occur in the action area under each of the Services’ jurisdictions.

23 *3.8.1.1 Endangered Species Act: Action Area*

24 The implementing regulations for Section 7(a)(2) of the ESA define “action area” as all areas
25 affected directly or indirectly by the Federal action and not merely the immediate area involved
26 in the action (50 CFR Part 402-TN4312). The action area effectively bounds the analysis of
27 federally listed species and critical habitats because only species and habitats that occur within
28 the action area may be affected by the Federal action.

29 For the purposes of assessing the potential impacts of the proposed Monticello SLR, the NRC
30 staff considers the action area to consist of the following:

31 Monticello Site: The terrestrial region of the action area consists of 2,051 ac (830 ha) within the
32 Monticello site in Wright and Sherburne Counties, Minnesota (Xcel 2023-TN9084: Table 3.2-1).
33 The site is situated on both sides of the Mississippi River, with most of the site on the south side
34 of the Mississippi River in Wright County. It includes developed land supporting nuclear power
35 plant operations (216 ac [87 ha]), deciduous forest (715 ac [289 ha]), evergreen forest (17 ac
36 [7 ha]), mixed forest (3 ac [1 ha]), shrub/scrub (8 ac [3 ha]), woody wetlands (90 ac [36 ha]),
37 emergent herbaceous wetlands (46 ac [18 ha]), and cultivated lands (640 ac [259 ha]).
38 Sections 3.2 and 3.6 of this EIS describe the developed and natural features of the site and the
39 characteristic vegetation and habitats.

1 Mississippi River: The aquatic region of the action area encompasses the regions of the
 2 Mississippi River affected by cooling water withdrawals and discharges. This includes the
 3 hydraulic zone of influence (HZI), which is the portion of the source waterbody that is
 4 hydraulically affected by water withdrawal by the cooling water intake structure, and the area of
 5 the Mississippi River that experiences increased temperatures from the discharge of heated
 6 effluent. These regions are described in more detail in Section 3.7.1.1 of this EIS.

7 The NRC staff recognizes that, although the described action area is stationary, federally listed
 8 species can move in and out of the action area. For instance, a migratory bird could occur in the
 9 action area seasonally as it forages or breeds within the action area. Thus, in its analysis, the
 10 NRC staff considers not only those species known to occur directly within the action area but
 11 those species that may passively or actively move into the action area. The NRC staff then
 12 considers whether the life history and habitat requirements of each species make it likely to
 13 occur in the action area where it could be affected by the proposed SLR. The following sections
 14 first discuss the listed species and critical habitats under FWS jurisdiction, followed by those
 15 under NMFS jurisdiction.

16 3.8.1.2 *Endangered Species Act: Federally Listed Species and Critical Habitats under U.S.*
 17 *Fish and Wildlife Service Jurisdiction*

18 This section evaluates seven species that may be present in the action area. The NRC staff
 19 determined these species to be relevant to this review based on an analysis of the Monticello
 20 action area, available scientific literature and studies, the results of past ESA Section 7
 21 consultations in connection with the Monticello site, and an official species list generated by the
 22 FWS’s Information for Planning and Conservation (IPaC; FWS 2023-TN9083). No designated or
 23 proposed critical habitat occurs in the action area. Table 3-18 lists each of these species and its
 24 Federal status.

25 **Table 3-18 Federally Listed Species under U.S. Fish and Wildlife Jurisdiction Evaluated**
 26 **for Monticello Nuclear Generating Plant Subsequent License Renewal**

Common Name	Species	Federal Status ^(a)
northern long-eared bat	<i>Myotis septentrionalis</i>	FE
tricolored bat	<i>Perimyotis subflavus</i>	FPE
whooping crane	<i>Grus americana</i>	FE (NEP)
monarch butterfly	<i>Danaus plexippus</i>	FC
Higgins’ eye pearlymussel	<i>Lampsilis higginsii</i>	FE
gray wolf	<i>Canis lupus</i>	FT
rusty patched bumble bee	<i>Bombus affinis</i>	FE

(a) Indicates protection status under the Endangered Species Act. FC = candidate for Federal listing; FE = federally endangered; FPE = proposed for Federal listing as endangered; NEP = in the vicinity of the action area, this species is part of a nonessential experimental population.

27 During the NRC staff’s environmental review for the initial Monticello LR (NRC 2006-TN7315:
 28 Section 4.6), the staff evaluated the effects of Monticello operations on three federally listed
 29 species: the Higgins’ eye pearlymussel (*Lampsilis higginsii*), the gray wolf (*Canis lupus*), and the
 30 bald eagle. In 2005, the NRC (2005-TN9649) prepared a biological assessment for these
 31 species and submitted it to the FWS for concurrence. In its assessment, the staff concluded that
 32 Monticello operations during the initial LR period would have no effect on the Higgins’ eye
 33 pearlymussel or gray wolf. During the initial LR review, the NRC submitted a biological
 34 assessment to the FWS to document its “no effect” findings (NRC 2005-TN9649: Appendix E).

1 The staff based its finding for the Higgins' eye pearl mussel on the facts that (1) the nearest
2 known location of the species is too far downstream of Monticello to be affected by its
3 operations; (2) Monticello thermal discharges are monitored and regulated by the MPCA
4 through the NPDES program to be protective of aquatic biota, which includes fish species that
5 can serve as hosts for mussel glochidia; and (3) no operational changes were planned for the
6 initial LR term. The NRC staff based its finding for the gray wolf on the facts that (1) the species
7 does not occur on the Monticello site or associated transmission lines, (2) no direct land-
8 disturbing activities would occur as part of the initial LR, and (3) plant operations and vegetation
9 maintenance practices on site and within transmission corridors would not be detrimental to the
10 species. The NRC concluded that initial LR was not likely to adversely affect the bald eagle
11 based on the facts that (1) Xcel Energy would follow the MDNR Management Guidelines for
12 Bald Eagle Breeding Areas; (2) the potential for disturbance during nesting/breeding, either from
13 the Monticello site activities or from ROW maintenance, was highly unlikely; and (3) the
14 potential for bald eagle electrocutions and collisions is also highly unlikely. The FWS concurred
15 with the NRC's "not likely to adversely affect" finding for the bald eagle in 2006 (DOI 2006-
16 TN9678). While the bald eagle continues to occur in the area, the FWS has delisted this species
17 from Federal protection under the ESA. The bald eagle remains federally protected under the
18 Bald and Golden Eagle Protection Act, which is discussed in Section 3.6.3.3 of this EIS.

19 In the SLR ER, Xcel Energy evaluated whether rusty patched bumble bee (*Bombus affinis*),
20 which is federally listed as endangered, could occur within the vicinity of the Monticello site
21 (Xcel 2023-TN9084: Section 3.7.8.1.3). According to the FWS model habitat (ESRI 2023-
22 TN9651), the Monticello site and surrounding area are unlikely to support the rusty patched
23 bumble bee. Moreover, the rusty patched bumble bee is not identified as occurring in the action
24 area on the FWS's IPaC official species list (FWS 2023-TN9083)." Therefore, the NRC staff
25 does not consider this species in this EIS.

26 Based on the NRC staff's analysis of the federally listed species and critical habitats under U.S.
27 Fish and Wildlife Service jurisdiction the NRC staff finds that the northern long-eared bat
28 (*Myotis septentrionalis*), tricolored bat (*Perimyotis subflavus*), whooping crane (*Grus*
29 *americana*), and monarch butterfly (*Danaus plexippus*) warrant further consideration to
30 determine if they may occur in the action area. These species are discussed in detail below.

31 Northern Long-Eared Bat

32 The FWS listed the northern long-eared bat as threatened throughout its range in 2015 (80 FR
33 17974-TN4216). In 2016, FWS determined that designating critical habitat for the species was
34 not prudent because such a designation would increase threats to the species resulting from
35 vandalism and disturbances and could potentially increase the spread of white-nose syndrome
36 (81 FR 24707-TN8388). In 2022, the FWS reclassified this species as endangered with an
37 effective date of January 30, 2023 (87 FR 73488-TN8545). Information in this section is
38 organized according to the description of the species in the FWS *Federal Register* notice
39 associated with the final rule to list the species (80 FR 17974-TN4216) and draws from this
40 source unless otherwise indicated.

41 Although there have been few genetic studies on the northern long-eared bat, FWS describes it
42 as a monotypic species (i.e., having no subspecies). This species has been recognized by
43 different common names including Keen's bat, northern Myotis, and the northern bat. The
44 northern long-eared bat is a medium-sized bat that is distinguished from other *Myotis* species by
45 its long ears, which average 0.7 in. (17 mm) in length. Adults weigh 5–8 g (0.2–0.3 oz), and
46 females tend to be slightly larger than males. Individuals are medium to dark brown on the back,

1 dark brown on the ears and wing membranes, and tawny to pale brown on the ventral side.
2 Within its range, the northern long-eared bat can be confused with the little brown bat or the
3 western long-eared myotis (*M. evotis*).

4 The northern long-eared bat is found across much of the eastern and north-central United
5 States and all Canadian provinces from the Atlantic coast west to the southern Northwest
6 Territories and eastern British Columbia. Its range includes 37 U.S. states.

7 Northern long-eared bats predominantly overwinter in hibernacula of various sizes that include
8 underground caves and abandoned mines. Preferred hibernacula have relatively constant, cool
9 temperatures with very high humidity and no air currents. Individuals most often roost in small
10 crevices or cracks in cave or mine walls or ceilings but are also infrequently observed hanging
11 in the open. Less commonly, northern long-eared bats overwinter in abandoned railroad
12 tunnels, storm sewers, aqueducts, attics, and other noncave or nonmine hibernacula with
13 temperature, humidity, and air flow conditions resembling suitable caves and mines.

14 In summer, northern long-eared bats typically roost individually or in colonies underneath bark
15 or in cavities or crevices of both live trees and snags. Males and nonreproductive females may
16 also roost in cooler locations including caves and mines. Individuals have also been observed
17 roosting in colonies in barns and other buildings, on utility poles, and in other human-made
18 structures. The species has been documented to roost in many species of trees, including black
19 oak (*Quercus velutina*), northern red oak (*Q. rubra*), silver maple (*Acer saccharinum*), black
20 locust (*Robinia pseudoacacia*), American beech (*Fagus grandifolia*), sugar maple
21 (*A. saccharum*), sourwood (*Oxydendrum arboreum*), and shortleaf pine (*Pinus echinata*). Foster
22 and Kurta (1999-TN8499) found that, rather than being dependent on particular tree species,
23 northern long-eared bats are likely to use a variety of trees as long as they form suitable cavities
24 or retain bark. Owen et al. (TN8500) found that tree-roosting maternal colonies chose roosting
25 sites in larger trees that were taller than the surrounding stand and in areas with abundant
26 snags. Carter and Feldhamer (TN8501) indicate that resource availability drives roost tree
27 selection more than the actual tree species. However, several studies have shown that the
28 species more often roosts in shade-tolerant deciduous trees than in conifers. Additionally, the
29 FWS concludes in its final listing that the tendency for northern long-eared bats to use healthy
30 live trees for roosting is low.

31 Northern long-eared bats actively form colonies in the summer, but such colonies are often in
32 flux because members will frequently depart to be solitary or to form smaller groups and later
33 return to the main unit. This behavior is described as “fission–fusion,” and it also results in
34 individuals often switching tree roosts (typically every 2–3 days). Roost trees are often near
35 each other within the species’ summer range, with various studies documenting distances
36 between roost trees ranging from 20 ft (6.1 m) to 2.4 mi (3.9 km).

37 Spring staging is the period between winter hibernation and spring migration to summer habitat
38 when bats begin to gradually emerge from hibernation. Individuals will exit the hibernacula to
39 feed but reenter the same or alternative hibernacula to resume periods of physical inactivity.
40 The spring staging period is believed to be short for the northern long-eared bat and may last
41 from mid-March through early May, with variations in timing and duration based on latitude and
42 weather.

43 Fall swarming is the period between the summer and winter seasons and includes behaviors
44 such as copulation, introduction of juveniles to hibernacula, and stopovers at sites between
45 summer and winter regions. Both males and females are present together at swarming sites,

1 and other bat species are often present as well. For northern long-eared bats, the swarming
2 period may occur between July and early October, depending on the latitude within the species'
3 range. Northern long-eared bats may use caves and mines during swarming. Little is known
4 about roost tree selection during this period, but some studies suggest that a wider variation in
5 tree selection may occur during swarming than during the summer.

6 Northern long-eared bats roost in cavities, crevices, and hollows or under the bark of live and
7 dead trees and snags greater than 3 in. (8 cm) in diameter at breast height. Isolated trees may
8 be considered suitable habitats when they exhibit these characteristics and are less than
9 1,000 ft (300 m) from the next nearest suitable roost tree within a wooded area. Northern
10 long-eared bats appear to choose roost trees based on structural suitability rather than
11 exhibiting a preference for specific species of trees.

12 Northern long-eared bats hibernate during winter months. Individuals arrive at hibernacula in
13 August or September, enter hibernation in October and November, and emerge from
14 hibernacula in March or April. The species has shown a high degree of repeated hibernaculum
15 use, although individuals may not return to the same hibernacula in successive seasons.
16 Northern long-eared bats often inhabit hibernacula in small numbers with other bat species
17 including little brown bats, big brown bats (*Eptesicus fuscus*), eastern small-footed bats
18 (*Myotis leibii*), tricolored bats (*Perimyotis subflavus*), and Indiana bats (*M. sodalis*). Northern
19 long-eared bats have been observed moving among hibernacula during the winter hibernation
20 period, but individuals do not feed during this time. The function of this behavior is not well
21 understood.

22 Northern long-eared bats migrate relatively short distances (between 56 and 89 km [35 and
23 55 mi]) from summer roosts and winter hibernacula. The spring migration period typically occurs
24 from mid-March to mid-May, and fall migration typically occurs between mid-August and
25 mid-October.

26 Northern long-eared bats mate from late July in northern regions to early October in southern
27 regions. Hibernating females store sperm until spring, and ovulation takes place when females
28 emerge from hibernacula. Gestation is estimated to be 60 days, after which time females give
29 birth to a single pup in late May or early June. Females raise their young in maternity colonies,
30 which generally consist of 30–60 individuals (females and young). Roost tree selection changes
31 depending on the reproductive stage, with lactating females roosting higher in tall trees with less
32 canopy cover. Young are capable of flight as early as 3 weeks following birth. Maximum lifespan
33 for northern long-eared bats is estimated to be up to 18.5 years, and the highest rate of mortality
34 occurs during the juvenile stage.

35 Northern long-eared bats are nocturnal foragers that use hawking and gleaning in conjunction
36 with passive acoustic cues to collect prey. The species' diet includes moths, flies, leafhoppers,
37 caddisflies, beetles, and arachnids. Individuals forage 1–3 m (3–10 ft) above the ground
38 between the understory and canopy of forested hillsides and ridges, with peak foraging activity
39 occurring within 5 hours after sunset.

40 Northern long-eared bats exhibit site fidelity to their summer home range, during which time
41 individuals roost and forage in forests. Studies indicate a variety of home range sizes—from as
42 little as 8.6 ha (21.3 ac) to as large as 172 ha (425 ac). Some studies indicate differences in
43 ranges between sexes, while others find no significant differences.

1 *Factors Affecting the Species*

2 FWS identifies white-nose syndrome, a disease caused by the fungus
3 *Pseudogymnoascus destructans*, to be the predominant threat to the northern long-eared bat's
4 continued existence. Other factors include human disturbances of hibernacula and loss of
5 summer habitat due to forest conversion and forest management.

6 *Occurrence within the Action Area*

7 FWS (FWS 2023-TN9083) identified the northern long-eared bat as potentially occurring in the
8 action area in the IPaC report for the proposed action. Within Minnesota, the species is found
9 throughout the State in the summer months. Xcel Energy reports no known occurrences of
10 northern long-eared bats on the Monticello site. However, Xcel Energy has conducted no
11 ecological surveys to specifically assess the species' presence or the suitability of onsite
12 habitat.

13 Based on the above information, the NRC staff conservatively assumes that the deciduous
14 forest habitat within the action area could support foraging, mating, and sheltering in the spring,
15 summer, and fall. Accordingly, the staff assesses the potential impacts of the proposed action
16 on this species in Section 3.8.4.1.1 of this EIS.

17 Tricolored Bat

18 The FWS issued a proposed rule to list the tricolored bat as endangered in 2022 (87 FR 56381-
19 TN8546-TN8546). The FWS proposed no critical habitat with the rule because it found that such
20 a designation could increase the degree of threat to the species. The information in this section
21 is drawn from the FWS's species status assessment (FWS 2021-TN8589) unless otherwise
22 cited.

23 The tricolored bat is a small insectivorous bat that can be distinguished by its unique tricolored
24 fur, which often appears yellowish to orange. The species occurs across 39 states in the
25 eastern and central United States and in portions of southern Canada, Mexico, and Central
26 America. During the winter, tricolored bats often inhabit caves and abandoned mines. In the
27 southern United States, where caves are sparse, tricolored bats also roost in road culverts
28 where they exhibit shorter hibernation bouts and may leave hibernacula to forage during warm
29 nights. Tricolored bats hibernate singly, but sometimes in pairs or in small clusters of both sexes
30 away from other bats. Between mid-August and mid-October, males and females converge at
31 cave and mine entrances to swarm and mate, and females typically give birth to two young
32 between May and July.

33 Tricolored bats disperse from winter hibernacula to a summer roosting habitat in the spring.
34 Tracking studies have recorded migration paths that span from 27 mi (44 km) to 151 mi
35 (243 km). During the spring, summer, and fall, tricolored bats occupy forested habitats.
36 Individuals roost among leaves of live or recently dead deciduous hardwood trees, but
37 individuals may also roost in pines (*Pinus* spp.), eastern red cedar (*Juniperus virginiana*),
38 Spanish moss (*Tillandsia usneoides*), *Usnea trichodea* lichen, and occasionally human
39 structures. Tricolored bats are opportunistic feeders and consume small insects including
40 caddisflies (Trichoptera), flying moths (Lepidoptera), small beetles (Coleoptera), small wasps
41 and flying ants (Hymenoptera), true bugs (Homoptera), and flies (Diptera).

1 *Factors Affecting the Species*

2 Tricolored bats face extinction primarily due to the range-wide impacts of white-nose syndrome,
3 a deadly disease affecting cave-dwelling bats. The FWS estimates that white-nose syndrome
4 has caused population declines of 90 percent or more in affected tricolored bat colonies across
5 most of the species' range.

6 *Occurrence within the Action Area*

7 The FWS (FWS 2023-TN9083) identified the tricolored bat as potentially occurring in the action
8 area in the IPaC report for the proposed action. Within Minnesota, the species is found
9 throughout the State in the summer months. Xcel Energy reports no occurrences of tricolored
10 bats on the Monticello site. However, Xcel Energy has conducted no ecological surveys to
11 specifically assess the species' presence or the suitability of onsite habitats.

12 Based on the above information, the NRC staff conservatively assumes that the deciduous
13 forest habitat within the action area could support foraging, mating, and sheltering in the spring,
14 summer, and fall. Accordingly, the staff assesses the potential impacts of the proposed action
15 on this species in Section 3.8.4.1.1 of this EIS.

16 Whooping Crane

17 FWS listed the whooping crane as endangered wherever found in 1967 on the original
18 endangered species list under the Endangered Species Preservation Act of 1966 prior to the
19 ESA's promulgation (32 FR 4001-TN2750). The FWS lists the population of whooping crane
20 whose range overlaps with the Monticello site as an experimental, nonessential population not
21 necessary for the continued species existence (66 FR 33903-TN9652). Experimental
22 populations are treated as threatened under the ESA, regardless of the species' designation
23 elsewhere; however, for purposes of ESA consultation, the FWS considers experimental
24 populations as proposed for listing such that the bar for consultation is higher than that for listed
25 species (FWS 2018-TN9653). Information in this section is drawn from the FWS's species
26 profile (FWS 2023-TN8854) unless otherwise cited.

27 The whooping crane is North America's tallest bird. It is a large snowy white wading bird with
28 black markings on the face. Whooping cranes currently exist in the wild at three locations and in
29 captivity at 12 sites. There is only one self-sustaining wild population, the Aransas–Wood
30 Buffalo National Park population, which nests in Wood Buffalo National Park and adjacent areas
31 in Canada and winters in the coastal marshes of Aransas County, Texas. Migrations occur from
32 March through April in the spring and from October through November in the fall (FWS 2018-
33 TN5743). Migrants travel during the day along narrow corridors in small groups under limited
34 cloud cover, tail winds, and otherwise favorable conditions. At night, whooping cranes roost in
35 palustrine and riverine wetlands. The species typically selects stopover sites with wide, open
36 views that are isolated from human disturbance (NGPC 2023-TN8876). In a 2009–2015 study of
37 nocturnal roost and diurnal sites used by migrating whooping cranes, Pearse et al. (TN8855)
38 determined that cranes selected roosts in emergent wetlands (50 percent), lacustrine wetlands
39 (25 percent), riverbanks (20 percent), and dryland sites (5 percent). Migrants selected day-use
40 sites in drylands (54 percent), wetlands (45 percent), and riverbanks (1 percent). Whooping
41 cranes tend to stop wherever they happen to be later in the day when conditions are no longer
42 suitable for migration such that stopover use patterns are often very unpredictable (FWS 2009-
43 TN8856). Thus, whooping cranes could use a particular wetland pond regularly, rarely, or even
44 just once over the course of several years of migrations.

1 *Factors Affecting the Species*

2 Direct mortality from hunting and wetland habitat destruction during agricultural development
3 are two primary drivers of whooping crane population declines. Historically, more than 10,000
4 whooping cranes once populated North America. All whooping cranes alive today have come
5 from the all-time low of 15 whooping cranes that were wintering at Aransas National Wildlife
6 Refuge in Austwell, Texas in 1941 (FWS 2023-TN8857).

7 *Occurrence within the Action Area*

8 The FWS identified the whooping crane as potentially occurring in the action area in the IPaC
9 report (FWS 2023-TN9083) for the proposed action. Xcel Energy reports no known occurrences
10 of whooping cranes on the Monticello site (Xcel 2023-TN9578: Enclosure 28). However, Xcel
11 Energy has conducted no ecological surveys to specifically assess the species' presence or the
12 suitability of an onsite habitat.

13 Because occurrences of whooping cranes are known within 15 mi (24 km) of the site (CLO
14 2023-TN9654) and because the site contains multiple wetland types and riverbanks, the site
15 may provide a suitable roosting habitat and stopover habitat. The NRC staff conservatively
16 assumes that whooping cranes may occur on site. Accordingly, the staff assesses the potential
17 impacts of the proposed action on this species in Section 3.8.4.1.2 of this DEIS.

18 Monarch Butterfly

19 The monarch butterfly is a candidate for Federal listing. In 2020, the FWS issued a 12-month
20 finding announcing its intent to prepare a proposed rule to list the monarch butterfly as
21 threatened (85 FR 81813-TN8590). In 2022, the FWS identified the monarch butterfly listing
22 action as a priority because the magnitude of threats is moderate to low; however, these threats
23 are imminent for the eastern and western North American populations. Although the ESA does
24 not require consultation for candidates, the NRC staff considers this species here at the
25 recommendation of the FWS (FWS 2023-TN9083) in its IPaC report for the proposed project.
26 The information in this section is drawn from the FWS's candidate review unless otherwise cited
27 (87 FR 26152-TN8591).

28 The monarch is a large butterfly with bright orange wings and black veining and borders. During
29 the breeding season, females lay eggs on milkweed (primarily *Asclepias* spp.). Developing
30 larvae feed on milkweed, which allows them to sequester toxic chemicals as a defense against
31 predators, before pupating into a chrysalis to transform into the adult butterfly form. Monarchs
32 produce multiple generations each breeding season, and most adult butterflies live 2–5 weeks.
33 Overwintering adults, however, enter reproductive diapause and live 6–9 months.

34 Monarch butterflies occur in 90 countries, islands, or island groups. Monarch butterflies have
35 become naturalized at most of these locations outside North America since 1840. The
36 populations outside eastern and western North America (including southern Florida) do not
37 exhibit long-distance migratory behavior. In many regions, monarchs breed year-round. In
38 temperate climates such as eastern and western North America, monarchs migrate long
39 distances and live for an extended period. In both eastern and western North America,
40 monarchs begin migrating in the fall to their respective overwintering sites in the forests of
41 California and Mexico. These overwintering sites provide protection from the elements and
42 moderate temperatures as well as nectar and clean water sources located nearby. Migration
43 distances can be greater than 1,900 mi (3,000 km) and span a 2-month period. In early spring

1 (February–March), surviving monarchs break diapause and mate at overwintering sites before
2 dispersing. The same individuals that undertook the initial southward migration begin flying back
3 through the breeding grounds, and their offspring restart the cycle of generational migration.

4 *Factors Affecting the Species*

5 The primary threats to the monarch’s biological status include loss and degradation of habitat
6 from conversion of grasslands to agriculture, widespread use of herbicides, logging/thinning at
7 overwintering sites in Mexico, forest and tree senescence, and incompatible management of
8 overwintering sites in California, urban development, drought, exposure to insecticides, and
9 effects of climate change.

10 *Occurrence within the Action Area*

11 Monarchs are associated with prairie, meadow, and grassland habitats. Within Minnesota, 15
12 native species of milkweed provide a habitat for the development of monarch eggs and larvae
13 (iNaturalist 2023-TN9655). Along publicly accessible roads directly adjacent to the site, three
14 milkweed species are known to occur (iNaturalist 2023-TN9655): poke milkweed
15 (*Asclepias exaltata*), common milkweed (*A. syriaca*), and swamp milkweed (*A. incarnata*).

16 Xcel Energy reports no known occurrences of monarch butterfly on the Monticello site (Xcel
17 2023-TN9084: Section 3.7.8.1.2). However, Xcel Energy has conducted no ecological surveys
18 to specifically assess the species’ presence or the suitability of onsite habitat. Given the
19 proximity of known milkweed occurrences adjacent to the site, the NRC staff conservatively
20 assumes that milkweeds could occur on site and that the site may provide a larval habitat. If
21 milkweeds are not present, monarchs could occur in the action area during spring and fall
22 migration when individuals are moving between areas of more suitable habitat. Accordingly, the
23 staff assesses the potential impacts of the proposed action on this species in Section 3.8.4.1.3
24 of this EIS.

25 Summary of Potential Species Occurrences in the Action Area

26 Table 3-19 summarizes the likelihood of each species discussed in this section to occur in the
27 action area. Based on the NRC staff’s analysis, four species have the potential to occur within
28 the action area. No proposed or designated critical habitat occurs within the action area.

29 3.8.1.3 *Endangered Species Act: Federally Listed Species and Critical Habitats Under* 30 *NMFS Jurisdiction*

31 No federally listed species or designated critical habitats under NMFS jurisdiction occur in the
32 action area. Therefore, this EIS does not discuss any such species or habitats.

33 **3.8.2 Magnuson–Stevens Act: Essential Fish Habitat**

34 Congress enacted the MSA in 1976 to foster the long-term biological and economic
35 sustainability of the Nation’s marine fisheries (TN7841). The MSA directs the Fishery
36 Management Councils, in conjunction with NMFS, to designate areas of essential fish habitat
37 (EFH) and to manage marine resources within those areas. EFH is the coastal and marine
38 waters and substrate necessary for fish to spawn, breed, feed, or grow to maturity (50 CFR
39 Part 600-TN1342). For each federally managed species, the Fishery Management Councils and
40 NMFS designate and describe EFH by life stage (i.e., egg, larva, juvenile, and adult).

1 **Table 3-19 Summary of the Potential for Federally Listed Species under the**
 2 **Jurisdiction of the U.S. Fish and Wildlife Service to Occur within the Action**
 3 **Area**

Common Name	Type and Likelihood of Occurrence in the Action Area
northern long-eared bat	Seasonal presence in spring, summer, and fall possible in very low numbers in action area forests of sufficient size to support foraging, mating, and sheltering.
tricolored bat	Presence possible in spring, summer, and fall in the deciduous forest habitat within the action area.
whooping crane	Occasional occurrence in very low numbers for foraging and sheltering.
monarch butterfly	Larval habitat may be present if milkweeds are present. Otherwise, occasional transitory presence when moving between areas of more suitable habitat.
Higgins' eye pearl mussel	Not present.
gray wolf	Not present.
rusty patch bumble bee	Not present.

4 No coastal or marine waters occur near Monticello. Therefore, this EIS does not discuss EFH.

5 **3.8.3 National Marine Sanctuaries Act: Sanctuary Resources**

6 Congress enacted the NMSA in 1972 to protect areas of the marine environment that have
 7 special national significance. The NMSA authorizes the Secretary of Commerce to establish the
 8 National Marine Sanctuary System and designate sanctuaries within that system, which
 9 includes 15 sanctuaries and 2 marine national monuments, encompassing more than
 10 600,000 mi² of marine and Great Lakes waters from Washington State to the Florida Keys and
 11 from Lake Huron to American Samoa. Within these areas, sanctuary resources include any
 12 living or nonliving resource of a national marine sanctuary that contributes to the conservation,
 13 recreational, ecological, historical, educational, cultural, archaeological, scientific, or aesthetic
 14 value of the sanctuary.

15 No coastal or marine waters or Great Lakes occur near Monticello. Therefore, this EIS does not
 16 discuss national marine sanctuaries or their resources.

17 **3.8.4 Proposed Action**

18 The following sections address the site-specific environmental impacts of the proposed
 19 Monticello SLR on the environmental issues identified in Table 3-1 that relate to federally
 20 protected ecological resources.

21 *3.8.4.1 Endangered Species Act: Federally Listed Species and Critical Habitats under*
 22 *U.S. Fish and Wildlife Service Jurisdiction*

23 In Section 3.8.1.2, the NRC staff determined that two federally listed species, the northern long-
 24 eared bat and whooping crane, may occur in the action area. Additionally, the tricolored bat,
 25 which the FWS has proposed for Federal listing as endangered, and the monarch butterfly,
 26 which is a candidate for Federal listing, may occur in the action area. Section 3.8.1 includes the
 27 relevant information about the habitat requirements, life history, and regional occurrence of
 28 these species. In the sections below, the NRC staff analyzes the potential impacts of the

1 proposed Monticello SLR on these four species. Table 3-20 summarizes the NRC staff’s ESA
 2 effect determinations that resulted from the staff’s analysis.

3 **Table 3-20 Effect Determinations for Federally Listed Species under U.S. Fish and**
 4 **Wildlife Service Jurisdiction**

Species	Federal Status ^(a)	Potentially Present in the Action Area?	Effect Determination ^(b)
northern long-eared bat	FE	Yes	NLAA
tricolored bat	FPE	Yes	NLAA
whooping crane	FE (NEP)	Yes	NLAA
monarch butterfly	FC	Yes	NLAA
Higgins’ eye pearl mussel	FE	No	NE
gray wolf	FT	No	NE
rusty patched bumble bee	FE	No	NE

FC = candidate for Federal listing; FE = federally endangered; FPE = proposed for Federal listing as endangered; NE = no effect; NEP = in the vicinity of the action area, this species is part of a nonessential experimental population; NLAA = may affect but is not likely to adversely affect.

(a) Indicates protection status under the Endangered Species Act.

(b) The NRC staff makes its effect determinations for federally listed species in accordance with the language and definitions specified in the FWS and NMFS Endangered Species Consultation Handbook (FWS and NMFS 1998-TN1031).

5 In Section 3.8.1.2, the NRC staff describes several additional federally listed species. The staff
 6 explains that these species do not occur in the action area; therefore, the staff does not address
 7 these species any further because SLR would have no effect on them. Table 3-20 identifies
 8 these species and the NRC’s staff’s “no effect” findings.

9 *3.8.4.1.1 Northern Long-eared Bat and Tricolored Bat*

10 In Section 3.8.1 of this EIS, the NRC staff concludes that northern long-eared bat and tricolored
 11 bat may occur in the action area’s forests in spring, summer, and fall. If present, these bats
 12 would occur rarely and in low numbers.

13 The potential stressors that northern long-eared and tricolored bats could experience from the
 14 operation of a nuclear power plant (generically) are as follows:

- 15 • mortality or injury from collisions with nuclear power plant structures and vehicles
- 16 • habitat loss, degradation, disturbance, or fragmentation; and associated effects
- 17 • behavioral changes resulting from refurbishment or other site activities

18 This section addresses each of these stressors below.

19 *Mortality or Injury from Collisions with Nuclear Power Plant Structures and Vehicles*

20 Several studies have documented bat mortality or injury resulting from collisions with
 21 human-made structures. Saunders (1930-TN8504) reported that five bats of three species—
 22 eastern red bat, hoary bat (*L. cinereus*), and silver-haired bat—were killed when they collided
 23 with a lighthouse in Ontario, Canada. In Kansas, Van Gelder (1956-TN8505) documented five
 24 eastern red bats that collided with a television tower. In Florida, Crawford and Baker (1981-
 25 TN8506) collected 54 bats of seven species that collided with a television tower over a 25 year
 26 period, Zinn and Baker (1979-TN8507) reported 12 dead hoary bats at another television tower

1 over an 18-year period, and Taylor and Anderson (1973-TN8508) reported 1 dead yellow bat
2 (*Lasiurus intermedius*) at a third Florida television tower. Bat collisions with communications
3 towers have been reported in North Dakota, Tennessee, and Saskatchewan, Canada; with
4 convention center windows in Chicago, IL; and with power lines, barbed wire fences, and
5 vehicles in numerous locations (Johnson and Strickland 2003-TN8509).

6 More recently, bat collisions with wind turbines have been of concern in North America. Bat
7 fatalities have been documented at most wind facilities throughout the United States and
8 Canada (USGS 2016-TN8510). For instance, during a 1996–1999 study at the Buffalo Ridge
9 wind power development project in Minnesota, Johnson et al. (TN8511) reported 183 bat
10 fatalities, most of which were hoary bats and eastern red bats. The USGS Fort Collins Science
11 Center estimates that tens to hundreds of thousands of bats die at wind turbines in North
12 America each year (USGS 2016-TN8510).

13 Bat collisions with human-made structures at nuclear power plants are not well documented but
14 are likely rare based on available information. In an assessment of the potential effects of the
15 operation of the Davis-Besse Nuclear Power Station in Ohio, the NRC staff (NRC 2014-
16 TN7385) noted that four dead bats were collected at the nuclear power plant during bird
17 mortality studies conducted from 1972 through 1979. Two red bats (*Lasiurus borealis*) were
18 collected at the cooling tower, and one big brown bat and one tricolored bat were collected near
19 other nuclear power plant structures. The NRC staff (NRC 2014-TN7385) found that future
20 collisions of bats would be extremely unlikely and, therefore, discountable, given the small
21 number of bats collected during the study and the marginal suitable habitat that the nuclear
22 power plant site provides. The FWS (FWS 2014-TN7605) concurred with this determination. In
23 a 2015 assessment associated with Indian Point Nuclear Generating Units 2 and 3 in New York,
24 the NRC staff (NRC 2015-TN7382) determined that bat collisions were less likely to occur at
25 Indian Point than at Davis-Besse because Indian Point does not have cooling towers or similarly
26 large obstructions. The tallest structures on the Indian Point site are 134 ft (40.8 m)-tall turbine
27 buildings and 250 ft (76.2 m)-tall reactor containment structures. The NRC staff (NRC 2015-
28 TN7382) concluded that the likelihood of bats colliding with these and other nuclear power plant
29 structures on the Indian Point site during the LR period was extremely unlikely to occur and,
30 therefore, discountable. FWS concurred with this determination (FWS 2015-TN7612). In 2018,
31 the NRC staff (NRC 2018-TN7381) determined that the likelihood of bats colliding with site
32 buildings or structures on the Seabrook Station, Unit 1, site in New Hampshire would be
33 extremely unlikely. The tallest structures on that site are the 199 ft (61 m)-tall containment
34 structure and the 103 ft (31 m)-tall turbine and heater bay building. The FWS (FWS 2018-
35 TN7610) concurred with the NRC staff's determination. Since that time, the FWS has concurred
36 with similar findings for initial and subsequent license renewals at multiple other nuclear power
37 plant sites, including Surry Power Station, Units 1 and 2, in Surry, VA (FWS 2019-TN7609);
38 Peach Bottom Atomic Power Station, Units 2 and 3, in Delta, PA (FWS 2019-TN9742); Point
39 Beach Nuclear Plant, Units 1 and 2, in Two Rivers, WI (FWS 2021-TN9740); North Anna Power
40 Station, Units 1 and 2, in Louisa, VA (FWS 2023-TN9093); and Perry Nuclear Power Plant,
41 Unit 1, in Perry, OH (FWS 2023-TN9741), among others.

42 The tallest structures on the Monticello site are the off-gas stack and the primary MET, both of
43 which are 328 ft (100 m) above ground level (Xcel 2023-TN9084: ER Sections 2.2.4 and 3.2.3).
44 The turbine buildings and transmission lines are also prominent features on the site. To date,
45 Xcel Energy has reported no incidents of injury or mortality of any species of bat on the
46 Monticello site associated with site buildings or structures. Accordingly, the NRC staff finds the
47 likelihood of future northern long-eared bat collisions with site buildings or structures to be
48 extremely unlikely and, therefore, discountable.

1 Vehicle collision risk for bats varies depending on factors including time of year, location of
2 roads and travel pathways in relation to roosting and foraging areas, the characteristics of
3 individuals' flight, traffic volume, and whether young bats are dispersing. Although collision has
4 been documented for several species of bats, the Indiana Bat Draft Recovery Plan (FWS 2007-
5 TN934) indicates that bat species do not seem to be particularly susceptible to vehicle
6 collisions. However, the FWS also finds it difficult to determine whether roads pose a greater
7 risk for bats colliding with vehicles or a greater likelihood of decreasing risk of collision by
8 deterring bat activity (FWS 2016-TN7400). In most cases, the FWS expects that roads of
9 increasing size decrease the likelihood of bats crossing the roads and, therefore, reduce
10 collision risk (FWS 2016-TN7400).

11 During the proposed Monticello SLR term, vehicular traffic from truck deliveries, site
12 maintenance activities, and personnel commuting to and from the site would continue
13 throughout the LR period as they have during the current licensing period. Vehicle use would
14 occur primarily in areas that bats would be less likely to frequent, such as along established
15 county and State roads or within industrial-use areas of the Monticello site. Additionally, most
16 vehicle activity would occur during daylight hours when bats are less active. To date, Xcel
17 Energy has reported no incidents of injury or mortality of any species of bat on the Monticello
18 site associated with vehicle collisions. Accordingly, the NRC staff finds the likelihood of future
19 northern long-eared or tricolored bat collisions with vehicles to be extremely unlikely and,
20 therefore, is not considered further.

21 *Habitat Loss, Degradation, Disturbance, or Fragmentation, and Associated Effects*

22 As previously discussed in this EIS, the Monticello action area includes a forested habitat that
23 protected bats may rarely to occasionally inhabit in spring, summer, and fall. In its final rule
24 listing the northern long-eared bat (80 FR 17974-TN4216), the FWS stated that forest
25 conversion and forest modification from management are two of the most common causes of
26 habitat loss, degradation, disturbance, or fragmentation affecting the species. Forest conversion
27 is the loss of forest to another land-use type, such as cropland, residential, or industrial. This
28 can lead to loss of a suitable habitat, fragmentation of remaining habitat patches, and
29 elimination of travel corridors (80 FR 17974-TN4216). Forest management practices maintain
30 forest habitat at the landscape level, but they involve practices that can have direct and indirect
31 effects on bats. Impacts from forest management are typically temporary in nature and can
32 include positive, neutral, and negative impacts.

33 The proposed action would not involve forest conversion or management and would generally
34 not disturb the existing forested habitat on the site. Xcel Energy states that it would continue to
35 perform vegetation maintenance on the site over the course of the proposed SLR term. Most
36 maintenance would be of grassy, mowed areas between buildings and along walkways within
37 the industrial portion of the site or on adjacent hillsides. Xcel Energy would continue to maintain
38 onsite transmission line ROWs in accordance with North American Electric Reliability
39 Corporation standards. Less-developed areas and forested areas would be largely unaffected.
40 Xcel Energy does not intend to expand the existing facilities or otherwise perform construction
41 or maintenance activities within these areas (Xcel 2023-TN9084: ER Sections 2.3 and 3.7.2.6).
42 Site personnel may occasionally remove select trees around the margins of existing forested
43 areas if those trees are deemed hazardous to buildings, infrastructure, or other site facilities or
44 to existing overhead clearances. Negative impacts on bats could result if such trees are
45 potential roost trees. Bats could also be directly injured during tree clearing. However, tree
46 removal would be infrequent, and Xcel Energy personnel would follow company guidance to
47 minimize potential impacts on bats.

1 The NRC staff finds that infrequent to rare hazardous tree removal in forested areas during the
2 proposed SLR term would not measurably affect any potential bat habitat in the action area.
3 Direct injury or mortality to bats during tree removal is also unlikely because Xcel Energy
4 company guidance would ensure that personnel take the appropriate measures to avoid this
5 potential impact. For instance, Xcel Energy could avoid this impact by removing hazardous
6 trees in the winter when bats are unlikely to be present on the site. Additionally, the continued
7 preservation of the existing forested areas on the site during the Monticello SLR term would
8 result in positive impacts on tricolored or long-eared bats if they are present within or near the
9 action area.

10 *Behavioral Changes Resulting from Refurbishment or Other Site Activities*

11 Construction or refurbishment and other site activities, including site maintenance and
12 infrastructure repairs, could prompt behavioral changes in bats. Noise, vibration, and general
13 human disturbance are stressors that may disrupt normal feeding, sheltering, and breeding
14 activities (FWS 2016-TN7400). At low noise levels or farther distances, bats initially may be
15 startled but would likely habituate to the low background noise levels. At closer range and
16 louder noise levels, particularly if accompanied by physical vibrations from heavy machinery,
17 many bats would likely be startled to the point of fleeing from their daytime roosts. Fleeing
18 individuals could experience increased susceptibility to predation and would expend increased
19 levels of energy, which could result in decreased reproductive fitness (FWS 2016-TN7400,
20 Table 4-1). Increased noise may also affect foraging success. Schaub et al. (2008) found that
21 the foraging success of the greater mouse-eared bat (*Myotis myotis*) diminished in areas with
22 noise mimicking the traffic sounds that would be experienced within 15 m (49 ft) of a highway.

23 Within the Monticello action area, noise, vibration, and other human disturbances could
24 dissuade bats from using the action area's forested habitat during migration, which could also
25 reduce the fitness of migrating bats. However, bats that use the action area have likely become
26 habituated to such disturbances because Monticello has been consistently operating for several
27 decades. According to the FWS, bats that are repeatedly exposed to predictable, loud noises
28 may habituate to such stimuli over time (FWS 2010-TN8537). For instance, Indiana bats have
29 been documented as roosting within approximately 1,000 ft (300 m) of a busy State route
30 adjacent to Fort Drum Military Installation and immediately adjacent to housing areas and
31 construction activities on the installation (U.S. Army 2014-TN8512). Northern long-eared and
32 tricolored bats would likely respond similarly.

33 Continued operation of Monticello during the SLR term would not include major construction or
34 refurbishment and would involve no other maintenance or infrastructure repair activities besides
35 routine activities already performed on the site. Levels and intensity of noise, lighting, and
36 human activity associated with continued day-to-day activities and site maintenance during the
37 SLR term would be similar to ongoing conditions since Monticello began operating, and such
38 activity would only occur on the developed, industrial-use portions of the site. While these
39 disturbances could cause behavioral changes in migrating or summer roosting bats, such as the
40 expenditure of additional energy to find alternative suitable roosts, the NRC staff assumes that
41 northern long-eared bats, if present in the action area, have already acclimated to regular site
42 disturbances. Thus, continued disturbances during the SLR term would not cause behavioral
43 changes in bats to a degree that would be able to be meaningfully measured, detected, or
44 evaluated or that would reach the scale where a take might occur.

1 *Summary of Effects*

2 The potential stressors evaluated in this section are unlikely to result in effects on the northern
3 long-eared and tricolored bats that could be meaningfully measured, detected, or evaluated,
4 and such stressors are otherwise unlikely to occur for the following reasons:

- 5 • Bat collisions with nuclear power plant structures in the United States are rare, and none
6 have been reported at Monticello. Vehicle collisions attributable to the proposed action are
7 also unlikely, and none have been reported at Monticello.
- 8 • The proposed action would not involve any construction, land clearing, or other
9 ground-disturbing activities.
- 10 • Continued preservation of the existing forested areas on the site would result in positive
11 impacts on bats.
- 12 • Bats, if present in the action area, have likely already acclimated to the noise, vibration, and
13 general human disturbances associated with site maintenance, infrastructure repairs, and
14 other site activities. During the SLR term, such disturbances and activities would continue at
15 current rates and would be limited to the industrial-use portions of the site.

16 *Conclusion for the Northern Long-eared Bat*

17 All potential effects on the northern long-eared bat resulting from the proposed action would be
18 insignificant or discountable. Therefore, the NRC staff concludes that the proposed action *may*
19 *affect but is not likely to adversely affect* the northern long-eared bat.

20 In a letter dated June 27, 2023 (FWS 2023-TN9082), the FWS concurred with this determination
21 based on a standing analysis completed by the Service in its development of the IPaC Northern
22 Long-eared Bat Rangewide Determination Key. The FWS's June 27, 2023, letter documents
23 that the NRC staff has fulfilled its ESA Section 7(a)(2) obligations with respect to the proposed
24 Monticello SLR. The NRC staff notes that ESA regulations at 50 CFR 402.16 prescribe certain
25 circumstances that require Federal agencies to reinitiate consultation. As of the date of issuance
26 of this EIS, the NRC staff has identified no information that would warrant reinitiation of
27 consultation (50 CFR 402.16-TN4312).

28 *Conclusion for the Tricolored Bat*

29 All potential effects on the tricolored bat resulting from the proposed action would be
30 insignificant or discountable. Therefore, the NRC staff concludes that the proposed action *may*
31 *affect but is not likely to adversely affect* the tricolored bat.

32 In a letter dated June 27, 2023 (FWS 2023-TN9081), the FWS concurred with this
33 determination. The FWS's June 27, 2023, letter documents that the NRC staff has fulfilled its
34 ESA Section 7(a)(2) obligations with respect to this species. The NRC staff notes that ESA
35 regulations at 50 CFR 402.16 prescribe certain circumstances that require Federal agencies to
36 reinitiate consultation. As of the date of issuance of this EIS, the NRC staff has identified no
37 information that would warrant reinitiation of consultation (50 CFR 402.16-TN4312).

38 *3.8.4.1.2 Whooping Crane*

39 In Section 3.8.1.2 of this EIS, the NRC staff concludes that whooping cranes may occur in the
40 action area when moving between areas of more suitable habitat. If present, whooping cranes

1 would occur occasionally and for short periods of time. Xcel Energy reports neither mortalities
2 (Xcel 2023-TN9578: Enclosure 31) nor any occurrences (Xcel 2023-TN9578: Enclosure 28) of
3 whooping cranes on site.

4 The primary human drivers affecting the whooping crane habitat include activities that cause a
5 loss of wetlands or the degradation of wetland and riverine habitats (FWS 2023-TN8854). Xcel
6 Energy proposes no construction or ground disturbance during the SLR term that would impact
7 wetland or riparian habitats. All plant operations would continue to occur within already
8 developed land on the Monticello site. Xcel Energy would continue to comply with its NPDES
9 permit, and no activities during the SLR term would alter the river flow in a manner that could
10 result in the degradation of the riverine habitat for whooping cranes.

11 During the proposed Monticello SLR term, vehicular traffic from truck deliveries, site
12 maintenance activities, and personnel commuting to and from the site would continue
13 throughout the SLR period as they have during the current licensing period. Vehicle use would
14 occur primarily in areas that whooping cranes would be less likely to frequent, such as along
15 established county and State roads or within industrial-use areas of the Monticello site.
16 Accordingly, the NRC staff finds the likelihood of future whooping crane collisions with vehicles
17 to be extremely unlikely and, therefore, is not considered further.

18 The risk of collisions with tall structures and in-scope transmission lines poses a threat to
19 whooping cranes and other birds. As described in Section 3.6.4, Xcel Energy maintains an
20 Avian Protection Plan to avoid and minimize bird mortality and injury incidents. Over the course
21 of 2014–2023, Xcel Energy reported 10 bird deaths (Xcel 2023-TN9578: Enclosure 31). Nine of
22 these were of unknown causes, and one was a collision with a building. One of these bird
23 deaths with unknown cause was a great blue heron (*Ardea herodias*), a large wading bird.
24 Given that only one large wading bird has died on the Monticello site over a 10-year period and
25 that whooping cranes are unlikely to pass through the site, the NRC staff finds the collision risk
26 to be low. Accordingly, the NRC staff finds the likelihood of future whooping crane collisions with
27 buildings, infrastructure, or in-scope transmission lines to be extremely unlikely and, therefore,
28 is not considered further.

29 *Summary of Effects*

30 The potential stressors evaluated in this section are unlikely to result in effects on whooping
31 cranes that could be meaningfully measured, detected, or evaluated, and such stressors are
32 otherwise unlikely to occur for the following reasons:

- 33 • The proposed action would not involve any habitat loss, land-disturbing activities, or any
34 activities that would degrade existing natural areas or potential wetland habitat for whooping
35 cranes.
- 36 • Continued preservation of the existing natural areas on the site would result in positive
37 impacts on whooping cranes.
- 38 • Collisions with tall structures or in-scope transmission lines are unlikely. Vehicle collisions
39 attributable to the proposed action are also unlikely, and none have been reported at
40 Monticello.

1 *Conclusion for the Whooping Crane*

2 All potential effects on the whooping crane resulting from the proposed action would be
3 insignificant or discountable. Therefore, the NRC staff concludes that the proposed action *may*
4 *affect but is not likely to adversely affect* whooping cranes.

5 In a letter dated June 27, 2023 (FWS 2023-TN9081), the FWS stated that because the
6 proposed action is not likely to result in jeopardy of the nonessential experimental population of
7 whooping crane, the NRC's obligations under Section 7 for the whooping crane are complete.
8 The FWS's June 27, 2023, letter documents that the NRC staff has fulfilled its ESA
9 Section 7(a)(1) and 7(a)(4) obligations with respect to this species. The NRC staff notes that
10 ESA regulations at 50 CFR 402.16 prescribe certain circumstances that require Federal
11 agencies to reinstate consultation. As of the date of issuance of this EIS, the NRC staff has
12 identified no information that would warrant re-initiation of consultation (50 CFR 402.16-
13 TN4312).

14 *3.8.4.1.3 Monarch Butterfly*

15 In Section 3.8.1.2 of this EIS, the NRC staff concludes that monarch butterflies may occur in the
16 action area during spring and fall migration when individuals are moving between areas of more
17 suitable habitat. If present, monarchs would occur occasionally and for short periods of time.

18 The FWS (FWS 2020-TN8593) identifies the primary drivers affecting the health of the two
19 North American migratory populations of monarch butterfly as (1) habitat loss and degradation,
20 (2) insecticide exposure, and (3) climate change effects.

21 Monarch habitat loss and degradation has resulted from the conversion of grasslands to
22 agriculture, widespread use of herbicides, logging/thinning at overwintering sites in Mexico,
23 senescence and incompatible management of overwintering sites in California, urban
24 development, and drought (FWS 2020-TN8593). The proposed Monticello SLR would not
25 involve any habitat loss, land-disturbing activities, or any activities that would degrade existing
26 natural areas or potential habitats for monarch butterflies. The continued preservation of existing
27 natural areas on the site would result in positive impacts on monarch butterflies.

28 Most insecticides are nonspecific and broad-spectrum in nature. Furthermore, the larvae of
29 many Lepidopterans are considered major pest species, and insecticides are specifically tested
30 on this taxon to ensure that they will effectively kill individuals at the labeled application rates
31 (FWS 2020-TN8593). Although insecticide use is most often associated with agricultural
32 production, any habitat where monarchs are found may be subject to insecticide use. Studies
33 looking specifically at the dose response of monarchs to neonicotinoids, organophosphates, and
34 pyrethroids have demonstrated monarch toxicity (e.g., Krischik et al. 2015-TN8596; James
35 2019-TN8595; Krishnan et al. 2020-TN8597; Bagar et al. 2020-TN8594). Moreover, the
36 magnitude of risk posed by insecticides may be underestimated, as research usually examines
37 the effects of the active ingredient alone, while many of the formulated products contain more
38 than one active insecticide.

39 During the proposed SLR period, Xcel Energy would continue applying herbicides as needed,
40 according to labeled uses, but has no plans to apply herbicides in natural areas. Application
41 would primarily be confined to industrial-use and other developed portions of the site, such as
42 perimeters of parking lots, roads, and walkways. Continued herbicide application could directly
43 affect monarchs in the action area by injuring or killing individuals exposed to these chemicals.

1 Certain herbicides such as glyphosate (e.g., Round Up) can kill milkweed, which can affect the
2 ability of female monarchs to lay eggs. Although milkweed is not specifically known to occur on
3 the Monticello site, it has the potential to occur on site in the grasslands and open areas, given
4 its occurrence in the Monticello vicinity (Section 3.8.1). Monarchs are only likely to occur in the
5 action area seasonally during spring and fall migration when individuals are moving between
6 areas of more suitable habitat. Because of the low likelihood of monarchs to be exposed to
7 hazardous levels of chemicals, this potential impact is insignificant because it is unlikely to
8 reach the scale where a take might occur.

9 Because the current and projected monarch population numbers are low, both the eastern and
10 western populations are more vulnerable to catastrophic events, such as extreme storms at the
11 overwintering habitat, and other climate change related phenomena. The FWS (FWS 2020-
12 TN8593) anticipates that the eastern population will gain habitat in the northcentral region of
13 North America as the species expands northward in response to increasing ambient
14 temperatures. The degree and rate at which this expansion occurs will depend on the
15 simultaneous northward expansion of milkweed. In the southern region of the continent, the
16 population will either experience no gain or some loss of habitat.

17 Impacts on climate change during normal operations at nuclear power plants can result from the
18 release of GHGs from stationary combustion sources, refrigeration systems, electrical
19 transmission and distribution systems, and mobile sources. However, such emissions are
20 typically very minor because nuclear power plants do not normally combust fossil fuels to
21 generate electricity. During the proposed SLR term, the contribution of Monticello operations to
22 climate-change-related effects on monarch butterflies would be too small to be meaningfully
23 measured, detected, or evaluated.

24 *Summary of Effects*

25 The potential stressors evaluated in this section are unlikely to result in effects on monarch
26 butterflies that could be meaningfully measured, detected, or evaluated, and such stressors are
27 otherwise unlikely to occur for the following reasons:

- 28 • The proposed action would not involve any habitat loss, land-disturbing activities, or any
29 activities that would degrade existing natural areas or potential habitat for monarchs.
- 30 • Continued preservation of the existing natural areas on the site would result in positive
31 impacts on monarchs.
- 32 • Herbicides would only be applied according to labeled uses in developed and manicured
33 areas of the site. Herbicides would not be applied in natural areas. Monarchs would only
34 have the potential to occur in the action area seasonally and infrequently, making the
35 likelihood of herbicide exposure low. This represents an insignificant effect because it is
36 unlikely to reach the scale where a take might occur.
- 37 • The contribution of Monticello operations to climate-change-related effects on monarchs
38 would be too small to be meaningfully measured, detected, or evaluated.

39 *Conclusion for the Monarch Butterfly*

40 All potential effects on the monarch butterfly resulting from the proposed action would be
41 insignificant or discountable. Therefore, the NRC staff concludes that the proposed action *may*
42 *affect but is not likely to adversely affect* the monarch butterfly. Because the monarch is a

1 candidate for Federal listing, the ESA does not require the NRC to consult with or receive
2 concurrence from the FWS regarding this species.

3 **3.8.4.2** *Endangered Species Act: Federally Listed Species and Critical Habitats under NMFS*
4 *Jurisdiction*

5 No federally listed species or critical habitats under NMFS jurisdiction occur within the action
6 area (see Section 3.8.2). Therefore, the NRC staff concludes that the proposed action would
7 have no effect on federally listed species or habitats under this agency's jurisdiction.

8 **3.8.4.3** *Endangered Species Act: Cumulative Effects*

9 The ESA regulations at 50 CFR 402.12(f)(4) direct Federal agencies to consider cumulative
10 effects as part of the proposed action effects analysis (TN4312). Under the ESA, cumulative
11 effects are those effects of future State or private activities, not involving Federal activities, that
12 are reasonably certain to occur within the action area of the Federal action subject to
13 consultation (50 CFR 402.02 TN4312). Cumulative effects under the ESA do not include past
14 actions or other Federal actions requiring separate ESA Section 7 consultation, which differs
15 from the definition of "cumulative impacts" under the NEPA.

16 When formulating biological opinions under formal ESA Section 7 consultation, the FWS and
17 NMFS (FWS and NMFS 1998-TN1031) consider cumulative effects when determining the
18 likelihood of jeopardy or adverse modification. Therefore, cumulative effects need only be
19 considered under the ESA if listed species will be adversely affected by the proposed action and
20 formal Section 7 consultation is necessary (FWS 2017-TN5753). Because the NRC staff
21 concluded earlier in this section that the proposed SLR is not likely to adversely affect any
22 federally listed species and would not destroy or adversely modify designated critical habitats,
23 the NRC staff did not separately consider cumulative effects for the listed species and
24 designated critical habitats. Further, the NRC staff did not identify any actions within the action
25 area that meet the definition of cumulative effects under the ESA.

26 **3.8.4.4** *Magnuson–Stevens Act: Essential Fish Habitat*

27 No EFH occurs within the affected area (Section 3.8.2). Therefore, the NRC staff concludes that
28 the proposed action would have no effect on EFH.

29 **3.8.4.5** *National Marine Sanctuaries Act: Sanctuary Resources*

30 No national marine sanctuaries occur within the affected area (see Section 3.8.3). Therefore,
31 the NRC staff concludes that the proposed action would have no effect on sanctuary resources.

32 **3.8.5 No-Action Alternative**

33 Under the no-action alternative, the NRC would not issue a renewed license, and Monticello
34 would shut down on or before the expiration of the current renewed facility operating licenses.
35 Upon shutdown, the nuclear power plant would require substantially less cooling water and
36 would produce little to no discernable thermal effluent. Thus, the potential for impacts on all
37 aquatic species related to cooling system operation would be significantly reduced. The ESA
38 action area under the no-action alternative would most likely be the same or similar to the area
39 described in Section 3.8.1.1. Northern long-eared bats, tricolored bats, whooping cranes, and
40 monarch butterflies may occur within the action area (Section 3.8.1). The NRC would consult

1 with the FWS, as appropriate, to address potential effects to these species resulting from the
2 shutdown and decommissioning of the plant. No EFH or national marine sanctuaries occur in
3 the region (Sections 3.8.2 and 3.8.3). Thus, shutdown would not result in impacts on EFH or
4 sanctuary resources. Actual impacts would depend on the specific shutdown activities and
5 whether any listed species or critical habitats are present when the no-action alternative is
6 implemented.

7 **3.8.6 Replacement Power Alternatives: Common Impacts**

8 This section describes the common impacts for all three replacement power alternatives
9 described in Sections 3.8.7 through 3.8.9. The natural gas, renewables (i.e., wind and solar),
10 and battery storage would be built partially onsite and offsite of the Monticello location. The
11 small modular nuclear reactors would have to be built in a different State because Minnesota
12 law (216B.243 Minnesota Statutes -TN9184) prohibits the construction and operation of new
13 nuclear power plants in Minnesota.

14 The ESA action area for any of the replacement alternatives would depend on various factors
15 including site selection, current land uses, planned construction activities, temporary and
16 permanent structure locations and parameters, and the timeline of the alternative. The ESA
17 action area would occur within Xcel Energy's ROI, which includes Colorado, Michigan,
18 Minnesota, New Mexico, North Dakota, South Dakota, Texas, and Wisconsin.

19 The listed species, critical habitats, EFH, and national marine sanctuaries potentially affected by
20 a replacement power alternative would depend on the boundaries of that alternative's effects
21 and the species and habitats federally protected at the time that the alternative is implemented.
22 For instance, if Monticello continues to operate until the end of the current license terms and a
23 replacement power alternative is implemented at that time, the FWS and NMFS may have listed
24 new species, delisted currently listed species whose populations have recovered, or revised
25 EFH designations. These listing and designation activities would change the potential for the
26 various alternatives to impact federally protected ecological resources. Additionally,
27 requirements for consultation under ESA, MSA, and NMSA would depend on whether Federal
28 permits or authorizations are required to implement each alternative.

29 Sections 3.6 and 3.7 describe the types of impacts that terrestrial and aquatic resources would
30 experience under each alternative. Impacts on federally protected ecological resources would
31 likely be similar in type. However, the magnitude and significance of such impacts could be
32 greater for federally protected ecological resources because such species and habitats are rare
33 and more sensitive to environmental stressors.

34 **3.8.7 Natural Gas and Renewables Alternative**

35 Xcel Energy's ROI includes Minnesota and seven other states: Colorado, Michigan,
36 New Mexico, North Dakota, South Dakota, Texas, and Wisconsin. This analysis assumes that
37 the natural gas-fired power plant would be constructed either onsite or offsite in one of the
38 states within Xcel Energy's ROI. Solar panels could be installed on the Monticello site, offsite
39 within Minnesota, or elsewhere within the ROI. Wind turbines would be installed offsite within
40 Minnesota or elsewhere within the ROI.

41 The NRC does not license natural gas or renewable energy facilities; therefore, the NRC would
42 not be responsible for ESA, MSA, or NMSA consultations for this alternative. The Federal and
43 private responsibilities for addressing impacts on federally protected ecological resources under

1 this alternative would be like those described in Section 3.8.5 of this EIS. Ultimately, the
2 magnitude and significance of adverse impacts on federally protected ecological resources
3 resulting from this alternative would depend on the site location and layout, plant design, plant
4 operations, and the protected species and habitats present in the area when the alternative is
5 implemented.

6 **3.8.8 Renewables and Storage Alternative**

7 Xcel Energy estimates that solar panels would be installed at as many as three different project
8 sites within the Xcel Energy ROI. Wind turbines would be installed offsite within Minnesota or
9 the ROI. Types of impacts to terrestrial species from the solar and wind energy facilities would
10 be similar to those described for the solar and wind portions of the previous alternative
11 (Section 3.6.7) as would permitting requirements from regulatory agencies. A small amount of
12 additional land would be needed to support the battery storage system at each solar project site.

13 The NRC does not license renewable energy facilities; therefore, the NRC would not be
14 responsible for ESA, MSA, or NMSA consultations for this alternative. The Federal and private
15 responsibilities for addressing the impacts on federally protected ecological resources under this
16 alternative would be like those described in Section 3.8.5 of this EIS. Ultimately, the magnitude
17 and significance of adverse impacts on federally protected ecological resources resulting from
18 this alternative would depend on the site location and layout, plant design, plant operations, and
19 the protected species and habitats present in the area when the alternative is implemented.

20 **3.8.9 New Nuclear (Small Modular Reactor) Alternative**

21 Because Minnesota prohibits the construction and operation of new nuclear power plants within
22 the State, the NRC staff assumes that the replacement plant would be constructed in one of the
23 other seven states within Xcel Energy's service area (i.e., Colorado, Michigan, New Mexico,
24 North Dakota, South Dakota, Texas, or Wisconsin).

25 The impacts of the new nuclear alternative are largely addressed in the impacts common to all
26 replacement power alternatives described in the previous section. Because the NRC would
27 remain the licensing agency under this alternative, the ESA and MSA would require the NRC to
28 consult with the FWS and NMFS, as applicable, before issuing a license for the construction
29 and operation of the new facility. During these consultations, the agencies would determine
30 whether the new reactors would affect any federally listed species, adversely modify or destroy
31 designated critical habitat, or result in adverse effects on EFH. If the new facility requires a CWA
32 Section 404 permit, USACE may be a cooperating agency for required consultations, or USACE
33 may be required to consult separately. Ultimately, the magnitude and significance of adverse
34 impacts on special status species and habitats would depend on the site location and layout,
35 nuclear power plant design, nuclear power plant operations, and the special status species and
36 habitats present in the area when the alternative is implemented.

37 **3.9 Historic and Cultural Resources**

38 This section describes the cultural background and the historic and cultural resources at
39 Monticello and its surrounding area. Historic and cultural resources describes material culture
40 left behind from past human activity. Cultural resources include sites, objects, landscapes,
41 structures, or other natural features of significance to groups of people who have traditional
42 association with it.

1 In this section of the EIS, a description of historic and cultural resources is followed by the NRC
2 staff's analysis of the potential impact on historic and cultural resources from the proposed
3 action (subsequent license renewal). This review also addresses the requirements of the NHPA
4 (TN4157) Section 106 process, specifically addressed in 36 CFR 800.3 through 800.5, to
5 determine if there is a potential for project-related activities to cause direct or indirect effects to
6 historic properties, and if so, to address those potential impacts. Section 106 of the NHPA
7 requires Federal agencies to consider the effects of their undertakings on historic properties
8 included on, or eligible for inclusion on, the National Register of Historic Places (NRHP [36 CFR
9 Part 800-TN513]). The NRHP is the Nation's official list recognizing buildings, structures,
10 objects, sites, and districts of national, State, or local historical significance which merit
11 preservation. The criteria for eligibility are listed in 36 CFR 60.4 (TN1682), Criteria for
12 Evaluation.

13 The proposed undertaking is subsequent renewal of the current renewed operating license,
14 which would extend the current operating term another 20 years. The Area of Potential Effect
15 (APE) consists of the 2,000 ac (809 ha) Monticello site located within the site boundary, where
16 activities associated with the operation of the facility could potentially compromise the integrity
17 of historic properties.

18 **3.9.1 Cultural Background**

19 Archaeological records document physical human occupation in Minnesota extending back
20 about 12,000 years. The Minnesota Office of the State Archaeologist (MnDA Undated-TN9657)
21 has general summaries of each time period. A synopsis is presented below.

22 *3.9.1.1 Paleoindian Period (prior to 7000 BC)*

23 Minnesota was glaciated until about 18,000 years ago, when warming temperatures and
24 receding glaciers began to uncover the southern half of the State during the end of the
25 Pleistocene epoch. Minnesota's archaeological record documents sites as early as around
26 12,000 years ago, or approximately 10,000 BC (MnDA Undated-TN9657).

27 Date ranges for the Paleoindian period that are generally accepted by archaeologists fall
28 between 11,500 before present (BP) to around 7,000 BP (9,550 to 5,050 BC). This period is
29 characterized by small groups of highly nomadic hunter-gatherers who followed big game such
30 as mammoths, mastodons, and bison across the landscape.

31 Stone tool technologies of this era are mostly associated with the Clovis and Folsom
32 (10,800 BC–9500 BC) cultures. Both cultures are known for their fluted points – large well-made
33 spear points characterized by a groove notched out in the middle to bottom half of the point,
34 allowing it to be attached to handles. Minnesota has documented numerous Clovis, or an
35 eastern variety of the fluted points, and Folsom points, in the State's archaeological record
36 (MnDA Undated-TN96577). A recent archaeological review identified at least two Folsom points
37 and one Plainview point recovered from Wright County, Minnesota, and one Folsom point from
38 Sherburne County, Minnesota, within the vicinity of the Monticello Nuclear Plant (Buhta et al.
39 2011-TN9656).

40 *3.9.1.2 Archaic Period (7000 BC to 500 BC)*

41 The Archaic period is the longest cultural period in Minnesota (MnDA Undated-TN9657). During
42 the Archaic period, Indigenous peoples became more sedentary, relying more on horticulture

1 and agriculture with a reduction in big game hunting for subsistence. Stone tool technologies
2 changed from larger spear points to smaller points that fit on atlatl darts. Copper tools
3 associated with the Old Copper Culture began to appear in tool assemblages (MnDA Undated-
4 TN9657). This era is divided into four subperiods based on the type of environmental adaption
5 that occurred: Prairie Archaic (west), Lake Forest Archaic (central and north central), Shield
6 Archaic (northeast), and Riverine Archaic (southeast) (MnDA Undated-TN9657).

7 ***Prairie Archaic***

8 The Prairie Archaic consisted of an adaptation to a grassland environment principally focused
9 on bison hunting for subsistence. The Itasca Bison site (located in Clearwater County), first
10 excavated in 1937, and again in the mid-1960s, is characteristic of this time period. The remains
11 of 16 now-extinct individual bison were recovered as well as side-notched dart points.
12 Radiocarbon dating confirm a site use between 7600 and 6000 BC (MnDA Undated-TN9657).

13 ***Lake Forest Archaic***

14 The Lake Forest Archaic in the central and north central portion of the State was characterized
15 by its wetter climate. Lakes increased in depth (by more than 30 ft [more than 9 m]) and
16 woodlands increased as well during this era. This period is the least understood
17 archaeologically as there are few sites excavated dating to the Lake Forest Archaic period. Like
18 the Prairie Archaic, there was a reliance on bison. However, regional variety allowed for broader
19 subsistence gathering (MnDA Undated-TN9657).

20 The Petaga Point site at the Mille Lacs Kathio State Park is a Lake Forest Archaic period site.
21 The site was first excavated in the 1920s and 1930s. Cultural material uncovered extensive Old
22 Copper components. Additional excavations completed in the 1960s by the University of
23 Minnesota also identified stone spear points, stone tools, and copper tools dating to over
24 3,000 years ago (Cummings Undated-TN9659).

25 ***Shield Archaic***

26 The Shield Archaic in northeastern Minnesota is named after the geological region it exists in-
27 the Canadian Shield (MnDA Undated-TN9657). The archaeological record for the Shield
28 Archaic is heavily based on sites from Canada. The absence of sites in Minnesota may be
29 attributed to the acidic soils of the coniferous forests and thus poor survival of bone (MnDA
30 Undated-TN9657). In Canada, sites dating to this time period are traditionally found at the
31 narrows of lakes and rivers where caribou may have crossed (MnDA Undated-TN9657).

32 The Fowl Lake site just south of the Canadian border is an example of a Shield Archaic site.
33 However, most of the existing artifact assemblage consists of surface collections collected by
34 non-archaeological professionals (MnDA Undated-TN9657).

35 ***Riverine Archaic***

36 The Riverine Archaic occurred along the Mississippi River and in deep-cut river valleys in
37 southeastern Minnesota. The river valley produced a variety of aquatic resources such as
38 waterfowl, fish, mussels, and tubers. Additionally, elk, deer, and bison were found in the
39 uplands. This area also provided fertile lands for growing squash and other crops (MnDA
40 Undated-TN9657).

1 The King Coulee site in Washaba County offers the most complete Late Archaic (1500–500 BC)
2 record. Excavations in the late 1980s showed deposits almost 6.5 ft (2 m) below the surface.
3 Artifacts such as stemmed projectile points, mussel shells, nuts, and squash seeds were
4 identified. Radiocarbon dates obtained directly from the squash, yielded dates of occupation
5 around 2,500 years ago, making it one of the earliest dates for cultigens in Minnesota’s
6 archaeological record (MnDA Undated-TN9657).

7 3.9.1.3 Woodland Period (500 BC to 1650 AD)

8 The Woodland Period represents more intensive plant cultivation (varieties of corn and wild
9 rice), the introduction of the bow and arrow, and the construction of burial mounds (MnDA
10 Undated-TN9657). Burial mounds have been recorded throughout the State except in the
11 northeast. The highest concentration of mounds is in the Red Wing area, the Lake Minnetonka
12 area, and near the Mille Lacs Lake (MnDA Undated-TN9657). Religion and technological
13 advances such as pottery also emerged during this time.

14 Individual Woodland complexes within the State are defined by the local ceramic types found in
15 those areas. The Laurel, Brainerd, and Blackduck complexes are in the north, while the Malmö,
16 St. Croix, Onamia, and Kathio complexes are found in the central region (MnDA Undated-
17 TN9657). The Lake Benton and Fox Lake complexes are noted in southwest Minnesota. Effigy
18 Mound, La Moille, Howard Lake, and Sorg have been identified in southeast Minnesota.

19 3.9.1.4 Contact Period/Mille Lacs Band of Ojibwe History (1600s AD to present)

20 In the mid-17th century, European explorers and fur traders began arriving in the region. The
21 area was mostly occupied by the Dakota. The French initially claimed the land, ceded it to Spain
22 in 1762, then regained it in 1800 only to sell it to the United States in 1803 as part of the
23 Louisiana Purchase. During this time, the Ojibwe began moving westward into the area, in some
24 cases conflicting with the Dakota. In 1849, Minnesota was established as a territory. Treaties
25 with the Tribes were signed around 1850. In 1858, Minnesota became a State (NRC 2006-
26 TN7315). The Mille Lacs Band of Ojibwe considers the area where the Monticello plant is
27 located as part of their usual and accustomed places, where they exercise the protection of
28 natural and cultural resources (Mille Lacs Band of Ojibwe 2023-TN9666).

29 The Mille Lacs Band of Ojibwe refer to themselves as *Anishinaabe*, the first and original people
30 (Godfrey 1993-TN9660). Approximately 500 years ago, the Ojibwe migrated west from the
31 Atlantic coast, eventually settling around the Mille Lacs Lake, in what is now the east central
32 part of Minnesota (Mille Lacs Band of Ojibwe Undated-TN9661). European fur traders and
33 missionaries began contact with Indigenous groups, including the Mille Lacs Band of Ojibwe,
34 around the mid-1600s (MnDA Undated-TN9657).

35 In 1837, the Ojibwe and Dakota ceded millions of acres to the United States under the Treaty of
36 1837, relinquishing lands in what is present-day Minnesota and Wisconsin. The treaty
37 guaranteed the rights to hunt, fish, and gather on the ceded lands (Minnesota Indian Affairs
38 Council Undated-TN9662). Following the Treaty of 1837, the Treaty of 1855 reserved 61,000 ac
39 (24685 ha) to establish the Mille Lacs Band of Ojibwe Reservation (Mille Lacs Band of Ojibwe
40 Undated-TN9661).

41 Over the decades, European settlers continued to occupy reservation lands. In 1879, the
42 U.S. government opened the reservation lands for timber companies and others to purchase
43 (Mille Lacs Band of Ojibwe Undated-TN9663), violating the Mille Lacs Band of Ojibwe rights
44 under the treaty. By the late 1800s, the Band was left nearly landless, and members were

1 removed from their homelands (Mille Lacs Band of Ojibwe Undated-TN9661). The passing of
2 the Nelson Act in 1889 allowed Ojibwe populations to acquire land allotments on their own
3 reservations but also allowed the government to sell the non-allotted “surplus” lands to the
4 public. In 1999, the U.S. Supreme Court upheld the rights of the Mille Lacs Band of Ojibwe
5 under the Treaty of 1855, affirming that the treaty had not ceded rights to land that the Ojibwe
6 had retained in 1837 (Minnesota Indian Affairs Council Undated-TN9664; USDOJ 2023-
7 TN9665) and that the U.S. government had violated the treaty.

8 The following is a brief history from the 1600s to late 1800s as viewed by the Mille Lacs Band of
9 Ojibwe (Mille Lacs Band of Ojibwe 2023-TN9666):

10 To start, along with our Ojibwe migration into this region in the mid-1600s came
11 the French fur traders who took advantage of our trade and commerce networks.
12 Our migration brought on resource competition with the Dakota peoples in the
13 area, resulting in frequent disputes, often hyper-inflated by the Euro-American
14 communities as “wars.” One such disputed area was the land between the
15 current Cities of Monticello–Big Lake to Otsego–Elk River, bounded by the *Misi-*
16 *ziibi* (Great River, i.e., Mississippi River) on the south and the *Gaabiitootigweyaa-*
17 *ziibi* (That Which the Stream Parallels [the Mississippi] River, i.e. Elk River) on the
18 north. In our Ojibwe language we call this area as our *Miigaadiwining* (At the
19 “Battling”) due to the disputes that occurred in 1772 and 1773, and various
20 historical documents in English call this region “Battle Point.”

21 As a result, Artz et al. (1976-TN9667) recorded 334 burial mounds in 26 groups
22 in Sherburne County, and 383 burial mounds in 57 groups in Wright County.
23 Additionally, Battle Rapids which is located downstream of the Minnesota
24 Highway 25 (MN-25) bridge in the City of Monticello is called in Ojibwe
25 *Miigaadiwini-zaasijiwan* (Battling Rapids), with City of Monticello’s Battle Rapids
26 Park along its shores. Otter Creek, located between the Monticello Plant and City
27 of Monticello’s downtown, in Ojibwe goes by two names: as *Nigigo-ziibiwishenh*
28 (Otter Brook), but also as *Miigaadiwin-ziibiwishenh* (“Battling” Brook).

29 Next, approximately 6-miles upstream from there, located in the Mississippi River
30 within the Monticello Plant’s site boundaries is our *Basa’igaan* (Place of Hewing),
31 to which Cedar Island known in Ojibwe as *Basa’igaani-minis* (Hewing Island) and
32 *Basa’igaani-zaasijiwan* (Hewing Rapids) are located due to the rich red cedar
33 (*Juniperus virginiana*) forest that once stood along the banks of the Mississippi
34 River, to which red cedar wood were hewn for our dugout canoes. This red cedar
35 forest extended to Cedar Lake located 5-miles south of the Monticello Plant,
36 which in Ojibwe is called *Meskwaawaako-minisiwang zaaga’igan* (Red Cedar
37 Islanding Lake). Farther upstream along the *Misi-ziibi* from the Monticello Plant
38 site are *Zhooniyaa-ziibiwishenh* (Silver Brook) known in English as Silver Creek
39 and *Gaa-biskaabiitigweyaag-ziibiwishenh* (Brook of the Oxbowing Place),
40 recorded by Joseph Nicollet as “Bend Creek” but is known today in English as
41 Fish Creek.

42 With the signing of the 1825 Treaty of Prairie du Chien (7 Stat. 272), the territorial
43 dispute between the Ojibwe and the Dakota were settled, and the area where the
44 Monticello Plant site sits became undisputed Dakota territory. But due to this
45 history, we do consider the area as our historical landscapes and cultural

1 properties and claim the area as part of our Usual and Accustomed Places for
2 the protection of our cultural resources, with the Dakota nations taking the lead.

3 When the 1837 Ojibwe ceded territory (Royce Area 242) and the 1837 Dakota
4 ceded territory (Royce Area 243) became part of the United States, Tribal nations
5 reserved certain usufructuary privileges which the Treaties protect. With this
6 dynamic change, the whole area north of the Mississippi River was opened up to
7 Euro-American settlement. Later, the United States entered into Treaty
8 negotiations with various Dakota nations for the area south of the Mississippi
9 River; the 1851 Treaties of Traverse des Sioux (10 Stat. 949) and of Mendota
10 (10 Stat. 954) ceded territory (Royce Area 289) officially became part of the
11 United States, further opening up the area for Euro-American settlement.

12 Settlement patterns by the Euro-Americans in the area created series of Red
13 River Ox-cart Trails, appearing along both banks of the Mississippi River as east
14 river road (known formally as the Red River Road) which was eventually
15 improved and replaced by US Highway 10 (US-10), and as west river road which
16 was improved with the section near the Monticello Plant becoming Broadway St
17 and County Road 75 (CR-75), and replaced by Interstate Highway 94 (I-94).
18 These river roads are depicted in the General Land Office surveys of Township
19 33 North Range 28 West of the 4th Parallel Meridian in Royce Area 243 in 1851,
20 and of Township 122 North Range 25 West of the 5th Parallel Meridian in Royce
21 Area 289 in 1857. Understanding the importance of roads and riverways for the
22 economy, our ancestors ensured the United States would build roads to serve
23 our reservation. Under Articles III and VIII of the 1855 Treaty of Washington
24 (11 Stat. 1165), roads were authorized to be built from our Mille Lacs
25 Reservation to what today is the City of Anoka to ensure our access to the Red
26 River Road and to the Mississippi River. In addition to roads, the US Army had
27 conducted surveys of the upper Mississippi River in 1873 and conducted further
28 assessments in 1874 to determine the feasibility of navigation.

29 **3.9.2 Historic and Cultural Resources at Monticello**

30 Historic and cultural resources within the Monticello site can include prehistoric and historic era
31 archaeological sites, historic districts, and buildings, as well as any site, structure, or object that
32 may be considered eligible for listing on the NRHP. Historic and cultural resources also include
33 traditional cultural properties that are important to a living community of people for maintaining
34 their culture. "Historic property" is the legal term for a historic or cultural resource that is
35 included on, or eligible for inclusion on, the NRHP. To gain a better understanding of the
36 archaeological resources within the region, a 1 mi (1.6 km) buffer was incorporated in the
37 literature search to learn what previously recorded sites and surveys exist within the APE and
38 beyond. This information helps cultural resources professionals understand what resources may
39 potentially be in the field.

40 ***Previously Recorded Historic and Archaeological Resources***

41 There are no previously recorded sites within the project site. Three previously recorded
42 archaeological sites, all consisting of lithic scatters, are within 1 mi (1.6 km) of the APE. The
43 closest site is approximately 0.75 mi (1.2 km) (MnDA Undated-TN9688). Fifteen historic
44 resources are also within 1 mi (1.6 km) of the APE. This includes four historic roads, four
45 historic houses, four historic farmsteads, two historic railroads, and one historic bridge (MnSHIP
46 Undated-TN9687).

1 **Previous surveys**

2 Cultural resource surveys were not conducted within the Monticello site before its construction
3 in 1967. In 2022, Xcel Energy commissioned SEARCH, Inc. to conduct an architectural history
4 survey to evaluate Monticello’s eligibility for listing. SEARCH performed an intensive
5 architectural survey of Monticello in September 2022, surveying 80 ac (32.4 ha) of the built
6 environment (Xcel 2023-TN9578). In total, 27 individual resources were inventoried.
7 Additionally, Monticello was evaluated collectively as a potential historic district. On February
8 27, 2023, the Minnesota State Historic Preservation Office (MNSHPO) concurred with the
9 recommendation in the architectural survey report that none of the inventoried resources met
10 the criteria for listing in the NRHP (Theriot et al. 2023-TN9689; MnDA SHPO 2023-TN9668).

11 In 2023, Xcel Energy contracted Westwood Professional Services, Inc. (Westwood) to conduct
12 a Phase IA cultural resources literature search. In support of the literature search, a field visit
13 was conducted in late October 2023 to assess the nature of the ground cover, identify areas of
14 archaeological interest, and determine the level of effort that might be required to conduct a
15 formal and comprehensive archaeological survey of the property at a later date.

16 Westwood summarized previous disturbances throughout the APE and identified areas that may
17 have a higher potential of encountering intact archaeological deposits. Approximately
18 12 percent of the APE has been previously disturbed and 88 percent is potentially undisturbed.
19 Of the disturbed areas, approximately 19 percent is deeply disturbed (greater than 10 ft [3.0 m])
20 and approximately 81 percent is surface level disturbance (disturbance is limited to the upper
21 10 ft [3.0 m] of ground surface) or unknown depths of disturbance (Xcel 2024-TN9859). In the
22 field visit, Westwood confirmed that no additional buildings 45 years or older were within the
23 APE. However, as part of the literature search, Westwood reviewed historical maps and aerial
24 photography and noted more than 20 nonextant building sites. Westwood concurred with the
25 recommendations previously described in SEARCH’s architectural survey report (Theriot et al.
26 2023-TN9689).

27 Westwood identified areas within the APE that had a lower possibility of encountering intact
28 archaeological deposits versus areas with a higher potential. As such, Westwood recommends
29 Xcel Energy conduct a formal Phase I survey in high archaeological potential areas prior to any
30 ground disturbance. For areas that have the lower potential for intact archaeological deposits,
31 Westwood recommends that a qualified archaeological professional review proposed
32 construction within these areas to determine the appropriate next steps, which could include
33 monitoring or a survey. For areas of deep disturbance, Westwood recommends no additional
34 cultural resources survey due to the documented significant ground disturbance that most likely
35 eliminated the potential for intact cultural resource deposits.

36 Through consultation (see Section 3.9.4.1 below), the Mille Lacs Band of Ojibwe identified red
37 cedar (*Juniperus virginiana*) and wild rice (*Zizania* spp.) as part of their cultural resources and
38 requested that a vegetation survey occur within the APE to confirm the presence or absence of
39 the natural resources within the property. Westwood biologists conducted a tree survey between
40 October and December 2023 to inventory red cedar within the 2,000 ac (809 ha) APE. Based on
41 their December 2023 summary report (Xcel 2024-TN9859), Westwood confirmed about 12,000
42 red cedar trees within the APE. Because the peak growth period for wild rice is between July
43 and early October, Westwood was not able to complete a survey for wild rice during their field
44 visit. Westwood plans to complete the survey in early summer 2024 (Xcel 2024-TN9859).

1 **3.9.3 Procedures**

2 Xcel Energy has three procedures in place to identify, protect, and minimize the potential impact
3 to cultural resources at Monticello (Xcel 2023-TN9084). The procedures currently define what
4 actions are taken in the event of unanticipated discoveries. Xcel Energy is in process of
5 updating these procedures to incorporate the results and recommendations provided in
6 Westwood’s literature review and consultation with the Mille Lacs Band of Ojibwe to ensure the
7 continued protection of archaeological, cultural, and historic resources. Procedures will be
8 updated to stipulate:

- 9 (1) No further cultural resources work where deep-level disturbances have been
10 documented.
- 11 (2) For projects that would take place in areas that have a lower potential for intact
12 archaeological deposits, Xcel Energy will review projects with a Secretary of Interior
13 qualified archaeologist to determine the appropriate next steps based on that
14 assessment (i.e., archaeological monitoring, survey).
- 15 (3) For projects where ground disturbance would occur in higher potential areas, a
16 Phase 1 cultural resources survey should be done prior to any development.
- 17 (4) For projects where ground disturbance would occur outside the Monticello facility
18 complex and that are under the control of NSPM, the Mille Lacs Band of Ojibwe will
19 be notified and invited to monitor ground disturbing activities. Exceptions to having a
20 Tribal monitor would apply to situations such as emergencies or other extenuating
21 circumstances that would require time-sensitive excavations.

22 Because the Monticello facility has been evaluated and determined to be not eligible for the
23 NRHP, no further cultural resources considerations is recommended.

24 **3.9.4 Proposed Action**

25 The NHPA of 1966, as amended (54 U.S.C. 300101 et seq. TN4157), requires Federal
26 agencies to consider the effects of their undertakings on historic properties. Issuing a
27 subsequent renewed operating license to a nuclear power plant is a Federal undertaking that
28 could potentially affect historic properties. Historic properties are defined as resources included
29 on, or eligible for inclusion on, the NRHP. The criteria for eligibility are listed in “Parks, Forests,
30 and Public Property” of the 36 CFR Part 60 (TN1682) Section 60.4 “Criteria for Evaluation,” and
31 include (a) association with significant events in history, (b) association with the lives of persons
32 significant in the past, (c) embodiment of distinctive characteristics of a type, period, or method
33 of construction, or (d) sites or places that have yielded, or may be likely to yield, information
34 important in prehistory or history.

35 In accordance with NHPA provisions, the NRC is required to make a reasonable effort to identify
36 historic properties included on, or eligible for inclusion on, the NRHP in the APE. The APE for a
37 subsequent license renewal action includes the power plant site, the transmission lines up to the
38 first substation, and immediate environs that may be affected by the subsequent license
39 renewal decision and land-disturbing activities associated with continued reactor operations
40 during the subsequent license renewal term. In addition, the NRC is required to notify the State
41 Historic Preservation Officer (SHPO) if historic properties would not be affected by subsequent
42 license renewal or if no historic properties are present. In Minnesota, the Minnesota State

1 Historic Preservation Office administers the State’s historic preservation program. The NRC
2 also notifies all consulting parties, including American Indian Tribes, and makes this finding
3 public (through the NEPA process) before issuing subsequent renewed operating licenses.
4 Similarly, if historic properties are present and could be affected by the undertaking, the NRC is
5 required to assess and resolve any adverse effects in consultation with the SHPO and any
6 American Indian Tribe that attaches religious and cultural significance to identified historic
7 properties.

8 The proposed undertaking is the subsequent renewal of the current renewed operating license,
9 which would extend the current operating term another 20 years. The APE consists of the
10 2,000 ac (809 ha) Monticello site where activities associated with the operation of the facility
11 could potentially compromise the integrity of historic properties.

12 3.9.4.1 Consultation

13 In accordance with 36 CFR 800.8, “Coordination with the National Environmental Policy Act,” on
14 March 13, 2023, the NRC staff initiated written consultations with the Advisory Council on
15 Historic Preservation (ACHP) and the Minnesota State Historic Preservation Office (TN513).
16 Also, on March 13, 2023, the NRC staff-initiated consultation with 30 federally recognized
17 Tribes. In these letters, the NRC staff provided information about the proposed action, defined
18 the APE, and indicated that the NHPA review would be integrated with the NEPA process, in
19 accordance with 36 CFR 800.8(c) (TN513). The NRC staff invited participation in the
20 identification of, and possible decisions concerning, historic properties and invited participation
21 in the scoping process. Appendix C includes copies of consultation documents.

22 On July 3, 2023, the Minnesota SHPO stated in its correspondence to the NRC that based on
23 their understanding of the scope of the proposed Federal undertaking, their office “generally
24 agree[s] that relicensing of Monticello facility does not require an archaeological survey due to
25 the extensive existing disturbance created when the facility was constructed in the late 1960s to
26 1971 and also that no new construction will occur as part of the relicensing” (MnDA SHPO
27 2023-TN9668). However, the Minnesota SHPO requested documentation “that describes and/or
28 shows the horizontal and vertical extent of these disturbed areas within the site boundary and a
29 clearer understanding that the relicensing would not result in any future ground-disturbance
30 beyond what has already been documented as thoroughly disturbed” and a map indicating
31 areas within the site boundary where Xcel Energy is committed to performing an archaeological
32 survey due to the lack of previous ground disturbance (MnDA SHPO 2023-TN9668). On
33 August 3, 2023, NRC staff met with representatives from the Minnesota SHPO (NRC 2023-
34 TN9773). During this meeting, NRC staff (1) discussed the APE of the undertaking; (2) provided
35 a general discussion related to routine operation and maintenance activities; and (3) requested
36 clarification regarding the documentation requested in the July 3, 2023 letter. By letter dated
37 August 21, 2023, to the NRC, the Minnesota SHPO stated that “based on the clarification
38 regarding the agency’s definition of the APE for this type of undertaking and the potential
39 activities that may occur within the APE, we recommend that a Phase I archaeological survey
40 be completed by a qualified archaeologist.” However, the Minnesota SHPO stated that if the
41 project area can be documented as previously surveyed or disturbed, as they indicated in their
42 July 3, 2023 letter, they will reconsider the need for a survey (MnDA SHPO 2023-TN9669).

43 On April 12, 2023, in correspondence to the NRC, the Mille Lacs Band of Ojibwe provided their
44 concerns related to the undertaking and requested continued discussions through government-
45 to-government consultation (Mille Lacs Band of Ojibwe 2023-TN9666). On July 25, August 10,
46 2023, and January 11, 2024 (NRC 2023-TN9671, NRC 2023-TN9670, NRC 2024-TN9772), the

1 NRC staff conducted teleconferences with representatives from the Mille Lacs Band to continue
2 dialogue and consultation. During the July 25, 2023, teleconference, the Mille Lacs Band
3 expressed concern that Monticello has not been subject to a cultural resources survey. During
4 the August 10, 2023, teleconference, the Mille Lacs Band requested that an inventory of
5 culturally important plant species be conducted to determine/identify if red cedar
6 (*Juniperus virginiana*) and wild rice (*Zizania* spp.) are present on the Monticello site.
7 Additionally, the Mille Lacs Band requested to participate in surveys conducted on the
8 Monticello site. As discussed in Section 3.9.2 above, Xcel Energy contracted Westwood
9 Professional Services, Inc. (Westwood) to conduct a Phase IA cultural resources literature
10 search and a survey of culturally important plant species within the Monticello site. In support of
11 the literature search, a field visit was conducted in late October 2023 and a representative of the
12 Mille Lacs Band's Tribal Historic Preservation Office was in attendance. On December 6, 2023,
13 a representative of the Mille Lacs Band's Tribal Historic Preservation Office was also in
14 attendance when the culturally important plant species survey was conducted (Xcel 2024-
15 TN9859). Because the peak growth period for wild rice is between July and early October,
16 Westwood was not able to complete a survey for wild rice during their field visit. Westwood
17 plans to complete the survey in early summer of 2024. Xcel Energy will invite the Mille Lacs
18 Band to participate in the wild rice survey (Xcel 2024-TN9859). During the January 11, 2024,
19 the NRC discussed comments from the Mille Lacs Band regarding the Monticello site cultural
20 resource literature search and red cedar survey commissioned by Xcel Energy. During the
21 January 11, 2024 teleconference, the Mille Lacs Band requested that should ground
22 disturbance occur outside the Monticello facility complex, a Tribal monitor should be present
23 (NRC 2024-TN9772). As discussed in Section 3.9.3 above, Xcel Energy is updating its site
24 procedures to incorporate a direction to notify and invite the Mille Lacs Band to monitor ground
25 disturbing activities should ground disturbance occur in areas outside the Monticello facility
26 complex and that are under the control of NSPM (Xcel 2024-TN9859).

27 3.9.4.2 Findings

28 Section 3.9.2 discusses historic and cultural resources on the Monticello property. Xcel Energy
29 did not identify refurbishment activities or new construction necessary for the continued
30 operation of Monticello during the SLR period (Xcel 2023-TN9084). Xcel Energy does not plan
31 to alter operations, expand existing facilities, physical changes, or disturb additional land to
32 support SLR. Plant operations and maintenance activities necessary to support subsequent
33 license renewal would be limited to previously disturbed areas and is expected to be similar to
34 current operations (Xcel 2023-TN9084, Xcel 2023-TN9578).

35 Section 2.1 of this EIS describes the types of activities carried out during nuclear power plant
36 operations; these include reactor operation, waste management, cooling water intake and
37 discharge, nuclear fuel receipt and storage, spent fuel security, office and clerical work,
38 maintenance, and refueling outages. Section 2.1.7 describes that maintenance activities
39 conducted at Monticello include inspection, testing, and surveillance to maintain the current
40 licensing basis of the facility. These activities include in-service inspections of safety-related
41 structures, systems, and components; quality assurance and fire protection programs, and
42 radioactive and nonradioactive water chemistry monitoring. If operations and maintenance
43 activities (such as inspection or maintenance of subsurface features like pipelines and conduits)
44 require ground disturbance during the SLR period, Xcel Energy anticipates that they would
45 occur on previously disturbed ground (Xcel 2023-TN9084, Xcel 2023-TN9578).

1 For the purposes of the NRC's NHPA review, the NRC staff has determined that the
2 undertaking will result in No Adverse Effect, as defined in 36 CFR 800.5(b). In the event that
3 ground disturbance is necessary for future development, Xcel Energy will have procedures in
4 place to reduce impacts to any cultural resources encountered. Archaeologists would be
5 consulted prior to development to determine the potential for encountering intact cultural
6 deposits and/or a Phase 1 archaeological survey would be conducted. Archaeological
7 monitoring would also occur during project activities to minimize impacts to cultural resources.

8 Based on (1) Xcel Energy's statement that it does not plan to alter operations, expand existing
9 facilities, or disturb additional land during the subsequent license renewal period, (2) input from
10 consulting parties, and (3) Xcel Energy's updates to procedures to identify, protect, and
11 minimize the potential impact to cultural resources at Monticello, the NRC staff concludes that
12 SLR for Monticello would not adversely affect historic properties or historic and cultural
13 resources.

14 **3.9.5 Alternatives**

15 *3.9.5.1 No-Action Alternative*

16 Under the no-action alternative, land-disturbance activities or dismantlement are not anticipated,
17 as these would be conducted during decommissioning. Therefore, facility shutdown and
18 adoption of the no action alternative would have no immediate effect on historic properties or
19 historic and cultural resources.

20 Known historic properties and cultural resources at Monticello would be unaffected if the NRC
21 does not renew the operating license and Xcel Energy terminates reactor operations. Under
22 10 CFR 50.82, "Termination of License," power reactor licensees are required to submit a
23 post-shutdown decommissioning activities report to the NRC, which would describe the plant's
24 planned decommissioning activities. (TN249). Until the post-shutdown decommissioning
25 activities report is submitted, the NRC staff cannot determine whether historic properties would
26 be affected outside the existing industrial site boundary by decommissioning activities, after the
27 nuclear power plant ceases operations.

28 *3.9.5.2 Replacement Power Alternatives: Common Impacts*

29 The potential for impacts to historic and cultural resources from construction and operation of a
30 replacement power alternative would vary greatly depending on the location of the site. If
31 construction and operation of replacement power alternatives require a Federal undertaking
32 (e.g., license, permit), in accordance with Section 106 of the NHPA, a reasonable effort to
33 identify historic properties within the APE and consideration of the effects of their undertakings
34 on historic properties would be required. Historic and cultural resources identified would need to
35 be recorded and evaluated for eligibility for listing on the NRHP. If historic properties are present
36 and could be affected by the undertaking, adverse effects would be assessed, determined, and
37 mitigated with the State Historic Preservation Officer and any American Indian Tribe that
38 attaches religious and cultural significance to identified historic properties through the
39 Section 106 consultation process.

1 Construction

2 Impacts to historic and cultural resources from the construction of replacement power
3 alternatives are primarily related to ground disturbance (e.g., land clearing, excavations). The
4 potential impact on historic and cultural resources during the construction of replacement
5 power-generating facilities would vary depending on the degree disturbance. Areas subject to
6 ground disturbance would need to be surveyed to identify and record historic and cultural
7 material. In accordance with 36 CFR Part 800 (TN513), any historic and cultural resources
8 found during these surveys would need to be evaluated for eligibility for listing in the NRHP if
9 construction of the replacement alternative requires a Federal undertaking. Areas of greatest
10 cultural sensitivity should be avoided while maximizing the use of previously disturbed areas.
11 Viewshed impacts to historic and cultural resources present can occur from the introduction of
12 structures and new transmission lines that are out of character with the current setting.

13 Operations

14 The potential for impacts on historic and cultural resources from the operation of replacement
15 power alternatives would be related to ground disturbing activities at the site or modifications to
16 the facility. Areas subject to ground disturbance would need to be surveyed to identify and
17 record historic and cultural material. Avoidance of historic and cultural resources should be
18 possible and effectively managed. Modifications to structures would have the potential for
19 viewshed impacts to historic and cultural resources.

20 3.9.5.3 *Natural Gas and Renewables Alternative*

21 Impacts on historic and cultural resources from the construction and operation of a natural gas
22 and renewable alternative would include those discussed above as impacts common to all
23 replacement alternatives (see Section 3.9.5.2). The potential for impacts during construction on
24 historic and cultural resources of this alternative would vary greatly, depending on the location
25 of the proposed sites. The construction of a natural gas, two-unit combustion turbine power
26 plant and wind turbines could be at an existing power plant or a greenfield site. The potential for
27 impacts on historic and cultural resources would result from land disturbances. Impacts would
28 depend on the resource richness of the sites, the gas pipeline corridor, and transmission
29 corridors. Using previously disturbed sites (such as at an existing power plant site) and co-
30 locating any new transmission lines with existing rights-of-way could minimize impacts to
31 historic and cultural resources. Aesthetic changes from new structures and new transmission
32 lines could have a noticeable effect on the viewshed of historic and cultural resources present. If
33 an existing power plant site is selected, the NRC does not anticipate viewshed impacts to
34 historic or cultural resources from the introduction of structures as they would be compatible
35 with the power plant setting. However, if a greenfield site is selected, viewshed impacts to
36 historic or cultural resources could occur from the introduction of new structures that are not
37 compatible with the setting.

38 Solar panels could be installed at as many as three locations, both on the Monticello site and
39 offsite in Minnesota or elsewhere in Xcel Energy's service area. Installation of solar panels
40 would require 1,500 ac (586 ha) and an additional 1,450 ac (586 ha) for a new transmission
41 corridor. Wind turbines could be installed offsite within Minnesota or elsewhere in Xcel Energy's
42 service area. Utility-scale wind farms would require relatively large areas. Approximately
43 66,000 ac (2,709 ha) would be disturbed during installation of the wind turbines and would
44 require an additional 2,700 ac (1,093 ha) for a new transmission corridor. The potential for
45 impacts on historic and cultural resources from the solar and wind components would result

1 from land disturbances and aesthetic changes that could have a noticeable effect on the
2 viewshed of nearby historic properties. Using previously disturbed sites (such as the Monticello
3 site) and co-locating any new transmission lines with existing rights-of-way could minimize
4 impacts to historic and cultural resources.

5 The potential for impacts on historic and cultural resources from purchased power or existing
6 natural gas power plants would depend on the need for plant modifications. For instance, if
7 purchased power would require plant modifications at existing facilities or construction of
8 transmission lines requiring land disturbance, there is a potential for impacts on historic and
9 cultural resources. However, if there are no changes to the facilities or no need for additional
10 transmission lines, impacts on historic and cultural resources would not be anticipated.

11 Routine facility operations would not result in impacts to historic and cultural resources. Any
12 maintenance activities that require ground disturbing activities have the potential to impact
13 historic and cultural resources. Ground disturbing maintenance activities in previously disturbed
14 areas within the sites would minimize impacts to historic and cultural resources.

15 Overall, the potential for impacts on historic and cultural resources from construction and
16 operation of a natural gas and renewables alternative would vary greatly depending on site
17 locations and resources present.

18 3.9.5.4 *Renewables and Storage Alternative*

19 Impacts on historic and cultural resources from the construction and operation of a renewables
20 and storage alternative would include those discussed above as impacts common to all
21 replacement alternatives (see Section 3.9.5.2). The potential for impacts during construction on
22 historic and cultural resources from the wind and solar portion of this alternative would vary
23 greatly, depending on the location of the proposed sites. Wind turbines could be installed offsite
24 within Minnesota or elsewhere in Xcel Energy's service area. Utility-scale wind farms would
25 require relatively large areas. Approximately 84,000 ac (3,400 ha) would be disturbed during
26 installation of the wind turbines and would require an additional 2,700 ac (1,093 ha) for a new
27 transmission corridor. Solar panels could be installed at as many as three sites, both on the
28 Monticello site and offsite in Minnesota or Xcel Energy's service area. Installation of solar
29 panels would require 5,300 ac (2,144 ha) and additional 4,500 ac (1,821 ha) for a new
30 transmission corridor. Construction of wind turbines (their support infrastructure) and solar
31 panels, and to a lesser extent, battery storage, could impact historic and cultural resources
32 because of earth moving activities (e.g., grading and digging) and aesthetic changes that could
33 have a noticeable effect on the viewshed of resources nearby. Using previously disturbed sites
34 and co-locating any new transmission lines with existing rights-of-way could minimize impacts to
35 historic and cultural resources.

36 The potential for impacts on historic and cultural resources from purchased power or existing
37 natural gas power plant would depend on the need for plant modifications. For instance, if
38 purchased power would require plant modifications at existing facilities or construction of
39 transmission lines requiring land disturbance, there is a potential for impacts on historic and
40 cultural resources. However, if there are no changes to the facilities or no need for additional
41 transmission lines, impacts on historic and cultural resources would not be anticipated.

42 Routine facility operations of the renewable and storage alternative would not result in impacts
43 to historic and cultural resources. Any maintenance activities that require ground-disturbing
44 activities has the potential to impact historic and cultural resources. Ground disturbing

1 maintenance activities in previously disturbed areas within the sites would minimize impacts to
2 historic and cultural resources.

3 Overall, the potential for impacts on historic and cultural resources from construction and
4 operation of a renewable and storage alternative would vary greatly depending on site locations
5 and resources present.

6 3.9.5.5 *New Nuclear (Small Modular Reactor) Alternative*

7 Impacts on historic and cultural resources from the construction and operation of a new nuclear
8 alternative (12 unit small modular reactor power plant) would include those discussed above as
9 impacts common to all replacement alternatives (see Section 3.9.5.2). The construction of new
10 nuclear alternative would require 130 ac (52 ha) and would be located at a greenfield site or
11 existing power plant site outside of Minnesota, but within Xcel Energy's service area. An
12 additional 450 ac (182 ha) would be needed for the new transmission corridor. The potential for
13 impacts on historic and cultural resources would result from land disturbances. Impacts would
14 depend on the resource richness of the site and transmission corridor. Using previously
15 disturbed sites (such as at an existing power plant site) and co-locating any new transmission
16 lines with existing rights-of-way could minimize impacts to historic and cultural resources.
17 Aesthetic changes from the 76 ft (23 m) tall containment structure, steam plume from cooling
18 towers, and new transmission lines could have a noticeable effect on the viewshed of historic
19 and cultural resources present. If an existing power plant site is selected, the NRC staff does
20 not anticipate viewshed impacts to historic or cultural resources from the introduction of
21 structures as they would be compatible with the power plant setting. However, if a greenfield
22 site is selected, viewshed impacts to historic or cultural resources could occur from the
23 introduction of new structures.

24 Routine normal plant operations would not result in impacts to historic and cultural resources.
25 Any maintenance activities that require ground disturbing activities has the potential to impact
26 historic and cultural resources. Ground disturbing maintenance activities in previously disturbed
27 areas within the site would minimize impacts to historic and cultural resources. Modifications or
28 additions to the existing facility would have the potential to cause viewshed impacts to historic
29 and cultural resources.

30 Overall, the potential for impacts on historic and cultural resources from construction and
31 operation of a new nuclear alternative would vary greatly depending on the location of the site.

32 **3.10 Socioeconomics**

33 This section describes current socioeconomic factors that have the potential to be affected by
34 changes in power plant operations at Monticello. Monticello and the communities that support it
35 can be described as a dynamic socioeconomic system. The communities supply the people,
36 goods, and services required to operate the nuclear power plant. Nuclear power plant
37 operations, in turn, supply wages and benefits for people and dollar expenditures for goods and
38 services. The measure of a community's ability to support Monticello continued reactor
39 operations depends on its ability to respond to changing environmental, social, economic, and
40 demographic conditions.

1 **3.10.1 Nuclear Power Plant Employment**

2 The socioeconomic ROI is defined by the areas where Monticello workers and their families
3 reside, spend their income, and use their benefits, thus affecting the economic conditions of the
4 region. Xcel Energy employs a permanent and supplementary full-time workforce of
5 663 workers (Xcel 2023-TN9084). Sixty-six percent of Monticello permanent workers reside in
6 Sherburne and Wright Counties, Minnesota (Xcel 2023-TN9084). The remaining workers are
7 spread among other counties in Minnesota and other States (Xcel 2023-TN9084) (Table 3-21).
8 Because most Monticello workers are based in Sherburne and Wright Counties, the greatest
9 socioeconomic effects are likely to be experienced there. The focus of the impact analysis,
10 therefore, is on the socioeconomic impacts of continued Monticello operation in Sherburne and
11 Wright counties.

12 **Table 3-21 Residence of Xcel Energy Permanent Employees**

State or County	Number of Employees	Percentage of Total
Sherburne	146	39
Wright	102	27
Hennepin	42	11
Stearns	37	10
Other Minnesota counties	44	12
Other States	3	1
Total	374	100

13 Refueling outages occur on a 2 year staggered cycle during April and May. Refueling outages
14 last 25–33 days and additional 650 workers are onsite during a typical outage (Xcel 2023-
15 TN9084).

16 **3.10.2 Regional Economic Characteristics**

17 Goods and services are needed to operate the Monticello site. Although procured from a wider
18 region, some portion of these goods and services are purchased directly from within the
19 socioeconomic ROI. These transactions sustain existing jobs and maintain income levels in the
20 local economy. This section presents information about employment and income in the
21 Monticello socioeconomic ROI.

22 *3.10.2.1 Regional Employment and Income*

23 According to the U.S. Census Bureau’s (USCB’s) 2017–2021 American Community Survey
24 5-Year Estimates, educational services and the healthcare and social assistance industry
25 represented the largest employment sector in the socioeconomic ROI, followed by
26 manufacturing (USCB 2022-TN9556). The Sherburne and Wright County civilian labor force
27 consisted of 130,919 individuals and the number of employed individuals was 127,600 (USCB
28 2022-TN9556). Estimated income information for the socioeconomic ROI is presented in
29 Table 3-22.

1 **Table 3-22 Estimated Income Information for the Monticello Socioeconomic Region of**
 2 **Influence (2017–2021, 5-Year Estimates)**

Metric	Sherburne County	Wright County	Minnesota
Median household income (dollars) ^(a)	92,374	94,276	77,706
Per capita income (dollars)(a)	38,423	39,327	41,204
Families living below the poverty level (percent)	3	3.3	5.6
People living below the poverty level (percent)	5	4.9	12.6
Unemployment rate	2.7	2.4	4.0

(a) In 2019 inflation-adjusted U.S. dollars.
 Source USCB 2022-TN9556

3 **3.10.2.2 Unemployment**

4 As shown in Table 3-22, people living in the two-county socioeconomic ROI had a median
 5 household income greater than the State average. Additionally, the percentage of individuals
 6 living below the poverty level in Sherburne and Wright counties was lower than the percentage
 7 of individuals living below the poverty level in the State of Minnesota.

8 According to the USCB 2017–2021 American Community Survey 5-Year Estimates, the
 9 unemployment rate in Sherburne County and Wright Counties were 2.7 and 2.4 percent,
 10 respectively. Comparatively, the unemployment rate in Minnesota during this same time period
 11 was 4 percent (USCB 2022-TN9556).

12 **3.10.3 Demographic Characteristics**

13 According to the 2020 Census, an estimated 258,805 people live within 20 mi (32 km) of
 14 Monticello, which equates to a population density of 206 persons per square mile (Xcel 2023-
 15 TN9084). This amount translates to a Category 4 population density using the LR GEIS
 16 (NRC 1996-TN288) measure of sparseness, which is defined as “greater than or equal to
 17 120 persons per square mile within 20 mi (32 km).” An estimated 3,285,866 people live within a
 18 50 mi (80 km) radius of the Monticello site, which equates to a population density of
 19 418 persons per square mile (Xcel 2023-TN9084). This translates to a Category 4 proximity
 20 index. Therefore, Monticello is a combination of “sparseness” Category 4 and “proximity”
 21 Category 4 translating to a “high” population area based on the LR GEIS sparseness and
 22 proximity matrix (NRC 1996-TN1162).

23 shows population projections and percent growth from 2000 to 2050 for Sherburne and Wright
 24 counties. During the last several decades, both counties have experienced increasing
 25 population. Based on population projections, the population in both counties is generally
 26 expected to continue to increase through 2050, but at a slower rate.

27 The 2020 Census demographic profile of the Monticello ROI population is presented in
 28 Table 3-24. According to the 2020 Census, minorities (race and ethnicity combined) composed
 29 11.6 percent of the total population in the socioeconomic ROI. The largest minority population of
 30 any race in the socioeconomic ROI were two or more races (3.9 percent of total population; 33
 31 percent of the total minority population) and Hispanic of any race (3.2 percent of the total
 32 population; 27 percent of the total minority population) (USCB 2020-TN9673).

33 According to the USCB’s 2017–2021 5-year estimates, minority populations in the two-county
 34 socioeconomic ROI were relatively stable at 11.7 percent (see Table 3-25).

1 **Table 3-23 Population and Percent Growth in Monticello Socioeconomic Region of**
 2 **Influence Counties**

Metric	Year	Sherburne County Population	Sherburne County Percent Change	Wright County Population	Wright County Percent Change
Recorded	2000	64,417	-	89,986	-
Recorded	2010	88,499	3.23	124,700	3.32
Recorded	2020	97,183	0.94	141,337	1.26
Projected	2030	106,065	0.88	152,493	0.76
Projected	2040	113,712	0.70	164,652	0.77
Projected	2050	120,188	0.56	175,236	0.62

3 Sources: USCB 2000-TN9672 Xcel 2023-TN9084.

4 **Table 3-24 Demographic Profile of the Population in the Monticello Two-County**
 5 **Region of Influence, 2020**

Demographic	Sherburne County	Wright County	Region of Influence
Total population	97,183	141,337	238,520
Percent White race	87.2	89.2	88.4
Percent Black or African American race	3.8	1.8	2.6
Percent American Indian and Alaska Native race	0.4	0.2	0.3
Percent Asian race	1.3	1.3	1.3
Percent Native Hawaiian and Other Pacific Islander race	0.0	0.0	0.0
Percent some other race	0.3	0.4	0.3
Percent two or more races	4.1	3.7	3.9
Hispanic, Latino, or Spanish Ethnicity of Any Race (Total Population)	2,820	4,697	7,517
Percent Hispanic, Latino, or Spanish Ethnicity of Any Race of total population	2.9	3.3	3.2

Source: USCB 2020-TN9673.

6 **Table 3-25 Demographic Profile of the Population in the Monticello Two-County**
 7 **Region of Influence, 2017–2021 (5-Year Estimates)**

Demographic	Sherburne County	Wright County	Region of Influence
Total population	96,295	139,890	236,185
Percent White race	89.1	91.4	91.4
Percent Black or African American race	2.9	1.6	2.2
Percent American Indian and Alaska Native race	0.4	0.3	0.3
Percent Asian race	1.4	1.2	1.3
Percent Native Hawaiian and other Pacific Islander race	0.0	0.0	0.0
Percent some other race	1.7	1.2	1.4
Percent two or more races	3.6	3.2	3.4
Hispanic, Latino, or Spanish Ethnicity of Any Race (Total Population)	2,704	4,501	7,205
Percent Hispanic, Latino, or Spanish Ethnicity of Any Race of total population	2.8	3.2	3.1

Source: USCB 2020-TN9673.

1 3.10.3.1 *Transient Population*

2 Sherburne County and Wright County can experience seasonal transient population growth as a
 3 result of local tourism and recreational activities associated with multiple Federal, State, and
 4 local parks as well as camping areas in the counties. There are 53 public use lands within 6 mi
 5 (10 km) of Monticello. The closest public use lands include a portion of the Mississippi River
 6 State Wild and Scenic Recreational District, all of the Mississippi Island Sherburne State
 7 Aquatic Management Area, and the Mississippi Island Wright State Aquatic Management Area
 8 within the Monticello site boundary. A transient population creates a demand for temporary
 9 housing and services in the area.

10 Based on the Census Bureau’s 2017–2021 American Community Survey 5-year estimates
 11 (USCB 2022-TN9556), 3,019 seasonal housing units are located in the two-county
 12 socioeconomic ROI.

13 3.10.3.2 *Migrant Farm Workers*

14 Migrant farm workers are individuals whose employment requires travel to harvest agricultural
 15 crops. These workers may or may not have a permanent residence. Some migrant workers
 16 follow the harvesting of crops, particularly fruit, throughout rural areas of the United States.
 17 Migrant workers may be members of minority or low-income populations. Because they travel
 18 and can spend a significant amount of time in an area without being actual residents, migrant
 19 workers may be unavailable for counting to census data collectors. If uncounted, these minority
 20 and low-income workers are underrepresented in the decennial Census population counts.

21 Since 2002, the Census of Agriculture has reported the numbers of farms hiring migrant workers
 22 defined as a farm worker whose employment required travel that prevented the worker from
 23 returning to his or her permanent place of residence the same day (USDA 2017-TN9674). The
 24 Census of Agriculture is conducted every 5 years and results in a comprehensive compilation of
 25 agricultural production data for every county in the nation.

26 Information about both migrant and temporary farm labor (i.e., working fewer than 150 days) can
 27 be found in the 2017 Census of Agriculture. Table 3-26 presents information about migrant and
 28 temporary farm labor in Sherburne and Wright Counties. According to the 2017 Census of
 29 Agriculture, 676 farm workers were hired to work for fewer than 150 days and were employed on
 30 184 farms in the two-county socioeconomic ROI. Thirteen farms in Sherburne County and five
 31 farms in Wright County reported hiring migrant workers.

32 **Table 3-26 Migrant Farm Workers and Temporary Farm Labor in Counties Located in**
 33 **the Socioeconomic Region of Influence (50 mi [80 km]) of Monticello**

County ^(a)	Number of Farms with Hired Farm Labor ^(b)	Number of Farms Hiring Workers for Less Than 150 Days ^(b)	Number of Farm Workers Working for Less Than 150 Days ^(b)	Number of Farms Reporting Migrant Farm Labor ^(b)
Sherburne	101	58	260	13
Wright	278	126	416	5
Total	379	184	676	18

34 Source: Table 7. Hired farm Labor—Workers and Payroll: 2017 (USDA 2017-TN9674).

1 **3.10.4 Housing and Community Services**

2 **3.10.4.1 Housing**

3 Table 3-27 lists the total number of occupied and vacant housing units, vacancy rates, and
4 median values in the two-county socioeconomic ROI. Based on the USCB’s 2017–2021
5 American Community Survey 5-year estimates, there were 89,342 housing units in the ROI, of
6 which 70,261 were occupied. The median values of owner-occupied housing units in the ROI is
7 \$265,000. The homeowner vacancy rate was approximately 0.4 percent in both counties (USCB
8 2022-TN9556).

9 **Table 3-27 Housing in the Monticello Region of Influence (2017–2021, 5-Year**
10 **Estimate)**

Housing Data	Sherburne County	Wright County	Region of Influence
Total housing units	35,491	53,851	89,342
Occupied housing units	33,825	50,290	84,115
Total vacant housing units	1,666	3,561	5,227
Percent total vacant	5%	7%	6%
Owner occupied units	28,500	41,761	70,261
Median value (dollars)	264,500	265,500	265,103 ^(a)
Owner vacancy rate (percent)	0.4	0.4	0.4 ^(b)
Renter occupied units	5,325	8,529	13,854
Median rent (dollars/month)	1,055	1,072	1,065 ^(c)
Rental vacancy rate (percent)	3.8	3	3.3 ^(b)

(a) Weighted average by owner-occupied units in Sherburne County and Wright County.
(b) Weighted average by total housing units in Sherburne County and Wright County.
(c) Weighted average by occupied units paying rent in Sherburne County and Wright County.
Source: USCB 2022-TN9556.

11 **3.10.4.2 Education**

12 Sherburne County comprises of three public school districts, with a total of 19,792 students in
13 42 schools (NCES 2024-TN9724, NCES 2024-TN9725). These 42 public schools include
14 18 elementary schools, 9 middle schools, and 15 high schools. Wright County comprises
15 12 public school districts, with approximately 27,000 students in over 75 schools. (NCES 2024-
16 TN9724, NCES 2024-TN9725).

17 **3.10.4.3 Public Water Supply**

18 Water service is supplied to residents of Sherburne County by eight public water systems and to
19 Wright County by 19 public water systems (Xcel 2023-TN9084). The primary source of water for
20 Sherburne and Wright County is groundwater. Both counties have sufficient capacity for water
21 supply and are projected to continue to have sufficient capacity into the future.

22 **3.10.5 Tax Revenues**

23 Xcel Energy pays property taxes to the State of Minnesota and to four local tax jurisdictions
24 including Wright County, the city of Monticello, the Monticello Public School District (PSD) #882-
25 01, and the Economic Development Authority in support of Monticello Housing Redevelopment
26 Authority initiative. Table 3-28 presents Monticello’s annual property tax payments to each local

1 tax jurisdiction as well as the annual revenue of each jurisdiction from 2017–2022. Monticello
 2 property taxes are a significant source of revenue for several jurisdictions and Xcel Energy is
 3 the largest taxpayer in the county (Xcel 2023-TN9084). Xcel Energy’s tax payments have
 4 remained consistent the last 6 years. Xcel Energy also pays into the State general tax revenue
 5 fund, these payments were between \$1.1 million and \$1.3 million between 2017 and 2022 and
 6 represent less than 1 percent of the State’s total tax revenue.

7 Xcel Energy also contributes \$1.6 million annually in support of emergency planning and
 8 preparedness to the State of Minnesota Homeland Security and Emergency Management in
 9 2022.

10 **Table 3-28 Monticello Property Tax Payments by Local Tax Jurisdiction, 2017–2022**

Jurisdiction	2017	2018	2019	2020	2021	2022
Wright County – Annual Revenue	119,225,722	138,724,187	151,084,235	187,838,242	171,533,344	171,866,785
Wright County – Monticello Nuclear Generating Plant (Monticello) Property Tax Paid	6,589,558	7,013,061	7,058,266	6,988,007	7,103,919	6,681,301
Wright County – % of Annual Revenue	6	5	5	4	4	4
City of Monticello – Annual Revenue	25,030,313	26,313,579	32,500,261	34,347,195	37,051,766	34,527,054
City of Monticello – Monticello Property Tax Paid	5,520,060	5,676,495	5,462,252	5,500,769	5,794,246	5,579,484
City of Monticello – % of Annual Revenue	22	22	17	16	16	16
Monticello PSD 882-01 – Annual Revenue	50,631,365	55,184,742	56,195,029	58,533,716	60,609,014	63,201,820
Monticello PSD 882-0 – Monticello Property Tax Paid	4,469,195	4,551,474	4,450,457	4,040,190	4,076,957	3,724,864
Monticello PSD 882-0t – % of Annual Revenue	9	8	8	7	7	6
Other EDA/MHRA – Annual Revenue	1,012,481	1,007,703	1,174,749	1,323,022	1,126,638	1,617,733
Other EDA/MHRA – Monticello Property Tax Paid	168,903	192,066	190,833	186,888	191,901	190,737
Other EDA/MHRA – % of Annual Revenue	17	19	16	14	17	12
Total – Annual Revenue	195,899,881	221,230,211	240,954,274	282,042,175	270,320,762	271,213,392
Total – Monticello Property Tax Paid	16,747,716	17,433,096	17,161,808	16,715,854	17,167,023	16,176,386
Total – % of Annual Revenue	9	8	7	6	6	6

EDA = Economic Development Authority; MHRA = Monticello Housing Redevelopment Authority; PSD = Public School District.

Source: Xcel 2023-TN9084, Xcel 2023-TN9578, Wright County 2023-TN9839, City of Monticello 2022-TN9838, MPSD 2023-TN9837.

1 **3.10.6 Local Transportation**

2 The transportation network surrounding the Monticello site comprises Interstate and State
 3 highways and local roads. Interstate 94 (I-94) is a major interstate highway southwest of
 4 Monticello that runs east–west through Minnesota. County Road 75 NE is a two-lane paved
 5 road that’s runs parallel to I-94 and connects commuter traffic to plant entrance roads. As
 6 shown in Table 3-29, average annual daily traffic volumes for County Road 75 between 2000
 7 and 2016 have remained consistent. Based on those volumes the level-of-service (LOS) rating
 8 for County Road 75 NE ranges between LOS “A” to LOS “C” (Xcel 2023-TN9084).

9 Within a 10 mi (16 km) radius of Monticello, there are four private airports/heliports and
 10 two public airports (Xcel 2023-TN9084). The Minneapolis-St Paul International Airport is 44 mi
 11 southeast of Monticello.

12 **Table 3-29 Total Average Annual Daily Traffic Counts on County Road 75**

Roadway and Location	Annual Average Daily Traffic Volume Estimates				
Year	2000	2004	2008	2012	2016
County Road 75 (NW of Monticello Nuclear Generating Plant [Monticello] plant entrance)	1,050	3,300	3,650	NA	1,600
County Road 75 (SE of Monticello plant entrance)	3,250	3,700	3,350	3,500	3,350

NA = not available; NW = northwest; SE = southeast.
 Source: Xcel 2023-TN9084.

13 **3.10.7 Proposed Action**

14 The following sections address the site-specific environmental impacts of the Monticello SLR on
 15 environmental issues related to socioeconomics.

16 *3.10.7.1 Employment and Income, Recreation and Tourism*

17 Nuclear power plants generate employment and income in the local economy. Therefore,
 18 continued operations associated with SLR can impact employment, income, recreation, and
 19 tourism. Nuclear power plant operations provide employment and income and pays for goods
 20 and services from local communities. Wages, salaries, and expenditures generated by nuclear
 21 plant operation create demand for goods and services in the local economy, while wage and
 22 salary spending by workers creates additional demand for services and housing. Payments for
 23 these goods and services create additional employment and income opportunities in the
 24 community. Communities located near nuclear power plants may experience population
 25 increases due to the increased demand for goods and services from plant workers and visitors.
 26 Communities located near nuclear power plants may experience summer, weekend, and
 27 retirement population increases due to the recreational and tourism related activities that attract
 28 visitors. Xcel Energy indicated in its ER that it has no plans to increase or decrease
 29 its workforce, will not conduct refurbishment activities, and does not anticipate changes to
 30 Monticello during the SLR term (Xcel 2023-TN9084). Consequently, people living near
 31 Monticello would not experience any changes in employment, income, recreation, and tourism
 32 during the SLR term beyond what is currently being experienced. Employment, income,
 33 recreational, and tourism are not expected to change. Based on this information, the NRC staff
 34 concludes that employment, income, recreational, and tourism impacts during the Monticello
 35 SLR term would be SMALL.

1 3.10.7.2 *Tax Revenues*

2 Nuclear plants provide tax revenue to local jurisdictions in the form of property tax payments,
3 payments in lieu of tax payments, or tax payments related to energy production. Changes in the
4 workforce and property taxes, or property tax payments to local governments and public
5 schools, can directly affect socioeconomic conditions in the counties and communities near the
6 nuclear power plant. Since commencement of reactor operations, Monticello has become a
7 well-established source of property and sales tax revenue in local communities. As shown in
8 Table 3-8, Monticello contributes an appreciable percentage of the total tax revenue collected
9 by Wright County and the City of Monticello, respectively, most recently totaling from 4% to
10 16%. Xcel Energy indicated in its ER that it has no plans to conduct refurbishment activities
11 during the SLR term that would affect the value of Monticello (Xcel 2023-TN9084). Therefore,
12 tax payments during the SLR term would be similar to those already being paid. Based on these
13 considerations, the NRC staff concludes that tax revenue impacts during the SLR term would be
14 SMALL.

15 3.10.7.3 *Community Service and Education*

16 Nuclear plant operations as a result of workforce changes can affect the availability and quality
17 of community (i.e., public safety and public utilities) and educational services. An increase in
18 operations workforce and related populations can increase the demand and cause disruption of
19 community services and education. The impact on community and educational services will
20 depend on the projected number of in-migrating workers and their families during the SLR term
21 and the ability to respond to the level of demand for services. Tax payments from nuclear power
22 plants can support a range of community services and have a beneficial impact on the quality
23 and availability of these services to local residents. Xcel Energy indicated in its ER that it has
24 no plans to increase or decrease its workforce and will not conduct refurbishment activities
25 affecting the value of Monticello (Xcel 2023-TN9084) and property tax payments. Therefore,
26 revenue from Monticello property tax payments used to support community services and
27 education are not expected to change. Based on these considerations, the NRC staff concludes
28 that impacts to community services and education during the SLR term would be SMALL.

29 3.10.7.4 *Population and Housing*

30 The availability of resources like housing are affected by changes in population. For example,
31 plant-induced population growth could cause a greater need for permanent housing and lead to
32 a regional housing shortage or increases in housing prices for the community. In its ER, Xcel
33 Energy states that it does not plan to increase or decrease its regular workforce during the SLR
34 term. Xcel Energy also states that it will continue to require approximately 650 additional
35 temporary workers to support regular refueling outages on a two-year schedule. Because these
36 refueling outages have long occurred on an expected schedule, there is sufficient short-term
37 rental housing in the vicinity of the plant for refueling outage workers without affecting the
38 availability of regular rental housing in the community. Xcel Energy also does not plan any
39 refurbishment activities during the SLR term that might require supporting workers that require
40 housing. Because the size of the Monticello workforce will remain the same during the SLR
41 term, the staff concludes the impact of SLR on population and housing would be SMALL.

42 3.10.7.5 *Transportation*

43 This issue concerns how Monticello SLR could impact local transportation. Transportation
44 impacts depend on many factors including the size of the workforce, the capacity of the local

1 road networks, and the availability of alternate commuting routes to and from the plant. As
2 stated in Xcel Energy's ER, Monticello currently employes 663 full and part time regular
3 workers. The plant requires an additional 650 temporary workers for refueling outages which
4 occur every two years. In its ER, Xcel Energy states that it has no plans to increase or decrease
5 its workforce during the SLR term. Aside from routine plant operations, major construction and
6 refurbishment projects can also cause transportation impacts by requiring temporary workers to
7 support the projects. The ER states that Xcel Energy has no plans to conduct refurbishment
8 activities during the SLR term. Since the size of the Monticello workforce will remain the same
9 during the SLR term with no temporary or permanent increase in workforce above current
10 operations, the NRC staff concludes that transportation impacts during the SLR term will be
11 SMALL.

12 **3.10.8 No-Action Alternative**

13 *3.10.8.1 Socioeconomics*

14 Under the no-action alternative, the NRC would not renew the operating license, and Monticello
15 would shut down on or before the expiration of the current facility operating license. This would
16 have a noticeable impact on socioeconomic conditions in the counties and communities near
17 Monticello. The loss of jobs, income, and tax revenue would have an immediate noticeable
18 socioeconomic impact. As jobs are eliminated, some, but not all, of the more than 660 workers
19 could leave. Income from the buying and selling of goods and services needed to maintain the
20 nuclear power plant would also be reduced. In addition, loss of tax revenue could affect the
21 availability of public services.

22 If workers and their families move away, increased vacancies and reduced demand for housing
23 would likely cause property values to fall. The greatest socioeconomic impact would be
24 experienced in the communities located nearest to Monticello in Sherburne and Wright counties.
25 However, the loss of jobs, income, and tax revenue may not be as noticeable in large
26 communities due to the time and steps required to prepare the nuclear power plant for
27 decommissioning. Also, Monticello would continue to pay taxes, albeit in amounts based on the
28 reduced value of its facility following shutdown, while decreased tax revenue from Monticello
29 could possibly be obtained by taxing authorities by other means. Therefore, depending on the
30 jurisdiction, socioeconomic impacts from not renewing the operating license and terminating
31 reactor operations at Monticello could range from SMALL to LARGE, depending on the affected
32 community.

33 *3.10.8.2 Transportation*

34 Traffic volume on roads near Monticello may be noticeably reduced after the termination of
35 reactor operations. Any reduction in traffic volume would coincide with workforce reductions at
36 Monticello. The number of truck deliveries and shipments would also be reduced until active
37 decommissioning. Therefore, due to the time and steps required to prepare the nuclear power
38 plant for decommissioning, traffic-related transportation impacts would be SMALL.

39 **3.10.9 Replacement Power Alternatives: Common Impacts**

40 Replacement power alternative facilities could be constructed in any State in the ROI for the
41 Xcel Energy service area, with some exceptions. These States include Colorado, Michigan,
42 New Mexico, North Dakota, South Dakota, Texas, Wisconsin, and Minnesota. Under Minnesota
43 law, no new nuclear plants can be built in the State. Therefore, any new nuclear alternative

1 would be built in one of the other States in the ROI. Workforce requirements for replacement
 2 power alternatives were evaluated to measure their possible effects on current socioeconomic
 3 and transportation conditions. Table 3-30 summarizes socioeconomic and transportation
 4 impacts of replacement power alternatives. The following sections provides a discussion of the
 5 common socioeconomic and transportation impacts during construction and operations of
 6 replacement power-generating facilities.

7 **Table 3-30 Socioeconomic and Transportation Impacts of Replacement Power**
 8 **Alternatives**

Alternative	Resource Requirements	Impacts	Discussion
New Nuclear (SMRs)	Construction: peak 1,200 workers for several months	MODERATE to LARGE	If all 12 SMRs are constructed/installed at the same time. Noticeable traffic impacts.
New Nuclear (SMRs)	Operations: 600 workers	SMALL	If all 12 SMRs are constructed/installed at the same time. Approximately same number of operations workers as Monticello.
Natural Gas and Renewables	Construction: peak 800 (NGCC), 140 (Solar), 450 (Wind) workers for several months	MODERATE	Workers would likely be scattered throughout the region and would not have a noticeable effect on local economy.
Natural Gas and Renewables	Operations: 150 workers (NGCC), 15 (Solar), 40 (Wind)	SMALL	If all four combined-cycle combustion turbines are constructed/installed at the same time. Some operations workers could transfer from Monticello.
Renewables and Storage Alternative	Construction: peak 700 (Solar & battery), and 580 (Wind) workers for several months	MODERATE	Workers would likely be scattered throughout the region and would not have a noticeable effect on local economy.
Renewables and Storage Alternative	Operations: 75 (Solar & battery), and 55 (Wind) workers	SMALL	Workers would likely be scattered throughout the region and would not have a noticeable effect on local economy.

NGCC = natural gas-fired combined-cycle; SMR = small modular reactors.
 Source: BLM 2019-TN8386; DOE 2011-TN8387; NRC 2011-TN6437; Xcel 2023-TN9084; NRC 2019-TN6136; Tegen 2016-TN8826.

3.10.9.1 *Socioeconomics*

9 Socioeconomic impacts are defined in terms of changes in the social and economic conditions
 10 of a region. For example, the creation of jobs and the purchase of goods and services during
 11 the construction and operation of a replacement power plant could affect regional employment,
 12 income, and tax revenue. For each alternative, two types of jobs would be created:

1 (1) construction jobs, which are transient, short in duration, and less likely to have a long-term
2 socioeconomic impact; and (2) operations jobs, which have the greater potential for permanent,
3 long-term socioeconomic impacts.

4 While the selection of a replacement power alternative could create opportunities for
5 employment and income and generate tax revenue in the local economy, employment, income,
6 and tax revenue could be greatly reduced or eliminated in communities located near Monticello.
7 These impacts are described in the “No-Action Alternative” (Section 3.10.8).

8 *3.10.9.1.1 Construction*

9 The relative economic effect of an influx of workers on the local economy and tax base would
10 vary and depend on the size of the workforce and construction phase. The greatest impact
11 would occur in the communities where the majority of construction workers would reside and
12 spend their incomes. As a result, some local communities could experience a short-term
13 economic boom during construction from increased tax revenue, income generated by
14 expenditures for goods and services, and increased demand for temporary (rental) housing.
15 After construction, local communities would likely experience a return to preconstruction
16 economic conditions.

17 *3.10.9.1.2 Operation*

18 Before the commencement of startup and operations, local communities could see an influx of
19 operations workers and their families resulting in an increased demand for permanent housing
20 and public services. These communities would also experience the economic benefits from
21 increased income and tax revenue generated by the purchase of goods and services needed to
22 operate a new replacement power plant. Consequently, power plant operations would have a
23 greater potential for effecting permanent, long term socioeconomic impacts on the region.

24 *3.10.9.1.3 Transportation*

25 Transportation impacts are defined in terms of changes in LOS conditions on local roads.
26 Additional vehicles during construction and operations could lead to traffic congestion and LOS
27 impacts on local roadways and delays at intersections.

28 *3.10.9.1.4 Construction*

29 Transportation impacts would consist of commuting workers and truck deliveries of equipment
30 and material to the construction site. Traffic volumes would increase substantially during shift
31 changes. Trucks would deliver equipment and material to the construction site and remove
32 waste material, thereby increasing the amount of traffic on local roads. The increase in traffic
33 volumes could result in LOS impacts and delays at intersections during certain hours of the day.
34 In some instances, construction material could also be delivered and removed by rail or barge.

35 *3.10.9.1.5 Operation*

36 Traffic volumes would be greatly reduced after construction because of the smaller size of the
37 operations workforce. Transportation impacts would consist of commuting operations workers,
38 truck deliveries, and removal of waste material.

1 **3.11 Human Health**

2 Monticello is both an industrial facility and a nuclear power plant. Similar to any industrial facility
3 or nuclear power plant, the operation of Monticello during the SLR period will produce various
4 human health risks for workers and members of the public. This section describes the human
5 health risks resulting from the operation of Monticello, including from radiological exposure,
6 chemical hazards, microbiological hazards, electromagnetic fields, and other hazards. The
7 description of these risks is followed by the NRC staff's analysis of the potential impacts on
8 human health from the proposed action (SLR) and alternatives to the proposed action.

9 **3.11.1 Radiological Exposure and Risk**

10 Operation of a nuclear power plant involves the use of nuclear fuel to generate electricity.
11 Through the fission process, the nuclear reactor splits uranium atoms, resulting very generally in
12 (1) the production of heat, which is then used to produce steam to drive the nuclear power
13 plant's turbines and generate electricity; and (2) the creation of radioactive byproducts. As
14 required by NRC regulations at 10 CFR 20.1101, "Radiation protection programs," (TN283) Xcel
15 Energy designed a radiation protection program to protect on-site personnel (including
16 employees and contractor employees), visitors, and off-site members of the public from
17 radiation and radioactive material at Monticello. The Monticello radiation protection program is
18 extensive and includes, but is not limited to, the following:

- 19 • Organization and Administration (e.g., a radiation protection manager who is responsible for
20 the program and ensures trained and qualified workers for the program)
- 21 • Implementing Procedures
- 22 • An as low as reasonably achievable (ALARA) program to minimize radiation dose to workers
23 and members of the public
- 24 • Dosimetry Program (i.e., measure radiation dose to nuclear power plant workers)
- 25 • Radiological Controls (e.g., protective clothing, shielding, filters, respiratory equipment, and
26 individual work permits with specific radiological requirements)
- 27 • Radiation Area Entry and Exit Controls (e.g., locked or barricaded doors, interlocks, local
28 and remote alarms, personnel contamination monitoring stations)
- 29 • Posting of Radiation Hazards (i.e., signs and notices alerting nuclear power plant personnel
30 of potential hazards)
- 31 • Recordkeeping and Reporting (e.g., documentation of worker dose and radiation survey
32 data)
- 33 • Radiation Safety Training (e.g., classroom training and use of mockups to simulate complex
34 work assignments)
- 35 • Radioactive Effluent Monitoring Management (i.e., controlling and monitoring radioactive
36 liquid and gaseous effluents released into the environment)
- 37 • Radioactive Environmental Monitoring (e.g., sampling and analysis of environmental media,
38 such air, water, groundwater, milk, food products, and sediment to measure the levels of
39 radiation emitted into the environment that may impact human health)
- 40 • Radiological Waste Management (i.e., controlling, monitoring, processing, and disposing of
41 radioactive solid waste)

1 For radiation exposure to Monticello personnel, the NRC staff reviewed the data contained in
2 NUREG-0713, Volume 42, *Occupational Radiation Exposure at Commercial Nuclear Power*
3 *Reactors and other Facilities 2020: Fifty-Third Annual Report* (NRC 2022-TN8530). The
4 Fifty-Third Annual Report was the most recent annual report available at the time of this
5 environmental review. It summarizes the occupational exposure data in the NRC’s Radiation
6 Exposure Information and Reporting System database through 2020. Nuclear power plants are
7 required by 10 CFR 20.2206, “Reports of individual monitoring,” to report their occupational
8 exposure data to the NRC annually (TN283).

9 NUREG-0713 contains a calculation of a 3-year average collective dose per reactor for workers
10 at all nuclear power reactors licensed by the NRC. The 3-year average collective dose is one of
11 the metrics that the NRC uses in the Reactor Oversight Process to evaluate the applicant’s
12 ALARA program. Collective dose is the sum of the individual doses received by workers at a
13 facility licensed to use radioactive material during a 1-year time period. There are no NRC or
14 EPA standards for collective dose. Based on the data for operating boiling water reactors like
15 the unit at Monticello, the average annual collective dose per reactor year was 106-person
16 roentgen equivalent man (rem) (NRC 2022-TN8530). In comparison, Monticello had a reported
17 annual collective dose per reactor year of 60 person-rem.

18 Section 3.13.1, “Radioactive Waste,” of this site-specific EIS discusses off-site dose to members
19 of the public.

20 **3.11.2 Chemical Hazards**

21 State and Federal environmental agencies regulate the use, storage, and discharge of
22 chemicals, biocides, and sanitary wastes. Such environmental agencies also regulate how
23 facilities like Monticello manage minor chemical spills. Chemical and hazardous wastes can
24 potentially affect workers, members of the public, and the environment.

25 At Monticello, chemical effects could result from discharge of waste, heavy metal leaching, the
26 use and disposal of chemicals, and chemical spills. Workers may encounter chemicals when
27 adjusting coolant systems, applying biocides, during maintenance activities on equipment
28 containing hazardous chemicals, and when solvents are used for cleaning (Xcel 2023-TN9084).

29 Xcel Energy currently controls the use, storage, and discharge of chemicals, biocides, and
30 sanitary wastes at Monticello in accordance with its chemical control procedures, waste
31 management procedures, and Monticello site-specific chemical accident spill prevention
32 provisions (Xcel 2023-TN9084). Xcel Energy monitors and controls discharges of chemicals,
33 biocides, and sanitary wastes through Monticello’s NPDES permit process, discussed in
34 Section 3.5.1.3. These nuclear power plant procedures, plans, and processes are designed to
35 prevent and minimize the potential for a chemical or hazardous waste release and, in the event
36 of such a release, minimize the impact on workers, members of the public, and the environment.

37 There were two inadvertent nonradioactive releases due to Monticello operations from 2016
38 through 2018. As discussed in ER Section 3.6.4.2.2, a Notice of Violation for carbon
39 tetrachloride detection in Well 10 was issued by the Minnesota Department of Health in 2016.
40 Monticello assessed water supply wells and determined a suitable alternative as discussed in
41 the ER (Xcel 2023-TN9084). In 2020, Monticello was issued a “no further action” letter setting
42 forth terms and conditions for Well 10. In addition, Well 10 was sealed at the end of 2020 and
43 carbon tetrachloride is not currently being used or held in inventory at the plant. In July 2019,
44 Monticello voluntarily reported a release of sodium hypochlorite through a floor drain. A release

1 sampling report was completed and there was no additional follow up from the State of
2 Minnesota regarding the release, which amounted to less than one-half gallon of water with less
3 than 1 percent sodium hypochlorite as discussed in the ER Sections 3.6.4.2.2 and 9.5.3.7 (Xcel
4 2023-TN9084). At Monticello, no reportable spills occurred due to Monticello operations from
5 October 1, 2018 through 2021. From the period of January 2022 until July 2023, Xcel Energy
6 confirmed that no reportable inadvertent releases or spills of nonradioactive contaminants
7 occurred (Xcel 2023-TN9578).

8 **3.11.3 Microbiological Hazards**

9 Microbiological hazards occur when workers or members of the public come into contact with
10 disease-causing microorganisms, also known as etiological agents. Thermal effluents
11 associated with nuclear power plants that discharge to a river, such as Monticello, have the
12 potential to promote the growth of certain thermophilic microorganisms linked to adverse human
13 health effects. Microorganisms of particular concern include several types of bacteria and the
14 free-living amoeba *Naegleria fowleri* (*N. fowleri*). There are optimum growth temperatures for
15 the microorganisms of concern as further discussed in the 2013 LR GEIS (NRC 2013-TN2654).

16 The public can be exposed to the thermophilic microorganisms during swimming, boating, or
17 other recreational uses of freshwater. If these organisms are naturally occurring and a nuclear
18 power plant's thermal effluent enhances their growth, the public could experience an elevated
19 risk of infection when recreating in the affected waters. Public exposure to Legionella from
20 nuclear power plant operation is generally not a concern because exposure risk is confined to
21 cooling towers and related components and equipment, which are typically within the protected
22 area of the site and, therefore, not accessible to the public.

23 Nuclear power plant workers can be exposed to Legionella when performing cooling system
24 maintenance through inhalation of cooling tower vapors because these vapors are often within
25 the optimum temperature range for Legionella growth. Nuclear power plant personnel at
26 Monticello most likely to come in contact with aerosolized Legionella are workers who clean and
27 maintain the condenser tubes. Nuclear power plant workers can also be exposed to *N. fowleri*
28 during cooling water discharges. Monticello has an industrial safety program that includes
29 procedures for entry to cooling water systems where Legionella is possible. Monticello also
30 includes further training on Legionella exposure in the plant's annual training (Xcel 2023-
31 TN9084).

32 As discussed in Section 2.2.3 of the Xcel Energy ER (Xcel 2023-TN9084), Monticello releases
33 heated condenser cooling water to a discharge canal, which discharges to the Mississippi River.
34 A plant computer chooses the optimal operating mode based on river flow, river temperature,
35 and status of critical plant equipment to ensure cooling water discharges are within the limits of
36 the NPDES permit. These modes include no cooling tower use in once-through circulation of
37 river water and cooling tower use for closed cycle, helper mode, and partial recirculation mode.
38 To ensure that the NPDES permit limits for discharge into the Mississippi River are maintained,
39 Monticello replaced its two cooling towers with slightly greater cooling capacity in May of 2021
40 and May of 2022.

41 **3.11.4 Electromagnetic Fields**

42 EMFs are generated by any electrical equipment. All nuclear power plants have electrical
43 equipment and power transmission systems associated with them. Power transmission systems
44 consist of switching stations (or substations) located on the nuclear power plant site and the

1 transmission lines needed to connect the plant to the regional electrical distribution grid.
2 Transmission lines operate at a frequency of 60 Hz (60 cycles per second), which is low
3 compared with the frequencies of 55 to 890 MHz for television transmitters and 1,000 MHz and
4 greater for microwaves.

5 The scope of the evaluation of transmission lines includes only those transmission lines that
6 connect the plant to the switchyard where electricity is fed into the regional power distribution
7 system (encompassing those lines that connect the plant to the first substation of the regional
8 electric power grid) and power lines that feed the plant from the grid are considered within the
9 regulatory scope of the license renewal environmental review. Transmission lines in scope are
10 confined to the Monticello site, spanning the short distance between the generating units and
11 the switchyards, as depicted in Figure 2.2-3 of Xcel Energy's environmental report (Xcel 2023-
12 TN9084)

13 Electric fields are produced by voltage and their strength increases with increases in voltage. A
14 magnetic field is produced from the flow of current through wires or electrical devices, and its
15 strength increases as the current increases. Electric and magnetic fields, collectively referred to
16 as EMFs, are produced by operating transmission lines.

17 Occupational workers or members of the public near transmission lines may be exposed to the
18 EMFs produced by the transmission lines. The EMF strength varies in time as the current and
19 voltage change, so that the frequency of the EMF is the same (e.g., 60 Hz for standard
20 alternating current, or AC). Electrical fields can be shielded by objects such as trees, buildings,
21 and vehicles. Magnetic fields, however, penetrate most materials, but their strength decreases
22 with increasing distance from the source.

23 The EMFs resulting from 60 Hz power transmission lines fall under the category of non-ionizing
24 radiation. The LR license renewal GEIS (NRC 2013-TN2654) summarizes NRC accepted
25 studies on the health effects of electromagnetic fields. There are no U.S. Federal standards
26 limiting residential or occupational exposure to EMFs from transmission power lines, but some
27 states have set electric field and magnetic field standards for transmission lines (NIEHS 2002-
28 TN6560). A voluntary occupational standard has been set for EMFs by the International
29 Commission on Non-Ionizing Radiation Protection (ICNIRP 1998-TN6591). The National
30 Institute of Occupational Safety and Health does not consider EMFs to be a proven health
31 hazard (NIOSH 1996-TN6766).

32 **3.11.5 Other Hazards**

33 This section addresses two additional human health hazards: (1) physical occupational hazards
34 and (2) occupational electric shock hazards.

35 Nuclear power plants are industrial facilities that have many of the typical occupational hazards
36 found at any other electric power generation utility. Nuclear power plant workers may perform
37 electrical work, electric powerline maintenance, repair work and maintenance activities, and
38 may be exposed to potentially hazardous physical conditions. A physical hazard is an action,
39 agent or condition that can cause harm upon contact. Physical actions could include slips, trips,
40 and falls from height. Physical agents could include noise, vibration, and ionizing radiation.
41 Physical conditions could include high heat, cold, pressure, confined space, or psychosocial
42 issues, such as work-related stress.

1 The Occupational Safety and Health Administration (OSHA) is responsible for developing and
2 enforcing workplace safety regulations. Congress created OSHA by enacting the Occupational
3 Safety and Health Act of 1970, as amended (29 U.S.C. 651 et seq.- Occupational Safety and
4 Health Act of 1970-TN4453) to safeguard the health of workers. With respect to nuclear power
5 plants, nuclear power plant conditions that result in an occupational risk, but do not affect the
6 safety of licensed radioactive materials, are under the statutory authority of OSHA rather than
7 the NRC as set forth in a Memorandum of Understanding (NRC and OSHA 2013-TN8542)
8 between the NRC and OSHA. Occupational hazards are reduced when workers adhere to
9 safety standards and use appropriate protective equipment; however, fatalities and injuries
10 caused by accidents may still occur. Xcel Energy maintains a comprehensive industrial safety
11 program for its workers in accordance with OSHA regulations (Xcel 2023-TN9084).

12 Based on its evaluation in the LR GEIS (NRC 2013-TN2654), the NRC has not found electric
13 shock resulting from direct access to energized conductors or from induced charges in metallic
14 structures to be a problem at most operating nuclear power plants. Generally, the NRC staff
15 also does not expect electric shock from such sources to be a human health hazard during the
16 SLR period. However, a site-specific review is required to determine the significance of the
17 electric shock potential along the portions of the transmission lines that are within the scope of
18 this EIS. Transmission lines that are within the scope of the NRC’s SLR environmental review
19 are limited to: (1) those transmission lines that connect the nuclear power plant to the substation
20 where electricity is fed into the regional distribution system, and (2) those transmission lines that
21 supply power to the nuclear power plant from the grid (NRC 2013-TN2654).

22 As discussed in Section 2.1.6.5, “Power Transmission Systems,” of this EIS, the only
23 transmission lines that are in regulatory scope for Monticello SLR are on-site. These in-scope
24 lines are in compliance with National Electrical Safety Code clearances (Xcel 2023-TN9084).
25 Therefore, there is no potential shock hazard to off-site members of the public from these on-
26 site transmission lines.

27 **3.11.6 Proposed Action**

28 The following sections address the site-specific environmental impacts of Monticello SLR on the
29 environmental issues related to human health.

30 *3.11.6.1 Radiation Exposures to the Public*

31 Nuclear power plants, under controlled conditions, release small amounts of radioactive
32 materials to the environment during normal operation. NRC regulations in 10 CFR Part 20
33 (TN283) identify maximum allowable concentrations of radionuclides that can be released from
34 a licensed nuclear power plant, such as Monticello, into the air and water at the boundary of
35 unrestricted areas to control radiation exposures of the public and releases of radioactivity.
36 These concentrations are derived based on an annual total effective dose equivalent (TEDE) of
37 0.1 rem to individual members of the public. In addition, pursuant to 10 CFR 50.36a, “Technical
38 specifications on effluents from nuclear power reactors” (TN249), nuclear power plants have
39 special license conditions called technical specifications for radioactive gaseous and liquid
40 releases from the nuclear power plant that are required to minimize the radiological impacts
41 associated with nuclear power plant operations to levels that are ALARA.

42 Radioactive waste management systems are incorporated into the design of each nuclear
43 power plant. They are designed to remove most of the fission product radioactivity that leaks
44 from the fuel, as well as most of the activation- and corrosion-product radioactivity produced by

1 neutrons in the vicinity of the reactor core. The amounts of radioactivity released through vents
2 and discharge points to areas outside the nuclear power plant boundary are recorded and
3 published annually in the radioactive effluent release reports. These environmental monitoring
4 programs are in place at all nuclear power plants. Because there is no reason to expect
5 effluents to increase at Monticello during the SLR term, doses from continued operation are
6 expected to be well within regulatory limits established in 10 CFR Part 20, (TN283), and 40 CFR
7 Part 190, “Environmental Radiation Protection Standards for Nuclear Power Operations”
8 (TN739). No mitigation measures beyond those already implemented under the current license
9 would be warranted because current mitigation practices have kept public radiation doses well
10 below regulatory standards and are expected to continue to do so.

11 The NRC staff reviewed Monticello’s effluent reports from years 2018 – 2022 (Xcel 2019-
12 TN9599, Xcel 2020-TN9598, Xcel 2021-TN9597, Xcel 2022-TN9595, Xcel 2023-TN9596) and
13 determined that the annual public dose recorded is a fraction of the regulatory limits and was in
14 accordance with radiation protection standards identified in 10 CFR Part 50 (TN249;
15 Appendix I), 10 CFR Part 20 (TN283), and 40 CFR Part 190 (TN739). This 5-year review period
16 provided a dataset that covers a broad range of activities that occur at a nuclear power plant,
17 such as refueling outages, routine operation, and maintenance that can affect the generation
18 and release of radioactive effluents into the environment. The NRC staff looked for indications of
19 adverse trends (e.g., increasing radioactivity levels) over the period of 2018 through 2022. As
20 discussed in Section 3.5.2, elevated tritium was indicated during routine sampling in 2022 and
21 determined to be coming from an area between the reactor and turbine buildings. The NRC was
22 notified in November 2022 following an analysis of monitoring well data. The NRC staff began
23 monitoring Monticello’s actions to determine the source of the leak, actions to stop the leak, and
24 the remediation plans. The NRC staff determined the leak had no impacts on public health and
25 safety and did not impact drinking water wells used by the community (Xcel 2023-TN9578, Xcel
26 2023-TN9609; NRC 2023-TN9601, NRC 2023-TN9616). The groundwater monitoring program
27 at Monticello is robust, and any future leaks that might occur during the SLR period should be
28 readily detected. All spills are well monitored, characterized, and actively remediated. Taken
29 together, the data show that there were no significant radiological impacts on the environment
30 from operations at Monticello.

31 Radiation doses to the public from continued operation are expected to continue at current
32 levels and would remain below regulatory limits during the SLR term. The NRC staff identified
33 no information at Monticello that would result in different impacts than those of current
34 operations. The NRC staff concludes that the health impacts from public radiation exposure due
35 to continued nuclear plant operations at Monticello during the SLR term would be SMALL based
36 on public doses being maintained within regulatory limits.

37 3.11.6.2 *Radiation Exposure to Plant Workers*

38 Nuclear power plant workers conducting activities involving radioactively contaminated systems
39 or working in radiation areas can be exposed to radiation. Individual occupational doses are
40 measured by nuclear power plant licensees as required by the NRC radiation protection
41 standard, at 10 CFR Part 20 (TN283). Most of the occupational radiation dose to nuclear power
42 plant workers results from external radiation exposure rather than from internal exposure from
43 inhaled or ingested radioactive materials. Workers also receive radiation exposure during the
44 storage and handling of radioactive waste. Occupational doses from any refurbishment activities
45 associated with SLR, and occupational doses from continued operations during the SLR term
46 are expected to be similar to the doses during current operations. The occupational doses are
47 estimated to be much less than the regulatory dose limits.

1 Under 10 CFR 20.2206, "Reports of individual monitoring" (TN283), the NRC requires nuclear
2 plant licensees to submit an annual report of the results of individual monitoring carried out by
3 the licensee for each individual for whom monitoring was required by 10 CFR 20.1502,
4 "Conditions requiring individual monitoring of external and internal occupational dose," during
5 that year. The NRC staff has reviewed the Monticello occupational dose reports and summary
6 reports through 2022 (NRC 2022-TN8530) and identified no information for Monticello that
7 would result in different impacts than those of current operations. The NRC staff concludes that
8 the health impacts from occupational radiation exposure due to continued nuclear plant
9 operations at Monticello during the SLR term would be SMALL based on individual worker
10 doses being maintained within 10 CFR Part 20 limits (TN283). No mitigation measures beyond
11 those implemented during the current license term would be warranted, because the ALARA
12 process continues to be effective in reducing radiation doses.

13 3.11.6.3 *Human Health Impact from Chemicals*

14 Impacts of chemical discharges on human health are considered to be SMALL if the discharges
15 of chemicals to water bodies are within effluent limitations designed to protect water quality and
16 if ongoing discharges have not resulted in adverse effects on aquatic biota. During the SLR
17 term, human health impacts from chemical hazards are expected to be the same as those
18 experienced during operations under the current license term.

19 Small quantities of biocides can be both readily dissipated and chemically altered in the
20 waterbody receiving them, so significant cumulative impacts on water quality would not be
21 expected. Major changes in the operation of the cooling system are not expected during the
22 SLR term (Xcel 2023-TN9084), so no change in the effects of biocide discharges on the quality
23 of the receiving water is anticipated.

24 The effects of minor chemical discharges and spills at nuclear power plants on water quality
25 have been of SMALL significance and mitigated as needed. Significant cumulative impacts on
26 water quality would not be expected because the small amounts of chemicals released by these
27 minor discharges or spills are readily dissipated in Mississippi River, the receiving waterbody.

28 Heavy metals (e.g., copper, zinc, and chromium) may be leached as small-volume waste
29 streams or corrosion products into the cooling water effluents. These metals are typically
30 addressed in NPDES permits so that any potential discharges are monitored and controlled.
31 Monticello utilizes stainless steel condenser tubes and would not contribute to leached heavy
32 metals to the cooling water discharge. The impact of metals in cooling system effluent streams
33 due to continued operations at Monticello are of SMALL significance (Xcel 2023-TN9084).

34 Overall, the NRC staff concludes that the human health impacts from chemicals due to
35 continued nuclear power plant operations at Monticello during the SLR term would be SMALL
36 based on these procedures, plans and processes.

37 3.11.6.4 *Microbiological Hazards to the Public (Plants with Cooling Ponds or Canals or* 38 *Cooling Towers That Discharge to a River)*

39 In the LR GEIS (NRC 2013-TN2654), the NRC staff determined that effects of thermophilic
40 microorganisms on the public for nuclear power plants using cooling ponds, lakes, or canals or
41 cooling towers that discharge to a river is a Category 2 issue that requires site-specific
42 evaluation during each license renewal review.

1 The thermophilic microorganism *N. fowleri* can pose public health concerns in recreational use
2 waters when these organisms are present in high enough concentrations to cause infection.
3 During the review for the 2010 environmental impact assessment for the proposed power uprate
4 at Monticello, the NRC staff considered the projected temperature increase and its potential to
5 affect the thermal plume in the Mississippi River. The NRC staff determined that thermophilic
6 organisms are not likely to occur as a result of discharges by Monticello into the river. The daily
7 maximum temperature at the discharge canal would remain within the NPDES discharge limits
8 and well below the optimal growth rate temperature for thermophilic organisms (75 FR 2565-
9 TN9617). In addition, as discussed in Section 3.11.3, the replacement of the two cooling towers
10 at Monticello ensures cooling capability remains below the NPDES permit limits. During the
11 proposed SLR term, the public health risk from *N. fowleri* remains extremely low and the
12 proposed action would not result in operational changes that would affect thermal effluent
13 temperature or otherwise create favorable conditions. The NRC staff concludes that the impacts
14 of thermophilic microorganisms on the public due to continued nuclear power plant operations at
15 Monticello during the SLR term would be SMALL because thermal effluent discharges from
16 Monticello during the proposed SLR term would not contribute to the proliferation of
17 microorganisms of concern in the Mississippi River.

18 3.11.6.5 Microbiological Hazards to Plant Workers

19 Impacts from microbiological hazards to nuclear power plant workers due to continued nuclear
20 power plant operations at Monticello during the SLR term are considered SMALL. Nuclear
21 power plant workers can be exposed to Legionella during maintenance activities associated with
22 complex water systems housed within buildings or structures, such as cooling towers. No
23 change in existing microbiological hazards is expected due to SLR as Xcel Energy is not
24 proposing changes in the cooling water system or sanitary wastewater treatment and disposal.
25 Xcel Energy implements a health and safety program to minimize the potential for nuclear
26 power plant worker exposure (Xcel 2023-TN9084).

27 3.11.6.6 Chronic Effects of EMFs

28 The LR GEIS (10 CFR Part 51-TN250), Subpart A, Appendix B; NRC 2013-TN2654 does not
29 designate the chronic effects of 60 Hz EMFs from powerlines as either a Category 1 or 2 issue.
30 Until a scientific consensus is reached on the health implications of electromagnetic fields, the
31 NRC will not include them as Category 1 or 2 issues.

32 Scientific consensus on the health implications of EMFs has not been established. The potential
33 for chronic effects from these fields continues to be studied and is not known at this time. The
34 National Institute of Environmental Health Sciences (NIEHS) directs related research through
35 the DOE. The NIEHS report (NIEHS 1999-TN78) contains the following conclusion:

36 The NIEHS concludes that ELF-EMF (extremely low frequency electromagnetic field)
37 exposure cannot be recognized as entirely safe because of weak scientific evidence that
38 exposure may pose a leukemia hazard. In our opinion, this finding is insufficient to
39 warrant aggressive regulatory concern. However, because virtually everyone in the
40 United States uses electricity and therefore is routinely exposed to ELF-EMF, passive
41 regulatory action is warranted such as continued emphasis on educating both the public
42 and the regulated community on means aimed at reducing exposures. The NIEHS does
43 not believe that other cancers or noncancer health outcomes provide sufficient evidence
44 of a risk to currently warrant concern.

45 This statement did not cause the NRC to change its position with respect to the chronic effects
46 of EMFs. The NRC staff considers the chronic effects of EMFs to be UNCERTAIN.

1 3.11.6.7 *Physical Occupational Hazards*

2 As nuclear power plants have many of the typical occupational hazards found at other electric
3 power generation utilities, the issue of occupational hazards can be evaluated by comparing the
4 rate of fatal injuries and nonfatal occupational injuries and illnesses in the utility sector with the
5 rate in all industries combined. Based on the 2021 Bureau of Labor Statistics for incidence rate
6 of fatal and nonfatal occupational injuries, utility sector rates are lower than those of many other
7 sectors (BLS 2021-TN7691). Occupational hazards can be minimized when workers adhere to
8 safety standards and use appropriate personal protective equipment; however, fatalities and
9 injuries caused by accidents may still occur.

10 Work at Monticello is performed under the statutory authority of OSHA and managed on-site by
11 an industrial safety program. The NRC staff expects that workers will continue to adhere to
12 safety standards and use protective equipment. The NRC staff expects that Xcel Energy will
13 continue to employ an occupational safety program and, as a result, the staff concludes that
14 physical occupational hazards due to continued nuclear power plant power operations at
15 Monticello during the SLR term are minimized and would be of SMALL significance (Xcel 2023-
16 TN9084).

17 3.11.6.8 *Electric Shock Hazards*

18 Based on the LR GEIS (NRC 2013-TN2654), the Commission found that electric shock resulting
19 from direct access to energized conductors or from induced charges in metallic structures has
20 not been identified as a problem at most operating nuclear power plants and generally is not
21 expected to be a problem during the license renewal term. However, a site-specific review is
22 required to determine the significance of the electric shock potential along the portions of the
23 transmission lines that are within the scope of Monticello SLR review.

24 As discussed in Section 3.11.5, “Other Hazards,” there are no off-site transmission lines that are
25 in regulatory scope for Monticello SLR. Therefore, there are no potential impacts on members of
26 the public resulting from such transmission lines. There are two transmission corridors on-site
27 containing 115kV and 345 kV overhead transmission lines with the potential for electric shock to
28 workers through induced currents. To address this occupational hazard, Xcel Energy adheres to
29 the National Electrical Safety Code for clearances and OSHA compliance requirements for
30 shock hazard avoidance (Xcel 2023-TN9084). As discussed in Section 3.11.5, Monticello
31 maintains an occupational safety program in accordance with OSHA regulations for its workers,
32 which includes protection from acute electric shock. Therefore, the NRC staff concludes that the
33 potential impacts from acute electric shock during the SLR term would be SMALL.

34 3.11.6.9 *Postulated Accidents*

35 The LR GEIS (NRC 2013-TN2654) evaluates the following two classes of postulated accidents
36 as they relate to license renewal:

37 Design-Basis Accidents: Postulated accidents that a nuclear facility must be designed and built
38 to withstand without loss to the systems, structures, and components necessary to ensure
39 public health and safety.

40 Severe Accidents: Postulated accidents that are more severe than design-basis accidents
41 because they could result in substantial damage to the reactor core.

1 As shown in Table 3-1 of this report, the LR GEIS (NRC 2013-TN2654) addresses design-basis
2 accidents as a Category 1 issue and concludes that the environmental impacts of design-basis
3 accidents are of SMALL significance for all nuclear power plants.

4 For Severe Accidents, Table 3-1 refers to EIS Appendix F of this report. Based on information in
5 the 2013 LR GEIS, the NRC determined in 10 CFR Part 51 (TN250), Subpart A, Appendix B
6 that for all nuclear power plants, the probability-weighted consequences of severe accidents
7 associated with license renewal is SMALL, with a caveat as follows:

8 The probability-weighted consequences of atmospheric releases, fallout onto open
9 bodies of water, releases to groundwater, and societal and economic impacts from
10 severe accidents are SMALL for all plants. However, alternatives to mitigate severe
11 accidents must be considered for all plants that have not considered such alternatives.
12 (NRC 2013-TN2654)

13 The NRC Staff evaluates Postulated Accidents and SAMAs for Monticello during the SLR term
14 in Appendix F of this report. The results are summarized below.

15 As part of its initial license renewal application submitted in 2006, Nuclear Management
16 Company, a subsidiary of Xcel Energy, included a SAMA analysis for Monticello in its LR ER
17 (NMC 2006). The NRC staff documented its review of the Monticello SAMA in the 2006
18 NUREG-1437 Supplement 26, "Generic Environmental Impact Statement for License Renewal of
19 Nuclear Plants, Regarding Monticello Nuclear Generating Plant Unit 1," (NRC 1999-TN8942).
20 Since the NRC staff had previously considered SAMAs for Monticello, Xcel Energy is not
21 required to perform another SAMA analysis for its SLR application (see 10 CFR
22 51.53(c)(3)(ii)(L) [10 CFR Part 51-TN250]). However, the NRC's regulations at 10 CFR Part 51
23 (TN250), which implement Section 102(2) of the NEPA, require that all applicants for license
24 renewal submit an environmental report to the NRC and in that report identify any "new and
25 significant information regarding the environmental impacts of license renewal of which the
26 applicant is aware" (10 CFR 51.53(c)(3)(iv)).

27 Accordingly, in its SLR application environmental report (Xcel 2023-TN9084), Xcel Energy
28 evaluated areas of new and potentially significant information that could affect the
29 environmental impact of postulated accidents during the SLR period. The NRC staff provides a
30 discussion of new information pertaining to Postulated Accidents and SAMAs in Appendix F,
31 "Environmental Impacts of Postulated Accidents," in this EIS.

32 Based on the NRC staff's review and evaluation of Xcel Energy's analysis of new and potentially
33 significant information regarding SAMAs and the staff's independent analyses as documented in
34 Appendix F, "Environmental Impacts of Postulated Accidents," to this EIS, the staff finds that
35 there is no new and significant information for Monticello related to Postulated Accidents or
36 SAMAs, that the impact of design-basis accidents for Monticello SLR is SMALL, and the
37 probability-weighted consequences of severe accidents associated with Monticello SLR are
38 SMALL.

39 **3.11.7 No-Action Alternative**

40 Under the no-action alternative, the NRC would not issue subsequent renewed licenses, and
41 Monticello would shut down on or before the expiration of the current renewed licenses. Human
42 health risks would be smaller following nuclear power plant shutdown. The reactor unit, which
43 currently operates within regulatory limits, would emit less radioactive gaseous, liquid, and solid
44 material to the environment. In addition, following shutdown, the variety of potential accidents at

1 the nuclear power plant (radiological or industrial) would be reduced to a limited set associated
2 with shutdown events and fuel handling and storage. In Section 3.11.6, "Proposed Action," the
3 NRC staff concluded that the impacts of continued nuclear power plant operation on human
4 health would be SMALL, except for "Chronic effects of electromagnetic fields (EMFs)," for which
5 the impacts are UNCERTAIN. In Section 3.11.6.9, "Postulated Accidents," the NRC staff
6 concluded that the impacts of accidents during operation are SMALL. Therefore, as radioactive
7 emissions to the environment decrease, and as the likelihood and types of accidents decrease
8 following shutdown, the NRC staff concludes that the risk to human health following nuclear
9 power plant shutdown would be SMALL.

10 **3.11.8 Replacement Power Alternatives: Common Impacts**

11 Impacts on human health from construction of a replacement power station would be similar to
12 impacts associated with the construction of any major industrial facility. Compliance with worker
13 protection rules, the use of personal protective equipment, training, and placement of
14 engineered barriers would limit those impacts on workers to acceptable levels.

15 The human health impacts from the operation of a power station include public risk from
16 inhalation of gaseous emissions. Regulatory agencies, including EPA and State of Minnesota
17 agencies, base air emission standards and requirements on human health impacts. These
18 agencies also impose site-specific emission limits to protect human health.

19 **3.11.9 Natural Gas and Renewables Alternative**

20 This alternative would involve the construction and installation of a new 750 MW natural
21 gas-fired, two-unit combustion turbine power plant built either onsite or off-site, 750 MW wind
22 turbines located off-site, and 200 MW of solar panels located both on and off-site of Monticello
23 (Xcel 2023-TN9084). Additional power generation would be provided by existing natural gas-
24 fired power plants operated by Xcel Energy. Impacts on human health from the Natural Gas and
25 Renewables alternative would include those identified in Section 3.11.8, "Replacement Power
26 Alternatives: Common Impacts." Because the NRC staff expects that licensees would limit
27 access to active construction areas to only authorized individuals, the impacts on human health
28 from the construction of the facility would be SMALL.

29 The human health effects from the operation of the natural gas alternative would include those
30 identified in Section 3.11.8 as common to the operation of all replacement power alternatives.
31 Health risk may be attributable to nitrogen oxide emissions that contribute to ozone formation
32 (NRC 2013-TN2654). Given the regulatory oversight exercised by the EPA and State agencies,
33 the NRC staff concludes that the human health impacts from the natural gas alternative would
34 be SMALL, except for "chronic effects of electromagnetic fields (EMFs)," for which the impacts
35 are UNCERTAIN.

36 Off-site wind turbines include operational hazards such as working at heights, working near
37 rotating mechanical or electrically energized equipment, and working in extreme weather at
38 times. Adherence to safety standards and the use of appropriate protective equipment through
39 implementation of an OSHA approved worker safety program would minimize occupational
40 hazards. Potential impacts on workers include ice thrown from rotor blades and broken blades
41 thrown as a result of mechanical failure. Adherence to proper worker safety procedures and
42 limiting public access to wind turbine sites would minimize the impacts from ice throw and
43 broken rotor blades. Potential impacts also include EMF exposure, aviation safety hazards, and
44 exposure to noise and vibration from the rotating blades. Impacts from EMF exposure would be

1 minimized by adherence to proper worker safety procedures and limiting access to any
2 components that could create an EMF. Aviation safety hazards would be minimized by proper
3 siting of the offshore wind turbine facilities and maintaining all proper safety warning devices,
4 such as indicator lights, for pilot visibility. Offshore installation of wind facilities would preclude
5 most potential human health effects from noise and vibration. Furthermore, the NRC staff has
6 identified no epidemiologic studies on noise and vibration from wind turbines that would suggest
7 any direct human health impact. Based on this information, the human health impacts from the
8 operation of the wind component for the combination alternative would be SMALL.

9 Solar PV panels are encased in heavy duty glass or plastic. Therefore, there is little risk that the
10 small amounts of hazardous semiconductor material that they contain would be released into the
11 environment. In the event of a fire, hazardous PM could be released into the atmosphere. Given
12 the short duration of fires and the high melting points of the materials found in the solar PV
13 panels, the impacts from inhalation are minimal. Also, the risk of fire at ground-mounted solar
14 installations is minimal because of precautions taken during site preparation, such as the
15 removal of fuels and the lack of burnable materials contained in the solar PV panels. Another
16 potential risk associated with PV systems and fire is the potential for shock or electrocution from
17 contact with a high voltage conductor. Proper procedures and clear marking of system
18 components should be used to provide emergency responders with appropriate warnings to
19 diminish the risk of shock or electrocution (Good Company 2011-TN8599). Solar PV panels do
20 not produce EMFs at levels considered harmful to human health, as established by the
21 International Commission on Non-Ionizing Radiation Protection. These small EMFs diminish
22 significantly with distance and are indistinguishable from normal background levels within several
23 yards (Good Company 2011-TN8599) Based on this information, the human health impacts from
24 the operation of the solar PV component for the combination alternative would be SMALL.

25 Therefore, given the expected compliance with worker and environmental protection rules and
26 the use of personal protective equipment, training, and engineered barriers, the NRC staff
27 concludes that the potential human health impacts for the Natural Gas and Renewables
28 alternative would be SMALL.

29 **3.11.10 Renewables and Storage Alternative**

30 This alternative would involve the construction and installation of 950 MW of wind turbines
31 located off-site, 700 MW of solar panels located both on and off-site of Monticello, and 300 MW
32 of lithium battery storage at solar off-site locations. This alternative would be supplemented by
33 purchased power as needed, along with occasional and small additional power generation from
34 existing natural gas-fired power plants operated by Xcel Energy.

35 As noted in the discussion of the Natural Gas and Renewables Alternative above, the impacts
36 on human health from wind turbines and solar panels would remain SMALL for human health
37 under this alternative discussion.

38 Lithium-Ion batteries are used for utility-scale storage and would fall under industrial safety
39 plans, environmental protection rules, and OSHA regulations. Lithium-ion batteries have the
40 potential to catch fire due to an effect called thermal runaway; although an uncommon
41 occurrence, thermal runaway is one of the most recognized safety issues for lithium-ion
42 batteries. The self-perpetuating process can end in battery destruction, release of toxic gases,
43 and has a high risk of fire or explosion (Łukasz et al. 2023-TN9618). Although thermal runaway
44 is a concern, industrial safety practices would limit the impacts on human health and therefore
45 overall impacts would be SMALL for the battery storage part of this alternative.

1 Therefore, given the expected compliance with worker and environmental protection rules and
2 the use of personal protective equipment, training, and engineered barriers, the NRC staff
3 concludes that the potential human health impacts for the Renewables and Storage alternative
4 would be SMALL.

5 **3.11.11 New Nuclear (Small Modular Reactor) Alternative**

6 The construction impacts of the new nuclear alternative would include those identified in
7 Section 3.11.8, "Replacement Power Alternatives Common Impacts" above. Under Minnesota
8 law, new nuclear plants would be sited outside the State. Construction impacts may differ
9 depending on the site chosen but are expected to be relatively similar. Because the NRC staff
10 expects that the licensee would limit access to active construction areas to only authorized
11 individuals, the impacts on human health from the construction of two new nuclear units would
12 be SMALL.

13 The human health effects from the operation of the new nuclear alternative would be similar to
14 those of operating the existing Monticello. SMR designs would use the same type of fuel (i.e.,
15 form of the fuel, enrichment, burnup, and fuel cladding) as the plants considered in the NRC
16 staff's evaluation in the LR GEIS (NRC 2013-TN2654). As such, their impacts would be similar
17 to those at Monticello. Under Minnesota law, new nuclear plants would be sited outside the
18 State. Human health impacts may differ depending on the site chosen but are expected to be
19 relatively similar to the impacts at Monticello. As presented in Section 3.11.6, "Proposed Action,"
20 impacts on human health from the operation of Monticello would be SMALL, except for "chronic
21 effects of electromagnetic fields (EMFs)," for which the impacts are UNCERTAIN. Therefore, the
22 NRC staff concludes that the impacts on human health from the operation of the new nuclear
23 alternative would be SMALL.

24 **3.12 Environmental Justice**

25 Under EO 12898, "Federal Actions To Address Environmental Justice in Minority Populations
26 and Low-Income Populations" (59 FR 7629-TN1450), Federal agencies are responsible for
27 identifying and addressing, as appropriate, disproportionate and adverse human health and
28 environmental impacts on minority and low-income populations. Independent agencies, such as
29 the NRC, are not bound by the terms of the order but are "requested to comply with the
30 provisions of [the] order" (EO 12898, Section 6-604). In 2004, the Commission issued the
31 agency's "Policy Statement on the Treatment of Environmental Justice Matters in NRC
32 Regulatory and Licensing Actions" (69 FR 52040-TN1009), which states:

33 The Commission is committed to the general goals set forth in EO 12898, and
34 strives to meet those goals as part of its NEPA review process.

35 The CEQ provides the following information in Environmental Justice: Guidance Under the
36 National Environmental Policy Act (CEQ 1997-TN452):

37 **Disproportionately High and Adverse Human Health Effects:** Adverse health effects
38 are measured in risks and rates that could result in latent cancer fatalities, as well as
39 other fatal or nonfatal adverse impacts on human health. Adverse health effects may
40 include bodily impairment, infirmity, illness, or death. Disproportionately high and
41 adverse human health effects occur when the risk or rate of exposure to an
42 environmental hazard for a minority or low-income population is significant (as employed

1 by NEPA) and appreciably exceeds the risk or exposure rate for the general population
2 or for another appropriate comparison group (CEQ 1997-TN452).

3 **Disproportionately High and Adverse Environmental Effects:** A disproportionately
4 high environmental impact that is significant (as employed by NEPA) refers to an impact
5 or risk of an impact on the natural or physical environment in a low-income or minority
6 community that appreciably exceeds the environmental impact on the larger community.
7 Such effects may include ecological, cultural, human health, economic, or social
8 impacts. An adverse environmental impact is an impact that is determined to be both
9 harmful and significant (as employed by NEPA). In assessing cultural and aesthetic
10 environmental impacts, impacts that uniquely affect geographically dislocated or
11 dispersed minority or low-income populations or American Indian Tribes are considered
12 (CEQ 1997-TN452).

13 This environmental justice analysis assesses the potential for disproportionate and adverse
14 human health or environmental effects on minority and low-income populations that could result
15 from the continued operation of Monticello Nuclear Generating Plant associated with the
16 proposed action (license renewal) and alternatives to the proposed action. In assessing the
17 impacts, the following definitions of minority individuals, minority populations, and low-income
18 population were used (CEQ 1997-TN452):

19 **Minority Individuals:** Individuals who identify themselves as members of the following
20 population groups: Hispanic or Latino, American Indian or Alaska Native, Asian, Black or African
21 American, Native Hawaiian or Other Pacific Islander, or two or more races, meaning individuals
22 who identified themselves on a Census form as being a member of two or more races, for
23 example, White and Asian.

24 **Minority Populations:** Minority populations are identified when (1) the minority population of an
25 affected area exceeds 50 percent or (2) the minority population percentage of the affected area
26 is meaningfully greater than the minority population percentage in the general population or
27 other appropriate unit of geographic analysis.

28 **Low-income Population:** Low-income populations in an affected area are identified with the
29 annual statistical poverty thresholds from the Census Bureau's Current Population Reports,
30 Series P60, on Income and Poverty.

31 In determining the location of minority and/or low-income populations, the NRC staff uses a
32 50 mi (80 km) radius from the facility as the geographic area to perform a comparative analysis.
33 The 50 mi (80 km) radius is consistent with the impact analysis conducted for human health
34 impacts. The NRC compares the percentage of minority and/or low-income populations in the
35 50 mi (80 km) geographic area to the percentage of minority and/or low-income populations in
36 each census block group to determine which block groups exceed the regional percentage (or
37 50 percent, whichever is lower), thereby identifying the location of these populations
38 (NRC 2020-TN6399).

39 Minority Population

40 According to the USCB's 2020 Census data, there are a total of 2,673 block groups within a
41 50 mi (80 km) radius of the Monticello site and 29 percent of the population residing within a
42 50 mi (80 km) radius of Monticello identified themselves as minority individuals. The largest
43 minority populations were Black or African American (10 percent) and Asian (7 percent) (USCB
44 2020-TN9675).

1 According to the CEQ definition, a minority population exists if the percentage of the minority
2 population of an area (e.g., census block group) exceeds 50 percent or is meaningfully greater
3 than the minority population percentage in the general population. Because the population
4 within the 50 mi (80 km) radius does not exceed 50 percent minority, the meaningfully greater
5 threshold was used to identify minority populations. Therefore, for the purposes of analysis,
6 census block groups within the 50 mi (80 km) radius of Monticello were identified as minority
7 population block groups if the percentage of the minority population in the block group exceeded
8 29 percent. Based on this, there are 1,019 minority population blocks groups within a 50 mi
9 (80 km) radius of Monticello.

10 As shown in Figure 3-17, high population minority block groups (race and ethnicity) are
11 predominantly clustered southeast, north, and northwest of the Monticello site. Monticello is not
12 located in a minority population block group.

13 As presented in Section Figure 3-17 of this EIS, in 2020, the minority population in the two-
14 county ROI was 11.6 percent (Table 3-24). Furthermore, as shown in Table 3-25, based on the
15 2017–2021 estimates, minority populations in the two-county ROI are estimated to have
16 remained relatively stable at 11.7 percent.


17 Low-Income Population

18 The U.S. Census Bureau's 2017–2021 American Community Survey data identifies 9 percent of
19 individuals residing within a 50 mi (80 km) radius of the Monticello site as living below the
20 Federal poverty threshold (USCB 2021-TN9676). The 2020 Federal poverty threshold was
21 \$26,200 for a family of four (USCB 2021-TN8833).


22 shows the location of predominantly low-income population block groups within the 50 mi
23 (80 km) radius of Monticello. In accordance with NRC guidance (NRC 2020-TN6399), census
24 block groups were considered low-income population block groups if the percentage of
25 individuals living below the Federal poverty threshold within the block groups exceeded
26 9 percent (the percent of the individuals living below the Federal poverty threshold within the
27 50 mi (80 km) radius of the Monticello site). Based on this, there are 844 low-income population
28 blocks groups within a 50 mi (80 km) radius of the Monticello site.

29 As shown in , low-income population block groups are distributed throughout the 50 mi (80 km)
30 radius of the Monticello site. Monticello is located adjacent to low-income population block
31 groups to the south and west.

32 As discussed in Sections 3.10, 3.10.2, 3.10.2.1 of this EIS, according to the USCB's 2017–2021
33 American Community Survey 5-Year Estimates (USCB 2021-TN8818), people living in the two-
34 county ROI had a median household income of \$93,501 which is more than the State average
35 of \$77,706. Additionally, the percentage of individuals living below the poverty level in
36 Sherburne and Wright Counties was lower than the percentage of individuals living below the
37 poverty level in the State of Minnesota.

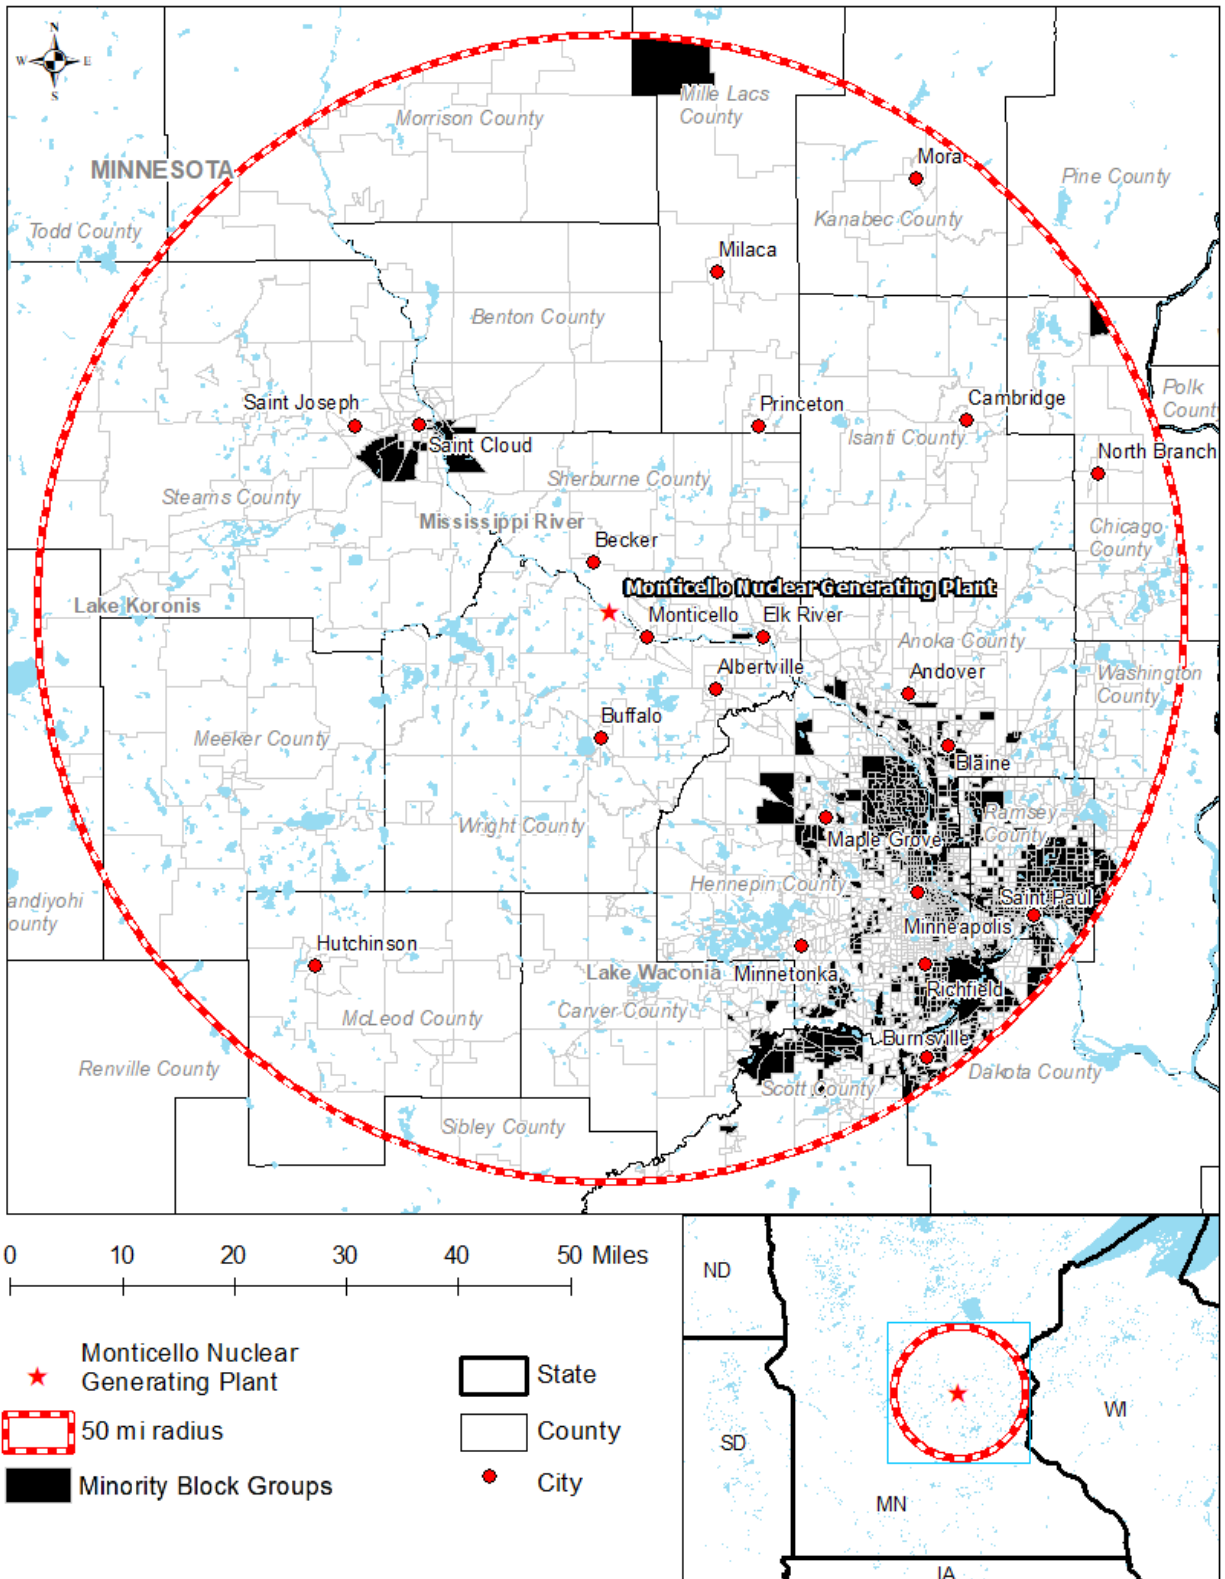

1
 2 **Figure 3-17 Minority Block Groups Within a 50 mi (80 km) Radius of Monticello.**
 3 **Source: Modified from USCB 2020-TN9675.**

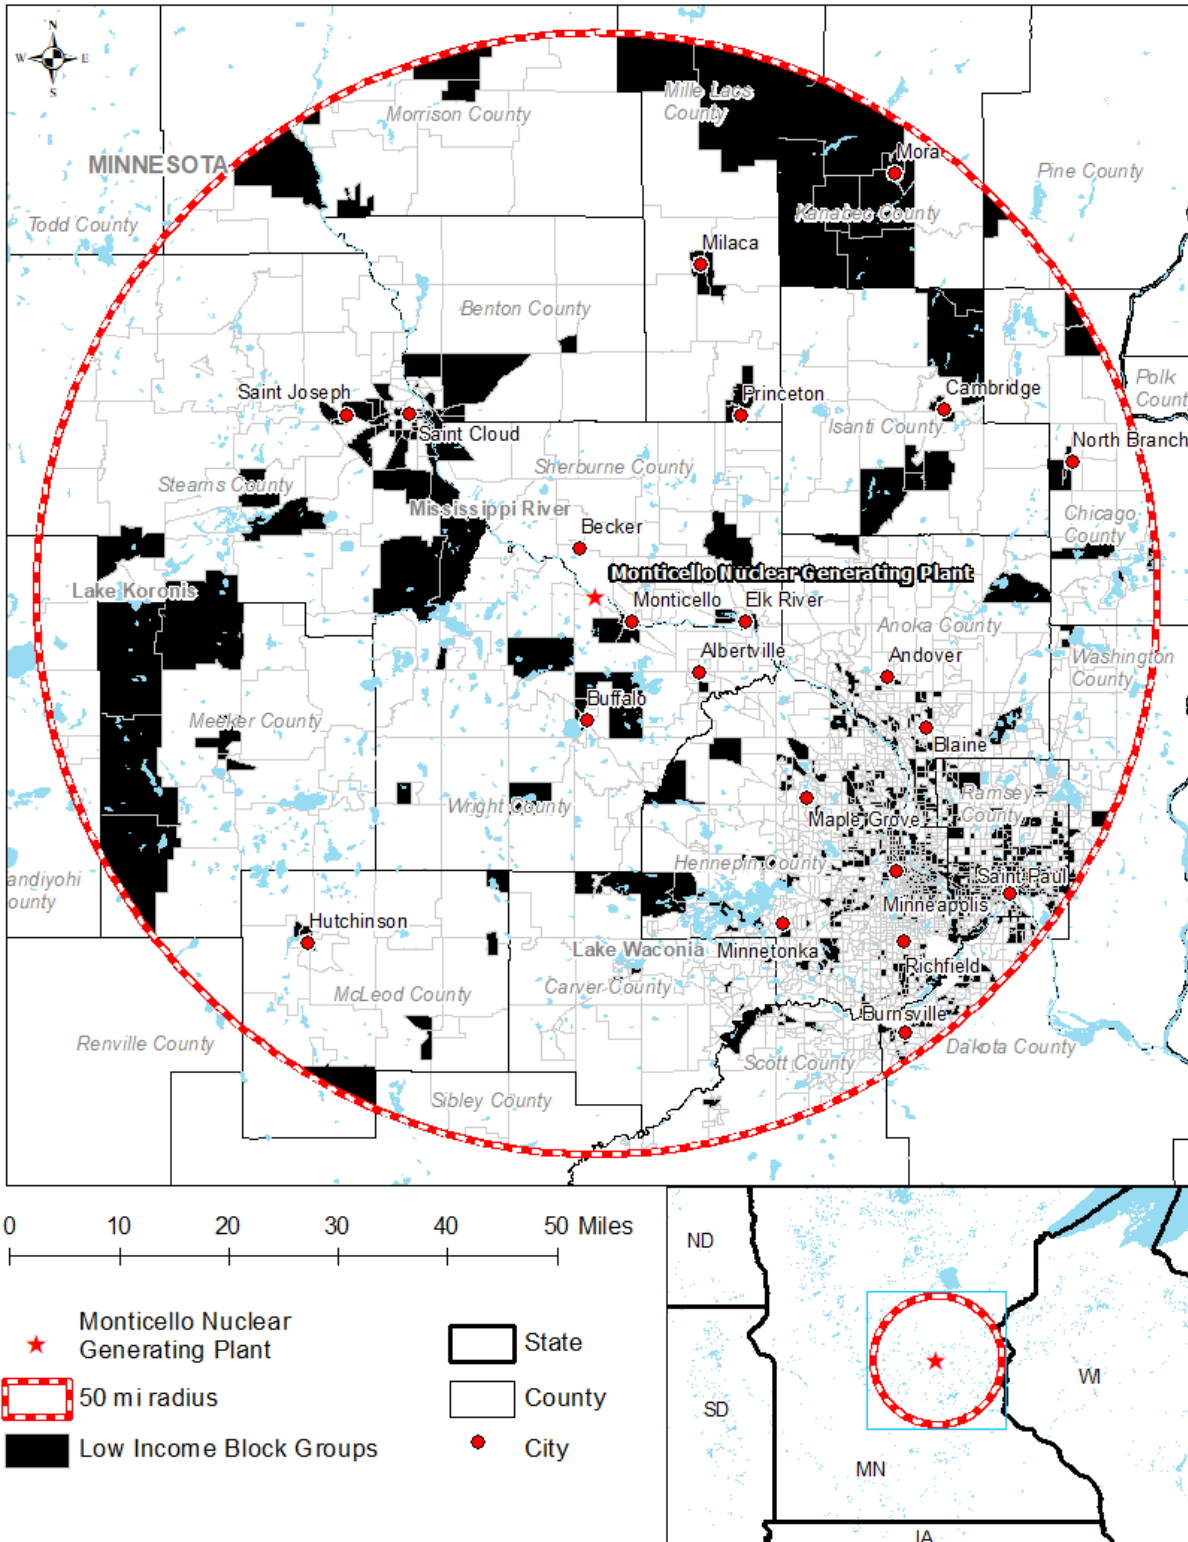

1
 2 **Figure 3-18 Low-Income Block Groups Within a 50 mi (80 km) Radius of Monticello.**
 3 **Source: Modified from UCSB (Modified from USCIB 2021-TN9676).**

1 **3.12.1 Proposed Action**

2 The NRC staff addresses environmental justice matters for license renewal by: (1) identifying
3 the location of minority and low-income populations that may be affected by the continued
4 operation of the nuclear power plant during the SLR term, (2) determining whether there would
5 be any potential human health or environmental effects to these populations and special
6 pathway receptors (groups or individuals with unique consumption practices and interactions
7 with the environment), and (3) determining whether any of the effects may be disproportionate
8 and adverse.

9 Adverse health effects are measured in terms of the risk and rate of fatal or nonfatal adverse
10 impacts on human health. Disproportionate and adverse human health effects occur when the
11 risk or rate of exposure to an environmental hazard for a minority or low-income population is
12 significant and exceeds the risk or exposure rate for the general population or for another
13 appropriate comparison group. Disproportionate environmental effects refer to impacts or risks
14 of impacts on the natural or physical environment in a minority or low-income community that
15 are significant and appreciably exceed the environmental impact on the larger community. Such
16 effects may include biological, cultural, economic, or social impacts.

17 Table 3-17 and Table 3-18 show the location of predominantly minority and low-income
18 population block groups residing within a 50 mi (80 km) radius of Monticello. This area of impact
19 is consistent with the 50 mi (80 km) impact analysis for public and occupational health and
20 safety. This chapter of the EIS presents the assessment of environmental and human health
21 impacts for each resource area. The analyses of impacts for all environmental resource areas
22 indicated that the impact from SLR would be SMALL.

23 Potential impacts on minority and low-income populations (including migrant workers or Native
24 Americans) would mostly consist of socioeconomic and radiological effects; however, radiation
25 doses from continued operations during the SLR term are expected to continue at current
26 levels, and they would remain within regulatory limits. Section 3.11.6.9 discusses the
27 environmental impacts from postulated accidents that might occur during the SLR term, which
28 include both design-basis and severe accidents. As discussed there and in Appendix F to this
29 EIS, the NRC staff concludes that the potential impacts of design-basis accidents, and the
30 probability-weighted consequences of severe accidents, are SMALL (see Section 3.11.6.9).

31 Therefore, based on the information and the analysis of human health and environmental
32 impacts, minority and low-income populations would not likely experience any disproportionate
33 and adverse human health and environmental effects from the continued operation of Monticello
34 during the SLR term.

35 *Subsistence Consumption of Fish and Wildlife*

36 As part of addressing environmental justice concerns associated with SLR, the NRC staff also
37 assessed the potential radiological risk to special population groups (such as migrant workers or
38 Native Americans) from exposure to radioactive material received through their unique
39 consumption practices and interactions with the environment, including the subsistence
40 consumption of fish and wildlife; native vegetation; contact with surface waters, sediments, and
41 local produce; absorption of contaminants in sediments through the skin; and inhalation of
42 airborne radioactive material released from the plant during routine operation. The special
43 pathway receptors analysis is an important part of the environmental justice analysis because
44 consumption patterns may reflect the traditional or cultural practices of minority and low-income

1 populations in the area, such as migrant workers or Native Americans. The results of this
2 analysis are presented here.

3 Section 4–4 of EO 12898, “Federal Actions to Address Environmental Justice in Minority
4 Populations and Low-Income Populations” (1994) (59 FR 7629-TN1450), directs Federal
5 agencies, whenever practical and appropriate, to collect and analyze information about the
6 consumption patterns of populations that rely principally on fish and wildlife for subsistence and
7 to communicate the risks of these consumption patterns to the public. In this EIS, the NRC staff
8 considered whether there were any means for minority or low-income populations to be
9 disproportionately affected by examining impacts on American Indian, Hispanics, migrant
10 workers, and other traditional lifestyle special pathway receptors.

11 As discussed in Section 3.6 and Section 3.9 of this EIS, the Mille Lacs Band of Ojibwe identified
12 wild rice (*Zizania* spp.), which is a traditional food source of the Ojibwe, as a cultural resource
13 that may occur on the Monticello site. Called *manoomin* in the Ojibwe language, wild rice is a
14 naturally occurring aquatic grass that grows in shallow water, such as in the bottom of shallow
15 lakebeds (MnDNR 2008-TN9711). It is a traditional subsistence staple food for Native American
16 Tribes who lived in areas of Minnesota, Wisconsin, and Canada. Wild rice is also a food source
17 for birds such as waterfowl that are traditional game animals for subsistence hunters.
18 Radiological contamination could enter the human food chain through subsistence consumption
19 of contaminated wild rice or through hunting and consumption of waterfowl that consume
20 contaminated wild rice. Xcel Energy plans to conduct a survey to determine whether wild rice is
21 present onsite in summer 2024 (Xcel 2024-TN9859). The NRC staff will include the results of
22 the wild rice survey, if available, in the final EIS.

23 Subsistence harvest fishing can also be a source of radiological exposure for special population
24 groups. The Upper Mississippi River Basin is home to 10 native American Tribes. Of these 10
25 Tribes, 5 do not have subsistence treaty fishing rights and have largely abandoned subsistence
26 fishing. The Prairie Island Indian Community and the Shakopee Mdewakanton Sioux
27 Community reservations can access fishing waters including the Mississippi River. However,
28 because their land is located close to the Minneapolis–St. Paul metropolitan area and the Tribes
29 participate in the local economy, subsistence fishing is less important (USACE 2012-TN9848).
30 Upper Mississippi River Basin Tribes that continue to exercise subsistence treaty rights include
31 the Mille Lac Band of Ojibwe, St. Croix Chippewa Indians of Wisconsin, Lac Courte Oreilles
32 Band of Ojibwe, and the Lac du Flambeau Band of Lake Superior Chippewa Indians (USACE
33 2012-TN9848).

34 The assessment of special pathways considered the levels of radiological and nonradiological
35 contaminants in fish, sediments, water, milk, and food products on or near Monticello.
36 Radionuclides released to the atmosphere may deposit on soil and vegetation and may
37 therefore eventually be incorporated into the human food chain. To assess the impact of reactor
38 operations on humans from the ingestion pathway, Xcel Energy collects and analyzes samples
39 of direct radiation, air, drinking water, river water, groundwater, vegetation, milk, fish, and
40 shoreline sediment as part of its ongoing comprehensive REMP.

41 To assess the impact of nuclear power plant operations, samples are collected annually from
42 the environment and analyzed for radioactivity. A plant effect would be indicated if the
43 radioactive material detected in a sample was higher than background levels. Two types of
44 samples are collected. The first type, a control sample, is collected from areas beyond the
45 influence of the nuclear power plant or any other nuclear facility. These control samples are
46 used as reference data to determine normal background levels of radiation in the environment.

1 The second type of samples, indicator samples, are collected near the nuclear power plant from
2 areas where any radioactivity contribution from the nuclear power plant will be at its highest
3 concentration. These indicator samples are then compared to the control samples, to evaluate
4 the contribution of nuclear power plant operations to radiation or radioactivity levels in the
5 environment. An effect would be indicated if the radioactivity levels detected in an indicator
6 sample were larger or higher than the control sample or background levels.

7 Xcel Energy collected samples from the environment in the vicinity of Monticello (Xcel 2023-
8 TN9084, Section 3.12 of this EIS). The pathways include direct radiation, air, drinking water,
9 river water, groundwater, vegetation, milk, fish, and shoreline sediment. A five-year period
10 provides a dataset that covers a broad range of activities that occur at a nuclear power plant,
11 such as refueling outages, routine operation, and maintenance that could release radioactive
12 effluents into the environment. The data show that there were no significant radiological impacts
13 on the environment from operations at Monticello.

14 Based on radiological environmental monitoring data, special pathway receptor populations in
15 the region would not likely experience disproportionate and adverse human health impacts
16 because of subsistence consumption. In addition, the continued operation of Monticello would
17 not have disproportionate and adverse human health and environmental effects on these
18 populations.

19 **3.12.2 No-Action Alternative**

20 Under the no-action alternative, the NRC would not renew the operating licenses, and
21 Monticello would shut down on or before the expiration of the current facility operating license.
22 Impacts on minority and low-income populations would depend on the number of jobs and the
23 amount of tax revenues lost in communities located near the nuclear power plant after reactor
24 operations cease. Not renewing the operating licenses and terminating reactor operations could
25 have a noticeable impact on socioeconomic conditions in the communities near Monticello. The
26 loss of jobs and income could have an immediate socioeconomic impact. Some, but not all, of
27 the 663 workers could leave the area. In addition, the nuclear power plant would generate less
28 tax revenue, which could reduce the availability of public services. This reduction could
29 disproportionately affect minority and low-income populations that may have become dependent
30 on these services.

31 **3.12.3 Replacement Power Alternatives: Typical Impacts**

32 The following discussions identify typical impacts that often stem from the construction and
33 operation of replacement power facilities that could disproportionately affect minority and low-
34 income populations. Based on the information available at this time, and the lack of information
35 on the replacement power facility design and siting, the NRC staff cannot determine if any of the
36 replacement power alternatives would result in disproportionate and adverse human health and
37 environmental effects on minority and low-income populations. This determination would
38 depend on the site location, facility design, operational characteristics of the new facility, unique
39 consumption practices and interactions with the environment of nearby populations, and the
40 location of predominantly minority and low-income populations. Construction and operation
41 impacts are not anticipated to be substantially different between the replacement power
42 alternatives, so the NRC staff's analyses of these alternatives are combined.

1 Construction

2 Potential impacts on minority and low-income populations from the construction of a
3 replacement power facility would mostly consist of environmental and socioeconomic effects
4 (e.g., noise, dust, traffic, employment, and housing impacts). The extent of the effects
5 experienced by these populations would depend on the location of the power plant and
6 transportation routes. Noise and dust impacts from construction would be short term and
7 primarily limited to onsite activities. Minority and low-income populations residing along site
8 access roads would be affected by increased truck and commuter vehicle traffic during
9 construction, especially during shift changes. However, these effects would be temporary,
10 limited to certain hours of the day, and would not likely be high and adverse. Increased demand
11 for rental housing during construction could disproportionately affect low-income populations
12 reliant on low-cost housing.

13 Operation

14 Potential impacts on minority and low-income populations from the operation of a replacement
15 power plant would mostly consist of environmental, health, and socioeconomic effects (e.g.,
16 employment and emissions). Minority and low-income populations living near the site may be
17 subject to visual and noise impacts from the operation of replacement power generating
18 facilities and transmission lines. Low-income populations that rely on subsistence consumption
19 of fish and wildlife could be disproportionately affected. Emissions during power plant operations
20 could also disproportionately affect nearby minority and low-income populations, depending on
21 the type of replacement power. However, permitted air emissions are expected to remain within
22 regulatory standards during operations. Socioeconomic impacts would likewise depend upon
23 the location of the facility and its contribution to the local economy and tax base.

24 **3.13 Waste Management**

25 Like any operating nuclear power plant, Monticello will produce both radioactive and
26 nonradioactive waste during the SLR period. This section describes waste management and
27 pollution prevention at Monticello. The description of these waste management activities is
28 followed by the NRC staff's analysis of the potential impacts of waste management activities
29 from the proposed action (SLR) and alternatives to the proposed action.

30 **3.13.1 Radioactive Waste**

31 The NRC licenses nuclear power plants with the expectation that they will release a limited
32 amount of radioactive material to both the air and water during normal operations. However,
33 NRC regulations require that gaseous and liquid radioactive releases from nuclear power plants
34 meet radiation dose-based limits specified in 10 CFR Part 20 (TN283), "Standards for Protection
35 Against Radiation," and the ALARA criteria in 10 CFR Part 50 (TN249), Appendix I, "Numerical
36 Guides for Design Objectives and Limiting Conditions for Operation to Meet the Criterion 'As
37 Low as is Reasonably Achievable' for Radioactive Material in Light-Water-Cooled Nuclear
38 Power Reactor Effluents." In other words, the NRC places regulatory limits on the radiation dose
39 that members of the public can receive from radioactive effluents of a nuclear power plant. For
40 this reason, all nuclear power plants use radioactive waste management systems to control and
41 monitor radioactive wastes.

42 Monticello uses liquid, gaseous, and solid waste processing systems to collect and treat, as
43 needed, radioactive materials produced as a byproduct of nuclear power plant operations.

1 Radioactive materials in liquid, gaseous, and solid effluents are reduced before being released
2 into the environment so that the resultant dose to members of the public from these effluents is
3 well within the NRC and EPA dose standards. Radionuclides that can be efficiently removed
4 from the liquid and gaseous effluents before release are converted to a solid waste form for
5 disposal in a licensed disposal facility.

6 Xcel Energy maintains a REMP to assess the radiological impact, if any, to the public and the
7 environment from radioactive effluents released during operations at Monticello (Xcel 2023-
8 TN9084).

9 Xcel Energy has an Offsite Dose Calculation Manual (ODCM) that contains the methods and
10 parameters for calculating offsite doses resulting from liquid and gaseous radioactive effluents.
11 These methods ensure that radioactive material discharges from Monticello meet NRC and EPA
12 regulatory dose standards. The ODCM also contains the requirements for the REMP (Xcel
13 2022-TN9595: Offsite Dose Calculation Manual [ODCM] 07.01 Monticello Nuclear Generating
14 Plant Revision 26 Enclosure 2).

15 3.13.1.1 *Radioactive Liquid Waste Management*

16 Xcel Energy uses waste management systems to collect, analyze, and process radioactive
17 liquids produced at Monticello. The Monticello liquid waste disposal system meets the design
18 objectives of 10 CFR Part 50 (TN249), Appendix I, and controls the processing, disposal, and
19 release of radioactive liquid wastes.

20 Liquid waste is processed through the radwaste system and is either returned to the condensate
21 system for plant re-use or solidified and shipped to an offsite disposal location. Also, although
22 liquid releases to the Mississippi River in accordance with the ODCM limit are allowed by the
23 technical specifications of the plant license, Monticello has not had any planned radioactive
24 releases to the Mississippi River since 1972. As discussed in Section 2.2.6.1 of the Xcel Energy
25 ER (Xcel 2023-TN9084), Monticello does not perform planned radioactive liquid waste
26 discharges. Unplanned abnormal releases containing radioactive material have occurred in
27 certain years, but they are monitored, reported, and fall within Federal release limits and
28 guidelines (NRC 2006-TN7315).

29 Xcel Energy's use of these radiological waste systems and the procedural requirements in the
30 ODCM provides assurance that the dose from radiological liquid effluents at Monticello complies
31 with NRC and EPA regulatory dose standards. Xcel Energy calculates dose estimates for
32 members of the public using radiological liquid effluent release data.

33 Xcel Energy's annual radioactive effluent release reports contain a detailed presentation of
34 liquid effluents released from Monticello and the resultant calculated doses (Xcel 2023-
35 TN9596). These reports are publicly available on the NRC's website (<https://www.nrc.gov/>). The
36 NRC staff reviewed five years of radioactive effluent release data from 2018 through 2022 (Xcel
37 2019-TN9599, Xcel 2020-TN9598, Xcel 2021-TN9597, Xcel 2022-TN9595, Xcel 2023-TN9596).
38 A five-year period provides a dataset that covers a broad range of activities that occur at a
39 nuclear power plant, such as refueling outages, routine operation, and maintenance, which can
40 affect the generation of radioactive effluents into the environment. The NRC staff compared the
41 data against NRC dose limits and looked for indications of adverse trends (i.e., increasing dose
42 levels or increasing radioactivity levels).

1 A review of five years of Radioactive Effluent Release Reports (Xcel 2019-TN9599, Xcel 2020-
2 TN9598, Xcel 2021-TN9597, Xcel 2022-TN9595, Xcel 2023-TN9596) confirmed that no liquid
3 effluents were released during normal operations; however, an abnormal discharge as well as
4 instances of abnormal releases have occurred during this five-year period. This EIS uses the
5 terms “abnormal discharge” and “abnormal release” as they are defined in Regulatory
6 Guide 1.21, Revision 3 (NRC 2021-TN7227). An “abnormal release” is an unplanned or
7 uncontrolled release of licensed radioactive material into the onsite environs while an “abnormal
8 discharge” is an unplanned or uncontrolled discharge of licensed radioactive material to the
9 unrestricted area. The following abnormal discharges or releases occurred in the period from
10 2018–2023:

- 11 • An abnormal discharge of approximately 480 gallons of liquid radioactive material occurred
12 in 2021 due to contamination of the clean Turbine Building Normal Waste Sump during a
13 refueling outage which resulted in a small release of tritium. The total dose was estimated to
14 be 4.69×10^{-8} mrem (4.69×10^{-10} mSv) (Xcel 2022-TN9595).
- 15 • On November 22, 2022, Monticello measured elevated tritium levels in a groundwater
16 monitoring well between the turbine building and reactor building. The licensee reported an
17 onsite monitoring well that indicated tritium activity above the ODCM and Nuclear Energy
18 Institute Groundwater Protection Initiative reporting levels (Xcel 2022-TN9595): Offsite Dose
19 Calculation Manual [ODCM] 07.01 Monticello Nuclear Generating Plant Revision 26
20 Enclosure 2; NRC 2022-TN9600). Since November 2022, the licensee identified the location
21 of the underground leak, repaired the leak, and implemented a recovery system to remove
22 contaminated groundwater from the beneath the plant. NRC inspectors observed and
23 evaluated the licensee’s initial response to identify and quantify the source of the tritium
24 leak. Results of the inspection were documented in the Monticello Nuclear Generating Plant
25 - Integrated Inspection Report 05000263/2023001 (NRC 2023-TN9601). Additional details
26 and evaluation of the tritium leak are described in Section 3.5.2 of this EIS. No statistically
27 significant concentrations of tritium were identified in sentinel wells in 2022; therefore,
28 Monticello did not report a tritium discharge to the unrestricted area (Xcel 2023-TN9596).
- 29 • A second tritium abnormal release was reported on March 23, 2023. As discussed during
30 the audit conducted in July 2023, this release was related to an increase in the flow through
31 the Control Rod Drive supply piping that was leaking, and it was found that the temporary
32 catchment basin used to collect the water was not large enough to handle the additional
33 volume. The pipe was replaced on March 25, 2023 (Xcel 2023-TN9609).
- 34 • In May 2023, a holding tank containing tritium contaminated water spilled. Event Notification
35 56535 estimated that between 300–600 gallons overflowed off a holding tank (NRC 2023-
36 TN9610). The licensee estimated the tritium activity concentration in the tank was
37 1.94×10^5 pCi/l of tritium based on a sample from pumping well 12a (Xcel 2023-TN9609).
38 As observed during the audit, the site was using temporary above ground tanks to store the
39 recovered tritiated water, which required a major facilities above ground storage tank permit.
40 The site later transferred the tritiated water to the remediation pond that was being
41 constructed at the time of the audit. As noted in the MPCA December 14, 2023, news
42 release, “The MPCA issued the appropriate permit in May 2023, requiring the use of
43 temporary tanks to end by Nov. 1 [2023]. The company has since transferred the tritiated
44 water to a more permanent in-ground lined pond and has emptied and dismantled the
45 temporary tanks.” (MPCA 2023-TN9694)

46 As part of ongoing reactor oversight activities, inspectors reviewed the licensee’s
47 implementation of its corrective action program related to the onsite monitoring well that
48 indicated tritium activity above the ODCM and Nuclear Energy Institute Groundwater Protection

1 Initiative reporting levels. As noted in the Inspection Report 05000263/2023002 dated August 7,
2 2023 (NRC 2023-TN9611), “The inspectors concluded the licensee developed a holistic plan
3 with significant input from contracted vendor with expertise in groundwater management and
4 cleanup. The inspectors noted a high level of support (time and resources) from all levels of the
5 organization to recover and store the contaminated groundwater onsite and prevent any
6 uncontrolled release from the site.” For a detailed discussion, refer to Section 3.5.2 of this EIS.

7 The NRC staff’s review of Xcel Energy’s radioactive liquid effluent control program shows that
8 the applicant maintained radiation doses to members of the public within NRC and EPA
9 radiation protection standards, as stated in Appendix I to 10 CFR Part 50 (TN249),
10 10 CFR Part 20 (TN283), and 40 CFR Part 190 (TN739), “Environmental Radiation Protection
11 Standards for Nuclear Power Operations.” The NRC staff observed no adverse trends in the
12 dose levels.

13 3.13.1.2 Radioactive Gaseous Waste Management

14 Radioactive gaseous wastes develop from gases in liquid contained in tanks and piping at
15 Monticello. The gaseous wastes are monitored and released at an acceptable rate designated
16 by the ODCM. The ODCM determines the effluent release rate to ensure that releases are
17 within predetermined limits, which ascertains compliance with dose limitations of licensee
18 commitments (Xcel 2022-TN9595: Offsite Dose Calculation Manual [ODCM] 07.01 Monticello
19 Nuclear Generating Plant Revision 26 Enclosure 2). The gaseous radwaste systems provide
20 gas holdup for decay, and the site releases the gases under controlled conditions.

21 Xcel Energy calculates dose estimates for members of the public based on radioactive gaseous
22 effluent release data and atmospheric transport models. Xcel Energy’s annual radioactive
23 effluent release reports present in detail the radiological gaseous effluents released from
24 Monticello and the resultant calculated doses. As described above in Section 3.13.1.1, the NRC
25 staff reviewed five years of radioactive effluent release data from the 2018 through 2022 reports
26 (Xcel Energy Effluent Report Xcel 2019-TN9599, Xcel 2020-TN9598, Xcel 2021-TN9597, Xcel
27 2022-TN9595, Xcel 2023-TN9596). The NRC staff compared the data against NRC dose limits
28 and looked for indications of adverse trends (i.e., increasing dose levels) over the period.

29 As a representative year, the following summarizes the calculated doses from radioactive
30 gaseous effluents released from Monticello during 2022 (Xcel 2023-TN9596):

- 31 • The air dose due to noble gases with resulting gamma radiation in gaseous effluents was
32 3.84×10^{-3} millirad (mrad) (3.84×10^{-5} milligray), which is well below the 10 mrad/yr
33 (0.1 milligray/yr) dose criterion in Appendix I to 10 CFR Part 50 (TN249).
- 34 • The air dose from beta radiation in gaseous effluents was 2.24×10^{-3} mrad (2.24×10^{-5}
35 milligray), which is well below the 20 mrad/yr (0.2 milligray/yr) dose criterion in Appendix I to
36 10 CFR Part 50 (TN249).
- 37 • The critical organ dose to an offsite member of the public from radiation in gaseous effluents
38 as a result of radioisotopes of iodine, particulates, tritium gases and carbon-14 was
39 4.77×10^{-2} mrem (4.77×10^{-4} mSv), which is below the 15 mrem/yr (0.15 mSv/yr) dose
40 criterion in Appendix I to 10 CFR Part 50 (TN249).

41 As discussed during the audit, Monticello has constructed a groundwater remediation storage
42 pond (also referred to as a holding pond or retention pond) to store the tritiated groundwater that
43 is being collected in response to the tritium leak. The water will either be reused in plant

1 systems or be evaporated from the pond. If pond evaporation is implemented, it will be the third
2 gaseous point for tritium at the plant. As discussed during the audit (Xcel 2023-TN9578):

- 3 1. tritium releases to the air from the current storage tanks associated with groundwater
4 remediation are being controlled with the use of covers
- 5 2. a cover is planned to be placed on the groundwater remediation pond once it is filled
- 6 3. if evaporation from the groundwater remediation pond is implemented, the necessary
7 updates to the Technical Specifications and ODCM will be made to appropriately measure
8 the effluent pathway

9 The NRC staff's review of the Monticello radioactive gaseous effluent control program showed
10 radiation doses to members of the public that were well below NRC and EPA radiation
11 protection standards contained in Appendix I to 10 CFR Part 50 (TN249), 10 CFR Part 20
12 (TN283), and 40 CFR Part 190 (TN739). The NRC staff observed no adverse trends in the dose
13 levels over the five years reviewed.

14 During the SLR term, Xcel Energy will continue to perform routine nuclear power plant refueling
15 and maintenance activities. Based on Xcel Energy's past performance in operating a radioactive
16 waste system at Monticello that maintains ALARA doses from radioactive gaseous effluents, the
17 NRC staff expects that Monticello will maintain similar performance during the SLR term.

18 3.13.1.3 *Radioactive Solid Waste Management*

19 Monticello's solid waste disposal system provides for packaging and/or solidification of
20 radioactive waste that will subsequently be shipped offsite to an approved burial facility. These
21 activities reduce the amount of waste shipped for offsite disposal. Solid radioactive wastes are
22 logged, processed, packaged, and stored for subsequent shipment and offsite burial. Solid
23 radioactive wastes and potentially radioactive wastes include reactor components, equipment
24 and tools removed from service, chemical laboratory samples, spent resins, used filter
25 cartridges, and radioactively contaminated hardware, as well as compacted wastes such as
26 contaminated protective clothing, paper, rags, and other trash generated from nuclear power
27 plant design modifications and operations, and routine maintenance activities. In addition,
28 nonfuel solid wastes result from treating and separating radionuclides from gases and liquids,
29 and from removing containment material from various reactor areas.

30 3.13.1.4 *Radioactive Waste Storage*

31 At Monticello, low-level radioactive waste (LLRW) is stored temporarily onsite at a low-level
32 waste storage facility before being shipped offsite for processing or disposal at licensed LLRW
33 treatment and disposal facilities. In 2020, Monticello shipped LLRW to the Energy Solutions
34 facility in Clive, Utah; the Erwin Resin Solutions facility in Erwin, Tennessee; and the UniTech
35 Services facility in Oakridge, Tennessee. LLRW is classified as Class A, Class B, or Class C
36 (minor volumes are classified as greater than Class C). Class A includes both dry active waste
37 and processed waste (e.g., dewatered resins). Classes B and C normally include a low
38 percentage of the LLRW generated. Radioactive waste that is greater than Class C waste is the
39 responsibility of the Federal government. Low-level mixed waste is managed through Xcel
40 Energy's chemistry procedure. Xcel Energy uses a contractor to characterize, label, and
41 manifest the waste, and transport it to a facility that can encapsulate, treat, or otherwise prepare
42 the waste for disposal. As indicated in Xcel Energy's ER and discussed with NRC staff during
43 the virtual audit, Monticello has sufficient existing capability to store all generated LLRW onsite.

1 No additional construction of onsite storage facilities is necessary for LLRW storage during the
2 subsequent period of extended operation (Xcel 2023-TN9084; Xcel 2023-TN9578).

3 Monticello stores spent fuel in a spent fuel pool and in an onsite ISFSI. The ISFSI safely stores
4 spent fuel onsite in licensed and approved dry cask storage containers. Spent fuel is stored in
5 the ISFSI under the general license. Section 4.11.2.2 of the Xcel Energy ER states that there
6 are 30 dry containers currently on the ISFSI pad. In order to store all the fuel that the site will
7 have by 2030, Monticello would need 40 total dry containers, so an additional 10 containers
8 would be needed by 2030 (Xcel 2023-TN9084). As discussed during the audit, the existing
9 ISFSI security perimeter can accommodate another 36 dry containers potentially, but on a
10 second support pad (to be built) without having to change the security perimeter (Xcel 2023-
11 TN9578).

12 The ISFSI facility requires a State of Minnesota Certificate of Need. The placement of the
13 30 canisters was allowed by a Certificate of Need issued in 2006 that expires in 2030. The ER
14 states that Xcel Energy applied for an additional Certificate of Need to allow Xcel Energy to
15 place ~14 more canisters from 2030–2040 on a new storage pad within the security perimeter
16 footprint. Following the audit, the Minnesota Public Utilities Commission approved the request to
17 place ~14 additional canisters. Beyond 2040, Xcel Energy would need to seek additional
18 Certificates of Need to place additional canisters on the second storage pad. As discussed
19 during the audit, the licensee confirmed that the estimated timeframe for construction of the
20 second pad in the Monticello ISFSI would be approximately 2026–2027 to support a 2028 dry
21 storage loading campaign for the up to 15 additional canisters. The licensee also confirmed that
22 the expanded ISFSI capacity along with the spent fuel pool is anticipated to be capable of
23 storing all the spent nuclear fuel generated during the SLR term (Xcel 2023-TN9578). If the
24 ISFSI pad needs to be expanded further, previously disturbed land near the ISFSI is likely to be
25 sufficient for the expansion with no significant environmental impact.

26 The NRC staff notes that the impacts of onsite storage of spent nuclear fuel during the period of
27 extended operation have been determined to be SMALL, as stated in 10 CFR Part 51-TN250,
28 Appendix B, Table B-1; see also NUREG-2157, Generic Environmental Impact Statement for
29 Continued Storage of Spent Nuclear Fuel (NRC 2014-TN4117).

30 3.13.1.5 *Radiological Environmental Monitoring Program*

31 Xcel Energy maintains a REMP to assess the radiological impact, if any, to the public and the
32 environment from Monticello operations. The REMP measures the aquatic, terrestrial, and
33 atmospheric environment for ambient radiation and radioactivity. Monitoring is conducted for the
34 following: direct radiation, air, precipitation, well water, river water, surface water, milk, food
35 products and vegetation (such as edible broad leaf vegetation), fish, silt, and shoreline
36 sediment. The REMP also measures background radiation (i.e., cosmic sources, global fallout,
37 and naturally occurring radioactive material, including radon). As part of the REMP program,
38 Xcel Energy conducts analyses of selected wells for the presence of gamma emitters, tritium in
39 groundwater on a quarterly basis (Xcel 2023-TN9084).

40 The NRC staff reviewed five years of annual radiological environmental monitoring data from
41 2018 through 2022 (Xcel 2019-TN9621, Xcel 2020-TN9612, Xcel 2021-TN9613, Xcel 2022-
42 TN9614, Xcel 2023-TN9615). A five-year period provides a dataset that covers a broad range of
43 activities that occur at a nuclear power plant, such as refueling outages, routine operation, and
44 maintenance that can affect the generation and release of radioactive effluents into the

1 environment. The NRC staff looked for indications of adverse trends (i.e., increasing
2 radioactivity levels) over the period of 2018 through 2022.

3 In addition to the REMP, Xcel Energy established an onsite groundwater protection initiative
4 program in 2008 in accordance with Nuclear Energy Institute (NEI) 0707, "Industry Groundwater
5 Protection Initiative" (NEI 2007-TN1913). This program monitors the onsite nuclear power plant
6 environment to detect leaks from nuclear power plant systems and pipes containing radioactive
7 liquid. Section 3.5.2.3, "Groundwater Quality," of this site-specific EIS contains information on
8 Monticello's groundwater protection initiative program. As of the date of ER publication,
9 Monticello was monitoring 19 wells and one stormwater drain location for potential radioactive
10 releases to groundwater, environmental conditions, and groundwater elevation in accordance
11 with Monticello procedures.

12 In response to the tritium leak in 2022, and as discussed in Section 3.5.2.3 of this site-specific
13 EIS, the groundwater monitoring program was expanded and Xcel Energy increased
14 groundwater sampling and the number of wells. Section 3.5.2.3 of this site-specific EIS also
15 contains a more complete description of the groundwater protection program and a historical
16 description of tritium and other radionuclide monitoring in groundwater at the site. As
17 documented in the Monticello Nuclear Generating Plant - Integrated Inspection Report
18 05000263/2023001 dated August 7, 2023 (NRC 2023-TN9601), NRC inspectors determined
19 that "the criteria, methodology, and requirements for reporting leaks and spills that contain
20 licensed radioactive materials were consistent with the industry initiative and were performed in
21 accordance with NRC requirements."

22 Based on its review of the REMP and inadvertent release data, the NRC staff finds no apparent
23 increasing trend in concentration or pattern indicating persistently high tritium or other
24 radionuclide concentration that might indicate an ongoing inadvertent release from Monticello.
25 The groundwater monitoring program data at Monticello show that Xcel Energy monitors,
26 characterizes, and actively remediates spills, and that there were no significant radiological
27 impacts to the offsite environment from operations at Monticello.

28 **3.13.2 Nonradioactive Waste**

29 Monticello generates nonradioactive waste as a result of nuclear power plant maintenance,
30 cleaning, and operational processes. Monticello manages nonradioactive wastes in accordance
31 with applicable Federal and State regulations, as implemented through its corporate
32 procedures. Monticello generates and manages hazardous wastes, nonhazardous wastes, and
33 universal wastes. Xcel Energy maintains a list of waste vendors that it has approved for use
34 across the entire company to remove and dispose of the nonradioactive wastes offsite (Xcel
35 2023-TN9084).

36 Waste minimization and pollution prevention are important elements of operations at all nuclear
37 power plants. Licensees are required to consider pollution prevention measures as dictated by
38 the Pollution Prevention Act (Public Law 101 5084 TN6607) and the Resource Conservation and
39 Recovery Act of 1976, as amended (Public Law 94 580 TN1281).

40 The RCRA governs the disposal of solid waste. The MPCA is authorized by the EPA to
41 implement the RCRA and regulate solid and hazardous waste in Minnesota (Xcel 2023-
42 TN9084). Monticello has a nonradioactive waste management program to handle
43 nonradioactive waste in accordance with Federal, State, and corporate regulations and

1 procedures. Monticello maintains a waste minimization program that uses material control,
2 process control, waste management, recycling, and feedback to reduce waste.

3 The Monticello SWPPP identifies potential sources of pollution that may affect the quality of
4 stormwater discharges from permitted outfalls. The SWPPP also describes BMPs for reducing
5 pollutants in stormwater discharges and assuring compliance with the site's NPDES permit
6 (Xcel 2023-TN9084).

7 Monticello also has an environmental management system (Xcel 2023-TN9084). Procedures
8 are in place to monitor areas within the site that have the potential to discharge oil into or on
9 navigable waters, in accordance with the regulations in 40 CFR Part 112, "Oil Pollution
10 Prevention" (TN1041). The Pollution Incident/Hazardous Substance Spill Procedure identifies
11 and describes the procedures, materials, equipment, and facilities that Xcel Energy uses to
12 minimize the frequency and severity of oil spills at Monticello.

13 Monticello is subject to the EPA reporting requirements in 40 CFR Part 110, "Discharge of Oil,"
14 under CWA Section 311(b)(4) (TN8485). Under these regulations, Monticello must report to the
15 U.S. Coast Guard (USCG) National Response Center any discharges of oil if the quantity may
16 be harmful to the public health or welfare or to the environment. Based on the NRC staff's
17 review of Section 9.5.3.6 of the Xcel Energy ER (Xcel 2023-TN9084) and a review of records
18 from 2016–2021, there have been no releases at Monticello that have triggered this notification
19 requirement (Xcel 2023-TN9084).

20 Monticello is also subject to the reporting provisions of the (Minnesota Statutes
21 Section 115.061(b) -TN9622) for reporting the release of a regulated substance from an
22 underground storage tank (UST) containing a petroleum product or hazardous substance.
23 Based on the NRC staff's review of Section 9.5.13.6 of the Xcel Energy ER (Xcel 2023-TN9084)
24 and a review of records from 2018–2022, no reportable spills under the reporting provisions of
25 the (Minnesota Statutes Section 115.061(b) -TN9622) occurred to date. In addition, the
26 applicant confirmed that there have been no reportable spills that would trigger this notification
27 requirement since the ER was written (Xcel 2023-TN9084).

28 **3.13.3 Proposed Action**

29 The following sections address the site-specific environmental impacts of Monticello SLR on the
30 environmental issues identified in Table 3-1 of this site-specific EIS that relate to waste
31 management.

32 *3.13.3.1 Low-Level Waste Storage and Disposal*

33 At Monticello, low-level radioactive waste is stored temporarily onsite before being shipped
34 offsite for treatment or disposal facilities (Xcel 2023-TN9084). Annual quantities of low-level
35 radioactive waste generated at Monticello vary from year to year depending on the number of
36 maintenance activities undertaken. Due to the comprehensive regulatory controls in place for
37 the management of radioactive waste, Xcel Energy's compliance with these regulations, and
38 Xcel Energy's use of licensed treatment and disposal facilities, the impacts of radioactive waste
39 are expected to be SMALL during the SLR term. Also, there are no other operating nuclear
40 power plants, fuel-cycle facilities, or radiological waste treatment and disposal facilities with a
41 50 mi (80 km) radius of Monticello. Therefore, the NRC staff concludes that the environmental
42 impacts from low-level waste storage and disposal due to continued nuclear power plant
43 operations at Monticello during the SLR term would be SMALL.

1 3.13.3.2 *Onsite Storage of Spent Nuclear Fuel*

2 As discussed in Section 2.1.6.2 of this EIS, Monticello’s spent fuel is stored in a spent fuel pool
3 and in an onsite ISFSI. The Monticello ISFSI is licensed under the general license provided to
4 nuclear power plant licensees under 10 CFR 72.210, “General license issued,” (TN4884). The
5 NRC’s regulation and its oversight of onsite spent fuel storage ensure that the increased volume
6 in onsite storage from operation during the SLR term can be safely accommodated with little
7 environmental effect. The ISFSI safely stores spent fuel onsite in licensed and approved dry
8 cask storage containers.

9 This issue was also considered for the NRC staff’s environmental review of Monticello’s initial
10 license renewal, and no new and significant information was found at that time (NRC 2006-
11 TN7315). The NRC staff identified no information or situations that would result in different
12 impacts for this issue for the SLR term at Monticello. Therefore, the NRC staff concludes that
13 the environmental impacts from onsite storage of spent nuclear fuel due to continued nuclear
14 power plant operations at Monticello during the SLR term would be SMALL.

15 3.13.3.3 *Offsite Radiological Impacts of Spent Nuclear Fuel and High-Level Waste Disposal*

16 As related to the issue of offsite radiological impacts of spent nuclear fuel and high-level waste
17 disposal, a history of the NRC’s Waste Confidence activities is provided in NUREG-2157,
18 “Generic Environmental Impact Statement for Continued Storage of Spent Nuclear Fuel (NRC
19 2014-TN4117), Section 1.1, History of Waste Confidence. The management and ultimate
20 disposition of spent nuclear fuel is limited to the findings codified in the September 19, 2014,
21 Continued Storage of Spent Nuclear Fuel, Final Rule (79 FR 56238-TN4104) and associated
22 NUREG-2157 (NRC 2014-TN4117). The ultimate disposal of spent nuclear fuel in a potential
23 future geologic repository is a separate and independent licensing action that is outside the
24 regulatory scope of this site-specific review. Per 10 CFR Part 51 (TN250) Subpart A, the
25 Commission concludes that the impacts presented in NUREG-2157 (NRC 2014-TN4117) would
26 not be sufficiently large to require the conclusion, for any nuclear power plant, that the option of
27 extended operation under 10 CFR Part 54 (TN4878) should be eliminated. Accordingly, while
28 the Commission has not assigned a single level of significance for the offsite radiological
29 impacts of spent nuclear fuel and high-level waste disposal, this issue is considered generic to
30 all nuclear power plants pursuant to 10 CFR 51.23 (TN250) and does not warrant a site-specific
31 analysis for continued nuclear power plant operations at Monticello during the SLR term.

32 3.13.3.4 *Mixed-Waste Storage and Disposal*

33 Mixed waste, regulated under RCRA (TN1281) and the AEA of 1954, as amended (42 U.S.C. §
34 2011 et seq.-TN663), is waste that is both radioactive and hazardous. Mixed waste is subject to
35 dual regulation: by the EPA or an authorized State for its hazardous component and by the NRC
36 or an Agreement State for its radioactive component. Similar to hazardous waste, mixed waste
37 is generally accumulated onsite in designated areas as authorized under RCRA then shipped
38 offsite for treatment as appropriate and for disposal. Occupational exposures and any releases
39 from onsite treatment of these and any other types of wastes are considered when evaluating
40 compliance with the applicable Federal standards and regulations: for example, 10 CFR Part 20
41 (TN283), 40 CFR Part 190 (TN739), and 10 CFR Part 50, Appendix I (TN249). Due to the
42 comprehensive regulatory controls in place for the management of mixed waste, Xcel Energy’s
43 compliance with these regulations, and Xcel Energy’s use of licensed treatment and disposal
44 facilities, the impacts of mixed waste are expected to be SMALL during the SLR term. The NRC
45 staff identified no information or situations that would result in different impacts for this issue

1 during the SLR term at Monticello. Therefore, the NRC staff concludes that, the radiological and
2 nonradiological environmental impacts from the mixed waste storage and disposal due to
3 continued nuclear plant operations at Monticello during the SLR term would be SMALL.

4 *3.13.3.5 Nonradioactive Waste Storage and Disposal*

5 Like any other industrial facility, nuclear power plants generate wastes that are not
6 contaminated with either radionuclides or hazardous chemicals. Monticello has a nonradioactive
7 waste management system to handle its nonradioactive hazardous and nonhazardous wastes.
8 The waste is managed in accordance with Xcel Energy's procedures. Waste minimization and
9 pollution prevention are important elements of operations at all nuclear power plants. Licensees
10 are required to consider pollution prevention measures as dictated by the Pollution Prevention
11 Act (Public Law 101-508; TN6607) and RCRA (Public Law 94-580; TN1281).

12 In addition, as discussed in Section 3.13.2 of this EIS, Monticello has a nonradioactive waste
13 management program to handle nonradioactive waste in accordance with Federal, State, and
14 corporate regulations and procedures. Monticello will continue to store and dispose of
15 nonradioactive hazardous and nonhazardous waste in accordance with EPA, State, and local
16 regulations in permitted disposal facilities. With respect to unplanned, nonradiological releases,
17 as described in Section 3.6.4.2.2 of the ER (Xcel 2023-TN9084), Xcel Energy reported two
18 inadvertent nonradioactive releases between 2016–2022. The NRC staff incorporates the
19 information in Section 3.6.4.2.2, "History of Nonradioactive Releases," of the ER (Xcel 2023-
20 TN9084) herein by reference. No other accidental spills or releases of nonradioactive
21 substances, including petroleum products, occurred at Monticello over the past 5 years, or were
22 any associated notices of violation issued to Xcel Energy for such releases (Xcel 2023-TN9084;
23 Xcel 2023-TN9578). The NRC staff's review of available information and regulatory databases
24 found no documented instances of accidental spills of chemical or petroleum products to
25 groundwater due to Monticello operations that resulted in a regulatory action over the last
26 5 years.

27 Due to the comprehensive regulatory controls in place for the management of nonradioactive
28 waste and Xcel Energy's compliance with these regulations, the impacts of nonradioactive
29 waste are expected to be SMALL during the SLR term. The NRC staff identified no information
30 or situations that would result in different impacts for this issue for the SLR term at Monticello.
31 Therefore, the NRC staff concludes that the environmental impacts from nonradioactive waste
32 storage and disposal due to continued nuclear plant operations at Monticello during the SLR
33 term would be SMALL.

34 **3.13.4 No-Action Alternative**

35 Under the no-action alternative, Monticello would cease operation at the end of the term of the
36 current renewed facility operating license or sooner and enter decommissioning. After entering
37 decommissioning, the nuclear power plant would generate less spent nuclear fuel, emit less
38 gaseous and liquid radioactive effluents into the environment, and generate less low-level
39 radioactive and nonradioactive wastes. In addition, following shutdown, the variety of potential
40 accidents at the nuclear power plant (radiological and industrial) would be reduced to a limited
41 set associated with shutdown events and fuel handling and storage. Therefore, as radioactive
42 emissions to the environment decrease, and the likelihood and variety of accidents decrease
43 following shutdown and decommissioning, the NRC staff concludes that impacts resulting from
44 waste management from implementation of the no-action alternative would be SMALL.

1 **3.13.5 Replacement Power Alternatives: Common Impacts**

2 Impacts from waste management common to all analyzed replacement power alternatives
3 would be from construction-related nonradiological debris generated during construction
4 activities. This waste would be recycled or disposed of in approved landfills.

5 **3.13.6 Natural Gas and Renewables Alternative**

6 Impacts from the waste generated during the construction of the natural gas combined-cycle
7 and renewable energy alternative would include those identified in Section 3.13.5 of this
8 site-specific EIS as common to all replacement power alternatives.

9 Waste generation from operation of the natural gas technology would be minimal. The only
10 significant waste generated at a natural gas combined-cycle power plant would be spent
11 selective catalytic reduction catalyst (plants use selective catalytic reduction catalyst to control
12 nitrogen oxide emissions). This spent catalyst is considered hazardous and would be disposed
13 of at a facility that handles hazardous materials. Other than the spent selective catalytic
14 reduction catalyst, waste generation at an operating natural gas fired plant would be limited
15 largely to typical operations and maintenance of nonhazardous waste. Based on this
16 information, the NRC staff concludes that the waste impacts for the natural gas combined-cycle
17 alternative would be SMALL.

18 The construction of the solar PV facilities would create sanitary and industrial waste. This waste
19 could be recycled or shipped to an offsite waste disposal facility. All the waste would be handled
20 in accordance with appropriate MPCA regulations. Impacts on waste management resulting
21 from the construction and operation of the solar PV facilities of the combination alternative
22 would be minimal. In summary, the NRC staff concludes that the waste management impacts
23 resulting from the construction and operation of the PV facilities would be SMALL.

24 Construction of onshore wind turbine facilities would create sanitary, construction, and industrial
25 waste. This waste would be recycled, disposed of onsite, or shipped to an offsite waste disposal
26 facility. The operation of each wind installation is expected to generate minimal waste from daily
27 operations. The nonhazardous and hazardous waste would be managed in compliance with
28 State regulations and disposed of in permitted facilities. Therefore, the NRC staff concludes that
29 the waste management impacts of the renewable energy alternatives would be SMALL.

30 Based on the above, the NRC staff concludes that the waste impacts for the natural gas and
31 renewables alternative would be SMALL.

32 **3.13.7 Renewables and Storage Alternative**

33 Impacts from the waste generated during the construction of the renewable energy and storage
34 alternative would include those identified in Section 3.13.5 of this site-specific EIS as common to
35 all replacement power alternatives. Impacts from the waste generated during the construction of
36 the renewable energy systems (solar PV and wind turbines) and would include those identified
37 in Section 3.13.6 of this site-specific EIS. The battery storage system at each solar installation
38 would have to be replaced after several years of operation; however, much of the components
39 are recyclable, minimizing the waste generation. Based on the above, the NRC staff concludes
40 that the waste impacts for the renewables and storage alternative would be SMALL.

1 **3.13.8 New Nuclear (Small Modular Reactor) Alternative**

2 Impacts from the waste generated during the construction of the new nuclear alternative would
3 include those identified in Section 3.13.5 above, as common to all replacement power
4 alternatives. During normal nuclear power plant operations, routine nuclear power plant
5 maintenance and cleaning activities would generate radioactive low-level waste, spent nuclear
6 fuel, high-level waste, and nonradioactive waste. Sections 3.13.1 and 3.13.2 of this site-specific
7 EIS discuss radioactive and nonradioactive waste management at Monticello. Advanced light-
8 water reactors would use the same type of fuel (i.e., form of the fuel, enrichment, burnup, and
9 fuel cladding) as those nuclear power plants considered in the NRC staff's evaluation in the
10 LR GEIS (NRC 2013-TN2654). As such, all wastes generated would be similar to those
11 generated at Monticello. According to the LR GEIS, the NRC does not expect the generation
12 and management of solid radioactive and nonradioactive waste during the SLR term to result in
13 significant environmental impacts. Based on this information, the NRC staff concludes that the
14 impacts on waste from the operation of the new nuclear alternative would be SMALL.

15 **3.14 Impacts Common to All Alternatives**

16 This section describes the impacts that the NRC staff considers common to all alternatives
17 discussed in this EIS, including the proposed action and replacement power alternatives. In
18 addition, the following sections discuss the termination of operations, the decommissioning of a
19 power plant and potential replacement power facilities, and GHG emissions.

20 **3.14.1 Fuel Cycle**

21 This section describes the environmental impacts associated with the fuel cycles of both the
22 proposed action and all replacement power alternatives that are analyzed in detail in this EIS.

23 *3.14.1.1 Uranium Fuel Cycle*

24 The following sections address the site-specific environmental impacts of Monticello SLR on the
25 environmental issues identified in Table 3-1 that relate to the uranium fuel cycle.

26 Offsite Radiological Impacts - Individual Impacts from Other Than the Disposal of Spent Fuel
27 and High-Level Waste

28 The primary indicators of offsite radiological impacts on individuals who live near uranium fuel
29 cycle facilities are the concentrations of radionuclides in the effluents from the fuel cycle
30 facilities and the radiological doses received by a maximally exposed individual on the site
31 boundary or at some location away from the site boundary. The basis for establishing the
32 significance of individual effects is the comparison of the releases in the effluents and the
33 maximally exposed individual doses with the permissible levels in applicable regulations. The
34 analyses performed by the NRC in the preparation of Table S-3 in 10 CFR 51.51 (TN250)
35 indicate that if the facilities operate under a valid license issued by either the NRC or an
36 Agreement State, the individual effects will meet the applicable regulations. Based on these
37 considerations, the NRC has concluded that the impacts on individuals from radioactive
38 gaseous and liquid releases during the SLR term would remain at or below the NRC's
39 regulatory limits. Efforts needed to keep releases and doses ALARA will continue to apply to
40 fuel-cycle-related activities. The NRC staff identified no information or situations that would
41 result in different impacts for this issue for the SLR term at Monticello. Therefore, the NRC staff
42 concludes that the offsite radiological impacts of the uranium fuel cycle (individual effects from

1 sources other than the disposal of spent fuel and high-level waste) due to continued nuclear
2 plant operations at Monticello during the SLR term would be SMALL.

3 Offsite Radiological Impacts - Collective Impacts from Other Than the Disposal of Spent Fuel
4 and High-Level Waste

5 The focus of this issue is the collective radiological doses to and health impacts on the public
6 resulting from uranium fuel cycle facilities over the SLR term. The radiological doses received
7 by the public are calculated based on the releases from the uranium fuel cycle facilities to the
8 environment, as provided in Table S-3 (TN250). These estimates were provided in the 1996
9 LR GEIS for the gaseous and liquid releases listed in Table S-3 as well as for radon-222 and
10 technetium-99 releases, which are not listed in Table S-3. The population dose commitments
11 were normalized for each year of operation of the model nuclear power plant (per reference
12 reactor year).

13 Based on the analyses provided in the 2013 LR GEIS (NRC 2013-TN2654), the estimated
14 involuntary 100-year dose commitment to the U.S. population resulting from the radioactive
15 gaseous releases from uranium fuel cycle facilities (excluding the nuclear power plants and
16 releases of radon-222 and technetium-99) was estimated to be 400 person-rem (4 person-Sv)
17 per reference reactor year. Similarly, the environmental dose commitment to the U.S. population
18 from the liquid releases was estimated to be 200 person-rem (2 person-Sv) per reference
19 reactor year. As a result, the total estimated involuntary 100-year dose commitment to the U.S.
20 population from radioactive gaseous and liquid releases listed in Table S-3 was given as 600
21 person-rem (6 person-Sv) per reference reactor year (see Section 6.2.2 of the 1996 LR GEIS;
22 NRC 1996-TN288).

23 The doses received by most members of the public would be so small that they would be
24 indistinguishable from the variations in natural background radiation. There are no regulatory
25 limits applicable to collective doses to the public from fuel cycle facilities. All regulatory limits are
26 based on individual doses. All fuel cycle facilities are designed and operated to meet the
27 applicable regulatory limits.

28 Based on its consideration of the available information, the Commission concluded that these
29 impacts are acceptable in that they would not be sufficiently large to require the NEPA
30 conclusion, for any nuclear power plant, that the option of extended operation under 10 CFR
31 Part 54 (TN4878) should be eliminated. Accordingly, the Commission has not assigned a single
32 level of significance for the collective effects of the fuel cycle. The NRC staff identified no
33 information or situations that would result in different impacts for this issue for the SLR term.
34 Therefore, the NRC staff concludes that the offsite radiological impacts of the uranium fuel cycle
35 (collective impacts from sources other than the disposal of spent nuclear fuel and high-level
36 waste) due to continued nuclear power plant operations at Monticello during the SLR term
37 would not be sufficiently large to require the NEPA conclusion that the option of Monticello SLR
38 should be eliminated.

39 Nonradiological Impacts of the Uranium Fuel Cycle

40 The nonradiological impacts associated with the uranium fuel cycle as they relate to LR are
41 provided in Table S-3 (TN250). The significance of the environmental impacts associated with
42 land use, water use, fossil fuel use, and chemical effluents was evaluated in the LR GEIS (NRC
43 2013-TN2654) based on several relative comparisons. The land requirements were compared
44 to those for a coal-fired power plant that could be built to replace the nuclear capacity if the

1 operating license is not renewed. The water requirements for the uranium fuel cycle were
2 compared to the annual requirements for a nuclear power plant. The amount of fossil fuels (coal
3 and natural gas) consumed to produce electrical energy and process heat during the various
4 phases of the uranium fuel cycle was compared to the amount of fossil fuel that would have
5 been used if the electrical output from the nuclear power plant was supplied by a coal-fired
6 plant. Similarly, the gaseous effluents SO₂, nitric oxide (NO), hydrocarbons, carbon monoxide
7 (CO), and other PM released because of the coal-fired electrical energy used in the uranium
8 fuel cycle were compared with the equivalent quantities of the same effluents that would be
9 released from a 45 MWe coal-fired plant. It was noted that the impacts associated with the uses
10 of all resources would be SMALL. Any impacts associated with nonradiological liquid releases
11 from the fuel cycle facilities would also be SMALL. The NRC staff identified no information or
12 situations that would result in different impacts for this issue for the SLR term at Monticello.
13 Therefore, the NRC staff concludes that the aggregate nonradiological impacts of the uranium
14 fuel cycle due to continued nuclear power plant operations at Monticello during the SLR term
15 would be SMALL.

16 Transportation

17 The environmental impacts associated with the transportation of fuel and waste to and from one
18 model nuclear power plant as they relate to LR are addressed in Table S-4 (10 CFR Part 51-
19 TN250). Table S-4 forms the basis for analysis of the environmental impacts of the
20 transportation of fuel and waste when evaluating applications for nuclear power plant LR. The
21 applicability of Table S-4 to LR applications was extensively evaluated in the 1996 LR GEIS
22 (NRC 1996-TN288) and its Addendum 1 (NRC 1999-TN289). The environmental impacts from
23 the transportation of fuel and waste attributable to LR were found to be SMALL when they are
24 within the parameters identified in 10 CFR 51.52 (TN250). The NRC staff identified no
25 information or situations that would result in different impacts for this issue for the SLR term at
26 Monticello and determined that Monticello is within the parameters identified in 10 CFR 51.52
27 (TN250). Therefore, the NRC staff concludes that the transportation impacts of the uranium fuel
28 cycle due to continued nuclear power plant operations at Monticello during the SLR term would
29 be SMALL.

30 *3.14.1.2 Replacement Nuclear Power Plant Fuel Cycles*

31 New Nuclear Energy Alternatives

32 The uranium fuel cycle impacts for a nuclear power plant result from the initial extraction of fuel,
33 the transport of fuel to the facility, and the management and ultimate disposal of spent fuel. The
34 environmental impacts of the uranium fuel cycle are referenced in Section 3.14.1.1 of this EIS.

35 Fossil Fuel Energy Alternatives

36 The fuel cycle impacts for a fossil-fuel-fired power plant result from the initial extraction of fuel,
37 the cleaning and processing of fuel, the transport of fuel to the facility, and the management and
38 ultimate disposal of any solid wastes from fuel combustion. These impacts are discussed in
39 more detail in Section 4.12.1.2 of the 2013 LR GEIS (NRC 2013-TN2654) and can generally
40 include the following:

- 41 • significant changes to land use and visual resources
- 42 • impacts on air quality, including the release of criteria pollutants, fugitive dust, volatile
43 organic compounds, and methane into the atmosphere

- 1 • noise impacts
- 2 • geology and soil impacts caused by land disturbances and mining
- 3 • water resource impacts, including the degradation of surface water and groundwater quality
- 4 • ecological impacts, including the loss of habitat and wildlife disturbances
- 5 • impacts on historic and cultural resources within the mine or pipeline footprint
- 6 • socioeconomic impacts from employment of both the mining workforce and service and
- 7 support industries
- 8 • environmental justice impacts
- 9 • health impacts on workers from exposure to airborne dust and methane gases
- 10 • generation of industrial wastes

11 Renewable Energy Alternatives

12 For renewable energy technologies that rely on the extraction of a fuel source (e.g., biomass),
13 such alternatives may have fuel cycle impacts with some similarities to those associated with
14 the uranium fuel cycle. Renewable energy technologies such as wind, solar, geothermal, and
15 wave and ocean energy do not have a fuel cycle comparable to the uranium fuel cycle. This is
16 because the natural resource exists (i.e., they are not consumed or irreversibly committed)
17 regardless of any effort to use them for electricity production. The fuel cycle impacts for these
18 renewable energy technologies cannot be determined.

19 **3.14.2 Terminating Nuclear Power Plant Operations and Decommissioning**

20 This section addresses the environmental impacts of Monticello SLR associated with the
21 termination of operations and the decommissioning of a nuclear power plant and replacement
22 power alternatives. All operating nuclear power plants will terminate operations and be
23 decommissioned at some point after the end of their operating life or after a decision is made to
24 cease operations. For the proposed action at Monticello, SLR could delay this eventuality for an
25 additional 20 years beyond the current license period, to end in 2050.

26 *3.14.2.1 Existing Nuclear Power Plant*

27 The decommissioning process begins when a licensee informs the NRC that it has permanently
28 ceased reactor operations, defueled, and intends to decommission the nuclear plant. The
29 licensee may also notify the NRC of the permanent cessation of reactor operations prior to the
30 end of the license term. Consequently, most nuclear plant activities and systems dedicated to
31 reactor operations would cease after reactor shutdown. The environmental impacts of
32 decommissioning a nuclear power plant are evaluated NUREG-0586, "Generic Environmental
33 Impact Statement on Decommissioning of Nuclear Facilities: Supplement 1, Regarding the
34 Decommissioning of Nuclear Power Reactors" (NRC 2002-TN665). Additionally,
35 Section 4.12.2.1 of the 2013 LR GEIS (NRC 2013-TN2654) summarizes the incremental
36 environmental impacts associated with nuclear power plant decommissioning activities. As
37 noted in Table 3-1, there is one Category 1 issue, "Termination of Nuclear Power Plant
38 Operations and Decommissioning," applicable to Monticello decommissioning following the SLR
39 term. The LR GEIS did not identify any site-specific (Category 2) decommissioning issues.

1 Termination of Nuclear Power Plant Operations and Decommissioning

2 The NRC staff determined that SLR would have a negligible effect on the impacts of terminating
3 operations and decommissioning on all resources. The NRC staff identified no information or
4 situations that would result in different environmental impacts for this issue for the SLR term at
5 Monticello. Therefore, the NRC staff concludes that the incremental environmental impacts of
6 the termination of plant operations and decommissioning due to continued nuclear power plant
7 operations at Monticello during the SLR term would be SMALL.

8 *3.14.2.2 Replacement Power Plants*

9 New Nuclear and Fossil Fuel Alternatives

10 The environmental impacts from the termination of power plant operations and the
11 decommissioning of a power generating facility are dependent on the facility's decommissioning
12 plan. Decommissioning plans generally outline the actions needed to restore the site to a
13 condition equivalent in character and value to the site on which the facility was first constructed.
14 General elements and requirements for a thermoelectric power plant decommissioning plan can
15 include the removal of structures below grade, the removal of all accumulated waste materials,
16 the removal of intake and discharge structures, and the cleanup and remediation of incidental
17 spills and leaks at the facility.

18 The environmental consequences of decommissioning can generally include the following:

- 19 • short-term impacts on air quality and noise from the deconstruction of facility structures
- 20 • short-term impacts on land use and visual resources
- 21 • long-term reestablishment of vegetation and wildlife communities
- 22 • socioeconomic impacts caused by decommissioning the workforce and the long-term loss of
23 jobs
- 24 • elimination of health and safety impacts on operating personnel and the general public

25 These impacts are representative of those associated with decommissioning any thermoelectric
26 power generating facility.

27 Activities that are unique to the termination of operations and the decommissioning of a nuclear
28 power generating facility include the safe removal of the facility from service, the reduction of
29 residual radioactivity to a level that permits the release of the property under restricted
30 conditions or unrestricted use, and the termination of the license.

31 Renewable Energy Alternatives

32 The termination of power plant operation and decommissioning for renewable energy facilities
33 would generally be similar to the activities and impacts discussed above for the new nuclear and
34 fossil fuel alternatives. Decommissioning would involve the removal of facility components and
35 any operational wastes and residues, if present, to restore sites to a condition equivalent in
36 character and value to the site on which the facility was first constructed. In other
37 circumstances, supporting infrastructure (e.g., buried utilities and pipelines) could be abandoned
38 in place (NRC 2013-TN2654). The range of possible decommissioning considerations and
39 impacts, depending on the renewable energy alternative considered, is discussed in
40 Section 4.12.2.2 of the LR GEIS (see subsection, "Renewable Alternatives") (NRC 2013-

1 TN2654). The staff incorporates the information in NUREG-1437, Revision 1, Section 4.12.2.2
2 (NRC 2013-TN2654: 4 227, 4 228), herein by reference.

3 **3.14.3 Greenhouse Gas Emissions and Climate Change**

4 The following sections discuss GHG emissions and climate change impacts. Section 3.14.3.1 of
5 this EIS evaluates the GHG emissions associated with the operation of Monticello and
6 replacement power alternatives. Section 3.14.3.2 discusses the observed changes in climate
7 and potential future climate change during the SLR term, based on climate model simulations
8 under future global GHG emissions scenarios, and the impacts from climate change on
9 environmental resources where there are incremental impacts of the proposed action
10 (subsequent license renewal).

11 *3.14.3.1 Greenhouse Gas Emissions from the Proposed Action and Alternatives*

12 Gases found in the Earth's atmosphere that trap heat and play a role in the Earth's climate are
13 collectively termed GHGs. These GHGs include carbon dioxide (CO₂), methane (CH₄), nitrous
14 oxide (N₂O), water vapor (H₂O), and fluorinated gases such as hydrofluorocarbons (HFCs),
15 perfluorocarbons, and sulfur hexafluoride. The Earth's climate responds to changes in the
16 concentrations of GHGs in the atmosphere because these gases affect the amount of energy
17 absorbed and heat trapped by the atmosphere. Increasing concentrations of GHGs in the
18 atmosphere generally increase the Earth's surface temperature. The atmospheric
19 concentrations of CO₂, CH₄, and N₂O have significantly increased since 1850. For instance,
20 since 1850, CO₂ concentrations have increased by almost 50 percent (USGCRP 2023-TN9762).
21 In 2019, global net GHG emissions were estimated to be 59 ± 6.6 gigatons of CO₂ equivalent
22 (CO₂eq), with the largest share in gross GHG emissions being CO₂ from fossil fuel combustion
23 and industrial processes (IPCC 2023-TN8557). The year 2022 set a record high concentration
24 for global average atmospheric CO₂ concentration at 417.06 parts per million (NOAA 2023-
25 TN9680). The annual rate of increase in atmospheric CO₂ over the last 60 years is 100 times
26 faster than previous natural increases (NOAA 2023-TN9680).

27 Long-lived GHGs—CO₂, CH₄, N₂O, and fluorinated gases—are well mixed throughout the
28 Earth's atmosphere, and their impact on climate is long-lasting and cumulative in nature as a
29 result of their long atmospheric lifetimes (EPA 2016-TN7561, USGCRP 2023-TN9762).
30 Therefore, the extent and nature of climate change are not specific to where GHGs are emitted.
31 Carbon dioxide is of primary concern for global climate change because it is the primary gas
32 emitted as a result of human activities. Climate change is the decades or longer changes in
33 climate measurements (e.g., temperature and precipitation) that have been observed on global,
34 national, and regional levels (IPCC 2007-TN7421; EPA 2016-TN7561; USGCRP 2014-TN3472).
35 Climate change research indicates that the cause of the Earth's warming over the last 50 to 100
36 years is due to the buildup of GHGs in the atmosphere resulting from human activities (IPCC
37 2013-TN7434, IPCC 2021-TN7435, IPCC 2023-TN8557; USGCRP 2014-TN3472, USGCRP
38 2017-TN5848, USGCRP 2018-TN5847). Climate change can vary regionally, spatially, and
39 seasonally depending on local, regional, and global factors. Just as regional climate differs
40 throughout the world, the impacts of climate change can vary among locations.

41 The sixth assessment synthesis report from the Intergovernmental Panel on Climate Change
42 (IPCC) states that “[i]t is unequivocal that human influence has warmed the atmosphere, ocean,
43 and land” (IPCC 2023-TN8557). The Fifth National Climate Assessment states that “[i]t is
44 unequivocal that human activities have increased atmospheric levels of carbon dioxide and
45 other GHGs. It is also unequivocal that global average temperature has risen in response”

1 (USGCRP 2023-TN9762). The EPA has determined that GHGs “may reasonably be anticipated
 2 both to endanger public health and to endanger public welfare” (74 FR 66496-TN245).

3 *3.14.3.1.1 Proposed Action*

4 The operation of Monticello results in direct and indirect GHG emissions. Xcel Energy has
 5 calculated direct (diesel generators, pumps, boiler) and indirect (worker vehicles) GHG
 6 emissions, which are provided in Table 3-31. Xcel Energy does not maintain an inventory of
 7 GHG emissions resulting from visitors and delivery vehicles (Xcel 2023-TN9084). Fluorinated
 8 gas emissions from refrigerant sources and from electrical transmission and distribution
 9 systems can result from leakage, servicing, repair, or disposal of sources. In addition to being
 10 GHGs, chlorofluorocarbons and hydrochlorofluorocarbons are ozone-depleting substances that
 11 are regulated by the Clean Air Act under Title VI, “Stratospheric Ozone Protection.”
 12 Chlorofluorocarbons and hydrochlorofluorocarbons are present at Monticello. Xcel Energy
 13 maintains a program to manage stationary refrigeration appliances at Monticello to recycle,
 14 recapture, and reduce emissions of ozone-depleting substances. Additionally, Monticello uses
 15 sulfur hexafluoride in a small number of high voltage breakers, but Monticello’s air permit does
 16 not require sulfur hexafluoride emissions to be tracked. Therefore, Table 3-31 does not account
 17 for any potential emissions from stationary sources such as the refrigeration or high voltage
 18 breakers at Monticello.

19 **Table 3-31 Annual Greenhouse Gas Emissions from Operation at Monticello Nuclear**
 20 **Generating Plant, Unit 1**

Year	Combustion Sources ^(a)	Workforce Commuting ^(b)	Total ^(c)
2017	3,000	3,250	6,250
2018	3,070	3,250	6,320
2019	2,200	3,250	5,450
2020	2,790	3,250	6,040
2021	2,390	3,250	5,630

(a) Combustion sources include those listed in Table 3-4 (e.g., diesel generators, pumps, boiler).
 (b) Emissions based on a workforce of 663 and the assumption of a 3.3 percent carpool rate was assumed.
 (c) Greenhouse gas (GHG) emissions are reported in metric tons and converted to short tons. All reported values are rounded. To convert to metric tons per year, multiply by 0.90718. Carbon dioxide equivalent (CO₂eq) is a metric used to compare the emissions of GHGs based on their global warming potential (GWP). The GWP is a measure used to compare how much heat a GHG traps in the atmosphere. The GWP is the total energy that a gas absorbs over a period of time compared to carbon dioxide. CO₂eq is obtained by multiplying the amount of the GHG by the associated GWP.

Source: Xcel 2023-TN9084.

21 *3.14.3.1.2 No-Action Alternative*

22 Under the no-action alternative, the NRC would not issue a subsequent renewed license, and
 23 Monticello would permanently shut down on or before the expiration of the current renewed
 24 license. At some point, all nuclear plants will terminate operations and undergo
 25 decommissioning. The decommissioning GEIS (NUREG-0586) (NRC 2002-TN7254) considers
 26 the environmental impacts of decommissioning. Therefore, the scope of impacts considered
 27 under the no-action alternative includes the immediate impacts resulting from activities at
 28 Monticello that would occur between plant shutdown and the beginning of decommissioning
 29 (i.e., activities and actions necessary to cease the operation of Monticello). Facility operations
 30 would terminate at or before the expiration of the current renewed license. When the facility

1 stops operating, there would be a reduction in the GHG emissions from activities related to plant
2 operation, such as the use of generators and employee vehicles. The NRC staff anticipates that
3 the GHG emissions for the no-action alternative would be less than those presented in , which
4 shows the estimated direct GHG emissions from the operation of Monticello and the associated
5 mobile emissions.

6 *3.14.3.1.3 Natural Gas and Renewables Alternative*

7 The natural gas and renewables alternative would consist of a natural-gas-fired, two-unit
8 combustion turbine power plant, wind turbines, solar panels, purchased power, and existing
9 natural-gas-fired power plants. The emissions associated with the operation of renewable
10 energy sources (wind and solar) would be negligible because no direct fossil fuels are burned to
11 generate electricity. Purchased power and existing natural-gas-fired power plants would
12 supplement renewable energy sources and new natural-gas-fired power plants on an as-needed
13 basis to meet energy demand. Associated GHG emissions would primarily be from the new
14 750 MW natural-gas-fired, two-unit combustion turbine power plant and existing natural-gas-
15 fired combustion turbines that would be operated as a peaking plant to provide energy during
16 occasional extended periods of low renewable output (Xcel 2023-TN9084). The projected
17 generation for the existing combustion turbines would average 368,000 MWh annually
18 (Xcel 2023-TN9084). The NRC staff estimates that direct emissions from the operation of the
19 new 750 MW natural-gas-fired, two-unit combustion turbine power plant (generating up to 6.570
20 million MWh) and the existing natural-gas-fired combustion turbine peaking plant (for a
21 combined total of 6.938 million MWh) would emit 4.2 million tons (3.8 million MT) of CO₂eq.

22 *3.14.3.1.4 Renewables and Storage Alternative*

23 This alternative would consist of wind turbines, solar panels with battery storage, purchased
24 power, and to a limited extent, existing natural-gas-fired power plants. Purchased power and
25 existing natural-gas-fired power plants would supplement renewable energy sources. The
26 emissions associated with the operation of renewable energy sources (wind and solar) would be
27 negligible because no direct fossil fuels are burned to generate electricity. For this alternative,
28 Xcel Energy projected an annual peak of 204,000 MWh from natural-gas-fired generation.
29 Purchased power would supplement renewable generation on an as-needed basis (Xcel 2023-
30 TN9084). Therefore, for this alternative, GHG emissions would primarily be from the operation
31 of existing natural-gas-fired plants. The NRC staff estimates that the direct emissions from an
32 annual peak of 204,000 MWh from natural-gas-fired generation would be 123,010 tons
33 (111,570 MT) of CO₂eq.

34 *3.14.3.1.5 New Nuclear Alternative*

35 Sources of GHG emissions of the new nuclear alternative would include diesel generators,
36 boilers, and pumps, similar to existing sources at Monticello. In NUREG-2226, the NRC
37 estimated the total carbon footprint as a result of operating two or more small modular reactors
38 with a maximum total electrical output of 800 MWe (NRC 2019-TN6136). In Section 5.7.1.2 of
39 NUREG-2226 (page 5-45), the NRC estimated that the carbon footprint for operations for
40 40 years is 199,500 tons of CO₂eq (181,000 MT) or 4,990 tons of CO₂eq annually (4,525 MT).
41 Therefore, the NRC staff estimates that operating a 12-unit small modular reactor plant
42 generating 880 MWe would emit up to 5,490 tons (4,980 MT) of CO₂eq annually.

1 3.14.3.1.6 Comparison of Greenhouse Gas Emissions

2 Table 3-32 presents the direct GHG emissions from facility operations under the proposed
 3 action of SLR and alternatives to the proposed action. The GHG emissions from the Natural
 4 Gas and Renewables Alternative and the Renewables and Storage Alternative are significantly
 5 greater than those from the continued operation of Monticello. If Monticello’s generating
 6 capacity were to be replaced by the Natural Gas and Renewables Alternative or the
 7 Renewables and Storage Alternative, there would be an increase in GHG emissions. Therefore,
 8 the NRC staff concludes that the continued operation of Monticello (proposed action) results in
 9 the avoidance of GHG emissions as compared to the Natural Gas and Renewables Alternative
 10 or the Renewables and Storage Alternative. However, the proposed action, the no-action
 11 alternative, and the new nuclear alternative would have similar and comparable GHG
 12 emissions.

13 **Table 3-32 Direct Greenhouse Gas Emissions from Facility Operations under the**
 14 **Proposed Action and Alternatives**

Technology/Alternative	Carbon Dioxide Equivalent (CO ₂ eq) TPY ^(a)
Proposed Action ^(b)	3,070
No-Action ^(c)	<3,070
Natural Gas and Renewables Alternative ^(d)	4.2 million
Renewables and Storage Alternative ^(e)	123,010
New Nuclear Alternative	5,490

TPY = ton(s) per year.

- (a) Carbon dioxide equivalent (CO₂eq) is a metric used to compare the emissions of greenhouse gases (GHGs) based on their global warming potential (GWP). The GWP is a measure used to compare how much heat a GHG traps in the atmosphere. The GWP is the total energy that a gas absorbs over a period of time compared to carbon dioxide. CO₂eq is obtained by multiplying the amount of the GHG by the associated GWP. For example, the GWP of methane is 21; therefore, 1 ton of methane emission is equivalent to 21 tons of carbon dioxide emissions.
- (b) GHG emissions include direct emissions from onsite combustion sources.
- (c) Emissions resulting from activities at Monticello that would occur between plant shutdown and the beginning of decommissioning and assumed not to be greater than the GHG emissions from operation at Monticello.
- (d) Emissions primarily from the operation of a natural-gas-fired, two-unit combustion turbine power plant and existing natural-gas-fired power plants.
- (e) Emissions primarily from the operation of existing natural-gas-fired power plants.

15 3.14.3.2 Observed Trends in Climate Change Indicators

16 The global surface temperature has increased faster since 1970 than in any other 50-year
 17 period over at least the last 2,000 years (IPCC 2023-TN8557). On a global level, from 1901 to
 18 2016, the average temperature has increased by 1.8°F (1.0°C) (USGCRP 2018-TN5847). Since
 19 1901, precipitation has increased at an average rate of 0.04 in. (0.1 cm) per decade on a global
 20 level (EPA 2021-TN7420). The United States Global Change Research Program (USGCRP)
 21 reports that from 1901 to 2016, average surface temperatures have increased by 1.8°F (1.0°C)
 22 across the contiguous United States (USGCRP 2018-TN5847). Since 1901, average annual
 23 precipitation has increased by 4 percent across the United States (USGCRP 2018-TN5847).
 24 The USGCRP reports that, since 1970, the contiguous United States is warming faster than the
 25 global average. Since 1970, the global temperature has increased by 1.7°F (0.9°C), while the
 26 average surface temperature in the contiguous United States has increased by 2.5°F (1.4°C)
 27 (USGCRP 2023-TN9762). The observed climate change indicators across the United States
 28 include increases in the frequency and intensity of heavy precipitation, earlier onset of spring

1 snowmelt and runoff, rise of the sea level and increased tidal flooding in coastal areas, an
2 increased occurrence of heat waves, and a decrease in the occurrence of cold waves.

3 Climate change and its impacts can vary regionally, spatially, and seasonally depending on
4 local, regional, and global factors. Observed climate changes and impacts have not been
5 uniform across the United States. Annual average temperature data for the Midwest for
6 2002–2021 (relative to 1901–1960) exhibit an increase of more than 2.0°F (1.1°C), and winter is
7 warming nearly twice as fast as summer (USGCRP 2023-TN9762, Figure 2.4). The number of
8 hot days (days at or above 95°F [at or above 35°C]) has decreased by 5.6 days, while the
9 number of cold days (days at or below 32°F) has decreased by 4.9 days in the Midwest from
10 2002–2021 relative to 1901–1960 (USGCRP 2023-TN9762).

11 Average annual precipitation from 2002–2021 for the Midwest was 5–15 percent higher relative
12 to the 1901–1960 average (USGCRP 2023-TN9762, Figure 2.4). The Midwest has experienced
13 a 45 percent increase in the number of extreme precipitation days (defined as the top 1 percent
14 of heaviest precipitation events) from 1958–2021 (USGCRP 2023-TN9762, Figure 2.8).

15 The NRC staff used the MDNR’s Minnesota Climate Trends tool to analyze temperature and
16 precipitation trends for 1895–2022 in Minnesota’s Mississippi River St. Cloud watershed area,
17 which encompasses Monticello. A trend analysis shows that the ambient average temperature
18 has increased at a rate of 0.26°F (0.14°C) per decade, and average precipitation increased at a
19 rate of 0.44 in (1.1 cm) per decade (MnDNR 2023-TN9681).

20 3.14.3.3 *Climate Change Projections*

21 Future global GHG emission concentrations (emission scenarios) and climate models are
22 commonly used to project possible climate change. Climate model simulations often use GHG
23 emission scenarios to represent possible future social, economic, technological, and
24 demographic development that, in turn, drive future emissions. Climate models indicate that
25 over the next decade, warming is very similar across all emission scenarios (USGCRP 2023-
26 TN9762). However, by mid-century (2040–2070), the differences between the projected
27 temperatures under higher and lower emission scenarios become observable. The impacts of
28 climate change increase with warming, and warming is certain to continue if emissions of CO₂
29 do not reach net zero (USGCRP 2023-TN9762).

30 The IPCC has generated various representative concentration pathway (RCP) scenarios
31 commonly used by climate modeling groups to project future climate conditions (IPCC 2000-
32 TN7652, IPCC 2013-TN7434, USGCRP 2017-TN5848, USGCRP 2018-TN5847). In the IPCC
33 Fifth Assessment Report, four RCPs were developed and are based on the predicted changes
34 in radiative forcing (a measure of the influence that a factor such as GHG emissions has in
35 changing the global balance of incoming and outgoing energy) in the year 2100, relative to
36 preindustrial conditions. The four RCP scenarios are numbered in accordance with the change
37 in radiative forcing measured in watts per square meter (i.e., +2.6 [very low], +4.5 [lower],
38 +6.0 [mid-high], and +8.5 [higher]) (USGCRP 2018-TN5847). For example, RCP 2.6 is
39 representative of a mitigation scenario aimed at limiting the increase in the global mean
40 temperature to 3.6°F (2°C) (IPCC 2014-TN7651). RCP 8.5 reflects a continued increase in
41 global emissions resulting in increased warming by 2100. In the IPCC Working Group
42 contribution to the Sixth Assessment Report, five shared socioeconomic pathways (SSPs) were
43 used along with the associated modeling results as the basis for their climate change
44 assessments (IPCC 2021-TN7435). These five socioeconomic pathway scenarios (SSP1-1.9,

1 SSP1-2.6, SSP2-4.5, SSP3-7.0, and SSP5-8.5) cover a range of GHG pathways and climate
2 change mitigation.

3 The Fourth National Climate Assessment uses RCPs when presenting projected climate change
4 (USGCRP 2017-TN5848). The Fifth National Climate Assessment uses SSPs, RCPs, and
5 global warming levels when presenting projected climate change (USGCRP 2023- TN9679).The
6 Minnesota Climate Mapping and Analysis Tool (ClimAT) provides highly localized climate
7 projections for Minnesota based on SSPs (Liess et al. 2023-TN9684). The NRC summarizes the
8 regional projections for the Midwest, presented below from the Fourth and Fifth National Climate
9 Assessment reports and ClimAT.

10 Projections based on the intermediate (RCP 4.5) and very high (RCP 8.5) scenarios for
11 mid-century (2036–2065) indicate annual average temperature increases across the Midwest
12 ranging from 4.21 to 5.29°F (2.3 to 2.9°C) relative to that for 1976–2005 (USGCRP 2017-
13 TN5848: Table 6.4). The coldest and warmest daily temperatures of the year are expected to
14 increase by 9.44°F (5.2°C) and 6.71°F (3.7°C), respectively, under a very high emission
15 scenario (RCP 8.5) by mid-century (2036–2065) relative to those for 1975–2005 (USGCRP
16 2017-TN5848: Table 6.5). Specific to Wright and Sherburne Counties, the projections for the
17 mid-century (2040–2059, relative to 1995–2014) indicate an increase of 3.1 to 4.4°F (1.72 to
18 2.4°C) in the average annual daily temperature for both the moderate (SSP2-45) and high
19 (SSP5-85) emission scenarios (Liess et al. 2023-TN9684).

20 Precipitation projections based on the intermediate (RCP 4.5) and very high (RCP 8.5) emission
21 scenarios for the mid-century (2036–2065) indicate precipitation increases across the Midwest
22 ranging from 8 to 20 percent relative to that for the previous five decades (1991–2020)
23 (USGCRP 2023-TN9762, Figure 4.3). Winter and spring precipitation is projected to increase,
24 but summer and autumn precipitation is projected to be more variable. Specific to Wright and
25 Sherburne Counties, projections based on the moderate scenario (SSP2-4.5) for the mid-
26 century (2040–2059, relative to 1995–2014) indicate an increase of 2.1 to 6.2 percent in
27 average annual precipitation (Liess et al. 2023-TN9684). Under the high emission scenario
28 (SSP5-8.5), ClimAT projects that average annual precipitation for mid-century for Wright and
29 Sherburne Counties can increase (up to 1.6 percent) or decrease (up to 1.6 percent).

30 The effects of climate change on Monticello structures, systems and components are outside
31 the scope of the NRC staff's SLR environmental review. The environmental review describes
32 the potential effects of continued nuclear power plant operation on the environment.
33 Site-specific environmental conditions are considered when siting nuclear power plants. This
34 includes the consideration of meteorological and hydrologic siting criteria as set forth in 10 CFR
35 Part 100 (TN282), "Reactor Site Criteria." NRC regulations require that plant structures, systems
36 and components important to safety be designed to withstand the effects of natural phenomena
37 such as flooding, without loss of capability to perform safety functions. Further, nuclear power
38 plants are required to operate within technical safety specifications in accordance with the NRC
39 operating license, including coping with natural phenomenon hazards. The NRC conducts
40 safety reviews prior to allowing licensees to make operational changes because of changing
41 environmental conditions. Additionally, the NRC evaluates the operating conditions and physical
42 infrastructure of nuclear power plants to assure ongoing safe operations under the plant's initial
43 and renewed operating licenses through the NRC's Reactor Oversight Program. If new
44 information about changing environmental conditions (such as rising sea levels or potential
45 flooding that threaten safe operating conditions or challenge compliance with the plant's
46 technical specifications) becomes available, the NRC will evaluate the new information to
47 determine whether any safety-related changes are needed at licensed nuclear power plants.

1 This is a separate and distinct process from the NRC staff's SLR environmental review
2 conducted in accordance with NEPA. Nonetheless, changes in climate could have broad
3 implications for certain resource areas. As discussed below, the NRC staff considers the
4 impacts of climate change on environmental resources that are incrementally affected by the
5 proposed action.

6 Air Quality: Climate change can impact air quality as a result of changes in meteorological
7 conditions. The formation, transport, dispersion, and deposition of air pollutants depend, in part,
8 on weather conditions (IPCC 2007-TN7421). Ozone and PM_{2.5} are particularly sensitive to
9 climate change (IPCC 2007-TN7421; EPA 2009-TN9068; USGCRP 2023-TN9762). Ozone is
10 formed by the chemical reaction of nitrogen oxides and volatile organic compounds in the
11 presence of heat and sunlight. The emission of ozone precursors also depends on the
12 temperature, wind, and solar radiation (IPCC 2007-TN7421). Warmer temperatures, air
13 stagnation, droughts, and wildfires are favorable conditions for higher levels of ozone and PM_{2.5}
14 (USGCRP 2023-TN9762). USGCRP reports that there is medium confidence that climate
15 change is projected to worsen air quality in many U.S. regions (USGCRP 2023-TN9762).
16 Across the Midwest, year-round ozone is projected to increase by 2035 under a very high
17 emissions scenario (RCP 8.5) (USGCRP 2023-TN9762). Surface Water Resources: Climate
18 change can impact surface water resources because of changes in the temperature,
19 precipitation, and other parameters. Increases in annual precipitation and heavy precipitation
20 events, as is projected for Minnesota, can result in greater runoff from the land while increasing
21 the potential for riverine flooding. In turn, these changes can result in the transport of a higher
22 sediment load and other contaminants to surface waters with potential degradation of the
23 ambient water quality. The projected changes in the cumulative annual runoff for mid-century
24 (2036–2065, relative to 1991–2020) for the Midwest under an intermediate scenario (RCP 4.5)
25 and very high scenario (RCP 8.5) indicate increases ranging from 5 to 20 percent (USGCRP
26 2023-TN9762: Figure 24.11). Cumulative runoff increases are projected throughout the Midwest
27 region in winter. However, in the autumn and spring, cumulative runoff decreases are projected
28 in southern areas of the Midwest and the northern Great Lakes areas, respectively. Cumulative
29 runoff in the summer is projected to vary throughout the Midwest. Increases in the cumulative
30 annual runoff may lead to increases in riverine flooding. Regulatory agencies would need to
31 account for changes in water availability in their water resource allocation and environmental
32 permitting programs. Regardless of water use permitting constraints, nuclear power plant
33 operators would have to account for any changes in the water temperature in operational
34 practices and procedures.

35 **3.15 Cumulative Effects**

36 Actions considered in the cumulative effects (impacts) analysis include the proposed SLR action
37 when added to the environmental effects from past, present, and reasonably foreseeable future
38 actions. The analysis considers all actions including minor ones, because the effects of
39 individually minor actions may be significant when considered collectively over a period of time.
40 The goal of the cumulative effects analysis is to identify potentially significant impacts. The
41 environmental effects of the proposed SLR action when combined with the effects of other
42 actions could result in a cumulative impact.

43 The cumulative effects or impacts analysis only considers resources and environmental
44 conditions that could be affected by the proposed license renewal action, including the effects of
45 continued reactor operations during the SLR term and any refurbishment activities at a nuclear
46 power plant. For there to be a cumulative effect, the proposed action (i.e., SLR) must have an

1 incremental new, additive, or increased physical effect or impact on the resource or
2 environmental condition beyond what is already occurring.

3 For the purposes of analysis, past and present actions include all actions that have occurred
4 since the commencement of reactor operations up to submittal of the SLR request. Older
5 actions are accounted for in baseline assessments presented in the affected environment
6 discussions in Sections 3.2 through 3.13. The time frame for the consideration of reasonably
7 foreseeable future actions is the 20-year SLR term. Reasonably foreseeable future actions
8 include current and ongoing planned activities through the end of the period of extended
9 operation.

10 The incremental effects of the proposed action (SLR) when added to the effects from past,
11 present, and reasonably foreseeable future actions and other actions result in the overall
12 cumulative effect. A qualitative cumulative effects analysis is conducted in instances where the
13 incremental effects of the proposed action (SLR) and past, present, and reasonably foreseeable
14 future actions are uncertain or not well known.

15 Information from Xcel Energy's ER; responses to requests for additional information; information
16 from other Federal, State, and local agencies; scoping comments; and information gathered
17 during the environmental site audit at Monticello were used to identify past, present, and
18 reasonably foreseeable future actions in the cumulative effects analysis.

19 Since the initial Monticello license renewal was completed, Xcel Energy completed replacement
20 of both cooling towers. This project was conducted in two phases using the same footprint as
21 the previously existing cooling towers; replacement of the second cooling tower was completed
22 in May 2022. Multiple groundwater monitoring and pumping wells and tanks associated with
23 groundwater tritium remediation have been installed at the Monticello site, along with a large
24 storage pond and a sheet pile wall near the Mississippi River (Xcel 2023-TN9578). Other
25 activities include minor and ongoing construction and maintenance activities on the Monticello
26 site.

27 Proposed future projects at Monticello include a proposal to construct a second concrete
28 storage pad within the existing Monticello ISFSI fenced area to increase spent fuel storage
29 capacity. The existing ISFSI is approximately 3.5 ac (1.4 ha) in size; the proposed expansion
30 project would require less than 1 ac (0.4 ha). Similarly, the expanded ISFSI capacity along with
31 the spent fuel pool is anticipated to be capable of storing all the spent nuclear fuel generated
32 during the SLR term. If the ISFSI storage needs to be expanded, previously disturbed land near
33 the ISFSI is likely to be sufficient for the expansion with no significant environmental impact.

34 Construction at the ISFSI is dependent on the State of Minnesota issuing a Certificate of Need.
35 The Minnesota Public Utilities Commission issued an order on October 17, 2023, granting a
36 Certificate of Need for additional dry cask storage to support 2030–2040 operations. As stated
37 in the order, "Xcel Energy's petition anticipated only needing around 14 canisters through 2040,
38 but proposed building space for approximately 36 canister vaults." Xcel Energy anticipates the
39 placement of up to 15 canisters during its 2028 dry storage loading campaign. (Xcel 2023-
40 TN9578).

41 Potential projects near Monticello include:

- 42 • Sherco Solar Project – A 460 MW solar energy facility proposed by Xcel Energy. The project
43 covers approximately 3,480 ac (1,408 ha) of land outside the city of Becker in Sherburne
44 County. The proposed project would include the installation of two new 345 kV transmission

1 lines totaling approximately 5 mi (1.6 km). The project would generate 900 temporary
2 construction jobs and 24 long-term jobs for operations and maintenance. The project is
3 expected to be completed in 2024 (Xcel 2023-TN9578).

- 4 • Four natural gas facilities – Proposed by Xcel Energy as a replacement for the Sherco
5 coal-fired plant.

6 The following sections discuss the cumulative effects on the environment near Monticello—
7 when the incremental environmental effects of the proposed license renewal action are
8 compounded by the effects from past, present, and reasonably foreseeable future actions. For
9 the most part, environmental conditions near Monticello are not expected to change appreciably
10 during the SLR term beyond what is already being experienced. Consequently, no cumulative
11 impacts analysis was performed for the following resource areas: land use, noise, geology and
12 soils, terrestrial resources, aquatic resources, and historic and cultural resources.

13 **3.15.1 Air Quality**

14 The region of influence for the cumulative air quality analysis consists of Sherburne and Wright
15 Counties, where the Monticello site is located. Xcel Energy has not proposed any refurbishment
16 related activities during the SLR term. As a result, air emissions from the nuclear power plant
17 during the SLR term would be similar to those presented in Section 3.3 of this EIS.

18 Consequently, cumulative changes to air quality in Sherburne and Wright counties would be the
19 result of future projects and action that change present-day emissions within the counties,
20 unrelated to the proposed action (i.e., SLR). Therefore, based on this information the proposed
21 action would have no cumulative effect on air quality beyond what is already being experienced.

22 Construction activities (e.g., Sherco Solar Project, transmission installation) identified in
23 Section 3.15 of this EIS could increase air emissions during their respective construction
24 periods, but those air emissions would be temporary and localized. The four proposed natural
25 gas facilities could be significant long-term sources of air emissions. Vehicular traffic associated
26 with operation of the Sherco Solar Project and natural gas facilities also will contribute to long-
27 term air emissions.

28 **3.15.2 Water Resources**

29 *3.15.2.1 Surface Water Resources*

30 The description of the affected environment in Section 3.5.1, “Surface Water Resources,” of this
31 EIS serves as the baseline for the cumulative impacts assessment for surface water resources.
32 Monticello withdraws cooling water from the Mississippi River and discharges return flows and
33 comingled effluents back to the river within the Mississippi River–St. Cloud watershed. As
34 discussed in Section 3.5.1, none of the surface water quality of use issues would have a greater
35 than SMALL impact on surface water quality or use. Additionally, Xcel Energy has not identified
36 any refurbishment activities or major changes to Monticello operations for the SLR term (Xcel
37 2023-TN9084).

38 *3.15.2.1.1 Water Use Considerations*

39 State-wide, the combined water use (surface water and groundwater) in Minnesota has declined
40 approximately 28 percent from 2010 to 2019 while over that same timeframe the population has
41 increased by approximately 7 percent (MnDNR 2020-TN9685). Much of the decrease in the

1 state’s water use can be attributed to a decrease in water needed for power plant cooling, even
2 as the overall demand for electricity remains constant.

3 The State of Minnesota requires an appropriation permit for anyone who uses more than
4 10,000 gallons of water per day (37,854 Liters per day) or 1 million gallons of water per year
5 (3,785,411 Liters per day) (MnDNR 2020-TN9685). These water users must submit annual
6 reports to the Minnesota Department of Natural Resources detailing their monthly water usage,
7 which helps the department manage water resources, especially during times of drought
8 (MnDNR 2020-TN9685).

9 The U.S. Geological Survey publishes State water-use data by type, category use (e.g., public
10 supply, power generation, industrial) and county every 5 years since 1985. As shown in
11 Figure 3.1-3 of Xcel Energy’s ER (Xcel 2023-TN9084), the Monticello site boundary
12 encompasses portions of both Sherburne and Wright counties. Data from the U.S. Geological
13 Survey distinguishes between water type (groundwater, surface water, saline, or freshwater),
14 but does not identify the water source (e.g., river, stream, reservoir) or basin. Table 3-33
15 presents surface water withdrawals from Wright and Sherburne counties for 2015. As shown in
16 the table, the vast majority of surface water usage is for thermoelectric power generation, with
17 relatively minor amounts for irrigation and mining.

18 As assessed in Section 3.5.1 “Surface Water Resources,” of this EIS, Monticello consumes only
19 a small amount of the water available in the Mississippi River, and changes in Monticello’s
20 surface water withdrawal rates over the SLR term are not anticipated (Xcel 2023-TN9084). The
21 nearest permitted intake downstream that has been actively appropriating water over the last
22 10 years is located approximately 20 mi (32 km) downstream of Monticello and supports
23 agricultural use (MnDNR 2023-TN9863). Therefore, continued operation of Monticello under the
24 proposed action should not have any significant impact on the amount of water available to
25 users downstream from Monticello, with minimal contributions to cumulative impacts on surface
26 water availability.

27 No new or proposed projects, with the potential to substantially impact surface water
28 withdrawals or consumptive water use within the reach of the Mississippi River where Monticello
29 is located, were identified during the NRC staff’s review. Therefore, based on the available
30 information, the proposed action would have no cumulative effect on surface water use beyond
31 what is already being experienced.

32 **Table 3-33 Surface Water Withdrawals from Wright and Sherburne Counties, 2015**

Category	Wright County (MGD)	Sherburne County (MGD)
Public Supply	0.00	0.00
Domestic, Self-Supplied	0.00	0.00
Industrial, Self-Supplied	0.00	0.00
Irrigation	0.13	0.08
Livestock	0.00	0.00
Aquaculture	0.00	0.00
Mining	0.12	0.15
Power Generation (Thermoelectric)	315.06	53.30
Total	315.31	53.53

MGD = million gallon(s) per day.
Source: Dieter et al. 2018-TN9686.

1 3.15.2.1.2 *Water Quality Considerations*

2 The water quality of the upper Mississippi River varies from near-pristine north of St Cloud to no
3 longer meeting river life and recreation standards by the time it reaches the Twin Cities. The
4 primary pollutants affecting water quality in this region include phosphorus, bacteria, nitrate, and
5 sediment. The streams and rivers that feed into the Mississippi are the source of most of these
6 nonpoint source pollutants, as south of St. Cloud, the land use changes from forests and
7 wetlands to crops and cities.

8 As discussed in Section 3.5.1.3, the MDNR classifies the portion of the Mississippi River
9 adjacent to the plant as suitable for aquatic recreation, including fishing and swimming, as well
10 as for protection as a drinking water source (NMC 2005-TN9345). While this reach is also listed
11 by MPCA as impaired for fish consumption due to PCB and mercury in fish tissue, and impaired
12 for aquatic recreation due to fecal coliform (MPCA 2022-TN9539), Monticello does not
13 contribute to these impairments.

14 Monticello periodically conducts mechanical or hydraulic maintenance dredging in the area in
15 front of the plant’s concrete intake apron and the Mississippi River. The material removed
16 consists primarily of silt, sand, and rocks. Monticello holds both a USACE regional general
17 permit (RGP- 003-MN) and a MDNR State dredge permit (1967-0743). Dredging may result in a
18 localized impact on water quality by temporarily increasing the turbidity of the water column.

19 As stated in Section 3.5.1.3, Monticello’s CWA Section 401 Water Quality Certification remains
20 valid (see Attachment E in Xcel 2023-TN9084). To operate, Monticello is required to comply
21 with its surface water withdrawal limits, NPDES permit, stormwater permits and other
22 regulations. Continued operation of Monticello would require renewed permits from the MPCA,
23 which would address changing requirements such that cumulative water quality objectives
24 would be served. Moreover, offsite projects would similarly have to comply with MPCA
25 regulations.

26 In summary, a substantial regulatory framework exists to address current and potential future
27 sources of water quality degradation within the watershed of the Monticello site with respect to
28 potential cumulative impacts on surface water quality. Therefore, based on this information, the
29 proposed action would have no cumulative effect on surface water quality beyond what is
30 already being experienced.

31 3.15.2.2 *Groundwater Resources*

32 The description of the affected environment in Section 3.5, “Groundwater Resources,” of this
33 EIS serves as the baseline for the cumulative impacts assessment for groundwater resources.
34 The normal flow of groundwater at Monticello is toward the Mississippi River with some local
35 reversal of flow when river levels are high. Monticello’s location near the river and the distance
36 to other groundwater users helps to limit the potential for any noticeable cumulative
37 groundwater use impacts. In addition, Monticello’s groundwater withdrawals for potable use and
38 other plant purposes is small enough that the NRC staff expects off-site groundwater levels
39 would not be affected. Monticello has received a permit for more significant groundwater
40 withdrawals to address remediation of a tritium release. As described in Section 3.5 of this EIS,
41 the staff determined that these withdrawals would result in a small, temporary reduction of
42 groundwater levels at the site boundary. Therefore, these withdrawals would not contribute
43 significantly to potential offsite cumulative groundwater use impacts.

1 As described in Section 3.5.2 of this EIS, a November 2022 release of tritium has affected
2 groundwater quality at the plant site. Monticello monitors the groundwater quality regularly and
3 has taken a number of actions to remediate the onsite groundwater contamination and prevent
4 the movement of affected groundwater offsite. As noted above, groundwater at the site
5 discharges to the Mississippi River; tritium levels in the river are regularly monitored and were
6 below detection limits as of August 2023. As described in Section 3.5.3.2 of this EIS, the NRC
7 staff concluded that groundwater quality impacts due to the release of radionuclides would be
8 SMALL to MODERATE during the SLR term because of uncertainty in the duration of
9 groundwater remediation. However, the NRC staff expects that the effects of the tritium release
10 will be limited to the immediate vicinity of the plant and would not contribute significantly to
11 potential offsite cumulative groundwater quality impacts.

12 **3.15.3 Socioeconomics**

13 As discussed in Section 3.9, continued operation of Monticello during the SLR term would have
14 no impact on socioeconomic conditions in the region beyond what is already being experienced.
15 Xcel Energy has no planned activities at Monticello beyond impacts already being experienced.
16 The only activities Xcel Energy plans at Monticello are the proposed expansion of the existing
17 ISFSI (which would be of limited duration and impact), and continued reactor operations and
18 maintenance.

19 Because Xcel Energy has no plans to hire additional workers during the SLR term, overall
20 expenditures and employment levels at Monticello would remain unchanged with no new or
21 increased demand for housing and public services. Therefore, the only contributory effects
22 would come from reasonably foreseeable future planned operational activities at Monticello and
23 other planned offsite activities, unrelated to the proposed action (SLR). When combined with
24 past, present, and reasonably foreseeable future activities, the proposed action would have no
25 new or increased cumulative effect beyond what is already being experienced.

26 **3.15.4 Human Health**

27 The NRC and EPA have established radiological dose limits to protect the public and workers
28 from both acute and long-term exposure to radiation and radioactive materials. These dose
29 limits are specified in 10 CFR Part 20 (TN283) and 40 CFR Part 190, "Environmental Radiation
30 Protection Standards for Nuclear Power Operations" (TN739). As discussed in Section 3.11,
31 "Human Health," of this EIS, the impacts on human health from continued nuclear power plant
32 operations during the SLR term would be SMALL.

33 For the purposes of this cumulative impact analysis, the geographical area considered is the
34 area within a 50 mi (80 km) radius of Monticello. There are no other operational nuclear power
35 plants within this 50 mi (80 km) radius. As discussed in Section 3.13.1, "Radioactive Waste," of
36 this EIS, Xcel Energy stores spent nuclear fuel from Monticello in a storage pool and in an
37 onsite ISFSI. Per the Monticello ER, the ISFSI will exhaust its current state-approved spent
38 nuclear fuel dry storage capacity in 2030 and will need to be expanded prior to the SLR period
39 of extended operation. The needed dry storage capacity would involve construction of a second
40 pad within the ISFSI fenced area. This expansion is within the boundary of the existing ISFSI
41 footprint. The State of Minnesota approved the request for a Certificate of Need to place up to
42 15 additional canisters on a second pad. Beyond 2040, Xcel Energy would need to seek
43 additional Certificates of Need to place additional canisters on the second storage pad. (Xcel
44 2023-TN9084).

1 The EPA regulations at 40 CFR Part 190 (TN739) limit the dose to members of the public from
2 all sources in the nuclear fuel cycle, including nuclear power plants, fuel fabrication facilities,
3 waste disposal facilities, and transportation of fuel and waste. As discussed in Section 3.13 in
4 this EIS, Xcel Energy has a radiological environmental monitoring program that measures
5 radiation and radioactive materials in the environment from Monticello, its ISFSI, and all other
6 sources. The NRC staff reviewed the radiological effluent and environmental monitoring reports
7 for the five-year period from 2018 through 2022 as part of this cumulative impacts assessment
8 (Xcel 2023-TN9596, Xcel 2022-TN9595, Xcel 2021-TN9597, Xcel 2020-TN9598, Xcel 2019-
9 TN9599, Xcel 2023-TN9615, Xcel 2022-TN9614, Xcel 2021-TN9613, Xcel 2020-TN9612, Xcel
10 2019-TN9621). The NRC staff's review of Xcel Energy's data showed no indication of an
11 adverse trend in radioactivity levels in the environment from either Monticello or the ISFSI. The
12 data showed that there was no measurable impact on the environment from operations at
13 Monticello.

14 Based on this information, there would be no significant cumulative radiological effect on human
15 health resulting from the proposed action (SLR), in combination with the cumulative effects from
16 other sources. This conclusion is based on the NRC staff's review of radiological environmental
17 monitoring program data, radioactive effluent release data, and worker dose data; the
18 expectation that Monticello would continue to comply with Federal radiation protection standards
19 during the period of extended operation; continued NRC oversight of plant emissions and
20 activities, and the continued regulation of any future development or actions in the vicinity of
21 Monticello by the State of Minnesota.

22 **3.15.5 Environmental Justice**

23 This cumulative impact analysis evaluates the potential for disproportionate and adverse human
24 health and environmental effects on minority and low-income populations that could result from
25 past, present, and reasonably foreseeable future actions, including the continued operational
26 effects of Monticello during the SLR term. Everyone living near Monticello, including minority
27 and low-income populations, currently experience its operational effects. The NRC addresses
28 environmental justice by identifying the location of minority and low-income populations and
29 determining whether there would be any potential human health or environmental effects and
30 whether any of the effects may be disproportionate and adverse to these populations.

31 Adverse health effects are measured in terms of the risk and rate of fatal or nonfatal adverse
32 impacts on human health. Disproportionate and adverse human health effects occur when the
33 risk or rate of exposure to an environmental hazard for a minority or low-income population
34 exceeds the risk or exposure rate for the general population or for another appropriate
35 comparison group. Disproportionate environmental effects refer to impacts or risks of impacts in
36 the natural or physical environment in a minority or low-income community that appreciably
37 exceed the environmental impact on the larger community. Such effects may include biological,
38 cultural, economic, or social impacts. Some of these potential effects have been identified in
39 resource areas presented in preceding sections of this chapter. As previously discussed in this
40 chapter, the SLR impacts for all resource areas (e.g., land, air, water, and human health) would
41 be SMALL.

42 As discussed in Section 3.11 of this EIS, there would be no disproportionate and adverse
43 human health and environmental effects on minority and low-income populations from the
44 continued operation of Monticello during the SLR term. Because Xcel Energy has no plans to
45 hire additional workers during the SLR term, employment levels at Monticello would remain
46 unchanged, and there would be no additional demand for housing or increase in traffic. Based

1 on this information and the analysis of human health and environmental effects, it is not likely
2 that there would be any disproportionate and adverse contributory effects on minority and low-
3 income populations from the continued operation of Monticello during the SLR term beyond
4 what is already being experienced. Therefore, the only contributory effects would come from
5 reasonably foreseeable future planned activities at Monticello, and other reasonably foreseeable
6 future offsite activities that are not related to the proposed action (SLR).

7 When combined with past, present, and reasonably foreseeable future activities, the proposed
8 action (SLR) would not likely cause disproportionate and adverse human health and
9 environmental effects on minority and low-income populations near Monticello.

10 **3.15.6 Waste Management and Pollution Prevention**

11 This section considers the incremental waste management impacts of the SLR term when
12 added to the contributory effects of other past, present, and reasonably foreseeable future
13 actions. In Section 3.13.3, "Proposed Action," the potential waste management impacts from
14 continued operations at Monticello during the SLR term would be SMALL.

15 As discussed in Sections 3.13.1 and 3.13.2, Xcel Energy maintains waste management
16 programs for radioactive and nonradioactive waste generated at Monticello and is required to
17 comply with Federal and State permits and other regulatory waste management requirements.
18 All industrial facilities, including nuclear power plants and other facilities within a 50 mi (80 km)
19 radius of Monticello, are also required to comply with appropriate NRC, EPA, and State
20 requirements for the management of radioactive and nonradioactive waste. Current waste
21 management activities at Monticello would likely remain unchanged during the SLR term, except
22 for the possibility of including tritium gaseous releases from the remediation pond as an
23 additional effluent point, see Section 3.13.1.2. Furthermore, the NRC staff expects that
24 Monticello will continue to comply with Federal and State requirements for radioactive and
25 nonradioactive waste.

26 Therefore, the proposed action, including continued radioactive and nonradioactive waste
27 generation during the SLR term, would have no cumulative effect beyond what is already being
28 experienced. This is based on Monticello's expected continued compliance with Federal and
29 State of Minnesota requirements for radioactive and nonradioactive waste management and the
30 expected regulatory compliance of other waste producers in the area.

31 **3.16 Resource Commitments Associated with the Proposed Action**

32 This section describes the NRC's consideration of potentially unavoidable adverse
33 environmental impacts that could result from implementation of the proposed action and
34 alternatives, the relationship between short-term uses of the environment and maintenance and
35 enhancement of long-term productivity, and the irreversible and irretrievable commitments of
36 resources.

37 **3.16.1 Unavoidable Adverse Environmental Impacts**

38 Unavoidable adverse environmental impacts are impacts that would occur after implementation
39 of all workable mitigation measures. Carrying out any of the replacement energy alternatives
40 considered in this EIS, including the proposed action, would result in some unavoidable adverse
41 environmental impacts.

1 Minor unavoidable adverse impacts on air quality would occur because of the emission and
2 release of various chemical and radiological constituents from nuclear power plant operations.
3 Nonradiological emissions resulting from nuclear power plant operations are expected to comply
4 with Federal EPA and State emissions standards. Chemical and radiological emissions would
5 not exceed the national emission standards for hazardous air pollutants.

6 Continued nuclear power plant operation would result in industrial wastewater discharges to the
7 Mississippi River containing small amounts of water treatment chemical additives and other
8 pollutants. Discharges are expected to comply with limits set in the NPDES permit.

9 During nuclear power plant operations, workers and members of the public would face
10 unavoidable exposure to low levels of radiation as well as hazardous and toxic chemicals.
11 Workers would be exposed to radiation and chemicals associated with routine nuclear power
12 plant operations and the handling of nuclear fuel and waste material. Workers would have
13 higher levels of exposure than members of the public, but doses would be administratively
14 controlled and would not exceed regulatory standards or administrative control limits. In
15 comparison, alternatives involving construction and operation of a nonnuclear power generating
16 facility also would result in unavoidable exposure to hazardous and toxic chemicals for workers
17 and the public.

18 Generation of spent nuclear fuel and waste material, including low-level radioactive waste,
19 hazardous waste, and nonhazardous waste, would be unavoidable. Hazardous and
20 nonhazardous wastes would be generated at some nonnuclear power generating facilities.
21 Wastes generated during nuclear power plant operations would be collected, stored, and
22 shipped for suitable treatment, recycling, or disposal in accordance with applicable Federal and
23 State regulations. Because of the costs of handling these materials, the NRC staff expects that
24 nuclear power plant operators would optimize all waste management activities and operations in
25 a way that generates the smallest possible amount of waste.

26 **3.16.2 Relationship between Short-Term Use of the Environment and Long-Term** 27 **Productivity**

28 The operation of power generating facilities would result in short-term uses of the environment,
29 as described in sections titled, "Proposed Action," "No-Action," and "Replacement Power
30 Alternatives: Common Impacts"). "Short term" is defined as the time period over which
31 continued power generating activities occurs.

32 Nuclear power plant operations require short-term use of the environment and commitment
33 of resources (e.g., land and energy), indefinitely or permanently. Certain short-term resource
34 commitments are substantially greater under most energy alternatives, including SLR, than
35 under the no-action alternative because of the continued generation of electrical power and the
36 continued use of generating sites and associated infrastructure. During operations, all energy
37 alternatives require similar relationships to be sustained between local short-term uses of the
38 environment and the maintenance and enhancement of long-term productivity.

39 Air emissions from nuclear power plant operations introduce small amounts of radiological and
40 nonradiological materials to the region around the nuclear power plant site. Over time, these
41 emissions would result in increased concentrations and exposures, but the NRC staff does not
42 expect that these emissions would affect air quality or radiation exposure to the extent that
43 public health and long-term productivity of the environment would be impaired.

1 Continued employment, expenditures, and tax revenues generated during nuclear power plant
2 operations directly benefit local, regional, and State economies over the short term. Local
3 governments that invest project-generated tax revenues into infrastructure and other required
4 services could enhance economic productivity over the long term.

5 The management and disposal of spent nuclear fuel, low-level radioactive waste, hazardous
6 waste, and nonhazardous waste require an increase in energy and consume space at
7 treatment, storage, or disposal facilities. Regardless of the location, the use of land to meet
8 waste disposal needs would reduce the long-term productivity of the land.

9 Nuclear power plant facilities are committed to electricity production over the short term. After
10 these facilities are decommissioned and the area restored, the land could be available for other
11 future productive uses.

12 **3.16.3 Irreversible and Irretrievable Commitment of Resources**

13 Resource commitments are irreversible when primary or secondary impacts limit the future
14 options for a resource. For example, consumption or loss of nonrenewable resources is
15 irreversible. An irretrievable commitment refers to the use or consumption of resources for a
16 period (e.g., for the duration of the action under consideration) that is neither renewable nor
17 recoverable for future use. Irreversible and irretrievable commitments of resources for electrical
18 power generation include the commitment of land, water, energy, raw materials, and other
19 natural and human-made resources required for power plant operations. In general,
20 commitments of capital, energy, labor, and material resources are also irreversible.

21 Implementation of any of the replacement energy alternatives considered in this site-specific
22 EIS would entail the irreversible and irretrievable commitments of energy, water, chemicals,
23 minerals, and—in some cases—fossil fuels. These resources would be committed during the
24 SLR term and during the entire life cycle of the nuclear power plant, and they would be
25 unrecoverable.

26 Energy expended would be in the form of fuel for equipment, vehicles, and nuclear power plant
27 operations and electricity for equipment and facility operations. Electricity and fuel would be
28 purchased from offsite commercial sources. Water would be obtained from existing water supply
29 systems or withdrawn from surface water or groundwater. Continued nuclear power plant
30 operation would result in continued consumptive water use of Mississippi River water by the
31 plant's cooling system. These resources are readily available, and the NRC staff does not
32 expect that the amounts required would deplete available supplies or exceed available system
33 capacities.

4 CONCLUSION

This site-specific EIS contains the NRC staff's environmental review of Xcel Energy's request to renew the Monticello operating license for an additional 20 years, as required by 10 CFR Part 51 (TN250), "Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions." The regulations in 10 CFR Part 51 implement the National Environmental Policy Act of 1969, as amended (42 U.S.C. 4321 et seq.-TN661). This chapter presents the NRC staff's conclusions regarding the environmental impacts of Monticello SLR, lists and compares the environmental impacts of alternatives to SLR, and presents the NRC staff's preliminary conclusions and recommendation.

4.1 Environmental Impacts of License Renewal

After reviewing the site-specific environmental impacts for all issues in this EIS, the NRC staff has concluded that subsequent license renewal of the Monticello facility operating license would have SMALL environmental impacts for all issues other than groundwater resources, which would have SMALL to MODERATE environmental impacts. The NRC staff considered mitigation measures for each environmental issue, as applicable, and concluded that no additional mitigation measure is warranted.

4.2 Comparison of Alternatives

In Section 3 of this EIS, the NRC considered the following alternatives to renewing the Monticello facility operating license:

- no-action
- natural gas and renewables
- renewables and storage
- new nuclear (SMR)

Based on the review presented in this draft EIS, the NRC staff concludes that the environmentally preferred alternative is the proposed SLR action. The NRC staff recommends approving the subsequent license renewal of the Monticello facility operating license. As shown Table 2-1, all other replacement power-generation alternatives have environmental impacts that are greater than SLR, in addition to the environmental impacts inherent to new construction. To make up for the lost power generation in case the NRC does not renew the Monticello facility operating license (i.e., the no-action alternative), energy decisionmakers may implement one of the replacement energy-generating alternatives discussed in Section 2, or a comparable combination alternative capable of replacing the power generated by Monticello.

4.3 Recommendation

The NRC staff's preliminary recommendation is that the adverse environmental impacts of SLR are not so great that preserving the option of continued reactor operations for energy-planning decisionmakers would be unreasonable. This preliminary recommendation is based on the following:

- Xcel Energy's environmental report
- consultation with Federal, State, Tribal, and local governmental agencies
- the NRC staff's independent environmental review
- the consideration of public comments received during the scoping process

5 REFERENCES

- 1
- 2 10 CFR Part 20. *Code of Federal Regulations*, Title 10, *Energy*, Part 20, "Standards for
3 Protection Against Radiation." TN283.
- 4 10 CFR Part 50. *Code of Federal Regulations*, Title 10, *Energy*, Part 50, "Domestic Licensing of
5 Production and Utilization Facilities." TN249.
- 6 10 CFR Part 51. *Code of Federal Regulations*, Title 10, *Energy*, Part 51, "Environmental
7 Protection Regulations for Domestic Licensing and Related Regulatory Functions." TN250.
- 8 10 CFR Part 54. *Code of Federal Regulations*, Title 10, *Energy*, Part 54, "Requirements for
9 Renewal of Operating Licenses for Nuclear Power Plants." TN4878.
- 10 10 CFR Part 72. *Code of Federal Regulations*, Title 10, *Energy*, Part 72, "Licensing
11 Requirements for the Independent Storage of Spent Nuclear Fuel, High-Level Radioactive
12 Waste, and Reactor-Related Greater than Class C Waste." TN4884.
- 13 10 CFR Part 100. *Code of Federal Regulations*, Title 10, *Energy*, Part 100, "Reactor Site
14 Criteria." TN282.
- 15 15 CFR Part 930. *Code of Federal Regulations*, Title 15, *Commerce and Foreign Trade*, Part
16 930, "Federal Consistency with Approved Coastal Management Programs." TN4475.
- 17 18 CFR Part 157. *Code of Federal Regulations*, Title 18, *Conservation of Power and Water
18 Resources*, Part 157, "Applications for Certificates of Public Convenience and Necessity and for
19 Orders Permitting and Approving Abandonment Under Section of the Natural Gas Act." TN7483.
- 20 36 CFR Part 60. *Code of Federal Regulations*, Title 36, *Parks, Forests, and Public Property*,
21 Part 60, "National Register of Historic Places." TN1682.
- 22 36 CFR Part 800. *Code of Federal Regulations*, Title 36, *Parks, Forests, and Public Property*,
23 Part 800, "Protection of Historic Properties." TN513.
- 24 40 CFR Part 50. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 50,
25 "National Primary and Secondary Ambient Air Quality Standards." TN1089.
- 26 40 CFR Part 51. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 51,
27 "Requirements for Preparation, Adoption, and Submittal of Implementation Plans." TN1090.
- 28 40 CFR Part 81. *Code of Federal Regulations*, Title 40, *Air Programs*, Subchapter C, *Protection
29 of Environment*, Part 81, "Designation of Areas for Air Quality Planning Purposes." TN7226.
- 30 40 CFR Part 110. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 110,
31 "Discharge of Oil." TN8485.
- 32 40 CFR Part 112. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 112,
33 "Oil Pollution Prevention." TN1041.

1 40 CFR Part 122. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 122,
2 “EPA Administered Permit Programs: The National Pollutant Discharge Elimination System.”
3 TN2769.

4 40 CFR Part 125. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 125,
5 “Criteria and Standards for the National Pollutant Discharge Elimination System.” TN254.

6 40 CFR Part 129. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 129,
7 “Toxic Pollutant Effluent Standards.” TN6409.

8 40 CFR Part 131. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 131,
9 “Water Quality Standards.” TN4814.

10 40 CFR Part 190. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 190,
11 “Environmental Radiation Protection Standards for Nuclear Power Operations.” TN739.

12 40 CFR Part 1501. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 1501,
13 “NEPA and Agency Planning.” TN4876.

14 50 CFR Part 10. *Code of Federal Regulations*, Title 50, *Wildlife and Fisheries*, Part 10, “National
15 Marine Fisheries Service, National Oceanic and Atmospheric Administration, Department of
16 Commerce.” TN5490.

17 50 CFR Part 402. *Code of Federal Regulations*, Title 50, *Wildlife and Fisheries*, Part 402,
18 “Interagency Cooperation—Endangered Species Act of 1973, as amended.” TN4312.

19 50 CFR Part 600. *Code of Federal Regulations*. Title 50, *Wildlife and Fisheries*, Part 600,
20 “Magnuson-Stevens Act Provisions.” TN1342.

21 32 FR 4001. March 11, 1967. “Native Fish and Wildlife; Endangered Species.” *Federal Register*,
22 Fish and Wildlife Service. TN2750.

23 59 FR 7629. February 16, 1994. “Executive Order 12898 of February 11, 1994: Federal Actions
24 To Address Environmental Justice in Minority Populations and Low-Income Populations.”
25 *Federal Register*, Office of the President. TN1450.

26 64 FR 6183. February 8, 1999. “Executive Order 13112 of February 3, 1999: Invasive Species.”
27 *Federal Register*, Office of the President. TN4477.

28 66 FR 33903. June 26, 2001. “Endangered and Threatened Wildlife and Plants; Establishment
29 of a Nonessential Experimental Population of Whooping Cranes in the Eastern United States.”
30 *Federal Register*, U.S. Fish and Wildlife Service (FWS). TN9652.

31 69 FR 52040. August 24, 2004. “Policy Statement on the Treatment of Environmental Justice
32 Matters in NRC Regulatory and Licensing Actions.” *Federal Register*, Nuclear Regulatory
33 Commission. TN1009.

34 70 FR 39104. July 6, 2005. “Regional Haze Regulations and Guidelines for Best Available
35 Retrofit Technology (BART) Determinations.” *Federal Register*, Environmental Protection
36 Agency. TN8374.

1 74 FR 66496. December 15, 2009. "Endangerment and Cause or Contribute Findings for
2 Greenhouse Gases Under Section 202(a) of the Clean Air Act." *Federal Register*,
3 Environmental Protection Agency. TN245.

4 75 FR 2565. January 15, 2010. "Northern States Power Company, LLC; Monticello Nuclear
5 Generating Plant Final Environmental Assessment and Finding of No Significant Impact."
6 *Federal Register*, Nuclear Regulatory Commission. TN9617.

7 79 FR 48300. August 15, 2014. "National Pollutant Discharge Elimination System—Final
8 Regulations to Establish Requirements for Cooling Water Intake Structures at Existing Facilities
9 and Amend Requirements at Phase I Facilities." *Federal Register*, Environmental Protection
10 Agency. TN4488.

11 79 FR 56238. September 19, 2014. "Continued Storage of Spent Nuclear Fuel." Final Rule,
12 *Federal Register*, Nuclear Regulatory Commission. TN4104.

13 80 FR 17974. April 2, 2015. "Endangered and Threatened Wildlife and Plants; Threatened
14 Species Status for the Northern Long-Eared Bat With 4(d) Rule—Final Rule and Interim Rule
15 with Request for Comments." *Federal Register*, Fish and Wildlife Service. TN4216.

16 81 FR 24707. April 27, 2016. "Endangered and Threatened Wildlife and Plants; Determination
17 that designation of Critical Habitat is not prudent for the Northern Long-Eared Bat." *Federal*
18 *Register*, Fish and Wildlife Service. TN8388.

19 81 FR 88609. December 8, 2016. "Safeguarding the Nation from the Impacts of Invasive
20 Species." Executive Order 13751. *Federal Register*, Office of the President. TN8375.

21 85 FR 81813. December 17, 2020. "Endangered and Threatened Wildlife and Plants: 12-Month
22 Finding for the Monarch Butterfly." *Federal Register*, Fish and Wildlife Service. TN8590.

23 87 FR 26152. May 3, 2022. "Endangered and Threatened Wildlife and Plants; Review of
24 Species that are Candidates for Listing as Endangered or Threatened; Annual Notification of
25 Findings on Resubmitted Petitions; Annual Description of Progress on Listing Actions." *Federal*
26 *Register*, Fish and Wildlife Service. TN8591.

27 87 FR 56381. September 14, 2022. "Endangered and Threatened Wildlife and Plants;
28 Endangered Species Status for Tricolored Bat." *Federal Register*, U.S. Fish and Wildlife
29 Service. TN8546.

30 87 FR 73488. November 30, 2022. "Endangered and Threatened Wildlife and Plants;
31 Endangered Species Status for Northern Long-Eared Bat." *Federal Register*, U.S. Fish and
32 Wildlife Service. TN8545.

33 88 FR 6327. January 31, 2023. "Northern States Power Company— Minnesota; Xcel Energy;
34 Monticello Nuclear Generating Plant, Unit 1." *Federal Register*, Nuclear Regulatory
35 Commission. TN9713.

36 88 FR 13474. March 3, 2023. "Northern States Power Company— Minnesota; Xcel Energy;
37 Monticello Nuclear Generating Plant, Unit 1." *Federal Register*, Nuclear Regulatory
38 Commission. TN9714.

- 1 88 FR 15103. March 10, 2023. "Notice of Intent To Conduct Scoping Process and Prepare
2 Environmental Impact Statement; Northern States Power Company—Minnesota; Monticello
3 Nuclear Generating Plant, Unit 1." *Federal Register*, Nuclear Regulatory Commission. TN9715.
- 4 42 U.S.C. § 4332. National Environmental Policy Act (NEPA) of 1969, Section 102,
5 "Cooperation of Agencies; Reports; Availability of Information; Recommendations; International
6 and National Coordination of Efforts." TN4880.
- 7 Adam-Guillermin, C., T. Hortal-Aas, D. Oughton, L. Blanchard, F. Alonzo, O. Armant, and N.
8 Horemans. 2018. "Radiosensitivity and transgenerational effects in non-human species." *Annals
9 of the ICRP* 47(3-4):327-341. <https://doi.org/10.1177/0146645318756844>. TN7972.
- 10 Albin, D.R. and L.B. Bruemmer. 1987. *Minnesota Ground-Water Quality*. 87-0733, U.S.
11 Geological Surveys, Washington, D.C. TN9643.
- 12 Allison, T.D., J.E. Diffendorfer, E.F. Baerwald, J.A. Beston, D. Drake, A.M. Hale, C.D. Hein,
13 M.M. Huso, S.R. Loss, J.E. Lovich, M.D. Strickland, K.A. Williams, and V.L. Winder. 2019.
14 "Impacts to Wildlife of Wind Energy Siting and Operation in the United States." Ecological
15 Society of America, *Issues in Ecology*, Report No. 21, Washington, D.C. TN8847.
- 16 Altena, E. 2008. *Mississippi River Creel Survey from St. Cloud to Coon Rapids May 12 to
17 September 30, 2007 Completion Report*. F-29-R(P)-27, Minnesota Department of Natural
18 Resources Division of Fisheries and Wildlife, St. Paul, Minnesota. TN9350.
- 19 Amish, R.A., V.R. Kranz, B.D. Lorenz, D.B. Wilcox, L.K. Davis, and B.B. Owen, Jr. 1978.
20 *Section 316(b) Demonstration for the Monticello Nuclear Generating Plant on the Mississippi
21 River at Monticello, Minnesota (NPDES Permit No: MN 0000868)*. Minneapolis, Minnesota.
22 ADAMs Accession No. ML052010548. TN9580.
- 23 APLIC (Avian Power Line Interaction Committee). 2012. *Reducing Avian Collisions with Power
24 Lines: The State of the Art in 2012*. Edison Electric Institute, Washington, D.C. Accessed
25 November 23, 2020, at
26 https://www.aplic.org/uploads/files/15518/Reducing_Avian_Collisions_2012watermarkLR.pdf.
27 TN6779.
- 28 Army (U.S. Army). 2014. *Biological Assessment on the Proposed Activities on Fort Drum
29 Military Installation, Fort Drum, New York (2015-2017) for the Indiana Bat (*Myotis sodalis*) and
30 Northern Long-Eared Bat (*Myotis septentrionalis*)*. Fort Drum, New York. TN8512.
- 31 Artz, J.A., E.L. Bristow, and W.E. Whittaker. 1976. *Mapping Precontact Burial Mounds in
32 Sixteen Minnesota Counties using Light Detection and Ranging (LiDAR)*. Office of the State
33 Archaeologist, the University of Iowa, Iowa City, Iowa. TN9667.
- 34 Atomic Energy Act of 1954. 42 U.S.C. § 2011 et seq. Public Law 112-239, as amended. TN663.
- 35 Bagar, T.A., M.L. Hladik, and J.C. Daniels. 2020. "Uptake and toxicity of clothianidin to monarch
36 butterflies from milkweed consumption." *Peer J* 8:e8669, Bethesda, Maryland. TN8594.
- 37 Bald and Golden Eagle Protection Act. 16 U.S.C. § 668-668d et seq. TN1447.

- 1 Barkley, S.W., and C. Perrin. 1971. "The Effects of the Lake Catherine Steam Electric Plant
2 Effluent on the Distribution of Fishes in the Receiving Embayment." In *Proceedings of the*
3 *Twenty-Fifth Annual Conference of the Southeastern Association of Game and Fish*
4 *Commissioners*, Columbia, South Carolina. Accessed June 13, 2022, at
5 <https://seafwa.org/sites/default/files/journal-articles/BARKLEY-384.pdf>. TN7734.
- 6 Barry, J.D. 2018. *Geologic Atlas of Wright County, Minnesota: County Atlas Series C-30, Part B,*
7 *Hydrogeology Report*. Minnesota Department of Natural Resources, St. Paul, Minnesota.
8 TN9638.
- 9 Bevanger, K. 1994. "Bird interactions with utility structures: collision and electrocution, causes
10 and mitigating measures." *IBIS: International journal of Avian Science* 136(4):412-425, Farcet,
11 Cambridgeshire, England. TN9619.
- 12 BLM (Bureau of Land Management). 2010. *North Steens 230-kV Transmission Line Project*
13 *Draft Environmental Impact Statement*. DOI-BLM-OR-B060-2010-0035-EIS, Bureau of Land
14 Management, Hines, Oregon. TN9626.
- 15 BLM (Bureau of Land Management). 2013. *Final Environmental Impact Statement for the*
16 *Mohave County Wind Farm Project (Volume 1)*. BLM/AZ/PL-13/003, Washington, D.C. TN8882.
- 17 BLM (Bureau of Land Management). 2019. *Gemini Solar Project, Final Resource Management*
18 *Plan Amendment and Environmental Impact Statement, Volume 1: Chapters 1 – 4*. DOI-BLM-
19 NV-S010-2018-0051-EIS, Washington D.C. TN8386.
- 20 BLS (U.S. Bureau of Labor Statistics). 2021. "Injuries, Illnesses, and Fatalities: Table 2.
21 Numbers of nonfatal occupational injuries and illnesses by industry and case types, 2020
22 [thousands]." Washington, D.C. Accessed June 12, 2022, at
23 https://www.bls.gov/iif/oshwc/osh/os/summ2_00_2020.htm. TN7691.
- 24 BOEM (Bureau of Ocean Energy Management). Undated. "Renewable Energy on the Outer
25 Continental Shelf: Ocean Wave Energy." Washington, D.C. Accessed June 12, 2022, at
26 [https://www.boem.gov/Renewable-Energy-Program/Renewable-Energy-Guide/Ocean-Wave-](https://www.boem.gov/Renewable-Energy-Program/Renewable-Energy-Guide/Ocean-Wave-Energy.aspx)
27 [Energy.aspx](https://www.boem.gov/Renewable-Energy-Program/Renewable-Energy-Guide/Ocean-Wave-Energy.aspx). TN7696.
- 28 Buhta, A.A., J.L. Hofman, E. C. Grimm, R.D. Mandel, and L.A. Hannus. 2011. *Investigating the*
29 *Earliest Human Occupation of Minnesota: A Multidisciplinary Approach to Modeling Landform*
30 *Suitability & Site Distribution Probability for the State's Early Paleoindian Resources*.
31 Archeology Laboratory Augustana College, Sioux Falls, South Dakota. TN9656.
- 32 Buhta, A.A., S.F. Anfinson, E. C. Grimm, and L.A. Hannus. 2017. *Minnesota's Archaic Tradition:*
33 *An Archeological and Paleoenvironmental Overview and Assessment*. Archeology Laboratory
34 Augustana College, Sioux Falls, South Dakota. TN9658.
- 35 Cada, G.F., J.A. Solomon, and J.M. Loar. 1981. *Effects of Sublethal Entrainment Stresses on*
36 *the Vulnerability of Juvenile Bluegill Sunfish to Predation*. ORNL/TM-7801. Oak Ridge National
37 Laboratory, Oak Ridge, Tennessee. Accessed June 13, 2022, at
38 <https://www.osti.gov/servlets/purl/6484168>. TN7733.

1 Carter, T.C., and G.A. Feldhamer. 2005. "Roost tree use by maternity colonies of Indiana bats
2 and northern long-eared bats in southern Illinois." *Forest Ecology and Management* 219(2-
3 3):259-268. TN8501.

4 CEQ (Council on Environmental Quality). 1997. *Environmental Justice Guidance under the*
5 *National Environmental Policy Act*. Washington D.C. ADAMS Accession No. ML103430030.
6 TN452.

7 Certrec. 2009. "Event Notification Detail, Notification Date September 10, 2009, Event Number:
8 45338." Fort Worth, Texas. TN9840.

9 City of Monticello. 2022. *Annual Comprehensive Financial Report for the Year Ended December*
10 *31, 2022*. Monticello, Minnesota. TN9838.

11 Clean Air Act. 42 U.S.C. § 7401 *et seq.* TN1141.

12 CLO (The Cornell Lab of Ornithology). 2023. "eBird." Ithaca, New York. Available at
13 <https://ebird.org/home>. TN9654.

14 Coastal Zone Management Act of 1972. 16 U.S.C. § 1451 *et seq.* TN1243.

15 Coutant, C.C. 1987. "Thermal Preference: When Does an Asset Become a Liability?"
16 *Environmental Biology of Fishes* 18(3):161–72. DOI:10.1007/BF00000356. Cham, Switzerland.
17 Accessed June 13, 2022, at <https://doi.org/10.1007/BF00000356>. TN7736.

18 Crawford, R.L., and W.W. Baker. 1981. "Bats Killed at a North Florida Television Tower: A 25-
19 Year Record." *Journal of Mammalogy* 62(3):651-652. TN8506.

20 Cummings, J. Undated. *Petaga Point Archaeological Site*. Mille Lacs Kathio State Park,
21 Onamia, Minnesota. Available at
22 https://files.dnr.state.mn.us/publications/state_parks/petaga_point.pdf. TN9659.

23 Diaz, R.J. 1994. "Response of Tidal Freshwater Macrobenthos to Sediment Disturbance."
24 *Hydrobiologia* 278:201-212. DOI:10.1007/BF00142328. Cham, Switzerland. Accessed June 14,
25 2022, at <https://doi.org/10.1007/BF00142328>. TN7773.

26 Dieter, C.A., K.S Linsey, R.R. Caldwell, M.A. Harris, T.I. Ivahnenko, J.K. Lovelace, M.A.
27 Maupin, and N.L. Barber. 2018. "Estimated Use of Water in the United States County-Level
28 Data for 2015 (Ver. 2.0; June 2018)." Washington, D.C. Accessed January 16, 2024, at
29 <https://www.sciencebase.gov/catalog/item/get/5af3311be4b0da30c1b245d8>. TN9686.

30 Dieter, C.A., M.A. Maupin, R.R. Caldwell, M.A. Harris, T.I. Ivahnenko, J.K. Lovelace, N.L.
31 Barber, and K.S. Linsey. 2018. *Estimated Use of Water in the United States in 2015*. USGS
32 Circular 1441, U.S. Geological Survey, Reston, Virginia. Accessed October 19, 2020, at
33 <https://pubs.usgs.gov/circ/1441/circ1441.pdf>. TN6681.

34 DOE (U.S. Department of Energy). 2011. *Final Environmental Impact Statement: Volume 1*
35 *Department of Energy Loan Guarantee to Royal Bank of Scotland for Construction and Startup*
36 *of the Topaz Solar Farm, San Luis Obispo County, California*. DOE/EIS-0458, Washington, D.C.
37 TN8387.

1 DOE (U.S. Department of Energy). 2015. *Wind Vision: A New Era for Wind Power in the United*
2 *States*. Washington, D.C. TN8757.

3 DOE (U.S. Department of Energy). 2019. *A Graded Approach for Evaluating Radiation Doses to*
4 *Aquatic and Terrestrial Biota*. DOE-STD-1153-2019, Washington, D.C. Available at
5 https://www.standards.doe.gov/standards-documents/1100/1153-astd-2019/@_@images/file.
6 TN6817.

7 DOE (U.S. Department of Energy). 2021. *Hydrogen Shot: An Introduction*. Office of Energy
8 Efficiency and Renewable Energy, Hydrogen and Fuel Cells Technology Office. Washington,
9 D.C. Accessed June 12, 2022, at [https://www.energy.gov/eere/fuelcells/articles/hydrogen-shot-](https://www.energy.gov/eere/fuelcells/articles/hydrogen-shot-introduction)
10 [introduction](https://www.energy.gov/eere/fuelcells/articles/hydrogen-shot-introduction). TN7693.

11 DOE (U.S. Department of Energy). Undated. "Fuel Cell Basics: Hydrogen and Fuel Cell
12 Technologies Office." Washington, D.C. Accessed June 12, 2022, at
13 <https://www.energy.gov/eere/fuelcells/fuel-cell-basics>. TN7695.

14 DOE (U.S. Department of Energy). Undated. "Geothermal Basics: Geothermal." Washington,
15 D.C. Accessed June 12, 2022, at <https://www.energy.gov/eere/geothermal/geothermal-basics>.
16 TN7698.

17 DOE (U.S. Department of Energy). Undated. "Wind Energy State Information." Washington,
18 D.C. Available at <https://windexchange.energy.gov/states>. TN8431.

19 DOE/EIA (U.S. Department of Energy/Energy Information Administration). 2013. *Annual Energy*
20 *Outlook 2013 with Projections to 2040*. DOE/EIA-0383(2013), Washington, D.C. ADAMS
21 Accession No. ML13253A313. TN2590.

22 DOE/EIA (U.S. Department of Energy/Energy Information Administration). 2015. *Annual Energy*
23 *Outlook 2015 with Projections to 2040*. DOE/EIA-0383(2015), Washington, D.C. ADAMS
24 Accession No. ML16172A121. TN4585.

25 DOE/EIA (U.S. Department of Energy/Energy Information Administration). 2021. "Today in
26 Energy: Less Electricity Was Generated by Coal than Nuclear in the United States in 2020."
27 Washington, D.C. Accessed June 12, 2022, at
28 <https://www.eia.gov/todayinenergy/detail.php?id=47196>. TN7718.

29 DOE/EIA (U.S. Department of Energy/Energy Information Administration). 2022. *Cost and*
30 *Performance Characteristics of New Generating Technologies, Annual Energy Outlook 2021*.
31 Washington, D.C. Accessed June 12, 2022, at
32 https://www.eia.gov/outlooks/aeo/assumptions/pdf/table_8.2.pdf. TN7694.

33 DOE/EIA (U.S. Department of Energy/Energy Information Administration). 2022. "North Carolina
34 State Energy Profile." Washington, D.C. Available at
35 <https://www.eia.gov/state/analysis.php?sid=VA>. TN8955.

36 DOE/EIA (U.S. Department of Energy/Energy Information Administration). 2023. *Electric Power*
37 *Monthly with Data for August 2023, Table 6.07.B: Capacity Factors for Utility Scale Generators*
38 *Primarily Using Non-Fossil Fuels*. Washington, D.C. TN8821.

1 DOI (U.S. Department of Interior). 2006. Letter from M. T. Chezick, Regional Environmental
2 Office, to NRC Chief, Rules Review and Directives Branch, dated May 2, 2006, regarding
3 “Monticello Nuclear Plant EIS comments ER 06/73.” Philadelphia, Pennsylvania. ADAMS
4 Accession No. ML061320037. TN9678.

5 Donaldson, M., S. Cooke, D.A. Patterson, and J.S. MacDonald. 2008. “Cold shock and fish.”
6 *Journal of Fish Biology* 73(7):1491-1530. DOI:10.1111/j.1095-8649.2008.02061.x. Hoboken,
7 New Jersey. Accessed June 6, 2022, at <https://doi.org/10.1111/j.1095-8649.2008.02061.x>.
8 TN7515.

9 Duke Energy. 2021. Letter from S.M. Snider, Vice President, Oconee Nuclear Station, to NRC
10 Document Control Desk, dated June 7, 2021, regarding “Duke Energy Carolinas, LLC (Duke
11 Energy) Oconee Nuclear Station (ONS), Units 1, 2, and 3 Docket Numbers 50-269, 50-270, 50-
12 287 Renewed License Numbers DPR-38, DPR-47, DPR-55 Application for Subsequent
13 Renewed Operating Licenses.” Seneca, South Carolina. ADAMS Accession No. ML21158A193.
14 TN8897.

15 EIA (U.S. Energy Information Administration). 2021. “State Electricity Profiles. Table 5. Electric
16 Power Industry Generation by Primary Energy Source, 1990 through 2019.” Washington, D.C.
17 Available at <https://www.eia.gov/electricity/state>. TN8353.

18 EIA (U.S. Energy Information Administration). 2022. “Virginia State Profile and Energy
19 Estimates -Analysis.” Washington, D.C. Available at
20 <https://www.eia.gov/state/analysis.php?sid=VA>. TN8352.

21 EIA (U.S. Energy Information Administration). 2023. “Minnesota, State Profile.” Washington,
22 D.C. Accessed March 1, 2024, at <https://www.eia.gov/state/print.php?sid=MN>. TN9786.

23 Endangered Species Act of 1973. 16 U.S.C. § 1531 *et seq.* TN1010.

24 EPA (U.S. Environmental Protection Agency). 1974. *Information on Levels of Environmental*
25 *Noise Requisite to Protect Public Health and Welfare with an Adequate Margin of Safety.*
26 Washington, D.C. ADAMS Accession No. ML12241A393. TN3941.

27 EPA (U.S. Environmental Protection Agency). 1981. *Noise Effects Handbook: A Desk*
28 *Reference to Health and Welfare, Effects of Noise.* EPA 350/9-82-106. Washington, D.C.
29 TN7412.

30 EPA (U.S. Environmental Protection Agency). 1986. *Quality Criteria for Water.* EPA 440/5-86-
31 001. U.S. Environmental Protection Agency, Office of Water, Washington, D.C. Accessed June
32 13, 2022, at [https://www.epa.gov/sites/default/files/2018-10/documents/quality-criteria-water-](https://www.epa.gov/sites/default/files/2018-10/documents/quality-criteria-water-1986.pdf)
33 [1986.pdf](https://www.epa.gov/sites/default/files/2018-10/documents/quality-criteria-water-1986.pdf). TN7726.

34 EPA (U.S. Environmental Protection Agency). 2004. *The Incidence and Severity of Sediment*
35 *Contamination in Surface Waters of the United States, National Sediment Quality Survey:*
36 *Second Edition.* EPA-823-R-04-007. U.S. Environmental Protection Agency, Office of Science
37 and Technology, Washington, D.C. Accessed June 13, 2022, at
38 <https://archive.epa.gov/water/archive/polwaste/web/pdf/nsqs2ed-complete-2.pdf>. TN7739.

39 EPA (U.S. Environmental Protection Agency). 2009. *Assessment of the Impacts of Global*
40 *Change on Regional U.S. Air Quality: A Synthesis of Climate Change Impacts on Ground-Level*

1 Ozone (*An Interim Report of the U.S. EPA Global Change Research Program*). EPA/600/R-
2 07/094F. Washington, D.C. TN9068.

3 EPA (U.S. Environmental Protection Agency). 2016. *Climate Change Indicators in the United*
4 *States 2016*. Fourth Edition, EPA 430-R-16-004, Washington D.C. Accessed June 7, 2022, at
5 https://www.epa.gov/sites/default/files/2016-08/documents/climate_indicators_2016.pdf.
6 TN7561.

7 EPA (U.S. Environmental Protection Agency). 2020. "2020 County-Level Process Data for
8 Mobile and Nonpoint Emissions, Wright and Sherburne Counties, Minnesota." Washington, D.C.
9 Available at [https://awsedap.epa.gov/public/single/?appid=20230c40-026d-494e-903f-](https://awsedap.epa.gov/public/single/?appid=20230c40-026d-494e-903f-3f112761a208&sheet=5d3fdda7-14bc-4284-a9bb-cfd856b9348d&opt=ctxmenu,currsel)
10 [3f112761a208&sheet=5d3fdda7-14bc-4284-a9bb-cfd856b9348d&opt=ctxmenu,currsel](https://awsedap.epa.gov/public/single/?appid=20230c40-026d-494e-903f-3f112761a208&sheet=5d3fdda7-14bc-4284-a9bb-cfd856b9348d&opt=ctxmenu,currsel).
11 TN9569.

12 EPA (U.S. Environmental Protection Agency). 2020. "Mercury and Air Toxics Standards
13 (MATS)." Washington D.C. Available at <https://www.epa.gov/mats>. TN8379.

14 EPA (U.S. Environmental Protection Agency). 2021. "Climate Change Indicators: U.S. and
15 Global Precipitation." Washington, D.C. Available at [https://www.epa.gov/climate-](https://www.epa.gov/climate-indicators/climate-change-indicators-us-and-global-precipitation)
16 [indicators/climate-change-indicators-us-and-global-precipitation](https://www.epa.gov/climate-indicators/climate-change-indicators-us-and-global-precipitation). TN7420.

17 EPA (U.S. Environmental Protection Agency). 2022. "Aquatic Nuisance Species (ANS)."
18 Washington D.C. Accessed June 6, 2022, at [https://www.epa.gov/vessels-marinas-and-](https://www.epa.gov/vessels-marinas-and-ports/aquatic-nuisance-species-ans)
19 [ports/aquatic-nuisance-species-ans](https://www.epa.gov/vessels-marinas-and-ports/aquatic-nuisance-species-ans). TN7519.

20 EPA (U.S. Environmental Protection Agency). 2023. "Energy Recovery from the Combustion of
21 Municipal Solid Waste (MSW)." Washington, D.C. Available at
22 [https://www.epa.gov/smm/energy-recovery-combustion-municipal-solid-waste-](https://www.epa.gov/smm/energy-recovery-combustion-municipal-solid-waste-msw#EnergyRecovery)
23 [msw#EnergyRecovery](https://www.epa.gov/smm/energy-recovery-combustion-municipal-solid-waste-msw#EnergyRecovery). TN8443.

24 EPA (U.S. Environmental Protection Agency). 2023. "Minnesota Nonattainment/Maintenance
25 Status for Each County by Year for All Criteria Pollutants." Chicago, Illinois. Available at
26 https://www3.epa.gov/airquality/greenbook/anayo_mn.html. TN9567.

27 EPA (U.S. Environmental Protection Agency). 2023. *Sole Source Aquifers near to Monticello,*
28 *MN*. Washington, D.C. TN9841.

29 EPA ECHO (U.S. Environmental Protection Agency Enforcement and Compliance History
30 Online). 2022. "Detailed Facility Report, Xcel Energy - Monticello Generating PLT, FRS ID
31 110002320747." Washington, D.C. Available at [https://echo.epa.gov/detailed-facility-](https://echo.epa.gov/detailed-facility-report?fid=110002320747&ej_type=sup&ej_compare=US)
32 [report?fid=110002320747&ej_type=sup&ej_compare=US](https://echo.epa.gov/detailed-facility-report?fid=110002320747&ej_type=sup&ej_compare=US)>. TN9568.

33 EPRI (Electric Power Research Institute). 2011. *Mapping and Assessment of the United States*
34 *Ocean Wave Energy Resource*. 1024637, EPRI, Palto Alto, California. TN8442.

35 ESRI (Environmental Systems Research Institute, Inc.). 2023. "ArcGIS Rusty Patched Bumble
36 Bee Map." Redlands, California. Available at
37 [https://www.arcgis.com/home/webmap/viewer.html?webmap=2716d871f88042a2a56b8001a1f1](https://www.arcgis.com/home/webmap/viewer.html?webmap=2716d871f88042a2a56b8001a1f1acae&extent=-100.6667%2c29.7389%2c-48.8551%2c50.9676)
38 [acae&extent=-100.6667%2c29.7389%2c-48.8551%2c50.9676](https://www.arcgis.com/home/webmap/viewer.html?webmap=2716d871f88042a2a56b8001a1f1acae&extent=-100.6667%2c29.7389%2c-48.8551%2c50.9676). TN9651.

- 1 Exo, K.M., O. Hüppop, and S. Garthe. 2003. "Birds and offshore windfarms: a hot topic in
2 marine ecology." *Wader Study Group Bulletin*, (100): 50-53. TN8488.
- 3 FAA (Federal Aviation Administration). 2013. "Form 7460-1 for ASN 2013-WTE-8267-OE." Fort
4 Worth, Texas. Accessed on December 21, 2023, at
5 [https://oeaaa.faa.gov/oeaaa/external/searchAction.jsp?action=displayOECASE&oeCaseID=2022](https://oeaaa.faa.gov/oeaaa/external/searchAction.jsp?action=displayOECASE&oeCaseID=202279218&row=0)
6 [79218&row=0](https://oeaaa.faa.gov/oeaaa/external/searchAction.jsp?action=displayOECASE&oeCaseID=202279218&row=0). TN9579.
- 7 Farmland Protection Policy Act of 1981. 7 U.S.C. § 4201 *et seq.* TN708.
- 8 Federal Water Pollution Control Act of 1972 (commonly referred to as the Clean Water Act). 33
9 U.S.C. § 1251 *et seq.* TN662.
- 10 Foster, R.W., and A. Kurta. 1999. "Roosting Ecology of the Northern Bat (*Myotis septentrionalis*)
11 and Comparisons with the Endangered Indiana Bat (*Myotis sodalis*)." *Journal of Mammalogy*
12 80(2):659-672. TN8499.
- 13 FWS (U.S. Fish and Wildlife Service). 2003. "History of Mussel Harvest on the River." Reston,
14 Virginia. ADAMS Accession No. ML052020231. TN9346.
- 15 FWS (U.S. Fish and Wildlife Service). 2007. *Indiana Bat (Myotis sodalis) Draft Recovery Plan:*
16 *First Revision*. Great Lakes-Big Rivers Region, Fort Snelling, Minnesota. ADAMS Accession No.
17 ML14302A612. TN934.
- 18 FWS (U.S. Fish and Wildlife Service). 2009. *Whooping Cranes and Wind Development - An*
19 *Issue Paper*. FWS Regions 2 and 6, Washington, D.C. TN8856.
- 20 FWS (U.S. Fish and Wildlife Service). 2010. Letter from S.E. Pruitt, Field Supervisor, to COL
21 M.J. Bennett, NGB Chief, Environmental Programs Division, dated October 21, 2010, regarding
22 "Programmatic Biological Opinion on the Effects of Ongoing and Future Military and Land
23 Management Activities at the Camp Atterbury Joint Maneuver Training Center in Bartholomew,
24 Brown, and Johnson Counties in Indiana on the Federally Endangered Indiana Bat (*Myotis*
25 *sodalis*)." Bloomington, Indiana. TN8537.
- 26 FWS (U.S. Fish and Wildlife Service). 2014. Letter from F. Clark, Acting Field Supervisor to D.J.
27 Wrona, NRC, dated September 30, 2014, regarding "Threatened and endangered species
28 within the vicinity of the Davis-Besse Nuclear Power Station." Columbus, Ohio. ADAMS
29 Accession No. ML14296A559. TN7605.
- 30 FWS (U.S. Fish and Wildlife Service). 2015. Letter from D.A. Stilwell, Field Supervisor, to D.J.
31 Wrona, Chief Environmental Review and Guidance Update Branch Division of License Renewal
32 Office of Nuclear Reactor Regulation, dated July 14, 2015, regarding "This responds to your
33 July 1, 2015, letter regarding the proposed renewal of Facility Operating Licenses DPR-26 and
34 DPR-64 for an additional 20 years at the Indian Point Nuclear Generating Units 2 and 3 located
35 in the Village of Buchanan, Westchester County, New York." Cortland, New York. ADAMS
36 Accession No. ML15196A013. TN7612.
- 37 FWS (U.S. Fish and Wildlife Service). 2016. *Programmatic Biological Opinion on Final 4(d) Rule*
38 *for the Northern Long-Eared Bat and Activities Excepted from Take Prohibitions*. Midwest
39 Regional Office, Bloomington, Minnesota. TN7400.

- 1 FWS (U.S. Fish and Wildlife Service). 2017. *Guidance for Preparing a Biological Assessment*.
2 Midwest Ecological Services, Bloomington, Minnesota. TN5753.
- 3 FWS (U.S. Fish and Wildlife Service). 2018. Email from A. Ciurej to NRC, dated February 26,
4 2018, regarding “Marsland Section 7 Consultation.” Wood River, Nebraska. ADAMS Accession
5 No. ML18078A057. TN5743.
- 6 FWS (U.S. Fish and Wildlife Service). 2018. Letter from T.R. Chapman, Supervisor, New
7 England Field Office, to B. Beasley, Office of Nuclear Reactor Regulation Division of Materials
8 and License Renewal, dated September 20, 2018, regarding “Seabrook Station Unit 1 License
9 Renewal, Seabrook NH, TAILS: 2018-I-2970.” Concord, New Hampshire. ADAMS Accession
10 No. ML18263A200. TN7610.
- 11 FWS (U.S. Fish and Wildlife Service). 2018. “What is a 10(j) Rule?” Falls Church, Virginia.
12 Available at [https://www.fws.gov/sites/default/files/documents/ESA-section10%28j%29-fact-](https://www.fws.gov/sites/default/files/documents/ESA-section10%28j%29-fact-sheet.pdf)
13 [sheet.pdf](https://www.fws.gov/sites/default/files/documents/ESA-section10%28j%29-fact-sheet.pdf). TN9653.
- 14 FWS (U.S. Fish and Wildlife Service). 2019. *Peach Bottom Atomic Power Station Units 2 and 3*
15 *Subsequent License Renewal*. Project number 2017-0333, State College, Pennsylvania.
16 ADAMS Accession No. ML19247D287. TN9742.
- 17 FWS (U.S. Fish and Wildlife Service). 2019. Letter from Virginia Ecological Services Field
18 Office, dated June 6, 2019, regarding “Updated list of threatened and endangered species that
19 may occur in your proposed project location, and/or may be affected by your proposed project.”
20 Gloucester, Virginia. ADAMS Accession No. ML19157A113. TN7609.
- 21 FWS (U.S. Fish and Wildlife Service). 2020. *Monarch (Danaus plexippus) Species Status*
22 *Assessment (SSA) Version 2.1*. Washington, D.C. TN8593.
- 23 FWS (U.S. Fish and Wildlife Service). 2021. *Birds of Conservation Concern 2021, Migratory*
24 *Bird Program*. Washington, D.C. TN8740.
- 25 FWS (Fish and Wildlife Service). 2021. *Species Status Assessment (SSA) for Tricolored Bat*
26 *(Perimyotis subflavus) Version 1.1*. Fish and Wildlife Service Northeast Region, Hadley,
27 Massachusetts. TN8589.
- 28 FWS (U.S. Fish and Wildlife Service). 2021. Letter from Green Bay Ecological Services Field
29 Office to B. Grange, dated February 9, 2021, regarding “Verification letter for the ‘Point Beach
30 Nuclear Plant, Units 1 and 2, Subsequent License Renewal’ project under the January 5, 2016,
31 Programmatic Biological Opinion on Final 4(d) Rule for the Northern Long-eared Bat and
32 Activities Excepted from Take Prohibitions.” New Franken, Wisconsin. ADAMS Accession No.
33 ML21040A485. TN9740.
- 34 FWS (U.S. Fish and Wildlife Service). 2023. Letter from Fish and Wildlife Service, Minnesota-
35 Wisconsin Ecological Services Field Office, to B. Arlene, dated June 27, 2023, regarding
36 “Federal agency coordination under the Endangered Species Act, Section 7 for ‘Monticello
37 Subsequent License Renewal’.” Bloomington, Minnesota. ADAMS Accession No.
38 ML24016A228. TN9082.
- 39 FWS (U.S. Fish and Wildlife Service). 2023. Letter from Fish and Wildlife Service, Virginia
40 Ecological Services Field Office, dated July 10, 2023, regarding “Federal agency coordination

1 under the Endangered Species Act, Section 7 for 'North Anna Power Station, Units 1 and 2,
2 Subsequent License Renewal'." Gloucester, Virginia. ADAMS Accession No. ML23191A537.
3 TN9093.

4 FWS (U.S. Fish and Wildlife Service). 2023. Letter from Ohio Ecological Services Field Office to
5 B. Arlene, dated October 19, 2023, regarding "Federal agency coordination under the
6 Endangered Species Act, Section 7 for 'Perry Nuclear Power Plant, Unit 1, License Renewal'."
7 Columbus, Ohio. ADAMS Accession No. ML23292A248. TN9741.

8 FWS (U.S. Fish and Wildlife Service). 2023. Letter from Fish and Wildlife Service, Minnesota-
9 Wisconsin Ecological Services Field Office, to Whom It May Concern, dated June 27, 2023,
10 regarding "List of threatened and endangered species that may occur in your proposed project
11 location or may be affected by your proposed project." Bloomington, Minnesota. ADAMS
12 Accession No. ML24016A229. TN9083.

13 FWS (U.S. Fish and Wildlife Service). 2023. "Species Profile for Loggerhead Shrike
14 (*Lanius ludovicianus*)." ECOS- Environmental Conservation Online System, Fort Collins,
15 Colorado. Accessed December 21, 2023, at <https://ecos.fws.gov/ecp/species/8833>. TN9571.

16 FWS (U.S. Fish and Wildlife Service). 2023. "Species Profile for Whooping Crane
17 (*Grus americana*)." ECOS- Environmental Conservation Online System, Fort Collins, Colorado.
18 Accessed September 6, 2023, at <https://ecos.fws.gov/ecp/species/758>. TN8854.

19 FWS (U.S. Fish and Wildlife Service). 2023. Letter from Fish and Wildlife Service,
20 Minnesota-Wisconsin Ecological Services Field Office, to B. Arlene, dated June 27, 2023,
21 regarding "Verification letter for 'Monticello Subsequent License Renewal' for specified
22 threatened and endangered species that may occur in your proposed project location consistent
23 with the Minnesota-Wisconsin Endangered Species Determination Key (Minnesota-Wisconsin
24 DKey)." Bloomington, Minnesota. ADAMS Accession No. ML24016A230. TN9081.

25 FWS (U.S. Fish and Wildlife Service). 2023. "Whooping Crane." Washington, D.C. Accessed
26 September 6, 2023, at <https://www.fws.gov/species/whooping-crane-grus-americana>. TN8857.

27 FWS (U.S. Fish and Wildlife Service). Undated. "3-200-81: Special Purpose- Utility."
28 Washington, D.C. Accessed November 7, 2023, at [https://www.fws.gov/service/3-200-81-
29 special-purpose-utility](https://www.fws.gov/service/3-200-81-special-purpose-utility). TN9282.

30 FWS (U.S. Fish and Wildlife Service). Undated. "Sherburne National Wildlife Refuge." Accessed
31 February 8, 2024, at <https://www.fws.gov/refuge/sherburne/species>. TN9744.

32 FWS and NMFS (U.S. Fish and Wildlife Service and National Marine Fisheries Service). 1998.
33 *Endangered Species Act Consultation Handbook, Procedures for Conducting Section 7*
34 *Consultation and Conference*. Washington, D.C. ADAMS Accession No. ML14171A801.
35 TN1031.

36 GEP (Google Earth Pro). 2024. "Imagery of Xcel Energy Monticello Nuclear Generating Plant,
37 2017 and 2023." Mountain View, California. Accessed April 2, 2024, at
38 <https://www.google.com/earth/about/versions/#download-pro>. TN9858.

39 Godfry, A. 1993. *A Social History of the Mille Lacs Ojibwe 1640-1993: Non-Removable and Self*
40 *Determined*. La Crosse, Wisconsin. TN9660.

- 1 Good Company. 2011. *Health and Safety Concerns of Photovoltaic Solar Panels*. Eugene,
2 Oregon. TN8599.
- 3 Gray, R.H., T.L. Page, and M.G. Saroglia. 1983. "Behavioral Response of Carp, *Cyprinus*
4 *carpio*, and Black Bullhead, *Ictalurus melas*, from Italy to Gas Supersaturated Water."
5 *Environmental Biology of Fishes* 8:163-167. DOI:10.1007/BF00005183. Cham, Switzerland.
6 Accessed June 13, 2022, at <https://doi.org/10.1007/BF00005183>. TN7727.
- 7 Harrison, F.L. 1985. "Effect of Physiochemical Form on Copper Availability to Aquatic
8 Organisms." In *Aquatic Toxicology and Hazard Assessment: Seventh Symposium*. ASTM STP
9 854, pages 469-484. R.C. Bahner, ed. American Society for Testing and Materials, Philadelphia,
10 Pennsylvania. DOI: 10.1520/STP36284S. TN7579.
- 11 Hatch, J.T., K.P. Schmidt, D.P. Siems, J.C. Underhill, and R.A. Bellig. 2003. "A New
12 Distributional Checklist of Minnesota Fishes, with Comments on Historical Occurrence." *Journal*
13 *of the Minnesota Academy of Science* 67 (1):1-17, Morris, Minnesota. TN9330.
- 14 Hathcock, C. 2019. *Literature review on impacts to avian species from solar energy collection*
15 *and suggested mitigations*. Department of Energy. TN8470.
- 16 Horvath, G., G. Kriska, and B. Robertson. 2009. "Polarized Light Pollution: A New Kind of
17 Ecological Photopollution." *Frontiers in Ecology and the Environment* 7(6):317-325,
18 Washington, D.C. TN897.
- 19 IAEA (International Atomic Energy Agency). 1992. *Effects of Ionizing Radiation on Plants and*
20 *Animals at Levels Implied by Current Radiation Protection Standards*. Technical Report Series
21 332, Vienna, Austria. TN712.
- 22 ICNIRP (International Commission on Non-Ionizing Radiation Protection). 1998. "Guidelines for
23 Limiting Exposure to Time-Varying Electric, Magnetic, and Electromagnetic Fields (up to 300
24 GHz)." *Health Physics* 74 (4): 494-522, Philadelphia, Pennsylvania. Accessed October 7, 2020,
25 at <https://www.icnirp.org/cms/upload/publications/ICNIRPemfgdl.pdf>. TN6591.
- 26 ICRP (International Commission on Radiological Protection). 2007. "The 2007
27 Recommendations of the International Commission on Radiological Protection." ICRP
28 Publication 103, *Ann. ICRP*, 37(2-4). Amsterdam, The Netherlands. Elsevier. Available at
29 http://journals.sagepub.com/doi/pdf/10.1177/ANIB_37_2-4. TN422.
- 30 ICRP (International Commission on Radiological Protection). 2008. "Environmental Protection -
31 the Concept and Use of Reference Animals and Plants." ICRP Publication 108. *Annals of the*
32 *ICRP* 38(4-6). Ottawa, Canada. Accessed June 7, 2022, at
33 <https://www.icrp.org/publication.asp?id=icrp%20publication%20108>. TN7530
- 34 ICRP (International Commission on Radiological Protection). 2009. "Environmental Protection:
35 Transfer Parameters for Reference Animals and Plants." ICRP Publication 114. *Annals of the*
36 *ICRP* 39(6). DOI: 10.1016/j.icrp.2011.08.009. Ottawa, Canada. Accessed June 7, 2022, at
37 <https://dx.doi.org/10.1016/j.icrp.2011.08.009>. TN7531.
- 38 IEA (International Energy Agency). 2007. *Biomass for Power Generation and CHP*. ETE03, IEA
39 Energy Technology Essentials, License CC BY 4.0. Paris, France. TN8436.

- 1 IMA (Iron Mining Association of Minnesota). 2021. "Mining Companies." Accessed October 2,
2 2023, at <https://www.taconite.org/mining-industry/mines>. TN9086.
- 3 iNaturalist. 2023. "Minnesota Observations." San Francisco, California. Available at
4 https://www.inaturalist.org/observations?place_id=38&subview=map&taxon_id=47906. TN9655.
- 5 IPCC (Intergovernmental Panel on Climate Change). 2000. *Summary for Policymakers,*
6 *Emissions Scenarios, A Special Report of IPCC Working Group III.* Intergovernmental Panel on
7 Climate Change, Geneva, Switzerland. Accessed June 11, 2022, at
8 <https://www.ipcc.ch/site/assets/uploads/2018/03/sres-en.pdf>. TN7652.
- 9 IPCC (Intergovernmental Panel on Climate Change). 2007. *Climate Change 2007: The Physical*
10 *Science Basis. Contribution of Working Group I to the Fourth Assessment Report of the*
11 *Intergovernmental Panel on Climate Change.* ADAMS No. ML112710385. Accessed May 23,
12 2022, at https://www.ipcc.ch/site/assets/uploads/2018/05/ar4_wg1_full_report-1.pdf. TN7421.
- 13 IPCC (Intergovernmental Panel on Climate Change). 2013. *Climate Change 2013: The Physical*
14 *Science Basis. Contribution of Working Group I to the Fifth Assessment Report of the*
15 *Intergovernmental Panel on Climate Change.* T.F. Stocker, D. Qin, G.-K. Plattner, M. Tignor,
16 S.K. Allen, J. Boschung, A. Nauels, Y. Xia, V. Bex, and P.M. Midgley, eds. Cambridge
17 University Press, Cambridge, United Kingdom. Accessed May 25, 2022, at
18 <https://www.ipcc.ch/report/ar5/wg1/>. TN7434.
- 19 IPCC (Intergovernmental Panel on Climate Change). 2014. *Climate Change 2014, Synthesis*
20 *Report.* Geneva, Switzerland. Accessed June 11, 2022, at [https://ar5-](https://ar5-syr.ipcc.ch/ipcc/ipcc/resources/pdf/IPCC_SynthesisReport.pdf)
21 [syr.ipcc.ch/ipcc/ipcc/resources/pdf/IPCC_SynthesisReport.pdf](https://ar5-syr.ipcc.ch/ipcc/ipcc/resources/pdf/IPCC_SynthesisReport.pdf). TN7651.
- 22 IPCC (Intergovernmental Panel on Climate Change). 2021. "Climate Change 2021: The
23 Physical Science Basis." Accessed May 24, 2022, at <https://www.ipcc.ch/report/ar6/wg1/>.
24 TN7435.
- 25 IPCC (Intergovernmental Panel on Climate Change). 2023. *AR6 Synthesis Report: Climate*
26 *Change 2023.* Intergovernmental Panel on Climate Change, Geneva, Switzerland. TN8557.
- 27 James, D.G. 2019. "A Neonicotinoid Insecticide at a Rate Found in Nectar Reduces Longevity
28 but not Oogenesis in Monarch Butterflies, *Danaus plexippus* (L.). (Lepidoptera: Nymphalidae)."
29 *Insects* 10(9):276, Bethesda, Maryland. TN8595.
- 30 Janes, D.E. 1978. *Evaluation of Health and Environmental Effects of Extra-High-Voltage (EHV)*
31 *Transmission.* 520179501, U.S. Environmental Protection Agency, Office of Radiation
32 Programs, Washington, D.C. TN7479.
- 33 Johnson, G.D., and Strickland, MD. 2003. *Biological Assessment for the Federally Endangered*
34 *Indiana Bat (*Myotis sodalis*) and Virginia Big-eared Bat (*Corynorhinus townsendii virginianus*)*
35 *NedPower Mount Storm Wind Project, Grant County, West Virginia.* West, Inc., Cheyenne,
36 Wyoming. TN8509.
- 37 Johnson, G.D., W.P. Erickson, M.D. Strickland, M.F. Shepard, D.A. Shepard, and S.A. Sarappo.
38 2003. "Mortality of Bats at a Large-scale Wind Power Development at Buffalo Ridge,
39 Minnesota." *The American Midland Naturalist* 15(2):332-342. TN8511.

1 Knife River. 2017. "Environmental Assessment Worksheet, Knife River Naaktgeboren Pit."
2 Accessed October 2, 2023, at
3 <https://www.co.wright.mn.us/AgendaCenter/ViewFile/Item/4064?fileID=9494>. TN9088.

4 Krischik, V., M. Rogers, G. Gupta, and A. Varshney. 2015. "Soil-Applied Imidacloprid
5 Translocates to Ornamental Flowers and Reduces Survival of Adult *Coleomegilla maculata*,
6 *Harmonia axyridis*, and *Hippodamia convergens* Lady Beetles, and Larval *Danaus plexippus*
7 and *Vanessa cardui* Butterflies." *PLoS One* 10(3):e0119133, San Francisco, California. TN8596.

8 Krishnan, N., Y. Zhang, K.G. Bidne, R.L. Hellmich, J.R. Coats, and S.P. Bradbury. 2020.
9 "Assessing Field-Scale Risks of Foliar Insecticide Applications to Monarch Butterfly (*Danaus*
10 *plexippus*) Larvae." *Environmental Toxicology Chemistry* 39(4):923-941. TN8597.

11 Kroening, S. and S. Vaughan. 2019. *The Condition of Minnesota's Groundwater Quality, 2013-*
12 *2017*. Minnesota Pollution Control Agency, St. Paul, Minnesota. TN9644.

13 Langford, T.E. 1983. *Electricity Generation and the Ecology of Natural Waters*. Liverpool
14 University Press, Liverpool, England. TN7676.

15 Larson, A. 2020. "Innovative Byproduct-Hydrogen Fuel Cell Power Plant Completed." *POWER*.
16 Rockville, Maryland. Available at [https://www.powermag.com/innovative-byproduct-hydrogen-](https://www.powermag.com/innovative-byproduct-hydrogen-fuel-cell-power-plant-completed/)
17 [fuel-cell-power-plant-completed/](https://www.powermag.com/innovative-byproduct-hydrogen-fuel-cell-power-plant-completed/). TN8401.

18 Lee, J.M., V.L. Chartier, D.P. Hartmann, G.E. Lee, K.S. Pierce, F.L. Shon, R.D. Stearns, and
19 M.T. Zeckmeister. 1989. *Electrical and Biological Effects of Transmission Lines: A Review*.
20 DOE/BP-945. U.S. Department of Energy, Bonneville Power Administration, Portland, Oregon.
21 June. Accessed June 1, 2022, at <https://doi.org/10.2172/5712107>. TN7481

22 Leidos. 2016. *Comparison of Fuels Used for Electric Generation in the U.S. (2016)*. Reston,
23 Virginia. TN9183.

24 Liess, S., H.A. Roop, T.E. Twine, R. Noe, N. Meyer, A. Fernandez, D. Dolma, J. Gorman, S.
25 Clark, J. Mosel, A. Farris, B. Hoppe, and P. Neff. 2023. "Fine-scale Climate Projects over
26 Minnesota for the 21st Century, CliMAT." St. Paul, Minnesota. Available at
27 <https://climate.umn.edu/MN-CliMAT>. TN9684.

28 Lindholm, G.F. 1980. *Ground-Water Appraisal of Sand Plains in Benton, Sherburne, Stearns,*
29 *and Wright Counties, Central Minnesota*. Open-File Report 80-1285, U.S. Geological Survey,
30 St. Paul, Minnesota. TN9703.

31 Loss, S.R., T. Will, and P.P. Marra. 2014. "Refining Estimates of Bird Collision and Electrocution
32 Mortality at Power Lines in the United States." *Plos One* 9(7): e101565, San Francisco,
33 California. TN9396.

34 Łukasz, B., I. Rybakowska, A. Krakowiak, M. Gregorczyk, And W. Waldman. 2023. "Lithium
35 Batteries Safety, Wider Perspective." *International Journal of Occupational Medicine and*
36 *Environmental Health* 36(1):3-20, Łódź, Poland. TN9618.

37 Magnuson-Stevens Fishery Conservation and Management Act, Public Law 94-265, as
38 amended through October 11, 1996. 16 U.S.C. § 1801 *et seq.* TN1061.

- 1 Magnuson Stevens Fishery Conservation and Management Reauthorization Act of 2006. 16
2 U.S.C. 1801 Note. Public Law 109-479, January 12, 2007, 120 Stat. 3575. TN7841.
- 3 Maize, K. 2019. "Waste-to-Energy: A Niche Market in Decline?" *POWER*, Rockville, Maryland.
4 Accessed June 12, 2022, at [https://www.powermag.com/waste-to-energy-a-niche-market-in-](https://www.powermag.com/waste-to-energy-a-niche-market-in-decline)
5 [decline](https://www.powermag.com/waste-to-energy-a-niche-market-in-decline). TN7699.
- 6 Marohn, K. and M. Becker. 2023. "Xcel Energy breaks ground on Sherco solar project." St.
7 Paul, Minnesota. Accessed April 1, 2024, at [https://www.mprnews.org/story/2023/05/22/xcel-](https://www.mprnews.org/story/2023/05/22/xcel-energy-breaks-ground-on-sherco-solar-project)
8 [energy-breaks-ground-on-sherco-solar-project](https://www.mprnews.org/story/2023/05/22/xcel-energy-breaks-ground-on-sherco-solar-project). TN9857.
- 9 Martin Marietta. 2023. "Monticello Pit." Accessed October 3, 2023, at
10 <https://www.martinmarietta.com/locations/central/minnesota-aggregates-district/monticello-pit>.
11 TN9089.
- 12 Mayhew, D.A., L.D. Jensen, D.F. Hanson, and P.H. Muessig. 2000. "A comparative review of
13 entrainment survival studies at power plants in estuarine environments." *Environmental Science*
14 *& Policy* (3) Supplement 1:295-301, Hunt Valley, Maryland. TN8458.
- 15 MdDNR (Maryland Department of Natural Resources). Undated. *Biology of Bluegills*. Annapolis,
16 Maryland. Accessed January 4, 2024, at
17 <https://dnr.maryland.gov/ccs/Documents/education/Biology-of-Bluegill.pdf>. TN9588.
- 18 Michaels T., and K. Krishnan. 2019. *Energy Recovery Council, 2018 Directory of Waste-to-*
19 *Energy Facilities*. Washington, D.C. Accessed June 12, 2022, at
20 <http://energyrecoverycouncil.org/wp-content/uploads/2019/01/ERC-2018-directory.pdf>. TN7700.
- 21 Michel, J., A.C. Bejarano, C.H. Peterson, and C. Voss. 2013. *Review of Biological and*
22 *Biophysical Impacts from Dredging and Handling of Offshore Sand*. OCS Study, BOEM 2013-
23 0119, Columbia, South Carolina. TN7838.
- 24 Migratory Bird Treaty Act of 1918. 16 U.S.C. § 703 *et seq.* TN3331.
- 25 Milgroom, J. 2023. "Wild Rice and the Ojibwe." St. Paul, Minnesota. Accessed February 8,
26 2024, at <https://www.mnopedia.org/thing/wild-rice-and-ojibwe>. TN9745.
- 27 Mille Lacs Band of Ojibwe. 2023. Email from C. J. Lippert, Air Quality Specialist, to N. Martinez,
28 Monticello Environmental Resource, dated April 12, 2023, regarding "Docket ID No. NRC-2023-
29 0031: Northern States Power Company – Minnesota; Xcel Energy; Monticello Nuclear
30 Generating Plant, Unit 1: Scoping Comments." Onamia, Minnesota. ADAMs Accession No.
31 ML23117A313. TN9666.
- 32 Mille Lacs Band of Ojibwe. Undated. "Boozhoo And Welcome to the Website of the Non-
33 Removable Mille Lacs Band Of Ojibwe." Onamia, Minnesota. TN9661.
- 34 Mille Lacs Band of Ojibwe. Undated. *The Non-Removeable*. Onamia, Minnesota. TN9663.
- 35 Miller, M.W. 1983. "Biological Effects from Exposure to Transmission Line Electromagnetic
36 Fields." *Right of Way* 30(3):8–15, Gardena, California. TN1328.

1 Minnesota Indian Affairs Council. Undated. "Relations: Dakota & Ojibwe Treaties: 1837 Land
2 Cession Treaties with the Ojibwe & Dakota." St. Paul, Minnesota. Accessed January 15, 2024,
3 at <https://treatiesmatter.org/treaties/land/1837-ojibwe-dakota>. TN9662.

4 Minnesota Indian Affairs Council. Undated. "Relations: Dakota & Ojibwe Treaties: 1855 Land
5 Cession Treaty with the Ojibwe." St. Paul, Minnesota. Accessed January 15, 2024, at
6 <https://treatiesmatter.org/treaties/land/1855-ojibwe>. TN9664.

7 State of Minnesota Senate. 2019. "S.F. No 4, Human Services Program Integrity, First
8 Engrossment." *Minnesota Bill Summary*, St. Paul, Minnesota. TN9180.

9 MN Stat. 84. 2023. Chapter 84, "Department of Natural Resources: Protection of Threatened
10 and Endangered Species." *Minnesota Statutes*, St. Paul, Minnesota. TN9583.

11 MN Stat. 115. 2023. Chapter 115, "Water Pollution Control; Sanitary Districts." *Minnesota*
12 *Statutes*, St. Paul, Minnesota. TN9622.

13 MN Stat. 103G. 2023. Chapter 103G, "Waters of the State." *Minnesota Statutes*, St. Paul,
14 Minnesota. TN9648.

15 MN Stat. 216B. 2023. Chapter 216B, "Public Utilities." *Minnesota Statutes*, St. Paul, Minnesota.
16 TN9184.

17 MNBBA (Minnesota Breeding Bird Atlas). 2023. "Trumpeter Swan *Cygnus buccinator*."
18 Roseville, Minnesota. Accessed on December 21, 2023, at
19 [https://mnbirdatlas.org/species/trumpeter-
20 swan/#:~:text=Formerly%20extirpated%2C%20but%20now%20classified,Short-
21 distance%20migrant](https://mnbirdatlas.org/species/trumpeter-swan/#:~:text=Formerly%20extirpated%2C%20but%20now%20classified,Short-distance%20migrant). TN9572.

22 MnDA (Minnesota Department of Agriculture). 2023. "Minnesota Noxious Weed List." St. Paul,
23 Minnesota. Accessed November 13, 2023, at [https://www.mda.state.mn.us/plants-
24 insects/minnesota-noxious-weed-list](https://www.mda.state.mn.us/plants-insects/minnesota-noxious-weed-list). TN9344.

25 MnDA (Minnesota Department of Administration: State Archaeologist). Undated. "MN
26 Archaeology." St. Paul, Minnesota. Accessed January 15, 2024, at
27 <https://mn.gov/admin/archaeologist/educators/mn-archaeology/>. TN9657.

28 MnDA (Minnesota Department of Administration: State Archaeologist). Undated. "Office of the
29 State Archaeologist (OSA) Portal." St. Paul, Minnesota. Accessed January 16, 2024, at
30 <https://osaportal.qisdata.mn.gov/>. TN9688.

31 MnDA SHPO (Minnesota Department of Administration: State Historic Preservation Office).
32 2023. Email from S.J. Beimers, Environmental Review Program Manager, to N. Martinez,
33 Environmental Scientist Office of Nuclear Material Safety and Safeguards, dated August 21,
34 2023, regarding "Request for Scoping Comments Concerning the Environmental Review of
35 Monticello Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application (Docket
36 No. 50-263) Wright and Sherburne Counties, Minnesota, SHPO No. 2022-1087." St. Paul,
37 Minnesota. ADAMs Accession No. ML23241A973. TN9669.

38 MnDA SHPO (Minnesota Department of Administration: State Historic Preservation Office).
39 2023. Email from S.J. Beimers, Environmental Review Program Manager, to NRC Program

1 Management, Announcements and Editing Staff Office of Administration, dated July 3, 2023,
2 regarding "Request for Scoping Comments Concerning the Environmental Review of Monticello
3 Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application (Docket No. 50-
4 263) Wright and Sherburne Counties, Minnesota, SHPO No. 2022-1087." St. Paul, Minnesota.
5 ADAMs Accession No. ML23199A280. TN9668.

6 MnDH (Minnesota Department of Health). 2018. Community Water Supply Systems 2018. St.
7 Paul, Minnesota. TN9640.

8 MnDH (Minnesota Department of Health). 2022. "Well Information from County Well Index for
9 the General Public." St. Paul, Minnesota. Accessed January 15, 2024, at
10 <https://gisdata.mn.gov/dataset/water-well-information-non-pws>. TN9641.

11 MnDNR (Minnesota Department of Natural Resources). 2004. *Management Plan Mississippi*
12 *Scenic Riverway*. St. Paul, Minnesota. TN9340.

13 MnDNR (Minnesota Department of Natural Resources). 2008. *Natural Wild Rice In Minnesota:*
14 *A Wild Rice Study document submitted to the Minnesota Legislature*. St. Paul, Minnesota.
15 TN9711.

16 MnDNR (Minnesota Department of Natural Resources). 2014. Minnesota Invasive Carp Action
17 Plan. St. Paul, Minnesota. TN9584.

18 MnDNR (Minnesota Department of Natural Resources). 2019. *Guidelines for Suspension of*
19 *Surface Water Appropriation Permits*. St. Paul. Available at
20 https://files.dnr.state.mn.us/natural_resources/climate/drought/drought_permit_suspension.pdf.
21 TN9650.

22 MnDNR (Minnesota Department of Natural Resources). 2020. *Water Availability and*
23 *Assessment Report*. St. Paul, Minnesota. Available at
24 <https://files.dnr.state.mn.us/aboutdnr/reports/legislative/2020-water-availability-assessment.pdf>.
25 TN9685.

26 MnDNR (Minnesota Department of Natural Resources). 2021. *Minnesota Groundwater*
27 *Provinces 2021*. St. Paul, Minnesota. Accessed at
28 https://files.dnr.state.mn.us/waters/groundwater_section/mapping/provinces/2021-provinces.pdf.
29 TN9636.

30 MnDNR (Minnesota Department of Natural Resources). 2023. "Aquatic Invasive Species
31 Observation." St. Paul, Minnesota. Accessed on December 28, 2023, at
32 <https://gisdata.mn.gov/dataset/env-invasive-aquatic-obs>. TN9576.

33 MnDNR (Minnesota Department of Natural Resources). 2023. "Cygnus buccinator." St. Paul,
34 Minnesota. Accessed December 27, 2023, at
35 [https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=ABNJB02](https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=ABNJB02030)
36 [030](https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=ABNJB02030). TN9573.

37 MnDNR (Minnesota Department of Natural Resources). 2023. Email from J. Bedell, Area
38 Hydrologist, to L. Desotell, Environmental Scientist, NRC, dated November 27, 2023, regarding
39 "[External_Sender] RE: MN DNR background information related to Monticello Nuclear
40 Generating Plant." St. Paul, Minnesota. ADAMs Accession No. ML24025A034. TN9863.

- 1 MnDNR (Minnesota Department of Natural Resources). 2023. *Invasive Carp Sampling Report*
2 *January-December 2022 Upper Mississippi river, Pools 1-8, Lower St. Croix River, Below St.*
3 *Croix Falls, Minnesota River, Below Granite Falls*. St. Paul, Minnesota. TN9352.
- 4 MnDNR (Minnesota Department of National Resources). 2023. "Minnesota Climate Trends,
5 Major Watersheds, Mississippi River, Average Temperature and Precipitation, Annual, 1895-
6 2023." St. Paul, Minnesota. Available at <https://arcgis.dnr.state.mn.us/ewr/climatetrends/#>.
7 TN9681.
- 8 MnDNR (Minnesota Department of Natural Resources). 2023. "Minnesota's endangered
9 species law." St. Paul, Minnesota. Accessed November 13, 2023, at
10 <https://www.dnr.state.mn.us/rsg/laws.html>. TN9351.
- 11 MnDNR (Minnesota Department of Natural Resources). 2023. "Rare Species Guide: Filtered
12 Search." St. Paul, Minnesota. Accessed on November 10, 2023, at
13 [https://www.dnr.state.mn.us/rsg/filter_search.html?action=doFilterSearch&allstatus=Y&mussel=](https://www.dnr.state.mn.us/rsg/filter_search.html?action=doFilterSearch&allstatus=Y&mussel=Y)
14 [Y](https://www.dnr.state.mn.us/rsg/filter_search.html?action=doFilterSearch&allstatus=Y&mussel=Y). TN9338.
- 15 MnDNR (Minnesota Department of Natural Resources). 2023. "River Classifications." St. Paul,
16 Minnesota. Accessed on November 11, 2023, at
17 https://www.dnr.state.mn.us/waters/watermgmt_section/wild_scenic/wsrivers/classification.html.
18 TN9341.
- 19 MnDNR (Minnesota Department of Natural Resources). 2023. "Species Profile." St. Paul,
20 Minnesota. Accessed January 4, 2024, at
21 <https://www.dnr.state.mn.us/minnaqua/speciesprofile/index.html>. TN9585.
- 22 MnDNR (Minnesota Department of Natural Resources). 2023. "Terrestrial Invasive Species
23 Observation." St. Paul, Minnesota. Accessed on December 28, 2023, at
24 <https://qisdata.mn.gov/dataset/env-invasive-terrestrial-obs>. TN9577.
- 25 MnDNR (Minnesota Department of Natural Resources). 2023. "The Wild & Scenic Mississippi
26 River." St. Paul, Minnesota. Accessed on November 10, 2023, at
27 https://www.dnr.state.mn.us/waters/watermgmt_section/wild_scenic/wsrivers/mississippi.html.
28 TN9339.
- 29 MnDNR (Minnesota Department of Natural Resources). 2023. "Water Appropriations Permit
30 Program." St. Paul, Minnesota. Accessed November 17, 2023, at
31 https://www.dnr.state.mn.us/waters/watermgmt_section/appropriations/index.html. TN9402.
- 32 MnDNR (Minnesota Department of Natural Resources). 2024. "*Falco peregrinus*: Peregrine
33 Falcon." St. Paul, Minnesota. Accessed February 8, 2024, at
34 [https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=ABNKD06](https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=ABNKD06070#:~:text=Currently%2C%2030%25%20of%20Midwestern%20Peregrine,Mississippi%20River%20(The%20Blufflands)
35 [070#:~:text=Currently%2C%2030%25%20of%20Midwestern%20Peregrine,Mississippi%20Rive](https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=ABNKD06070#:~:text=Currently%2C%2030%25%20of%20Midwestern%20Peregrine,Mississippi%20River%20(The%20Blufflands)
36 [r%20\(The%20Blufflands](https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=ABNKD06070#:~:text=Currently%2C%2030%25%20of%20Midwestern%20Peregrine,Mississippi%20River%20(The%20Blufflands). TN9743.
- 37 MnDNR (Minnesota Department of Natural Resources). 2024. "*Spilogale putorius* Eastern
38 Spotted Skunk." St. Paul, Minnesota. Accessed January 25, 2024, at
39 [https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=AMAJF05](https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=AMAJF05010)
40 [010](https://www.dnr.state.mn.us/rsg/profile.html?action=elementDetail&selectedElement=AMAJF05010). TN9710.

1 MnDNR (Minnesota Department of Natural Resources). 2024. "Wild rice management." St.
2 Paul, Minnesota. Accessed January 25, 2024, at
3 <https://www.dnr.state.mn.us/wildlife/shallowlakes/wildrice.html>. TN9712.

4 MnSHIP (Minnesota Statewide Historic Inventory Portal). Undated. "Welcome to MnSHIP,
5 Minnesota's Statewide Historic Inventory Portal!" St. Paul, Minnesota. Accessed January 16,
6 2024, at <https://mnship.gisdata.mn.gov/>. TN9687.

7 Moriarty, J. 2020. "Reintroducing Trumpeter Swans: What it took to Succeed." ThreeRivers Park
8 District, Plymouth, Minnesota. Accessed on December 21, 2023, at
9 <https://www.threeriversparks.org/blog/reintroducing-trumpeter-swans-what-it-took-succeed>.
10 TN9574.

11 Morrow, Jr., J.V., and J.C. Fischenich. 2000. "Habitat Requirements for Freshwater Fishes."
12 EMRRP Technical Notes Collection. ERDC TN-EMRRP-SR-06. U.S. Army Engineer Research
13 and Development Center, Vicksburg, Mississippi. TN7351.

14 MPCA (Minnesota Pollution Control Agency). 2020. "Beneficial Use Designations for Stream
15 Reaches: Mississippi River - St. Cloud Watershed (07010203)." St. Cloud, Minnesota. Available
16 at <https://www.pca.state.mn.us/sites/default/files/wq-s6-47p.pdf>. TN9538.

17 MPCA (Minnesota Pollution Control Agency). 2022. "2022 Impaired Waters List (wq-iw1-73)."
18 St. Paul, Minnesota. Available at [https://www.pca.state.mn.us/air-water-land-
19 climate/minnesotas-impaired-waters-list](https://www.pca.state.mn.us/air-water-land-climate/minnesotas-impaired-waters-list). TN9539.

20 MPCA (Minnesota Pollution Control Agency). 2023. "Construction Stormwater." St. Paul,
21 Minnesota. Available at <https://www.pca.state.mn.us/business-with-us/construction-stormwater>.
22 TN9266.

23 MPCA (Minnesota Pollution Control Agency). 2023. Letter from Armon Turpin, Engineer Solid
24 Waste Section, to Mark Gerlach, Environmental Analyst Xcel Energy, dated Mary 19, 2023,
25 regarding "Final Aboveground Storage Tank Major Facility Permit # TS0051508, Xcel Energy -
26 Monticello Nuclear Generating Facility." St. Paul, Minnesota. TN9401.

27 MPCA (Minnesota Pollution Control Agency). 2023. Letter from M Wenger, Supervisor Agency
28 Rule Unit Resource Management and Assistance Division, to P. Young, Manager Site Routine
29 Projects, dated May 16, 2023, regarding "Northern States Power Company dba Xcel Energy
30 Monticello Nuclear Power Generating Plant 2807 County Road 75, Monticello Wright and
31 Sherburne Counties, Minnesota Section 401 Water Quality Certification Waiver." St. Paul,
32 Minnesota. ADAMS Accession No. ML24082A166. TN9835.

33 MPCA (Minnesota Pollution Control Agency). 2023. *National Pollutant Discharge Elimination
34 System/State Disposal System MN0000868*. St. Paul, Minnesota. TN9690.

35 MPCA (Minnesota Pollution Control Agency). 2023. "Point Source Air Emissions Data." St. Paul,
36 Minnesota. Accessed January 12, 2024, at
37 [https://public.tableau.com/app/profile/mpca.data.services/viz/Pointsourceairemissionsdata_v10-
38 5-11130/Byfacility](https://public.tableau.com/app/profile/mpca.data.services/viz/Pointsourceairemissionsdata_v10-5-11130/Byfacility). TN9625.

- 1 MPCA (Minnesota Pollution Control Agency). 2023. "What's in My Neighborhood: Xcel Energy-
2 Monticello Generating Plant." St. Paul, Minnesota. Accessed January 12, 2024, at
3 <https://www.pca.state.mn.us/about-mpca/whats-in-my-neighborhood>. TN9624.
- 4 MPCA (Minnesota Pollution Control Agency). 2023. "Xcel Energy Inc. fined \$14,000 related to
5 tritiated water storage at Monticello nuclear facility." St. Paul, Minnesota. Accessed January 18,
6 2024, at [https://www.pca.state.mn.us/news-and-stories/xcel-energy-inc-fined-14000-related-to-](https://www.pca.state.mn.us/news-and-stories/xcel-energy-inc-fined-14000-related-to-tritiated-water-storage-at-monticello-nuclear-facility)
7 [tritiated-water-storage-at-monticello-nuclear-facility](https://www.pca.state.mn.us/news-and-stories/xcel-energy-inc-fined-14000-related-to-tritiated-water-storage-at-monticello-nuclear-facility). TN9694.
- 8 MPSD (Monticello Public School District). 2023. *2023-2024 Annual Budget Monticello School*
9 *District #882*. Monticello, Minnesota. TN9837.
- 10 National Environmental Policy Act of 1969 (NEPA), as amended. 42 U.S.C. § 4321 *et seq.*
11 TN661.
- 12 National Historic Preservation Act. 54 U.S.C. § 300101 *et seq.* TN4157.
- 13 National Marine Sanctuaries Act, as amended. 16 U.S.C. § 1431 *et seq.* TN4482.
- 14 National Wild and Scenic Rivers System. 2023. "System Wide Map." Burbank, Washington.
15 Accessed November 10, 2023, at <https://www.rivers.gov/map>. TN9342.
- 16 NCES (National Center for Education Statistics). 2024. "Sherburne County Public School
17 Districts." Washington, D.C. Accessed January 26, 2024, at
18 https://nces.ed.gov/ccd/schoolsearch/school_list.asp?Search=1&InstName=&SchoolID=&Address=&City=&State=27&Zip=&Miles=&County=Sherburne&PhoneAreaCode=&Phone=&DistrictName=&DistrictID=&SchoolType=1&SchoolType=2&SchoolType=3&SchoolType=4&SpecificSchlTypes=all&IncGrade=-1&LoGrade=-1&HiGrade=-1. TN9725.
- 22 NCES (National Center for Education Statistics). 2024. "Wright County Public School Districts."
23 Washington, D.C. Accessed January 26, 2024, at
24 https://nces.ed.gov/ccd/schoolsearch/school_list.asp?Search=1&InstName=&SchoolID=&Address=&City=&State=27&Zip=&Miles=&County=Wright&PhoneAreaCode=&Phone=&DistrictName=&DistrictID=&SchoolType=1&SchoolType=2&SchoolType=3&SchoolType=4&SpecificSchlTypes=all&IncGrade=-1&LoGrade=-1&HiGrade=-1. TN9724.
- 28 Nebeker, A.V., F.D. Baker, and S.L. Weitz. 1981. "Survival and Adult Emergence of Aquatic
29 Insects in Air-Supersaturated Water." *Journal of Freshwater Ecology* 1(3):243-250. London,
30 England. Accessed June 13, 2022, at <https://doi.org/10.1080/02705060.1981.9664039>.
31 TN7725.
- 32 NEI (Nuclear Energy Institute). 2007. *Industry Ground Water Protection Initiative—Final*
33 *Guidance Document*. NEI 07–07, Washington, D.C. ADAMS Accession No. ML091170588.
34 TN1913.
- 35 NEI (Nuclear Energy Institute). 2019. *Industry Groundwater Protection Initiative – Final*
36 *Guidance Document, Rev. 1*. NEI-07-07, Revision 1, Washington, D.C. ADAMS Accession No.
37 ML19142A071. TN6775.

- 1 NETL (National Energy Technology Laboratory). 2014. *Life Cycle Analysis of Natural Gas*
2 *Extraction and Power Generation*. DOE/NETL-2014/1646, Department of Energy, Pittsburgh,
3 Pennsylvania. TN9628.
- 4 NGPC (Nebraska Game and Parks Commission). 2023. "Whooping Crane, Status:
5 Endangered." Lincoln, Nebraska. Available at [https://outdoornebraska.gov/learn/nebraska-](https://outdoornebraska.gov/learn/nebraska-wildlife/nebraska-animals/birds/whooping-crane/)
6 [wildlife/nebraska-animals/birds/whooping-crane/](https://outdoornebraska.gov/learn/nebraska-wildlife/nebraska-animals/birds/whooping-crane/). TN8876.
- 7 NIEHS (National Institute of Environmental Health Sciences). 1999. *NIEHS Report on Health*
8 *Effects from Exposure to Power-Line Frequency Electric and Magnetic Fields*. NIH Publication
9 No 99-4493, National Institutes of Health, Research Triangle Park, North Carolina. ADAMS
10 Accession No. ML093240277. TN78.
- 11 NIEHS (National Institute of Environmental Health Sciences). 2002. *Electric and Magnetic*
12 *Fields Associated with the Use of Electric Power: Questions and Answers*. National Institutes of
13 Health, Research Triangle Park, North Carolina. ADAMS Accession No. ML112660024.
14 TN6560.
- 15 Nightingale, B., and C. Simenstad. 2001. *Overwater Structures: Marine Issues*. White Paper.
16 Research Project T1803, Task 35. Washington State Department of Transportation, Olympia,
17 Washington. Accessed June 7, 2022, at
18 <https://www.wsdot.wa.gov/research/reports/fullreports/508.1.pdf>. TN7538.
- 19 NIOSH (National Institute for Occupational Safety and Health). 1996. *EMFs In The Workplace*.
20 Washington, D.C. ADAMS Accession No. ML21145A339. TN6766.
- 21 NMC (Nuclear Management Company). 2005. Email from J.J. Holhaus, Environmental Project
22 Manager Nuclear Management Company Monticello Nuclear Generating Plant, to J. Davis,
23 dated November 18, 2005, regarding "Ecology Information Request." Monticello, Minnesota.
24 ADAMs Accession No. ML053260547. TN9399.
- 25 NMC (Nuclear Management Company). 2005. Letter from T.J. Palmisano, Site Vice President
26 Monticello Nuclear Generating Plant, to NRC Document Control Desk, dated March 16, 2005,
27 regarding "Monticello Nuclear Generating Plant Docket 50-263 License No. DPR-22 Application
28 for Renewed Operating License." L-MT-05-014, Hudson, Wisconsin. ADAMs Accession No.
29 ML050880237. TN9345.
- 30 NMC (Nuclear Management Company). 2006. Letter from J. Conway, Site Vice President
31 Monticello Nuclear Generating Plant, to NRC Document Control Desk, dated May 4, 2006,
32 regarding "Monticello Nuclear Generating Plant, Docket 50-263, License No. DPR-22, 2005
33 Annual Radiological Environmental Operating Report." Monticello, Minnesota. ADAMS
34 Accession No. ML061280617. TN9677.
- 35 NOAA (National Oceanic and Atmospheric Administration). 2022. "Minnesota State Climate
36 Summary 2022." NOAA Technical Report NESDIS 150-MN. Washington, D.C. Available at
37 <https://statesummaries.ncics.org/chapter/mn/>. TN9565.
- 38 NOAA (National Oceanic and Atmospheric Administration). 2023. "Climate Change:
39 Atmospheric Carbon Dioxide." Washington, D.C. Available at [https://www.climate.gov/news-](https://www.climate.gov/news-features/understanding-climate/climate-change-atmospheric-carbon-dioxide)
40 [features/understanding-climate/climate-change-atmospheric-carbon-dioxide](https://www.climate.gov/news-features/understanding-climate/climate-change-atmospheric-carbon-dioxide). TN9680.

- 1 NOAA (National Oceanic and Atmospheric Administration). 2024. "Local Climatological Data
2 Publications Select Station for St. Cloud, Minnesota (KTSC)." Washington, D.C. Accessed
3 January 12, 2024, at
4 https://www.ncdc.noaa.gov/IPS/lcd/lcd.html?_page=0&state=MN&_target1=Next+%3E.
5 TN9623.
- 6 NOAA NCEI (National Oceanic and Atmospheric Administration National Centers for
7 Environmental Information). 2023. "Storm Events for Wright and Sherburne Counties,
8 Minnesota, from January 1, 1950 to May 31, 2023 for Tornado, Flood, Blizzard." Silver Spring,
9 Maryland. Available at
10 <https://www.ncdc.noaa.gov/stormevents/listevents.jsp?eventType=%28Z%29+Blizzard&eventTy>
11 [pe=%28Z%29+Flood&eventType=%28C%29+Tornado&beginDate_mm=01&beginDate_dd=01](https://www.ncdc.noaa.gov/stormevents/listevents.jsp?eventType=%28Z%29+Blizzard&eventTy)
12 [&beginDate_yyyy=1950&endDate_mm=05&endDate_dd=31&endDate_yyyy=2023&county=SH](https://www.ncdc.noaa.gov/stormevents/listevents.jsp?eventType=%28Z%29+Blizzard&eventTy)
13 [ERBURNE%3A141&county=WRIGHT%3A171&hailfilter=0.00&tornfilter=0&windfilter=000&sort](https://www.ncdc.noaa.gov/stormevents/listevents.jsp?eventType=%28Z%29+Blizzard&eventTy)
14 [=DT&submitbutton=Search&statefips=27%2CMINNESOTA](https://www.ncdc.noaa.gov/stormevents/listevents.jsp?eventType=%28Z%29+Blizzard&eventTy). TN9566.
- 15 NPS (National Park Service). 2010. *Federal Land Managers' Air Quality Related Values Work*
16 *Group (FLAG). Phase I Report-Revised (2010), Natural Resource Report NPS/NRPC/NRR-*
17 *2010/232*. Hopkins, South Carolina. ADAMS Accession No. ML22118A305. TN7925.
- 18 NPS (National Park Service). 2022. "Mississippi River Facts." St. Paul, Minnesota. Accessed
19 January 12, 2024, at <https://www.nps.gov/miss/riverfacts.htm>. TN9630.
- 20 NRC (U.S. Nuclear Regulatory Commission). 1996. *Generic Environmental Impact Statement*
21 *for License Renewal of Nuclear Plants*. Volumes 1 and 2, NUREG-1437, Washington, D.C.
22 ADAMS Accession Nos. ML040690705, ML040690738. TN288.
- 23 NRC (U.S. Nuclear Regulatory Commission). 1996. *Generic Environmental Impact Statement*
24 *for License Renewal of Nuclear Plants*. NUREG-1437, Washington, D.C. Pages 4-37 and 4-42
25 to 4-45. [Specific Pages for Levy Hearing]. TN1162.
- 26 NRC (U.S. Nuclear Regulatory Commission). 1999. *Generic Environmental Impact Statement*
27 *for License Renewal of Nuclear Plants Addendum to Main Report, NUREG-1437, Volume 1,*
28 *Addendum 1*. Washington, D.C. ADAMS Accession No. ML040690720. TN289.
- 29 NRC (U.S. Nuclear Regulatory Commission). 1999. *Generic Environmental Impact Statement*
30 *for License Renewal of Nuclear Plants, Supplement 2, Regarding the Oconee Nuclear Station,*
31 *Final Report*. NUREG-1437, Washington, D.C. ADAMS Accession No. ML003670637. TN8942.
- 32 NRC (U.S. Nuclear Regulatory Commission). 2002. "Final Generic Environmental Impact
33 Statement of Decommissioning of Nuclear Facilities (NUREG-0586)." NUREG-0586,
34 Supplement 1, Volumes 1 and 2, Washington, D.C. ADAMS Accession Nos. ML023470327,
35 ML023500228. TN665.
- 36 NRC (U.S. Nuclear Regulatory Commission). 2002. *Generic Environmental Impact Statement*
37 *on Decommissioning of Nuclear Facilities, Supplement 1: Regarding the Decommissioning of*
38 *Nuclear Power Reactors, Main Report - Final Report*. NUREG-0586, Supplement 1, Volume 1
39 and 2, Washington, D.C. ADAMS Accession Nos. ML023470304, ML023470323,
40 ML023500187, ML023500211, ML023500223. TN7254.

1 NRC (Nuclear Regulatory Commission). 2005. Letter from R. Franovich, Branch Chief, to D. P.
2 Stinnett, Field Supervisor, U.S. Fish and Wildlife Service, dated December 22, 2005, regarding
3 “Biological Assessment for Monticello Nuclear Generating Plant License Renewal Review (TAC
4 No. MC6441).” Washington D.C. ADAMS Accession No. ML053570019. TN9649.

5 NRC (U.S. Nuclear Regulatory Commission). 2006. *Generic Environmental Impact Statement*
6 *for License Renewal of Nuclear Plants, Supplement 26: Regarding Monticello Nuclear*
7 *Generating Plant, Final Report.* NUREG-1437, Supplement 26, Washington, D.C. ADAMS
8 Accession No. ML062490078. TN7315.

9 NRC (U.S. Nuclear Regulatory Commission). 2006. *Liquid Radioactive Release Lessons*
10 *Learned Task Force Final Report.* Washington, D.C. ADAMS Accession No. ML083220312.
11 TN1000.

12 NRC (U.S. Nuclear Regulatory Commission). 2009. Memorandum from A.L. Vietti-Cook to R.W.
13 Borchardt, dated April 2, 2009, regarding “Staff Requirements - SECY-08-0197 - Options to
14 Revise Radiation Protection Regulations and Guidance with Respect to the 2007
15 Recommendations of the International Commission on Radiological Protection.” SRM-SECY-08-
16 0197, Washington, D.C. ADAMS Accession No. ML090920103. TN6651.

17 NRC (U.S. Nuclear Regulatory Commission). 2009. *Radiological Environmental Monitoring for*
18 *Nuclear Power Plants.* Regulatory Guide 4.1, Revision 2, Washington, D.C. ADAMS Accession
19 No. ML091310135. TN3802.

20 NRC (U.S. Nuclear Regulatory Commission). 2011. *Final Environmental Impact Statement for*
21 *Combined Licenses (COLs) for Comanche Peak Nuclear Power Plant Units 3 and 4.* NUREG-
22 1943, Volume 1, Washington, D.C. ADAMS Accession No. ML11131A001. TN6437.

23 NRC (U.S. Nuclear Regulatory Commission). 2011. Memorandum from Chairman Jaczko to
24 Commissioners Svinicki, Apostolakis, Magwood, and Ostendorff, dated March 21, 2011,
25 regarding “NRC Actions Following the Events in Japan.” COMGBJ-11-0002, Washington, D.C.
26 TN7448.

27 NRC (U.S. Nuclear Regulatory Commission). 2012. “In the Matter of All Power Reactor
28 Licensees and Holders of Construction Permits in the Active or Deferred Status. Order
29 Modifying Licenses with Regard to Requirements For Mitigation Strategies For Beyond-Design-
30 Basis External Events (Effective Immediately).” 7590-01-P, EA-12-049, NRC-2012-0068,
31 Washington, D.C. ADAMS Accession No. ML12056A045. TN7947.

32 NRC (U.S. Nuclear Regulatory Commission). 2012. Letter from E. Leeds to All Power Reactor
33 Licensees and Holders of Construction Permits in Active or Deferred Status, dated March 12,
34 2012, regarding “Request for Information Pursuant to Title 10 of the *Code of Federal*
35 *Regulations* 50.54(f) Regarding Recommendations 2.1, 2.3, and 9.3, of the Near-Term Task
36 Force Review of Insights from the Fukushima Dai-ichi Accident.” Washington, D.C. ADAMS
37 Accession No. ML12053A340. TN2198.

38 NRC (U.S. Nuclear Regulatory Commission). 2013. *Generic Environmental Impact Statement*
39 *for License Renewal of Nuclear Plants.* NUREG-1437, Revision 1, Washington, D.C. ADAMS
40 Package Accession No. ML13107A023. TN2654.

1 NRC (U.S. Nuclear Regulatory Commission). 2013. Letter from T. Beltz, Senior Project
2 Manager, to K. Fili, Site Vice President Monticello Nuclear Generating Plant, dated December 9,
3 2013, regarding “Monticello Nuclear Generating Plant -Issuance of Amendment No. 176 to
4 Renewed Facility Operating License Regarding Extended Power Uprate (TAC NO. MD9990).”
5 Washington, D.C. ADAMS Accession No. ML13316C459. TN9799.

6 NRC (U.S. Nuclear Regulatory Commission). 2014. Email from B.A. Grange to U.S. Fish and
7 Wildlife Service, dated June 17, 2014, regarding “Davis Besse Operating License Renewal.”
8 Washington, D.C. ADAMS Accession No. ML14168A616. TN7385.

9 NRC (U.S. Nuclear Regulatory Commission). 2014. *Generic Environmental Impact Statement*
10 *for Continued Storage of Spent Nuclear Fuel*. Final Report, NUREG–2157, Washington, D.C.
11 ADAMS Package Accession No. ML14198A440. TN4117.

12 NRC (U.S. Nuclear Regulatory Commission). 2014. *Probabilistic Seismic Hazard Analysis:*
13 *Background Information*. Washington, D.C. ADAMS Accession No. ML14140A648. TN8997.

14 NRC (U.S. Nuclear Regulatory Commission). 2015. *Biological Assessment on the Northern*
15 *Long-Eared Bat (Myotis septentrionalis) and Indiana Bat (Myotis sodalis), Indian Point Nuclear*
16 *Generating Units 2 and 3, Proposed License Renewal*. Docket Numbers 50-247 and 50-286,
17 Rockville, Maryland. ADAMS Accession No. ML15161A086. TN7382.

18 NRC (U.S. Nuclear Regulatory Commission). 2015. *Generic Environmental Impact Statement*
19 *for License Renewal of Nuclear Plants; Supplement 53 Regarding Sequoyah Nuclear Plant,*
20 *Units 1 and 2, Final Report*. NUREG-1437, Supplement 53, Washington, D.C. ADAMS
21 Accession No. ML15075A438. TN5842.

22 NRC (U.S. Nuclear Regulatory Commission). 2018. *Biological Evaluation of Impacts to Northern*
23 *Long-Eared Bat, Rufa Red Knot, Piping Plover, and Roseate Tern, Seabrook Station, Unit 1,*
24 *Proposed License Renewal to Operating License No. NPF-86*. Docket No. 50-443, Rockville,
25 Maryland. ADAMS Accession No. ML18186A692. TN7381.

26 NRC (U.S. Nuclear Regulatory Commission). 2018. *Environmental Impact Statement for an*
27 *Early Site Permit (ESP) at the Clinch River Nuclear Site, Draft Report for Comment*. NUREG-
28 2226, Volumes 1 and 2, Washington, D.C. ADAMS Accession No. ML18100A220. TN7244.

29 NRC (U.S. Nuclear Regulatory Commission). 2018. “Seismic Reviews at U.S. Nuclear Power
30 Plants.” Backgrounder, June 2018, Washington, D.C. ADAMS Accession No. ML081620327.
31 TN8998.

32 NRC (U.S. Nuclear Regulatory Commission). 2019. *Environmental Impact Statement for an*
33 *Early Site Permit (ESP) at the Clinch River Nuclear Site*. NUREG-2226, Washington, D.C.
34 ADAMS Package Accession No. ML19087A266. TN6136.

35 NRC (U.S. Nuclear Regulatory Commission). 2020. Letter from R. Bernardo, Project
36 Management Office of Nuclear Reactor Regulation, to T. Conboy, Site Vice President Northern
37 States Power Company, dated November 25, 2020, regarding “Monticello Nuclear Generating
38 Plant – Documentation of the Completion of Required Actions Taken in Response to the
39 Lessons Learned from the Fukushima Dai-Ichi Accident.” Washington, D.C. ADAMS Accession
40 No. ML20324A631. TN9695.

- 1 NRC (U.S. Nuclear Regulatory Commission). 2020. *Procedural Guidance for Preparing*
2 *Categorical Exclusions, Environmental Assessments, and Considering Environmental Issues.*
3 LIC-203, Revision 4, Washington, D.C. ADAMS Accession No. ML20016A379. TN6399.
- 4 NRC (U.S. Nuclear Regulatory Commission). 2021. *Measuring, Evaluating, and Reporting*
5 *Radioactive Material in Liquid and Gaseous Effluents and Solid Waste.* Regulatory Guide 1.21,
6 Revision 3, Washington, D.C. ADAMS Accession No. ML21139A224. TN7227.
- 7 NRC (U.S. Nuclear Regulatory Commission). 2022. "Event Notification Detail, Notification Date:
8 November 22, 2022, Event Number: 56236." Washington, D.C. Accessed January 8, 2024, at
9 <https://lersearch.inl.gov/ENView.aspx?DOC::56236>. TN9600.
- 10 NRC (U.S. Nuclear Regulatory Commission). 2022. "Memorandum and Order in the Matter of
11 Florida Power & Light Co. (Turkey Point Nuclear Generating Units 3 and 4)." CLI-22-02,
12 Rockville, Maryland. ADAMS Accession No. ML22055A496. TN8182.
- 13 NRC (U.S. Nuclear Regulatory Commission). 2022. "Memorandum and Order in the Matter of
14 Duke Energy Carolinas, LLC (Oconee Nuclear Station, Units 1, 2, and 3); Exelon Generating
15 Company, LLC (Peach Bottom Atomic Power Station, Units 2 and 3); Florida Power & Light Co.
16 (Turkey Point Nuclear Generating Units 3 and 4); Nextera Energy Point Beach, LLC (Point
17 Beach Nuclear Plant, Units 1 and 2); Virginia Electric and Power Company (North Anna Power
18 Station, Units 1 and 2)." CLI-22-03, Rockville, Maryland. ADAMS Accession Nos.
19 ML22055A521. TN9844.
- 20 NRC (U.S. Nuclear Regulatory Commission). 2022. "Memorandum and Order in the Matter of
21 "Exelon Generation Company LLC, (Peach Bottom Atomic Power Station, Units 2 and 3)."
22 CLI-22-04, Rockville, Maryland. ADAMS Accession No. ML22055A557. TN9553.
- 23 NRC (Nuclear Regulatory Commission). 2022. *Occupational Radiation Exposure at Commercial*
24 *Nuclear Power Reactors and Other Facilities 2020: Fifty-Third Annual Report.* NUREG-0713,
25 Washington, D.C. ADAMS Accession No. ML22276A269. TN8530.
- 26 NRC (U.S. Nuclear Regulatory Commission). 2023. "Event Notification Detail, Notification Date:
27 May 23, 2023, Event Number: 56535." Washington, D.C. Accessed January 11, 2024, at
28 <https://lersearch.inl.gov/ENView.aspx?DOC::56535>. TN9610.
- 29 NRC (U.S. Nuclear Regulatory Commission). 2023. Letter from T. Smith, Chief Environmental
30 Review License Renewal Branch, to C. Domingos, Site Vice President Northern States Power
31 Company- Minnesota, dated June 2, 2023, regarding "Monticello Nuclear Generating Plant, Unit
32 1 - Notice of Intent to Conduct Scoping Process and Prepare an Environmental Impact
33 Statement (Epid Number: L-2023-Sle-0000)." Washington, D.C. ADAMS Accession No.
34 ML23047A041. TN9723.
- 35 NRC (U.S. Nuclear Regulatory Commission). 2023. Letter from H. Peterson, Chief Reactor
36 Projects, to C. Domingos, Site Vice President Monticello Nuclear Generating Plant, dated May
37 4, 2023, regarding "Monticello Nuclear Generating Plant–Integrated Inspection Report
38 05000263/2023001." Lisle, Illinois. ADAMs Accession No. ML23124A108. TN9601.
- 39 NRC (U.S. Nuclear Regulatory Commission). 2023. Letter from H. Peterson, Chief Reactor
40 Projects, to S.Hafen, Site Vice President Monticello Nuclear Generating Plant, dated August 7,

1 2023, regarding “Monticello Nuclear Generating Plant–Integrated Inspection Report
2 05000263/2023002.” Lisle, Illinois. ADAMs Accession No. ML23219A155. TN9611.

3 NRC (U.S. Nuclear Regulatory Commission). 2023. Letter from N. Martinez, Environmental
4 Scientist Environmental Review License Renewal Branch to T.B. Smith, Environmental Review
5 License Renewal Branch, dated August 29, 2023, regarding “Summary of Visit to Minnesota
6 State Historic Preservation Office.” Washington, D.C. ADAMs Accession No. ML23228A096.
7 TN9773.

8 NRC (U.S. Nuclear Regulatory Commission). 2023. Memorandum from N. Martinex,
9 Environmental Scientist Environmental Review License Renewal Branch to T.B. Smith, Chief
10 Environmental Review License Renewal Branch, dated September 7, 2023, regarding
11 “Teleconference Summary between U.S. Nuclear Regulatory Commission and the Mille Lacs
12 Band Of Ojibwe.” Washington, D.C. ADAMs Accession No. ML23237A264. TN9671.

13 NRC (U.S. Nuclear Regulatory Commission). 2023. Memorandum from N. Martinez,
14 Environmental Scientist Environmental Review License Renewal Branch to T.B. Smith, Chief
15 Environmental Review License Renewal Branch, dated August 30, 2023, regarding
16 “Teleconference Summary between U.S. Nuclear Regulatory Commission and the Mille Lacs
17 Band Of Ojibwe.” Washington, D.C. ADAMs Accession No. ML23222A126. TN9670.

18 NRC (U.S. Nuclear Regulatory Commission). 2023. “Tritium and Effluent Release Issue.”
19 Washington, D.C. Accessed January 11, 2024, at [https://www.nrc.gov/info-
20 finder/reactors/mont/tritium-and-effluent-release-issue.html#response](https://www.nrc.gov/info-finder/reactors/mont/tritium-and-effluent-release-issue.html#response). TN9616.

21 NRC (U.S. Nuclear Regulatory Commission). 2024. Letter from S. Koenick, Chief Environmental
22 Project Management Branch 1, to S. Hafen, Site Vice President Northern States Power
23 Company, dated March 18, 2024, regarding “Issuance of Environmental Scoping Summary
24 Report Associated with the U.S. Nuclear Regulatory Commission Staff’s Review of the
25 Monticello Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application (Epid
26 Number: L-2023-Sle-0000) (Docket Number: 50-263).” Washington, D.C. ADAMs Accession
27 No. ML24059A288. TN9817.

28 NRC (U.S. Nuclear Regulatory Commission). 2024. Memorandum from N. Martinez,
29 Environmental Scientist Environmental Review License Renewal Branch to M.R. Rome, Chief
30 Environmental Technical Review Branch 1, dated January 30, 2024, regarding “January 11,
31 2024, Teleconference Summary Between the U.S. Nuclear Regulatory Commission and the
32 Mille Lacs Band Of Ojibwe.” Washington, D.C. ADAMs Accession No. ML24023A090. TN9772.

33 NRC and OSHA (Nuclear Regulatory Commission and Occupational Safety and Health
34 Administration). 2013. “Memorandum of Understanding Between the U.S. Nuclear Regulatory
35 Commission and the Occupational Safety and Health Administration.” Washington, D.C.
36 ADAMs Accession No. ML11354A432. TN8542.

37 NREL (National Renewable Energy Laboratory). Undated. “Concentrating Solar Power.”
38 Golden, Colorado. Accessed June 12, 2022, at <https://www.nrel.gov/csp/index.html>. TN7710.

39 Occupational Safety and Health Act of 1970, as amended. 29 U.S.C. § 651 *et seq.* TN4453.

40 Owen, S.F., Menzel, M.A., Ford, W.M., Edwards, J.W., Chapman, B.R., Miller, K.V., Wood, P.B.
41 2022. *Roost Tree Selection by Maternal Colonies of Northern Long-eared Myotis on an*

1 *Intensively Managed Forest*. Technical Report NE-22, United States Forest Service
2 Northeastern Research Station, Newton Square, Pennsylvania. TN8500.

3 Partridge, A. and B. Steigauf. 2020. *Minnesota's Power Plant Communities: An Uncertain*
4 *Future*. Center for Energy and Environment, Minneapolis, Minnesota. TN9575.

5 Pauly, D. and R. Froese. 2023. "FishBase A Global Information System on Fishes." Kiel,
6 Germany. Accessed January 4, 2024, at <https://fishbase.se/home.htm>. TN9590.

7 Pearse, A.T., M.J. Harner, D.M. Baasch, G.D. Wright, A.J. Caven, and K.L. Metzger. 2017.
8 *Evaluation of Nocturnal Roost and Diurnal Sites Used by Whooping Cranes in the Great Plains,*
9 *United States*. United States Geological Survey, Reston, Virginia. TN8855.

10 Petersen, W., E. Willer, and C. Williamowski. 1997. "Remobilization of Trace Elements from
11 Polluted Anoxic Sediments After Resuspension in Oxidic Water." *Water, Air, and Soil Pollution*
12 99(1-4):515-522. DOI:10.1007/BF02406891. Cham, Switzerland. Accessed June 13, 2022, at
13 <https://doi.org/10.1007/BF02406891>. TN7740.

14 Petersen, M.D., A.M. Shumway, P.M. Powers, C.S. Mueller, M.P. Moschetti, A.D. Frankel, S.
15 Rezaeian, D.E. McNamara, N. Luco, O.S. Boyd, K.S. Rukstales, K.S. Jaiswal, E.M. Thompson,
16 S.M. Hoover, B.S. Clayton, E.H. Field, and Y. Zeng. 2020. "The 2018 update of the US National
17 Seismic Hazard Model: Overview of model and implications." *Earthquake Spectra* 36(1):5-41,
18 Los Angeles, California. TN7281.

19 Pollution Prevention Act of 1990. 42 U.S.C. § 13101 *et seq.* TN6607.

20 Resource Conservation and Recovery Act of 1976. 42 U.S.C 6901 Note. Public Law 94-580, 90
21 Stat. 2795. TN1281.

22 Romberg, G.P., S.A. Spigarelli, W. Prepejchal, M.M. Thommes, J.W. Gibbons, and R.R. Sharitz.
23 1974. "Fish Behavior at a Thermal Discharge into Lake Michigan." *Thermal Ecology*
24 *Symposium*. CONF-730505. Aiken, South Carolina. TN7891.

25 Saunders, W.E. 1930. "Bats in Migration." *Journal of Mammalogy* 11(2):255. TN8504.

26 Scott-Walton, B., K.M. Clark, B.R. Holt, D.C. Jones, S.D. Kaplan, J.S. Krebs, P. Polson, R.A.
27 Shepherd, and J.R. Young. 1979. *Potential Environmental Effects of 765-kV Transmission*
28 *Lines: Views Before the New York State Public Service Commission, Cases 26529 and 26559,*
29 *1976–1978*. DOE/EV-0056, U.S. Department of Energy, Washington, D.C. Accessed June 1,
30 2022, at: <https://doi.org/10.2172/5766103>. TN7480.

31 SNYPSC (State of New York Public Service Commission). 1978. *Opinion No. 78-13, Opinion*
32 *and Order Determining Health and Safety Issues, Imposing Operating Conditions, and*
33 *Authorizing, in Case 26529, Operation Pursuant to Those Conditions*. Power Authority of the
34 State of New York, Albany, New York. TN7478.

35 Solley, W.B., R.R. Pierce, and H.A. Perlman. 1998. *Estimated Use of Water in the United States*
36 *in 1995*. USGS Circular 1200. Accessed June 5, 2022, at <https://doi.org/10.3133/cir1200>.
37 TN7508.

- 1 Stein, S., C. Stein, J. Kley, R. Keller, M. Merino, E. Wolin, D. Wiens, Michael Wyession, G. Al-
2 Equabi, W. Shen, A. Frederiksen, Fiona Darbyshire, D. Jurdy, Gregory Waite, W. Rose, E. Vye,
3 T. Rooney, R. Moucha, and E. Brown. 2016. "New Insights into North America's Midcontinent
4 Rift." *EOS: Earth & Space Science News* 97(18):1-16, Washington, D.C. TN9868.
- 5 Stewig, J.D. and B. Chapman. 2009. *Fisheries Assessment of the Mississippi River in Wright,
6 Stearns and Sherburne Counties 2007, River Miles 879 to 926*. F-29-R(P), Minnesota
7 Department of Natural Resources Division of Fisheries and Wildlife, St. Paul, Minnesota.
8 TN9337.
- 9 Su, S.H., L.C. Pearlman, J.A. Rothrock, T.J. Iannuzzi, and B.L. Finley. 2002. "Potential Long-
10 Term Ecological Impacts Caused by Disturbance of Contaminated Sediments: A Case Study."
11 *Environmental Management* 29(2):234-249. Cham, Switzerland. Accessed June 13, 2022, at
12 <https://doi.org/10.1007/s00267-001-0005-3>. TN7742.
- 13 Taylor, W.K., and B.H. Anderson. 1973. "Nocturnal migrants killed at a central Florida TV tower;
14 Autumns 1969-1971." *The Wilson bulletin* 85(1):42-51. TN8508.
- 15 Tegen, S. 2016. "Wind Energy Workforce Development & Jobs." *Nebraska Wind and Solar
16 Conference*, Lincoln, Nebraska. TN8826.
- 17 Theriot, A., M. Travisano, A. Downing, and A. Parham. 2023. *Architectural History Survey of
18 Monticello Nuclear Generating Plant, Wright County, Minnesota*. New Orleans, Louisiana.
19 TN9689.
- 20 Thompson, M., J.A. Beston, M. Etterson, J.E. Diffendorfer, and S.R. Loss. 2017. "Factors
21 Associated with Bat Mortality at Wind Energy Facilities in the United States." *Biological
22 Conservation*, 215:241-254, Elsevier, Amsterdam, Netherlands. TN8746.
- 23 TVA (Tennessee Valley Authority). 2013. *Sequoyah Nuclear Plant, Units 1 and 2, License
24 Renewal Application, Appendix E, Applicant's Environmental Report, Operating License
25 Renewal Stage*. Chattanooga, Tennessee: TVA. January 7, 2013. ADAMS Nos. ML13024A012,
26 ML13024A013, ML13024A006, ML13024A007, ML13024A008, ML13024A009, and
27 ML13024A010. TN7899.
- 28 UNSCEAR (United Nations Scientific Committee on the Effects of Atomic Radiation). 2010.
29 "Sources and Effects of Ionizing Radiation. UNSCEAR 2008 Report to the General Assembly
30 with Scientific Annexes. Volume 1: Sources." New York, New York. Available at
31 [https://www.unscear.org/unscear/uploads/documents/unscear-
32 reports/UNSCEAR_2008_Report_Vol.I-CORR.pdf](https://www.unscear.org/unscear/uploads/documents/unscear-reports/UNSCEAR_2008_Report_Vol.I-CORR.pdf). TN7974.
- 33 USACE (U.S. Army Corps of Engineers). 2012. *Treaty Rights and Subsistence Fishing in the
34 U.S. Waters of the Great Lakes, Upper Mississippi River, and Ohio River Basins*. Washington,
35 D.C. TN9848.
- 36 USACE (United States Army Corps of Engineers). Undated. "The Mississippi Drainage Basin."
37 New Orleans, Louisiana. Accessed January 12, 2024, at
38 [https://www.mvn.usace.army.mil/Missions/Mississippi-River-Flood-Control/Mississippi-River-
39 Tributaries/Mississippi-Drainage-Basin/](https://www.mvn.usace.army.mil/Missions/Mississippi-River-Flood-Control/Mississippi-River-Tributaries/Mississippi-Drainage-Basin/). TN9629.

- 1 USCB (United States Census Bureau). 2000. "Profile of General Demographic Characteristics:
2 2000, Hood County, Texas; Somervell County, Texas; Tarrant County, Texas." Washington,
3 D.C. Available at
4 <https://data.census.gov/table?q=2000+population&t=Population+Total&q=050XX00US48221,48425,48439&tid=DECENNIALDPSF42000.DP1>. TN9672.
- 6 USCB (United States Census Bureau). 2020. "2020 Decennial Census, Profile of General
7 Population and Housing Characteristics, Hood County, Texas; Somervell County, Texas;
8 Tarrant County, Texas; Texas." Washington, D.C. Available at
9 https://data.census.gov/table?q=040XX00US48_050XX00US48221,48425,48439&d=DEC+Demographic+Profile. TN9673.
- 11 USCB (United States Census Bureau). 2020. "Hispanic or Latino Origin by Race, 2020
12 Decennial Census, DEC Demographic and Housing Characteristics, Total Population,
13 Wisconsin and Minnesota." Washington, D.C. Available at
14 [https://data.census.gov/table?q=P5:+HISPANIC+OR+LATINO+ORIGIN+BY+RACE&q=040XX00US27\\$1500000,55\\$1500000&y=2020&d=DEC+Demographic+and+Housing+Characteristics](https://data.census.gov/table?q=P5:+HISPANIC+OR+LATINO+ORIGIN+BY+RACE&q=040XX00US27$1500000,55$1500000&y=2020&d=DEC+Demographic+and+Housing+Characteristics).
15 TN9674.
- 17 USCB (United States Census Bureau). 2021. "Poverty Status of Individuals in the Past 12
18 Months by Living Arrangement, 2021: ACS 5-Year Estimates Detailed Table B17021,
19 Wisconsin, Minnesota." Washington, D.C. Available at
20 [https://data.census.gov/table/ACS5Y2021.B17021?q=B17021:%20POVERTY%20STATUS%20OF%20INDIVIDUALS%20IN%20THE%20PAST%2012%20MONTHS%20BY%20LIVING%20ARRANGEMENT&q=040XX00US27\\$1500000,55\\$1500000&y=2021&d=ACS%205-Year%20Estimates%20Detailed%20Tables](https://data.census.gov/table/ACS5Y2021.B17021?q=B17021:%20POVERTY%20STATUS%20OF%20INDIVIDUALS%20IN%20THE%20PAST%2012%20MONTHS%20BY%20LIVING%20ARRANGEMENT&q=040XX00US27$1500000,55$1500000&y=2021&d=ACS%205-Year%20Estimates%20Detailed%20Tables). TN9676.
- 24 USCB (U.S. Census Bureau). 2021. "Poverty Thresholds by Size of Family and Number of
25 Children." Washington, D.C. Accessed September 5, 2023, at
26 <https://www.census.gov/data/tables/time-series/demo/income-poverty/historical-poverty-thresholds.html>. TN8833.
- 28 USCB (U.S. Census Bureau). 2021. "Selected Economic Characteristics, 5-Year Estimates,
29 Table ID: DP03." Washington, D.C. Accessed August 30, 2023, at
30 <https://data.census.gov/table?tid=ACSDP1Y2021.DP03>. TN8818.
- 31 USCB (U.S. Census Bureau). 2022. "American Community Survey 2017-2021 5-Year Data
32 Release." Washington, D.C. Accessed December 13, 2023, at
33 <https://www.census.gov/newsroom/press-kits/2022/acs-5-year.html>. TN9556.
- 34 USDA (United States Department of Agriculture). 2017. "2017 Census Volume 1, Chapter 2:
35 County Level Data, Texas." Washington, D.C. Available at
36 https://www.nass.usda.gov/Publications/AgCensus/2017/Full_Report/Volume_1,_Chapter_2_County_Level/Texas/. TN9674.
- 38 USDOJ (U.S. Department of Justice). 2023. "Minnesota V. Mille Lacs Band." Washington, D.C.
39 Accessed January 15, 2024, at <https://www.justice.gov/enrd/indian-resources-section/minnesota-v-mille-lacs-band>. TN9665.
- 41 USGCRP (U.S. Global Change Research Program). 2014. *Climate Change Impacts in the
42 United States: The Third National Climate Assessment*. J.M. Melillo, T.C. Richmond, and G.W.

- 1 Yohe (eds.). U.S. Government Printing Office, Washington, D.C. ADAMS Accession No.
2 ML14129A233. TN3472.
- 3 USGCRP (U.S. Global Change Research Program). 2017. *Climate Science Special Report:
4 Fourth National Climate Assessment*. Volume I. Wuebbles, D.J., D.W. Fahey, K.A. Hibbard, D.J.
5 Dokken, B.C. Stewart, and T.K. Maycock (eds.). Washington, D.C. ADAMS Accession No.
6 ML19008A410. doi: 10.7930/J0J964J6. TN5848.
- 7 USGCRP (U.S. Global Change Research Program). 2018. *Impacts, Risks, and Adaptation in
8 the United States: Fourth National Climate Assessment*. Volume II. D.R. Reidmiller, C.W. Avery,
9 D.R. Easterling, K.E. Kunkel, K.L.M. Lewis, T.K. Maycock, and B.C. Stewart (eds.). Washington,
10 D.C. ADAMS Accession No. ML19008A414. doi: 10.7930/NCA4.2018. TN5847.
- 11 USGCRP (U.S. Global Change Research Program). 2023. *The Fifth National Climate
12 Assessment*. A.R. Crimmins, C.W. Avery, D.R. Easterling, K.E. Kunkel, B.C. Stewart, and T.K.
13 Maycock, Eds. Washington, D.C. Available at <https://doi.org/10.7930/NCA5.2023>. TN9762.
- 14 USGS (U.S. Geological Survey). 1992. *Ground Water Atlas of the United States, Segment 9:
15 Iowa, Michigan, Minnesota, Wisconsin*. Hydrologic Investigations Atlas 730-J, U.S. Geological
16 Survey, Reston, Virginia. TN9637.
- 17 USGS (U.S. Geological Survey). 2008. *Assessment of Moderate- and High-Temperature
18 Geothermal Resources of the United States*. Fact Sheet 2008–3082, Menlo Park, California.
19 Accessed June 12, 2022, at <https://pubs.usgs.gov/fs/2008/3082/pdf/fs2008-3082.pdf>. TN7697.
- 20 USGS (U.S. Geological Survey). 2014. “Documentation for the 2014 Update of the United
21 States National Seismic Hazard Maps.” U.S. Geological Survey Open-File Report 2014–1091,
22 Reston, Virginia. Available at <http://pubs.usgs.gov/of/2014/1091/pdf/ofr2014-1091.pdf>. TN6177.
- 23 USGS (U.S. Geological Survey). 2016. “Bat Fatalities at Wind Turbines- Investigating the
24 Causes and Consequences.” Reston, Virginia. Available at [https://www.usgs.gov/centers/fort-
25 collins-science-center/science/bat-fatalities-wind-turbines-investigating-causes-and?qt-
26 science_center_objects=0#qt-science_center_objects](https://www.usgs.gov/centers/fort-collins-science-center/science/bat-fatalities-wind-turbines-investigating-causes-and?qt-science_center_objects=0#qt-science_center_objects). TN8510.
- 27 USGS (U.S. Geological Survey). 2023. “Minnesota geologic map data.” Washington, D.C.
28 Available at <https://mrddata.usgs.gov/geology/state/state.php?state=MN>. TN9261.
- 29 USGS (U.S. Geological Survey). 2023. “Search Earthquake Catalog, Earthquake Hazards
30 Program.” Latitude 45.333, Longitude -98.8333, Reston, Virginia. Available at
31 <https://earthquake.usgs.gov/earthquakes/search/>. TN9263.
- 32 USGS (U.S. Geological Survey). 2023. “The Mineral Industry of Minnesota, Minerals Yearbook
33 Vol. II - Domestic.” Accessed October 2, 2023, at [https://www.usgs.gov/centers/national-
34 minerals-information-center/mineral-industry-minnesota](https://www.usgs.gov/centers/national-minerals-information-center/mineral-industry-minnesota). TN9087.
- 35 USGS (U.S. Geological Survey). 2024. “USGS 05270700 Mississippi River At St. Cloud, MN:
36 Discharge, cubic feet per second (Mean) 1988-2023.” Reston, Virginia. Accessed January 15,
37 2024, at
38 [https://nwis.waterdata.usgs.gov/nwis/dv?cb_00060=on&format=rdb&site_no=05270700&legacy
39 =&referred_module=sw&period=&begin_date=1988-10-01&end_date=2023-10-09](https://nwis.waterdata.usgs.gov/nwis/dv?cb_00060=on&format=rdb&site_no=05270700&legacy=&referred_module=sw&period=&begin_date=1988-10-01&end_date=2023-10-09). TN9647.

- 1 USGS (U.S. Geological Survey). 2024. "USGS Surface-Water Annual Statistics for the Nation:
2 USGS 05270700 Mississippi River At St. Cloud, MN." Reston, Virginia. Accessed January 15,
3 2024, at
4 https://nwis.waterdata.usgs.gov/nwis/annual/?referred_module=sw&site_no=05270700∓por_05270700_73091=899978,00060,73091,1989,2023&year_type=W&format=html_table&date_format=YYYY-MM-DD&rdb_compression=file&submitted_form=parameter_selection_list. TN9646.
- 8 USGS (U.S. Geological Survey). 2024. "USGS Surface-Water Mean Daily Statistics for the
9 Nation: USGS 05270700 Mississippi River At St. Cloud, MN." Reston, Virginia. Accessed
10 January 12, 2024, at
11 https://waterdata.usgs.gov/nwis/dvstat/?referred_module=sw&site_no=05270700&por_05270700_73091=899978,00060,73091,1988-10-01,2023-08-20&format=html_table&stat_cds=mean_va&date_format=YYYY-MM-DD&rdb_compression=file&submitted_form=parameter_selection_list. TN9631.
- 15 USGS (U.S. Geological Survey). 2024. "USGS Surface-Water Maximum Daily Statistics for the
16 Nation: USGS 05270700 Mississippi River At St. Cloud, MN." Reston, Virginia. Accessed
17 January 12, 2024, at
18 https://waterdata.usgs.gov/nwis/dvstat/?referred_module=sw&site_no=05270700&por_05270700_73091=899978,00060,73091,1988-10-01,2023-08-20&format=html_table&stat_cds=max_va&date_format=YYYY-MM-DD&rdb_compression=file&submitted_form=parameter_selection_list. TN9632.
- 22 USGS (U.S. Geological Survey). 2024. "USGS Surface-Water Minimum Daily Statistics for the
23 Nation: USGS 05270700 Mississippi River At St. Cloud, MN." Reston, Virginia. Accessed
24 January 12, 2024, at
25 https://waterdata.usgs.gov/nwis/dvstat/?referred_module=sw&site_no=05270700&por_05270700_73091=899978,00060,73091,1988-10-01,2023-08-20&format=html_table&stat_cds=min_va&date_format=YYYY-MM-DD&rdb_compression=file&submitted_form=parameter_selection_list. TN9634.
- 29 Van Gelder, R.G. 1956. "Echo-Location Failure in Migratory Bats." *Transactions of the Kansas
30 Academy of Science* 59(2):220-222. TN8505.
- 31 Varfalvy, L., R.D. Dallaire, P.S. Maruvada, and N. Rivest. 1985. "Measurement and Statistical
32 Analysis of Ozone from HVDC and HVAC Transmission Lines." *IEEE Transactions on Power
33 Apparatus and Systems* PAS- 104(10): 2789 - 2797. DOI: 10.1109/TPAS.1985.319122.
34 Piscataway, New Jersey. Accessed May 16, 2022, at
35 <https://dx.doi.org/10.1109/TPAS.1985.319122>. TN7364.
- 36 WAPA/FWS (Western Area Power Administration, U.S. Fish and Wildlife Service). 2015. *Upper
37 Great Plains Wind Energy Programmatic Environmental Impact Statement, Final*. DOE/EIS-
38 0408, Billings, Montana and Lakewood, Colorado. TN8725.
- 39 WCPZ (Wright County Planning & Zoning). 2022. Letter from Edward Pettit, Environmental
40 Health Supervisor, to MBE Sand and Gravel Mine EAW Recipient, dated July 12, 2022,
41 regarding "EAW comment period timeline." Buffalo, Minnesota. TN9090.
- 42 White, D. 2020. *Ecological regions of Minnesota: Level II and IV maps and descriptions*. EPA,
43 Washington, D.C. TN9281.

1 Wight County Office of Planning and Zoning. 2007. *Land Use Plan: Northeast Quadrant (NEQ)*
2 *Land Use Plan Buffalo, Monticello and Rockford Townships Shaping NE Wright County's*
3 *Future*. Buffalo, Minnesota. Available at
4 [https://www.co.wright.mn.us/DocumentCenter/View/236/Northeast-Quadrant-Land-Use-Plan---](https://www.co.wright.mn.us/DocumentCenter/View/236/Northeast-Quadrant-Land-Use-Plan---Adopted-07-31-07-PDF)
5 [Adopted-07-31-07-PDF](https://www.co.wright.mn.us/DocumentCenter/View/236/Northeast-Quadrant-Land-Use-Plan---Adopted-07-31-07-PDF). TN9693.

6 Wilber D.H., D.G. Clarke, and M.H. Burlas. 2006. "Suspended Sediment Concentrations
7 Associated with a Beach Nourishment Project on the Northern Coast of New Jersey." *Journal of*
8 *Coastal Research* 22(5):1035-1042. DOI:10.2112/04-0268.1. Accessed June 8, 2022, at
9 <https://doi.org/10.2112/04-0268.1>. TN7563.

10 Wright County. 2023. *Annual Comprehensive Financial Report of Wright County, Minnesota,*
11 *Year Ended December 31, 2022*. Buffalo, Minnesota. TN9839.

12 Wight County. Undated. "Wright County Land Use Plan." Buffalo, Minnesota. Accessed January
13 18, 2024, at <https://www.co.wright.mn.us/184/Wright-County-Land-Use-Plan>. TN9692.

14 Xcel (Xcel Energy Environmental Services). 2004. *Monticello Nuclear Generating Plant*
15 *Environmental Monitoring Program 2002-2003 Report*. Minneapolis, Minnesota. ADAMs
16 Accession No. ML052010508. TN9581.

17 Xcel Energy. 2008. Letter from S.M. Wilensky, Acting Vice President, to B.W. Haar, Executive
18 Secretary, Minnesota Public Utilities Commission, dated February 14, 2008, regarding "Petition
19 to the Minnesota Public Utilities Commission for a Certificate of Need for the Monticello Nuclear
20 Generating Plant for Extended Power Uprate Docket No. E002/CB-08-____." Minneapolis,
21 Minnesota. TN9536.

22 Xcel (Xcel Energy). 2019. Letter from C. Church, Site Vice President Monticello Nuclear
23 Generating Plant, to NRC Document Control Desk, dated May 13, 2019, regarding "Monticello
24 Nuclear Generating Plant Docket No. 50-263, Renewal License Numbers DPR-22, 2018 Annual
25 Radioactive Effluent Release Report." Monticello, Minnesota. ADAMs Accession No.
26 ML19134A243. TN9599.

27 Xcel (Xcel Energy). 2019. Letter from C. Church, Site Vice President Monticello Nuclear
28 Generating Plant, to NRC Document Control Desk, dated May 13, 2019, regarding "Monticello
29 Nuclear Generating Plant, Docket No. 50-263, Renewed Facility Operating License No. DPR-
30 22, 2018 Annual Radiological Environmental Operating Report." Monticello, Minnesota. ADAMs
31 Accession No. ML19134A241. TN9621.

32 Xcel (Xcel Energy). 2020. Letter from T. Conboy, Site Vice President Monticello Nuclear
33 Generating Plant, to NRC Document Control Desk, dated May 14, 2020, regarding "Monticello
34 Nuclear Generating Plant Docket No. 50-263, Renewal License Numbers DPR-22, 2019 Annual
35 Radioactive Effluent Release Report." Monticello, Minnesota. ADAMs Accession No.
36 ML20135H153. TN9598.

37 Xcel (Xcel Energy). 2020. Letter from T. Conboy, Site Vice President Monticello Nuclear
38 Generating Plant, to NRC Document Control Desk, dated May 14, 2020, regarding "Monticello
39 Nuclear Generating Plant, Docket No. 50-263, Renewed Facility Operating License No. DPR-
40 22, 2019 Annual Radiological Environmental Operating Report." Monticello, Minnesota. ADAMs
41 Accession No. ML20135H150. TN9612.

1 Xcel (Xcel Energy). 2021. Letter from T. Conboy, Site Vice President Monticello Nuclear
2 Generating Plant, to NRC Document Control Desk, dated May 13, 2021, regarding "Monticello
3 Nuclear Generating Plant Docket No. 50-263, Renewal License Numbers DPR-22, 2020 Annual
4 Radioactive Effluent Release Report." Monticello, Minnesota. ADAMs Accession No.
5 ML21133A496. TN9597.

6 Xcel (Xcel Energy). 2021. Letter from T. Conboy, Site Vice President Monticello Nuclear
7 Generating Plant, to NRC Document Control Desk, dated May 13, 2021, regarding "Monticello
8 Nuclear Generating Plant, Docket No. 50-263, Renewed Facility Operating License No. DPR-
9 22, 2020 Annual Radiological Environmental Operating Report." Monticello, Minnesota. ADAMs
10 Accession No. ML21133A495. TN9613.

11 Xcel (Xcel Energy). 2021. Letter from T.A. Conboy, Site Vice President, Monticello Nuclear
12 Generating Plant, to NRC Document Control Desk, dated February 11, 2021, regarding
13 "Submittal of Revision 38 to the Updated Safety Analysis Report." Monticello, Minnesota.
14 ADAMs Accession No. ML21070A105. TN9633.

15 Xcel (Xcel Energy). 2022. Letter from S. Hafen, Plant Manager Monticello Nuclear Generating
16 Plant, to NRC Document Control Desk, dated May 11, 2022, regarding "Monticello Nuclear
17 Generating Plant Docket No. 50-263, Renewal License Numbers DPR-22, 2021 Annual
18 Radioactive Effluent Release Report." Monticello, Minnesota. ADAMs Accession No.
19 ML22131A300. TN9595.

20 Xcel (Xcel Energy). 2022. Letter from S. Hafen, Plant Manager Monticello Nuclear Generating
21 Plant, to NRC Document Control Desk, dated May 11, 2022, regarding "Monticello Nuclear
22 Generating Plant, Docket No. 50-263, Renewed Facility Operating License No. DPR-22, 2021
23 Annual Radiological Environmental Operating Report." Monticello, Minnesota. ADAMs
24 Accession No. ML22131A299. TN9614.

25 Xcel (Xcel Energy). 2023. Letter from S. Hafen, Plant Manager Monticello Nuclear Generating
26 Plant, to NRC Document Control Desk, dated May 10, 2023, regarding "Monticello Nuclear
27 Generating Plant Docket No. 50-263, Renewal License Numbers DPR-22, 2022 Annual
28 Radioactive Effluent Release Report." Monticello, Minnesota. ADAMs Accession No.
29 ML23130A190. TN9596.

30 Xcel (Xcel Energy). 2023. Letter from S. Hafen, Plant Manager Monticello Nuclear Generating
31 Plant, to NRC Document Control Desk, dated May 10, 2023, regarding "Monticello Nuclear
32 Generating Plant, Docket No. 50-263, Renewed Facility Operating License No. DPR-22, 2022
33 Annual Radiological Environmental Operating Report." Monticello, Minnesota. ADAMs
34 Accession No. ML23130A188. TN9615.

35 Xcel (Xcel Energy). 2023. Letter from C.P. Domingos, Site Vice President, Monticello and
36 Prairie Island Nuclear Generating Plant Northern States Power Company, to NRC Document
37 Control Desk, dated January 9, 2023, regarding "Monticello Nuclear Generating Plant Docket
38 No. 50-263, Renewal License Numbers DPR-22 Application for Subsequent Renewal Operating
39 License." Monticello, Minnesota. ADAMs Accession No. ML23009A352. TN9084.

40 Xcel (Xcel Energy). 2023. Letter from S. Hafen, Site Vice President Monticello Nuclear
41 Generating Plant, to NRC Document Control Desk, dated December 18, 2023, regarding
42 "Monticello Nuclear Generating Plant, Docket No. 50-263, Renewed Facility Operating License
43 No. DPR-22, Subsequent License Renewal Application Response to Request for Additional

1 Information and Request for Confirmation of Information - Set 1 Part 2." Monticello, Minnesota.
2 ADAMs Accession No. ML23352A081. TN9609.

3 Xcel (Xcel Energy). 2023. Letter from S. Hafen, Site Vice President Monticello Nuclear
4 Generating Plant, to NRC Document Control Desk, dated November 21, 2023, regarding
5 "Monticello Nuclear Generating Plant Docket No. 50-263, Renewal License Numbers DPR-22
6 Subsequent License Renewal Application Response to Request for Additional Information and
7 Request for Confirmation of Information - Set 1." Monticello, Minnesota. ADAMs Accession No.
8 ML23332A182. TN9578.

9 Xcel (Xcel Energy). 2024. Email from S. Sollum, Senior Engineer, P.E., Subsequent License
10 Renewa to J. Umana, dated March 27, 2024, regarding "[External_Sender] RE: Requests for
11 Information to Support DEIS." Monticello, Minnesota. ADAMs Accession No. ML24092A215.
12 TN9860.

13 Xcel (Xcel Energy). 2024. Letter from S. Hafen, Site Vice President Monticello
14 NuclearGenerating Plant, to NRC Document Control Desk, dated February 20, 2024, regarding
15 "Monticello Nuclear Generating Plant, Docket No. 50-263, Renewed Facility Operating License
16 No. DPR-22, Subsequent License Renewal Application Response to Request for Additional
17 Information and Request for Confirmation of Information - Set 1 Part 1." Monticello, Minnesota.
18 ADAMs Accession No. ML24088A215. TN9859.

19 Xcel (Xcel Energy). 2024. *Monticello Groundwater: Progress on the recovery and treatment of*
20 *tritium in the groundwater at the Monticello Nuclear Generating Plant.* Monticello, Minnesota.
21 TN9645.

22 Zahorik, P. and J. Kelly. 2007. "Accurate vocal compensation for sound intensity loss with
23 increasing distance in natural environments." *The Journal of the Acoustical Society of America*
24 122(5), Falmouth, Massachusetts. TN9627.

25 Zinn, T.L., and W.W. Baker. 1979. "Seasonal Migration of the Hoary Bat, *Lasiurus cinereus*,
26 through Florida." *Journal of Mammalogy* 60(3):634-635. TN8507.

1

6 LIST OF PREPARERS

2 Members of the U.S. Nuclear Regulatory Commission’s (NRC's) Office of Nuclear Material
 3 Safety and Safeguards prepared this draft site-specific environmental impact statement with
 4 assistance from other NRC organizations and Pacific Northwest National Laboratory (PNNL).
 5 Table 6-1 identifies each contributor’s name, education, affiliation, and function or expertise.

6

Table 6-1 List of Preparers

Name	Education and Experience	Function or Expertise
Beth Alferink, NRC	MS Environmental Engineering MS Nuclear Engineering BS Nuclear Engineering 25+ years of national laboratory, industry, and government experience including radiation detection and measurements, nuclear power plant emergency response, operations, health physics, decommissioning, shielding and criticality	Human Health, Termination of Operations and Decommissioning, Radiological and Nonradiological Waste Management, Uranium Fuel Cycle, Spent Fuel
Briana Arlene, NRC	Master’s Certification, National Environmental Policy Act BS Conservation Biology 18 years of experience in ecological impact analysis, Endangered Species Act Section 7 consultations, and Essential Fish Habitat consultations	Terrestrial Resources, Aquatic Resources, Federally Protected Ecological Resources
Lloyd Desotell, NRC	MS Civil Engineering MS Water Resources Management BA Environmental Studies Over 20 years of experience conducting surface and subsurface hydrologic analyses	Surface Water Resources, Groundwater Resources
Elijah Dickson, NRC	PhD Radiation Health Physics MHP Radiation Health Physics BS Radiation Health Physics 15+ years of experience in radiological consequence analysis, source terms, probabilistic risk assessment, technical reviews.	Postulated Accidents
Jerry Dozier, NRC	MS Reliability Engineering MBA Business Administration BS Mechanical Engineering 30+ years of experience including operations, reliability engineering, technical reviews, and NRC branch management	Postulated Accidents
Lifeng Guo, NRC	PhD Hydrogeology MS Geology BS Hydrogeology and Engineering Geology Registered Professional Geologist Over 30 years of combined experience in hydrogeologic investigation, hydrogeochemical analysis, and remediation	Surface Water Resources, Groundwater Resources, and Geologic Environment

Table 6-1 List of Preparers (Continued)

Name	Education and Experience	Function or Expertise
Caroline Hsu, NRC	BS Molecular Biology BA English Literature 13 years of government experience	Land Use and Visual Resources, Terrestrial Resources, Socioeconomics, Environmental Justice
Stephen Koenick, NRC	BS Mechanical Engineering MS Environmental Engineering Over 30 years of government experience	Management Oversight
Nancy Martinez, NRC	BS Earth and Environmental Science AM Earth and Planetary Science 13 years of experience in environmental impact analysis	Meteorology, Air Quality, Noise, Greenhouse Gas Emissions and Climate Change, and Historic and Cultural Resources,
Leah Parks, NRC	PhD Environmental Management MS Environmental Engineering BS Systems and Information Engineering 17 years of academic and government experience including nuclear power plant operations, health physics, decommissioning, waste management, environmental impact analysis, and performance assessment	Radiological and Nonradiological Waste Management, Spent Nuclear Fuel
Jeffrey Rikhoff, NRC	MRP Regional Environmental Planning MS Development Economics BA English 43 years of combined industry and Government experience in NEPA compliance for DOE Defense Programs/NNSA and Nuclear Energy, DoD, and DOI; project management; socioeconomics and environmental justice impact analysis, historic and cultural resource impact assessments, consultation with American Indian Tribes, and comprehensive land use and development planning studies	Land Use, Visual Resources, Air Quality and Noise, Cumulative Impacts
Michelle Rome, NRC	MS Biological Sciences BS Environmental Science 20 years of experience of governmental and industry experience in environmental impact analyses, endangered species consultations, essential fish habitat assessments, and regulatory analyses, including at the NRC and National Oceanic and Atmospheric Administration (NOAA)	Management Oversight
Ted Smith, NRC	MS Environmental Engineering BS Electrical Engineering 38 years of experience, including DOE Power Administration, support of site Environmental Management programs, and spent fuel management, oversight of U.S. Navy nuclear ships design, construction, and operation, NRC project management and management	Management Oversight

Table 6-1 List of Preparers (Continued)

Name	Education and Experience	Function or Expertise
Gerry Stirewalt, NRC	PhD Structural Geology Registered Professional Geologist (PG) and Certified Engineering Geologist (CEG) 50+ years of experience in Environmental and Engineering Geology	Geologic Environment; Groundwater
Jessica Umaña, NRC	BS Geography and Environmental Systems 20+ years project management experience	Environmental Project Manager
Teresa Carlon, PNNL	BS Information Technology; 30 years of experience as SharePoint administrator, project coordinator, and databases	Reference Coordinator
Caitlin Condon, PNNL	PhD Radiation Health Physics; BS Environmental Health; 6 years of experience in health physics, NEPA environmental impact assessments, waste management, radionuclide dispersion and dosimetry modeling.	Project Management
Cyler Conrad, PNNL	PhD in Anthropology (Archaeology); MA in Master of Anthropology (Archaeology); 12 years of Cultural Resources Management Experience	Historic and Cultural Resources
Cary Counts, PNNL	BS Ceramic Engineering MS Environmental Systems Engineering 50+ years of experience in reviewing and producing environmental documentation (e.g., environmental impact statements, environmental reports, etc.) for various Federal agencies.	Production Editor
Susan Ennor, PNNL	BA Journalism 40 years of experience in document planning, editing, and production	Production Editor
Tracy Fuentes, PNNL	PhD Urban Design and Planning MS Plant Biology BS Botany Over 15 years of experience, including NEPA planning; environmental impact analysis, environmental resource monitoring, data analysis, and research	Land Use, Terrestrial Resources
Dave Goodman, PNNL	JD Law BS Economics 12 years of experience including NEPA environmental impact assessments, ecological restoration, Endangered Species Act, land use and visual resources, and environmental law and policy	Cumulative Impacts, NEPA Regulatory Analyst
Philip Meyer, PNNL	PhD Civil Engineering MS Civil Engineering BA Physics 30+ years of experience in applied groundwater and unsaturated zone research; 15+ years of	Groundwater Resources, Geologic Environment

Table 6-1 List of Preparers (Continued)

Name	Education and Experience	Function or Expertise
	experience in groundwater resource assessment and environmental impact evaluation	
Ann Miracle, PNNL	PhD Molecular Immunology MS Molecular Genetics BA Biology Over 15 years of experience in ecological impact analysis, Endangered Species Act Section 7 consultations, and EFH consultations	Terrestrial Resources
Patrick Mirick, PNNL	MS Fisheries; BA Biology and Economics; 15 years of experience in environmental assessments, policy and technical analysis for fisheries, and public outreach and engagement	Aquatic Resources
Jaime Moore, PNNL	MPM Master of Project Management BS Business Administration 23 years of Project Management experience	Project Management
Jon Napier, PNNL	PhD Radiation Health Physics MS Health Physics BS Environmental Science Certified Health Physicist with 7 years of experience in health physics, nuclear materials inspections and licensing, and radiation safety	Radiological Human Health, Radiological Waste, Spent Nuclear Fuel
Michelle Niemeyer, PNNL	MS Agricultural Economics BS Agricultural Economics	Environmental Justice, Socioeconomics
Mike Parker, PNNL	BA English Literature 25 years of experience copyediting, document design, and formatting and 20 years of experience in technical editing	Document Production
Rajiv Prasad, PNNL	PhD Civil and Environmental Engineering MTech Civil Engineering BE Civil Engineering 25 years of experience in applying hydrologic principles to water resources engineering, hydrologic design, flooding assessments, environmental engineering, and impacts assessment including 15 years of experience in NEPA environmental assessments of surface water resources	Surface Water Resources
Adrienne Rackley, PNNL	MS Economics BA Business Administration AA General Studies	Environmental Justice, Socioeconomics
Lindsey Renaud, PNNL	MA Anthropology BA Anthropology 10 years in cultural resource management, NEPA environmental impact assessments and Section 106 and 110 compliance. Secretary of the Interior-qualified registered professional archaeologist. Experience in Tribal engagement and Native American Graves Protection and Repatriation Act (NAGPRA) compliance	Historical and Cultural Resources

Table 6-1 List of Preparers (Continued)

Name	Education and Experience	Function or Expertise
Kacoli Sen, PNNL	PhD Cancer Biology MS Zoology (specialization Ecology) BS Zoology Diploma in Environmental Law Over 6 years of technical and scientific editing and production experience	Production Editor
Isaiah Steinke, PNNL	PhD Electrical Engineering MS Data Analytics BS Materials Science and Engineering 10+ years of technical and scientific editing	Production Editor
Kazi Tamaddun, PNNL	PhD Civil and Environmental Engineering MS Civil Engineering 8 years of experience in hydrologic, hydraulic, ecosystem, and water systems modeling; hydro-climatology; climate change modeling and analysis	Surface Water Resources
Anita Waller, PNNL	BA English MA American Studies 20 years of experience in reference management, developmental and copyediting, and document production	Production Editor

AA = associate degree; AM = Master of Arts; BA = Bachelor of Arts; BE = Bachelor of Engineering; BS = Bachelor of Science; DoD = U.S. Department of Defense; DOE = Department of Energy; DOI = U.S. Department of Interior; EFH = essential fish habitat; MBA Master of Business Administration; MHP = Master of Public Health; MPM = Master of Project Management; MRP = Master of Regional Planning; MS = Master of Science; MTech = Masters of Technology; NEPA = National Environmental Policy Act of 1969; NNSA = National Nuclear Security Administration; NRC = U.S. Nuclear Regulatory Commission; PhD = Doctor of Philosophy; PMP = Project Management Professional; PNNL = Pacific Northwest National Laboratory.

1 **7 LIST OF AGENCIES, ORGANIZATIONS, AND PERSONS TO WHOM**
2 **THE NRC SENDS COPIES OF THIS EIS**

Name and Title	Affiliation and Address
Shawn Hafen	Xcel Energy
David Ogulei, Kathleen Kowal	U.S. Environmental Protection Agency, Region 5
U.S. Fish and Wildlife Service	Minnesota-Wisconsin Ecological Services Field Office
Reid Nelson	Office of Federal Agency Programs Advisory Council on Historic Preservation
Sarah J. Beimers	Minnesota State Historic Preservation Office
Kelly Applegate	Mille Lacs Band of Ojibwe
Charlie Lippert	Mille Lacs Band of Ojibwe

3

4

APPENDIX A

COMMENTS RECEIVED ON THE MONTICELLO POWER STATION, UNITS 1 AND 2 ENVIRONMENTAL REVIEW

The U.S. Nuclear Regulatory Commission (NRC) staff began the scoping process for the Environmental Review of Monticello subsequent license renewalSLR application January 31, 2023, in accordance with the National Environmental Policy Act of 1969 (NEPA) (42 U.S.C. § 4321, et seq-TN8608). On March 10th, 2023 the NRC issued a notice of intent to conduct an environmental scoping process for Monticello that was published in the Federal Register on March 10, 2023 *Federal Register* (88 FR 15103-TN9715). *Federal Register* notices are searchable using the notice number (e.g., 88 FR 15103) at [Regulations.gov](https://www.regulations.gov). In its notice, the NRC requested that members of the public and stakeholders submit comments on the North Anna subsequent license renewal environmental review to the Federal Rulemaking Website at [Regulations.gov](https://www.regulations.gov).

As part of the environment impact statement scoping process, the NRC staff held a in person public meeting on March 22, 2023, followed by a virtual public scoping meeting on March 29, 2023.

The in-person and the virtual public scoping meetings consisted of prepared statements by the NRC staff and a public comment session. Attendees provided oral statements that were recorded and transcribed by a certified court reporter. Written statements submitted at the public meeting are captured in the NRC's Agencywide Documents Access and Management System.

The transcript of the in-person meeting is an attachment of the scoping meeting summary dated May 1, 2023 (NRC 2023-TN9818), and the transcript of the virtual public scoping meeting is an attachment of the scoping meeting summary, dated May 1, 2023 (NRC 2024-TN9817). In addition to the comments received during the virtual and in-person public meeting, were also received electronically, via [Regulations.gov](https://www.regulations.gov) and email.

At the conclusion of the scoping process, the staff issued the Monticello Nuclear Power Plant Scoping Summary Report ML24059A342 (NRC 2024-TN9817). The report contains comments received during the public meetings and electronically during the scoping period as well as the NRC staff's initial consideration of those comments.

A.1 References

88 FR 15103. March 10, 2023. "Notice of Intent To Conduct Scoping Process and Prepare Environmental Impact Statement; Northern States Power Company—Minnesota; Monticello Nuclear Generating Plant, Unit 1." *Federal Register*, Nuclear Regulatory Commission. TN9715.

42 U.S.C. § 4321 et seq. U.S. Code Title 41, The Public Health and Welfare, Section 4321 "Congressional Declaration of Purpose." TN8608.

NRC (U.S. Nuclear Regulatory Commission). 2023. Memorandum from J. Umana, Project Manager Environmental Review License Renewal Branch, to T. Smith, Chief Environmental Review License Renewal Branch, dated May 1, 2023, regarding "Meeting Summary: Public Scoping Meeting for the Environmental Review of the Subsequent License Renewal Application

1 for Monticello Nuclear Generating Plant, Unit 1 (EPID No.: L-2023-SLE-0000).” Washington,
2 D.C. ADAMS Accession No. ML23110A013. TN9818.

3 NRC (U.S. Nuclear Regulatory Commission). 2024. Letter from S. Koenick, Chief Environmental
4 Project Management Branch 1, to S. Hafen, Site Vice President Northern States Power
5 Company, dated March 18, 2024, regarding “Issuance of Environmental Scoping Summary
6 Report Associated with the U.S. Nuclear Regulatory Commission Staff’s Review of the
7 Monticello Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application (Epid
8 Number: L-2023-Sle-0000) (Docket Number: 50-263).” Washington, D.C. ADAMS Accession
9 No. ML24059A288. TN9817.

10

APPENDIX B

APPLICABLE LAWS, REGULATIONS, AND OTHER REQUIREMENTS

There are several Federal laws and regulations that affect environmental protection, health, safety, compliance, and consultation at U.S. Nuclear Regulatory Commission (NRC)-licensed nuclear power plant sites. Some of these laws and regulations require permits by or consultations with other Federal agencies or State, Tribal, or local governments. Certain Federal environmental requirements have been delegated to State authorities for enforcement and implementation. Furthermore, States also have enacted laws to protect public health and safety and the environment. It is NRC policy that nuclear power plants are operated in a manner that provides adequate protection of public health and safety and protection of the environment through compliance with applicable Federal and State laws, regulations, and other requirements, as appropriate.

The Atomic Energy Act of 1954, as amended (42 U.S.C. 2011 et seq.-TN663), authorizes the NRC to enter into an agreement with any State to allow the State to assume regulatory authority for certain activities (see 42 U.S.C. 2021-TN6606). A State that enters into such an agreement with the NRC is called an Agreement State. Minnesota is one such NRC Agreement State, as outlined in the Agreement between the NRC and State of Minnesota for Discontinuance of Certain Commission Regulatory Authority and Responsibility within the State pursuant to the Section 274 of the Atomic Energy Act of 1954, as amended <https://www.nrc.gov/cdn/nmss/pdf/mnagreement.pdf> (NRC and MN 2006-TN9819).

The NRC discontinued the regulatory authority of the Commission, and the State of Minnesota assumed regulatory authority for the licensing, rulemaking, inspection, and enforcement activities involving: (1) radioactive materials produced as a result of processes related to the production or utilization of special nuclear material; (2) uranium and thorium source materials; and (3) special nuclear material in quantities not sufficient to form a critical mass. (NRC and MN 2006-TN9819). Integrated Materials Performance Evaluation Program review for the State of Minnesota, the Minnesota Department of Health regulated 148 specific licenses authorizing possession and use of radioactive materials. (IMPEP 2022, NRC 2022-TN9834). The NRC retains regulatory authority over all other activities not specifically discontinued, including the regulation of commercial nuclear power plants. (NRC and MN 2006-TN9819).

The Homeland Security and Emergency Management Preparedness program helps to ensure the health and safety of the public in the event of a radiological incident at the Monticello Nuclear Plant.

In addition to carrying out some Federal programs, State legislatures develop their own laws. State statutes can supplement, as well as implement, Federal laws for protection of air, surface water, and groundwater. State legislation may address solid waste management programs, locally rare or endangered species, and historic and cultural resources.

The U.S. Environmental Protection Agency (EPA) has the primary responsibility to administer the Clean Water Act (33 U.S.C. 1251 et seq.-TN662). The National Pollutant Discharge Elimination System program addresses water pollution by regulating the discharge of potential pollutants to waters of the United States. The Clean Water Act, as administered by the EPA, allows for primary enforcement and administration through State agencies, as long as the State program is at least as stringent as the Federal program.

1 The EPA has delegated the authority to issue National Pollutant Discharge Elimination System
 2 permits to the State of Minnesota. The Minnesota Pollution Control Agency provides oversight
 3 for public water supplies, provides permits to regulate the discharge of industrial and municipal
 4 wastewaters—including discharges to groundwater—and monitors State water resources for
 5 water quality.

6 **B.1 Federal and State Requirements**

7 Monticello Nuclear Generating Plant, Unit 1 (Monticello) is subject to various Federal and State
 8 requirements. Table B-1 lists the principal Federal and State regulations and laws that are
 9 considered or mentioned in this environmental impact statement for Monticello subsequent
 10 license renewal.

11 **Table B-1 Federal and State Requirements**

Law or Regulation	Requirements
Current Operating License and License Renewal	
Atomic Energy Act (AEA) (42 U.S.C. 2011 et seq.-TN663)	The AEA of 1954, as amended, and the Energy Reorganization Act (ERA) of 1974 (42 U.S.C. 5801 et seq.-TN4466) give the NRC the licensing and regulatory authority for commercial nuclear energy use. They allow the NRC to establish dose and concentration limits for protection of workers and the public for activities under NRC jurisdiction. The NRC implements its responsibilities under the AEA through regulations set forth in Title 10, “Energy,” of the <i>Code of Federal Regulations</i> (CFR).
Archeological and Historic Preservation Act of 1974, as amended (54 U.S.C. § 312501 et seq.-TN4844)	The Archeological and Historic Preservation Act establishes procedures for preserving historical and archeological resources. Analysis of environmental compliance includes assessing energy alternatives for possible impacts on prehistoric, historic, and traditional cultural resources.
Antiquities Act of 1906, as amended (54 U.S.C. §§ 320301–320303 and 18 U.S.C. § 1866(b)-TN6602)	The Antiquities Act protects historic and prehistoric ruins, monuments, and antiquities, including paleontological resources, on federally controlled lands from appropriation, excavation, injury, and destruction without permission.
American Indian Religious Freedom Act of 1978 (42 U.S.C. § 1996-TN5281)	The American Indian Religious Freedom Act protects Native Americans’ rights of freedom to believe, express, and exercise traditional religions.
Bald and Golden Eagle Protection Act of 1940, as amended (16 U.S.C. §§ 668–668d-TN1447)	The Bald and Golden Eagle Protection Act makes it unlawful to take, pursue, molest, or disturb bald and golden eagles, their nests, or their eggs anywhere in the United States. The U.S. Fish and Wildlife Service (FWS) may issue take permits to individuals, government agencies, or other organizations to authorize limited, non-purposeful disturbance of eagles, in the course of conducting lawful activities such as operating utilities or conducting scientific research.
Native American Graves Protection and Repatriation Act of 1990 (25 U.S.C. § 3001-TN1686)	The Native American Graves Protection and Repatriation Act establishes provisions for the treatment of inadvertent discoveries of Indian remains and cultural objects. When discoveries are made during ground-disturbing activities, the activity in the area must immediately stop, and reasonable protective efforts, proper notifications, and appropriate disposition of the discovered items must be pursued.

Table B-1 Federal and State Requirements (Continued)

Law or Regulation	Requirements
<p>Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) as amended by the Superfund Amendments and Reauthorization Act (42 U.S.C. § 9601 et seq.-TN6592)</p>	<p>CERCLA includes an emergency response program to respond to a release of a hazardous substance to the environment. Releases of source, byproduct, or special nuclear material from a nuclear incident are excluded from CERCLA requirements if the releases are subject to the financial protection requirements of the AEA. CERCLA is intended to provide a response to, and cleanup of, environmental problems that are not covered adequately by the permit programs of the many other environmental laws, including the Clean Air Act (CAA); CWA; Safe Drinking Water Act; Marine Protection, Research, and Sanctuaries Act (33 U.S.C. § 1401 et seq.-TN4479); Resource Conservation and Recovery Act (RCRA); and AEA. Under Section 120 of CERCLA, each department, agency, and instrumentality (e.g., a municipality) of the United States is subject to, and must comply with, CERCLA in the same manner as any nongovernmental entity (except for requirements for bonding, insurance, financial responsibility, or applicable time period). Under CERCLA, the EPA would have the authority to regulate hazardous substances at a facility in the event of a release or a “substantial threat of a release” of those materials. Releases greater than reportable quantities would be reported to the National Response Center. Assessment of alternatives for environmental compliance includes consideration of whether hazardous substances, in reportable quantity amounts, could be present at nuclear power plants during the license renewal term.</p>
<p>Emergency Planning and Community Right-to-Know Act (EPCRA) of 1986 (42 U.S.C. § 11001 et seq.-TN6603) (also known as “SARA Title III”)</p>	<p>The EPCRA, which is the major amendment to CERCLA (42 U.S.C. § 9601 et seq.-TN6592), establishes the requirements for Federal, State, and local governments; Tribes; and industry regarding emergency planning and “Community Right-to-Know” reporting on hazardous and toxic chemicals. The “Community Right-to-Know” provisions increase the public’s knowledge of and access to information about chemicals at individual facilities, their uses, and releases into the environment. States and communities working with facilities can use the information to improve chemical safety and protect public health and the environment. The EPCRA requires emergency planning and notice to communities and government agencies concerning the presence and release of specific chemicals. The EPA implements the EPCRA under regulations found in 40 CFR Part 355 (TN5493), Part 370 (TN6612), and Part 372 (TN6613).</p>
<p>Pollution Prevention Act of 1990 (42 U.S.C. § 13101 et seq.-TN6607)</p>	<p>The Pollution Prevention Act establishes a national policy for waste management and pollution control that focuses first on source reduction, then on environmental issues, safe recycling, treatment, and disposal.</p>
<p>National Environmental Policy Act of 1969 (NEPA), (42 U.S.C. 4321 et seq.-TN661)</p>	<p>NEPA requires Federal agencies to integrate environmental values into their decision-making process by considering the environmental impacts of proposed Federal actions and reasonable alternatives to those actions. NEPA establishes policy, sets goals (in Section 101), and provides means (in Section 102) for carrying out the policy. Section 102(2) contains provisions that force actions to make sure Federal agencies follow the letter and spirit of the Act. For major Federal actions significantly affecting the quality of the human environment, Section 102(2)(c) of the NEPA requires Federal</p>

Table B-1 Federal and State Requirements (Continued)

Law or Regulation	Requirements
	agencies to prepare a detailed statement that includes the environmental impacts of the proposed action and other specified information. This environmental impact statement (EIS) has been prepared in accordance with NEPA requirements and NRC regulations (10 CFR Part 51-TN250) for implementing NEPA to assure compliance with Section 102(2).
10 CFR Part 20 (TN283)	Regulations in 10 CFR Part 20, "Standards for Protection Against Radiation," establish standards for protection against ionizing radiation resulting from activities conducted under licenses issued by the NRC. These regulations are issued under the AEA of 1954, as amended, and the ERA of 1974, as amended. The purpose of these regulations is to control the receipt, possession, use, transfer, and disposal of licensed material by any licensee in such a manner that the total dose to an individual (including doses resulting from licensed and unlicensed radioactive material and from radiation sources other than background radiation) does not exceed the standards for protection against radiation prescribed in the regulations in this part.
10 CFR Part 50 (TN249)	Regulations in 10 CFR Part 50, "Domestic Licensing of Production and Utilization Facilities," are NRC regulations issued under the AEA, as amended, and Title II of the ERA of 1974, to provide for the licensing of production and utilization facilities, including power reactors.
10 CFR Part 51 (TN250)	Regulations in 10 CFR Part 51, "Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions," contain the NRC's regulations that implement NEPA.
10 CFR Part 54 (TN4878)	NRC regulations in 10 CFR Part 54, "Requirements for Renewal of Operating Licenses for Nuclear Power Plants," govern the issuance of renewed operating licenses and renewed combined licenses for nuclear power plants licensed under Sections 103 or 104b of the AEA, as amended, and Title II of the ERA of 1974. The regulations focus on managing adverse effects of aging. The rule is intended to ensure that important systems, structures, and components will continue to perform their intended functions during the period of extended operation.
Air Quality Protection	
Clean Air Act, (42 U.S.C. 7401 et seq.-TN1141)	The CAA is intended to "protect and enhance the quality of the Nation's air resources so as to promote the public health and welfare and the productive capacity of its population." The CAA establishes regulations to ensure maintenance of air quality standards and authorizes individual States to manage permits. Section 118 of the CAA requires each Federal agency, with jurisdiction over properties or facilities engaged in any activity that might result in the discharge of air pollutants, to comply with all Federal, State, inter-State, and local requirements regarding the control and abatement of air pollution. Section 109 of the CAA directs the EPA to set National Ambient Air Quality Standards (NAAQS) for criteria pollutants. The EPA has identified and set NAAQS for the following criteria pollutants: particulate matter, sulfur dioxide, carbon monoxide, ozone, nitrogen dioxide, and lead. Section 111 of the CAA requires the establishment of national performance standards for new or

Table B-1 Federal and State Requirements (Continued)

Law or Regulation	Requirements
	<p>modified stationary sources of atmospheric pollutants. Section 160 of the CAA requires that specific emission increases must be evaluated before permit approval to prevent significant deterioration of air quality. Section 112 requires specific standards for release of hazardous air pollutants (including radionuclides). These standards are implemented through plans developed by each State and approved by the EPA. The CAA requires sources to meet standards and obtain permits to satisfy those standards. Nuclear power plants may be required to comply with the CAA Title V, Sections 501–507, for sources subject to new source performance standards or sources subject to National Emission Standards for Hazardous Air Pollutants. EPA regulates the emissions of air pollutants using 40 CFR Parts 50 to 99 (TN5264).</p>
<p>Occupational Safety and Health Act (OSHA) of 1970 (29 U.S.C. § 651 et seq.-TN4453)</p>	<p>The OSHA establishes standards to enhance safe and healthy working conditions in places of employment throughout the United States. The Act is administered and enforced by the Occupational Safety and Health Administration, a U.S. Department of Labor agency. Employers who fail to comply with OSHA standards can be penalized by the Federal Government. The act allows States to develop and enforce OSHA standards if such programs have been approved by the U.S. Secretary of Labor.</p>
<p>Noise Control Act of 1972 (42 U.S.C. § 4901 et seq.-TN4294)</p>	<p>The Noise Control Act delegates the responsibility of noise control to State and local governments. Commercial facilities are required to comply with Federal, State, inter-State, and local requirements regarding noise control. Section 4 of the Noise Control Act directs Federal agencies to carry out programs in their jurisdictions “to the fullest extent within their authority” and in a manner that furthers a national policy of promoting an environment free from noise that jeopardizes health and welfare.</p>
Water Resources Protection	
<p>Clean Water Act (33 U.S.C. § 1251 et seq.-TN1067)</p>	<p>The CWA (formerly the Federal Water Pollution Control Act) was enacted to restore and maintain the chemical, physical, and biological integrity of the Nation’s water. The Act requires all branches of the Federal Government, with jurisdiction over properties or facilities engaged in any activity that might result in a discharge or runoff of pollutants to surface waters, to comply with Federal, State, inter-State, and local requirements.</p> <p>As authorized by the CWA, the NPDES permit program controls water pollution by regulating point sources that discharge pollutants into waters of the United States. The NPDES program requires all facilities that discharge pollutants from any point source into waters of the United States to obtain an NPDES permit. An NPDES permit is developed with two levels of controls: (1) technology-based limits and (2) water quality-based limits. NPDES permit terms may not exceed 5 years, and the applicant must reapply at least 180 days prior to the permit expiration date. A nuclear power plant may also participate in the NPDES General Permit for Industrial Stormwater due to stormwater runoff from industrial or commercial facilities to waters of the United States. The EPA is authorized under the CWA to directly implement</p>

Table B-1 Federal and State Requirements (Continued)

Law or Regulation	Requirements
	<p>the NPDES program, but the EPA has authorized many States to implement all or parts of the national program.</p> <p>Section 316(a) of the CWA addresses thermal effects and requires that facilities operate under effluents limitations that assure the protection and propagation of a balanced, indigenous population of shellfish, fish, and wildlife in and on the receiving body of water. Section 316(b) of the CWA requires that cooling-water intake structures of regulated facilities must reflect the best technology available for minimizing impingement mortality and entrainment of aquatic organisms. These sections of the CWA are implemented and enforced through the NPDES program.</p> <p>Section 401 of the CWA requires States to certify that the permitted discharge would comply with all limitations necessary to meet established State water quality standards, treatment standards, or schedule of compliance. Under this section, the EPA or a delegated State agency has the authority to review and approve, condition, or deny all permits or licenses that might result in a discharge to waters of the State, including wetlands. CWA Section 401 [33 U.S.C. 1341(a)(1)] states: "No license or permit shall be granted until the certification required by this section has been obtained or has been waived as provided in the preceding sentence. No license or permit shall be granted if certification has been denied by the State, interstate agency, or the Administrator, as the case may be." Therefore, the NRC cannot issue its license without a Section 401 Certification or an NRC determination that a waiver has occurred, in accordance with 40 CFR 121.9(c) (TN6718). In accordance with 10 CFR 50.54(aa) (TN249), conditions in the Section 401 Certification become a condition of the NRC license.</p> <p>The U.S. Army Corps of Engineers (USACE) is the lead agency for enforcement of CWA wetland requirements (33 CFR Part 320-TN424). A Section 404 permit would need to be obtained from the USACE before implementing any action, such as earthmoving activities and certain erosion controls, which could disturb wetlands. Federal and State permits/certifications are obtained using the same form and permit applications for activities affecting waterways and wetlands and are reviewed by the USACE in consultation with the FWS, the Soil Conservation Service, the EPA, and the delegated State agency.</p>
<p>Coastal Zone Management Act of 1972 (CZMA), as amended (16 U.S.C. 1451 et seq.-TN1243)</p>	<p>Congress enacted the CZMA in 1972 to address the increasing pressures of over-development upon the Nation's coastal resources. The National Oceanic and Atmospheric Administration administers the act. The CZMA encourages States to preserve, protect, develop, and, where possible, restore or enhance valuable natural coastal resources such as wetlands, floodplains, estuaries, beaches, dunes, barrier islands, and coral reefs, as well as the fish and wildlife using those habitats. Participation by States is voluntary. To encourage States to participate, the CZMA makes Federal financial assistance available to any coastal State or territory, including those on the Great Lakes that are willing to develop and implement a comprehensive coastal management program.</p>

Table B-1 Federal and State Requirements (Continued)

Law or Regulation	Requirements
	<p>Section 307(c)(3)(A) of the CZMA requires that applicants for Federal licenses who conduct activities in a coastal zone provide certification that the proposed activity complies with the enforceable policies of the State's coastal zone program. The NRC cannot issue its license without CZMA compliance by the applicant.</p>
<p>Safe Drinking Water Act of 1974 (SDWA) (42 U.S.C. § 300(f) et seq.-TN1337)</p>	<p>The SDWA was enacted to protect the quality of public water supplies and sources of drinking water and establishes minimum national standards for public water supply systems in the form of maximum contaminant levels for pollutants, including radionuclides. Other programs established by the SDWA include the Sole Source Aquifer Program, the Wellhead Protection Program, and the Underground Injection Control Program. In addition, the act provides underground sources of drinking water with protection from contaminated releases and spills.</p> <p>If a nuclear power plant is located within an area designated as a sole source aquifer pursuant to Section 1424(e) of the SDWA, the supplemental environmental impact statement would be subject to EPA review. If the EPA review raises concerns that nuclear power plant operations are not protective of groundwater quality, specific mitigation recommendations or additional pollution prevention requirements may be required.</p>
<p>Rivers and Harbors Act of 1899, Section 10 (33 U.S.C. § 401 et seq.-TN660)</p>	<p>The Rivers and Harbors Act of 1899 (33 U.S.C. § 401 et seq.) requires USACE authorization in order to protect navigable waters in the development of harbors and other construction and excavation. Section 10 of the act prohibits the unauthorized obstruction or alteration of any navigable water of the United States. That section provides that the construction of any structure in or over any navigable water of the United States, or the accomplishment of any other work affecting the course, location, condition, or physical capacity of such waters is unlawful unless the work has been authorized by the Secretary of the Army through the USACE. Activities requiring Section 10 permits include structures (e.g., piers, wharves, breakwaters, bulkheads, jetties, weirs, transmission lines) and work such as dredging or disposal of dredged material, or excavation, filling, or other modifications to the navigable waters of the United States.</p>
<p>Wild and Scenic Rivers Act, (16 U.S.C. 1271 et seq.-TN1811)</p>	<p>The Wild and Scenic Rivers Act created the National Wild and Scenic Rivers System that was established to protect the environmental values of free-flowing streams from degradation by impacting activities, including water resources projects.</p>
<p>Minnesota Pollution Control Agency (MPCA) National Pollution Discharge Program (NPDES) Minnesota Statutes Chapters 115 (TN9622) and 116 (TN9820) Permit MN0000868</p>	<p>The MPCA Implements the NPDES under the Clean Water Act (CWA).</p>

Table B-1 Federal and State Requirements (Continued)

Law or Regulation	Requirements
Minnesota Department of Natural Resources (MDNR), Minnesota Statutes Chapter 103 G. 255 – 315 Appropriation and Use of Waters (TN9648)	The MDNR Implements the Minnesota Statutes in Chapter 103 G 255 – 315 Water Diversion and Appropriation, “The Minnesota Surface Water Withdrawal, Permitting, Use, and Reporting Act,” and “establishes a system and rules for permitting and registering the withdrawal and use of surface water from within the State of Minnesota and those surface water shared with adjacent states.”
Waste Management and Pollution Prevention	
Resource Conservation and Recovery Act (RCRA) (42 U.S.C. 6901 et seq.-TN1281)	The RCRA requires the EPA to define and identify hazardous waste; establish standards for its transportation, treatment, storage, and disposal; and require permits for persons engaged in hazardous waste activities. Section 3006 (42 U.S.C. 6926) allows States to establish and administer these permit programs with EPA approval. The EPA regulations implementing the RCRA are found in 40 CFR Parts 260 through 283 (TN6617). Regulations imposed on a generator or on a treatment, storage, and/or disposal facility vary according to the type and quantity of material or waste generated, treated, stored, and/or disposed. The method of treatment, storage, and/or disposal also affects the extent and complexity of the requirements.
Nuclear Waste Policy Act of 1982 (42 U.S.C. § 10101 et seq.- TN740)	The Nuclear Waste Policy Act provides for the research and development of repositories for the disposal of high-level radioactive waste, spent nuclear fuel, and low-level radioactive waste. Title I includes the provisions for the disposal and storage of high-level radioactive waste and spent nuclear fuel. Subtitle A of Title I delineates the requirements for site characterization and construction of the repository and the participation of States and other local governments in the selection process. Subtitles B, C, and D of Title I deal with the specific issues for interim storage, monitored retrievable storage, and low-level radioactive waste.
Low-Level Radioactive Waste Policy Act of 1980, as amended (42 U.S.C. § 2021b et seq.- TN6606)	The Low-Level Radioactive Waste Policy Act amended the AEA to improve the procedures for implementation of compacts that provide for the establishment and operation of regional low-level radioactive waste disposal facilities. It also allows Congress to grant consent for certain inter-State compacts. The amended act sets forth the responsibilities for disposal of low-level waste by States or inter-State compacts. The act states the amount of waste that certain low-level waste recipients can receive over a set time period. The amount of low-level radioactive waste generated by both pressurized and boiling water reactor types is allocated over a transition period until a local waste facility becomes operational.
Hazardous Materials Transportation Act, as amended (49 U.S.C. § 5101 et seq.- TN6605)	The Hazardous Materials Transportation Act regulates the transportation of hazardous material (including radioactive material) in and between states. According to the act, States may regulate the transport of hazardous material as long as their regulation is consistent with provisions of the act or U.S. Department of Transportation regulations provided in 49 CFR Parts 171 through 177 (TN5466). Other regulations regarding packaging for transportation of radionuclides are contained in 49 CFR Part 173, Subpart I.

Table B-1 Federal and State Requirements (Continued)

Law or Regulation	Requirements
Protected Species	
Endangered Species Act (ESA) 16 U.S.C. 1531 et seq.-TN1010	The ESA was enacted to prevent the further decline of endangered and threatened species and to restore those species and their critical habitats. Section 7, "Interagency Cooperation," of the Act requires Federal agencies to consult with the FWS or the National Marine Fisheries Service (NMFS) on Federal actions that may affect listed species or designated critical habitats.
Fish and Wildlife Coordination Act of 1934, as amended (16 U.S.C. §§ 661–666e-TN4467)	The Fish and Wildlife Coordination Act requires Federal agencies that construct, license, or permit water resource development projects to consult with the FWS (or NMFS, when applicable) and State wildlife resource agencies for any project that involves an impoundment of more than 10 ac (4 ha), diversion, channel deepening, or other waterbody modification regarding the impacts of that action on fish and wildlife and any mitigative measures to reduce adverse impacts.
Federal Insecticide, Fungicide, and Rodenticide Act, as amended (7 U.S.C. § 136 et seq.-TN4535)	The Federal Insecticide, Fungicide, and Rodenticide Act, as amended, by the Federal Environmental Pesticide Control Act and subsequent amendments, requires the registration of all new pesticides with the EPA before they are used in the United States. Manufacturers are required to develop toxicity data for their pesticide products. Toxicity data may be used to determine permissible discharge concentrations for an NPDES permit.
Fish and Wildlife Conservation Act of 1980 (16 U.S.C. § 2901 et seq.-TN6604)	The Fish and Wildlife Conservation Act provides Federal technical and financial assistance to States for the development of conservation plans and programs for nongame fish and wildlife. The Fish and Wildlife Conservation Act conservation plans identify significant problems that may adversely affect nongame fish and wildlife species and their habitats and appropriate conservation actions to protect the identified species. The Act also encourages Federal agencies to conserve and promote the conservation of nongame fish and wildlife and their habitats.
Magnuson–Stevens Fishery Conservation and Management Act (16 U.S.C. 1801 et seq.-TN7841)	The Magnuson–Stevens Fishery Conservation and Management Act, as amended, governs marine fisheries management in U.S. Federal waters. The Act created eight regional fishery management councils and includes measures to rebuild overfished fisheries, protect essential fish habitat, and reduce bycatch. Under Section 305 of the act, Federal agencies are required to consult with the NMFS for any Federal actions that may adversely affect essential fish habitat.
National Marine Sanctuaries Act of 1966 (NMSA), as amended (16 U.S.C. § 1431 et seq.-TN7197)	The NMSA establishes provisions for the designation and protection of marine areas that have special national significance. The NMSA authorizes the Secretary of Commerce to designate national marine sanctuaries and establish the National Marine Sanctuary System. Pursuant to Section 304(d) of the NMSA, Federal agencies must consult with the National Oceanic and Atmospheric Administration's Office of National Marine Sanctuaries when their proposed actions are likely to destroy, cause the loss of, or injure a sanctuary resource.

Table B-1 Federal and State Requirements (Continued)

Law or Regulation	Requirements
Toxic Substances Control Act (TSCA) (15 U.S.C. § 2601 et seq.-TN4454)	The TSCA regulates the manufacture, processing, distribution, and use of certain chemicals not regulated by RCRA or other statutes, including asbestos-containing material and polychlorinated biphenyls. Any TSCA-regulated waste removed from structures (e.g., polychlorinated biphenyls-contaminated capacitors or asbestos) or discovered during the implementation phase (e.g., contaminated media) would be managed in compliance with TSCA requirements in 40 CFR Part 761 (TN6610).
Migratory Bird Treaty Act of 1918, as amended (16 U.S.C. § 703 et seq.-TN3331)	The Migratory Bird Treaty Act is intended to protect birds that have common migration patterns between the United States and Canada, Mexico, Japan, and Russia. The Act stipulates that, except as permitted by regulations, it is unlawful at any time, by any means, or in any manner to pursue, hunt, take, capture, or kill any migratory bird.
Marine Mammal Protection Act of 1972 (MMPA) (16 U.S.C. § 1361 et seq.-TN4478)	<p>The MMPA was enacted to protect and manage marine mammals and their products (e.g., the use of hides and meat). The primary authority for implementing the Act belongs to the FWS and NMFS. The FWS manages walrus, polar bears, sea otters, dugongs, marine otters, and the West Indian, Amazonian, and West African manatees. The NMFS manages whales, porpoises, seals, and sea lions. The two agencies may issue permits under Section 104 (16 U.S.C. 1374) to persons, including Federal agencies, that authorize the taking or importing of specific species of marine mammals.</p> <p>After the Secretary of the Interior or the Secretary of Commerce approves a State's program, the State can take over responsibility for managing one or more marine mammals. The Act also established a Marine Mammal Commission whose duties include reviewing laws and international conventions related to marine mammals, studying the condition of these mammals, and recommending steps to Federal officials (e.g., listing a species as endangered) that should be taken to protect marine mammals. Federal agencies are directed by MMPA Section 205 (16 U.S.C. 1405) to cooperate with the commission by permitting it to use their facilities or services.</p>
Environmental Standards for Uranium Fuel Cycle (40 CFR Part 190, Subpart B-TN739)	These regulations establish maximum doses to the body or organs of members of the public as a result of normal operational releases from uranium fuel cycle activities, including uranium enrichment. These regulations were promulgated by the EPA under the authority of the AEA, as amended, and have been incorporated by reference in the NRC regulations in 10 CFR 20.1301(e) (TN283).
Historic Preservation and Cultural Resources	
National Historic Preservation Act, (54 U.S.C. 300101 et seq.-TN4157) (formerly 16 U.S.C. 470 et seq.)	The National Historic Preservation Act was enacted to create a national historic preservation program, including the National Register of Historic Places and the Advisory Council on Historic Preservation. Section 106 of the Act requires Federal agencies to take into account the effects of their undertakings on historic properties. The Advisory Council on Historic Preservation regulations implementing Section 106 of the Act are found in 36 CFR Part 800, "Protection of Historic Properties" (TN513). The regulations call for

Table B-1 Federal and State Requirements (Continued)

Law or Regulation	Requirements
	public involvement in the Section 106 consultation process, including involvement from Indian Tribes and other interested members of the public, as applicable.

1 ac =acre(s); AEA = Atomic Energy Act; CAA = Clean Air Act; CERCLA = Comprehensive Environmental Response,
2 Compensation, and Liability Act; CFR = *Code of Federal Regulations*; CWA = Clean Water Act; EIS = environmental
3 impact statement; CZMA = Coastal Zone Management Act; EPA = U.S. Environmental Protection Agency; EPCRA =
4 Emergency Planning and Community Right-to-Know Act; FWS = U.S. Fish and Wildlife Service; ha = hectare(s);
5 NAAQS = National Ambient Air Quality Standards; NEPA = National Environmental Policy Act; NMFS = National
6 Marine Fisheries Service; NMSA = National Marine Sanctuaries Act; NPDES = National Pollutant Discharge
7 Elimination System; OSHA = Occupational Safety and Health Act; RCRA = Resource Conservation and Recovery
8 Act; SDWA = Safe Drinking Water Act of 1974; TSCA = Toxic Substances Control Act; USACE = United States Army
9 Corp of Engineers.

10 **B.2 Operating Permits and Other Requirements**

11 Table B-2 lists the permits and licenses issued by Federal, State, and local authorities for
12 operational activities at Monticello as identified in Chapter 9 of Xcel Energy’s environmental
13 report.

14 **Table B-2 Operating Permits and Other Requirements**

Permit	Responsible Agency	Number	Expiration Date	Authorized Activity
Monticello Nuclear Generating Plant (Monticello) license to operate Unit 1	Nuclear Regulatory Commission (NRC)	DPR-22	Renewed: 11/08/2006 Expires: 09/08/2030	Operation of Monticello
Certification of water quality standards	Minnesota Pollution Control Agency (MPCA)	N/A	N/A	Section 401 Water Quality Certification issued by the State for operation of Monticello.
Regional general permit (Section 404)	US Army Corp of Engineers USACE	RGP-003-MN	03/01/2026	Maintenance dredging in front of the intake apron on the Mississippi River.
Uniform Program Credentials (Hazmat permit and registration)	Alliance for Uniform Hazmat Transportation Procedures	UPM211635NV	03/31/2024	Hazardous material shipment.
License to ship radioactive material	Tennessee Department of Environment and Conservation (TDEC)	T-MN002-L21	12/31/2022	Shipment of radioactive material to a licensed disposal/processing facility in Tennessee.

15
16

Table B-2 Operating Permits and Other Requirements (Continued)

Permit	Responsible Agency	Number	Expiration Date	Authorized Activity
General site access permit for radioactive waste disposal	Utah Department of Environmental Quality (UDEQ)	0209001562	10/18/2023	Delivery of radioactive waste to a land disposal facility located in Utah.
Hazardous waste generator license	Minnesota Pollution Control Agency (MPCA)	MND000681639	06/30/2024	Authorizes facility to operate as a hazardous waste generator.
NPDES permit	Minnesota Pollution Control Agency (MPCA)	MN0000868	04/30/2028	Discharges of wastewater to waters of the state.
Air emission permit	Minnesota Pollution Control Agency (MPCA)	17100019-04	11/15/2018 ^(a)	Operate air emission facility (four diesel generators, diesel fire pump, three flexible pumps, and heating boiler).
Tank registration	Minnesota Pollution Control Agency (MPCA)	TS0051508	N/A	Underground storage tank registration.
Tank registration	Minnesota Pollution Control Agency (MPCA)	TS0051508	5/19/2033	Aboveground storage tank registration.
State dredging permit	Minnesota Department of Health (MNDR)	1967-0743	5/14/2023	Maintenance dredging of sand and silt from discharge canal and intake skimmer area.
Water appropriations permit	Minnesota Department of Health (MNDR)	67-0083	N/A	Groundwater withdrawals from Well #1 and Well #2.
Water appropriations permit	Minnesota Department of Health (MNDR)	66-1172	N/A	Surface water withdrawals from the Mississippi River.
Division of Fish and Wildlife special permit	Minnesota Department of Health (MNDR)	32875	12/31/2022 Renewal requested.	Collection of fish for scientific purposes.
Division of Ecological and Water Resources permit	Minnesota Department of Health (MNDR)	511	12/31/2023	Transport of zebra mussels and other prohibited invasive species to Xcel Energy facilities or to a repair site for purposes of control,

Table B-2 Operating Permits and Other Requirements (Continued)

Permit	Responsible Agency	Number	Expiration Date	Authorized Activity
				disposal, and maintenance of equipment.
Sanitary Sewer Wastewater Discharge Agreement	City of Monticello	N/A	N/A	Agreement to discharge domestic sanitary waste to the City of Monticello sanitary sewer collection system.
ISFSI Certificate of Need	State of Minnesota	DOCKET NO. E-002/CN-21-668	1/1/2040	Certificate of Need for Additional Dry Cask Storage at the Monticello Nuclear Generating Plant Independent Spent Fuel Storage Installation in Wright County
License to ship radioactive material	Tennessee Department of Environment and Conservation (TDEC); TDEC Rule 0400-20-10-.32	T-MN002-L21	12/31/2023	Shipment of radioactive material to a licensed disposal/processing facility in Tennessee.
General Site Access Permit for Radioactive Waste Disposal	Utah Department of Environmental Quality (UDEQ); Utah Administrative Code R313-26	209001562	10/18/2023	Delivery of radioactive waste to a land disposal facility located in Utah.

FERC = Federal Energy Regulatory Commission; ISFSI = independent spent fuel storage installation; MB = migratory birds; N/A = not applicable; NPDES = National Pollutant Discharge Elimination System; NRC = U.S. Nuclear Regulatory Commission; SQG = Small Quantity Generators; USACE = U.S. Army Corps of Engineers; USDOT = U.S. Department of Transportation; USFWS = U.S. Fish and Wildlife Service.
Sources: Xcel 2023-TN9084.

1 B.3 References

2 10 CFR Part 20. *Code of Federal Regulations*, Title 10, *Energy*, Part 20, “Standards for
3 Protection Against Radiation.” TN283.

4 10 CFR Part 50. *Code of Federal Regulations*, Title 10, *Energy*, Part 50, “Domestic Licensing of
5 Production and Utilization Facilities.” TN249.

6 10 CFR Part 51. *Code of Federal Regulations*, Title 10, *Energy*, Part 51, “Environmental
7 Protection Regulations for Domestic Licensing and Related Regulatory Functions.” TN250.

1 10 CFR Part 54. *Code of Federal Regulations*, Title 10, *Energy*, Part 54, “Requirements for
2 Renewal of Operating Licenses for Nuclear Power Plants.” TN4878.

3 33 CFR Part 320. *Code of Federal Regulations*, Title 33, *Navigation and Navigable Waters*, Part
4 320, “General Regulatory Policies.” TN424.

5 36 CFR Part 800. *Code of Federal Regulations*, Title 36, *Parks, Forests, and Public Property*,
6 Part 800, “Protection of Historic Properties.” TN513.

7 40 CFR Part 121. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 121,
8 “State Certification of Activities Requiring a Federal License or Permit.” TN6718.

9 40 CFR Part 190. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 190,
10 “Environmental Radiation Protection Standards for Nuclear Power Operations.” TN739.

11 40 CFR Part 355. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 302,
12 “Emergency Planning and Notification.” TN5493.

13 40 CFR Part 370. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 370,
14 “Hazardous Chemical Reporting: Community Right-To-Know.” TN6612.

15 40 CFR Part 372. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 372,
16 “Toxic Chemical Release Reporting: Community Right-To-Know.” TN6613.

17 40 CFR Part 761. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 761,
18 “Polychlorinated Biphenyls (PCBs) Manufacturing, Processing, Distribution in Commerce, and
19 Use Prohibitions.” TN6610.

20 40 CFR Parts 260–283. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Parts
21 260–283, EPA Regulations Implementing RCRA. TN6617.

22 40 CFR Parts 50-99. *Code of Federal Regulations*, Title 40, *Protection of the Environment*,
23 Subchapter C, Parts 50-99, “Air Programs.” TN5264.

24 49 CFR Parts 171-177. *Code of Federal Regulations*, Title 49, *Transportation*, Subchapter C,
25 “Hazardous Materials Regulations (49 CFR Parts 171-177).” TN5466.

26 American Indian Religious Freedom Act, as amended. 42 U.S.C. § 1996 *et seq.* TN5281.

27 Antiquities Act of 1906, as amended. 54 U.S.C. § 320301–320303 and 18 U.S.C. § 1866(b).
28 TN6602.

29 Archeological and Historic Preservation Act of 1974, as amended. 54 U.S.C. § 312501 *et seq.*
30 TN4844.

31 Atomic Energy Act of 1954. 42 U.S.C. § 2011 *et seq.* Public Law 112-239, as amended. TN663.

32 Bald and Golden Eagle Protection Act. 16 U.S.C. § 668-668d *et seq.* TN1447.

33 Clean Air Act. 42 U.S.C. § 7401 *et seq.* TN1141.

1 Coastal Zone Management Act of 1972. 16 U.S.C. § 1451 *et seq.* TN1243.

2 Comprehensive Environmental Response, Compensation, and Liability Act, as amended. 42
3 U.S.C. § 9601 *et seq.* TN6592.

4 Emergency Planning and Community Right-to-Know Act of 1986. 42 U.S.C. § 11001 *et seq.*
5 TN6603.

6 Endangered Species Act of 1973. 16 U.S.C. § 1531 *et seq.* TN1010.

7 Energy Reorganization Act of 1974, as amended. 42 U.S.C. § 5801 *et seq.* TN4466.

8 EPA/USACE (U.S. Environmental Protection Agency/U.S. Army Corps of Engineers). 2011.
9 *Draft Guidance on Identifying Waters Protected by the Clean Water Act.* EPA/USACE,
10 Washington, D.C. ADAMS Accession No. ML12178A570. TN1067.

11 Federal Insecticide, Fungicide, and Rodenticide Act, as amended. 7 U.S.C. § 136 *et seq.*
12 TN4535.

13 Federal Water Pollution Control Act of 1972 (commonly referred to as the Clean Water Act). 33
14 U.S.C. § 1251 *et seq.* TN662.

15 Fish and Wildlife Conservation Act of 1980. 16 U.S.C. § 2901 *et seq.* TN6604.

16 Fish and Wildlife Coordination Act, as amended. 16 U.S.C. § 661 *et seq.* TN4467.

17 Hazardous Materials Transportation Act. 49 U.S.C. § 5101 *et seq.* TN6605.

18 Low-Level Radioactive Waste Policy Act of 1980. 42 U.S.C. § 2021b *et seq.* Public Law 96-573.
19 TN6606.

20 Magnuson Stevens Fishery Conservation and Management Reauthorization Act of 2006. 16
21 U.S.C. 1801 Note. Public Law 109-479, January 12, 2007, 120 Stat. 3575. TN7841.

22 Marine Mammal Protection Act of 1972, as amended. 16 U.S.C. § 1361 *et seq.* TN4478.

23 Marine Protection, Research, and Sanctuaries Act of 1972, as amended. 33 U.S.C. § 1401
24 *et seq.* TN4479.

25 Migratory Bird Treaty Act of 1918. 16 U.S.C. § 703 *et seq.* TN3331.

26 MN Stat. 103G. 2023. Chapter 103G, “Waters of the State.” *Minnesota Statutes*, St. Paul,
27 Minnesota. TN9648.

28 MN Stat. 115. 2023. Chapter 115, “Water Pollution Control; Sanitary Districts.” *Minnesota*
29 *Statutes*, St. Paul, Minnesota. TN9622.

30 MN Stat. 116. 2023. Chapter 116, “Pollution Control Agency.” *Minnesota Statutes*, St. Paul,
31 Minnesota. TN9820.

32 National Environmental Policy Act of 1969 (NEPA), as amended. 42 U.S.C. § 4321 *et seq.*
33 TN661.

1 National Historic Preservation Act. 54 U.S.C. § 300101 *et seq.* TN4157.

2 Native American Graves Protection and Repatriation Act. 25 U.S.C. § 3001 *et seq.* TN1686.

3 NMSA (National Marine Sanctuaries Act). 2000. “National Marine Sanctuaries Act, Title 16,
4 Chapter 32 § 1431 *et seq.* United States Code as amended by Public Law 106-513.” Silver
5 Spring, M.D. Available at [https://nmssanctuaries.blob.core.windows.net/sanctuaries-](https://nmssanctuaries.blob.core.windows.net/sanctuaries-prod/media/archive/library/national/nmsa.pdf)
6 [prod/media/archive/library/national/nmsa.pdf](https://nmssanctuaries.blob.core.windows.net/sanctuaries-prod/media/archive/library/national/nmsa.pdf). TN7197.

7 Noise Control Act of 1972. 42 U.S.C. § 4901 *et seq.* TN4294.

8 NRC (U.S. Nuclear Regulatory Commission). 2022. Letter from C. Haney, Deputy Executive
9 Director for Materials, Waste, Research, State, Tribal, Compliance, Administration, and Human
10 Capital Programs, to D. Huff, Assistant Commissioner Minnesota Department of Health, dated
11 April 12, 2022, regarding “Final Minnesota Agreement State Program Integrated Materials
12 Performance Evaluation Program (IMPEP) Report.” Washington, D.C. ADAMS Accession No.
13 ML22083A236. TN9834.

14 NRC and MN (U.S. Nuclear Regulatory Commission and State of Minnesota). 2006.
15 “Agreement between the United States Nuclear Regulatory Commission and the State of
16 Minnesota for Discontinuance of Certain Commission Regulatory Authority and Responsibility
17 within the State Pursuant to Section 274 of the Atomic Energy Act Of 1954, as Amended.”
18 Washington, D.C., St. Paul, Minnesota. TN9819.

19 Nuclear Waste Policy Act of 1982. 42 U.S.C. § 10101 *et seq.* TN740.

20 Occupational Safety and Health Act of 1970, as amended. 29 U.S.C. § 651 *et seq.* TN4453.

21 Pollution Prevention Act of 1990. 42 U.S.C. § 13101 *et seq.* TN6607.

22 Resource Conservation and Recovery Act of 1976. 42 U.S.C. 6901 Note. Public Law 94-580, 90
23 Stat. 2795. TN1281.

24 Rivers and Harbors Appropriation Act of 1899. 33 U.S.C. § 401 *et seq.* TN660.

25 Safe Drinking Water Act of 1974, as amended. 42 U.S.C. § 300f *et seq.* TN1337.

26 Toxic Substances Control Act, as amended. 15 U.S.C. § 2601 *et seq.* TN4454.

27 Wild and Scenic Rivers Act. 16 U.S.C. § 1271 *et seq.* TN1811.

28 Xcel (Xcel Energy). 2023. Letter from C.P. Domingos, Site Vice President, Monticello and
29 Prairie Island Nuclear Generating Plant Northern States Power Company, to NRC Document
30 Control Desk, dated January 9, 2023, regarding “Monticello Nuclear Generating Plant Docket
31 No. 50-263, Renewal License Numbers DPR-22 Application for Subsequent Renewal Operating
32 License.” Monticello, Minnesota. ADAMS Accession No. ML23009A352. TN9084.

33

34

1 **APPENDIX C**

2 **CONSULTATION CORRESPONDENCE**

3

4 **C.1 Endangered Species Act Section 7 Consultation**

5 As a Federal agency, the U.S. Nuclear Regulatory Commission (NRC) must comply with the
6 Endangered Species Act of 1973 (ESA), as amended (16 U.S.C. 1531 et seq.; TN1010), as part
7 of any action authorized, funded, or carried out by the agency. In this case, the proposed
8 agency action is whether to issue a subsequent renewed facility operating license for the
9 continued operation of Monticello Nuclear Generating Plant, Unit 1 (Monticello). The proposed
10 action would authorize Xcel Energy to operate Monticello for an additional 20 years beyond the
11 current renewed operating license term. Under Section 7 of the ESA, the NRC must consult with
12 the U.S. Fish and Wildlife Service (FWS) and the National Marine Fisheries Service (NMFS)
13 (“the Services” [collectively] or “Service” [individually]), as appropriate, to ensure that the
14 proposed action is not likely to jeopardize the continued existence of any endangered or
15 threatened species or result in the destruction or adverse modification of designated critical
16 habitat.

17 **C.2 Federal Agency Obligations under Section 7 of the Endangered Species Act**

18 The ESA and the regulations that implement ESA Section 7 at Title 50 of the *Code of Federal*
19 *Regulations* (50 CFR Part 402-TN4312) describe the consultation process that Federal
20 agencies must follow in support of agency actions. As part of this process, the Federal agency
21 shall either (1) request that the Services provide a list of any listed or proposed species or
22 designated or proposed critical habitats that may be present in the action area or (2) request
23 that the Services concur with a list of species and critical habitats that the Federal agency has
24 created (50 CFR 402.12(c)). If any such species or critical habitats may be present, the Federal
25 agency prepares a biological assessment to evaluate the potential effects of the action and
26 determine whether the species or critical habitats are likely to be adversely affected by the
27 action (50 CFR 402.12(a); 16 U.S.C. 1536(c)-TN4459).

28 Biological assessments are required for any agency action that is a “major construction activity”
29 (50 CFR 402.12(b)) (TN4312). A major construction activity is a construction project or other
30 undertaking having construction-type impacts that is a major Federal action significantly
31 affecting the quality of the human environment under the National Environmental Policy Act of
32 1969, as amended (42 U.S.C. 4321 et seq.) (NEPA) (51 FR 19926-TN7600). Federal agencies
33 may fulfill their obligations to consult with the Services under ESA Section 7 and to prepare a
34 biological assessment, if required, in conjunction with the interagency cooperation procedures
35 required by other statutes, including NEPA (50 CFR 402.06(a)). In such cases, the Federal
36 agency should include the results of ESA Section 7 consultation(s) in the NEPA document
37 (50 CFR 402.06(b)).

38 **C.2.1 Biological Evaluation**

39 Subsequent license renewal (SLR) does not require the preparation of a biological assessment
40 because it is not a major construction activity. Nonetheless, the NRC staff must consider the
41 impacts of its actions on federally listed species and designated critical habitats. In cases where
42 the staff finds that license renewal “may affect” ESA-protected species or habitats, ESA
43 Section 7 requires the NRC to consult with the relevant Service(s).

1 To support such consultations, the NRC staff has incorporated its analysis of the potential
 2 impacts of the proposed license renewal into Section 3.7 of this environmental impact statement
 3 (EIS). The NRC staff refers to its ESA analysis as a “biological evaluation.”

4 The NRC staff structured its evaluation in accordance with the Services’ suggested biological
 5 assessment contents described at 50 CFR 402.12(f) (TN4312). Section 3.8.4.1 of this report
 6 describes the action area as well as the ESA-protected species and habitats potentially present
 7 in the action area. Section 3.8.4.2 assesses the potential effects of the proposed Monticello SLR
 8 on the ESA-protected species and habitats present in the action area and contains the NRC
 9 staff’s effect determinations for each of those species and habitat. Section 3.8.4.3 addresses
 10 cumulative effects. Finally, Sections 3.8.5 through 3.8.9 address the potential effects of the no-
 11 action alternative and power replacement alternatives. The results of the NRC staff’s analysis
 12 are summarized below in Table C-1.

13 **Table C-1 Effect Determinations for Federally Listed Species under U.S. Fish and**
 14 **Wildlife Service Jurisdiction**

Species	Federal Status ^(a)	Potentially Present in the Action Area?	Effect Determination ^(b)	FWS Concurrence Date ^(c)
northern long-eared bat	FE	Yes	NLAA	06/27/23
tricolored bat	FPE	Yes	NLAA	06/27/23
whooping crane	NEP	Yes	NLAA	06/27/23
monarch butterfly	FC	Yes	NLAA	06/27/23
Higgins’ eye pearlymussel	FE	No	NE	n/a
gray wolf	FT	No	NE	n/a
rusty patched bumble bee	FE	No	NE	n/a

(a) Indicates protection status under the Endangered Species Act (ESA). FC = candidate for Federal listing; FE = federally endangered; FPE = proposed for Federal listing as endangered; FT = federally threatened.
 (b) The NRC staff makes its effect determinations for federally listed species in accordance with the language and definitions specified in the U.S. Fish and Wildlife Service (FWS) and National Marine Fisheries Service (NMFS) Endangered Species Consultation Handbook (FWS and NMFS 1998-TN1031). NLAA = may affect but is not likely to adversely affect; NE = no effect.
 (c) The ESA does not require Federal agencies to seek FWS concurrence for “no effect” determinations or for conclusions regarding effects on candidate species. n/a = not applicable.

15 **C.2.2 Chronology of Endangered Species Act Section 7 Consultation**

16 *Endangered Species Act Section 7 Consultation with the U.S. Fish and Wildlife Service*

17 On June 27, 2023, the FWS concurred with the NRC’s determination that the proposed
 18 Monticello SLR may affect but is not likely to adversely affect the northern long-eared bat and
 19 tricolored bat (FWS 2023-TN9082, FWS 2023-TN9081). Also on June 27, 2023, the FWS
 20 determined that because the proposed action is not likely to result in jeopardy of the
 21 nonessential experimental population of whooping crane, the NRC’s obligations under Section 7
 22 for whooping crane are complete (FWS 2023-TN9081). Because the monarch butterfly is a
 23 candidate for Federal listing, the ESA does not require the NRC to consult with or receive
 24 concurrence from the FWS regarding this species. The FWS’s June 27, 2023, letters document
 25 that the NRC staff has fulfilled its ESA Section 7(a)(2) obligations with respect to the proposed
 26 Monticello SLR. The ESA regulations at 50 CFR 402.16 prescribe certain circumstances that
 27 require Federal agencies to reinitiate consultation. As of the date of issuance of this draft site-

1 specific environmental impact statement, the NRC staff has identified no information that would
2 warrant re-initiation of consultation.

3 Table C-2 lists the correspondence between the NRC and the FWS pursuant to ESA Section 7
4 that has transpired to date.

5 **Table C-2 Endangered Species Act Section 7 Consultation Correspondence with the**
6 **U.S. Fish and Wildlife Service**

Date	Description	ADAMS Accession No. ^(a)
June 27, 2023	Minnesota-Wisconsin Ecological Services Field Office (FWS) to B. Arlene (NRC), List of threatened and endangered species for proposed Monticello SLR	ML24016A229
June 27, 2023	Minnesota-Wisconsin Ecological Services Field Office (FWS) to B. Arlene (NRC), Federal agency coordination under ESA Section 7 and concurrence that the proposed Monticello SLR is not likely to adversely affect the long-eared bat	ML24016A228
June 27, 2023	Minnesota-Wisconsin Ecological Services Field Office (FWS) to B. Arlene (NRC), Verification letter for Monticello SLR concerning monarch butterfly, tricolored bat, and whooping crane consistent with the Minnesota-Wisconsin Endangered Species Determination Key	ML24016A230

ADAMS = Agencywide Documents Access and Management System; Duke Energy = Duke Energy Carolinas, LLC; ESA = Endangered Species Act; FWS = U.S. Fish and Wildlife Service; NRC = U.S. Nuclear Regulatory Commission; SLR = subsequent license renewal.

(a) Access these documents through the NRC's ADAMS at <http://adams.nrc.gov/wba/>.

7 *Endangered Species Act Section 7 Consultation with the National Marine Fisheries Service*

8 As discussed in Section 3.8.1 and 3.8.4.2 of this EIS, no federally listed species or critical
9 habitats under NMFS's jurisdiction occur within the action area. Therefore, the NRC staff did not
10 engage the NMFS pursuant to ESA Section 7 for the proposed Monticello SLR.

11 **C.3 Magnuson–Stevens Act Essential Fish Habitat Consultation**

12 The NRC must comply with the Magnuson–Stevens Fishery Conservation and Management Act
13 of 1996 (MSA), as amended (16 U.S.C. 1801 et seq.-TN7841), for any actions authorized,
14 funded, or undertaken, or proposed to be authorized, funded, or undertaken that may adversely
15 affect any essential fish habitat (EFH) identified under the MSA. In Sections 3.8.3 and 3.8.4.4
16 of this EIS, the NRC staff concludes that the NMFS has not designated any EFH under the MSA
17 within the action area and that the proposed Monticello SLR would have no effect on EFH.
18 Thus, the MSA does not require the NRC to consult with the NMFS for the proposed action.

19 **C.4 National Marine Sanctuaries Act Consultation**

20 The National Marine Sanctuaries Act of 1966, as amended (16 U.S.C. § 1431 et seq.-TN7197),
21 authorizes the Secretary of Commerce to designate and protect areas of the marine
22 environment with special national significance due to their conservation, recreational, ecological,
23 historical, scientific, cultural, archaeological, educational, or aesthetic qualities as national
24 marine sanctuaries. Under Section 304(d) of the act, Federal agencies must consult with the

1 National Oceanic and Atmospheric Administration’s Office of National Marine Sanctuaries if a
2 Federal action is likely to destroy, cause the loss of, or injure any sanctuary resources.

3 In Sections 3.8.3 and 3.8.4.5 of this draft EIS, the NRC staff concludes that no coastal or marine
4 waters or Great Lakes occur near Monticello and that the Monticello SLR would have no effect
5 on sanctuary resources. Thus, the NMSA does not require the NRC to consult with the National
6 Oceanic and Atmospheric Administration for the proposed action.

7 **C.5 National Historic Preservation Act Section 106 Consultation**

8 The National Historic Preservation Act of 1966, as amended (54 U.S.C. 300101 et seq.)
9 (NHPA), requires Federal agencies to consider the effects of their undertakings on historic
10 properties and consult with applicable State and Federal agencies, Tribal groups, individuals,
11 and organizations with a demonstrated interest in the undertaking before taking action. Historic
12 properties are defined as resources that are eligible for listing on the National Register of
13 Historic Places. The historic preservation review process (Section 106 of the NHPA) is outlined
14 in regulations issued by the Advisory Council on Historic Preservation in 36 CFR Part 800,
15 “Protection of Historic Properties” (TN513). In accordance with 36 CFR 800.8(c), “Use of the
16 NEPA Process for Section 106 Purposes,” the NRC has elected to use the NEPA process to
17 comply with its obligations under Section 106 of the NHPA.

18 Table C-3 lists the chronology of consultation and consultation documents related to the NRC’s
19 NHPA Section 106 review of the Monticello SLR.

20 **Table C-3 National Historic Preservation Act Correspondence**

Date	Sender and Recipient	Description	ADAMS Accession No. ^(a)
03/13/2023	T. Smith (NRC) to R. Nelson, Director, Office of Federal Agency Programs, Advisory Council on Historic Preservation	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A274
03/13/2023	T. Smith (NRC) to A. Spong, D- SHPO, Minnesota State Historic Preservation Office	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A278
03/13/2023	T. Smith (NRC) to D. Copper, Tribal Chairman, Apache Tribe of Oklahoma	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280

21

Table C-3 National Historic Preservation Act Correspondence (Continued)

Date	Sender and Recipient	Description	ADAMS Accession No.^(a)
03/13/2023	T. Smith (NRC) to M. Wiggins, Jr., Chairman, Bad River Tribe	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to C. Chavers, Tribal Chairwoman, Bois Forte Band of Chippewa	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to R. Wassana, Governor, Cheyenne and Arapaho Tribes	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to A. Reider, President, Flandreau Santee Sioux Tribe	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to K. DuPuis, Sr., Tribal Chairperson, Fond du Lac Band of Lake Superior Chippewa	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to J. Stiffarm, President, Fort Belknap	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to R. Deschampe, Tribal Chair, Grand Portage Band of Lake Superior Chippewa	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to T. Rhodd, Chairman, Iowa Tribe of Kansas and Nebraska	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280

Table C-3 National Historic Preservation Act Correspondence (Continued)

Date	Sender and Recipient	Description	ADAMS Accession No.^(a)
03/13/2023	T. Smith (NRC) to D. Blaker, President, Keweenaw Bay Indian Community	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to L. Taylor, Chairman, Lac Courte Oreilles Band of Lake Superior Chippewa Indians	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to J. Johnson, President, Lac du Flambeau Band of Lake Superior Chippewa Indians	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to J. Williams, Jr., Chairman, Lac Vieux Desert Band of Lake Superior Chippewa Indians	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to F. Jackson, Sr., Chairman, Leech Lake Band of Ojibwe	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to R. Larsen, President, Lower Sioux Indian Community	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to M. Benjamin, Chairwoman, Mille Lacs Band of Ojibwe	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to C. J. Chavers, President, Minnesota Chippewa Tribe	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280

Table C-3 National Historic Preservation Act Correspondence (Continued)

Date	Sender and Recipient	Description	ADAMS Accession No.^(a)
03/13/2023	T. Smith (NRC) to J. Johnson, President, Prairie Island Indian Community	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to C. Boyd, Chairman, Red Cliff Band of Lake Superior Chippewa	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to D. Seki, Chairman, Red Lake Nation	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to A. Denney, Chairman, Santee Sioux Nation	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to K. B. Anderson, Chairman, Shakopee Mdewakanton Sioux Community	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to J. G. Renville, Tribal Chairman, Sisseton Wahpeton Oyate of the Lake Reservation	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to R. Vanzile, Jr., Chairman, Sokaogon Chippewa Community	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to D. Yankton, Sr., Chairperson, Spirit Lake Nation	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280

Table C-3 National Historic Preservation Act Correspondence (Continued)

Date	Sender and Recipient	Description	ADAMS Accession No.^(a)
03/13/2023	T. Smith (NRC) to W. Reynolds, Chairman, St. Croix Chippewa of Wisconsin	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to R.J. Corn, Sr., Chairman, The Menominee Indian Tribe of Wisconsin	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to J. Azure, Chairman, Turtle Mountain Band of Chippewa Indians	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to K. Jensvold, Tribal Chairman, Upper Sioux Community	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
03/13/2023	T. Smith (NRC) to M. Fairbanks, Chairman, White Earth Nation	Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23069A280
04/12/2023	K. Applegate, Commissioner of Natural Resources, Mille Lacs Band of Ojibwe to N. Martinez (NRC)	Response to NRC Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23117A313
07/03/2023	S. Beimers, Environmental Review Program Manager, Minnesota State Historic Preservation Office to NRC	Response to NRC Request for Scoping Comments Concerning the Environmental Review of Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	ML23199A280
06/20/2023	Memorandum to T. Smith (NRC) from N. Martinez (NRC)	Teleconference Summary Between NRC and Minnesota State Historic Preservation Office	ML23156A234
08/21/2023	S. Beimers, Environmental Review Program Manager, Minnesota State Historic	Response to NRC Request for Scoping Comments Concerning the Environmental Review of	ML23241A973

Table C-3 National Historic Preservation Act Correspondence (Continued)

Date	Sender and Recipient	Description	ADAMS Accession No. ^(a)
	Preservation Office to N. Martinez (NRC)	Monticello Generating Plant, Unit 1, Subsequent License Renewal Application	
08/29/2023	Memorandum to T. Smith (NRC) from N. Martinez (NRC)	Summary of Visit to Minnesota State Historic Preservation Office	ML23228A096
08/30/2023	Memorandum to T. Smith (NRC) from N. Martinez (NRC)	Teleconference Summary Between NRC and The Mille Lacs Band of Ojibwe	ML23222A126
09/07/2023	Memorandum to T. Smith (NRC) from N. Martinez (NRC)	Teleconference Summary Between NRC and The Mille Lacs Band of Ojibwe	ML23237A264
12/22/2023	Memorandum to T. Smith and S. Koenick (NRC) from N. Martinez (NRC)	Teleconference Summary Between NRC, The Mille Lacs Band of Ojibwe, Minnesota State Historic Preservation Office, and Xcel Energy	ML23345A012
01/30/2024	Memorandum to M. Rome (NRC) from N. Martinez (NRC)	Teleconference Summary Between the NRC and The Mille Lacs Band of Ojibwe	ML24023A090
02/23/2024	Memorandum to	Teleconference Summary Between the NRC and Xcel Energy	ML24039A180

ADAMS = Agencywide Documents Access and Management System; NRC = U.S. Nuclear Regulatory Commission; SHPO = State Historic Preservation Officer.

(a) Access these documents through the NRC's ADAMS at <https://adams.nrc.gov/wba/>.

1 **C.6 References**

- 2 36 CFR Part 800. *Code of Federal Regulations*, Title 36, *Parks, Forests, and Public Property*,
3 Part 800, "Protection of Historic Properties." TN513.
- 4 50 CFR Part 402. *Code of Federal Regulations*, Title 50, *Wildlife and Fisheries*, Part 402,
5 "Interagency Cooperation—Endangered Species Act of 1973, as amended." TN4312.
- 6 51 FR 19926. 1986. "Interagency Cooperation - Endangered Species Act of 1973, as
7 amended." Final Rule, *Federal Register*, Fish and Wildlife Service, Interior; National Marine
8 Fisheries Service, National Oceanic and Atmospheric Administration, Commerce. TN7600.
- 9 16 U.S.C. § 1536. Endangered Species Act, Section 7, "Interagency Cooperation." TN4459.
- 10 Endangered Species Act of 1973. 16 U.S.C. § 1531 et seq. TN1010.
- 11 FWS (U.S. Fish and Wildlife Service). 2023. Letter from Fish and Wildlife Service, Minnesota-
12 Wisconsin Ecological Services Field Office, to B. Arlene, dated June 27, 2023, regarding
13 "Federal agency coordination under the Endangered Species Act, Section 7 for 'Monticello
14 Subsequent License Renewal'." Bloomington, Minnesota. ADAMS Accession No.
15 ML24016A228. TN9082.

- 1 FWS (U.S. Fish and Wildlife Service). 2023. Letter from Fish and Wildlife Service, Minnesota-
2 Wisconsin Ecological Services Field Office, to B. Arlene, dated June 27, 2023, regarding
3 “Verification letter for ‘Monticello Subsequent License Renewal’ for specified threatened and
4 endangered species that may occur in your proposed project location consistent with the
5 Minnesota-Wisconsin Endangered Species Determination Key (Minnesota-Wisconsin DKey).”
6 Bloomington, Minnesota. ADAMS Accession No. ML24016A230. TN9081.
- 7 FWS and NMFS (U.S. Fish and Wildlife Service and National Marine Fisheries Service). 1998.
8 *Endangered Species Act Consultation Handbook, Procedures for Conducting Section 7*
9 *Consultation and Conference*. Washington, D.C. ADAMS Accession No. ML14171A801.
10 TN1031.
- 11 Magnuson Stevens Fishery Conservation and Management Reauthorization Act of 2006. 16
12 U.S.C. 1801 Note. Public Law 109-479, January 12, 2007, 120 Stat. 3575. TN7841.
- 13 NMSA (National Marine Sanctuaries Act). 2000. “National Marine Sanctuaries Act, Title 16,
14 Chapter 32 § 1431 et seq. United States Code as amended by Public Law 106-513.” Silver
15 Spring, M.D. Available at [https://nmssanctuaries.blob.core.windows.net/sanctuaries-](https://nmssanctuaries.blob.core.windows.net/sanctuaries-prod/media/archive/library/national/nmsa.pdf)
16 [prod/media/archive/library/national/nmsa.pdf](https://nmssanctuaries.blob.core.windows.net/sanctuaries-prod/media/archive/library/national/nmsa.pdf). TN7197.
- 17
18

1 **APPENDIX D**

2
3 **CHRONOLOGY OF ENVIRONMENTAL REVIEW CORRESPONDENCE**

4 This appendix contains a chronological listing of correspondence between the U.S. Nuclear
5 Regulatory Commission (NRC) and external parties as part of the agency’s environmental
6 review of the Monticello Nuclear Generating Plant, Unit 1, subsequent license renewal
7 application. This appendix does not include the consultation correspondence or comments
8 received during the scoping process. For a list and discussion of consultation correspondence,
9 see Appendix C of this environmental impact statement. For scoping comments, see
10 Appendix A of this site-specific environmental impact statement and the NRC’s, “Scoping
11 Summary Report” (Agencywide Documents Access and Management System [ADAMS]
12 Accession No. (ML24059A342; NRC 2024-TN9817). All documents are available electronically
13 from the NRC’s Public Electronic Reading Room found at: <http://www.nrc.gov/reading-rm.html>.
14 From the site, the public can gain access to ADAMS, which provides text and image files of the
15 NRC’s public documents. The ADAMS accession number for each document is included in the
16 following table.

17 **D.1 Environmental Review Correspondence**

18 Table D-1 lists the environmental review correspondence, by date, beginning with the request
19 by Xcel Energy for subsequent license renewal of the operating license for Monticello.

20 **Table D-1 Environmental Review Correspondence**

Date	Correspondence Description	ADAMS Accession No. or Federal Register Citing
01/09/2023	Monticello Nuclear Generating Plant Docket No. 50-263, Renewal License Number DPR-22 Application for Subsequent Renewal Operating License	ML23009A352
01/24/2023	Monticello Nuclear Generating Plant, Unit 1 – Receipt and Availability of the Subsequent License Renewal Application	ML23010A007
01/31/2023	Northern States Power Company – Minnesota; Xcel Energy; Monticello Nuclear Generating Plant, Unit 1; Subsequent license renewal application; receipt	88 FR 6327
02/23/2023	Monticello Nuclear Generating Plant, Unit 1 – Determination of Acceptability and Sufficiency for Docketing, Proposed Review Schedule, and Opportunity for a Hearing Regarding the Northern States Power Company–A Minnesota Corporation’s, Application for Subsequent License Renewal	ML23047A175
02/28/2023	Monticello Nuclear Generating Plant, Unit 1 – Subsequent License Renewal Application Online Reference Portal	ML23048A037
03/03/2023	Northern States Power Company – Minnesota; Xcel Energy; Monticello Nuclear Generating Plant, Unit 1; Subsequent license renewal application; opportunity to request a hearing and petition for leave to intervene	88 FR 13474
03/10/2023	Notice of Intent to Conduct Scoping Process and Prepare Environmental Impact Statement; Northern States Power Company – Minnesota; Monticello Nuclear Generating Plant, Unit 1	88 FR 15103

21

Table D-1 Environmental Review Correspondence (Continued)

Date	Correspondence Description	ADAMS Accession No. or Federal Register Citing
03/14/2023	Public Meeting Announcement for March 22, 2023: Environmental Scoping Meeting Related to the Monticello Nuclear Generating Plant Subsequent License Renewal Application (In-person)	ML23073A041
03/22/2023	March 22, 2023, Monticello, Unit 1 Subsequent License Renewal Application Public Environmental Scoping Meeting Presentation Slides	ML23081A039
03/27/2023	March 29, 2023, Monticello, Unit 1, Subsequent License Renewal Application Public Scoping Webinar Presentation Slides	ML23086C072
03/28/2023	Public Meeting Announcement for March 29, 2023: Environmental Scoping Meeting Related to the Monticello Nuclear Generating Plant Subsequent License Renewal Application (Webinar)	ML23087A102
04/18/2023	March 22, 2023, Monticello Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application Public Environmental Scoping Meeting Transcript	ML23108A313
04/18/2023	March 29, 2023, Monticello Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application Public Environmental Scoping Webinar Teams Transcript	ML23108A318
05/01/2023	Memo, March 22, 2023, Meeting Summary: Public Scoping Meeting for the Environmental Review of the Subsequent License Renewal Application for Monticello Nuclear Generating Plant, Unit 1	ML23110A014
05/01/2023	Meeting Summary for March 22, 2023, Environmental Scoping Meeting Related to the Monticello Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application	ML23110A015
05/01/2023	Memo, March 29, 2023, Meeting Summary: Public Scoping Meeting for the Environmental Review of the Subsequent License Renewal Application for Monticello Nuclear Generating Plant, Unit 1	ML23115A438
05/01/2023	Meeting Summary for March 29, 2023, Environmental Scoping Meeting Related to the Monticello Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application	ML23115A464
06/02/2023	Letter to Christopher P. Domingos, Monticello Nuclear Generating Plant, Unit 1 - Notice of Intent to Conduct Scoping Process and Prepare an Environmental Impact Statement	ML23047A118
08/09/2023	Monticello Nuclear Generating Plant, Unit 1 – License Renewal Regulatory Audit regarding the Environmental Review of the Subsequent License Renewal	ML23215A131
10/23/2023	Monticello Nuclear Generating Plant, Unit 1, Summary of the Environmental Hybrid Audit Related to the Review of the Subsequent License Renewal Application	ML23291A110
10/23/2023	Monticello Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application Request for Confirmation of Information and Requests for Additional Information	ML23291A109

Table D-1 Environmental Review Correspondence (Continued)

Date	Correspondence Description	ADAMS Accession No. or Federal Register Citing
11/21/2023	Monticello Nuclear Generating Plant, Subsequent License Renewal Application Response to Request for Additional Information and Request for Confirmation of Information - Set 1	ML23332A182
12/18/2023	Subsequent License Renewal Application Response to Request for Additional Information and Request for Confirmation of Information – Set 1 Part 2	ML23352A081
02/24/2024	Subsequent License Renewal Application Response to Request for Additional Information and Request for Confirmation of Information – Supplement to Set 1 Part 1	ML24088A215

1 **D.2 References**

2 NRC (U.S. Nuclear Regulatory Commission). 2024. Letter from S. Koenick, Chief Environmental
3 Project Management Branch 1, to S. Hafen, Site Vice President Northern States Power
4 Company, dated March 18, 2024, regarding “Issuance of Environmental Scoping Summary
5 Report Associated with the U.S. Nuclear Regulatory Commission Staff’s Review of the
6 Monticello Nuclear Generating Plant, Unit 1, Subsequent License Renewal Application (EPID
7 Number: L-2023-Sle-0000) (Docket Number: 50-263).” Washington, D.C. ADAMS Accession
8 No. ML24059A288. TN9817.

1 **APPENDIX E**

2 **PROJECTS AND ACTIONS CONSIDERED IN THE**
3 **CUMULATIVE IMPACTS ANALYSIS**
4

5 The cumulative impacts analysis has been provided in Section 3.15 of this environmental impact
6 statement (see Section 3.15, Cumulative Effects).

APPENDIX F

ENVIRONMENTAL IMPACTS OF POSTULATED ACCIDENTS

This appendix describes the environmental impacts from postulated accidents that may occur at Monticello Nuclear Generating Power Station, Unit 1 (Monticello) during the subsequent license renewal (SLR) period. The term “accident” refers to any unintentional event outside the normal nuclear power plant operational envelope that could result in either: (1) an unplanned release of radioactive materials into the environment; or (2) the potential for an unplanned release of radioactive materials into the environment. Postulated accidents include design-basis accidents and severe accidents (e.g., those involving core damage).

This environmental impact statement (EIS) considers the impacts of SLR issues applicable to the Monticello SLR on a site-specific basis. The U.S. Nuclear Regulatory Commission (NRC) staff prepared this site-specific EIS in accordance with Commission Legal Issuance (CLI)-22-03 (NRC 2022-TN9844), that references CLI-22-02 (NRC 2022-TN8182).

NUREG-1437, *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* (LR GEIS) (NRC 1996-TN288, NRC 2013-TN2654), evaluates in detail the following two classes of postulated accidents as they relate to license renewal (LR). The LR GEIS conclusions are codified in Title 10 of the *Code of Federal Regulations* 10 CFR Part 51-TN250, “Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions”:

- Design-Basis Accidents (DBA): Postulated accidents that a nuclear facility must be designed and built to withstand without loss to the systems, structures, and components necessary to ensure public health and safety.
- Severe Accidents: Postulated accidents that are more severe than DBAs because they could result in substantial damage to the reactor core, with or without serious offsite consequences.

The original LR GEIS, NUREG-1437, published in 1996 (NRC 1996-TN288), contains the analysis for the determination of environmental impacts related to postulated accidents (NRC 1996-TN288). NUREG-1437 was updated to evaluate any new information related to the 1996 LR GEIS analysis and site-specific severe accident mitigation alternatives (SAMA) analysis and is referred to as the “2013 LR GEIS.” (NRC 2013-TN2654) Recently, NUREG-1437 was updated with newer information and was published in draft form for public comment, and is referred to here as the “2023 draft LR GEIS.” (NRC 2023-TN9172)

On March 21, 2022, the Commission issued CLI-22-02 (NRC 2022-TN8182) when considering the appeals of Natural Resources Defense Council, Friends of the Earth, and Miami Waterkeeper, in the *Turkey Point* SLR proceeding, and reconsidered the Commission’s earlier decision in CLI-20-3 (NRC 2022-TN9844, NRC 2020-TN9570). The Commission reversed CLI-20-3 (NRC 2022-TN9844), which addressed the referred ruling from the Atomic Safety and Licensing Board. In CLI-20-3 (NRC 2022-TN9844), the Commission had held that, when considering the environmental impacts of SLR, the NRC staff may rely on the 2013 LR GEIS (LR GEIS NRC 2013-TN2654) and 10 CFR Part 51 (TN250) Subpart A, Appendix B, Table B-1, “Summary of Findings on National Environmental Policy Act (NEPA) Issues for License Renewal of Nuclear Power Plants,” to evaluate the environmental impacts of Category 1 issues for SLR. For the reasons described in CLI-22-02 (NRC 2022-TN8182), the Commission reversed that decision and held that the 2013 LR GEIS did not address SLR. The Commission

1 stated, “that the staff may not exclusively rely on the 2013 LR GEIS and Table B-1 for the
2 evaluation of environmental impacts of Category 1 issues” (NRC 2022-TN8182).

3 The applicant submitted an application for SLR along with an environmental report, by letter
4 dated January 9, 2023 (Xcel 2023-TN9084). Xcel Energy, the owner-licensee for Monticello,
5 submitted this application on behalf of itself and Northern States Power Company–Minnesota,
6 the operator-licensee, for Monticello. Northern States Power Company–Minnesota was
7 incorporated as a wholly-owned subsidiary of Xcel Energy, Inc. effective August 18, 2000. The
8 application is for the SLR of Renewed Facility Operating License Number DPR-22 for Monticello
9 Unit 1. An audit of this environmental report was conducted the week of July 31, 2023 (NRC
10 2023-TN9794). As a result of the Commission’s decision in CLI-22-02, in this draft EIS, the NRC
11 staff has conducted a site-specific evaluation of the environmental impacts of Monticello’s SLR
12 application.

13 This appendix describes (1) the NRC staff’s evaluation of new and significant information
14 related to design-basis accidents at Monticello, (2) the staff’s evaluation of new and significant
15 information for postulated severe accidents at Monticello, and (3) the staff’s evaluation of new
16 and significant information related to the Monticello SAMA evaluation performed during
17 initial LR. The NRC staff conducted this site-specific new and significant evaluation to verify that
18 the environmental impacts of DBAs and the probability-weighted consequences of postulated
19 severe accidents for Monticello continue to be SMALL.

20 **F.1 Background for Design-Basis Accidents**

21 Although this EIS documents the NRC staff’s review of an SLR application, it should be noted
22 that long before any LR actions, an operating reactor has already completed the NRC licensing
23 process for the original 40-year operating license. To receive a license to operate a nuclear
24 power reactor, an applicant must submit to the NRC an operating license application that
25 includes, among many other requirements, a safety analysis report. The applicant’s safety
26 analysis report (Xcel 2021-TN9633) presents the design criteria and design information for the
27 proposed reactor and includes comprehensive data on the proposed site. The applicant’s safety
28 analysis report also describes various design-basis accidents and the safety features designed
29 to prevent or mitigate their impacts. The NRC staff reviews the operating license application to
30 determine if the nuclear power plant’s design—including designs for preventing or mitigating
31 accidents—meets the NRC’s regulations and requirements. At the conclusion of that review, an
32 operating license would be issued only if the NRC finds, in part, reasonable assurance that the
33 activities authorized by the license can be conducted without endangering the health and safety
34 of the public and that the activities will be conducted in accordance with the NRC’s regulations.

35 **F.1.1 Design-Basis Accidents**

36 DBAs are postulated accidents that a nuclear facility must be designed and built to withstand
37 without loss to the systems, structures, and components necessary to ensure public health and
38 safety. Planning for design-basis accidents ensures that the proposed nuclear power plant can
39 withstand normal transients (e.g., rapid changes in the reactor coolant system temperature or
40 pressure, or rapid changes in reactor power), as well as a broad spectrum of postulated
41 accidents without undue hazard to the health and safety of the public. Many of these design-
42 basis accidents may occur but are unlikely to occur even once during the life of the nuclear
43 power plant; nevertheless, carefully evaluating each design-basis accident is crucial to
44 establishing the design-basis for the preventive and mitigative safety systems of the proposed
45 nuclear power plant. The regulations in 10 CFR Part 50 (TN249), “Domestic Licensing of

1 Production and Utilization Facilities,” and 10 CFR Part 100 (TN282), “Reactor Site Criteria,”
2 describe the NRC’s acceptance criteria for design-basis accidents.

3 Before the NRC issues an operating license for a new nuclear power plant, the applicant must
4 demonstrate the ability of its proposed reactor to withstand all design-basis accidents. The
5 applicant and the NRC staff evaluate the environmental impacts of design-basis accidents for
6 the hypothetical individual exposed to the maximum postulated amount of radiation (maximum
7 exposed individual member of the public). The results of these evaluations of are found in the
8 applicant’s final safety analysis report (see Xcel 2021-TN9633). Once the NRC issues the
9 operating license for the new reactor, the licensee is required to maintain the acceptable design
10 and performance criteria throughout the operating life of the nuclear power plant; including any
11 LR periods of extended operation. The consequences of design-basis accidents are evaluated
12 for the hypothetical maximum exposed individual taking into consideration any changes in the
13 nuclear power plant environment over time; as such, any changes in the nuclear power plant
14 environment over time will have been accounted for and will not significantly impact these
15 evaluations.

16 The NRC regulation in 10 CFR 54.29(a) (TN4878), “Standards for Issuance of a Renewed
17 License,” requires LR applicants to demonstrate that identified actions have been, or will be
18 taken, to manage the effects of aging and perform any required time-limited aging analyses
19 such that there is reasonable assurance that the activities authorized by the renewed license
20 will continue to be conducted in accordance with the nuclear power plant’s current licensing
21 basis (CLB), as defined in 10 CFR 54.3(a), “Definitions.” Furthermore, the applicant must show
22 that any changes made to the nuclear power plant’s CLB are in accordance with the Atomic
23 Energy Act of 1954, as amended, and applicable NRC regulations. As previously discussed,
24 since the regulatory requirements for the plant’s existing design-basis and aging management
25 programs will be in effect for LR, the environmental impacts of design-basis accidents, as
26 calculated for the original operating license application, should not differ significantly from the
27 environmental impacts for any other time during nuclear power plant operations, including
28 during the initial LR and the subsequent license renewal periods. Accordingly, the design of the
29 nuclear power plant, relative to design-basis accidents during the period of extended operation,
30 is considered to remain acceptable.

31 Consistent with Regulatory Issue Summary (RIS)-2014-06, “Consideration of Current Operating
32 Issues and Licensing Actions in License Renewal,” (NRC 2014-TN7851), the early and
33 adequate identification of design-basis accidents and mitigation (before SLR) makes them a
34 part of the CLB of the nuclear power plant as defined at 10 CFR 54.3(a) (TN4878), “Current
35 licensing basis (CLB).” The NRC requires licensees to maintain the CLB of the nuclear power
36 plant under the current operating license, as well as during any LR period. Therefore, under the
37 provisions of 10 CFR 54.30, design-basis accidents are not subject to a safety review under LR.

38 **F.1.2 Evaluation of Design-Basis Accidents Specific to Monticello**

39 In Section 4.15.1.2, “Site-Specific Analysis for Monticello SLR,” of the Monticello SLR
40 Environmental Report (ER), Xcel Energy summarized the licensing basis and site-specific NRC
41 approval needed to operate a nuclear power facility, such as described in the Monticello safety
42 analysis report (SAR) (Xcel 2021-TN9633, Xcel 2023-TN9084). The Monticello SAR presents
43 the design and performance criteria for the proposed reactor and comprehensive data on the
44 proposed site. The environmental impacts of design-basis accidents were evaluated during the
45 initial licensing process, and the ability of the plant to withstand these accidents was
46 demonstrated to be acceptable before issuance of the operating license. The licensee is

1 required to maintain the acceptable design and performance criteria throughout the life of the
2 plant including any extended-life operation.

3 The Monticello SAR also discusses various hypothetical design-basis accidents and the safety
4 features designed to prevent and mitigate accidents. A number of the postulated accidents are
5 not expected to occur during the life of the plant but are evaluated to establish the design-basis
6 for the preventive and mitigative safety systems of the facility. The acceptance criteria for
7 design-basis accidents are described in 10 CFR Part 50 and 10 CFR Part 100.

8 The NRC has reviewed Monticello's design-basis on several occasions following the issuance of
9 the initial operating licenses. An example of NRC's continued review of Monticello design-basis
10 include a December 7, 2006 "Issuance of an Amendment Regarding the Alternative Source
11 Term." in which the NRC staff determined that the radiological consequences estimated by the
12 licensee for Monticello (various DBAs) will comply with the requirements of 10 CFR 50.67,
13 "Accident Source Term," and the guidelines of Regulatory Guide (RG) 1.183, "Alternative
14 Radiological Source Terms for Evaluating DBAs at Nuclear Reactors," and are therefore
15 acceptable (NRC 2006-TN9797). The radiological consequences for design-basis accidents
16 were also evaluated for the hypothetical maximum exposed individual (NRC 2006-TN9797),
17 with the consideration that changes in the plant environment will not affect these evaluations.
18 The environmental impacts during a LR term do not differ significantly from those calculated for
19 the design-basis accident assessments conducted as part of the initial plant licensing process.
20 Impacts from design-basis accidents are not affected by changes in plant environment because
21 such impacts (1) are based on calculated radioactive releases that are not expected to
22 appreciably change, (2) are not affected by changes in the plant environment because they are
23 evaluated for the hypothetical maximally exposed individual under expected environmental
24 parameters and conditions, and (3) have been previously determined to be acceptable (NRC
25 1996-TN288, NRC 2013-TN2654).

26 Another example of NRC's review of Monticello design-basis include its review of external
27 hazards information for all operating power reactors, including Monticello, as ordered by the
28 Commission following the Fukushima accident. For Monticello, the NRC staff concluded that no
29 further regulatory actions were needed to ensure adequate protection or compliance with
30 regulatory requirements, including site-specific external hazards information, re-confirming the
31 acceptability of Monticello's design-basis (NRC 2020-TN9695).

32 Under the NRC's LR rules in 10 CFR Part 54 (TN4878), "Requirements for Renewal of
33 Operating Licenses for Nuclear Power Plants," applicants for initial LR and SLR must take
34 adequate steps to account for aging during the period of extended operation either through
35 updates to the time-limited aging analyses or implementation of aging management plans.
36 Based on these activities, the NRC expects that operation during an initial LR or SLR term
37 would continue to provide an equivalent level of safety as during the operating period.
38 Furthermore, as provided in the statement of considerations for Part 54, the Commission
39 believes that considerable experience has demonstrated that its regulatory process, including
40 the performance-based requirements of the maintenance rule, provide adequate assurance that
41 degradation due to aging of structures, systems, and components that perform active safety
42 functions will be appropriately managed to ensure their continued functionality during the period
43 of extended operation. Furthermore, although the definition of CLB in 10 CFR Part 54 is broad
44 and encompasses various aspects of the NRC regulatory process (e.g., operation and design
45 requirements), the Commission concluded that a specific focus on functionality is appropriate for
46 performing the LR review. Reasonable assurance that the function of important structures,
47 systems, and components will be maintained throughout the renewal period, combined with the

1 rule's stipulation that all aspects of a plant's CLB (e.g., technical specifications) and the NRC's
2 regulatory process carry forward into the renewal period, are viewed as sufficient to conclude
3 that the CLB (which represents an acceptable level of safety) will be maintained. Functional
4 capability is the principal emphasis for much of the CLB and is the focus of the maintenance
5 rule and other regulatory requirements to ensure that aging issues are appropriately managed in
6 the current license term. The LR rule assures this management continues into any subsequent
7 term.

8 Consistent with 10 CFR Part 54 (TN4878), the applicant performed an integrated plant
9 assessment for the SLR application. This was done by its SLR team which evaluated Monticello
10 systems, structures, and components and conducted time-limited aging analyses. These
11 evaluations and analyses ensure that systems, structures, and components remain capable of
12 performing their functions consistent with existing plant design and performance criteria
13 specified in the Monticello licensing basis. The applicant found that the current Monticello
14 design- and performance criteria will be maintained during the subsequent period of extended
15 operation (Xcel 2023-TN9084).

16 As stated in Section 5.3.2 of the 1996 LR GEIS (TN288), the NRC staff assessed the
17 environmental impacts from design-basis accidents in individual nuclear power plants at the
18 time of the initial license application review. The licensee is required to maintain the nuclear
19 power plant within acceptable design and performance criteria, including during any LR term. As
20 such, the NRC staff would not expect environmental impacts to change significantly. The 1996
21 LR GEIS concluded that the environmental impacts of design-basis accidents are of SMALL
22 significance for all nuclear power plants, because the nuclear power plants were designed to
23 withstand these accidents.

24 For this SLR, the environmental impacts of design-basis accidents continue to be of SMALL
25 significance for Monticello because the plant was designed to successfully withstand these
26 accidents. As previously discussed, this is due to the requirements for Monticello to maintain the
27 current licensing basis and implement appropriate aging management programs during the SLR
28 term.

29 The impacts of design-basis accidents were also evaluated in the NRC staff's environmental
30 impact statement for Monticello's initial LR. As stated in the Monticello NRC LR EIS (NRC 2006-
31 TN7315, ADAMS Accession No. ML062490078):

32 "The Commission has determined that the environmental impacts of DBAs are of
33 SMALL significance for all plants because the plants were designed to
34 successfully withstand these accidents. Therefore, for the purposes of license
35 renewal, DBAs are designated as a Category 1 issue in 10 CFR Part 51, Subpart
36 A, Appendix B, Table B-1. The early resolution of the DBAs makes them a part of
37 the current licensing basis of the plant; the current licensing basis of the plant is
38 to be maintained by the licensee under its current license and, therefore, under
39 the provisions of 10 CFR 54.30, is not subject to review under license renewal."

40 Furthermore, the Staff concluded in the Monticello LR EIS (NRC 2006-TN7315, ML062490078),

41 "The staff has not identified any new and significant information during its
42 independent review of the NMC [Nuclear Management Company] ER, the staff's
43 site visit, the scoping process, its evaluation of other available information, or

1 public comments on the draft SEIS. Therefore, the staff concludes that there are no
2 impacts related to design basis accidents beyond those discussed in the GEIS.”

3 The environmental impacts during the SLR term are not expected to differ significantly from
4 those calculated for the design-basis accident assessments conducted as part of the initial plant
5 licensing process or as part of the initial license renewal process. Xcel Energy stated, and the
6 staff confirmed, that impacts due to design-basis accidents are SMALL. Based on the
7 discussion above, the NRC staff concludes that the impacts for this issue, with respect to an
8 SLR term for Monticello, are SMALL.

9 In its ER for the Monticello SLR application, Xcel Energy did not identify any new and significant
10 information related to design-basis accidents at Monticello (Xcel 2023-TN9084). The NRC staff
11 also did not identify any new and significant information related to design-basis accidents during
12 its independent review of Xcel Energy’s ER, through the scoping process, or in its evaluation of
13 other available information. Therefore, the NRC staff concludes that there are no environmental
14 impacts related to design-basis accidents at Monticello during the SLR period beyond those
15 already discussed in the EIS for Monticello’s initial license renewal or generically for all nuclear
16 power plants in the 2013 LR GEIS.

17 **F.1.3 Severe Accidents**

18 Severe accidents are postulated accidents that are more severe than design-basis accidents
19 because they can result in substantial damage to the reactor core, with or without serious offsite
20 consequences. Severe accidents entail multiple failures of equipment or functions.

21 **F.1.4 Severe Accidents and License Renewal**

22 Chapter 5 of the 1996 LR GEIS (NRC 1996-TN288) conservatively predicted the environmental
23 impacts of postulated severe accidents on a plant-specific basis that may occur during the
24 period of extended operations at nuclear power plants. Since that time, the NRC staff’s
25 prediction for Monticello has been confirmed to be conservative and the environmental impacts
26 determined to remain SMALL by a plant specific severe accident Level 3 probabilistic risk
27 assessment (PRA) consequence analysis. The results of the consequence analysis are found in
28 the Monticello initial license renewal application that was reviewed by the NRC staff (NRC 2006-
29 TN7315).

30 In the 1996 LR GEIS, the NRC considered impacts of severe accidents including the following:

- 31 • dose and health effects of accidents
- 32 • economic impacts of accidents
- 33 • effect of uncertainties on the results

34 The NRC staff calculated these estimated impacts by studying the risk analysis of severe
35 accidents that the NRC staff had prepared in support of several nuclear power plant’s original
36 reactor operating license review. Not all original operating reactor licenses contained a severe
37 accident analysis because the NRC had not always required them. When the NRC staff
38 prepared the 1996 LR GEIS, 28 nuclear power plant sites (44 units) had EISs or Final
39 Environmental Statements that contained a severe accident analysis. The 1996 LR GEIS relied
40 on severe accident analyses provided in the plant-specific EISs where available. Table 5-1 in
41 the 1996 LR GEIS lists the 28 nuclear power plants, representing 44 units, that included severe
42 accident analyses in their plant-specific EISs. These plant-specific EISs used site-specific

1 meteorology, land topography, population distributions, and offsite emergency response
 2 parameters, along with generic or plant-specific source terms, to calculate offsite health and
 3 economic impacts. The offsite health effects included those from airborne releases of
 4 radioactive material and contamination of surface water and groundwater. Table 5.6 of the 1996
 5 GEIS present the Monticello values for the predicted early- and latent fatalities as well as dose
 6 estimates per reactor-year (RY) to determine that the impacts are SMALL. For completeness,
 7 the 1996 LR GEIS results for Monticello are provided in Table F-1 below.

8 **Table F-1 Predicted Early and Latent Fatalities and Dose Estimates per Reactor-Year**
 9 **for Monticello at the Middle Year of the License Renewal Period (1996 GEIS)**

Predicted UCB Total Early Fatalities/R Y (95% UCB)	Non-Normalized Predicted Latent Total Fatalities/R Y (95% UCB)	Non-Normalized Predicted Total Dose (person-rem/R Y) (95% UCB)
4.1 × 10 ⁻³	5.0 × 10 ⁻²	730

R Y = reactor year; UCB = upper-confidence bound.

10 The 1996 LR GEIS used very conservative 95th-percentile upper-confidence bound (UCB)
 11 estimates for its severe accident environmental impact whenever available. As described in
 12 Section 5.3.3.2.2 of the 1996 LR GEIS, this approach provides inherent layers of conservatism
 13 to cover uncertainties (TN288). The 1996 LR GEIS concluded that the probability-weighted
 14 consequences of severe accidents, as related to LR, are SMALL compared to other risks to
 15 which the populations surrounding nuclear power plants are routinely exposed. As listed in
 16 Table 5.6 of the 1996 LR GEIS, the range of predicted population dose risk varied from
 17 48 person-rem/R Y at Big Rick Point to 9,727 person-rem/R Y at Indian Point. The published
 18 result for Monticello predicted a total population dose risk of 730 person-rem/R Y which is on the
 19 lower range of Table 5.6.

20 The 2013 LR GEIS (NRC 2013-TN2654) assessed more recent information and developments
 21 in severe accident analyses and how they might affect the conclusions in Chapter 5 of the 1996
 22 LR GEIS. The 2013 LR GEIS also provides comparative data where appropriate. Based on
 23 information in the 2013 LR GEIS, the NRC staff determined that for all nuclear power plants, the
 24 probability-weighted consequences of severe accidents are SMALL. However, the 2013
 25 LR GEIS determined that alternatives to mitigate severe accidents must be considered as a
 26 Category 2 issue for all nuclear power plants that have not considered such alternatives.
 27 Category 2 issues, presented in Table B-1, “Summary of Findings on NEPA [National
 28 Environmental Policy Act] Issues for License Renewal of Nuclear Power Plants,” of Appendix B
 29 to Subpart A of 10 CFR Part 51 (TN250), states:

30 The probability-weighted consequences of atmospheric releases, fallout onto
 31 open bodies of water, releases to groundwater, and societal and economic
 32 impacts from severe accidents are SMALL for all plants. However, alternatives to
 33 mitigate severe accidents must be considered for all plants that have not
 34 considered such alternatives.

35 The 1996 LR GEIS used the environmental impact information from the 28 plant-specific EISs
 36 and a metric called the exposure index (EI) to (1) scale up the radiological impact of severe
 37 accidents on the population due to demographic changes from the time the original EIS was
 38 performed until the year representing the mid-LR period, and (2) estimate the severe accident
 39 environmental impacts for the other plants (whose EISs did not include a quantitative
 40 assessment of severe accidents). The EI method is a measure of the degree to which the

1 population would be exposed to the release of radioactive material resulting from a severe
2 accident. The method uses the projected population distribution around each nuclear power
3 plant site at the middle of its LR period with site-specific meteorology data. By using this
4 information, it weights the population in each of 16 sectors around a nuclear power plant by the
5 fraction of time the wind blows in that direction on an annual basis. The EI metric was also used
6 to project economic impacts at the mid-year of the LR period. A more detailed description of the
7 EI method is contained in Appendix G of the 1996 LR GEIS.

8 The plant-specific EIs, in conjunction with the plant-specific total probability-weighted
9 consequences, or risk values, from the Final Environmental Statements, were used to predict
10 the 95 percent UCB consequences. This was performed for 74 nuclear power plants (including
11 Monticello), representing 118 units, from atmospheric releases due to severe accidents.
12 Predicted 95 percent UCB values were developed for early fatalities per RY, latent fatalities per
13 RY, and total population dose risk per RY. The results of this assessment are provided in 1996
14 LR GEIS Table 5.10, Table 5.11, and Table 5.6, respectively. These results are repeated in
15 Table F-1 for Monticello (recited above) in the columns titled "Predicted Total Early Fatalities/R
16 (95 percent UCB)," "Non-Normalized Predicted Latent Total Fatalities/R
17 (95 percent UCB)," and "Non-Normalized Predicted Total Population Dose Risk (person-rem/R
18 Y) (95 percent UCB)," respectively. In Section 5.5.2.5 of the 1996 LR GEIS, the NRC staff concluded that the
19 generic analysis summarized in the 1996 LR GEIS "applies to all plants and that the probability-
20 weighted consequences of atmospheric releases, fallout onto open bodies of water, releases to
21 ground water, and societal and economic impacts of severe accidents are of small significance
22 for all plants."

23 Per the Commission's regulations, applicants are required to include a plant-specific SAMA
24 analysis in the ER for license renewal if one has not been previously considered. The NRC staff
25 documented its review of the Monticello SAMA analysis in NUREG-1437 Supplement 26,
26 "Generic Environmental Impact Statement for License Renewal of Nuclear Plants, Regarding
27 Monticello Unit 1," (NRC 2006-TN7315) during Monticello initial LR. The SAMA analysis
28 included a Level 3 PRA consequence analysis that calculated the population dose risk or
29 probability-weighted consequences to the environment. The consequence analysis software
30 that was used for the Level 3 PRA consequence analysis was the MELCOR Accident
31 Consequence Code System (MACCS) code (SNL 2021-TN7810).¹ Thus, Xcel Energy submitted
32 an initial LR application that included a plant-specific estimate of the total population dose risk
33 due to severe accidents using a Level 3 PRA consequence analysis. The Monticello Level 3
34 PRA consequence analysis provided a more refined plant specific Monticello calculation of
35 population dose risk for comparison to the non-normalized predicted total population dose risk
36 per RY (person-rem/R
37 Y) consequences, at the 95 percent UCB, provided for Monticello in the
38 1996 LR GEIS. It included Monticello updated core damage frequencies (CDFs) for internal and
39 external event hazards, plant-specific updated analyses of containment performance under
40 severe accident conditions, and updated consequence analyses using Monticello plant-specific
41 information about radionuclide source terms, radionuclide releases, projected population
distribution during the LR period, meteorological data, and emergency response.

¹ MACCS was developed at and continues to be maintained by Sandia National Laboratories for the NRC. It is used to model estimates of the health risks and economic impacts of offsite radiological releases from potential severe accidents at nuclear facilities. See the description of SOARCA in this appendix for a relatively recent application by the NRC of the MACCS code for performing a state-of-the-art assessment of the consequences of severe accidents at nuclear power plants.

1 The population dose risk calculated in the Monticello Level 3 PRA consequence analysis for
2 initial LR included the contribution from severe accidents due to internally initiated events, which
3 also included events initiated by internal flooding. Xcel Energy accounted for externally initiated
4 events by using the best available information at the time. The Monticello external events
5 multiplier was calculated explicitly based on the Individual Plant Examination – External Events
6 (IPEEE). The use of external events multipliers were later included in the methodology provided
7 in NEI 05-01 (NEI 2005-TN1978), which has been endorsed by the NRC (2013-TN4791). The
8 external events multiplier is the ratio of the total plant CDF (both internally initiated and
9 externally initiated) to the CDF for internally initiated events. This multiplier is multiplied by the
10 estimated population dose risk for internally initiated events to develop the estimate of the
11 Monticello total plant population dose risk. The external event multiplier for Monticello was
12 calculated to be 3.4 in its PRA analysis during initial LR (NRC 2006-TN7315).

13 The calculated total population dose risk of 76 person-rem/RY from the Monticello initial
14 LR SAMA analyses Level 3 PRA consequence analysis is near a factor of 10 less than the
15 corresponding 1996 LR GEIS value of 730 person-rem/RY. The smaller Monticello initial LR
16 calculated value of population dose risk in comparison to the value in the 1996 GEIS
17 demonstrate the magnitude of conservatism used in the 1996 LR GEIS predicted values. This is
18 from both the standpoint of reduced consequences using more recent plant-specific information
19 and the conservatism built into the 1996 LR GEIS methodology which reinforces the conclusion
20 that the probability-weighted consequences due to severe accidents are small.

21 Since publication of the 1996 LR GEIS and 2013 LR GEIS, and the completion of numerous
22 plant-specific LR SAMA analyses, developments in plant operation and accident analysis have
23 occurred that could affect the assumptions made in these analyses. These changes are
24 grouped into the following areas which correspond with the section (in parentheses) of the 2013
25 GEIS.

- 26 • internal event risk (2013 GEIS, Section E.3.1)
- 27 • external event risk (2013 GEIS, Section E.3.2)
- 28 • updates in the quantification of accident source terms (2013 GEIS, Section E.3.3)
- 29 • increases in licensed reactor power levels, i.e., power uprates (2013 GEIS, Section E.3.4)
- 30 • increases in fuel burnup levels (2013 GEIS, Section E.3.5)
- 31 • consideration of reactor accidents at low power and shutdown conditions (2013 GEIS,
32 Section E.3.6)
- 33 • consideration of accidents in Spent Fuel Pools (SFPs) (2013 GEIS, Section E.3.7)
- 34 • the Biological Effects of Ionizing Radiation (BEIR) VII report on the risk of fatal cancers
35 posed by exposure to radiation (2013 GEIS, Section E.3.8)
- 36 • Sections discussing uncertainties (2013 GEIS, Section E.3.9), SAMAs (2013 GEIS,
37 Section E.4), and conclusions are also provided.

38 The 2023 draft revised LR GEIS evaluates new information regarding severe accidents for each
39 of the above topics (for both initial LR and SLR) and considers whether the information would,
40 collectively, change the conclusions in the 1996 LR GEIS and 2013 LR GEIS that the impacts of
41 severe accidents are small. As explained below, while several of these factors may result in
42 modest increases to severe accident risk, other new information regarding these factors
43 suggests that the risk of severe accidents may be, on average, substantially lower than

1 previously estimated. As a result, the following analysis, based on the analysis presented in the
2 draft 2023 LR GEIS, further supports the findings from the 1996 and 2013 LR GEIS, and the
3 Monticello initial LR EIS that the probability-weighted impacts of severe accidents for Monticello
4 would be small.

5 The NRC's regulations in 10 CFR Part 51 (TN250), which implement Section 102(2) of NEPA,
6 require that all applicants for LR must submit an ER to the NRC, in which they identify any "new
7 and significant information regarding the environmental impacts of LR of which the applicant is
8 aware" (see 10 CFR 51.53(c)(3)(iv)). Accordingly, in its SLR application ER, Xcel Energy
9 evaluates areas of new and significant information that could affect the environmental impact of
10 postulated severe accidents during the SLR period of extended operation and possible new and
11 significant information as it relates to SAMAs.

12 In the 2013 LR GEIS, the NRC staff evaluated the NRC's severe accident environmental impact
13 assessments in 1996 LR GEIS considering new information that might affect the evaluation and
14 confirmed that the determination regarding probability-weighted consequences of atmospheric
15 releases, fallout onto open bodies of water, releases to groundwater, and socioeconomic
16 impacts from severe accidents are small for all plants (NRC 2013-TN2654, Appendix E).

17 This EIS for Monticello evaluates new information regarding severe accidents using a similar
18 approach as that in the 2013 LR GEIS and considers whether the new information would,
19 collectively, change the conclusion that the probability-weighted consequences of a severe
20 accident at Monticello are small. As explained below, while several factors at Monticello may
21 result in modest increases in severe accident risk, other new information regarding these factors
22 suggests that the risk of severe accidents may be, on average, substantially lower than
23 previously estimated. As a result, the following NRC staff review and independent analysis
24 overall further supports the findings from the 1996 and 2013 LR GEIS, as well as the initial LR
25 EIS for Monticello, that the probability-weighted impacts of severe accidents would be SMALL.

26 **F.2 Severe Accident Analysis (Probability-Weighted Consequences)**

27 In a SAMA analysis, the NRC requires LR applicants to consider the environmental impacts of
28 severe accidents, their probability of occurrence, and potential means to mitigate those
29 accidents. As quoted above, 10 CFR Part 51 (TN250), Table B-1 states, "Alternatives to
30 mitigate severe accidents must be considered for all nuclear power plants that have not
31 considered such alternatives." This NRC requirement to consider alternatives to mitigate severe
32 accidents can be fulfilled by a SAMA analysis. The purpose of the SAMA analysis is to identify
33 design alternatives, procedural modifications, or training activities that may further reduce the
34 risks of severe accidents at nuclear power plants and that are also potentially cost-beneficial to
35 implement. The SAMA analysis includes the identification and evaluation of SAMAs that may
36 reduce the radiological risk from a severe accident by preventing substantial core damage
37 (i.e., preventing a severe accident) or by limiting releases from containment if substantial core
38 damage occurs (i.e., mitigating the impacts of a severe accident) (NRC 2013-TN2654). The
39 regulation at 10 CFR 51.53(c)(3)(ii)(L), states that each LR applicant must submit an ER that
40 considers alternatives to mitigate severe accidents "[i]f the staff has not previously considered
41 [SAMAs] for the applicant's plant in an [EIS] or related supplement or in an environmental
42 assessment."

1 **F.2.1 Monticello Initial License Renewal Application and SAMA Analysis**

2 As part of its initial LR application submitted in 2006, Nuclear Management Company (NMC), a
3 subsidiary of Xcel Energy, (hereafter referred to as Xcel Energy) included a SAMA analysis for
4 Monticello in its LR ER (NMC 2005-TN9345). Xcel Energy based that SAMA analysis on: (1) the
5 Monticello PRA for total accident frequency, CDF, and containment large early release
6 frequency (LERF); and (2) a supplemental analysis of offsite consequences and economic
7 impacts for risk determination. The Monticello PRA included a Level 1 analysis to determine the
8 CDF from internally initiated events and a Level 2 analysis to determine containment
9 performance during severe accidents. The offsite consequences and economic impacts
10 analyses were assessed through a Level 3 PRA which used site-specific data for meteorology,
11 population, and economics estimates, as well as evacuation modeling to determine the offsite
12 risk impacts on the surrounding environment and the public. Projected population distribution
13 estimates were based on 1990 census data projected out to 2030.

14 As part of its review of the initial Monticello LR application, the NRC staff reviewed
15 Xcel Energy's 2006 analysis of SAMAs, as documented in Supplement 26 to NUREG-1437
16 (NRC 2006-TN7315). Supplement 26 to NUREG-1437 contains the NRC staff's evaluation of
17 the potential environmental impacts of nuclear power plant accidents and examines each SAMA
18 both individually and, in some cases, in combination, to determine the SAMA's potential risk
19 reduction. To quantify each SAMA's cost-benefit value, the NRC staff then compared this
20 potential risk reduction against the cost of implementing the SAMA.

21 During its review of the initial LR application, the staff reviewed the NMC analysis and
22 concluded that the applied methods and their implementation was comprehensive. The
23 treatment of SAMA benefits and costs support the general conclusion that the SAMA
24 evaluations performed by NMC are reasonable and sufficient for the LR submittal (NRC 2006-
25 TN7315).

26 **F.2.2 Subsequent License Renewal Application and New and Significant Information**
27 **as it Relates to the Probability-Weighted Consequences of Severe Accidents**

28 As discussed above, a LR application must include an ER that describes SAMAs if the NRC
29 staff has not previously evaluated SAMAs for that nuclear power plant in an EIS, in a related
30 supplement to an EIS, or in an environmental assessment. As also discussed above, the NRC
31 staff performed a site-specific analysis of Monticello SAMAs in NUREG-1437, Supplement 26
32 (NRC 2006-TN7315). Therefore, in accordance with 10 CFR 51.53(c)(3)(ii)(L) and Table B-1 of
33 Appendix B to Subpart A of 10 CFR Part 51 (TN250), Xcel Energy was not required to provide
34 another SAMA analysis in its ER for the Monticello SLR application, other than addressing any
35 new and significant information that might affect its previous analyses and conclusions. Below,
36 the NRC staff summarizes possible areas of new and significant information and assesses
37 Xcel Energy's conclusions.

38 **F.3 Evaluation of New Information Concerning Severe Accident Consequences**
39 **for Monticello as It Relates to the LR GEIS and the 2006 Initial LR SEIS**

40 The 2013 LR GEIS considers developments in nuclear power plant operation and accident
41 analysis that could have changed the assumptions made in the 1996 LR GEIS concerning
42 severe accident consequences. The 2013 GEIS confirmed the 1996 LR GEIS determination that
43 the probability-weighted consequences of severe accidents are SMALL for all nuclear power
44 plants. Appendix E of the 2013 LR GEIS provides the NRC staff's evaluation of the

1 environmental impacts of postulated accidents. Table E-19, "Summary of Conclusions," shows
2 the developments that the NRC staff considered, as well as the NRC staff's conclusions. That
3 table serves as the basis for the 2013 conclusion that the probability-weighted consequences of
4 severe accidents remain SMALL for all nuclear power plants.

5 The NRC staff's evaluation for this Monticello SLR application followed the generic approach
6 provided in the 2013 GEIS using Monticello site-specific information. The site-specific analysis
7 evaluates the impact of any relevant new Monticello information on the environmental
8 consequences of continued plant operation during the subsequent period of extended operation.

9 For Monticello SLR, the NRC staff confirmed from this analysis that there is no new and
10 significant information that would change the 2013 LR GEIS conclusions, or the conclusions in
11 the initial LR SEIS for Monticello, regarding the probability-weighted consequences of severe
12 accidents. The NRC staff evaluated Xcel Energy's new information during the Monticello audit
13 (NRC 2023-TN9794), during the scoping process, and through the evaluation of other available
14 information. The results of that review follow.

15 **F.3.1 New Internal Events Information (Section E.3.1 of the 2013 LR GEIS)**

16 The purpose of this section is to consider updated information since Monticello initial license
17 renewal regarding the contribution to CDF from accidents initiated by internal events and
18 potential internal event impacts. The LR SAMA analyses submitted for initial LR and reviewed
19 by the NRC staff explicitly considered the impact of internal events in the assessment of SAMAs
20 and the determination of population dose risk for Monticello initial LR.

21 The Monticello internal events CDF in the initial LR SAMA was 4.5×10^{-5} /year (NRC 2006-
22 TN7315). The Monticello internal events CDF provided in the ER for SLR is approximately
23 1.3×10^{-5} /year (Xcel 2023-TN9084). Specifically, the current internal events CDF of
24 1.3×10^{-5} /year represents approximately 71 percent reduction or about a factor of 3.5 reduction
25 from the initial LR SAMA analysis.

26 As discussed above, the assessed impacts from the 1996 LR GEIS were based on the original
27 license EISs for the 28 nuclear power plant sites listed in Table 5.1 of the GEIS. Monticello was
28 not one of the original 28 nuclear power plant sites, however a comparison with the original
29 internal event CDF values that the 1996 LR GEIS analysis is shown in Figure F-2. Specifically,
30 The Monticello internal events CDF provided in the SLR ER (1.3×10^{-5} /year) is more than a
31 factor of 4.2 lower than the 1996 LR GEIS mean CDF for boiling water reactors (BWRs) of
32 5.4×10^{-5} /yr. This represents a factor of 1.8 lower from the 1996 LR GEIS median value.
33 Likewise, The Monticello internal events CDF provided in the SLR ER (1.3×10^{-5} /year) is more
34 than a factor of 3.5 lower than the Monticello LR SAMA internal events CDF of 4.5×10^{-5} /yr.

35 In summary, the updated accident frequencies from the Monticello initial LR and SLR ER are
36 lower than the mean and median values of the BWR internal event accident frequencies that
37 form the basis for the environmental impacts shown in the 1996 LR GEIS. Furthermore, the SLR
38 internal event accident frequency for Monticello has decreased since the Monticello initial LR
39 SAMA analysis.

1 **Table F-2 Boiling Water Reactor Internal Event (Full Power) Core Damage Frequency**
 2 **Comparison**

Nuclear Power Plant	1996 LR GEIS Estimated CDF ^(a)	IPE CDF ^(b)	SAMA Internal Event CDF ^(c)
Monticello	N/A	$2.6 \times 10^{-5}/\text{yr}^{(d)}$	$4.5 \times 10^{-5}/\text{yr}^{(d)}$
Mean value	$5.4 \times 10^{-5}/\text{yr}$	$1.5 \times 10^{-5}/\text{yr}$	$8.7 \times 10^{-6}/\text{yr}$
Median value	$2.4 \times 10^{-5}/\text{yr}$	$1.45 \times 10^{-5}/\text{yr}$	$3.1 \times 10^{-6}/\text{yr}$

CDF = core damage frequency; IPE = Individual Plant Examination; LR GEIS = Generic Environmental Impact Statement for License Renewal of Nuclear Plants; N/A = not available; SAMA = severe accident mitigation alternative.

(a) The estimated CDF was obtained by summing individual atmospheric release sequences, including intact containment sequences.

(b) Data were obtained from NRC 1997-TN7812, unless otherwise noted.

(c) Data were obtained from the applicable plant-specific supplement to NUREG-1437, unless otherwise noted.

(d) The internal events initiated CDF value includes contribution from internal flooding events.

3 Therefore, considering the site-specific internal event CDF reduction in Monticello’s risk profile,
 4 the NRC staff concludes that the probability-weighted offsite consequences of severe accidents
 5 initiated by internal events during the SLR term at Monticello would be SMALL. For these
 6 issues, the 1996 LR GEIS and 2013 LR GEIS predicted that the probability-weighted
 7 consequences of severe accidents would be SMALL for all nuclear plants. The Monticello initial
 8 LR SEIS reached the same conclusion. The NRC staff’s site-specific analysis identified no new
 9 and significant information regarding internal events during its review of Xcel Energy’s ER,
 10 during the SAMA audit, through the scoping process, or through the evaluation of other
 11 available information. Thus, the NRC staff finds Xcel Energy’s conclusion acceptable that no
 12 new and significant information exists for Monticello concerning offsite consequences of severe
 13 accidents initiated by internal events that would alter the conclusion that for Monticello, the
 14 probability-weighted consequences of atmospheric releases, fallout onto open bodies of water,
 15 releases to groundwater, and societal and economic impacts from severe accidents remains
 16 SMALL for the SLR period.

17 Therefore, considering the CDF reduction in Monticello’s risk profile and the new information
 18 evaluated in the 2013 LR GEIS, the NRC staff concludes that the offsite consequences of
 19 severe accidents initiated by internal events during the SLR term at Monticello would not exceed
 20 the impacts predicted in the 1996 or 2013 LR GEIS. For these issues, the LR GEIS predicted
 21 that the probability-weighted consequences of severe accidents would be SMALL for all nuclear
 22 power plants. The Monticello SEIS for initial LR (NRC 2006-TN7315) reached the same
 23 conclusion. The NRC staff identified no new and significant information regarding internal
 24 events during its review of Xcel Energy’s ER, during the SAMA audit, through the scoping
 25 process, or through the evaluation of other available information. Thus, the staff concludes using
 26 plant-specific information that no new and significant information exists for Monticello during the
 27 SLR term concerning the offsite consequences of severe accidents initiated by internal events
 28 that would alter the conclusions reached in the 1996 or 2013 LR GEIS, or the initial LR SEIS for
 29 Monticello.

30 **F.3.2 External Events (Section E.3.2 of the 2013 LR GEIS)**

31 The purpose of this section is to consider updated information regarding the contribution to CDF
 32 from accidents initiated by external events and potential external event impacts. The 1996
 33 LR GEIS included a qualitative assessment of the environmental impacts of accidents initiated
 34 by external events (see Section 5.3.3.1 of the 1996 LR GEIS). The sources of information used

1 in this assessment for SLR are the 2006 Monticello SAMA analyses provided in the ER and the
2 plant-specific SEIS to NUREG-1437, Supplement 26. The LR SAMA analyses submitted and
3 reviewed by the NRC staff explicitly considers the impact of external events in the assessment
4 of SAMAs.

5 The 2013 LR GEIS expanded the scope of the evaluation in the 1996 LR GEIS and used more
6 recent technical information that included both internally and externally initiated event core
7 damage frequencies. Section E.3.2.3 of the 2013 LR GEIS concludes that the CDFs from
8 severe accidents initiated by external events, as quantified in NUREG-1150, "Severe Accident
9 Risks: An Assessment for Five U.S. Nuclear Power Plants" (NRC 1990-TN525), and other
10 sources documented in the GEIS, are comparable to CDFs from accidents initiated by internal
11 events, but lower than the CDFs that formed the basis for the 1996 LR GEIS.

12 The assessment in this section of the site-specific EIS is based on the cumulative assessment
13 of the risks and environmental impacts of severe accidents initiated by external events and
14 those initiated by internal events, based on the aforementioned information sources. As with the
15 previous section that addressed updated information with regard to internal events risk, the
16 evaluation contained in this section compares the CDFs that formed the basis for the
17 1996 LR GEIS, and offsite population dose risks directly from the 1996 LR GEIS, to the
18 information submitted in the Monticello SLR ER (Xcel 2023-TN9084).

19 The first step in the NRC staff's evaluation is to compare the BWR internal event-initiated CDFs
20 presented in the 1996 LR GEIS to those reported in both the Monticello LR ER and the
21 Monticello SLR ER. For BWRs, the 1996 LR GEIS estimated CDFs used to determine the
22 probability-weighted consequences ranged from $2.4 \times 10^{-5}/\text{RY}$ (several plants) to $1.1 \times 10^{-4}/\text{RY}$
23 (Nine Mile Point 2) with a mean of 5.4×10^{-5} and median $2.4 \times 10^{-5}/\text{RY}$. Note that CDF
24 estimates in the 1996 LR GEIS were obtained by summing individual atmospheric release
25 sequences, including intact containment sequences, provided in the original (plant-specific)
26 EISs. The specific internal event CDF for Monticello was not used in the 1996 GEIS because
27 the original Monticello operational final environmental statement was not available when the
28 1996 GEIS evaluation was performed. Thus, in this SLR EIS, the NRC staff compares the range
29 of BWR internal event-initiated CDFs available for the 1996 LR GEIS evaluation to the BWR
30 internal event-initiated CDFs reported in both the Monticello LR ER and the Monticello SLR ER.

31 For the 2023 SLR application, the licensee reported the sum of the fire and seismic CDFs
32 ($2.3 \times 10^{-5}/\text{RY}$, $6.4 \times 10^{-6}/\text{RY}$, respectively) in the Monticello ER to be $2.94 \times 10^{-5}/\text{RY}$. This sum
33 ($2.94 \times 10^{-5}/\text{RY}$) is less than $5.4 \times 10^{-5}/\text{RY}$ which is the internal events mean value CDF for
34 BWRs that the 1996 LR GEIS used to estimate the probability-weighted, offsite consequences
35 for airborne, surface water and groundwater pathways, as well as the resulting economic
36 impacts for such pathways. This sum ($2.94 \times 10^{-5}/\text{RY}$) is greater than the Monticello internal
37 event CDF ($1.3 \times 10^{-5}/\text{RY}$) reported in the ER, but lower than the internal events mean value
38 CDF for BWRs that the 1996 LR GEIS used to estimate the probability-weighted, offsite
39 consequences for airborne, surface water and groundwater pathways, as well as the resulting
40 economic impacts for such pathways. Since Monticello fire and seismic PRA models and
41 estimates were developed at Monticello since the time of the initial LR, these models were
42 considered new information by Xcel Energy. Xcel Energy used this information in its quantitative
43 PRA calculation to evaluate each SAMA's potential for significance. This information is
44 presented in Table 4.15-2 of the ER. The findings of the NRC staff's review are presented
45 below.

1 Similarly, the result of the Monticello SAMA Level 3 PRA consequence analysis was within the
 2 bounds of the 1996 LR GEIS estimate regarding probability-weighted consequence results
 3 considering external events. In the Monticello LR ER, the applicant estimated the population
 4 dose risk within 50 mi (80 km) of the Monticello site to be approximately 38 person-rem per
 5 year. The breakdown of these results by containment release mode is summarized in Table 5-4
 6 of the staff's EIS for initial LR. Considering the new CDF information regarding seismic and fire
 7 in the Monticello SLR ER, another external event multiplier was calculated by the NRC staff and
 8 also presented in Table F-3 below. The external event multiplier was calculated by dividing the
 9 Monticello total CDF of $4.3 \times 10^{-5}/\text{RY}$ by the Monticello internal events CDF of $1.3 \times 10^{-5}/\text{RY}$ to
 10 compute an external event multiplier of 4. Using 6 as a conservative multiplier, the new
 11 Monticello population dose risk is 228 person-rem/R Y (38×6). This new value of
 12 228 person-rem/R Y that considers the new external event information continues to be much
 13 lower than the 1996 LR GEIS estimated predicted total population dose risk (95 percent UCB)
 14 value of 730 person-rem/R Y for Monticello.

15 As provided in Table F-3, with the newer external events multiplier of 6, the calculated total
 16 population dose risk of 228 person-rem/R Y is about a factor of 3 (calculated $730/228$) less than
 17 the corresponding 1996 LR GEIS value for Monticello of 730 person-rem/R Y used to make the
 18 initial environmental impact determination of SMALL.

19 **Table F-3 Monticello All Hazards (Full Power) Population Dose Risk Comparison with**
 20 **Newer External Events Multiplier**

Nuclear Power Plant	1996 LR GEIS Estimated Predicted Total Population Dose – Non-normalized 95% UCB (person-rem/R Y) ^(a)	New SAMA All Hazards PDR (person-rem/R Y) ^(b)
Monticello	730	228
Mean value	2,718	41.0
Median value	2,636	37.3

LR GEIS = Generic Environmental Impact Statement for License Renewal of Nuclear Plants; PDR = population dose risk; R Y = reactor-year; SAMA = severe accident mitigation alternative; UCB = upper-confidence bound.

(a) Data were obtained from NRC 1996-TN288.

(b) Data were obtained from the applicable plant-specific supplement to NUREG-1437 and multiplied by the external events multiplier from the same plant-specific SEIS to NUREG-1437, if applicable (NRC 2022-TN7857). For Monticello, the staff developed a conservative external event multiplier with the new Monticello SEISMIC and FIRE PRA information.

Source: NRC 2022-TN7857, unless otherwise.

21 The 1996 LR GEIS did not quantitatively consider severe accidents initiated by external events
 22 when assessing environmental impacts. However, the application for the Monticello SLR period
 23 does consider external events. Xcel Energy indicated the PRA models in the Monticello SLR ER
 24 reflected the most up-to-date understanding of nuclear power plant risk at the time of analysis
 25 The new CDF estimates, which are dominated by fire, have increased since the Monticello
 26 initial LR SAMA. However, these higher CDF values are within the range of those forming the
 27 basis of the 1996 LR GEIS. Furthermore, the environmental impact, population dose risk,
 28 adjusted for external events is lower than those predicted for Monticello in the 1996 LR GEIS.
 29 Therefore, the offsite consequences of severe accidents initiated by external events during the
 30 subsequent LR term would not exceed the impacts predicted in the 1996 GEIS. Therefore, the
 31 staff concludes that no new and significant information exists for Monticello concerning offsite
 32 consequences of severe accidents initiated by external events.

1 In addition, on November 25, 2020, the NRC staff completed its review of external hazards
2 information for all operating power reactors (as ordered by the Commission following the
3 Fukushima accident). For Monticello, the staff concluded that no further regulatory actions were
4 needed to ensure adequate protection or compliance with regulatory requirements, including
5 site-specific external hazards information, thus re-confirming the acceptability of Monticello's
6 external hazard information (NRC 2020-TN9695).

7 In conclusion, there was an 8 percent decrease in the Monticello internal events CDF since the
8 initial ER. Monticello provided commitments, or implemented safety enhancements mandated
9 by the NRC, based on the lessons learned from the Fukushima accident. As predicted in the
10 2013 LR GEIS, the sum of the Monticello external events CDFs was within the range of BWR
11 CDFs that formed the basis for the 1996 LR GEIS. Therefore, the NRC staff concludes that the
12 probability-weighted offsite consequences of severe accidents initiated by external events
13 during the SLR term would not exceed the consequences predicted in the 1996 or
14 2013 LR GEIS. For these issues, the LR GEIS predicts that the probability-weighted
15 consequences would be SMALL for all nuclear power plants. The NRC staff identified no new
16 and significant information regarding external events during its review of Xcel Energy's ER,
17 through the SAMA audit, during the scoping process, or through the evaluation of other
18 available information. Thus, the NRC staff concludes using plant-specific information that no
19 new and significant information exists for Monticello and the probability-weighted consequences
20 of atmospheric releases, fallout onto open bodies of water, releases to groundwater, and
21 societal and economic impacts from severe accidents remains SMALL for the SLR period.

22 **F.3.3 New Source Term Information (Section E.3.3 of the 2013 LR GEIS)**

23 The source term refers to the magnitude and mix of the radionuclides released from the fuel
24 (expressed as fractions of the fission product inventory in the fuel), as well as their physical and
25 chemical form, and the timing of their release following an accident. The 2013 LR GEIS
26 concludes that, in most cases, more recent estimates give significantly lower release
27 frequencies and release fractions than was assumed in the 1996 LR GEIS. Thus, the
28 environmental impacts of radioactive materials released during severe accidents, used as the
29 basis for the 1996 LR GEIS (i.e., the frequency-weighted release consequences), are higher
30 than the environmental impacts using more recent source term information. The predicted early
31 and latent fatalities and population dose risk estimates per RY for Monticello are provided in
32 Table 5.6 of the 1996 LR GEIS. The very conservatively predicted 1996 LR GEIS 95 percent
33 UCB total early fatalities/R Y and 95 percent latent total fatalities/R Y were determined to be
34 4.1×10^{-3} and 5.0×10^{-2} , respectively. Similarly, the 1996 LR GEIS very conservatively
35 predicted 95 percent UCB population dose/R Y to be 730 person-rem/R Y. In the Monticello initial
36 LR ER, the population dose risk was calculated to be 76 person-rem/R Y which is a factor of 10
37 improvement.

38 Peach Bottom Atomic Power Station was evaluated in NUREG/CR-7110 (NRC 2013-TN4592)
39 in the state-of-art reactor consequence analysis (SOARCA), published in 2013. This analysis
40 updated the NRC's severe accident studies of the Peach Bottom Atomic Power Station (i.e.,
41 NUREG-1150), incorporating state-of-the-art analyses to evaluate offsite risk. The SOARCA
42 was not a complete analysis of all scenarios in the PRA, but it supports the conclusion that the
43 offsite effects from a severe accident would be small. While the Monticello design is not identical
44 to Peach Bottom Atomic Power Station, both are BWRs with MARK I containments, and the
45 general conclusions of lower offsite consequences from the SOARCA apply to Monticello as
46 well (Xcel 2023-TN9084).

1 The SOARCA report presents the results of an earthquake and station blackout in terms of
2 individual latent cancer fatality risk and early (or prompt) fatality risk. In summary, the mitigated
3 scenarios show essentially zero risk of early fatalities from radiation exposure and result in very
4 small risk of a long-term cancer fatality (NRC 2012-TN3092). As indicated in the SOARCA
5 report:

6 “The individual early fatality risk from SOARCA scenarios is essentially zero.
7 Individual latent cancer fatality (LCF) risk from the selected specific, important
8 scenarios is thousands of times lower than the NRC Safety Goal and millions of
9 times lower than the general cancer fatality risk in the United States from all
10 causes, even assuming the linear no-threshold (LNT) dose-response model.
11 Using a dose-response model that truncates annual doses below normal
12 background levels (including medical exposures) results in a further reduction to
13 the LCF risk (by a factor of 100 for smaller releases and a factor of 3 for larger
14 releases). LCF risk calculations are generally dominated by long-term exposure
15 to small annual doses (about 500 mrem per year) corresponding to evacuees
16 returning to their homes after the accident and being exposed to residual
17 radiation over a long period of time.” (NRC 2012-TN3092)

18 The unmitigated scenarios from SOARCA result is essentially zero risk of early fatality for an
19 individual. Although these unmitigated scenarios result in core damage and release of
20 radioactive material to the environment, the release is often delayed, which allows the
21 population to take protective actions such as evacuation and sheltering. Therefore, the public
22 would not be exposed to concentrations of radioactive material in excess of NRC regulatory
23 limits. This result holds even when uncertainties are considered—all three uncertainty analyses
24 continued to show extremely low risk of early fatalities. For the unmitigated scenarios, the
25 individual risk of a long-term cancer fatality is calculated to be very small, regardless of which
26 distance interval (e.g., 0–10 mi, 0–20 mi, 0–50 mi) is considered. This result holds even when
27 uncertainties are considered (NRC 2022-TN8182).

28 In conclusion, more recent source term information indicates that the timing from dominant
29 severe accident sequences, as quantified in the SOARCA (NRC 2012-TN3092), comes much
30 later than the timing assumed in the analysis forming the basis of the 1996 LR GEIS. In most
31 cases, the release frequencies and release fractions are significantly lower for the more recent
32 estimates. Specifically, the SOARCA results show essentially zero early fatality risk for Peach
33 Bottom, a BWR similar to Monticello, and show a very low individual risk of cancer fatalities for
34 the populations close to the nuclear power plants (i.e., well below the NRC Safety Goal of two
35 long-term cancer fatalities annually in a population of one million individuals). Thus, the
36 probability-weighted impacts estimated using the more recent and realistic source term
37 information are much lower than the probability-weighted impacts used as the basis for the
38 1996 LR GEIS (i.e., the frequency-weighted consequences).

39 None of the SAMAs evaluated in the Monticello ER were found to reduce source term category
40 group frequency by at least 50 percent. Therefore, the offsite consequences of severe accidents
41 initiated by the new source term during the SLR term would not exceed the impacts predicted in
42 the 1996 or 2013 LR GEIS. For these issues, the LR GEIS predicts that the probability-weighted
43 consequences of severe accidents would be SMALL for all nuclear power plants. The Monticello
44 SEIS for initial LR reached the same conclusion. The NRC staff identified no new and significant
45 information regarding the source term during its review of Xcel Energy’s ER, through the SAMA
46 audit, during the scoping process, or through the evaluation of other available information. Thus,
47 the NRC staff concludes that no new and significant information exists for Monticello concerning

1 the source term that would alter the conclusions reached in the 1996 or 2013 LR GEIS or the
2 Monticello SEIS for initial LR.

3 **F.3.4 Power Uprate Information (Section E.3.4 of the 2013 LR GEIS)**

4 Operating at a higher reactor power level results in a larger fission product radionuclide
5 inventory in the core than if the reactor were operating at a lower power level. In the event of an
6 accident, the larger radionuclide inventory in the core would result in a larger source term. If the
7 accident is severe, the release of radioactive materials from this larger source term could result
8 in higher doses to offsite populations.

9 LERF represents the frequency of event sequences that could result in early fatalities. The
10 impact of a power uprate on early fatalities can be measured by considering the impact of the
11 uprate on the LERF calculated value. To this end, Table E-14 of the 2013 LR GEIS presents the
12 change in LERF calculated by each licensee that has been granted a power uprate of greater
13 than 10 percent. Table E-14 shows that the increase in LERF ranges from a minimal impact to
14 an increase of about 30 percent (with a mean of 10.5 percent). The 2013 LR GEIS,
15 Section E.3.4.3, "Conclusion," determines that a power uprate will result in a small to (in some
16 cases) moderate increase in the environmental impacts from a postulated accident. However,
17 taken in combination with the other information presented in the LR GEIS, the increases would
18 be bounded by the 95 percent UCB values in Table 5.10 and Table 5.11 of the 1996 LR GEIS.
19 Taken in combination with the other information presented in the 2013 LR GEIS, the NRC staff
20 concluded that effects of such increases on risk and environmental impacts of severe accidents
21 would be bounded by the 1996 LR GEIS which used the 95 percent UCB values as the basis for
22 estimating offsite consequences.

23 Monticello was originally designed for operation at power levels up to 1,670 megawatts thermal
24 (MWt) and an electrical output of up to 545 megawatts electric (MWe). Since being placed into
25 commercial operation, an uprate license amendment was approved by the NRC on January 21,
26 1998. This power uprate increased the power output by 6.3 percent to 1,775 MWt and an
27 electrical output of up to 600 MWe (NRC 2006-TN7315, NRC 2013-TN9799). Then, in 2013, an
28 EPU was approved. The EPU increased licensed reactor thermal power by approximately
29 13 percent to 2,004 MWt and an electrical output of up to 691 MWe. For the 2013 EPU, several
30 modifications were made, including, but not limited to, modifications to main steam transmitters
31 and valves, both high- and low-pressure turbines, instrumentation and controls, and the
32 associated steam, condensate, and feedwater paths, reactor feed pump, power range neutron
33 monitoring system, and main generator transformer (NRC 2006-TN7315; Xcel 2008-TN9821;
34 NRC 2013-TN9799; Xcel 2023-TN9084).

35 The Monticello PRA was updated to include impacts related to EPU changes since they are
36 considered new information in the quantitative SLR evaluation. The result of the PRA updates
37 resulted in an increase in the internal events CDF by approximately 7.8 percent and LERF by
38 approximately 8.2 percent. In a 2013 NRC staff Monticello EPU evaluation, the NRC staff
39 concurred that the EPU change in power represent a relatively small change to the overall
40 challenge to containment under severe accident conditions (NRC 2013-TN9799).

41 Therefore, the NRC staff finds that the offsite consequences from the power uprates would not
42 exceed the consequences predicted in the 2013 LR GEIS or the Monticello SEIS for initial LR.
43 The NRC staff has identified no new and significant information regarding power uprates during
44 its review of Xcel Energy's ER, through the SAMA audit, during the scoping process, or through
45 the evaluation of other available information. Thus, the staff concludes using plant-specific

1 information that no new and significant information exists for Monticello concerning offsite
2 consequences due to power uprates that would alter the conclusions reached in the 1996 or
3 2013 LR GEIS or the Monticello SEIS for initial LR.

4 **F.3.5 Higher Fuel Burnup Information (Section E.3.5 of the 2013 LR GEIS)**

5 According to the 2013 LR GEIS, increased peak fuel burnup from 42 to 75 gigawatt days per
6 metric ton uranium (GWd/MTU) for PWRs, and 60 to 75 GWd/MTU for boiling water reactors,
7 results in small-to-moderate increases (up to 38 percent) in population dose in the event of a
8 severe accident. However, taken in combination with the other information presented in the
9 2013 LR GEIS, the increases would be bounded by the 95 percent UCB values in Table 5.10
10 and Table 5.11 of the 1996 LR GEIS.

11 There has been continued movement toward higher fuel burnup, to allow for more efficient
12 utilization of the fuel and longer operating cycles. The purpose of Section E.3.5 of the
13 2013 LR GEIS was to account for the effect of current and possible future increased fuel burnup
14 on postulated accidents. Future peak burnups considered were 62 gigawatt days per metric ton
15 uranium GWd/MTU for PWRs and 70 GWd/MTU for boiling water reactors.

16 As discussed in Section 2.2.1 of the Monticello SLR ER, average peak rod fuel burnup limit for
17 Monticello during the terms of the extended licenses is not expected to exceed 62 GWd/MTU.
18 Therefore, the offsite consequences from higher fuel burnup would not exceed the 70
19 GWd/MTU consequences predicted in the 2013 LR GEIS. For these issues, the LR GEIS
20 predicted that the probability-weighted consequences would be SMALL for all nuclear power
21 plants. The Monticello SEIS for initial LR reached the same conclusion. The NRC staff identified
22 no new and significant information regarding higher fuel burnup during its review of Xcel
23 Energy's ER, through the SAMA audit, during the scoping process, or through the evaluation of
24 other available information. Thus, the NRC staff concludes that no new and significant
25 information exists for Monticello concerning offsite consequences due to higher fuel burnup that
26 would alter the conclusions reached in the 2013 LR GEIS. Thus, the staff concludes using plant-
27 specific information that no new and significant information exists for Monticello concerning
28 offsite consequences due to higher fuel burnup that would alter the conclusions reached in the
29 1996 or 2013 LR GEIS or the Monticello SEIS for initial LR.

30 **F.3.6 Low Power and Reactor Shutdown Event Information (Section E.3.6 of the 2013** 31 **LR GEIS)**

32 The 2013 LR GEIS states the environmental impacts from accidents at low power and shutdown
33 conditions are generally comparable to those from accidents at full power when comparing the
34 values in NUREG/CR-6143, "Evaluation of Potential Severe Accidents During Low Power and
35 Shutdown Operations at Grand Gulf, Unit 1" (NRC 1995-TN8976), and NUREG/CR-6144,
36 "Evaluation of Potential Severe Accidents During Low Power and Shutdown Operations at
37 Surry, Unit 1" (BNL 1995-TN7776), with the values in NUREG-1150, "Severe Accident Risks: An
38 Assessment for Five U.S. Nuclear Power Plants" (NRC 1990-TN525). The 2013 LR GEIS
39 further indicates that although the impacts for low power and shutdown conditions could be
40 somewhat greater than for full power (for certain metrics), the 1996 LR GEIS's very
41 conservative estimates of the environmental impact of severe accidents (using 95th UCBs)
42 bound the potential impacts from accidents at low power and shutdown with margin.

43 Monticello and Grand Gulf are not identically designed plants, but they are both BWRs. Also,
44 Peach Bottom was one of the five plants analyzed in NUREG/CR-1150 (NRC 1990-TN525).

1 While the Monticello design is not identical to Peach Bottom Atomic Power Station, both are
2 BWRs with MARK I containments. Based on the similarities between Monticello and Peach
3 Bottom and Grand Gulf, the NRC staff finds that the general conclusions regarding plant
4 configurations in low power and shutdown conditions evaluated in the GEIS apply to Monticello
5 as well. Additionally, as discussed in SECY-97-168, existing regulatory controls for shutdown
6 operations have evolved through a series of industry actions that have been successful in
7 achieving an acceptable level of safety for low power and shutdown operation (NRC 1997-
8 TN7621). Therefore, the offsite consequences of severe accidents, considering low power and
9 shutdown events, would not exceed the impacts predicted in either the 1996 or 2013 GEIS. At
10 Monticello, low power and shutdown events are in line with the conclusions in the GEIS.
11 Xcel Energy concludes that no new and significant information exists for Monticello concerning
12 lower power and shutdown events.

13 Peach Bottom was evaluated in NUREG-1150 and Grand Gulf was evaluated in
14 NUREG/CR-6143 (SNL 1995-TN7783) for low power and reactor shutdown event information.
15 Monticello is a similarly designed nuclear power plant (i.e., they are all boiling water reactors);
16 thus, the NRC staff concludes that there are likely to be no significant nuclear power plant
17 configurations in low power and shutdown conditions likely to distinguish Monticello from the
18 evaluated nuclear power plants. Thus, the staff concludes that the environmental impact of
19 Monticello from accidents at low power and shutdown conditions are generally comparable to
20 the impacts from accidents at full power, which is consistent with the 2013 and 1996 LR GEIS.

21 Additionally, as discussed in SECY-97-168, "Issuance for Public Comment of Proposed
22 Rulemaking Package for Shutdown and Fuel Storage Pool Operation" (NRC 1997-TN7621),
23 industry initiatives taken during the early 1990s have also contributed to the improved safety of
24 low power and shutdown operations for all nuclear power plants. Promulgation of 10 CFR
25 50.65(a)(4) to require licensees to assess and manage the increase in risk that may result from
26 the proposed maintenance activities and industry's implementation of NUMARC 93-01 have
27 further enhanced the NRC staff's ability to oversee licensee activities related to shutdown risk.
28 The NRC staff concludes low power and shutdown risk is effectively managed by NRC required
29 maintenance rule programs, and that, therefore low power and shutdown risk is not expected to
30 challenge the 1996 LR GEIS 95 percent UCB risk metrics during the SLR period.

31 Therefore, the offsite consequences of severe accidents, considering low power and reactor
32 shutdown events, are in line with the conclusions in the 1996 or 2013 LR GEIS. For these
33 issues, the LR GEIS predicts that the probability-weighted consequences of severe accidents
34 would be SMALL for all nuclear power plants. The NRC staff identified no new and significant
35 information regarding low power and reactor shutdown events during its review of Xcel Energy's
36 ER, through the NRC staff's SAMA audit, during the scoping process, or through the evaluation
37 of other available information. Thus, the staff concludes that no new and significant information
38 exists for Monticello concerning low power and reactor shutdown events that would alter the
39 conclusions reached in the 1996 or 2013 LR GEIS.

40 **F.3.7 Spent Fuel Pool Accident Information (Section E.3.7 of the 2013 LR GEIS)**

41 The 2013 LR GEIS concludes that the environmental impacts from accidents involving SFPs, as
42 quantified in NUREG-1738, "Technical Study of Spent Fuel Pool Accident Risk at
43 Decommissioning Nuclear Power Plants" (NRC 2001-TN5235), can be comparable to those
44 from reactor accidents at full power (as estimated in NUREG-1150 (NRC 1990-TN525). The
45 2013 LR GEIS further indicates that subsequent analyses performed, and mitigative measures
46 employed since 2001, have further lowered the risk of accidents involving SFPs. In addition, the

1 LR GEIS notes that even the conservative estimates from NUREG-1738 (published in 2001) are
2 much lower than the impacts from full power reactor accidents estimated in the 1996 LR GEIS.
3 Therefore, the LR GEIS concludes, the environmental impacts stated in the 1996 LR GEIS
4 bound the impact from Spent Fuel Pool accidents for all nuclear power plants. For these issues,
5 the LR GEIS predicts that the impacts would be SMALL for all nuclear power plants.

6 There are no spent fuel configurations that would distinguish Monticello from the evaluated
7 nuclear power plants such that the assumptions in the 2013 and 1996 LR GEIS would not apply.
8 Consistent with NUREG-1738, the impacts of accidents in SFPs at Monticello is comparable to
9 or lower than those from reactor accidents and are bounded by the 1996 LR GEIS. In addition,
10 two orders were issued by the NRC in March 2012, Mitigating Strategies (EA-12-049) and Spent
11 Fuel Pool Instrumentation (EA-12-051). Monticello implemented both of these orders in 2016
12 and 2017, respectively (NRC 2017-TN9795). Mitigation strategies implemented after
13 September 11, 2001 and diverse and flexible coping strategies, provide additional resources to
14 maintain SFP water inventory and risk reduction. The 2013 LR GEIS (NRC 2013-TN2654)
15 indicates that analyses performed and mitigative measures employed since 2001 have further
16 lowered the risk of accidents involving SFPs. As a result of post-Fukushima Near-Term Task
17 Force 2.1 recommendations, the implementation of diverse and flexible coping strategies
18 provides additional resources to maintain SFP water inventory and risk reduction (NRC 2017-
19 TN9795). The NRC staff identified no new and significant information regarding Spent Fuel Pool
20 accidents during its review of Xcel Energy's ER, through the SAMA audit, during the scoping
21 process, or through the evaluation of other available information. Thus, the NRC staff concludes
22 that no new and significant information exists for Monticello concerning Spent Fuel Pool
23 accidents that would alter the conclusions reached in the 1996 or 2013 LR GEIS.

24 **F.3.8 Use of Biological Effects of Ionizing Radiation VII Risk Coefficients**
25 **(Section E.3.8 of the 2013 LR GEIS)**

26 In 2005, the NRC staff completed a review of the National Academy of Sciences report, "Health
27 Risks from Exposure to Low Levels of Ionizing Radiation: Biological Effects of Ionizing Radiation
28 (BEIR) VII, Phase 2." The NRC staff documented its findings in SECY-05-0202, "Staff Review of
29 the National Academies Study of the Health Risks from Exposure to Low Levels of Ionizing
30 Radiation (BEIR VII)" (NRC 2005-TN4513). The SECY paper states that the NRC staff agrees
31 with the BEIR VII report's major conclusion—namely, the current scientific evidence is
32 consistent with the hypothesis that there is a linear, no-threshold, dose-response relationship
33 between exposure to ionizing radiation and the development of cancer in humans. The BEIR VII
34 conclusion is consistent with the hypothesis on radiation exposure and human cancer that the
35 NRC uses to develop its standards of radiological protection. Therefore, the NRC staff has
36 determined that the conclusions of the BEIR VII report do not warrant any change in the NRC's
37 radiation protection standards and regulations because the NRC's standards are adequately
38 protective of public health and safety and will continue to apply during Monticello's SLR term.
39 This general topic is discussed further in the NRC's 2007 denial of Petition for Rulemaking -51-
40 11 (72 FR 71083-TN7789), in which the NRC stated that it finds no need to modify the 1996
41 LR GEIS considering the BEIR VII report. For these issues, the LR GEIS predicts that the
42 impacts of using the BEIR VII risk coefficients would be SMALL for all nuclear power plants.
43 Because the Monticello SAMA analysis does not find any SAMAs that reduced the risk metrics
44 by at least 50 percent, no offsite doses are computed as part of a full Level 3 evaluation.
45 Therefore, BEIR VII risk coefficients have no impact on the Monticello SAMA Stage 1 analysis.
46 Further, the plant internal events risk has been reduced by approximately 75 percent since the
47 initial LR review, therefore the impact from consideration of the BIER VII report would be
48 insignificant (Xcel 2023-TN9084).

1 The NRC staff identified no new and significant information regarding the risk coefficient used in
2 the BEIR VII report during its review of Xcel Energy's ER, through the SAMA audit, during the
3 scoping process, or through the evaluation of other available information. Thus, the staff
4 concludes that no new and significant information exists for Monticello concerning the biological
5 effects of ionizing radiation that would alter the conclusions reached in the 1996 or 2013
6 LR GEIS.

7 **F.3.9 Uncertainties (Section E.3.9 of the 2013 LR GEIS)**

8 The 1996 LR GEIS used 95th percent upper-confidence bound estimates whenever available
9 for its estimates of the environmental impacts of severe accidents, which applies conservatism
10 to cover uncertainties (NRC 1996-TN288). The 1996 LR GEIS used a Monticello specific
11 predicted upper-confidence bound total population dose risk value of 730 person-rem/Ry
12 (NRC 1996-TN288, Table 5-9). This can be compared to the Monticello initial LR specific
13 population dose risk calculation of 38 person-rem/Ry (using internal event CDF only) (NRC
14 2006-TN7315, Table 5-4). For Monticello, this factor of population dose reduction from newer
15 information is on the order of a factor of 19.

16 As listed in Table 5.6 of the 1996 LR GEIS, the Monticello predicted total population dose risk of
17 730 person-rem/Ry is in the lower range of predicted population dose risks in the 1996
18 LR GEIS. These values ranged from the Big Rock Point facility at 48 person-rem/Ry to the
19 Indian Point facility at 9727 person-rem/Ry. The newer Monticello internal event CDF
20 information accounts for a decrease in CDF by a factor of 3.5. When external events are
21 considered, the regional population dose risk reduction based on Monticello specific newer
22 information is on the order of a factor of 3.2 when compared to the upper bound estimates
23 utilized in the 1996 LR GEIS. When these factors are applied, the net change in risk for
24 Monticello is a reduction by a factor of about 2 ($3.5 \times 3.2 \div 4.7 = 2$). Further, the decrease in
25 environmental impacts is supported by the SOARCA that found latent cancer fatality risk is
26 reduced by a factor of 3 to 100. (NRC 2013-TN4592) Therefore, The NRC staff concludes that
27 new Monticello SLR information is bounded by the predicted Monticello analysis in the 1996
28 LR GEIS.

29 Section 5.3.3 in the 1996 LR GEIS provides a discussion of the uncertainties associated with
30 the analysis in the LR GEIS and in the individual nuclear power plant EISs used to estimate the
31 environmental impacts of severe accidents. The 1996 LR GEIS used 95th percentile upper-
32 confidence bound estimates whenever available for its estimates of the environmental impacts
33 of severe accidents. This approach provides conservatism to cover uncertainties, as described
34 in Section 5.3.3.2.2 of the 1996 LR GEIS. Many of these same uncertainties also apply to the
35 analysis used in the 2013 LR GEIS update. As discussed in Sections E.3.1 through E.3.8 of the
36 2013 LR GEIS, the LR GEIS update used more recent information to supplement the estimate
37 of environmental impacts contained in the 1996 LR GEIS. In effect, the assessments contained
38 in Sections E.3.1 through E.3.8 of the 2013 LR GEIS provided additional information and
39 insights into certain areas of uncertainty associated with the 1996 LR GEIS. However, as
40 provided in the 2013 LR GEIS, the impact and magnitude of uncertainties, as estimated in the
41 1996 LR GEIS, bound the uncertainties introduced by the new information and considerations
42 addressed in the 2013 LR GEIS. Accordingly, in the 2013 LR GEIS, the NRC staff concluded
43 that the reduction in environmental impacts resulting from the use of new information (since the
44 1996 LR GEIS analysis) outweighs any increases in impact resulting from the new information.
45 As a result, the findings in the 1996 LR GEIS remain valid. The NRC staff identified no new and
46 significant information regarding uncertainties during its review of Xcel Energy's ER, the SAMA
47 audit, the scoping process, or the evaluation of other available information. Accordingly, the

1 NRC staff concludes that no new and significant information exists for Monticello concerning
2 uncertainties that would alter the conclusions reached in the 1996 or 2013 LR GEIS.

3 Another consideration for uncertainty is population growth. According to NEI 17-04, Rev. 1,
4 Section 2.1 (NEI 2019-TN6815), population growth is considered new information, but is not
5 necessarily significant for the Stage 1 analysis. For Monticello, detailed population information
6 including population projection information is presented in Section 3.11.1 of the Monticello SLR
7 ER. For the 50 mi (80 km) radius from the plant, the 2020 permanent population was 3,285,866,
8 and the projected 2050 permanent and transient population is 4,387,091. Using an exponential
9 scale, that is a 0.97 percent growth per year or a 21.3 percent growth from the beginning to the
10 end of the 60 to 80 years renewal period. The 2013 LR GEIS indicates that given the range of
11 uncertainty in these types of analyses, a 5 to 30 percent change is not considered significant.
12 The Monticello projected population is within the 30 percent population increase that the 2013
13 LR GEIS has determined not to be significant. The staff concludes that the overall effect of
14 projected increased population around the nuclear power plant during the SLR period of
15 extended operation does not result in significant increases in impacts. Thus, the staff concludes
16 using plant-specific information that no new and significant information exists for Monticello
17 concerning population increases that would alter the conclusions reached in the 1996 or 2013
18 LR GEIS.

19 **F.3.10 Summary and Conclusion (Section E.5 of the 2013 LR GEIS)**

20 The 2013 LR GEIS categorizes “sources of new information” by their potential effect on the
21 best-estimate environmental impacts associated with postulated severe accidents. These
22 effects can (1) decrease the environmental impact associated with severe accidents; (2) not
23 affect the environmental impact associated with severe accidents; or (3) increase the
24 environmental impact associated with severe accidents.

25 No new and significant information regarding Monticello was identified that was above the
26 values previously evaluated in the 1996 LR GEIS. Thus, there was no new and significant
27 information that would significantly increase the environmental impact associated with severe
28 accidents. However, the reduction in risk due to a better understanding of the Monticello source
29 term provided a substantial decrease in the calculated environmental impact (consequences)
30 that was calculated in the 1996 LR GEIS. Given the new and updated information, the reduction
31 in estimated environmental impacts from the use of new internal event and source term
32 information outweighs any increases from the consideration of external events, future power
33 uprates, higher fuel burnup, low power and shutdown risk, and Spent Fuel Pool risk. Thus, the
34 staff concludes that the overall impact of new and significant information regarding Monticello
35 since initial LR continues to be well below the impact previously evaluated in the 1996 GEIS.
36 Therefore, the conclusion in the 1996 LR GEIS and 2013 LR GEIS that “the probability-weighted
37 consequences of atmospheric releases, fallout onto open bodies of water, releases to
38 groundwater, and societal and economic impacts from severe accidents are SMALL” is
39 considered appropriate for the Monticello SLR.

40 Other areas of new information relating to the Monticello severe accident risk, severe accident
41 environmental impact assessment, and cost-beneficial SAMAs are described below. These
42 areas of new information demonstrate additional conservatism in the evaluations in the LR GEIS
43 and Xcel Energy’s ER, because they result in further reductions in the impact of a severe
44 accident.

1 **F.4 Other New Information Related to NRC Efforts to Reduce Severe Accident**
2 **Risk Following Publication of the 1996 LR GEIS**

3 The Commission has considered and adopted various regulatory requirements for mitigating
4 severe accident risks at reactor sites through a variety of NRC regulatory programs. For
5 example, in 1996, when it promulgated Table B-1, “Summary of Findings on NEPA Issues for
6 License Renewal of Nuclear Power Plants,” in Appendix B to Subpart A of 10 CFR Part 51
7 (TN250), “Environmental Effect of Renewing the Operating License of a Nuclear Power Plant,”
8 the Commission explained in a *Federal Register* notice:

9 The Commission has considered containment improvements for all plants
10 pursuant to its Containment Performance Improvement program...and the
11 Commission has additional ongoing regulatory programs whereby licensees
12 search for individual plant vulnerabilities to severe accidents and consider cost-
13 beneficial improvements (Final rule, “Environmental Review for Renewal of
14 Nuclear Power Plant Operating Licenses,” 61 FR 28467-TN4491 [June 5, 1996]).

15 These “additional ongoing regulatory programs” that the Commission mentioned include the
16 Individual Plant Examination (IPE) and the IPEEE program, which consider “potential
17 improvements to reduce the frequency or consequences of severe accidents on a nuclear
18 power plant-specific basis and essentially constitute a broad search for severe accident
19 mitigation alternatives.” Further, in the same rule, the Commission observed that the IPEs
20 “resulted in a number of plant procedural or programmatic improvements and some plant
21 modifications that will further reduce the risk of severe accidents” (61 FR 28481-TN8474)
22 (*Federal Register* notices are accessible and searchable at <https://www.federalregister.gov>).
23 Based on these and other considerations, the Commission stated its belief that it is “unlikely that
24 any site-specific consideration of SAMAs for LR will identify major plant design changes or
25 modifications that will prove to be cost-beneficial for reducing severe accident frequency or
26 consequences.” The Commission noted that it may review and possibly reclassify the issue of
27 severe accident mitigation as a Category 1 issue upon the conclusion of its IPE/IPEEE program
28 but deemed it appropriate to consider SAMAs for nuclear power plants for which it had not done
29 so previously, pending further rulemaking on this issue.

30 The Commission reaffirmed its SAMA-related conclusions in Table B-1 of Appendix B to
31 Subpart A of 10 CFR Part 51 (TN250) and 10 CFR 51.53(c)(3)(ii)(L), “Postconstruction
32 Environmental Reports,” in Exelon Generation Co., LLC (Limerick Generating Station, Units 1
33 and 2), CLI-13-07, (October 31, 2013). In addition, the Commission observed that it had
34 promulgated those regulations because it had “determined that one SAMA analysis would
35 uncover most cost-beneficial measures to mitigate both the risk and the effects of severe
36 accidents, thus satisfying our obligations under NEPA” (NRC 2013-TN2654).

37 The NRC has continued to address severe accident-related issues since the agency published
38 the LR GEIS in 1996. Combined NRC and licensee efforts have reduced risks from accidents
39 beyond those accidents that were considered in the 1996 LR GEIS. The 2013 LR GEIS
40 describes many of those efforts (NRC 2013-TN2654). Each of the regulatory initiatives
41 described in the 2013 GEIS applies to all reactors, including Monticello. These are areas of new
42 information that reinforce the conclusion that the probability-weighted consequences of severe
43 accidents are SMALL for all nuclear power plants, as stated in the 2013 LR GEIS, and further
44 reduce the likelihood of finding a cost-beneficial SAMA that would substantially reduce the
45 severe accident risk at Monticello.

1 **F.4.1 Conclusion**

2 In summary, the new regulatory initiatives to reduce severe accident risk described above
3 contribute to safety, as do safety improvements not related to LR, including the NRC and
4 industry response to generic safety issues (NRC 2011-TN7816). Thus, the performance and
5 safety record of nuclear power plants operating in the United States, including Monticello,
6 support the conclusion that the probability-weighted consequences of severe accidents in the
7 SLR period are SMALL (NRC 2013-TN2654).

8 **F.5 Evaluation of New and Significant Information Pertaining to SAMAs Using**
9 **NEI 17-04, “Model SLR New and Significant Assessment Approach for**
10 **SAMA”**

11 In its evaluation of the significance of new information, the NRC staff considers that new
12 information is significant if it provides a seriously different picture of the impacts of the Federal
13 action under consideration. Thus, for mitigation alternatives such as SAMAs, new information is
14 significant if it indicates that a mitigation alternative would substantially reduce an impact of the
15 Federal action on the environment. Consequently, with respect to SAMAs, new information may
16 be significant if it indicates a given potentially cost-beneficial SAMA would substantially reduce
17 the impacts of a severe accident or the probability or risk of a severe accident occurring
18 (NRC 2013-TN2654).

19 Xcel Energy stated in its ER, that it used the methodology in NEI 17-04 Revision 1, “Model SLR
20 New and Significant Assessment Approach for SAMA,” (NEI 2019-TN6815) to evaluate new and
21 significant information as it relates to the Monticello SLR SAMAs. By letter dated
22 December 11, 2019, the staff reviewed NEI 17-04 and found it acceptable for interim use,
23 pending formal NRC endorsement of NEI 17-04 by incorporation in RG 4.2, Supplement 1,
24 “Preparation of Environmental Reports for Nuclear Power Plant License Renewal Applications”
25 (NRC 2019-TN7805). In general, as discussed earlier, the NEI 17-04 methodology (NEI 2017-
26 TN8338) does not consider a potential SAMA to be significant unless it reduces by at least
27 50 percent the maximum benefit as defined in Section 4.5, “Total Cost of Severe Accident
28 Risk/Maximum Benefit,” of NEI 05-01, Revision A, “Severe Accident Mitigation Alternatives
29 (SAMA) Analysis Guidance Document.” NEI 05-01 is endorsed in NRC RG 4.2, Supplement 1
30 (NRC 2013-TN2654).

31 NEI 17-04 describes a three-stage process for determining whether there is any new and
32 significant information relevant to a previous SAMA analysis.

- 33 • **Stage 1:** The SLR applicant uses PRA risk insights and/or risk model quantifications to
34 estimate the percent reduction in the maximum benefit associated with: (1) all
35 unimplemented “Phase 2” SAMAs for the analyzed nuclear power plant; and (2) those
36 SAMAs identified as potentially cost-beneficial for other nuclear power plants in the United
37 States and those applicable to the analyzed nuclear power plant. If one or more of those
38 SAMAs are shown to reduce the maximum benefit by 50 percent or more, then the applicant
39 must complete Stage 2. (Applicants that demonstrate that there is no potentially significant
40 new information through the Stage 1 screening process are not required to perform the
41 Stage 2 or Stage 3 assessments.)

- 1 • **Stage 2:** The SLR applicant develops updated averted cost-risk estimates for implementing
2 those SAMAs. If the Stage 2 assessment confirms that one or more SAMAs reduce the
3 maximum benefit by 50 percent or more, then the applicant must complete Stage 3.
- 4 • **Stage 3:** The SLR applicant performs a cost-benefit analysis for the “potentially significant”
5 SAMAs identified in Stage 2.

6 Upon completion of the Stage 1 screening process, Xcel Energy determined that there is no
7 potentially significant new information affecting its Monticello SAMA analysis; thus, Xcel Energy
8 did not perform the Stage 2 or Stage 3 assessments. The following sections summarize Xcel
9 Energy’s application of the NEI 17-04 methodology to Monticello SAMAs.

10 **F.5.1 Data Collection**

11 NEI 17-04 Section 3.1, “Data Collection,” explains that the initial step of the assessment process
12 is to identify the “new information” relevant to the SAMA analysis and to collect and develop
13 those elements of information that will be used to support the assessment. The guidance
14 document states that each applicant should collect, develop, and document the information
15 elements corresponding to the stage or stages of the SAMA analysis performed for the site. For
16 Monticello SLR, the NRC staff reviewed the onsite information during an audit at NRC
17 headquarters and determined that Xcel Energy had considered the appropriate information
18 (NRC 2023-TN9723).

19 **F.5.2 Stage 1 Assessment**

20 Section E4.15.3, “Methodology for Evaluation of New and Significant SAMAs,” of Xcel Energy’s
21 SLR ER describes the process it used to identify any potentially new and significant SAMAs
22 from the Monticello SAMA analysis (Xcel 2023-TN9084). In Stage 1 of the process, Xcel Energy
23 used PRA risk insights and/or risk model quantifications to estimate the percent reduction in the
24 maximum benefit associated with the following two types of SAMAs:

- 25 4. all unimplemented “Phase 2” SAMAs for Monticello
- 26 5. those SAMAs identified as potentially cost-beneficial for other U.S. nuclear power plants and
27 that are applicable to Monticello (Xcel 2023-TN9084)

28 **F.5.3 Xcel Energy’s Evaluation of Unimplemented Monticello “Phase 2” SAMAs**

29 As part of the SLR ER, Xcel Energy examined its initial LR SAMA analysis and the Monticello
30 PRA again, for insights. The purpose was to determine if there is any new and significant
31 information regarding the SAMA analyses that were performed to support issuance of the initial
32 renewed operating licenses for Monticello. Xcel Energy reevaluated the 16 SAMAs that were
33 considered “Phase 2” in connection with initial LR, using the NEI 17--04 process. The
34 conclusion of the Monticello analysis was that six of the proposed SAMAs were cost-beneficial
35 and were implemented at Monticello, and 10 SAMAs were not cost-beneficial at that time but
36 remain for further evaluation in the SLR.

37 If any of the SAMAs were found to reduce the total CDF, or at least one consequential source
38 term category frequency by at least 50 percent, then the SAMA was retained for a Stage 2
39 assessment (Level 3 PRA evaluation of the reduction in maximum benefit). As discussed below,
40 all SAMAs were screened and found to be not significant without the need to go to the Stage 2
41 assessment or PRA Level 3 evaluation.

1 The list of SAMAs collected was evaluated qualitatively to screen any that are not applicable to
2 Monticello or that already exist at Monticello. The remaining SAMAs were then grouped (if
3 similar) based on similarities in mitigation equipment or risk reduction benefits, and all were
4 evaluated for the impact they have on the Monticello CDF and source term category frequencies
5 if implemented.

6 **F.5.4 Xcel Energy’s Evaluation of SAMAs Identified as Potentially Cost-Beneficial at** 7 **Other U.S. Nuclear Power Plants and Which Are Applicable to Monticello**

8 The 2013 LR GEIS considered the nuclear power plant-specific supplemental EISs that
9 document potential environmental impacts and mitigation measures for severe accidents
10 relevant to LR for each nuclear power plant. Some of these nuclear power plant-specific
11 supplements had identified potentially cost-beneficial SAMAs. Xcel Energy reviewed the SEISs
12 of nuclear power plants with a similar design to Monticello. A total of 129 industry SAMAs were
13 collected from the 1996 LR GEIS supplements for each BWR site, of which all but 49 were
14 qualitatively screened using the criteria discussed in Section 4.15.3.1 of the Monticello SLR ER.
15 In addition, 10 Monticello specific SAMAs were collected for evaluation in the SLR, of which one
16 was screened. Table 4.15-1 of the Monticello SLR ER presents the 58 SAMAs that were not
17 qualitatively screened. A total of 21 SAMA groups were identified for quantitative screening
18 evaluation. The current Monticello PRA models (internal events plus flooding and fire PRA
19 models) were used in the quantitative evaluation of maximum benefit to determine the level of
20 significance of new information.

21 Table 4.15-2 of the Monticello SLR ER presents the quantitative screening results from the
22 bounding SAMA evaluations. As seen in Table 4.15-2, none of the bounding quantitative
23 screening evaluations result in a reduction of total CDF, total LERF, or total Large Late Release
24 Frequency (LLRF) greater than 50 percent. The staff noted that in some cases, some measures
25 (e.g., internal flooding LERF) yield an individual reduction greater than 50 percent, but when
26 combined with the other hazards, no SAMA results in a collective CDF or significant source term
27 category group frequency (LERF) reduction of greater than 50 percent. None of the SAMAs
28 considered for quantitative evaluation would reduce the Monticello maximum benefit by
29 50 percent or greater.

30 The NRC staff reviewed Monticello’s onsite information and its SAMA Stage 1 process during an
31 in-office audit at NRC headquarters (NRC 2023-TN9794). The staff found that Xcel Energy had
32 used a methodical and reasonable approach to identify any SAMAs that might reduce the
33 maximum benefit by at least 50 percent and therefore could be considered potentially
34 significant. Therefore, the NRC staff finds that Xcel Energy’s conclusion is in accordance with
35 the NEI 17-04 guidance, and that it did not need to conduct a Stage 2 assessment. Thus, the
36 NRC staff finds that there is no new and significant information that would alter the conclusions
37 of the Monticello SAMA analysis during the SLR period.

38 **F.5.5 Other New Information**

39 As discussed in Xcel Energy’s SLR application ER and in NEI 17-04, there are some inputs to
40 the SAMA analysis that are expected to change, or to potentially change, for all nuclear power
41 plants. Examples of these inputs include the following:

- 42 • updated Level 3 PRA model consequence results, which may be impacted by multiple
43 inputs, including, but not limited to, the following:
 - 44 – population, as projected within a 50 mi (80 km) radius of the nuclear power plant

- 1 – value of farm and nonfarm wealth
- 2 – core inventory (e.g., due to power uprate)
- 3 – evacuation timing and speed
- 4 – Level 3 PRA methodology updates
- 5 – cost-benefit methodology updates

6 In addition, other changes that could be considered new information may be dependent on
7 nuclear power plant activities or site-specific changes. These types of changes (listed in
8 NEI 17-04) include the following:

- 9 • identification of a new hazard (e.g., a fault that was not previously analyzed in the seismic
10 analysis)
- 11 • updated nuclear power plant risk model (e.g., a fire PRA that replaces the IPEEE analysis)
- 12 • impacts of nuclear power plant changes that are included in the nuclear power plant risk
13 models will be reflected in the model results and do not need to be assessed separately
- 14 • nonmodeled modifications to the nuclear power plant
- 15 • modifications determined to have no risk impact need not be included (e.g., replacement of
16 the condenser vacuum pumps), unless they impact a specific input to SAMA (e.g., new
17 low-pressure turbine in the power conversion system that results in a greater net electrical
18 output)

19 **F.5.6 Conclusion**

20 The NRC staff reviewed Xcel Energy's new and significant information analysis for severe
21 accidents and SAMAs at Monticello during the SLR period and finds Xcel Energy's analysis and
22 methods to be reasonable. As described above, Xcel Energy evaluated a total of 139 SAMAs
23 for Monticello SLR and did not find any SAMAs that would reduce the maximum benefit by
24 50 percent or more. The NRC staff reviewed Xcel Energy's evaluation and concludes that
25 Xcel Energy's methods and results were reasonable. Based on Monticello's Stage 1 qualitative
26 and quantitative screening results, Xcel Energy demonstrated that none of the nuclear power
27 plant-specific and industry SAMAs that it had considered constitute new and significant
28 information that could change the conclusion of Monticello's previous SAMA analysis. Further,
29 the NRC staff did not otherwise identify any new and significant information that would alter the
30 conclusions reached in the previous SAMA analysis for Monticello. Therefore, the NRC staff
31 concludes that there is no new and significant information that would alter the conclusions of the
32 SAMA analysis performed for Monticello's initial LR.

33 In addition, given the low residual risk at Monticello, the decrease in internal event CDF at
34 Monticello from the previous SAMA analysis, and the fact that no potentially cost-beneficial
35 SAMAs were identified during Monticello's initial LR review, the staff considers it unlikely that
36 Xcel Energy would have found any potentially cost-beneficial SAMAs for SLR. Further, the
37 robust NRC regulatory actions, as well as the conservative assumptions used in earlier severe
38 accident studies and SAMA analyses, also make it unlikely that Xcel Energy would have found
39 any potentially significant cost-beneficial SAMAs during its SLR review. For all the reasons
40 stated above, the NRC staff concludes that Xcel Energy reached reasonable SAMA conclusions
41 in its SLR ER and that there is no new and significant information regarding any potentially
42 cost-beneficial SAMA that would substantially reduce the risks of a severe accident at
43 Monticello.

1 **F.6** References

- 2 Note: All NUREG reports listed in Appendix F are available electronically from the NRC's public
3 website found at <https://www.nrc.gov/reading-rm/doc-collections/nuregs/index.html>. From this
4 site, the public can gain access to NRC's collection of technical reports by using the technical
5 report numbers (e.g., NUREG-xxxx or NUREG/CR-xxxx).
- 6 10 CFR Part 50. *Code of Federal Regulations*, Title 10, *Energy*, Part 50, "Domestic Licensing of
7 Production and Utilization Facilities." TN249.
- 8 10 CFR Part 51. *Code of Federal Regulations*, Title 10, *Energy*, Part 51, "Environmental
9 Protection Regulations for Domestic Licensing and Related Regulatory Functions." TN250.
- 10 10 CFR Part 54. *Code of Federal Regulations*, Title 10, *Energy*, Part 54, "Requirements for
11 Renewal of Operating Licenses for Nuclear Power Plants." TN4878.
- 12 10 CFR Part 100. *Code of Federal Regulations*, Title 10, *Energy*, Part 100, "Reactor Site
13 Criteria." TN282.
- 14 61 FR 28467. June 5, 1996. "Environmental Review for Renewal of Nuclear Power Plant
15 Operating Licenses." *Federal Register*, Nuclear Regulatory Commission. TN4491.
- 16 61 FR 28481. December 18, 1996. "Environmental Review for Renewal of Nuclear Power Plant
17 Operating Licenses." *Federal Register*, Nuclear Regulatory Commission. TN8474.
- 18 72 FR 71083. December 14, 2007. "Sally Shaw; Denial of Petition for Rulemaking." *Federal*
19 *Register*, Nuclear Regulatory Commission, Washington, D.C. TN7789.
- 20 BNL (Brookhaven National Laboratory). 1995. *Evaluation of Potential Severe Accidents During*
21 *Low Power and Shutdown Operations at Surry, Unit 1, Analysis of Core Damage Frequency*
22 *from Internal Fires During Mid-Loop Operations, Main Report*. NUREG/CR-6144, BNL-NUREG-
23 52399, Volume 3, Part 1. Upton, New York. ADAMS Accession No. ML18151A227. TN7776.
- 24 NEI (Nuclear Energy Institute). 2005. *Severe Accident Mitigation Alternatives (SAMA) Analysis*
25 *Guidance Document*. NEI-05-01, Revision A, Washington, D.C. ADAMS Accession No.
26 ML060530203. TN1978.
- 27 NEI (Nuclear Energy Institute). 2017. *Model SLR New and Significant Assessment Approach for*
28 *SAMA*. NEI 17-04, Rev 0, Washington, D.C. ADAMS Accession No. ML17181A470. TN8338.
- 29 NEI (Nuclear Energy Institute). 2019. Letter from C. Earls, Senior Director Regulatory Affairs, to
30 R. Elliott, Division of Rulemaking, Environmental, and Financial Support Office of Nuclear
31 Material, Safety, and Safeguards, dated November 12, 2019, regarding "NRC Review and
32 Endorsement of NEI 17-04, Model SLR New and Significant Assessment Approach for SAMA,
33 Revision 1." Washington, D.C. ADAMS Accession No. ML19316C713. TN6815.
- 34 NMC (Nuclear Management Company). 2005. Letter from T.J. Palmisano, Site Vice President
35 Monticello Nuclear Generating Plant, to NRC Document Control Desk, dated March 16, 2005,
36 regarding "Monticello Nuclear Generating Plant Docket 50-263 License No. DPR-22 Application
37 for Renewed Operating License." L-MT-05-014, Hudson, Wisconsin. ADAMs Accession No.
38 ML050880237. TN9345.

1 NRC (U.S. Nuclear Regulatory Commission). 1990. *Severe Accident Risks: An Assessment for*
2 *Five U.S. Nuclear Power Plants*. NUREG-1150, Washington, D.C. ADAMS Accession No.
3 ML040140729. TN525.

4 NRC (U.S. Nuclear Regulatory Commission). 1995. Memorandum from M.A. Cunningham,
5 Chief Probabilistic Risk Analysis Branch, to J.C. McKnight, Document Control Branch, Division
6 of Information Support Services, dated November 22, 1993, regarding "Placement of Research
7 Reports in the Public Document Room." Washington, D.C. ADAMS Accession No.
8 ML20058E812. TN8976.

9 NRC (U.S. Nuclear Regulatory Commission). 1996. *Generic Environmental Impact Statement*
10 *for License Renewal of Nuclear Plants*. Volumes 1 and 2, NUREG-1437, Washington, D.C.
11 ADAMS Accession Nos. ML040690705, ML040690738. TN288.

12 NRC (U.S. Nuclear Regulatory Commission). 1997. *Individual Plant Examination Program:*
13 *Perspectives on Reactor Safety and Plater Performance*. Volume 1, Part 1 Final Summary
14 Report and Volume 2, Parts 2-5, Final Report, NUREG-1560, Washington D.C. TN7812.

15 NRC (U.S. Nuclear Regulatory Commission). 1997. Memorandum from L.J. Callan to The
16 Commissioners, dated July 30, 1997, regarding "Issuance for Public Comment of Proposed
17 Rulemaking Package for Shutdown and Fuel Storage Pool Operation." SECY-97-168,
18 Washington, D.C. TN7621.

19 NRC (U.S. Nuclear Regulatory Commission). 2001. *Technical Study of Spent Fuel Pool*
20 *Accident Risk at Decommissioning Nuclear Power Plants*. NUREG-1738, Washington, D.C.
21 ADAMS Accession No. ML010430066. TN5235.

22 NRC (U.S. Nuclear Regulatory Commission). 2005. *Policy Issue: Staff Review of the National*
23 *Academies Study of the Health Risks from Exposure to Low Levels of Ionizing Radiation (BEIR*
24 *VII)*. SECY-05-0202, Washington, D.C. ADAMS Accession No. ML052640532. TN4513.

25 NRC (U.S. Nuclear Regulatory Commission). 2006. *Generic Environmental Impact Statement*
26 *for License Renewal of Nuclear Plants, Supplement 26: Regarding Monticello Nuclear*
27 *Generating Plant, Final Report*. NUREG-1437, Supplement 26, Washington, D.C. ADAMS
28 Accession No. ML062490078. TN7315.

29 NRC (U.S. Nuclear Regulatory Commission). 2006. Letter from P. Tam, Senior Project
30 Manager, to J. Conway, Site Vice President Monticello Nuclear Generating Plant, dated
31 December 7, 2006, regarding "Monticello Nuclear Generating Plant - Issuance of Amendment
32 Re: Full-Scope Implementation of the Alternative Source Term Methodology (TAC No.
33 MC8971)." Washington, D.C. ADAMS Accession No. ML062850049. TN9797.

34 NRC (U.S. Nuclear Regulatory Commission). 2011. "Resolution of Generic Safety Issues
35 (Formerly entitled "A Prioritization of Generic Safety Issues") (NUREG-0933, Main Report with
36 Supplements 1-35)." Washington, D.C. Accessed June 15, 2022, at
37 <https://www.nrc.gov/sr0933/index.html>. TN7816.

38 NRC (U.S. Nuclear Regulatory Commission). 2012. *State-of-the-Art Reactor Consequence*
39 *Analyses (SOARCA) Report*. NUREG-1935, Washington, D.C. ADAMS Accession No.
40 ML12332A057. TN3092.

1 NRC (U.S. Nuclear Regulatory Commission). 2013. *Generic Environmental Impact Statement*
2 *for License Renewal of Nuclear Plants*. NUREG-1437, Revision 1, Washington, D.C. ADAMS
3 Package Accession No. ML13107A023. TN2654.

4 NRC (U.S. Nuclear Regulatory Commission). 2013. Letter from T. Beltz, Senior Project
5 Manager, to K. Fili, Site Vice President Monticello Nuclear Generating Plant, dated December 9,
6 2013, regarding “Monticello Nuclear Generating Plant -Issuance of Amendment No. 176 to
7 Renewed Facility Operating License Regarding Extended Power Uprate (TAC NO. MD9990).”
8 Washington, D.C. ADAMS Accession No. ML13316C459. TN9799.

9 NRC (U.S. Nuclear Regulatory Commission). 2013. *Preparation of Environmental Reports for*
10 *Nuclear Power Plant License Renewal Applications*. Regulatory Guide 4.2, Supplement 1,
11 Revision 1, Washington, D.C. ADAMS Accession No. ML13067A354. TN4791.

12 NRC (U.S. Nuclear Regulatory Commission). 2013. *State-of-the-Art Reactor Consequence*
13 *Analyses Project Volume 1: Peach Bottom Integrated Analysis*. NUREG/CR-7110, Volume 1,
14 Revision 1, Washington, D.C. ADAMS Accession No. ML13150A053. TN4592.

15 NRC (U.S. Nuclear Regulatory Commission). 2014. “Consideration of Current Operating Issues
16 and Licensing Actions in License Renewal.” NRC Regulatory Issue Summary (RIS) 2014-06,
17 Washington, D.C. ADAMS Accession No. ML13177A325. TN7851.

18 NRC (U.S. Nuclear Regulatory Commission). 2023. Letter from M. Shams, Chief Beyond-
19 Design-Basis Management Branch, to C. Church, Site Vice President Northern States Power
20 Company- Minnesota, dated December 10, 2017, regarding “Monticello Nuclear Generating
21 Plant- Safety Evaluation Regarding Implementation of Mitigating Strategies and Reliable Spent
22 Fuel Pool Instrumentation Related to Orders EA-12-049 and EA-12-051 (CAC Nos. MF0923
23 and MF0924; EPID Nos.L-2013-JLD-0015 and L-2013-JLD-0016).” Washington, D.C. ADAMS
24 Accession No. ML17319A591. TN9795.

25 NRC (U.S. Nuclear Regulatory Commission). 2019. Letter from A. Bradford to C. Earls, Nuclear
26 Energy Institute, dated December 11, 2019, regarding “Interim endorsement of NEI 17-04,
27 Model SLR [subsequent or second license renewal] new and significant assessment approach
28 for SAMA, Revision 1.” Washington, D.C. ADAMS Accession No. ML19323E740. TN7805.

29 NRC (U.S. Nuclear Regulatory Commission). 2020. Letter from R. Bernardo, Project
30 Management Office of Nuclear Reactor Regulation, to T. Conboy, Site Vice President Northern
31 States Power Company, dated November 25, 2020, regarding “Monticello Nuclear Generating
32 Plant – Documentation of the Completion of Required Actions Taken in Response to the
33 Lessons Learned from the Fukushima Dai-Ichi Accident.” Washington, D.C. ADAMS Accession
34 No. ML20324A631. TN9695.

35 NRC (U.S. Nuclear Regulatory Commission). 2020. *Nuclear Regulatory Commission Issuances.*
36 *Opinions and Decisions of the Nuclear Regulatory Commission with Selected Orders January 1,*
37 *2020 - June 30, 2020*. NUREG-0750. Volume 91. ADAMS Accession No. ML21168A338.
38 TN9570

39 NRC (U.S. Nuclear Regulatory Commission). 2022. “Memorandum and Order in the Matter of
40 Florida Power & Light Co. (Turkey Point Nuclear Generating Units 3 and 4).” CLI-22-02,
41 Rockville, Maryland. ADAMS Accession No. ML22055A496. TN8182.

1 NRC (U.S. Nuclear Regulatory Commission). 2022. "Memorandum and Order in the Matter of
2 Duke Energy Carolinas, LLC (Oconee Nuclear Station, Units 1, 2, and 3); Exelon Generating
3 Company, LLC (Peach Bottom Atomic Power Station, Units 2 and 3); Florida Power & Light Co.
4 (Turkey Point Nuclear Generating Units 3 and 4); Nextera Energy Point Beach, LLC (Point
5 Beach Nuclear Plant, Units 1 and 2); Virginia Electric and Power Company (North Anna Power
6 Station, Units 1 and 2)." CLI-22-03, Rockville, Maryland. ADAMS Accession Nos.
7 ML22055A521. TN9844.

8 NRC (U.S. Nuclear Regulatory Commission). 2022. *Sources of Information Used in Appendix E,*
9 *License Renewal Generic Environmental Impact Statement.* NUREG-1437, Revision 2,
10 Washington, D.C. June. ADAMS Accession No. ML22201A061. TN7857.

11 NRC (U.S. Nuclear Regulatory Commission). 2023. From P.K. Holahan, Director Subsequent
12 License Renewal Directorate Office of Nuclear Materials Safety and Safeguards, to Y. Malave,
13 T Holahan, B. Rogers, L. Gibson, S. Talley, B. Anderson, B. Venkataraman, J. Davis, K. Folk,
14 and J. Rikhoff, dated March 6, 2023, regarding "Issuance of Proposed Rule and Notice of
15 Availability of the Draft Generic Environmental Impact Statement for License Renewal of
16 Nuclear Plants (NUREG-1437, Draft Revision 2) (STC-23-012)." Washington, D.C. ADAMS
17 Accession No. ML23065A249. TN9172.

18 NRC (U.S. Nuclear Regulatory Commission). 2023. Letter from J. Umana, Environmental
19 Project Manager, to C. Domingos, Site Vice President Northern States Power Company-
20 Minnesota, dated August 9, 2023, regarding "Monticello Nuclear Generating Plant, Unit 1 –
21 License Renewal Regulatory Audit Regarding the Environmental Review of the Subsequent
22 License Renewal Application (Epid Number: L-2023-Sle-0000) (Document Number: 50-263)."
23 Washington, D.C. ADAMS Accession No. ML23215A131. TN9794.

24 NRC (U.S. Nuclear Regulatory Commission). 2023. Letter from T. Smith, Chief Environmental
25 Review License Renewal Branch, to C. Domingos, Site Vice President Northern States Power
26 Company- Minnesota, dated June 2, 2023, regarding "Monticello Nuclear Generating Plant, Unit
27 1 - Notice of Intent to Conduct Scoping Process and Prepare an Environmental Impact
28 Statement (Epid Number: L-2023-Sle-0000)." Washington, D.C. ADAMS Accession No.
29 ML23047A041. TN9723.

30 SNL (Sandia National Laboratories). 1995. *Evaluation of Potential Severe Accidents During Low*
31 *Power and Shutdown Operations at Grand Gulf, Unit 1, Summary of Results.* NUREG/CR–
32 6143, SAND93-2440, Volume 1, Albuquerque, New Mexico. ADAMS Accession No.
33 ML20087K369. TN7783.

34 SNL (Sandia National Laboratories). 2021. *MACCS Theory Manual.* SAND2021-11535,
35 Albuquerque, New Mexico. ADAMS Accession No. ML22118B153. TN7810.

36 Xcel (Xcel Energy). 2008. Letter from T. O'Connor, Site Vice President Monticello Nuclear
37 Generating Plant, to NRC Document Control Desk, dated November 5, 2008, regarding
38 "Monticello Nuclear Generating Plant, Docket 50-263, Renewed Facility Operating License,
39 License No. DPR-22 License, Amendment Request: Extended Power Uprate (TAC MD9990)."
40 Monticello, Minnesota. ADAMS Accession No. ML083230113. TN9821.

41 Xcel (Xcel Energy). 2021. Letter from T.A. Conboy, Site Vice President, Monticello Nuclear
42 Generating Plant, to NRC Document Control Desk, dated February 11, 2021, regarding

- 1 "Submittal of Revision 38 to the Updated Safety Analysis Report." Monticello, Minnesota.
2 ADAMS Accession No. ML21070A105. TN9633.
- 3 Xcel (Xcel Energy). 2023. Letter from C.P. Domingos, Site Vice President, Monticello and
4 Prairie Island Nuclear Generating Plant Northern States Power Company, to NRC Document
5 Control Desk, dated January 9, 2023, regarding "Monticello Nuclear Generating Plant Docket
6 No. 50-263, Renewal License Numbers DPR-22 Application for Subsequent Renewal Operating
7 License." Monticello, Minnesota. ADAMS Accession No. ML23009A352. TN9084.

1 **APPENDIX G**

2
3 **ENVIRONMENTAL ISSUES AND IMPACT FINDINGS CONTAINED IN**
4 **THE PROPOSED RULE, 10 CFR PART 51, “ENVIRONMENTAL**
5 **PROTECTION REGULATIONS FOR DOMESTIC LICENSING AND**
6 **RELATED REGULATORY FUNCTIONS”**

7 The U.S. Nuclear Regulatory Commission (NRC, the Commission) staff prepared this site-
8 specific environmental impact statement (EIS) to evaluate the environmental impacts of
9 subsequent license renewal (SLR) for the Monticello Nuclear Generating Plant Unit 1
10 (Monticello) by Xcel Energy. The NRC staff prepared the site-specific EIS in accordance with
11 the Commission’s decisions in Commission Legal Issuance (CLI) CLI-22-03 (TN9844) and
12 CLI-22-02 (TN8182), both dated February 24, 2022. In those decisions, the Commission noted
13 that it was directing the NRC staff to initiate rulemaking to revise the License Renewal Generic
14 Environmental Impact Statement (LR GEIS) and the regulations in 10 CFR Part 51 (TN250) to
15 address the environmental impacts of SLR. The Commission afforded SLR applicants an
16 opportunity to await the issuance of a revised LR GEIS or to seek SLR based upon a site-
17 specific evaluation of the environmental impacts of SLR for their plants.

18 In its SLR application, Xcel Energy submitted an environmental report that provides site-specific
19 information concerning the environmental impacts of SLR for Monticello. Accordingly, in this
20 draft EIS, the NRC staff presents a site-specific evaluation of the environmental impacts of SLR
21 for Monticello. This draft EIS evaluates, on a site-specific basis, each of the environmental
22 issues that were dispositioned as Category 1 issues (i.e., generic to all or a distinct subset of
23 nuclear power plants) in the 2013 LR GEIS that are applicable to Monticello, as well as an
24 evaluation of all the site-specific (Category 2) issues that are applicable to Monticello.

25 On March 3, 2023, the NRC published a proposed rule (88 FR 13329-TN8601) proposing to
26 amend its environmental protection regulations in Title 10 of the *Code of Federal Regulations*
27 (10 CFR) Part 51 (TN250). Specifically, the proposed rule would update the NRC’s 2013
28 findings concerning the environmental impacts of renewing the operating license of a nuclear
29 power plant. The technical basis for the proposed rule would be provided by Revision 2 to
30 NUREG-1437, “Generic Environmental Impact Statement for License Renewal of Nuclear
31 Plants” (the draft 2023 LR GEIS; NRC 2023-TN7802), which would update NUREG-1437,
32 Revision 1 (the 2013 LR GEIS NRC 2013-TN2654); the 2013 LR GEIS, in turn, was an update
33 of NUREG-1437, Revision 0 (the 1996 LR GEIS; NRC 1996-TN288). The 2023 final LR GEIS
34 (NRC 2023-TN7802) supports the proposed revised list of issues under the National
35 Environmental Policy Act of 1969, as amended, and the associated environmental impact
36 findings listed in Table B-1 of Appendix B to Subpart A of 10 CFR Part 51 (TN250). The 2023
37 LR GEIS and proposed rule (NRC 2023-TN7802) reflect the lessons learned and knowledge
38 gained from the NRC staff’s conduct of environmental reviews for initial license reviewal (LR)
39 and SLR since 2013.

40 The 2023 proposed rule would redefine the number and scope of the environmental issues that
41 must be addressed by the NRC during LR and SLR environmental reviews. The proposed rule
42 identifies 80 environmental impact issues, 20 of which would require plant-specific analyses.
43 The proposed rule would reclassify some previously site-specific (Category 2) issues as generic
44 (Category 1) issues and would consolidate other issues. It would also add new Category 1 and

1 Category 2 issues to Table B-1 of Appendix B to Subpart A of 10 CFR Part 51 (TN250). These
2 proposed changes are summarized as follows.

- 3 • One Category 2 issue, “Groundwater quality degradation (cooling ponds at inland sites),”
4 and a related Category 1 issue, “Groundwater quality degradation (cooling ponds in salt
5 marshes),” would be consolidated into a single Category 2 issue, “Groundwater quality
6 degradation (plants with cooling ponds).”
- 7 • Two related Category 1 issues, “Infrequently reported thermal impacts (all plants)” and
8 “Effects of cooling water discharge on dissolved oxygen, gas supersaturation, and
9 eutrophication,” and the thermal effluent component of the Category 1 issue, “Losses from
10 predation, parasitism, and disease among organisms exposed to sublethal stresses,” would
11 be consolidated into a single Category 1 issue, “Infrequently reported effects of thermal
12 effluents.”
- 13 • One Category 2 issue, “Impingement and entrainment of aquatic organisms (plants with
14 once-through cooling systems or cooling ponds),” and the impingement component of the
15 Category 1 issue, “Losses from predation, parasitism, and disease among organisms
16 exposed to sublethal stresses,” would be consolidated into a single Category 2 issue,
17 “Impingement mortality and entrainment of aquatic organisms (plants with once-through
18 cooling systems or cooling ponds).”
- 19 • One Category 1 issue, “Impingement and entrainment of aquatic organisms (plants with
20 cooling towers),” and the impingement component of the Category 1 issue, “Losses from
21 predation, parasitism, and disease among organisms exposed to sublethal stresses,” would
22 be consolidated into a single Category 1 issue, “Impingement mortality and entrainment of
23 aquatic organisms (plants with cooling towers).”
- 24 • One Category 2 issue, “Threatened, endangered, and protected species and essential fish
25 habitat,” would be divided into three Category 2 issues: (1) “Endangered Species Act:
26 federally listed species and critical habitats under U.S. Fish and Wildlife jurisdiction,”
27 (2) “Endangered Species Act: federally listed species and critical habitats under National
28 Marine Fisheries Service jurisdiction,” and (3) “Magnuson–Stevens Act: essential fish
29 habitat.”
- 30 • Two new Category 2 issues, “National Marine Sanctuaries Act: sanctuary resources” and
31 “Climate change impacts on environmental resources,” would be added.
- 32 • One Category 2 issue, “Severe accidents,” would be changed to a Category 1 issue.
- 33 • One new Category 1 issue, “Greenhouse gas impacts on climate change,” would be added.
- 34 • Several issue titles and findings would be revised to clarify their intended meanings.

35 Finalization and publication of the 2023 draft LR GEIS and the proposed rule (NRC 2023-
36 TN7802) are expected to occur in or about August 2024. Upon being finalized, under the NRC’s
37 environmental protection regulations, the NRC staff would have to consider and analyze in its
38 LR and SLR environmental reviews the potential significant impacts associated with the new
39 Category 2 issues and, to the extent that there is any new and significant information, the
40 potential significant impacts associated with the new Category 1 issues. To account for the
41 proposed rule and 2023 draft LR GEIS, and the possibility of their finalization in 2024, the NRC
42 staff analyzes in this appendix, on a site-specific basis, the new and revised environmental
43 issues as they may apply to the SLR for Monticello. Table G-1 lists the new and revised
44 environmental issues that would apply to Monticello SLR. The sections that follow discuss how

1 the NRC staff addressed each of these new and revised issues in this site-specific EIS and
 2 explain how this EIS covers the issues in the proposed rule and the 2023 draft LR GEIS.

3 **Table G-1 New and Revised 10 CFR Part 51 License Renewal Environmental Issues**

Issue	2023 Draft LR GEIS Section	Category
Infrequently reported effects of thermal effluents	4.6.1.2	1
Impingement mortality and entrainment of aquatic organisms (plants with once-through cooling systems or cooling ponds)	4.6.1.2	2
Endangered Species Act: federally listed species and critical habitats under U.S. Fish and Wildlife jurisdiction	4.6.1.3.1	2
Endangered Species Act: federally listed species and critical habitats under National Marine Fisheries Service jurisdiction	4.6.1.3.2	2
Magnuson–Stevens Act: essential fish habitat	4.6.1.3.3	2
National Marine Sanctuaries Act: sanctuary resources	4.6.1.3.4	2
Severe accidents	4.9.1.2.1	1
Greenhouse gas impacts on climate change	4.12.1	1
Climate change impacts on environmental resources	4.12.3	2

CFR = *Code of Federal Regulations*; LR GEIS = License Renewal Generic Environmental Impact Statement.
 Source: 10 CFR Part 51-TN250; 2023 LR GEIS (NRC 2023-TN7802).

4 **G.1 Infrequently Reported Effects of Thermal Effluents**

5 The proposed rule proposes to combine two Category 1 issues, “Infrequently reported thermal
 6 impacts (all plants)” and “Effects of cooling water discharge on dissolved oxygen, gas
 7 supersaturation, and eutrophication,” and the thermal effluent component of the Category 1
 8 issue, “Losses from predation, parasitism, and disease among organisms exposed to sublethal
 9 stresses,” into one Category 1 issue, “Infrequently reported effects of thermal effluents.” This
 10 issue pertains to the interrelated and infrequently reported effects of thermal effluents, including
 11 cold shock, thermal migration barriers, the accelerated maturation of aquatic insects, and the
 12 proliferated growth of aquatic nuisance species, as well as the effects of thermal effluents on
 13 dissolved oxygen, gas supersaturation, and eutrophication. This issue also considers the
 14 sublethal stresses associated with thermal effluents that can increase the susceptibility of
 15 exposed organisms to predation, parasitism, or disease. These changes do not introduce any
 16 new environmental issues; rather, the proposed rule would reorganize existing issues. The
 17 changes are fully summarized and explained in Section 4.6.1.2 of the 2023 draft LR GEIS and
 18 in the proposed rule (NRC 2023-TN7802).

19 Section 3.7.3 of this EIS analyzes infrequently reported effects of thermal effluents for
 20 Monticello SLR and concludes that the impacts would be SMALL. Thus, the environmental issue
 21 of infrequently reported effects of thermal effluents is addressed in this site-specific EIS.

22 **G.2 Impingement Mortality and Entrainment of Aquatic Organisms (Plants with**
 23 **Once-Through Cooling Systems or Cooling Ponds)**

24 The proposed rule proposes to combine the Category 2 issue, “Impingement and entrainment of
 25 aquatic organisms (plants with once-through cooling systems or cooling ponds),” and the
 26 impingement component of the Category 1 issue, “Losses from predation, parasitism, and
 27 disease among organisms exposed to sublethal stresses,” into one Category 2 issue,

1 “Impingement mortality and entrainment of aquatic organisms (plants with once-through cooling
2 systems or cooling ponds).” This issue pertains to the impingement mortality and entrainment of
3 finfish and shellfish at nuclear power plants with once-through cooling systems and cooling
4 ponds during the LR term (either initial LR or SLR). This includes plants with helper cooling
5 towers that are seasonally operated to reduce the thermal load to the receiving waterbody,
6 reduce entrainment during peak spawning periods, or reduce consumptive water use during
7 periods of low river flow.

8 In the 2023 draft LR GEIS (NRC 2023-TN7802), the NRC renamed this issue to specify
9 impingement mortality, rather than simply impingement. This change is consistent with the U.S.
10 Environmental Protection Agency (EPA) 2014 Clean Water Act Section 316(b) (TN662)
11 regulations and the EPA’s assessment that impingement reduction technology is available and
12 feasible and has been demonstrated to be effective. Additionally, the EPA 2014 Clean Water
13 Act Section 316(b) regulations establish best technology available standards for impingement
14 mortality based on the fact that survival is a more appropriate metric for determining
15 environmental impact rather than simply looking at total impingement. Therefore, the 2023 draft
16 LR GEIS (NRC 2023-TN7802) also consolidates the impingement component of the “Losses
17 from predation, parasitism, and disease among organisms exposed to sublethal stresses” issue
18 for plants with once-through cooling systems or cooling ponds into this issue.

19 Section 3.7.2.1 of this EIS analyzes the impacts of impingement and entrainment for Monticello
20 SLR. The analysis considers the components of the proposed revision to this issue,
21 impingement mortality, and the impingement component of losses from predation, parasitism,
22 and disease among organisms exposed to sublethal stresses. In this section, the NRC staff
23 concludes that impingement and entrainment during the SLR term on the aquatic organisms
24 would be of SMALL significance. Thus, the environmental issue of impingement mortality and
25 entrainment of aquatic organisms (plants with once-through cooling systems or cooling ponds)
26 is addressed in this EIS.

27 **G.3 Endangered Species Act: Federally Listed Species and Critical Habitats** 28 **under U.S. Fish and Wildlife Jurisdiction**

29 The proposed rule proposes to divide the Category 2 issue, “Threatened, endangered, and
30 protected species and essential fish habitat,” into three separate Category 2 issues for clarity
31 and consistency with the separate Federal statues and interagency consultation requirements
32 that the NRC must consider with respect to federally protected ecological resources. When
33 combined, however, the scope of the three issues is the same as the scope of the former
34 “Threatened, endangered, and protected species and essential fish habitat” issue discussed in
35 the 2013 LR GEIS (NRC 2013-TN2654).

36 The first of the three issues, “Endangered Species Act: federally listed species and critical
37 habitats under U.S. Fish and Wildlife jurisdiction,” concerns the potential effects of continued
38 nuclear power plant operation and any refurbishment during the LR term on federally listed
39 species and critical habitats protected under the Endangered Species Act (TN1010) and under
40 the jurisdiction of the U.S. Fish and Wildlife Service.

41 Sections 3.8.1 and 3.8.3 of this EIS address the impacts of Monticello SLR on federally listed
42 species and critical habitats under U.S. Fish and Wildlife Service jurisdiction. The NRC staff
43 determined that Monticello SLR may affect but is not likely to adversely affect the northern long-
44 eared bat, tricolored bat, whooping crane, and monarch butterfly. Appendix C.1 describes the
45 staff’s Endangered Species Act consultation with the U.S. Fish and Wildlife Service. Thus, the

1 environmental issue of “Endangered Species Act: federally listed species and critical habitats
2 under U.S. Fish and Wildlife Service jurisdiction” is addressed in this EIS.

3 **G.4 Endangered Species Act: Federally Listed Species and Critical Habitats**
4 **under National Marine Fisheries Service Jurisdiction**

5 As explained in the previous section, the proposed rule proposes to divide the Category 2 issue,
6 “Threatened, endangered, and protected species and essential fish habitat,” into three separate
7 Category 2 issues. The second of the three issues, “Endangered Species Act: federally listed
8 species and critical habitats under National Marine Fisheries Service jurisdiction,” concerns the
9 potential effects of continued nuclear power plant operation and any refurbishment during the
10 LR term on federally listed species and critical habitats protected under the Endangered
11 Species Act and under the jurisdiction of the National Marine Fisheries Service.

12 Sections 3.8.1 and 3.8.3 of this EIS find that no federally listed species or critical habitats under
13 NMFS jurisdiction occur within the action area. Accordingly, the NRC staff concluded that the
14 proposed action would have no effect on federally listed species or habitats under this agency’s
15 jurisdiction. Therefore, the environmental issue of “Endangered Species Act: federally listed
16 species and critical habitats under National Marine Fisheries Service jurisdiction” is addressed
17 in this EIS.

18 **G.5 Magnuson–Stevens Act: Essential Fish Habitat**

19 As explained above, the proposed rule proposes to divide the Category 2 issue, “Threatened,
20 endangered, and protected species and essential fish habitat,” into three separate Category 2
21 issues. The third of the three issues, “Magnuson–Stevens Act: essential fish habitat,” concerns
22 the potential effects of continued nuclear power plant operation and any refurbishment during
23 the LR term on essential fish habitat protected under the Magnuson–Stevens Act (TN7841).

24 Sections 3.8.2 and 3.8.4.4 of this EIS find that no essential fish habitat occurs within the
25 affected area. Accordingly, the NRC staff concluded that the proposed action would have no
26 effect on essential fish habitat. Therefore, the environmental issue of “Magnuson-Stevens Act:
27 essential fish habitat” is addressed in this EIS.

28 **G.6 National Marine Sanctuaries Act: Sanctuary Resources**

29 The proposed rule proposes to add a new Category 2 issue, “National Marine Sanctuaries Act:
30 sanctuary resources,” to evaluate the potential effects of continued nuclear power plant
31 operation and any refurbishment during the LR term on sanctuary resources protected under
32 the National Marine Sanctuaries Act (16 U.S.C. § 1431 et seq.- TN7197).

33 Under the National Marine Sanctuaries Act, the National Oceanic and Atmospheric
34 Administration’s Office of National Marine Sanctuaries designates and manages the National
35 Marine Sanctuary System. Marine sanctuaries may occur near nuclear power plants located on
36 or near marine waters as well as the Great Lakes.

37 Sections 3.8.3 and 3.8.4.5 of this EIS find that no national marine sanctuaries occur within the
38 affected area. Accordingly, the NRC staff concluded that the proposed action would have no
39 effect on sanctuary resources. Therefore, the environmental issue of “National Marine
40 Sanctuaries Act: sanctuary resources” is addressed in this EIS.

1 **G.7 Severe Accidents**

2 With respect to postulated accidents, the proposed rule proposes to amend Table B-1 in
3 Appendix B to Subpart A of 10 CFR Part 51 (TN250) by reclassifying the Category 2 “Severe
4 accidents” issue as a Category 1 issue. In the 2013 LR GEIS (NRC 2013-TN2654), the issue of
5 severe accidents was classified as a Category 2 issue to the extent that only alternatives to
6 mitigate severe accidents must be considered for all nuclear power plants where the licensee
7 had not previously performed a severe accident mitigation alternative (SAMA) analysis for the
8 plant. In the 2023 draft LR GEIS (NRC 2023-TN7802), this issue is to be resolved generically for
9 the vast majority, if not all, expected LR applicants because the applicants who will likely
10 reference the LR GEIS have previously completed an SAMA analysis.

11 As discussed in Appendix F of this EIS, an analysis of SAMAs was performed for Monticello and
12 evaluated by the NRC staff at the time of initial license renewal (NRC 2006-TN7315). In
13 Section 3.11.6.9 and Appendix F of this EIS, the NRC staff evaluated the significance of any
14 new information related to the plant-specific SAMA analysis. Therefore, the environmental issue
15 of severe accidents is addressed in this site-specific EIS.

16 **G.8 Greenhouse Gas Impacts on Climate Change**

17 With respect to greenhouse gas (GHG) emissions and climate change, the proposed rule
18 proposes to amend Table B-1 in Appendix B to Subpart A of 10 CFR Part 51 (TN250) by adding
19 a new Category 1 issue “Greenhouse gas impacts on climate change.” This new issue has an
20 impact level of SMALL. This new issue considers GHG impacts on climate change from the
21 routine operations of nuclear power plants and construction vehicles and other motorized
22 equipment used during refurbishment activities. GHG emissions from the routine operations of
23 nuclear power plants are typically very minor because such plants, by their very nature, do not
24 normally combust fossil fuels to generate electricity. However, nuclear power plant operations
25 do have some GHG emission sources, including diesel generators, pumps, diesel engines,
26 boilers, refrigeration systems, and electrical transmission and distribution systems, as well as
27 mobile sources (e.g., worker vehicles and delivery vehicles). GHG emissions from construction
28 vehicles and other motorized equipment for refurbishment activities would be intermittent and
29 temporary, restricted to the refurbishment period. GHG emissions from continued operations
30 and refurbishment activities are minor.

31 The issue of GHG impacts on climate change associated with nuclear power plant operations
32 was not identified as either a generic or plant-specific issue in the 1996 LR GEIS (NRC 1996-
33 TN288) or the 2013 LR GEIS (NRC 2013-TN2654). In the 2013 LR GEIS, however, the NRC
34 staff presented the GHG emission factors associated with the nuclear power life cycle.
35 Following the issuance of CLI-09-21 (NRC 2009-TN6406), the NRC staff began to evaluate the
36 effects of GHG emissions in plant-specific environmental reviews for LR and SLR applications.
37 Accordingly, Section 3.14.3 of this EIS evaluates the GHG emissions associated with the
38 operation of Monticello during the SLR term. Table 3-32 of this EIS presents the quantified
39 annual GHG emissions from direct and indirect sources at Monticello for the 2017–2021 time
40 period. Monticello’s direct GHG emissions result from onsite combustion sources, and indirect
41 GHG emissions include those from workforce commuting.

42 Xcel Energy has no plans to conduct major refurbishment during the Monticello SLR term, and
43 therefore, no GHG emissions from refurbishment or increases in GHG emissions from routine
44 operations at Monticello are anticipated. The NRC staff concludes that there would be no
45 impacts on climate change beyond the impacts discussed in the 2023 draft LR GEIS (NRC

1 2023-TN7802) and in Table B-1 in Appendix B to Subpart A of 10 CFR Part 51 of the proposed
2 rule (88 FR 13329-TN8601). Based on this information, the NRC staff concludes that GHG
3 impacts on climate change for Monticello during the SLR term are SMALL. Therefore, the
4 environmental issue of GHG impacts on climate change is addressed in this site-specific EIS.

5 **G.9 Climate Change Impacts on Environmental Resources**

6 With respect to climate change, the proposed rule proposes to amend Table B-1 in Appendix B
7 to Subpart A of 10 CFR Part 51 (TN250) by adding the new Category 2 issue “Climate change
8 impacts on environmental resources.” This new issue considers the additive effects of climate
9 change on environmental resources that may also be directly affected by continued operations
10 and refurbishment during the SLR term. The effects of climate change can vary regionally, and
11 climate change information at the regional and local scales is necessary to assess trends and
12 the impacts on the human environment for a specific location. The impacts of climate change on
13 environmental resources during the LR term are location-specific and cannot be evaluated
14 generically.

15 The issue of climate change impacts was not identified as either a generic or plant-specific
16 issue in the 1996 LR GEIS (NRC 1996-TN288) or the 2013 LR GEIS (NRC 2013-TN2654).
17 However, the 2013 draft LR GEIS described the environmental impacts that could occur on
18 resources areas (air quality, water resources, etc.) that may also be affected by LR. In plant-
19 specific initial LR and SLR environmental reviews prepared since issuance of the 2013
20 LR GEIS, the NRC staff has considered the projected differences in climate changes in the
21 United States and the climate change impacts on the resource areas that could be incrementally
22 affected by the proposed action as part of its cumulative impacts analysis. Accordingly,
23 Section 3.14.3 of this site-specific EIS discusses the observed changes in climate and the
24 potential future climate change across the Midwest region of the United States during the
25 Monticello SLR term based on climate model simulations under future global GHG emission
26 scenarios. The NRC staff considered regional projected climate changes from numerous climate
27 assessment reports and data, including the U.S. Global Change Research Program (USGCRP
28 2009-TN18, USGCRP 2014-TN3472, USGCRP 2017-TN5848, USGCRP 2018-TN5847,
29 USGCRP 2023-TN9762), the Intergovernmental Panel on Climate Change (IPCC 2000-
30 TN7652, IPCC 2007-TN7421, IPCC 2013-TN7434, IPCC 2021-TN7435, IPCC 2023-TN8557),
31 and the Minnesota Climate Mapping and Analysis Tool (ClimAT) (Liess et al. 2023-TN9684).
32 Furthermore, in Section 3.14.3 of this EIS, the NRC staff evaluated the impacts from climate
33 change on environmental resources (e.g., air quality and water resources) where there are
34 incremental affected impacts due to Monticello by the proposed action (SLR). Therefore, this
35 issue, “Climate change impacts on environmental resources,” has been addressed in this EIS.

36 **G.10 References**

37 10 CFR Part 51. *Code of Federal Regulations*, Title 10, *Energy*, Part 51, “Environmental
38 Protection Regulations for Domestic Licensing and Related Regulatory Functions.” TN250.

39 88 FR 13329. March 3, 2023. “Renewing Nuclear Power Plant Operating Licenses-
40 Environmental Review.” *Federal Register*, Nuclear Regulatory Commission. TN8601.

41 Endangered Species Act of 1973. 16 U.S.C. § 1531 *et seq.* TN1010.

42 Federal Water Pollution Control Act of 1972 (commonly referred to as the Clean Water Act). 33
43 U.S.C. § 1251 *et seq.* TN662.

- 1 IPCC (Intergovernmental Panel on Climate Change). 2000. *Summary for Policymakers,*
2 *Emissions Scenarios, A Special Report of IPCC Working Group III.* Intergovernmental Panel on
3 Climate Change, Geneva, Switzerland. Accessed June 11, 2022, at
4 <https://www.ipcc.ch/site/assets/uploads/2018/03/sres-en.pdf>. TN7652.
- 5 IPCC (Intergovernmental Panel on Climate Change). 2007. *Climate Change 2007: The Physical*
6 *Science Basis. Contribution of Working Group I to the Fourth Assessment Report of the*
7 *Intergovernmental Panel on Climate Change.* ADAMS No. ML112710385. Accessed May 23,
8 2022, at https://www.ipcc.ch/site/assets/uploads/2018/05/ar4_wg1_full_report-1.pdf. TN7421.
- 9 IPCC (Intergovernmental Panel on Climate Change). 2013. *Climate Change 2013: The Physical*
10 *Science Basis. Contribution of Working Group I to the Fifth Assessment Report of the*
11 *Intergovernmental Panel on Climate Change.* T.F. Stocker, D. Qin, G.-K. Plattner, M. Tignor,
12 S.K. Allen, J. Boschung, A. Nauels, Y. Xia, V. Bex, and P.M. Midgley, eds. Cambridge
13 University Press, Cambridge, United Kingdom. Accessed May 25, 2022, at
14 <https://www.ipcc.ch/report/ar5/wg1/>. TN7434.
- 15 IPCC (Intergovernmental Panel on Climate Change). 2021. “Climate Change 2021: The
16 Physical Science Basis.” Accessed May 24, 2022, at <https://www.ipcc.ch/report/ar6/wg1/>.
17 TN7435.
- 18 IPCC (Intergovernmental Panel on Climate Change). 2023. *AR6 Synthesis Report: Climate*
19 *Change 2023.* Intergovernmental Panel on Climate Change, Geneva, Switzerland. TN8557.
- 20 Liess, S., H.A. Roop, T.E. Twine, R. Noe, N. Meyer, A. Fernandez, D. Dolma, J. Gorman, S.
21 Clark, J. Mosel, A. Farris, B. Hoppe, and P. Neff. 2023. “Fine-scale Climate Projects over
22 Minnesota for the 21st Century, CliMAT.” St. Paul, Minnesota. Available at
23 <https://climate.umn.edu/MN-CliMAT>. TN9684.
- 24 Magnuson Stevens Fishery Conservation and Management Reauthorization Act of 2006. 16
25 U.S.C. 1801 Note. Public Law 109-479, January 12, 2007, 120 Stat. 3575. TN7841.
- 26 NMSA (National Marine Sanctuaries Act). 2000. “National Marine Sanctuaries Act, Title 16,
27 Chapter 32 § 1431 et seq. United States Code as amended by Public Law 106-513.” Silver
28 Spring, M.D. Available at [https://nmssanctuaries.blob.core.windows.net/sanctuaries-](https://nmssanctuaries.blob.core.windows.net/sanctuaries-prod/media/archive/library/national/nmsa.pdf)
29 [prod/media/archive/library/national/nmsa.pdf](https://nmssanctuaries.blob.core.windows.net/sanctuaries-prod/media/archive/library/national/nmsa.pdf). TN7197.
- 30 NRC (U.S. Nuclear Regulatory Commission). 1996. *Generic Environmental Impact Statement*
31 *for License Renewal of Nuclear Plants.* Volumes 1 and 2, NUREG-1437, Washington, D.C.
32 ADAMS Accession Nos. ML040690705, ML040690738. TN288.
- 33 NRC (U.S. Nuclear Regulatory Commission). 2006. *Generic Environmental Impact Statement*
34 *for License Renewal of Nuclear Plants, Supplement 26: Regarding Monticello Nuclear*
35 *Generating Plant, Final Report.* NUREG-1437, Supplement 26, Washington, D.C. ADAMS
36 Accession No. ML062490078. TN7315.
- 37 NRC (U.S. Nuclear Regulatory Commission). 2009. “Memorandum and Order in the Matter of
38 Duke Energy Carolinas, LLC (Combined License Application for William States Lee III Nuclear
39 Station, Units 1 and 2) and Tennessee Valley Authority (Bellefonte Nuclear Power Plant, Units 3
40 and 4).” CLI-09-21, Rockville, Maryland. ADAMS Accession No. ML093070690. TN6406.

- 1 NRC (U.S. Nuclear Regulatory Commission). 2013. *Generic Environmental Impact Statement*
2 *for License Renewal of Nuclear Plants*. NUREG-1437, Revision 1, Washington, D.C. ADAMS
3 Package Accession No. ML13107A023. TN2654.
- 4 NRC (U.S. Nuclear Regulatory Commission). 2022. “Memorandum and Order in the Matter of
5 Florida Power & Light Co. (Turkey Point Nuclear Generating Units 3 and 4).” CLI-22-02,
6 Rockville, Maryland. ADAMS Accession No. ML22055A496. TN8182.
- 7 NRC (U.S. Nuclear Regulatory Commission). 2022. “Memorandum and Order in the Matter of
8 Duke Energy Carolinas, LLC (Oconee Nuclear Station, Units 1, 2, and 3); Exelon Generating
9 Company, LLC (Peach Bottom Atomic Power Station, Units 2 and 3); Florida Power & Light Co.
10 (Turkey Point Nuclear Generating Units 3 and 4); Nextera Energy Point Beach, LLC (Point
11 Beach Nuclear Plant, Units 1 and 2); Virginia Electric and Power Company (North Anna Power
12 Station, Units 1 and 2).” CLI-22-03, Rockville, Maryland. ADAMS Accession Nos.
13 ML22055A521. TN9844.
- 14 NRC (U.S. Nuclear Regulatory Commission). 2023. *Generic Environmental Impact Statement*
15 *for License Renewal of Nuclear Plants, Draft Report for Comment*. NUREG–1437, Revision 2,
16 Washington, D.C. ADAMS Package Accession No. ML23011A063. TN7802.
- 17 USGCRP (U.S. Global Change Research Program). 2009. *Global Climate Change Impacts in*
18 *the United States*. T.R. Karl, J.M. Melillo, and T.C. Peterson (editors). Cambridge University
19 Press, New York, New York. ADAMS Accession No. ML100580077. TN18.
- 20 USGCRP (U.S. Global Change Research Program). 2014. *Climate Change Impacts in the*
21 *United States: The Third National Climate Assessment*. J.M. Melillo, T.C. Richmond, and G.W.
22 Yohe (eds.). U.S. Government Printing Office, Washington, D.C. ADAMS Accession No.
23 ML14129A233. TN3472.
- 24 USGCRP (U.S. Global Change Research Program). 2017. *Climate Science Special Report:*
25 *Fourth National Climate Assessment*. Volume I. Wuebbles, D.J., D.W. Fahey, K.A. Hibbard, D.J.
26 Dokken, B.C. Stewart, and T.K. Maycock (eds.). Washington, D.C. ADAMS Accession No.
27 ML19008A410. doi: 10.7930/J0J964J6. TN5848.
- 28 USGCRP (U.S. Global Change Research Program). 2018. *Impacts, Risks, and Adaptation in*
29 *the United States: Fourth National Climate Assessment*. Volume II. D.R. Reidmiller, C.W. Avery,
30 D.R. Easterling, K.E. Kunkel, K.L.M. Lewis, T.K. Maycock, and B.C. Stewart (eds.). Washington,
31 D.C. ADAMS Accession No. ML19008A414. doi: 10.7930/NCA4.2018. TN5847.
- 32 USGCRP (U.S. Global Change Research Program). 2023. *The Fifth National Climate*
33 *Assessment*. A.R. Crimmins, C.W. Avery, D.R. Easterling, K.E. Kunkel, B.C. Stewart, and T.K.
34 Maycock, Eds. Washington, D.C. Available at <https://doi.org/10.7930/NCA5.2023>. TN9762.

NRC FORM 335 (12-2010) NRCMD 3.7	U.S. NUCLEAR REGULATORY COMMISSION BIBLIOGRAPHIC DATA SHEET <i>(See instructions on the reverse)</i>	1. REPORT NUMBER (Assigned by NRC, Add Vol., Supp., Rev., and Addendum Numbers, if any.) NUREG-1437 Supplement 26 Second Renewal		
2. TITLE AND SUBTITLE Site-Specific Environmental Impact Statement for License Renewal of Nuclear Plants Supplement 26, Second Renewal Regarding Subsequent License Renewal for Monticello Nuclear Generating Plant, Unit 1 Draft Report for Comment	3. DATE REPORT PUBLISHED			
	<table border="1" style="width: 100%;"> <tr> <td style="width: 50%; text-align: center;">MONTH</td> <td style="width: 50%; text-align: center;">YEAR</td> </tr> <tr> <td style="text-align: center;">April</td> <td style="text-align: center;">2024</td> </tr> </table>	MONTH	YEAR	April
MONTH	YEAR			
April	2024			
5. AUTHOR(S) See Chapter 6, "List of Preparers" of the report	4. FIN OR GRANT NUMBER			
	6. TYPE OF REPORT <p style="text-align: center;">Technical</p> 7. PERIOD COVERED (Inclusive Dates)			
8. PERFORMING ORGANIZATION - NAME AND ADDRESS (If NRC, provide Division, Office or Region, U. S. Nuclear Regulatory Commission, and mailing address; if contractor, provide name and mailing address.) U.S. Nuclear Regulatory Commission (NRC) Office of Nuclear Material Safety and Safeguards Washington, DC 20555-0001				
9. SPONSORING ORGANIZATION - NAME AND ADDRESS (If NRC, type "Same as above", if contractor, provide NRC Division, Office or Region, U. S. Nuclear Regulatory Commission, and mailing address.)				
10. SUPPLEMENTARY NOTES				
11. ABSTRACT (200 words or less) The U.S. Nuclear Regulatory Commission (NRC) prepared this site-specific environmental impact statement (EIS) as part of its environmental review of Xcel Energy's request to renew the operating license for Monticello Nuclear Generating Plant, Unit 1 (Monticello) for an additional 20 years. This EIS includes the site-specific evaluation of the environmental impacts of the proposed action (Monticello subsequent license renewal [SLR]), and alternatives to SLR. As alternatives, the NRC considered: (1) natural gas and renewables; (2) renewables and storage; (3) new nuclear small modular reactors, and (4) the no-action alternative. Based on its evaluation of environmental impacts, the NRC staff's preliminary recommendation is that the adverse environmental impacts of Monticello SLR are not so great that preserving the option of SLR for energy planning decisionmakers would be unreasonable. The NRC staff based its preliminary recommendation of the following (1) Xcel Energy's environmental report, (2) consultation with Federal, State, Tribal, and local governmental agencies, (3) the NRC staff's independent environmental review, (4) the consideration of public comments received during the scoping periods.				
12. KEY WORDS/DESCRIPTORS (List words or phrases that will assist researchers in locating the report.) Monticello; License Renewal; Draft site-specific EIS; DSEIS; National Environmental Policy Act; NEPA; Environmental impact	13. AVAILABILITY STATEMENT <p style="text-align: center;">unlimited</p>			
	14. SECURITY CLASSIFICATION <i>(This Page)</i> <p style="text-align: center;">unclassified</p>			
	<i>(This Report)</i> <p style="text-align: center;">unclassified</p>			
	15. NUMBER OF PAGES			
16. PRICE				



Federal Recycling Program




UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, DC 20555-0001

OFFICIAL BUSINESS



@nrcgov



**NUREG-1437
Supplement 26
Second Renewal, Draft**

**Site-Specific Environmental Impact Statement for License Renewal of Nuclear Plants
Supplement 26, Second Renewal Regarding Subsequent License Renewal for
Monticello Nuclear Generating Plant, Unit 1**

April 2024