

Docket No: 50-461

# CLINTON POWER STATION

## Annual Radiological Environmental Operating Report

1 January Through 31 December 2008

Prepared By  
Teledyne Brown Engineering  
Environmental Services

**Exelon**<sup>™</sup>

**Nuclear**

Clinton Power Station  
Clinton, IL 61727

April 2009

## Table Of Contents

I. Summary and Conclusions .....	1
II. Introduction.....	3
A. Objectives of the REMP .....	3
B. Implementation of the Objectives .....	3
III. Program Description.....	4
A. Sample Collection.....	4
B. Sample Analysis .....	6
C. Data Interpretation.....	6
D. Program Exceptions.....	8
E. Program Changes .....	9
IV. Results and Discussion .....	10
A. Aquatic Environment .....	10
1. Surface Water.....	10
2. Drinking Water .....	11
3. Ground Water .....	12
4. Fish .....	12
5. Sediment.....	12
B. Atmospheric Environment .....	13
1. Airborne .....	13
a. Air Particulates .....	13
b. Airborne Iodine .....	14
2. Terrestrial.....	14
a. Milk .....	14
b. Food Products .....	14
c. Grass .....	15
C. Ambient Gamma Radiation.....	15
D. Land Use Survey.....	16
E. Summary of Results – Inter-laboratory Comparison Program.....	17
V. References.....	19

## Appendices

### Appendix A Radiological Environmental Monitoring Report Summary

#### Tables

Table A-1 Radiological Environmental Monitoring Program Annual Summary for the Clinton Power Station, 2008

### Appendix B Location Designation, Distance & Direction, and Sample Collection & Analytical Methods

#### Tables

Table B-1: Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Clinton Power Station, 2008

Table B-2: Radiological Environmental Monitoring Program - Summary of Sample Collection, Clinton Power Station, 2008

#### Figures

Figure B-1: Environmental Sampling Locations Within One Mile of the Clinton Power Station, 2008

Figure B-2: Environmental Sampling Locations Between One and Two Miles from the Clinton Power Station, 2008

Figure B-3: Environmental Sampling Locations Between Two and Five Miles from the Clinton Power Station, 2008

Figure B-4: Environmental Sampling Locations Greater Than Five Miles from the Clinton Power Station, 2008

### Appendix C Data Tables and Figures - Primary Laboratory

#### Tables

Table C-I.1 Concentrations of I-131 in Surface Water Samples Collected in the Vicinity of Clinton Power Station, 2008.

Table C-I.2 Concentrations of Tritium in Surface Water Samples Collected in the Vicinity of Clinton Power Station, 2008.

Table C-I.3	Concentrations of Gamma Emitters in Surface Water Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-II.1	Concentrations of Gross Beta in Drinking Water Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-II.2	Concentrations of Tritium in Drinking Water Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-II.3	Concentrations of Gamma Emitters in Drinking Water Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-III.1	Concentrations of Tritium in Ground Water Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-III.2	Concentrations of Gamma Emitters in Ground Water Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-IV.1	Concentrations of Gamma Emitters in Fish Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-V.1	Concentrations of Gamma Emitters in Sediment Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-VI.1	Concentrations of Gross Beta in Air Particulate Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-VI.2	Monthly and Yearly Mean Values of Gross Beta Concentrations (E-3 pCi/cu meter) in Air Particulate Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-VI.3	Concentrations of Gamma Emitters in Air Particulate Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-VII.1	Concentrations of I-131 in Air Iodine Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-VIII.1	Concentrations of I-131 in Milk Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-VIII.2	Concentrations of Gamma Emitters in Milk Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-IX.1	Concentrations of Gamma Emitters in Vegetation Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-IX.2	Concentrations of Gamma Emitters in Grass Samples Collected in the Vicinity of Clinton Power Station, 2008.
Table C-X.1	Quarterly TLD Results for Clinton Power Station, 2008.
Table C-X.2	Mean Quarterly TLD Results for the Inner Ring, Outer Ring, Special Interest and Control Locations for Clinton Power Station, 2008.

Table C-X.3 Summary of the Ambient Dosimetry Program for Clinton Power Station, 2008.

Figures

Figure C-1 Mean Monthly Gross Beta Concentrations in Air Particulate Samples Collected in the Vicinity of CPS, 2008.

Figure C-2 Mean Quarterly Ambient Gamma Radiation Levels (TLD) in the Vicinity of CPS, 2008.

Appendix D Inter-Laboratory Comparison Program

Tables

Table D-1 Analytics Environmental Radioactivity Cross Check Program  
Teledyne Brown Engineering, 2008

Table D-2 ERA Environmental Radioactivity Cross Check Program  
Teledyne Brown Engineering, 2008

Table D-3 DOE's Mixed Analyte Performance Evaluation Program (MAPEP)  
Teledyne Brown Engineering, 2008

Appendix E Annual Radiological Groundwater Protection Program Report  
(ARGPPR)

## I. Summary and Conclusions

This report on the Radiological Environmental Monitoring Program (REMP) conducted for the Clinton Power Station (CPS) by Exelon covers the period 1 January 2008 through 31 December 2008. During that time period, 1,578 analyses were performed on 1,462 samples. In assessing all the data gathered for this report and comparing these results with preoperational data, it was concluded that the operation of CPS had no adverse radiological impact on the environment.

There were zero (0) radioactive liquid releases from CPS during 2008. Releases of gaseous radioactive materials were accurately measured in plant effluents. There was no gaseous effluent releases that approached the limits specified in the CPS Offsite Dose Calculation Manual (ODCM). The highest calculated offsite dose received by a member of the public due to the release of gaseous effluents from Clinton Power Station was  $7.45 \text{ E-}04$  or 0.000745 mrem.

Surface, drinking, and ground water samples were analyzed for concentrations of tritium and gamma emitting nuclides. Drinking water samples were also analyzed for concentrations of gross beta and I-131. No fission or activation products were detected. Gross beta activities detected were consistent with those detected in previous years. No tritium activity was detected and the required lower limit of detection (LLD) was met.

Fish and shoreline sediment samples were analyzed for concentrations of gamma emitting nuclides. No fission or activation products were detected in fish or shoreline sediment samples.

Air particulate samples were analyzed for concentrations of gross beta and gamma emitting nuclides. Cosmogenic Be-7 was detected at levels consistent with those detected in previous years. No fission or activation products were detected.

High sensitivity I-131 analyses were performed on weekly air samples. All required LLDs were met.

Cow milk samples were analyzed for concentrations of I-131 and gamma emitting nuclides. All I-131 results were below the required LLDs. Concentrations of naturally occurring K-40 were consistent with those detected in previous years. No fission or activation products were found.

Food product samples were analyzed for concentrations of gross beta and gamma emitting nuclides. Gross beta activities detected were consistent with those detected in previous years. Concentrations of Cosmogenic Be-7 and naturally occurring K-40 were consistent with those detected in previous years. No fission or activation products were detected.

Grass samples were analyzed for concentrations of gamma emitting nuclides. Concentrations of Cosmogenic Be-7 and naturally occurring K-40 were

consistent with those detected in previous years. No fission or activation products were detected.

Environmental gamma radiation measurements were performed quarterly using thermoluminescent dosimeters. Levels detected were consistent with those observed in previous years.

## II. Introduction

The Clinton Power Station (CPS), consisting of one approximately 1140 MW gross electrical power output boiling water reactor is located in Harp Township, DeWitt County, Illinois. CPS is owned and operated by Exelon and became operational in 1987. Unit No. 1 went critical on 15 February 1987. The site encloses approximately 13,730 acres. This includes the 4,895 acre, man-made cooling lake and about 452 acres of property not owned by Exelon. The plant is situated on approximately 150 acres. The cooling water discharge flume – which discharges to the eastern arm of the lake – occupies an additional 130 acres. Although the nuclear reactor, supporting equipment and associated electrical generation and distribution equipment lie in Harp Township, portions of the aforementioned 13,730 acre plot reside within Wilson, Rutledge, DeWitt, Creek, Nixon and Santa Anna Townships.

A Radiological Environmental Monitoring Program (REMP) for CPS was initiated in 1987. The preoperational period for most media covers the periods May 1980 through 27 February 1987 and was summarized in a separate report. This report covers those analyses performed by Teledyne Brown Engineering (TBE) and Global Dosimetry on samples collected during the period 1 January 2008 through 31 December 2008.

### A. Objectives of the REMP

The objectives of the REMP are to:

1. Provide data on measurable levels of radiation and radioactive materials in the site environs.
2. Evaluate the relationship between quantities of radioactive material released from the plant and resultant radiation doses to individuals from principal pathways of exposure.

### B. Implementation of the Objectives

The implementation of the objectives is accomplished by:

1. Identifying significant exposure pathways.
2. Establishing baseline radiological data of media within those pathways.
3. Continuously monitoring those media before and during Station operation to assess Station radiological effects (if any) on man and the environment.



### III. Program Description

#### A. Sample Collection

This section describes the general collection methods used by Environmental Inc. (Midwest Labs) to obtain environmental samples for the CPS REMP in 2008. Sample locations and descriptions can be found in Tables B-1 and B-2, and Figures B-1 through B-3, Appendix B. The sampling methods used by Environmental Inc. (Midwest Labs) are listed in Table B-2.

#### Aquatic Environment

The aquatic environment was evaluated by performing radiological analyses on samples of surface water, drinking water, well water, fish, and shoreline sediment. Two gallon water samples were collected monthly from continuous samplers located at three surface water locations (CL-90, CL-91 and CL-99) and one drinking water location (CL-14). A monthly grab sample was obtained from one surface water location (CL-13). Quarterly samples were obtained from two well water locations (CL-07D and CL-12). All samples were collected in new unused plastic bottles, which were rinsed at least twice with source water prior to collection. Fish samples comprising the flesh of largemouth bass, crappie, carp, bluegill and channel catfish the species most commonly harvested from the lakes by sporting fishermen, were collected semiannually at two locations, CL-19 and CL-105 (control). Shoreline sediment samples composed of recently deposited substrate were collected at one location semiannually, CL-07B.

#### Atmospheric Environment

The atmospheric environment was evaluated by performing radiological analyses on samples of air particulate, airborne iodine, milk, food produce and grass. Airborne iodine and particulate samples were collected and analyzed weekly at ten locations (CL-01, CL-02, CL-03, CL-04, CL-06, CL-07, CL-08, CL-11, CL-15, and CL-94). The control location was CL-11. Airborne iodine and particulate samples were obtained at each location, using a vacuum pump with charcoal and glass fiber filters attached. The pumps were run continuously and sampled air at the rate of approximately one cubic foot per minute. The filters were replaced weekly and sent to the laboratory for analysis.

Milk samples were collected biweekly at one location (CL-116) from May through October, and monthly from November through April to coincide with the grazing season. All samples were collected in new unused

plastic bottles from the bulk tank at that location, preserved with sodium bisulfite, and shipped promptly to the laboratory.

Food products were collected once a month from June through September at four locations (CL-114, CL-115, CL-117 and CL-118). The control location was CL-114. Various broadleaf vegetable samples were collected and placed in new unused plastic bags, and sent to the laboratory for analysis.

Grass samples were collected biweekly at four locations (CL-01, CL-02, CL-08 and CL-116) from May through October. The control location was CL-116. All samples were collected in new unused plastic bags and sent to the laboratory for analysis.

#### Ambient Gamma Radiation

Direct radiation measurements were made using Panasonic 814 calcium sulfate ( $\text{CaSO}_4$ ) thermoluminescent dosimeters (TLD). The TLD locations were placed around the CPS site as follows:

An inner ring consisting of 16 locations (CL-01, CL-05, CL-22, CL-23, CL-24, CL-34, CL-35, CL-36, CL-42, CL-43, CL-44, CL-45, CL-46, CL-47, CL-48 and CL-63). An additional three locations were installed as part of a volunteer comparison study near and within the site perimeter (CL-05MM, CL-46MM and CL-47MM).

An outer ring consisting of 16 locations (CL-51, CL-52, CL-53, CL-54, CL-55, CL-56, CL-57, CL-58, CL-60, CL-61, CL-76, CL-77, CL-78, CL-79, CL-80 and CL-81). CL-58MM was installed as part of a volunteer comparison study extending to approximately 5 miles from the site designed to measure possible exposures to close-in population.

A special interest set consisting of seven locations (CL-37, CL-41, CL-49, CL-64, CL-65, CL-74 and CL-75) representing special interest areas.

A supplemental set consisting of 14 locations (CL-02, CL-03, CL-04, CL-06, CL-07, CL-08, CL-15, CL-33, CL-84, CL-90, CL-91, CL-97, CL-99, and CL-114).

CL-11 represents the control location for all environmental TLDs.

The specific TLD locations were determined by the following criteria:

1. The presence of relatively dense population;

2. Site meteorological data taking into account distance and elevation for each of the sixteen–22 1/2 degree sectors around the site, where estimated annual dose from CPS, if any, would be most significant;
3. On hills free from local obstructions and within sight of the vents (where practical);
4. And near the closest dwelling to the HVAC and VG stacks in the prevailing downwind direction.

Two TLDs – each composed of two CaSO<sub>4</sub> thermoluminescent phosphors enclosed in plastic – were placed at each location in a vented PVC conduit located approximately three feet above ground level. The TLDs were exchanged quarterly and sent to Global Dosimetry for analysis.

#### B. Sample Analysis

This section describes the general analytical methodologies used by TBE and Environmental Inc. (Midwest Labs) to analyze the environmental samples for radioactivity for the CPS REMP in 2008. The analytical procedures used by the laboratories are listed in Table B-2.

In order to achieve the stated objectives, the current program includes the following analyses:

1. Concentrations of beta emitters in drinking water and air particulates.
2. Concentrations of gamma emitters in surface, drinking and well water, air particulates, milk, fish, grass, sediment and vegetables.
3. Concentrations of tritium in surface, drinking and well water.
4. Concentrations of I-131 in air, milk, vegetables and drinking water.
5. Ambient gamma radiation levels at various on-site and off-site environs.

#### C. Data Interpretation

The radiological and direct radiation data collected prior to CPS becoming operational was used as a baseline with which these operational data were compared. For the purpose of this report, CPS was considered operational at initial criticality. In addition, data were compared to

previous years' operational data for consistency and trending. Several factors were important in the interpretation of the data:

1. Lower Limit of Detection and Minimum Detectable Concentration

The lower limit of detection (LLD) was defined as the smallest concentration of radioactive material in a sample that would yield a net count (above background) that would be detected with only a 5% probability of falsely concluding that a blank observation represents a "real" signal. The LLD was intended as a before the fact estimate of a system (including instrumentation, procedure and sample type) and not as an after the fact criteria for the presence of activity. All analyses were designed to achieve the required CPS detection capabilities for environmental sample analysis.

2. Net Activity Calculation and Reporting of Results

Net activity for a sample was calculated by subtracting background activity from the sample activity. Since the REMP measures extremely small changes in radioactivity in the environment, background variations may result in sample activity being lower than the background activity resulting in a negative number. A minimum detectable concentration (MDC) was reported in all cases where positive activity was not detected.

Gamma spectroscopy results for each type of sample were grouped as follows:

For surface water and well water 12 nuclides, Mn-54, Co-58, Fe-59, Co-60, Zn-65, Nb-95, Zr-95, Cs-134, Cs-137, Ba-140, La-140, and Ce-144 were reported.

For fish, sediment and milk, 14 nuclides, Be-7, K-40, Mn-54, Co-58, Fe-59, Co-60, Zn-65, Nb-95, Zr-95, Cs-134, Cs-137, Ba-140, La-140, and Ce-144 were reported.

For drinking water, grass and vegetation 13 nuclides, Mn-54, Co-58, Fe-59, Co-60, Zn-65, Nb-95, Zr-95, I-131, Cs-134, Cs-137, Ba-140, La-140, and Ce-144 were reported.

For grass 15 nuclides, Be-7, K-40, Mn-54, Co-58, Fe-59, Co-60, Zn-65, Nb-95, Zr-95, I-131, Cs-134, Cs-137, Ba-140, La-140, and Ce-144 were reported.

For air particulate 11 nuclides, Be-7, K-40, Co-60, Nb-95, Zr-95,

Ru-103, Ru-106, Cs-134, Cs-137, Ce-141 and Ce-144, were reported.

Means and standard deviations of the results were calculated. The standard deviations represent the variability of measured results for different samples rather than single analysis uncertainty.

D. Program Exceptions

The exceptions described below are those that are considered 'deviations' from the Radiological Environmental Monitoring Program as required by the Station's ODCM. By definition, 'deviations' are permitted as delineated within NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants", October 1978, and within Radiological Assessment Branch Technical Position, Revision 1, November 1979, which states...."Deviations are permitted from the required sampling schedule if specimens are unobtainable due to hazardous conditions, seasonal unavailability, malfunction of automatic sampling equipment and other legitimate reasons".... The below section addresses the reporting requirements found within Section 7.1 of the Station's ODCM.

February 06, 2008, Issue Report (IR) # 732558

Non-ODCM Composite Water sampler CL-99 was found flooded during the weekly inspection. The flooding caused the compositor to fail and subsequent troubleshooting revealed the sampling diffuser had also become clogged, restricting sample flow.

February 27, 2008, IR 741702

Environmental Air Sampler CL-03 was found not running during the performance of the weekly surveillance. Additionally, the digital timer was also found to have stopped recording run time. The malfunction was a blown fuse. The Air Sampler collected sufficient volume, therefore was analyzed and required LLDs were achieved.

May 27, 2008, IR # 779850

TLD CL-56 was found to be missing during the vendor monthly verification of ODCM TLDs. Additionally, the TLD holder container that houses the TLD was found tampered with as the bottom had been dismantled. This container housing the TLD is mounted on a metal rod driven into the ground, which was also missing. TLD CL-56 was replaced on 05/28/08 with a spare, having a result of 12.8 mRem for the rest of the monitoring period.

June 25, 2008, IR # 793454

Broadleaf vegetation was substituted for CL-114 and CL-115 due to late planting and heavy rain with flooding.

July 09, 2008 – July 16, 2008 IR # 797218

Environmental Air sampler CL-94 had a lengthy power interruption due to a severe thunder and lightning storm. Pressure and flow adjustments were made after power was restored. The total sample volume did not meet the minimum acceptance criteria.

July 16, 2008 – July 23, 2008 IR 799543

Environmental Air sampler CL-11 had a lengthy power interruption due to a severe thunder and lightning storm. Pressure and flow adjustments were made after power was restored. The total volume did not meet the minimum acceptance criteria.

December 17, 2008 – December 26, 2008 IR # 860278

Environmental Air Sampler CL-06 was not sampled and analyzed due to icy conditions for the weekly surveillance. The sample was collected and analyzed after the due date as weather conditions permitted. There was no impact to the data and all LLDs were achieved.

Program exceptions were reviewed to understand the causes of the exception and to return to ODCM sample compliance before the next sampling frequency period.

The overall sample recovery rate indicates that the appropriate procedures and equipment are in place to assure reliable program implementation.

#### E. Program Changes

Although there were no changes to the program in 2008, during an annual NRC ODCM REMP inspection, there was an enhancement. An Inspector observed the orientation of an environmental area TLD and as an enhancement, suggested that if relocated approximately sixty (60) feet closer towards the Station, would serve better as a direct line of sight in a cleared opening, unobstructed from tree branches and leaves.

Over the twenty (20) plus years of Unit Operation, the surrounding environment consisting of trees and their branches have grown, thus challenging the guidance ANSI N545-1975, which requires TLDs should be moved as far as possible from large or dense objects that may cause directional anomalies or otherwise perturb the radiation field. Although

historical reviews were performed that resulted in no anomalous data relative to the radiation field, as part of our extent of condition, all environmental TLDs were evaluated as to locations and their respective orientations with the following determination:

Completed:

- A review of the results from adjacent Environmental Area TLD data sectors revealed no significant patterns or variances.
- An extent of condition review examined all Environmental Area TLD locations and their respective orientations and identified three (3) additional locations as candidates for additional monitoring.
- Clinton Power Station has installed four (4) TLDs in close proximity to the original TLDs: CL-05MM, CL-46MM, CL-47MM and CL-58MM.
- These Environmental Area TLDs located within the same meteorological sector near the four (4) locations, were measured and studied for comparison (Table C-X.1).
  - Although TLDs CL-05MM, CL-47MM and CL-58MM were closer to the Station, they resulted in less exposure than the originally installed locations for all four quarters of 2008.
  - TLD CL-46MM showed a slight increase for all four quarters of 2008, averaging 1.6 mRem higher than the originally installed location.

Clinton Power Station will continue this comparison study throughout 2009.

Because the TLD results from this study are not part of the ODCM REMP averages, the results are for comparison purposes only.

#### IV. Results and Discussion

##### A. Aquatic Environment

##### 1. Surface Water

Samples were taken hourly, and grab samples to supplement during periods of inoperability – see exceptions, from a continuous

compositor at three locations (CL-90, CL-91 and CL-99) on a monthly schedule and grab samples were taken monthly from one station (CL-13). The following analyses were performed.

#### Iodine-131

Monthly samples from location CL-90 were analyzed for I-131 activity (Table C-I.1, Appendix C). The required LLD was met.

#### Tritium

Monthly samples from all locations were composited quarterly and analyzed for tritium activity (Table C-I.2, Appendix C). The required LLD was met.

#### Gamma Spectrometry

Samples from all locations were analyzed for gamma emitting nuclides (Table C-I.3, Appendix C). Naturally occurring K-40 was found in one of 12 samples at locations CL-13 and CL-90 and three of 12 samples at locations CL-99. No other nuclides were detected and all required LLDs were met.

## 2. Drinking Water

Monthly samples were collected from a continuous compositor at one location (CL-14). The following analyses were performed:

#### Gross Beta

Monthly samples were analyzed for concentrations of gross beta (Tables C-II.1, Appendix C). Gross beta was found in two of 12 samples. The values ranged from 1.8 to 4.1 pCi/l. Concentrations detected were consistent with those detected in previous years.

#### Tritium

Monthly samples were composited quarterly and analyzed for tritium activity (Table C-II.2, Appendix C). The required LLD was met.



### Gamma Spectrometry

Monthly samples were analyzed for gamma emitting nuclides (Table C-II.3, Appendix C). Naturally occurring K-40 was found in one sample at location CL-14. No other nuclides were detected and all required LLDs were met.

#### 3. Ground Water

Quarterly grab samples were collected at two locations (CL-7D and CL-12, consisting of CL-12R [a raw water sample from this well] and CL-12T [same well water, but after treatment and available for consumption]). The following analyses were performed:

### Tritium

Samples from all locations were analyzed for tritium activity (Table C-III.1, Appendix C). The required LLD was met.

### Gamma Spectrometry

Samples from all locations were analyzed for gamma emitting nuclides (Table C-III.2, Appendix C). No nuclides were detected and all required LLDs were met.

#### 4. Fish

Fish samples comprised of carp, largemouth bass, bluegill, crappie and channel catfish were collected at two locations (CL-19 and CL-105) semiannually. The following analysis was performed:

### Gamma Spectrometry

The edible portion of fish samples from both locations was analyzed for gamma emitting nuclides (Table C-IV.1, Appendix C). Naturally occurring K-40 was found at both stations. No fission or activation products were found. No other nuclides were detected and the required LLDs were met.

#### 5. Shoreline Sediment

Aquatic shoreline sediment samples were collected at CL-07B semiannually. The following analysis was performed:

### Gamma Spectrometry

Shoreline sediment samples were analyzed for gamma emitting nuclides (Table C-V.1, Appendix C). Naturally occurring K-40 was detected in both samples. No fission or activation products were found. No other nuclides were detected and the required LLDs were met.

#### B. Atmospheric Environment

##### 1. Airborne

##### a. Air Particulates

Continuous air particulate samples were collected from 10 locations on a weekly basis. The 10 locations were separated into three groups: Group I represents locations within one mile of the CPS site boundary (CL-02, CL-03, CL-04, CL-06, CL-15, and CL-94). Group II represents the locations at an intermediate distance within one to five miles of CPS (CL-01, CL-07, and CL-08), and Group III represents the control location greater than five miles from CPS (CL-11). The following analyses were performed:

#### Gross Beta

Weekly samples were analyzed for concentrations of beta emitters (Table C-VI.1 and C-VI.2 and Figure C-1, Appendix C).

Detectable gross beta activity was observed at all locations. Comparison of results among the three groups aid in determining the effects, if any, resulting from the operation of CPS. The results from the On-Site locations (Group I) ranged from 8 to 39 E-3 pCi/m<sup>3</sup> with a mean of 20 E-3 pCi/m<sup>3</sup>. The results from the Intermediate Distance location (Group II) ranged from 8 to 55 E-3 pCi/m<sup>3</sup> with a mean of 19 E-3 pCi/m<sup>3</sup>. The results from the Control locations (Group III) ranged from 8 to 39 E-3 pCi/m<sup>3</sup> with a mean of 21 E-3 pCi/m<sup>3</sup>. Comparison of the 2008 air particulate data with previous years data indicate no effects from the operation of CPS (Figure C-5, Appendix C). In addition a comparison of the weekly mean values for 2008 indicate no notable differences among the three groups.

### Gamma Spectrometry

Weekly samples were composited quarterly and analyzed for gamma emitting nuclides (Table C-VI.3, Appendix C). Naturally occurring isotopes Be-7 due to cosmic ray activity was detected in 34 samples. No other nuclides were detected and all required LLDs were met.

b. Airborne Iodine

Continuous air samples were collected from 10 locations (CL-01, CL-02, CL-03, CL-04, CL-06, CL-07, CL-08, CL-11, CL-15 and CL-94) and analyzed weekly for I-131 (Table C-VII.1, Appendix C). All results were less than the MDC and the required LLD was met.

2. Terrestrial

a. Milk

Samples were collected from CL-116 biweekly May through October and monthly November through April, to coincide with the grazing season. The following analyses were performed:

#### Iodine-131

Milk samples were analyzed for concentrations of I-131 (Table C-VIII.1, Appendix C). The required LLD was met.

### Gamma Spectrometry

Each milk sample was analyzed for concentrations of gamma emitting nuclides (Table C-VIII.2, Appendix C). Naturally occurring K-40 activity was found in all samples. No other nuclides were detected and all required LLDs were met.

b. Food Products

Broadleaf vegetation samples and substitutes as noted in exceptions were collected from four locations (CL-114, CL-115, CL-117 and CL-118) monthly June through September, to coincide with the harvest season. The following analyses were performed:

### Gamma Spectrometry

Each food product sample, cabbage, swiss chard, lettuce, and substitutions as noted earlier were analyzed for concentrations of gamma emitting nuclides (Table C-IX.1, Appendix C).

Naturally occurring Be-7 due to cosmic ray activity was detected in 39 of 44 samples. Naturally occurring K-40 activity was found in all samples. No other nuclides were detected and all required LLDs were met.

#### c. Grass

Samples were collected from four locations (CL-01, CL-02, CL-08, and CL-116) biweekly May through October. The following analyses were performed:

### Gamma Spectrometry

Each grass sample was analyzed for concentrations of gamma emitting nuclides (Table C-IX.2, Appendix C).

Naturally occurring Be-7 due to cosmic ray activity was detected in 51 of 52 samples. Naturally occurring K-40 activity was found in 51 of 52 samples. No other nuclides were detected and all required LLDs were met.

#### C. Ambient Gamma Radiation

Ambient gamma radiation levels were measured utilizing Panasonic 814 (CaSO<sub>4</sub>) thermoluminescent dosimeters. Fifty-four TLD locations were established around the site. Results of TLD measurements are listed in Tables C-X.1 to C-X.3, Appendix C.

A total of 216 TLD measurements were made in 2008. The average dose from the inner ring was 20.2 mR/quarter. The average dose from the outer ring was 20.3 mR/quarter. The average dose from the special interest group was 20.1 mR/quarter. The average dose from the supplemental group was 19.1 mR/quarter. The quarterly measurements ranged from 15.7 to 25.3 mR/quarter. Some statistical anomalies were noted for two TLD stations. TLD CL-49 for fourth quarter had a slightly higher than average 2 standard deviation of 6.4 mR/quarter. The two TLDs associated with the standard deviation had the following results:

one had readings of 23.6, 25.6 and 26.8 and the other had readings of 19.6, 19.6 and 20.3, resulting in the higher than average 2 standard deviation. TLD CL-58 for third quarter has a slightly higher than average 2 standard deviation of 4.8 mR/quarter. The two TLDs associated with the standard deviation had the following results: one had readings of 20.1, 25.6 and 26.8 and the other had readings of 18.1, 18.8 and 18.1, resulting in the higher than average 2 standard deviation. The inner ring and outer ring measurements compared well to the Control Station, CL-11, which ranged from 17.3 mR/quarter to 21.6 mR/quarter with an average measurement of 19.3 mR/quarter. A comparison of the Inner Ring and Outer Ring data to the Control Location data indicate that the ambient gamma radiation levels from all the locations were comparable. The historical ambient gamma radiation data from the control location were plotted along with similar data from the Inner and Outer Ring Locations (Figure C-2, Appendix C).

At the end of 2008, the data comparison between the original and newly installed TLDs showed comparable results.

D. Land Use Survey

A Land Use Survey conducted during the July through October 2008 growing season around the Clinton Power Station (CPS) was performed by Environmental Inc. (Midwest Labs) for Exelon to comply with Clinton's Offsite Dose Calculation Manual, section 5.2. The purpose of the survey was to document the nearest resident, milk producing animal and garden of greater than 538 ft<sup>2</sup> in each of the sixteen 22 ½ degree sectors around the site. The distance and direction of all locations from the CPS Station HVAC vent stack were positioned using Global Positioning System (GPS) technology. There were no changes required to the CPS REMP, as a result of this survey. The results of this survey are summarized below.

Distance in Miles from the CPS Station HVAC Vent Stack

Sector	Residence Miles	Garden Miles	Milk Farm Miles
1 N	0.9	0.9	0.9
2 NNE	1.0	2.3	3.0
3 NE	1.3	2.1	>5.0
4 ENE	1.8	2.6	>5.0
5 E	1.0	1.0	1.0
6 ESE	3.2	3.3	>5.0
7 SE	2.4	2.4	>5.0
8 SSE	1.7	2.7	>5.0
9 S	3.0	3.0	4.1
10 SSW	2.9	>5.0	3.4
11 SW	0.7	>5.0	3.6
12 WSW	1.6	2.3	3.4
13 W	1.2	2.0	>5.0
14 WNW	1.6	>5.0	>5.0
15 NW	1.6	2.3	>5.0
16 NNW	1.7	1.3	1.3

E. Summary of Results – Inter-Laboratory Comparison Program

The primary laboratories analyzed Performance Evaluation (PE) samples of air particulate, air iodine, milk, soil, vegetation and water matrices for 19 analytes (Appendix D). The PE samples, supplied by Analytics Inc., Environmental Resource Associates (ERA) and DOE's Mixed Analyte Performance Evaluation Program (MAPEP), were evaluated against the following pre-set acceptance criteria:

1. Analytics Evaluation Criteria

Analytics' evaluation report provides a ratio of TBE's result and Analytics' known value. Since flag values are not assigned by Analytics, TBE-ES evaluates the reported ratios based on internal QC requirements, which are based on the DOE MAPEP criteria.

2. ERA Evaluation Criteria

ERA's evaluation report provides an acceptance range for control and warning limits with associated flag values. ERA's acceptance limits are established per the USEPA, NELAC, state specific PT program requirements or ERA's SOP for the Generation of Performance Acceptance Limits, as applicable. The acceptance limits are either determined by a regression equation specific to each analyte or a fixed percentage limit promulgated under the appropriate regulatory document.

3. DOE Evaluation Criteria

MAPEP's evaluation report provides an acceptance range with associated flag values.

The MAPEP defines three levels of performance: Acceptable (flag = "A"), Acceptable with Warning (flag = "W"), and Not Acceptable (flag = "N"). Performance is considered acceptable when a mean result for the specified analyte is  $\pm 20\%$  of the reference value. Performance is acceptable with warning when a mean result falls in the range from  $\pm 20\%$  to  $\pm 30\%$  of the reference value (i.e.,  $20\% < \text{bias} < 30\%$ ). If the bias is greater than 30%, the results are deemed not acceptable.

For the primary laboratory, 16 out of 18 analytes met the specified acceptance criteria. Two samples did not meet the specified acceptance criteria for the following reasons:

1. Teledyne Brown Engineering's Analytics December 2008 Sr-89 in milk result of 18.0 pCi/L was higher than the known value of 12.6 pCi/L, resulting in a found to known ratio of 1.43. NCR 09-02 was initiated to investigate this failure.
2. Teledyne Brown Engineering's Analytics' ERA Quik Response water sample January 2008 Sr-89 result of 37.33 pCi/L exceeded the upper acceptance limit of 25.2 pCi/L. No cause could be found for the failure. Studies bracketing these results, RAD 71 and RAD

72 had acceptable Sr-89 results. NCR 08-03

The Inter-Laboratory Comparison Program provides evidence of the counting systems and methods, and that the laboratories are producing accurate and reliable data.

V. References

1. American National Standards Institute, Inc., "Performance, Testing and Procedural Specifications for Thermoluminescent Dosimetry," ANSI N545-1975.
2. Code of Federal Regulations, Title 10, Part 20 (Nuclear Regulatory Commission).
3. CPS 2007 Annual Radioactive Effluent Release Report.
4. "Environmental Radioactivity," M. Eisenbud, 1987 (E187).
5. "Natural Radon Exposure in the United States," Donald T. Oakley, U.S. Environmental Protection Agency. ORP/SID 72-1, June 1972.
6. Federal Radiation Council Report No. 1, "Background Material for the Development of Radiation Protection Standards," May 13, 1960.
7. International Commission on Radiation Protection, Publication 2, "Report of Committee II on Permissible Dose for Internal Radiation," (1959) with 1962 Supplement issued in ICRP Publication 6; Publication 9, "Recommendations on Radiation Exposure," (1965); ICRP Publication 7 (1965), amplifying specific recommendations of Publication 26 (1977).
8. International Commission on Radiation Protection, Publication No. 39 (1984), "Principles of Limiting Exposure to the Public to Natural Sources of Radiation".
9. "Radioactivity in the Environment: Sources, Distribution and Surveillance," Ronald L. Kathren, 1984.
10. National Council on Radiation Protection and Measurements, Report No. 22, "Maximum Permissible Body Burdens and Maximum Permissible Concentrations of Radionuclides in Air and Water for Occupational Exposure," (Published as National Bureau of Standards Handbook 69, issued June 1959, superseding Handbook 52).
11. National Council on Radiation Protection and Measurements, Report No. 39, "Basic Radiation Protection Criteria," January 1971.
12. National Council on Radiation Protection and Measurements, Report No. 44, "Krypton-85 in the Atmosphere – Accumulation, Biological Significance, and Control Technology," July 1975.



13. National Council on Radiation Protection and Measurements, Report No. 91, "Recommendations on Limits for Exposure to Ionizing Radiation," June 1987.
14. National Council on Radiation Protection and Measurements, Report No. 93, "Ionizing Radiation Exposure of the Population of the United States," September 1987.
15. National Research Council, 1990, Committee on Biological Effects of Ionizing Radiation (BEIR V), Board on Radiation Effects Research on Life Sciences, "The Effects of Exposure to Low Levels of Ionizing Radiation".
16. United States Nuclear Regulatory Commission, Regulatory Guide 4.1, "Programs for Monitoring Radioactivity in the Environs of Nuclear Power Plants," Revision 1, April 1975.
17. United States Nuclear Regulatory Commission, Regulatory Guide 4.13, "Performance, Testing and Procedural Specifications for Thermoluminescence Dosimetry: Environmental Applications," Revision 1, July 1977.
18. United States Nuclear Regulatory Commission, Regulatory Guide 1.109, "Calculation of Annual Dose to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR Part 50, Appendix I," Revision 1, October 1977.
19. United States Nuclear Regulatory Commission Branch Technical Position, "An Acceptable Radiological Environmental Monitoring Program," Revision 1, November 1979.
20. United States Nuclear Regulatory Commission, Regulatory Guide 4.15, "Quality Assurance for Radiological Monitoring Programs (Normal Operations) – Effluent Streams and the Environment," Revision 1, February 1979.
21. Technical Specifications, Clinton Power Station, Unit No. 1, Docket No. 50-461, Office of Nuclear Reactor Regulation, 1986. Facility Operating License Number NPF-62.
22. Clinton Power Station, Updated Safety Analysis Report.
23. Clinton Power Station, Unit 1, Off-Site Dose Calculation Manual.

**APPENDIX A**

**RADIOLOGICAL ENVIRONMENTAL MONITORING  
REPORT SUMMARY**

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	CONTROL LOCATION (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
SURFACE WATER (PCI/LITER)	I-131 (LOW LVL)	12	1	<LLD	NA	-		0
	H-3	16	2000	<LLD	<LLD	-		0
	GAMMA BE-7	48	NA	ND	ND	-		0
	K-40		NA	49 (2/24) (28/71)	106 (3/24) (38/194)	106 (3/12) (38/194)	CL-99 CONTROL NORTH FORK ACCESS 3.5 MILES NNE OF SITE	0
	MN-54		15	<LLD	<LLD	-		0
	CO-58		15	<LLD	<LLD	-		0
	FE-59		30	<LLD	<LLD	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION		DOCKET NUMBER: 50-461		REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
Location of Facility: DEWITT COUNTY IL		INDICATOR CONTROL LOCATIONS		MEAN (M)	MEAN (M)	MEAN (M)	STATION #	NUMBER OF
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	(F) RANGE	(F) RANGE	(F) RANGE	NAME DISTANCE AND DIRECTION	NONROUTINE REPORTED MEASUREMENTS
SURFACE WATER (PCI/LITER)	CO-60		15	<LLD	<LLD	-		0
	ZN-65		30	<LLD	<LLD	-		0
	NB-95		15	<LLD	<LLD	-		0
	ZR-95		30	<LLD	<LLD	-		0
	CS-134		15	<LLD	<LLD	-		0
	CS-137		18	<LLD	<LLD	-		0
	BA-140		60	<LLD	<LLD	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION		DOCKET NUMBER: 50-461		REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
Location of Facility: DEWITT COUNTY IL		INDICATOR CONTROL		LOCATION WITH HIGHEST ANNUAL MEAN (M)				
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
DRINKING WATER (PCI/LITER)	LA-140		15	<LLD	<LLD	-		0
	CE-144		NA	ND	ND	-		0
	GR-B	12	4	3 (2/12) (1.8/4.1)	NA	3 (2/12) (1.8/4.1)	CL-14 INDICATOR STATION PLANT SERVICE BLDG ONSITE	0
	H-3	4	2000	<LLD	NA	-		0
	GAMMA BE-7	12	NA	ND	NA	-		0
	K-40		NA	183 (1/12)	NA	183 (1/12)	CL-14 INDICATOR STATION PLANT SERVICE BLDG ONSITE	0
	MN-54		15	<LLD	NA	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION		DOCKET NUMBER: 50-461							
Location of Facility: DEWITT COUNTY IL		REPORTING PERIOD: 2008							
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR	CONTROL	LOCATION WITH HIGHEST ANNUAL MEAN (M)			NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION		
DRINKING WATER (PCI/LITER)	CO-58		15	<LLD	NA	-			0
	FE-59		30	<LLD	NA	-			0
	CO-60		15	<LLD	NA	-			0
	ZN-65		30	<LLD	NA	-			0
	NB-95		15	<LLD	NA	-			0
	ZR-95		30	<LLD	NA	-			0
	I-131		15	<LLD	NA	-			0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	CONTROL LOCATION (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
DRINKING WATER (PCI/LITER)	CS-134		15	<LLD	NA	-		0
	CS-137		18	<LLD	NA	-		0
	BA-140		60	<LLD	NA	-		0
	LA-140		15	<LLD	NA	-		0
	CE-144		NA	ND	NA	-		0
GROUND WATER (PCI/LITER)	H-3	12	200	<LLD	NA	-		0
	GAMMA BE-7	12	NA	ND	NA	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461		REPORTING PERIOD: 2008		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR	CONTROL	LOCATION WITH HIGHEST ANNUAL MEAN (M)		
				LOCATIONS	LOCATION	MEAN (M)	STATION #	NUMBER OF
				MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	NAME DISTANCE AND DIRECTION	NONROUTINE REPORTED MEASUREMENTS
GROUND WATER (PCI/LITER)	K-40		NA	ND	NA	-		0
	MN-54		15	<LLD	NA	-		0
	CO-58		15	<LLD	NA	-		0
	FE-59		30	<LLD	NA	-		0
	CO-60		15	<LLD	NA	-		0
	ZN-65		30	<LLD	NA	-		0
	NB-95		15	<LLD	NA	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)



**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	CONTROL LOCATION (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
GROUND WATER (PCI/LITER)	ZR-95		30	<LLD	NA	-		0
	CS-134		15	<LLD	NA	-		0
	CS-137		18	<LLD	NA	-		0
	BA-140		60	<LLD	NA	-		0
	LA-140		15	<LLD	NA	-		0
	CE-144		NA	NA	ND	NA	-	
FISH (PCI/KG WET)	GAMMA BE-7	16	NA	ND	ND	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	CONTROL MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
FISH (PCI/KG WET)	K-40		NA	3130 (8/8) (2410/3650)	3063 (8/8) (2260/3380)	3130 (8/8) (2410/3650)	CL-19 INDICATOR END OF DISCHARGE FLUME 3.4 MILES E OF SITE	0
	MN-54		130	<LLD	<LLD	-		0
	CO-58		130	<LLD	<LLD	-		0
	FE-59		260	<LLD	<LLD	-		0
	CO-60		130	<LLD	<LLD	-		0
	ZN-65		260	<LLD	<LLD	-		0
	NB-95		NA	ND	ND	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL		DOCKET NUMBER: 50-461		REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
FISH (PCI/KG WET)	ZR-95		NA	ND	ND	-		0
	CS-134		100	<LLD	<LLD	-		0
	CS-137		100	<LLD	<LLD	-		0
	BA-140		NA	ND	ND	-		0
	LA-140		NA	ND	ND	-		0
	CE-144		NA	ND	ND	-		0
SEDIMENT (PCI/KG DRY)	GAMMA BE-7	2	NA	ND	NA	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461		REPORTING PERIOD: 2008		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR	CONTROL	LOCATION WITH HIGHEST ANNUAL MEAN (M)		
				LOCATIONS	LOCATION	MEAN (M) (F)	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE		
SEDIMENT (PCI/KG DRY)	K-40		NA	8420 (2/2) (6980/9860)	NA	8420 (2/2) (6980/9860)	CL-07B INDICATOR CLINTON LAKE 2.1 MILES SE OF SITE	0
	MN-54		NA	ND	NA	-		0
	CO-58		NA	ND	NA	-		0
	FE-59		NA	ND	NA	-		0
	CO-60		NA	ND	NA	-		0
	ZN-65		NA	ND	NA	-		0
	NB-95		NA	ND	NA	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

A-10

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR MEAN (M) (F) RANGE	CONTROL LOCATION MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
SEDIMENT (PCI/KG DRY)	ZR-95		NA	ND	NA	-		0
	CS-134		150	<LLD	NA	-		0
	CS-137		180	<LLD	NA	-		0
	BA-140		NA	ND	NA	-		0
	LA-140		NA	ND	NA	-		0
	CE-144		NA	ND	NA	-		0
AIR PARTICULATE (E-3 PCI/CU.METER)	GR-B	520	10	19 (465/468) (6/55)	21 (52/52) (8/110)	21 (52/52) (8/110)	CL-11 CONTROL AMERENIP SUBSTATION 16 MILES S OF SITE	0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		INDICATOR CONTROL LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
AIR PARTICULATE (E-3 PCI/CU.METER)	GAMMA BE-7	40	NA	89 (31/36) (47.8/186)	79.8 (3/4) (62.1/104)	112.7 (4/4) (58.9/186)	CL-08 INDICATOR DEWITT CEMETERY 2.2 MILES E OF SITE	0
	K-40		NA	ND	ND	-		0
	CO-60		NA	ND	ND	-		0
	NB-95		NA	ND	ND	-		0
	ZR-95		NA	ND	ND	-		0
	RU-103		NA	ND	ND	-		0
	RU-106		NA	ND	ND	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
AIR PARTICULATE (E-3 PCI/CU.METER)	CS-134		50	<LLD	<LLD	-		0
	CS-137		60	<LLD	<LLD	-		0
	CE-141		NA	ND	ND	-		0
	CE-144		NA	ND	ND	-		0
AIR IODINE (E-3 PCI/CU.METER)	GAMMA I-131	520	70	<LLD	<LLD	-		0
MILK (PCI/LITER)	I-131	20	1	NA	<LLD	-		0
	GAMMA BE-7	20	NA	NA	ND	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461		REPORTING PERIOD: 2008		INDICATOR CONTROL LOCATION WITH HIGHEST ANNUAL MEAN (M)	
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS	
MILK (PCI/LITER)	K-40		NA	NA	1207 (20/20) (965/1380)	1207 (20/20) (965/1380)	CL-116 CONTROL PASTURE IN RURAL KENNEY 14 MILES WSW OF SITE	0	
	MN-54		NA	NA	ND	-		0	
	CO-58		NA	NA	ND	-		0	
	FE-59		NA	NA	ND	-		0	
	CO-60		NA	NA	ND	-		0	
	ZN-65		NA	NA	ND	-		0	
	NB-95		NA	NA	ND	-		0	

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)



**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR MEAN (M) (F) RANGE	CONTROL LOCATION MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
MILK (PCI/LITER)	ZR-95		NA	NA	ND	-		0
	CS-134		15	NA	<LLD	-		0
	CS-137		18	NA	<LLD	-		0
	BA-140		60	NA	<LLD	-		0
	LA-140		15	NA	<LLD	-		0
	CE-144		NA	NA	ND	-		0

ND = NOT DETECTED  
THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION		DOCKET NUMBER: 50-461		REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
Location of Facility: DEWITT COUNTY IL		INDICATOR CONTROL LOCATIONS		MEAN (M)	MEAN (M)	MEAN (M)	STATION #	NUMBER OF
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	(F) RANGE	(F) RANGE	(F) RANGE	NAME DISTANCE AND DIRECTION	NONROUTINE REPORTED MEASUREMENTS
VEGETATION (PCI/KG WET)	GAMMA BE-7	44	NA	406.4 (30/34) (108/2090)	337.1 (9/10) (112/667)	581.1 (10/10) (148/2090)	CL-115 INDICATOR SITE'S SECONDARY ACCESS ROAD 0.7 MILES NE OF SITE	0
	K-40		NA	4771.8 (34/34) (1670/8370)	5035 (10/10) (2570/7820)	5281.7 (12/12) (2760/8370)	CL-118 INDICATOR SITE'S MAIN ACCESS ROAD 0.7 MILES NNE OF SITE	0
	MN-54		NA	ND	ND	-		0
	CO-58		NA	ND	ND	-		0
	FE-59		NA	ND	ND	-		0
	CO-60		NA	ND	ND	-		0
	ZN-65		NA	ND	ND	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR MEAN (M) (F) RANGE	CONTROL LOCATION MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
VEGETATION (PCI/KG WET)	NB-95		NA	ND	ND	-		0
	ZR-95		NA	ND	ND	-		0
	I-131		60	<LLD	<LLD	-		0
	CS-134		60	<LLD	<LLD	-		0
	CS-137		80	<LLD	<LLD	-		0
	BA-140		NA	ND	ND	-		0
	LA-140		NA	ND	ND	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR MEAN (M) (F) RANGE	CONTROL MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
VEGETATION (PCI/KG WET)	CE-144		NA	ND	ND	-		0
GRASS (PCI/KG WET)	GAMMA BE-7	52	NA	2152.9 (38/39) (437/5160)	1823.1 (13/13) (1160/3080)	2896.9 (13/13) (1310/5160)	CL-02 INDICATOR CLINTON'S MAIN ACCESS ROAD 0.7 MILES NNE OF SITE	0
	K-40		NA	5039.5 (38/39) (3160/8400)	4462.3 (13/13) (2430/5590)	5306.9 (13/13) (3480/8400)	CL-08 INDICATOR DEWITT CEMETERY 2.2 MILES E OF SITE	0
	MN-54		NA	ND	ND	-		0
	CO-58		NA	ND	ND	-		0
FE-59			NA	ND	ND	-		0
CO-60			NA	ND	ND	-		0

ND = NOT DETECTED

THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461 REPORTING PERIOD: 2008		LOCATION WITH HIGHEST ANNUAL MEAN (M)		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	MEAN (M) (F) RANGE	STATION # NAME DISTANCE AND DIRECTION	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
GRASS (PCI/KG WET)	ZN-65		NA	ND	ND	-		0
	NB-95		NA	ND	ND	-		0
	ZR-95		NA	ND	ND	-		0
	I-131		60	<LLD	<LLD <sup>(F)</sup>	-		0
	CS-134		60	<LLD	<LLD	-		0
	CS-137		80	<LLD	<LLD	-		0
	BA-140		NA	ND	ND	-		0

ND = NOT DETECTED  
THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR  
THE CLINTON POWER STATION, 2008**

Name of Facility: CLINTON POWER STATION Location of Facility: DEWITT COUNTY IL				DOCKET NUMBER: 50-461		REPORTING PERIOD: 2008		
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR	CONTROL	LOCATION WITH HIGHEST ANNUAL MEAN (M)		
				LOCATIONS	LOCATION	MEAN (M)	STATION #	NUMBER OF
				MEAN (M)	MEAN (M)	MEAN (M)	NAME	NONROUTINE
				(F)	(F)	(F)	DISTANCE AND DIRECTION	REPORTED
				RANGE	RANGE	RANGE		MEASUREMENTS
GRASS (PCI/KG WET)	LA-140		NA	ND	ND	-		0
	CE-144		NA	ND	ND	-		0
DIRECT RADIATION (MILLI-ROENTGEN/QTR.)	TLD-QUARTERLY	216	NA	19.9 (212/212) (15.7/25.3)	19.3 (4/4) (17.3/21.6)	21.6 (4/4) (19.2/25.3)	CL-58 INDICATOR  4.3 MILES SSW	0

A-20

ND = NOT DETECTED  
THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

Intentionally left blank

**APPENDIX B**

**LOCATION DESIGNATION, DISTANCE & DIRECTION, AND  
SAMPLE COLLECTION & ANALYTICAL METHODS**



TABLE B-1: Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Clinton Power Station, 2008

Location	Location Description	Distance & Direction From Site
<u>A. Surface Water</u>		
CL-13	Salt Creek Bridge on Rt. 10 (indicator)	3.6 miles SW
CL-90	Discharge Flume (indicator)	0.4 miles SE
CL-91	Parnell Boat Access (control)	6.1 miles ENE
CL-99	North Fork Access (control)	3.5 miles NNE
<u>B. Drinking (Potable) Water</u>		
CL-14	Station Plant Service Bldg (indicator)	onsite
<u>C. Well Water</u>		
CL-07D	Mascoutin Recreation Area (indicator)	2.3 miles ESE
CL-12T	DeWitt Pump House (indicator)	1.6 miles E
CL-12R	DeWitt Pump House (indicator)	1.6 miles E
<u>D. Milk - bi-weekly / monthly</u>		
CL-116	Dement Dairy (control)	14 miles WSW
<u>E. Air Particulates / Air Iodine</u>		
CL-01	Camp Quest	1.8 miles W
CL-02	Clinton's Main Access Road	0.7 miles NNE
CL-03	Clinton's Secondary Access Road	0.7 miles NE
CL-04	Residence Near Recreation Area	0.8 miles SW
CL-06	Clinton's Recreation Area	0.7 miles WSW
CL-07	Mascoutin Recreation Area	2.3 miles SE
CL-08	DeWitt Cemetery	2.2 miles E
CL-11	Illinois Power Substation (Control)	16 miles S
CL-15	Rt. 900N Residence	0.9 miles N
CL-94	Old Clinton Road	0.6 miles E
<u>F. Fish</u>		
CL-19	End of Discharge Flume (indicator)	3.4 miles E
CL-105	Lake Shelbyville (control)	50 miles S
<u>G. Shoreline Sediment</u>		
CL-07B	Clinton Lake (indicator)	2.1 miles SE
<u>H. Food Products</u>		
CL-114	Cisco (Control)	12.5 miles SSE
CL-115	Site's Secondary Access Road	0.7 miles NE
CL-117	Residence North of Site	0.9 miles N
CL-118	Site's Main Access Road	0.7 miles NNE
<u>I. Grass</u>		
CL-01	Camp Quest	1.8 miles W
CL-02	Clinton's Main Access Road	0.7 miles NNE
CL-08	DeWitt Cemetery	2.2 miles E
CL-116	Pasture in Rural Kenney	14 miles WSW

TABLE B-1: Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Clinton Power Station, 2008

Location	Location Description	Distance & Direction From Site
<u>J. Environmental Dosimetry - TLD</u>		
<u>Inner Ring</u>		
CL-01		1.8 miles W
CL-05		0.7 miles NNE
CL-22		0.6 miles NE
CL-23		0.5 miles ENE
CL-24		0.5 miles E
CL-34		0.8 miles WNW
CL-35		0.7 miles NW
CL-36		0.6 miles N
CL-42		2.8 miles ESE
CL-43		2.8 miles SE
CL-44		2.3 miles SSE
CL-45		2.8 miles S
CL-46		2.8 miles SSW
CL-47		3.3 miles SW
CL-48		2.3 miles WSW
CL-63		1.3 miles NNW
<u>Outer Ring</u>		
CL-51		4.4 miles NW
CL-52		4.3 miles NNW
CL-53		4.3 miles E
CL-54		4.6 miles ESE
CL-55		4.1 miles SE
CL-56		4.1 miles SSE
CL-57		4.6 miles S
CL-58		4.3 miles SSW
CL-60		4.5 miles SW
CL-61		4.5 miles WSW
CL-76		4.6 miles N
CL-77		4.5 miles NNE
CL-78		4.8 miles NE
CL-79		4.5 miles ENE
CL-80		4.1 miles W
CL-81		4.5 miles WNW

TABLE B-1: Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Clinton Power Station, 2008

Location	Location Description	Distance & Direction From Site
<u>Special Interest</u>		
CL-37		3.4 miles N
CL-41		2.4 miles E
CL-49		3.5 miles W
CL-64		2.1 miles WNW
CL-65		2.6 miles ENE
CL-74		1.9 miles W
CL-75		0.9 miles N
<u>Supplemental</u>		
CL-02		0.7 miles NNE
CL-03		0.7 miles NE
CL-04		0.8 miles SW
CL-06		0.8 miles WSW
CL-07		2.3 miles SE
CL-08		2.2 miles E
CL-15		0.9 miles N
CL-33		11.7 miles SW
CL-84		0.6 miles E
CL-90		0.4 miles SE
CL-91		6.1 miles ENE
CL-97		10.3 miles SW
CL-99		3.5 miles NNE
CL-114		12.5 miles SE
<u>Control</u>		
CL-11		16 miles S

TABLE B-2: Radiological Environmental Monitoring Program – Summary of Sample Collection and Analytical Methods, Clinton Power Station, 2008

Sample Medium	Analysis	Sampling Method	Analytical Procedure Number
Surface Water	Gamma Spectroscopy	Monthly composite from a continuous water compositor.	TBE, TBE-2007 Gamma emitting radioisotope analysis Env. Inc., SPM-1 Sampling Procedure Manual
Surface Water	Tritium	Quarterly composite from a continuous water compositor.	TBE, TBE-2011 Tritium analysis in drinking water by liquid scintillation Env. Inc., SPM-1 Sampling Procedure Manual
Drinking Water	Gross Beta	Monthly composite from a continuous water compositor.	TBE, TBE-2008 Gross Alpha and/or gross beta activity in various matrices Env. Inc., SPM-1 Sampling Procedure Manual
Drinking Water	Gamma Spectroscopy	Monthly composite from a continuous water compositor.	TBE, TBE-2007 Gamma emitting radioisotope analysis Env. Inc., SPM-1 Sampling Procedure Manual
Drinking Water	Tritium	Quarterly composite from a continuous water compositor.	TBE, TBE-2011 Tritium analysis in drinking water by liquid scintillation Env. Inc., SPM-1 Sampling Procedure Manual
Well Water	Gamma Spectroscopy	Quarterly composite from a continuous water compositor.	TBE, TBE-2007 Gamma emitting radioisotope analysis Env. Inc., SPM-1 Sampling Procedure Manual
Well Water	Tritium	Quarterly composite from a continuous water compositor.	TBE, TBE-2011 Tritium analysis in drinking water by liquid scintillation Env. Inc., SPM-1 Sampling Procedure Manual
Fish	Gamma Spectroscopy	Semi-annual samples collected via electroshocking or other techniques	TBE-2007 Gamma emitting radioisotope analysis Env. Inc., SPM-1 Sampling Procedure Manual
Air Particulates	Gross Beta	One-week composite of continuous air sampling through glass fiber filter paper	TBE, TBE-2008 Gross Alpha and/or gross beta activity in various matrices Env. Inc., SPM-1 Sampling Procedure Manual
Air Particulates	Gamma Spectroscopy	Quarterly composite of each station	TBE, TBE-2007 Gamma emitting radioisotope analysis Env. Inc., SPM-1 Sampling Procedure Manual
Air Iodine	Gamma Spectroscopy	One-week composite of continuous air sampling through charcoal filter	TBE, TBE-2007 Gamma emitting radioisotope analysis Env. Inc., SPM-1 Sampling Procedure Manual
Milk	I-131	Bi-weekly grab sample when cows are on pasture. Monthly all other times	TBE, TBE-2012 Radioiodine in various matrices Env. Inc., SPM-1 Sampling Procedure Manual

TABLE B-2: Radiological Environmental Monitoring Program – Summary of Sample Collection and Analytical Methods, Clinton Power Station, 2008

Sample Medium	Analysis	Sampling Method	Analytical Procedure Number
Food Products	Gross Beta	Monthly grab June through September	TBE, TBE-2008 Gross Alpha and/or gross beta activity in various matrices Env. Inc., SPM-1 Sampling Procedure Manual
Food Products	Gamma Spectroscopy	Monthly grab June through September	TBE, TBE-2007 Gamma emitting radioisotopes analysis Env. Inc., SPM-1 Sampling Procedure Manual
Grass	Gamma Spectroscopy	Biweekly May through October	TBE, TBE-2007 Gamma emitting radioisotopes analysis Env. Inc., SPM-1 Sampling Procedure Manual
TLD	Thermoluminescence Dosimetry	Quarterly TLDs comprised of two Global Dosimetry CaF <sub>2</sub> elements.	Global Dosimetry Quality Assurance Manual

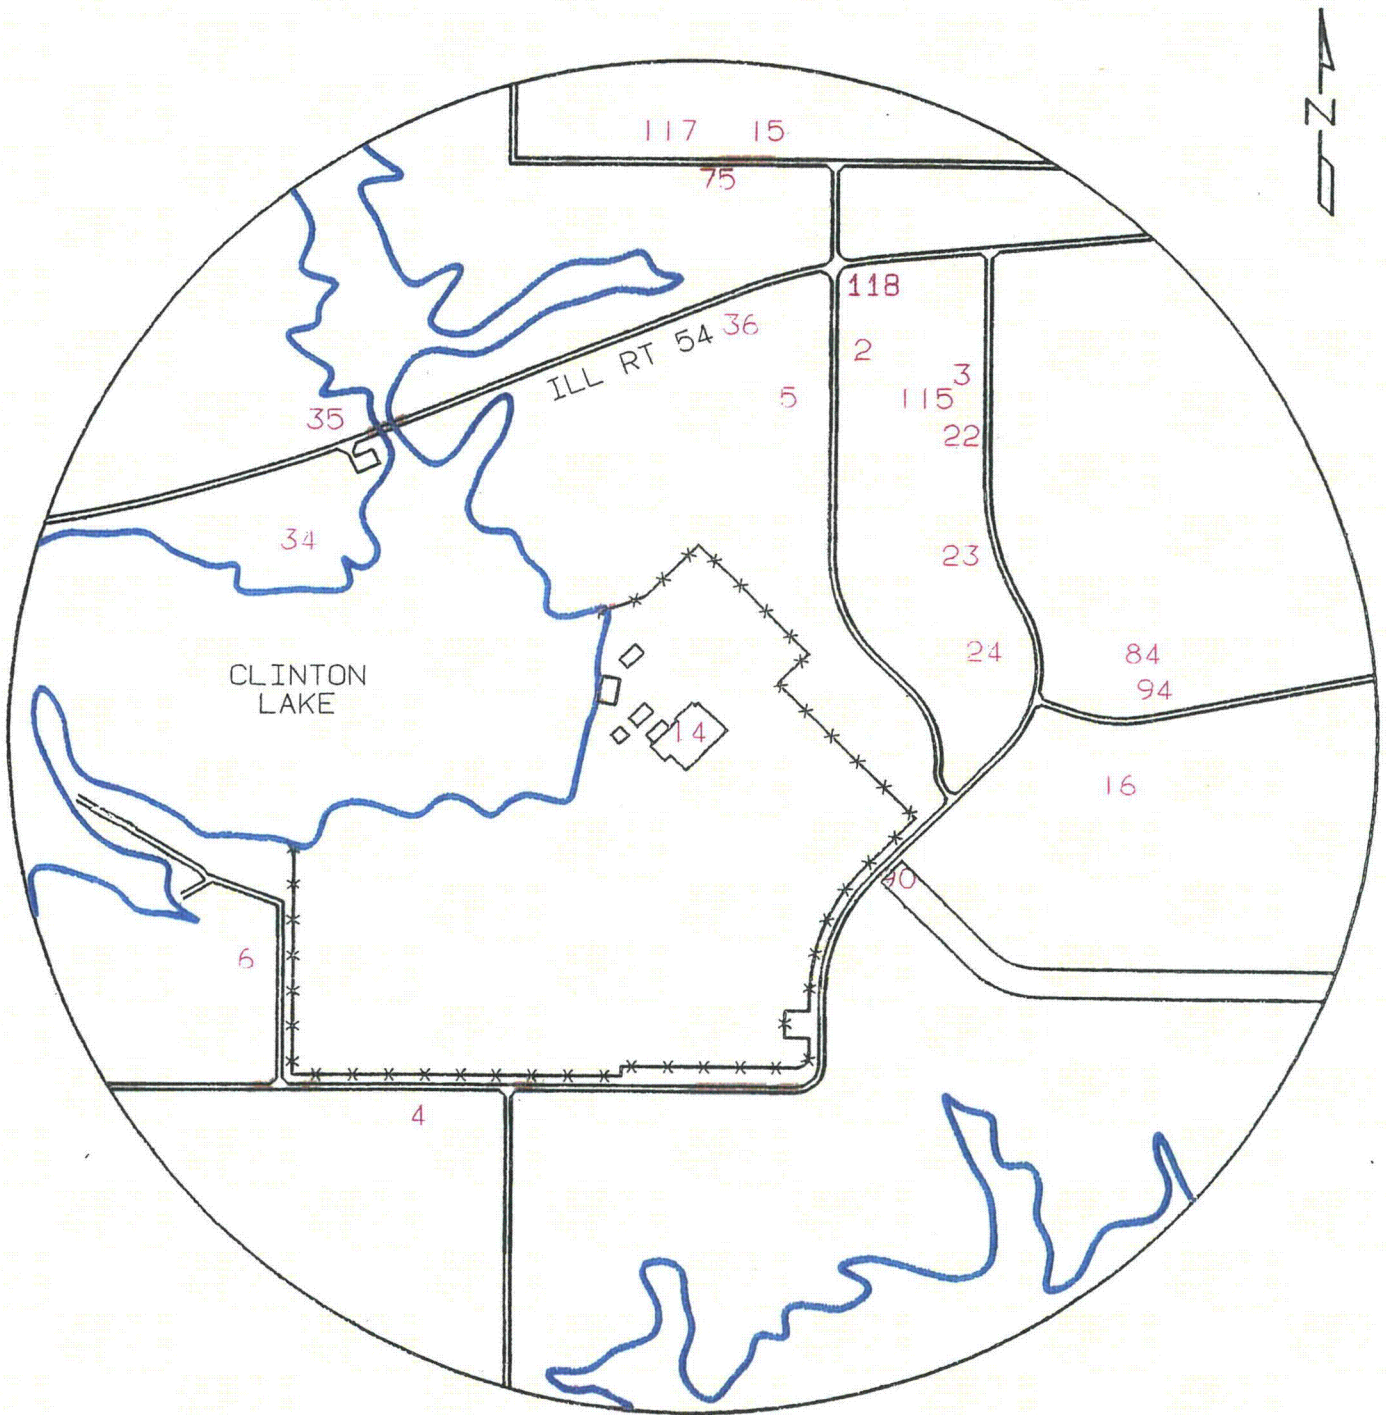


Figure B-1  
 Environmental Sampling Locations Within One  
 Mile of the Clinton Power Station, 2008

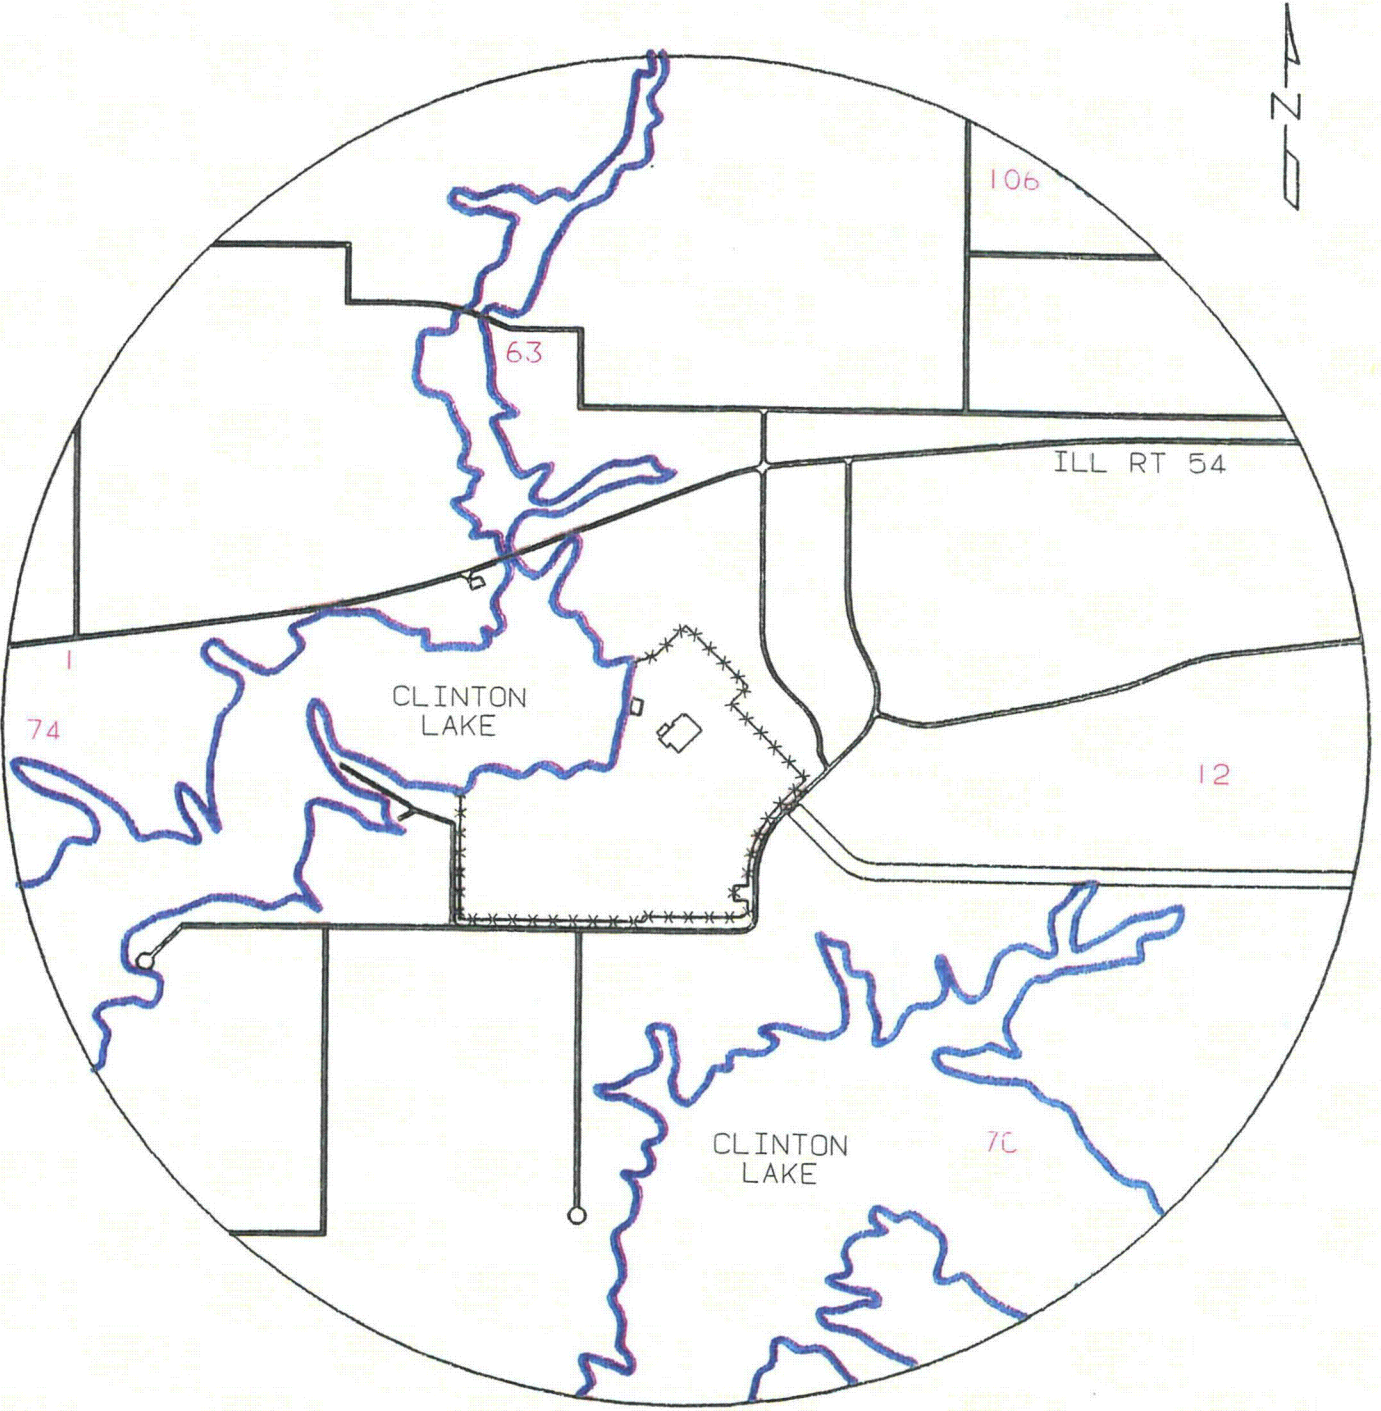


Figure B-2  
 Environmental Sampling Locations Between One and Two  
 Miles of the Clinton Power Station, 2008

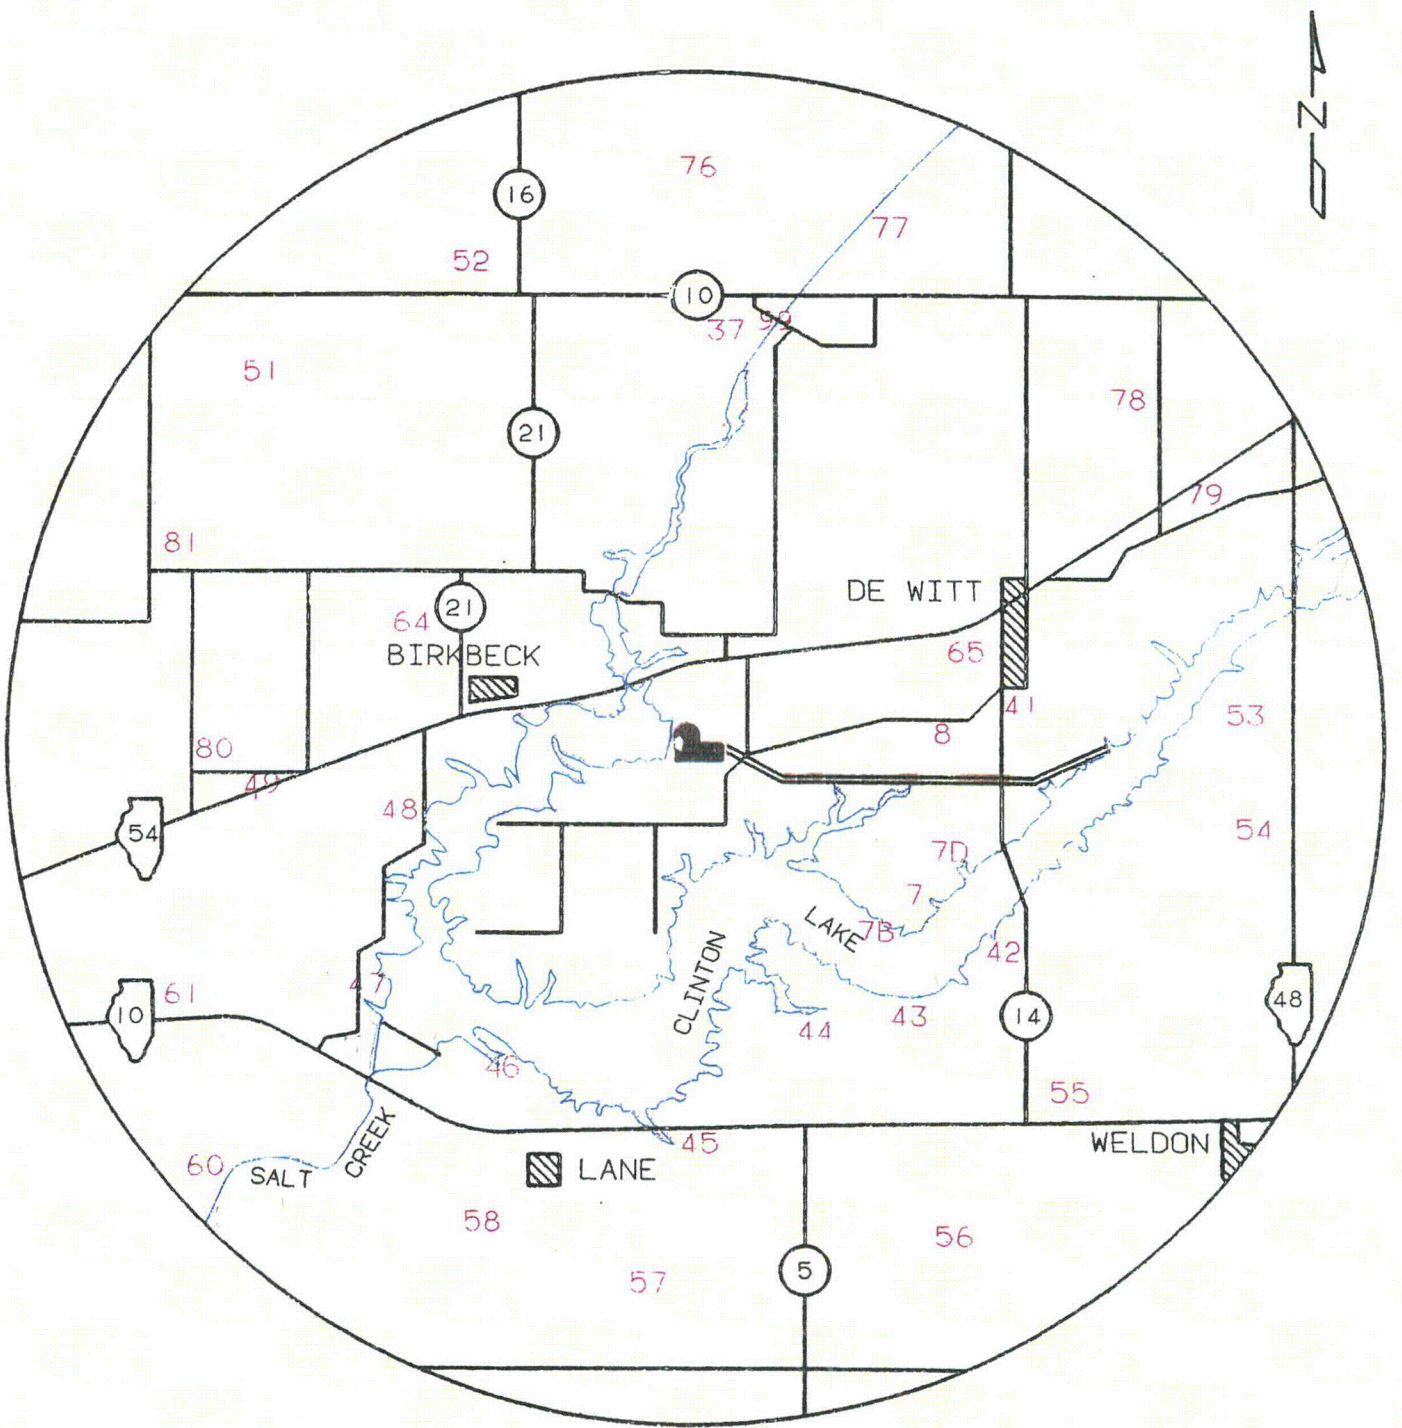


Figure B-3  
 Environmental Sampling Locations Between Two and  
 Five Miles of the Clinton Power Station, 2008



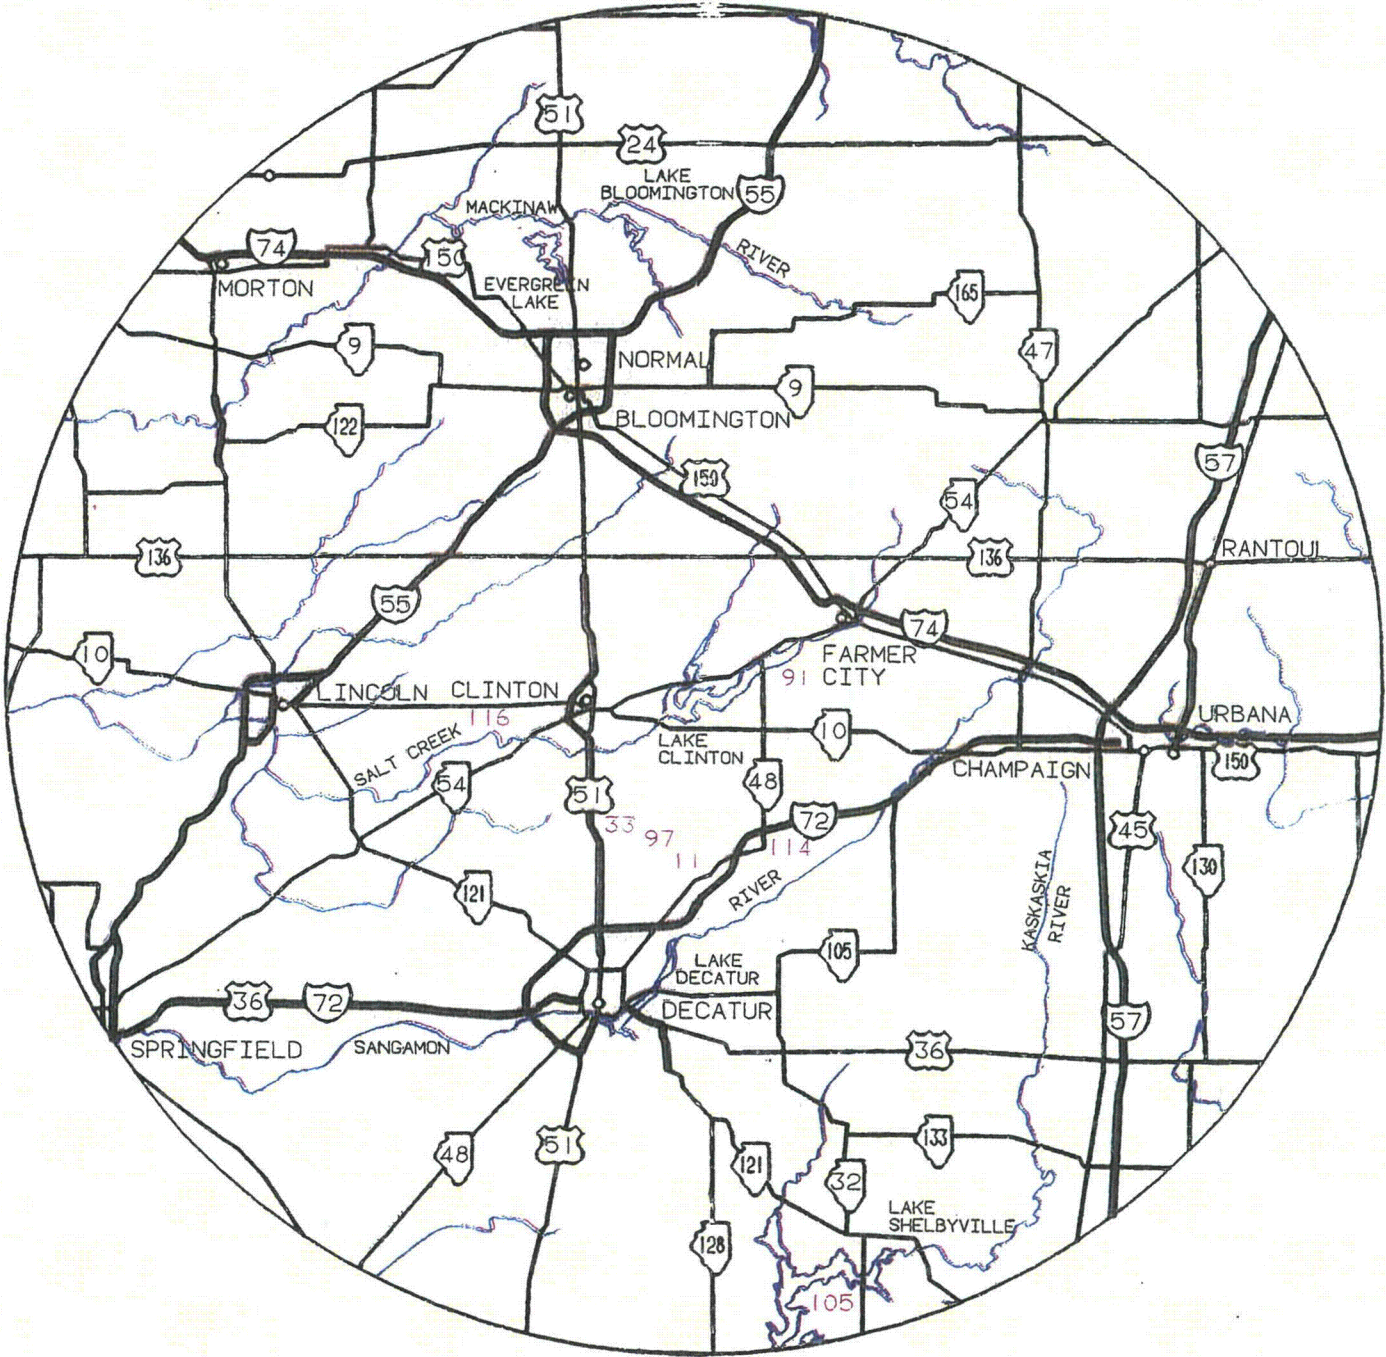


Figure B-4  
Environmental Sampling Locations Greater than Five  
Miles of the Clinton Power Station, 2008

**APPENDIX C**

**DATA TABLES AND FIGURES -  
PRIMARY LABORATORY**

**TABLE C-I.1****CONCENTRATIONS OF I-131 IN SURFACE WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**RESULTS IN UNITS OF PCI/LITER  $\pm$  2 SIGMA

COLLECTION PERIOD	CL-90
12/26/07 - 01/30/08	< 0.7
01/30/08 - 02/27/08	< 0.6
02/27/08 - 03/26/08	< 0.4
03/26/08 - 04/30/08	< 0.5
04/30/08 - 05/28/08	< 0.6
05/28/08 - 06/25/08	< 0.5
06/25/08 - 07/30/08	< 0.8
07/30/08 - 08/27/08	< 0.9
08/27/08 - 09/24/08	< 0.9
09/24/08 - 10/29/08	< 0.9
10/29/08 - 11/26/08	< 0.8
11/26/08 - 12/31/08	< 0.6

MEAN

**TABLE C-I.2****CONCENTRATIONS OF TRITIUM IN SURFACE WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**RESULTS IN UNITS OF PCI/LITER  $\pm$  2 SIGMA

COLLECTION PERIOD	CL-90	CL-13	CL-91	CL-99
01/30/08 - 03/26/08	< 177	< 176	< 179	< 177
04/30/08 - 06/25/08	< 190	< 184	< 191	< 189
07/31/08 - 09/24/08	< 144	< 128	< 141	< 131
09/24/08 - 12/31/08	< 178	< 149	< 178	< 177

MEAN

TABLE C-I.3

CONCENTRATIONS OF GAMMA EMITTERS IN SURFACE WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140	Ce-144
C-2 CL-13	12/26/07 - 12/26/07	< 31	< 58	< 3	< 4	< 8	< 4	< 7	< 4	< 8	< 3	< 4	< 28	< 5	< 27
	01/30/08 - 01/30/08	< 60	< 63	< 8	< 7	< 13	< 7	< 13	< 7	< 11	< 7	< 7	< 23	< 10	< 45
	02/27/08 - 02/27/08	< 19	< 10	< 2	< 2	< 4	< 2	< 5	< 2	< 4	< 2	< 2	< 10	< 4	< 18
	03/26/08 - 03/26/08	< 44	< 115	< 6	< 6	< 11	< 8	< 11	< 5	< 10	< 5	< 6	< 25	< 6	< 51
	04/30/08 - 04/30/08	< 52	< 53	< 7	< 6	< 15	< 6	< 11	< 7	< 10	< 6	< 6	< 28	< 9	< 37
	05/28/08 - 05/28/08	< 35	< 96	< 5	< 5	< 13	< 5	< 12	< 5	< 9	< 5	< 5	< 33	< 9	< 32
	06/25/08 - 06/25/08	< 47	< 53	< 5	< 5	< 11	< 5	< 12	< 5	< 9	< 4	< 5	< 36	< 12	< 38
	07/30/08 - 07/30/08	< 46	< 45	< 6	< 5	< 12	< 4	< 10	< 6	< 9	< 4	< 5	< 32	< 12	< 39
	08/27/08 - 08/27/08	< 17	28 ± 27	< 2	< 2	< 4	< 2	< 3	< 2	< 3	< 1	< 2	< 21	< 6	< 11
	09/24/08 - 09/24/08	< 20	< 18	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 2	< 2	< 19	< 6	< 16
	10/29/08 - 10/29/08	< 9	< 8	< 1	< 1	< 2	< 1	< 2	< 1	< 2	< 1	< 1	< 18	< 6	< 6
11/26/08 - 11/26/08	< 15	< 11	< 1	< 2	< 3	< 1	< 2	< 1	< 3	< 1	< 1	< 17	< 5	< 10	
MEAN		-	28 ± 0	-	-	-	-	-	-	-	-	-	-	-	-
CL-90	12/26/07 - 01/30/08	< 36	< 48	< 4	< 4	< 8	< 4	< 9	< 3	< 8	< 3	< 4	< 14	< 5	< 30
	01/30/08 - 02/27/08	< 28	< 29	< 3	< 3	< 7	< 4	< 8	< 3	< 6	< 3	< 3	< 16	< 6	< 20
	02/27/08 - 03/26/08	< 47	< 119	< 5	< 6	< 11	< 6	< 10	< 7	< 11	< 5	< 6	< 23	< 9	< 43
	03/26/08 - 04/30/08	< 63	71 ± 62	< 6	< 6	< 14	< 7	< 13	< 7	< 10	< 5	< 6	< 31	< 12	< 47
	04/30/08 - 05/28/08	< 43	< 83	< 4	< 5	< 8	< 5	< 9	< 4	< 9	< 4	< 5	< 25	< 9	< 33
	05/28/08 - 06/25/08	< 45	< 38	< 5	< 5	< 11	< 4	< 8	< 6	< 8	< 5	< 5	< 32	< 9	< 42
	06/25/08 - 07/30/08	< 39	< 34	< 4	< 4	< 8	< 4	< 8	< 5	< 6	< 4	< 4	< 27	< 6	< 37
	07/30/08 - 08/27/08	< 16	< 11	< 1	< 1	< 3	< 1	< 3	< 2	< 3	< 1	< 1	< 20	< 6	< 12
	08/27/08 - 09/24/08	< 17	< 15	< 1	< 2	< 4	< 2	< 3	< 2	< 3	< 2	< 2	< 17	< 6	< 12
	09/24/08 - 10/29/08	< 10	< 5	< 1	< 1	< 2	< 1	< 1	< 1	< 2	< 1	< 1	< 16	< 4	< 7
	10/29/08 - 11/26/08	< 20	< 16	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 2	< 2	< 20	< 6	< 14
11/26/08 - 12/31/08	< 30	< 22	< 3	< 3	< 7	< 3	< 6	< 3	< 6	< 3	< 3	< 26	< 9	< 22	
MEAN		-	71 ± 0	-	-	-	-	-	-	-	-	-	-	-	-

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

TABLE C-I.3

**CONCENTRATIONS OF GAMMA EMITTERS IN SURFACE WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/LITER  $\pm$  2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140	Ce-144	
C-3	CL-91 12/26/07 - 01/30/08	< 36	< 95	< 4	< 5	< 9	< 6	< 11	< 4	< 8	< 4	< 5	< 20	< 6	< 35	
	01/30/08 - 02/27/08	< 47	< 57	< 6	< 6	< 13	< 6	< 12	< 6	< 12	< 6	< 6	< 27	< 10	< 47	
	02/27/08 - 03/26/08	< 51	< 126	< 5	< 5	< 13	< 5	< 14	< 7	< 9	< 7	< 7	< 26	< 11	< 42	
	03/26/08 - 04/30/08	< 54	< 61	< 4	< 6	< 12	< 5	< 12	< 7	< 9	< 6	< 6	< 28	< 8	< 42	
	04/30/08 - 05/28/08	< 41	< 76	< 4	< 4	< 9	< 4	< 9	< 4	< 6	< 4	< 4	< 28	< 9	< 32	
	05/28/08 - 06/25/08	< 45	< 38	< 5	< 4	< 11	< 4	< 11	< 6	< 9	< 4	< 5	< 34	< 11	< 34	
	06/25/08 - 07/30/08	< 41	< 86	< 5	< 5	< 10	< 4	< 10	< 4	< 8	< 4	< 4	< 24	< 7	< 32	
	07/30/08 - 08/27/08	< 14	< 13	< 1	< 1	< 3	< 1	< 2	< 2	< 2	< 3	< 1	< 1	< 17	< 5	< 10
	08/27/08 - 09/24/08	< 19	< 15	< 2	< 2	< 5	< 2	< 4	< 2	< 2	< 4	< 2	< 2	< 19	< 6	< 14
	09/24/08 - 10/29/08	< 8	< 14	< 1	< 1	< 2	< 0	< 1	< 1	< 1	< 1	< 1	< 1	< 15	< 4	< 5
	10/29/08 - 11/26/08	< 13	< 35	< 1	< 1	< 3	< 1	< 3	< 2	< 3	< 1	< 1	< 1	< 18	< 6	< 9
11/26/08 - 12/31/08	< 31	< 30	< 3	< 3	< 7	< 3	< 3	< 6	< 4	< 6	< 3	< 3	< 29	< 8	< 22	
MEAN		-	-	-	-	-	-	-	-	-	-	-	-	-	-	
CL-99	12/26/07 - 01/30/08	< 50	194 $\pm$ 61	< 6	< 5	< 14	< 6	< 12	< 5	< 11	< 6	< 7	< 22	< 9	< 37	
	01/30/08 - 02/27/08	< 50	< 40	< 6	< 5	< 13	< 5	< 15	< 7	< 10	< 5	< 6	< 21	< 6	< 48	
	02/27/08 - 03/26/08	< 44	< 81	< 5	< 4	< 9	< 3	< 10	< 4	< 7	< 4	< 4	< 24	< 7	< 34	
	03/26/08 - 04/30/08	< 40	< 45	< 4	< 4	< 10	< 5	< 9	< 5	< 9	< 5	< 5	< 22	< 10	< 36	
	04/30/08 - 05/28/08	< 12	< 27	< 1	< 1	< 3	< 1	< 3	< 1	< 2	< 1	< 1	< 8	< 2	< 10	
	05/28/08 - 06/25/08	< 48	< 46	< 5	< 5	< 13	< 5	< 8	< 5	< 9	< 5	< 5	< 33	< 10	< 36	
	06/25/08 - 07/30/08	< 56	86 $\pm$ 75	< 4	< 5	< 11	< 5	< 12	< 6	< 11	< 5	< 6	< 35	< 13	< 46	
	07/30/08 - 08/27/08	< 16	< 11	< 1	< 2	< 4	< 1	< 3	< 2	< 3	< 1	< 1	< 22	< 6	< 12	
	08/27/08 - 09/24/08	< 17	38 $\pm$ 26	< 2	< 2	< 4	< 2	< 3	< 2	< 3	< 2	< 2	< 18	< 6	< 12	
	09/24/08 - 10/29/08	< 8	< 6	< 1	< 1	< 2	< 1	< 1	< 1	< 1	< 1	< 1	< 14	< 5	< 4	
	10/29/08 - 11/26/08	< 16	< 17	< 1	< 2	< 4	< 1	< 3	< 2	< 3	< 1	< 1	< 20	< 8	< 11	
11/26/08 - 12/31/08	< 30	< 25	< 3	< 3	< 8	< 3	< 3	< 6	< 3	< 6	< 3	< 3	< 26	< 9	< 23	
MEAN		-	106 $\pm$ 160	-	-	-	-	-	-	-	-	-	-	-	-	

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

**TABLE C-II.1****CONCENTRATIONS OF GROSS BETA IN DRINKING WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**RESULTS IN UNITS OF PCI/LITER  $\pm$  2 SIGMA

COLLECTION PERIOD	CL-14
12/26/07 - 01/30/08	< 2.1
01/30/08 - 02/27/08	< 2.0
02/27/08 - 03/26/08	< 1.9
03/26/08 - 04/30/08	< 1.8
04/30/08 - 05/28/08	4.1 $\pm$ 2.5
05/28/08 - 06/25/08	< 2.8
06/25/08 - 07/30/08	< 2.0
07/30/08 - 08/27/08	< 2.7
08/27/08 - 09/24/08	< 2.0
09/24/08 - 10/29/08	1.8 $\pm$ 1.2
10/29/08 - 11/26/08	< 1.8
11/26/08 - 12/31/08	< 1.9
MEAN	3.0 $\pm$ 3.3

**TABLE C-II.2****CONCENTRATIONS OF TRITIUM IN DRINKING WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**RESULTS IN UNITS OF PCI/LITER  $\pm$  2 SIGMA

COLLECTION PERIOD	CL-14
12/26/07 - 03/26/08	< 176
03/26/08 - 06/25/08	< 197
06/25/08 - 09/24/08	< 149
09/24/08 - 12/31/08	< 179
MEAN	-

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

TABLE C-II.3

CONCENTRATIONS OF GAMMA EMITTERS IN DRINKING WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140	Ce-144
C-5 CL-14	12/26/07 - 01/30/08	< 47	183 ± 67	< 5	< 5	< 11	< 5	< 11	< 5	< 9	< 6	< 5	< 5	< 20	< 7	< 40
	01/30/08 - 02/27/08	< 55	< 54	< 5	< 7	< 11	< 5	< 12	< 6	< 9	< 10	< 5	< 5	< 23	< 9	< 42
	02/27/08 - 03/26/08	< 49	< 61	< 4	< 5	< 13	< 6	< 11	< 5	< 10	< 9	< 6	< 6	< 26	< 10	< 34
	03/26/08 - 04/30/08	< 43	< 127	< 6	< 6	< 15	< 6	< 15	< 7	< 10	< 9	< 6	< 7	< 27	< 9	< 44
	04/30/08 - 05/28/08	< 47	< 62	< 5	< 5	< 11	< 6	< 11	< 5	< 10	< 13	< 4	< 6	< 27	< 9	< 36
	05/28/08 - 06/25/08	< 47	< 103	< 4	< 5	< 14	< 7	< 11	< 6	< 9	< 14	< 5	< 6	< 34	< 14	< 35
	06/25/08 - 07/30/08	< 43	< 26	< 4	< 5	< 9	< 5	< 11	< 5	< 8	< 11	< 4	< 5	< 29	< 8	< 38
	07/30/08 - 08/27/08	< 15	< 29	< 1	< 2	< 4	< 1	< 3	< 2	< 3	< 12	< 1	< 1	< 18	< 6	< 10
	08/27/08 - 09/24/08	< 20	< 35	< 2	< 2	< 4	< 2	< 4	< 2	< 4	< 12	< 2	< 2	< 20	< 6	< 18
	09/24/08 - 10/29/08	< 9	< 20	< 1	< 1	< 2	< 1	< 1	< 1	< 2	< 15	< 1	< 1	< 17	< 4	< 5
	10/29/08 - 11/26/08	< 19	< 41	< 1	< 2	< 3	< 2	< 3	< 2	< 4	< 13	< 1	< 2	< 22	< 5	< 13
11/26/08 - 12/31/08	< 28	< 55	< 3	< 3	< 7	< 3	< 6	< 3	< 6	< 15	< 3	< 3	< 27	< 8	< 21	
MEAN		-	183 ± 0	-	-	-	-	-	-	-	-	-	-	-	-	-

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

TABLE C-III.1

CONCENTRATIONS OF TRITIUM IN GROUND WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

COLLECTION PERIOD	CL-07D	CL-12R	CL-12T
03/26/08 - 03/26/08	< 162	< 167	< 191
06/25/08 - 06/25/08	< 175	< 181	< 174
09/24/08 - 09/24/08	< 151	< 143	< 150
12/31/08 - 12/31/08	< 187	< 198	< 194
MEAN	-	-	-



TABLE C-III.2

**CONCENTRATIONS OF GAMMA EMITTERS IN GROUND WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/LITER  $\pm$  2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140	Ce-144
CL-07D	03/26/08	< 45	< 50	< 4	< 6	< 9	< 4	< 10	< 6	< 10	< 5	< 6	< 27	< 9	< 45
	06/25/08	< 25	< 55	< 3	< 3	< 6	< 3	< 5	< 3	< 5	< 3	< 3	< 14	< 5	< 21
	09/24/08	< 18	< 17	< 2	< 2	< 5	< 2	< 4	< 2	< 3	< 2	< 2	< 18	< 6	< 13
	12/31/08	< 14	< 21	< 1	< 1	< 3	< 1	< 3	< 2	< 3	< 1	< 1	< 13	< 4	< 11
	MEAN	-	-	-	-	-	-	-	-	-	-	-	-	-	-
CL-12R	03/26/08	< 53	< 52	< 5	< 6	< 10	< 6	< 10	< 6	< 10	< 5	< 6	< 27	< 11	< 43
	06/25/08	< 30	< 70	< 3	< 4	< 7	< 4	< 7	< 4	< 7	< 3	< 4	< 18	< 6	< 24
	09/24/08	< 20	< 17	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 2	< 2	< 20	< 6	< 16
	12/31/08	< 17	< 15	< 2	< 2	< 4	< 1	< 3	< 2	< 3	< 1	< 2	< 16	< 5	< 12
	MEAN	-	-	-	-	-	-	-	-	-	-	-	-	-	-
CL-12T	03/26/08	< 55	< 115	< 6	< 6	< 15	< 5	< 14	< 7	< 13	< 5	< 6	< 30	< 9	< 42
	06/25/08	< 28	< 69	< 3	< 3	< 8	< 4	< 6	< 4	< 6	< 3	< 3	< 16	< 6	< 24
	09/24/08	< 14	< 10	< 1	< 1	< 3	< 1	< 2	< 1	< 2	< 1	< 1	< 14	< 4	< 11
	12/31/08	< 16	< 33	< 2	< 2	< 4	< 2	< 3	< 2	< 3	< 1	< 2	< 16	< 5	< 12
	MEAN	-	-	-	-	-	-	-	-	-	-	-	-	-	-

TABLE C-IV.1

**CONCENTRATIONS OF GAMMA EMITTERS IN FISH SAMPLES COLLECTED IN THE VICINITY  
OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/KG WET  $\pm$  2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140	Ce-144
<b>CL-105</b>															
Bluegill	04/23/08	< 212	3160 $\pm$ 695	< 23	< 30	< 54	< 29	< 49	< 31	< 45	< 25	< 24	< 176	< 51	< 130
Carp	04/23/08	< 291	3140 $\pm$ 559	< 33	< 33	< 84	< 37	< 71	< 41	< 65	< 40	< 35	< 284	< 72	< 200
Crappie	04/23/08	< 372	3230 $\pm$ 810	< 56	< 46	< 107	< 44	< 102	< 55	< 83	< 39	< 52	< 290	< 118	< 229
Largemouth Bass	04/23/08	< 247	3370 $\pm$ 707	< 33	< 36	< 89	< 38	< 88	< 44	< 54	< 35	< 39	< 276	< 56	< 208
Bluegill	10/09/08	< 461	2740 $\pm$ 648	< 45	< 43	< 134	< 23	< 102	< 50	< 82	< 40	< 39	< 1140	< 315	< 239
Carp	10/09/08	< 482	3220 $\pm$ 691	< 37	< 56	< 117	< 45	< 87	< 62	< 96	< 41	< 41	< 1030	< 428	< 239
Crappie	10/09/08	< 590	3380 $\pm$ 726	< 54	< 61	< 130	< 47	< 106	< 66	< 126	< 45	< 46	< 1240	< 346	< 248
Largemouth Bass	10/09/08	< 603	2260 $\pm$ 774	< 40	< 55	< 114	< 34	< 96	< 62	< 106	< 45	< 40	< 1140	< 352	< 265
	MEAN	-	3063 $\pm$ 760	-	-	-	-	-	-	-	-	-	-	-	-
<b>CL-19</b>															
Bluegill	04/23/08	< 404	2880 $\pm$ 781	< 47	< 46	< 115	< 51	< 94	< 55	< 98	< 50	< 51	< 240	< 119	< 259
Carp	04/23/08	< 273	3600 $\pm$ 579	< 29	< 28	< 65	< 33	< 66	< 41	< 58	< 32	< 34	< 225	< 61	< 194
Channel Catfish	04/23/08	< 282	3120 $\pm$ 554	< 35	< 31	< 63	< 38	< 74	< 40	< 61	< 29	< 33	< 186	< 79	< 159
Largemouth Bass	04/23/08	< 406	3650 $\pm$ 770	< 42	< 46	< 111	< 37	< 104	< 50	< 99	< 43	< 52	< 315	< 90	< 240
Bluegill	10/09/08	< 489	3270 $\pm$ 722	< 40	< 53	< 127	< 37	< 89	< 62	< 93	< 34	< 44	< 1140	< 311	< 276
Carp	10/09/08	< 335	2410 $\pm$ 660	< 36	< 35	< 125	< 47	< 64	< 48	< 70	< 36	< 34	< 896	< 321	< 202
Channel Catfish	10/09/08	< 472	3190 $\pm$ 760	< 38	< 54	< 133	< 20	< 94	< 58	< 91	< 47	< 41	< 1200	< 245	< 230
Largemouth Bass	10/09/08	< 586	2920 $\pm$ 661	< 49	< 69	< 151	< 42	< 112	< 84	< 120	< 43	< 52	< 1170	< 409	< 300
	MEAN	-	3130 $\pm$ 807	-	-	-	-	-	-	-	-	-	-	-	-

TABLE C-V.1

CONCENTRATIONS OF GAMMA EMITTERS IN SEDIMENT SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008

RESULTS IN UNITS OF PCI/KG DRY ± SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140	Ce-144
CL-07B	04/23/08	< 345	9860 ± 916	< 39	< 37	< 78	< 33	< 96	< 48	< 74	< 35	< 39	< 205	< 52	< 193
	10/09/08	< 325	6980 ± 698	< 37	< 38	< 109	< 29	< 80	< 45	< 75	< 29	< 31	< 448	< 107	< 161
	MEAN	-	8420 ± 4073	-	-	-	-	-	-	-	-	-	-	-	-

TABLE C-VI.1

**CONCENTRATIONS OF GROSS BETA IN AIR PARTICULATE SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2007**

RESULTS IN UNITS OF E-3 PCI/CU METER  $\pm$  2 SIGMA

COLLECTION PERIOD	GROUP I					
	CL-02	CL-03	CL-04	CL-06	CL-15	CL-94
01/02/08 - 01/09/08	20 $\pm$ 4	27 $\pm$ 5	25 $\pm$ 5	20 $\pm$ 4	20 $\pm$ 5	26 $\pm$ 5
01/09/08 - 01/16/08	32 $\pm$ 5	32 $\pm$ 5	34 $\pm$ 5	33 $\pm$ 5	31 $\pm$ 5	32 $\pm$ 5
01/16/08 - 01/23/08	28 $\pm$ 5	27 $\pm$ 5	29 $\pm$ 5	22 $\pm$ 5	28 $\pm$ 5	27 $\pm$ 5
01/23/08 - 01/30/08	32 $\pm$ 5	32 $\pm$ 5	35 $\pm$ 5	35 $\pm$ 5	34 $\pm$ 5	32 $\pm$ 5
01/30/08 - 02/06/08	19 $\pm$ 4	20 $\pm$ 4	22 $\pm$ 5	21 $\pm$ 4	22 $\pm$ 5	25 $\pm$ 5
02/06/08 - 02/13/08	30 $\pm$ 5	29 $\pm$ 5	28 $\pm$ 5	26 $\pm$ 5	31 $\pm$ 5	31 $\pm$ 5
02/13/08 - 02/20/08	23 $\pm$ 5	28 $\pm$ 5	23 $\pm$ 5	29 $\pm$ 5	24 $\pm$ 5	27 $\pm$ 5
02/20/08 - 02/27/08	15 $\pm$ 4	25 $\pm$ 14	16 $\pm$ 4	14 $\pm$ 4	16 $\pm$ 4	16 $\pm$ 4
02/27/08 - 03/05/08	17 $\pm$ 4	20 $\pm$ 5	19 $\pm$ 4	17 $\pm$ 4	17 $\pm$ 4	18 $\pm$ 4
03/05/08 - 03/12/08	28 $\pm$ 5	26 $\pm$ 5	26 $\pm$ 5	24 $\pm$ 5	27 $\pm$ 5	24 $\pm$ 5
03/12/08 - 03/19/08	16 $\pm$ 4	19 $\pm$ 4	17 $\pm$ 4	16 $\pm$ 4	16 $\pm$ 4	16 $\pm$ 4
03/19/08 - 03/26/08	14 $\pm$ 4	17 $\pm$ 4	13 $\pm$ 4	11 $\pm$ 4	15 $\pm$ 4	12 $\pm$ 4
03/26/08 - 04/02/08	12 $\pm$ 4	13 $\pm$ 4	11 $\pm$ 4	10 $\pm$ 4	9 $\pm$ 4	14 $\pm$ 4
04/02/08 - 04/09/08	14 $\pm$ 4	16 $\pm$ 4	12 $\pm$ 4	16 $\pm$ 4	16 $\pm$ 4	17 $\pm$ 4
04/09/08 - 04/16/08	9 $\pm$ 4	9 $\pm$ 3	11 $\pm$ 4	9 $\pm$ 3	11 $\pm$ 4	10 $\pm$ 4
04/16/08 - 04/23/08	16 $\pm$ 4	20 $\pm$ 4	19 $\pm$ 4	17 $\pm$ 4	21 $\pm$ 4	17 $\pm$ 4
04/23/08 - 04/30/08	20 $\pm$ 5	17 $\pm$ 5	15 $\pm$ 4	13 $\pm$ 5	16 $\pm$ 4	18 $\pm$ 4
04/30/08 - 05/07/08	13 $\pm$ 4	16 $\pm$ 4	14 $\pm$ 4	16 $\pm$ 4	16 $\pm$ 4	15 $\pm$ 4
05/07/08 - 05/14/08	8 $\pm$ 4	< 5	8 $\pm$ 4	9 $\pm$ 4	7 $\pm$ 4	9 $\pm$ 4
05/14/08 - 05/21/08	12 $\pm$ 4	11 $\pm$ 4	12 $\pm$ 4	13 $\pm$ 4	10 $\pm$ 4	8 $\pm$ 3
05/21/08 - 05/28/08	6 $\pm$ 3	8 $\pm$ 4	9 $\pm$ 3	6 $\pm$ 3	10 $\pm$ 4	8 $\pm$ 3
05/28/08 - 06/04/08	16 $\pm$ 5	17 $\pm$ 5	18 $\pm$ 5	15 $\pm$ 5	10 $\pm$ 4	17 $\pm$ 5
06/04/08 - 06/11/08	12 $\pm$ 4	8 $\pm$ 4	11 $\pm$ 4	9 $\pm$ 4	10 $\pm$ 4	11 $\pm$ 4
06/11/08 - 06/18/08	10 $\pm$ 4	15 $\pm$ 4	10 $\pm$ 4	12 $\pm$ 4	12 $\pm$ 4	13 $\pm$ 4
06/18/08 - 06/25/08	16 $\pm$ 4	16 $\pm$ 4	15 $\pm$ 4	20 $\pm$ 4	12 $\pm$ 4	15 $\pm$ 4
06/25/08 - 07/02/08	11 $\pm$ 4	15 $\pm$ 4	10 $\pm$ 4	15 $\pm$ 4	10 $\pm$ 4	11 $\pm$ 4
07/02/08 - 07/09/08	11 $\pm$ 4	16 $\pm$ 4	12 $\pm$ 4	11 $\pm$ 4	10 $\pm$ 4	16 $\pm$ 4
07/09/08 - 07/16/08	17 $\pm$ 4	19 $\pm$ 4	16 $\pm$ 4	14 $\pm$ 4	12 $\pm$ 4	29 $\pm$ 8
07/16/08 - 07/23/08	27 $\pm$ 5	22 $\pm$ 5	21 $\pm$ 5	29 $\pm$ 5	22 $\pm$ 5	22 $\pm$ 5
07/23/08 - 07/30/08	13 $\pm$ 4	15 $\pm$ 4	16 $\pm$ 4	17 $\pm$ 4	15 $\pm$ 4	20 $\pm$ 4
07/30/08 - 08/06/08	18 $\pm$ 4	24 $\pm$ 5	19 $\pm$ 4	23 $\pm$ 4	21 $\pm$ 4	21 $\pm$ 4
08/06/08 - 08/13/08	17 $\pm$ 4	20 $\pm$ 4	17 $\pm$ 4	18 $\pm$ 4	17 $\pm$ 4	18 $\pm$ 4
08/13/08 - 08/20/08	19 $\pm$ 4	24 $\pm$ 4	21 $\pm$ 4	24 $\pm$ 5	22 $\pm$ 4	20 $\pm$ 4
08/20/08 - 08/27/08	23 $\pm$ 4	22 $\pm$ 4	24 $\pm$ 4	22 $\pm$ 4	20 $\pm$ 4	25 $\pm$ 5
08/27/08 - 09/03/08	27 $\pm$ 5	28 $\pm$ 5	26 $\pm$ 5	28 $\pm$ 5	23 $\pm$ 5	28 $\pm$ 5
09/03/08 - 09/10/08	17 $\pm$ 4	16 $\pm$ 4	21 $\pm$ 5	19 $\pm$ 4	14 $\pm$ 4	22 $\pm$ 5
09/10/08 - 09/17/08	14 $\pm$ 4	14 $\pm$ 4	13 $\pm$ 4	13 $\pm$ 4	8 $\pm$ 4	15 $\pm$ 4
09/17/08 - 09/24/08	34 $\pm$ 5	29 $\pm$ 5	30 $\pm$ 5	31 $\pm$ 6	32 $\pm$ 5	34 $\pm$ 5
09/24/08 - 10/01/08	37 $\pm$ 6	37 $\pm$ 5	39 $\pm$ 6	37 $\pm$ 6	29 $\pm$ 5	38 $\pm$ 6
10/01/08 - 10/08/08	23 $\pm$ 5	22 $\pm$ 5	21 $\pm$ 5	21 $\pm$ 5	20 $\pm$ 5	24 $\pm$ 5
10/08/08 - 10/15/08	16 $\pm$ 4	15 $\pm$ 4	16 $\pm$ 4	15 $\pm$ 4	15 $\pm$ 4	19 $\pm$ 4
10/15/08 - 10/22/08	13 $\pm$ 4	14 $\pm$ 4	15 $\pm$ 4	18 $\pm$ 4	15 $\pm$ 4	18 $\pm$ 4
10/22/08 - 10/29/08	8 $\pm$ 4	13 $\pm$ 4	11 $\pm$ 4	12 $\pm$ 4	11 $\pm$ 4	10 $\pm$ 4
10/29/08 - 11/05/08	34 $\pm$ 5	34 $\pm$ 5	31 $\pm$ 5	34 $\pm$ 5	31 $\pm$ 5	30 $\pm$ 5
11/05/08 - 11/12/08	14 $\pm$ 4	11 $\pm$ 4	15 $\pm$ 4	13 $\pm$ 4	14 $\pm$ 4	15 $\pm$ 4
11/12/08 - 11/19/08	19 $\pm$ 5	18 $\pm$ 4	21 $\pm$ 5	16 $\pm$ 4	17 $\pm$ 4	22 $\pm$ 5
11/19/08 - 11/26/08	21 $\pm$ 5	22 $\pm$ 5	19 $\pm$ 4	18 $\pm$ 4	18 $\pm$ 4	17 $\pm$ 4
11/26/08 - 12/03/08	20 $\pm$ 5	23 $\pm$ 5	19 $\pm$ 5	25 $\pm$ 5	21 $\pm$ 5	18 $\pm$ 4
12/03/08 - 12/10/08	22 $\pm$ 4	24 $\pm$ 5	21 $\pm$ 4	22 $\pm$ 4	19 $\pm$ 4	23 $\pm$ 5
12/10/08 - 12/17/08	26 $\pm$ 5	29 $\pm$ 5	20 $\pm$ 5	25 $\pm$ 5	26 $\pm$ 5	28 $\pm$ 5
12/17/08 - 12/24/08	31 $\pm$ 5	28 $\pm$ 5	28 $\pm$ 5	35 $\pm$ 4	31 $\pm$ 5	30 $\pm$ 5
12/24/08 - 12/31/08	33 $\pm$ 5	31 $\pm$ 5	26 $\pm$ 5	19 $\pm$ 6	28 $\pm$ 5	34 $\pm$ 5
MEAN	19 $\pm$ 16	21 $\pm$ 14	19 $\pm$ 14	19 $\pm$ 15	18 $\pm$ 15	20 $\pm$ 15

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

TABLE C-VI.1

**CONCENTRATIONS OF GROSS BETA IN AIR PARTICULATE SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2007**

RESULTS IN UNITS OF E-3 PCI/CU METER  $\pm$  2 SIGMA

COLLECTION PERIOD	GROUP II		GROUP III	
	CL-01	CL-07	CL-08	CL-11 **
01/02/08 - 01/09/08	25 $\pm$ 5	23 $\pm$ 5	23 $\pm$ 5	25 $\pm$ 5
01/09/08 - 01/16/08	32 $\pm$ 5	33 $\pm$ 5	29 $\pm$ 5	31 $\pm$ 5
01/16/08 - 01/23/08	23 $\pm$ 5	27 $\pm$ 5	30 $\pm$ 5	28 $\pm$ 5
01/23/08 - 01/30/08	32 $\pm$ 5	30 $\pm$ 5	29 $\pm$ 5	28 $\pm$ 5
01/30/08 - 02/06/08	27 $\pm$ 5	14 $\pm$ 4	19 $\pm$ 4	23 $\pm$ 5
02/06/08 - 02/13/08	28 $\pm$ 5	25 $\pm$ 5	28 $\pm$ 5	29 $\pm$ 5
02/13/08 - 02/20/08	25 $\pm$ 5	28 $\pm$ 5	26 $\pm$ 5	23 $\pm$ 5
02/20/08 - 02/27/08	15 $\pm$ 4	13 $\pm$ 4	14 $\pm$ 4	16 $\pm$ 4
02/27/08 - 03/05/08	19 $\pm$ 4	19 $\pm$ 4	22 $\pm$ 4	20 $\pm$ 4
03/05/08 - 03/12/08	24 $\pm$ 5	23 $\pm$ 5	27 $\pm$ 5	25 $\pm$ 5
03/12/08 - 03/19/08	17 $\pm$ 4	17 $\pm$ 4	15 $\pm$ 4	17 $\pm$ 4
03/19/08 - 03/26/08	14 $\pm$ 4	14 $\pm$ 4	16 $\pm$ 4	11 $\pm$ 4
03/26/08 - 04/02/08	13 $\pm$ 4	11 $\pm$ 4	14 $\pm$ 4	11 $\pm$ 4
04/02/08 - 04/09/08	16 $\pm$ 4	16 $\pm$ 4	16 $\pm$ 4	15 $\pm$ 4
04/09/08 - 04/16/08	9 $\pm$ 4	8 $\pm$ 3	10 $\pm$ 4	8 $\pm$ 3
04/16/08 - 04/23/08	15 $\pm$ 4	16 $\pm$ 4	21 $\pm$ 4	19 $\pm$ 4
04/23/08 - 04/30/08	21 $\pm$ 5	16 $\pm$ 4	16 $\pm$ 4	14 $\pm$ 4
04/30/08 - 05/07/08	16 $\pm$ 4	11 $\pm$ 4	13 $\pm$ 4	15 $\pm$ 4
05/07/08 - 05/14/08	9 $\pm$ 4	9 $\pm$ 4	10 $\pm$ 4	9 $\pm$ 4
05/14/08 - 05/21/08	16 $\pm$ 4	11 $\pm$ 4	15 $\pm$ 4	13 $\pm$ 4
05/21/08 - 05/28/08	< 4	7 $\pm$ 3	8 $\pm$ 3	9 $\pm$ 3
05/28/08 - 06/04/08	16 $\pm$ 4	15 $\pm$ 5	19 $\pm$ 5	17 $\pm$ 5
06/04/08 - 06/11/08	12 $\pm$ 4	9 $\pm$ 4	8 $\pm$ 4	10 $\pm$ 4
06/11/08 - 06/18/08	13 $\pm$ 4	15 $\pm$ 4	15 $\pm$ 4	18 $\pm$ 4
06/18/08 - 06/25/08	14 $\pm$ 4	12 $\pm$ 4	14 $\pm$ 4	17 $\pm$ 4
06/25/08 - 07/02/08	10 $\pm$ 4	11 $\pm$ 4	13 $\pm$ 4	12 $\pm$ 4
07/02/08 - 07/09/08	10 $\pm$ 4	12 $\pm$ 4	12 $\pm$ 4	16 $\pm$ 4
07/09/08 - 07/16/08	12 $\pm$ 4	12 $\pm$ 4	17 $\pm$ 4	17 $\pm$ 4
07/16/08 - 07/23/08	22 $\pm$ 5	24 $\pm$ 5	22 $\pm$ 5	110 $\pm$ 21 (1)
07/23/08 - 07/30/08	15 $\pm$ 4	15 $\pm$ 4	16 $\pm$ 4	14 $\pm$ 4
07/30/08 - 08/06/08	18 $\pm$ 4	21 $\pm$ 4	18 $\pm$ 4	18 $\pm$ 4
08/06/08 - 08/13/08	18 $\pm$ 4	10 $\pm$ 4	20 $\pm$ 4	19 $\pm$ 4
08/13/08 - 08/20/08	19 $\pm$ 4	20 $\pm$ 4	25 $\pm$ 5	26 $\pm$ 5
08/20/08 - 08/27/08	15 $\pm$ 4	18 $\pm$ 4	19 $\pm$ 4	25 $\pm$ 5
08/27/08 - 09/03/08	29 $\pm$ 5	26 $\pm$ 5	28 $\pm$ 5	33 $\pm$ 5
09/03/08 - 09/10/08	15 $\pm$ 4	16 $\pm$ 4	21 $\pm$ 5	15 $\pm$ 4
09/10/08 - 09/17/08	13 $\pm$ 4	11 $\pm$ 4	14 $\pm$ 4	15 $\pm$ 4
09/17/08 - 09/24/08	28 $\pm$ 5	31 $\pm$ 5	33 $\pm$ 5	28 $\pm$ 5
09/24/08 - 10/01/08	29 $\pm$ 5	32 $\pm$ 5	35 $\pm$ 5	39 $\pm$ 6
10/01/08 - 10/08/08	24 $\pm$ 5	18 $\pm$ 4	23 $\pm$ 5	25 $\pm$ 5
10/08/08 - 10/15/08	19 $\pm$ 4	12 $\pm$ 4	15 $\pm$ 4	19 $\pm$ 4
10/15/08 - 10/22/08	19 $\pm$ 4	17 $\pm$ 4	12 $\pm$ 4	14 $\pm$ 4
10/22/08 - 10/29/08	14 $\pm$ 4	11 $\pm$ 4	8 $\pm$ 4	10 $\pm$ 4
10/29/08 - 11/05/08	29 $\pm$ 5	28 $\pm$ 5	32 $\pm$ 5	27 $\pm$ 5
11/05/08 - 11/12/08	14 $\pm$ 4	12 $\pm$ 4	14 $\pm$ 4	13 $\pm$ 4
11/12/08 - 11/19/08	22 $\pm$ 5	17 $\pm$ 4	21 $\pm$ 5	16 $\pm$ 4
11/19/08 - 11/26/08	19 $\pm$ 4	20 $\pm$ 4	17 $\pm$ 4	21 $\pm$ 4
11/26/08 - 12/03/08	17 $\pm$ 4	19 $\pm$ 5	19 $\pm$ 4	20 $\pm$ 5
12/03/08 - 12/10/08	27 $\pm$ 5	20 $\pm$ 4	19 $\pm$ 4	22 $\pm$ 5
12/10/08 - 12/17/08	20 $\pm$ 5	29 $\pm$ 5	24 $\pm$ 5	26 $\pm$ 5
12/17/08 - 12/24/08	30 $\pm$ 5	< 4	34 $\pm$ 5	32 $\pm$ 5
12/24/08 - 12/31/08	28 $\pm$ 5	55 $\pm$ 6	34 $\pm$ 5	30 $\pm$ 5
MEAN	19 $\pm$ 13	18 $\pm$ 17	20 $\pm$ 15	21 $\pm$ 29

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

\*\* INDICATES CONTROL STATION

(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

TABLE C-VI.2

MONTHLY AND YEARLY MEAN VALUES OF GROSS BETA CONCENTRATIONS IN AIR PARTICULATE SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

GROUP I* - ON-SITE LOCATIONS				GROUP II** - INTERMEDIATE DISTANCE LOCATIONS				GROUP III*** - CONTROL LOCATIONS			
COLLECTION PERIOD	MIN	MAX	MEAN ± 2SD	COLLECTION PERIOD	MIN	MAX	MEAN ± 2SD	COLLECTION PERIOD	MIN	MAX	MEAN ± 2SD
01/02/08 - 01/30/08	20	35	29 ± 9	01/02/08 - 01/30/08	23	33	28 ± 7	01/02/08 - 01/30/08	25	31	28 ± 5
01/30/08 - 02/27/08	14	31	23 ± 11	01/30/08 - 02/27/08	13	28	22 ± 12	01/30/08 - 02/27/08	16	29	23 ± 11
02/27/08 - 04/02/08	9	28	17 ± 10	02/27/08 - 04/02/08	11	27	18 ± 9	02/27/08 - 04/02/08	11	25	17 ± 12
04/02/08 - 04/30/08	9	21	15 ± 7	04/02/08 - 04/30/08	8	21	15 ± 8	04/02/08 - 04/30/08	8	19	14 ± 10
04/30/08 - 05/28/08	< 5	16	11 ± 6	04/30/08 - 05/28/08	< 4	16	11 ± 6	04/30/08 - 05/28/08	9	15	11 ± 6
05/28/08 - 07/02/08	8	20	13 ± 6	05/28/08 - 07/02/08	8	19	13 ± 5	05/28/08 - 07/02/08	10	18	15 ± 7
07/02/08 - 07/30/08	10	29	17 ± 11	07/02/08 - 07/30/08	10	24	16 ± 9	07/02/08 - 07/30/08	14	110	39 ± 94
07/30/08 - 09/03/08	17	28	22 ± 7	07/30/08 - 09/03/08	10	29	20 ± 10	07/30/08 - 09/03/08	18	33	24 ± 12
09/03/08 - 10/01/08	8	39	25 ± 20	09/03/08 - 10/01/08	11	35	23 ± 18	09/03/08 - 10/01/08	15	39	24 ± 24
10/01/08 - 10/29/08	8	24	16 ± 9	10/01/08 - 10/29/08	8	24	16 ± 10	10/01/08 - 10/29/08	10	25	17 ± 13
10/29/08 - 12/03/08	11	34	21 ± 13	10/29/08 - 12/03/08	12	32	20 ± 11	10/29/08 - 12/03/08	13	27	20 ± 11
12/03/08 - 12/31/08	19	35	27 ± 9	12/03/08 - 12/31/08	< 4	55	29 ± 20	12/03/08 - 12/31/08	22	32	27 ± 9
01/02/08 - 12/31/08	< 5	39	20 ± 15	01/02/08 - 12/31/08	< 4	55	19 ± 15	01/02/08 - 12/31/08	8	110	21 ± 29

\* GROUP I LOCATIONS WITHIN 1 MILES OF CPS

\*\* GROUP II LOCATIONS WITHIN 1-5 MILES OF CPS

\*\*\* GROUP III LOCATIONS GREATER THAN 5 MILES OF CPS

TABLE C-VI.3

**CONCENTRATIONS OF GAMMA EMITTERS IN AIR PARTICULATE SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF E-3 PCI/CU METER  $\pm$  2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Co-60	Nb-95	Zr-95	Ru-103	Ru-106	Cs-134	Cs-137	Ce-141	Ce-144
CL-01	01/02/08 - 04/02/08	55 $\pm$ 28	< 42	< 3	< 5	< 9	< 8	< 26	< 3	< 2	< 11	< 13
	04/02/08 - 07/02/08	103 $\pm$ 25	< 34	< 3	< 3	< 4	< 4	< 23	< 3	< 2	< 5	< 11
	07/02/08 - 10/01/08	< 75	< 42	< 2	< 6	< 12	< 16	< 20	< 3	< 2	< 23	< 13
	10/01/08 - 12/31/08	63 $\pm$ 21	< 42	< 2	< 3	< 5	< 3	< 23	< 3	< 2	< 4	< 12
	MEAN	73 $\pm$ 52	-	-	-	-	-	-	-	-	-	-
CL-02	01/02/08 - 04/02/08	61 $\pm$ 24	< 43	< 2	< 5	< 7	< 5	< 19	< 3	< 2	< 11	< 13
	04/02/08 - 07/02/08	82 $\pm$ 33	< 57	< 3	< 5	< 8	< 5	< 27	< 4	< 3	< 8	< 17
	07/02/08 - 10/01/08	120 $\pm$ 104	< 69	< 5	< 11	< 15	< 25	< 34	< 4	< 3	< 36	< 18
	10/01/08 - 12/31/08	71 $\pm$ 22	< 55	< 4	< 5	< 8	< 5	< 28	< 4	< 3	< 5	< 15
	MEAN	84 $\pm$ 52	-	-	-	-	-	-	-	-	-	-
CL-03	01/02/08 - 04/02/08	116 $\pm$ 42	< 52	< 2	< 7	< 8	< 11	< 40	< 4	< 4	< 18	< 19
	04/02/08 - 07/02/08	134 $\pm$ 29	< 16	< 3	< 3	< 6	< 3	< 18	< 2	< 2	< 5	< 11
	07/02/08 - 10/01/08	130 $\pm$ 56	< 45	< 3	< 10	< 14	< 17	< 34	< 4	< 3	< 32	< 14
	10/01/08 - 12/31/08	68 $\pm$ 18	< 28	< 2	< 2	< 5	< 3	< 24	< 2	< 2	< 4	< 10
	MEAN	112 $\pm$ 60	-	-	-	-	-	-	-	-	-	-
CL-04	01/02/08 - 04/02/08	48 $\pm$ 30	< 52	< 2	< 5	< 7	< 6	< 24	< 3	< 2	< 10	< 12
	04/02/08 - 07/02/08	123 $\pm$ 37	< 58	< 2	< 6	< 9	< 6	< 35	< 3	< 3	< 7	< 16
	07/02/08 - 10/01/08	86 $\pm$ 71	< 44	< 4	< 8	< 16	< 17	< 23	< 3	< 3	< 33	< 15
	10/01/08 - 12/31/08	53 $\pm$ 30	< 52	< 3	< 4	< 5	< 4	< 28	< 4	< 3	< 7	< 17
	MEAN	78 $\pm$ 70	-	-	-	-	-	-	-	-	-	-
CL-06	01/02/08 - 04/02/08	71 $\pm$ 30	< 62	< 5	< 6	< 11	< 9	< 30	< 3	< 3	< 13	< 16
	04/02/08 - 07/02/08	91 $\pm$ 28	< 38	< 3	< 4	< 6	< 4	< 23	< 3	< 2	< 7	< 12
	07/02/08 - 10/01/08	< 109	< 23	< 2	< 11	< 19	< 21	< 30	< 4	< 3	< 39	< 19
	10/01/08 - 12/31/08	56 $\pm$ 25	< 33	< 3	< 3	< 5	< 3	< 22	< 2	< 2	< 3	< 10
	MEAN	73 $\pm$ 36	-	-	-	-	-	-	-	-	-	-

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

TABLE C-VI.3

CONCENTRATIONS OF GAMMA EMITTERS IN AIR PARTICULATE SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Co-60	Nb-95	Zr-95	Ru-103	Ru-106	Cs-134	Cs-137	Ce-141	Ce-144
CL-07	01/02/08 - 04/02/08	< 43	< 39	< 2	< 5	< 8	< 7	< 28	< 3	< 2	< 10	< 12
	04/02/08 - 07/02/08	101 ± 26	< 24	< 3	< 3	< 6	< 5	< 25	< 3	< 2	< 6	< 12
	07/02/08 - 10/01/08	91 ± 53	< 27	< 3	< 8	< 17	< 16	< 24	< 3	< 2	< 29	< 13
	10/01/08 - 12/31/08	78 ± 34	< 61	< 4	< 4	< 9	< 4	< 24	< 4	< 3	< 6	< 14
	MEAN	90 ± 23	-	-	-	-	-	-	-	-	-	-
CL-08	01/02/08 - 04/02/08	103 ± 37	< 56	< 4	< 6	< 10	< 8	< 26	< 3	< 3	< 13	< 16
	04/02/08 - 07/02/08	103 ± 44	< 58	< 4	< 5	< 7	< 6	< 23	< 4	< 3	< 7	< 13
	07/02/08 - 10/01/08	186 ± 56	< 48	< 3	< 10	< 17	< 21	< 34	< 4	< 3	< 46	< 21
	10/01/08 - 12/31/08	59 ± 21	< 41	< 3	< 3	< 5	< 4	< 25	< 3	< 2	< 4	< 11
	MEAN	113 ± 106	-	-	-	-	-	-	-	-	-	-
CL-11**	01/02/08 - 04/02/08	73 ± 31	< 36	< 2	< 5	< 8	< 7	< 22	< 2	< 3	< 12	< 12
	04/02/08 - 07/02/08	104 ± 25	< 52	< 3	< 4	< 5	< 4	< 21	< 3	< 2	< 6	< 12
	07/02/08 - 10/01/08	< 95	< 43	< 3	< 10	< 15	< 17	< 32	< 3	< 3	< 24	< 12
	10/01/08 - 12/31/08	62 ± 24	< 49	< 2	< 3	< 5	< 4	< 20	< 3	< 3	< 5	< 12
	MEAN	80 ± 43	-	-	-	-	-	-	-	-	-	-
CL-15	01/02/08 - 04/02/08	118 ± 46	< 41	< 3	< 6	< 12	< 7	< 27	< 4	< 3	< 16	< 19
	04/02/08 - 07/02/08	84 ± 26	< 37	< 3	< 4	< 5	< 4	< 23	< 3	< 2	< 5	< 10
	07/02/08 - 10/01/08	< 120	< 57	< 3	< 14	< 23	< 23	< 39	< 4	< 2	< 37	< 17
	10/01/08 - 12/31/08	63 ± 30	< 48	< 2	< 4	< 8	< 5	< 32	< 3	< 3	< 6	< 17
	MEAN	88 ± 56	-	-	-	-	-	-	-	-	-	-
CL-94	01/02/08 - 04/02/08	62 ± 33	< 52	< 3	< 5	< 9	< 6	< 22	< 3	< 2	< 10	< 12
	04/02/08 - 07/02/08	108 ± 34	< 47	< 2	< 5	< 7	< 4	< 17	< 4	< 2	< 8	< 17
	07/02/08 - 10/01/08	< 82	< 21	< 3	< 8	< 17	< 18	< 30	< 3	< 2	< 30	< 14
	10/01/08 - 12/31/08	72 ± 18	< 53	< 3	< 3	< 5	< 3	< 20	< 2	< 2	< 4	< 11
	MEAN	81 ± 48	-	-	-	-	-	-	-	-	-	-

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

\*\* INDICATES CONTROL STATION

C-14



**TABLE C-VII.1 CONCENTRATIONS OF I-131 IN AIR IODINE SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

COLLECTION PERIOD	GROUP I					
	CL-02	CL-03	CL-04	CL-06	CL-15	CL-94
01/02/08 - 01/09/08	< 24	< 24	< 24	< 24	< 30	< 30
01/09/08 - 01/16/08	< 20	< 20	< 19	< 19	< 26	< 25
01/16/08 - 01/23/08	< 26	< 24	< 26	< 25	< 24	< 25
01/23/08 - 01/30/08	< 34	< 34	< 33	< 33	< 36	< 37
01/30/08 - 02/06/08	< 36	< 18	< 35	< 33	< 36	< 37
02/06/08 - 02/13/08	< 47	< 45	< 47	< 46	< 29	< 28
02/13/08 - 02/20/08	< 57	< 57	< 57	< 58	< 53	< 51
02/20/08 - 02/27/08	< 31	< 18	< 16	< 28	< 33	< 30
02/27/08 - 03/05/08	< 35	< 37	< 34	< 34	< 36	< 37
03/05/08 - 03/12/08	< 59	< 59	< 60	< 59	< 60	< 60
03/12/08 - 03/19/08	< 32	< 32	< 32	< 22	< 39	< 20
03/19/08 - 03/26/08	< 36	< 36	< 35	< 36	< 29	< 29
03/26/08 - 04/02/08	< 31	< 30	< 30	< 29	< 35	< 36
04/02/08 - 04/09/08	< 34	< 33	< 34	< 33	< 38	< 38
04/09/08 - 04/16/08	< 29	< 28	< 29	< 27	< 40	< 39
04/16/08 - 04/23/08	< 62	< 59	< 60	< 60	< 69	< 69
04/23/08 - 04/30/08	< 44	< 43	< 42	< 45	< 63	< 64
04/30/08 - 05/07/08	< 37	< 36	< 38	< 37	< 21	< 37
05/07/08 - 05/14/08	< 26	< 25	< 25	< 24	< 27	< 27
05/14/08 - 05/21/08	< 43	< 42	< 42	< 42	< 40	< 41
05/21/08 - 05/28/08	< 28	< 31	< 26	< 26	< 34	< 33
05/28/08 - 06/04/08	< 54	< 52	< 52	< 52	< 58	< 58
06/04/08 - 06/11/08	< 39	< 37	< 37	< 37	< 40	< 38
06/11/08 - 06/18/08	< 38	< 37	< 37	< 36	< 40	< 40
06/18/08 - 06/25/08	< 44	< 42	< 43	< 43	< 39	< 37
06/25/08 - 07/02/08	< 63	< 62	< 62	< 62	< 65	< 67
07/02/08 - 07/09/08	< 42	< 42	< 43	< 43	< 34	< 33
07/09/08 - 07/16/08	< 67	< 66	< 65	< 66	< 31	< 62
07/16/08 - 07/23/08	< 32	< 32	< 31	< 31	< 16	< 16
07/23/08 - 07/30/08	< 40	< 40	< 39	< 39	< 47	< 47
07/30/08 - 08/06/08	< 33	< 33	< 32	< 32	< 57	< 58
08/06/08 - 08/13/08	< 60	< 60	< 60	< 60	< 48	< 49
08/13/08 - 08/20/08	< 52	< 50	< 52	< 51	< 53	< 54
08/20/08 - 08/27/08	< 30	< 31	< 29	< 31	< 57	< 58
08/27/08 - 09/03/08	< 58	< 58	< 58	< 58	< 55	< 56
09/03/08 - 09/10/08	< 31	< 30	< 30	< 30	< 28	< 29
09/10/08 - 09/17/08	< 49	< 49	< 49	< 49	< 46	< 46
09/17/08 - 09/24/08	< 47	< 46	< 46	< 50	< 36	< 36
09/24/08 - 10/01/08	< 40	< 37	< 37	< 42	< 70	< 69
10/01/08 - 10/08/08	< 65	< 65	< 65	< 63	< 46	< 46
10/08/08 - 10/15/08	< 49	< 48	< 48	< 46	< 56	< 56
10/15/08 - 10/22/08	< 52	< 52	< 52	< 49	< 49	< 49
10/22/08 - 10/29/08	< 52	< 52	< 51	< 51	< 68	< 67
10/29/08 - 11/05/08	< 64	< 61	< 65	< 62	< 47	< 48
11/05/08 - 11/12/08	< 58	< 59	< 58	< 59	< 59	< 60
11/12/08 - 11/19/08	< 51	< 49	< 49	< 48	< 41	< 41
11/19/08 - 11/26/08	< 52	< 52	< 52	< 49	< 45	< 45
11/26/08 - 12/03/08	< 66	< 66	< 66	< 66	< 61	< 61
12/03/08 - 12/10/08	< 67	< 67	< 66	< 65	< 53	< 53
12/10/08 - 12/17/08	< 62	< 58	< 61	< 60	< 61	< 63
12/17/08 - 12/24/08	< 65	< 63	< 63	< 42	< 65	< 66
12/24/08 - 12/31/08	< 41	< 40	< 40	< 55	< 48	< 49
MEAN	-	-	-	-	-	-

**TABLE C-VII.1 CONCENTRATIONS OF I-131 IN AIR IODINE SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

COLLECTION PERIOD	GROUP II			GROUP III
	CL-01	CL-07	CL-08	CL-11 *
01/02/08 - 01/09/08	< 14	< 17	< 28	< 28
01/09/08 - 01/16/08	< 12	< 15	< 25	< 24
01/16/08 - 01/23/08	< 14	< 13	< 24	< 24
01/23/08 - 01/30/08	< 23	< 19	< 35	< 35
01/30/08 - 02/06/08	< 39	< 22	< 34	< 32
02/06/08 - 02/13/08	< 25	< 15	< 28	< 28
02/13/08 - 02/20/08	< 35	< 38	< 51	< 50
02/20/08 - 02/27/08	< 30	< 18	< 30	< 30
02/27/08 - 03/05/08	< 18	< 17	< 37	< 36
03/05/08 - 03/12/08	< 35	< 36	< 60	< 59
03/12/08 - 03/19/08	< 32	< 35	< 38	< 38
03/19/08 - 03/26/08	< 20	< 15	< 29	< 29
03/26/08 - 04/02/08	< 17	< 27	< 35	< 34
04/02/08 - 04/09/08	< 22	< 36	< 21	< 37
04/09/08 - 04/16/08	< 19	< 21	< 39	< 39
04/16/08 - 04/23/08	< 26	< 29	< 68	< 67
04/23/08 - 04/30/08	< 20	< 28	< 64	< 63
04/30/08 - 05/07/08	< 23	< 36	< 37	< 37
05/07/08 - 05/14/08	< 19	< 26	< 27	< 14
05/14/08 - 05/21/08	< 22	< 24	< 42	< 40
05/21/08 - 05/28/08	< 14	< 27	< 33	< 33
05/28/08 - 06/04/08	< 27	< 46	< 58	< 54
06/04/08 - 06/11/08	< 19	< 26	< 38	< 38
06/11/08 - 06/18/08	< 20	< 29	< 40	< 39
06/18/08 - 06/25/08	< 21	< 25	< 38	< 37
06/25/08 - 07/02/08	< 31	< 43	< 67	< 67
07/02/08 - 07/09/08	< 32	< 20	< 33	< 32
07/09/08 - 07/16/08	< 28	< 14	< 32	< 32
07/16/08 - 07/23/08	< 19	< 12	< 16	< 65 (1)
07/23/08 - 07/30/08	< 29	< 26	< 46	< 46
07/30/08 - 08/06/08	< 25	< 24	< 57	< 56
08/06/08 - 08/13/08	< 33	< 39	< 50	< 49
08/13/08 - 08/20/08	< 22	< 23	< 54	< 54
08/20/08 - 08/27/08	< 16	< 24	< 57	< 57
08/27/08 - 09/03/08	< 31	< 30	< 56	< 55
09/03/08 - 09/10/08	< 16	< 23	< 29	< 28
09/10/08 - 09/17/08	< 26	< 37	< 46	< 46
09/17/08 - 09/24/08	< 23	< 23	< 36	< 35
09/24/08 - 10/01/08	< 21	< 56	< 70	< 70
10/01/08 - 10/08/08	< 36	< 25	< 48	< 46
10/08/08 - 10/15/08	< 38	< 23	< 55	< 55
10/15/08 - 10/22/08	< 28	< 38	< 48	< 48
10/22/08 - 10/29/08	< 29	< 45	< 67	< 67
10/29/08 - 11/05/08	< 36	< 37	< 48	< 48
11/05/08 - 11/12/08	< 32	< 47	< 59	< 59
11/12/08 - 11/19/08	< 25	< 27	< 41	< 41
11/19/08 - 11/26/08	< 31	< 24	< 44	< 44
11/26/08 - 12/03/08	< 37	< 34	< 61	< 61
12/03/08 - 12/10/08	< 37	< 26	< 53	< 54
12/10/08 - 12/17/08	< 37	< 34	< 62	< 62
12/17/08 - 12/24/08	< 41	< 34	< 63	< 65
12/24/08 - 12/31/08	< 22	< 39	< 49	< 48

MEAN

\* INDICATES CONTROL STATION  
 (1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

TABLE C-VIII.1

**CONCENTRATIONS OF I-131 IN MILK SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**RESULTS IN UNITS OF PCI/LITER  $\pm$  2 SIGMA

COLLECTION PERIOD	CONTROL FARM
	CL-116
01/30/08	< 0.9
02/27/08	< 0.8
03/26/08	< 0.7
04/30/08	< 0.5
05/14/08	< 0.7
05/28/08	< 0.9
06/11/08	< 0.7
06/25/08	< 0.4
07/09/08	< 0.6
07/23/08	< 0.7
07/30/08	< 0.7
08/06/08	< 0.6
08/20/08	< 0.9
09/03/08	< 0.7
09/17/08	< 0.7
10/01/08	< 0.6
10/15/08	< 0.8
10/29/08	< 0.9
11/26/08	< 1.0
12/31/08	< 0.6
MEAN	-

**TABLE C-VIII.2 CONCENTRATIONS OF GAMMA EMITTERS IN MILK SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140	Ce-144
CL-116**	01/30/08	< 36	1080 ± 108	< 5	< 4	< 11	< 4	< 11	< 5	< 8	< 4	< 5	< 16	< 4	< 34
	02/27/08	< 50	965 ± 121	< 6	< 6	< 12	< 7	< 13	< 5	< 9	< 5	< 6	< 23	< 6	< 41
	03/26/08	< 61	1240 ± 149	< 7	< 7	< 16	< 7	< 15	< 6	< 13	< 7	< 8	< 35	< 9	< 61
	04/30/08	< 57	1180 ± 139	< 7	< 7	< 15	< 6	< 16	< 7	< 12	< 6	< 7	< 31	< 10	< 55
	05/14/08	< 88	1160 ± 214	< 8	< 11	< 21	< 9	< 23	< 10	< 16	< 9	< 10	< 45	< 11	< 73
	05/28/08	< 45	1060 ± 119	< 6	< 6	< 14	< 6	< 13	< 6	< 10	< 5	< 5	< 32	< 9	< 35
	06/11/08	< 60	1380 ± 151	< 6	< 7	< 11	< 6	< 13	< 6	< 11	< 6	< 6	< 42	< 13	< 52
	06/25/08	< 50	1300 ± 141	< 7	< 7	< 14	< 6	< 11	< 6	< 10	< 5	< 6	< 34	< 12	< 40
	07/09/08	< 50	1220 ± 129	< 6	< 6	< 14	< 6	< 14	< 6	< 11	< 5	< 6	< 43	< 10	< 39
	07/23/08	< 46	1200 ± 121	< 4	< 5	< 12	< 5	< 10	< 6	< 9	< 5	< 6	< 24	< 7	< 38
	07/30/08	< 54	1310 ± 152	< 6	< 7	< 15	< 8	< 18	< 7	< 11	< 6	< 7	< 33	< 9	< 46
	08/06/08	< 53	1320 ± 156	< 6	< 7	< 12	< 4	< 12	< 5	< 9	< 4	< 5	< 43	< 11	< 44
	08/20/08	< 44	1190 ± 129	< 5	< 7	< 12	< 6	< 14	< 7	< 11	< 5	< 5	< 32	< 12	< 44
	09/03/08	< 48	1270 ± 130	< 6	< 6	< 15	< 5	< 13	< 6	< 10	< 5	< 6	< 34	< 12	< 42
	09/17/08	< 45	1250 ± 104	< 4	< 5	< 12	< 5	< 10	< 5	< 10	< 4	< 4	< 32	< 12	< 34
	10/01/08	< 25	1230 ± 51	< 2	< 3	< 7	< 2	< 5	< 3	< 5	< 2	< 2	< 31	< 9	< 18
	10/15/08	< 49	1220 ± 135	< 5	< 6	< 13	< 6	< 12	< 7	< 11	< 5	< 6	< 40	< 15	< 40
10/29/08	< 36	1220 ± 80	< 4	< 4	< 11	< 4	< 9	< 5	< 8	< 3	< 4	< 39	< 10	< 32	
11/26/08	< 24	1190 ± 59	< 2	< 3	< 6	< 2	< 5	< 3	< 5	< 2	< 2	< 24	< 6	< 19	
12/31/08	< 43	1160 ± 102	< 4	< 4	< 11	< 3	< 9	< 5	< 9	< 4	< 5	< 27	< 6	< 33	
MEAN	-	-	1207 ± 190	-	-	-	-	-	-	-	-	-	-	-	-

C-18

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

\*\* INDICATES CONTROL STATION

**TABLE C-IX.1 CONCENTRATIONS OF GAMMA EMITTERS IN VEGETATION SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140	Ce-144
CL-114	06/25/08 (1)															
	06/25/08 (1)															
	06/25/08	667 ± 186	7820 ± 563	< 22	< 23	< 49	< 25	< 51	< 24	< 40	< 56	< 20	< 19	< 109	< 34	< 137
	Substituted Broadleaf Vegetation															
	07/30/08	305 ± 43	4270 ± 109	< 7	< 8	< 21	< 7	< 18	< 8	< 14	< 50	< 7	< 6	< 79	< 22	< 42
	Cabbage															
	07/30/08	261 ± 46	3360 ± 119	< 5	< 6	< 16	< 5	< 12	< 6	< 11	< 36	< 4	< 6	< 58	< 17	< 31
	Lettuce															
	07/30/08	368 ± 34	5810 ± 104	< 3	< 4	< 11	< 4	< 9	< 4	< 7	< 26	< 3	< 3	< 41	< 10	< 23
	Swiss chard															
	08/27/08	112 ± 54	3950 ± 140	< 3	< 4	< 10	< 4	< 8	< 4	< 8	< 49	< 3	< 4	< 59	< 14	< 26
	Cabbage															
	08/27/08	383 ± 103	6020 ± 230	< 4	< 4	< 12	< 4	< 9	< 5	< 9	< 54	< 3	< 4	< 75	< 21	< 29
	Lettuce															
	08/27/08	315 ± 79	7710 ± 187	< 4	< 5	< 12	< 4	< 10	< 5	< 8	< 49	< 3	< 4	< 62	< 16	< 22
	Swiss chard															
	09/24/08	< 64	2570 ± 140	< 6	< 6	< 15	< 6	< 13	< 7	< 12	< 37	< 5	< 6	< 61	< 18	< 40
	Cabbage															
	09/24/08	386 ± 101	3630 ± 195	< 8	< 10	< 21	< 8	< 20	< 10	< 18	< 50	< 8	< 8	< 93	< 29	< 52
	Substitute greens for lettuce															
	09/24/08	237 ± 65	5210 ± 205	< 8	< 9	< 22	< 8	< 19	< 9	< 15	< 41	< 7	< 8	< 75	< 19	< 48
	Swiss chard															
	MEAN	337 ± 302	5035 ± 3598	-	-	-	-	-	-	-	-	-	-	-	-	-

C-19

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
 (1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

**TABLE C-IX.1 CONCENTRATIONS OF GAMMA EMITTERS IN VEGETATION SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140	Ce-144
CL-115	06/25/08 (1)															
	06/25/08 (1)															
	06/25/08	2090 ± 256	6410 ± 507	< 22	< 21	< 46	< 22	< 44	< 22	< 33	< 59	< 18	< 22	< 135	< 41	< 128
	Substituted Broadleaf Vegetation															
	07/30/08	305 ± 65	3540 ± 138	< 6	< 7	< 16	< 5	< 14	< 7	< 12	< 46	< 5	< 6	< 72	< 20	< 38
	Cabbage															
	07/30/08	682 ± 101	5210 ± 192	< 9	< 10	< 24	< 9	< 20	< 11	< 18	< 51	< 9	< 10	< 89	< 29	< 55
	Lettuce															
	07/30/08	606 ± 56	4830 ± 122	< 5	< 5	< 13	< 4	< 11	< 6	< 9	< 36	< 4	< 5	< 54	< 13	< 31
	Swiss chard															
	08/27/08	166 ± 89	5340 ± 190	< 4	< 4	< 13	< 3	< 8	< 5	< 8	< 57	< 4	< 4	< 73	< 15	< 24
	Cabbage															
	08/27/08	148 ± 85	6570 ± 240	< 4	< 5	< 11	< 4	< 10	< 5	< 9	< 53	< 3	< 4	< 64	< 17	< 21
	Lettuce & Soy															
	08/27/08	830 ± 100	7670 ± 234	< 4	< 4	< 12	< 4	< 9	< 5	< 8	< 58	< 4	< 5	< 77	< 20	< 24
	Swiss chard															
	09/24/08	359 ± 54	3270 ± 107	< 4	< 5	< 13	< 5	< 10	< 6	< 9	< 41	< 4	< 4	< 59	< 17	< 28
	Swiss chard sub for lettuce															
	09/24/08	252 ± 65	3440 ± 149	< 7	< 8	< 18	< 7	< 16	< 9	< 15	< 41	< 7	< 8	< 75	< 21	< 45
	Cabbage															
	09/24/08	373 ± 83	3260 ± 181	< 8	< 8	< 21	< 8	< 18	< 10	< 16	< 43	< 7	< 8	< 81	< 22	< 51
	Swiss chard															
	MEAN	581 ± 1152	4954 ± 3151	-	-	-	-	-	-	-	-	-	-	-	-	-

C-20

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES  
 (1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

**TABLE C-IX.1 CONCENTRATIONS OF GAMMA EMITTERS IN VEGETATION SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140	Ce-144
CL-117	06/25/08	< 186	3730 ± 412	< 19	< 20	< 45	< 23	< 53	< 23	< 40	< 56	< 17	< 23	< 134	< 44	< 126
	Cabbage															
	06/25/08	187 ± 122	2360 ± 343	< 16	< 14	< 44	< 17	< 39	< 17	< 29	< 41	< 14	< 18	< 111	< 21	< 79
	Lettuce															
	06/25/08	< 172	4790 ± 490	< 17	< 15	< 44	< 19	< 42	< 18	< 32	< 49	< 16	< 18	< 109	< 24	< 115
	Swiss chard															
	07/30/08	283 ± 41	3490 ± 97	< 4	< 4	< 11	< 4	< 9	< 5	< 7	< 29	< 3	< 4	< 44	< 13	< 24
	Cabbage															
	07/30/08	444 ± 55	3500 ± 123	< 5	< 6	< 16	< 6	< 13	< 6	< 11	< 44	< 4	< 5	< 64	< 18	< 31
	Lettuce															
	07/30/08	470 ± 58	6350 ± 170	< 6	< 7	< 19	< 6	< 15	< 7	< 12	< 44	< 5	< 6	< 71	< 18	< 35
	Swiss chard															
	08/27/08	108 ± 46	3440 ± 132	< 3	< 4	< 10	< 3	< 7	< 4	< 7	< 46	< 3	< 3	< 58	< 13	< 22
	Cabbage															
	08/27/08	250 ± 94	6110 ± 229	< 4	< 5	< 13	< 3	< 8	< 5	< 9	< 60	< 4	< 4	< 70	< 17	< 30
	Lettuce															
	08/27/08	177 ± 60	6290 ± 167	< 4	< 4	< 11	< 4	< 8	< 5	< 7	< 48	< 3	< 4	< 65	< 16	< 25
	Swiss chard															
	09/24/08	508 ± 93	3700 ± 186	< 8	< 9	< 22	< 8	< 19	< 10	< 17	< 51	< 7	< 9	< 91	< 22	< 53
	Cabbage															
	09/24/08	< 62	1670 ± 111	< 6	< 6	< 16	< 5	< 12	< 6	< 11	< 39	< 5	< 6	< 66	< 18	< 40
	Lettuce															
	09/24/08	224 ± 39	3890 ± 77	< 1	< 2	< 5	< 1	< 3	< 2	< 3	< 55	< 1	< 1	< 49	< 13	< 8
	Swiss chard															
	MEAN	295 ± 288	4110 ± 3004	-	-	-	-	-	-	-	-	-	-	-	-	-

C-21

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

**TABLE C-IX.1 CONCENTRATIONS OF GAMMA EMITTERS IN VEGETATION SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140	Ce-144
CL-118	06/25/08	< 188	5550 ± 482	< 23	< 24	< 58	< 30	< 54	< 24	< 42	< 59	< 20	< 24	< 142	< 41	< 119
	Cabbage															
	06/25/08	153 ± 118	3090 ± 349	< 15	< 18	< 42	< 16	< 36	< 20	< 27	< 41	< 15	< 16	< 114	< 23	< 96
	Lettuce															
	06/25/08	277 ± 185	6640 ± 562	< 22	< 23	< 54	< 24	< 55	< 24	< 43	< 59	< 21	< 19	< 137	< 38	< 117
	Swiss chard															
	07/30/08	297 ± 46	4550 ± 112	< 4	< 5	< 12	< 4	< 10	< 5	< 9	< 36	< 4	< 19	< 54	< 13	< 29
	Cabbage															
	07/30/08	354 ± 62	3240 ± 131	< 5	< 6	< 15	< 5	< 13	< 6	< 11	< 47	< 5	< 5	< 70	< 18	< 35
	Lettuce															
	07/30/08	477 ± 69	6170 ± 160	< 6	< 6	< 18	< 6	< 14	< 7	< 12	< 47	< 5	< 6	< 71	< 19	< 35
	Swiss chard															
	08/27/08	339 ± 108	5650 ± 197	< 4	< 4	< 11	< 2	< 8	< 4	< 8	< 55	< 3	< 3	< 66	< 14	< 23
	Cabbage															
	08/27/08	615 ± 109	8370 ± 257	< 4	< 5	< 12	< 4	< 10	< 5	< 8	< 60	< 4	< 4	< 68	< 21	< 26
	Lettuce															
	08/27/08	177 ± 56	6820 ± 178	< 3	< 4	< 10	< 3	< 8	< 4	< 7	< 42	< 3	< 3	< 59	< 13	< 20
	Swiss chard															
	09/24/08	251 ± 67	2760 ± 127	< 6	< 6	< 14	< 5	< 12	< 6	< 11	< 35	< 5	< 5	< 58	< 14	< 38
	Cabbage															
	09/24/08	381 ± 80	5190 ± 176	< 8	< 9	< 22	< 8	< 19	< 10	< 16	< 47	< 8	< 8	< 81	< 25	< 52
	substitute greens for lettuce															
	09/24/08	410 ± 93	5350 ± 215	< 9	< 9	< 23	< 9	< 19	< 10	< 17	< 48	< 7	< 8	< 84	< 22	< 47
	Swiss chard															
	MEAN	339 ± 266	5282 ± 3337	-	-	-	-	-	-	-	-	-	-	-	-	-

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES



**TABLE C-IX.2 CONCENTRATIONS OF GAMMA EMITTERS IN GRASS SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140	Ce-144
CL-01	05/14/08	< 318	< 158	< 17	< 16	< 39	< 14	< 46	< 16	< 28	< 37	< 16	< 15	< 94	< 29	< 86
	05/28/08	829 ± 156	5240 ± 359	< 13	< 14	< 36	< 16	< 35	< 16	< 24	< 35	< 11	< 13	< 86	< 28	< 79
	06/11/08	1630 ± 144	4120 ± 271	< 12	< 11	< 29	< 9	< 27	< 14	< 21	< 31	< 10	< 12	< 75	< 22	< 83
	06/25/08	1180 ± 177	3160 ± 358	< 13	< 16	< 35	< 15	< 36	< 18	< 28	< 40	< 15	< 17	< 91	< 27	< 91
	07/09/08	950 ± 136	3960 ± 319	< 10	< 13	< 28	< 12	< 27	< 13	< 21	< 29	< 9	< 12	< 79	< 22	< 77
	07/23/08	2270 ± 67	4360 ± 119	< 4	< 5	< 11	< 5	< 11	< 5	< 8	< 10	< 4	< 5	< 24	< 6	< 33
	08/06/08	1750 ± 73	3620 ± 128	< 5	< 6	< 15	< 5	< 13	< 6	< 10	< 27	< 4	< 5	< 49	< 14	< 32
	08/20/08	1600 ± 84	5140 ± 169	< 7	< 7	< 18	< 8	< 16	< 8	< 13	< 33	< 6	< 7	< 61	< 15	< 44
	09/03/08	2680 ± 302	6460 ± 517	< 20	< 21	< 50	< 24	< 47	< 21	< 40	< 58	< 16	< 20	< 132	< 32	< 122
	09/17/08	3470 ± 159	3620 ± 210	< 10	< 10	< 25	< 9	< 22	< 11	< 18	< 42	< 8	< 9	< 83	< 20	< 66
	10/01/08	1670 ± 78	3780 ± 114	< 3	< 4	< 10	< 3	< 8	< 4	< 7	< 54	< 3	< 3	< 67	< 14	< 22
	10/15/08	1080 ± 154	4020 ± 306	< 11	< 12	< 31	< 11	< 28	< 13	< 22	< 57	< 8	< 11	< 99	< 22	< 75
	10/29/08	2380 ± 62	6140 ± 91	< 1	< 2	< 5	< 1	< 3	< 2	< 3	< 53	< 1	< 1	< 45	< 11	< 9
	MEAN	1791 ± 1570	4468 ± 2091	-	-	-	-	-	-	-	-	-	-	-	-	-
CL-02	05/14/08	2480 ± 315	4040 ± 457	< 19	< 20	< 54	< 21	< 50	< 19	< 32	< 56	< 16	< 18	< 134	< 26	< 126
	05/28/08	1310 ± 147	4810 ± 319	< 14	< 15	< 34	< 15	< 34	< 15	< 26	< 43	< 13	< 14	< 92	< 26	< 103
	06/11/08	1620 ± 214	4900 ± 389	< 15	< 16	< 40	< 18	< 38	< 17	< 30	< 45	< 14	< 14	< 95	< 29	< 99
	06/25/08	1890 ± 251	4740 ± 424	< 19	< 21	< 44	< 19	< 40	< 24	< 36	< 59	< 18	< 18	< 129	< 33	< 120
	07/09/08	3830 ± 279	6360 ± 457	< 18	< 20	< 50	< 20	< 41	< 20	< 32	< 59	< 16	< 19	< 123	< 43	< 110
	07/23/08	4950 ± 126	5170 ± 195	< 8	< 8	< 18	< 8	< 17	< 8	< 14	< 16	< 7	< 8	< 39	< 11	< 53
	08/06/08	5160 ± 145	5890 ± 201	< 7	< 8	< 21	< 9	< 18	< 8	< 15	< 41	< 7	< 8	< 74	< 21	< 43
	08/20/08	2190 ± 105	5430 ± 171	< 7	< 8	< 20	< 8	< 18	< 9	< 14	< 34	< 7	< 7	< 65	< 20	< 42
	09/03/08	3080 ± 222	6810 ± 414	< 16	< 17	< 41	< 17	< 41	< 17	< 29	< 48	< 14	< 16	< 104	< 31	< 94
	09/17/08	3920 ± 200	5020 ± 281	< 12	< 13	< 32	< 13	< 27	< 13	< 22	< 54	< 11	< 11	< 103	< 30	< 67
	10/01/08	2600 ± 120	5320 ± 161	< 3	< 4	< 10	< 3	< 7	< 4	< 7	< 57	< 3	< 3	< 66	< 16	< 19
	10/15/08	1970 ± 214	4360 ± 333	< 9	< 11	< 25	< 9	< 21	< 14	< 20	< 54	< 9	< 12	< 109	< 30	< 71
	10/29/08	2660 ± 68	6040 ± 93	< 1	< 2	< 5	< 1	< 3	< 2	< 3	< 51	< 1	< 1	< 43	< 10	< 9
	MEAN	2897 ± 2458	5299 ± 1591	-	-	-	-	-	-	-	-	-	-	-	-	-

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

**TABLE C-IX.2 CONCENTRATIONS OF GAMMA EMITTERS IN GRASS SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	I-131	Cs-134	Cs-137	Ba-140	La-140	Ce-144
CL-08	05/14/08	437 ± 121	3480 ± 320	< 13	< 15	< 32	< 12	< 31	< 15	< 23	< 40	< 12	< 14	< 86	< 29	< 84
	05/28/08	586 ± 131	5670 ± 354	< 18	< 19	< 43	< 17	< 44	< 20	< 35	< 55	< 20	< 19	< 120	< 29	< 133
	06/11/08	939 ± 148	5790 ± 398	< 16	< 15	< 41	< 19	< 40	< 18	< 27	< 43	< 14	< 15	< 96	< 25	< 90
	06/25/08	973 ± 233	4590 ± 500	< 19	< 23	< 48	< 21	< 49	< 23	< 39	< 57	< 16	< 23	< 127	< 44	< 139
	07/09/08	3070 ± 204	5250 ± 336	< 12	< 15	< 33	< 14	< 34	< 15	< 22	< 39	< 12	< 12	< 78	< 26	< 85
	07/23/08	2540 ± 108	5050 ± 196	< 7	< 8	< 17	< 8	< 17	< 8	< 13	< 14	< 7	< 8	< 39	< 10	< 46
	08/06/08	2020 ± 94	6640 ± 194	< 6	< 8	< 20	< 7	< 17	< 8	< 14	< 34	< 6	< 7	< 62	< 17	< 40
	08/20/08	902 ± 73	5990 ± 161	< 5	< 6	< 16	< 6	< 14	< 7	< 11	< 28	< 5	< 6	< 51	< 12	< 36
	09/03/08	2380 ± 243	8400 ± 498	< 19	< 18	< 44	< 20	< 43	< 19	< 33	< 56	< 16	< 18	< 122	< 25	< 119
	09/17/08	3380 ± 186	3860 ± 235	< 9	< 11	< 25	< 11	< 22	< 11	< 18	< 48	< 9	< 10	< 86	< 24	< 69
	10/01/08	2380 ± 111	4000 ± 144	< 3	< 3	< 9	< 3	< 7	< 4	< 7	< 54	< 3	< 3	< 66	< 17	< 18
	10/15/08	944 ± 120	4090 ± 240	< 8	< 10	< 26	< 8	< 21	< 10	< 17	< 44	< 8	< 8	< 74	< 19	< 50
	10/29/08	2110 ± 84	6180 ± 140	< 2	< 3	< 8	< 2	< 5	< 3	< 5	< 60	< 2	< 2	< 58	< 15	< 12
		MEAN	1743 ± 1977	5307 ± 2717	-	-	-	-	-	-	-	-	-	-	-	-
CL-116	05/14/08	1770 ± 253	3990 ± 402	< 19	< 20	< 41	< 17	< 42	< 20	< 35	< 57	< 18	< 19	< 128	< 35	< 134
	05/28/08	1190 ± 140	4280 ± 273	< 10	< 13	< 28	< 11	< 26	< 12	< 23	< 32	< 11	< 11	< 70	< 23	< 68
	06/11/08	2000 ± 198	5160 ± 340	< 11	< 13	< 33	< 14	< 27	< 15	< 22	< 35	< 11	< 12	< 88	< 18	< 81
	06/25/08	1370 ± 232	4980 ± 438	< 21	< 23	< 46	< 22	< 45	< 25	< 35	< 50	< 19	< 22	< 110	< 37	< 118
	07/09/08	1160 ± 142	2430 ± 235	< 10	< 11	< 23	< 9	< 24	< 11	< 21	< 32	< 10	< 11	< 71	< 19	< 62
	07/23/08	3080 ± 168	4370 ± 241	< 11	< 11	< 25	< 12	< 26	< 12	< 18	< 23	< 10	< 11	< 62	< 15	< 74
	08/06/08	2080 ± 63	4550 ± 114	< 4	< 5	< 11	< 4	< 10	< 5	< 9	< 26	< 4	< 4	< 42	< 10	< 31
	08/20/08	1790 ± 84	5590 ± 158	< 5	< 6	< 14	< 6	< 13	< 6	< 10	< 26	< 5	< 5	< 46	< 12	< 33
	09/03/08	2510 ± 190	4800 ± 328	< 13	< 14	< 32	< 11	< 30	< 15	< 22	< 37	< 11	< 13	< 90	< 21	< 76
	09/17/08	1730 ± 107	5030 ± 190	< 7	< 8	< 18	< 8	< 17	< 8	< 12	< 29	< 6	< 7	< 58	< 16	< 42
	10/01/08	1540 ± 76	4560 ± 120	< 3	< 4	< 11	< 3	< 8	< 4	< 7	< 56	< 3	< 3	< 61	< 14	< 19
	10/15/08	1560 ± 169	4120 ± 300	< 9	< 9	< 20	< 8	< 18	< 10	< 17	< 60	< 9	< 9	< 98	< 25	< 65
	10/29/08	1920 ± 78	4150 ± 113	< 2	< 2	< 7	< 2	< 4	< 2	< 4	< 59	< 2	< 2	< 53	< 11	< 11
		MEAN	1823 ± 1059	4462 ± 1537	-	-	-	-	-	-	-	-	-	-	-	-

\* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING THE POSITIVE VALUES

TABLE C-X.1 QUARTERLY TLD RESULTS FOR CLINTON POWER STATION, 2008

RESULTS IN UNITS OF MILLI-ROENTGEN/QUARTER ± 2 STANDARD DEVIATIONS

STATION CODE	MEAN ± 2 S.D.	JAN - MAR	APR - JUN	JUL - SEP	OCT - DEC
CL-01	20.0 ± 3.5	21.3 ± 1.1	18.1 ± 1.1	21.6 ± 1.3	18.8 ± 3.8
CL-02	20.4 ± 4.2	22.5 ± 0.8	18.2 ± 1.4	21.9 ± 0.6	19.0 ± 1.4
CL-03	19.7 ± 3.9	21.3 ± 1.5	17.9 ± 1.7	21.4 ± 2.1	18.1 ± 1.8
CL-04	19.8 ± 3.4	20.8 ± 2.1	17.6 ± 0.9	21.4 ± 2.6	19.3 ± 1.6
CL-05	21.0 ± 5.0	22.7 ± 1.3	18.5 ± 1.3	23.5 ± 1.8	19.2 ± 1.3
CL-06	18.4 ± 2.9	19.9 ± 1.2	16.8 ± 0.5	19.2 ± 0.9	17.5 ± 1.8
CL-07	19.2 ± 3.5	20.0 ± 2.5	17.2 ± 1.7	21.1 ± 1.9	18.3 ± 3.3
CL-08	19.6 ± 4.8	21.9 ± 1.9	16.8 ± 1.7	21.2 ± 1.4	18.4 ± 3.1
CL-11	19.3 ± 3.8	20.0 ± 2.4	17.3 ± 1.4	21.6 ± 1.9	18.3 ± 3.1
CL-15	18.2 ± 3.1	19.8 ± 1.5	17.1 ± 2.7	19.3 ± 1.2	16.7 ± 1.7
CL-22	20.3 ± 3.3	21.1 ± 1.1	18.1 ± 1.2	21.9 ± 0.9	19.9 ± 1.9
CL-23	20.8 ± 5.2	23.4 ± 3.3	18.6 ± 2.3	22.6 ± 1.0	18.5 ± 2.0
CL-24	20.9 ± 3.7	21.5 ± 2.1	19.3 ± 1.4	23.2 ± 1.2	19.5 ± 1.9
CL-33	20.5 ± 2.9	21.4 ± 1.8	18.6 ± 1.2	21.8 ± 0.6	20.2 ± 1.5
CL-34	20.9 ± 4.1	22.4 ± 1.0	19.1 ± 1.7	22.8 ± 1.1	19.1 ± 1.8
CL-35	19.6 ± 3.5	20.4 ± 0.8	17.8 ± 2.9	21.6 ± 0.6	18.4 ± 2.2
CL-36	19.9 ± 3.2	20.2 ± 0.9	18.2 ± 1.6	21.9 ± 0.8	19.2 ± 2.0
CL-37	19.4 ± 3.9	20.5 ± 1.9	17.8 ± 1.0	21.6 ± 1.3	17.8 ± 1.6
CL-41	21.3 ± 4.1	23.1 ± 2.1	19.5 ± 2.1	23.1 ± 1.7	19.6 ± 1.5
CL-42	19.7 ± 2.9	20.7 ± 0.6	17.9 ± 0.9	21.1 ± 0.9	19.2 ± 2.2
CL-43	21.3 ± 3.8	21.9 ± 1.1	19.3 ± 1.1	23.7 ± 1.7	20.4 ± 1.6
CL-44	20.4 ± 3.2	21.9 ± 1.9	18.7 ± 0.7	21.6 ± 1.3	19.4 ± 1.3
CL-45	21.0 ± 4.3	21.6 ± 2.0	19.1 ± 0.8	23.7 ± 3.0	19.4 ± 1.1
CL-46	18.4 ± 4.7	21.5 ± 3.4	16.9 ± 1.4	18.9 ± 1.3	16.3 ± 1.4
CL-47	21.5 ± 4.0	23.4 ± 2.8	19.6 ± 1.9	23.0 ± 1.2	19.9 ± 0.9
CL-48	20.3 ± 3.7	22.3 ± 1.8	18.4 ± 2.6	21.4 ± 0.7	19.2 ± 3.2
CL-49	21.5 ± 3.5	21.7 ± 1.3	18.9 ± 1.5	22.6 ± 2.5	22.6 ± 6.4 (1)
CL-51	21.5 ± 3.9	22.4 ± 1.3	18.6 ± 1.1	22.9 ± 2.4	21.9 ± 4.0
CL-52	20.6 ± 2.7	21.8 ± 3.3	19.3 ± 3.2	21.6 ± 1.0	19.5 ± 2.1
CL-53	20.2 ± 3.2	20.9 ± 1.1	18.5 ± 1.8	22.1 ± 0.8	19.3 ± 1.6
CL-54	20.4 ± 3.9	22.2 ± 0.8	18.6 ± 1.5	22.0 ± 1.6	18.8 ± 1.4
CL-55	20.8 ± 4.3	22.5 ± 2.3	18.1 ± 0.7	22.5 ± 2.1	20.1 ± 2.4
CL-56	20.3 ± 10	23.1 ± 2.8	12.8 ± 0.8 (1)	23.7 ± 2.3	21.4 ± 2.0
CL-57	20.1 ± 3.4	21.5 ± 1.3	18.6 ± 1.9	21.6 ± 5.7	18.6 ± 1.8
CL-58	21.6 ± 5.7	22.2 ± 2.1	19.5 ± 1.8	25.3 ± 4.8 (1)	19.2 ± 2.3
CL-60	20.9 ± 4.5	23.8 ± 1.7	18.5 ± 1.2	21.3 ± 0.7	19.9 ± 2.8
CL-61	20.0 ± 3.7	21.6 ± 2.1	17.6 ± 3.5	21.3 ± 1.2	19.3 ± 1.4
CL-63	18.2 ± 3.2	20.4 ± 1.8	17.3 ± 1.1	18.3 ± 2.8	16.7 ± 2.8
CL-64	19.4 ± 4.2	21.3 ± 2.1	18.3 ± 1.1	21.0 ± 1.9	17.0 ± 1.4
CL-65	21.0 ± 3.7	23.0 ± 2.1	18.6 ± 2.1	21.5 ± 1.7	20.7 ± 6.2
CL-74	18.4 ± 3.0	20.1 ± 1.3	16.4 ± 0.7	18.6 ± 1.6	18.6 ± 1.8
CL-75	19.7 ± 3.5	21.2 ± 2.2	17.8 ± 0.8	21.1 ± 1.8	18.6 ± 1.7
CL-76	19.8 ± 4.0	22.6 ± 1.8	18.1 ± 1.7	20.0 ± 1.5	18.6 ± 0.7
CL-77	19.0 ± 3.7	20.7 ± 1.5	17.5 ± 0.8	20.5 ± 1.4	17.3 ± 2.3
CL-78	20.4 ± 2.6	21.6 ± 0.8	18.7 ± 1.3	21.1 ± 2.8	20.0 ± 1.9
CL-79	19.8 ± 5.0	22.8 ± 3.3	17.9 ± 1.9	20.8 ± 3.5	17.5 ± 0.7
CL-80	19.7 ± 3.9	22.0 ± 1.7	17.9 ± 1.5	20.6 ± 2.4	18.2 ± 1.8
CL-81	19.5 ± 5.1	22.8 ± 2.4	17.5 ± 0.8	20.1 ± 1.3	17.5 ± 0.8
CL-84	20.0 ± 3.5	22.2 ± 4.1	18.1 ± 1.5	20.4 ± 2.1	19.2 ± 1.8
CL-90	17.3 ± 3.9	20.0 ± 2.1	15.8 ± 1.6	17.6 ± 1.3	15.9 ± 2.4
CL-91	18.8 ± 3.2	20.8 ± 1.6	17.6 ± 1.5	19.5 ± 2.1	17.4 ± 1.7
CL-97	20.3 ± 3.7	20.9 ± 0.8	18.4 ± 1.0	22.5 ± 1.9	19.2 ± 2.9
CL-99	17.2 ± 2.3	18.5 ± 0.8	15.7 ± 0.6	17.2 ± 2.0	17.5 ± 1.3
CL-114	18.8 ± 3.0	20.3 ± 1.7	17.3 ± 0.8	19.9 ± 3.9	17.8 ± 3.6

(1) SEE PROGRAM EXCEPTIONS SECTION FOR EXPLANATION

**TABLE C-X.1 QUARTERLY TLD RESULTS FOR CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF MILLI-ROENTGEN/QUARTER ± 2 STANDARD DEVIATIONS

STATION CODE	MEAN ± 2 S.D.	JAN - MAR	APR - JUN	JUL - SEP	OCT - DEC
CL-05MM *	19.6 ± 3.4	21.4 ± 0.9	18.4 ± 1.2	20.7 ± 0.7	17.9 ± 1.3
CL-46MM *	20.0 ± 3.1	22.1 ± 2.4	18.8 ± 1.6	20.1 ± 1.1	18.8 ± 1.7
CL-47MM *	19.8 ± 4.0	22.0 ± 1.5	18.1 ± 1.3	21.0 ± 1.4	18.2 ± 1.6
CL-58MM *	19.2 ± 2.6	20.8 ± 1.7	18.1 ± 0.8	19.6 ± 0.9	18.1 ± 0.8

\* SEE PAGE 14, SECTION IV.C FOR EXPLANATION

COMPARISON OF STATIONS CL-05, CL-46, CL-47 AND CL-58 AND CORRESPONDING MM SAMPLES

STATION CODE	MEAN ± 2 S.D.	JAN - MAR	APR - JUN	JUL - SEP	OCT - DEC
CL-05	21.0 ± 5.0	22.7 ± 1.3	18.5 ± 1.3	23.5 ± 1.8	19.2 ± 1.3
CL-05MM	19.6 ± 3.4	21.4 ± 0.9	18.4 ± 1.2	20.7 ± 0.7	17.9 ± 1.3
CL-46	18.4 ± 4.7	21.5 ± 3.4	16.9 ± 1.4	18.9 ± 1.3	16.3 ± 1.4
CL-46MM	20.0 ± 3.1	22.1 ± 2.4	18.8 ± 1.6	20.1 ± 1.1	18.8 ± 1.7
CL-47	21.5 ± 4.0	23.4 ± 2.8	19.6 ± 1.9	23.0 ± 1.2	19.9 ± 0.9
CL-47MM	19.8 ± 4.0	22.0 ± 1.5	18.1 ± 1.3	21.0 ± 1.4	18.2 ± 1.6
CL-58	21.6 ± 5.7	22.2 ± 2.1	19.5 ± 1.8	25.3 ± 4.8 (1)	19.2 ± 2.3
CL-58MM	19.2 ± 2.6	20.8 ± 1.7	18.1 ± 0.8	19.6 ± 0.9	18.1 ± 0.8

**TABLE C-X.2 MEAN QUARTLY TLD RESULTS FOR THE INNER RING, OUTER RING, SPECIAL INTEREST, SUPPLEMENTAL AND CONTROL LOCATIONS FOR CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF MILLI-ROENTGEN/QUARTER  $\pm$  2 STANDARD DEVIATIONS OF THE STATION DATA

COLLECTION PERIOD	INNER RING $\pm$ 2 S.D.	OUTER RING	SPECIAL INTEREST	SUPPLEMENTAL	CONTROL
JAN-MAR	21.7 $\pm$ 2.0	22.2 $\pm$ 1.6	21.6 $\pm$ 2.3	20.7 $\pm$ 2.2	20.0 $\pm$ 0.0
APR-JUN	18.4 $\pm$ 1.5	18.0 $\pm$ 3.0	18.2 $\pm$ 2.0	17.4 $\pm$ 1.8	17.3 $\pm$ 0.0
JUL-SEP	21.9 $\pm$ 3.1	21.7 $\pm$ 2.8	21.4 $\pm$ 2.9	20.3 $\pm$ 3.2	21.6 $\pm$ 0.0
OCT-DEC	18.9 $\pm$ 2.2	19.2 $\pm$ 2.6	19.3 $\pm$ 3.8	18.2 $\pm$ 2.3	18.3 $\pm$ 0.0

**TABLE C-X.3 SUMMARY OF THE AMBIENT DOSIMETRY PROGRAM FOR CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF MILLI-ROENTGEN/QUARTER

LOCATION	SAMPLES ANALYZED	PERIOD MINIMUM	PERIOD MAXIMUM	PERIOD MEAN $\pm$ 2 S.D.	PRE-OP MEAN, $\pm$ 2 S.D., ALL LOCATIONS
INNER RING	64	16.3	23.7	20.2 $\pm$ 3.9	
OUTER RING	64	17.3	25.3	20.3 $\pm$ 4.3	18 $\pm$ 2.4
SPECIAL INTEREST	28	16.4	23.1	20.1 $\pm$ 3.9	
SUPPLEMENTAL	56	15.7	22.5	19.1 $\pm$ 3.7	
CONTROL	4	17.3	21.6	19.3 $\pm$ 3.8	

INNER RING STATIONS - CL-01, CL-05, CL-22, CL-23, CL-24, CL-34, CL-35, CL-36, CL-42, CL-43, CL-44, CL-45, CL-46, CL-47, CL-48, CL-63, CL-5MM\*, CL-46MM\*, CL-47MM \*

OUTER RING STATIONS - CL-51, CL-52, CL-53, CL-54, CL-55, CL-56, CL-57, CL-58, CL-60, CL-61, CL-76, CL-77, CL-78, CL-79, CL-80, CL-81, CL-58MM\*


SPECIAL INTEREST STATIONS - CL-37, CL-41, CL-49, CL-64, CL-65, CL-74, CL-75

SUPPLEMENTAL STATIONS - CL-02, CL-03, CL-04, CL-06, CL-07, CL-08, CL-114, CL-15, CL-33, CL-84, CL-90, CL-91, CL-97, CL-99

CONTROL STATIONS - CL-11

\* THE RESULTS FOR TLDs CL-05MM, CL-46mm, CL-47MM, CL-58MM ARE NOT PART OF THE REMP AVERAGES. THEY ARE USED FOR COMPARISON PURPOSES ONLY.


**FIGURE C-1  
MEAN MONTHLY GROSS BETA CONCENTRATION IN AIR PARTICULATE  
SAMPLES COLLECTED IN THE VICINITY OF CPS, 2008**

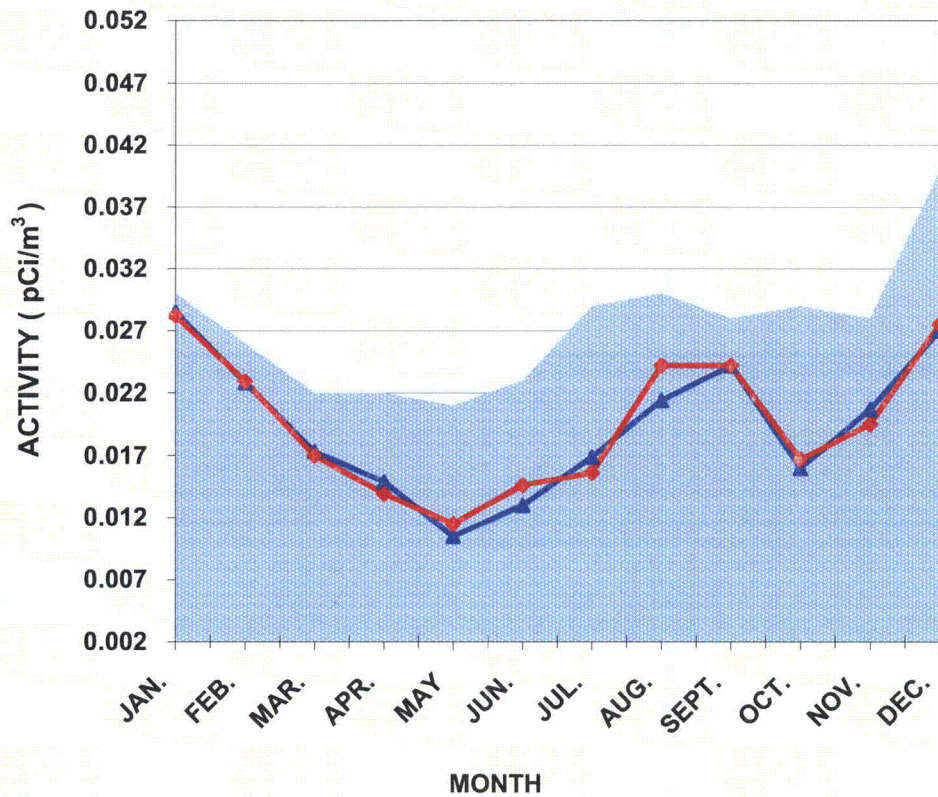

PRE-OP (ALL SITES)  
 2008 CONTROL  
 2008 INDICATOR

No July 16 - July 23, 2008 data point for CL-11. See program exceptions section for explanation

**FIGURE C-2  
MEAN QUARTERLY AMBIENT GAMMA RADIATION LEVELS (TLD) IN THE  
VICINITY OF CPS, 2008**

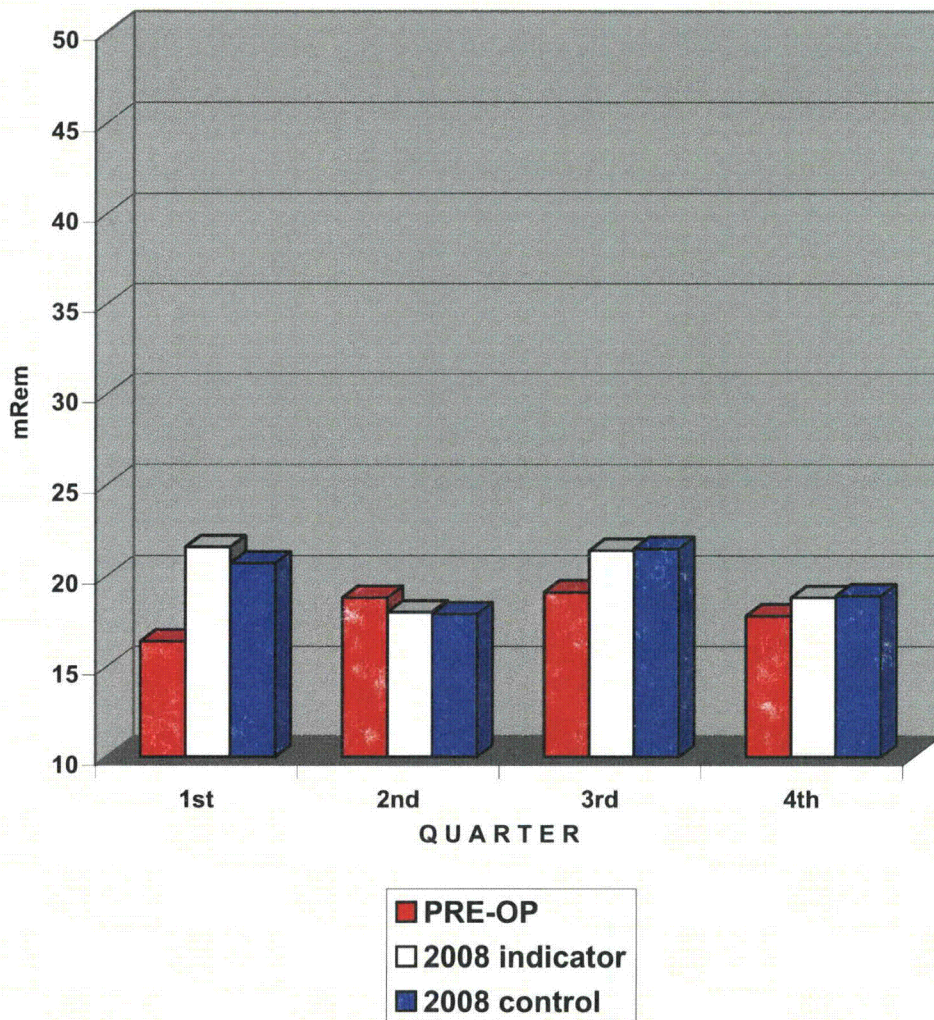

**APPENDIX D**

**INTER-LABORATORY COMPARISON  
PROGRAM**



TABLE D-1

**ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM**  
**TELEDYNE BROWN ENGINEERING, 2008**

(PAGE 1 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)			
March 2008	E5847-396	Milk	Sr-89	pCi/L	83.5	95.8	0.87	A			
			Sr-90	pCi/L	13.9	12.9	1.08	A			
March 2008	E5848-396	Milk	I-131	pCi/L	57.3	60.0	0.96	A			
			Ce-141	pCi/L	229	249	0.92	A			
			Cr-51	pCi/L	336	359	0.94	A			
			Cs-134	pCi/L	106	125	0.85	A			
			Cs-137	pCi/L	141	146	0.97	A			
			Co-58	pCi/L	71.8	70.8	1.01	A			
			Mn-54	pCi/L	98.1	94.2	1.04	A			
			Fe-59	pCi/L	102	102	1.00	A			
			Zn-65	pCi/L	135	137	0.99	A			
			Co-60	pCi/L	230	236	0.97	A			
			March 2008	E5850A-396	AP	Ce-141	pCi	163	157	1.04	A
						Cr-51	pCi	233	227	1.03	A
						Cs-134	pCi	72.6	79.0	0.92	A
Cs-137	pCi	98.3				92.0	1.07	A			
Co-58	pCi	46.7				44.7	1.04	A			
Mn-54	pCi	69.8				59.4	1.18	A			
Fe-59	pCi	72.2				64.5	1.12	A			
Zn-65	pCi	106				86.4	1.23	W			
Co-60	pCi	156	149	1.05	A						
March 2008	E5849-396	Charcoal	I-131	pCi	65.5	60.1	1.09	A			
June 2008	E5971-396	Milk	Sr-89	pCi/L	83.9	85.0	0.99	A			
			Sr-90	pCi/L	14.4	15.8	0.91	A			
June 2008	E5972-396	Milk	I-131	pCi/L	70.9	71.4	0.99	A			
			Ce-141	pCi/L	157	174	0.90	A			
			Cr-51	pCi/L	159	138	1.15	A			
			Cs-134	pCi/L	69.7	76.7	0.91	A			
			Cs-137	pCi/L	115	116	0.99	A			
			Co-58	pCi/L	59.1	61.9	0.95	A			
			Mn-54	pCi/L	139	135	1.03	A			
			Fe-59	pCi/L	98.4	91.7	1.07	A			
			Zn-65	pCi/L	129	127	1.02	A			
			Co-60	pCi/L	101	104	0.97	A			
June 2008	E5974-396	AP	Ce-141	pCi	206	207	1.00	A			
			Cr-51	pCi	173	164	1.05	A			
			Cs-134	pCi	95.9	91.0	1.05	A			
			Cs-137	pCi	142.0	138.0	1.03	A			
			Co-58	pCi	72.0	73.4	0.98	A			
			Mn-54	pCi	180	160.0	1.13	A			
			Fe-59	pCi	108.0	109.0	0.99	A			
			Zn-65	pCi	159	150	1.06	A			
Co-60	pCi	129	124	1.04	A						

TABLE D-1

**ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM**  
**TELEDYNE BROWN ENGINEERING, 2008**

(PAGE 2 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)			
June 2008	E5973-396	Charcoal	I-131	pCi	73.8	84.1	0.88	A			
September 2008	E6284-396	Milk	Sr-89	pCi/L	76.2	73.9	1.03	A			
			Sr-90	pCi/L	12.3	11.0	1.12	A			
	E6285-396	Milk	I-131	pCi/L	65.7	67.9	0.97	A			
			Ce-141	pCi/L	145	161	0.90	A			
			Cr-51	pCi/L	406	421	0.96	A			
			Cs-134	pCi/L	196	232	0.84	A			
			Cs-137	pCi/L	147	162	0.91	A			
			Co-58	pCi/L	167	179	0.93	A			
			Mn-54	pCi/L	165	166	0.99	A			
			Fe-59	pCi/L	161	144	1.12	A			
			Zn-65	pCi/L	305	319	0.96	A			
			Co-60	pCi/L	218	234	0.93	A			
				E6287-396	AP	Ce-141	pCi	79.5	76.3	1.04	A
						Cr-51	pCi	208	199	1.05	A
						Cs-134	pCi	106	110	0.96	A
						Cs-137	pCi	79.3	76.7	1.03	A
Co-58	pCi	87.7				84.4	1.04	A			
Mn-54	pCi	90.3				78.6	1.15	A			
Fe-59	pCi	81.7				68.3	1.20	A			
Zn-65	pCi	144				151	0.95	A			
	E6286-396	Charcoal	I-131	pCi	93.2	90.0	1.04	A			
December 2008	E6415-396	Milk	Sr-89	pCi/L	98.4	91.9	1.07	A			
			Sr-90	pCi/L	18.0	12.6	1.43	N (1)			
	E6416-396	Milk	I-131	pCi/L	69.2	79.9	0.87	A			
			Ce-141	pCi/L	177	191	0.93	A			
			Cr-51	pCi/L	231	246	0.94	A			
			Cs-134	pCi/L	117	134	0.87	A			
			Cs-137	pCi/L	119	120	0.99	A			
			Co-58	pCi/L	104	104	1.00	A			
			Mn-54	pCi/L	153	152	1.01	A			
			Fe-59	pCi/L	99.6	100	1.00	A			
			Zn-65	pCi/L	177	183	0.97	A			
			Co-60	pCi/L	133	133	1.00	A			
				E6418-396	AP	Ce-141	pCi	148	146	1.01	A
						Cr-51	pCi	202	187	1.08	A
Cs-134	pCi	103				102	1.01	A			
Cs-137	pCi	95.4				91.2	1.05	A			
Co-58	pCi	81.4				79.2	1.03	A			
Mn-54	pCi	113				116.0	0.97	A			
Fe-59	pCi	76.5				76.4	1.00	A			
Zn-65	pCi	122				139	0.88	A			

TABLE D-1

ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM  
TELEDYNE BROWN ENGINEERING, 2008

(PAGE 3 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)
December 2008	E6417-396	Charcoal	I-131	pCi	65.8	74.1	0.89	A

(1) NCR 09-02 initiated to investigate the failure.

(a) Teledyne Brown Engineering reported result.

(b) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) Ratio of Teledyne Brown Engineering to Analytics results.

(d) Analytics evaluation based on TBE internal QC limits: A= Acceptable. Reported result falls within ratio limits of 0.80-1.20. W-Acceptable with warning. Reported result falls within 0.70-0.80 or 1.20-1.30. N = Not Acceptable. Reported result falls outside the ratio limits of < 0.70 and > 1.30.

TABLE D-2

**ERA ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM**  
**TELEDYNE BROWN ENGINEERING, 2008**

(PAGE 1 OF 1)

Month/Year	Identification Number	Media	Nuclide	Units	Reported Value (a)	Known Value (b)	Control Limits	Evaluation (c)
January 2008	Quik <sup>tm</sup> Response	Water	Sr-89	pCi/L	37.33	19.0	11.8 - 25.2	N (1)
			Sr-90	pCi/L	40.40	42.7	31.5 - 49.0	A
			Ba-133	pCi/L	87.8	90.5	76.2 - 99.6	A
			Cs-134	pCi/L	80.67	88.9	72.9 - 97.8	A
			Cs-137	pCi/L	222.33	231	208 - 256	A
			Co-60	pCi/L	98.9	101.0	90.9 - 113	A
			Zn-65	pCi/L	352	350	315 - 408	A
			Gr-A	pCi/L	13.0	12.7	6.02 - 18.7	A
			Gr-B	pCi/L	32.7	36.2	23.8 - 43.8	A
			H-3	pCi/L	11100	11300	9840 - 12400	A
January 2008	RAD 72	Water	Sr-89	pCi/L	69.0	65.3	53.0 - 73.4	A
			Sr-90	pCi/L	35.6	41.4	30.5 - 47.6	A
			Ba-133	pCi/L	25.9	25.7	20.0 - 29.5	A
			Cs-134	pCi/L	86.5	92.6	76.0 - 102	A
			Cs-137	pCi/L	155	158	142 - 176	A
			Co-60	pCi/L	16.0	14.4	11.4 - 18.7	A
			Zn-65	pCi/L	214	204	184 - 240	A
			Gr-A	pCi/L	13.3	14.8	7.15 - 21.2	A
			Gr-B	pCi/L	21.2	22.5	13.7 - 30.6	A
			I-131	pCi/L	22.8	23.6	19.6 - 28.0	A
H-3	pCi/L	3390	3540	3000 - 3910	A			
April 2008	Rad 73	Water	Sr-89	pCi/L	65.47	60.4	48.6 - 68.2	A
			Sr-90	pCi/L	39.80	39.2	28.8 - 45.1	A
			Ba-133	pCi/L	59.63	58.3	48.3 - 64.3	A
			Cs-134	pCi/L	45.00	46.6	37.4 - 51.3	A
			Cs-137	pCi/L	97.97	102	91.8 - 115	A
			Co-60	pCi/L	75.47	76.6	68.9 - 86.7	A
			Zn-65	pCi/L	109	106	95.4 - 126	A
			Gr-A	pCi/L	41.03	50.8	26.5 - 63.7	A
			Gr-B	pCi/L	50.20	51.4	35.0 - 58.4	A
			I-131	pCi/L	26.67	28.7	23.9 - 33.6	A
H-3	pCi/L	11633	12000	10400 - 13200	A			

(1) Could find no cause for Sr-89 failure. Sample sent to outside lab for verification, but the outside laboratory was unable to confirm our numbers or ERA numbers. Studies bracketing these results, RAD 71 and RAD 72, had acceptable Sr-89 results. NCR 08-03

(a) Teledyne Brown Engineering reported result.

(b) The ERA known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) ERA evaluation: A=acceptable. Reported result falls within the Warning Limits. NA=not acceptable. Reported result falls outside of the Control Limits. CE=check for Error. Reported result falls within the Control Limits and outside of the Warning Limit.

TABLE D-3

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)  
TELEDYNE BROWN ENGINEERING, 2008

(PAGE 1 OF 2)

Month/Year	Identification Number	Media	Nuclide	Units	Reported Value (a)	Known Value (b)	Acceptance Range	Evaluation (c)
January 2008	07-MaW18	Water	Cs-134	Bq/L	-0.26		(1)	A
			Cs-137	Bq/L	0.029		(1)	A
			Co-57	Bq/L	21	22.8	16.0 - 29.6	A
			Co-60	Bq/L	8.2	8.40	5.88 - 10.92	A
			H-3	Bq/L	473	472	330 - 614	A
			Mn-54	Bq/L	12	12.1	8.5 - 15.7	A
			Sr-90	Bq/L	10.70	11.4	7.98 - 14.82	A
			Zn-65	Bq/L	15.6	16.3	11.4 - 21.2	A
	07-GrW18	Water	Gr-A	Bq/L	1.4	1.399	>0.0 - 2.798	A
			Gr-B	Bq/L	3.06	2.43	1.22 - 3.65	A
	07-MaS18	Soil	Cs-134	Bq/kg	790	854.0	598 - 1110	A
			Cs-137	Bq/kg	568	545	382 - 709	A
			Co-57	Bq/kg	424	421	295 - 547	A
			Co-60	Bq/kg	2.307	2.9	(2)	A
			Mn-54	Bq/kg	611	570	399 - 741	A
			K-40	Bq/kg	6.09	571	400 - 742	A
			Sr-90	Bq/kg	454	493.0	345 - 641	A
			Zn-65	Bq/kg	0.162		(1)	A
	07-RdF18	AP	Cs-134	Bq/sample	2.73	2.5200	1.76 - 3.28	A
			Cs-137	Bq/sample	2.88	2.7	1.89 - 3.51	A
			Co-57	Bq/sample	3.493	3.55	2.49 - 4.62	A
			Co-60	Bq/sample	1.357	1.31	0.92 - 1.70	A
			Mn-54	Bq/sample	0.006		(1)	A
			Sr-90	Bq/sample	1.61	1.548	1.084 - 2.012	A
			Zn-65	Bq/sample	2.59	2.04	1.43 - 2.65	A
	07-GrF18	AP	Gr-A	Bq/sample	0.131	0.348	>0.0 - 0.696	A
			Gr-B	Bq/sample	0.261	0.286	0.143 - 0.429	A
	January 2008	07-RdV18	Vegetation	Cs-134	Bq/sample	5.25	6.28	4.40 - 8.16
Cs-137				Bq/sample	3.13	3.41	2.39 - 4.43	A
Co-57				Bq/sample	6.837	6.89	4.82 - 8.96	A
Co-60				Bq/sample	2.44	2.77	1.94 - 3.60	A
Mn-54				Bq/sample	4.45	4.74	3.32 - 6.16	A
K-40				Bq/sample	61.3		(1)	A
Sr-90				Bq/sample	1.33	1.273	0.891 - 1.655	A
Zn-65				Bq/sample	0.085		(1)	A
August 2008	08-MaW19	Water	Cs-134	Bq/L	17.1	19.5	13.7 - 25.4	A
			Cs-137	Bq/L	21.4	23.6	16.5 - 30.7	A
			Co-57	Bq/L	-0.044		(1)	A
			Co-60	Bq/L	10.8	11.6	8.1 - 15.1	A
			H-3	Bq/L	334	341	239 - 443	A
			Mn-54	Bq/L	13.0	13.7	9.6 - 17.8	A
			Sr-90	Bq/L	6.55	6.45	4.52 - 8.39	A
			Zn-65	Bq/L	16.5	17.1	12.0 - 22.2	A

TABLE D-3

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)  
TELEDYNE BROWN ENGINEERING, 2008

(PAGE 2 OF 2)

Month/Year	Identification Number	Media	Nuclide	Units	Reported Value (a)	Known Value (b)	Acceptance Range	Evaluation (c)			
August 2008	08-GrW19	Water	Gr-A	Bq/L	0.0612	<0.56	(3)	A			
			Gr-B	Bq/L	0.222	<1.85	(3)	A			
	08-MaS19	Soil	Cs-134	Bq/kg	546	581	407 - 755	A			
			Cs-137	Bq/kg	2.52	2.8	(2)	A			
			Co-57	Bq/kg	340	333	233 - 433	A			
			Co-60	Bq/kg	157	145.0	102 - 189	A			
			Mn-54	Bq/kg	460	415	291 - 540	A			
			K-40	Bq/kg	650	571	399 - 741	A			
			Sr-90	Bq/kg	1.40		(1)	A			
			Zn-65	Bq/kg	-1.53		(1)	A			
			08-RdF19	AP		Cs-134	Bq/sample	2.46	2.6300	1.84 - 3.42	A
						Cs-137	Bq/sample	0.0063		(1)	A
Co-57	Bq/sample	1.36				1.50	1.05 - 1.95	A			
Co-60	Bq/sample	0.0143					(1)	A			
Mn-54	Bq/sample	2.70				2.64	1.85 - 3.43	A			
Sr-90	Bq/sample	1.42				1.12	0.78 - 1.46	W			
Zn-65	Bq/sample	0.975				0.94	0.66 - 1.22	A			
08-GrF19	AP		Gr-A	Bq/sample	-0.0037		(4)	A			
			Gr-B	Bq/sample	0.540	0.525	0.263 - 0.788	A			
08-RdV19	Vegetation		Cs-134	Bq/sample	4.36	5.5	3.9 - 7.2	W			
			Cs-137	Bq/sample	-0.03		(1)	A			
			Co-57	Bq/sample	6.72	7.1	5.0 - 9.2	A			
			Co-60	Bq/sample	4.04	4.70	3.3 - 6.1	A			
			Mn-54	Bq/sample	5.22	5.8	4.1 - 7.5	A			
			K-40	Bq/sample	64.4		(1)	A			
			Sr-90	Bq/sample	1.62	1.9	1.3 - 2.5	A			
Zn-65	Bq/sample	6.160	6.9	4.8 - 9.0	A						

(1) Not evaluated by MAPEP.

(2) Reported a statistically zero result.

(3) Designed to test the Safe Drinking Water screening levels. Labs reporting values less than ref values were found to be acceptable.

(4) False positive test.

(a) Teledyne Brown Engineering reported result.

(b) The MAPEP known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) DOE/MAPEP evaluation: A=acceptable, W=acceptable with warning, N=not acceptable.

Intentionally left blank

**APPENDIX E**

**ANNUAL RADIOLOGICAL GROUNDWATER  
PROTECTION PROGRAM REPORT (ARGPPR)**



Intentionally left blank

Docket No: 50-461

# CLINTON POWER STATION

Annual Radiological  
Groundwater Protection Program Report

1 January Through 31 December 2008

**Prepared By**

Teledyne Brown Engineering  
Environmental Services

**Exelon**<sup>SM</sup>

---

**Nuclear**

Clinton Power Station  
Clinton, IL 61727

**April 2009**

## Table Of Contents

I. Summary and Conclusions .....	1
II. Introduction.....	3
A. Objectives of the RGPP .....	3
B. Implementation of the Objectives .....	3
C. Program Description.....	4
D. Characteristics of Tritium (H-3) .....	5
III. Program Description.....	5
A. Sample Analysis .....	5
B. Data Interpretation.....	6
C. Background Analysis.....	7
1. Background Concentrations of Tritium .....	7
IV. Results and Discussion .....	9
A. Groundwater Results.....	9

## Appendices

Appendix A      Location Designation of the Annual Radiological Groundwater Protection Program Report (ARGPPR)

### Tables

Table A-1:      Radiological Groundwater Protection Program - Sampling Locations, Clinton Power Station, 2008

### Figures

Security-Related Information: Maps of the Clinton Power Station have been withheld from public disclosure under 10CFR2.390 and N.J.S.A. 47:1A-1.1

Appendix B      Data Tables of the Annual Radiological Groundwater Protection Program Report (ARGPPR)

### Tables

Table B-I.1      Concentrations of Tritium and Strontium in Groundwater Samples Collected in the Vicinity of Clinton Power Station, 2008.

Table B-I.2      Concentrations of Gamma Emitters in Groundwater Samples Collected in the Vicinity of Clinton Power Station, 2008.

Table B-II.1      Concentrations of Tritium and Strontium in Surface Water Samples Collected in the Vicinity of Clinton Power Station, 2008.

Table B-II.2      Concentrations of Gamma Emitters in Surface Water Samples Collected in the Vicinity of Clinton Power Station, 2008.

## I. Summary and Conclusions

In 2006, Exelon instituted a comprehensive program to evaluate the impact of station operations on groundwater and surface water in the vicinity of Clinton Power Station. This evaluation involved numerous station personnel and contractor support personnel. This report covers groundwater and surface water samples, collected outside of the Licensee required Off-Site Dose Calculation Manual (ODCM) requirements, both on and off station property in 2008. During that time period, 99 analyses were performed on 51 samples from 24 locations. The monitoring was conducted in two phases.

In assessing all the data gathered for this report, it was concluded that the operation of Clinton Power Station had no adverse radiological impact on the environment, and there are no known active releases into the groundwater or surface water at Clinton Power Station.

Gamma-emitting radionuclides associated with licensed plant operations were not detected at concentrations greater than their respective Lower Limits of Detection (LLDs) as specified in NUREG-1302 in any of the groundwater or surface water samples. In the case of tritium, Exelon specified that the independent laboratory achieve a lower limit of detection 10 times lower than that required by the United States Environmental Protection Agency (USEPA) regulation.

Strontium-90 was not detected at concentrations greater than the Lower Limit of Detection (LLD) as specified in NUREG-1302 in any of the groundwater or surface water samples.

Tritium was not detected in any of the groundwater or surface water samples at concentrations greater than the United States Environmental Protection Agency (USEPA) drinking water standard (and the Nuclear Regulatory Commission Reporting Limit) of 20,000 pCi/L. Background levels of tritium were detected at concentrations greater than the self-imposed LLD of 200 pCi/L in one of 18 groundwater monitoring locations. The tritium concentrations ranged from  $740 \pm 154$  pCi/L to  $901 \pm 173$  pCi/L.

Intentionally left blank

## II. Introduction

The Clinton Power Station (CPS), consisting of one approximately 1140 MW gross electrical power output boiling water reactor is located in Harp Township, DeWitt County, Illinois. CPS is owned and operated by AmerGen Energy Company and became operational in 1987. Unit No. 1 went critical on 15 February 1987. The site encloses approximately 13,730 acres. This includes the 4,895 acre, man-made cooling lake and about 452 acres of property not owned by AmerGen. The plant is situated on approximately 150 acres. The cooling water discharge flume – which discharges to the eastern arm of the lake – occupies an additional 130 acres. Although the nuclear reactor, supporting equipment and associated electrical generation and distribution equipment lie in Harp Township, portions of the aforementioned 13,730 acre plot reside within Wilson, Rutledge, DeWitt, Creek, Nixon and Santa Anna Townships.

This report covers those analyses performed by Teledyne Brown Engineering (TBE) on samples collected in 2008.

### A. Objectives of the RGPP

The long-term objectives of the RGPP are as follows:

1. Identify suitable locations to monitor and evaluate potential impacts from station operations before significant radiological impact to the environment and potential drinking water sources.
2. Understand the local hydrogeologic regime in the vicinity of the station and maintain up-to-date knowledge of flow patterns on the surface and shallow subsurface.
3. Perform routine water sampling and radiological analysis of water from selected locations.
4. Report new leaks, spills, or other detections with potential radiological significance to stakeholders in a timely manner.
5. Regularly assess analytical results to identify adverse trends.
6. Take necessary corrective actions to protect groundwater resources.

### B. Implementation of the Objectives

The objectives identified have been implemented at Clinton Power Station as discussed below:

1. Exelon and its consultant identified locations as described in the Phase 1 study. Phase 1 studies were conducted by Connestoga Rovers and Associates (CRA) and the results and conclusions were made available to state and federal regulators as well as the public on an Exelon web site in station specific reports.  
<http://www.exeloncorp.com/ourcompanies/powergen/nuclear/Tritium.htm>
2. The Clinton Power Station reports describe the local hydrogeologic regime. Periodically, the flow patterns on the surface and shallow subsurface are updated based on ongoing measurements.
3. Clinton Power Station will continue to perform routine sampling and radiological analysis of water from selected locations.
4. Clinton Power Station has implemented new procedures to identify and report new leaks, spills, or other detections with potential radiological significance in a timely manner.
5. Clinton Power Station staff and consulting hydrogeologist assess analytical results on an ongoing basis to identify adverse trends.

C. Program Description

1. Sample Collection

Sample locations can be found in Table A-1 and Figures A-1 and A-2, Appendix A.

Groundwater and Surface Water

Samples of water are collected, managed, transported and analyzed in accordance with approved procedures following regulatory methods. Both groundwater and surface water are collected. Sample locations, sample collection frequencies and analytical frequencies are controlled in accordance with approved station procedures. Contractor and/or station personnel are trained in the collection, preservation management, and shipment of samples, as well as in documentation of sampling events. Analytical laboratories are subject to internal quality assurance programs, inter-laboratory cross-check programs, as well as nuclear industry audits. Station personnel review and evaluate all analytical data deliverables after initial review by the contractor.



Analytical data results are reviewed by both station personnel and an independent hydrogeologist for adverse trends or changes to hydrogeologic conditions.

D. Characteristics of Tritium (H-3)

Tritium (chemical symbol H-3) is a radioactive isotope of hydrogen. The most common form of tritium is tritium oxide, which is also called "tritiated water." The chemical properties of tritium are essentially those of ordinary hydrogen.

Tritiated water behaves the same as ordinary water in both the environment and the body. Tritium can be taken into the body by drinking water, breathing air, eating food, or absorption through skin. Once tritium enters the body, it disperses quickly and is uniformly distributed throughout the body. Tritium is excreted primarily through urine with a clearance rate characterized by an effective biological half-life of about 14 days. Within one month or so after ingestion, essentially all tritium is cleared. Organically bound tritium (tritium that is incorporated in organic compounds) can remain in the body for a longer period.

Tritium is produced naturally in the upper atmosphere when cosmic rays strike air molecules. Tritium is also produced during nuclear weapons explosions, as a by-product in reactors producing electricity, and in special production reactors, where the isotopes lithium-7 and/or boron-10 are activated to produce tritium. Like normal water, tritiated water is colorless and odorless. Tritiated water behaves chemically and physically like non-tritiated water in the subsurface, and therefore tritiated water will travel at the same velocity as the average groundwater velocity.

Tritium has a half-life of approximately 12.3 years. It decays spontaneously to helium-3 ( $^3\text{He}$ ). This radioactive decay releases a beta particle (low-energy electron). The radioactive decay of tritium is the source of the health risk from exposure to tritium. Tritium is one of the least dangerous radionuclides because it emits very weak beta radiation and leaves the body relatively quickly. Since tritium is almost always found as water, it goes directly into soft tissues and organs. The associated dose to these tissues is generally uniform and is dependent on the water content of the specific tissue.

III. Program Description

A. Sample Analysis

This section describes the general analytical methodologies used by TBE

and EIML to analyze the environmental samples for radioactivity for the Clinton Power Station RGPP in 2008.

In order to achieve the stated objectives, the current program includes the following analyses:

1. Concentrations of gamma emitters in groundwater and surface water.
2. Concentrations of strontium in groundwater and surface water.
3. Concentrations of tritium in groundwater and surface water.

B. Data Interpretation

The radiological data collected prior to Clinton Power Station becoming operational were used as a baseline with which these operational data were compared. For the purpose of this report, Clinton Power Station was considered operational at initial criticality. Several factors were important in the interpretation of the data:

1. Lower Limit of Detection and Minimum Detectable Concentration

The lower limit of detection (LLD) is specified by federal regulation as a minimum sensitivity value that must be achieved routinely by the analytical parameter.

2. Laboratory Measurements Uncertainty

The estimated uncertainty in measurement of tritium in environmental samples is frequently on the order of 50% of the measurement value.

Statistically, the exact value of a measurement is expressed as a range with a stated level of confidence. The convention is to report results with a 95% level of confidence. The uncertainty comes from calibration standards, sample volume or weight measurements, sampling uncertainty and other factors. Exelon reports the uncertainty of a measurement created by statistical process (counting error) as well as all sources of error (Total Propagated Uncertainty or TPU). Each result has two values calculated. Exelon reports the TPU by following the result with plus or minus  $\pm$  the estimated sample standard deviation, as TPU, that is obtained by propagating all sources of analytical uncertainty in measurements.

Analytical uncertainties are reported at the 95% confidence level in this report for reporting consistency with the AREOR.

Gamma spectroscopy results for each type of sample were grouped as follows:

For groundwater and surface water 13 nuclides, Be-7, K-40, Mn-54, Co-58, Fe-59, Co-60, Zn-65, Nb-95, Zr-95, Cs-134, Cs-137, Ba-140 and La-140 were reported.

### C. Background Analysis

A pre-operational radiological environmental monitoring program (pre-operational REMP) was conducted to establish background radioactivity levels prior to operation of the Station. The environmental media sampled and analyzed during the pre-operational REMP were atmospheric radiation, fall-out, domestic water, surface water, marine life, milk, and vegetation. The results of the monitoring were detailed in the report entitled, Environmental Radiological Monitoring for Clinton Power Nuclear Power Station, Illinois Power Company, Annual Report 1987, May 1988.

The pre-operational REMP contained analytical results from samples collected from the surface water and groundwater.

#### 1. Background Concentrations of Tritium

The purpose of the following discussion is to summarize background measurements of tritium in various media performed by others.

##### a. Tritium Production

Tritium is created in the environment from naturally occurring processes both cosmic and subterranean, as well as from anthropogenic (i.e., man-made) sources. In the upper atmosphere, "Cosmogenic" tritium is produced from the bombardment of stable nuclides and combines with oxygen to form tritiated water, which will then enter the hydrologic cycle. Below ground, "lithogenic" tritium is produced by the bombardment of natural lithium present in crystalline rocks by neutrons produced by the radioactive decay of naturally abundant uranium and thorium. Lithogenic production of tritium is usually negligible compared to other sources due to the limited abundance of lithium in rock. The lithogenic

tritium is introduced directly to groundwater.

A major anthropogenic source of tritium and strontium-90 comes from the former atmospheric testing of thermonuclear weapons. Levels of tritium in precipitation increased significantly during the 1950s and early 1960s, and later with additional testing, resulting in the release of significant amounts of tritium to the atmosphere. The Canadian heavy water nuclear power reactors, other commercial power reactors, nuclear research and weapons production continue to influence tritium concentrations in the environment.

b. Precipitation Data

Precipitation samples are routinely collected at stations around the world for the analysis of tritium and other radionuclides. Two publicly available databases that provide tritium concentrations in precipitation are Global Network of Isotopes in Precipitation (GNIP) and USEPA's RadNet database. GNIP provides tritium precipitation concentration data for samples collected world wide from 1960 to 2006. RadNet provides tritium precipitation concentration data for samples collected at stations through out the U.S. from 1960 up to and including 2006. Based on GNIP data for sample stations located in the U.S. Midwest, tritium concentrations peaked around 1963. This peak, which approached 10,000 pCi/L for some stations, coincided with the atmospheric testing of thermonuclear weapons. Tritium concentrations in surface water showed a sharp decline up until 1975, followed by a gradual decline since that time. Tritium concentrations in Midwest precipitation have typically been below 100 pCi/L since around 1980. Tritium concentrations in wells may still be above the 200 pCi/L detection limit from the external causes described above.

c. Surface Water Data

Tritium concentrations are routinely measured in Clinton Lake.

According to the USEPA, surface water data typically has an uncertainty  $\pm 70$  to 100 pCi/L 95% confidence bound on each given measurement. Therefore, the typical background data provided may be subject to measurement uncertainty of approximately  $\pm 70$  to 100 pCi/L.

The radio-analytical laboratory is counting tritium results to an Exelon specified LLD of 200 pCi/L. Typically, the lowest positive measurement will be reported within a range of 40 – 240 pCi/L or  $140 \pm 100$  pCi/L. Clearly, these sample results cannot be distinguished as different from background at this concentration.

#### IV. Results and Discussion

##### A. Groundwater Results

###### Groundwater

Baseline samples were collected from on and off-site wells during two (2) Phases at the station. Analytical results and anomalies are discussed below.

###### Tritium

Samples from 18 locations were analyzed for tritium activity (Table B-I.1 Appendix B). Tritium values ranged from below the Exelon imposed LLD of 200 pico-curies per liter to 901 pCi/l.

###### Strontium

Samples from 18 locations were analyzed for strontium-90 (Table B-I.1 Appendix B). Strontium-90 was not detected at concentrations greater than the LLD.

###### Gamma Emitters

Naturally occurring Beryllium-7 was not detected in 2008. Additionally, naturally occurring Potassium-40 was detected in one of 18 samples. The concentration was 69 pCi/liter. No other gamma emitting nuclides were detected. (Table B-I.2, Appendix B).

##### B. Surface Water Results

###### Surface Water

Baseline samples were collected from on and off-site surface water during two (2) Phases at the station. Analytical results and anomalies are discussed below.

Tritium

Samples from six locations were analyzed for tritium activity (Table B-II.1 Appendix B). Tritium was not detected at concentrations greater than the LLD.

Strontium

Samples from six locations were analyzed for strontium-90 (Table B-II.1 Appendix B). Strontium-90 was not detected at concentrations greater than the LLD.

Gamma Emitters

No gamma emitting nuclides were detected. (Table B-II.2, Appendix B).

**APPENDIX A**

**LOCATION DESIGNATION OF THE ANNUAL  
RADIOLOGICAL GROUNDWATER PROTECTION PROGRAM  
REPORT (ARGPPR)**

TABLE A-1: Radiological Groundwater Protection Program - Sampling Locations, Clinton Power Station, 2008

Site	Site Type
B-3	Monitoring Well
Lagoon Spigot	Ground Water
MW-CL-1	Monitoring Well
MW-CL-12I	Monitoring Well
MW-CL-13I	Monitoring Well
MW-CL-13S	Monitoring Well
MW-CL-14S	Monitoring Well
MW-CL-15I	Monitoring Well
MW-CL-15S	Monitoring Well
MW-CL-16S	Monitoring Well
MW-CL-17S	Monitoring Well
MW-CL-18I	Monitoring Well
MW-CL-18S	Monitoring Well
MW-CL-19S	Monitoring Well
MW-CL-2	Monitoring Well
MW-CL-20S	Monitoring Well
MW-CL-21S	Monitoring Well
MW-CL-22S	Monitoring Well
SW-CL-1	Surface Water
SW-CL-2	Surface Water
SW-CL-4	Surface Water
SW-CL-5	Surface Water
SW-CL-6	Surface Water
SW-CL-7	Surface Water



**APPENDIX B**

**DATA TABLES OF THE ANNUAL RADIOLOGICAL  
GROUNDWATER PROTECTION PROGRAM REPORT  
(ARGPPR)**

TABLE B-I.1

**CONCENTRATIONS OF TRITIUM AND STRONTIUM IN GROUNDWATER  
SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/LITER  $\pm$  2 SIGMA

SITE	COLLECTION		
	DATE	H-3	SR-90
B-3	04/14/08	< 177	
B-3	10/22/08	< 138	< 1.0
MW-CL-1	04/23/08	< 191	
MW-CL-1	10/22/08	< 146	< 1.6
MW-CL-12I	04/15/08	< 184	
MW-CL-12I	10/22/08	< 138	< 1.0
MW-CL-13I	04/23/08	< 196	
MW-CL-13I	10/23/08	< 144	< 1.4
MW-CL-13S	04/23/08	< 194	
MW-CL-13S	10/23/08	179 $\pm$ 101	< 1.2
MW-CL-14S	04/23/08	< 178	
MW-CL-14S	10/22/08	192 $\pm$ 100	< 1.2
MW-CL-15I	04/15/08	< 181	
MW-CL-15I	10/23/08	< 143	< 1.1
MW-CL-15S	04/14/08	< 172	
MW-CL-15S	10/23/08	< 143	< 1.0
MW-CL-16S	04/23/08	< 193	
MW-CL-16S	10/22/08	< 145	< 1.1
MW-CL-17S	04/23/08	< 195	
MW-CL-17S	10/22/08	< 148	< 1.0
MW-CL-18I	04/23/08	< 195	
MW-CL-18I	10/22/08	< 148	< 1.0
MW-CL-18S	04/23/08	< 193	
MW-CL-18S	10/22/08	< 141	< 1.2
MW-CL-19S	04/15/08	< 167	
MW-CL-19S	10/22/08	< 139	< 0.9
MW-CL-2	04/15/08	< 183	
MW-CL-2	10/22/08	< 147	< 1.4
MW-CL-20S	04/14/08	< 169	
MW-CL-20S	10/22/08	< 137	< 1.2
MW-CL-21S	02/25/08	819 $\pm$ 154	
MW-CL-21S	04/14/08	740 $\pm$ 154	
MW-CL-21S	07/09/08	901 $\pm$ 173	
MW-CL-21S	10/23/08	744 $\pm$ 147	< 1.1
MW-CL-22S	04/23/08	< 194	
MW-CL-22S	10/22/08	< 146	< 0.9
LAGOON SPIGOT	04/23/08	< 191	
LAGOON SPIGOT	05/16/08	< 198	
LAGOON SPIGOT	10/22/08	< 143	< 0.8

TABLE B-1.2

CONCENTRATIONS OF GAMMA EMITTERS IN GROUND WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008

RESULTS IN UNITS OF PCI/LITER ± SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
B-3	10/22/08	< 23	< 53	< 2	< 2	< 6	< 2	< 4	< 2	< 4	< 2	< 2	< 54	< 11
MW-CL-1	10/22/08	< 19	69 ± 33	< 2	< 2	< 5	< 2	< 3	< 2	< 3	< 1	< 2	< 48	< 15
MW-CL-12I	10/22/08	< 17	< 42	< 1	< 2	< 6	< 1	< 3	< 2	< 3	< 1	< 1	< 44	< 15
MW-CL-13I	10/23/08	< 22	< 40	< 2	< 2	< 6	< 1	< 3	< 3	< 4	< 2	< 1	< 55	< 12
MW-CL-13S	10/23/08	< 19	< 43	< 1	< 2	< 5	< 1	< 3	< 2	< 4	< 1	< 1	< 40	< 13
MW-CL-14S	10/22/08	< 18	< 13	< 1	< 2	< 5	< 2	< 3	< 2	< 3	< 1	< 1	< 38	< 11
MW-CL-15I	10/23/08	< 16	< 11	< 1	< 1	< 4	< 1	< 3	< 2	< 3	< 1	< 1	< 42	< 13
MW-CL-15S	10/23/08	< 19	< 32	< 1	< 2	< 5	< 1	< 3	< 2	< 3	< 1	< 1	< 46	< 14
MW-CL-16S	10/22/08	< 18	< 42	< 1	< 2	< 5	< 1	< 3	< 2	< 4	< 1	< 1	< 49	< 12
MW-CL-17S	10/22/08	< 15	< 28	< 1	< 2	< 4	< 1	< 2	< 2	< 3	< 1	< 1	< 32	< 14
MW-CL-18I	10/22/08	< 15	< 25	< 1	< 1	< 3	< 1	< 2	< 1	< 2	< 1	< 1	< 26	< 8
MW-CL-18S	10/22/08	< 17	< 11	< 1	< 2	< 4	< 1	< 3	< 2	< 3	< 1	< 1	< 45	< 15
MW-CL-19S	10/22/08	< 16	< 36	< 1	< 2	< 4	< 1	< 2	< 2	< 3	< 1	< 1	< 39	< 11
MW-CL-2	10/22/08	< 17	< 11	< 1	< 2	< 4	< 1	< 3	< 2	< 3	< 1	< 1	< 44	< 12
MW-CL-20S	10/22/08	< 17	< 10	< 1	< 1	< 3	< 2	< 3	< 2	< 2	< 1	< 1	< 35	< 13
MW-CL-21S	10/23/08	< 17	< 33	< 1	< 2	< 4	< 1	< 2	< 2	< 3	< 1	< 1	< 44	< 13
MW-CL-22S	10/22/08	< 16	< 12	< 1	< 2	< 4	< 1	< 2	< 2	< 3	< 1	< 1	< 36	< 14
LAGOON SPIGOT	10/22/08	< 14	< 30	< 1	< 1	< 3	< 1	< 2	< 1	< 3	< 1	< 1	< 35	< 10

B-2

(1) WELL RAN DRY. ONLY ENOUGH WATER COLLECTED FOR H-3 ANALYSIS

**TABLE B-II.1 CONCENTRATIONS OF TRITIUM AND STRONTIUM IN SURFACE WATER SAMPLES COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/LITER  $\pm$  2 SIGMA

SITE	COLLECTION		
	DATE	H-3	SR-90
SW-CL-1	04/15/08	< 170	
SW-CL-1	10/22/08	< 145	< 1.0
SW-CL-2	04/14/08	< 177	
SW-CL-2	10/22/08	< 142	< 1.0
SW-CL-4	04/14/08	< 166	
SW-CL-4	10/22/08	< 144	< 1.3
SW-CL-5	04/14/08	< 179	
SW-CL-5	10/22/08	< 143	< 0.7
SW-CL-6	04/15/08	< 180	
SW-CL-6	10/22/08	< 145	< 1.0
SW-CL-7	04/14/08	< 169	
SW-CL-7	10/22/08	< 135	< 0.8

TABLE B-II.2

**CONCENTRATIONS OF GAMMA EMITTERS IN SURFACE WATER SAMPLES  
COLLECTED IN THE VICINITY OF CLINTON POWER STATION, 2008**

RESULTS IN UNITS OF PCI/LITER ± SIGMA

STC	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
SW-CL-1	10/22/08	< 15	< 30	< 1	< 2	< 4	< 1	< 2	< 1	< 3	< 1	< 1	< 36	< 13
SW-CL-2	10/22/08	< 13	< 22	< 1	< 1	< 3	< 1	< 2	< 1	< 2	< 1	< 1	< 30	< 10
SW-CL-4	10/22/08	< 15	< 34	< 1	< 2	< 4	< 1	< 2	< 2	< 3	< 1	< 1	< 39	< 11
SW-CL-5	10/22/08	< 19	< 12	< 1	< 2	< 5	< 1	< 2	< 2	< 3	< 1	< 1	< 44	< 14
SW-CL-6	10/22/08	< 14	< 31	< 1	< 1	< 3	< 1	< 2	< 2	< 3	< 1	< 1	< 40	< 11
SW-CL-7	10/22/08	< 18	< 33	< 1	< 2	< 4	< 1	< 3	< 2	< 3	< 1	< 1	< 46	< 13