

April 29, 2009

U. S. Nuclear Regulatory Commission  
Document Control Desk  
Washington, D.C. 20555

Subject: **Docket Nos. 50-206, 50-361 and 50-362**  
**Annual Radioactive Effluent Release Report - 2008**  
**San Onofre Nuclear Generating Station, Units 1, 2, and 3**

Dear Sir or Madam:

In accordance with 10 CFR 50.36(a), Unit 1 Permanently Defueled Technical Specification (TS) Section D6.9.1.4, and Units 2 and 3 TS Section 5.7.1.3, Southern California Edison (SCE) is providing the Annual Radioactive Effluent Release Report - 2008 (ARERR) for San Onofre Nuclear Generating Station, Units 1, 2, and 3. The period of the report is January 1, 2008 through December 31, 2008.

Unit 1 Permanently Defueled TS Section D6.14.2.3 and Units 2 and 3 TS Section 5.5.2.1.1(c) require revisions made to the Offsite Dose Calculation Manual (ODCM) for this reporting period to be submitted with the ARERR.

On February 29, 2008, SO123-ODCM, Revision 1 was issued and is included with this submittal. To comply with Technical Specification 5.5.2.1.1, change bars are included on all affected pages.

If you require additional information, please contact Mr. Geoffrey Cook at (949) 368-9008.

Sincerely,



Enclosure 1: Annual Radioactive Effluent Release Report - 2008  
Enclosure 2: ODCM, SO123-ODCM, Revision 1

cc: E. E. Collins, NRC Regional Administrator, Region IV  
J. E. Whitten, NRC Region IV, Nuclear Material Safety Branch Chief  
R. Hall, NRC Project Manager, SONGS Units 2 and 3  
J. C. Shepherd, NRC Project Manager, SONGS Unit 1  
G. G. Warnick, NRC Senior Resident Inspector, SONGS Units 2 and 3  
S. Y. Hsu, California Department of Public Health

**Enclosure 1:**

**Annual Radioactive Effluent Release Report - 2008**



# **SAN ONOFRE NUCLEAR GENERATING STATION**

---

Annual Radioactive Effluent Release Report

2008

January - December

## **PREFACE**

San Onofre Nuclear Generating Station is located next to San Onofre State Beach, adjoining Camp Pendleton Marine Corps Base, in San Diego County, 64 miles south of Los Angeles, California. There are two operating pressurized water reactors with a total rated capacity of 2254 net megawatts electrical.

Unit 1, rated at 410 net megawatts electrical, was supplied by Westinghouse Electric Company and began commercial operation on January 1, 1968. The unit was permanently shutdown on November 30, 1992. By August 31, 2004, all fuel was transferred to the Independent Spent Fuel Storage Installation (ISFSI). As of November 29, 2006, all remaining monitored effluent pathways were permanently removed from service. Unit 1 is owned by Southern California Edison (80%) and San Diego Gas and Electric (20%).

Unit 2 and Unit 3 were supplied by Combustion Engineering, Inc., with turbine generators supplied by G.E.C. Turbine Generators, Ltd., of England. The units began commercial operation on August 18, 1983, and April 1, 1984, respectively and are rated at 1127 net megawatts electrical each. The twin units are owned by Southern California Edison (78.21%), San Diego Gas and Electric (20%), and the City of Riverside (1.79%).

Effective December 29, 2006, the City of Anaheim transferred its ownership interests in San Onofre Units 2 and 3 and the entitlement to the Units 2 and 3 output, to Southern California Edison Company, except that it retains its ownership interests in its used nuclear fuel and Units 2 and 3's independent spent fuel storage installation located on the facility's site. In addition, the City of Anaheim retains financial responsibility for its used fuel and for a portion of the Units 2 and 3 decommissioning costs. The City of Anaheim remains a licensee for purposes of its retained interests and liabilities.

## TABLE OF CONTENTS

SECTION A - INTRODUCTION .....	1
SECTION B - GASEOUS EFFLUENTS .....	2
SECTION C - LIQUID EFFLUENTS .....	11
SECTION D - PREVIOUS RADIOACTIVE EFFLUENT RELEASE REPORT ADDENDUM .....	19
SECTION E -RADWASTE SHIPMENTS	
UNITS 2 & 3 .....	20
DECOMMISSIONED UNIT 1 .....	24
COMMON .....	27
SECTION F - APPLICABLE LIMITS .....	29
SECTION G - ESTIMATION OF ERROR .....	33
SECTION H - 10 CFR 50 APPENDIX I REQUIREMENTS .....	34
SECTION I - CHANGES TO OFFSITE DOSE CALCULATION MANUAL .....	38
SECTION J - CHANGES TO RADIOACTIVE WASTE TREATMENT SYSTEMS .....	39
SECTION K - MISCELLANEOUS .....	39
Abnormal Releases .....	39
Effluent Monitors Out of Service Greater Than 30 days .....	40
Onsite Groundwater Samples .....	43
40 CFR 190 Requirements .....	48
SECTION L - S.O.N.G.S. CONCLUSIONS .....	49
METEOROLOGY .....	50

# ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

### SECTION A. INTRODUCTION

This Annual Radioactive Effluent Release Report summarizes the gaseous and liquid radioactive effluent releases and radwaste shipments made from the San Onofre Nuclear Generating Station. It will also summarize the radwaste shipments from the decommissioning of Unit 1. This report is prepared in the general format of USNRC Regulatory Guide 1.21 and includes:

1. Quarterly Summaries of Gaseous and Liquid Effluents for "Continuous" and "Batch" Modes of Release
2. Percent of Applicable Limits
3. Estimated Total Percent Error
4. Lower Limit of Detection Concentrations
5. Batch Release Summaries
6. Previous Radioactive Effluent Release Report Addendum
7. Radwaste Shipments
8. 10 CFR 50 Appendix I Requirements
9. Changes to Offsite Dose Calculation Manual

# ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

### SECTION B. GASEOUS EFFLUENTS

Table 1A, "Gaseous Effluents-Summation of All Releases," provides a detailed listing of gaseous effluents released quarterly in four categories: fission and activation gases, iodine-131, particulates with half-lives greater than eight days, and tritium. Listed for each of the four categories are:

- (1) the total curies released
- (2) the average release rate
- (3) the percent of applicable limit
- (4) the estimated total error

In addition, the particulate category lists the gross alpha radioactivity released for each quarter.

The methodology used to calculate the percent of Applicable Limit is presented in Section F of this report. The methodology used in Table 1A to calculate the estimated total error is presented in Section G of this report.

Table 1B, "Gaseous Effluents-Elevated Release," has not been included in this report since San Onofre Nuclear Generating Station does not conduct elevated releases.

Table 1C, "Gaseous Effluents-Ground Level Releases," provides the systematic listing by radionuclide for the quantity of radioactivity released in three categories: fission gases, iodines, and particulates. The total radioactivity for each radionuclide is listed for each quarterly period by both "continuous" and "batch" modes of release.

Waste gas decay tank releases are considered to be "batch" releases. Containment purges and plant stack releases are considered to be "continuous" releases.

Table 1D, "Gaseous Effluents-Lower Limit of Detection," provides a listing of lower limit of detection concentrations for radionuclides not detected in Tables 1A and 1C.

Table 1E, "Gaseous Effluents-Radiation Doses at the Site Boundary," provides a quarterly summary of doses at the site boundary for this report period.

Table 1F, "Gaseous Effluents-Batch Release Summary," provides summary information regarding batch releases conducted during this report period from San Onofre Nuclear Generating Station.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 1A

GASEOUS EFFLUENTS-SUMMATION OF ALL RELEASES

		Unit	First Quarter	Second Quarter	Estimated Total Error, %
A. Fission and activation gases					
1.	Total release	Ci	1.89E+1	1.21E+1	3.00E+1
2.	Average release rate for period	µCi/sec	2.40E+0	1.54E+0	
3.	Percent of applicable limit	% MPC	4.39E-3	5.14E-3	
4.	Percent Effluent Concentration Limit	% ECL	4.71E-3	1.36E-2	
B. Iodines					
1.	Total iodine-131	Ci	1.35E-5	1.12E-4	1.90E+1
2.	Average release rate for period	µCi/sec	1.72E-6	1.42E-5	
3.	Percent of applicable limit	% MPC	8.24E-6	6.84E-5	
4.	Percent Effluent Concentration Limit	% ECL	4.12E-6	3.42E-5	
C. Particulates					
1.	Particulates with half-lives >8 days	Ci	3.79E-4	4.69E-4	1.60E+1
2.	Average release rate for period	µCi/sec	4.82E-5	5.96E-5	
3.	Percent of applicable limit	% MPC	3.96E-5	6.53E-5	
4.	Percent Effluent Concentration Limit	% ECL	2.01E-4	3.49E-4	
5.	Gross alpha activity	Ci	<LLD	<LLD	5.00E+1
D. Tritium					
1.	Total release	Ci	1.37E+1	1.91E+1	2.50E+1
2.	Average release rate for period	µCi/sec	1.74E+0	2.43E+0	
3.	Percent of applicable limit	% MPC	4.18E-3	5.83E-3	
4.	Percent Effluent Concentration Limit	% ECL	8.36E-3	1.17E-2	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 1A (Continued)

GASEOUS EFFLUENTS-SUMMATION OF ALL RELEASES

		Unit	Third Quarter	Fourth Quarter	Estimated Total Error, %
A. Fission and activation gases					
1.	Total release	Ci	1.63E+1	3.33E+1	3.00E+1
2.	Average release rate for period	μCi/sec	2.05E+0	4.19E+0	
3.	Percent of applicable limit	% MPC	3.56E-3	8.90E-3	
4.	Percent Effluent Concentration Limit	% ECL	3.23E-3	1.39E-2	
B. Iodines					
1.	Total iodine-131	Ci	1.18E-4	1.00E-3	1.90E+1
2.	Average release rate for period	μCi/sec	1.48E-5	1.26E-4	
3.	Percent of applicable limit	% MPC	7.13E-5	6.04E-4	
4.	Percent Effluent Concentration Limit	% ECL	3.56E-5	3.02E-4	
C. Particulates					
1.	Particulates with half-lives >8 days	Ci	1.05E-4	2.58E-4	1.60E+1
2.	Average release rate for period	μCi/sec	1.31E-5	3.25E-5	
3.	Percent of applicable limit	% MPC	8.37E-6	2.92E-5	
4.	Percent Effluent Concentration Limit	% ECL	4.13E-5	1.58E-4	
5.	Gross alpha activity	Ci	<LLD	<LLD	5.00E+1
D. Tritium					
1.	Total release	Ci	1.82E+1	2.99E+1	2.50E+1
2.	Average release rate for period	μCi/sec	2.29E+0	3.76E+0	
3.	Percent of applicable limit	% MPC	5.50E-3	9.03E-3	
4.	Percent Effluent Concentration Limit	% ECL	1.10E-2	1.81E-2	

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 1C

GASEOUS EFFLUENTS-GROUND LEVEL RELEASES  
CONTINUOUS MODE

Radionuclides Released	Unit	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
1. Fission and activation gases					
argon-41	Ci	4.09E-1	2.02E+0	2.13E-1	1.68E+0
krypton-85	Ci	<LLD	<LLD	<LLD	<LLD
krypton-85m	Ci	<LLD	<LLD	<LLD	<LLD
krypton-87	Ci	<LLD	<LLD	<LLD	<LLD
krypton-88	Ci	<LLD	<LLD	<LLD	<LLD
xenon-133	Ci	1.72E+1	1.01E+1	1.61E+1	2.98E+1
xenon-133m	Ci	<LLD	<LLD	<LLD	1.84E-1
xenon-135	Ci	<LLD	<LLD	<LLD	<LLD
xenon-135m	Ci	<LLD	<LLD	<LLD	<LLD
xenon-138	Ci	<LLD	<LLD	<LLD	<LLD
Total for period	Ci	1.76E+1	1.21E+1	1.63E+1	3.17E+1
2. Iodines					
iodine-131	Ci	1.35E-5	1.12E-4	1.18E-4	1.00E-3
iodine-132	Ci	1.30E-7	<LLD	<LLD	1.56E-4
iodine-133	Ci	4.28E-5	1.64E-4	3.03E-4	1.31E-4
iodine-135	Ci	<LLD	<LLD	<LLD	<LLD
Total for period	Ci	5.64E-5	2.76E-4	4.21E-4	1.29E-3

LLD Lower Limit of Detection; see Table 1D.

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 1C (Continued)

GASEOUS EFFLUENTS-GROUND LEVEL RELEASES  
CONTINUOUS MODE

Radionuclides Released	Unit	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
3. Particulates					
barium-140	Ci	<LLD	<LLD	<LLD	<LLD
bromine-82	Ci	7.83E-5	6.05E-5	4.88E-5	1.53E-4
cerium-141	Ci	<LLD	<LLD	<LLD	<LLD
cerium-144	Ci	<LLD	<LLD	<LLD	<LLD
cesium-134	Ci	<LLD	<LLD	<LLD	<LLD
cesium-137	Ci	2.42E-5	<LLD	<LLD	2.33E-6
cobalt-57	Ci	<LLD	1.51E-6	<LLD	<LLD
cobalt-58	Ci	1.97E-4	1.60E-4	7.40E-5	1.32E-4
cobalt-60	Ci	1.48E-4	2.62E-4	3.05E-5	1.24E-4
iron-59	Ci	<LLD	<LLD	<LLD	<LLD
lanthanum-140	Ci	<LLD	<LLD	<LLD	<LLD
manganese-54	Ci	7.67E-6	1.53E-5	<LLD	<LLD
molybdenum-99	Ci	<LLD	<LLD	<LLD	<LLD
niobium-95	Ci	2.07E-6	<LLD	<LLD	<LLD
niobium-97	Ci	1.46E-5	1.32E-4	<LLD	<LLD
silver-110m	Ci	<LLD	3.00E-5	<LLD	<LLD
strontium-89	Ci	<LLD	<LLD	<LLD	<LLD
strontium-90	Ci	<LLD	<LLD	<LLD	<LLD
zinc-65	Ci	<LLD	<LLD	<LLD	<LLD

LLD Lower Limit of Detection; see Table 1D.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 1C (Continued)

GASEOUS EFFLUENTS-GROUND LEVEL RELEASES  
 BATCH MODE \*

Radionuclides Released	Unit	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
1. Fission and activation gases					
krypton-85	Ci	1.30E+0	**	**	1.64E+0
krypton-85m	Ci	<LLD	**	**	<LLD
krypton-87	Ci	<LLD	**	**	<LLD
krypton-88	Ci	<LLD	**	**	<LLD
xenon-133	Ci	6.87E-3	**	**	<LLD
xenon-133m	Ci	<LLD	**	**	<LLD
xenon-135	Ci	<LLD	**	**	<LLD
xenon-135m	Ci	<LLD	**	**	<LLD
xenon-138	Ci	<LLD	**	**	<LLD
Total for period	Ci	1.31E+0	**	**	1.64E+0

LLD Lower Limit of Detection; see Table 1D.

\* Iodines and particulates are not analyzed prior to release via batch mode.

\*\* No batch releases were conducted in the second and third quarters of 2008.

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 1D

GASEOUS EFFLUENTS-LOWER LIMIT OF DETECTION  
CONTINUOUS and BATCH MODE

Radionuclides	Continuous Mode LLD ( $\mu\text{Ci/cc}$ )	Batch Mode LLD ( $\mu\text{Ci/cc}$ )
1. Fission and activation gases		
krypton-85	1.60E-5	N/A
krypton-85m	3.70E-8	2.30E-6
krypton-87	1.90E-7	9.80E-6
krypton-88	1.30E-7	8.10E-6
xenon-133	*	5.10E-6
xenon-133m	3.00E-7	2.00E-5
xenon-135	3.90E-8	2.50E-6
xenon-135m	1.50E-6	3.00E-5
xenon-138	2.60E-6	4.80E-5
2. Iodines		
iodine-132	1.30E-9	N/A
iodine-135	1.50E-10	N/A
3. Particulates		
barium-140	5.00E-13	N/A
cerium-141	5.80E-14	N/A
cerium-144	2.30E-13	N/A
cesium-134	1.40E-13	N/A
cesium-137	1.20E-13	N/A
cobalt-57	2.90E-14	N/A
iron-59	3.10E-13	N/A
lanthanum-140	1.00E-12	N/A
manganese-54	1.30E-13	N/A
molybdenum-99	7.00E-14	N/A
niobium-95	1.30E-13	N/A
niobium-95	1.40E-12	N/A
silver-110m	1.80E-13	N/A
strontium-89	1.00E-11	N/A
strontium-90	1.00E-11	N/A
zinc-65	3.30E-13	N/A
4. alpha	1.00E-11	N/A

\* Radionuclide was >LLD in all 4 quarters.

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 1E

## GASEOUS EFFLUENTS-RADIATION DOSES AT THE SITE BOUNDARY

		Unit	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
A. Noble Gas						
1.	Gamma Air Dose	mrad	1.51E-3	3.41E-3	1.17E-3	3.99E-3
2.	Percent Applicable Limit	%	1.51E-2	3.41E-2	1.17E-2	3.99E-2
3.	Beta Air Dose	mrad	3.34E-3	2.62E-3	2.68E-3	6.13E-3
4.	Percent Applicable Limit	%	1.67E-2	1.31E-2	1.34E-2	3.07E-2
B. Tritium, Iodine, Particulates (at the nearest receptor)						
1.	Organ Dose	mrem	4.49E-3	5.96E-3	2.75E-3	6.57E-3
2.	Percent Applicable Limit	%	2.99E-2	3.97E-2	1.83E-2	4.38E-2

NOTE: Calculations performed in accordance with the ODCM utilizing the historical X/Q.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 1F

GASEOUS EFFLUENTS-BATCH RELEASE SUMMARY

	12 month period
1. Number of batch releases:	5 releases
2. Total time period for batch releases:	1849 minutes
3. Maximum time period for a batch release:	485 minutes
4. Average time period for a batch release:	370 minutes
5. Minimum time period for a batch release:	282 minutes

# ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

### SECTION C. LIQUID EFFLUENTS

Table 2A, "Liquid Effluents-Summation of All Releases," provides a detailed summary of liquid effluents released quarterly in three categories: fission and activation products, tritium, and dissolved and entrained gases. Listed for each of the three categories are:

- (1) the total curies released
- (2) the average diluted concentration
- (3) the percent of applicable limit
- (4) the estimated total error

In addition, Table 2A lists:

- (1) the gross alpha radioactivity
- (2) the volume of waste released (prior to dilution)
- (3) the volume of dilution water

The methodology used to calculate the percent of applicable limit is presented in Section F of this report. The methodology used to calculate the estimated total error in Table 2A is presented in Section G of this report.

Table 2B, "Liquid Effluents," provides the systematic listing by radionuclide for the quantity of radioactivity released in each category. The total radioactivity of each radionuclide released is listed for each quarterly period by both "continuous" and "batch" modes of release.

Table 2C, "Liquid Effluents-Lower Limit of Detection," provides a listing of lower limit of detection concentrations for radionuclides not detected in Table 2B.

Table 2D, "Liquid Effluents-Radiation Doses at the Liquid Site Boundary," presents a quarterly summary of doses at the Liquid Site Boundary for this report period.

Table 2E, "Liquid Effluents-Batch Release Summary," provides summary information regarding batch releases conducted during this report period from San Onofre Nuclear Generating Station.

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 2A

## LIQUID EFFLUENTS-SUMMATION OF ALL RELEASES

		Unit	First Quarter	Second Quarter	Estimated Total Error, %
A. Fission and activation products					
1.	Total release (not including tritium,	Ci	1.03E-2	9.15E-3	1.90E+1
2.	Average diluted concentration during	μCi/ml	1.38E-11	1.21E-11	
3.	Percent of applicable limit	% MPC	1.67E-5	1.84E-5	
4.	Percent Effluent Concentration Limit	% ECL	1.04E-4	1.42E-4	
B. Tritium					
		Ci	7.82E+1	2.05E+2	1.90E+1
2.	Average diluted concentration during	μCi/ml	1.05E-7	2.71E-7	
3.	Percent of applicable limit	% MPC	3.49E-3	9.02E-3	
4.	Percent Effluent Concentration Limit	% ECL	1.05E-2	2.71E-2	
C. Dissolved and entrained gases					
1.	Total release	Ci	2.28E-2	3.45E-2	1.90E+1
2.	Average diluted concentration during	μCi/ml	3.05E-11	4.56E-11	
3.	Percent of applicable limit	% MPC	1.53E-5	2.28E-5	
4.	Percent Effluent Concentration Limit	% ECL	1.53E-5	2.28E-5	
D. Gross alpha radioactivity					
1.	Total release	Ci	<LLD	<LLD	5.00E+1
E. Volume of waste released (batch & continuous,					
		liters	4.12E+7	4.74E+7	5.00E+0
F. Volume of dilution water used during period					
		liters	7.48E+11	7.58E+11	5.00E+0

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 2A (Continued)

LIQUID EFFLUENTS-SUMMATION OF ALL RELEASES

		Unit	Third	Fourth	Estimated
1.	Total release (not including tritium,	Ci	1.21E-2	8.42E-3	1.90E+1
2.	Average diluted concentration during	μCi/ml	1.58E-11	1.42E-11	
3.	Percent of applicable limit	% MPC	2.49E-5	2.09E-5	
4.	Percent Effluent Concentration Limit	% ECL	2.11E-4	1.54E-4	
1.	Total release	Ci	4.95E+2	2.65E+2	1.90E+1
2.	Average diluted concentration during	μCi/ml	6.47E-7	4.47E-7	
3.	Percent of applicable limit	% MPC	2.16E-2	1.49E-2	
4.	Percent Effluent Concentration Limit	% ECL	6.47E-2	4.47E-2	
1.	Total release	Ci	3.23E+0	6.10E-1	1.90E+1
2.	Average diluted concentration during	μCi/ml	4.22E-9	1.03E-9	
3.	Percent of applicable limit	% MPC	2.11E-3	5.14E-4	
4.	Percent Effluent Concentration Limit	% ECL	2.11E-3	5.14E-4	
1.	Total release	Ci	<LLD	<LLD	5.00E+1
E.	Volume of waste released (batch & continuous,	liters	5.46E+7	4.57E+7	5.00E+0
		liters	7.65E+11	5.93E+11	5.00E+0

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 2B

LIQUID EFFLUENTS  
CONTINUOUS MODE

Radionuclides Released	Unit	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
1. Fission and activation products					
barium-140	Ci	<LLD	<LLD	<LLD	<LLD
cerium-141	Ci	<LLD	<LLD	<LLD	<LLD
cerium-144	Ci	<LLD	<LLD	<LLD	<LLD
cesium-134	Ci	<LLD	<LLD	<LLD	<LLD
cesium-137	Ci	<LLD	<LLD	5.10E-6	<LLD
chromium-51	Ci	<LLD	<LLD	<LLD	<LLD
cobalt-58	Ci	<LLD	<LLD	<LLD	<LLD
cobalt-60	Ci	<LLD	<LLD	<LLD	<LLD
iodine-131	Ci	<LLD	<LLD	<LLD	<LLD
iron-55	Ci	<LLD	<LLD	<LLD	<LLD
iron-59	Ci	<LLD	<LLD	<LLD	<LLD
lanthanum-140	Ci	<LLD	<LLD	<LLD	<LLD
manganese-54	Ci	<LLD	<LLD	<LLD	<LLD
molybdenum-99	Ci	<LLD	<LLD	<LLD	<LLD
niobium-95	Ci	<LLD	<LLD	<LLD	<LLD
strontium-89	Ci	<LLD	<LLD	<LLD	<LLD
strontium-90	Ci	<LLD	<LLD	<LLD	<LLD
technetium-99m	Ci	<LLD	<LLD	<LLD	<LLD
zinc-65	Ci	<LLD	<LLD	<LLD	<LLD
zirconium-95	Ci	<LLD	<LLD	<LLD	<LLD
Total for period	Ci	<LLD	<LLD	5.10E-6	<LLD
2. Dissolved and entrained gases					
xenon-133	Ci	<LLD	<LLD	<LLD	<LLD
xenon-135	Ci	<LLD	<LLD	<LLD	<LLD
Total for period	Ci	<LLD	<LLD	<LLD	<LLD

LLD Lower Limit of Detection; see Table 2C

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 2B (Continued)

LIQUID EFFLUENTS  
BATCH MODE

Radionuclides Released	Unit	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
1. Fission and activation products					
antimony-124	Ci	<LLD	<LLD	<LLD	4.87E-6
antimony-125	Ci	9.88E-4	2.63E-4	4.01E-4	8.44E-4
barium-140	Ci	<LLD	<LLD	<LLD	<LLD
cerium-141	Ci	<LLD	<LLD	<LLD	<LLD
cerium-144	Ci	<LLD	<LLD	<LLD	<LLD
cesium-134	Ci	1.01E-5	<LLD	3.73E-5	5.51E-5
cesium-137	Ci	5.44E-5	1.26E-4	2.65E-4	1.09E-4
chromium-51	Ci	6.67E-4	<LLD	3.94E-4	1.35E-3
cobalt-57	Ci	1.23E-5	8.97E-6	1.53E-5	1.26E-5
cobalt-58	Ci	2.47E-3	2.17E-3	3.82E-3	3.49E-3
cobalt-60	Ci	1.16E-3	1.96E-3	2.86E-3	1.43E-3
iodine-131	Ci	<LLD	<LLD	<LLD	<LLD
iron-55	Ci	3.09E-3	2.29E-3	2.78E-3	<LLD
iron-59	Ci	1.61E-4	1.05E-4	<LLD	4.81E-6
lanthanum-140	Ci	<LLD	<LLD	<LLD	<LLD
manganese-54	Ci	1.52E-4	2.48E-4	3.18E-4	1.56E-4
molybdenum-99	Ci	<LLD	<LLD	<LLD	<LLD
niobium-95	Ci	7.58E-4	1.05E-3	4.36E-4	4.46E-4
niobium-97	Ci	9.56E-6	<LLD	<LLD	<LLD
silver-110m	Ci	4.03E-4	4.52E-4	4.52E-4	1.33E-4
strontium-89	Ci	<LLD	<LLD	<LLD	<LLD
strontium-90	Ci	<LLD	<LLD	<LLD	<LLD
technetium-99m	Ci	<LLD	<LLD	<LLD	<LLD
tin-113	Ci	<LLD	<LLD	<LLD	6.19E-5
tin-117m	Ci	2.54E-5	<LLD	<LLD	<LLD
zinc-65	Ci	<LLD	<LLD	<LLD	<LLD
zirconium-95	Ci	3.80E-4	4.69E-4	3.00E-4	3.24E-4
Total for period	Ci	1.03E-2	9.15E-3	1.21E-2	8.42E-3
2. Dissolved and entrained gases					
krypton-85	Ci	2.25E-2	3.43E-2	3.01E-1	1.23E-1
xenon-131m	Ci	<LLD	<LLD	7.15E-2	1.56E-2
xenon-133	Ci	3.11E-4	2.34E-4	2.84E+0	4.70E-1
xenon-133m	Ci	<LLD	<LLD	1.61E-2	1.23E-3
xenon-135	Ci	<LLD	<LLD	4.01E-4	<LLD
Total for period	Ci	2.28E-2	3.45E-2	3.23E+0	6.10E-1

LLD Lower Limit of Detection; see Table 2C.

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 2C

## LIQUID EFFLUENTS-LOWER LIMIT OF DETECTION

Radionuclides	LLD ( $\mu\text{Ci/ml}$ ) Continuous Mode	LLD ( $\mu\text{Ci/ml}$ ) Batch Mode
1. Fission and activation products		
antimony-124	N/A	2.70E-7
barium-140	3.10E-7	2.50E-7
cerium-141	4.60E-8	4.30E-8
cerium-144	1.90E-7	1.90E-7
cesium-134	8.00E-8	8.00E-8
cesium-137	6.80E-8	*
chromium-51	3.50E-7	3.20E-7
cobalt-58	7.30E-8	*
cobalt-60	1.10E-7	*
iodine-131	6.10E-8	4.60E-8
iron-55	1.00E-6	1.00E-6
iron-59	1.70E-7	1.60E-7
lanthanum-140	6.10E-7	2.00E-7
manganese-54	7.20E-8	*
molybdenum-99	6.10E-8	2.80E-8
niobium-95	7.30E-8	*
niobium-97	1.10E-6	1.60E-7
strontium-89	5.00E-8	5.00E-8
strontium-90	5.00E-8	5.00E-8
technetium-99m	6.20E-8	2.90E-8
tin-113	N/A	5.70E-8
tin-117m	N/A	2.50E-8
zinc-65	1.80E-7	1.80E-7
zirconium-95	1.20E-7	*
2. Dissolved and entrained gases		
xenon-131m	N/A	3.20E-6
xenon-133	2.60E-7	*
xenon-133m	N/A	7.30E-7
xenon-135	9.40E-8	9.40E-8
3. gross alpha		
	1.00E-7	1.00E-7

\* Radionuclide was >LLD in all 4 quarters.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 2D

LIQUID EFFLUENTS-RADIATION DOSES AT THE LIQUID SITE BOUNDARY

	Unit	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
A.					
1. Total body dose	mrem	4.06E-4	5.74E-4	1.11E-3	5.26E-4
2. Percent Applicable Limit	%	1.35E-2	1.91E-2	3.69E-2	1.75E-2
B.					
1. Limiting organ dose	mrem	2.94E-3	3.11E-3	3.59E-3	1.60E-3
2. Percent Applicable Limit	%	2.94E-2	3.11E-2	3.59E-2	1.60E-2
3. Limiting organ for period		GI/LLI	GI/LLI	GI/LLI	GI/LLI

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 2E

LIQUID EFFLUENTS-BATCH RELEASE SUMMARY

	12 month period
1. Number of batch releases:	164 releases
2. Total time period for batch releases:	26116 minutes
3. Maximum time period for a batch release:	522 minutes
4. Average time period for a batch release:	159 minutes
5. Minimum time period for a batch release:	50 minute
6. Average saltwater flow during batch releases:	738000 gpm

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

SECTION D. PREVIOUS RADIOACTIVE EFFLUENT RELEASE REPORT ADDENDUM

In the 2005 Annual Radioactive Effluent Release Report, the U2/3 Shipments in Table A3 were mistakenly reported as all being sent by truck, when two were shipped by rail. The correction is provided below and is documented in AR # 080500516.

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not Irradiated Fuel)

3. Solid Waste Disposition		
Number of Shipments	Mode of Transportation	Destination
6*	TAG Transport Truck/Flatbed Trailer	Duratek/EnviroCare, UT
1**	Hitman Transport Truck/Flatbed Trailer	Studsvik/Barnwell
2	MHFLogisticalSolutions Rail	EnviroCare, UT

\* SONGS maintains a contract with Duratek that provides volume reduction services. The processed volume was shipped from the Duratek facility to Envirocare using 10 shipments. Those 10 shipments included waste from other generators. SCE's waste volume was a small fraction of the total waste volume of these shipments.

\*\* SONGS maintains a contract with Studsvik that provides volume reduction services. The processed volume was shipped from the Studsvik facility to Barnwell using 1 shipment. The shipment included waste from other generators. SCE's waste volume was a small fraction of the total waste volume of these shipments.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

SECTION E. RADWASTE SHIPMENTS

TABLE 3 (Units 2 & 3)

SOLID WASTE AND IRRADIATED FUEL SHIPMENT

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not Irradiated Fuel)

1.	Type of waste	Unit	12 month period	Estimated total error (%)
a.	Spent resins, filter sludges *	m <sup>3</sup>	3.15E+0	3.00E+1
		Ci	9.66E+2	
b.	Dry active waste (DAW), compactable and non-compactable *	m <sup>3</sup>	3.39E+2	3.00E+1
		Ci	2.48E+0	
c.	Irradiated components	m <sup>3</sup>	N/A	N/A
		Ci	N/A	
d.	Other: Filters	m <sup>3</sup>	N/A	N/A
		Ci	N/A	

Note: Total curie content estimated.

\* Material packaged in containers that meet the General Design requirements and/or USA Type IP-1 of various sizes. The spent resin containers were packaged in high integrity containers and shipped in Type A and Type B casks.

N/A No shipment made.

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

2. Estimate of Major Nuclide Composition (spent resins, filter sludges)		
a. americium-241	%	1.50E-4
antimony-125	%	4.66E-2
carbon-14	%	3.13E-1
cerium-144	%	7.69E-3
cesium-134	%	1.52E+0
cesium-137	%	5.51E+0
cobalt-57	%	6.44E-2
cobalt-58	%	3.93E+0
cobalt-60	%	4.14E+0
curium-243/244	%	1.00E-4
iron-55	%	1.87E+1
manganese-54	%	1.11E+0
nickel-59	%	2.37E-1
nickel-63	%	6.44E+1
niobium-95	%	3.10E-4
plutonium-238	%	5.89E-5
plutonium-239/240	%	5.66E-5
plutonium-241	%	3.46E-3
strontium-89	%	1.51E-3
strontium-90	%	3.16E-2
technetium-99	%	9.79E-3
tritium	%	1.74E-2

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

2. Estimate of Major Nuclide Composition (DAW)		
b. americium-241	%	1.98E-3
antimony-124	%	1.07E-3
antimony-125	%	3.61E-1
carbon-14	%	7.49E-1
cerium-144	%	2.72E-1
cesium-134	%	1.65E+0
cesium-137	%	6.84E+0
chromium-51	%	7.76E-1
cobalt-57	%	8.25E-2
cobalt-58	%	6.55E+0
cobalt-60	%	5.77E+0
curium-242	%	4.39E-6
curium-243/44	%	6.66E-5
iodine-129	%	3.25E-3
iron-55	%	2.14E+1
iron-59	%	2.49E-1
manganese-54	%	1.25E+0
nickel-59	%	1.40E-1
nickel-63	%	5.32E+1
niobium-95	%	2.20E-1
plutonium-238	%	1.31E-3
plutonium-239/40	%	1.78E-3
plutonium-241	%	2.23E-3
strontium-89	%	2.57E-3
strontium-90	%	3.75E-2
technetium-99	%	3.28E-1
tritium	%	1.36E-2
zirconium-95	%	1.08E-1
c. not applicable	%	N/A
d. not applicable	%	N/A

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not Irradiated Fuel)

3. Solid Waste Disposition		
Number of Shipments	Mode of Transportation	Destination
7	Hittman Transport Truck/Flatbed Trailer/Highway	EnergySolutions, UT
18 *	Hittman Transport Truck/Flatbed Trailer/Highway	EnergySolutions (Duratek), TN/ EnergySolutions, UT
4 *	Hittman Transport Truck/Flatbed Trailer/Highway (Type A Cask)	Studsvik/EnergySolutions, UT and Barnwell, SC
1 *	Hittman Transport Truck/Flatbed Trailer/Highway (Type B Cask)	Studsvik/EnergySolutions, UT and Barnwell, SC

\* SONGS 2/3 maintains contracts with vendors Studsvik and EnergySolutions (Duratek), that provide volume reduction services. The processed volume was shipped from the vendor's facility to EnergySolutions in Clive, UT and Barnwell, South Carolina using 43 shipments. Those 43 shipments included waste from other generators. SCE's waste volume was a fraction of the total waste volume of these shipments.

B. IRRADIATED FUEL SHIPMENTS (Disposition)

Number of Shipments	Mode of Transportation	Destination
None	No shipments were made	N/A

C. DEWATERING

Number of Containers	Solidification Agent
None	N/A

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

SECTION E. RADWASTE SHIPMENTS

TABLE 3 (Decommissioned Unit 1)

SOLID WASTE AND IRRADIATED FUEL SHIPMENT

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not Irradiated Fuel)

1.	Type of waste	Unit	12 month period	Estimated total error (%)
a.	Spent resins, filter sludges, evaporator bottoms	m <sup>3</sup>	N/A	N/A
		Ci	N/A	
b.	Dry active waste (DAW), compactable and non-compactable*:	m <sup>3</sup>	7.98E+3	3.00E+1
		Ci	1.04E+1	
c.	Irradiated components:	m <sup>3</sup>	N/A	N/A
		Ci	N/A	
d.	Other:	m <sup>3</sup>	N/A	N/A
		Ci	N/A	

NOTE: Total curie content estimated.

\* Material packaged in various General Design, IP-1 and IP-2.

N/A No shipment made.

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

Estimate of Major Nuclide Composition (DAW)		
a. not applicable	%	N/A
b. americium-241	%	5.96E-2
carbon-14	%	9.39E-1
cerium-144	%	6.16E-4
cesium-134	%	5.76E-1
cesium-137	%	4.86E+1
cobalt-60	%	7.85E+0
curium-242	%	5.29E-9
curium-243/44	%	1.16E-2
iron-55	%	2.36E+0
nickel-63	%	3.84E+1
plutonium-238	%	3.64E-2
plutonium-239/40	%	1.77E-2
plutonium-241	%	7.57E-1
silver-110m	%	5.78E-4
strontium-90	%	1.72E-1
tritium	%	2.29E-1
c. not applicable	%	N/A
d. not applicable	%	N/A

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

3. Solid Waste Disposition		
Number of Shipments	Mode of Transportation	Destination
309	BNSF Railroad/UP Railroad	EnergySolutions, UT
4	Piazza Trucking Truck/Flatbed Trailer/Highway	EnergySolutions, UT
3	Hittman Transport Truck/Flatbed Trailer/Highway	EnergySolutions, UT
2*	Hittman Transport Truck/Flatbed Trailer/Highway	EnergySolutions(Duratek), TN

\* SONGS 1 maintains a contract with EnergySolutions (Duratek), that provides volume reduction services. The processed volume was shipped from the vendor's facility to EnergySolutions in Clive, UT using 2 shipments. Those 2 shipments included waste from other generators. SCE's waste volume was a fraction of the total waste volume of these shipments.

B. IRRADIATED FUEL SHIPMENTS (Disposition)

Number of Shipments	Mode of Transportation	Destination
None	No shipments were made	N/A

C. DEWATERING

Number of Containers	Solidification Agent
None	N/A

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

COMMON RADWASTE SHIPMENTS

TABLE 3 (COMMON)

SOLID WASTE AND IRRADIATED FUEL SHIPMENT

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not Irradiated Fuel)

1.	Type of waste	Unit	12 month period	Estimated total error (%)
a.	Spent resins, filter sludges, evaporator bottoms	m <sup>3</sup>	N/A	N/A
		Ci	N/A	
b.	Dry active waste (DAW), compactable and non-compactable	m <sup>3</sup>	N/A	N/A
		Ci	N/A	
c.	Irradiated components	m <sup>3</sup>	N/A	N/A
		Ci	N/A	
d.	Other (filters)	m <sup>3</sup>	N/A	N/A
		Ci	N/A	

N/A No shipment made.

2.	Estimate of major nuclide composition (by type of waste)		
a.	not applicable	%	N/A
b.	not applicable	%	N/A
c.	not applicable	%	N/A
d.	not applicable	%	N/A

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not Irradiated Fuel)

3. Solid Waste Disposition (S.O.N.G.S. 1, 2, and 3)		
Number of Shipments	Mode of Transportation	Destination
None	No shipments were made	N/A

B. IRRADIATED FUEL SHIPMENTS (Disposition)

Number of Shipments	Mode of Transportation	Destination
None	No shipments were made	N/A

C. DEWATERING

Number of Containers	Solidification Agent
None	N/A

D. CHANGES TO THE PROCESS CONTROL PROGRAM AT SAN ONOFRE UNITS 1, 2, & 3

None.

REFERENCES:

1. Unit 1 Technical Specifications, section D6.13.2.
2. Units 2 and 3 License Controlled Specifications, Section 5.0.103.2.2.

# ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

### SECTION F. APPLICABLE LIMITS

#### Gaseous Effluents - Applicable Limits

The percent of Applicable Limits, tabulated in Sections A, B, C, and D of Table 1A, were calculated using the following equation:

- % Applicable Limit        =        
$$\frac{(\text{Rel Rate}) (X/Q) (100)}{\text{MPC}_{\text{eff}}}$$

          where: Rel Rate        =        total curies released in each category and each quarter, divided by the seconds in a quarter; the value in Sections A.2, B.2, C.2 and D.2 of Table 1A,  $\mu\text{Ci}/\text{sec}$ .

                                  X/Q        =         $4.80\text{E-}6 \text{ sec}/\text{m}^3$ ; the annual average atmospheric dispersion defined in the ODCM.
  
- $\text{MPC}_{\text{eff}}$         =        
$$\frac{1}{\sum_{i=1}^n \frac{F_i}{\text{MPC}_i}}$$

          where:  $F_i$         =        fractional abundance of the  $i^{\text{th}}$  radionuclide obtained by dividing the activity (curies) for each radionuclide,  $C_i$ , by the sum of all the isotopic activity,  $C_T$ .

                                  n        =        total number of radionuclides identified

$\text{MPC}_i$         =        Maximum Permissible Concentration (MPC) of the  $i^{\text{th}}$  radionuclide from 10 CFR 20 (20.1-20.602), Appendix B, Table II, Column 1.
  
- % ECL        =        
$$\frac{(\text{Rel Rate}) (X/Q) (100)}{\text{ECL}_{\text{eff}}}$$

          where: Rel Rate        =        total curies released in each category and each quarter, divided by the seconds in a quarter; the value in Sections A.2, B.2, C.2 and D.2 of Table 1A,  $\mu\text{Ci}/\text{sec}$ .

                                  X/Q        =         $4.80\text{E-}6 \text{ sec}/\text{m}^3$ ; the annual average atmospheric dispersion defined in the ODCM.
  
- $\text{ECL}_{\text{eff}}$         =        
$$\frac{1}{\sum_{i=1}^n \frac{F_i}{\text{ECL}_i}}$$

          where:  $F_i$         =        fractional abundance of the  $i^{\text{th}}$  radionuclide obtained by dividing the activity (curies) for each radionuclide,  $C_i$ , by the sum of all the isotopic activity,  $C_T$ .

                                  n        =        total number of radionuclides identified

$\text{ECL}_i$         =        Effluent Concentration Limit (ECL) of the  $i^{\text{th}}$  radionuclide from 10 CFR 20 (20.1001-20.2402), Appendix B, Table 2, Column 1.

# ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

### SECTION F. APPLICABLE LIMITS (Continued)

#### Liquid Effluents - Applicable Limits

The percent of Applicable Limits, tabulated in Sections A, B, and C of Table 2A, were calculated using the following equations:

- % Applicable Limit =  $\frac{(\text{Dil Conc}) (100)}{\text{MPC}_{\text{eff}}}$

where: Dil Conc = total curies released in each category and each quarter divided by the total volume released (sum of Sections E and F in Table 2A); the value in Sections A.2, B.2, and C.2 of Table 2A,  $\mu\text{Ci/ml}$ .
- $\text{MPC}_{\text{eff}} = \frac{1}{\sum_{i=1}^n \frac{F_i}{\text{MPC}_i}}$

where:  $F_i$  = fractional abundance of the  $i^{\text{th}}$  radionuclide obtained by dividing the activity (curies) for each radionuclide,  $C_i$ , by the sum of all the isotopic activity,  $C_T$ .

n = total number of radionuclides identified

$\text{MPC}_i$  = Maximum Permissible Concentration (MPC) of the  $i^{\text{th}}$  radionuclide from 10 CFR 20 (20.1-20.602), Appendix B, Table II, Column 2.
- % ECL =  $\frac{(\text{Dil Conc}) (100)}{\text{ECL}_{\text{eff}}}$

where: Dil Conc = total curies released in each category and each quarter divided by the total volume released (sum of Sections E and F in Table 2A); the value in Sections E.2, B.2, and C.2 of Table 2A,  $\mu\text{Ci/ml}$ .
- $\text{ECL}_{\text{eff}} = \frac{1}{\sum_{i=1}^n \frac{F_i}{\text{ECL}_i}}$

where:  $F_i$  = fractional abundance of the  $i^{\text{th}}$  radionuclide obtained by dividing the activity (curies) for each radionuclide,  $C_i$ , by the sum of all the isotopic activity,  $C_T$ .

n = total number of radionuclides identified

$\text{ECL}_i$  = Effluent Concentration Limit (ECL) of the  $i^{\text{th}}$  radionuclide from 10 CFR 20 (20.1001-20.2402), Appendix B, Table 2, Column 2.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

APPENDIX A

GASEOUS EFFLUENTS - APPLICABLE LIMITS

- A. Table 1A lists the total curies released and the release rate. The percent of applicable limit compares the released concentrations to the concentration limits of 10 CFR 20, Appendix B, Table II, Column 1.
- B. Table 1E lists the air doses as calculated using the historical X/Q. The air dose due to noble gases released in gaseous effluents from S.O.N.G.S. (per reactor) to areas at and beyond the site boundary shall be limited to the following values:
1. During any calendar quarter:  $\leq 5$  mrad for gamma radiation and  $\leq 10$  mrad for beta radiation.
  2. During any calendar year:  $\leq 10$  mrad for gamma radiation and  $\leq 20$  mrad for beta radiation.
- C. The dose to a Member of the Public from iodines, tritium, and all radionuclides in particulate form with half-lives greater than eight days in gaseous effluents released from S.O.N.G.S. (per reactor) to areas at and beyond the site boundary shall be limited to the following values:
1. During any calendar quarter:  $\leq 7.5$  mrem to any organ.
  2. During any calendar year:  $\leq 15$  mrem to any organ.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

APPENDIX A (Continued)

LIQUID EFFLUENTS - APPLICABLE LIMITS

- A. Table 2A lists the total curies released, the diluted concentration, and percent of the applicable limit. The percent of applicable limit compares the diluted concentration of radioactive material released to the concentrations specified in 10 CFR 20, Appendix B, Table II, Column 2 for radionuclides other than dissolved or entrained gases. For dissolved or entrained noble gases, the concentration is limited to 2.00E-4  $\mu\text{Ci/ml}$ .
- B. Table 2D lists doses due to liquid releases. The dose commitment to a Member of the Public from radioactive materials in liquid effluents released from S.O.N.G.S. (per reactor) to unrestricted areas shall be limited to the following values:
1. During any calendar quarter:  $\leq 1.5$  mrem to the total body and  $\leq 5$  mrem to any organ.
  2. During any calendar year:  $\leq 3$  mrem to the total body and  $\leq 10$  mrem to any organ.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

SECTION G. ESTIMATION OF ERROR

Estimations of the error in reported values of gaseous and liquid effluents releases have been made.

Sources of error for gaseous effluents - batch releases are:

- (1) tank volumes
- (2) sampling
- (3) counting
- (4) calibration

Sources of error for gaseous effluents - continuous releases are:

- (1) fan flow rate
- (2) sampling
- (3) counting
- (4) calibration
- (5) differential pressure drop

Sources of error for liquid effluents - batch releases are:

- (1) tank volumes
- (2) sampling
- (3) counting
- (4) calibration

Sources of error for liquid effluents - continuous releases are:

- (1) dilution flow rate
- (2) sampling
- (3) counting
- (4) calibration

These sources of error are independent, and calculated according to the following formula:

thus, the total error is

$$\text{Total Error} = \sqrt{\sigma_1^2 + \sigma_2^2 + \sigma_3^2 + \dots + \sigma_i^2}$$

where:  $\sigma_i$  = Error associated with each component.

# ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

### SECTION H. 10 CFR 50 APPENDIX I REQUIREMENTS

Table 1 in Section H presents the quarterly and annual maximum dose to an individual. Six different categories are presented:

- (1) Liquid Effluents - Whole Body
- (2) Liquid Effluents - Organ
- (3) Airborne Effluents - Tritium, Iodines and Particulates
- (4) Noble Gases - Gamma
- (5) Noble Gases - Beta
- (6) Direct Radiation

The doses for categories 1 and 2 were calculated using the methodology of the ODCM; these data are also presented in Table 2D. Categories 3, 4, and 5 were calculated utilizing RETDAS (Radioactive Effluent Tracking and Dose Assessment Software), Regulatory Guide 1.109 methodology, and concurrent meteorology. Table 1E of gaseous effluents previously presented, however, lists data similar to categories 3, 4 and 5 using methods described in the ODCM and the historical meteorology (X/Q). Category 6 presents direct dose data measured by TLD dosimeters. Each portion of each category is footnoted to briefly describe each maximum individual dose presented.

For members of the public, per the ODCM, who may at times be within the site boundary<sup>1</sup>, the occupancy of the individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the site boundary. For members of the public who traverse the site boundary via highway I-5, the residency time shall be considered negligible and hence the dose "0".

Table 2 in Section H presents the percent of Applicable Limits for each dose presented in Table 1.

<sup>1</sup> ODCM Figures 1-2 & 2-2.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

TABLE 1

SOURCE	Dose * (millirems)				
	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	Year
LIQUID EFFLUENTS	1)	2)	3)	4)	5)
Whole Body	4.06E-4	5.74E-4	1.11E-3	5.26E-4	2.61E-3
Organ	6)	7)	8)	9)	10)
	2.94E-3	3.11E-3	3.59E-3	1.60E-3	1.12E-2
AIRBORNE EFFLUENTS	11)	12)	13)	14)	15)
Tritium, Iodines, and Particulates	5.39E-3	5.32E-3	5.66E-3	1.54E-2	3.18E-2
NOBLE GASES **	16)	17)	18)	19)	20)
Gamma	6.72E-3	1.25E-2	2.37E-3	1.67E-2	3.82E-2
Beta	21)	22)	23)	24)	25)
	1.39E-2	8.23E-3	4.94E-3	2.60E-2	5.31E-2
DIRECT RADIATION	26)	27)	28)	29)	30)
	1.38E-1	1.43E-1	1.11E-1	9.77E-2	4.26E-1

\* The numbered footnotes below briefly explain how each maximum dose was calculated, including the organ and the predominant pathway(s).

\*\* Noble gas doses due to airborne effluent are in units of mrad, reflecting the air dose.

1. This value was calculated using the methodology of the ODCM.
2. This value was calculated using the methodology of the ODCM.
3. This value was calculated using the methodology of the ODCM.
4. This value was calculated using the methodology of the ODCM.
5. This value was calculated using the methodology of the ODCM.
6. This value was calculated using the methodology of the ODCM; the GI-LLI received the maximum dose primarily by the saltwater fish pathway.
7. This value was calculated using the methodology of the ODCM; the GI-LLI received the maximum dose primarily by the saltwater fish pathway.

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

### SAN ONOFRE NUCLEAR GENERATING STATION

8. This value was calculated using the methodology of the ODCM; the GI-LLI received the maximum dose primarily by the saltwater fish pathway.
9. This value was calculated using the methodology of the ODCM;-the GI-LLI received the maximum dose primarily by the saltwater fish pathway.
10. This value was calculated using the methodology of the ODCM; the GI-LLI received the maximum dose primarily by the saltwater fish pathway.
11. The maximum organ dose was to a child's liver and was located in the NNW sector. This was calculated using the assumptions of USNRC Regulatory Guide 1.109.
12. The maximum organ dose was to a child's thyroid and was located in the NNW sector This was calculated using the assumptions of USNRC Regulatory Guide 1.109.
13. The maximum organ dose was to a child's thyroid and was located in the NNW sector This was calculated using the assumptions of USNRC Regulatory Guide 1.109.
14. The maximum organ dose was to a child's thyroid and was located in the NNW sector. This was calculated using the assumptions of USNRC Regulatory Guide 1.109.
15. The maximum organ dose was to a child's thyroid and was located in the NNW sector This was calculated using the assumptions of USNRC Regulatory Guide 1.109.
16. The maximum air dose for gamma radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.
17. The maximum air dose for gamma radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.
18. The maximum air dose for gamma radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.
19. The maximum air dose for gamma radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.
20. The maximum air dose for gamma radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.
21. The maximum air dose for beta radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.
22. The maximum air dose for beta radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.
23. The maximum air dose for beta radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.
24. The maximum air dose for beta radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.
25. The maximum air dose for beta radiation was located in the NNE sector, at the exclusion area boundary, and calculated using the assumptions of the USNRC Regulatory Guide 1.109.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

26. Measurements were made using TLD dosimeters; values are presented as site wide dose and are prorated to 300 hours per year; highest dose was measured at the Site Boundary in the WSW sector.
27. Measurements were made using TLD dosimeters; values are presented as site wide dose and are prorated to 300 hours per year; highest dose was measured at the Site Boundary in the WSW sector.
28. Measurements were made using TLD dosimeters; values are presented as site wide dose and are prorated to 300 hours per year; highest dose was measured at the Site Boundary in the S sector.
29. Measurements were made using TLD dosimeters; values are presented as site wide dose and are prorated to 300 hours per year; highest dose was measured at the Site Boundary in the S sector.
30. Measurements were made using TLD dosimeters; values are presented as site wide dose and are prorated to 300 hours per year; highest dose was measured at the Site Boundary in the WSW sector.

TABLE 2

SOURCE	Percent Applicable Limit				
	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	Year
LIQUID EFFLUENTS Whole Body	1.35E-2	1.91E-2	3.69E-2	1.75E-2	4.36E-2
Organ	2.94E-2	3.11E-2	3.59E-2	1.60E-2	5.62E-2
AIRBORNE EFFLUENTS Tritium, Iodines, and Particulates	3.59E-2	3.54E-2	3.77E-2	1.03E-1	1.06E-1
NOBLE GASES Gamma	6.72E-2	1.25E-1	2.37E-2	1.67E-1	1.91E-1
Beta	6.94E-2	4.11E-2	2.47E-2	1.30E-1	1.33E-1

NOTE: Direct Radiation is not specifically addressed in the Applicable Limits.

# ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

### SECTION I. CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL

On February 29, 2008, revision 1 to the SONGS Offsite Dose Calculation Manual (ODCM) was issued. This revision accomplishes three objectives: 1) Incorporates the latest updates related to the 2006-2007 Land Use Census (LUC) from the J.W. Scott to D. Dick Memorandum for File, "2008 Dose Parameters for SONGS," dated February 11, 2008, 2) Creates Appendix B to incorporate historical references for the effluent control program and 3) Changes page numbers in Appendices to identify the Appendix number.

Editorial corrections were made to Figure 4-5 to correct a release pathway unintentionally omitted from the figure. Added pg vi in the Table of Contents for SO123-ODCM to identify the two ODCM appendices.

No 50.59 or effluent ODCM evaluation reviews were required or performed for editorial changes.

None of the changes impact the accuracy or reliability of effluent dose or setpoint calculations. The level of radioactive effluent control required by 10 CFR 20, 40 CFR 190, 10 CFR 50.35a and Appendix I to 10 CFR 50 will be maintained.

Throughout the document, change bars are marked in one of four ways as follows:

- A Addition
- D Deletion
- F Editorial/Format change
- R Revision

Page #	Change	Reason
vi	Added pg vi in Table of Contents to include a List of Appendices.	A
2-29	Revised table 2-6 per LUC	R
4-20	corrected to include a release pathway unintentionally removed in prior revision	F
Appendix A- ALL	renumbered the page to include Appendix identification i.e. 1-1 to A1-1.	F
Appendix Ai- table of contents	edited to include page identifier for Table of Contents for Appendix A, Changed page numbers and reformatted	R
A1-8	Revised Ri values per LUC	R
A1-10	Revised Ri values per LUC, edited page 1 of 2 to page 1 of 3 per LUC	R/F
A1-11	Changed from pg 2 of 2 to page 2 of 3 per LUC	F
A1-12	Added new pathway, page 3 of 3 per LUC	A
A1-13	Revised Ri values per LUC	R
A1-14	Revised Ri values per LUC	R
A1-15	Revised Ri values per LUC	R
A1-17	Revised Ri values per LUC	R
A1-19	Revised Ri values per LUC	R
A1-22	Changed from page 1 of 2 to page 1 of 3 per LUC	F
A1-23	Added new pathway, page 2 of 3 per LUC	A
A1-24	Changed from page 2 of 2 to page 3 of 3 per LUC	F
Appendix B	Added Appendix B so as to include supplemental information on the effluent control program (historical references)	A

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

### SAN ONOFRE NUCLEAR GENERATING STATION

#### SECTION J. CHANGES TO RADIOACTIVE WASTE TREATMENT SYSTEMS

None.

#### SECTION K. MISCELLANEOUS

##### Abnormal Releases

- North Industrial Area (NIA) Main Firewater Break

A pressurized in-service fire main was inadvertently broken on 08/08/2008, during excavation of an abandoned catch basin in the North Industrial Area (NIA) yard. The water flowed across the yard into the sewage treatment plant (STP) south train settling tanks, which were not in use at the time. When the tanks overflowed into the sump, the sewage treatment sump pumps turned on automatically for approximately 1 hour. The resultant unplanned, unmonitored release was estimated to be a total of 24,000 gallons, based on the pumps' discharge rate. The water that remained in the south settling tanks was subsequently sampled and the results were <LLD for gamma activity and tritium. However, sample results for the sand that had been excavated from the catch basin indicated the presence of Cs-137 between  $3.228\text{E-}7$   $\mu\text{Ci/g}$  and  $3.187\text{E-}6$   $\mu\text{Ci/g}$ . Approximately  $1.4$  yds<sup>3</sup> of sand was estimated to be entrained in the 24,000 gallons of water that was released. The maximum whole body dose of  $2.38\text{E-}7$  mrem and an organ dose of  $7.04\text{E-}9$  mrem that could have been received by a member of the public due to this event. This event is documented in NN 200092767.

##### Missed Surveillances

- Missed 2RT7817 18 Month Surveillance

On 10/09/2008, it was discovered that the 18 month surveillance for 2RT-7817, which monitors the full flow condensate polisher effluent line, required by section 4.1.1b in the ODCM was not completed by its due date of 4/22/2008. Prior to the required surveillance, the work order was sent back to planning to change the work window, but the order was never revised and reissued, resulting in the missed surveillance. The compensatory action for an inoperable 2RT-7817 is a 1/24 hr grab sample during the release if the reactor coolant specific activity is  $<0.01$   $\mu\text{Ci/gm}$ . The unit 2 reactor coolant specific activity was  $<0.01$   $\mu\text{Ci/gm}$  from 04/22/08 to 10/10/08.

The longest release through the condensate polisher demineralizer effluent line from 04/22/2008 to 10/09/2008 occurred on 07/01/2008, was 2 hrs and 55 minutes long. As required by the effluent control program, grab samples were taken prior to each release and a release permit was generated based on the sample.

The 2RT-7817 surveillance was successfully completed on its next scheduled surveillance on 10/22/2008. The dose consequences to a member of the public from releases via this pathway are included in this report; no additional dose consequences resulted from the missed surveillance. This event is documented in NN 200173009.

- Missed 2/3RT2101 Surveillance

On 10/22/2008, the North Industrial Area (NIA) sump pumps were placed in service (automatic) after it had been removed from service for maintenance activities. Operations and chemistry failed to effectively communicate the status and requirements necessary to return the NIA sump to service, thus compensatory sampling was not initiated until 10/26/2008. As soon as chemistry realized that the NIA sump pumps were in automatic but the radiation monitor was not in service, a grab sample was taken and analyzed and compensatory sampling was initiated. The plant computer system (PCS) indicated the sump pumps ran on two separate occasions during 10/22/08 and 10/26/2008. An estimated total volume of 4557 gallons was released from the NIA sump. The PCS did not record any influents into the NIA sump. The samples taken before and after the event were <LLD for gamma and tritium. There was no dose consequence to a member of the public due to this event. This event is documented in NN 200192238.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

EFFLUENT RADIATION MONITORS OUT OF SERVICE GREATER THAN 30 DAYS

January 1, 2008 - December 31, 2008

S.O.N.G.S. 2			
Monitor	Inoperability Period	Inoperability Cause	Explanation
2RT-7870 Condenser Air Ejector Process Flow Monitor	04/17/00 - present	Inoperable process flow measuring device whenever vacuum pump is running.	Design deficiency causes process flow instrument to be inoperable while the vacuum pump is running, as high flow values are not sensed. Flow monitor works properly during normal operations. The monitor is isokinetic during the vacuum pump operation due to the substitute flow value that is manually inserted whenever the vacuum pump is running. The issue was previously documented in ARs 000101252 and 000400960. It is currently being tracked in NN200001437.
2RT-6753 and 2RT-6759 Steam Generator Blowdown Radiation Monitors	11/21/07 - 01/15/08	Outage Activities	The radiation monitors are declared inoperable by Operations when the monitor's alarm and automatic functions are bypassed to support outage activities. The radiation monitors did not malfunction, nor degrade and were placed back in service when the pathway was put back to a normal operating alignment.
2RT-7817 BPS/FFCPD Discharge Monitor	03/04/08 - 04/18/08	No flow indication during a HUT release to outfall.	Monitor power supply failed. Removed defective power supply and installed a new power supply. This event is documented in AR 080300101.
2RT-7865 Plant Vent Stack (Containment Purge) Particulate and Iodine Sampler	12/17/07 - 03/10/08	Intermittent heat trace circuitry operability	Design deficiency due to heat trace being inadequately designed to maintain the temperature above the specified analysis limit for the full temperature-humidity range experienced at SONGS. The event was summarized and documented in NN 200330946.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

EFFLUENT RADIATION MONITORS OUT OF SERVICE GREATER THAN 30 DAYS

(Continued)

January 1, 2008 - December 31, 2008

S.O.N.G.S. 3			
Monitor	Inoperability Period	Inoperability Cause	Explanation
3RT-7870 Condenser Air Ejector Process Flow Monitor	04/17/00 - present	Inoperable process flow measuring device whenever vacuum pump is running.	Design deficiency causes process flow instrument to be inoperable while the vacuum pump is running, as high flow values are not sensed. Flow monitor works properly during normal operations. The monitor is isokinetic during the vacuum pump operation due to the substitute flow value that is manually inserted whenever the vacuum pump is running. The issue was previously documented in ARs 000101252 and 000400960. It is currently tracked in NN 200001437.
3RT-7817 BPS/FFCPD Discharge Monitor	03/04/08 - 04/10/08	High Radiation Alarm and Erratic behavior	The instrument was spiking when no release was in progress. No cause was determined during the investigation. The radiation monitor appeared to be working correctly after the power was cycled and the monitor was re-booted. The issue is summarized and evaluated in AR 080300142.
3RT-7817 BPS/FFCPD Discharge Monitor	09/24/08 - 11/28/08	Damaged Power Supply  Flow Switch Failure	While completing an 18 month surveillance, the battery and power supply were running very hot and damage to a connector to the power was observed. Replaced the LDU power supply and the damaged connector.  After the repairs to the power supply were completed, the monitor flow switch (FISL7817) failed to function as designed. The flow switch was replaced. The event is summarized and evaluated in NN200163311 and NN200172869.
3RT-6753 and 3RT-6759 Steam Generator Blowdown Radiation Monitors	10/09/08 - 12/10/08	Outage Activities	The radiation monitors are declared inoperable by Operations when the monitor's alarm and automatic functions are bypassed to support outage activities. The radiation monitors did not malfunction, and were placed back in service when the pathway was put back to a normal operating alignment.
3RT-7865 Plant Vent Stack (Containment Purge) Particulate and Iodine Sampler	11/30/07 - 01/22/08	Intermittent heat trace circuitry operability	Design deficiency due to heat trace being inadequately designed to maintain the temperature above the specified analysis limit for the full temperature-humidity range experienced at SONGS. The event was summarized and documented in NN 200330946.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

EFFLUENT RADIATION MONITORS OUT OF SERVICE GREATER THAN 30 DAYS

(Continued)

January 1, 2008 - December 31, 2008

S.O.N.G.S. 2/3			
Monitor	Inoperability Period	Inoperability Cause	Explanation
2/3RT-7808 Plant Vent Stack Monitor	05/19/08 - 06/23/08	Low Flow Alarm	The fittings to the radiation monitor flow transmitter were galled and were unable to be used to perform the instrument calibration. The fittings for the high and low flow switches were replaced so that the calibration could be performed. This issue was identified and documented in AR 080500900.
2/3RT-2101 NIA Sump Radiation Monitor	05/05/08 - 09/10/08	Failed Surveillance	The flow totalizer failed the 18 month surveillance but the radiation monitor remained available to alarm on high radiation signal. Replaced software and flow transducers. These issues were identified and documented in AR 080500410 and Order 800047842.
2/3RT-2101 NIA Sump Radiation Monitor	10/01/08 - 01/23/09	High Temperature Alarm	Monitor failure due to high temperature fault. Low work priority delayed testing to determine the cause. No degraded, nonconforming, or unanalyzed condition was identified. The monitor was reset and placed back in service. The issue was identified and documented in NN 200163285.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

Onsite Groundwater Samples

This section provides results of on-site samples of groundwater in accordance with the voluntary Nuclear Energy Institute (NEI) Groundwater Protection Initiative. The sample locations and the frequency of sampling are likely to change as Unit 1 decommissioning proceeds. For those few sample data that are not below the lower limit of detection, the levels are near the analytical sensitivity for the laboratory techniques. They do not indicate that there has been an inadvertent release of radioactive material beyond the site boundary.

January 1, 2008 - December 31, 2008

Sample Date	Location	Tritium Activity, $\mu\text{Ci/ml}$	Gamma Activity, $\mu\text{Ci/ml}$
01/02/2008	U1 DW 6	<LLD	<LLD
	U1 DW 11	<LLD	<LLD
	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
01/06/2008	U1 DW 11	<LLD	<LLD
	U1 DW 12	<LLD	<LLD
01/09/2008	U1 DW 6	<LLD	<LLD
	U1 DW 11	<LLD	<LLD
	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
01/16/2008	U1 DW 6	<LLD	<LLD
	U1 DW 11	<LLD	<LLD
	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
01/23/2008	U1 DW 6	<LLD	<LLD
01/30/2008	U1 DW 6	<LLD	<LLD
02/14/2008	U1 DW 6	<LLD	<LLD
	U1 DW 11	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
03/14/2008	U1 DW 6	<LLD	<LLD
	U1 DW 11	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
04/14/2008	U1 DW 6	<LLD	<LLD
	U1 DW 11	<LLD	<LLD
	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
05/15/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
05/16/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
05/17/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
05/18/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

## SAN ONOFRE NUCLEAR GENERATING STATION

Onsite Groundwater Samples (Continued)

January 1, 2008 - December 31, 2008

Sample Date	Location	Tritium Activity, $\mu\text{Ci/ml}$	Gamma Activity, $\mu\text{Ci/ml}$
05/19/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
06/04/2008	U1 DW 12	<LLD	<LLD
06/05/2008	U1 DW 12	<LLD	<LLD
06/07/2008	U1 DW 12	<LLD	<LLD
06/08/2008	U1 DW 12	<LLD	<LLD
06/09/2008	U1 DW 12	<LLD	<LLD
06/10/2008	U1 DW 12	<LLD	<LLD
06/12/2008	U1 DW 12	<LLD	<LLD
06/13/2008	U1 DW 12	<LLD	<LLD
07/09/2008	U1 DW 14	<LLD	<LLD
07/10/2008	U1 DW 14	<LLD	<LLD
07/11/2008	U1 DW 14	<LLD	<LLD
07/13/2008	U1 DW 14	<LLD	<LLD
07/14/2008	U1 DW 14	<LLD	<LLD
08/15/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
08/22/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
08/23/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
08/24/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
08/25/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
	U1 DW 15	<LLD	<LLD
08/26/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
08/27/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

Onsite Groundwater Samples (Continued)

January 1, 2008 - December 31, 2008

Sample Date	Location	Tritium Activity, $\mu\text{Ci/ml}$	Gamma Activity, $\mu\text{Ci/ml}$
08/28/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
08/29/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
08/30/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
09/04/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
09/05/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
	U1 DW 15	<LLD	<LLD
09/06/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
	U1 DW 15	<LLD	<LLD
09/07/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
	U1 DW 15	<LLD	<LLD
09/08/2008	U1 DW 12	<LLD	<LLD
	U1 DW 13	<LLD	<LLD
	U1 DW 14	<LLD	<LLD
	U1 DW 15	<LLD	<LLD
09/15/2008	U1 DW 15	<LLD	<LLD

U1 DW = Wells installed to support decommissioning of Unit 1. The locations of these wells will change as decommissioning proceeds.

*a priori* LLDs = H-3:  $1.0 \text{ E-}5 \mu\text{Ci/ml}$ , Cs-137:  $6.8 \text{ E-}8 \mu\text{Ci/ml}$

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

Onsite Groundwater Samples (Continued)

This section provides results of on-site samples of groundwater in accordance with the voluntary Nuclear Energy Institute (NEI) Groundwater Protection Initiative. The sample locations and the frequency of sampling may change as Protection Initiative over time. For those few sample data that are not below the lower limit of detection, the levels are near the analytical sensitivity for the laboratory techniques. They do not indicate that there has been an inadvertent release of radioactive material beyond the site boundary.

January 1, 2008 - December 31, 2008

Sample Date	Location	Tritium Activity, $\mu\text{Ci/ml}$	Gamma Activity, $\mu\text{Ci/ml}$
01/03/2008	SONGS PA 2	1.60E-6	<LLD
01/11/2008	SONGS PA 2	1.28E-6	<LLD
01/18/2008	SONGS PA 2	1.52E-6	<LLD
01/25/2008	SONGS PA 2	1.22E-6	<LLD
02/14/2008	SONGS PA 1 SONGS PA 4	<LLD <LLD	<LLD <LLD
02/21/2008	SONGS PA 3 SONGS PA 2	<LLD 1.81 E-6	<LLD <LLD
03/21/2008	SONGS OCA 1	<LLD	<LLD
03/25/2008	SONGS OCA 2	<LLD	<LLD
03/26/2008	SONGS PA 2	1.14E-6	<LLD
03/27/2008	SONGS OCA 3	<LLD	<LLD
04/25/2008	SONGS PA 2	6.50E-7	<LLD
05/29/2008	SONGS PA 2	<LLD	<LLD
06/11/2008	SONGS PA 1 SONGS PA 4	<LLD <LLD	<LLD <LLD
06/13/2008	SONGS PA 2 SONGS PA 3	5.30E-7 <LLD	<LLD <LLD
06/27/2008	SONGS OCA 1 SONGS OCA 2 SONGS OCA 3	<LLD <LLD <LLD	<LLD <LLD <LLD
07/17/2008	SONGS PA 2	<LLD	<LLD
09/22/2008	SONGS OCA 2	<LLD	<LLD
09/24/2008	SONGS OCA 1 SONGS OCA 3	<LLD <LLD	<LLD <LLD

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

Onsite Groundwater Samples (Continued)

January 1, 2008 - December 31, 2008

Sample Date	Location	Tritium Activity, $\mu\text{Ci/ml}$	Gamma Activity, $\mu\text{Ci/ml}$
9/26/2008	SONGS PA 1	<LLD	<LLD
	SONGS PA 2	2.96E-7	<LLD
	SONGS PA 3	<LLD	<LLD
	SONGS PA 4	<LLD	<LLD
12/29/2008	SONGS OCA 3	<LLD	<LLD
12/30/2008	SONGS PA 1	<LLD	<LLD
	SONGS PA 2	<LLD	<LLD
	SONGS PA 3	<LLD	<LLD
	SONGS PA 4	<LLD	<LLD
12/31/2008	SONGS OCA 1	<LLD	<LLD
	SONGS OCA 2	<LLD	<LLD

SONGS PA = Wells installed in the Protected Area to implement the Groundwater Protection Initiative.

SONGS OCA = Wells installed in the Owner Controlled Area to implement the Groundwater Protection Initiative.

*a priori* LLDs = H-3: 3.0E-6  $\mu\text{Ci/ml}$ , Cs-137: 1.8 E-8  $\mu\text{Ci/ml}$

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

SAN ONOFRE NUCLEAR GENERATING STATION

40 CFR 190 REQUIREMENTS

Table 1 below presents the annual site-wide doses and percent of ODCM Specification limits to members of the public. These values were calculated utilizing doses resulting from all effluent pathways and direct radiation. The different categories presented are: (1) Total Body, (2) Limiting Organ, and (3) Thyroid.

Dose Category	Units	Year
1. Total Body		
a. Total Body Dose	mrem	4.72E-1
b. Percent ODCM Specification Limit	%	1.89E+0
2. Limiting Organ		
a. Organ Dose (GI-LLI)	mrem	6.43E-2
b. Percent ODCM Specification Limit	%	2.57E-1
3. Thyroid		
a. Thyroid Dose	mrem	5.49E-2
b. Percent ODCM Specification Limit	%	7.32E-2

## ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

### SAN ONOFRE NUCLEAR GENERATING STATION

#### SECTION L. S.O.N.G.S. CONCLUSIONS

- Gaseous releases totaled  $1.62\text{E}+2$  curies of which noble gases were  $8.07\text{E}+1$  curies, iodines were  $2.04\text{E}-3$  curies, particulates were  $1.70\text{E}-3$  curies, and tritium was  $8.09\text{E}+1$  curies.
- The radiation doses from gaseous releases were: (a) gamma air dose:  $3.82\text{E}-2$  mrad at the site boundary, (b) beta air dose:  $5.31\text{E}-2$  mrad at the site boundary, (c) organ dose:  $3.18\text{E}-2$  mrem at the nearest receptor.
- Liquid releases totaled  $1.04\text{E}+3$  curies of which particulates and iodines were  $4.00\text{E}-2$  curies, tritium was  $1.04\text{E}+3$  curies, and noble gases were  $3.90\text{E}+0$  curies.
- The radiation doses from liquid releases were: (a) total body:  $2.61\text{E}-3$  mrem, (b) limiting organ:  $1.12\text{E}-2$  mrem.
- Radioactive releases and resulting doses generated from S.O.N.G.S. were below the Applicable Limits for both gaseous and liquid effluents.
- S.O.N.G.S. 1, 2 and 3 made 348 radwaste shipments to EnergySolutions, UT, Studsvik, TN, Duratek/EnergySolutions, TN, and Barnwell, SC. The total volume of the 348 shipments was  $8.32\text{E}+3$  cubic meters containing  $9.79\text{E}+2$  curies of radioactivity.
- Meteorological conditions during the year were typical for S.O.N.G.S. Meteorological dispersion was good 33% of the time, fair 40% of the time and poor 27% of the time.
- The total volume of releases from groundwater and dewatering wells was  $2.86\text{E}+8$  gallons. The largest volume was from the dewatering wells at Unit 1, but also included water from the development of the Industry Groundwater Protection Initiative-related wells in the Owner Controlled Area and the Protected Area at SONGS. The output from groundwater and dewatering wells was released through ODCM credited release points and radioactivity included in the earlier tables of this report. The results of samples taken from these on-site wells are reported in Section K.
- The net result from the analysis of these effluent releases indicates that the operation of S.O.N.G.S. has met all the requirements of the applicable regulations that ensure adequate protection of the health of members of the public.

## **METEOROLOGY**

The meteorology of the San Onofre Nuclear Generating Station for each of the four quarters, 2008 is described in this section. Meteorological measurements have been made according to the guidance provided in USNRC Regulatory Guide 1.23, "Onsite Meteorological Programs." A summary report of the meteorological measurements taken during each calendar quarter are presented in Table 4A as joint frequency distribution (JFD) of wind direction and wind speed by atmospheric stability class.

Hourly meteorological data for batch releases have been recorded for the periods of actual release. These data are available, as well as the hourly data for the Annual Report, but have not been included in this report because of the bulk of data records.

Table 4A lists the joint frequency distribution for each quarter, 2008. Each page of Table 4A represents the data for the individual stability classes: A, B, C, D, E, F, and G. The last page of each section is the JFD for all the stability classes. The wind speeds have been measured at the 10-meter level, and the stability classes are defined by the temperature differential between the 10-meter and 40-meter levels.

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

January - March

Table 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08010100-08033123

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL A

EXTREMELY UNSTABLE (DT/DZ  $-1.9$  C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	0	2	0	0	0	0	0	0	0	2
NNE	0	0	1	1	0	0	0	0	0	0	0	0	2
NE	0	0	0	0	0	1	0	0	0	0	0	0	1
ENE	0	0	0	0	1	0	0	0	0	0	0	0	1
E	0	0	0	0	0	1	0	0	0	0	0	0	1
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	1	0	0	0	0	0	0	0	1
SSE	0	0	0	0	1	2	14	2	0	0	0	0	19
S	0	0	0	3	6	15	16	1	0	0	0	0	41
SSW	0	0	0	8	6	17	13	1	0	0	0	0	45
SW	0	0	1	3	5	16	11	2	0	0	0	0	38
WSW	1	0	0	7	10	23	10	0	0	0	0	0	51
W	0	0	0	2	6	37	33	2	0	0	0	0	80
WNW	0	0	0	3	4	27	33	4	0	0	0	0	71
NW	0	0	0	0	0	4	4	0	1	0	0	0	9
NNW	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTALS	1	0	2	27	42	143	134	12	1	0	0	0	362
NUMBER OF VALID HOURS				362				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				362	

PASQUILL B

MODERATELY UNSTABLE ( $-1.9 < DT/DZ < -1.7$  C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	1	0	0	0	0	0	0	0	0	0	0	0	1
NNE	0	0	0	0	1	0	0	0	0	0	0	0	1
NE	0	0	0	0	0	0	1	0	0	0	0	0	1
ENE	1	0	0	0	0	0	0	0	0	0	0	0	1
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	0	1	0	0	0	0	0	0	0	1
SE	0	0	0	2	0	1	4	0	0	0	0	0	7
SSE	0	0	0	0	2	1	6	2	1	0	0	0	12
S	0	0	0	1	1	0	2	2	1	0	0	0	7
SSW	0	0	0	1	1	4	0	1	0	0	0	0	7
SW	0	0	0	0	1	1	0	0	0	0	0	0	2
WSW	1	0	1	2	2	1	0	0	0	0	0	0	7
W	0	0	0	1	4	1	2	0	0	0	0	0	8
WNW	0	0	0	0	1	0	0	0	0	0	0	0	1
NW	0	0	0	0	0	1	1	1	0	0	0	0	3
NNW	1	0	0	0	0	0	0	0	0	0	0	0	1
TOTALS	4	0	1	7	14	10	16	6	2	0	0	0	60
NUMBER OF VALID HOURS				60				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				60	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

January - March

Table 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08010100-08033123

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL C

SLIGHTLY UNSTABLE (-1.7 < DT/DZ -1.5 C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	1	0	0	1	0	0	0	0	0	0	0	0	2
NNE	1	0	0	0	0	0	0	1	0	0	0	0	2
NE	0	0	0	0	0	0	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0	0	1	0	0	0	1
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	2	0	1	0	0	0	3
SSE	0	0	0	0	2	2	5	4	0	0	0	0	13
S	0	0	0	3	1	0	4	1	0	0	0	0	9
SSW	0	0	0	0	4	2	0	0	0	0	0	0	6
SW	0	0	0	0	4	2	2	1	0	0	0	0	9
WSW	2	0	0	0	8	6	1	1	0	0	0	0	18
W	0	0	1	0	5	2	0	0	0	0	0	0	8
WNW	0	0	0	0	1	6	0	0	1	0	0	0	8
NW	0	0	0	0	0	1	0	0	0	0	0	0	1
NNW	0	0	0	0	0	1	0	0	0	0	0	0	1
TOTALS	4	0	1	4	25	22	14	8	3	0	0	0	81
NUMBER OF VALID HOURS				81				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				81	

PASQUILL D

NEUTRAL (-1.5 < DT/DZ -0.5 C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	1	3	1	0	2	5	0	0	0	0	0	12
NNE	0	1	0	1	3	8	9	1	0	0	0	0	23
NE	0	0	0	1	0	4	4	0	2	0	0	0	11
ENE	0	0	0	1	0	1	1	0	0	1	0	0	4
E	0	0	0	0	0	1	3	1	0	0	0	0	5
ESE	0	0	0	1	1	1	14	1	0	0	0	0	18
SE	0	0	0	1	1	4	27	14	15	0	0	0	62
SSE	0	0	0	2	1	14	19	4	6	4	2	0	52
S	0	0	0	1	4	8	12	8	2	3	0	0	38
SSW	0	0	0	1	2	7	8	6	4	2	0	0	30
SW	0	0	1	3	3	2	11	9	4	1	0	0	34
WSW	0	0	1	1	3	13	10	14	1	0	0	0	43
W	0	0	0	4	8	13	8	5	4	0	0	0	42
WNW	0	0	1	6	8	12	5	2	1	0	0	0	35
NW	0	0	1	6	1	12	7	1	0	0	0	0	28
NNW	0	0	1	1	2	5	2	0	0	0	0	0	11
TOTALS	0	2	8	31	37	107	145	66	39	11	2	0	448
NUMBER OF VALID HOURS				448				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				448	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

January - March

Table 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08010100-08033123

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL E

SLIGHTLY STABLE (-0.5 < DT/DZ 1.5 C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	1	2	6	4	6	5	0	0	0	0	0	24
NNE	0	0	1	5	12	14	25	0	0	0	0	0	57
NE	0	0	0	3	3	1	6	0	1	0	0	0	14
ENE	0	0	0	2	0	4	1	1	0	0	0	0	8
E	0	0	1	1	3	3	2	0	0	0	0	0	10
ESE	0	0	1	2	2	8	8	5	1	0	0	0	27
SE	0	0	0	1	3	11	23	18	11	1	0	0	68
SSE	0	0	2	2	2	6	6	7	1	3	1	0	30
S	0	1	2	3	4	1	8	5	3	1	1	0	29
SSW	0	1	1	5	6	3	2	1	1	0	0	0	20
SW	0	0	0	1	1	3	1	1	0	1	0	0	8
WSW	0	1	0	4	5	0	0	4	3	0	0	0	17
W	0	1	2	3	2	5	2	3	4	0	0	0	22
WNW	0	0	0	8	3	9	2	3	4	0	0	0	29
NW	0	1	3	4	2	7	4	0	0	0	0	0	21
NNW	0	1	2	3	4	5	1	1	0	0	0	0	17
TOTALS	0	7	17	53	56	86	96	49	29	6	2	0	401
NUMBER OF VALID HOURS				401				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				401	

PASQUILL F

MODERATELY STABLE (1.5 < DT/DZ 4.0 C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	3	1	4	0	0	0	0	0	0	8
NNE	0	0	3	11	20	28	10	0	1	0	0	0	73
NE	3	0	4	14	12	9	0	3	0	0	0	0	45
ENE	0	0	1	7	4	2	1	0	0	0	0	0	15
E	0	0	1	5	6	3	0	0	0	0	0	0	15
ESE	0	0	1	4	3	2	1	0	0	0	0	0	11
SE	0	0	0	1	1	1	0	0	0	0	0	0	3
SSE	0	0	0	2	4	1	1	0	0	0	0	0	8
S	0	0	0	0	3	0	0	0	0	0	0	0	3
SSW	0	0	1	0	1	0	0	0	0	0	0	0	2
SW	0	0	2	5	1	3	0	0	0	0	0	0	11
WSW	1	0	1	2	6	0	0	0	0	0	0	0	10
W	0	2	1	4	5	1	0	0	0	0	0	0	13
WNW	0	0	2	6	1	4	0	0	0	0	0	0	13
NW	0	0	1	2	5	1	0	0	0	0	0	0	9
NNW	1	0	1	3	5	3	0	0	0	0	0	0	13
TOTALS	5	2	19	69	78	62	13	3	1	0	0	0	252
NUMBER OF VALID HOURS				252				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				252	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

January - March

Table 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08010100-08033123

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL G

EXTREMELY STABLE (DT/DZ > 4.0 C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	6	0	2	6	4	10	2	0	0	0	0	0	30
NNE	7	0	1	6	31	138	144	10	0	0	0	0	337
NE	1	0	1	12	21	36	5	1	0	0	0	0	77
ENE	0	1	4	6	6	6	3	0	0	0	0	0	26
E	0	0	1	2	3	5	1	0	0	0	0	0	12
ESE	0	1	2	4	1	2	2	0	0	0	0	0	12
SE	0	0	0	3	3	4	1	0	0	0	0	0	11
SSE	0	0	0	3	0	1	0	0	0	0	0	0	4
S	0	0	0	3	3	1	1	0	0	0	0	0	8
SSW	0	1	0	0	1	1	0	0	0	0	0	0	3
SW	0	0	0	4	2	0	0	0	0	0	0	0	6
WSW	1	0	2	2	3	2	0	0	0	0	0	0	10
W	3	0	1	2	4	1	0	0	0	0	0	0	11
WNW	0	0	0	3	3	5	0	0	0	0	0	0	11
NW	0	1	0	2	2	3	1	0	0	0	0	0	9
NNW	3	0	0	2	2	5	0	1	0	0	0	0	13
TOTALS	21	4	14	60	89	220	160	12	0	0	0	0	580
NUMBER OF VALID HOURS				580				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				580	

ALL STABILITY CLASSES, ALL DT/DZ

WIND SPEED (M/S) AT 10 METER LEVEL

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	8	2	7	17	11	22	12	0	0	0	0	0	79
NNE	8	1	6	24	67	188	188	12	1	0	0	0	495
NE	4	0	5	30	36	51	16	4	3	0	0	0	149
ENE	1	1	5	16	11	13	6	1	1	1	0	0	56
E	0	0	3	8	12	13	6	1	0	0	0	0	43
ESE	0	1	4	11	8	13	25	6	1	0	0	0	69
SE	0	0	0	8	9	21	57	32	27	1	0	0	155
SSE	0	0	2	9	12	27	51	19	8	7	3	0	138
S	0	1	2	14	22	25	43	17	6	4	1	0	135
SSW	0	2	2	15	21	34	23	9	5	2	0	0	113
SW	0	0	4	16	17	27	25	13	4	2	0	0	108
WSW	6	1	5	18	37	45	21	19	4	0	0	0	156
W	3	3	5	16	34	60	45	10	8	0	0	0	184
WNW	0	0	3	26	21	63	40	9	6	0	0	0	168
NW	0	2	5	14	10	29	17	2	1	0	0	0	80
NNW	5	1	4	9	13	19	3	2	0	0	0	0	56
TOTALS	35	15	62	251	341	650	578	156	75	17	4	0	2184
NUMBER OF VALID HOURS				2184				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				2184	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

April - June

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08040100-08063023

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL A

EXTREMELY UNSTABLE (DT/DZ  $-1.9$  C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	0	0	0	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0	1	0	0	0	0	1
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	1	0	0	0	0	0	1
SSE	0	0	0	0	1	6	11	3	4	0	0	0	25
S	0	0	0	0	2	10	36	14	7	0	0	0	69
SSW	0	0	0	1	1	21	54	10	0	1	0	0	88
SW	0	0	0	2	14	44	57	6	0	0	0	0	123
WSW	0	0	0	2	17	54	99	2	0	0	0	0	174
W	0	0	0	1	3	57	101	0	0	0	0	0	162
WNW	0	0	0	1	2	20	93	2	0	0	0	0	118
NW	0	0	0	0	0	3	14	6	0	0	0	0	23
NNW	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTALS	0	0	0	7	40	215	466	44	11	1	0	0	784
NUMBER OF VALID HOURS				784				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				784	

PASQUILL B

MODERATELY UNSTABLE ( $-1.9 < DT/DZ < -1.7$  C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	0	0	0	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0	1	0	0	0	0	1
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	1	0	0	0	0	0	1
SSE	0	0	0	1	0	1	3	0	0	0	0	0	5
S	0	0	0	0	0	3	3	2	0	1	0	0	9
SSW	0	0	0	0	1	5	7	0	2	0	0	0	15
SW	0	0	1	0	0	3	2	1	1	0	0	0	8
WSW	0	0	0	0	1	0	0	0	0	0	0	0	1
W	0	0	0	1	2	0	1	0	0	0	0	0	4
WNW	0	0	0	0	1	3	4	0	0	0	0	0	8
NW	0	0	0	0	0	4	7	0	0	0	0	0	11
NNW	0	0	0	0	0	0	1	0	0	0	0	0	1
TOTALS	0	0	1	2	5	19	29	4	3	1	0	0	64
NUMBER OF VALID HOURS				64				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				64	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

April - June

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08040100-08063023

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL C

SLIGHTLY UNSTABLE (-1.7 < DT/DZ -1.5 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	1	0	1	0	0	0	0	0	0	2
NNE	0	0	0	0	1	0	0	0	0	0	0	0	1
NE	0	0	0	2	0	2	0	0	0	0	0	0	4
ENE	0	0	0	0	0	0	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	0	1	0	0	0	0	0	0	1
SSE	0	0	0	2	0	1	11	2	2	0	0	0	18
S	0	0	0	0	0	2	5	2	3	2	0	0	14
SSW	0	0	0	0	1	5	6	1	0	0	0	0	13
SW	0	0	0	0	1	5	3	0	0	0	0	0	9
WSW	0	0	0	0	1	1	0	0	0	0	0	0	2
W	0	0	0	1	1	3	0	0	0	0	0	0	5
WNW	0	0	0	1	3	1	1	0	0	0	0	0	6
NW	0	0	0	0	3	4	9	0	0	0	0	0	16
NNW	0	0	0	0	1	1	0	0	0	0	0	0	2
TOTALS	0	0	0	7	12	27	35	5	5	2	0	0	93
NUMBER OF VALID HOURS				93				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				93	

PASQUILL D

NEUTRAL (-1.5 < DT/DZ -0.5 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	1	5	5	6	0	0	0	0	0	0	17
NNE	0	0	0	10	6	12	0	0	0	0	0	0	28
NE	0	0	0	1	2	2	0	1	0	0	0	0	6
ENE	0	0	0	1	1	1	0	0	0	0	0	0	3
E	0	0	0	0	2	2	0	0	0	0	0	0	4
ESE	0	0	0	1	1	6	8	0	0	0	0	0	16
SE	0	0	0	1	1	24	56	14	5	0	0	0	101
SSE	0	0	0	1	8	29	56	17	10	0	0	0	121
S	0	0	0	9	10	22	46	6	2	0	0	0	95
SSW	0	0	3	2	10	14	22	5	0	0	0	0	56
SW	0	0	1	10	10	4	2	2	1	0	0	0	30
WSW	0	1	0	3	2	9	3	0	0	0	0	0	18
W	0	0	1	4	5	4	4	0	0	0	0	0	18
WNW	0	0	0	2	7	6	3	0	0	0	0	0	18
NW	0	1	0	4	5	10	11	0	0	0	0	0	31
NNW	0	0	0	2	4	6	3	0	0	0	0	0	15
TOTALS	0	2	6	56	79	157	214	45	18	0	0	0	577
NUMBER OF VALID HOURS				577				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				577	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

April - June

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08040100-08063023

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL E

SLIGHTLY STABLE (-0.5 < DT/DZ 1.5 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	1	0	3	9	3	0	0	0	0	0	0	16
NNE	0	1	2	8	19	16	3	0	0	0	0	0	49
NE	0	1	1	3	2	6	0	0	0	0	0	0	13
ENE	0	0	0	6	2	3	0	0	0	0	0	0	11
E	0	0	1	1	2	3	0	0	0	0	0	0	7
ESE	0	1	0	2	4	7	6	0	0	0	0	0	20
SE	0	0	2	1	2	5	8	1	0	0	0	0	19
SSE	0	0	0	4	5	7	0	0	0	0	0	0	16
S	0	0	1	2	2	0	0	0	0	0	0	0	5
SSW	0	0	0	4	3	1	0	0	0	0	0	0	8
SW	0	1	0	3	1	0	0	0	0	0	0	0	5
WSW	0	0	0	3	2	0	0	0	0	0	0	0	5
W	0	0	1	1	5	3	1	0	0	0	0	0	11
WNW	0	0	0	4	4	6	2	0	0	0	0	0	16
NW	0	0	1	3	2	7	3	0	0	0	0	0	16
NNW	0	0	1	5	4	3	1	0	0	0	0	0	14
TOTALS	0	5	10	53	68	70	24	1	0	0	0	0	231
NUMBER OF VALID HOURS				231				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				231	

PASQUILL F

MODERATELY STABLE (1.5 < DT/DZ 4.0 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	2	3	3	0	0	0	0	0	0	8
NNE	0	1	2	5	15	42	11	0	0	0	0	0	76
NE	0	0	2	6	2	1	1	1	0	0	0	0	13
ENE	0	0	0	0	1	2	2	0	0	0	0	0	5
E	0	0	0	2	2	2	0	0	0	0	0	0	6
ESE	0	0	0	2	0	1	0	0	0	0	0	0	3
SE	0	0	0	1	2	1	2	0	0	0	0	0	6
SSE	0	0	0	0	2	3	1	0	0	0	0	0	6
S	0	0	0	1	0	0	0	0	0	0	0	0	1
SSW	0	0	1	2	0	1	1	0	0	0	0	0	5
SW	0	0	0	0	0	0	0	0	0	0	0	0	0
WSW	0	1	0	0	1	0	0	0	0	0	0	0	2
W	0	0	2	3	2	4	0	0	0	0	0	0	11
WNW	0	0	2	2	4	9	0	0	0	0	0	0	17
NW	0	0	0	2	2	4	2	0	0	0	0	0	10
NNW	0	0	1	4	0	2	1	0	0	0	0	0	8
TOTALS	0	2	10	32	36	75	21	1	0	0	0	0	177
NUMBER OF VALID HOURS				177				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				177	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

April - June

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08040100-08063023

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL G

EXTREMELY STABLE (DT/DZ > 4.0 C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	3	1	1	4	0	0	0	0	0	9
NNE	0	1	1	3	12	79	57	1	0	0	0	0	154
NE	0	0	1	5	4	20	5	0	0	0	0	0	35
ENE	0	0	0	3	0	5	1	0	0	0	0	0	9
E	0	0	0	2	1	1	0	0	0	0	0	0	4
ESE	0	0	2	2	4	2	0	0	0	0	0	0	10
SE	0	1	0	1	1	1	1	0	0	0	0	0	5
SSE	0	0	0	1	2	0	0	0	0	0	0	0	3
S	0	0	1	1	1	2	0	0	0	0	0	0	5
SSW	0	0	0	1	1	0	0	0	0	0	0	0	2
SW	0	0	0	0	0	0	0	0	0	0	0	0	0
WSW	0	0	0	0	2	0	1	0	0	0	0	0	3
W	0	0	0	2	0	1	0	0	0	0	0	0	3
WNW	0	0	0	0	1	3	0	0	0	0	0	0	4
NW	0	0	0	0	1	4	1	0	0	0	0	0	6
NNW	0	0	1	0	0	3	2	0	0	0	0	0	6
TOTALS	0	2	6	24	31	122	72	1	0	0	0	0	258
NUMBER OF VALID HOURS				258				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				258	

ALL STABILITY CLASSES, ALL DT/DZ

WIND SPEED (M/S) AT 10 METER LEVEL

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	1	1	14	18	14	4	0	0	0	0	0	52
NNE	0	3	5	26	53	149	71	1	0	0	0	0	308
NE	0	1	4	17	10	31	6	2	0	0	0	0	71
ENE	0	0	0	10	4	11	3	2	0	0	0	0	30
E	0	0	1	5	7	8	0	0	0	0	0	0	21
ESE	0	1	2	7	9	16	14	0	0	0	0	0	49
SE	0	1	2	4	6	32	69	15	5	0	0	0	134
SSE	0	0	0	9	18	47	82	22	16	0	0	0	194
S	0	0	2	13	15	39	90	24	12	3	0	0	198
SSW	0	0	4	10	17	47	90	16	2	1	0	0	187
SW	0	1	2	15	26	56	64	9	2	0	0	0	175
WSW	0	2	0	8	26	64	103	2	0	0	0	0	205
W	0	0	4	13	18	72	107	0	0	0	0	0	214
WNW	0	0	2	10	22	48	103	2	0	0	0	0	187
NW	0	1	1	9	13	36	47	6	0	0	0	0	113
NNW	0	0	3	11	9	15	8	0	0	0	0	0	46
TOTALS	0	11	33	181	271	685	861	101	37	4	0	0	2184
NUMBER OF VALID HOURS				2184				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				2184	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

July - September

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08070100-08093023

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL A

EXTREMELY UNSTABLE (DT/DZ  $-1.9$  C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	0	0	0	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0	0	0	0	0	0	0
SSE	0	0	0	0	0	3	1	0	0	0	0	0	4
S	0	0	0	0	0	3	21	0	0	0	0	0	24
SSW	0	0	0	0	5	14	29	1	0	0	0	0	49
SW	0	0	1	1	15	47	31	1	0	0	0	0	96
WSW	0	0	0	3	21	105	52	0	0	0	0	0	181
W	0	0	0	2	10	85	130	0	0	0	0	0	227
WNW	0	0	0	1	5	51	120	0	0	0	0	0	177
NW	0	0	0	0	1	5	7	1	1	0	0	0	15
NNW	0	0	0	1	0	0	0	0	0	0	0	0	1
TOTALS	0	0	1	8	57	313	391	3	1	0	0	0	774
NUMBER OF VALID HOURS				774				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				774	

PASQUILL B

MODERATELY UNSTABLE ( $-1.9 < DT/DZ < -1.7$  C/100 METERS)

WIND DIR	.22-50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	0	0	0	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0	0	0	0	0	0	0
ENE	0	0	0	0	1	0	0	0	0	0	0	0	1
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0	0	0	0	0	0	0
SSE	0	0	0	0	1	2	0	0	0	0	0	0	3
S	0	0	0	1	3	5	1	0	0	0	0	0	10
SSW	0	0	0	0	3	3	7	3	0	0	0	0	16
SW	0	0	0	2	3	4	6	0	0	0	0	0	15
WSW	0	0	0	0	3	3	0	0	0	0	0	0	6
W	0	0	0	1	3	3	1	0	0	0	0	0	8
WNW	0	0	0	1	5	7	2	0	0	0	0	0	15
NW	0	0	0	0	1	3	4	2	0	0	0	0	10
NNW	0	0	0	0	1	1	0	0	0	0	0	0	2
TOTALS	0	0	0	5	24	31	21	5	0	0	0	0	86
NUMBER OF VALID HOURS				86				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				86	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

July - September

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08070100-08093023

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL C

SLIGHTLY UNSTABLE (-1.7 < DT/DZ -1.5 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	1	0	0	0	0	0	0	0	0	0	1
NNE	0	0	1	3	0	0	0	0	0	0	0	0	4
NE	0	0	0	1	0	0	0	0	0	0	0	0	1
ENE	0	0	0	0	0	0	0	0	0	0	0	0	0
E	0	0	0	0	0	0	1	0	0	0	0	0	1
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	1	0	0	0	0	0	0	0	0	1
SSE	0	0	0	1	4	5	1	0	0	0	0	0	11
S	0	0	0	0	6	9	3	0	0	0	0	0	18
SSW	0	0	0	0	2	9	4	0	0	0	0	0	15
SW	0	0	1	5	2	9	2	0	0	0	0	0	19
WSW	0	0	0	1	8	5	0	0	0	0	0	0	14
W	0	0	0	1	6	4	0	0	0	0	0	0	11
WNW	0	0	0	2	16	10	1	0	0	0	0	0	29
NW	0	0	0	2	4	10	4	0	0	0	0	0	20
NNW	0	0	0	0	0	2	0	0	0	0	0	0	2
TOTALS	0	0	3	17	48	63	16	0	0	0	0	0	147
NUMBER OF VALID HOURS				147				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				147	

PASQUILL D

NEUTRAL (-1.5 < DT/DZ -0.5 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	2	9	13	7	0	0	0	0	0	0	31
NNE	0	0	2	14	12	12	1	0	0	0	0	0	41
NE	0	0	2	5	3	10	0	0	0	0	0	0	20
ENE	0	0	0	4	0	3	0	0	0	0	0	0	7
E	0	0	1	3	2	2	0	0	0	0	0	0	8
ESE	0	0	1	5	1	7	0	0	0	0	0	0	14
SE	0	0	1	6	12	21	11	1	0	0	0	0	52
SSE	0	0	0	4	12	58	34	1	0	0	0	0	109
S	0	0	1	12	22	49	27	0	0	0	0	0	111
SSW	0	1	2	23	28	13	7	0	0	0	0	0	74
SW	0	1	4	19	12	8	4	0	0	0	0	0	48
WSW	0	1	9	23	23	9	0	0	0	0	0	0	65
W	0	0	8	29	18	4	0	0	0	0	0	0	59
WNW	0	0	5	37	26	8	0	0	0	0	0	0	76
NW	0	0	3	19	18	17	10	2	0	0	0	0	69
NNW	0	0	7	17	15	8	0	0	0	0	0	0	47
TOTALS	0	3	48	229	217	236	94	4	0	0	0	0	831
NUMBER OF VALID HOURS				831				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				831	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

July - September

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08070100-08093023

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL E

SLIGHTLY STABLE (-0.5 < DT/DZ 1.5 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	1	1	7	9	2	1	0	0	0	0	0	21
NNE	0	3	5	27	17	12	1	0	0	0	0	0	65
NE	0	1	2	6	3	2	0	0	0	0	0	0	14
ENE	0	0	3	3	0	1	0	0	0	0	0	0	7
E	0	1	2	2	2	0	0	0	0	0	0	0	7
ESE	0	0	0	2	3	0	0	0	0	0	0	0	5
SE	0	0	1	1	3	3	5	4	0	0	0	0	17
SSE	0	0	1	3	7	6	6	3	0	0	0	0	26
S	0	0	1	6	4	2	0	0	0	0	0	0	13
SSW	0	0	1	1	1	1	0	0	0	0	0	0	4
SW	0	0	1	2	1	0	0	0	0	0	0	0	4
WSW	0	1	1	2	0	2	0	1	0	0	0	0	7
W	0	1	1	2	1	1	0	0	0	0	0	0	6
WNW	0	0	2	2	2	1	2	0	0	0	0	0	9
NW	0	0	0	1	1	1	0	0	0	0	0	0	3
NNW	0	0	1	1	2	5	0	0	0	0	0	0	9
TOTALS	0	8	23	68	56	39	15	8	0	0	0	0	217
NUMBER OF VALID HOURS				217				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				217	

PASQUILL F

MODERATELY STABLE (1.5 < DT/DZ 4.0 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	0	2	5	1	0	0	0	0	0	8
NNE	0	1	0	5	15	26	1	0	0	0	0	0	48
NE	0	0	0	3	2	1	0	0	0	0	0	0	6
ENE	0	0	1	4	1	1	0	0	0	0	0	0	7
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	2	0	1	0	0	0	0	0	0	3
SE	0	0	0	1	0	0	0	0	0	0	0	0	1
SSE	0	0	0	0	0	1	0	0	0	0	0	0	1
S	0	0	0	1	1	1	0	0	0	0	0	0	3
SSW	0	0	1	1	1	0	1	0	0	0	0	0	4
SW	0	0	0	0	1	0	0	0	0	0	0	0	1
WSW	0	0	0	0	0	0	0	0	0	0	0	0	0
W	0	0	0	1	1	0	0	0	0	0	0	0	2
WNW	0	1	0	1	0	1	3	0	0	0	0	0	6
NW	0	0	0	0	0	1	0	2	0	0	0	0	3
NNW	0	0	2	0	1	0	0	0	0	0	0	0	3
TOTALS	0	2	4	19	25	38	6	2	0	0	0	0	96
NUMBER OF VALID HOURS				96				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				96	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

July - September

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08070100-08093023

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL G

EXTREMELY STABLE (DT/DZ > 4.0 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	1	0	0	0	1	0	0	0	0	2
NNE	0	0	0	1	4	17	10	0	0	0	0	0	32
NE	0	0	0	1	1	0	0	0	0	0	0	0	2
ENE	0	0	0	0	2	0	0	0	0	0	0	0	2
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	1	1	0	0	0	0	0	0	0	2
SE	0	0	0	1	0	1	0	0	0	0	0	0	2
SSE	0	0	0	0	3	0	0	0	0	0	0	0	3
S	0	0	0	0	1	0	0	0	0	0	0	0	1
SSW	0	0	0	0	1	0	0	0	0	0	0	0	1
SW	0	0	1	1	0	0	0	0	0	0	0	0	2
WSW	0	0	1	0	0	0	0	0	0	0	0	0	1
W	0	0	0	0	0	1	0	0	0	0	0	0	1
WNW	0	0	0	0	1	0	0	0	0	0	0	0	1
NW	0	0	0	1	0	0	0	0	0	0	0	0	1
NNW	0	0	0	1	0	1	2	0	0	0	0	0	4
TOTALS	0	0	2	8	14	20	12	1	0	0	0	0	57
NUMBER OF VALID HOURS				57				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				57	

ALL STABILITY CLASSES, ALL DT/DZ  
WIND SPEED (M/S) AT 10 METER LEVEL

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	1	4	17	24	14	2	1	0	0	0	0	63
NNE	0	4	8	50	48	67	13	0	0	0	0	0	190
NE	0	1	4	16	9	13	0	0	0	0	0	0	43
ENE	0	0	4	11	4	5	0	0	0	0	0	0	24
E	0	1	3	5	4	2	1	0	0	0	0	0	16
ESE	0	0	1	10	5	8	0	0	0	0	0	0	24
SE	0	0	2	10	15	25	16	5	0	0	0	0	73
SSE	0	0	1	8	27	75	42	4	0	0	0	0	157
S	0	0	2	20	37	69	52	0	0	0	0	0	180
SSW	0	1	4	25	41	40	48	4	0	0	0	0	163
SW	0	1	8	30	34	68	43	1	0	0	0	0	185
WSW	0	2	11	29	55	124	52	1	0	0	0	0	274
W	0	1	9	36	39	98	131	0	0	0	0	0	314
WNW	0	1	7	44	55	78	128	0	0	0	0	0	313
NW	0	0	3	23	25	37	25	7	1	0	0	0	121
NNW	0	0	10	20	19	17	2	0	0	0	0	0	68
TOTALS	0	13	81	354	441	740	555	23	1	0	0	0	2208
NUMBER OF VALID HOURS				2208				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				2208	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

October - December

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08100100-08123123

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL A

EXTREMELY UNSTABLE (DT/DZ  $-1.9$  C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	0	0	0	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0	1	0	0	0	0	1
ENE	0	0	0	0	0	0	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0	0	0	0	0	0	0
SSE	0	0	0	0	0	1	2	0	0	0	0	0	3
S	0	0	0	0	4	10	7	0	0	0	0	0	21
SSW	0	0	0	1	5	6	4	0	0	0	0	0	16
SW	0	0	0	1	6	5	2	0	0	0	0	0	14
WSW	0	0	0	2	8	18	21	1	0	0	0	0	50
W	0	0	0	0	15	43	20	3	2	0	0	0	83
WNW	0	0	0	0	4	46	68	7	6	0	0	0	131
NW	0	0	0	0	1	4	4	6	0	0	0	0	15
NNW	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTALS	0	0	0	4	43	133	128	18	8	0	0	0	334
NUMBER OF VALID HOURS				334				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				334	

PASQUILL B

MODERATELY UNSTABLE ( $-1.9 < DT/DZ < -1.7$  C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	0	0	0	0	0	0	0	0	0	0
NNE	0	0	0	0	0	0	0	1	0	0	0	0	1
NE	0	0	0	0	0	0	0	1	0	0	0	0	1
ENE	0	0	0	0	0	0	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	1	0	0	0	0	0	0	0	0	0	0	0	1
SE	0	0	0	0	0	0	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	0	0	0	0	0	0	0
S	0	0	0	1	0	1	0	2	1	0	0	0	5
SSW	0	0	0	0	4	0	2	1	0	0	0	0	7
SW	0	0	0	2	0	0	1	1	0	0	0	0	4
WSW	1	0	1	1	0	0	2	0	0	0	0	0	5
W	0	1	0	0	2	0	0	1	0	0	0	0	4
WNW	0	0	0	1	1	4	1	0	1	0	0	0	8
NW	0	0	0	1	0	1	0	0	0	0	0	0	2
NNW	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTALS	2	1	1	6	7	6	6	7	2	0	0	0	38
NUMBER OF VALID HOURS				38				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				38	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

October - December

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08100100-08123123

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL C

SLIGHTLY UNSTABLE (-1.7 < DT/DZ -1.5 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	0	1	0	0	0	0	0	0	0	1
NNE	0	0	0	0	0	0	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0	2	0	0	0	0	2
ENE	0	0	0	0	0	0	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0	0	0	0	0	0	0
ESE	0	0	0	0	0	0	0	0	0	0	0	0	0
SE	0	0	0	0	0	0	0	0	0	0	0	0	0
SSE	0	0	0	0	0	0	3	1	0	0	0	0	4
S	0	0	0	0	1	2	1	0	0	0	0	0	4
SSW	0	0	0	0	2	0	1	0	0	0	0	0	3
SW	0	0	0	1	1	3	1	0	0	0	0	0	6
WSW	1	0	0	0	1	0	0	1	1	0	0	0	4
W	1	0	0	0	0	3	0	0	0	0	0	0	4
WNW	0	0	0	0	0	3	0	0	0	0	0	0	3
NW	0	0	0	0	1	0	4	1	0	0	0	0	6
NNW	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTALS	2	0	0	1	7	11	10	5	1	0	0	0	37
NUMBER OF VALID HOURS				37				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				37	

PASQUILL D

NEUTRAL (-1.5 < DT/DZ -0.5 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	0	4	1	2	4	0	0	0	0	0	11
NNE	0	0	0	0	1	5	1	0	0	0	0	0	7
NE	0	0	1	1	1	3	1	3	1	0	0	0	11
ENE	0	0	0	4	1	0	1	0	0	0	0	0	6
E	1	0	0	2	1	4	1	0	0	0	0	0	9
ESE	0	0	0	1	4	3	2	6	0	0	0	0	16
SE	0	0	0	1	5	8	17	11	9	0	0	0	51
SSE	0	0	2	3	6	9	19	16	1	0	0	0	56
S	0	0	0	1	4	7	7	2	1	1	2	0	25
SSW	0	0	0	5	1	7	6	4	0	0	2	0	25
SW	0	0	1	2	2	6	6	8	2	1	0	0	28
WSW	2	0	0	0	4	4	6	2	2	0	0	0	20
W	0	0	2	3	5	7	3	4	6	0	0	0	30
WNW	0	0	1	3	6	15	6	1	1	0	0	0	33
NW	0	0	0	2	5	16	17	3	1	0	0	0	44
NNW	1	0	0	5	4	10	4	2	0	0	0	0	26
TOTALS	4	0	7	37	51	106	101	62	24	2	4	0	398
NUMBER OF VALID HOURS				398				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				398	

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT - 2008

METEOROLOGY

October - December

TABLE 4A

SITE: SAN ONOFRE

PERIOD OF RECORD 08100100-08123123

WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL E

SLIGHTLY STABLE (-0.5 < DT/DZ 1.5 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	1	5	11	10	3	0	0	0	0	0	30
NNE	0	1	1	17	15	20	5	1	0	0	0	0	60
NE	0	1	1	10	5	6	2	5	7	2	0	0	39
ENE	0	0	1	6	2	7	2	3	1	0	0	0	22
E	0	0	1	7	7	7	4	2	0	0	0	0	28
ESE	0	0	2	3	3	2	5	0	0	0	0	0	15
SE	0	0	0	7	8	10	9	0	0	0	0	0	34
SSE	0	1	0	2	5	16	8	1	1	0	0	0	34
S	0	0	0	0	1	1	0	1	0	0	0	0	3
SSW	0	0	4	0	4	0	0	1	0	0	0	0	9
SW	0	1	2	5	4	0	0	1	0	0	0	0	13
WSW	0	1	0	3	6	0	3	3	0	0	0	0	16
W	0	0	1	6	9	7	0	6	0	0	0	0	29
WNW	0	0	0	7	8	16	7	2	6	0	0	0	46
NW	0	0	2	4	6	5	5	1	0	0	0	0	23
NNW	0	0	1	4	2	7	3	0	0	0	0	0	17
TOTALS	0	5	17	86	96	114	56	27	15	2	0	0	418
NUMBER OF VALID HOURS				418				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				418	

PASQUILL F

MODERATELY STABLE (1.5 < DT/DZ 4.0 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	1	0	1	7	8	5	5	0	0	0	0	0	27
NNE	0	1	1	14	32	31	16	2	0	0	0	0	97
NE	3	1	7	15	16	5	8	2	0	0	0	0	57
ENE	2	0	6	11	9	4	0	0	0	0	0	0	32
E	4	0	3	10	5	2	0	0	0	0	0	0	24
ESE	3	0	2	5	2	1	1	0	0	0	0	0	14
SE	0	0	0	4	3	1	3	0	0	0	0	0	11
SSE	0	0	0	4	4	3	4	1	0	0	0	0	16
S	0	0	1	8	2	1	0	0	0	0	0	0	12
SSW	0	0	0	3	2	0	0	0	0	0	0	0	5
SW	3	0	1	5	1	1	0	0	0	0	0	0	11
WSW	0	0	2	4	4	1	0	0	0	0	0	0	11
W	3	0	1	0	7	5	0	0	0	0	0	0	16
WNW	0	1	2	2	6	7	6	0	0	0	0	0	24
NW	2	0	3	3	5	2	3	0	0	0	0	0	18
NNW	2	0	3	5	1	3	1	0	0	0	0	0	15
TOTALS	23	3	33	100	107	72	47	5	0	0	0	0	390
NUMBER OF VALID HOURS				390				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				390	

October - December  
 TABLE 4A  
 SITE: SAN ONOFRE  
 PERIOD OF RECORD 08100100-08123123  
 WIND SPEED (M/S) AT 10 METER LEVEL

PASQUILL G  
 EXTREMELY STABLE (DT/DZ > 4.0 C/100 METERS)

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	0	0	4	3	3	8	6	0	0	0	0	0	24
NNE	0	1	2	12	18	130	149	3	0	0	0	0	315
NE	0	1	1	10	20	29	19	4	0	0	0	0	84
ENE	0	0	1	7	10	7	6	0	0	0	0	0	31
E	0	0	0	6	5	6	0	0	0	0	0	0	17
ESE	0	0	3	2	1	2	0	0	0	0	0	0	8
SE	0	0	0	3	1	1	0	0	0	0	0	0	5
SSE	0	0	1	2	3	2	3	0	0	0	0	0	11
S	0	0	0	5	3	2	0	0	0	0	0	0	10
SSW	0	1	1	5	3	0	0	0	0	0	0	0	10
SW	0	0	0	8	0	4	1	0	0	0	0	0	13
WSW	0	0	1	4	0	1	1	0	0	0	0	0	7
W	0	0	2	2	4	1	0	0	0	0	0	0	9
WNW	0	1	1	3	6	16	0	0	0	0	0	0	27
NW	0	0	1	3	1	4	4	0	0	0	0	0	13
NNW	0	0	2	1	2	3	1	0	0	0	0	0	9
TOTALS	0	4	20	76	80	216	190	7	0	0	0	0	593
NUMBER OF VALID HOURS				593				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				593	

ALL STABILITY CLASSES, ALL DT/DZ  
 WIND SPEED (M/S) AT 10 METER LEVEL

WIND DIR	.22-.50	.51-75	.76-1.0	1.1-1.5	1.6-2.0	2.1-3.0	3.1-5.0	5.1-7.0	7.1-10.0	10.1-13.0	13.1-18.0	>18	TOTALS
N	1	0	6	19	24	25	18	0	0	0	0	0	93
NNE	0	3	4	43	66	186	171	7	0	0	0	0	480
NE	3	3	10	36	42	43	30	18	8	2	0	0	195
ENE	2	0	8	28	22	18	9	3	1	0	0	0	91
E	5	0	4	25	18	19	5	2	0	0	0	0	78
ESE	4	0	7	11	10	8	8	6	0	0	0	0	54
SE	0	0	0	15	17	20	29	11	9	0	0	0	101
SSE	0	1	3	11	18	31	39	19	2	0	0	0	124
S	0	0	1	15	15	24	15	5	2	1	2	0	80
SSW	0	1	5	14	21	13	13	6	0	0	0	0	75
SW	3	1	4	24	14	19	11	10	2	1	0	0	89
WSW	4	1	4	14	23	24	33	7	3	0	0	0	113
W	4	1	6	11	42	66	23	14	8	0	0	0	175
WNW	0	2	4	16	31	107	88	10	14	0	0	0	272
NW	2	0	6	13	19	32	37	11	1	0	0	0	121
NNW	3	0	6	15	9	23	9	2	0	0	0	0	67
TOTALS	31	13	78	310	391	658	538	131	50	4	4	0	2208
NUMBER OF VALID HOURS				2208				NUMBER OF CALMS				0	
NUMBER OF INVALID HOURS				0				TOTAL HOURS FOR THE PERIOD				2208	

**Enclosure 2:**

**SO123-ODCM, Revision 1**

February 29, 2008

Mr. R. T. Ridenoure

SUBJECT: Revision 1 of the San Onofre Nuclear Generating Station (SONGS)  
Offsite Dose Calculation Manual(ODCM), S0123-ODCM.


In accordance with Technical Specification 5.5.2.1, Revision 1 to the SONGS  
Dose Calculation Manual has been prepared and reviewed for your approval.

This revision incorporates the current changes to the Land Use Census. In  
addition to several administrative changes, it also creates an additional  
appendix to capture supplemental information pertinent to the effluent  
controls program; 1) a Kathleen Yhip to Daryl Dick Memorandum for File,  
"Recommended Effluent Concentration Limits from 10CFR20 Appendix B, Table 2,  
for Setpoint Calculations," dated April 23, 1993 and 2) an E.S. Medling to  
J. Clark Memorandum for File, "Impact of the New 10 CFR 20 Upon SONGS  
Effluent Control Limits," dated June 14, 1993.


None of the changes in this revision will adversely affect the accuracy or  
reliability of effluent dose calculations or set point determinations. Your  
approval for this revision is requested.

Copies of this letter are being forwarded to the Nuclear Safety Group as  
required by Technical Specification 5.5.2.1.

Please contact me if there are any questions.

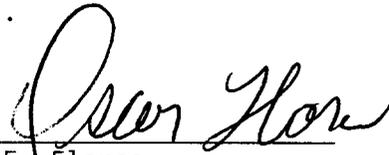  
O.F. Flores  
Manager, Chemistry

Approved by:

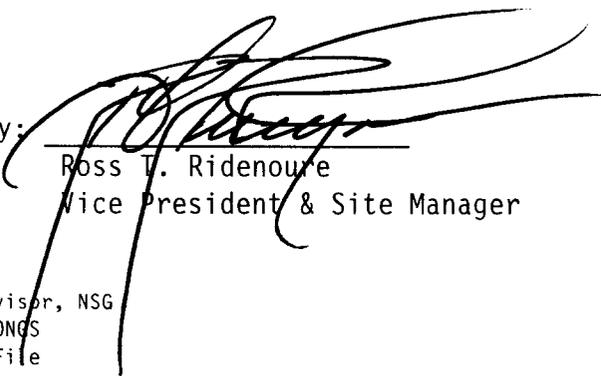  
Ross T. Ridenoure  
Vice President & Site Manager

Attachment  
cc: Supervisor, NSG  
CDM-SONGS  
Chem File

RECEIVED CDM

FEB 29 2008

SITE FILE COPY

2/29/2008

SUBJECT: SONGS OFFSITE DOSE CALCULATION MANUAL Revision 1

Enclosed is Revision 1 to the SONGS Offsite Dose Calculation Manual (ODCM). This revision accomplishes three objectives: 1) Incorporates the latest updates related to the 2006-2007 Land Use Census (LUC) from the J.W. Scott to D. Dick Memorandum for File, "2008 Dose Parameters for SONGS," dated February 11, 2008 2) Creates Appendix B to incorporate historical references for the effluent control program and 3) Changes page numbers in Appendices to identify the Appendix number.

Editorial corrections were made to Figure 4-5 to correct a release pathway unintentionally omitted from the figure. Added pg vi in the Table of Contents for S0123-ODCM to identify the two ODCM appendices.

No 50.59 or EOE reviews were required or performed for editorial changes.

None of the changes impact the accuracy or reliability of effluent dose or setpoint calculations. The level of radioactive effluent control required by 10CFR20, 40CFR190, 10CFR50.35a and Appendix I to 10CFR50 will be maintained.

Throughout the document, change bars are marked in one of four ways as follows:

- A Addition
- D Deletion
- F Editorial/Format change
- R Revision

Page #	Change	Reason
vi	Added pg vi in Table of Contents to include a List of Appendices.	A
2-29	Revised table 2-6 per LUC	R
4-20	corrected to include a release pathway unintentionally removed in prior revision	F
Appendix A- ALL	renumbered the page to include Appendix identification ie. 1-1 to A1-1.	F
Appendix A- table of contents	edited to include page identifier for Table of Contents for Appendix A, Changed page numbers and reformatted	R
A1-8	Revised Ri values per LUC	R

A1-10	Revised Ri values per LUC, edited page 1 of 2 to page 1 of 3 per LUC	R/F
A1-11	Changed from pg 2 of 2 to page 2 of 3 per LUC	F
A1-12	Added new pathway, page 3 of 3 per LUC	A
A1-13	Revised Ri values per LUC	R
A1-14	Revised Ri values per LUC	R
A1-15	Revised Ri values per LUC	R
A1-17	Revised Ri values per LUC	R
A1-19	Revised Ri values per LUC	R
A1-22	Changed from page 1 of 2 to page 1 of 3 per LUC	F
A1-23	Added new pathway, page 2 of 3 per LUC	A
A1-24	Changed from page 2 of 2 to page 3 of 3 per LUC	F
Appendix B	Added Appendix B so as to include supplemental information on the effluent control program (historical references)	A

OFFSITE DOSE CALCULATION MANUAL

NUCLEAR ORGANIZATION

SAN ONOFRE NUCLEAR GENERATING STATION (SONGS)

S0123-0DCM  
Revision 1  
02-29-08

ODCM

TABLE OF CONTENTS

	<u>Page</u>
LIST OF FIGURES . . . . .	iv
LIST OF TABLES . . . . .	v
INTRODUCTION . . . . .	vi
1.0 LIQUID EFFLUENTS . . . . .	1-1 thru 1-27
1.1 Concentration . . . . .	1-1
1.1.1 Specification . . . . .	1-1
1.1.1.1, 1.1.1.2 Surveillances . . . . .	1-1
1.2 Dose . . . . .	1-6
1.2.1 Specification . . . . .	1-6
1.2.1.1 Surveillance . . . . .	1-6
1.3 Liquid Waste Treatment . . . . .	1-7
1.3.1 Specification . . . . .	1-7
1.3.1.1, 1.3.1.2, 1.3.1.3 Surveillances . . . . .	1-7
1.4 Liquid Effluent Monitor Methods of Setpoint Calculation . . . . .	1-9
1.4.1 Batch Release Setpoint Determination . . . . .	1-11
1.4.2 Continuous Release Setpoint Determination . . . . .	1-15
1.5 Dose Calculations for Liquid Effluents . . . . .	1-24
1.6 Representative Sampling . . . . .	1-27
2.0 GASEOUS EFFLUENTS . . . . .	2-1 thru 2-31
2.1 Dose Rate . . . . .	2-1
2.1.1 Specification . . . . .	2-1
2.1.1.1, 2.1.1.2 Surveillances . . . . .	2-1
2.2 Dose - Noble Gas . . . . .	2-5
2.2.1 Specification . . . . .	2-5
2.2.1.1 Surveillance . . . . .	2-5
2.3 Dose - Radioiodines, Radioactive Materials in Particulate Form and Tritium . . . . .	2-6
2.3.1 Specification . . . . .	2-6
2.3.1.1 Surveillance . . . . .	2-6

ODCM

TABLE OF CONTENTS (Continued)

	<u>Page</u>
2.4 Gaseous Radwaste Treatment . . . . .	2-7
2.4.1 Specification . . . . .	2-7
2.4.1.1 Surveillance . . . . .	2-7
2.4.1.2, 2.4.1.3 Surveillances . . . . .	2-8
2.5 Deleted, moved to Section 3	
2.6 Gaseous Effluent Monitor Setpoints . . . . .	2-10
2.6.1 Plant Stack . . . . .	2-10
2.6.2 Condenser Evacuation System . . . . .	2-13
2.6.3 Containment Purge . . . . .	2-15
2.6.4 Waste Gas Header . . . . .	2-18
2.7 Gaseous Effluent Dose Rate . . . . .	2-21
2.7.1 Noble Gases . . . . .	2-21
2.7.2 Radioiodines and Particulates . . . . .	2-22
2.8 Gaseous Effluent Dose Calculation . . . . .	2-23
2.8.1 Noble Gases . . . . .	2-23
2.8.1.1 Historical Meteorology . . . . .	2-23
2.8.1.2 Concurrent Meteorology . . . . .	2-24
2.8.2 Radioiodines and Particulates . . . . .	2-25
2.8.2.1 Historical Meteorology . . . . .	2-25
2.8.2.2 Concurrent Meteorology . . . . .	2-26
3.0 PROJECTED DOSES . . . . .	3-1 thru 3-5
3.1 Liquid Dose Projection . . . . .	3-1
3.2 Gaseous Dose Projection . . . . .	3-1
3.3 Total Dose . . . . .	3-2
3.3.1 Specification . . . . .	3-2
3.3.1.1 Surveillance . . . . .	3-2
3.4 Total Dose Calculations . . . . .	3-3
3.4.1 Total Dose to Most Likely Member of the Public . . . . .	3-3
3.4.1.1 Annual Total Organ Dose . . . . .	3-3
3.4.1.2 Annual Total Whole Body Dose . . . . .	3-4
3.4.1.3 Annual Total Thyroid Dose . . . . .	3-5

ODCM

TABLE OF CONTENTS (Continued)

	<u>Page</u>
4.0 EQUIPMENT . . . . .	4-1 thru 4-22
4.1 Radioactive Liquid Effluent Monitoring Instrumentation . .	4-1
4.1.1 Specification . . . . .	4-1
4.1.1.1, 4.1.1.2 Surveillances . . . . .	4-1
4.2 Radioactive Gaseous Effluent Monitoring Instrumentation . .	4-9
4.2.1 Specification . . . . .	4-9
4.2.1.1 Surveillance . . . . .	4-9
4.3 Operability of Radioactive Waste Equipment . . . . .	4-19
5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING . . . . .	5-1 thru 5-27
5.1 Monitoring Program . . . . .	5-1
5.1.1 Specification . . . . .	5-1
5.1.1.1 Surveillance . . . . .	5-2
5.2 Land Use Census . . . . .	5-11
5.2.1 Specification . . . . .	5-11
5.2.1.1 Surveillance . . . . .	5-11
5.3 Interlaboratory Comparison Program . . . . .	5-12
5.3.1 Specification . . . . .	5-12
5.3.1.1 Surveillance . . . . .	5-12
5.4 Annual Radiological Environmental Operating Report . . . .	5-13
5.5 Sample Locations . . . . .	5-14
6.0 ADMINISTRATIVE . . . . .	6-1 thru 6-17
6.1 Definitions . . . . .	6-1
6.2 Administrative Controls . . . . .	6-8
6.3 Major Changes to Radioactive Waste Treatment Systems (Liquid and Gaseous) . . . . .	6-10
6.4 Bases . . . . .	6-11

ODCM  
LIST OF FIGURES

Figure	Title	Page
1-2	Site Boundary for Liquid Effluents . . . . .	1-8
2-2	Site Boundary for Gaseous Effluents . . . . .	2-9
4-5	SONGS 2 and 3 Radioactive Liquid Waste Treatment Systems . . . . .	4-20
4-6	SONGS 2 and 3 Radioactive Gaseous Waste Treatment Systems . . . . .	4-21
4-7	Solid Waste Handling . . . . .	4-22
5-1	Radiological Environmental Monitoring Sample Locations 1 Mile Radius . . . . .	5-23
5-2	Radiological Environmental Monitoring Sample Locations 2 Mile Radius . . . . .	5-24
5-3	Radiological Environmental Monitoring Sample Locations 10 Miles Radius . . . . .	5-25
5-4	Radiological Environmental Monitoring Sample Locations Orange County . . . . .	5-26
5-5	Radiological Environmental Monitoring Sample Locations San Diego County . . . . .	5-27

ODCM

LIST OF TABLES

Table	Title	Page
1-1	Radioactive Liquid Waste Sampling and Analysis Program . . .	1-2
1-3	Liquid Effluent Radiation Monitors Calibration Constants . . . . .	1-23
1-4	Dose Commitment Factors $A_{it}$ . . . . .	1-25
2-1	Radioactive Gaseous Waste Sampling and Analysis Program . .	2-2
2-3	Gaseous Effluent Radiation Monitor Calibration Constants . . . . .	2-20
2-4	Dose Factors for Noble Gas and Daughters . . . . .	2-27
2-5	Dose Parameters $P_{ik}$ . . . . .	2-28
2-6	Units 2 and 3 Controlling Location Factors . . . . .	2-29
2-7	SYF Controlling Location Factors . . . . .	2-30
2-8	NIA (Unit 1) Controlling Location Factor . . . . .	2-31
4-1	Radioactive Liquid Effluent Monitoring Instrumentation . . .	4-2
4-2	Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements . . . . .	4-6
4-3	Radioactive Gaseous Effluent Monitoring Instrumentation . .	4-10
4-4	Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements . . . . .	4-14
5-1	Radiological Environmental Monitoring Program . . . . .	5-3
5-2	Reporting Levels for Radioactivity Concentrations in Environmental Samples . . . . .	5-7
5-3	Maximum Values for the Lower Limits of Detection (LLD) . . .	5-8
5-4	Radiological Environmental Monitoring Sample Locations . . .	5-15
5-5	PIC Radiological Environmental Monitoring Locations . . . .	5-21
5-6	Sector and Direction Designation for Radiological Environmental Monitoring Sample Location Map . . . . .	5-22
6-1	Operational Modes . . . . .	6-6
6-2	Frequency Notation . . . . .	6-7

**ODCM**  
**LIST OF APPENDICES**

<u>Title</u>	<u>Appendix</u>
Ri TABLES . . . . .	S0123-ODCM-A
Supplemental Information for the Effluent Controls Program . . . .	S0123-ODCM-B

## INTRODUCTION

The OFFSITE DOSE CALCULATION MANUAL (ODCM) is a supporting document of the RADIOLOGICAL EFFLUENT TECHNICAL SPECIFICATIONS (NUREG 0472). The ODCM enumerates dose and concentration specifications, instrument requirements, as well as describes the methodology and parameters to be used in the calculation of offsite doses from radioactive liquid and airborne effluents consistent with RG 1.109 and NUREG 0133. In order to meet release limits, it additionally provides calculations for liquid and gaseous effluent monitoring instrumentation alarm/trip setpoints. The environmental section contains the requirements for the radiological environmental monitoring program.

The ODCM will be maintained at the Site for use as a document of Specifications and acceptable methodologies and calculations to be used in implementing the Specifications. Changes in the calculational methods or parameters will be incorporated into the ODCM in order to assure that the ODCM represents current methodology.

## 1.0 LIQUID EFFLUENTS

### 1.1 CONCENTRATION

#### SPECIFICATION

- 1.1.1 The concentration of radioactive material released from the site (see Figure 1-2) shall be limited to the concentrations specified in 10 CFR Part 20, Appendix B, Table II, column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to  $2 \times 10^{-4}$  microcuries/ml total activity.

APPLICABILITY: At all times

#### ACTION:

- a. With the concentration of radioactive material released from the site exceeding the above limits, immediately restore the concentration to within the above limits.

#### SURVEILLANCE REQUIREMENTS

- .1 Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program of Table 1-1.
- .2 The results of the radioactivity analyses shall be used in accordance with the methodology and parameters in Section 1.4 to assure that the concentrations at the point of release are maintained within the limits of Specification 1.1.1.

TABLE 1-1

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

Liquid Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) ( $\mu\text{Ci}/\text{ml}$ ) <sup>a</sup>	
A. Batch Waste Release <sup>d</sup>	P Each Batch	P Each Batch	Principal Gamma Emitters <sup>f</sup>	$5 \times 10^{-7}$	
			I-131	$1 \times 10^{-6}$	
	P One Batch/M	M	Dissolved and Entrained Gases (Gamma emitters)		$1 \times 10^{-5}$
			P Each Batch	M Composite <sup>b</sup>	H-3
	Gross Alpha	$1 \times 10^{-7}$			
	P Each Batch	Q Composite <sup>b</sup>	Sr-89, Sr-90	$5 \times 10^{-8}$	
Fe-55			$1 \times 10^{-6}$		

NOTE BATCH RELEASE POINTS: Primary Plant Makeup Storage Tanks, Radwaste Primary Tanks, Radwaste Secondary Tanks, Miscellaneous Waste Condensate Monitor Tanks, Blowdown Processing System Neutralization Sump, FFCPD sumps (high conductivity, low conductivity) and holdup tank, Component Cooling Water Sump, Storage Tank Area Sump, S/G Blowdown.

B. Continuous Releases <sup>e</sup> ,	D Grab Sample	W Composite <sup>c</sup>	Principal Gamma Emitters <sup>f</sup>	$5 \times 10^{-7}$	
			I-131	$1 \times 10^{-6}$	
	M Grab Sample	M	Dissolved and Entrained Gases (Gamma emitters)		$1 \times 10^{-5}$
			D Grab Sample	M Composite <sup>c</sup>	H-3
	Gross Alpha	$1 \times 10^{-7}$			
	D Grab Sample	Q Composite <sup>c</sup>	Sr-89, Sr-90	$5 \times 10^{-8}$	
Fe-55			$1 \times 10^{-6}$		

NOTE CONTINUOUS RELEASE POINTS: Turbine Plant Sump<sup>\*</sup>, Blowdown Processing System Neutralization Sump<sup>\*\*</sup>, S/G Blowdown Bypass Line<sup>\*\*</sup>, S/G Blowdown, Auxiliary Building Sump.<sup>\*</sup>

TABLE 1-1

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM  
(Continued)

Liquid Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) ( $\mu\text{Ci/ml}$ ) <sup>a</sup>
C. Continuous Release <sup>e</sup> North Industrial Area Yard Drain Sump	3 x W Grab Sample	W Composite <sup>b,g</sup>	Principal Gamma Emitters <sup>f</sup>	$5 \times 10^{-7}$
	3 x W Grab Sample	M Composite <sup>b,g</sup>	H-3	$1 \times 10^{-5}$
			Gross Alpha	$1 \times 10^{-7}$
	3 x W Grab Sample	Q Composite <sup>b,g</sup>	Sr-89, Sr-90	$5 \times 10^{-8}$
Fe-55			$1 \times 10^{-6}$	

TABLE 1-1 (Continued)

TABLE NOTATION

- a. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$\text{LLD} = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

where:

LLD is the "a priori" lower limit of detection as defined above (as microcurie per unit mass or volume),

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

V is the sample size (in units of mass or volume),

$2.22 \times 10^6$  is the number of transformations per minute per microcurie,

Y is the fractional radiochemical yield (when applicable),

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  is the elapsed time between midpoint of sample collection and time of counting (for plant effluents, not environmental samples).

The value of  $s_b$  used in the calculation of the LLD for a particular measurement system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance.

Typical values of E, V, Y and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of the measurement system and not as a posteriori (after the fact) limit for a particular measurement.\*

\*For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HASL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" Anal. Chem. 40, 586-93 (1968).
- (3) Hartwell, J. K., "Detection Limits for Radioisotopic Counting Techniques," Atlantic Richfield Hanford Company Report ARH-2537 (June 22, 1972).

TABLE 1-1 (Continued)

TABLE NOTATION

- b. A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen which is representative of the liquids released.
- c. To be representative of the quantities and concentrations of radioactive materials in liquid effluents, samples shall be collected continuously in proportion to the rate of flow of the effluent stream. Prior to analysis, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluent release.
- d. A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed, by a method described in the ODCM, to assure representative sampling.
- e. A continuous release is the discharge of liquid wastes of a nondiscrete volume; e.g., from a volume of system that has an input flow during the continuous release.
- f. The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141, Ce-144. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, and those isotopes listed in Reg. Guide 1.21, shall also be identified and reported.
- g. Prior to analysis, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluent release.
- \* Administrative controls shall ensure that only one continuous release point is discharging through a discharge path at any given time. The normal continuous release point via 2(3)RT-7821 is the turbine plant sump.
- \*\* The first sump when transferring outlying sumps shall be treated as a batch release.
- \*\*\* Sampling of this flow is not required if at least once per 31 days blowdown bypass isolation valve (S21301MU619 for Steam Generator 2E088, S21301MU618 for Steam Generator 2E089, S31301MU619 for Steam Generator 3E088 and S31301MU618 for Steam Generator 3E089) is verified locked shut.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.2 DOSE

#### SPECIFICATION

- 1.2.1 The dose or dose commitment to an individual from radioactive materials in liquid effluents released, from each reactor unit, from the site (see Figure 1-2) shall be limited:
- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ, and
  - b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

APPLICABILITY: At all times

#### ACTION:

- a. With calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, in lieu of any other report required by Technical Specification Section 5.7.1 and LCS 5.0.104, prepare and submit to the Commission within 30 days, pursuant to Technical Specification Section 5.7.2 and LCS 5.0.104.2, a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions taken to reduce the releases and the proposed actions to be taken to assure that subsequent releases will be in compliance with Specification 1.2.1.

#### SURVEILLANCE REQUIREMENTS

- .1 Dose Calculation. Cumulative dose contributions from liquid effluents shall be determined in accordance with Section 1.5 at least once per 31 days.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.3 LIQUID WASTE TREATMENT

#### SPECIFICATION

- 1.3.1 The liquid radwaste treatment system shall be OPERABLE. The appropriate portions of the system shall be used to reduce the radioactive materials in liquid wastes prior to their discharge when the projected doses due to the liquid effluent from the site (see Figure 1-2) when averaged over 31 days, would exceed 0.06 mrem to the total body or 0.2 mrem to any organ.\*

APPLICABILITY: At all times

#### ACTION:

- a. With radioactive liquid waste being discharged without treatment and in excess of the above limits, in lieu of any other report required by Technical Specification Section 5.7.1 and LCS 5.0.104, prepare and submit to the Commission within 30 days pursuant to Technical Specification Section 5.7.2 and LCS 5.0.104.2, a Special Report which includes the following information:
1. Explanation of why liquid radwaste was being discharged without treatment, identification of the inoperable equipment or subsystems and the reason for inoperability,
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.


#### SURVEILLANCE REQUIREMENTS

- .1 Doses due to liquid releases shall be projected at least once per 31 days, in accordance with Section 3.1.
- .2 During plant operation (either unit in Mode 1-4), the appropriate portions of the liquid radwaste treatment system shall be demonstrated OPERABLE by operating the liquid radwaste treatment system equipment for at least 15-minutes at least once per 92 days unless the liquid radwaste system has been utilized to process radioactive liquid effluents during the previous 92 days.
- .3 In plant shut-down (both units in Mode 5,6), the appropriate portions of the liquid radwaste treatment system shall be demonstrated OPERABLE by operating the liquid radwaste treatment system equipment for at least 15-minutes prior to processing liquids unless the appropriate liquid radwaste system has been utilized to process radioactive liquid effluents during the previous 92 days.

\* Per reactor unit

SITE BOUNDARY FOR LIQUID EFFLUENTS

FIGURE 1-2

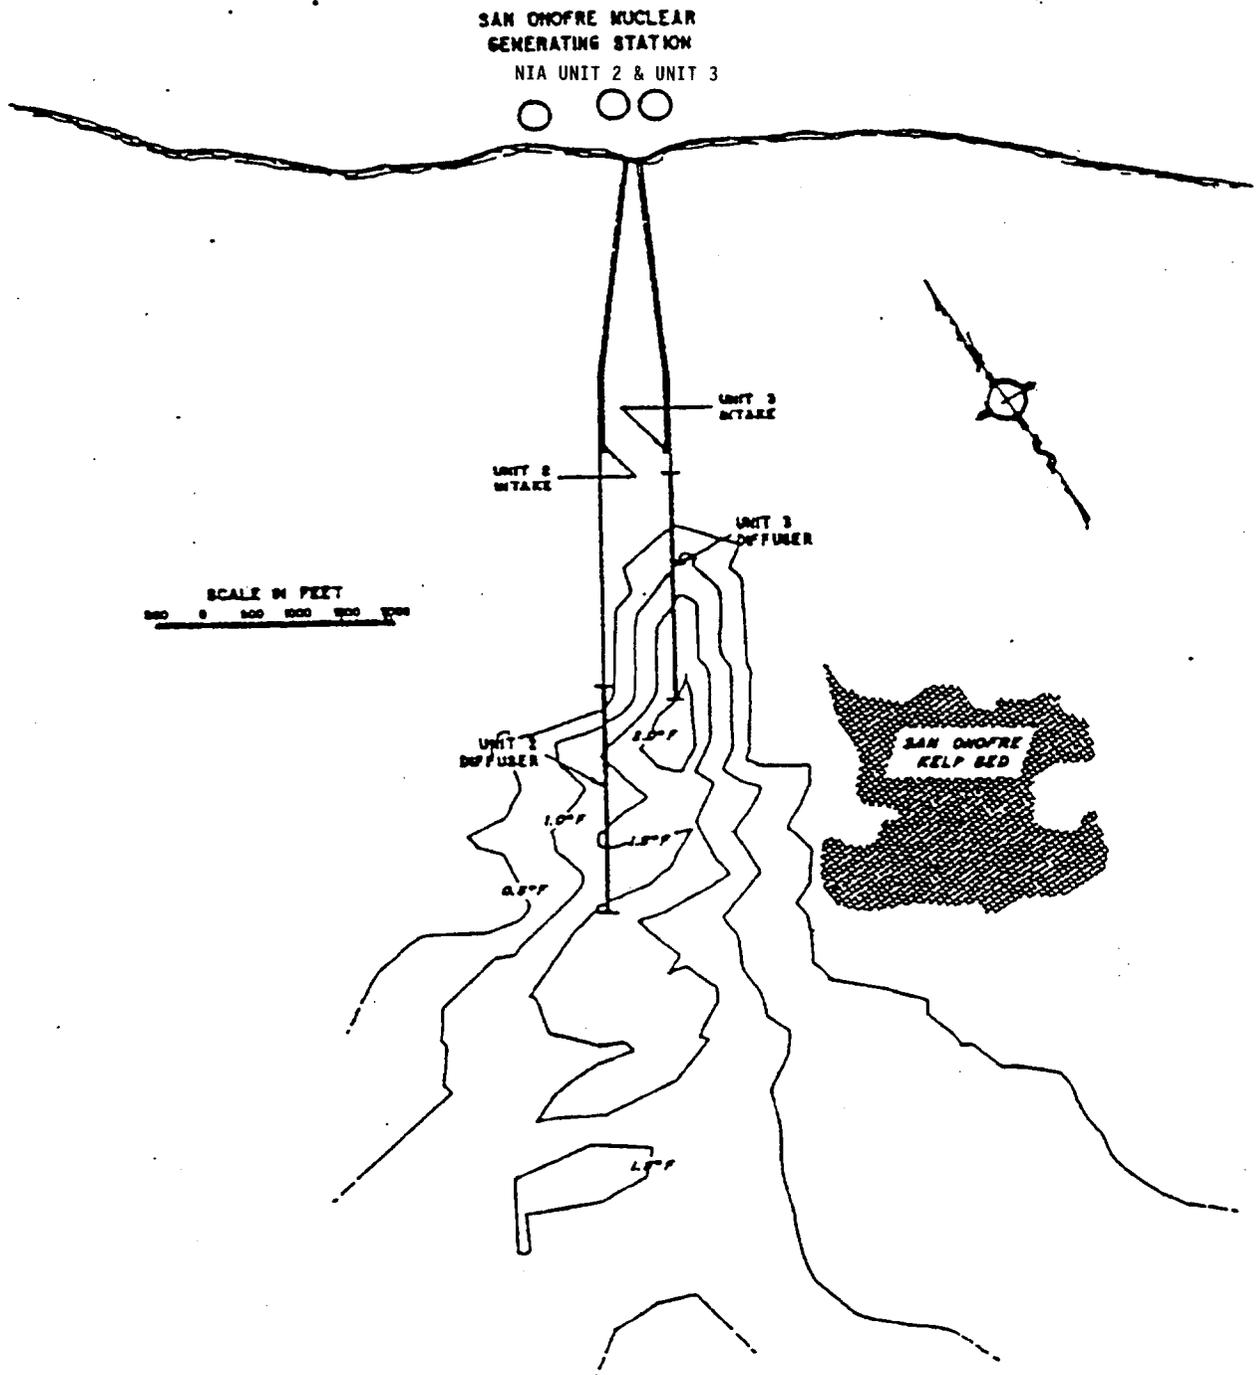

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4 LIQUID EFFLUENT MONITOR METHODS OF SETPOINT CALCULATION

Liquid Radwaste Effluent Line Monitors provide alarm and automatic termination of release prior to exceeding the concentration limits specified in 10CFR20, Appendix B, Table II, Column 2 at the release point to the unrestricted area. To meet this specification and for the purpose of implementation of Specification 1.1.1, the alarm/trip setpoints for liquid effluent monitors and flow measurement devices are set to assure that the following equation is satisfied:

$$\left( \frac{C_m R}{F+R} \right) \leq MPC_{eff} \quad (1-1)$$

where:

$C_m$  = setpoint, representative of a radionuclide concentration for the radiation monitor measuring the radioactivity in the waste effluent line prior to dilution and subsequent release,  $\mu\text{Ci}/\text{ml}$

$R$  = permissible waste effluent flow rate at the radiation monitor location, in volume per unit time in the same units as for  $F$

$F$  = dilution water flow in volume per unit time.  
= 185,000 gpm per circulating water pump (4 total)\*  
= 17,000 gpm per saltwater pump (2 total)

\* The design flowrate of each circulating water pump is 205,000 gpm. The value used in the determination of  $F$  takes into account factors such as frictional losses, pump inefficiency, and tidal flow, and provides reasonable assurance that the radioactive release concentration is not underestimated.

NOTE: Since the values of  $R$  are much smaller than  $F$ , the term  $(F + R)$  in equation (1-1) may be replaced by  $F$ .

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4 LIQUID EFFLUENT MONITOR METHODS OF SETPOINT CALCULATION (Continued)

$MPC_{eff}$  = effective effluent maximum concentration permissible limit ( $\mu\text{Ci}/\text{ml}$ ) at the release point to the unrestricted area for the radionuclide mixture being released:

$$= \left( \frac{1}{\sum_{i=1}^n \left( \frac{F_i}{MPC_i} \right)} \right) \quad (1-2)$$

where:

$n$  = number of radionuclides identified in sample analysis

$F_i$  = fractional concentration of the  $i^{\text{th}}$  radionuclide as obtained by sample analysis

$MPC_i$  = MPC of the  $i^{\text{th}}$  radionuclide (10CFR20, App B, Table II, Column 2)

Administrative values are used to reduce each setpoint to account for the potential activity released simultaneously from the following release points:

$RW_{7813}$	= Radwaste Effluent discharge
$SG_{88-2}$	= Unit 2 Steam Generator E-088
$SG_{89-2}$	= Unit 2 Steam Generator E-089
$SG_{88-3}$	= Unit 3 Steam Generator E-088
$SG_{89-3}$	= Unit 3 Steam Generator E-089
$B_2$	= Unit 2 Blowdown Processing System Neutralization Sump
$B_3$	= Unit 3 Blowdown Processing System Neutralization Sump
$T_2$	= Unit 2 Turbine Plant Sump
$T_3$	= Unit 3 Turbine Plant Sump
$Y$	= NIA Yard Drain Sump

The sum of the administrative values is limited to 1.0 to ensure that the total concentration from all release points to the plant discharge will not result in a release exceeding the limits of 10CFR20, Appendix B, Table II, Column 2. The administrative values shall be assigned such that:

$$(RW_{7813} + SG_{88-2} + SG_{89-2} + SG_{88-3} + SG_{89-3} + B_2 + B_3 + T_2 + T_3 + Y) \leq 1.0.$$

The administrative values shall be periodically reviewed based on actual release data and revised as necessary.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.1 BATCH RELEASE SETPOINT DETERMINATION

The waste flow (R) and monitor setpoint ( $C_m$ ) are set to meet the condition of equation (1-1) for the  $MPC_{eff}$  limit. The method by which this is accomplished is as follows:

STEP 1: The isotopic concentration for each batch tank (or sump) to be released is obtained from the sum of the measured concentrations in the tank (or sump) as determined by analysis.

$$C = \left( \sum_i C'_{\gamma_i} \right) + (C_\alpha) + (C_s) + (C_t) + (C_{Fe}) + (C_{Xe}) \quad (1-3)$$

where:

$C$  = total concentration in each batch tank,  $\mu\text{Ci/ml}$

$\sum_i C'_{\gamma_i}$  = sum of the measured concentrations for each radionuclide,  $i$ , in the gamma spectrum, excluding Xe-133,  $\mu\text{Ci/ml}$

$C_\alpha$  = gross alpha concentration determined in the previous monthly composite sample,  $\mu\text{Ci/ml}$

$C_s$  = Sr-89 and Sr-90 concentrations as determined in the previous quarterly composite sample,  $\mu\text{Ci/ml}$

$C_t$  = H-3 concentration as determined in the previous monthly composite sample, or as measured in the sample taken prior to release,  $\mu\text{Ci/ml}$

$C_{Fe}$  = Fe-55 concentration as determined in the previous quarterly composite sample,  $\mu\text{Ci/ml}$

$C_{Xe}$  = Xe-133 concentration as determined by isotopic analysis,  $\mu\text{Ci/ml}$

1.0 LIQUID EFFLUENTS (Continued)

1.4.1 BATCH RELEASE SETPOINT DETERMINATION (Continued)

STEP 2: The effective MPC ( $MPC_{eff}$ ) for each batch tank (or sump) is determined using:

$$MPC_{eff} = \frac{1}{\sum_i \left( \frac{C_{yi}/C}{MPC_{yi}} \right) + \left( \frac{C_s/C}{MPC_s} \right) + \left( \frac{C_t/C}{MPC_t} \right) + \left( \frac{C_\alpha/C}{MPC_\alpha} \right) + \left( \frac{C_{Fe}/C}{MPC_{Fe}} \right)} \quad (1-4)$$

where:

$MPC_{yi}$ ,  
 $MPC_s$ ,  
 $MPC_t$ ,  
 $MPC_{Fe}$ ,  
 $MPC_\alpha$   
 = the limiting concentrations of the appropriate radionuclide from 10CFR20, Appendix B, Table II, Column 2

NOTE: For dissolved or entrained noble gases, the concentration shall be limited to 2.0E-4  $\mu\text{Ci/ml}$  total activity.

STEP 3: The setpoint,  $C_m$  ( $\mu\text{Ci/ml}$ ) for each batch release radioactivity monitor may now be specified based on the respective values of  $C$ ,  $\sum_i C'_{yi}$ ,  $F$ ,  $MPC_{eff}$ , and  $R$  to provide compliance with the limits of 10CFR20, Appendix B, Table II, Column 2.

STEP 4: If the monitor reads in CPM, the setpoint may be derived using the applicable calibration constants given in Table 1-3 to correspond to the calculated monitor limit  $C_m$ ,  $\mu\text{Ci/ml}$ .

$$CPM_{max} = \frac{(C_m, \mu\text{Ci/ml})}{(\text{Cal. Const.}, \mu\text{Ci/cc/cpm})} \quad (1-5)$$

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.1 BATCH RELEASE SETPOINT DETERMINATION (Continued)

#### 1.4.1.1 RADWASTE DISCHARGE LINE MONITOR (2/3RT-7813)

The value for  $C_m$ , the concentration limit at the detector, is determined by using:

$$C_m \leq \frac{(RW_{7813})(F)(\sum_i C'_{\gamma i})}{(R)\left(\frac{C}{MPC_{eff}}\right)} \quad (1-6)$$

where:

$RW_{7813}$  = Radwaste Effluent discharge administrative value

$F$  = dilution water flow in volume per unit time  
= 185,000 gpm per circulating water pump (4 total)  
= 17,000 gpm per saltwater pump (2 total)

$C$  = Total concentration in each batch sample

$\sum_i C'_{\gamma i}$  = total gamma isotopic concentration, excluding Xe-133,  
 $\mu\text{Ci/ml}$

$R$  = typical effluent release rate.

Values of  $R$  for each tank are as follows:

Radwaste Primary Tanks = 140 gpm (per pump)

Radwaste Secondary Tanks = 140 gpm (per pump)

Primary Plant Makeup Tank = 160 gpm (per pump)

Condensate Monitor Tanks = 100 gpm (per pump)

$MPC_{eff}$  = from equation (1-4)

NOTE: If  $C_m \leq \sum_i C'_{\gamma i}$ , then no release is possible. To increase  $C_m$ , increase the administrative value  $RW_{7813}$ , and/or increase dilution flow  $F$  (by running more dilution pumps in the applicable discharge structure), and/or decrease the effluent flow rate  $R$  and recalculate  $C_m$  using the new  $RW_{7813}$ ,  $F$ ,  $R$  as applicable and equation (1-6).

1.0 LIQUID EFFLUENTS (Continued)

1.4.1.2 BLOWDOWN PROCESSING SYSTEM NEUTRALIZATION SUMP/FULL FLOW CONDENSATE POLISHER DEMINERALIZER (FFCPD) SUMP DISCHARGE LINE MONITOR (BATCH) (2RT-7817, 3RT-7817)

The value for  $C_2$  (Unit 2) or  $C_3$  (Unit 3), the concentration limit at the Unit 2 or Unit 3 detector, is determined by using:

$$C_2 \leq \frac{(B_2) (F) (\sum_i C'_{\gamma i})}{(R) (C/MPC_{eff})} \quad (1-7)$$

$$C_3 \leq \frac{(B_3) (F) (\sum_i C'_{\gamma i})}{(R) (C/MPC_{eff})} \quad (1-8)$$

where:

$C_2$  = instantaneous concentration at detector 2RT-7817 in  $\mu\text{Ci/cc}$

$C_3$  = instantaneous concentration at detector 3RT-7817 in  $\mu\text{Ci/cc}$

$B_2$  = Unit 2 BPS Neutralization Sump administrative value

$B_3$  = Unit 3 BPS Neutralization Sump administrative value

$F$  = dilution water flow in volume per unit time  
 = 185,000 gpm per circulating water pump (4 total)  
 = 17,000 gpm per saltwater pump (2 total)

$\sum_i C'_{\gamma i}$  = total gamma isotopic concentration, excluding Xe-133,  $\mu\text{Ci/ml}$ , (STEP 1)

$R$  = Typical release flow rates:  
     BPS Neutralization Sump = 500 gpm  
     FFCPD High Conductivity Sump = 500 gpm  
     FFCPD Low Conductivity Sump = 600 gpm  
     FFCPD Holdup Tank = 1000 gpm

$C$  = total concentration in each batch sample,  $\mu\text{Ci/ml}$

$MPC_{eff}$  = value of  $MPC_{eff}$  from equation (1-4) for the sample analysis

NOTE: If  $C_2$  or  $C_3 \leq \sum_i C'_{\gamma i}$ , then no release is possible. To increase  $C_2$  or  $C_3$ , increase the administrative value  $B_2$  or  $B_3$ , and/or increase dilution flow  $F$  (by running more dilution pumps), and/or decrease the effluent flow rate,  $R$ , and recalculate  $C_2$  or  $C_3$  using the new  $B_2$  or  $B_3$ ,  $F$ ,  $R$  as applicable and equation (1-7) or (1-8).

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2 CONTINUOUS RELEASE SETPOINT DETERMINATION

The waste flow (R) and monitor setpoint ( $C_m$ ) are set to meet the condition of equation (1-1) for the effective MPC ( $MPC_{eff}$ ) limit. The method by which this is accomplished is as follows:

STEP 1: The isotopic concentration for the continuous releases are obtained for each release stream (steam generator blowdown, steam generator blowdown bypass, blowdown processing system neutralization sump, turbine plant sump, and yard drain sump) from the sum of the respective measured concentrations as determined by analysis:

$$C = \left( \sum_i C'_{\gamma_i} \right) + (C_{\alpha}) + (C_s) + (C_t) + (C_{Fe}) + (C_{Xe}) \quad (1-3)$$

where:

$C$  = total concentration ( $\mu\text{Ci/ml}$ )

$\sum_i C'_{\gamma_i}$  = total gamma activity associated with each radionuclide,  $i$ , in the weekly composite analysis for the release stream, excluding Xe-133,  $\mu\text{Ci/ml}$

$C_{\alpha}$  = total measured gross alpha concentration determined from the previous monthly composite analysis for the release stream,  $\mu\text{Ci/ml}$

$C_s$  = total measured concentration of Sr-89 and Sr-90 as determined from the previous quarterly composite analysis for the release stream,  $\mu\text{Ci/ml}$

$C_t$  = total measured H-3 concentration determined from the previous weekly or monthly composite analysis for the release stream,  $\mu\text{Ci/ml}$

$C_{Fe}$  = total Fe-55 concentration as determined in the previous quarterly composite sample for the release stream,  $\mu\text{Ci/ml}$

$C_{Xe}$  = Xe-133 concentration as determined by isotopic analysis,  $\mu\text{Ci/ml}$

1.0 LIQUID EFFLUENTS (Continued)

1.4.2 CONTINUOUS RELEASE SETPOINT DETERMINATION (Continued)

STEP 2: The effective MPC ( $MPC_{eff}$ ) for each release stream (steam generator blowdown, blowdown processing system neutralization sump, turbine plant sump, or NIA yard drain sump) is determined using:

$$MPC_{eff} = \frac{1}{\sum_i \left( \frac{C_{Yi}/C}{MPC_{Yi}} \right) + \left( \frac{C_s/C}{MPC_s} \right) + \left( \frac{C_t/C}{MPC_t} \right) + \left( \frac{C_\alpha/C}{MPC_\alpha} \right) + \left( \frac{C_{Fe}/C}{MPC_{Fe}} \right)} \quad (1-4)$$

where:

$MPC_{Yi}$ ,  
 $MPC_s$ ,  
 $MPC_t$ ,  
 $MPC_{Fe}$ ,  
 $MPC_\alpha$

= the limiting concentrations of the appropriate radionuclide from 10CFR20, Appendix B, Table II, Column 2

STEP 3: The setpoint,  $C_m$  ( $\mu\text{Ci/ml}$ ) for each continuous release radioactivity monitor may now be specified based on the respective values of  $C$ ,  $\sum_i C'_{Yi}$ ,  $F$ ,  $MPC_{eff}$ , and  $R$  to provide compliance with the limits of 10CFR20, Appendix B, Table II, Column 2.

STEP 4: If the monitor reads in CPM, the setpoint may be derived using the applicable calibration constants given in Table 1-3 to correspond to the calculated monitor limit  $C_m$ ,  $\mu\text{Ci/ml}$ .

$$CPM_{max} = \frac{(C_m, \mu\text{Ci/ml})}{(\text{Cal. Const.}, \mu\text{Ci/cc/cpm})} \quad (1-5)$$

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.1 BLOWDOWN PROCESSING SYSTEM NEUTRALIZATION SUMP DISCHARGE LINE MONITORS (2RT-7817, 3RT-7817)

The value for  $C_2$  (Unit 2) or  $C_3$  (Unit 3), the concentration limit at the Unit 2 or Unit 3 detector, is determined by using:

$$C_2 \leq \frac{(B_2) (F) (\sum_i C'_{\gamma i})}{(R) (C/MPC_{eff})} \quad (1-7)$$

$$C_3 \leq \frac{(B_3) (F) (\sum_i C'_{\gamma i})}{(R) (C/MPC_{eff})} \quad (1-8)$$

where:

$C_2$  = instantaneous concentration at detector 2RT-7817 in  $\mu\text{Ci/cc}$

$C_3$  = instantaneous concentration at detector 3RT-7817 in  $\mu\text{Ci/cc}$

$B_2$  = Unit 2 Blowdown Processing System Neutralization Sump administrative value

$B_3$  = Unit 3 Blowdown Processing System Neutralization Sump administrative value

$F$  = dilution water flow in volume per unit time  
= 185,000 gpm per circulating water pump (4 total)  
= 17,000 gpm per saltwater pump (2 total)

$\sum_i C'_{\gamma i}$  = total gamma isotopic concentration, excluding Xe-133,  $\mu\text{Ci/ml}$ , (STEP 1)

$R$  = effluent flow rate, gpm, (STEP 1), (maximum of 500 gpm)

$C$  = total concentration,  $\mu\text{Ci/ml}$

$MPC_{eff}$  = value of  $MPC_{eff}$  from equation (1-4) for the sample analysis

NOTE: If  $C_2$  or  $C_3 \leq \sum_i C'_{\gamma i}$ , then no release is possible. To increase  $C_2$  or  $C_3$ , increase the administrative value  $B_2$  or  $B_3$ , and/or increase dilution flow  $F$  (by running more dilution pumps), and/or decrease the effluent flow rate,  $R$ , and recalculate  $C_2$  or  $C_3$  using the new  $B_2$  or  $B_3$ ,  $F$ ,  $R$  as applicable and equation (1-7) or (1-8).

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.2 STEAM GENERATOR BLOWDOWN BYPASS DISCHARGE LINE MONITORS (2RT-6753, 2RT-6759, 3RT-6753, 3RT-6759)

The value for  $C_{59-2}$ ,  $C_{53-2}$ ,  $C_{59-3}$  or  $C_{53-3}$ , the concentration limit at the Unit 2 or Unit 3 detectors, is determined by using:

$$C_{59-2} \leq \frac{(SG_{88-2})(F)(\sum_i C'_{vi})}{(R)(C/MPC_{eff})} \quad (1-9)$$

$$C_{53-2} \leq \frac{(SG_{89-2})(F)(\sum_i C'_{vi})}{(R)(C/MPC_{eff})} \quad (1-10)$$

$$C_{59-3} \leq \frac{(SG_{88-3})(F)(\sum_i C'_{vi})}{(R)(C/MPC_{eff})} \quad (1-11)$$

$$C_{53-3} \leq \frac{(SG_{89-3})(F)(\sum_i C'_{vi})}{(R)(C/MPC_{eff})} \quad (1-12)$$

where:

$C_{59-2}$  = instantaneous concentration at detector 2RT-6759 in  $\mu\text{Ci/ml}$

$C_{53-2}$  = instantaneous concentration at detector 2RT-6753 in  $\mu\text{Ci/ml}$

$C_{59-3}$  = instantaneous concentration at detector 3RT-6759 in  $\mu\text{Ci/ml}$

$C_{53-3}$  = instantaneous concentration at detector 3RT-6753 in  $\mu\text{Ci/ml}$

$SG_{88-2}$  = Unit 2 E088 Steam Generator Blowdown administrative value

$SG_{89-2}$  = Unit 2 E089 Steam Generator Blowdown administrative value

$SG_{88-3}$  = Unit 3 E088 Steam Generator Blowdown administrative value

$SG_{89-3}$  = Unit 3 E089 Steam Generator Blowdown administrative value

F = dilution water flow in volume per unit time  
= 185,000 gpm per circulating water pump (4 total)  
= 17,000 gpm per saltwater pump (2 total)

1.0 LIQUID EFFLUENTS (Continued)

1.4.2.2 STEAM GENERATOR BLOWDOWN BYPASS DISCHARGE LINE MONITORS  
(2RT-6753, 2RT-6759, 3RT-6753, 3RT-6759) (Continued)

$\Sigma_i C'_{\gamma i}$  = total gamma isotopic concentration, excluding Xe-133,  
 $\mu\text{Ci/ml}$ , (STEP 1)

R = maximum blowdown bypass effluent flowrate per steam  
generator, 200 gpm, (STEP 1)

C = total concentration,  $\mu\text{Ci/ml}$

$\text{MPC}_{\text{eff}}$  = value of  $\text{MPC}_{\text{eff}}$  from equation (1-4) for the sample  
analysis

NOTE: If  $C_{59-2}$ ,  $C_{53-2}$ ,  $C_{59-3}$ , or  $C_{53-3} \leq \Sigma_i C'_{\gamma i}$  (for the respective steam generator), then no release is possible. To increase  $C_{59-2}$ ,  $C_{53-2}$ ,  $C_{59-3}$  or  $C_{53-3}$ , increase the administrative value  $\text{SG}_{88-2}$ ,  $\text{SG}_{89-2}$ ,  $\text{SG}_{88-3}$  or  $\text{SG}_{89-3}$ , and/or increase dilution flow F (by running more dilution pumps), and/or decrease the effluent flow rate R and recalculate  $C_{59-2}$ ,  $C_{53-2}$ ,  $C_{59-3}$  or  $C_{53-3}$  using the new values of  $\text{SG}_{89-2}$ ,  $\text{SG}_{88-2}$ ,  $\text{SG}_{89-3}$  or  $\text{SG}_{88-3}$ , F, R as applicable and equation (1-9), (1-10), (1-11) or (1-12).

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.3 TURBINE PLANT SUMP MONITORS (2RT-7821, 3RT-7821)

The value for  $C_2$  (Unit 2) or  $C_3$  (Unit 3), the concentration limit at the Unit 2 or Unit 3 detector, is determined by using:

$$C_2 \leq \frac{(T_2) (F) (\sum_i C'_{vi})}{(R) (C/MPC_{eff})} \quad (1-13)$$

$$C_3 \leq \frac{(T_3) (F) (\sum_i C'_{vi})}{(R) (C/MPC_{eff})} \quad (1-14)$$

where:

$C_2$  = instantaneous concentration at detector 2RT-7821 in  $\mu\text{Ci/cc}$

$C_3$  = instantaneous concentration at detector 3RT-7821 in  $\mu\text{Ci/cc}$

$T_2$  = Unit 2 Turbine Plant Sump administrative value

$T_3$  = Unit 3 Turbine Plant Sump administrative value

$F$  = dilution water flow in volume per unit time  
= 185,000 gpm per circulating water pump (4 total)  
= 17,000 gpm per saltwater pump (2 total)

$\sum_i C'_{vi}$  = total gamma isotopic concentration, excluding Xe-133,  $\mu\text{Ci/ml}$ , (STEP 1)

$R$  = effluent flow rate, gpm, (STEP 1), typically flow rate:  
= 100 gpm (per pump)

$C$  = total concentration,  $\mu\text{Ci/ml}$

$MPC_{eff}$  = value of  $MPC_{eff}$  from equation (1-4) for the sample analysis

NOTE: If  $C_2$  or  $C_3 \leq \sum_i C'_{vi}$ , then no release is possible. To increase  $C_2$  or  $C_3$ , increase the administrative value  $T_2$  or  $T_3$ , and/or increase dilution flow  $F$  (by running more dilution pumps), and/or decrease the effluent flow rate,  $R$ , and recalculate  $C_2$  or  $C_3$  using the new  $T_2$  or  $T_3$ ,  $F$ ,  $R$  as applicable and equation (1-13) or (1-14).

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.3 TURBINE PLANT SUMP MONITORS (2RT-7821, 3RT-7821) (Continued)

Use of a temporary discharge path from the Turbine Plant Sump is allowed providing the radiation monitor, 2(3)RT-7821, is in service and the normal discharge path is used concurrently. Temporary pumps facilitate faster discharge when draining the condenser to the outfall via this pathway. The following conditions shall be met:

- a. The release permit shall account for the entire volume of water discharged from the Turbine Plant Sump.
- b. The alarm setpoint for the monitor shall be adjusted to take into account the entire discharge flow through both the normal and temporary paths.
- c. Procedures shall require the immediate termination of the discharge via the temporary path if the monitor on the normal path alarms.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.4 NIA YARD DRAIN SUMP MONITOR (RT-2101)

There is one Yard Drain Sump on site, located in the North Industrial Area. It can be released through either the Unit 2 or Unit 3 outfall. The same radiation monitor is used for either outfall.

The value for  $C_{YDS}$ , the concentration limit at the detector, is determined by using:

$$C_{YDS} \leq \frac{(Y) (F) (\sum_i C'_{\gamma i})}{(R) (C/MPC_{eff})} \quad (1-15)$$

where:

$C_{YDS}$  = instantaneous concentration at detector RT-2101 in  $\mu\text{Ci/ml}$

Y = NIA Yard Drain Sump administrative value

F = dilution water flow in volume per unit time  
= 185,000 gpm per circulating water pump (4 total)  
= 17,000 gpm per saltwater pump (2 total)

$\sum_i C'_{\gamma i}$  = total gamma isotopic concentration,  $\mu\text{Ci/ml}$ , (STEP 1)

R = effluent flow rate, gpm, typical flow rates:  
= 2300 gpm or 4100 gpm

C = total concentration,  $\mu\text{Ci/ml}$

$MPC_{eff}$  = value of  $MPC_{eff}$  from equation (1-4) for the sample analysis

NOTE: If  $C_{YDS} \leq \sum_i C'_{\gamma i}$ , then no release is possible. To increase  $C_{YDS}$ , increase the administrative value Y, and/or increase dilution flow F (by running more dilution pumps), and/or decrease the effluent flow rate, R, and recalculate  $C_{YDS}$  using the new Y, F, R as applicable and equation (1-15).

**TABLE 1-3****Liquid Effluent Radiation Monitor Calibration Constants <sup>(a)</sup>**  
( $\mu\text{Ci/cc/cpm}$ )

MONITOR	Co-60	Ba-133	Cs-137
2RT-6753		2.07E-8	1.90E-8
2RT-6759		1.90E-8	1.90E-8
3RT-6753		1.92E-8	1.92E-8
3RT-6759		1.98E-8	1.97E-8

<sup>(a)</sup> This table provides typical ( $\pm 20\%$ ) calibration constants for the liquid effluent radiation monitors.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.5 DOSE CALCULATION FOR LIQUID EFFLUENTS

The liquid releases considered in the following dose calculations are described in Section 1.4. The dose commitment to an individual from radioactive materials in liquid effluents released to unrestricted areas are calculated for the purpose of implementing Specification 1.2.1 using the following expression.

$$D_{\tau} = \sum_i [A_{i\tau} \sum_j (\Delta t_j C_{ij} F_j)] \quad (1-16)$$

where:

$A_{i\tau}$  = Site-related adult ingestion dose commitment factor to the total body or an organ,  $\tau$ , for each identified principal gamma and beta emitter,  $i$ , from Table 1-4 in mrem/hr per  $\mu\text{Ci/ml}$ .

$C_{ij}$  = average concentration of radionuclide,  $i$ , in the undiluted liquid effluent during time period,  $\Delta t_j$ , in  $\mu\text{Ci/ml}$ .

$D_i$  = dose commitment to the total body or an organ,  $\tau$ , from the liquid effluent for the time period,  $\Delta t_j$ , in mrem.

$F_j$  = near field average dilution factor (actually mixing ratio) for  $C_{ij}$  during the time period,  $\Delta t_j$ . This factor is the ratio of the maximum undiluted liquid waste flow during time period,  $\Delta t_j$ , to the average flow from the site discharge structure to unrestricted receiving waters,

$$\text{or: } \left( \frac{\text{maximum liquid radioactive waste flow}}{\text{discharge structure exit flow}} \right)$$

$\Delta t_j$  = length of the  $j^{\text{th}}$  time period over which  $C_{ij}$  and  $F_j$  are averaged for all liquid releases, in hours.

**TABLE 1-4**

**DOSE COMMITMENT FACTORS\*,  $A_{i1}$**   
(mrem/hr per  $\mu\text{Ci/ml}$ )

Radio-nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
H-3		2.82E-1	2.82E-1	2.82E-1	2.82E-1	2.82E-1	2.82E-1
Na-24	4.57E-1	4.57E-1	4.57E-1	4.57E-1	4.57E-1	4.57E-1	4.57E-1
Cr-51			5.58E+0	3.34E+0	1.23E+0	7.40E+0	1.40E+3
Mn-54		7.06E+3	1.35E+3		2.10E+3		2.16E+4
Mn-56		1.78E+2	3.15E+1		2.26E+2		5.67E+3
Fe-55	5.11E+4	3.53E+4	8.23E+3			1.97E+4	2.03E+4
Fe-59	8.06E+4	1.90E+5	7.27E+4			5.30E+4	6.32E+5
Co-57		1.42E+2	2.36E+2				3.59E+3
Co-58		6.03E+2	1.35E+3				1.22E+4
Co-60		1.73E+3	3.82E+3				3.25E+4
Cu-64		2.14E+2	1.01E+2		5.40E+2		1.83E+4
Zn-65	1.61E+5	5.13E+5	2.32E+5		3.43E+5		3.23E+5
Br-84			9.39E-2				7.37E-7
Rb-88		1.79E+0	9.49E-1				2.47E-11
Sr-89	4.99E+3		1.43E+2				8.00E+2
Sr-90	1.23E+5		3.01E+4				3.55E+3
Sr-91	9.18E+1		3.71E+0				4.37E+2
Sr-92	3.48E+1		1.51E+0				6.90E+2
Y-90	6.06E+0		1.63E-1				6.42E+4
Y-91m	5.73E-2		2.22E-3				1.68E-1
Y-92	5.32E-1		1.56E-2				9.32E+3
Zr-95	1.59E+1	5.11E+0	3.46E+0		8.02E+0		1.62E+4
Zr-97	8.81E-1	1.78E-1	8.13E-2		2.68E-1		5.51E+4
Nb-95	1.84E+0	1.03E+0	5.51E-1		1.01E+0		6.22E+3
Nb-95m	1.84E+0	1.03E+0	5.51E-1		1.01E+0		6.22E+3
Nb-97	1.55E-2	3.91E-3	1.43E-3		4.56E-3		1.44E+1
Mo-99		1.28E+2	2.43E+1		2.89E+2		2.96E+2
Tc-99m	1.30E-2	3.66E-2	4.66E-1		5.56E-1	1.79E-2	2.17E+1

NOTE: where no value is given, no data are available.

\* Source: Reg. Guide 1.109, Table E-11, Table A-1  
USNRC NUREG-0172, Table 4  
ICRP-30, Part 3, Supplement A

Methodology: USNRC NUREG-0133, Section 4.3.1

**TABLE 1-4**  
(Continued)

**DOSE COMMITMENT FACTORS\*, A<sub>ii</sub>**  
(mrem/hr per  $\mu$ Ci/ml)

Radio-nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
Ru-103	1.07E+2		4.60E+1		4.07E+2		1.25E+4
Ru-106	1.59E+3		2.01E+2		3.06E+3		1.03E+5
Ag-110m	1.42E+3	1.32E+3	7.82E+2		2.59E+3		5.37E+5
Sn-113							2.26E+5
Sn-117m							2.26E+5
Sb-124	2.76E+2	5.22E+0	1.09E+2	6.70E-1		2.15E+2	7.84E+3
Sb-125	1.77E+2	1.97E+0	4.20E+1	1.79E-1		1.36E+2	1.94E+3
Te-129m	9.31E+2	3.47E+2	1.47E+2	3.20E+2	3.89E+3		4.69E+3
Te-132	2.04E+2	1.32E+2	1.24E+2	1.46E+2	1.27E+3		6.24E+3
I-131	2.18E+2	3.12E+2	1.79E+2	1.02E+5	5.35E+2		8.23E+1
I-132	1.06E+1	2.85E+1	9.96E+0	9.96E+2	4.54E+1		5.35E+0
I-133	7.45E+1	1.30E+2	3.95E+1	1.90E+4	2.26E+2		1.16E+2
I-134	5.56E+0	1.51E+1	5.40E+0	2.62E+2	2.40E+1		1.32E-2
I-135	2.32E+1	6.08E+1	2.24E+1	4.01E+3	9.75E+1		6.87E+1
Cs-134	6.84E+3	1.63E+4	1.33E+4		5.27E+3	1.75E+3	2.85E+2
Cs-136	7.16E+2	2.83E+3	2.04E+3		1.57E+3	2.16E+2	3.21E+2
Cs-137	8.77E+3	1.20E+4	7.85E+3		4.07E+3	1.35E+3	2.32E+2
Cs-138	6.07E+0	1.20E+1	5.94E+0		8.81E+0	8.70E-1	5.12E-5
Ba-139	7.85E+0	5.59E-3	2.30E-1		5.23E-3	3.17E-3	1.39E+1
Ba-140	1.64E+3	2.06E+0	1.08E+2		7.02E-1	1.18E+0	3.38E+3
La-140	1.57E+0	7.94E-1	2.10E-1				5.83E+4
Ce-141	3.43E+0	2.32E+0	2.63E-1		1.08E+0		8.86E+3
Ce-143	6.04E-1	4.46E+2	4.94E-2		1.97E-1		1.67E+4
Ce-144	1.79E+2	7.47E+1	9.59E+0		4.43E+1		6.04E+4
Nd-147	3.96E+0	4.58E+0	2.74E-1		2.68E+0		2.20E+4
W-187	9.16E+0	7.66E+0	2.68E+0				2.51E+3
Np-239	3.53E-2	3.47E-3	1.91E-3		1.08E-2		7.11E+2

NOTE: where no value is given, no data are available.

\* Source: Reg. Guide 1.109, Table E-11, Table A-1  
USNRC NUREG-0172, Table 4  
ICRP-30, Part 3, Supplement A

Methodology: USNRC NUREG-0133, Section 4.3.1

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.6 Representative Sampling

Prior to sampling of a batch release, each batch shall be thoroughly mixed to assure representative sampling in accordance with the requirements of Regulatory Guide 1.21 and NUREG-0800, Section 11.5. The methodology for mixing and sampling is described in S0123-III-5.23, "Generating Effluent Release Permits Using The Vax Computer" and S0123-III-5.2.23, "Units 2/3 Liquid Effluents".

## 2.0 GASEOUS EFFLUENTS

### 2.1 DOSE RATE

#### SPECIFICATION

- 2.1.1 The dose rate in unrestricted areas due to radioactive materials released in gaseous effluents from the site (see Figure 2-2) shall be limited to the following:
- a. For noble gases: Less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin, and
  - b. For all radioiodines, tritium and for all radioactive materials in particulate form with half lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.

APPLICABILITY: At all times

#### ACTION:

- a. With dose rate(s) exceeding the above limits, immediately decrease the release rate to within the above limit(s).

#### SURVEILLANCE REQUIREMENTS

- .1 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with Section 2.7.
- .2 The dose rate due to radioiodines, tritium and radioactive materials in particulate form with half lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with Section 2.7 by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 2-1.

TABLE 2-1

RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

Gaseous Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection ( $\mu\text{Ci/ml}$ ) <sup>a</sup>
Batch Waste Gas Decay Tank	P Each Tank Grab Sample	P Each Tank	Principal Gamma Emitters <sup>9</sup>	$1 \times 10^{-4}$
Continuous	*	*	Principal Gamma Emitters <sup>9</sup>	$1 \times 10^{-4}$
	*	*	Tritium	$1 \times 10^{-6}$
	Continuous <sup>f</sup> Sampler	Charcoal Sample	W <sup>d</sup> I-131	$1 \times 10^{-12}$
			I-133	$1 \times 10^{-10}$
	Continuous <sup>f</sup> Sampler	W <sup>d</sup> Particulate Sample	Principal Gamma Emitters <sup>9</sup> (I-131 and Others)	$1 \times 10^{-11}$
	Continuous <sup>f</sup> Sampler	M Composite Particulate Sample	Gross Alpha	$1 \times 10^{-11}$
	Continuous <sup>f</sup> Sampler	Q Composite Particulate Sample	Sr-89 and Sr-90	$1 \times 10^{-11}$
Continuous <sup>f</sup> Monitor	Noble Gas Monitor	Noble Gases Gross Beta or Gamma	$1 \times 10^{-6}$	

\*Sampling frequencies for noble gases and tritium are:

CONTINUOUS PATHWAYS:

Containment Purge - 42"	:	Each Purge <sup>b,c</sup>
Containment Purge - 8"	:	Monthly Grab <sup>b</sup>
Condenser Air Ejector	:	Monthly Grab <sup>b</sup>
Plant Vent Stack	:	Weekly Grab <sup>b,e</sup>
South Yard Facility	:	Particulate and Iodine sampling only <sup>h</sup>

TABLE 2-1 (Continued)

TABLE NOTATION

- a. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

where:

LLD is the "a priori" lower limit of detection as defined above (as microcurie per unit mass or volume),

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

V is the sample size (in units of mass or volume),

$2.22 \times 10^6$  is the number of transformations per minute per microcurie,

Y is the fractional radiochemical yield (when applicable),

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  is the elapsed time between midpoint of sample collection and time of counting (for plant effluents, not environmental samples).

The value of  $s_b$  used in the calculation of the LLD for a particular measurement system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance.

Typical values of E, V, Y and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of the measurement system and not as a a posteriori (after the fact) limit for a particular measurement.\*

\*For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HASL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" Anal. Chem. 40, 586-93 (1968).
- (3) Hartwell, J. K., "Detection Limits for Radioisotopic Counting Techniques," Atlantic Richfield Hanford Company Report ARH-2537 (June 22, 1972).

TABLE 2-1 (Continued)

TABLE NOTATION

- b. Analyses shall also be performed on the affected unit and plant vent stack following shutdown, startup, or a THERMAL POWER change exceeding 15 percent of the RATED THERMAL POWER within a 1-hour period. This requirement does not apply if: (1) analysis shows that the DOSE EQUIVALENT I-131 concentration in the reactor coolant has not increased more than a factor of 3; and (2) the noble gas monitor shows that effluent activity has not increased more than a factor of 3.
- c. Tritium grab samples shall be taken at least once per 24 hours when the refueling canal is flooded.
- d. (i) Samples shall be changed at least once per 7 days and analyses shall be completed within 48 hours after changing (or after removal from sampler).  
  
(ii) Sampling shall also be performed on the affected unit and plant vent stack at least once per 24 hours for at least 7 days following each shutdown, startup, or a THERMAL POWER change exceeding 15 percent of RATED THERMAL POWER in 1 hour and analyses shall be completed within 48 hours of changing. This requirement does not apply if: (1) analysis shows that the DOSE EQUIVALENT I-131 concentration in the reactor coolant has not increased more than a factor of 3; and (2) the noble gas monitor shows that effluent activity has not increased more than a factor of 3. When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10. This requirement is not applicable to the South Yard Facility.
- e. Tritium grab samples shall be taken at least one per 7 days from the ventilation exhaust from the spent fuel pool area, whenever spent fuel is in the spent fuel pool.
- f. The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with Specifications 2.1, 2.2, 2.3.
- g. The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for gaseous emissions and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141 and Ce-144 for particulate emissions. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported.
- h. Radioactive airborne effluents only expected to be particulate and iodine.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.2 DOSE - NOBLE GASES

#### SPECIFICATION

- 2.2.1 The air dose due to noble gases released in gaseous effluents, from each reactor unit, from the site (see Figure 2-2) shall be limited to the following:
- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation and,
  - b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABILITY: At all times

#### ACTION:

- a. With calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, in lieu of any other report required by Technical Specification Section 5.7.1 and LCS 5.0.104, prepare and submit to the Commission within 30 days, pursuant to Technical Specification Section 5.7.2 and LCS 5.0.104.2, a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions taken to reduce releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with Specification 2.2.1.

#### SURVEILLANCE REQUIREMENTS

- .1 Dose Calculations Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section 2.8 at least once per 31 days.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.3 DOSE - RADIOIODINES, RADIOACTIVE MATERIALS IN PARTICULATE FORM AND TRITIUM

#### SPECIFICATION

- 2.3.1 The dose to an individual from tritium, radioiodines and radioactive materials in particulate form with half-lives greater than 8 days in gaseous effluents released, from each reactor unit, from the Site (see Figure 2-2) shall be limited to the following:
- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ and,
  - b. During any calendar year: Less than or equal to 15 mrem to any organ.

APPLICABILITY: At all times

#### ACTION:

- a. With the calculated dose from the release of tritium, radioiodines, and radioactive materials in particulate form, with half lives greater than 8 days, in gaseous effluents exceeding any of the above limits, in lieu of any other report required by Technical Specification Section 5.7.1 and LCS 5.0.104, prepare and submit to the Commission within 30 days pursuant to Technical Specification Section 5.7.2 and LCS 5.0.104.2, a Special Report which identifies the cause(s) for exceeding the limit and defines the corrective actions taken to reduce releases and the proposed actions to be taken to assure that subsequent releases will be in compliance with Specification 2.3.1.

#### SURVEILLANCE REQUIREMENTS

- .1 Dose Calculations Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section 2.8 at least once per 31 days.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.4 GASEOUS RADWASTE TREATMENT

#### SPECIFICATION

- 2.4.1 The GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM shall be operable. The appropriate portions of the GASEOUS RADWASTE TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected gaseous effluent air doses due to gaseous effluent releases from the site (see Figure 2-2), when averaged over 31 days, would exceed 0.2 mrad for gamma radiation and 0.4 mrad for beta radiation. The appropriate portions of the VENTILATION EXHAUST TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected doses due to gaseous effluent releases from the site (see Figure 2-2) when averaged over 31 days would exceed 0.3 mrem to any organ.\*

APPLICABILITY: At all times

#### ACTION:

- a. With gaseous waste being discharged without treatment and in excess of the above limits, in lieu of any other report required by Technical Specification Section 5.7.1 and LCS 5.0.104, prepare and submit to the Commission within 30 days, pursuant to Technical Specification Section 5.7.2 and LCS 5.0.104.2, a Special Report which includes the following information:
1. Explanation of why gaseous radwaste was being discharged without treatment, identification of the inoperable equipment or subsystems and the reason for inoperability,
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.

#### SURVEILLANCE REQUIREMENTS

- .1 Doses due to gaseous releases from the site shall be projected at least once per 31 days, in accordance with Section 3.2.


\*These doses are per reactor unit.

2.0 GASEOUS EFFLUENTS (Continued)

2.4 GASEOUS RADWASTE TREATMENT (Continued)

SURVEILLANCE REQUIREMENTS (Continued)

- 2.4.1.2 During plant operation (Modes 1-4), the applicable portions of the GASEOUS RADWASTE TREATMENT SYSTEM and VENTILATION EXHAUST TREATMENT SYSTEM shall be demonstrated OPERABLE by operating the GASEOUS RADWASTE TREATMENT SYSTEM equipment and VENTILATION EXHAUST TREATMENT SYSTEM equipment for at least 15 minutes, at least once per 92 days unless the appropriate system has been utilized to process radioactive gaseous effluents during the previous 92 days.
- .3 In plant shut-down (Mode 5, 6), the applicable portions of the GASEOUS RADWASTE TREATMENT SYSTEM and VENTILATION EXHAUST TREATMENT SYSTEM shall be demonstrated OPERABLE by operating the GASEOUS RADWASTE TREATMENT SYSTEM equipment and VENTILATION EXHAUST TREATMENT SYSTEM equipment for at least 15-minutes prior to processing gases unless the appropriate gaseous radwaste system has been utilized to process radioactive gaseous effluents during the previous 92 days.

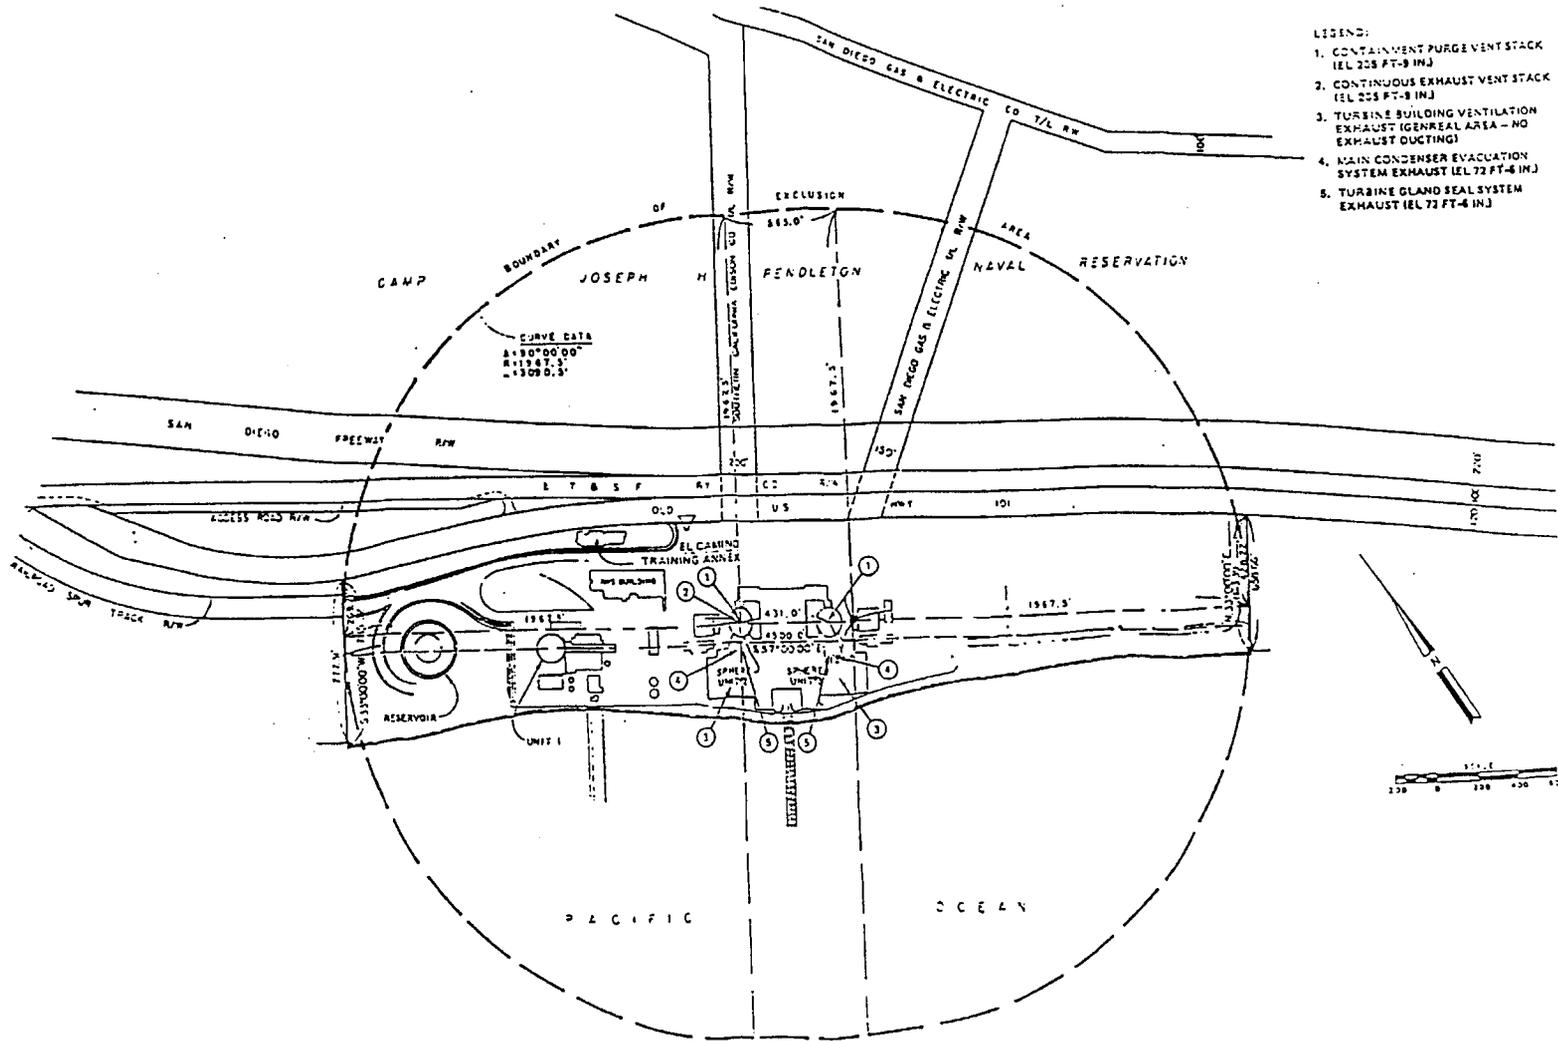

SAN ONOFRE  
 NUCLEAR GENERATING STATION  
 SITE BOUNDARY FOR GASEOUS EFFLUENTS

Figure 2-2

2.0 GASEOUS EFFLUENTS (Continued)

2.6 Methods of Calculation for Gaseous Effluent Monitor Setpoints

Administrative values are used to reduce each setpoint to account for the potential activity released simultaneously from the following release points:

- PVS = Plant Vent Stack
- CAE = Condenser Air Ejector
- CP = Containment Purge
- SY = South Yard
- WG = Waste Gas

The sum of the administrative values is limited to 1.0 to ensure that the total concentration from all release points on site to the environment will not result in a release exceeding the limits of Specification 2.1.1. The sum total of all these administrative values for the site shall be less than or equal to 1.0.

The administrative values shall be periodically reviewed based on actual release data and revised as necessary.

2.6.1 PLANT VENT STACK - 2/3RT-7808, 2RT-7865-1, 3RT-7865-1

For the purpose of implementation of Specification 2.1.1, the alarm setpoint level for noble gas monitors is based on the gaseous effluent flow rate and the meteorological dispersion factor.

Total Body

The concentration at the detector corresponding to a 500 mrem/yr total body dose rate at the exclusion area boundary is determined by:

$$C_{det} = \frac{(PVS) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (500 \text{ mrem/yr})(10^{-6} \text{ m}^3/\text{cc})}{(\text{flow rate, cfm})(X/Q, \text{ sec/m}^3) \left[ \sum_i \left( K_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{tot}} \right) \right]} \quad (2-1)$$

Skin

The concentration at the detector corresponding to a 3000 mrem/yr skin dose rate at the exclusion area boundary is determined by:

$$C_{det} = \frac{(PVS) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (3000 \text{ mrem/yr})(10^{-6} \text{ m}^3/\text{cc})}{(\text{flow rate, cfm})(X/Q, \text{ sec/m}^3) \left[ \sum_i \left( L_i + 1.1M_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{tot}} \right) \right]} \quad (2-2)$$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.1 PLANT VENT STACK - 2/3RT-7808, 2RT-7865-1, 3RT-7865-1 (Continued)

where:

$C_{det}$	= the instantaneous concentration at the detector, $\mu\text{Ci/cc}$
PVS	= an administrative value used to account for potential activity from other gaseous release pathways, typically 0.38.
$K_i$	= total body dose conversion factor from Table 2-4 for the $i^{\text{th}}$ gamma emitting noble gas, $\text{mrem/yr per } \mu\text{Ci/m}^3$
$L_i$	= skin Dose Conversion Factor from Table 2-4 for the $i^{\text{th}}$ noble gas, $\text{mrem/yr per } \mu\text{Ci/m}^3$
$M_i$	= air Dose Conversion Factor from Table 2-4 for the $i^{\text{th}}$ noble gas, $\text{mrem/yr per } \mu\text{Ci/m}^3$
1.1	= conversion factor to convert gamma air dose to skin dose
$C_i$	= concentration of the $i^{\text{th}}$ noble gas as determined by sample analysis, $\mu\text{Ci/cc}$
$C_{tot}$	= total concentration of noble gases as determined by sample analysis, $\mu\text{Ci/cc} = \sum_i C_i$
flow rate	= total plant vent stack flow rate, cfm, = typically 164,000 cfm
2120	= conversion constant, $\text{cfm per m}^3/\text{sec}$
500 mrem/yr	= total body dose rate limit, as specified by Specification 2.1.1.a
3000 mrem/yr	= skin dose rate limit as specified by Specification 2.1.1.a
X/Q	= historical annual average dispersion factor for any landward sector, $\text{sec/m}^3$ = $4.8\text{E-}6 \text{ sec/m}^3$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.1.1 Maximum Permissible Alarm Setpoint for 2/3RT-7808, 2RT-7865-1 and 3RT-7865-1

The smaller of the values of  $C_{det}$  from equations (2-1) and (2-2) shall be used to determine the maximum permissible monitor alarm setpoint.

The maximum release rate ( $\mu\text{Ci}/\text{sec}$ ) for Plant Vent Stack Monitors is determined by converting the concentration at the detector,  $C_{det}$  ( $\mu\text{Ci}/\text{cc}$ ) to an equivalent release rate in  $\mu\text{Ci}/\text{sec}$ , as follows:

$$A_{max} = \frac{(C_{det}, \mu\text{Ci}/\text{cc})(\text{flow rate, cfm})(28320)}{(S)(60)} \quad (2-3)$$

where:

$A_{max}$  = maximum permissible release rate,  $\mu\text{Ci}/\text{sec}$

$C_{det}$  = smaller of the values of  $C_{det}$  determined in equations (2-1) and (2-2).

flow rate = plant vent stack flow rate (cfm) used in equations (2-1) and (2-2)

28320 = conversion from  $\text{ft}^3$  to cc

60 = conversion from minutes to seconds

S = correction factor to compensate for the split flow between Unit 2 and Unit 3 Plant Vent Stacks, typically 2 for split stack monitoring and 1 for combined stack monitoring

The release rate setpoint shall not be set greater than the maximum release rate determined above, when the monitor is being used to meet the requirements of Specification 2.1.1.

2.0 GASEOUS EFFLUENTS (Continued)

2.6.2 CONDENSER EVACUATION SYSTEM - 2RT-7818, 2RT-7870-1, 3RT-7818 or 3RT-7870-1

2.6.2.1 2RT-7818 and 3RT-7818 Condenser Air Ejector Monitors

For the purpose of implementation of Specification 2.1.1, the alarm setpoint level for noble gas monitors is based on the gaseous effluent flow rate and the meteorological dispersion factor.

The concentration at the detector corresponding to a total body dose rate of 500 mrem/yr at the exclusion area boundary is determined by using:

Total Body

$$C_{det} = \frac{(CAE)(0.5) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (500 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( K_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{tot}} \right) \right]} \quad (2-4)$$

The concentration at the detector corresponding to a 3000 mrem/yr skin dose rate at the exclusion area boundary is determined by using:

Skin

where: (CAE) = an administrative value used to account for potential activity from other gaseous release pathways, typically 0.1.

0.5 = an administrative value used to account for releases from both SONGS 2 and SONGS 3 condenser air ejectors simultaneously.

Other parameters are specified in 2.6.1 and/or 2.6.2.2.

$$C_{det} = \frac{(CAE)(0.5) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (3000 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( L_i + 1.1M_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{tot}} \right) \right]} \quad (2-5)$$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.2 CONDENSER EVACUATION SYSTEM - 2RT-7818, 2RT-7870-1, 3RT-7818 or 3RT-7870-1 (Continued)

The smaller of the values  $C_{det}$  from equations (2-4) or (2-5) is to be used in determining the maximum permissible monitor alarm setpoint (cpm), as follows:

The maximum permissible alarm setting (cpm) is determined by using the calibration constant for the corresponding Condenser Evacuation System Monitor given in Table 2-3. The maximum permissible alarm setpoint is the cpm value corresponding to the concentration,  $C_{det}$ , [smaller value from equation (2-4) or (2-5)].

The calibration constant used is based on Kr-85 or on Xe-133, whichever yields a lower detection efficiency (higher value in terms of  $\mu\text{Ci}/\text{cc}/\text{cpm}$ ). The alarm setpoint will not be set greater than the maximum permissible alarm setting determined above.

#### 2.6.2.2 2RT-7870-1 and 3RT-7870-1 Wide Range Gas Monitors

The maximum release rate ( $\mu\text{Ci}/\text{sec}$ ) for Wide Range Gas Monitor is determined by converting the concentration at the detector,  $C_{det}$  ( $\mu\text{Ci}/\text{cc}$ ), to an equivalent release rate in  $\mu\text{Ci}/\text{sec}$ .

$$A_{max} = (C_{det}, \mu\text{Ci}/\text{cc}) (\text{flow rate}, \text{cc}/\text{sec}) \quad (2-6)$$

where:

$A_{max}$  = maximum permissible release rate,  $\mu\text{Ci}/\text{sec}$

$C_{det}$  = smaller value of  $C_{det}$ , as obtained from equations (2-4) and (2-5)

flow rate = flow rate of the condenser air ejector,  $\text{cc}/\text{sec}$   
= 4.719E5  $\text{cc}/\text{sec}$  (conservatively assumed as design flow rate)

## 2.0 GASEOUS EFFLUENTS (Continued)

2.6.3 CONTAINMENT PURGE - 2RT-7828, 3RT-7828, 2RT-7865-1, 3RT-7865-1  
 For the purpose of implementation of Specification 2.1.1, the alarm setpoint level for noble gas monitors is based on the gaseous effluent flow rate and the meteorological dispersion factor.

NOTE: 2(3)RT-7865 is not designed to monitor main purge.

The concentration at the detector corresponding to a total body dose rate of 500 mrem/yr at the exclusion boundary is determined by using:

Total Body

$$C_{\text{det2}} = \frac{(CP)(P_2) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (500 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( K_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{\text{tot}}} \right) \right]} \quad (2-7)$$

$$C_{\text{det3}} = \frac{(CP)(P_3) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (500 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( K_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{\text{tot}}} \right) \right]} \quad (2-8)$$

The concentration at the detector corresponding to a 3000 mrem/yr skin dose rate at the exclusion area boundary is determined by using:

Skin

$$C_{\text{det2}} = \frac{(CP)(P_2) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (3000 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( L_i + 1.1M_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{\text{tot}}} \right) \right]} \quad (2-9)$$

2.0 GASEOUS EFFLUENTS (Continued)

2.6.3 CONTAINMENT PURGE - 2RT-7828, 3RT-7828, 2RT-7865-1, 3RT-7865-1  
(Continued)

$$C_{\text{det3}} = \frac{(CP)(P_3) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (3000 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( L_i + 1.1M_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{\text{tot}}} \right) \right]} \quad (2-10)$$

where:

- $C_{\text{det2}}$  = instantaneous concentration of the Unit 2 detector,  $\mu\text{Ci/cc}$ .
- $C_{\text{det3}}$  = instantaneous concentration of the Unit 3 detector,  $\mu\text{Ci/cc}$ .
- CP = administrative value used to account for potential activity from other gaseous release pathways, typically 0.38.

$P_2$  and  $P_3$  are administrative values used to account for simultaneous purges of both SONGS 2 and SONGS 3. The fractions  $P_2$  and  $P_3$  will be assigned such that  $P_2 + P_3 \leq 1.0$ .

- Flow rate = observed maximum flowrate in cfm from the unit specific monitor 7828.  
Default values will be the following conservative measured flows:
  - = 50,000 cfm main purge [2(3)RT-7828 only]
  - = 3,000 cfm mini-purge
 (The above values replace the smaller design flowrates.)

Other parameters are as specified in 2.6.1 above. The smaller of the values of maximum permissible  $C_{\text{det2}}$  from equation (2-7) or (2-9) and  $C_{\text{det3}}$  from equations (2-8) or (2-10) is to be used in determining the maximum permissible monitor alarm setpoints.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.3 CONTAINMENT PURGE - 2RT-7828, 3RT-7828, 2RT-7865-1, 3RT-7865-1 (Continued)

#### 2.6.3.1 Maximum Permissible Alarm Setting for 2(3)RT-7865-1

The maximum permissible alarm setting for the Wide Range Gas Monitor expressed as a maximum release rate ( $\mu\text{Ci}/\text{sec}$ ) is determined by converting the concentration at the detector,  $C_{\text{det}}$  ( $\mu\text{Ci}/\text{cc}$ ), to an equivalent release rate in  $\mu\text{Ci}/\text{sec}$ .

where:  $A_{\text{max}} = (C_{\text{det}}, \mu\text{Ci}/\text{cc}) (\text{flow rate, cc}/\text{sec}) \quad (2-6)$

$A_{\text{max}} = \text{maximum permissible release rate, } \mu\text{Ci}/\text{sec}$

$C_{\text{det}} = \text{smaller value of } C_{\text{det}}, \text{ as obtained from equation (2-7, 2-9) for Unit 2 or (2-8, 2-10) for Unit 3.}$

flow rate = flow rate, cc/sec  
= 1.416E6 cc/sec for mini-purge.

#### .2 Maximum Permissible Alarm Setting (RT-7828)

The maximum permissible alarm setting for RT-7828 is in  $\mu\text{Ci}/\text{cc}$  and is the smaller of the values of  $C_{\text{det}}$  ( $\mu\text{Ci}/\text{cc}$ ) from equations (2-7) and (2-9) for Unit 2 or equations (2-8) and (2-10) for Unit 3.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.4 WASTE GAS HEADER - 3RT-7865-1, 2/3RT-7808

For the purpose of Specification 2.1.1, the alarm setpoint level for noble gas monitors is based on the gaseous effluent flow rate and the meteorological dispersion factor. Since the waste gas header discharges to the plant vent stack, either 3RT-7865-1 or 2/3RT-7808 may be used to monitor waste gas header releases.

The concentration at the detector corresponding to a total body dose rate of 500 mrem/yr or a skin dose rate of 3000 mrem/yr at the exclusion area boundary is determined by using equations (2-1) or (2-2) with sample concentration ( $C_i$ ) and ( $C_{tot}$ ) being obtained from the waste gas decay tank to be released.

#### 2.6.4.1 Maximum Permissible Alarm Setpoint for 3RT-7865-1 and 2/3RT-7808

The smaller of the values of  $C_{det}$  from equations (2-1) and (2-2) shall be used to determine the maximum permissible monitor alarm setpoint.

The maximum release rate ( $\mu\text{Ci}/\text{sec}$ ) for Plant Vent Stack Monitors is determined by converting the concentration at the detector,  $C_{det}$  ( $\mu\text{Ci}/\text{cc}$ ) to an equivalent release rate in  $\mu\text{Ci}/\text{sec}$ , as follows:

$$A_{\max} = \frac{(C_{\text{det}}, \mu\text{Ci}/\text{cc})(\text{flow rate, cfm})(28320)}{(S)(60)} \quad (2-3)$$

where:

$A_{\max}$  = maximum permissible release rate,  $\mu\text{Ci}/\text{sec}$

$C_{\text{det}}$  = smaller of the values of  $C_{\text{det}}$  determined in equations (2-1) and (2-2)

flow rate = plant vent stack flow rate (cfm) used in equations (2-1) and (2-2)

28320 = conversion from  $\text{ft}^3$  to cc

60 = conversion from minutes to seconds

S = correction factor for 3RT-7865-1 viewing only half the total plant vent stack flow, typically 2 for 3RT-7865-1 and 1 for 2/3RT-7808.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.4 WASTE GAS HEADER - 3RT-7865-1, 2/3RT-7808 (Continued)

2.6.4.2 A release from the waste gas header is not possible if:

$$\left(\sum_i C_i\right) \left(\frac{f}{F}\right) > C_{det} \quad (2-11)$$

where:

- $\sum_i C_i$  = total gamma activity ( $\mu\text{Ci/cc}$ ) of the waste gas holdup tank to be released, as determined from the pre-release sample analysis
- f = waste gas header effluent flow rate, cfm
- F = plant vent stack flowrate (cfm) used in equations (2-1) and (2-2)
- $C_{det}$  = smaller of the values of  $C_{det}$  determined in equations (2-1) and (2-2) with  $C_i$  being obtained from the waste gas holdup tank to be released

If a release is not possible, adjust the waste gas header flow by determining the maximum permissible waste gas header effluent flow rate corresponding to the Plant Vent Stack Monitor setpoint in accordance with the following:

$$f < \frac{(WG)(C_{det})(F)}{\sum_i C_i} \quad (2-12)$$

where:

- f = waste gas header effluent flow rate (cfm)
- F = plant vent stack flow rate (cfm) used in equation (2-1) or (2-2)
- $C_{det}$  = smaller of the value of  $C_{det}$  from equation (2-1) or (2-2)
- $\sum_i C_i$  = total gamma activity ( $\mu\text{Ci/cc}$ ) of the waste gas holdup tank to be released, as determined from the pre-release sample analysis.
- WG = an administrative value to account for the potential activity from other releases in the same release pathway, typically 0.9.

**Table 2-3**  
**Gaseous Effluent Radiation Monitor Calibration Constants<sup>(a)</sup>**  
 ( $\mu\text{Ci}/\text{cc}/\text{cpm}$ )

MONITOR	Kr-85	Xe-133
2RT-7818A	4.27E-8	6.86E-8
3RT-7818A	3.73E-8	5.12E-8

(a) This table provides typical ( $\pm 20\%$ ) calibration constants for the gaseous effluent radiation monitors.

2.0 GASEOUS EFFLUENTS (Continued)

2.7 Gaseous Effluent Dose Rate

The methodology used for the purpose of implementation of Specification 2.1.1 for the dose rate above background to an individual in an unrestricted area is calculated by using the following expressions:

2.7.1 FOR NOBLE GASES: (2-13)

$$\dot{D}_{TB} = \sum_i \left[ K_i (\overline{X/Q}) \dot{Q}_i \right]$$

$$\dot{D}_s = \sum_i \left[ (L_i + 1.1M_i) (\overline{X/Q}) \dot{Q}_i \right] \quad (2-14)$$

where:

- $\dot{D}_{TB}$  = total body dose rate in unrestricted areas due to radioactive materials released in gaseous effluents, mrem/yr
- $\dot{D}_s$  = skin dose rate in unrestricted areas due to radioactive materials released in gaseous effluents, mrem/yr
- $K_i$  = the total body dose factor due to gamma emissions from Table 2-4 for each identified noble gas radionuclide, i, in mrem/yr per  $\mu\text{Ci}/\text{m}^3$
- $L_i$  = skin dose factor due to the beta emissions from Table 2-4 for each identified noble gas radionuclide, i, in mrem/yr per  $\mu\text{Ci}/\text{m}^3$
- $M_i$  = air dose factor due to gamma emissions from Table 2-4 for each identified noble gas radionuclide, i, in mrad/yr per  $\mu\text{Ci}/\text{m}^3$  (conversion constant of 1.1 mrem/mrad converts air dose to skin dose.)
- $\dot{Q}_i$  = measured or calculated release rate of radionuclide, i, for either continuous or batch gaseous effluents, in  $\mu\text{Ci}/\text{sec}$
- $(\overline{X/Q})$  = Maximum annual average atmospheric dispersion factor for any landward sector or distance at or beyond the unrestricted area boundary.
  - =  $4.8\text{E}-6$  sec/ $\text{m}^3$  for Units 2 and 3
  - =  $8.0\text{E}-5$  sec/ $\text{m}^3$  for South Yard Facility

2.0 GASEOUS EFFLUENTS (Continued)

2.7.2 FOR ALL RADIOIODINES, TRITIUM AND FOR ALL RADIOACTIVE MATERIALS IN PARTICULATE FORM WITH HALF LIVES GREATER THAN EIGHT DAYS:

(2-15)

$$\dot{D}_o = \sum_i \left[ \sum_k (P_{ik} \bar{W}_k) \dot{Q}_i \right]$$

where:

- $\dot{D}_o$  = organ dose rate in unrestricted areas due to radioactive materials released in gaseous effluents, mrem/yr
- $\dot{Q}_i$  = measured or calculated release rate of radionuclide, i, for either continuous or batch gaseous effluents,  $\mu\text{Ci}/\text{sec}$
- $P_{ik}$  = dose parameter for radionuclide, i, for pathway, k, from Table 2-5 for the inhalation pathway in mrem/yr per  $\mu\text{Ci}/\text{m}^3$ . The dose factors are based on the critical individual organ and the child age group.
- $\bar{W}_k$  = highest calculated annual average dispersion ( $\bar{X}/Q$ ) or deposition ( $\bar{D}/Q$ ) factor for estimating the dose to an individual at or beyond the unrestricted area boundary for pathway k.
  - = ( $\bar{X}/Q$ ),  $4.8\text{E}-6 \text{ sec}/\text{m}^3$  for Units 2/3 for the inhalation pathway. The location is the unrestricted area in the NW sector.
  - = ( $\bar{X}/Q$ ),  $8.0\text{E}-5 \text{ sec}/\text{m}^3$  for South Yard Facility for the inhalation pathway. The location is the unrestricted area in the E sector.
  - = ( $\bar{X}/Q$ ),  $1.3\text{E}-5 \text{ sec}/\text{m}^3$  for the NIA (Unit 1) for the inhalation pathway. The location is the unrestricted area in the NW sector. (Historical value)
  - = ( $\bar{D}/Q$ ),  $4.3\text{E}-8 \text{ m}^2$  for Units 2/3 for the food and ground plane pathways. The location is the unrestricted area in the E sector.
  - = ( $\bar{D}/Q$ ),  $8.0\text{E}-7 \text{ m}^2$  for South Yard Facility for the food and ground plane pathways. The location is the unrestricted area in the E sector.
  - = ( $\bar{D}/Q$ ),  $7.2\text{E}-8 \text{ sec}/\text{m}^3$  for NIA (Unit 1) for the food and ground pathways. The location is the unrestricted area in the NW sector. (Historical value)

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.8 Gaseous Effluent Dose Calculation

#### 2.8.1 DOSE FROM NOBLE GASES IN GASEOUS EFFLUENTS

The gaseous releases considered in the following dose calculations are described in Section 2.6. The air dose in unrestricted areas due to noble gases released in gaseous effluents is calculated using the following expressions:

##### 2.8.1.1 For historical meteorology:

$$D_{\gamma} = 3.17 \times 10^{-8} \sum_i M_i \left[ (\bar{X}/Q) Q_i \right] \quad (2-16)$$

$$D_{\beta} = 3.17 \times 10^{-8} \sum_i N_i \left[ (\bar{X}/Q) Q_i \right] \quad (2-17)$$

where:

- $D_{\gamma}$  = total gamma air dose from gaseous effluents, mrad
- $D_{\beta}$  = total beta air dose from gaseous effluents, mrad
- $3.17 \times 10^{-8}$  = inverse seconds per year
- $M_i$  = air dose factor due to gamma emissions from Table 2-4 for each identified noble gas radionuclide,  $i$ , in mrad/yr per  $\mu\text{Ci}/\text{m}^3$
- $N_i$  = air dose due to beta emissions from Table 2-4 for each identified noble gas radionuclide,  $i$ , in mrad/yr per  $\mu\text{Ci}/\text{m}^3$
- $(\bar{X}/Q)$  = Maximum annual average atmospheric dispersion factor for any landward sector or distance at or beyond the unrestricted area boundary.
  - =  $4.8\text{E}-6$  sec/ $\text{m}^3$  for Units 2 and 3
  - =  $8.0\text{E}-5$  sec/ $\text{m}^3$  for South Yard Facility
- $Q_i$  = amount of noble gas radionuclide,  $i$ , released in gaseous effluents,  $\mu\text{Ci}$ .

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.8.1.2 For meteorology concurrent with release:

NOTE: Consistent with the methodology provided in Regulatory Guide 1.109 and the following equations, quality affecting computer software is used to perform the actual calculations.

$$D_{\gamma\theta} = 1.14 \times 10^{-4} \sum_i M_i \left[ \sum_j (\Delta t_j (X/Q)_{j\theta} \dot{Q}_{ij}) \right] \quad (2-18)$$

$$D_{\beta\theta} = 1.14 \times 10^{-4} \sum_i N_i \left[ \sum_j (\Delta t_j (X/Q)_{j\theta} \dot{Q}_{ij}) \right] \quad (2-19)$$

where:

- $D_{\gamma\theta}$  = total gamma air dose from gaseous effluents in sector  $\theta$ , mrad
- $D_{\beta\theta}$  = total beta air dose from gaseous effluents in sector  $\theta$ , mrad
- $1.14 \times 10^{-4}$  = inverse hours/year
- $M_i$  = air dose factor due to gamma emissions from Table 2-4 for each identified noble gas radionuclide,  $i$ , in mrad/yr per  $\mu\text{Ci}/\text{m}^3$
- $N_i$  = air dose factor due to beta emissions from Table 2-4 for each identified noble gas radionuclide,  $i$ , in mrad/yr per  $\mu\text{Ci}/\text{m}^3$
- $\Delta t_j$  = length of the  $j^{\text{th}}$  time period over which  $(X/Q)_{j\theta}$  and  $\dot{Q}_{ij}$  are averaged for gaseous releases in hours
- $(X/Q)_{j\theta}$  = atmospheric dispersion factor for time period  $\Delta t_j$  at exclusion boundary location in landward sector  $\theta$  determined by concurrent meteorology,  $\text{sec}/\text{m}^3$
- $\dot{Q}_{ij}$  = average release rate of radionuclide,  $i$ , in gaseous effluents during time period,  $\Delta t_j$ ,  $\mu\text{Ci}/\text{sec}$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.8.2 DOSE FROM TRITIUM, RADIOIODINES AND RADIOACTIVE MATERIALS IN PARTICULATE FORM WITH HALF LIVES GREATER THAN 8 DAYS IN GASEOUS EFFLUENTS

The dose to an individual from tritium, radioiodines and radioactive materials in particulate form with half lives greater than eight days in gaseous effluents released to unrestricted areas is calculated using the following expressions:

#### 2.8.2.1 For historical meteorology:

(2-20)

$$D_o = 3.17 \times 10^{-8} \sum_i \left[ \sum_k (R_{ik} W_k) Q_i \right]$$

where:

$D_o$  = total projected dose from gaseous effluents to an individual, mrem

$3.17 \times 10^{-8}$  = year/second

$Q_i$  = amount of each radionuclide,  $i$ , (tritium, radioiodine, radioactive material in particulate form with half lives greater than eight days), released in gaseous effluents,  $\mu\text{Ci}$

$\sum_k R_{ik} W_k$  = sum of all pathways,  $k$ , for radionuclide,  $i$ , of the  $R_i W$  product, in mrem/yr per  $\mu\text{Ci}/\text{sec}$ . The  $\sum_k R_{ik} W_k$  value for each radionuclide,  $i$ , is given in Table 2-6 for Units 2/3, Table 2-7 for South Yard Facility, and Table 2-8 for the North Industrial Area (Unit 1 historical value). The value given is the maximum  $\sum_k R_{ik} W_k$  for all locations and is based on the most restrictive age groups.

$R_{ik}$  = dose factor for each identified radionuclide,  $i$ , for pathway  $k$ , (for the inhalation pathway in mrem/yr per  $\mu\text{Ci}/\text{m}^3$  and for the food and ground plane pathways in  $\text{m}^2$ -mrem/yr per  $\mu\text{Ci}/\text{sec}$ ), at the controlling location. The  $R_{ik}$ 's for each controlling location for each age group are given in Appendix A. Data in these tables are derived using the NRC code, PARTS. (See the annual update of revised  $R_i$  parameters based on changes in the Land Use Census provided by Corporate Health Physics and Environmental.)

2.0 GASEOUS EFFLUENTS (Continued)

2.8.2.1 For historical meteorology: (Continued)

- $W_k$  = annual average dispersion ( $\overline{X/Q}$ ) or deposition ( $\overline{D/Q}$ ) factor for estimating the dose to an individual at the controlling location for pathway k.
- =  $\overline{(X/Q)}$  for the inhalation pathway in  $\text{sec}/\text{m}^3$ .  
The  $\overline{(X/Q)}$  for each controlling location is given in Appendix A.
- =  $\overline{(D/Q)}$  for the food and ground plane pathways in  $\text{m}^{-2}$ .  
The  $\overline{(D/Q)}$  for each controlling location is given in Appendix A.

2.8.2.2 For meteorology concurrent with releases:

NOTE: Consistent with the methodology provided in Regulatory Guide 1.109 and the following equations, quality affecting computer software is used to perform the actual calculations.

- where:  $D_{\theta} = 1.14 \times 10^{-4} \sum_{i,j,k} \sum_{m,n} \left[ (\Delta t_j) (R_{ik\theta}) (W_{jk\theta}) \left( \dot{Q}_{ij} \right) \right]$  (2-21)
- $D_{\theta}$  = total annual dose from gaseous effluents to an individual in sector  $\theta$ , mrem.
- $\Delta t_j$  = length of the  $j^{\text{th}}$  period over which  $W_{jk\theta}$  and  $\dot{Q}_{ij}$  are averaged for gaseous released, hours
- $\dot{Q}_{ij}$  = average release rate of radionuclide,  $i$ , in gaseous effluents during time period  $\Delta t_j$ ,  $\mu\text{Ci}/\text{sec}$
- $R_{ik\theta}$  = dose factor for each identified radionuclide  $i$ , for pathway  $k$  for sector  $\theta$  (for the inhalation pathway in  $\text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{m}^3$  and for the food and ground plane pathways in  $\text{m}^2 \text{mrem}/\text{yr}$  per  $\mu\text{Ci}/\text{sec}$ ) at the controlling location. A listing of  $R_{ik}$  for the controlling locations in each landward sector for each group is given in Appendix A. The  $\theta$  is determined by the concurrent meteorology.
- $W_{jk\theta}$  = dispersion ( $\overline{X/Q}$ ) or deposition ( $\overline{D/Q}$ ) factor for the time period  $\Delta t_j$  for each pathway  $k$  for calculating the dose to an individual at the controlling location in sector  $\theta$  using concurrent meteorological conditions.
- =  $\overline{(X/Q)}$  for the inhalation pathway,  $\text{sec}/\text{m}^3$
- =  $\overline{(D/Q)}$  for the food and ground plane pathways,  $\text{m}^{-2}$

**TABLE 2-4**

**DOSE FACTORS FOR NOBLE GASES AND DAUGHTERS\*\***

Radio-Nuclide	Total Body Dose Factor $K_i$ (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )	Skin Dose Factor $L_i$ (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )	Gamma Air Dose Factor $M_i$ (mrad/yr per $\mu\text{Ci}/\text{m}^3$ )	Beta Air Dose Factor $N_i$ (mrad/yr per $\mu\text{Ci}/\text{m}^3$ )
Kr-85m	1.17E+3	1.46E+3	1.23E+3	1.97E+3
Kr-85	1.61E+1	1.34E+3	1.72E+1	1.95E+3
Kr-87	5.92E+3	9.73E+3	6.17E+3	1.03E+4
Kr-88	1.47E+4	2.37E+3	1.52E+4	2.93E+3
Xe-131m	9.15E+1	4.76E+2	1.56E+2	1.11E+3
Xe-133m	2.51E+2	9.94E+2	3.27E+2	1.48E+3
Xe-133	2.94E+2	3.06E+2	3.53E+2	1.05E+3
Xe-135m	3.12E+3	7.11E+2	3.36E+3	7.39E+2
Xe-135	1.81E+3	1.86E+3	1.92E+3	2.46E+3
Xe-138	8.83E+3	4.13E+3	9.21E+3	4.75E+3
Ar-41	8.84E+3	2.69E+3	9.30E+3	3.28E+3

\*\*Source: USNRC Reg. Guide 1.109, Table B-1

**TABLE 2-5**

**DOSE PARAMETER  $P_{ik}$ \***

**CHILD AGE GROUP  
CRITICAL ORGAN**

Radionuclide	Inhalation Pathway (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )	Radionuclide	Inhalation Pathway (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )
H - 3	1.1E+3	I -131	1.6E+7
Cr-51	1.7E+4	I -132	1.9E+5
Mn-54	1.6E+6	I -133	3.8E+6
Co-57	5.1E+5	I -134	5.1E+4
Co-58	1.1E+6	I -135	7.9E+5
Co-60	7.1E+6	Cs-134	1.0E+6
Sr-89	2.2E+6	Cs-136	1.7E+5
Sr-90	1.0E+8	Cs-137	9.1E+5
Zr-95	2.2E+6	Ba-140	1.7E+6
Nb-95	6.1E+5	Ce-141	5.4E+5
Ru-103	6.6E+5	Ce-144	1.2E+7
Te-129m	1.8E+6		

\*Source: USNRC NUREG-0133, Section 5.2.1.1

**TABLE 2-6**

**UNITS 2&3 CONTROLLING LOCATION FACTORS<sup>1</sup>**

Radionuclide	$\sum_k R_{ik} W_k$ mrem/yr per $\mu\text{Ci}/\text{sec}$	Use:
H -3	3.55E-3	R: Camp Mesa
Cr-51	1.47E-1	R: Camp Mesa
Mn-54	3.05E+1	R: Camp Mesa
Co-57	6.59E+0	R: Camp Mesa
Co-58	1.09E+1	R: Camp Mesa
Co-60	4.24E+2	R: Camp Mesa
Sr-89	1.68E+1	Q: SC Res. with Garden
Sr-90	6.60E+2	Q: SC Res. with Garden
Zr-95	1.21E+1	R: Camp Mesa
Nb-95	1.07E+1	E: Deer Consumer/Hunter
Ru-103	1.69E+1	E: Deer Consumer/Hunter
Te-129m	7.67E+0	E: Deer Consumer/Hunter
Cs-134	1.30E+2	R: Camp Mesa
Cs-136	2.80E+0	R: Camp Mesa
Cs-137	1.95E+2	R: Camp Mesa
Ba-140	5.95E+0	R: Camp Mesa
Ce-141	1.95E+0	R: Camp Mesa
Ce-144	3.83E+1	R: Camp Mesa
I -131	4.47E+1	R: Camp Mesa
I -132	5.79E-1	R: Camp Mesa
I -133	1.08E+1	R: Camp Mesa
I -134	1.49E-1	R: Camp Mesa
I -135	2.27E+0	R: Camp Mesa
UN-ID	1.75E+1	R: Camp Mesa

<sup>1</sup> These values to be used in manual calculations are the maximum  $\sum_k R_{ik} W_k$  for all locations based on the most restrictive age group.

**TABLE 2-7**

**SOUTH YARD FACILITY CONTROLLING LOCATION FACTORS<sup>1</sup>**

Radionuclide	$\sum_k R_{ik} W_k$ mrem/yr per $\mu\text{Ci}/\text{sec}$	Use:
H -3	1.31E-3	G: San Onofre Bch Campgd
Cr-51	4.15E-2	F: SO St. Pk./Guard Shack
Mn-54	9.70E+0	F: SO St. Pk./Guard Shack
Co-57	2.41E+0	F: SO St. Pk./Guard Shack
Co-58	3.14E+0	F: SO St. Pk./Guard Shack
Co-60	1.35E+2	F: SO St. Pk./Guard Shack
Sr-89	1.71E+0	F: Deer Consumer/Hunter
Sr-90	1.04E+2	G: San Onofre Bch Campgd
Zr-95	7.26E+0	F: Deer Consumer/Hunter
Nb-95	2.88E+1	F: Deer Consumer/Hunter
Ru-103	4.56E+1	F: Deer Consumer/Hunter
Te-129m	2.26E+1	F: Deer Consumer/Hunter
Cs-134	4.28E+1	F: SO St. Pk./Guard Shack
Cs-136	1.04E+0	F: SO St. Pk./Guard Shack
Cs-137	6.36E+1	F: SO St. Pk./Guard Shack
Ba-140	1.39E+0	G: San Onofre Bch Campgd
Ce-141	4.29E-1	G: San Onofre Bch Campgd
Ce-144	8.39E+0	G: San Onofre Bch Campgd
I -131	2.28E+1	F: Deer Consumer/Hunter
I -132	1.22E-1	G: San Onofre Bch Campgd
I -133	2.22E+0	G: San Onofre Bch Campgd
I -134	3.24E-2	G: San Onofre Bch Campgd
I -135	4.60E-1	G: San Onofre Bch Campgd
UN-ID	5.36E+0	F: SO St Pk./Guard Shack

<sup>1</sup> These values to be used in manual calculations are the maximum  $\sum_k R_{ik} W_k$  for all locations based on the most restrictive age group.

**TABLE 2-8**

**NORTH INDUSTRIAL AREA (UNIT 1) CONTROLLING LOCATION FACTORS<sup>1</sup>**

Radionuclide	$\sum_k R_{ik} W_k$ mrem/yr per $\mu\text{Ci/sec}$	Use:
H -3	5.46E-3	A: Camp Mesa
Cr-51	2.42E-1	B: Camp Mesa
Mn-54	5.54E+1	B: Camp Mesa
Co-57	1.17E+1	B: Camp Mesa
Co-58	1.80E+1	B: Camp Mesa
Co-60	7.82E+2	B: Camp Mesa
Sr-89	1.82E+1	Q: SC Res. with Garden
Sr-90	7.16E+2	Q: SC Res. with Garden
Zr-95	1.93E+1	A: Camp Mesa
Nb-95	7.68E+0	B: Camp Mesa
Ru-103	1.09E+1	E: Deer Consumer/Hunter
Te-129m	9.04E+0	A: Camp Mesa
Cs-134	2.32E+2	B: Camp Mesa
Cs-136	5.17E+0	B: Camp Mesa
Cs-137	3.40E+2	B: Camp Mesa
Ba-140	9.07E+0	A: Camp Mesa
Ce-141	3.01E+0	A: Camp Mesa
Ce-144	5.68E+1	A: Camp Mesa
I -131	6.77E+1	A: Camp Mesa
I -132	8.36E-1	A: Camp Mesa
I -133	1.60E+1	A: Camp Mesa
I -134	2.29E-1	A: Camp Mesa
I -135	3.40E+0	A: Camp Mesa
UN-ID	3.02E+1	B: Camp Mesa

<sup>1</sup> These values to be used in manual calculations are the maximum  $\sum_k R_{ik} W_k$  for all locations based on the most restrictive age group.

### 3.0 PROJECTED DOSES

#### 3.1 Liquid Dose Projection

The methodology used for projecting a liquid dose over 31 days for Specification 1.3.1 is as follows:

1. Determine the monthly total body and organ doses resulting from releases during the previous twelve months.
2. Projected dose = Previous 12 months' dose divided by 12 for the total body and each organ.

#### 3.2 Gaseous Dose Projection

The methodology used for projecting a gaseous dose over 31 days for Specification 2.4.1 is as follows:

1. Determine the monthly gamma, beta and organ dose resulting from releases during the previous twelve months.
2. Projected dose = Previous 12 months' dose divided by 12 for the gamma, beta and organ doses.

### 3.0 PROJECTED DOSES (Continued)

#### 3.3 TOTAL DOSE

##### SPECIFICATION

3.3.1 The dose or dose commitment to any member of the public, due to releases of radioactivity and radiation, from uranium fuel cycle sources shall be limited to less than or equal to 25 mrem to the total body or any organ (except the thyroid, which shall be limited to less than or equal to 75 mrem) over 12 consecutive months.

APPLICABILITY: At all times

##### ACTION:

- a. With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of Specifications 1.2.1.a, 1.2.1.b, 2.2.1.a, 2.2.1.b, 2.3.1.a, or 2.3.1.b in lieu of any other report required by Specification 6.9.1, prepare and submit a Special Report to the Director, Nuclear Reactor Regulation, U.S. Nuclear Regulatory Commission, Washington, D.C. 20555, within 30 days, which defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the limits of Specification 3.3.1. This Special Report shall include an analysis which estimates the radiation exposure (dose) to a member of the public from uranium fuel cycle sources (including all effluent pathways and direct radiation) for a 12 consecutive month period that includes the release(s) covered by this report. If the estimated dose(s) exceeds the limits of Specification 3.3.1, and if the release condition resulting in violation of 40 CFR 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190 and including the specified information of paragraph 190.11(b). Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete. The variance only relates to the limits of 40 CFR 190, and does not apply in any way to the requirements for dose limitation of 10 CFR Part 20, as addressed elsewhere in this ODCM.

##### SURVEILLANCE REQUIREMENTS

- .1 Dose Calculations Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with surveillance 1.2.1.1, 2.2.1.1, and 2.3.1.1.

### 3.0 PROJECTED DOSES (Continued)

#### 3.4 TOTAL DOSE CALCULATIONS

##### 3.4.1 Total Dose to Most Likely Member of the Public

The total annual dose or total dose commitment to any member of the public, due to releases of radioactivity and to radiation, from uranium fuel cycle sources within 5 miles of the Site is calculated using the following expressions. This methodology is used to meet the dose limitations of 40 CFR 190 per twelve consecutive months. The transportation of radioactive material is excluded from the dose calculations.

The Annual Total Dose is determined monthly for maximum organ (gas & liquid), whole body (gas & liquid) and thyroid (gas & liquid) to verify that the Site total is less than or equal to 25 mrem, 25 mrem, and 75 mrem respectively.

##### .1 Annual Total Organ Dose ( $D_{TOT}(0)$ )

$$D_{TOT}(0) = \sum_{l=1}^{12} \sum_{j=1}^{2/3} \left[ D_{jl}(OG) + D_{jl}(OL) + D_{jl}^{H-3}(OG) \right] \quad (3-1)$$

where:

\*NOTE:  $D_{jl}^{H-3}(OG) = 0$  for bone

\*\*All to be summed over the most recent 12 months.

$$D_{jl}(OG) = K \sum_{i=1}^n C_i \sum_k R_{ik} W_k \quad (3-2)$$

i = each isotope in specific organ category

j = NIA, Unit 2 and Unit 3

l = months 1 - 12\*\*

$$K = 3.1688E-2 \frac{\text{year}-\mu\text{Ci}}{\text{sec}-\text{Ci}}$$

### 3.0 PROJECTED DOSES (Continued)

#### 3.4 TOTAL DOSE CALCULATIONS (Continued)

##### 3.4.1 Total Dose to Most Likely Member of the Public (Continued)

$n$  = number of isotopes in the specified organ category

$C_i$  = total particulate gas curies released for the month

$\sum_k r_{ik} W_k$  = SONGS controlling location factors (Tables 2-6, 2-7 or 2-8).

$D_{j1}(OL)$  = liquid organ dose for the specified organ in mrem for the month. [equation (1-16)]

$D_{j1}^{H-3}(OG)^*$  = gas organ dose from tritium in mrem for the month. [equation (2-15)]

##### .2 Annual Total Whole Body Dose $D_{TOT}(WB)$

$$D_{TOT}(WB) = \sum_{l=1}^{12} \sum_{j=1}^{2/3} \left[ D_{j1}(WBL) + D_{j1}^{H-3}(OG) + 0.9 D_{j1}(\gamma) \right] + D(DIRECT) \quad (3-3)$$

where:

$j$  = NIA, Unit 2 and Unit 3

$l$  = months 1 - 12, to be summed over the most recent 12 months

$D_{j1}(WBL)$  = liquid whole body organ dose in mrem for the whole month. [equation (1-16)]

$D_{j1}^{H-3}(OG)$  = gas organ dose from tritium in mrem for the month. [equation (2-15)]

$D_{j1}(\gamma)$  = gamma air dose in mrad for the month.  
0.9 converts mrad to mrem.  
[equation (2-16)]

$$D(Direct) = \sum_{q=1}^4 \left[ \max[D(\text{beach})_i] - \frac{\sum_{p=1}^n D(\text{bkgd})_i}{n} \right] .0342 \quad (3-4)$$

$p$  = for all TLDs per quarter

$q$  = for Quarters 1-4

### 3.0 PROJECTED DOSES (Continued)

#### 3.4 TOTAL DOSE CALCULATIONS (Continued)

##### 3.4.1 Annual Total Whole Body Dose $D_{TOT}(WB)$ (Continued)

###### \*Direct Radiation

The direct radiation levels are evaluated most recently using thulium doped TLDs. The TLDs are placed at a minimum of 30 locations around the site. The average dose measured by TLDs 5 to 50 miles from the site is used as background. These sites are subject to change.

The background is subtracted from the highest reading TLD within 5 miles of the site (generally numbers 55 through 58). This value is the direct dose but must be prorated by the occupancy factor.

Example: Beach time (west boundary, seawall) of 300 hrs/yr, east and north boundaries of 20 hrs/yr, or 8 hrs/yr for the south boundary and west fence of parking lot 1 (top of bluff).

Reference: E. M. Goldin Memorandum for File, "Occupancy Factors at San Onofre Owner Controlled Area Boundaries," dated October 1, 1991.

##### .3 Annual Total Thyroid Dose $D_{TOT}(T)$

$$D_{TOT}(T) = \sum_{l=1}^{12} \sum_{j=1}^{2/3} [D_{jl}(OG) + D_{jl}(OL)] \quad (3-5)$$

where:

j = NIA, Unit 2 and Unit 3

l = months 1 - 12, to be summed over the most recent 12 months

$D_{jl}(OG)$  = thyroid organ dose from gaseous iodine for the month in mrem. [equation (2-20)]

$D_{jl}(OL)$  = liquid thyroid organ dose for the month in mrem. [equation (1-16)]

## 4.0 EQUIPMENT

### 4.1 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

#### SPECIFICATION

- 4.1.1 The radioactive liquid effluent monitoring instrumentation channels shown in Table 4-1 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of Specification 1.1.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with Section 1.4.

APPLICABILITY: At all times

#### ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above specification, immediately suspend the release of radioactive liquid effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 4-1. Exert best efforts to return the instrument to OPERABLE status within 30 days and, additionally, if the inoperable instrument(s) remain inoperable for greater than 30 days, explain in the next Annual Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner.
- c. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE and either the appropriate ACTION items in Table 4-1 not taken or the necessary surveillances not performed at the specified frequency prescribed in Table 4-2, perform an evaluation based on the significance of the event in accordance with the site Corrective Action Program.

#### SURVEILLANCE REQUIREMENTS

- .1 Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table 4-2.
- .2 At least once per 12 hours and within 1 hour after a change in pump operation that affects dilution flow has been completed, all pumps required to be providing dilution to meet the site radioactive effluent concentration limits of Specification 1.1.1 shall be determined to be operating and providing dilution to the discharge structure.

TABLE 4-1

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT*</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>ACTION</u>
1. GROSS RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE		
a. Liquid Radwaste Effluent Line - 2/3RT-7813	1	28
b. Steam Generator Blowdown Processing System (Neutralization Sump) Full Flow Condensate Polisher Effluent Line - 2(3)RT-7817	1	29
c. Turbine Plant Sumps, Auxiliary Building Sump Component Cooling Water Sumps, Storage Tank Area Sumps Effluent Line - 2(3)RT-7821	1	30
d. Steam Generator (E088) Blowdown Effluent Line - 2(3)RT-6759	1	29
e. Steam Generator (E089) Blowdown Effluent Line - 2(3)RT-6753	1	29
f. Yard Drain Sump - RT-2101	1	44
2. PROCESS FLOW RATE MEASUREMENT DEVICES		
a. Liquid Radwaste Effluent Line	1	31
b. Steam Generator Blowdown Processing System (Neutralization Sump), Full Flow Condensate Polisher Effluent Line	1	31
c. Turbine Plant Sumps, Auxiliary Building Sump Component Cooling Water Sumps, Storage Tank Area Sumps Effluent Line	1	31
d. Steam Generator (E088) Blowdown Bypass Effluent Line	1	31
e. Steam Generator (E089) Blowdown Bypass Effluent Line	1	31
f. Yard Drain Sump Effluent Line	1	31

TABLE 4-1

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT*</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>ACTION</u>
3. DATA ACQUISITION SYSTEM (CONTROL ROOM ALARM ANNUNCIATION)	1	32
4. UNIT 2 PLANT COMPUTER SYSTEM (CONTROL ROOM ALARM ANNUNCIATION)	1	32
5. CONTINUOUS COMPOSITE SAMPLERS		
a. Turbine Plant Sump, Auxiliary Building Sumps - 2(3) APC 5887	1	33
b. Blowdown Processing System Neutralization Sump - 2(3) APC 3772	1	33
c. Steam Generator (E088) Blowdown to Bypass, Steam Generator (E088) Blowdown - 2(3) APC 4077	1	33
d. Steam Generator (E089) Blowdown to Bypass, Steam Generator (E089) Blowdown - 2(3) APC 4076	1	33

TABLE 4-1 (Continued)

TABLE NOTATION

- \* Monitor Recorders are not required for the Operability of the monitor, providing the inoperable recorder does not cause the monitor to become inoperable (i.e., feedback signal). As long as the monitor has indication, alarm capability (if applicable), proper response (based on surveillance requirements) and isolation function (if applicable), the loss of the recorder does not render the monitor inoperable.
- ACTION 28 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirements, effluent releases may continue provided that prior to initiating a release:
- a. At least two independent samples are analyzed in accordance with Specification 1.1.1 and
  - b. At least two technically qualified members of the Facility Staff independently verify the release rate calculation and discharge line valving;
- Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 29 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are analyzed for gross radioactivity (beta or gamma) at a limit of detection of at least  $10^{-7}$  microcuries/gram:
- a. At least once per 8 hours when the specific activity of the secondary coolant is greater than 0.01 microcuries/gram DOSE EQUIVALENT I-131;
  - b. At least once per 24 hours when the specific activity of the secondary coolant is less than or equal to 0.01 microcuries/gram DOSE EQUIVALENT I-131; or
  - c. Lock closed valve S2(3)1318MU577 and divert flow to T-064 for processing as liquid radwaste.
- ACTION 30 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that, at least once per 12 hours, grab samples are collected and analyzed within 4 hours of collection time for gross radioactivity (beta or gamma) at a limit of detection of at least  $10^{-7}$  microcuries/ml or lock closed valve S2(3)2419MU077 or S2(3)2419MU078 and divert flow to the radwaste sump for processing as liquid radwaste.

TABLE 4-1 (Continued)

TABLE NOTATION

- ACTION 31 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the process flow rate is estimated at least once per 12 hours during actual releases. In addition, a new flow estimate shall be made within 1 hour after a change that affects process flow has been completed. Pump curves may be used to estimate process flow.
- Loss of process flow instrument(s) results in the associated gross activity monitor becoming INOPERABLE. Perform the compensatory action for the inoperable gross activity monitor in addition to this compensatory action. [2(3)RT-7817, 2(3)RT-7821, 2/3RT-7813]
- ACTION 32 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the monitor is verified OPERABLE by performing a channel check at least once per 4 hours during actual releases.
- ACTION 33 - With the number of channels OPERABLE less than required by the Minimum channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are collected daily, and composited and analyzed weekly:
- a. at least once per 24 hours, not to exceed 30 hours
  - b. at least once per 12 hours for steam generator when the specific activity of the secondary coolant is greater than 0.01 microcuries/gram DOSE EQUIVALENT I-131.
- ACTION 44 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that, at least once per 12 hours, grab samples are collected and analyzed within 4 hours of collection time for gross radioactivity (beta or gamma) at a lower limit of detection of at least  $10^{-7}$  microcurie/ml).

TABLE 4-2

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT**</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNELS CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>
1. GROSS BETA OR GAMMA RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE				
a. Liquid Radwaste Effluents Line - 2/3RT-7813	D	P	R(2)	Q(1)
b. Steam Generator Blowdown Processing System (Neutralization Sump), Full Flow Condensate Polisher Effluent Line - 2(3)RT-7817	D	M	R(2)	Q(1)
c. Turbine Plant Sump, Auxiliary Building Sump, Component Cooling Water Sumps, Storage Tank Area Sumps Effluent Line - 2(3)RT-7821	D	M	R(2)	Q(1)
d. Steam Generator (E088) Blowdown Bypass Effluent Line - 2(3)RT-6759	D	M	R(2)	Q(1)
e. Steam Generator (E089) Blowdown Bypass Effluent Line - 2(3)RT-6753	D	M	R(2)	Q(1)
f. Yard Drain Sump Effluent Line - RT-2101	D	M	R(2)	Q(1)
2. PROCESS FLOW RATE MEASUREMENT DEVICES				
a. Liquid Radwaste Effluent Line	D(3)	N/A	R	Q
b. Steam Generator Blowdown Processing System (Neutralization Sump), Full Flow Condensate Polisher Effluent Line	D(3)	N/A	R	Q
c. Turbine Plant Sump, Auxiliary Building Sump, Component Cooling Water Sumps, Storage Tank Area Sumps Effluent Line	D(3)	N/A	R	Q
d. Steam Generator (E088) Blowdown Bypass Effluent Line	D(3)	N/A	R	Q
e. Steam Generator (E089) Blowdown Bypass Effluent Line	D(3)	N/A	R	Q
f. Yard Drain Sump Effluent Line	D(3)	N/A	R	Q

TABLE 4-2

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT**</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNELS CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>
3. DATA ACQUISITION SYSTEM (CONTROL ROOM ALARM ANNUNCIATION)	D	N/A	N/A(4)	Q
4. UNIT 2 PLANT COMPUTER SYSTEM (CONTROL ROOM ANNUNCIATION)	D	N/A	N/A	Q
5. CONTINUOUS COMPOSITE SAMPLERS				
a. Turbine Plant Sump, Auxiliary building Sumps - 2(3) APC 5887	D(5)	N/A	R	Q
b. Blowdown Processing System Neutralization Sump - 2(3) APC 3772	D(5)	N/A	R	Q
c. Steam Generator (E088) Blowdown to Bypass, Steam Generator (E088) Blowdown - 2(3) APC 4077	D(5)	N/A	R	Q
d. Steam Generator (E089) Blowdown to Bypass, Steam Generator (E089) Blowdown - 2(3) APC 4076	D(5)	N/A	R	Q

TABLE 4-2 (Continued)

TABLE NOTATION

\*\* Monitor Recorders are not required for the Operability of the monitor, providing the inoperable recorder does not cause the monitor to become inoperable (i.e., feedback signal). As long as the monitor has indication, alarm capability (if applicable), proper response (based on surveillance requirements) and isolation function (if applicable), the loss of the recorder does not render the monitor inoperable.

(1) The CHANNEL FUNCTIONAL TEST shall also demonstrate verification of effluent path isolation actuation signal, automatic pathway isolation†, and Control Room alarm annunciation if any of the following conditions exist:

1. Instrument indicates measured levels above the alarm/trip setpoint.
2. Circuit failure.

† Automatic pathway isolation is tested on a once per refueling period.

Down scale failure testing is bounded by administrative limitation on monitor setpoint which ensure monitor alarm and release termination occur prior to reaching the level of monitor saturation.

If the instrument controls are not in the operate mode, procedures shall require that the channel be declared inoperable.

(2) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATIONS, sources that have been related to the initial calibration shall be used.

(3) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic, or batch releases are made.

(4) The Data Acquisition System (DAS) software and hardware do not require Channel Calibration. The DAS software is quality affecting and controlled by the site Software Modification Request process under procedure S0123-V-4.71, Software Development and Maintenance. The DAS hardware is installed plant equipment and controlled by the site design change process utilizing procedure S0123-XXIX-2.10, Design Change Process or S0123-XXIV-10.1, Field Change Notice (FCN) and Field Interim Design Change Notice (FIDCN).

(5) CHANNEL CHECK shall consist of verifying compositor switch positions and installed counter setting, and comparing integrator readings to sample volume collected.

## 4.0 EQUIPMENT

### 4.2 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

#### SPECIFICATION

- 4.2.1 The radioactive gaseous effluent monitoring instrumentation channels shown in Table 4-3 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of Specification 2.1.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with ODCM.

APPLICABILITY: At all times

#### ACTION:

- a. With a radioactive gaseous effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above specification, immediately suspend the release of radioactive gaseous effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 4-3. Exert best efforts to return the instrument to OPERABLE status within 30 days and, additionally, if the inoperable instrument(s) remain inoperable for greater than 30 days, explain in the next Annual Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner.
- c. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE and either the appropriate ACTION items in Table 4-3 not taken or the necessary surveillances not performed at the specified frequency prescribed in Table 4-4, perform an evaluation based on the significance of the event in accordance with the site Corrective Action Program.

#### SURVEILLANCE REQUIREMENTS

- .1 Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table 4-4.

TABLE 4-3

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT***</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
1. WASTE GAS HOLDUP SYSTEM			
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release - 2/3RT-7808, or 3RT-7865-1	1	*	35
b. Process Flow Rate Monitoring Device	1	*	36a
2. CONDENSER EVACUATION SYSTEM			
a. Noble Gas Activity Monitor - 2(3)RT-7818, or 2(3)RT-7870-1	1	**	37
b. Iodine Sampler	1	**	40
c. Particulate Sampler	1	**	40
d. Associated P&I Sample Flow Measuring Device	1	**	36b
e. Process Flow Rate Monitoring Device	1(1)	**	36a
3. PLANT VENT STACK			
a. Noble Gas Activity Monitor - 2/3RT-7808, or 2RT-7865-1 <u>and</u> 3RT-7865-1	1(2)	*	37
b. Iodine Sampler	1(2)	*	40
c. Particulate Sampler	1(2)	*	40
d. Associated P&I Sample Flow Measuring Device	1(2)	*	36b
e. Process Flow Rate Monitoring Device - 2/3RT-7808, or 2RT-7865-1 <u>and</u> 3RT-7865-1	1	*	36a
4. CONTAINMENT PURGE SYSTEM			
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release - 2(3)RT-7828, or 2(3)RT-7865-1	1	*	38
b. Iodine Sampler	1	*	40
c. Particulate Sampler	1	*	40
d. Associated P&I Sample Flow Measuring Device	1	*	36b
e. Process Flow Rate Monitoring Device	1	*	36a
5. DATA ACQUISITION SYSTEM (CONTROL ROOM ALARM ANNUNCIATION)	1	*	42

TABLE 4-3 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT***</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
6. SOUTH YARD FACILITY (SYF) WORK AREA SYFRU-7904			
a. Iodine Sampler	1	*	40
b. Particulate Sampler	1	*	40
c. Associated P&I Sample Flow Measuring Device	1	*	41b
d. Process Flow Rate Monitoring Device	1	*	41a
7. SOUTH YARD FACILITY (SYF) DECONTAMINATION UNIT SYFRU-7905			
a. Iodine Sampler	1	*	40
b. Particulate Sampler	1	*	40
c. Associated P&I Sample Flow Measuring Device	1	*	41b
d. Process Flow Rate Monitoring Device	1	*	41a

TABLE 4-3 (Continued)

TABLE NOTATION

- \* At all times.
  - \*\* MODES 1-4 with any main steam isolation valve and/or any main steam isolating bypass valve not fully closed.
  - \*\*\* Monitor Recorders are not required for the Operability of the monitor, providing the inoperable recorder does not cause the monitor to become inoperable (i.e., feedback signal). As long as the monitor has indication, alarm capability (if applicable), proper response (based on surveillance requirements) and isolation function (if applicable), the loss of the recorder does not render the monitor inoperable.
- (1) 2(3)RT-7818 is not equipped to monitor process flow. If another means of continuously monitoring process flow is not available, then comply with ACTION 36.
  - (2) Due to unequal mixing in the Plant Vent Stack, both 2RT-7865-1 and 3RT-7865-1 are required to be operable when 2/3RT-7808 is inoperable.
- ACTION 35 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment provided that prior to initiating the release:
- a. At least two independent samples of the tank's contents are analyzed, and
  - b. At least two technically qualified members of the Facility Staff independently verify the release rate calculations and discharge valve lineup;
- Otherwise, suspend releases of radioactive effluents via this pathway.

TABLE 4-3 (Continued)

TABLE NOTATION

- ACTION 36 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided:
- a. The process flow rate is estimated at least once per 12 hours during actual releases. In addition, a new flow estimate shall be made within 1 hour after a change that affects process flow has been completed. System design characteristics may be used to estimate process flow.
  - b. The particulate and iodine (P&I) sample flow rate is estimated or verified at least once per 12 hours during actual releases.
- ACTION 37 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are taken at least once per 12 hours and these samples are analyzed for gross activity within 24 hours.
- ACTION 38 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, immediately suspend PURGING of radioactive effluents via this pathway.
- ACTION 40 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the effected pathway may continue provided samples are continuously collected with auxiliary sampling equipment as required in Table 2-1.
- ACTION 41 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided:
- a. The process flow rate is estimated at least once per 12 hours during times of building occupation. System design characteristics may be used to estimate flow.
  - b. The particulate and iodine (P&I) sample flow rate is estimated at least once per 12 hours during times of building occupation.
- ACTION 42 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the monitor is verified operable by performing a channel check at least once per 4 hours during actual releases.

TABLE 4-4

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT***</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNELS CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODE FOR WHICH SURVEILLANCE IS REQUIRED</u>
1. WASTE GAS HOLDUP SYSTEM					
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release - 2/3RT-7808, 3RT-7865-1	P	P	R(3)	Q(1)	*
b. Process Flow Rate Monitoring Device	P	NA	R	Q	*
2. CONDENSER EVACUATION SYSTEM					
a. Noble Gas Activity Monitor - 2(3)RT-7818, 2(3)RT-7870-1	D	M	R(3)	Q(2)	**
b. Iodine Sampler	W	NA	NA	NA	**
c. Particulate Sampler	W	NA	NA	NA	**
d. Associated Sample Flow Measuring Device	D	NA	R	Q	**
e. Process Flow Rate Monitoring Device (2(3)RT-7870-1)	D	NA	R	Q	**

TABLE 4-4 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT***</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNELS CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODE FOR WHICH SURVEILLANCE IS REQUIRED</u>
3. PLANT VENT STACK					
a. Noble Gas Activity Monitor - 2/3RT-7808, 2RT-7865-1, 3RT-7865-1	D	M	R(3)	Q(2)	*
b. Iodine Sampler	W	NA	NA	NA	*
c. Particulate Sampler	W	NA	NA	NA	*
d. Associated Sample Flow Measuring Device	D	NA	R	Q	*
e. Process Flow Rate Monitoring Device	D	NA	R	Q	*
4. CONTAINMENT PURGE SYSTEM					
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release - 2(3)RT-7828, 2(3)RT-7865-1	D	P(4)	R(3)	Q(1)	*
b. Iodine Sampler	W	NA	NA	NA	*
c. Particulate Sampler	W	NA	NA	NA	*
d. Process Flow Rate Monitoring Device	D	NA	R	Q	*
e. Associated Sample Flow Measuring Device	D	NA	R	Q	*

TABLE 4-4 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT***</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNELS CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODE FOR WHICH SURVEILLANCE IS REQUIRED</u>
5. SOUTH YARD FACILITY (SYF) WORK AREA					
a. Iodine Sampler	W	NA	NA	NA	*
b. Particulate Sampler	W	NA	NA	NA	*
c. Process Flow Rate Monitoring Device	D(5)	NA	R	Q	*
d. Associated Sample Flow Measuring Device	D(5)	NA	R	Q	*
6. SOUTH YARD FACILITY (SYF) DECONTAMINATION UNIT					
a. Iodine Sampler	W	NA	NA	NA	*
b. Particulate Sampler	W	NA	NA	NA	*
c. Process Flow Rate Monitoring Device	D(6)	NA	R	Q	*
d. Associated Sample Flow Measuring Device	D(6)	NA	R	Q	*

NOTE: For 5 and 6, ECP 030100131 abandons the MGP radiation monitors and installs flow meters. This section applies to the flow meters and will take effect when ECP turnover is complete.

TABLE 4-4 (Continued)

TABLE NOTATION

- \* At all times.
  - \*\* Modes 1-4 with any main steam isolation valve and/or any main steam isolating bypass valve not fully closed.
  - \*\*\* Monitor Recorders are not required for the Operability of the monitor, providing the inoperable recorder does not cause the monitor to become inoperable (i.e., feedback signal). As long as the monitor has indication, alarm capability (if applicable), proper response (based on surveillance requirements) and isolation function (if applicable), the loss of the recorder does not render the monitor inoperable.
- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate verification of effluent path isolation actuation signal, automatic pathway isolation†, and Control Room alarm annunciation if any of the following conditions exist:

1. Instrument indicates measured levels above the alarm/trip setpoint.
2. Circuit failure.

† Automatic pathway isolation is tested on a once per refueling interval.

† The main containment purge isolation valves are required to be tested in Mode 5 prior to performing initial core alterations. Containment purge valves are not required to be tested for automatic isolation in the event of a mid-cycle outage.

Down scale failure testing is bounded by administrative limitation on monitor setpoints which ensure monitor alarm and release termination occur prior to reaching the level of monitor saturation.

If the instrument controls are not set in the operate mode, procedures shall call for declaring the channel inoperable.

- (2) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exist:

1. Instrument indicates measured levels above the alarm setpoint.
2. Circuit failure.

Down scale failure testing is bounded by administrative limitation on monitor setpoints which ensure monitor alarm and release termination occur prior to reaching the level of monitor saturation.

If the instrument controls are not set in the operate mode, procedures shall call for declaring the channel inoperable.

TABLE 4-4 (Continued)

TABLE NOTATION (Continued)

- (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATIONS, sources that have been related to the initial calibration shall be used.
- (4) Prior to each release and at least once per month.
- (5) Daily checks only required during times of building occupation.
- (6) CHANNEL CHECK required by Health Physics daily for each day that the CO<sub>2</sub> Decontamination Unit is used.

### 4.3 OPERABILITY OF RADIOACTIVE WASTE EQUIPMENT

The flow diagrams defining the treatment paths and the components of the radioactive liquid, gaseous and solid waste management systems are shown in Figures 4-5 thru 4-7.

FIGURE 4-5 SONGS RADIOACTIVE LIQUID WASTE TREATMENT SYSTEMS



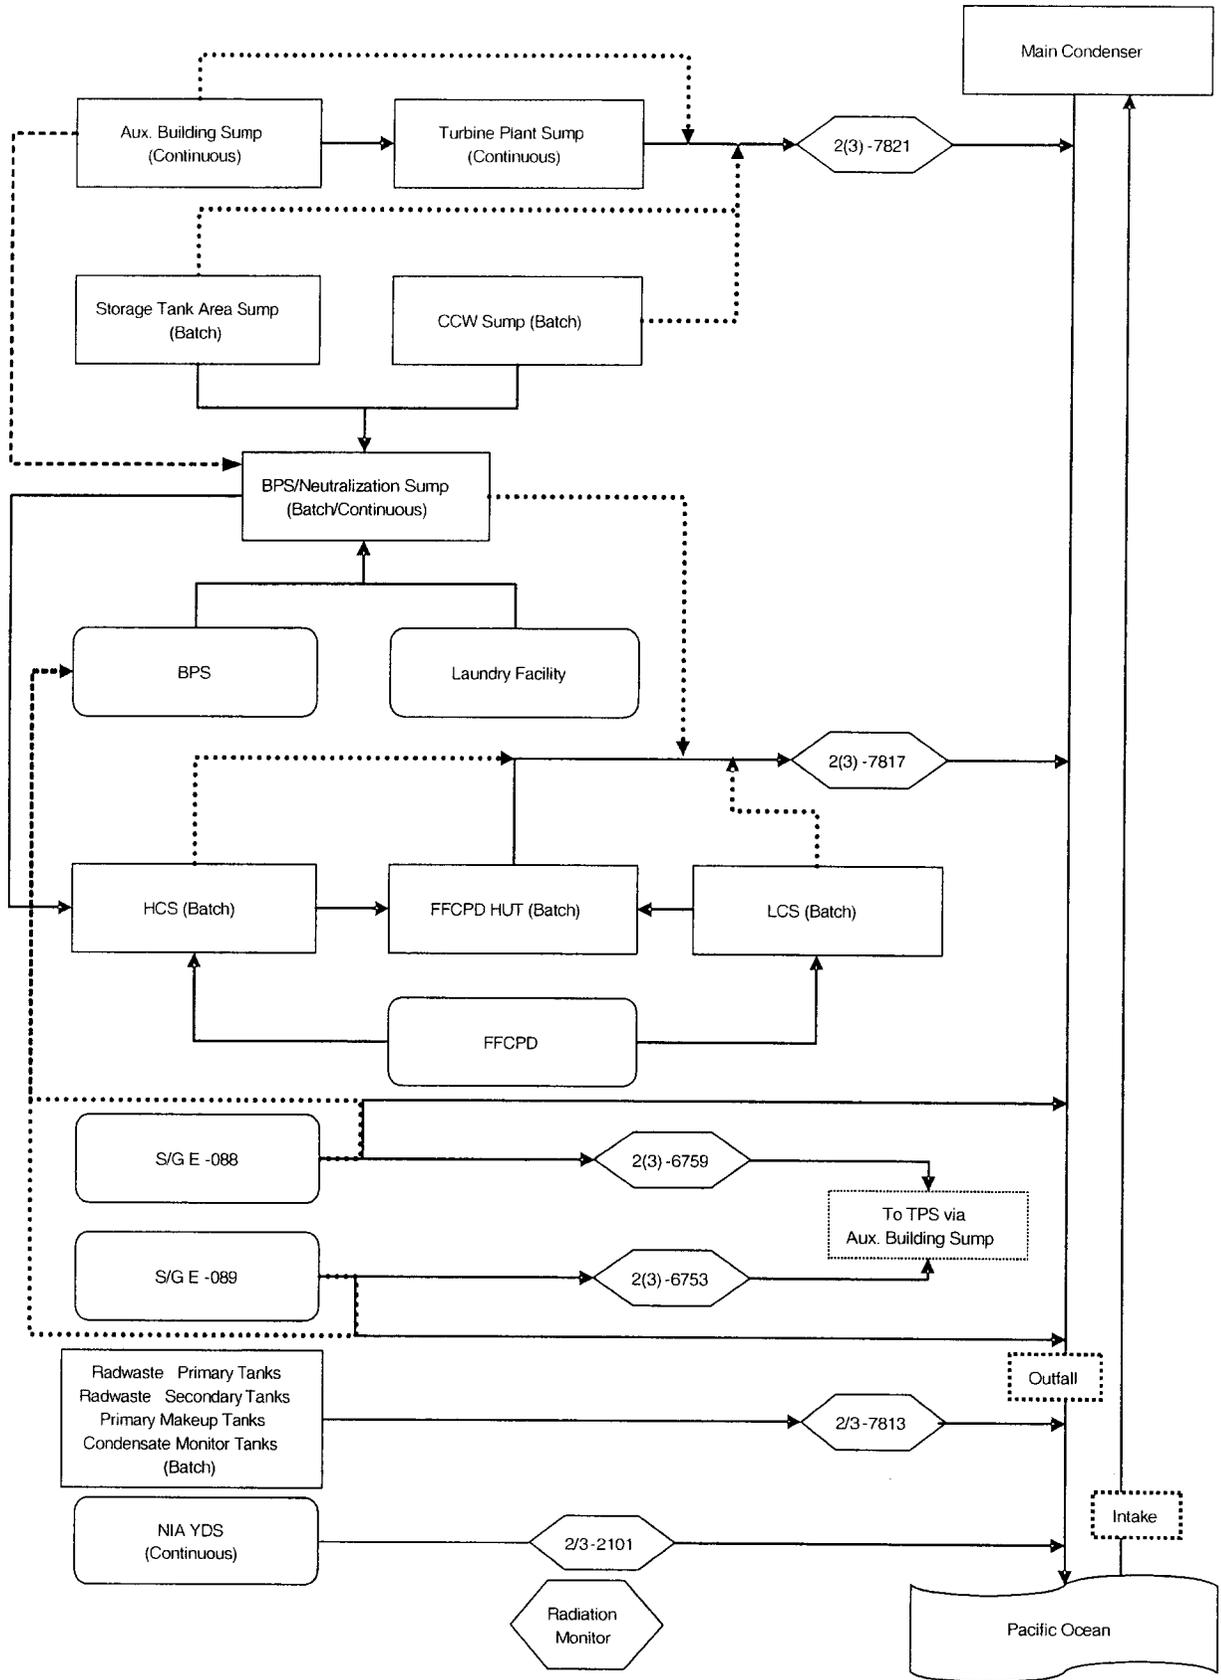


FIGURE 4-6 SONGS RADIOACTIVE GASEOUS WASTE TREATMENT SYSTEMS

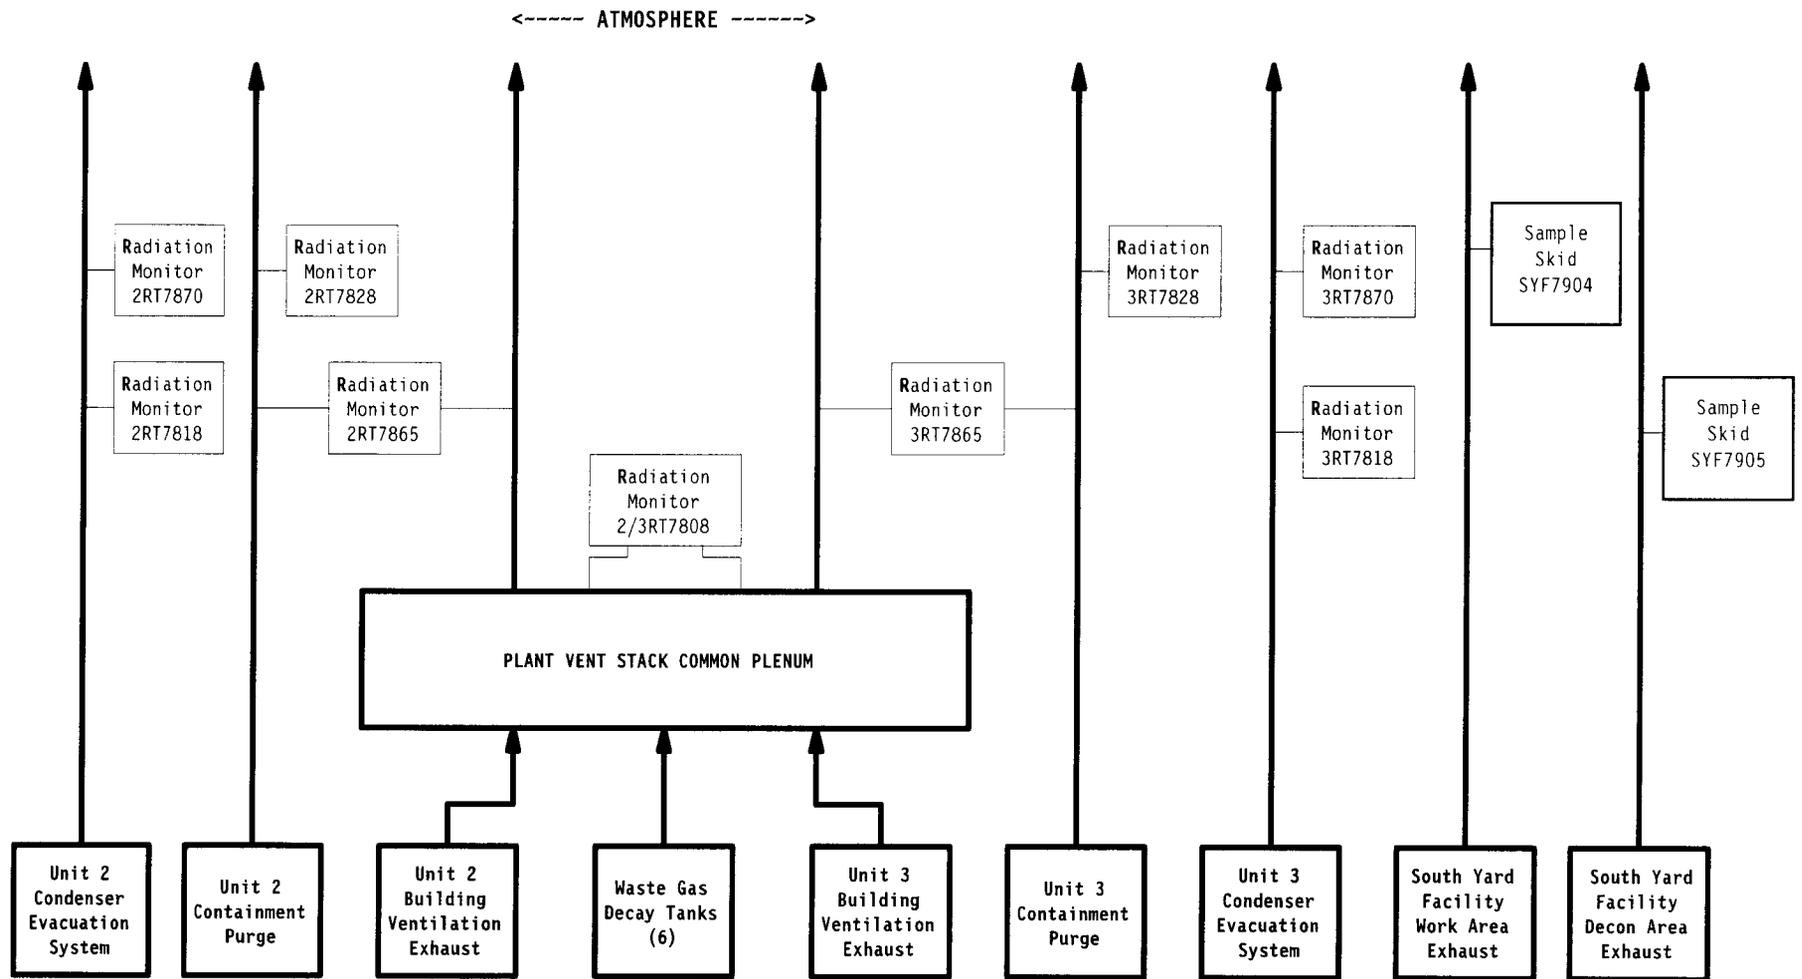

2(3)RT-7865-1 can be aligned to either containment purge or the plant vent stack

FIGURE 4-7 SOLID WASTE HANDLING

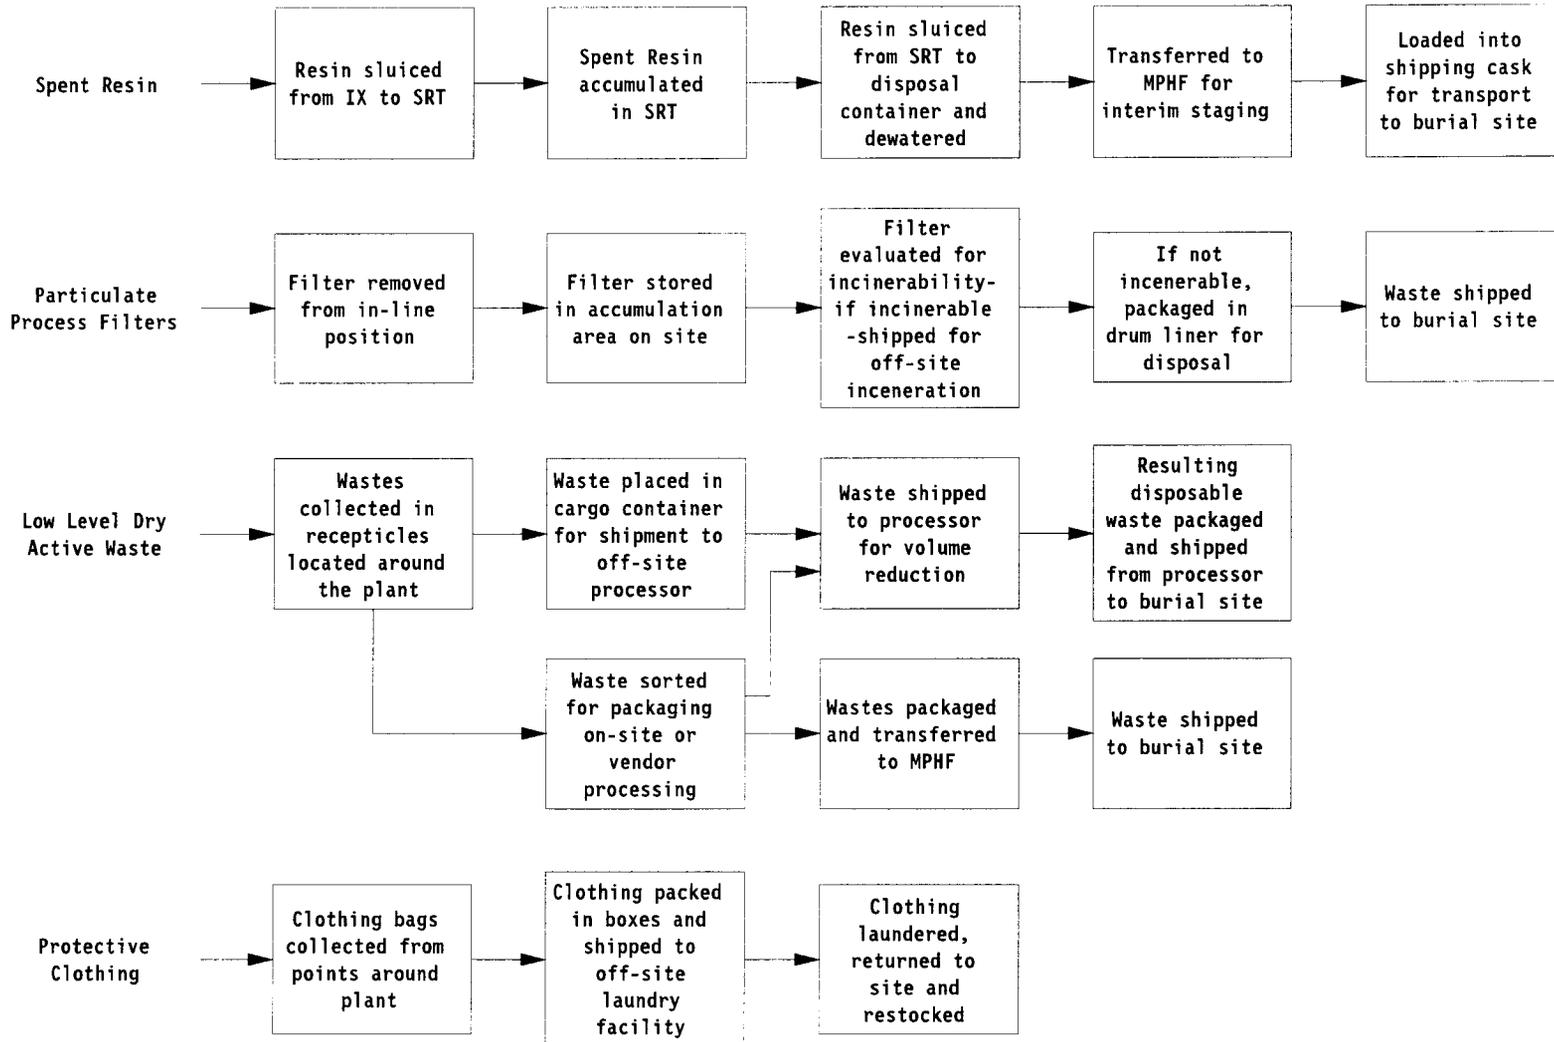

LEGEND:  
 SRT: Spent Resin Tank  
 MPH: Multi Purpose Handling Facility  
 IX: Ion Exchanger

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING

### 5.1 Monitoring Program

#### SPECIFICATION

5.1.1 The radiological environmental monitoring program shall be conducted as specified in Table 5-1. The requirements are applicable at all times.

APPLICABILITY: At all times

#### ACTION:

- a. Should the radiological environmental monitoring program not be conducted as specified in Table 5-1, in lieu of any other report required by Technical Specification Section 5.7.1 and LCS 5.0.104, prepare and submit to the Commission, in the Annual Radiological Environmental Operating Report (see Section 5.4), a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.
- b. Should the level of radioactivity in an environmental sampling medium exceed the reporting levels of Table 5-2 when averaged over any calendar quarter, in lieu of any other report required by Technical Specification Section 5.7.1 and LCS 5.0.104, prepare and submit to the Commission, within 30 days from the end of the affected calendar quarter a Report pursuant to 10 CFR 50.73. When more than one of the radionuclides in Table 5-2 are detected in the sampling medium, this report shall be submitted if:  
$$\frac{\text{concentration (1)}}{\text{limit level (1)}} + \frac{\text{concentration (2)}}{\text{limit level (2)}} + \dots \geq 1.0$$
- c. When radionuclides other than those in Table 5-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose to an individual is equal to or greater than the calendar year limits of Specification(s) 1.2.1, 2.2.1 or 2.3.1, as appropriate. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report (see Section 5.4).

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING (Continued)

### ACTION: (Continued)

- d. With fresh leafy vegetable samples or fleshy vegetable samples unavailable from one or more of the sample locations required by Table 5-1, identify specific locations for obtaining replacement samples and add them within 30 days to the Radiological Environmental Monitoring Program given in the ODCM. The specific locations from which samples were unavailable may then be deleted from the monitoring program. Pursuant to Technical Specification 5.7.1, submit in the next Annual Radioactive Effluent Release Report documentation for a change in the ODCM including a revised figure(s) and table for the ODCM reflecting the new location(s) with supporting information identifying the cause of the unavailability of samples and justifying the selection of the new location(s) for obtaining samples.

### SURVEILLANCE REQUIREMENTS

- .1 The radiological environmental monitoring samples shall be collected pursuant to Table 5-1 from the locations given in Table 5-4 and Figures 5-1 through 5-5 and shall be analyzed pursuant to the requirements of Tables 5-1 and 5-3.

TABLE 5-1

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

<u>Exposure Pathway and/or Sample</u>	<u>Number of Samples and Sample Locations<sup>a</sup></u>	<u>Sampling and Collection Frequency<sup>a</sup></u>	<u>Type and Frequency of Analyses</u>
1. AIRBORNE Radioiodine and Particulates	<p>Samples from at least 5 locations</p> <p>3 samples from offsite locations (in different sectors) of the highest calculated annual average ground level D/Q.</p> <p>1 sample from the vicinity of a community having the highest calculated annual average ground-level D/Q.</p> <p>1 sample from a control location 15-30 km (10-20 miles) distant and in the least prevalent wind direction<sup>c</sup></p>	Continuous operation of sampler with sample collection as required by dust loading, but at least once per 7 days. <sup>d</sup>	<p>Radioiodine cartridge. Analyze at least once per 7 days for I-131. Particulate sampler. Analyze for gross beta radioactivity <math>\geq</math> 24 hours following filter change. Perform gamma isotopic<sup>b</sup> analysis on each sample when gross beta activity is <math>&gt;</math> 10 times the yearly mean of control samples. Perform gamma isotopic analysis on composite (by location) sample at least once per 92 days.</p>
2. DIRECT RADIATION <sup>e</sup>	At least 30 locations including an inner ring of stations in the general area of the site boundary and an outer ring approximately in the 4 to 5 mile range from the site with a station in each sector of each ring. The balance of the stations is in special interest areas such as population centers, nearby residences, schools, and in 2 or 3 areas to serve as control stations.	At least once per 92 days.	Gamma dose. At least once per 92 days.

TABLE 5-1 (Continued)

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

<u>Exposure Pathway and/or Sample</u>	<u>Number of Samples and Sample Locations<sup>a</sup></u>	<u>Sampling and Collection Frequency<sup>a</sup></u>	<u>Type and Frequency of Analyses</u>
3. WATERBORNE			
a. Ocean	4 locations	At least once per month and composited <sup>f</sup> quarterly	Gamma isotopic analysis of each monthly sample. Tritium analysis of composite sample at least once per 92 days.
b. Drinking <sup>g</sup>	2 locations	Monthly at each location.	Gamma isotopic and tritium analyses of each sample.
c. Sediment	4 locations from Shoreline	At least once per 184 days.	Gamma isotopic analysis of each sample.
d. Ocean	5 locations Bottom Sediments	At least once per 184 days.	Gamma isotopic analysis of each sample.

TABLE 5-1 (Continued)

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

<u>Exposure Pathway and/or Sample</u>	<u>Number of Samples and Sample Locations<sup>a</sup></u>	<u>Sampling and Collection Frequency<sup>a</sup></u>	<u>Type and Frequency of Analyses</u>
4. INGESTION			
a. Nonmigratory Marine Animals	3 locations	One sample in season, or at least once per 184 days if not seasonal. One sample of each of the following species: 1. Fish-2 adult species such as perch or sheephead. 2. Crustaceae-such as crab or lobster. 3. Mollusks-such as limpets, seahares or clams.	Gamma isotopic analysis on edible portions.
b. Local Crops	2 locations	Representative vegetables, normally 1 leafy and 1 fleshy collected at harvest time. At least 2 vegetables collected semiannually from each location.	Gamma isotopic analysis on edible portions semiannually and I-131 analysis for leafy crops.

TABLE 5-1 (Continued)

**TABLE NOTATION**

- a. Sample locations are indicated on Figures 5-1 through 5-5.
- b. Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.
- c. The purpose of this sample is to obtain background information. If it is not practical to establish control locations in accordance with the distance and wind direction criteria, other sites which provide valid background data may be substituted.
- d. Canisters for the collection of radioiodine in air are subject to channeling. These devices should be carefully checked before operation in the field or several should be mounted in series to prevent loss of iodine.
- e. Regulatory Guide 4.13 provides minimum acceptable performance criteria for thermoluminescence dosimetry (TLD) systems used for environmental monitoring. One or more instruments, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. For the purpose of this table, a thermoluminescent dosimeter may be considered to be one phosphor and two or more phosphors in a packet may be considered as two or more dosimeters. Film badges should not be used for measuring direct radiation.
- f. Composite samples should be collected with equipment (or equivalent) which is capable of collecting an aliquot at time intervals which are very short (e.g., hourly) relative to the compositing period (e.g., monthly).
- g. No drinking water pathway exists at SONGS.

TABLE 5-2

**REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES**

Reporting Levels

Analysis	Water (pCi/l)	Airborne Particulate or Gases (pCi/m <sup>3</sup> )	Marine Animals (pCi/Kg, wet)	Local Crops (pCi/Kg, wet)
H-3	2 x 10 <sup>4(a)</sup>			
Mn-54	1 x 10 <sup>3</sup>		3 x 10 <sup>4</sup>	
Fe-59	4 x 10 <sup>2</sup>		1 x 10 <sup>4</sup>	
Co-58	1 x 10 <sup>3</sup>		3 x 10 <sup>4</sup>	
Co-60	3 x 10 <sup>2</sup>		1 x 10 <sup>4</sup>	
Zn-65	3 x 10 <sup>2</sup>		2 x 10 <sup>4</sup>	
Zr-95, Nb-95	4 x 10 <sup>2</sup>			
I-131	2 <sup>(b)</sup>	0.9		1 x 10 <sup>2</sup>
Cs-134	30	10	1 x 10 <sup>3</sup>	1 x 10 <sup>3</sup>
Cs-137	50	20	2 x 10 <sup>3</sup>	2 x 10 <sup>3</sup>
Ba-140, La-140	2 x 10 <sup>2</sup>			

- (a) For drinking water samples. This is 40 CFR Part 141 value. If no drinking water pathway exists, a value of 30,000 pCi/l may be used.
- (b) If no drinking water pathway exists, a value of 20 pCi/l may be used.

TABLE 5-3

DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS<sup>c</sup>MAXIMUM VALUES FOR THE LOWER LIMITS OF DETECTION (LLD)<sup>a</sup>

Analysis	Water (pCi/l)	Airborne Particulate or Gases (pCi/m <sup>3</sup> )	Marine Animals (pCi/Kg, wet)	Local Crops (pCi/Kg, wet)	Sediment (pCi/Kg, dry)
gross beta	4	1 x 10 <sup>-2</sup>			
H-3	2000 <sup>(b)</sup>				
Mn-54	15		130		
Fe-59	30		260		
Co-58, 60	15		130		
Zn-65	30		260		
Zr-95, Nb-95	15				
I-131	1 <sup>(d)</sup>	7 x 10 <sup>-2</sup>		60	
Cs-134	15	5 x 10 <sup>-2</sup>	130	60	150
Cs-137	18	6 x 10 <sup>-2</sup>	150	80	180
Ba-140, La-140	15				

TABLE 5-3 (Continued)

TABLE NOTATION

- a. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

where:

LLD is the "a priori" lower limit of detection as defined above (as microcurie per unit mass or volume),

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

V is the sample size (in units of mass or volume),

$2.22 \times 10^6$  is the number of transformations per minute per microcurie,

Y is the fractional radiochemical yield (when applicable),

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  is the elapsed time between midpoint of sample collection or end of the collection period and time of counting (for environmental samples, not plant effluents ).

The value of  $s_b$  used in the calculation of the LLD for a detection system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. In calculating the LLD for a radionuclide determined by gamma-ray spectrometry, the background shall include the typical contributions of other radionuclides normally present in the samples (e.g., potassium-40 in milk samples). Typical values of E,V,Y and  $\Delta t$  shall be used in the calculations.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of the measurement system and not as a posteriori (after the fact) limit for a particular measurement.\*

\*For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HASL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" Anal. Chem. 40, 586-93 (1968).

TABLE 5-3 (Continued)

TABLE NOTATION

- b. If no drinking water pathway exists, a value of 3000 pCi/l may be used.
- c. Other peaks which are measurable and identifiable, together with the radionuclides in Table 5-3, shall be identified and reported.
- d. If no drinking water pathway exists, a value of 15 pCi/l may be used.

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING (Continued)

### 5.2 LAND USE CENSUS

#### SPECIFICATION

- 5.2.1 A land use census shall be conducted and shall identify the location of the nearest milk animal, the nearest residence and the nearest garden\* of greater than 500 square feet producing fresh leafy vegetables in each of the 16 meteorological sectors within a distance of five miles.

APPLICABILITY: At all times

#### ACTION:

- a. With the land use census identifying a location(s) that yields a calculated dose or dose commitment greater than the values currently being calculated in Specification 2.3.1, pursuant to Technical Specification 5.7.1, identify the new locations in the next Annual Radioactive Effluent Release Report.
- b. With the land use census identifying a location(s) that yields a calculated dose or dose commitment (via the same exposure pathway) 20 percent greater than at a location from which samples are currently being obtained in accordance with Specification 5.1, add the new location within 30 days to the Radiological Environmental Monitoring Program given in the ODCM. The sampling location(s), excluding the control station location, having the lowest calculated dose or dose commitment(s) via the same exposure pathway, may be deleted from this monitoring program after October 31, of the year in which this Land Use Census was conducted. Pursuant to Technical Specification 5.7.1, submit in the next Annual Radioactive Effluent Release Report documentation for a change in the ODCM including a revised figure(s) and table(s) for the ODCM reflecting the new location(s) with information supporting the change in sampling locations.

#### SURVEILLANCE REQUIREMENTS

- .1 The land use census shall be conducted at least once per 12 months between the dates of June 1 and October 1 using that information which will provide the best results, such as by a door-to-door survey, aerial survey, or by consulting local agriculture authorities.

\*Broad leaf vegetation sampling may be performed at the site boundary in the direction sector with the highest D/Q in lieu of the garden census.

5.0 **RADIOLOGICAL ENVIRONMENTAL MONITORING** (Continued)

5.3 INTERLABORATORY COMPARISON PROGRAM

SPECIFICATION

- 5.3.1 Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program that complies with Regulatory Guide 4.15.

APPLICABILITY: At all times

ACTION:

- a. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report.

SURVEILLANCE REQUIREMENTS

- .1 A summary of the results obtained as part of the above required Interlaboratory Comparison Program and in accordance with Section 5.4.1 of this document shall be included in the Annual Radiological Environmental Operating Report (see Section 5.4).

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING (Continued)

### 5.4 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT\*

5.4.1 The annual radiological environmental operating reports shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison with preoperational studies, operational controls (as appropriate), and previous environmental surveillance reports and an assessment of the observed impacts of the plant operation on the environment. The reports shall also include the results of land use censuses required by Section 5.2. If harmful effects or evidence of irreversible damage are detected by the monitoring, the report shall provide an analysis of the problem and a planned course of action to alleviate the problem.

The annual radiological environmental operating reports shall include summarized and tabulated results in the Radiological Assessment Branch Technical Position, Revision 1, November 1979 of all radiological environmental samples taken during the report period. In the event that some results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as possible in a supplementary report.

The reports shall also include the following: a summary description of the radiological environmental monitoring program; a map of all sampling locations keyed to a table giving distances and directions from the mid-point of reactor Units 2 and 3; and the results of licensee participation in the Interlaboratory Comparison Program, required by Section 5.3.

\* A single submittal may be made for a multiple unit station, combining those sections that are common to all units at the station.

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING (Continued)

### 5.5 SAMPLE LOCATIONS

The Radiological Environmental Monitoring Sample Locations are identified in Figures 5-1 through 5-5. These sample locations are described in Table 5-4 and indicate the distance in miles and the direction, determined from degrees true north, from the center of the Units 2 and 3 building complex. Table 5-6 gives the sector and direction designation for the Radiological Environmental Monitoring Sample Location on Map, Figures 5-1 through 5-5.

**TABLE 5-4****RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS**

<u>TYPE OF SAMPLE AND SAMPLING LOCATION***</u>	<u>DISTANCE*</u> (miles)	<u>DIRECTION*</u>
<b>Direct Radiation</b>		
1 City of San Clemente (Former SDG&E Offices)	5.7	NW
2 Camp San Mateo (MCB, Camp Pendleton)	3.5	N
3 Camp San Onofre (MCB, Camp Pendleton)	2.6	NE
4 Camp Horno (MCB, Camp Pendleton)	4.5	E
6 Old Route 101 (East-Southeast)	3.0	ESE
8 Noncommissioned Officers' Beach Club	1.4	NW
10 Bluff (Adjacent to PIC #1)	0.7	WNW
11 Former Visitors' Center	0.4**	NW
12 South Edge of Switchyard	0.2**	E
13 Southeast Site boundary (Bluff)	0.4**	ESE
15 Southeast Site Boundary (Office Building)	0.1**	SSE
16 East Southeast Site Boundary	0.4**	ESE
17 Transit Dose	-	-
18 Transit Dose	-	-
19 San Clemente Highlands	5.0	NNW
22 Former U.S. Coast Guard Station - San Mateo Point	2.7	WNW
23 SDG&E Service Center Yard	8.1	NW

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* Distances are within the Units 2 and 3 Site Boundary (0.4 mile in all sectors) and not required by Technical Specification.

\*\*\* MCB - Marine Corps Base PIC - Pressurized Ion Chamber

**TABLE 5-4****RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS**

TYPE OF SAMPLE AND SAMPLING LOCATION***	DISTANCE* (miles)	DIRECTION*
<b>Direct Radiation</b> (Continued)		
31 Aurora Park-Mission Viejo	18.6	NNW
33 Camp Talega (MCB, Camp Pendleton)	5.7	N
34 San Onofre School (MCB, Camp Pendleton)	1.9	NW
35 Range 312 (MCB, Camp Pendleton)	4.7	NNE
36 Range 208C (MCB, Camp Pendleton)	4.2	NE
38 San Onofre State Beach Park	3.3	SE
40 SCE Training Center - Mesa (Adjacent to PIC #3)	0.7	NNW
41 Old Route 101 - East	0.3**	E
44 Fallbrook Fire Station	17.7	E
46 San Onofre State Beach Park	0.9	SE
47 Camp Las Flores (MCB, Camp Pendleton)	8.6	SE

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* Distances are within the Units 2 and 3 Site Boundary (0.4 mile in all sectors) and not required by Technical Specification.

\*\*\* MCB - Marine Corps Base PIC - Pressurized Ion Chamber

**TABLE 5-4****RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS**

TYPE OF SAMPLE AND SAMPLING LOCATION***	DISTANCE* (miles)	DIRECTION*
<b>Direct Radiation (Continued)</b>		
49 Camp Chappo (MCB, Camp Pendleton)	12.8	ESE
50 Oceanside Fire Station (CONTROL)	15.6	SE
53 San Diego County Operations Center	44.3	SE
54 Escondido Fire Station	31.8	ESE
55 San Onofre State Beach (Unit 1, West)	0.2**	W
56 San Onofre State Beach (Unit 1, West)	0.2**	W
57 San Onofre State Beach (Unit 2)	0.1**	WSW
58 San Onofre State Beach (Unit 3)	0.1**	S
59 SONGS Meteorological Tower	0.3**	WNW
60 Transit Control Storage Area	-	-
61 Mesa - East Boundary (Adjacent to PIC #4)	0.7	N
62 MCB - Camp Pendleton (Adjacent to PIC #5)	0.6	NNE
63 MCB - Camp Pendleton (Adjacent to PIC #6)	0.6	NE
64 MCB - Camp Pendleton (Adjacent to PIC #7)	0.6	ENE
65 MCB - Camp Pendleton (Adjacent to PIC #8)	0.7	E
66 San Onofre State Beach (Adjacent to PIC #9)	0.6	ESE
67 Former SONGS Evaporation Pond (Adjacent to PIC #2)	0.6	NW
68 Range 210C (MCB, Camp Pendleton)	4.3	ENE
73 South Yard Facility	0.4**	ESE
Transit Control A	-	-
Transit control B	-	-
Fader (Co-Located with TLD # 54)****	31.8	ESE
74 Oceanside City Hall (Backup CONTROL)	15.6	SE
75 Gate 25 MCB	4.6	SE
76 El Camino Real Mobil Station	4.6	NW
77 Area 62 Heavy lift pad	4.3	N
78 Sheep Valley	4.4	ESE

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* Distances are within the Units 2 and 3 Site Boundary (0.4 mile in all sectors) and not required by Technical Specification.

\*\*\* MCB - Marine Corps Base PIC - Pressurized Ion Chamber

\*\*\*\* For fading correction due to significant increase in temperature.

**TABLE 5-4****RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS**

<u>TYPE OF SAMPLE AND SAMPLING LOCATION</u>		<u>DISTANCE*</u> <u>(miles)</u>	<u>DIRECTION*</u>
<b>Airborne</b>			
1	City of San Clemente (City Hall)	5.1	NW
7	AWS Roof	0.18**	NW
9	State Beach Park	0.6	ESE
10	Bluff	0.7	WNW
11	Mesa EOF	0.7	NNW
12	Former SONGS Evaporation Pond	0.6	NW
13	Marine Corps Base (Camp Pendleton East)	0.7	E
14	Mesa Medical Facility	0.7	NNW
15	Oceanside City Hall (CONTROL)	15.6	SE
<b>Soil Samples<sup>†</sup></b>			
1	Camp San Onofre	2.6	NE
2	Old Route 101 - (East Southeast)	3.0	ESE
3	Basilone Road/I-5 Freeway Offramp	2.0	NW
5	Former Visitor's Center	0.4**	NW
6	Oceanside (CONTROL)	16.0	SE
<b>Ocean Water</b>			
A	Station Discharge Outfall - Unit 1	0.6	SW
B	Outfall - Unit 2	1.5	SW
C	Outfall - Unit 3	1.2	SSW
D	Newport Beach (CONTROL)	30.0	NW

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* Distances are within the Units 2 and 3 Site boundary (0.4 mile in all sectors) and not required by Technical Specification.

<sup>†</sup> Soil Samples are not required by Technical Specifications.

**TABLE 5-4****RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS**

<u>TYPE OF SAMPLE AND SAMPLING LOCATION</u>		<u>DISTANCE*</u> <u>(miles)</u>	<u>DIRECTION*</u>
<b>Drinking Water</b>			
4	Camp Pendleton Drinking Water Reservoir	2.2	NNW
5	Oceanside City Hall (new CONTROL)	15.6	SE
<b>Shoreline Sediment (Beach Sand)</b>			
1	San Onofre State Beach (Southeast)	0.6	SE
2	San Onofre Surfing Beach	0.8	WNW
3	San Onofre State Beach (Southeast)	3.5	SE
4	Newport Beach (North End) (CONTROL)	29.2	NW
<b>Local Crops</b>			
1	San Clemente Ranch (San Mateo Canyon)	2.6	NW
2	Oceanside (CONTROL)**	15 to 25	SE to ESE
4	San Clemente Resident w/Garden	4.4	NW
6	SONGS Garden	0.4	NNW

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* Control location should be in Section G or F, 15 to 25 miles from site. The control location will be selected based on sample availability. The exact location shall be noted in the Annual Radiological Environmental Operating Report.

## RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS

TYPE OF SAMPLE AND SAMPLING LOCATION		DISTANCE* (miles)	DIRECTION*
<b>Non-Migratory Marine Animals</b>			
A	Unit 1 Outfall	0.9	WSW
B	Units 2 and 3 Outfall	1.5	SSW
C	Laguna Beach (CONTROL)**	15 to 150	WNW to NW
<b>Kelp<sup>†</sup></b>			
A	San Onofre Kelp Bed	1.5	S
B	San Mateo Kelp Bed	3.8	WNW
C	Barn Kelp Bed	6.3	SSE
D	DELETED		
E	Salt Creek (CONTROL)	11 to 13	WNW to NW
<b>Ocean Bottom Sediments</b>			
A	DELETED		
B	Unit 1 Outfall	0.8	SSW
C	Unit 2 Outfall	1.6	SW
D	Unit 3 Outfall	1.2	SSW
E	Laguna Beach (CONTROL)	18.2	NW
F	SONGS Upcoast	0.9	WSW

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* A location more distant from SONGS in the WNW to NW direction may be used as the CONTROL location.

† Kelp Samples are not required by Technical Specifications.

**TABLE 5-5**

**PIC - RADIOLOGICAL ENVIRONMENTAL MONITORING LOCATIONS**

PRESSURIZED ION CHAMBERS	Theta (Degrees)*	DISTANCE*		DIRECTION/SECTOR*	
		Meters	miles		
S1	San Onofre Beach	298°	1070	0.7	WNW P
S2	SONGS Former Evap. Pnd	313°	890	0.6	NW Q
S3	Japanese Mesa	340°	1150	0.7	NNW R
S4	MCB - Camp Pendleton	3°	1120	0.7	N A
S5	MCB - Camp Pendleton	19°	1050	0.6	NNE B
S6	MCB - Camp Pendleton	46°	940	0.6	NE C
S7	MCB - Camp Pendleton	70°	870	0.6	ENE D
S8	MCB - Camp Pendleton	98°	1120	0.7	E E
S9	San Onofre State Beach	121°	940	0.6	ESE F

\* Distance (meters/miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Theta direction is determined from degrees true north.

TABLE 5-6

**SECTOR AND DIRECTION DESIGNATION FOR RADIOLOGICAL  
ENVIRONMENTAL MONITORING SAMPLE LOCATION MAP**

DEGREES TRUE NORTH FROM SONGS 2 AND 3 MID-POINT			NOMENCLATURE	
<u>Sector Limit</u>	<u>Center Line</u>	<u>Sector Limit</u>	<u>22.5° Sector*</u>	<u>Direction</u>
348.75	0 & 360	11.25	A	N
11.25	22.5	33.75	B	NNE
33.75	45.0	56.25	C	NE
56.25	67.5	78.75	D	ENE
78.75	90.0	101.25	E	E
101.25	112.0	123.75	F	ESE
123.75	135.0	146.25	G	SE
146.25	157.0	168.75	H	SSE
168.75	180.0	191.25	J	S
191.25	202.5	213.75	K	SSW
213.75	225.0	236.25	L	SW
236.25	247.5	258.75	M	WSW
258.75	270.0	281.25	N	W
281.25	292.5	303.75	P	WNW
303.75	315.0	326.25	Q	NW
326.25	337.5	348.75	R	NNW

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true North.

Figure 5-1  
Radiological Environmental Monitoring Sample Locations  
1 Mile Radius


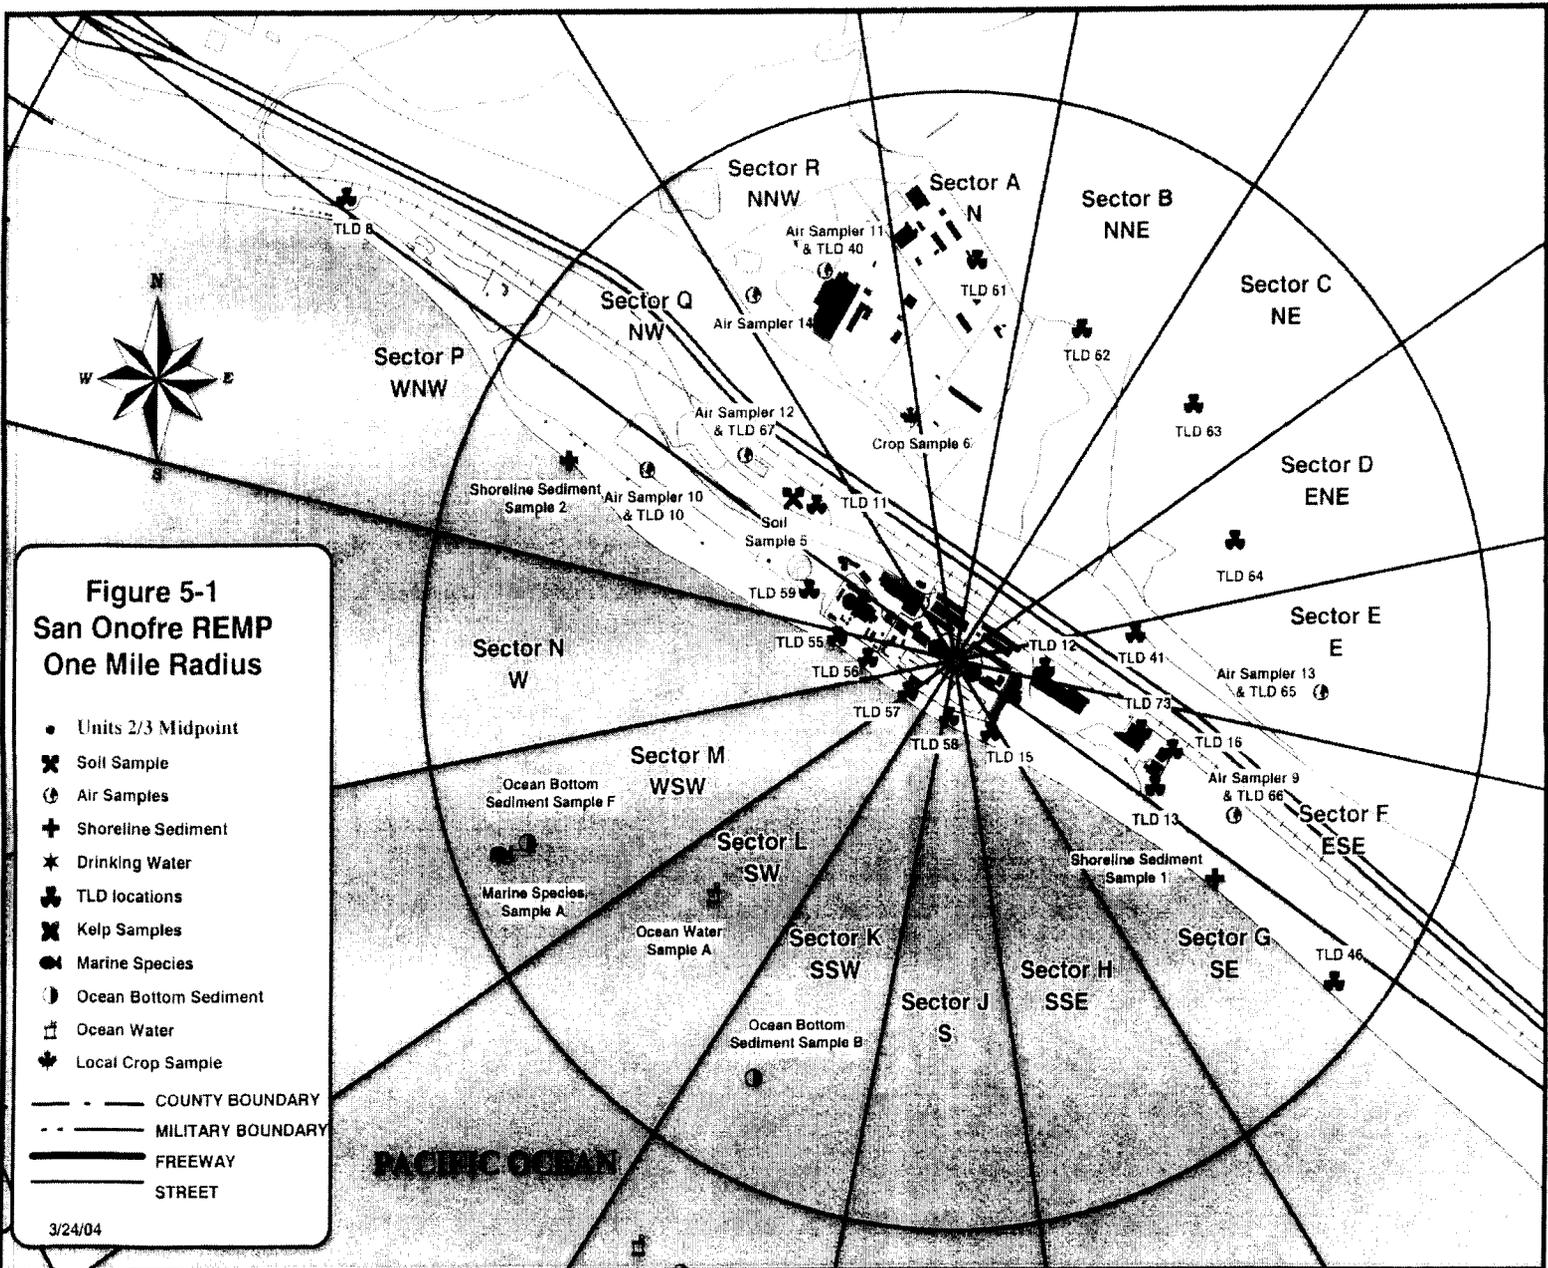


Figure 5-1  
San Onofre REMP  
One Mile Radius

- Units 2/3 Midpoint
- ✕ Soil Sample
- ⊕ Air Samples
- ⊕ Shoreline Sediment
- \* Drinking Water
- ♣ TLD locations
- ✕ Kelp Samples
- Marine Species
- ⊕ Ocean Bottom Sediment
- ⊕ Ocean Water
- ♣ Local Crop Sample
- COUNTY BOUNDARY
- MILITARY BOUNDARY
- == FREEWAY
- == STREET

3/24/04


Figure 5-2  
Radiological Environmental Monitoring Sample Locations  
2 Mile Radius

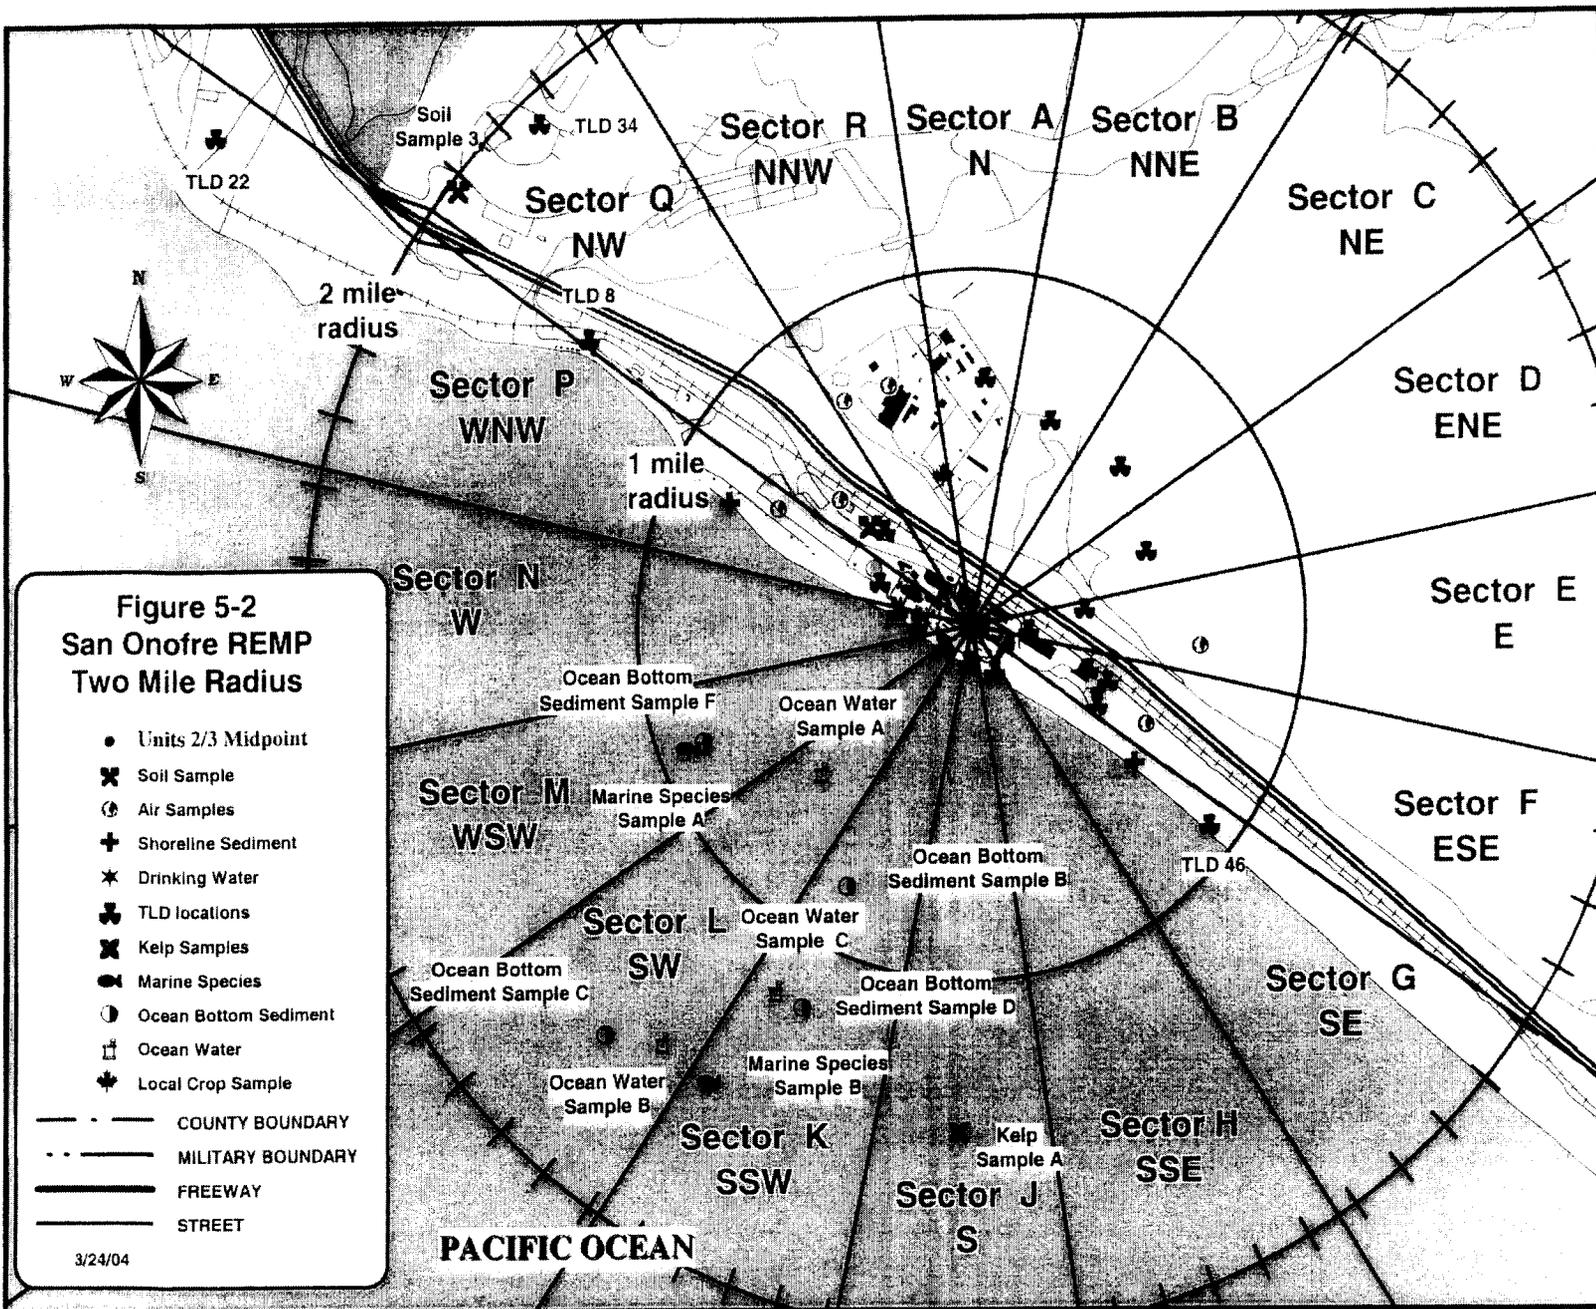

5-24

S0123-ODCM  
Revision 0  
02-27-07

Figure 5-3  
Radiological Environmental Monitoring Sample Locations  
5 Mile Radius

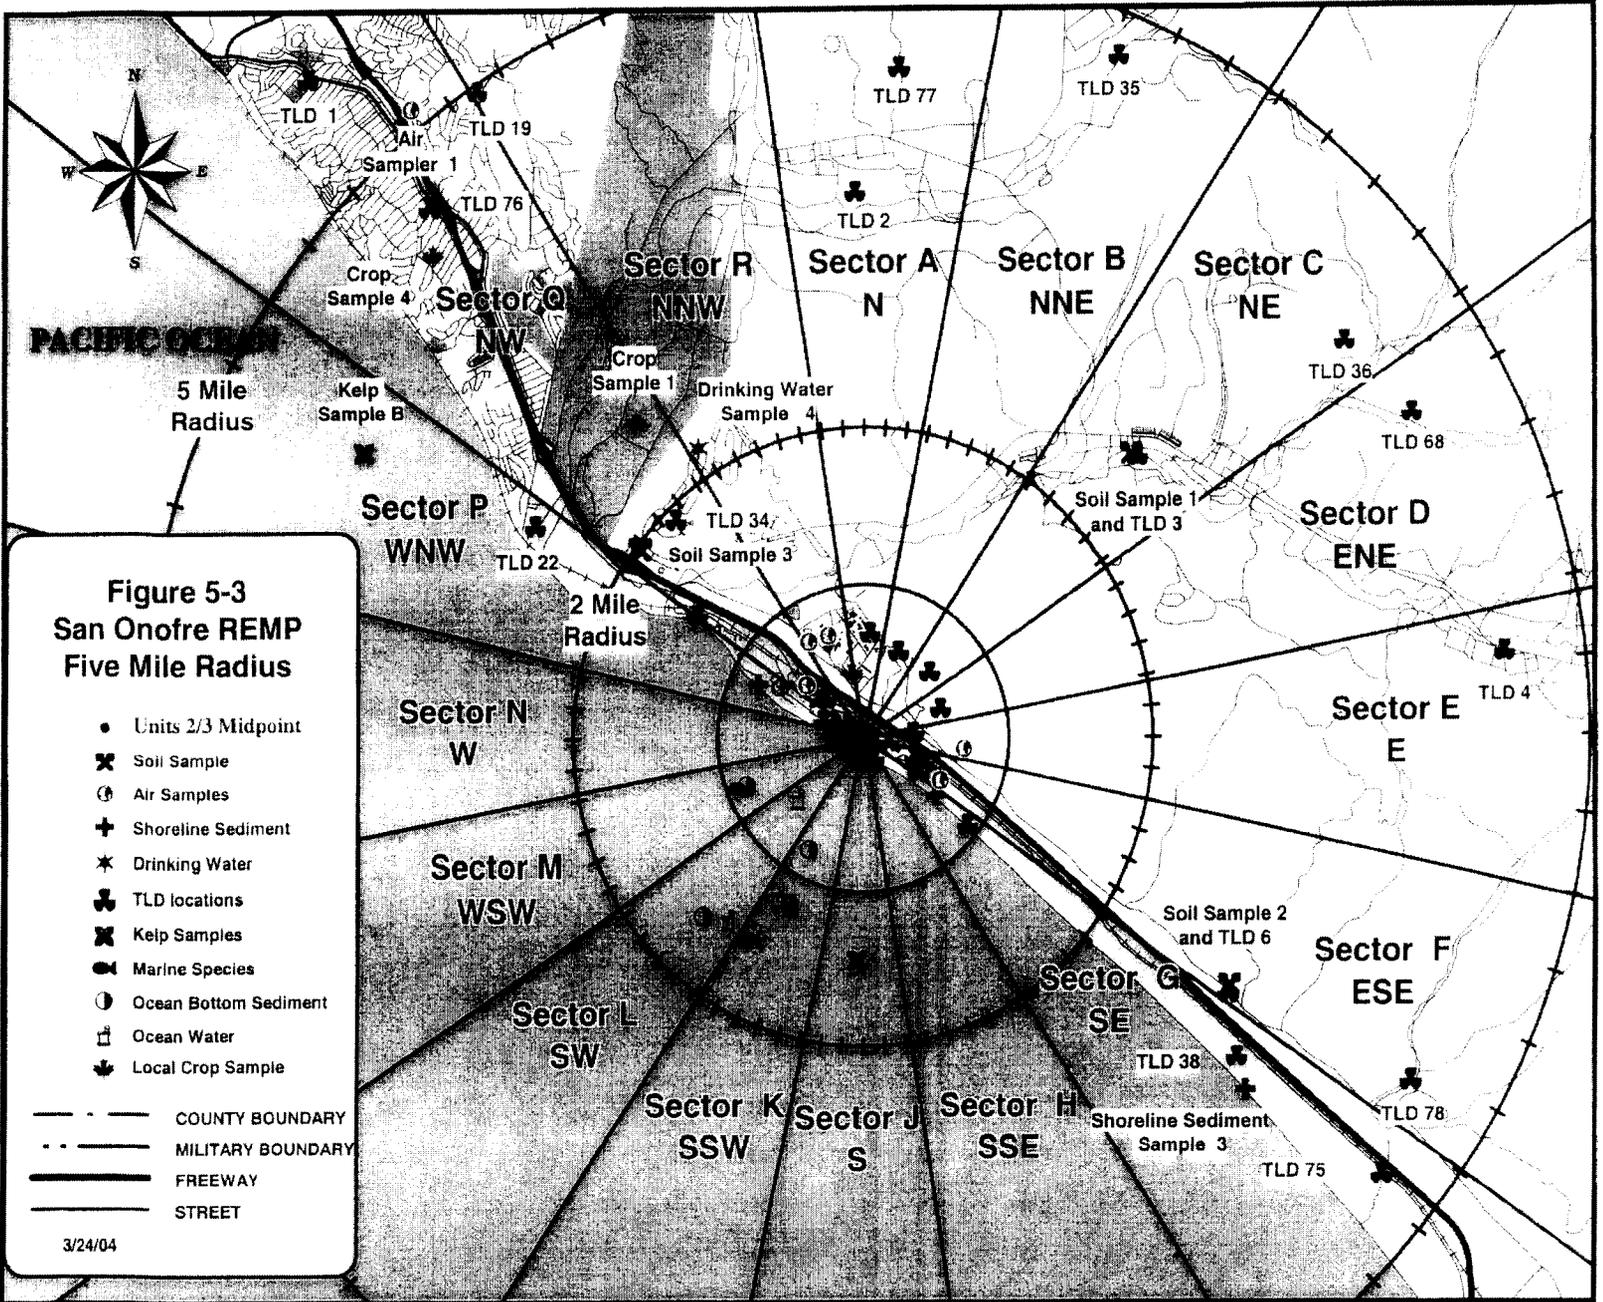

5-25

S0123-0DCM  
Revision 0  
02-27-07

Figure 5-4  
Radiological Environmental Monitoring Sample Locations - Orange County


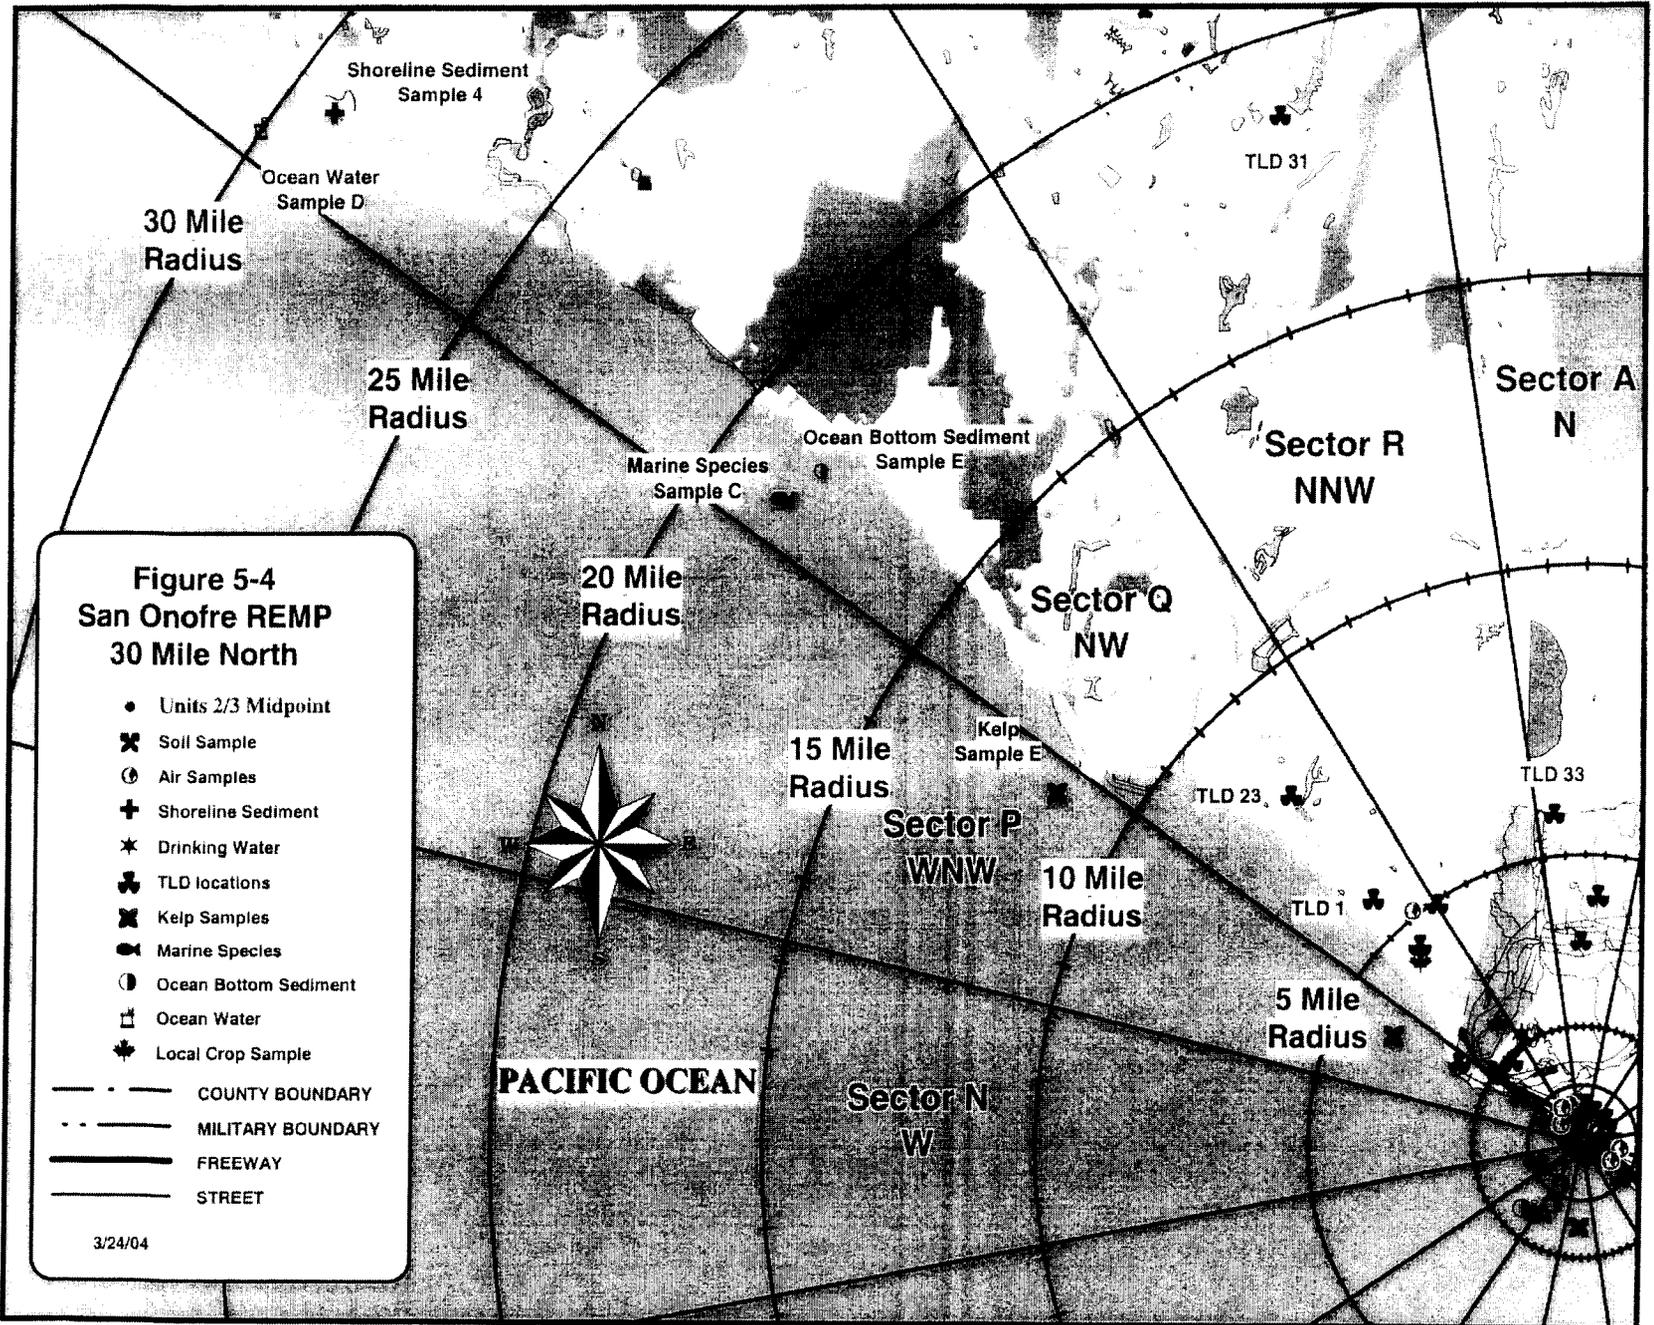


Figure 5-5  
Radiological Environmental Monitoring Sample Locations - San Diego County

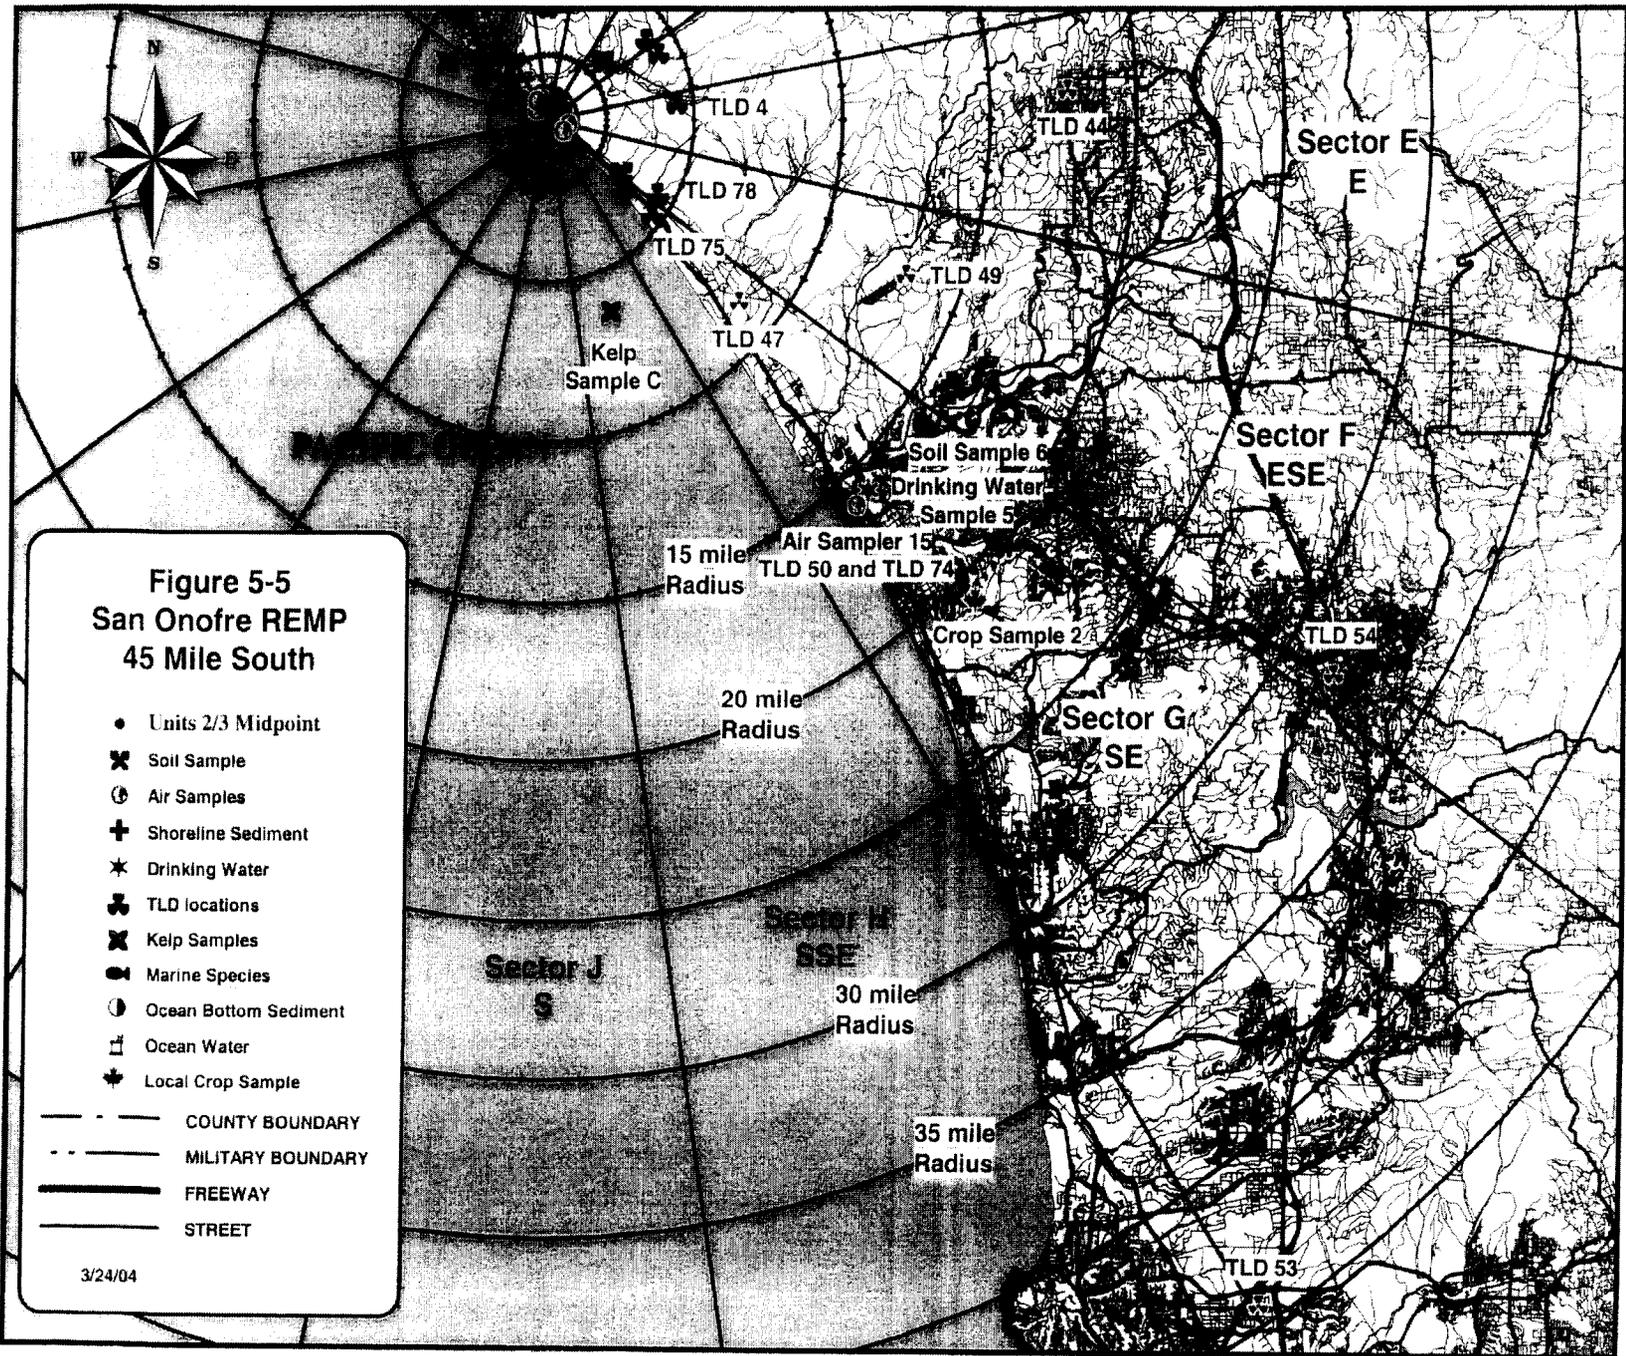

5-27

S0123-ODCM  
 Revision 0  
 02-27-07

## 6.0 ADMINISTRATIVE

### 6.1 DEFINITIONS

The defined terms of this section appear in capitalized type and are applicable through these Specifications.

#### ACTION

- 6.1.1 ACTION shall be that part of a specification which prescribes remedial measures required under designated conditions.

#### CHANNEL CALIBRATION

- 6.1.2 A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output such that it responds with the necessary range and accuracy to known values of the parameter which the channel monitors. The CHANNEL CALIBRATION shall encompass the entire channel, including the sensor and alarm and/or trip functions, and shall include the CHANNEL FUNCTIONAL TEST. The CHANNEL CALIBRATION may be performed by any series of sequential, overlapping or total channel steps such that the entire channel is calibrated.

#### CHANNEL CHECK

- 6.1.3 A CHANNEL CHECK shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.

#### CHANNEL FUNCTIONAL TEST

- 6.1.4 A CHANNEL FUNCTIONAL TEST shall be:
- a. Analog channels - the injection of a simulated signal into channel as close to the sensor as practicable to verify OPERABILITY, including alarm and/or trip functions.
  - b. Bistable channels - the injection of a simulated signal into the sensor to verify OPERABILITY, including alarm and/or trip functions.
  - c. Digital computer channels - the exercising of the digital computer hardware using diagnostic programs and the injection of simulated process data into the channel to verify OPERABILITY.

## 6.0 ADMINISTRATIVE (Continued)

### DOSE EQUIVALENT I-131

- 6.1.5 DOSE EQUIVALENT I-131 shall be that concentration of I-131 (microcuries/gram) which alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in International Commission on Radiological Protection Publication 30, Tables titled Committed Dose Equivalent in Target Organs or Tissues per Intake of Unit Activities.

### FREQUENCY NOTATION

- 6.1.6 The FREQUENCY NOTATION specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 6.2.

### GASEOUS RADWASTE TREATMENT SYSTEM

- 6.1.7 A GASEOUS RADWASTE TREATMENT SYSTEM is any system designed and installed to reduce radioactive gaseous effluents by collecting primary coolant system offgases from the primary system and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.

### MEMBERS OF THE PUBLIC

- 6.1.8 MEMBER(S) OF THE PUBLIC shall include all individuals who by virtue of their occupational status have no formal association with the plant. This category complies with the requirements of 10CFR50 and shall include non-employees of the licensee who are permitted to use portions of the site for recreational, occupational, or purposes not associated with plant functions. Supplemental workers and their dependents are included in this definition while they temporarily reside at Camp Mesa. This category shall not include non-employees such as vending machine servicemen or postmen who, as part of their formal job function, occasionally enter an area that is controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials.

## 6.0 ADMINISTRATIVE (Continued)

### MODE

- 6.1.9 A MODE shall correspond to any one inclusive combination of core reactivity condition, power level, average reactor coolant temperature, and reactor vessel head closure bolt tensioning specified in Table 6-1 with fuel in the reactor vessel.

### OPERABLE - OPERABILITY

- 6.1.10 A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling and seal water, lubrication and other auxiliary equipment that are required for the system, subsystem, train, component or device to perform its function(s) are also capable of performing their related support function(s).

### PURGE - PURGING

- 6.1.11 PURGE or PURGING is the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

### SITE BOUNDARY

- 6.1.12 The SITE BOUNDARY shall be that line beyond which the land is not owned, leased, or otherwise controlled by the licensee.

### SOLIDIFICATION

- 6.1.13 SOLIDIFICATION shall be the conversion of radioactive wastes from liquid systems to a homogeneous (uniformly distributed), monolithic, immobilized solid with definite volume and shape, bounded by a stable surface of distinct outline on all sides (free-standing).

## 6.0 ADMINISTRATIVE (Continued)

### SOURCE CHECK

6.1.14 For Victoreen and NMC analog monitors, a SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a radioactive source. [2(3)RT-6753, 2(3)RT-6759, 2(3)RT-7818A]

For Sorrento Electronics digital monitors a SOURCE CHECK shall be the verification of proper computer response to a check source request. [2(3)RT-7828, 2(3)RT-7865-1, 2(3)RT-7870-1]

For MGPI monitors a SOURCE CHECK shall be the verification of proper computer response to the continuous internal detector, monitor calibration and electrical checks. [2(3)RT-7817, 2(3)RT-7821, 2/3RT-7813, 2/3RT-7808, RT-2101]

### SURVEILLANCE REQUIREMENT: MEETING SPECIFIED FREQUENCY

6.1.15 The specified Frequency for each SR is met if the Surveillance is performed within 1.25 times the interval specified in the Frequency, as measured from the previous performance or as measured from the time a specified condition of the Frequency is met.

For Frequencies specified as "once," the above interval extension does not apply.

If a Completion Time requires periodic performance on a "once per ..." basis, the above Frequency extension applies to each performance after the initial performance.

This provision is not intended to be used repeatedly as a convenient means to extend surveillance intervals beyond those specified. Additionally, it does not apply to any Action Statements.

### THERMAL POWER

6.1.16 THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.

### VENTILATION EXHAUST TREATMENT SYSTEM

6.1.17 A VENTILATION EXHAUST TREATMENT SYSTEM is any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal absorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment (such a system is not considered to have any effect on noble gas effluents). Engineered Safety Feature (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

6.0 ADMINISTRATIVE (Continued)

VENTING

6.1.18 VENTING is the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent used in system names does not imply a VENTING process.

TABLE 6-1

OPERATIONAL MODES

<u>OPERATION MODE</u>	<u>REACTIVITY CONDITION, (<math>K_{eff}</math>)</u>	<u>% OF RATED THERMAL POWER(a)</u>	<u>AVERAGE COOLANT TEMPERATURE (<math>^{\circ}</math>F)</u>
1. POWER OPERATION	$\geq 0.99$	$> 5\%$	NA
2. STARTUP	$\geq 0.99$	$\leq 5\%$	NA
3. HOT STANDBY	$< 0.99$	NA	$\geq 350^{\circ}$ F
4. HOT SHUTDOWN	$< 0.99$	NA	$350^{\circ}$ F $> T_{avg} > 200^{\circ}$ F
5. COLD SHUTDOWN (b)	$< 0.99$	NA	$\leq 200^{\circ}$ F
6. REFUELING (c)	NA	NA	NA

(a) Excluding decay heat.

(b) All reactor vessel head closure bolts fully tensioned.

(c) One or more reactor vessel head closure bolts less than fully tensioned.

TABLE 6-2  
FREQUENCY NOTATION

<u>NOTATION</u>	<u>FREQUENCY</u>
S	At least once per 12 hours
D	At least once per 24 hours
W	At least once per 7 days
M	At least once per 31 days
Q	At least once per 92 days
SA	At least once per 184 days
R	At least once per 18 months*
S/U	Prior to each reactor startup
P	Completed prior to each release
N.A.	Not applicable
Refueling Interval	Not to exceed 24 months

\*A month is defined as a 31-day period.

## 6.0 ADMINISTRATIVE (Continued)

### 6.2 ADMINISTRATIVE CONTROLS

#### ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT\*

- 6.2.1 Routine radioactive effluent release reports covering the operation of the unit during the previous calendar year shall be submitted before May 1 of each year.
- 6.2.2 The radioactive effluent release reports shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof.

The radioactive effluent release report shall include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing of wind speed, wind direction, and atmospheric stability, and precipitation (if measured) on magnetic tape, or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability. This same report shall include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit or station during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the SITE BOUNDARY (Figure 1-2 and 2-2) during the report period. All assumptions used in making these assessments (i.e., specific activity, exposure time and location) shall be included in these reports. The meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents (as determined by sampling frequency and measurement) shall be used for determining the gaseous pathway doses. The assessment of radiation doses shall be performed in accordance with the OFFSITE DOSE CALCULATION MANUAL (ODCM).

---

\* A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the Station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

## 6.0 ADMINISTRATIVE (Continued)

### 6.2 ADMINISTRATIVE CONTROLS (Continued)

#### 6.2.2 (Continued)

The radioactive effluent release report shall also include an assessment of radiation doses to the likely most exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources (including doses from primary effluent pathways and direct radiation) for the previous 12 consecutive months to show conformance with 40 CFR 190, Environmental Radiation Protection Standards for Nuclear Power Operation. Acceptable methods for calculating the dose contribution from liquid and gaseous effluents are given in Regulatory Guide 1.109, Rev. 1.

The radioactive effluents release shall include the following information for each type of solid waste shipped offsite during the report period:

- a. Container volume,
- b. Total curie quantity (specify whether determined by measurement or estimate),
- c. Principal radionuclides (specify whether determined by measurement or estimate),
- d. Type of waste (e.g., spent resin, compacted dry waste, evaporator bottoms),
- e. Type of container (e.g., LSA, Type A, Type B, Large Quantity), and
- f. Solidification Agent (e.g., cement, urea formaldehyde).

The radioactive effluent release report shall include unplanned releases from the site to unrestricted areas of radioactive materials in gaseous and liquid effluents made during the reporting period.

The radioactive effluent release reports shall include any changes to the PROCESS CONTROL PROGRAM (PCP) made during the reporting period.

6.0 ADMINISTRATIVE (Continued)

6.3 MAJOR CHANGES TO RADIOACTIVE WASTE TREATMENT SYSTEMS (Liquid, & Gaseous)

Licensee initiated major changes to the radioactive waste systems (liquid & gaseous):

1. Shall be reported to the Commission in the Annual Radioactive Effluent Release Report for the period in which the evaluation was performed pursuant to Quality Assurance Program Description (SCE-1-A), Subsection 17.2.20.3.1.i. The discussion of each change shall contain:
  - a. A summary of the evaluation that led to the determination that the change could be made in accordance with applicable regulations;
  - b. Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
  - c. A detailed description of the equipment, components and processes involved and the interfaces with other plant systems;
  - d. An evaluation of the change which shows the predicted releases of radioactive materials in liquid and gaseous effluents that differ from those previously predicted in the license application and amendments thereto;
  - e. An evaluation of the change which shows the expected maximum exposures to individual in the unrestricted area and to the general population that differ from those previously estimated in the license application and amendments thereto;
  - f. A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents to the actual release for the period prior to when the changes are to be made;
  - g. An estimate of the exposure to plant operating personnel as a result of the change; and
  - h. Documentation of the fact that the change was reviewed and found acceptable pursuant to Quality Assurance Program Description (SCE-1-A), Subsection 17.2.20.3.1.i.
2. Shall become effective upon review and acceptance pursuant to Quality Assurance Program Description (SCE-1-A), Subsection 17.2.20.3.1.i.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES

#### LIQUID EFFLUENTS

##### CONCENTRATION (1.1)

6.4.1 This specification is provided to ensure that the concentration of radioactive materials released in liquid waste effluents from the site will be less than the concentration levels specified in 10 CFR Part 20, Appendix B, Table II, Column 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water outside the site will result in exposures within (1) the Section II.A design objectives of Appendix I, 10 CFR 50, to an individual, and (2) the limits of 10 CFR 20.106(e) to the population. The concentration limit for dissolved or entrained noble gases is based upon the assumption that Xe-135 is the controlling radioisotope and its MPC in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

##### DOSE (1.2)

6.4.2 This specification is provided to implement the requirements of Section II.A, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents will be kept "as low as is reasonably achievable." The dose calculations in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

This specification applies to the release of liquid effluents from each reactor at the site. For units with shared radwaste treatment systems, the liquid effluents from the shared system are proportioned among the units sharing that system.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

#### LIQUID WASTE TREATMENT (1.3)

- 6.4.3 The OPERABILITY of the liquid radwaste treatment system ensures that this system will be available for use whenever liquid effluents require treatment prior to release to the environment. The requirement that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design objective given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the liquid radwaste treatment system were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR Part 50, for liquid effluents.

#### GASEOUS EFFLUENTS

##### DOSE RATE (2.1)

- 6.4.4 This specification is provided to ensure that the dose at any time at the site boundary from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR Part 20 for unrestricted areas. The annual dose limits are the doses associated with the concentrations of 10 CFR Part 20, Appendix B, Table II, Column 1. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of an individual in an unrestricted area, either within or outside the site boundary, to annual average concentrations exceeding the limits specified in Appendix B, Table II of 10 CFR Part 20 (10 CFR Part 20.106(b)). For individuals who may at times be within the site boundary, the occupancy of the individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the site boundary. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to an individual at or beyond the site boundary to less than or equal to 500 mrem/year to the total body or to less than or equal to 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year.

This specification applies to the release of gaseous effluents from all reactors at the site. For units with shared radwaste treatment systems, the gaseous effluents from the shared system are proportioned among the units sharing that system.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

#### DOSE - NOBLE GASES (2.2)

- 6.4.5 This specification is provided to implement the requirements of Sections II.B, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents will be kept "as low as is reasonably achievable." The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The dose calculations established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision 1, July 1977. For individuals who may at times be within the site boundary, the occupancy of the individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the SITE BOUNDARY. For MEMBERS OF THE PUBLIC who traverse the SITE BOUNDARY via highway I-5, the residency time shall be considered negligible and hence the dose "0". The ODCM equations provided for determining the air doses at the SITE BOUNDARY are based upon the historical average atmospheric conditions.

#### DOSE - RADIOIODINES, RADIOACTIVE MATERIALS IN PARTICULATE FORM AND TRITIUM (2.3)

- 6.4.6 This specification is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Conditions for Operation are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the Surveillance Requirements implement the

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methods for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate specifications for radioiodines, radioactive materials in particulate form and tritium are dependent on the existing radionuclide pathways to man, in the unrestricted area. The pathways which were examined in the development of these calculations were: 1) individual inhalation of airborne radionuclides, 2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, 3) deposition onto grassy areas where milk animals and meat producing animals graze with consumption of the milk and meat by man, and 4) deposition on the ground with subsequent exposure of man.

#### GASEOUS RADWASTE TREATMENT (2.4)

- 6.4.7 The OPERABILITY of the GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the systems will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

#### TOTAL DOSE (3.3)

- 6.4.8 This specification is provided to meet the dose limitations of 40 CFR 190. The specification requires the preparation and submittal of a Special Report whenever the calculated doses from plant radioactive effluents exceed twice the design objective doses of Appendix I. For sites containing up to 4 reactors, it is highly unlikely that the resultant dose to a member of the public will exceed the dose limits of 40 CFR 190 if the individual reactors remain within the reporting requirement level. The Special Report will describe a course of action which should result in the limitation of dose to a member of the public for 12 consecutive months to within the 40 CFR 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the member of the public from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 5 miles must be considered. If the dose to any member of the public is estimated to exceed the requirements of 40 CFR 190, the Special Report with a request for a variance in accordance with the provisions of 40 CFR 190.11, is considered to be a timely request and fulfills the requirements of 40 CFR 190 until NRC staff action is completed provided the release conditions resulting in violation of 40 CFR 190 have not already been corrected. An individual is not considered a member of the public during any period in which he/she is engaged in carrying out any operation which is part of the nuclear fuel cycle.

#### RADIOACTIVE LIQUID EFFLUENT INSTRUMENTATION (4.1)

- 6.4.9 The radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63 and 64 of Appendix A to 10 CFR Part 50.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

#### RADIOACTIVE GASEOUS EFFLUENT INSTRUMENTATION (4.2)

- 6.4.10 The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. This instrumentation also includes provisions for monitoring and controlling the concentrations of potentially explosive gas mixtures in the waste gas holdup system. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63 and 64 of Appendix A to 10 CFR Part 50.

#### MONITORING PROGRAM (5.1)

- 6.4.11 The radiological monitoring program required by this specification provides measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides, which lead to the highest potential radiation exposures of individuals resulting from the station operation. This monitoring program thereby supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and modeling of the environmental exposure pathways. The initially specified monitoring program will be effective for at least the first three years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The detection capabilities required by Table 5-1 are state-of-the-art for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as a a posteriori (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors will be identified and described in the Annual Radiological Environmental Operating Report.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

#### LAND USE CENSUS (5.2)

- 6.4.12 This specification is provided to ensure that changes in the use of UNRESTRICTED AREAS are identified and that modifications to the monitoring program are made if required by the results of this census. The best survey information from the door-to-door, aerial or consulting with local agricultural authorities shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. Restricting the census to gardens of greater than 500 square feet provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were used, 1) that 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and 2) a vegetation yield of 2 kg/square meter.

#### INTERLABORATORY COMPARISON PROGRAM (5.3)

- 6.4.13 The requirement for participation in an Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are reasonably valid.

**OFFSITE DOSE CALCULATION MANUAL**

**NUCLEAR ORGANIZATION**

**SAN ONOFRE NUCLEAR GENERATING STATION (SONGS)**

**APPENDIX A**

**R<sub>i</sub> TABLES**

ODCM APPENDIX A

TABLE OF CONTENTS

<u>Section</u>	<u>Title</u>	<u>Page</u>
1.0	UNITS 2 AND 3 R <sub>i</sub> TABLES* . . . . .	A1-1 thru A1-24
1-1	Dose Parameters R <sub>i</sub> for Sector P . . . . .	A1-1
1-2	Dose Parameters R <sub>i</sub> for Sector Q . . . . .	A1-4
1-3	Dose Parameters R <sub>i</sub> for Sector R . . . . .	A1-8
1-4	Dose Parameters R <sub>i</sub> for Sector A . . . . .	A1-10
1-5	Dose Parameters R <sub>i</sub> for Sector B . . . . .	A1-13
1-6	Dose Parameters R <sub>i</sub> for Sector C . . . . .	A1-15
1-7	Dose Parameters R <sub>i</sub> for Sector D . . . . .	A1-17
1-8	Dose Parameters R <sub>i</sub> for Sector E . . . . .	A1-19
1-9	Dose Parameters R <sub>i</sub> for Sector F . . . . .	A1-21
1-10	Dose Parameters R <sub>i</sub> for Sector G . . . . .	A1-22
2.0	SOUTH YARD FACILITY R <sub>i</sub> TABLES** . . . . .	A2-1 thru A2-10
2-1	Dose Parameters R <sub>i</sub> for Sector D . . . . .	A2-1
2-2	Dose Parameters R <sub>i</sub> for Sector E . . . . .	A2-2
2-3	Dose Parameters R <sub>i</sub> for Sector F . . . . .	A2-3
2-4	Dose Parameters R <sub>i</sub> for Sector G . . . . .	A2-7
3.0	NORTH INDUSTRIAL AREA (UNIT 1) R <sub>i</sub> TABLES*** . . . . .	A3-1 thru A3-21
3-1	Dose Parameters R <sub>i</sub> for Sector P . . . . .	A3-1
3-2	Dose Parameters R <sub>i</sub> for Sector Q . . . . .	A3-4
3-3	Dose Parameters R <sub>i</sub> for Sector R . . . . .	A3-8
3-4	Dose Parameters R <sub>i</sub> for Sector A . . . . .	A3-9
3-5	Dose Parameters R <sub>i</sub> for Sector B . . . . .	A3-11
3-6	Dose Parameters R <sub>i</sub> for Sector C . . . . .	A3-13
3-7	Dose Parameters R <sub>i</sub> for Sector D . . . . .	A3-15
3-8	Dose Parameters R <sub>i</sub> for Sector E . . . . .	A3-16
3-9	Dose Parameters R <sub>i</sub> for Sector F . . . . .	A3-18
3-10	Dose Parameters R <sub>i</sub> for Sector G . . . . .	A3-20

References: \* J. W. Scott to D. Dick Memorandum for file: "2008 Dose Parameters for SONGS," dated February 11, 2008.

\*\* M. Goeders to Po Chang Memorandum for file: "Determination of meteorological parameters for the SoYTH Yard facility using OCMs methodology," dated May, 30 1995.

\*\*\* J.W. Scott to D. Dick Memorandum for file: " 2006 Dose Parameters for SONGS," dated February 7, 2007

**TABLE 1-1**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR P**

Pathway = Surf Beach/Lifeguard X/Q = 1.3E-6 sec/m <sup>3</sup>			Distance = 0.5 miles D/Q = 5.5E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	7.8E+0	-0-	4.2E+1	-0-	1.2E+2	-0-
Cr-51	-0-	-0-	1.2E+2	3.2E+4	6.9E+2	1.5E+5	1.3E+3	4.2E+5
Mn-54	-0-	-0-	1.1E+4	9.5E+6	6.5E+4	4.5E+7	1.3E+5	1.3E+8
Co-57	-0-	-0-	9.1E+1	2.4E+6	1.0E+3	1.1E+7	2.9E+3	3.1E+7
Co-58	-0-	-0-	7.6E+3	2.6E+6	4.4E+4	1.2E+7	8.5E+4	3.5E+7
Co-60	-0-	-0-	4.9E+4	1.5E+8	2.9E+5	7.0E+8	5.4E+5	2.0E+9
Sr-89	-0-	-0-	1.5E+4	1.5E+2	7.9E+4	7.1E+2	1.3E+5	2.0E+3
Sr-90	-0-	-0-	1.0E+5	-0-	5.4E+5	-0-	8.8E+5	-0-
Zr-95	-0-	-0-	1.5E+4	1.7E+6	8.8E+4	8.2E+6	1.6E+5	2.3E+7
Nb-95	-0-	-0-	4.2E+3	9.4E+5	2.5E+4	4.5E+6	4.6E+4	1.2E+7
Ru-103	-0-	-0-	4.6E+3	7.5E+5	2.6E+4	3.6E+6	4.6E+4	9.9E+6
Te-129m	-0-	-0-	1.2E+4	1.4E+5	6.5E+4	6.4E+5	1.1E+5	1.8E+6
Cs-134	-0-	-0-	8.3E+2	4.7E+7	4.8E+3	2.2E+8	8.9E+3	6.2E+8
Cs-136	-0-	-0-	1.0E+2	1.0E+6	5.8E+2	4.9E+6	1.1E+3	1.4E+7
Cs-137	-0-	-0-	7.2E+2	7.1E+7	4.0E+3	3.4E+8	6.9E+3	9.4E+8
Ba-140	-0-	-0-	1.2E+4	1.4E+5	6.6E+4	6.7E+5	1.2E+5	1.9E+6
Ce-141	-0-	-0-	3.8E+3	9.4E+4	2.0E+4	4.5E+5	3.3E+4	1.2E+6
Ce-144	-0-	-0-	8.2E+4	4.8E+5	4.4E+5	2.3E+6	7.1E+5	6.4E+6
I -131	-0-	-0-	1.1E+5	1.2E+5	4.8E+5	5.6E+5	1.1E+6	1.6E+6
I -132	-0-	-0-	1.3E+3	8.5E+3	4.9E+3	4.1E+4	1.0E+4	1.1E+5
I -133	-0-	-0-	2.7E+4	1.7E+4	9.5E+4	8.0E+4	2.0E+5	2.2E+5
I -134	-0-	-0-	3.5E+2	3.1E+3	1.3E+3	1.5E+4	2.7E+3	4.1E+4
I -135	-0-	-0-	5.5E+3	1.7E+4	2.0E+4	8.2E+4	4.1E+4	2.3E+5
UN-ID	-0-	-0-	6.9E+3	5.1E+6	4.1E+4	2.4E+7	7.9E+4	6.8E+7

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-1**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR P**

Pathway = Cotton Point Estates X/Q = 1.1E-7 sec/m <sup>3</sup>		Distance = 2.7 miles D/Q = 3.2E-10 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-1**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR P**

Pathway = Cotton Point Gardens X/Q = 1.0E-7 sec/m <sup>3</sup>		Distance = 2.8 miles D/Q = 3.0E-10 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	4.0E+3	1.3E+3	2.6E+3	1.3E+3	2.3E+3
Cr-51	1.3E+4	4.7E+6	1.7E+4	1.1E+7	2.1E+4	1.5E+7	1.4E+4	1.6E+7
Mn-54	1.0E+6	1.4E+9	1.6E+6	2.0E+9	2.0E+6	2.3E+9	1.4E+6	2.3E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	5.8E+8	3.1E+4	6.6E+8	3.1E+4	6.3E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	7.5E+8	1.3E+6	9.7E+8	9.3E+5	9.9E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.4E+10	8.7E+6	2.5E+10	6.0E+6	2.5E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	3.5E+10	2.4E+6	1.5E+10	1.4E+6	9.8E+9
Sr-90	1.1E+7	-0-	1.5E+7	1.4E+12	1.6E+7	8.3E+11	9.6E+6	6.7E+11
Zr-95	1.8E+6	2.5E+8	2.2E+6	1.1E+9	2.7E+6	1.5E+9	1.8E+6	1.4E+9
Nb-95	4.8E+5	1.4E+8	6.1E+5	4.3E+8	7.5E+5	5.9E+8	5.0E+5	6.1E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	5.0E+8	7.8E+5	6.8E+8	5.0E+5	6.6E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.9E+9	2.0E+6	1.8E+9	1.2E+6	1.2E+9
Cs-134	8.0E+4	6.8E+9	1.2E+5	3.2E+10	1.5E+5	2.3E+10	9.8E+4	1.8E+10
Cs-136	1.2E+4	1.5E+8	1.5E+4	3.7E+8	1.8E+4	3.2E+8	1.2E+4	3.2E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	3.4E+10	1.2E+5	2.4E+10	7.5E+4	1.9E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	3.0E+8	2.0E+6	2.3E+8	1.3E+6	2.8E+8
Ce-141	5.2E+5	1.4E+7	5.4E+5	4.2E+8	6.1E+5	5.5E+8	3.6E+5	5.2E+8
Ce-144	9.8E+6	7.0E+7	1.2E+7	1.0E+10	1.3E+7	1.3E+10	7.8E+6	1.1E+10
I -131	1.5E+7	1.7E+7	1.6E+7	4.8E+10	1.5E+7	3.1E+10	1.2E+7	3.8E+10
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	8.1E+8	2.9E+6	4.6E+8	2.2E+6	5.3E+8
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	1.2E+7	6.2E+5	8.2E+6	4.5E+5	9.1E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	3.5E+9	1.2E+6	2.6E+9	8.6E+5	2.0E+9

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-2**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q**

Pathway = SORB Resident Employee X/Q = 9.9E-7 sec/m <sup>3</sup>			Distance = 1.1 miles D/Q = 5.0E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-2**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q**

Pathway = San Onofre Mobile Homes X/Q = 6.9E-7 sec/m <sup>3</sup>		Distance = 1.4 miles D/Q = 3.3E-9 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-2**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q**

Pathway = San Mateo Pt Homes X/Q = 2.6E-7 sec/m <sup>3</sup>		Distance = 2.7 miles D/Q = 1.0E-9 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-2**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q**

Pathway = S. C. Resident With Garden X/Q = 1.4E-7 sec/m <sup>3</sup>		Distance = 4.1 miles D/Q = 4.7E-10 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	4.0E+3	1.3E+3	2.6E+3	1.3E+3	2.3E+3
Cr-51	1.3E+4	4.7E+6	1.7E+4	1.1E+7	2.1E+4	1.5E+7	1.4E+4	1.6E+7
Mn-54	1.0E+6	1.4E+9	1.6E+6	2.0E+9	2.0E+6	2.3E+9	1.4E+6	2.3E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	5.8E+8	3.1E+4	6.6E+8	3.1E+4	6.3E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	7.5E+8	1.3E+6	9.7E+8	9.3E+5	9.9E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.4E+10	8.7E+6	2.5E+10	6.0E+6	2.5E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	3.5E+10	2.4E+6	1.5E+10	1.4E+6	9.8E+9
Sr-90	1.1E+7	-0-	1.5E+7	1.4E+12	1.6E+7	8.3E+11	9.6E+6	6.7E+11
Zr-95	1.8E+6	2.5E+8	2.2E+6	1.1E+9	2.7E+6	1.5E+9	1.8E+6	1.4E+9
Nb-95	4.8E+5	1.4E+8	6.1E+5	4.3E+8	7.5E+5	5.9E+8	5.0E+5	6.1E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	5.0E+8	7.8E+5	6.8E+8	5.0E+5	6.6E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.9E+9	2.0E+6	1.8E+9	1.2E+6	1.5E+9
Cs-134	8.0E+4	6.8E+9	1.2E+5	3.2E+10	1.5E+5	2.3E+10	9.8E+4	1.8E+10
Cs-136	1.2E+4	1.5E+8	1.5E+4	3.7E+8	1.8E+4	3.2E+8	1.2E+4	3.2E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	3.4E+10	1.2E+5	2.4E+10	7.5E+4	1.9E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	3.0E+8	2.0E+6	2.3E+8	1.3E+6	2.8E+8
Ce-141	5.2E+5	1.4E+7	5.4E+5	4.2E+8	6.1E+5	5.5E+8	3.6E+5	5.2E+8
Ce-144	9.8E+6	7.0E+7	1.2E+7	1.0E+10	1.3E+7	1.3E+10	7.8E+6	1.1E+10
I -131	1.5E+7	1.7E+7	1.6E+7	4.8E+10	1.5E+7	3.1E+10	1.2E+7	3.8E+10
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	8.1E+8	2.9E+6	4.6E+8	2.2E+6	5.3E+8
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	1.2E+7	6.2E+5	8.2E+6	4.5E+5	9.1E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	3.5E+9	1.2E+6	2.6E+9	8.6E+5	2.0E+9

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-3**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR R**

Pathway = Camp Mesa X/Q = 3.7E-06 sec/m <sup>3</sup>		Distance = 0.4 miles D/Q = 2.5E-08 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Inhalation Pathway	Food & Ground Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H 3**	4.9E+2	-0-	8.5E+2	-0-	9.6E+2	-0-	9.6E+2	-0-
Cr-51	9.7E+3	3.5E+6	1.3E+4	3.5E+6	1.6E+4	3.5E+6	1.1E+4	3.5E+6
Mn-54	7.6E+5	1.0E+9	1.2E+6	1.0E+9	1.5E+6	1.0E+9	1.1E+6	1.0E+9
Co-57	3.7E+3	2.6E+8	1.0E+4	2.6E+8	2.4E+4	2.6E+8	2.4E+4	2.6E+8
Co-58	5.9E+5	2.9E+8	8.4E+5	2.9E+8	1.0E+6	2.9E+8	7.0E+5	2.9E+8
Co-60	3.4E+6	1.6E+10	5.3E+6	1.6E+10	6.6E+6	1.6E+10	4.5E+6	1.6E+10
Sr-89	1.5E+6	1.6E+4	1.6E+6	1.6E+4	1.8E+6	1.6E+4	1.1E+6	1.6E+4
Sr-90	8.5E+6	-0-	1.1E+7	-0-	1.2E+7	-0-	7.3E+6	-0-
Zr-95	1.3E+6	1.9E+8	1.7E+6	1.9E+8	2.0E+6	1.9E+8	1.3E+6	1.9E+8
Nb-95	3.6E+5	1.0E+8	4.6E+5	1.0E+8	5.7E+5	1.0E+8	3.8E+5	1.0E+8
Ru-103	4.2E+5	8.2E+7	5.0E+5	8.2E+7	5.9E+5	8.2E+7	3.8E+5	8.2E+7
Te-129M	1.3E+6	1.5E+7	1.3E+6	1.5E+7	1.5E+6	1.5E+7	9.3E+5	1.5E+7
Cs-134	6.0E+4	5.2E+9	9.1E+4	5.2E+9	1.1E+5	5.2E+9	7.4E+4	5.2E+9
Cs-136	8.9E+3	1.1E+8	1.1E+4	1.1E+8	1.3E+4	1.1E+8	9.1E+3	1.1E+8
Cs-137	5.4E+4	7.8E+9	7.9E+4	7.8E+9	9.1E+4	7.8E+9	5.7E+4	7.8E+9
Ba-140	1.2E+6	1.6E+7	1.3E+6	1.6E+7	1.5E+6	1.6E+7	9.6E+5	1.6E+7
Ce-141	3.9E+5	1.0E+7	4.1E+5	1.0E+7	4.6E+5	1.0E+7	2.7E+5	1.0E+7
Ce-144	7.4E+6	5.3E+7	9.0E+6	5.3E+7	1.0E+7	5.3E+7	5.9E+6	5.3E+7
I -131	1.1E+7	1.3E+7	1.2E+7	1.3E+7	1.1E+7	1.3E+7	9.0E+6	1.3E+7
I -132	1.3E+5	9.4E+5	1.5E+5	9.4E+5	1.1E+5	9.4E+5	8.7E+4	9.4E+5
I -133	2.7E+6	1.9E+6	2.9E+6	1.9E+6	2.2E+6	1.9E+6	1.6E+6	1.9E+6
I -134	3.4E+4	3.4E+5	3.8E+4	3.4E+5	3.0E+4	3.4E+5	2.3E+4	3.4E+5
I -135	5.3E+5	1.9E+6	6.0E+5	1.9E+6	4.7E+5	1.9E+6	3.4E+5	1.9E+6
UN-ID*	4.9E+5	5.6E+8	7.5E+5	5.6E+8	9.4E+5	5.6E+8	6.5E+5	5.6E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-3**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR R**

Pathway = San Onofre Mobile Homes X/Q = 5.2E-7 sec/m <sup>3</sup>		Distance = 1.3 miles D/Q = 3.0E-9 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H 3**	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129M	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID*	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-4**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR A**

Pathway = Camp Mesa X/Q = 2.7E-6 sec/m <sup>3</sup>		Distance = 0.4 miles D/Q = 2.1E-8 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	4.9E+2	-0-	8.5E+2	-0-	9.6E+2	-0-	9.6E+2	-0-
Cr-51	9.7E+3	3.5E+6	1.3E+4	3.5E+6	1.6E+4	3.5E+6	1.1E+4	3.5E+6
Mn-54	7.6E+5	1.0E+9	1.2E+6	1.0E+9	1.5E+6	1.0E+9	1.1E+6	1.0E+9
Co-57	3.7E+3	2.6E+8	1.0E+4	2.6E+8	2.4E+4	2.6E+8	2.4E+4	2.6E+8
Co-58	5.9E+5	2.9E+8	8.4E+5	2.9E+8	1.0E+6	2.9E+8	7.0E+5	2.9E+8
Co-60	3.4E+6	1.6E+10	5.3E+6	1.6E+10	6.6E+6	1.6E+10	4.5E+6	1.6E+10
Sr-89	1.5E+6	1.6E+4	1.6E+6	1.6E+4	1.8E+6	1.6E+4	1.1E+6	1.6E+4
Sr-90	8.5E+6	-0-	1.1E+7	-0-	1.2E+7	-0-	7.3E+6	-0-
Zr-95	1.3E+6	1.9E+8	1.7E+6	1.9E+8	2.0E+6	1.9E+8	1.3E+6	1.9E+8
Nb-95	3.6E+5	1.0E+8	4.6E+5	1.0E+8	5.7E+5	1.0E+8	3.8E+5	1.0E+8
Ru-103	4.2E+5	8.2E+7	5.0E+5	8.2E+7	5.9E+5	8.2E+7	3.8E+5	8.2E+7
Te-129m	1.3E+6	1.5E+7	1.3E+6	1.5E+7	1.5E+6	1.5E+7	9.3E+5	1.5E+7
Cs-134	6.0E+4	5.2E+9	9.1E+4	5.2E+9	1.1E+5	5.2E+9	7.4E+4	5.2E+9
Cs-136	8.9E+3	1.1E+8	1.1E+4	1.1E+8	1.3E+4	1.1E+8	9.1E+3	1.1E+8
Cs-137	5.4E+4	7.8E+9	7.9E+4	7.8E+9	9.1E+4	7.8E+9	5.7E+4	7.8E+9
Ba-140	1.2E+6	1.6E+7	1.3E+6	1.6E+7	1.5E+6	1.6E+7	9.6E+5	1.6E+7
Ce-141	3.9E+5	1.0E+7	4.1E+5	1.0E+7	4.6E+5	1.0E+7	2.7E+5	1.0E+7
Ce-144	7.4E+6	5.3E+7	9.0E+6	5.3E+7	1.0E+7	5.3E+7	5.9E+6	5.3E+7
I -131	1.1E+7	1.3E+7	1.2E+7	1.3E+7	1.1E+7	1.3E+7	9.0E+6	1.3E+7
I -132	1.3E+5	9.4E+5	1.5E+5	9.4E+5	1.1E+5	9.4E+5	8.7E+4	9.4E+5
I -133	2.7E+6	1.9E+6	2.9E+6	1.9E+6	2.2E+6	1.9E+6	1.6E+6	1.9E+6
I -134	3.4E+4	3.4E+5	3.8E+4	3.4E+5	3.0E+4	3.4E+5	2.3E+4	3.4E+5
I -135	5.3E+5	1.9E+6	6.0E+5	1.9E+6	4.7E+5	1.9E+6	3.4E+5	1.9E+6
UN-ID	4.9E+5	5.6E+8	7.5E+5	5.6E+8	9.4E+5	5.6E+8	6.5E+5	5.6E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-4**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR A**

Pathway = Camp San Mateo X/Q = 7.2E-8 sec/m <sup>3</sup>			Distance = 3.6 miles D/Q = 4.1E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-4**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR A**

Pathway = Deer Consumer/Hunter X/Q = 5.7E-8 sec/m <sup>3</sup>			Distance = 4.2 miles D/Q = 6.6E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	1.1E+2	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	1.2E+3	5.8E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	1.2E+5	1.2E+8
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	2.6E+3	4.2E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	7.7E+4	6.9E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	5.0E+5	1.9E+9
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	1.2E+5	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	8.0E+5	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	1.5E+5	2.1E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	4.2E+4	8.3E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	4.2E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	1.0E+5	5.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	8.1E+3	7.2E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	1.0E+3	1.8E+7
Cs-137	-0-	-0-	-0-	1.2E+8	-0-	9.3E+7	6.3E+3	9.7E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	1.1E+5	8.5E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	3.0E+4	5.0E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	6.5E+5	5.3E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	9.9E+5	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	9.5E+3	1.0E+5
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	1.8E+5	2.0E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+3	3.8E+4
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	3.7E+4	2.1E+5
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	7.2E+4	1.8E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-5**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR B**

Pathway = Sanitary Landfill X/Q = 1.3E-7 sec/m <sup>3</sup>			Distance = 2.1 miles D/Q = 1.1E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	8.7E+1	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	9.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+4	9.5E+7
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+3	2.3E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	6.4E+4	2.6E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	4.1E+5	1.5E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+4	1.5E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	6.6E+5	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	1.7E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	3.5E+4	9.4E+6
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	3.5E+4	7.4E+6
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	8.4E+4	1.3E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	6.7E+3	4.7E+8
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.0E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	5.2E+3	7.1E+8
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	8.7E+4	1.4E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+4	9.4E+5
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	5.3E+5	4.8E+6
I -131	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+5	1.2E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+3	8.5E+4
I -133	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.7E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+3	3.1E+4
I -135	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	1.7E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	5.9E+4	5.1E+7

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-5**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR B**

Pathway = Deer Consumer/Hunter X/Q = 6.8E-8 sec/m <sup>3</sup>			Distance = 3.8 miles D/Q = 5.1E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	1.1E+2	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	1.2E+3	5.8E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	1.2E+5	1.2E+8
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	2.6E+3	4.2E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	7.7E+4	6.9E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	5.0E+5	1.9E+9
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	1.2E+5	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	8.0E+5	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	1.5E+5	2.1E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	4.2E+4	8.3E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	4.2E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	1.0E+5	5.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	8.1E+3	7.2E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	1.0E+3	1.8E+7
Cs-137	-0-	-0-	-0-	1.2E+8	-0-	9.3E+7	6.3E+3	9.7E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	1.1E+5	8.5E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	3.0E+4	5.0E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	6.5E+5	5.3E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	9.9E+5	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	9.5E+3	1.0E+5
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	1.8E+5	2.0E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+3	3.8E+4
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	3.7E+4	2.1E+5
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	7.2E+4	1.8E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-6**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR C**

Pathway = Deer Consumer/Hunter X/Q = 4.0E-7 sec/m <sup>3</sup>			Distance = 1.0 miles D/Q = 4.6E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	-0-	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	-0-	1.9E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	-0-	2.7E+6
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	-0-	1.4E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	-0-	3.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	-0-	1.3E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	-0-	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	-0-	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	-0-	1.9E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	-0-	8.1E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	-0-	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	-0-	5.3E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	-0-	1.5E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	-0-	5.4E+6
Cs-137	-0-	-0-	-0-	1.2E+8	-0-	9.3E+7	-0-	1.2E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	-0-	6.8E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	-0-	3.8E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	-0-	4.7E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	-0-	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	-0-	-0-
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	-0-	1.1E+1
I -134	-0-	-0-	-0-	-0-	-0-	-0-	-0-	-0-
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	-0-	8.1E-16
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	-0-	1.2E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-6**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR C**

Pathway = Camp San Onofre X/Q = 8.7E-8 sec/m <sup>3</sup>			Distance = 2.8 miles D/Q = 7.9E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-7**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR D**

Pathway = Deer Consumer/Hunter X/Q = 5.3E-7 sec/m <sup>3</sup>			Distance = 0.8 miles D/Q = 7.3E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.3E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.7E+2	3.1E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.6E+4	3.9E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	8.1E+2	2.2E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.4E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.5E+5	6.9E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.6E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.5E+5	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	4.6E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.3E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.3E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	5.3E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.5E+3	3.2E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	3.1E+2	9.3E+6
Cs-137	-0-	-0-	-0-	1.2E+8	-0-	9.3E+7	1.9E+3	3.8E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.3E+4	7.3E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.4E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.0E+5	4.9E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.1E+5	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+3	3.2E+4
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.6E+4	6.3E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	7.7E+2	1.2E+4
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.5E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.2E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-7**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR D**

Pathway = Camp San Onofre X/Q = 6.9E-8 sec/m <sup>3</sup>			Distance = 3.0 miles D/Q = 7.2E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-8**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR E**

Pathway = Deer Consumer/Hunter X/Q = 8.5E-7 sec/m <sup>3</sup>			Distance = 0.8 miles D/Q = 1.3E-8 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.3E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.7E+2	3.1E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.6E+4	3.9E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	8.1E+2	2.2E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.4E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.5E+5	6.9E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.6E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.5E+5	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	4.6E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.3E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.3E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	5.3E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.5E+3	3.2E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	3.1E+2	9.3E+6
Cs-137	-0-	-0-	-0-	1.2E+8	-0-	9.3E+7	1.9E+3	3.8E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.3E+4	7.3E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.4E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.0E+5	4.9E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.1E+5	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+3	3.2E+4
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.6E+4	6.3E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	7.7E+2	1.2E+4
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.5E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.2E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-8**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR E**

Pathway = Camp Horno X/Q = 7.5E-8 sec/m <sup>3</sup>			Distance = 4.1 miles D/Q = 7.2E-10 m <sup>-2</sup>					
Radio- Nuclide	Infant		Child		Teen		Adult	
	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-9**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR F**

Pathway = San Onofre State Park/Guard Shack		Distance = 0.8 miles						
X/Q = 9.6E-7 sec/m <sup>3</sup>		D/Q = 8.4E-9 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+3	8.0E+5
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	2.4E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	5.4E+3	5.9E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+5	6.5E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+6	3.7E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	3.7E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+5	4.3E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+4	2.3E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+4	1.9E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	3.4E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+4	1.2E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+3	2.6E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+4	1.8E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+5	3.5E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	6.2E+4	2.3E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	1.2E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+6	2.9E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+4	2.1E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+5	4.2E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	5.1E+3	7.7E+4
I -135	-0-	-0-	-0-	-0-	-0-	-0-	7.7E+4	4.3E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.3E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-10**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR G**

Pathway = San Onofre State Beach Campground X/Q = 2.3E-7 sec/m <sup>3</sup>		Distance = 1.8 miles D/Q = 1.0E-9 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	5.3E+1	-0-	9.2E+1	-0-	1.0E+2	-0-	1.0E+2	-0-
Cr-51	1.1E+3	3.8E+5	1.4E+3	3.8E+5	1.7E+3	3.8E+5	1.2E+3	3.8E+5
Mn-54	8.2E+4	1.1E+8	1.3E+5	1.1E+8	1.6E+5	1.1E+8	1.2E+5	1.1E+8
Co-57	4.0E+2	2.8E+7	1.1E+3	2.8E+7	2.6E+3	2.8E+7	2.6E+3	2.8E+7
Co-58	6.4E+4	3.1E+7	9.1E+4	3.1E+7	1.1E+5	3.1E+7	7.6E+4	3.1E+7
Co-60	3.7E+5	1.8E+9	5.8E+5	1.8E+9	7.2E+5	1.8E+9	4.9E+5	1.8E+9
Sr-89	1.7E+5	1.8E+3	1.8E+5	1.8E+3	2.0E+5	1.8E+3	1.2E+5	1.8E+3
Sr-90	9.2E+5	-0-	1.2E+6	-0-	1.4E+6	-0-	7.9E+5	-0-
Zr-95	1.4E+5	2.1E+7	1.8E+5	2.1E+7	2.2E+5	2.1E+7	1.5E+5	2.1E+7
Nb-95	3.9E+4	1.1E+7	5.0E+4	1.1E+7	6.2E+4	1.1E+7	4.1E+4	1.1E+7
Ru-103	4.5E+4	8.9E+6	5.4E+4	8.9E+6	6.4E+4	8.9E+6	4.1E+4	8.9E+6
Te-129m	1.4E+5	1.6E+6	1.4E+5	1.6E+6	1.6E+5	1.6E+6	1.0E+5	1.6E+6
Cs-134	6.5E+3	5.6E+8	9.9E+3	5.6E+8	1.2E+4	5.6E+8	8.0E+3	5.6E+8
Cs-136	9.7E+2	1.2E+7	1.2E+3	1.2E+7	1.5E+3	1.2E+7	9.9E+2	1.2E+7
Cs-137	5.9E+3	8.5E+8	8.5E+3	8.5E+8	9.9E+3	8.5E+8	6.2E+3	8.5E+8
Ba-140	1.3E+5	1.7E+6	1.4E+5	1.7E+6	1.7E+5	1.7E+6	1.0E+5	1.7E+6
Ce-141	4.2E+4	1.1E+6	4.5E+4	1.1E+6	5.0E+4	1.1E+6	3.0E+4	1.1E+6
Ce-144	8.1E+5	5.7E+6	9.8E+5	5.7E+6	1.1E+6	5.7E+6	6.4E+5	5.7E+6
I -131	1.2E+6	1.4E+6	1.3E+6	1.4E+6	1.2E+6	1.4E+6	9.8E+5	1.4E+6
I -132	1.4E+4	1.0E+5	1.6E+4	1.0E+5	1.2E+4	1.0E+5	9.4E+3	1.0E+5
I -133	2.9E+5	2.0E+5	3.2E+5	2.0E+5	2.4E+5	2.0E+5	1.8E+5	2.0E+5
I -134	3.7E+3	3.7E+4	4.2E+3	3.7E+4	3.2E+3	3.7E+4	2.5E+3	3.7E+4
I -135	5.7E+4	2.1E+5	6.5E+4	2.1E+5	5.1E+4	2.1E+5	3.7E+4	2.1E+5
UN-ID	5.3E+4	6.1E+7	8.2E+4	6.1E+7	1.0E+5	6.1E+7	7.1E+4	6.1E+7

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-10**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR G**

Pathway = Surfcamp.com X/Q = 1.6E-7 sec/m <sup>3</sup>			Distance = 2.3 miles D/Q = 6.4E-10 m <sup>-2</sup>					
Radio- Nuclide	Infant		Child		Teen		Adult	
	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway
H -3**	-0-	-0-	2.9E+2	-0-	3.3E+2	-0-	3.3E+2	-0-
Cr-51	-0-	-0-	4.4E+3	1.2E+6	5.5E+3	1.2E+6	3.7E+3	1.2E+6
Mn-54	-0-	-0-	4.1E+5	3.6E+8	5.2E+5	3.6E+8	3.6E+5	3.6E+8
Co-57	-0-	-0-	3.4E+3	8.9E+7	8.2E+3	8.9E+7	8.2E+3	8.9E+7
Co-58	-0-	-0-	2.9E+5	9.9E+7	3.5E+5	9.9E+7	2.4E+5	9.9E+7
Co-60	-0-	-0-	1.8E+6	5.6E+9	2.3E+6	5.6E+9	1.6E+6	5.6E+9
Sr-89	-0-	-0-	5.6E+5	5.6E+3	6.3E+5	5.6E+3	3.6E+5	5.6E+3
Sr-90	-0-	-0-	3.8E+6	-0-	4.3E+6	-0-	2.5E+6	-0-
Zr-95	-0-	-0-	5.8E+5	6.5E+7	7.0E+5	6.5E+7	4.6E+5	6.5E+7
Nb-95	-0-	-0-	1.6E+5	3.6E+7	2.0E+5	3.6E+7	1.3E+5	3.6E+7
Ru-103	-0-	-0-	1.7E+5	2.8E+7	2.0E+5	2.8E+7	1.3E+5	2.8E+7
Te-129m	-0-	-0-	4.6E+5	5.1E+6	5.1E+5	5.1E+6	3.2E+5	5.1E+6
Cs-134	-0-	-0-	3.1E+4	1.8E+9	3.8E+4	1.8E+9	2.5E+4	1.8E+9
Cs-136	-0-	-0-	3.8E+3	3.9E+7	4.6E+3	3.9E+7	3.1E+3	3.9E+7
Cs-137	-0-	-0-	2.7E+4	2.7E+9	3.1E+4	2.7E+9	2.0E+4	2.7E+9
Ba-140	-0-	-0-	4.5E+5	5.3E+6	5.3E+5	5.3E+6	3.3E+5	5.3E+6
Ce-141	-0-	-0-	1.4E+5	3.6E+6	1.6E+5	3.6E+6	9.4E+4	3.6E+6
Ce-144	-0-	-0-	3.1E+6	1.8E+7	3.5E+6	1.8E+7	2.0E+6	1.8E+7
I -131	-0-	-0-	4.2E+6	4.5E+6	3.8E+6	4.5E+6	3.1E+6	4.5E+6
I -132	-0-	-0-	5.0E+4	3.2E+5	3.9E+4	3.2E+5	3.0E+4	3.2E+5
I -133	-0-	-0-	1.0E+6	6.4E+5	7.6E+5	6.4E+5	5.6E+5	6.4E+5
I -134	-0-	-0-	1.3E+4	1.2E+5	1.0E+4	1.2E+5	7.8E+3	1.2E+5
I -135	-0-	-0-	2.1E+5	6.6E+5	1.6E+5	6.6E+5	1.2E+5	6.6E+5
UN-ID*	-0-	-0-	2.6E+5	1.9E+8	3.2E+5	1.9E+8	2.2E+5	1.9E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 1-10**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR G**

Pathway = San Onofre State Beach Surfcamp X/Q = 1.2E-7 sec/m <sup>3</sup>		Distance = 2.8 miles D/Q = 4.5E-10 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3**	-0-	-0-	3.1E+2	-0-	3.6E+2	-0-	6.3E+2	-0-
Cr-51	-0-	-0-	4.7E+3	1.3E+6	5.9E+3	1.3E+6	7.2E+3	2.3E+6
Mn-54	-0-	-0-	4.4E+5	3.9E+8	5.5E+5	3.9E+8	7.0E+5	6.9E+8
Co-57	-0-	-0-	3.7E+3	9.6E+7	8.8E+3	9.6E+7	1.6E+4	1.7E+8
Co-58	-0-	-0-	3.1E+5	1.1E+8	3.8E+5	1.1E+8	4.6E+5	1.9E+8
Co-60	-0-	-0-	2.0E+6	6.0E+9	2.4E+6	6.0E+9	3.0E+6	1.1E+10
Sr-89	-0-	-0-	6.0E+5	6.0E+3	6.8E+5	6.0E+3	7.0E+5	1.1E+4
Sr-90	-0-	-0-	4.1E+6	-0-	4.6E+6	-0-	4.8E+6	-0-
Zr-95	-0-	-0-	6.2E+5	7.0E+7	7.5E+5	7.0E+7	8.8E+5	1.3E+8
Nb-95	-0-	-0-	1.7E+5	3.8E+7	2.1E+5	3.8E+7	2.5E+5	6.8E+7
Ru-103	-0-	-0-	1.9E+5	3.0E+7	2.2E+5	3.0E+7	2.5E+5	5.4E+7
Te-129m	-0-	-0-	4.9E+5	5.5E+6	5.5E+5	5.5E+6	6.2E+5	9.8E+6
Cs-134	-0-	-0-	3.4E+4	1.9E+9	4.1E+4	1.9E+9	4.9E+4	3.4E+9
Cs-136	-0-	-0-	4.1E+3	4.2E+7	5.0E+3	4.2E+7	6.0E+3	7.5E+7
Cs-137	-0-	-0-	2.9E+4	2.9E+9	3.4E+4	2.9E+9	3.8E+4	5.1E+9
Ba-140	-0-	-0-	4.9E+5	5.7E+6	5.7E+5	5.7E+6	6.4E+5	1.0E+7
Ce-141	-0-	-0-	1.5E+5	3.8E+6	1.7E+5	3.8E+6	1.8E+5	6.8E+6
Ce-144	-0-	-0-	3.3E+6	1.9E+7	3.7E+6	1.9E+7	3.9E+6	3.5E+7
I -131	-0-	-0-	4.5E+6	4.8E+6	4.1E+6	4.8E+6	6.0E+6	8.6E+6
I -132	-0-	-0-	5.4E+4	3.5E+5	4.2E+4	3.5E+5	5.7E+4	6.2E+5
I -133	-0-	-0-	1.1E+6	6.8E+5	8.2E+5	6.8E+5	1.1E+6	1.2E+6
I -134	-0-	-0-	1.4E+4	1.3E+5	1.1E+4	1.3E+5	1.5E+4	2.2E+5
I -135	-0-	-0-	2.2E+5	7.0E+5	1.7E+5	7.0E+5	2.2E+5	1.3E+6
UN-ID*	-0-	-0-	2.8E+5	2.1E+8	3.5E+5	2.1E+8	4.3E+5	3.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-1**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR D**

Pathway = Camp Horno Sewage Trmnt. X/Q = 1.2E-7 sec/m <sup>3</sup>		Distance = 3.2 Miles D/Q = 1.2E-9 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+3	1.1E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	3.2E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	8.4E+4	7.8E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	8.7E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	4.9E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	4.9E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	5.7E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	3.1E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	2.5E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+5	4.5E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.9E+5	1.6E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+4	3.4E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	2.3E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+5	4.7E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	8.3E+4	3.1E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	1.6E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	2.7E+6	3.9E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+4	2.8E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	4.9E+5	5.6E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	6.8E+3	1.0E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+5	5.8E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	1.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-2**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR E**

Pathway = Camp Horno X/Q = 6.0E-7 sec/m <sup>3</sup>		Distance = 3.7 Miles D/Q = 5.7E-9 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+5	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.9E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	8.5E+5	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	6.2E+5	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-3**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR F**

Pathway = Sheep (Meat)/Shepherd X/Q = 7.2E-6 sec/m <sup>3</sup>		Distance = 0.3 Miles D/Q = 4.5E-8 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I -131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I -132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I -133	-0-	-0-	-0-	1.6E+2	-0-	8.7E+3	1.2E+4	1.3E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I -135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-3**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR F**

Pathway = San Onofre State Park/Guard Shack		Distance = 0.4 Miles						
X/Q = 5.4E-6 sec/m <sup>3</sup>		D/Q = 3.5E-8 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+3	8.0E+5
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	2.4E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+4	5.9E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+5	6.5E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+6	3.7E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	3.7E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+5	4.3E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+4	2.3E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+4	1.9E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	3.4E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.2E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+4	2.6E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.8E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+5	3.5E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	6.2E+4	2.3E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	1.2E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+6	2.9E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+4	2.1E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+5	4.2E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	5.1E+3	7.7E+4
I -135	-0-	-0-	-0-	-0-	-0-	-0-	7.7E+4	4.3E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.3E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-3**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR F**

Pathway = Deer Consumer/Hunter X/Q = 5.4E-6 sec/m <sup>3</sup>			Distance = 0.4 Miles D/Q = 3.5E-8 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.5E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.8E+4	4.1E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.0E+4	2.3E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.8E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
Cs-137	-0-	-0-	-0-	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.4E+4
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.2E+4
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-3**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR F**

Pathway = Border Patrol Checkpt. X/Q = 1.2E-6 sec/m <sup>3</sup>			Distance = 1.4 Miles D/Q = 8.2E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	4.1E+3	1.3E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	3.9E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	9.8E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+5	1.1E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+6	6.1E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	6.2E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.8E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	7.2E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	3.9E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	3.1E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+5	5.6E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	1.9E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	4.2E+4	4.3E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+5	2.9E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	5.9E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+5	3.9E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	3.4E+6	4.9E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+4	3.5E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	6.1E+5	7.0E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	8.5E+3	1.3E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+5	7.2E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+5	2.1E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-4**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR G**

Pathway = San Onofre Bch Campgd X/Q = 4.5E-6 sec/m <sup>3</sup>			Distance = 0.4 Miles D/Q = 1.8E-8 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	8.0E+1	-0-	1.4E+2	-0-	1.6E+2	-0-	2.9E+2	-0-
Cr-51	1.6E+3	5.7E+5	2.1E+3	5.7E+5	2.6E+3	5.7E+5	3.3E+3	1.1E+6
Mn-54	1.2E+5	1.7E+8	1.9E+5	1.7E+8	2.4E+5	1.7E+8	3.2E+5	3.2E+8
Co-57	4.7E+4	4.2E+7	6.3E+4	4.2E+7	7.2E+4	4.2E+7	8.4E+4	7.8E+7
Co-58	9.6E+4	4.7E+7	1.4E+5	4.7E+7	1.7E+5	4.7E+7	2.1E+5	8.7E+7
Co-60	5.6E+5	2.7E+9	8.7E+5	2.7E+9	1.1E+6	2.7E+9	1.4E+6	4.9E+9
Sr-89	2.5E+5	2.7E+3	2.7E+5	2.7E+3	3.0E+5	2.7E+3	3.2E+5	4.9E+3
Sr-90	5.0E+6	-0-	1.2E+7	-0-	1.3E+7	-0-	2.3E+7	-0-
Zr-95	2.2E+5	3.1E+7	2.8E+5	3.1E+7	3.3E+5	3.1E+7	4.0E+5	5.7E+7
Nb-95	5.9E+4	1.7E+7	7.6E+4	1.7E+7	9.3E+4	1.7E+7	1.2E+5	3.1E+7
Ru-103	6.8E+4	1.3E+7	8.2E+4	1.3E+7	9.7E+4	1.3E+7	1.2E+5	2.5E+7
Te-129m	2.1E+5	2.4E+6	2.2E+5	2.4E+6	2.4E+5	2.4E+6	2.6E+5	4.5E+6
Cs-134	8.7E+4	8.4E+8	1.3E+5	8.4E+8	1.4E+5	8.4E+8	1.9E+5	1.6E+9
Cs-136	1.7E+4	1.9E+7	2.1E+4	1.9E+7	2.4E+4	1.9E+7	3.3E+4	3.4E+7
Cs-137	7.5E+4	1.3E+9	1.1E+5	1.3E+9	1.0E+5	1.3E+9	1.4E+5	2.3E+9
Ba-140	2.0E+5	2.5E+6	2.1E+5	2.5E+6	2.5E+5	2.5E+6	2.9E+5	4.7E+6
Ce-141	6.4E+4	1.7E+6	6.7E+4	1.7E+6	7.6E+4	1.7E+6	8.3E+4	3.1E+6
Ce-144	1.2E+6	8.6E+6	1.5E+6	8.6E+6	1.6E+6	8.6E+6	1.8E+6	1.6E+7
I -131	1.8E+6	2.1E+6	2.0E+6	2.1E+6	1.8E+6	2.1E+6	2.7E+6	3.9E+6
I -132	2.1E+4	1.5E+5	2.4E+4	1.5E+5	1.9E+4	1.5E+5	2.6E+4	2.8E+5
I -133	4.4E+5	3.0E+5	4.7E+5	3.0E+5	3.6E+5	3.0E+5	4.9E+5	5.6E+5
I -134	5.5E+3	5.5E+4	6.3E+3	5.5E+4	4.9E+3	5.5E+4	6.8E+3	1.0E+5
I -135	8.6E+4	3.1E+5	9.8E+4	3.1E+5	7.7E+4	3.1E+5	1.0E+5	5.8E+5
UN-ID	8.0E+4	9.2E+7	1.2E+5	9.2E+7	1.5E+5	9.2E+7	2.0E+5	1.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-4**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR G**

Pathway = Highway Patrol Weigh Station X/Q = 4.2E-7 sec/m <sup>3</sup>		Distance = 1.6 Miles D/Q = 1.7E-9 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	3.4E+3	1.1E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+5	3.3E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	8.8E+4	8.1E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+5	9.0E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	5.1E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+5	5.1E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	4.2E+5	6.0E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	3.2E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	2.6E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.8E+5	4.7E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	1.6E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	3.5E+4	3.6E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	2.4E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+5	4.9E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+4	3.2E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	1.7E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	2.8E+6	4.1E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	2.7E+4	2.9E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	5.1E+5	5.8E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	7.1E+3	1.1E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	6.0E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	1.8E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-4**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR G**

Pathway = Sheep (Meat)/Shepherd X/Q = 2.4E-7 sec/m <sup>3</sup>			Distance = 2.3 Miles D/Q = 9.2E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I -131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I -132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I -133	-0-	-0-	-0-	1.6E+2	-0-	8.7E+3	1.2E+4	1.3E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I -135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 2-4**

**SOUTH YARD FACILITY DOSE PARAMETER R<sub>i</sub> FOR SECTOR G**

Pathway = Deer Consumer/Hunter X/Q = 1.8E-7 sec/m <sup>3</sup>			Distance = 2.9 Miles D/Q = 6.4E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.5E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.8E+4	4.1E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.0E+4	2.3E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.8E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
Cs-137	-0-	-0-	-0-	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.4E+4
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.2E+4
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-1**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR P**

Pathway = Surf Beach/Life Guard X/Q = 3.8E-6 sec/m <sup>3</sup>			Distance = 0.3 miles D/Q = 1.7E-8 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	7.8E+0	-0-	4.2E+1	-0-	1.2E+2	-0-
Cr-51	-0-	-0-	1.2E+2	3.2E+4	6.9E+2	1.5E+5	1.3E+3	4.2E+5
Mn-54	-0-	-0-	1.1E+4	9.5E+6	6.5E+4	4.5E+7	1.3E+5	1.3E+8
Co-57	-0-	-0-	9.1E+1	2.4E+6	1.0E+3	1.1E+7	2.9E+3	3.1E+7
Co-58	-0-	-0-	7.6E+3	2.6E+6	4.4E+4	1.2E+7	8.5E+4	3.5E+7
Co-60	-0-	-0-	4.9E+4	1.5E+8	2.9E+5	7.0E+8	5.4E+5	2.0E+9
Sr-89	-0-	-0-	1.5E+4	1.5E+2	7.9E+4	7.1E+2	1.3E+5	2.0E+3
Sr-90	-0-	-0-	1.0E+5	-0-	5.4E+5	-0-	8.8E+5	-0-
Zr-95	-0-	-0-	1.5E+4	1.7E+6	8.8E+4	8.2E+6	1.6E+5	2.3E+7
Nb-95	-0-	-0-	4.2E+3	9.4E+5	2.5E+4	4.5E+6	4.6E+4	1.2E+7
Ru-103	-0-	-0-	4.6E+3	7.5E+5	2.6E+4	3.6E+6	4.6E+4	9.9E+6
Te-129m	-0-	-0-	1.2E+4	1.4E+5	6.5E+4	6.4E+5	1.1E+5	1.8E+6
Cs-134	-0-	-0-	8.3E+2	4.7E+7	4.8E+3	2.2E+8	8.9E+3	6.2E+8
Cs-136	-0-	-0-	1.0E+2	1.0E+6	5.8E+2	4.9E+6	1.1E+3	1.4E+7
Cs-137	-0-	-0-	7.2E+2	7.1E+7	4.0E+3	3.4E+8	6.9E+3	9.4E+8
Ba-140	-0-	-0-	1.2E+4	1.4E+5	6.6E+4	6.7E+5	1.2E+5	1.9E+6
Ce-141	-0-	-0-	3.8E+3	9.4E+4	2.0E+4	4.5E+5	3.3E+4	1.2E+6
Ce-144	-0-	-0-	8.2E+4	4.8E+5	4.4E+5	2.3E+6	7.1E+5	6.4E+6
I -131	-0-	-0-	1.1E+5	1.2E+5	4.8E+5	5.6E+5	1.1E+6	1.6E+6
I -132	-0-	-0-	1.3E+3	8.5E+3	4.9E+3	4.1E+4	1.0E+4	1.1E+5
I -133	-0-	-0-	2.7E+4	1.7E+4	9.5E+4	8.0E+4	2.0E+5	2.2E+5
I -134	-0-	-0-	3.5E+2	3.1E+3	1.3E+3	1.5E+4	2.7E+3	4.1E+4
I -135	-0-	-0-	5.5E+3	1.7E+4	2.0E+4	8.2E+4	4.1E+4	2.3E+5
UN-ID	-0-	-0-	6.9E+3	5.1E+6	4.1E+4	2.4E+7	7.9E+4	6.8E+7

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-1**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR P**

Pathway = Cotton Point Estates (w/o Garden)		Distance = 2.5 miles						
X/Q = 1.4E-7 sec/m <sup>3</sup>		D/Q = 4.2E-10 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-1**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR P**

Pathway = Cotton Point Estates with Garden		Distance = 2.6 miles						
X/Q = 1.3E-7 sec/m <sup>3</sup>		D/Q = 3.9E-10 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	4.0E+3	1.3E+3	2.6E+3	1.3E+3	2.3E+3
Cr-51	1.3E+4	4.7E+6	1.7E+4	1.1E+7	2.1E+4	1.5E+7	1.4E+4	1.6E+7
Mn-54	1.0E+6	1.4E+9	1.6E+6	2.0E+9	2.0E+6	2.3E+9	1.4E+6	2.3E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	5.8E+8	3.1E+4	6.6E+8	3.1E+4	6.3E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	7.5E+8	1.3E+6	9.7E+8	9.3E+5	9.9E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.4E+10	8.7E+6	2.5E+10	6.0E+6	2.5E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	3.5E+10	2.4E+6	1.5E+10	1.4E+6	9.8E+9
Sr-90	1.1E+7	-0-	1.5E+7	1.4E+12	1.6E+7	8.3E+11	9.6E+6	6.7E+11
Zr-95	1.8E+6	2.5E+8	2.2E+6	1.1E+9	2.7E+6	1.5E+9	1.8E+6	1.4E+9
Nb-95	4.8E+5	1.4E+8	6.1E+5	4.3E+8	7.5E+5	5.9E+8	5.0E+5	6.1E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	5.0E+8	7.8E+5	6.8E+8	5.0E+5	6.6E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.9E+9	2.0E+6	1.8E+9	1.2E+6	1.2E+9
Cs-134	8.0E+4	6.8E+9	1.2E+5	3.2E+10	1.5E+5	2.3E+10	9.8E+4	1.8E+10
Cs-136	1.2E+4	1.5E+8	1.5E+4	3.7E+8	1.8E+4	3.2E+8	1.2E+4	3.2E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	3.4E+10	1.2E+5	2.4E+10	7.5E+4	1.9E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	3.0E+8	2.0E+6	2.3E+8	1.3E+6	2.8E+8
Ce-141	5.2E+5	1.4E+7	5.4E+5	4.2E+8	6.1E+5	5.5E+8	3.6E+5	5.2E+8
Ce-144	9.8E+6	7.0E+7	1.2E+7	1.0E+10	1.3E+7	1.3E+10	7.8E+6	1.1E+10
I -131	1.5E+7	1.7E+7	1.6E+7	4.8E+10	1.5E+7	3.1E+10	1.2E+7	3.8E+10
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	8.1E+8	2.9E+6	4.6E+8	2.2E+6	5.3E+8
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	1.2E+7	6.2E+5	8.2E+6	4.5E+5	9.1E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	3.5E+9	1.2E+6	2.6E+9	8.6E+5	2.0E+9

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-2**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q**

Pathway = San Onofre Recreation Beach			Distance = 0.8 miles					
X/Q = 1.2E-6 sec/m <sup>3</sup>			D/Q = 6.1E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-2**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q**

Pathway = San Onofre Mobile Homes X/Q = 9.1E-7 sec/m <sup>3</sup>			Distance = 1.2 miles D/Q = 4.3E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-2**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q**

Pathway = San Mateo Pt Homes X/Q = 2.8E-7 sec/m <sup>3</sup>			Distance = 2.5 miles D/Q = 1.1E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-2**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q**

Pathway = San Clemente Resident With Garden		Distance = 3.9 miles						
X/Q = 1.5E-7 sec/m <sup>3</sup>		D/Q = 5.1E-10 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	4.0E+3	1.3E+3	2.6E+3	1.3E+3	2.3E+3
Cr-51	1.3E+4	4.7E+6	1.7E+4	1.1E+7	2.1E+4	1.5E+7	1.4E+4	1.6E+7
Mn-54	1.0E+6	1.4E+9	1.6E+6	2.0E+9	2.0E+6	2.3E+9	1.4E+6	2.3E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	5.8E+8	3.1E+4	6.6E+8	3.1E+4	6.3E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	7.5E+8	1.3E+6	9.7E+8	9.3E+5	9.9E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.4E+10	8.7E+6	2.5E+10	6.0E+6	2.5E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	3.5E+10	2.4E+6	1.5E+10	1.4E+6	9.8E+9
Sr-90	1.1E+7	-0-	1.5E+7	1.4E+12	1.6E+7	8.3E+11	9.6E+6	6.7E+11
Zr-95	1.8E+6	2.5E+8	2.2E+6	1.1E+9	2.7E+6	1.5E+9	1.8E+6	1.4E+9
Nb-95	4.8E+5	1.4E+8	6.1E+5	4.3E+8	7.5E+5	5.9E+8	5.0E+5	6.1E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	5.0E+8	7.8E+5	6.8E+8	5.0E+5	6.6E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.9E+9	2.0E+6	1.8E+9	1.2E+6	1.2E+9
Cs-134	8.0E+4	6.8E+9	1.2E+5	3.2E+10	1.5E+5	2.3E+10	9.8E+4	1.8E+10
Cs-136	1.2E+4	1.5E+8	1.5E+4	3.7E+8	1.8E+4	3.2E+8	1.2E+4	3.2E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	3.4E+10	1.2E+5	2.4E+10	7.5E+4	1.9E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	3.0E+8	2.0E+6	2.3E+8	1.3E+6	2.8E+8
Ce-141	5.2E+5	1.4E+7	5.4E+5	4.2E+8	6.1E+5	5.5E+8	3.6E+5	5.2E+8
Ce-144	9.8E+6	7.0E+7	1.2E+7	1.0E+10	1.3E+7	1.3E+10	7.8E+6	1.1E+10
I -131	1.5E+7	1.7E+7	1.6E+7	4.8E+10	1.5E+7	3.1E+10	1.2E+7	3.8E+10
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	8.1E+8	2.9E+6	4.6E+8	2.2E+6	5.3E+8
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	1.2E+7	6.2E+5	8.2E+6	4.5E+5	9.1E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	3.5E+9	1.2E+6	2.6E+9	8.6E+5	2.0E+9

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-3**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR R**

Pathway = San Onofre Mobile Homes X/Q = 6.0E-7 sec/m <sup>3</sup>			Distance = 1.2 miles D/Q = 3.5E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-4**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR A**

Pathway = Camp Mesa X/Q = 4.2E-6 sec/m <sup>3</sup>		Distance = 0.3 miles D/Q = 3.2E-8 m <sup>-2</sup>						
Radio- Nuclide	Infant		Child		Teen		Adult	
	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-4**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR A**

Pathway = Camp San Mateo X/Q = 7.8E-8 sec/m <sup>3</sup>			Distance = 3.5 miles D/Q = 4.4E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-5**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR B**

Pathway = Camp Mesa X/Q = 3.9E-6 sec/m <sup>3</sup>			Distance = 0.3 miles D/Q = 3.4E-8 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	4.9E+3	3.4E+8	1.3E+4	3.4E+8	3.1E+4	3.4E+8	3.1E+4	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	1.1E+7	-0-	1.5E+7	-0-	1.6E+7	-0-	9.6E+6	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	8.0E+4	6.8E+9	1.2E+5	6.8E+9	1.5E+5	6.8E+9	9.8E+4	6.8E+9
Cs-136	1.2E+4	1.5E+8	1.5E+4	1.5E+8	1.8E+4	1.5E+8	1.2E+4	1.5E+8
Cs-137	7.1E+4	1.0E+10	1.0E+5	1.0E+10	1.2E+5	1.0E+10	7.5E+4	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-5**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR B**

Pathway = Sanitary Landfill X/Q = 1.4E-7 sec/m <sup>3</sup>			Distance = 2.1 miles D/Q = 1.2E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	5.8E+1	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	6.6E+2	2.1E+5
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	6.4E+4	6.3E+7
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+3	1.6E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	4.2E+4	1.7E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	2.7E+5	9.8E+8
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	6.4E+4	9.9E+2
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	4.4E+5	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	8.1E+4	1.1E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+4	6.2E+6
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+4	5.0E+6
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	5.6E+4	9.0E+5
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+3	3.1E+8
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	5.5E+2	6.9E+6
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	3.4E+3	4.7E+8
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	5.8E+4	9.4E+5
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+4	6.2E+5
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	3.2E+6
I -131	-0-	-0-	-0-	-0-	-0-	-0-	5.4E+5	7.9E+5
I -132	-0-	-0-	-0-	-0-	-0-	-0-	5.2E+3	5.7E+4
I -133	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	1.1E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+3	2.1E+4
I -135	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+4	1.2E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	3.9E+4	3.4E+7

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-6**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR C**

Pathway = Deer Consumer/Hunter X/Q = 3.7E-7 sec/m <sup>3</sup>			Distance = 1.1 miles D/Q = 4.6E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	5.4E+0	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	6.2E+1	2.1E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	6.0E+3	8.6E+6
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.4E+2	1.5E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	4.0E+3	3.9E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	2.6E+4	2.3E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	6.0E+3	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	4.1E+4	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	7.6E+3	1.9E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	2.2E+3	8.1E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	2.2E+3	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	5.3E+3	5.3E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	4.2E+2	1.8E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	5.2E+1	6.1E+6
Cs-137	-0-	-0-	-0-	1.2E+8	-0-	9.3E+7	3.2E+2	1.6E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	5.5E+3	6.9E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	1.6E+3	3.9E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	3.3E+4	4.7E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	5.1E+4	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	4.9E+2	5.3E+3
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	9.3E+3	1.1E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+2	1.9E+3
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.9E+3	1.1E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	3.7E+3	1.3E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-6**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR C**

Pathway = Camp San Onofre X/Q = 8.4E-8 sec/m <sup>3</sup>			Distance = 2.9 miles D/Q = 7.4E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-7**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR D**

Pathway = Camp San Onofre X/Q = 7.0E-8 sec/m <sup>3</sup>			Distance = 3.0 miles D/Q = 7.2E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-8**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR E**

Pathway = Deer Consumer/Hunter X/Q = 6.0E-7 sec/m <sup>3</sup>			Distance = 1.0 miles D/Q = 8.4E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	8.9E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	1.0E+3	5.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	9.8E+4	1.0E+8
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	2.2E+3	3.8E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	6.5E+4	6.4E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	4.2E+5	1.6E+9
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	9.8E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	6.7E+5	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	1.2E+5	2.1E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	3.5E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	3.5E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	8.6E+4	5.3E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	6.8E+3	6.3E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	8.4E+2	1.6E+7
Cs-137	-0-	-0-	-0-	1.2E+8	-0-	9.3E+7	5.3E+3	8.4E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	8.9E+4	8.2E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	2.5E+4	4.8E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	5.5E+5	5.2E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	8.4E+5	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	8.0E+3	8.7E+4
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	1.5E+5	1.7E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+3	3.2E+4
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	3.1E+4	1.8E+5
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	6.1E+4	1.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-8**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR E**

Pathway = Camp Horno X/Q = 7.3E-8 sec/m <sup>3</sup>			Distance = 4.2 miles D/Q = 6.9E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+4	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.5E+4	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I -132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I -133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-9**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR F**

Pathway = San Onofre State Park/Guard Shack		Distance = 1.0 miles						
X/Q = 5.8E-7 sec/m <sup>3</sup>		D/Q = 4.8E-9 m <sup>-2</sup>						
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+3	8.0E+5
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	2.4E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	5.4E+3	5.9E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+5	6.5E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+6	3.7E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	3.7E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+5	4.3E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+4	2.3E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+4	1.9E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	3.4E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+4	1.2E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+3	2.6E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+4	1.8E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+5	3.5E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	6.2E+4	2.3E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	1.2E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+6	2.9E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+4	2.1E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+5	4.2E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	5.1E+3	7.7E+4
I -135	-0-	-0-	-0-	-0-	-0-	-0-	7.7E+4	4.3E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.3E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-9**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR F**

Pathway = Border Patrol Checkpoint X/Q = 1.8E-7 sec/m <sup>3</sup>			Distance = 2.2 miles D/Q = 1.3E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+3	1.2E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	3.6E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	8.1E+3	8.8E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	9.8E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+6	5.5E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	5.6E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	4.6E+5	6.5E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+5	3.5E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+5	2.8E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	5.1E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+4	1.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.9E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.9E+4	2.7E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+5	5.3E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+4	3.5E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+6	1.8E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+6	4.4E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+4	3.2E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	5.5E+5	6.3E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	7.7E+3	1.2E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	6.5E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+5	1.9E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-10**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR G**

Pathway = San Onofre State Park Beach Campground X/Q = 2.0E-7 sec/m <sup>3</sup>		Distance = 2.0 miles D/Q = 8.2E-10 m <sup>-2</sup>						
Radio- Nuclide	Infant		Child		Teen		Adult	
	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway
H -3	5.3E+1	-0-	9.2E+1	-0-	1.0E+2	-0-	1.0E+2	-0-
Cr-51	1.1E+3	3.8E+5	1.4E+3	3.8E+5	1.7E+3	3.8E+5	1.2E+3	3.8E+5
Mn-54	8.2E+4	1.1E+8	1.3E+5	1.1E+8	1.6E+5	1.1E+8	1.2E+5	1.1E+8
Co-57	4.0E+2	2.8E+7	1.1E+3	2.8E+7	2.6E+3	2.8E+7	2.6E+3	2.8E+7
Co-58	6.4E+4	3.1E+7	9.1E+4	3.1E+7	1.1E+5	3.1E+7	7.6E+4	3.1E+7
Co-60	3.7E+5	1.8E+9	5.8E+5	1.8E+9	7.2E+5	1.8E+9	4.9E+5	1.8E+9
Sr-89	1.7E+5	1.8E+3	1.8E+5	1.8E+3	2.0E+5	1.8E+3	1.2E+5	1.8E+3
Sr-90	9.2E+5	-0-	1.2E+6	-0-	1.4E+6	-0-	7.9E+5	-0-
Zr-95	1.4E+5	2.1E+7	1.8E+5	2.1E+7	2.2E+5	2.1E+7	1.5E+5	2.1E+7
Nb-95	3.9E+4	1.1E+7	5.0E+4	1.1E+7	6.2E+4	1.1E+7	4.1E+4	1.1E+7
Ru-103	4.5E+4	8.9E+6	5.4E+4	8.9E+6	6.4E+4	8.9E+6	4.1E+4	8.9E+6
Te-129m	1.4E+5	1.6E+6	1.4E+5	1.6E+6	1.6E+5	1.6E+6	1.0E+5	1.6E+6
Cs-134	6.5E+3	5.6E+8	9.9E+3	5.6E+8	1.2E+4	5.6E+8	8.0E+3	5.6E+8
Cs-136	9.7E+2	1.2E+7	1.2E+3	1.2E+7	1.5E+3	1.2E+7	9.9E+2	1.2E+7
Cs-137	5.9E+3	8.5E+8	8.5E+3	8.5E+8	9.9E+3	8.5E+8	6.2E+3	8.5E+8
Ba-140	1.3E+5	1.7E+6	1.4E+5	1.7E+6	1.7E+5	1.7E+6	1.0E+5	1.7E+6
Ce-141	4.2E+4	1.1E+6	4.5E+4	1.1E+6	5.0E+4	1.1E+6	3.0E+4	1.1E+6
Ce-144	8.1E+5	5.7E+6	9.8E+5	5.7E+6	1.1E+6	5.7E+6	6.4E+5	5.7E+6
I -131	1.2E+6	1.4E+6	1.3E+6	1.4E+6	1.2E+6	1.4E+6	9.8E+5	1.4E+6
I -132	1.4E+4	1.0E+5	1.6E+4	1.0E+5	1.2E+4	1.0E+5	9.4E+3	1.0E+5
I -133	2.9E+5	2.0E+5	3.2E+5	2.0E+5	2.4E+5	2.0E+5	1.8E+5	2.0E+5
I -134	3.7E+3	3.7E+4	4.2E+3	3.7E+4	3.2E+3	3.7E+4	2.5E+3	3.7E+4
I -135	5.7E+4	2.1E+5	6.5E+4	2.1E+5	5.1E+4	2.1E+5	3.7E+4	2.1E+5
UN-ID	5.3E+4	6.1E+7	8.2E+4	6.1E+7	1.0E+5	6.1E+7	7.1E+4	6.1E+7

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**TABLE 3-10**

**NORTH INDUSTRIAL AREA (UNIT 1) DOSE PARAMETER R<sub>i</sub> FOR SECTOR G**

Pathway = San Onofre State Beach Campground Resident X/Q = 1.1E-7 sec/m <sup>3</sup>			Distance = 3.0 miles D/Q = 4.0E-10 m <sup>-2</sup>					
Radio- Nuclide	Infant		Child		Teen		Adult	
	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway
H -3	-0-	-0-	9.2E+1	-0-	1.0E+2	-0-	2.4E+2	-0-
Cr-51	-0-	-0-	1.4E+3	3.8E+5	1.7E+3	3.8E+5	2.8E+3	8.9E+5
Mn-54	-0-	-0-	1.3E+5	1.1E+8	1.6E+5	1.1E+8	2.7E+5	2.7E+8
Co-57	-0-	-0-	1.1E+3	2.8E+7	2.6E+3	2.8E+7	6.0E+3	6.6E+7
Co-58	-0-	-0-	9.1E+4	3.1E+7	1.1E+5	3.1E+7	1.8E+5	7.3E+7
Co-60	-0-	-0-	5.8E+5	1.8E+9	7.2E+5	1.8E+9	1.1E+6	4.1E+9
Sr-89	-0-	-0-	1.8E+5	1.8E+3	2.0E+5	1.8E+3	2.7E+5	4.1E+3
Sr-90	-0-	-0-	1.2E+6	-0-	1.4E+6	-0-	1.8E+6	-0-
Zr-95	-0-	-0-	1.8E+5	2.1E+7	2.2E+5	2.1E+7	3.4E+5	4.8E+7
Nb-95	-0-	-0-	5.0E+4	1.1E+7	6.2E+4	1.1E+7	9.7E+4	2.6E+7
Ru-103	-0-	-0-	5.4E+4	8.9E+6	6.4E+4	8.9E+6	9.7E+4	2.1E+7
Te-129m	-0-	-0-	1.4E+5	1.6E+6	1.6E+5	1.6E+6	2.4E+5	3.8E+6
Cs-134	-0-	-0-	9.9E+3	5.6E+8	1.2E+4	5.6E+8	1.9E+4	1.3E+9
Cs-136	-0-	-0-	1.2E+3	1.2E+7	1.5E+3	1.2E+7	2.3E+3	2.9E+7
Cs-137	-0-	-0-	8.5E+3	8.5E+8	9.9E+3	8.5E+8	1.4E+4	2.0E+9
Ba-140	-0-	-0-	1.4E+5	1.7E+6	1.7E+5	1.7E+6	2.4E+5	3.9E+6
Ce-141	-0-	-0-	4.5E+4	1.1E+6	5.0E+4	1.1E+6	6.9E+4	2.6E+6
Ce-144	-0-	-0-	9.8E+5	5.7E+6	1.1E+6	5.7E+6	1.5E+6	1.3E+7
I -131	-0-	-0-	1.3E+6	1.4E+6	1.2E+6	1.4E+6	2.3E+6	3.3E+6
I -132	-0-	-0-	1.6E+4	1.0E+5	1.2E+4	1.0E+5	2.2E+4	2.4E+5
I -133	-0-	-0-	3.2E+5	2.0E+5	2.4E+5	2.0E+5	4.1E+5	4.7E+5
I -134	-0-	-0-	4.2E+3	3.7E+4	3.2E+3	3.7E+4	5.7E+3	8.6E+4
I -135	-0-	-0-	6.5E+4	2.1E+5	5.1E+4	2.1E+5	8.6E+4	4.8E+5
UN-ID	-0-	-0-	8.2E+4	6.1E+7	1.0E+5	6.1E+7	1.7E+5	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

**OFFSITE DOSE CALCULATION MANUAL**

**NUCLEAR ORGANIZATION**

**SAN ONOFRE NUCLEAR GENERATING STATION (SONGS)**

**APPENDIX B**

**SUPPLEMENTAL INFORMATION FOR EFFLUENT CONTROLS**

ODCM APPENDIX B

TABLE OF CONTENTS

<u>Section</u>	<u>Title</u>	<u>Page</u>
1.0	Gas and Liquid Effluent Concentration Limits for Radiation Monitor Setpoint Calculations . . . . .	B1-1 thru B1-5
1-1	K. Yhip to D. Dick, Memorandum for file "Recommended Effluent Concentration Limits from 10CFR20 Appendix B, Table 2, for setpoint calculations," dated April 23, 1993 . . . . .	B1-1
1-2	Table of the Gas and Liquid Concentrations Limits for Specific Isotopes . . . . .	B1-2
2.0	SONGS Effluent Control Limits: 10 CFR 20 impact . . . . .	B2-1 thru B2-2
2-1	E.S. Medling to J. Clark and P. Knapp, Memorandum for file "Impact of new 10 CFR 20 upon SONGS Effluent Control Limits," dated June 14, 1993. . . . .	B2-1

April 23, 1993

TO: DARYL DICK, SONGS Effluent Engineering


SUBJECT: RECOMMENDED EFFLUENT CONCENTRATION LIMITS FROM 10CFR20 APPENDIX B,  
TABLE 2, FOR SETPOINT CALCULATIONS

Daryl,

I have indicated on the attached table which effluent concentration limits (ECLs) are recommended for use when calculating radiation monitor setpoint values for liquid and airborne radioactive effluent releases from SONGS.

For simplicity's sake, when the station implements the new 10CFR20, ECLs should be used exclusively. In cases where more than one value is listed (based on retention) in Appendix B, Table 2, the most conservative value is recommended for routine calculations. Under conditions which require more flexibility, actual chemical and physical characteristics of the release stream may be considered to allow use of a more representative value. It is recommended that each of these instances be documented. Since no ECLs are provided in Column 2 for dissolved and entrained gases in liquids, per NUREG 1301, "Offsite Dose Calculation manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors", Specification 3.11.1.1, a value of  $2E-4$   $\mu\text{Ci/ml}$  should be used.

If there are any questions, please call me at 50512.

  
Kathleen Yhip  
HPE Engineer

cc: HPE Files

**TABLE 1-1**

**UNITS 2 & 3 DOSE PARAMETER R<sub>i</sub> FOR SECTOR P**

GAS AND LIQUID EFFLUENT CONCENTRATION LIMIT (ECL) VALUES						
	ISOTOPE	GAS ECL	GAS MPC	ISOTOPE	LIQUID ECL	LIQUID MPC
		(ECL)	(MPC)		(ECL)	(MPC)
1	H-3	1E-7	2E-7	H-3	1E-3	3E-3
2	Na-24	7E-9	5E-9	Na-24	5E-5	3E-5
3	Ar-41	1E-8	4E-8	Ar-41		2E-4
4	Sc-46	3E-10	8E-10	Sc-46	1E-5	4E-5
5	Cr-51	6E-8 d 3E-8 w, a	8E-8	Cr-51	5E-4	2E-3
6	Mn-54	1E-9	1E-9	Mn-54	3E-5	1E-4
7	Mn-56	2E-8 d 3E-8 w	2E-8	Mn-56	7E-5	1E-4
8	Fe-55	3E-9 d 6E-9 w	3E-8	Fe-55	1E-4	8E-4
9	Fe-59	5E-10 d 7E-10 w	2E-9	Fe-59	1E-5	5E-5
10	Co-57	4E-9 w 9E-10 a	6E-9	Co-57	6E-5	4E-4
11	Co-58	2E-9 w 1E-9 a	2E-9	Co-58	2E-5	9E-5
12	Co-60	2E-10 w 5E-11 a	3E-10	Co-60	3E-6	3E-5
13	Cu-64	4E-8 d 3E-8 w, a	4E-8	Cu-64	2E-4	2E-4
14	Zn-65	4E-10	2E-9	Zn-65	5E-6	1E-4
15	Br-82	6E-9 d 5E-9 w	6E-9	Br-82	4E-5	4E-5
16	Br-84	8E-8 d 9E-8 w	3E-8	Br-84	4E-4	2E-4
17	Kr-85	7E-7	3E-7	Kr-85		2E-4
18	Kr-85m	1E-7	1E-7	Kr-85m		2E-4
19	Kr-87	2E-8	2E-8	Kr-87		2E-4
20	Kr-88	9E-8	2E-8	Kr-88		2E-4
21	Rb-88	9E-8	2E-4	Rb-88	4E-4	2E-4

GAS AND LIQUID EFFLUENT CONCENTRATION LIMIT (ECL) VALUES						
	ISOTOPE	GAS ECL	GAS MPC	ISOTOPE	LIQUID ECL	LIQUID MPC
		(ECL)	(MPC)		(ECL)	(MPC)
22	Rb-89	2E-7	2E-4	Rb-89	9E-4	2E-4
23	Sr-89	1E-9 d 2E-10 a	3E-10	Sr-89	8E-6	3E-6
24	Sr-90	3E-11 d 6E-12 a	3E-11	Sr-90	5E-7	3E-7
25	Sr-91	8E-9 d 5E-9 a	9E-9	Sr-91	2E-5	5E-5
26	Sr-92	1E-8 d 9E-9 a	1E-8	Sr-92	4E-5	6E-5
27	Y-90	9E-10	3E-9	Y-90	7E-6	2E-5
28	Y-91m	3E-7 w 2E-7 a	6E-7	Y-91m	2E-3	3E-3
29	Y-92	1E-8	1E-8	Y-92	4E-5	6E-5
30	Zr-95	4E-10 d, a 5E-10 w	1E-9	Zr-95	2E-5	6E-5
31	Zr-97	3E-9 d 2E-9 w, a	3E-9	Zr-97	9E-6	2E-5
32	Nb-95	2E-9	3E-9	Nb-95	3E-5	1E-4
33	Nb-95m	4E-9 w 3E-9a	1E-10	Nb-95m	3E-5	3E-6
34	Nb-97	1E-7	2E-7	Nb-97	3E-4	9E-4
35	Mo-99	4E-9 d 2E-9 a	7E-9	Mo-99	2E-5	4E-5
36	Tc-99m	2E-7 d 3E-7 w	5E-7	Tc-99m	1E-3	3E-3
37	Ru-103	2E-9 d 1E-9 w 9E-10 a	3E-9	Ru-103	3E-5	8E-5
38	Ru-106	1E-10 d 8E-11 w 2E-11 a	2E-10	Ru-106	3E-6	1E-5
39	Ag-110m	2E-10 d 3E-10 w 1E-10 a	3E-10	Ag-110m	6E-6	3E-5
40	Sn-113	2E-9 d 8E-10 w	2E-9	Sn-113	3E-5	9E-5

GAS AND LIQUID EFFLUENT CONCENTRATION LIMIT (ECL) VALUES						
	ISOTOPE	GAS ECL	GAS MPC	ISOTOPE	LIQUID ECL	LIQUID MPC
		(ECL)	(MPC)		(ECL)	(MPC)
41	Sn-117m	3E-9 d 2E-9 w	1E-10	Sn-117m	3E-5	3E-6
42	Sb-122	3E-9 d 2E-9 w	5E-9	Sb-122	1E-5	3E-5
43	Sb-124	1E-9 d 3E-10 w	7E-10	Sb-124	7E-6	2E-5
44	Sb-125	3E-9 d 7E-10 w	9E-10	Sb-125	3E-5	1E-4
45	Xe-131m	2E-6	4E-7	Xe-131m		2E-4
46	Xe-133	5E-7	3E-7	Xe-133		2E-4
47	Xe-133m	6E-7	3E-7	Xe-133m		2E-4
48	Xe-135	7E-8	1E-7	Xe-135		2E-4
49	Xe-135m	4E-8	3E-8	Xe-135m		2E-4
50	Xe-138	2E-8	3E-8	Xe-138		2E-4
51	Te-129m	9E-10 d 3E-10 w	1E-9	Te-129m	7E-6	2E-5
52	Te-132	1E-9 d 9E-10 w	4E-9	Te-132	9E-6	2E-5
53	I-131	2E-10	1E-10	I-131	1E-6	3E-7
54	I-132	2E-8	3E-9	I-132	1E-4	8E-6
55	I-133	1E-9	4E-10	I-133	7E-6	1E-6
56	I-134	6E-8	6E-9	I-134	4E-4	2E-5
57	I-135	6E-9	1E-9	I-135	3E-5	4E-6
58	Cs-134	2E-10	4E-10	Cs-134	9E-7	9E-6
59	Cs-136	9E-10	6E-9	Cs-136	6E-6	6E-5
60	Cs-137	2E-10	5E-10	Cs-137	1E-6	2E-5
61	Cs-138	8E-8	3E-8	Cs-138	4E-4	2E-4
62	Ba-139	4E-8	3E-8	Ba-139	2E-4	2E-4
63	Ba-140	2E-9	1E-9	Ba-140	8E-6	2E-5
64	La-140	2E-9	4E-9	La-140	9E-6	2E-5
65	Ce-141	1E-9 w 8E-10 a	5E-9	Ce-141	3E-5	9E-5

GAS AND LIQUID EFFLUENT CONCENTRATION LIMIT (ECL) VALUES						
	ISOTOPE	GAS ECL	GAS MPC	ISOTOPE	LIQUID ECL	LIQUID MPC
		(ECL)	(MPC)		(ECL)	(MPC)
66	Ce-143	3E-9 w 2E-9 a	7E-9	Ce-143	2E-5	4E-5
67	Ce-144	4E-11 w 2E-11 a	2E-10	Ce-144	3E-6	1E-5
68	Nd-147	1E-9	8E-9	Nd-147	2E-5	6E-5
69	W-187	1E-8	1E-8	W-187	3E-5	6E-5
70	Np-239	3E-9	2E-8	Np-239	2E-5	1E-4
71	ALPHA	1E-15	2E-14	ALPHA	2E-9	3E-8

June 14, 1993

J. CLARK  
P. KNAPP

SUBJECT: Impact of new 10 CFR 20 upon SONGS Effluent Control Limits

#### INTRODUCTION

The New 10 CFR 20 is mandated to be implemented by all licensees by January 1, 1994. Unit 1 Technical Specification (TS) 6.8.4.f. (2) AND (7) and Units 2 and 3 TS 6.8.4.e. (2) and (7) require programs which set limits on concentrations of liquid and gaseous releases from the site according to 10 CFR 20 Appendix B, Table II. Questions have been asked of licensing regarding the effect of the new regulation upon SONGS Effluent Control Limits, and if it is necessary to revise the TS prior to implementation of the new rule.

#### EXECUTIVE SUMMARY

Licensing has reviewed the applicable TS and the new 10 CFR 20. As a result of the above, Licensing has concluded that SCE is not required to obtain amendments to the TS as a result of implementation of the revised Part 20. The new Part 20 permits the existing TS cited above to be amended at any time SCE deems appropriate.

The above conclusion is in agreement with the position presented to NRC Staff by NUMARC during a meeting earlier this month. Preliminary comments from the NRC staff indicate their concurrence. The NRC is expected to issue meeting minutes by mid-June, showing their concurrence.

#### LICENSING ISSUE

Revised Part 20 [20.1008(b)] generally requires that the license condition and TS references to the old Part 20, Sections 20.1-20.601 should be considered to have been replaced by comparable references to the new Part 20, Sections 20.1001-20.2401. The revised Part 20 [20.1008(c)] requires that any TS that is more restrictive than a requirement in the revised Part 20 remains in force until there is a TS change through a license amendment.

The limit on annually averaged radioactivity concentrations in effluents to unrestricted areas, which is a requirement in the old Part 20 (20.106), has been changed to an optional method [20.1302(b)(2)(i)] of demonstrating compliance with the annual dose limit specified in 20.1301 and is no longer ITSELF a requirement in the revised Part 20.

SONGS TS require that effluent concentrations be maintained below the indicated level at all times. "At all times" is reasonably accepted as meaning that averaging beyond instrument response times is not permitted. The revised Part 20 contains NO comparable "at all times" concentration limit. The

SONGS TS, by not permitting any arbitrary averaging period, are therefore MORE RESTRICTIVE than the revised part 20 limits.

Accordingly, since the SONGS TS are more restrictive than the revised Part 20, the provision of 20.1008(c) applies, with the result that the TS remains in effect, as is, until it is revised, or the license is renewed. With this conclusion, SONGS may exercise any of the following options:

1. NOT request any TS changes, with the result that SONGS must still establish setpoints in accordance with 10 CFR 20, Appendix B, Table II.
2. Request an amendment to section 6.8.4 changing the reference to the "revised" Part 20, Appendix B, Table 2.
3. Request an amendment to the Tech Specs of units 2/3, and NOT of 1, or vice versa.
4. Upon approval by the NRC, implement any of the above Tech Spec changes irrespective of the implementation date of the revised 10 CFR 20.

This memo does not intend to say that any requirements of 10 CFR 20 and 40 CFR 190 are invalid, including those limits pertaining to dose to members of the public, and applicable survey methods to confirm conformance with those limits.



E. S. MEDLING

cc: W. Marsh  
D. Dick  
S. Hetterick  
P. Chang  
L. Bray  
NLFS  
CDM