



Robert E. Schuetz
Columbia Generating Station
P.O. Box 968, MD PE23
Richland, WA 99352-0968
Ph. 509.377.2425
reschuetz@energy-northwest.com

May 13, 2020
GO2-20-075
DIC: 1316.11

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555

**Subject: COLUMBIA GENERATING STATION, DOCKET NO. 50-397
INDEPENDENT SPENT FUEL STORAGE INSTALLATION, DOCKET NO. 72-35
2019 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT**

References: 1. Columbia Generating Station Technical Specification 5.6.1
2. Independent Spent Fuel Storage Installation Technical Specification 5.4.c
3. EFSEC Resolution No. 332, February 21, 2012

Dear Sir or Madam:

In accordance with the requirements of References 1-3, the subject report is submitted as an enclosure to this letter. This letter contains no regulatory commitments. If you have questions regarding this information, please contact R.L. Phillips at (509) 377-5350.

Executed on this 13 day of May, 2020.

Respectfully,

DocuSigned by:

A handwritten signature in black ink that reads "Robert E. Schuetz".
A0D08FB61898465...

Robert E. Schuetz
Site Vice President

Enclosure – as stated

cc: NRC Region IV Administrator
NRC NRR Project Manager
NRC Sr. Resident Inspector (988C)
CD Sonoda – BPA/1399
K. Hall (WDOE)
A. Kidder (ESFEC)


Director, SFPO-NRC NMSS
M. Priddy (WDOH)
L. Albin (WDOH)
P. Miller (WDFW)
J. Temple (WDOE)



**ENERGY
NORTHWEST**

COLUMBIA GENERATING STATION

**2019 ANNUAL RADIOLOGICAL
ENVIRONMENTAL OPERATING REPORT FOR
THE COLUMBIA GENERATING STATION**

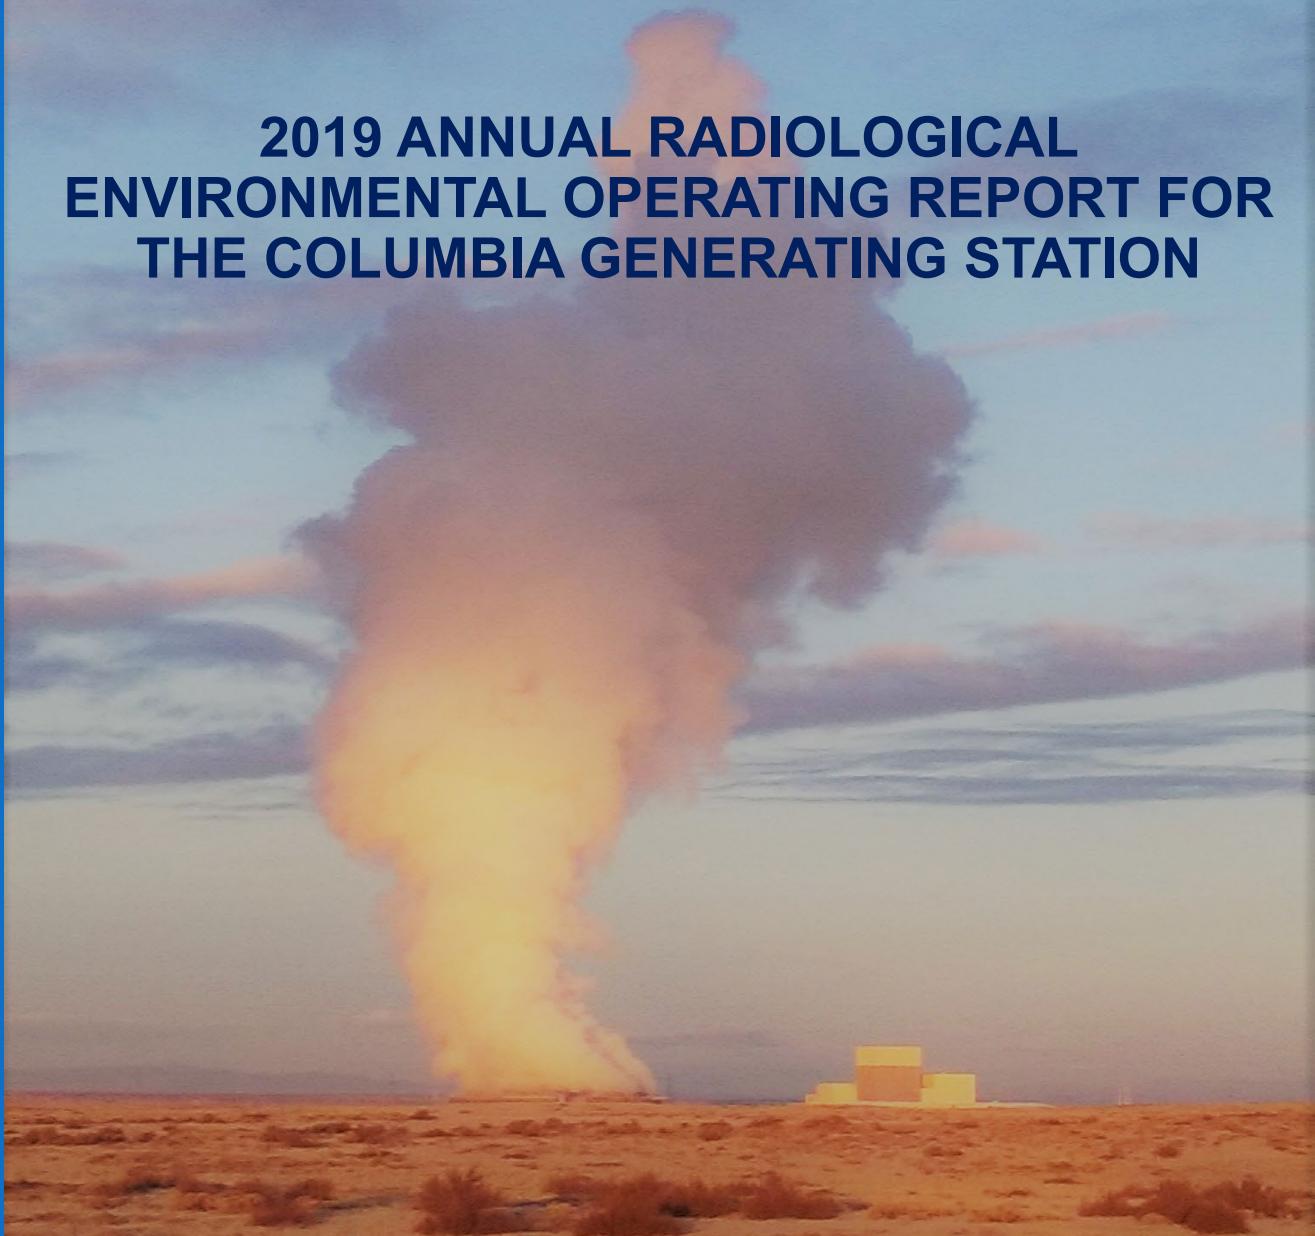



COLUMBIA GENERATING STATION

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

2019 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

For Calendar Year 2019

Preparation Date: April 2020

Submitted Date: May 2020

Authored By: Date: 4/14/2020
Elisa Nguyen, ENW Environmental Services

Reviewed By: Date: 4/13/2020
Ruth Chaffee, ENW Environmental Services

Reviewed By: Date: 4/13/2020
Jane LePage, ENW Environmental Services

Approved By: Date: 4/13/2020
Brad Barfuss, ENW Environmental Services Manager

TABLE OF CONTENTS

<u>SECTION</u>	<u>PAGE</u>
1.0 EXECUTIVE SUMMARY	1-1
2.0 DEFINITIONS	2-1
3.0 INTRODUCTION	3-1
3.1 Site Description	3-1
3.2 Program Background	3-1
3.3 Program Objectives	3-2
4.0 PROGRAM DESCRIPTION	4-1
4.1 Sample Locations	4-1
4.2 Independent Spent Fuel Storage Installation (ISFSI)	4-1
4.3 Land Use Census	4-2
4.4 Sampling Methods	4-2
4.4.1 Direct Radiation	4-2
4.4.2 Airborne - Particulate/Iodine	4-2
4.4.3 Water	4-3
4.4.4 Soil	4-4
4.4.5 Sediment	4-4
4.4.6 Fish	4-5
4.4.7 Milk	4-5
4.4.8 Garden Produce	4-5
4.5 Split Sample Program	4-6
4.6 Sample Analyses	4-6
4.6.1 Analysis of TLDs	4-6
4.6.2 Gross Beta Activity on Air Particulate Filters	4-6
4.6.3 Measurement of Gamma Emitting Radionuclides	4-7
4.6.4 Gross Alpha and Gross Beta Activity in Water	4-7
4.6.5 Tritium in Water	4-7
4.6.6 Low Level Radioiodine in Milk and Water	4-8

TABLE OF CONTENTS

<u>SECTION</u>		<u>PAGE</u>
4.6.7	Carbon-14	4-8
4.6.8	Strontium-89/90, Iron-55, and Nickel-63	4-8
4.7	Data Analysis Methods	4-8
4.8	Changes to the Sampling Program in 2019	4-8
5.0	RESULTS AND DISCUSSION	5-1
5.1	Direct Radiation	5-1
5.2	Airborne Particulate/Iodine	5-3
5.3	Water	5-5
5.3.1	Surface Water	5-5
5.3.2	Ground Water	5-6
5.4	Soil	5-7
5.5	River Sediment	5-7
5.6	Fish	5-7
5.7	Milk	5-8
5.8	Garden Produce	5-8
5.9	Special Interest Stations	5-8
5.9.1	Evaporation Pond (Station 101B)	5-8
5.9.2	Sanitary Waste Treatment Facility (Station 102B)	5-9
5.9.3	Cooling System Sediment Disposal Area (Station 119)	5-9
5.9.4	Independent Spent Fuel Storage Installation	5-11
5.9.5	Miscellaneous Environmental Sample Results	5-12
5.10	2019 Sample Deviations	5-12

TABLE OF CONTENTS

<u>SECTION</u>	<u>PAGE</u>
6.0 QUALITY ASSURANCE AND QUALITY CONTROL	6-1
6.1 Quality Control for the Energy Northwest Environmental TLD Program	6-1
6.2 Quality Control for the Environmental Sample Program	6-1
6.2.1 Sample Collection Quality Control	6-2
6.2.2 Laboratory Instruments Quality Control	6-2
6.2.3 Sample Batch Quality Control	6-2
6.3 Laboratory Intercomparison Program Participation and Results	6-3
6.4 Laboratory Quality Control Program Problems and Improvements	6-3
7.0 REFERENCES	7-1
8.0 ERRATA	8-1

APPENDIX A. Data Tables A and B

LIST OF TABLES

<u>TABLE</u>		<u>PAGE</u>
4-1	Radiological Environmental Monitoring Program Sampling Plan	4-9
4-2	REMP Sample Stations and Requirements	4-15
4-3	2019 Five Mile Land Use Census Results	4-19
4-4	Comparison of Laboratory Nominal Lower Limits of Detection With Offsite Dose Calculation Manual Requirements	4-20
5-1A	ODCM REMP Sample Deviations for 2019	5-12
5-1B	EFSEC REMP Sample Deviations for 2019	5-13
5-1C	ODCM & EFSEC REMP Sample Deviations for 2019	5-13
5-1D	CGS REMP Air Sample Percent in Service Time for 2019	5-14
5-1E	CGS REMP Water Sample Percent in Service Time for 2019	5-14
5-2	Radiological Environmental Monitoring Program Summary	5-15
5-3	Quarterly TLD Data Summary with Comparison to the Preoperational and Operational Periods	5-25
6-1	2019 Environmental Spiked Dosimeter Results	6-4
6-2	ENW REMP Program Cross Check Performance Results	6-5

LIST OF FIGURES

<u>FIGURE</u>		<u>PAGE</u>
4-1	Select REMP Sampling Locations Within 0.8 Miles of CGS	4-21
4-2	Select REMP Sampling Locations Between 0.8 and 2.8 Miles	4-22
4-3	Select REMP Sampling Locations Beyond 2.8 Miles	4-23
4-4	ISFSI TLD Station Layout	4-24
5-1	“S” Stations Quarterly TLDs 1984-2018 Hi/Low/Mean and 2019 Mean by Sector	5-1
5-2	Near Plant Stations Quarterly TLDs 1984-2018 Hi/Low/Mean and 2019 Mean by Sector	5-2
5-3	Remote Stations Quarterly TLDs 1984-2018 Hi/Low/Mean and 2019 Mean by Sector	5-2
5-4	1985-2018 Weekly Hi/Low/Mean and 2019 Weekly Mean Gross Beta in Air-Near Plant Stations	5-3
5-5	1985-2018 Weekly Hi/Low/Mean and 2019 Weekly Mean Gross Beta in Air-Remote Stations	5-4
5-6	Gross Beta in River/Drinking (Stations 26 & 29) and Plant Discharge Water (Station 27) for 2019	5-5
5-7	Tritium in River/Drinking (Stations 26 & 29) and Plant Discharge Water (Station 27) for 2019	5-6
5-8	Cooling System Sediment Activity Levels for Disposals Made in 2019	5-10
5-9	ISFSI TLD Trend at CGS	5-11

1.0 EXECUTIVE SUMMARY

1.0 EXECUTIVE SUMMARY

The primary purpose of the Energy Northwest Radiological Environmental Monitoring Program (REMP) is to evaluate the radiological impact that Columbia Generating Station (CGS) operation may have on the environment. Sampling is performed as specified in the Offsite Dose Calculation Manual (ODCM) and agreements made with the State of Washington Energy Facility Site Evaluation Council (EFSEC). Additional sampling is also performed to meet Nuclear Energy Institute (NEI) guidelines or as an Energy Northwest initiative. The program serves to validate CGS effluent measurements and exposure pathway models and to provide a documented, historical record of CGS impact on the environment. Presented in this report are summaries and discussions of the data generated for the REMP conducted at CGS for calendar year 2019.

Various types of environmental samples are routinely collected and analyzed by the REMP. The types of samples collected include air, water, soil, sediment, milk, fish, and garden produce. Additionally, the program continuously monitors direct radiation at numerous locations surrounding CGS. Analysis results are trended and compared to results from control locations, results obtained in previous operational and pre-operational periods, and regulatory limits.

The results contained in this report show that all identified radiological impact to the environment attributable to CGS operation was limited to areas within the CGS controlled area. All routine sample results were consistent with the results obtained from control locations, results from the preoperational period, and historical results collected since CGS began commercial operation. All activity identified within the controlled area is attributed to rain-washout (recapture) of gaseous activity released from CGS via an approved and monitored effluent pathway. All radioactive material identified outside the CGS controlled area was of natural origin or known to be present in the environment around CGS in the quantities identified. No radioactive material related to CGS operation was identified beyond the CGS controlled area. The results are consistent with and verify CGS effluent measurements and modeling of the exposure pathways. CGS has continued to monitor the environment by direct radiation, airborne, ingestion, and waterborne pathways. These four exposure pathways are summarized as follows:

Direct Radiation - No impact was identified at locations beyond the CGS controlled area. Within the controlled area, the only impact identified was at locations known to be influenced by the Independent Spent Fuel Storage Installation (ISFSI) or radiation from the turbine building during operation.

Airborne - No impact due to CGS operation was identified. No radioiodines or other radionuclides related to CGS operation were identified in any of the environmental air samples.

Ingestion - No impact due to CGS operation was identified in any of the milk, fish, or food product sample results. Carbon-14 activities in local fruit samples were below the level of detection.

Waterborne - No impact was identified at surface/drinking water locations outside the CGS controlled area. Low level tritium activity was identified in storm drain water contained in evaporation ponds and radionuclides related to CGS operation were identified at low levels in evaporation pond and cooling tower sediment. The activity identified at these locations is due to recapture and concentration of CGS effluent activity; the activity levels observed are consistent with levels historically identified. Tritium activity

identified in groundwater samples was at levels historically observed and consistent with levels known to exist in Hanford groundwater. No evidence that CGS operation contributed to groundwater tritium levels was identified. Radionuclide activity identified in river sediment is consistent with activity levels known to exist in Hanford area sediment and soils.

2.0 DEFINITIONS

Curie (Ci): A measure of radioactivity; equal to 3.7×10^{10} disintegrations per second, or 2.22×10^{12} disintegrations per minute.

DOE: U.S. Department of Energy.

EFSEC: Energy Facility Site Evaluation Council.

EDDP: Hanford External Dosemetry Program. Supplier of environmental TLDs for the CGS REMP.

Flow Proportional Sampling: Sample collection volume or frequency determined as a function of the flow rate of the water being sampled.

Grab Sample: A single discrete sample drawn at one point in time.

IDC: Energy Northwest Industrial Development Complex, formerly referred to as the WNP-1 and WNP-4 sites.

Indicator Station: A sampling location that is likely to be affected by plant effluents due to its proximity and/or direction from the Columbia Generating Station.

Ingestion Pathway Monitoring: The ingestion pathway includes milk, fish, and garden produce. Also sampled vegetables such as (under special circumstances) are other media such as (under special circumstances) are other media such as vegetables such as eggs and meat when additional information about particular radionuclides is needed.

ISFSI: Independent Spent Fuel Storage Installation.

Lower Limit of Detection (LLD): The smallest concentration of radioactive material in a sample that will yield a net count (above system background) that will be false conclusion that a blank observation represents "real" number of results.

Mean: The average, i.e., the sum of results divided by the number of results.

Microcurie: 3.7×10^4 disintegrations per second, or 2.22×10^6 disintegrations per minute.

Millicuriegen (mR): $1/1000$ Roentgen; a unit of exposure to X or gamma radiation.

Counting Error: An estimate of the two-sigma relative uncertainty associated with the sample results based on effective count times.

Control Station: A sampling station in a location not likely to be affected by plant effluents due to its distance and/or direction from the Columbia Generating Station.

Composite Sample: A series of single collected portions (liquids) analyzed as one sample. The aliquots making up the sample are collected at time intervals that are very short compared to the composite period.

CGS Protected Area: The area within the security fence surrounding CGS. Access to this area requires a security badge or escort.

CGS Controlled Area: The area within a 1.2-mile radius of the CGS reactor building and a narrow corridor extending from CGS east to the Columbia River.

CGS: Columbia Generating Station, formerly referred to as WNP-2.

Blank Sample: A sample of the same media as the field sample being analyzed but without any radiouclide(s) being measured. It enables correction for the inherent sample background.

Beta Particle (β): Charged particle emitted from the nucleus of an atom with a mass and charge equal in magnitude to that of an electron.

Beccquerel (Bq): One disintegration per second. One picocurie (PCi) equals 0.037 becquerel.

Alpha Particle (α): A charged particle emitted from the nucleus of an atom having a mass and charge equal in magnitude of a helium nucleus.

Airborne Activity Sampling: Continuous sampling of air through the collection of particulates and radionuclides on filter media. Periodic soil samples are collected for gamma isotopic analysis to provide information on deposition to the soil from airborne releases.

a posteriori: refers to an "after the fact" limit determined for a particular measurement and not a limit for a particular measurement.

a priori: refers to a "before the fact" limit that represents the capabilities of a measurement system and not a limit for a particular measurement.

2.0 DEFINITIONS

MDA: Minimum Detectable Activity.

MSA: Mission Support Alliance.

MDC: Minimum Detectable Concentration.

NEI: Nuclear Energy Institute

NIST: National Institute of Standards and Technology.

NPDES: National Pollutant Discharge Elimination System.

NRC: U.S. Nuclear Regulatory Commission.

ODCM: Offsite Dose Calculation Manual. Licensing document that contains the NRC mandated effluent and offsite radiological monitoring requirements.

Picocurie (pCi): 1×10^{-12} Curie or one millionth of a microcurie. 1 picocurie equal 0.037 becquerel or 2.22 disintegrations per minute

Radioiodine: Radioisotopes of iodine. For commercial nuclear reactors, iodine-131 to iodine-135 are the principle radioiodines of concern. Due to its longer half-life, iodine-131 is the most probable radioiodine identifiable in the environment.

REMP: Radiological Environmental Monitoring Program.

Range: The difference between the smallest and largest results.

Restricted Area: Any area where access is controlled for the purpose of protecting individuals from exposure to radiation or radioactive materials.

Roentgen: Unit of exposure to ionizing radiation in air.

Site Certification Agreement (SCA): The initial Columbia Generating Station licensing agreement with the State of Washington. The REMP sampling commitments in the SCA have been modified by EFSEC agreements.

Spiked Sample: A sample that has had a known quantity of radionuclide(s) added for the purposes of assessing analytical performance.

Standard Deviation: A measure of the scatter of a set of observations (or samples) around their mean value. Indicated by “ σ ”.

Standard Error of the Mean: An estimate of the uncertainty associated with the mean of observation (or sample) averages. Also known as the standard deviation.

$$SE = \sqrt{\frac{S^2}{n}}$$

where S^2 , the variance is

$$S_m^2 = \frac{1}{(n - 1)} \sum n (Xi - X)^2$$

SWTF: Sanitary Waste Treatment Facility. The sanitary waste processing facility for the Columbia Generating Station and other ENW facilities near the CGS site.

TEDA: triethylene diamine. A compound used in charcoal cartridge filters to collect radioiodine.

Thermoluminescent Dosimeter (TLD): A device used to measure the amount of exposure to radiation. A crystal phosphor that stores energy proportional to the amount of exposure; the exposure level is determined by heating the crystal and reading the amount of emitted light.

TMU: Tower Make Up.

WaDOH: Washington State Department of Health.

WSU: Washington State University.

3.0 INTRODUCTION

3.0 INTRODUCTION

3.1 Site Description

The Columbia Generating Station (CGS) is a 1230 MWe commercial nuclear power plant that achieved initial criticality on January 19, 1984. The plant is located in a sparsely populated shrub-steppe region within the Department of Energy (DOE) Hanford Site in southeastern Washington. The plant is approximately three miles west of the Columbia River and is surrounded on all sides by uninhabited desert land. The nearest large population centers are Richland, Pasco and Kennewick, which are 12 miles south, 18 miles southeast, and 21 miles southeast, respectively. The nearest privately owned lands are located approximately four miles east-northeast of the plant, across the Columbia River. The site has a bimodal wind pattern with winds primarily from the northwest and south.⁽¹⁾ The primary region of focus for REMP sampling is the farming region east of the plant.

Naturally occurring radionuclides exist in detectable quantities throughout the world and are seen in many of the samples collected for the CGS REMP. Some examples of naturally occurring radionuclides that are frequently seen in samples are potassium-40, beryllium-7, actinium-228 (present as a decay product of radium-228), and radium-226. Additionally, some relatively long lived anthropogenic radioisotopes, such as strontium-90 and cesium-137, are also seen in some REMP samples; these radionuclides exist in measurable quantities throughout the world as a result of fallout from atmospheric nuclear weapons testing.^(2,3)

Due to the location of CGS on the Hanford Site, there are other sources of reactor produced radionuclides in close proximity to the plant. CGS is unique in the U.S. commercial nuclear power industry in this respect. Hanford-related radionuclides, most notably tritium, are identified in some CGS REMP samples. Though the presence of these radionuclides in the vicinity of CGS are not necessarily reflective of CGS activity, changes in the levels of these radionuclides are monitored to assess any contribution that CGS may be making to the established background. The DOE has an active environmental monitoring program for the Hanford Site that overlaps the CGS REMP.

3.2 Program Background

The CGS REMP is designed to conform to the Nuclear Regulatory Commission (NRC) Regulatory Guide 4.1,⁽⁴⁾ NUREG 1302,⁽⁵⁾ and the 1979 NRC Branch Technical Position.⁽⁶⁾ In addition, the REMP also meets the requirements of 10 CFR 72.44(d)(2)⁽²⁰⁾ for coverage of the ISFSI.

The quality assurance aspects of the sampling program and the thermoluminescent dosimetry are conducted in accordance with Regulatory Guides 4.15⁽⁷⁾ and 4.13.⁽⁸⁾ The REMP also adheres to the requirements of the State of Washington Energy Facility Site Evaluation Council (EFSEC),⁽⁹⁾ CGS Technical Specifications,⁽¹⁰⁾ and the CGS Offsite Dose Calculation Manual (ODCM).⁽¹¹⁾ These requirements cover the environmental sampling and sample analysis aspects of the program, and also the reporting and quality assurance requirements.

The preoperational phase of the program, which lasted from March 1978 until initial criticality in January 1984, provided a baseline of background environmental data. Variability in the background levels of radioactivity over time is due to differences in geologic composition, meteorological conditions, decay of

nuclear testing fallout material in the environment, and seasonal changes. Variability in results may also have been introduced by changing analytical contractors and the use of different correction factors over the years.

In addition to evaluating environmental concentrations against regulatory limits, the REMP also compares some results to standards set by the State of Washington.^(12, 13) Results may also be evaluated by comparing them to similar measurements made during the preoperational and previous operational periods and to the detection capabilities associated with the current methods of analysis.

3.3 Program Objectives

The REMP provides an independent mechanism for determining the levels of radioactivity in the plant environs in order to empirically quantify and qualify any radiological effect plant operation may be making on the environment. The program serves to ensure that any accumulation of radionuclides in the environment resulting from station operation will be identified promptly and before they become significant or exceed established limits.

While in-plant monitoring programs are used to ensure that 10 CFR 20⁽¹⁴⁾ and 10 CFR 50⁽¹⁵⁾ criteria for releases of radioactive effluents are met, the REMP further verifies that the measured concentrations of radioactive material and levels of radiation observed in the environment are not higher than expected based on CGS effluent measurements and modeling of the exposure pathways.

4.0 PROGRAM DESCRIPTION

4.0 PROGRAM DESCRIPTION

Environmental samples for the REMP are collected in accordance with the CGS ODCM. Additional sampling requirements are specified in Resolutions or Council Orders issued by the State of Washington Energy Facility Site Evaluation Council (EFSEC). Some sampling is also performed as a CGS initiative in response to site specific or industry wide concerns. The sampling plan presented in Table 4-1 gives an overview of the REMP sampling routine, a summary of the sample locations, the specified collection frequency, and the types of analyses to be performed. The methods of sampling and sampling frequencies utilized in the program are mostly dictated by regulatory requirements. Factors such as nuclide half-lives and the major exposure pathways for the radionuclides potentially released from the plant have been taken into account in determining the sampling methodology.

4.1 Sample Locations

One hundred and sixteen sampling locations (referred to as ‘stations’) were included in the monitoring program during 2019. More than one sample type may be collected at a sample station. One hundred and six indicator and three control stations were located within a 10-mile radius of CGS. Seven additional stations were located beyond the ten-mile radius of the plant, three were indicator locations and four were control locations. Sample stations are listed in Tables 4-1 and 4-2. Most station locations are shown in Figures 4-1 to 4-4.

The locations of most sample stations have been selected on the basis of an exposure pathway analysis. The exposure pathway analysis was based on factors such as weather patterns, anticipated emissions, likely receptors, and land use in the surrounding areas. Samples collected from stations located in areas that potentially could be influenced by CGS operation are used as indicators. Samples collected from locations that are not likely to be influenced by CGS operation serve as controls. Results from indicator stations are compared to the results from control stations and results obtained during the previous operational and preoperational years of the program in order to assess the impact CGS operation may be having on the environment.

4.2 Independent Spent Fuel Storage Installation (ISFSI)

The Independent Spent Fuel Storage Installation (ISFSI) is a fenced, secured area constructed to provide a storage location for spent nuclear fuel. The spent fuel is stored in HI-STORM dry storage casks which are placed on concrete pads inside the facility. The pads are 30-feet wide by 147-feet long and each pad can hold up to 18 casks. The ISFSI is located approximately 500 meters north-northwest of the reactor building. Radiological exposure rates inside the ISFSI security fence line are elevated and access to the area requires radiological dosimetry and security notification. In addition to the TLD monitoring program, quarterly radiological surveys of the ISFSI are conducted by the CGS Radiation Protection Department.

Direct radiation monitoring of the ISFSI is performed using TLDs placed at 12 locations on the second of three security fences that surround the facility. The TLDs are exchanged quarterly. Two additional TLD locations, Station 121 located approximately 200 meters north of the turbine building, and Station 122 located approximately 100 meters north of the ISFSI, were established prior to ISFSI operation to specifically monitor ISFSI direct radiation. In addition, two more TLD stations, Station 155, located WNW of the ISFSI, and Station 156, located to the NW of the ISFSI, were installed in order to further aid in monitoring ISFSI direct radiation. Figure 4-1 shows the

ISFSI location in relation to CGS and the position of these additional TLD locations. Figure 4-4 shows the location of the 12 TLD stations around the ISFSI second fence line. This arrangement of TLDs in conjunction with the radiological surveys conducted by the CGS Radiation Protection Department serves as the radiological monitoring program for the ISFSI.

4.3 Land Use Census

The Land Use Census conducted annually during the growing season encompasses the areas within a five-mile radius of CGS. The purpose of this census is to identify the locations of the nearest milk animal, the nearest residence, and the nearest garden greater than 500 ft² producing broadleaf vegetation. This information is used to determine whether any site located during the census has a calculated dose or dose commitment greater than the sites currently monitored for the same exposure pathway. If a new location with a higher dose commitment was found, routine sampling of that dose pathway would be initiated at that new site. The results of the 2019 five- miles land use census are presented in Table 4-3.

4.4 Sampling Methods

Environmental samples are collected by Energy Northwest personnel in accordance with the program plan outlined in Table 4-1. Methods of sample collection and TLD handling are specified in REMP specific procedures. A general overview of the sampling methods used in the REMP is given below. Generic descriptions of the REMP sample analysis methods are given in section 4.6.

4.4.1 Direct Radiation

Direct radiation dose levels are monitored with Harshaw Model 8807 thermoluminescent dosimeters (TLDs). The TLDs are placed in the field between three and five feet above the ground. TLDs are wrapped in aluminum foil and sealed in plastic bags to prevent damage. TLDs are exchanged on a quarterly basis.

The locations of the TLD stations are listed in Table 4-2 and are shown in Figures 4-1 through 4-4. Station 9A near Sunnyside, WA serves as the environmental TLD control location. Station 119C serves as the control for Station 119B (the cooling system sediment disposal basin). The remaining TLDs deployed in the field serve as indicator TLDs. The TLDs are arranged in a series of rings that encircle CGS. The innermost ring of TLD stations, referred to as the “S” stations, are located inside the CGS site boundary at distances that range from 0.3-0.8 miles from the reactor building centerline. The second ring of TLDs, referred to as the “near plant” stations, are located at distances ranging from 0.9 to 2.1 miles from the reactor building. The outer ring of TLDs are located at distances that range from a little under three miles to around ten miles. Direct radiation is also monitored by TLDs at the ISFSI and at a number of miscellaneous locations at CGS initiative. A MicroRem dose rate meter is available as a backup device and to take real time readings as needed.

4.4.2 Airborne - Particulate/Iodine

Weekly air particulate and radioiodine (iodine -131) samples are obtained through the use of low volume (1.5 cfm), constant flow-rate sampling units located at 12 locations. The samples collected at Station 9A (Figure 4-3) serve as controls, the samples collected at all other locations (Figures 4-1, 4-2, and 4-3) are indicators. Air particulate samples are collected using 47mm diameter glass

fiber filters, air iodine samples are collected using Radeco CP-100 TEDA impregnated charcoal cartridges. The air particulate filter and charcoal cartridge are placed in tandem, particulate filter first, in a holder that attaches to the air inlet of the sampler unit. The sampler units are placed in ventilated metal weatherproof housings mounted on elevated platforms at each air sample location. The filter media are changed weekly. Four additional air sample monitor locations are available to monitor work at the DOE 618-11 burial site if needed.

4.4.3 Water

Water sampling is performed to meet ODCM and State of Washington EFSEC requirements, to comply with NEI guidelines, or as a CGS initiative. REMP water sampling can be categorized as follows:

- Intake-River/Drinking Water; two locations (Stations 26 and 29)
- Deep Groundwater; three locations (Stations 31, 32, and 52)
- Shallow Groundwater; nine locations (MW-3, 5, 6 and MW-9 through MW-14)
- Plant Discharge Water; one location (Station 27)
- Storm Drain Water; one location (Station 101B)
- Sanitary Wastewater; one location (Station 102B)

The sample at Station 26 is obtained using a composite sampler that draws water from the plant intake water system (TMU). The source of this water is the Columbia River. The station serves as a control location, as it is upstream of the plant discharge location, and also as a drinking water location as drinking water for CGS comes from this source. Station 29 is a composite sampler located at the City of Richland Water Treatment Plant located 11 miles downstream of the plant discharge. Station 29 is an indicator station for both river and drinking water.

The ODCM requirement for a downstream water sample is conservatively met by Station 27, a composite sampler that collects water from the cooling tower discharge line just prior to final discharge into the Columbia River. This sample reflects the radioactivity present in the plant discharge prior to any river dilution, rather than the concentrations that would be found after dilution in the mixing zone. Composite samples from Stations 26, 27, and 29 are collected monthly and analyzed for gamma emitting radionuclides, gross beta, and tritium.

Three drinking water wells on Energy Northwest property are used to provide deep groundwater samples. These wells are greater than 400 feet deep and provide samples from the confined aquifer under CGS. Station 31 and 32 are deep wells at the IDC (ENW Industrial Development Complex) located 1.2 miles down gradient from CGS. Station 52 is a deep well located 0.1-mile north of the CGS reactor building. The IDC wells supply water for drinking and fire protection at the IDC site. Water from Station 52 can be used as a backup source for drinking water and fire protection. All of these wells are considered indicator locations. Quarterly grab samples are collected from each well and analyzed for gamma emitting radionuclides and tritium.

The composite sampler at Station 101B collects samples of wastewater discharged to two evaporation ponds located on the CGS site. The water collected is storm drain, air wash, and non-radioactive system wastewater originating from within the CGS protected area. Samples are collected monthly on a flow proportional basis and analyzed for gross beta, gamma emitting

radionuclides, and tritium. Sampling and analysis requirements for Station 101B are given in EFSEC Resolution 332⁽⁹⁾ and EFSEC Council Order 874.⁽²³⁾ Process wastewater originating outside of the CGS protected area is typically discharged to three additional evaporation ponds; the water discharged to these ponds is not sampled by the Station 101B composite sampler. Annual grab samples are collected from these three evaporation ponds and analyzed for gamma emitting radionuclides and tritium as specified by EFSEC Council Order 874.⁽²³⁾

The Sanitary Waste Treatment Facility (SWTF) receives sanitary waste water from CGS, the IDC (ENW Industrial Development Complex), and the Kootenai Building. Discharge standards and monitoring requirements for the SWTF are established in EFSEC Resolution No. 300.⁽¹⁶⁾ The Station 102B composite sampler collects a representative sample of water flowing into the head works at the SWTF. Monthly samples are collected and analyzed for gross alpha, gross beta, tritium, and gamma emitting radionuclides.

Routine quarterly grab samples are taken as part of the REMP from nine shallow ground water monitoring wells surrounding CGS. The monitoring well locations are shown in Figure 4-1. The shallow groundwater wells are all less than 100 feet deep and allow samples to be obtained from the unconfined aquifer under CGS. None of the wells are used for drinking water. Sampling from these locations is performed to meet NEI 07-07 guidelines⁽¹⁷⁾ and requirements in the CGS NPDES permit.

4.4.4 Soil

Annual soil samples are a requirement of EFSEC Resolution No. 332.⁽⁹⁾ For 2019, two soil samples were collected from locations near CGS (Station 7 and 23), two samples from farmland in Franklin County east of CGS (Station 8 and 48), and one sample from a control location near Sunnyside, WA (Station 9A). Each sample was collected from an area of approximately one square foot to a depth of approximately one inch. Approximately one to two kilograms of soil is collected from each location. Soil samples are analyzed for gamma activity on a dry weight basis.

4.4.5 Sediment

River sediment samples are collected semiannually as required by the ODCM and EFSEC Resolution No. 332.⁽⁹⁾ The upstream sediment sample location (Station 33) is approximately two miles upriver from the plant discharge. The downstream sample (Station 34) is collected approximately one mile downstream from the plant discharge. Each sample consists of approximately two kilograms of shallow surface sediment scooped from areas known to be underwater during high water periods and where the potential for sediment accumulation is likely. Sediment samples are dried in an oven and then analyzed for gamma emitting radionuclides on a dry weight basis.

Cooling system sediment samples are collected and analyzed whenever cooling system sediment is added to the disposal cells (Station 119B, Figure 4-1). Disposal of cooling system sediment is made in accordance with EFSEC Resolution No. 299.⁽¹⁸⁾ Pre-disposal samples are collected and analyzed prior to transfer to ensure the material will be within the limits specified in the EFSEC resolution. Following transfer, the material is allowed to dry and a post-disposal sample is collected and analyzed.

Sediment samples from the two evaporation ponds that receive wastewater originating from within the CGS protected area (ponds 3 and 4) are collected annually and analyzed for gamma emitting radionuclides. This sampling and analysis is performed to meet EFSEC Council Order 874⁽²³⁾ requirements. Sediment samples from the other three evaporation ponds may be collected as a CGS initiative as conditions allow.

4.4.6 Fish

Annual fish sampling is usually performed in late summer or fall. Fish samples collected from the Columbia River (Station 30) serve as indicator samples, whereas fish collected on the Snake River (Station 38) serve as control samples. Only edible portions of the fish are used to prepare the samples for analysis. Fish samples are analyzed for gamma emitting radionuclides on a wet weight basis. Three species of fish are collected; an anadromous species (salmon or steelhead), and two other resident species generally considered edible or potentially edible (typically bass, whitefish, carp, walleye, perch, or sucker). The same species are collected at each location. Resident species have been collected using traditional hook and line fishing since 2012.

Anadromous species are obtained from local fish hatcheries through arrangements made with the State of Washington Department of Fish and Wildlife.

4.4.7 Milk

Milk samples are collected semimonthly during the spring and summer months (April through September) when cows are more likely to be grazing or on fresh feed. During the fall and winter months, milk samples are collected monthly. Raw milk samples are collected within a few hours of milking and the samples are normally prepared and analyzed within four days. Milk samples are collected from both indicator and control locations. Station 36 in Franklin County serves as the primary indicator location and is the only known dairy within a ten-mile radius of CGS. Station 36B was identified as the second monthly indicator milk sample location in 2018. This station is located 6.2 miles ESE of CGS and goat milk samples were collected from this location. Control milk samples (Station 9B) were collected from a dairy in the lower Yakima Valley near Prosser, WA.

4.4.8 Garden Produce

Samples of local garden produce are collected during the growing season when the produce is readily available. Three types of garden produce are typically collected; root crops, fruits, and leafy vegetables. Control samples (Station 9C) are usually obtained from the lower Yakima Valley. Indicator samples are collected from areas downstream of the CGS discharge where crops are irrigated with Columbia River water or from locations that potentially could be impacted by CGS gaseous emissions. The Riverview and Ringold areas of Pasco are the principle collection locations for fruit crop. Root crop is primarily collected from a garden located near WSU Tri-Cities SSE of CGS. Historically, root crops were obtained in the Riverview area of Pasco. Collection of leafy vegetables is primarily made from gardens and farms located east of CGS. Vegetation samples may also be collected from locations closer to CGS; however, none were collected in 2019. Garden and vegetable samples are typically puréed in a food processor and then analyzed for gamma emitting radionuclides on a wet weight basis. Only edible portions are used for analysis.

4.5 Split Sample Program

In addition to the sample analyses performed by the Energy Northwest Environmental Services laboratory, a number of the samples collected are split and independently analyzed by the Washington State Department of Health (WaDOH). CGS REMP personnel typically collects these samples, ships a representative portion to the WaDOH laboratory, then separately analyzes another portion of the sample. For media such as air particulates or TLDs where sample splitting is not feasible, the WaDOH co-locates a TLD or air sampler at the sample location. The following split samples are typically provided: Monthly surface water samples from three locations, annual ground water samples from three locations, weekly air iodine and particulate filters from two locations, bi-annual vegetable samples from one location, monthly indicator milk samples from one location, quarterly control milk samples from one location, annual resident fish from one location, annual soil samples from three locations, annual sediment samples from two locations.

4.6 Sample Analyses

General descriptions of the procedures used to analyze REMP samples are provided in the following sections. All REMP TLDs in 2019 were processed at the Hanford External Dosimetry Program (HEDP) laboratory located on the Hanford site. The HEDP is operated by Mission Support Alliance (MSA). Carbon-14 analysis of apples was performed by the Washington State Department of Health (WaDOH) in 2019. All other routine REMP samples were collected and analyzed by Energy Northwest Environmental Services. Samples are normally collected and analyzed within a short time period to ensure required detection sensitivities are met and to provide timely results. Sample count times are conservatively calculated to ensure required *a priori* LLDs are achieved. Table 4-4 lists the ODCM required LLDs and the nominal target LLD used in the Energy Northwest REMP program.

4.6.1 Analysis of TLDs

REMP TLDs are analyzed on a Harshaw Model 8800 hot gas reader. The reader is calibrated immediately prior to processing the environmental TLDs. The reader is calibrated with TLDs that have been given a known exposure from a cesium-137 source. Each group of environmental TLDs is processed with blank (freshly annealed) TLDs and spiked TLDs that have been given a known exposure. Exposure received by the field TLDs during transport is monitored with a set of ‘trip’ control dosimeters that accompany the field dosimeters to and from the field locations and while in storage. Another set of TLDs, the building controls, are used to determine the exposure of the TLDs at the storage location. The TLD exposure during transport to and from the field was determined from the difference between the building control results and the trip control results.

4.6.2 Gross Beta Activity on Air Particulate Filters

Air particulate filters are counted directly in a gas flow proportional counter after a delay of several days to allow for the decay of radon and its progeny. Samples were counted using a Protean WPC-9550 instrument which allows automated sample counting and simultaneous alpha/beta determination. If gross beta activity is identified significantly above the mean of the control, gamma isotopic analysis is performed on the individual samples.

4.6.3 Measurement of Gamma Emitting Radionuclides

Gamma isotopic analysis allows identification and quantification of gamma-emitting radionuclides that may be attributable to CGS effluents. Shielded, high purity germanium (HPGe) detectors are used to assay environmental samples for gamma emitting radionuclides. All samples are counted in standardized, calibrated geometries.

- **Liquids** – Measured aliquots of the liquid samples are poured into appropriately sized Marinelli beakers or plastic container. Sample results are corrected for decay during the collection period if applicable. Results are reported in pCi/liter.
- **Solids** – Soil, sludge, and sediment samples are dried and ground as needed. Foodstuff, biota (fish), and vegetation, are chopped finely or pureed and then analyzed wet (no drying is done). For foodstuff (including fish), only the edible portion of the sample is used. Sample aliquots are placed in tared containers and weighed. Results are reported in pCi/kg.
- **Charcoal Cartridges** – Typically four charcoal cartridges are counted simultaneously using a cartridge holding jig that positions the cartridges in a standardized geometry to the side of the detector. Detector calibration files are maintained for both face count and side count positions. If radioiodines are identified in the assay of a group, each charcoal cartridge in the group is assayed separately. Results are corrected for decay during the sample collection period. Results are reported in pCi/m³.
- **Air Particulate Filters** – At the end of each quarter, air particulate filters are composited on a station by station basis. The filters are stacked in a Petri dish and analyzed by gamma spectroscopy. Results are reported in pCi/m³ and represent the total quarterly gamma activity collected at each station. Results are decay corrected to the midpoint of the sample collection period. If a radionuclide related to CGS operation is positively identified, the filters are separated and counted individually.

4.6.4 Gross Alpha and Gross Beta Activity in Water

A measured aliquot of each sample is evaporated to a small volume then quantitatively transferred to a ribbed, stainless steel planchet. Final evaporation is normally done under a heat lamp. Residue mass is determined by weighing the planchet before and after mounting the sample. The planchet is counted for gross alpha and beta activity using a Protean WPC-9550 automatic gas flow proportional counter which allows automated sample counting and simultaneous alpha/beta determination. Results are corrected for sample self-absorption using the sample residue mass values. Results are reported in pCi/liter.

4.6.5 Tritium in Water

The sample is distilled, then 8.0mL of the distillate is mixed with 12.0mL of scintillation cocktail. The sample mixture is analyzed on a Packard Tri-Carb 2900TR automatic liquid scintillation counter. Results are reported in pCi/liter.

4.6.6 Low Level Radioiodine in Milk and Water

Four liters of sample are first equilibrated with stable iodide carrier. Anion exchange resin is then added and mixed for a period sufficient to allow any iodine present in the sample to be captured by the resin. The resin is then isolated from the liquid sample and transferred to a small counting container. The radioiodine content is determined by gamma spectroscopy analysis. Results are reported in pCi/liter.

4.6.7 Carbon-14

Carbon-14 levels in the environment around CGS are evaluated by comparison of carbon-14 content in apples obtained from local orchards to apples obtained from control locations. The analysis method used involves sample oxidation, capture of the resulting carbon dioxide, then liquid scintillation counting. Final results are calculated on a wet weight basis. Sample analysis is performed by an outside laboratory.

4.6.8 Strontium-89/90, Iron-55, and Nickel-63

These "hard to detect" analytes are not routinely analyzed as part of the CGS REMP. When needed, these analyses are performed under contract by Teledyne- Brown Environmental Services Laboratory located in Knoxville, TN using the vendor's standard analysis procedures.

4.7 Data Analysis Methods

Counting results for low level samples are often within the counting error of the background determination; consequently, results for these samples can be positive or negative values. Though most REMP analytical results are below the detection limit, an actual calculated value has been reported. In some cases, the reported value is zero or a negative number. Reporting results in this manner is the preferred practice for low level environmental analyses as it gives an indication of positive or negative biases that may be present and prevents loss of individual results inherent in the use of "less than" (<) values. Also reported in most cases are the *a posteriori* MDA values. A nuclide is flagged as positively identified if its calculated value is greater than the MDA. A listing of the Energy Northwest nominal target LLDs (*a priori*) for each sample type is provided in Table 4-4; the ODCM required LLDs are also included for a comparison.

Data is trended following analysis for many of the sample types analyzed. For analyses such as gross beta on air particulate filters where results are normally above the detection limit, indicator results are plotted with the control results for better comparison. Analysis results that are normally below detection limits are plotted against historical data to monitor if trends may be evident.

Thermoluminescent dosimeter (TLD) data is presented in both units of mR/day and mR/standard quarter. TLD results in mR/day are calculated by taking the total exposure (in mR) determined for each TLD, correcting for storage background and any transit (or trip) exposure received during distribution and retrieval, then dividing by the number of days the TLD was in the field. The mR/standard quarter values are calculated by multiplying the mR/day value by 91.25 days (365/4). All TLD results are reported in units of exposure (Roentgen) and not in units of dose (Rem).

4.8 Changes to the Sampling Program in 2019

No changes made to the sampling program in 2019.

TABLE 4-1
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SAMPLING PLAN

SAMPLE TYPE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ^(a)	SAMPLE COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS	REQUIRED BY
DIRECT RADIATION				
TLD ^(b)	Thirty-four routine monitoring stations either with two or more dosimeters or with one instrument for measuring and recording dose rate continuously, placed as follows:	Quarterly.	Gamma dose quarterly.	
	An inner ring of stations, one in each meteorological sector in the general area of the Site Boundary (ST: 1, 2, 13-20, 22, 24, 25, 49-51).			ODCM 6.3.1-1 1
	An outer ring of stations, one in each of the meteorological sectors of NE, ENE, E, ESE, SE in the six to ten km (3.73 to 6.21 miles) range from the site (ST: 46, 45, 43, 8, and 41), and one in each of the meteorological sectors of N, NNE, SSE, S, SSW in the nine to thirteen km (5.59 to 8.08 miles) range from the site (ST: 53, 54, 55, 6, and 56).			ODCM 6.3.1-1 1
	The balance of the stations to be placed in special interest areas such as population centers, nearby residences, schools, and one or two areas to serve as control stations (ST: 4, 5, 7, 10, 40, 42, 44, and 9A).			ODCM 6.3.1-1 1
	Additional monitoring stations for the Independent Spent Fuel Storage Installation (ISFSI). (ST: 121-131, 136B-138B).			ODCM 6.3.1-1 1
TLD	9.6 miles SSE(ST-4) 6.5 miles SE (ST-40) 7.7 miles S (ST-6) 2.8 miles WNW(ST-7) 4.4 miles ESE (ST-8) 28 miles WSW(ST-9) 3.2 miles E (ST-10) 3.2 miles ENE (ST-11) 6.7 miles NNW (ST-12) At least 1 TLD within each 22 1/2° sector around CGS located between 0.9 and 2.2 miles of CGS. (ST: 1-3, 13-25, 47, and 49-51)	Continuous Exposure Quarterly Collection	Exposure Rate (milliroentgen/period)	EFSEC 332
TLD ISFSI	4 or more TLDs located on ISFSI security fence line. (ST: 124, 128, 129, 137B)	Continuous Exposure Quarterly Collection	Exposure Rate (milliroentgen/period)	EFSEC 332

TABLE 4-1
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SAMPLING PLAN

SAMPLE TYPE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ^(a)	SAMPLE COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS	REQUIRED BY
TLD	0.44 miles WSW (ST-58) 8.87 miles S (ST-65) 0.90 miles ESE (ST-150) 0.83 miles E (ST-151) 0.30 miles NW (ST-155) 0.33 miles NNW (ST-156)	Continuous Exposure Quarterly Collection	Exposure Rate (milliroentgen/period)	OTHER-Special study stations
	0.17 miles WNW (ST-88) 0.23 miles WSW (ST-89)			CGS initiative
	0.28 miles SSE (ST-119C) 0.31 miles S (ST-119B)			EFSEC 299
AIRBORNE				
Particulates and Radioiodine	Samples from six locations:	Continuous sampler operation with sample collection weekly, or more frequently if required by dust loading.	Radioiodine Canister: I-131 analysis weekly.	
	One sample from close to the Site Boundary location, having a high calculated annual average ground-level D/Q. (ST-57)		Particulate Sampler: Gross beta radioactivity analysis following filter change, ^(c)	ODCM 6.3.1-1 2
	Three samples from close to the three Columbia River locations having the highest calculated D/Q. (ST: 8, 40, and 48)		Particulate Sampler: Gross beta radioactivity analysis following filter change, ^(c)	ODCM 6.3.1-1 2
	One sample from the vicinity of a community having the highest calculated annual average ground level D/Q. (ST-4)		Particulate Sampler: Gross beta radioactivity analysis following filter change, ^(c)	ODCM 6.3.1-1 2
	One sample from a control location, greater than 30 km (18.64 mi) from Columbia Generating Station (CGS) and in a sector not likely to be influenced by CGS. (ST-9)		Gamma isotopic analysis ^(d) of composite (by location) quarterly.	ODCM 6.3.1-1 2
Particulates and Radioiodine	1.3 miles S (ST-1) 3.0 miles ESE (ST-23) 4.6 miles NE (ST-48) 9.6 miles SSE (ST-4) 6.5 miles SE (ST-40) 7.7 miles S (ST-6) 2.8 miles WNW (ST-7) 4.4 miles ESE (ST-8) 28 miles WSW (ST-9)	Continuous Sampling Weekly Collection	Radioiodine analysis (I-131) Weekly Particulate Gross Beta analysis weekly Particulate gamma isotopic of quarterly composite (by location)	EFSEC 332
	7.72 miles ESE (ST-5) 1.1 miles ESE (ST-21B)		Radioiodine analysis (I-131) Weekly Particulate Gross Beta analysis weekly Particulate gamma isotopic of quarterly composite (by location)	CGS Initiative

TABLE 4-1
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SAMPLING PLAN

SAMPLE TYPE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ^(a)	SAMPLE COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS	REQUIRED BY
WATERBORNE				
a. Surface ^(e)	One sample upstream (ST- 26) One sample downstream (ST-29)	Composite sample over one month period. ^(f)	Gamma isotopic analysis ^(d) monthly. Composite for tritium analysis quarterly.	ODCM 6.3.1-1 3a
b. Ground	Samples from one or two sources only if likely to be affected. ^(g) (ST-31)	Grab sample performed quarterly	Gamma isotopic ^(d) and tritium analysis quarterly.	ODCM 6.3.1-1 3b
c. Drinking	One sample of each of one to three of the nearest water supplies that could be affected by its discharge. (ST-27) One sample from a control location. (ST-26)	Composite sample over two week period ^(h) when I-131 analysis is performed; monthly composite otherwise.	I-131 analysis on each composite when the dose calculated for the consumption of the water is greater than one mrem per year. ^(h) Composite for gross beta and gamma isotopic analysis ^(d) monthly. Composite for tritium analysis quarterly.	ODCM 6.3.1-1 3c
Sanitary Waste Treatment Facility Water	ST-102B	Composite Aliquots. Monthly collection.	Monthly gamma isotopic, gross beta, gross alpha, and tritium.	EFSEC 300
Ground Water	ST-32	Grab sample performed quarterly	Quarterly gamma isotopic and tritium.	OTHER-Special study stations
Ground Water Monitoring	MW-3, 5, 6, 9-14	Grab sample performed quarterly	Quarterly gamma isotopic and tritium.	NEI 07-07 and NPDES
Evaporation Pond Water	EVP-1A, 1B, 2	Grab sample performed annually	Annual gamma isotopic and tritium	EFSEC 874
Evaporation Pond Water	EVP-3, 4	Grab sample performed annually	Annual gamma isotopic and tritium	CGS Initiative
River Intake, Plant Discharge, Storm Drain, and Drinking Water	3.2 miles E (ST-26) 3.2 miles E (ST-27) 0.2 miles ENE (ST-101B) 11.6 miles SSE (ST-29)	Composite Aliquots Monthly Collection	Gamma Isotopic, Gross Beta, and Tritium on all samples. Sr-90 on drinking water as needed (see note)	EFSEC 332
A representative sample will be collected using automatic composite sampling equipment that collects samples on a flow proportional or a set timed interval. When timed interval sampling is used, the sample collection frequency is short (e.g., hourly) relative to the compositing period (e.g., monthly). Flow proportional sampling is preferred.				
If the gross beta activity in a drinking water sample is greater than 8 pCi/l, strontium-90 analysis will be performed. This requirement does not pertain to river intake, storm drain, or plant discharge water.				
Storm Drain	0.2 miles ENE (ST-101B)	Composite Aliquots Monthly Collection	Gamma Isotopic, Gross Beta, and Tritium on all samples.	EFSEC 874

TABLE 4-1
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SAMPLING PLAN

SAMPLE TYPE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ^(a)	SAMPLE COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS	REQUIRED BY
Ground Water	0.1 miles N (ST-52) From two shallow groundwater well locations.	Quarterly Grab Samples	Gamma Isotopic and Tritium.	EFSEC 332
Shallow groundwater sampling locations include MW-3,5,6,7,8,9,10,11,12,13,14.				
SOIL AND SEDIMENT				
d. Sediment from shoreline	One sample from downstream area with existing or potential recreational value. (ST-34)	Semiannually.	Gamma isotopic analysis ^(d) semiannually.	ODCM 6.3.1-1 3d
Evaporation Pond Sediment	EV-3, 4	Grab sample performed annually	Annual gamma isotopic.	EFSEC 874
Cooling System Sediment Disposal Area	ST-119B	Grab sample of dried sediment within 30 days of disposal date.	Gamma Isotopic. After disposal.	EFSEC 299
River Sediment	~2.0 miles upstream (ST-33) ~1.0 miles downstream (ST-34)	Annual Grab sample	Gamma Isotopic	EFSEC 332
Sample should consist of shoreline sediment and not deep water sediment. Samples should be taken from areas known to be underwater during high water periods and where the potential for river silt or sediment accumulation is likely.				
Soil	Two samples from locations near CGS historically sampled, two samples from locations in Franklin County, one sample from control location.	Annual Grab Sample	Gamma Isotopic Sr-90 as needed (see note)	EFSEC 332
Locations near CGS historically sampled include air sample stations 1, 21, 7, and 23. Samples should be alternated so that these locations are sampled bi-annually. Samples from Franklin County should be from agricultural areas that may be impacted by CGS operation. Control is ST-9, 28 miles WSW of CGS.				
Individual soil samples will be analyzed for strontium-90 if gamma results indicate the presence of radionuclides attributable to CGS operation at levels that are greater than 5 times the historic trend and greater than 5 times the analysis LLD.				
INGESTION				
a. Milk	Samples from milking animals from at least one location within 10 miles distance having the highest dose potential, if available. ^(h) (ST-36) Samples from location within 10 miles distance where milking animals are known to be on pasture. If unavailable, collect an additional sample from the location with the highest dose potential, if available. ^(h) (ST-36B) Sample from milking animals at a control location greater than 30 km (18.6 miles) and in a sector not likely to be influenced by CGS. ^(l) (ST-9B)	Monthly in the first half of the month. Monthly during the grazing season, in the second half of the month. Monthly	Gamma isotopic ^{(d)(k)} , Iodine-131 analysis monthly	ODCM 6.3.1-1 4a

TABLE 4-1
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SAMPLING PLAN

SAMPLE TYPE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ^(a)	SAMPLE COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS	REQUIRED BY
Milk	Milk from at least 1 Dairy within 10 miles of CGS. (ST-36) (see note) Milk control from Dairy > 20 miles from CGS and in sector not likely to be effected by CGS operation. (ST-9B)	Semi monthly when milk animals are on pasture, monthly at other times.	Gamma Isotopic and I-131 analysis on all samples collected. Sr-90 if Cs-134/137 identified in excess of 30 pCi/l	EFSEC 332
Samples are obtained from at least one milk producer located within ten miles of CGS, if available. If more than one producer is available, collection from more than one location should be made. If multiple locations (GT 2) are available, the 2 locations with the highest dose potential should be sampled.				
If no milk producers within 10 miles are available, samples of broadleaf vegetation or feed grown near 2 offsite locations with higher predicted ground level D/Q values may be sampled monthly during the growing season in lieu of milk sampling.				
b. Fish and Invertebrates	One sample of each of three recreationally important species (one anadromous and two resident) in vicinity of plant discharge area. (ST-30) One sample of same species in areas not influenced by plant discharge. (ST-38)	Sample annually, unless an impact is indicated, then semiannually. ⁽ⁱ⁾	Gamma isotopic analysis ^(d) on edible portions.	ODCM 6.3.1-1 4b
Fish	One sample from 3 species (one anadromous and two resident) in the vicinity of the plant discharge area. (ST- 30) One sample from the same or similar species from areas not influenced by plant discharge. (ST-38)	Annually, unless an impact is indicated, then semiannually	Gamma Isotopic on edible portions.	EFSEC 332
If any of the analytical results of the Columbia River fish samples are significantly higher than the results of the control samples or results from previous years, sampling is to be conducted semiannually.				
Anadromous species may be collected at local hatcheries. Fish species with recreational value should preferentially be collected if available.				
c. Food Products	1 sample of each principal class of food products from any area that is irrigated by water in which liquid plant wastes have been discharged. (ST-9C, 37 , 48G, 104 , 37B)	At time of harvest. ^(j)	Gamma isotopic analysis ^(d) on edible portions.	ODCM 6.3.1-1 4c
Fruits and Vegetables	Samples of fruits and vegetables grown for human consumption from locations using Columbia River water obtained downstream of CGS discharge or from locations potentially impacted by CGS gaseous emissions. (ST-37, 37B) Samples of fruits and vegetables from control locations. (ST-9C)	During growing season, at time of availability.	Gamma Isotopic on edible portions.	EFSEC 332
Samples should be obtained from farms or gardens in close proximity to CGS. Sample of root crops, leafy vegetables, and fruits should be collected as they are in season; different varieties should be obtained. For locations where the predominate pathway is gaseous, leafy vegetables are the preferred sample media. For locations where the predominate pathway is liquid, root crops are the preferred sample media. Vegetation samples taken from locations within 2 miles of CGS may be taken in place of leafy vegetables.				
One control root crop, leafy vegetable, and fruit sample should be collected each year.				

Table 4-1 Footnotes for ODCM requirements:

- (a) Specific parameters of distance and direction sector relative to the reactor are provided for each sample location in Table 5-1. Refer to Radiological Assessment Branch Technical Position, Revision 1, November 1979. Deviations are permitted from the required sampling schedule if specimens are unobtainable due to circumstances such as hazardous conditions, seasonal unavailability, and malfunction of automatic sampling equipment. When sample media is unobtainable due to equipment malfunction, corrective actions should be taken to ensure equipment is returned to functional status prior to the end of the next sampling period. In some cases, alternate sample collection may be substituted for the missing specimen.
- (b) One or more instruments, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. For the purposes of this table, a thermoluminescent dosimeter (TLD) is considered to be one phosphor card with multiple readout areas; a phosphor card in a packet is considered to be equivalent to two or more dosimeters. Film badges shall not be used as dosimeters for measuring direct radiation. (The number of direct radiation monitoring stations may be reduced according to geographical limitations. The frequency of analysis or readout for TLD systems will depend upon the characteristics of the specific system used and should be selected to obtain optimum dose information with minimal fading.)
- (c) Airborne particulate sample filters shall be analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thorium daughter decay. If gross beta activity in air particulate samples is greater than 10 times the yearly mean of control samples, gamma isotopic analysis shall be performed on the individual samples.
- (d) Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.
- (e) The "upstream sample" shall be taken from the Tower Makeup (TMU) intake line. The "downstream" sample shall be taken from the Circulating Water Blowdown (CBD) discharge line.
- (f) A composite sample is one in which the quantity (aliquot) of liquid is proportional to the quantity of flowing liquid and in which the method of sampling employed results in a specimen that is representative of the liquid flow. In this program composite sample aliquots shall be collected at time intervals that are very short (e.g., hourly) relative to the compositing period (e.g., monthly) in order to assure obtaining a representative sample.
- (g) Groundwater samples shall be taken when this source is tapped for drinking or irrigation purposes in areas where the hydraulic gradient or recharge properties are suitable for contamination.
- (h) (for Waterborne c. Drinking) The dose shall be calculated for the maximum organ and age group, using the methodology and parameters in the ODCM.
- (h) If no milk producers within 10 miles are available, samples of three types of broad leaf vegetation or feed grown near 2 offsite locations with higher predicted ground level D/Q values may be sampled monthly during the growing season in lieu of milk sampling.
- (i) If any of the analytical results for Columbia River fish samples are significantly higher than the results of the control location samples or the results of previous fish samples, sampling will be conducted semiannually.
- (j) If harvest occurs more than once a year, sampling shall be performed during each discrete harvest. If harvest occurs continuously, sampling shall be monthly. Attention shall be paid to including samples of tuberous and root food products.
- (k) If Cs-134 or Cs-137 is measured in an individual milk sample in excess of 30 pCi/L, then Sr-90 analysis shall be performed.
- (l) If no milk producers within 10 miles are available and sampling per footnote (h) is performed, obtain samples of similar broadleaf vegetation or feed grown at locations greater than 30 km from CGS and in sectors not likely to be influenced by CGS monthly in lieu of control milk sampling.

TABLE 4-2
REMP SAMPLE STATIONS AND REQUIREMENTS

SECTOR ^(a)	STATION NUMBER ^(b)	DISTANCE MILES ^(c)	ODCM ^(d)	STATE ^(e)	OTHER ^(f)
N (1)	52	0.07	DGW	DGW	
	71(1S)	0.28			TLD
	47	0.70		TLD	
	57	0.70	AP/AI		
	18	1.16	TLD	TLD	
	53	7.54	TLD		
NNE (2)	72(2S)	0.32			TLD
	2	1.45	TLD	TLD	
	54	6.08	TLD		
	EVP-1A	0.31		Dis W	
NE (3)	73(3S)	0.54			TLD
	19	1.74	TLD	TLD	
	48	4.59	AP/AI	AP/AI, SO	
	48G ^(k)	4.63	GP		
	46	4.99	TLD		
	MW-9	0.22		SGW	SGW
	EVP-1B	0.25		Dis W	
	EVP-2	0.35		Dis W	
	EVP-3	0.43		SE	
ENE (4)	74(4S)	0.38			TLD
	21	1.45		TLD, SO	
	20	1.93	TLD	TLD	
	11	3.16		TLD	
	33	3.44		SE	
	45	4.45	TLD		
	44	5.90	TLD		
	101B	0.22		Dis W	
	MW-11	0.10		SGW	SGW
	EVP-4	0.60		SE	
E (5)	75(5S)	0.37			TLD
	22	2.08	TLD		
	10	3.16	TLD	TLD	
	26	3.19	SW, DW	SW	
	27	3.19	SW	Dis W	
	30 ^(g)	3.5	FI	FI	
	43	5.63	TLD		
	104 ^(k)	5.08			GP
	151 (Site 4)	0.83			TLD
	MW-12	0.12		SGW	SGW

TABLE 4-2
REMP SAMPLE STATIONS AND REQUIREMENTS

SECTOR ^(a)	STATION NUMBER ^(b)	DISTANCE MILES ^(c)	ODCM ^(d)	STATE ^(e)	OTHER ^(f)
ESE (6)	76(6S)	0.42			TLD
	31	1.06	DGW		
	32	1.27			DGW
	51	2.14	TLD		
	34	3.32	SE	SE	
	23	3.03		TLD, AP/AI, SO	
	8	4.39	TLD, AP/AI	TLD, AP/AI, SO	
	42	5.85	TLD		
	36	7.33	MI	MI	
	36B ⁽ⁿ⁾	6.2	MI	MI	
	5	7.72	TLD	SO	AP/AI
	38 ^(g)	26	FI	FI	
	21B	1.1			AP/AI
	150 (Site 1)	0.90			TLD
SE (7)	77(7S)	0.57			TLD
	24	1.87	TLD	TLD	
	3	2.06		TLD	
	41	5.79	TLD		
	40	6.51	TLD, AP/AI	AP/AI	
	MW-14	0.58		SGW	SGW
SSE (8)	119C	0.28		TLD	
	102B	0.50		SFW	
	78(8S)	0.81			TLD
	25	1.50	TLD	TLD	
	55	6.05	TLD		
	4	9.57	TLD, AP/AI	TLD, AP/AI	
	29	11.57	DW	DW	
	37 ^(h)	16	GP	GP, SO	
	37B ^(h)	10.1	GP	GP	
	MW-6	0.33		SGW	SGW
	MW-13	0.52		SGW	SGW
S (9)	119B	0.31		TLD, SE	
	79(9S)	0.76			TLD
	1	1.25	TLD	TLD, AP/AI, SO	
	6	7.72	TLD	TLD, AP/AI	
	65	8.87			TLD
SSW (10)	80(10S)	0.83			TLD
	50	1.26	TLD	TLD	
	56	6.65	TLD		
	MW-3	0.31		SGW	SGW

TABLE 4-2
REMP SAMPLE STATIONS AND REQUIREMENTS

SECTOR ^(a)	STATION NUMBER ^(b)	DISTANCE MILES ^(c)	ODCM ^(d)	STATE ^(e)	OTHER ^(f)
SW (11)	81(11S)	0.74			TLD
	MW-5	0.43		SGW	SGW
	13	1.26	TLD	TLD	
	9B	23.2	MI	MI	
WSW (12)	82(12S)	0.57			TLD
	14	1.26	TLD	TLD	
	9A	28.35	TLD, AP/AI	TLD, AP/AI, SO	
	9C ⁽ⁱ⁾	32	GP	GP	
	89 ^(j)	0.23			TLD
	58	0.44			TLD
W (13)	83(13S)	0.52			TLD
	15	1.24	TLD	TLD	
WNW (14)	84(14S)	0.55			TLD
	16	1.21	TLD	TLD	
	7	2.83	TLD	TLD, AP/AI, SO	
	88 ^(j)	0.17			TLD
	MW-10	0.07		SGW	SGW
NW (15)	85 (15S)	0.43			TLD
	130	0.24			TLD
	49	1.19	TLD	TLD	
	155	0.30			TLD
NNW (16)	121	0.12			TLD
	122	0.31			TLD
	123	0.29			TLD
	124 ^(m)	0.28		TLD	TLD
	125	0.28			TLD
	126	0.28			TLD
	127	0.26			TLD
	128 ^(m)	0.25		TLD	TLD
	129 ^(m)	0.17		TLD	TLD
	131	0.21			TLD
	136B	0.29			TLD
	137B ^(m)	0.24		TLD	TLD
	138B	0.17			TLD
	86 (16S)	0.31			TLD
	17	1.19	TLD	TLD	
	12	6.74		TLD	
	156	0.33			TLD

TABLE 4-2 SAMPLE TYPE KEY

AP/AI - Air Particulate/Air Iodine	DW - Drinking Water
Dis W - Discharge Water	FI - Fish
GP - Garden/Orchard Produce	DGW - Deep Ground Water
MI - Milk	SE - Sediment
SFW - Sanitation Facility Water	SO - Soil
SW - Surface Water	TLD - Thermoluminescent Dosimeter
VE – Vegetation	SGW – Shallow Ground Water

TABLE 4-2 FOOTNOTES:

- (a) The area in the vicinity of CGS is separated into 16 sectors for reporting purposes. The 16 sectors cover 360 degrees in equal 22.5 degree sections, beginning with sector 1 (N) at 348.75 to 11.25 degrees and continuing clockwise through sector 16 (NNW).
- (b) Alternate designations for some sample stations are given in parentheses; i.e., TLD Stations 71-86 are also referred to as 1S-16S.
- (c) Distance and sector indications are relative to the center of the CGS reactor building and were determined using GPS coordinate readings. Distance and sector indication for the Evaporation Ponds is to the center of each pond.
- (d) ODCM - Offsite Dose Calculation Manual Table 6.3.1-1 requirement.
- (e) STATE - State of Washington EFSEC requirement. Station 102B is an EFSEC Resolution 300 requirement. Stations 119B and 119C are EFSEC Resolution 299 requirements. Sampling at Evaporation Ponds 1A, 1B, 2, 3, and 4 is specified in EFSEC Council Order 874. All other State required samples are specified in EFSEC Resolution 332. Only five of the nine listed soil stations are sampled each year.
- (f) OTHER –Special study stations. TLD Stations 121 through 131 and 136B through 138B satisfy ISFSI monitoring requirements 10CFR72.44(d)(2). Sampling at MW locations is performed to meet NEI 07-07 guidelines and NPDDES requirements.
- (g) Station 30 is the Columbia River at the vicinity of the plant discharge. Actual distance of fish collection locations from plant are variable, distance listed is approximation. Station 38 is the Snake River. Control resident fish are typically collected at variable locations in area below Ice Harbor Dam, distance listed is approximation. Control anadromous fish are typically collected at Lyons Ferry Fish Hatchery.
- (h) Fruit and Vegetable indicator samples are typically collected from farms and gardens in the Riverview area of Pasco. Distance listed here is general distance of Riverview area to CGS. Station 37 designation is also used for any samples collected in Franklin County that could potentially be affected by CGS liquid or gaseous effluents. Station 37B is the designation given for a garden located at the Washington State University branch campus in Richland, WA.
- (i) Station 9C is the designation given for control fruits and vegetables. Distance listed is general distance to the Sunnyside-Grandview area where the majority of the control fruits and vegetables are obtained.
- (j) Stations 88-89 were installed at CGS initiative to monitor remediation work at the DOE 618-11 burial ground. No remediation work was performed at the burial ground in 2019. Quarterly TLDs were deployed at both stations in 2019. No air samples were collected from any of these locations in 2019.
- (k) Station 48G is listed in ODCM table 5-1 as an alternate (garden produce) location for atmospheric deposition. This location consists of a small garden near the Ringold Fish Hatchery. Station 104, though outside the 5-mile radius of CGS, is the garden location with the highest projected dose commitment. CGS obtained broad leaf vegetable samples from both stations 48G and 104 in 2019.
- (l) MW-3, 5, 6, 9-14 are all listed as State required shallow groundwater monitoring stations. Actual EFSEC 332 requirement is to obtain 2 shallow ground water samples quarterly from any of these locations.
- (m) Stations 124, 128, 129 and 137 are ISFSI TLD stations listed as state requirements. Actual EFSEC 332 requirement is to have 4 or more TLDs located on the ISFSI security fence. Any 4 of the 12 TLD stations CGS has established on the ISFSI fence line can satisfy this requirement.
- (n) Station 36B is the designation given for second monthly indicator milk sample from a location where the milking animal was known to have been on pasture, if available.

TABLE 4-3
2019 FIVE MILE LAND USE CENSUS RESULTS

SECTOR ^(a)	NEAREST RESIDENT ^(b)	GARDEN ^(d) (>500 ft ²)	DAIRY ANIMALS ^(e)	LIVESTOCK ^(b,c)
NE	4.50	4.63	none	4.63
ENE	3.88	none	none	4.95
E	4.64	5.08	none	4.64
ESE	4.26	none	6.17	none
SE	none	none	none	none

FOOTNOTES

- (a) Within a five-mile radius of the plant, only the five sectors listed above contain activities related to land use census requirements. The other eleven sectors lay fully within the federally owned Hanford Site. Only those sectors containing potential land use census activities are presented here.
- (b) Estimated distances in miles from CGS Reactor Building based on GPS readings.
- (c) Ten to fifteen beef cattle were identified in a pasture in the ENE sector. The western edge of the pasture is just within the 5-mile radius of CGS. Additional feed appears to be provided at this location. A single horse was observed at a residence in the E sector, there is little pasture at this location and the horse appear to be fed mostly hay. Four chickens were observed in NE sector, there is no pasture at this location.
- (d) The garden in the NE sector is located approximately 200 yards from the Station 48 air sampler and is irrigated using water from a local spring. The garden in the E sector, though technically outside the 5-mile radius of CGS, was included as dose projections indicated higher deposition potential at this location than at any other garden identified. CGS REMP obtained broad leaf vegetable samples from the gardens in the NE and E sector in 2019. In addition to the 2 gardens, commercial agriculture is extensively practiced in some parts of the sectors listed in Table 4-3. Agricultural activities observed were primarily apple and soft fruit orchards, corn, alfalfa, and grape vineyards.
- (e) Eight head of goats were identified on pasture in the ESE sector. This location is outside the 5-mile radius of CGS, but was included given dose projections indicated higher deposition potential at this location than at any other dairy identified. Samples of goat milk obtained from this location served as second monthly sample.

TABLE 4-4
COMPARISON OF LABORATORY NOMINAL LOWER LIMITS OF DETECTION WITH
OFFSITE DOSE CALCULATION MANUAL REQUIREMENTS

MEDIA (UNITS)	ANALYSIS	ENERGY	
		NORTHWEST LLDs^(a)	ODCM REQUIRED LLDs
Air (pCi/m³)	Gross Beta	0.002	0.01
	Cs-134	0.001	0.05
	Cs-137	0.001	0.06
	I-131	0.03	0.07
Water: (pCi/liter)	Gross Beta	2.4	4
	Tritium	300	2000 ^(b)
	Sr-90	1	---
	Ni-63	5	---
	Fe-55	200	---
	I-131 ^(c)	1	---
	Mn-54	7	15
	Fe-59	10	30
	Co-58	7	15
	Co-60	7	15
	Zn-65	10	30
	Zr-Nb-95	7	15
	Cs-134	7	15
	Cs-137	7	18
Soil/Sediment: (pCi/kg dry)	Ba-La-140	10	15
	Mn-54	20	---
	Co-60	20	---
	Zn-65	30	---
	Cs-134	20	150
	Cs-137	20	180
Fish: (pCi/kg wet)	Sr-90	10	---
	Mn-54	25	130
	Fe-59	100	260
	Co-58	35	130
	Co-60	25	130
	Zn-65	50	260
	Cs-134	30	130
Milk: (pCi/liter)	Cs-137	25	150
	I-31 ^(c)	0.5	1
	Cs-134	8	15
	Cs-137	8	18
	Ba-La-140	10	15
Garden Produce: (pCi/kg wet)	Sr-90	1	---
	Cs-134	20	60
	Cs-137	20	80
	I-131	20	60

^(a) These are the nominal target LLDs (a priori) for analyses performed in the Energy Northwest Environmental Services Laboratory and are based on conservative assumptions. These calculations included corrections for decay during the collection period and delay prior to analysis using factors that are normally encountered for the different media types. Actual LLDs (a posteriori) may be higher or lower for specific samples.

^(b) If no drinking water pathway exists, a value of 3,000 pCi/liter may be used.

^(c) This ENW Iodine-131 LLD achieved by anion resin separation and does not represent a direct analysis of the sample media.

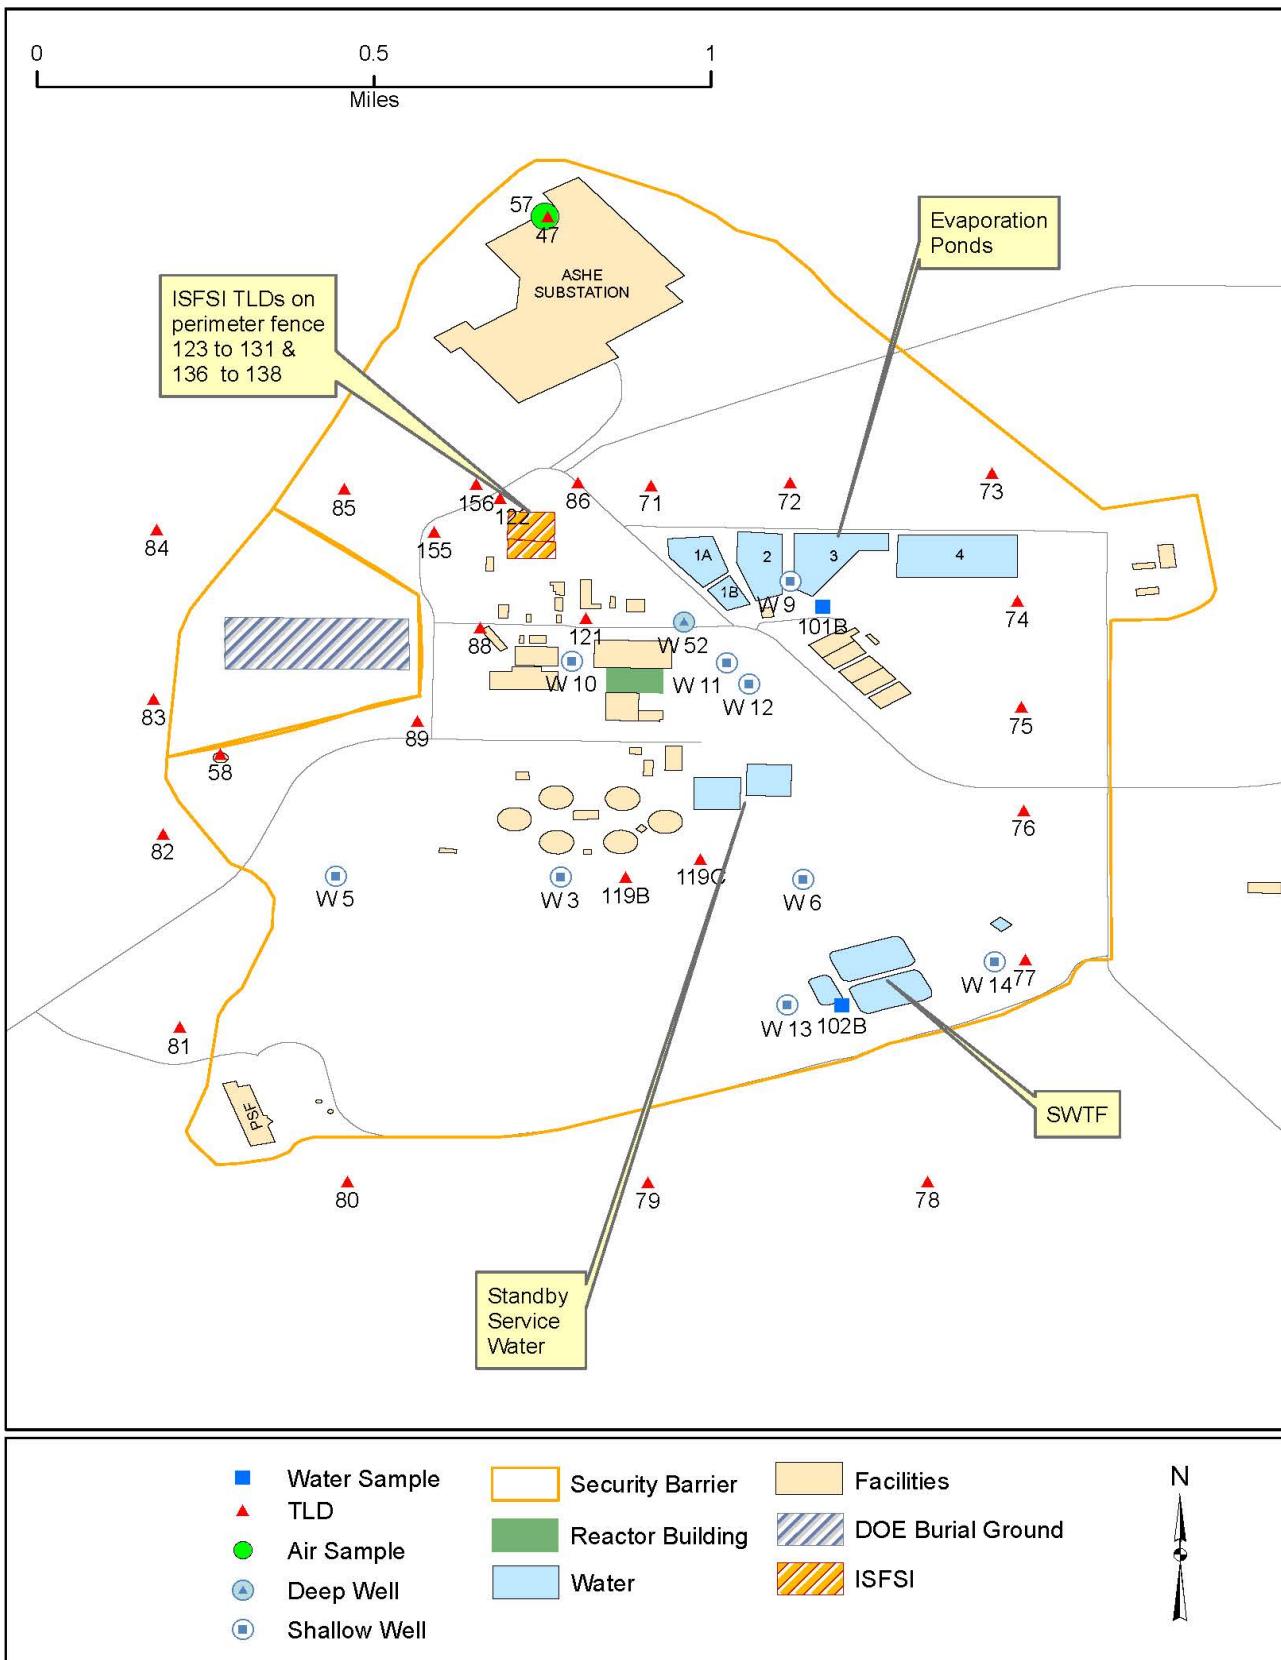


FIGURE 4-1 SELECT REMP SAMPLING LOCATIONS WITHIN 0.8 MILES OF CGS

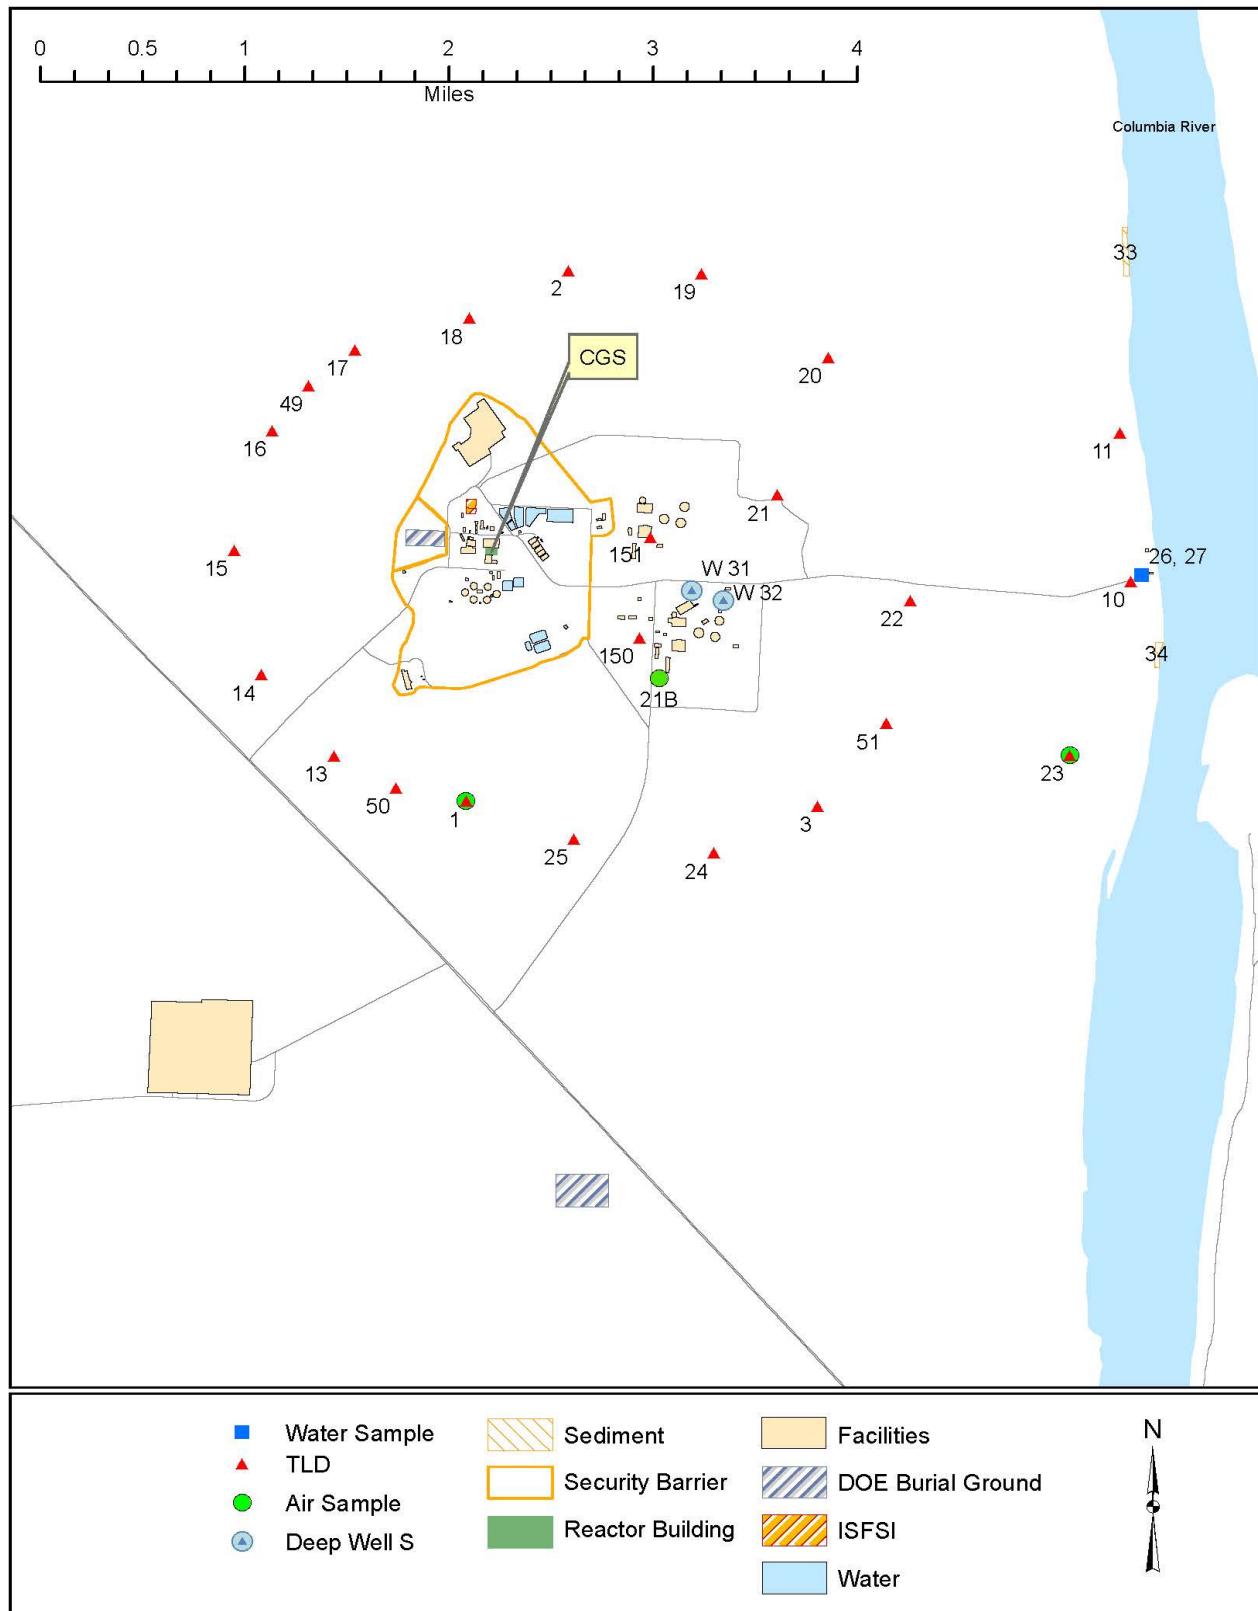


FIGURE 4-2 SELECT REMP SAMPLING LOCATIONS BETWEEN 0.8 AND 2.8 MILES

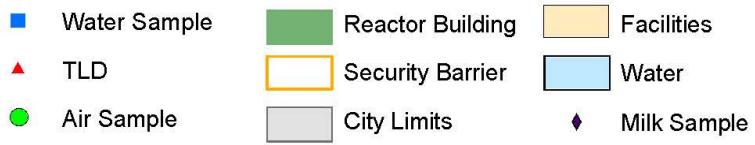
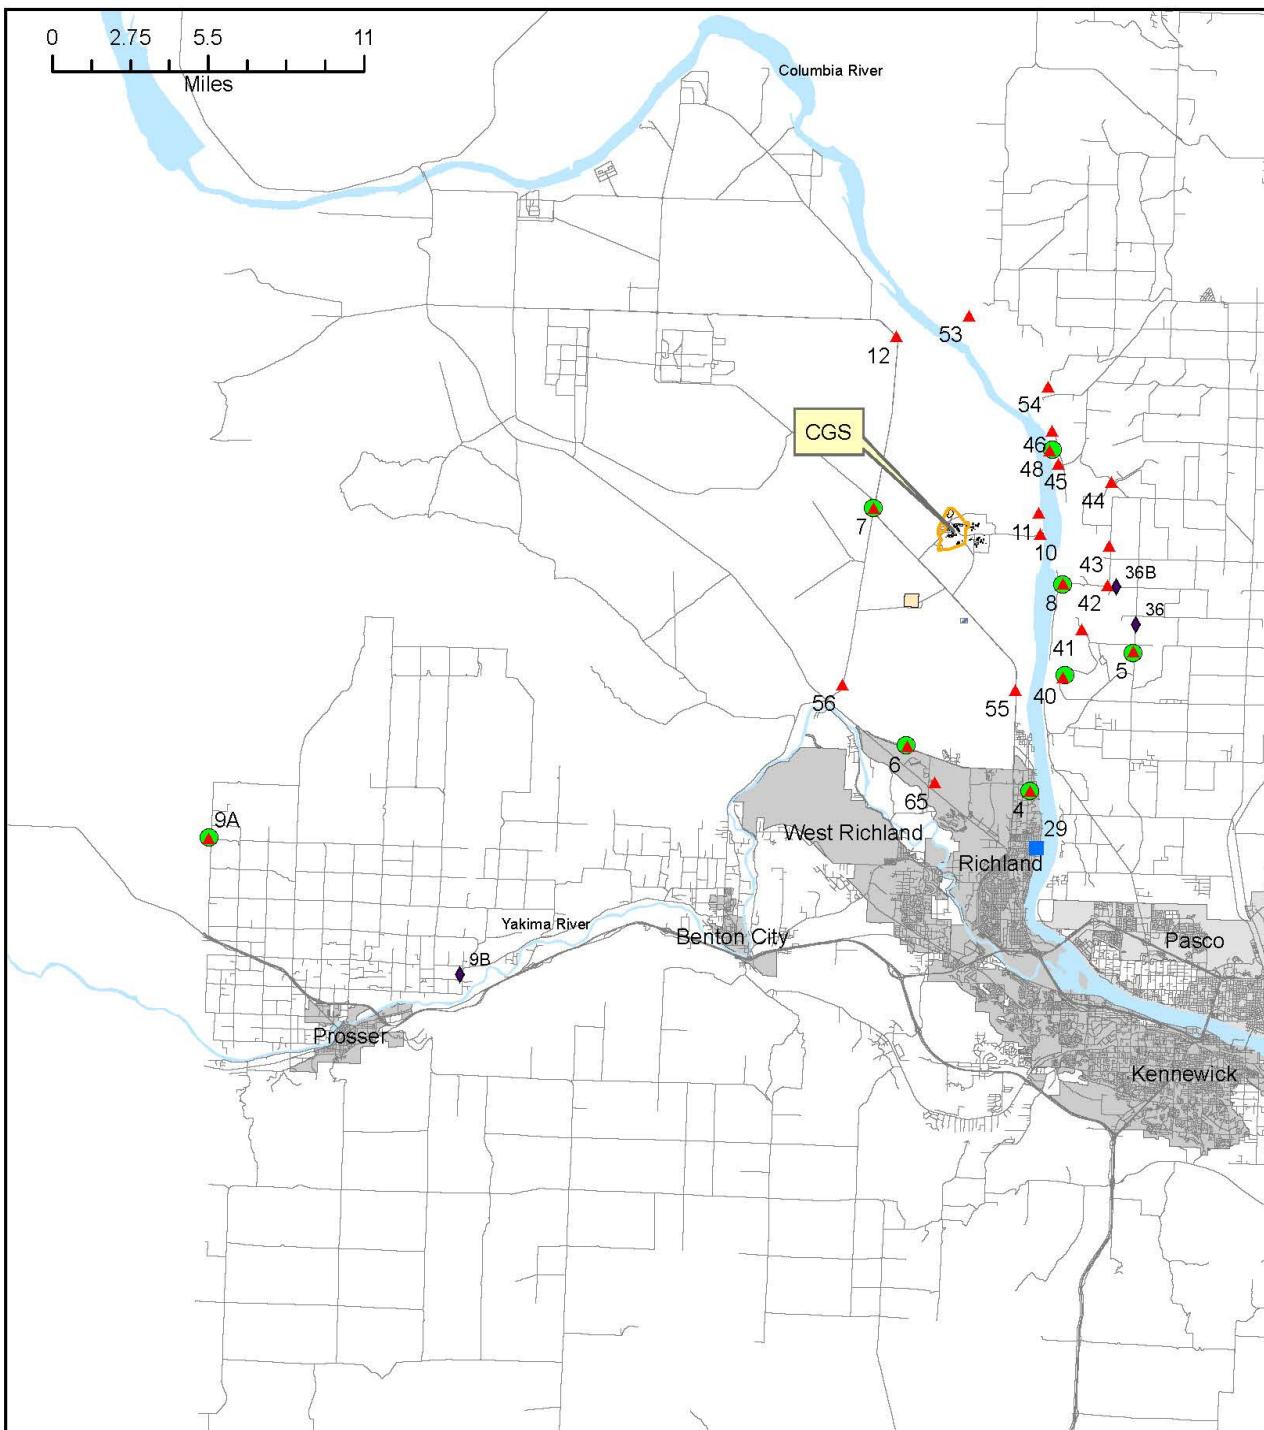


FIGURE 4-3 SELECT REMP SAMPLING LOCATIONS BEYOND 2.8 MILES

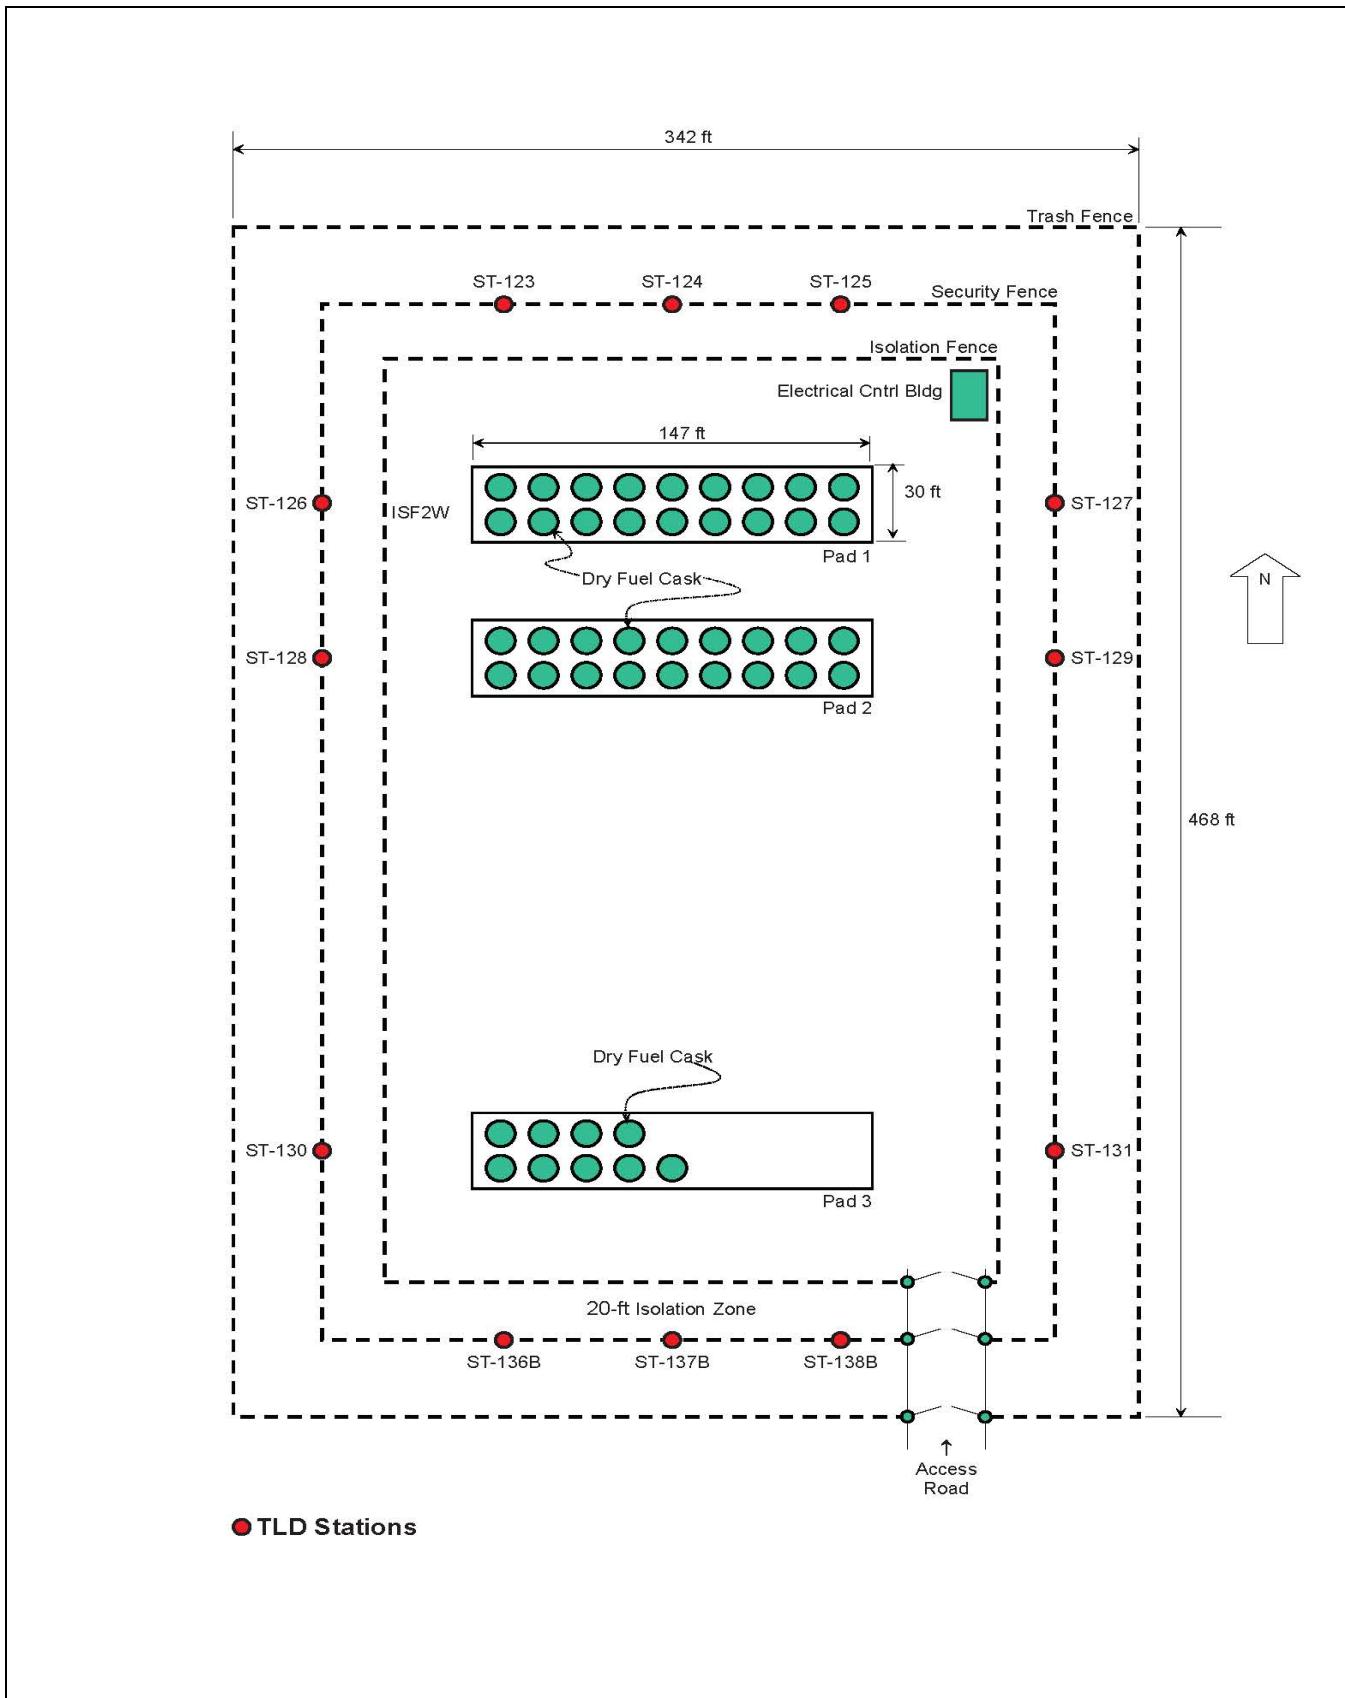


FIGURE 4-4 ISFSI TLD STATION LAYOUT

5.0 RESULTS AND DISCUSSION

5.0 RESULTS AND DISCUSSION

The 2019 Annual Radiological Environmental Operating Report for CGS covers the period from January 2019 to December 2019. Table 5-2 provides a summary of the ODCM required REMP sample and CGS groundwater monitoring analysis results in the format specified by the NRC.^(5,6) Results for naturally occurring radionuclides that are not related to CGS operations have not been included in the summary table. The lower limit of detection (LLD) values listed in Table 5-2 are the ODCM required detection limits and are not the method detection limits listed in Table 4-4. Analytical results for all REMP samples are presented in Appendix A of this volume. The following sections summarize the results in greater detail.

5.1 Direct Radiation

Direct radiation is monitored at 80 TLD locations surrounding CGS. TLDs are exchanged on a quarterly frequency at all locations. The 16 locations designated as "S" stations are located between 0.3 and 0.8 miles from the CGS reactor building and all are inside the property boundary, see Figure 4-1 for station locations. Figure 5-1 shows the 2019 "S" station mean quarterly TLD results separated into 16 geographical sectors around the plant. Figure 5-1 also shows the pre-operational mean and the high, low, and mean results in each sector for the 1984 - 2018 operational period for comparison. The 2019 "S" station TLD results were lower than the pre-operational mean in 11 of the 16 sectors and lower than the operational mean in 12 of the 16 sectors. TLD results from the N, NNE, and NNW sectors are slightly higher than the other "S" station locations as a result of being physically closer to the Independent Spent Fuel Storage Installation (ISFSI) and the CGS turbine building. TLD results for the NE sector (Station 73) have been slightly elevated since the 4th quarter in 2013 due to a mound of excavation dirt piled near the TLD station that increased the natural background at this location.

Excluding the NNW sector data, the average deviation relative to the operational period was -2.34%; in 2018 the average deviation was -3.85%. The NNW sector is the closest "S" station to the ISFSI and the higher result here is attributed to the station's close proximity to this facility.

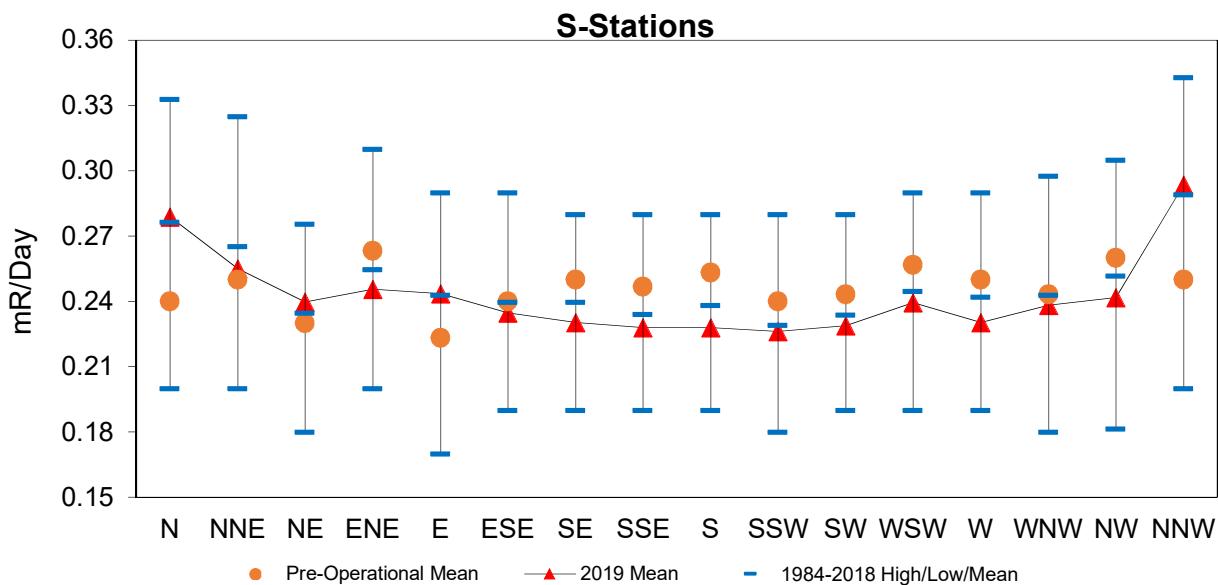


Figure 5-1 "S" Stations Quarterly TLDs 1984-2018 Hi/Low/Mean and 2019 Mean by Sector

The 19 locations designated as “near plant” stations are located at distances between 0.9 and 2.1 miles from the CGS reactor building, see Figure 4-2 for station locations. Figure 5-2 shows the exposure rates for the “near plant” TLD locations separated into sixteen geographical sectors around the plant. Figure 5-2 also shows the pre-operational mean and the high, low, and mean results in each sector for the 1984-2018 operational period for comparison. The 2019 “near plant” TLD results were lower than the pre-operational mean in 14 of the 16 sectors and less than the operational mean in 16 of the 16 sectors. The average deviation relative to the operational period was -3.6%; in 2018 the average deviation was -5.0%.

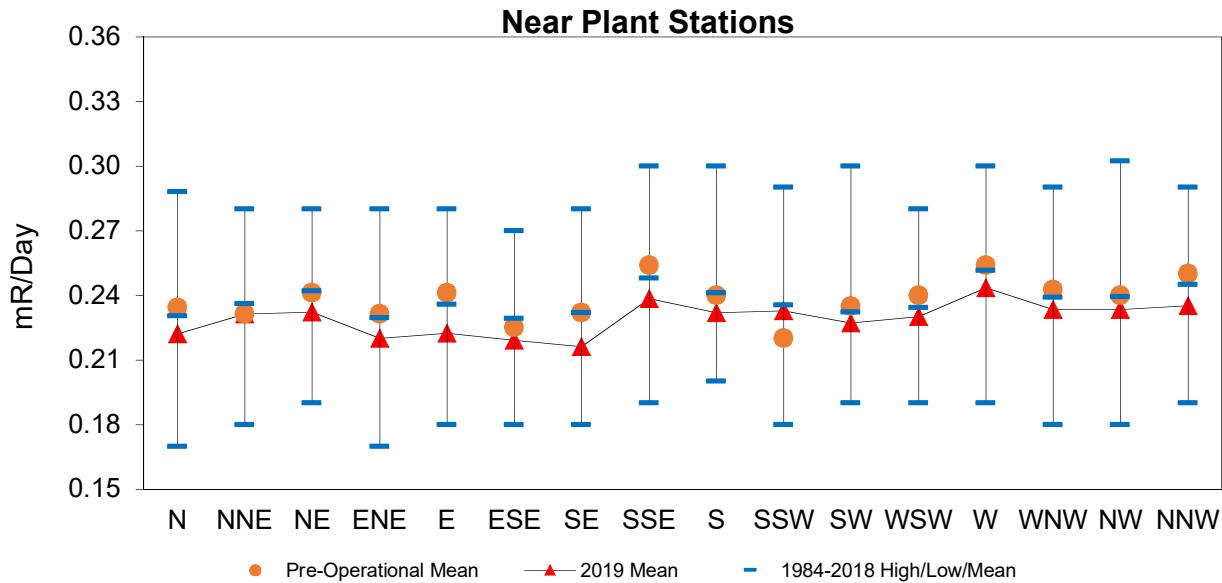


Figure 5-2 Near Plant Stations Quarterly TLDs 1984-2018 Hi/Low/Mean and 2019 Mean by Sector

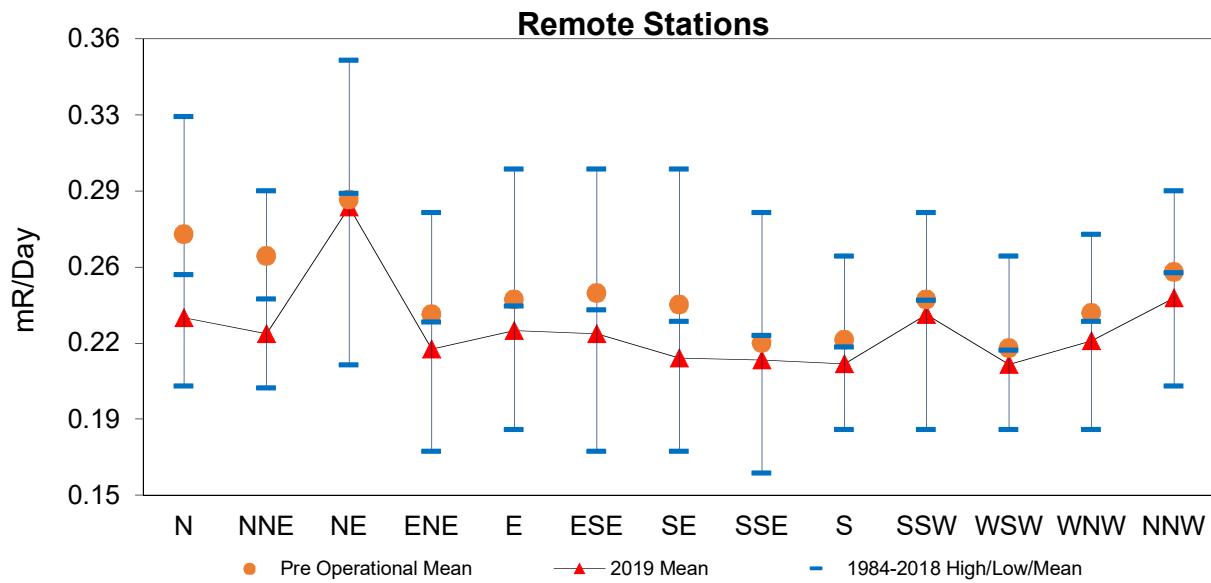


Figure 5-3 Remote Stations Quarterly TLDs 1984-2018 Hi/Low/Mean and 2019 Mean by Sector

The 22 TLD locations designated as remote locations are located between 2.83 and 28.35 miles from the CGS reactor building; see Figure 4-3 for station locations. Figure 5-3 shows the exposure rates for the remote TLD locations separated into geographical sectors around the plant. Figure 5-3 also shows the pre-operational mean and the high, low, and mean results by sector for the 1984-2018 operational period

for comparison. The 2019 remote TLD results were lower than both the pre-operational mean and the operational mean in all 13 sectors. Station 46 in the Wahluke Reserve (NE sector) remained the remote location with the highest exposure rate. This has been the case since the pre-operational measurement phase and is attributed to differences in the underlying rock and soil composition in this area. The 2019 average deviation relative to the operational period was -5.0%; the average deviation in 2018 was -7.0%.

Offsite direct radiation monitoring results are consistent with previous years. The 2019 results indicate no observable dose contributions due to plant operations at locations outside the CGS controlled area. Dose contributions inside the CGS controlled area were limited to those locations known to be influenced by the ISFSI and/or radiation from the turbine building during operation. Environmental radiation exposure rates for 2019, the pre-operational period, and the long term operational period are summarized in Table 5-3. See also Appendix A, Tables A-1.1 and B-1.1 for the 2019 quarterly TLD results. TLD results for special interest locations are discussed in further detail in Section 5.9.

5.2 Airborne Particulate/Iodine

Air samples are collected weekly at eleven locations in the vicinity of CGS. The control location is 28 miles WSW of CGS. Air particulate filters are analyzed for gross beta and iodine cartridges for radioiodine on a weekly basis. Air filters are also composited and analyzed for gamma emitting radionuclides quarterly.

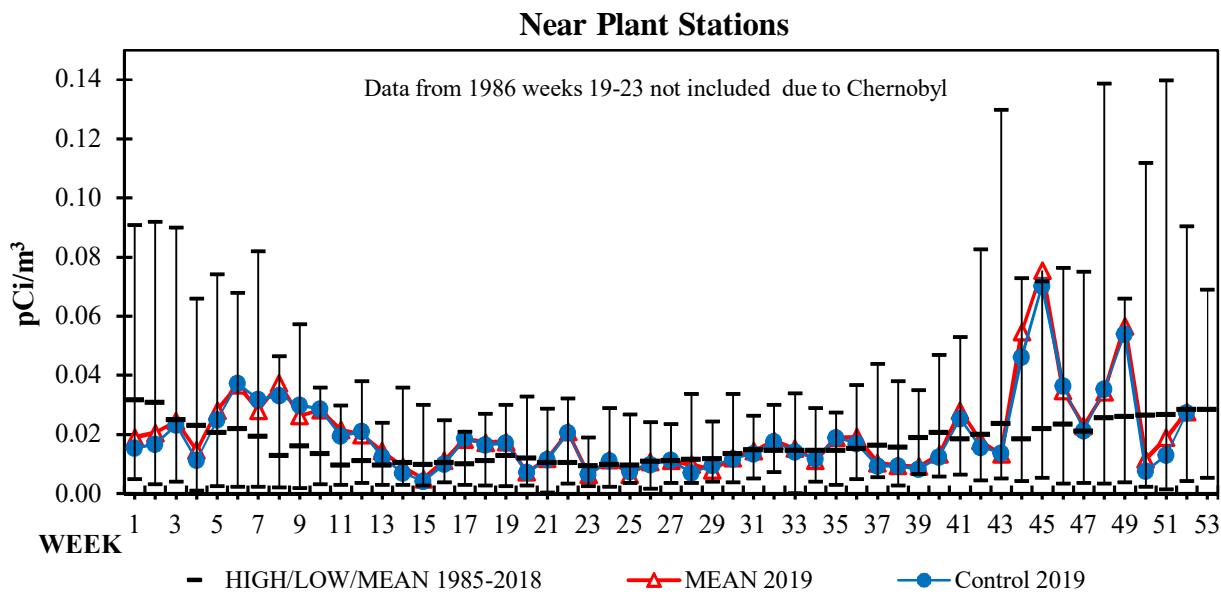


Figure 5-4 1985-2018 Weekly Hi/Low/Mean and 2019 Weekly Mean Gross Beta in Air - Near Plant Stations

Figure 5-4 above illustrates the 2019 mean weekly particulate filter gross beta results for the five stations located within three miles of CGS (See also Appendix A, Tables A-2.1, A-2.2). Results for the near plant stations are similar to results from the remote locations and follow the trend of the control location.

The 2019 mean weekly particulate filter gross beta results for the 6 sample stations located between 3 and 9.6 miles from CGS are shown in Figure 5-5 (See also Appendix A, Tables A-2.1, A-2.2). Results for these remote stations are similar to results from the near plant stations and follow the trend of the control location. No correlation between air gross beta activity and proximity to CGS was observed.

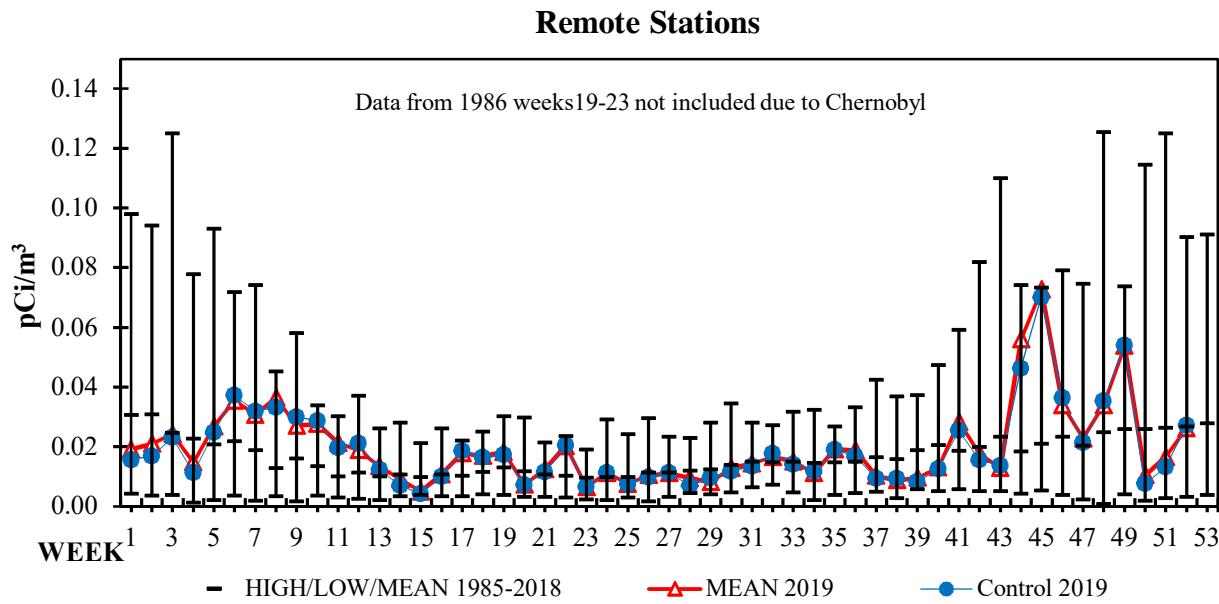


Figure 5-5 1985-2018 Weekly Hi/Low/Mean and 2019 Weekly Mean Gross Beta in Air - Remote Stations

For both the near plant and remote air station locations, higher results and greater variability in air gross beta activity historically have been observed during fall and winter months due to weather induced background fluctuations. Gross beta levels typically increase during periods of inversion due to natural decay products being trapped near the earth surface. Gross beta results plotted over a period of several years typically show a cyclical pattern with higher results observed in the fall and winter compared to the spring and summer. Gross beta results were observed above the average trend range in February, March, November, and December. The increases observed during these periods occurred at all sample locations including the control and are attributed to weather phenomena and not the result of CGS operation. The highest particulate filter gross beta results for the year occurred during week 45; weather conditions for the week were characterized by air stagnation and fog.

Quarterly gamma isotopic analysis of the air particulate filters identified the presence of beryllium-7 in all the control and indicator composite samples (See Appendix A, Tables A-3.1, A-3.2). Beryllium-7 is a naturally occurring radionuclide formed in the upper atmosphere by interaction with cosmic radiation and is not a radionuclide associated with CGS operation. Naturally occurring potassium-40 was also identified in one of the indicator samples. No radioisotopes associated with CGS operation were identified in any of the quarterly air particulate gamma isotopic sample results.

The 2019 weekly iodine cartridge isotopic results showed no indication of radioiodines in any of the samples. Results for iodine-131 were, in all cases, below the lower limit of detection (See Appendix A, Tables A-4.1, A-4.2). The 2019 air particulate and iodine sample results show no evidence of measurable environmental radiological air quality impact that can be attributed to CGS plant operation.

5.3 Water

5.3.1 Surface Water

Monthly composite surface water samples are collected at five locations and analyzed for tritium, gross beta, and gamma emitting radionuclides. A graph of the 2019 gross beta results for the plant intake, plant discharge, and river/drinking water stations is shown in Figure 5-6.

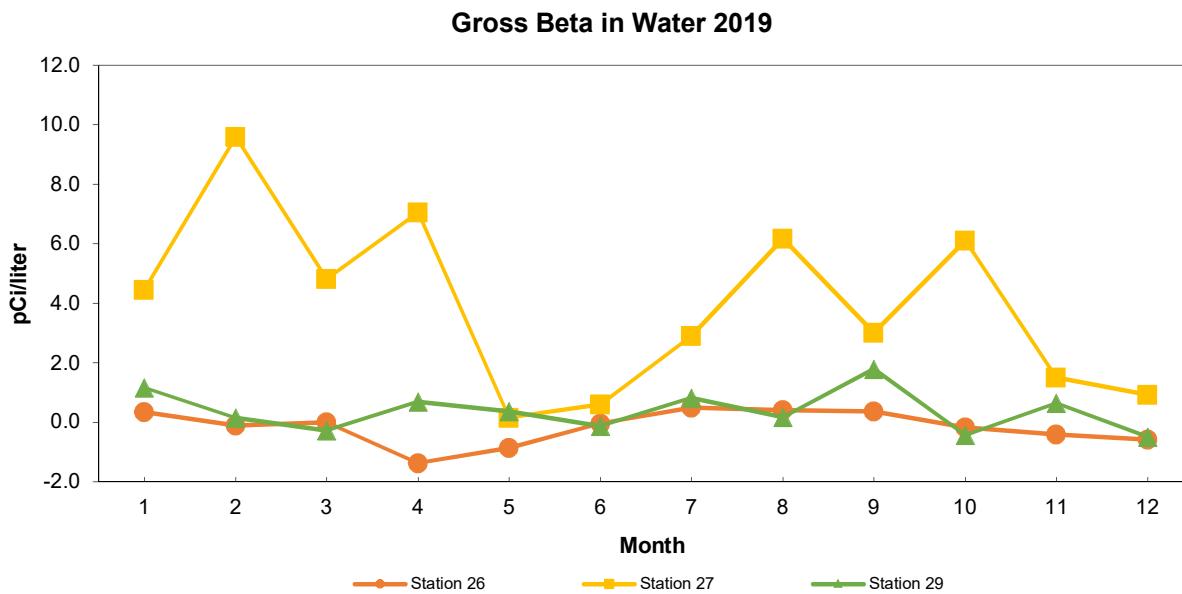


Figure 5-6 Gross Beta in River/Drinking (Stations 26 & 29) and Plant Discharge Water (Station 27) for 2019

All drinking and river water (Stations 26 and 29) gross beta results were below the analysis detection limits (See Appendix A, Tables A-5.1, A-5.2). Gross beta levels in the plant discharge water (Station 27) were above the detection limits in eight of the twelve samples. Positive results for this location are expected due to concentration of natural radioactivity in the water by evaporative loss and the scrubbing action of the cooling towers which incorporates atmospheric particulate material into the discharge water. Historically, higher gross beta results at Station 27 can be correlated to the level of calcium concentration in the CGS circulating water. The Station 27 sample results are representative of the radioactivity present in plant discharge water before any mixing with river water occurs.

Monthly tritium results for all plant intake, plant discharge, and river/drinking water samples were below the analysis method *a priori* LLD. Tritium results for the three sample locations are illustrated in Figure 5-7; quarterly averages for the locations are listed in Appendix A, Tables A-6.1, A-6.2.

Gamma spectrometry results for all plant intake, plant discharge, and river/drinking water samples identified only naturally occurring radionuclides; no gamma-emitting radionuclides related to CGS operation were positively identified in these samples (See Appendix A, Tables A-7.1, A-7.2, A-13.1, A-13.2).

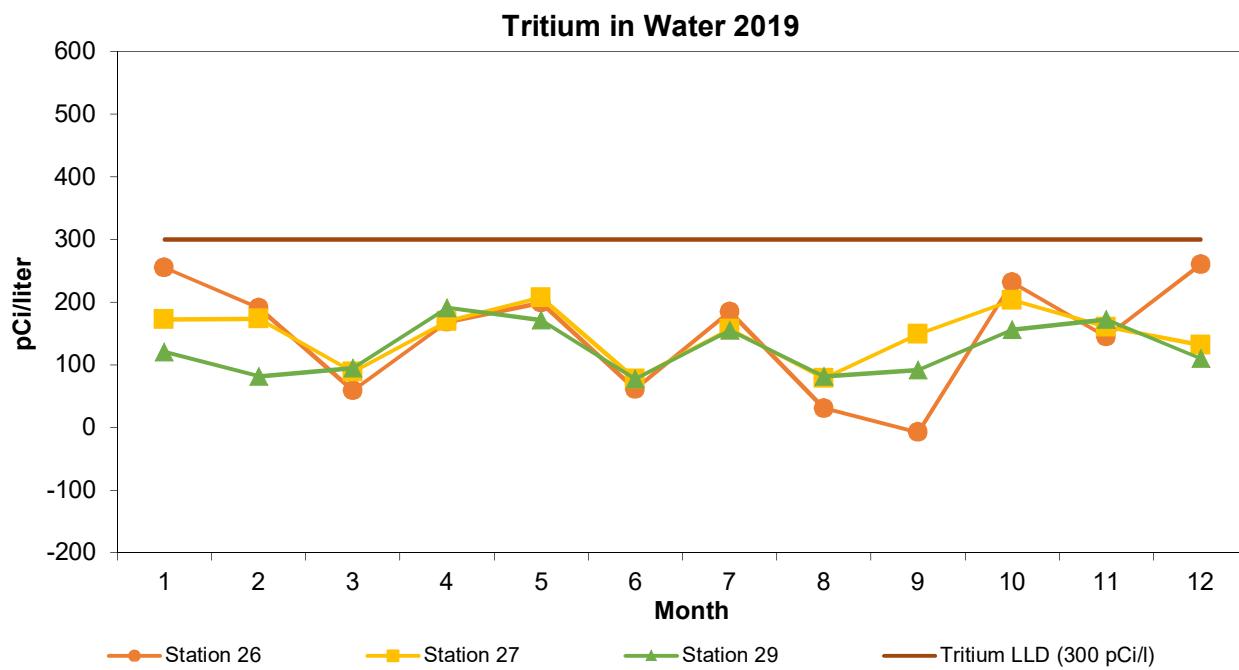


Figure 5-7 Tritium in River/Drinking (Stations 26 & 29) and Plant Discharge Water (Station 27) for 2019

Analysis results for the plant intake, plant discharge, and river/drinking water samples showed no measurable impact to the environment due to CGS plant operations in 2019. Composite water samples are also taken from a sanitary waste and storm drain location. Analysis results for these samples are discussed in further detail in Section 5.9.

5.3.2 Ground Water

Samples from 3 deep wells were collected quarterly to meet ODCM and EFSEC Resolution No. 332⁽⁹⁾ requirements. Quarterly samples were also collected from nine shallow groundwater monitoring wells located near CGS as part of the CGS groundwater monitoring program. All well samples were analyzed for tritium and gamma emitting radionuclides. Well locations sampled are shown in Figures 4-1 and 4-2.

Analytical results for the three deep water wells were consistent with results seen in previous years. Tritium results were below detection limits and no gamma emitting radionuclides related to CGS operation were identified in any samples (See Appendix A, Tables A-6.1, A-6.2, A-14.1, and A-14.2).

The CGS groundwater monitoring program is conducted to meet the Nuclear Energy Institute (NEI) Groundwater Protection Initiative (NEI 07-07)⁽¹⁷⁾ guidelines and to support NPDES requirements. Water samples from the unconfined aquifer are collected quarterly from nine shallow monitoring wells located around the CGS site. None of these monitoring wells are used as a source of drinking water. CGS is unique in the commercial nuclear power industry in that it is located in an area where the unconfined aquifer under the site is known to be contaminated with tritium as a result of past DOE activities on the Hanford Site.⁽¹⁹⁾ The CGS groundwater program is intended to assess any contribution CGS may be making to the known groundwater contamination issue.

Gamma Spectroscopy results for the nine shallow monitoring wells identified only natural occurring radionuclides (See Appendix A, Tables B-10.1, and B-10.2). The 2019 groundwater sample results show no evidence that CGS made a measurable radiological impact on groundwater.

Tritium results for the nine shallow monitoring wells ranged from < LLD to 12,600 pCi/liter (See Appendix A, Table B-11.1). Tritium results from each well were consistent during the year and within the trend range observed in previous years with the exception of MW-3 which showed a marked decrease in tritium concentration starting in the 2nd quarter of 2017 and remained at below its historic trend level during 2019. The highest tritium concentrations were measured at MW-5 which is hydraulically up-gradient of CGS. The tritium identified in the shallow monitoring well samples is the result of past DOE activities on the Hanford site and is not attributable to CGS operation. Historically, the only identified impact that CGS operation has had on ground water tritium concentrations was through the discharge of storm drain water. With the establishment of lined evaporation ponds in 2014, this pathway was effectively eliminated. All storm drain water from the CGS site was directed to the lined evaporation ponds in 2019.

5.4 Soil

Gamma spectroscopy analysis was performed on soil samples from five different locations in 2019 (See Appendix A, Tables A-8.1, A-8.2). Two samples were collected from locations near CGS, two samples were collected for locations east of CGS in Franklin County, and one sample was collected from a control location. Naturally occurring radionuclides were identified in all samples. Cesium-137 was identified at two of the indicator locations and also the control location. The level of cesium-137 identified was within the range considered normal background and consistent with cesium-137 concentrations found in Hanford area soils.^(21,22) The cesium-137 activity identified was below the level that would require strontium-90 analysis to be performed.⁽⁹⁾ The soil sample results indicate no measurable impact from CGS plant operation.

5.5 River Sediment

Gamma spectroscopy results of river sediment identified naturally occurring radionuclides and cesium-137 (See Appendix A, Tables A-9.1, 9.2). Relative to the circulating water discharge point, cesium-137 was detected in the downstream samples (Station 34) and but not in the upstream samples (Station 33). The downstream cesium-137 activity levels were similar to the levels identified in previous years and within the range known to be present in Hanford area sediment and soil.^(21,24) Cesium-137 was not identified in any samples of plant cooling water discharged to the Columbia River. CGS has not made a radioactive discharge to the Columbia River since 1998. The sediment sample results indicate no measurable impact from CGS plant operation.

5.6 Fish

The gamma spectroscopy results of fish samples collected at both the indicator location (Columbia River) and the control location (Snake River) identified only the presence of naturally occurring radionuclides (See Appendix A, Tables A-10.1, 10.2). The same three species; walleye, bass, and salmon, were collected at both the indicator and control locations. No radiological impact attributable to CGS operation was identified in the 2019 fish sample results.

5.7 Milk

No radioiodine activity was identified in any of the milk samples collected in 2019 (See Appendix A, Tables A-11.1, A-11.2). Gamma spectroscopy results of milk radionuclides other than radioiodine did not identify the presence of any radionuclides of interest (See Appendix A, Tables A-12.1, A-12.2). Naturally occurring potassium-40 was identified in all milk samples. The 2019 milk analysis results indicate no measurable impact due to CGS plant operation.

5.8 Garden Produce

Gamma analysis was performed on thirty five samples of fruits, vegetables, and root crops in 2019 (See Appendix A, Tables A-15.1, A-15.2, A-16.1, A-16.2, A-17.1, A-17.2). No radionuclides related to CGS operation were identified in any of the samples. Naturally occurring potassium-40 was identified in all samples.

5.9 Special Interest Stations

Sampling and analysis is performed at the locations covered in this section to comply with EFSEC requirements or as a CGS initiative. Sanitary Waste Treatment Facility (SWTF) and storm drain water sampling were incorporated into the routine sampling schedule in 1992. In 1995, the cooling tower sediment disposal area was added. TLD monitoring in the vicinity of the planned ISFSI was first performed in 1998 to collect background data and TLD monitoring was established on the ISFSI fence line after construction was completed in 2002. Additional TLD locations were established in 2008/2009 to monitor potential remediation work at the DOE 618-11 burial ground west of CGS. Discussion of the results from each of these locations is given in the following sections.

5.9.1 Evaporation Pond (Station 101B)

The Station 101B composite sampler samples storm drain, air wash, and non-radioactive system wastewater originating from within the CGS protected area. Water from these sources has been directed to two lined evaporation ponds since November 2014. Wastewater originating outside the CGS protected area is typically directed to three other lined evaporation ponds that are not sampled by the Station 101B sampler. Figure 4-1 shows the location of the five evaporation ponds; Station 101B samples water flowing into ponds 3 and 4. Sampling and analysis at this location is specified in EFSEC Resolutions.^(9,23) Historically, the water directed to the evaporation ponds was discharged to an unlined storm drain pond. Remediation of the historic storm drain pond was completed in 2016.

Monthly composite water samples were analyzed for gamma emitting radionuclides, tritium, and gross beta. Low level cobalt-60 was identified in the August 2019 composite sample; the finding was documented in Condition Report (CR) 400110. The most probable source of the activity was from heavy rain event in mid-August. No gamma emitting radionuclides of interest were identified in September and October samples. (See Appendix A, Tables B-2.1, B-2.2). Gross beta was identified above background in 2 of the 12 monthly samples (See Appendix A, Tables B-3.1, B-3.2). Tritium was detected in eleven of the twelve samples (See Appendix A, Tables B-4.1, B-4.2). The samples with higher tritium levels were all from colder, wetter months which is consistent with results seen in previous years. The source of the tritium in storm drain water is attributed to recapture of tritium from CGS gaseous effluents which is more likely to occur during cooler, rainier periods. The total amount of tritium calculated to have been recaptured in CGS storm drain water in 2019 was slightly lower than the amount determined for 2018.

Water grab samples were taken from all five ponds in April and analyzed for tritium, gross beta, and gamma emitting radionuclides. Gross beta results were below the analysis detection limits and no gamma emitting radionuclides related to CGS operation were identified in any of the samples (See Appendix A, Tables B-12.1 and B-14.1). Tritium was detected above the detection limit in one of the five ponds (See Appendix A, Table B-15.1).

Sediment samples were collected in September from evaporation ponds 3 and 4 and analyzed for gamma emitting radionuclides. Due to the amount of water remaining in the ponds, the samples were taken from locations near the side of the ponds and below the water line. Only natural occurring radionuclides identified both ponds 3 and 4. (See Appendix A, Table B-13.1).

5.9.2 Sanitary Waste Treatment Facility (Station 102B)

The Sanitary Waste Treatment Facility (SWTF) is located approximately 0.5 miles south-southeast of CGS. The facility processes sanitary wastewater from CGS, the ENW Industrial Development Complex (formerly referred to as WNP-1 and WNP-4), and the Kootenai Building. The Station 102B composite sampler collects wastewater as it enters the SWTF head works. Discharge standards and monitoring requirements for the SWTF are established in EFSEC Resolution No. 300.⁽¹⁶⁾

Low level gross beta was identified in eleven of the twelve Station 102B samples. The levels identified were consistent with levels identified in previous years. Gross alpha was not positively identified in any of the Station 102B samples (See Appendix A, Tables B-5.1, B-5.2, B-6.1, and B-6.2).

Gamma spectroscopy results of the monthly Station 102B samples identified only naturally occurring radionuclides (See Appendix A, Tables B-7.1, B-7.2).

No tritium activity was identified in any of the Station 102B samples in 2019 (See Appendix A, Tables B-8.1, B-8.2). Tritium activity has not been identified in the Station 102B samples since processing of DOE 400 area wastewater was terminated in 2013.

5.9.3 Cooling System Sediment Disposal Area (Station 119)

EFSEC Resolution No. 299⁽¹⁸⁾ authorizes the onsite disposal of sediments from plant cooling systems containing low levels of radionuclides. The disposal area for these sediments is located just south of the CGS cooling towers. EFSEC Resolution No. 299⁽¹⁸⁾ requires direct radiation monitoring using quarterly TLDs in the vicinity of the disposal cells and the collection and analysis of a dry composite sediment sample from the disposal cell within thirty days following each cleaning in order to confirm that the disposal criteria outlined in the resolution have not been exceeded.

The source of the radioactivity identified in cooling tower sediment is attributed to incorporation of radionuclides present in the general environment (cesium-137) or recapture of radionuclides in CGS gaseous effluents (cobalt-60). As air is pulled through the cooling towers, atmospheric particles are incorporated into the cooling water. Algae and other biological organisms present in the cooling tower environment actively assimilate the radionuclides resulting in concentrated and measurable levels of the radionuclides in these biological materials. The material removed during cleaning and referred to as sediment is composed in large part of algae and other biological organisms that exist in the cooling tower environment.

Cleaning of the CGS cooling towers was performed in May and October 2019. The May cleaning occurred during the R-24 refueling outage and it involved removal of sediment from both the upper tower decks and the tower basins. The October cleaning was limited to the upper tower decks only. Disposal of the material removed resulted in an estimated 410 cubic meters of dry sediment being added to the disposal cells in May and an additional 55 cubic meters in October.

A summary of the estimated mass and radionuclide content of all transfers to the disposal cell area in 2019 is presented in Figure 5-8. For those isotopes listed in the table that were not positively identified, the MDA value obtained from the sample analysis was used in the table calculations. As such, the total activity reported is a conservative estimate.

As shown in Figure 5-8, all material transferred to the disposal cell area in 2019 (See Appendix A, Tables B-9.1) was considerably below the disposal concentration limits specified in EFSEC Resolution No. 299.⁽¹⁸⁾ The cobalt-60 and cesium-137 activity levels identified were within the range historically observed for cooling tower sediment. Cesium-137 levels were within the range typically observed in Hanford area soils.

Measurements of direct radiation at the disposal pit area were taken using TLDs. Two locations were used, an indicator location by the collection area (Station 119B) and a control location approximately 200 yards to the east (Station 119Ctrl). The negligible difference between the indicator and the control TLDs indicate that there was no measureable dose contribution above background due to material in the disposal cells (See Tables 5.3 and Appendix A, Tables B-1.1).

2019 Cooling System Sediment Disposal Data				
	Disposal Date	May-19	Oct-19	
Description:	R-24 Cleaning	Fall Cleaning		
Pit ID:	2019a and b	2019b		
Mass, kg	249,660	2,020		
Density, g/cc	0.61	0.037		
*Unity Calculation	3.46E-02	7.53E-02		
Nuclide	Limit (pCi/kg)	Analytical Result (pCi/kg)	Analytical Result (pCi/kg)	Total Activity (Curie)
Co-60	5.00E+03	< 6.3E+01	2.3E+02	1.6E-05
Mn-54	3.00E+04	< 6.1E+01	< 7.0E+01	1.5E-05
Zn-65	5.00E+04	< 2.1E+02	< 2.8E+02	5.2E-05
Cs-134	1.00E+04	< 1.2E+02	< 1.4E+02	3.0E-05
Cs-137	2.00E+04	< 7.7E+01	1.6E+02	2.0E-05
Total:				1.3E-04

* The sum of the fractions of maximum concentration for each nuclide does not exceed 1 in accordance with EFSEC Resolution 299, Attachment 1 Section 3B.

Figure 5-8 Cooling System Sediment Activity Levels for Disposals Made in 2019

5.9.4 Independent Spent Fuel Storage Installation

The Independent Spent Fuel Storage Installation (ISFSI) is a fenced, secured area north northwest of CGS. Twelve TLD stations are located on the second of three security fences that surround the ISFSI. Four other TLD locations; Stations 121, 122, 155, and 156, are located near the ISFSI to provide additional monitoring of ISFSI direct radiation. The ISFSI was expanded in 2016 and a new pad installed. Refer to Figure 4-4 for a map showing ISFSI TLD locations.

No new spent fuel casks were added to the ISFSI in 2019. As shown in Figure 5-9, exposure rates at the ISFSI fence line show a downward trend since the second quarter 2018 when spent fuel was last added to the ISFSI. The TLD stations with the highest dose rates are located on the south fence; these stations are closest in proximity to the spent fuel casks moved to the ISFSI in 2018.

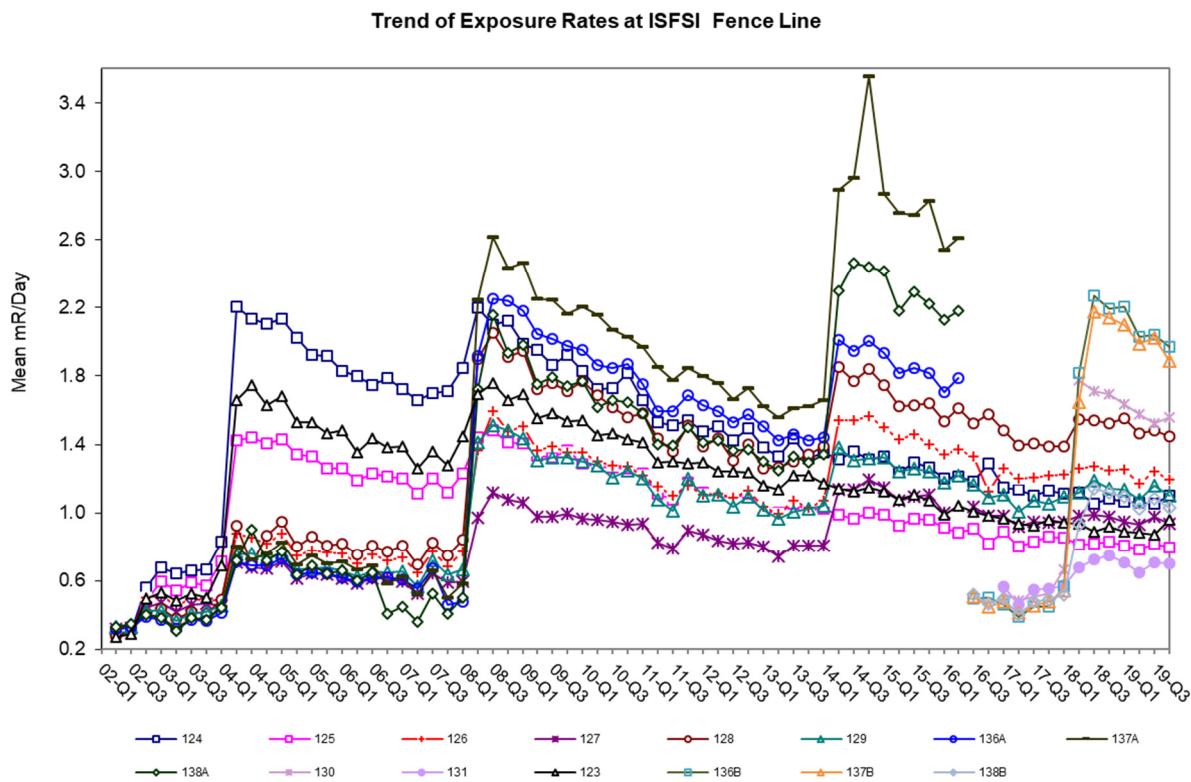


Figure 5-9 ISFSI TLD Trend at CGS

TLD results from Stations 122, 155, and 156 show mostly a flat trend line for the year. Results from these locations are slightly above background as expected due to their close proximity to the ISFSI. Station 121 showed a marked decrease in the 2nd quarter then a return to the normal trend range in the 3rd and 4th quarters. The 2nd quarter decrease corresponds to the R-24 outage when turbine building radiation levels were greatly reduced. This location has predominately been influenced by turbine building radiation levels and not the ISFSI (See Table 5-3 and Appendix A, Tables B-1.1, B-1.2).

5.9.5 Miscellaneous Environmental Sample Results

Apple samples from both control and indicator locations were collected in the summer and fall of 2019 and analyzed for carbon-14 content. Analyses were performed by the Washington State Department of Health Laboratory. Results were similar for both indicator and control samples. Carbon-14 activities were below the level of detection. The results do not indicate any discernable effect attributable to CGS operation (See Appendix B, Table B-17.1).

Quarterly TLDs were exchanged at three Stations 58, 88, and 89 in 2019 for monitoring DOE 618-11 burial ground located just west of CGS (See Figure 4-1). The results were consistent with the historical trend (See Appendix A, Table B-1.1).

Snow samples collected from six locations on the CGS site in March 2019 were analyzed for tritium content as a CGS initiative. All results were below the analysis method a priori LLD (See Appendix A, Table B-16.1).

5.10 2019 Sample Deviations

A summary of REMP sample deviations encountered in 2019 is listed below in Table 5-1A through 5-1C. All known deviations from the sampling schedule (i.e. sample was not obtained) or analyses where the ODCM specified lower limit of detection was not achieved are included. For ODCM or EFSEC specified locations where composite or continuous samples are collected, any known period greater than 24 hours during which samples were not collected have been included. Inclusion of ODCM related sample deviations in Tables 5-1A and 5-1C serves to meet the required compensatory measure listed in ODCM RFO 6.3.1 A.1. Table 5-1D lists information regarding air sampling station requirements. Table 5-1E lists information regarding water sample station sampling requirements.

**TABLE 5-1A
ODCM REMP Sample Deviations for 2019**

SAMPLE MEDIA	DATE	LOCATION	CR/WO	PROBLEM	PLANS FOR PREVENTING RECURRANCE
NA	NA	NA	NA	NA	NA

TABLE 5-1B
EFSEC REMP Sample Deviations for 2019

SAMPLE MEDIA	DATE	LOCATION	CR/WO	PROBLEM	PLANS FOR PREVENTING RECURRENCE
Air Sampler	5/13/19 to 5/15/19	Station 1	393912	Station was out of service for 33 hours due to planned power outage.	Corrective actions are deemed not possible due to the remote nature of the sample station.
Water	6/13/19 to 6/17/19	Station 101B	395702	Station was found to be out of service and not collecting samples due to unexpected loss of power.	Added contact information to facilities checklist to notify REMP personnel.

TABLE 5-1C
ODCM & EFSEC REMP Sample Deviations for 2019

SAMPLE MEDIA	DATE	LOCATION	CR/WO	PROBLEM	PLANS FOR PREVENTING RECURRENCE
Water	3/19/19 to 3/21/19	Station 26	391752	TMU-SR-1 was out of service due to pump supplying water to sampler was turned off for repair.	Repaired pump.
Water	6/11/19 to 6/16/19	Station 26	395399	TMU-SR-1 found with power but not collecting sample. It appears the sampler was not operating to the Instrument Master Data Sheet (IMDS) specifications.	Restored sampler to IMDS parameters.
Air Sampler	7/6/19 to 7/9/19	Statin 48	396630	Station was found off with 94 hours on timer due to electrical issue.	Contacted utility company to update contact information to notify REMP personnel.

Table 5-1D below shows the percent in service time for the 12 air sample locations. The table shows overall availability for all ODCM required locations was 99.0% or greater.

TABLE 5-1D
CGS REMP Air Sample Percent in Service Time for 2019

Station ID	ODCM Required	EFSEC Required	Percent Time in Service
1		x	99.3%
4	x	x	99.9%
5			99.3%
6		x	99.9%
7		x	99.9%
8	x	x	99.9%
9	x	x	99.9%
21B			99.9%
23		x	99.9%
40	x	x	99.9%
48	x	x	99.0%
57	x		99.9%

Table 5-1E below shows the percent in service time for the five water locations. The table shows overall availability for all ODCM required locations was 99.1% or greater.

TABLE 5-1E
CGS REMP Water Sample Percent in Service Time for 2019

Station ID	ODCM Required	EFSEC Required	Percent Time in Service
26	x	x	99.1%
27	x	x	100.0%
29	x	x	100.0%
101B		x	99.0%
102B		x	100.0%

Table 5-2 below summarizes the analytical results for all ODCM required REMP samples and CGS groundwater monitoring. The results are presented in a format similar to Table 3 of the NRC Branch Technical Position paper on radiological environmental monitoring. The mean and range values are based on detectable results only. The table contains the following:

- Media or pathway sampled and the units of measurement.
- Analysis type and total number of analysis performed.
- The lower limit of detection for the analysis type.
- Mean and range for all indicator locations, and the ratio of detectable measurements to the number of total measurements made for all indicator locations.
- Mean and range for all control locations, and the ratio of detectable measurements of the number of total measurements made at the control locations.
- For analysis types where detectable measurements were made, the location with the highest annual mean, distance and direction of location from CGS, and the mean, range and ratio of detectable measurements to the number of total measurements for that location.
- The number of non-routine reported measurements.

TABLE 5-2							
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY							
COLUMBIA GENERATING STATION				DOCKET NO. 50-397			
Benton County, Washington				Calendar Year 2019			
Medium: Environmental Direct Radiation (TLD)				mR/std. Units: quarter			
Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
TLD Quarterly	227	---	21.0 (223 / 223) (17.3-27.8)	86 NNW 0.3 miles	26.8 (4/4) (25.7-27.8)	19.2 (4/4) (18.6-19.7)	0

a. (f) is the number of positive measurements / total measurements at specified location.

Reference Appendix A, Tables A-1.1, A-1.2

TABLE 5-2 (cont.)**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY****COLUMBIA GENERATING STATION****Benton County, Washington****DOCKET NO. 50-397****Calendar Year 2019****mR/std.****Units: quarter****Medium: ISFSI Direct Radiation (TLD)**

Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
TLD Quarterly	48	---	113.5 (48 / 48) (59.0-201.1)	136B NNW 0.29 miles	188.1 (4 / 4) (180.0-201.1)	--- (0 / 0)	0

a. (f) is the number of positive measurements / total measurements at specified location.

Reference Appendix A, Tables B-1.1, B-1.2

ISFSI TLDs are Stations 123 to 131, and 136B to 138B. Station 130 and 131 were added in the 1st quarter 2017.**TABLE 5-2 (cont.)****RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY****COLUMBIA GENERATING STATION****Benton County, Washington****DOCKET NO. 50-397****Calendar Year 2019****Medium: Air Particulate/Air Radioiodine****Units: pCi/m³**

Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
Gross Beta	572	0.01	0.0198 (572/572) (0.0194-0.0206)	57 N 0.70 miles	0.0206 (52/52) (0.0038-0.0774)	0.0190 (52/52) (0.0042-0.0701)	0
I-131	572	0.07	-- (0/572)	---	---	--- (0 / 52)	0
Cs-134	48	0.05	--- (0 / 44)	---	---	--- (0 / 4)	0
Cs-137	48	0.06	--- (0 / 44)	---	---	--- (0 / 4)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Tables A-2.1, A-2.2, Tables A-3.1, A-3.2, and Tables A- 4.1, A-4.2.

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION
Benton County, Washington

DOCKET NO. 50-397
Calendar Year 2019

Medium: Water-River/Drinking				Units: pCi/L			
Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^c	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
Gross Beta	24	4.0	--- (0/24) ^(b)	---	---	--- (0 / 12)	0
H-3	8	2000	--- (0 / 8) ^(b)	---	---	--- (0 / 4)	0
Mn-54	24	15	--- (0 / 24) ^(b)	---	---	--- (0 / 12)	0
Fe-59	24	30	--- (0 / 24) ^(b)	---	---	--- (0 / 12)	0
Co-58	24	15	--- (0 / 24) ^(b)	---	---	--- (0 / 12)	0
Co-60	24	15	--- (0 / 24) ^(b)	---	---	--- (0 / 12)	0
Zn-65	24	30	--- (0 / 24) ^(b)	---	---	--- (0 / 12)	0
Zr/Nb-95	24	15	--- (0 / 24) ^(b)	---	---	--- (0 / 12)	0
Cs-134	24	15	--- (0 / 24) ^(b)	---	---	--- (0 / 12)	0
Cs-137	24	18	--- (0 / 24) ^(b)	---	---	--- (0 / 12)	0
Ba/La-140	24	15	--- (0 / 24) ^(b)	---	---	--- (0 / 12)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. This includes the control sample for this group; the control (Station 26) is also a drinking water sample.

c. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Tables A-5.1,A-5.2, Tables A-6.1, A-6.2, and Tables A-7.1, A-7.2

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION

Benton County, Washington

DOCKET NO. 50-397

Calendar Year 2019

Medium: Water-Discharge				Units: pCi/L			
Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
Gross Beta	12	4.0	3.94 (8/12) (0.159-9.60)	27 E 3.2 miles	3.94 (8/12) (0.159-9.60)	--- (0 / 0)	0
H-3	4	2000	--- (0/4)	---	---	--- (0 / 0)	0
Mn-54	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Fe-59	12	30	--- (0 / 12)	---	---	--- (0 / 0)	0
Co-58	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Co-60	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Zn-65	12	30	--- (0 / 12)	---	---	--- (0 / 0)	0
Zr/Nb-95	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Cs-134	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Cs-137	12	18	--- (0 / 12)	---	---	--- (0 / 0)	0
Ba/La-140	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Tables A-5.1,A-5.2, Tables A-6.1, A-6.2, and Tables A-13.1, A-13.2

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION
Benton County, Washington

DOCKET NO. 50-397
Calendar Year 2019

Medium: Water- Deep Ground				Units: pCi/L			
Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
H-3	12	2000	--- (0 / 12)	---	---	--- (0 / 0)	0
Mn-54	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Fe-59	12	30	--- (0 / 12)	---	---	--- (0 / 0)	0
Co-58	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Co-60	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Zn-65	12	30	--- (0 / 12)	---	---	--- (0 / 0)	0
Zr/Nb-95	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Cs-134	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0
Cs-137	12	18	--- (0 / 12)	---	---	--- (0 / 0)	0
Ba/La-140	12	15	--- (0 / 12)	---	---	--- (0 / 0)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Tables A-6.1, A-6.2, and Tables A-14.1, A-14.2

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION
Benton County, Washington

DOCKET NO. 50-397
Calendar Year 2019

Medium: Water- Shallow Ground

Units: pCi/L

Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
H-3	36	2000	3340(28/ 36) (159-12,600)	MW-5 SW 0.43 miles	12,000 (4 / 4) (11,500-12,600)	--- (0 / 0)	0
Mn-54	36	15	--- (0 / 36)	---	---	--- (0 / 0)	0
Fe-59	36	30	--- (0 / 36)	---	---	--- (0 / 0)	0
Co-58	36	15	--- (0 / 36)	---	---	--- (0 / 0)	0
Co-60	36	15	--- (0 / 36)	---	---	--- (0 / 0)	0
Zn-65	36	30	--- (0 / 36)	---	---	--- (0 / 0)	0
Zr/Nb-95	36	15	--- (0 / 36)	---	---	--- (0 / 0)	0
Cs-134	36	15	--- (0 / 36)	---	---	--- (0 / 0)	0
Cs-137	36	18	--- (0 / 36)	---	---	--- (0 / 0)	0
Ba/La-140	36	15	--- (0 / 36)	---	---	--- (0 / 0)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Tables B-10.1, B-10.2, and B-11.1.

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION
Benton County, Washington

DOCKET NO. 50-397
Calendar Year 2019

Medium: River Sediment				Units: pCi/kg			
Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
Cs-134	4	150	--- (0 / 2)	---	---	--- (0 / 2)	0
Cs-137	4	180	112 (2 / 2) (84.1-140)	34 ESE 3.32 Miles	112 (2 / 2) (84.1-140)	--- (0 / 2)	0
Co-60	4	---	--- (0 / 2)	---	---	--- (0 / 2)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Tables A-9.1, A-9.2.

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION
Benton County, Washington

DOCKET NO. 50-397
Calender Year 2019

Medium: Roots					Units: pCi/kg		
Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
I-131	11	60	--- (0 / 8)	---	---	--- (0 / 3)	0
Cs-134	11	60	--- (0 / 8)	---	---	--- (0 / 3)	0
Cs-137	11	80	--- (0 / 8)	---	---	--- (0 / 3)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Tables A-15.1, A-15.2.

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION
Benton County, Washington

DOCKET NO. 50-397
Calendar Year 2019

Medium: Fruits					Units: pCi/kg		
Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
I-131	10	60	--- (0 / 7)	---	---	--- (0 / 3)	0
Cs-134	10	60	--- (0 / 7)	---	---	--- (0 / 3)	0
Cs-137	10	80	--- (0 / 7)	---	---	--- (0 / 3)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Table A-16.1, A-16.2.

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION
Benton County, Washington

DOCKET NO. 50-397
Calendar Year 2019

Medium: Vegetables and Vegetation					Units: pCi/kg		
Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
I-131	14	60	--- (0 / 11)	---	---	--- (0 / 3)	0
Cs-134	14	60	--- (0 / 11)	---	---	--- (0 / 3)	0
Cs-137	14	80	--- (0 / 11)	---	---	--- (0 / 3)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Table A-17.1, A-17.2.

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION
Benton County, Washington

DOCKET NO. 50-397
Calendar Year 2019

Medium: Fish					Units: pCi/kg		
Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
Mn-54	6	130	--- (0 / 3)	---	---	--- (0 / 3)	0
Fe-59	6	260	--- (0 / 3)	---	---	--- (0 / 3)	0
Co-58	6	130	--- (0 / 3)	---	---	--- (0 / 3)	0
Co-60	6	130	--- (0 / 3)	---	---	--- (0 / 3)	0
Zn-65	6	260	--- (0 / 3)	---	---	--- (0 / 3)	0
Cs-134	6	130	--- (0 / 3)	---	---	--- (0 / 3)	0
Cs-137	6	150	--- (0 / 3)	---	---	--- (0 / 3)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Table A-10.1, A-10.2.

TABLE 5-2 (cont.)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

COLUMBIA GENERATING STATION
Benton County, Washington

DOCKET NO. 50-397
Calendar Year 2019

Medium: Milk

Units: pCi/L

Analysis Type	Total Analyses Performed	Lower Limit of Detection (LLD) ^b	Indicator Locations Mean (f) ^a Range	Location With Highest Annual Mean		Control Locations Mean (f) ^a Range	Number of Nonroutine Measurements
				Location Information	Mean (f) ^a Range		
I-131	36	1.0	--- (0 / 18)	---	---	--- (0 / 18)	0
Cs-134	36	15	--- (0 / 18)	---	---	--- (0 / 18)	0
Cs-137	36	18	--- (0 / 18)	---	---	--- (0 / 18)	0
Ba/La-140	36	15	--- (0 / 18)	---	---	--- (0 / 18)	0

a. (f) is the number of positive measurements / total measurements at specified location.

b. These are the ODCM specified LLDs, actual method LLDs will be lower. See Table 4-4.

Reference Appendix A, Tables A-11.1, A-11.2, Tables A-12.1, A-12.2.

TABLE 5-3
QUARTERLY TLD DATA SUMMARY WITH COMPARISON TO
PREOPERATIONAL AND OPERATIONAL PERIODS
 Results in mR/Standard Quarter

Station	Pre-Operational				Operational to 2018				2019 Operational			
	Min	Max	Std Dev	Mean	Min	Max	Std Dev	Mean	Min	Max	Std Dev	Mean
1	19.16	23.73	2.07	21.90	18.25	27.38	1.60	22.00	20.45	21.61	0.53	21.16
2	17.34	22.81	2.09	21.10	16.43	25.55	1.50	21.53	20.65	21.95	0.59	21.11
3	18.25	21.90	1.46	20.42	16.43	24.64	1.63	20.72	18.27	20.85	1.09	19.69
4	15.51	23.73	2.65	19.96	14.60	22.81	1.58	19.43	17.32	18.88	0.66	18.11
5	18.25	22.81	1.74	20.76	16.43	23.73	1.56	19.91	18.40	19.60	0.53	19.04
6	18.25	21.90	1.50	20.19	16.43	23.73	1.51	19.98	17.53	19.75	0.98	18.92
7	19.16	22.81	1.69	21.33	16.43	24.64	1.65	20.97	19.41	21.14	0.87	20.18
8	21.90	25.55	1.50	23.84	15.51	27.38	1.86	23.14	20.95	23.08	0.91	22.17
9	15.51	21.90	2.00	19.85	16.43	23.73	1.57	19.77	18.58	19.68	0.54	19.18
10	19.16	22.81	1.38	20.99	16.43	24.64	1.57	20.88	19.68	20.70	0.44	20.21
11	19.16	22.81	1.38	21.44	16.43	24.64	1.40	21.44	19.87	22.10	0.99	20.76
12	20.99	24.64	1.60	23.04	18.25	26.46	1.63	23.01	20.97	23.64	1.23	21.97
13	19.16	22.81	1.54	21.44	17.34	27.38	1.69	21.18	20.09	22.04	0.89	20.74
14	19.16	24.64	2.07	21.90	17.34	25.55	1.46	21.38	19.56	22.47	1.26	21.00
15	20.99	25.55	1.37	23.15	17.34	27.38	1.64	22.94	20.88	23.73	1.19	22.22
16	20.08	23.73	1.52	22.13	16.43	26.46	1.74	21.80	19.82	22.77	1.23	21.31
17	19.16	23.73	1.62	22.81	17.34	26.46	1.56	22.37	19.89	22.15	1.06	21.45
18	20.08	23.73	1.27	22.13	16.43	25.55	1.59	21.94	19.43	21.97	1.10	20.79
19	20.08	23.73	1.24	22.01	17.34	25.55	1.54	22.09	19.58	22.52	1.21	21.20
20	19.16	23.73	1.76	21.44	15.62	25.55	1.67	21.68	18.69	22.53	1.57	20.62
21	19.16	21.90	1.25	20.68	15.51	23.73	1.40	20.19	18.77	20.25	0.65	19.56
22	19.16	23.73	1.58	22.01	16.43	25.55	1.49	21.51	18.85	21.51	1.10	20.29
23	20.08	23.73	1.49	21.60	17.34	25.55	1.58	21.07	19.66	22.03	0.97	20.85
24	20.99	23.73	1.09	21.90	16.74	50.50	3.03	21.83	17.82	21.55	1.74	19.79
25	20.99	24.64	1.46	23.15	17.34	27.38	1.82	22.63	20.40	23.24	1.17	21.75
40	17.34	21.90	1.70	19.94	15.51	24.64	1.74	19.76	17.63	19.05	0.61	18.18
41	20.08	25.55	2.00	23.73	17.34	27.38	1.96	22.19	19.08	22.18	1.27	20.69
42	20.08	23.73	1.61	22.36	17.34	26.46	1.90	21.72	18.47	20.77	0.96	19.77
43	20.99	24.64	1.49	23.12	16.43	27.38	2.03	22.38	20.57	21.56	0.46	20.99
44	19.16	22.81	1.34	21.12	15.51	24.64	1.96	20.46	17.60	19.44	0.84	18.82
45	19.16	22.81	1.37	21.25	16.43	25.55	1.75	20.94	19.28	20.39	0.57	19.87
46	22.81	28.29	2.10	26.10	19.16	31.94	2.05	26.37	23.13	27.05	1.81	25.78
47	17.34	20.99	1.73	19.85	15.51	26.28	1.61	20.12	19.01	20.63	0.73	19.74
49	21.90	21.90	-	21.90	16.43	27.57	1.59	21.83	20.33	22.98	1.21	21.28
50	20.08	20.08	-	20.08	16.43	26.46	1.66	21.49	20.52	22.38	0.79	21.26
51	19.16	21.90	1.18	20.53	16.43	24.64	1.56	20.92	18.68	21.55	1.18	20.00
53	24.64	24.64	-	24.64	18.25	29.57	2.09	22.95	20.30	22.11	0.81	21.13
54	23.73	23.73	-	23.73	18.18	26.46	1.91	21.91	20.16	20.81	0.27	20.47
55	20.99	20.99	-	20.99	16.43	25.55	1.44	21.34	20.23	20.97	0.33	20.61
56	21.90	21.90	-	21.90	16.43	25.55	1.66	21.85	20.42	22.24	0.75	21.27
58	-	-	-	-	17.83	24.35	1.45	19.82	18.70	21.89	1.41	19.87
65	-	-	-	-	17.73	22.72	1.11	19.81	18.02	20.43	1.09	19.51

TABLE 5-3 (Cont.)
QUARTERLY TLD DATA SUMMARY WITH COMPARISON TO
PREOPERATIONAL AND OPERATIONAL PERIODS
 Results in mR/Standard Quarter

Station	Pre-Operational				Operational to 2018				2019 Operational			
	Min	Max	Std Dev	Mean	Min	Max	Std Dev	Mean	Min	Max	Std Dev	Mean
71(1S)	20.08	22.81	1.58	21.90	18.25	30.39	2.33	25.22	24.02	26.64	1.33	25.44
72(2S)	21.90	23.73	0.91	22.81	18.25	29.65	1.94	24.21	21.98	24.56	1.39	23.27
73(3S)	20.08	21.90	0.91	20.99	16.43	25.15	1.55	21.43	20.55	23.38	1.21	21.88
74(4S)	23.73	24.64	0.53	24.03	18.25	28.29	1.80	23.24	21.01	24.61	1.68	22.42
75(5S)	19.16	21.90	1.39	20.38	15.51	26.46	1.77	22.17	20.17	25.30	2.72	22.21
76(6S)	20.99	22.81	0.91	21.90	17.34	26.46	1.71	21.87	20.62	22.75	0.98	21.41
77(7S)	21.90	23.73	0.91	22.81	17.34	25.55	1.54	21.89	19.85	21.78	0.86	21.03
78(8S)	21.90	23.73	1.05	22.51	17.34	25.55	1.53	21.37	19.60	22.02	0.99	20.79
79(9S)	22.81	23.73	0.53	23.12	17.34	25.55	1.57	21.74	19.63	21.93	0.98	20.80
80(10S)	20.99	22.81	0.91	21.90	16.43	25.55	1.66	20.90	19.79	22.03	1.06	20.65
81(11S)	20.08	23.73	1.90	22.20	17.34	25.55	1.47	21.35	20.35	21.46	0.54	20.87
82(12S)	21.90	24.64	1.39	23.42	17.34	26.46	1.49	22.33	20.95	22.83	1.01	21.84
83(13S)	21.90	23.73	0.91	22.81	17.34	26.46	1.78	22.09	19.90	22.04	1.17	21.01
84(14S)	20.99	22.81	1.05	22.20	16.43	27.17	1.71	22.16	21.07	22.91	0.82	21.75
85(15S)	21.90	24.64	1.58	23.73	16.58	27.83	1.84	22.97	20.77	23.13	1.19	22.07
86(16S)	21.90	23.73	0.91	22.81	18.25	31.28	2.49	26.38	25.68	27.83	1.09	26.79
87	-	-	-	-	19.34	34.34	3.68	28.67	-	-	-	-
88	-	-	-	-	17.05	31.67	3.28	25.27	22.42	27.25	2.06	25.35
89	-	-	-	-	19.25	29.38	2.25	25.96	23.42	27.53	1.83	26.08
90	-	-	-	-	16.79	21.02	0.83	18.99	-	-	-	-
119B	-	-	-	-	19.24	25.64	1.40	21.96	20.42	23.77	1.46	21.66
119Ctrl	-	-	-	-	19.53	26.55	1.28	21.87	21.07	23.83	1.30	22.15
121 (ISFSI)	-	-	-	-	19.52	130.27	21.34	73.79	50.16	77.79	12.89	69.37
122 (ISFSI)	-	-	-	-	19.62	42.49	6.47	32.10	33.58	35.81	1.07	34.69
123 (ISFSI)	-	-	-	-	24.99	160.33	32.66	109.34	79.72	87.41	3.53	82.19
124 (ISFSI)	-	-	-	-	26.89	201.05	42.20	133.45	96.09	100.53	2.02	97.56
125 (ISFSI)	-	-	-	-	26.46	135.52	25.42	96.02	71.52	74.61	1.34	73.15
126 (ISFSI)	-	-	-	-	26.00	145.68	31.24	96.47	106.96	114.20	3.45	110.76
127 (ISFSI)	-	-	-	-	28.97	109.16	20.54	74.33	84.72	89.07	1.94	86.44
128 (ISFSI)	-	-	-	-	25.64	187.25	43.85	114.06	131.94	141.92	4.38	135.72
129 (ISFSI)	-	-	-	-	30.16	138.08	29.71	88.88	98.39	105.72	3.32	102.07
130 (ISFSI)	-	-	-	-	44.04	161.87	56.18	90.02	139.21	149.20	4.21	143.57
131 (ISFSI)	-	-	-	-	42.30	68.07	9.04	55.42	58.98	64.78	2.69	62.97
136A (ISFSI)	-	-	-	-	28.99	205.64	60.07	115.48	-	-	-	-
137A (ISFSI)	-	-	-	-	29.47	324.49	82.76	139.11	-	-	-	-
138A (ISFSI)	-	-	-	-	28.28	224.87	63.34	113.66	-	-	-	-
136B (ISFSI)	-	-	-	-	35.48	206.85	72.24	87.51	180.03	201.06	9.06	188.11
137B (ISFSI)	-	-	-	-	37.52	198.32	67.87	84.75	172.21	191.70	8.07	182.40
138B (ISFSI)	-	-	-	-	36.88	104.19	26.31	59.94	93.56	99.99	3.24	96.67
Site 1	-	-	-	-	11.92	20.19	1.18	18.35	19.11	19.98	0.41	19.43
Site 4	-	-	-	-	15.70	20.24	1.02	18.55	17.33	19.52	1.07	18.65
155	-	-	-	-	22.78	27.54	1.50	24.80	24.83	26.52	0.83	25.60
156	-	-	-	-	24.56	29.14	1.46	27.20	26.61	29.41	1.20	28.27

TABLE 5-3 NOTES: The preoperational period was from 1982 to 1983. The operational period started in the 1st quarter 1984. Station 65 was added in 1997. Stations 119B and 119Ctrl were added in 1995. Stations 121 and 122 were added in 1998. Stations 123-129 and 136A-138A were added in the 2nd quarter of 2002. Stations Site 1 and Site 4 were added in 2006. Stations 58 and 87 to 90 were added in 2008 to monitor remediation work at the DOE 618-11 burial site. Stations 87 and 90 were removed from service in the 1st quarter of 2017. Stations 136A-138A were relocated in the 3rd quarter 2016 and designated as stations 136B-138B. Stations 155 and 156 were added in the 1st quarter 2016. Stations 130 and 131 were added in the 1st quarter 2017.

6.0 QUALITY ASSURANCE AND QUALITY CONTROL

6.0 QUALITY ASSURANCE AND QUALITY CONTROL

The REMP is designed to meet the quality assurance (QA) and quality control (QC) criteria of the NRC Regulatory Guide 4.15⁽⁷⁾ and 10 CFR 50 Appendix B⁽¹⁵⁾. The laboratories performing sample analysis, Energy Northwest Environmental Services and Hanford External Dosimetry Program (HEDP), maintain quality control programs to ensure that analytical results are accurate, precise, and defendable. The following sections summarize the quality assurance and quality control aspects of the TLD, sample collection, and sample analysis components of the REMP.

6.1 Quality Control for the Energy Northwest Environmental TLD Program

The Quality Control program for the environmental TLD program covers the preparation, transportation, deployment, collection, storage, processing, and evaluation of the environmental TLDs and is designed to meet the requirements of NRC Regulatory Guides 4.13⁽⁸⁾ and 4.15.⁽⁷⁾

From the time the TLDs are annealed to the time they are placed in the field, they are stored and transported with control TLDs. Two sets of control TLDs are used, the building controls and the transportation (trip) controls. The building controls monitor the exposure that the TLDs receive while being transported to and from the TLD vendor and while in storage awaiting deployment and analysis. The trip controls accompany the field TLDs when transported to and from the vendor and also during deployment and collection in the field. The building controls and trip controls are stored in a low background lead shield while the field TLDs are deployed. If the trip control results are greater than the building control results, the difference between the two is subtracted from the field dosimeters to account for exposure during transit.

Reader QC dosimeters serve as checks that the dosimeter reader calibration is satisfactory and that the TLDs were processed correctly. These TLDs are annealed and then given a known exposure (typically 100 mR) to a cesium-137 source. The number of QC dosimeters used during each processing is generally 10% of the number of field dosimeters. Evaluation of the 2019 reader QC dosimeter results indicated satisfactory agreement for all periods. The quarterly average reader QC results are presented in Table 6-1.

TLDs designated as spikes are prepared by the Energy Northwest Radiation Protection Department by exposing the TLDs to a calibrated source to produce a known exposure. The spiked dosimeters are submitted and processed with the field dosimeters to further verify the accuracy and precision of the environmental TLD results. Quarterly spikes receive a target exposure of 22, 40, and 50 mR. Evaluation of the 2019 spiked dosimeter results indicated satisfactory agreement for all periods. Spiked TLD results are presented in Table 6-1.

6.2 Quality Control for the Environmental Sample Program

Quality control for the environmental sample program encompasses both the sample collection and sample analysis processes. Results are reviewed for correctness, reasonableness, and data entry errors. Sample results that are suspect are normally investigated. A crosscheck program utilizing blind samples supplied by an outside vendor is maintained for all sample media routinely analyzed.

6.2.1 Sample Collection Quality Control

Duplicate samples are collected and submitted for analysis when practical. The duplicate samples are used to assess the repeatability of the sample collection process and the precision of the analytical method.

6.2.2 Laboratory Instruments Quality Control

Analytical Balances - Analytical balances used in the laboratory for sample preparations are calibrated annually. Performance checks are performed prior to use and span the range of intended use. Performance check results are documented on the sample preparation forms and kept with the analytical results.

Analytical Instruments – Analytical instruments used for determining radioactive emissions in samples are calibrated for efficiency annually using standard reference material traceable to the National Institute of Standards and Technology (NIST). Below is a summary of the routine QC practices for the different analytical instruments.

- Gas-flow Proportional Counter: Background and performance checks are performed daily when in use. Control charts are maintained with two and three-sigma limits specified; the checks must fall within the two-sigma warning limits prior to use. Mid-batch QC and end of batch performance checks are typically performed.
- Gamma Spectrometers: Performance checked daily for efficiency, energy per channel relationship, peak resolution, and background when in use. The checks are performed and plotted for both a low and high energy peak. Efficiency checks are held within two-sigma control limits. Long duration background checks are performed quarterly. A low level batch QC check is typically analyzed with each set of samples.
- Liquid Scintillation Counter: Background and performance checks are performed daily when in use. A performance check standard of the same matrix as the samples is analyzed and results trended. A control chart with acceptance limits specified is maintained. A low level batch QC check is typically analyzed with each set of samples.

6.2.3 Sample Batch Quality Control

Sample batch analysis is normally performed with sample blanks and known-addition samples (or spiked samples) included. The type of known addition sample used is dictated by the sample media being analyzed, the primary analytes of interest, and the method being used. The following is a summary of sample batch QC activities.

Iodine-131 Cartridges - At least one known-addition sample is analyzed with each batch. A charcoal cartridge of the same type used for sample collection but spiked with barium-133 is used. The 356 keV peak of barium-133 serves as a proxy for the 364 keV peak of iodine-131. Samples from the control location serve as blanks.

Gross Beta Filters - At least one unused blank air particulate filter and at least one known-addition air particulate filter is analyzed with each batch.

Aqueous Samples – In most cases, samples collected from the control locations are analyzed as blanks. A known-addition sample is typically analyzed with each batch of samples.

Gross Alpha/Beta in Water - Blank samples are prepared from reagent grade water and analyzed with each batch of samples. One known addition sample and one replicate sample is normally analyzed with each batch.

Tritium in Water – A blank and a low level known addition sample is typically analyzed with each batch. A replicate sample is prepared and analyzed with each batch when necessary.

6.3 Laboratory Intercomparison Program Participation and Results

Participation in cross check intercomparison studies is mandatory for laboratories performing analyses of CGS REMP samples. Intercomparison studies provide a consistent and effective means to evaluate the accuracy and precision of analyses performed by a laboratory. Study results should fall within specified control limits. Results that fall outside the control limits are investigated and corrective action taken.

The Energy Northwest Environmental Services Laboratory participated in three proficiency testing studies involving radioactive measurements provided by Environmental Resource Associates (ERA) during 2019. The Laboratory's intercomparison program was further supplemented by additional cross check media provided by ERA. The Laboratory's intercomparison program results for 2019 are shown in Table 6-2. Participation in the ERA studies serves to meet the intercomparison program requirements specified in the ODCM.

In addition to participation in an intercomparison program, the CGS REMP routinely splits environmental samples with the Washington State Department of Health (WaDOH). Split samples are sent to the WaDOH lab on a scheduled frequency where they are independently analyzed. This split sample program provides an additional check on the accuracy and precision of the results reported in this document.

6.4 Laboratory Quality Control Program Problems and Improvements

The results of the fall 2019 I-131 in milk proficiency sample (RAD-118) were slightly below the acceptance limits. Investigation found no calculation, reporting, or instrumentation errors. No anomalies during preparation were noted or identified. A second I-131 in milk proficiency sample (RAD-119) was obtained and prepared by the same individual using the same procedure. Results of the RAD-119 sample were in good agreement with the known value. The cause of the low RAD-118 result was not identified. The laboratory initiated counting the I-131 source material before it is added to the milk media and also counting the waste milk after extraction in order to help identify any potential issues before reporting results.

TABLE 6-1
2019 ENVIRONMENTAL SPIKED DOSIMETER RESULTS

PERIOD	SPIKE ID	KNOWN EXPOSURE (mR)	REPORTED EXPOSURE (mR)	BIAS (%)
1st Quarter	ENW Spike	22.48	22.55	+0.3%
	ENW Spike	22.48	22.91	+1.9%
	ENW Spike	22.48	22.69	+0.9%
	ENW Spike	22.48	22.55	+0.3%
	ENW Spike	22.48	21.78	-3.1%
	ENW Spike	22.48	25.18	+12.0%
	HEDP Avg. Reader	100	99.1	+0.1%
2nd Quarter	ENW Spike	22	21.2	-3.6%
	ENW Spike	22	21.6	-1.8%
	ENW Spike	22	21.3	-3.2%
	ENW Spike	40	39.5	-1.3%
	ENW Spike	40	39.6	-1.0%
	ENW Spike	40	39.5	-1.3%
	HEDP Avg. Reader	100	99.6	-0.4%
3rd Quarter	ENW Spike	22	22.4	+1.6%
	ENW Spike	22	21.9	-0.4%
	ENW Spike	22	22.2	+0.9%
	ENW Spike	50	50.6	+1.3%
	ENW Spike	50	50.1	+0.3%
	ENW Spike	50	51.2	+2.4%
	HEDP Avg. Reader	100	99.6	-0.4%
4th Quarter	ENW Spike	22	21.6	-1.8%
	ENW Spike	22	22.1	+0.5%
	ENW Spike	22	22.2	+0.9%
	ENW Spike	40	39.3	-1.8%
	ENW Spike	40	40.5	+1.2%
	ENW Spike	40	40.6	+1.4%
	HEDP Avg. Reader	100	99.0	-0.6%

TABLE 6-2
ENW REMP PROGRAM CROSS CHECK PERFORMANCE RESULTS

ERA MRAD-30 Results Spring 2019					
Standard/Analyte	Units	Reported Value	Assigned Value	Acceptance Limits	Performance Evaluation
Air Filter Radionuclides					
Americium-241	pCi/Filter	18	18.7	13.3 - 24.9	Acceptable
Cesium-134	pCi/Filter	600	721	468 - 884	Acceptable
Cesium-137	pCi/Filter	708	634	521 - 832	Acceptable
Cobalt-60	pCi/Filter	96	93.8	79.7 - 119	Acceptable
Manganese-54	pCi/Filter	< 50	< 50.0	0.00 - 50.0	Acceptable
Zinc-65	pCi/Filter	1585	1380	1130 - 2110	Acceptable
Air Filter Gross Alpha/Beta					
Gross Alpha	pCi/Filter	43.9	50.3	26.3 - 82.9	Acceptable
Gross Beta	pCi/Filter	75.4	78.6	47.7 - 119	Acceptable
Water Radionuclides					
Americium-241	pCi/L	156	168	115 - 215	Acceptable
Cesium-134	pCi/L	113	123	92.9 - 135	Acceptable
Cesium-137	pCi/L	128	125	107 - 142	Acceptable
Cobalt-60	pCi/L	1101	1100	949 - 1260	Acceptable
Manganese-54	pCi/L	< 100	< 100	0.00 - 100	Acceptable
Zinc-65	pCi/L	1919	1780	1580 - 2250	Acceptable
Water Gross Alpha/Beta					
Gross Alpha	pCi/L	81.6	68.5	25.0 - 94.5	Acceptable
Gross Beta	pCi/L	129	151	75.5 - 208	Acceptable
Water Tritium					
Tritium	pCi/L	23175	23700	17900 - 28800	Acceptable
Soil Radionuclides					
Actinium-228	pCi/kg	3169	3280	2160 - 4130	Acceptable
Americium-241 ^a	pCi/kg	< 500	474	256 - 671	Acceptable
Bismuth-212	pCi/kg	2537	3400	973 - 5070	Acceptable
Bismuth-214	pCi/kg	1432	1370	658 - 2040	Acceptable
Cesium-134	pCi/kg	9614	9280	6350 - 11100	Acceptable
Cesium-137	pCi/kg	1208	1030	779 - 1300	Acceptable
Cobalt-60	pCi/kg	6344	5880	4630 - 7260	Acceptable
Lead-212	pCi/kg	3598	3380	2360 - 4270	Acceptable
Lead-214	pCi/kg	1555	1450	609 - 2280	Acceptable
Manganese-54	pCi/kg	< 100	< 1000	0.00 - 1000	Acceptable
Potassium-40	pCi/kg	24086	24300	16700 - 29000	Acceptable
Zinc-65	pCi/kg	1658	1460	1170 - 1990	Acceptable

a- Assigned value was below the analysis method MDA for this isotope.

TABLE 6-2 (Cont.)
ENW REMP PROGRAM CROSS CHECK PERFORMANCE RESULTS

ERA MRAD-31 Results Fall 2019					
Standard/Analyte	Units	Reported Value	Assigned Value	Acceptance Limits	Performance Evaluation
Air Filter Radionuclides					
Cesium-134	pCi/Filter	51.6	59.0	38.3 - 72.3	Acceptable
Cesium-137	pCi/Filter	488	437	359 - 573	Acceptable
Cobalt-60	pCi/Filter	61.3	58.4	49.6 - 74.2	Acceptable
Manganese-54	pCi/Filter	< 50	< 50.0	0.00 - 50.0	Acceptable
Zinc-65	pCi/Filter	411	364	298 - 556	Acceptable
Air Filter Gross Alpha/Beta					
Gross Alpha	pCi/Filter	61.7	59.0	30.8 - 97.2	Acceptable
Gross Beta	pCi/Filter	53.8	57.6	34.9 - 87.0	Acceptable
Water Radionuclides					
Americium-241 ^a	pCi/L	< 100	64.2	44.1 - 82.1	Acceptable
Cesium-134	pCi/L	1755	1960	1480 - 2160	Acceptable
Cesium-137	pCi/L	1866	1840	1580 - 2090	Acceptable
Cobalt-60	pCi/L	1844	1870	1610 - 2150	Acceptable
Manganese-54	pCi/L	< 100	< 100	0.00 - 100	Acceptable
Zinc-65	pCi/L	1442	1370	1220 - 1730	Acceptable
Water Gross Alpha/Beta					
Gross Alpha	pCi/L	114	124	45.3 - 171	Acceptable
Gross Beta	pCi/L	51.0	68.0	34.0 - 93.6	Acceptable
Water Tritium					
Tritium	pCi/L	22203	22300	16800 - 27100	Acceptable
Soil Radionuclides					
Actinium-228	pCi/kg	3273	3170	2090 - 3990	Acceptable
Americium-241	pCi/kg	2162	1920	1040 - 2720	Acceptable
Bismuth-212	pCi/kg	2458	3280	939 - 4890	Acceptable
Bismuth-214	pCi/kg	1335	1330	638 - 1980	Acceptable
Cesium-134	pCi/kg	7308	7650	5230 - 9140	Acceptable
Cesium-137	pCi/kg	1368	1230	930 - 1560	Acceptable
Cobalt-60	pCi/kg	3837	3710	2920 - 4580	Acceptable
Lead-212	pCi/kg	3502	3350	2340 - 4240	Acceptable
Lead-214	pCi/kg	1483	1450	609 - 2280	Acceptable
Manganese-54	pCi/kg	< 100	< 1000	0.00 - 1000	Acceptable
Potassium-40	pCi/kg	23821	24700	17000 - 29500	Acceptable
Zinc-65	pCi/kg	3041	2690	2150 - 3670	Acceptable

a- Assigned value was below the analysis method MDA for this isotope.

TABLE 6-2 (Cont)
ENW REMP PROGRAM CROSS CHECK PERFORMANCE RESULTS

2019 ERA Crosscheck Result Iodine-131 Charcoal Cartridge						
Sample ID	Analysis	Units	Result	Ref Value	Acceptance Limits	Performance Evaluation
01241901A	Iodine-131	pCi/Filter	395	362	303-434	Acceptable
01241902A	Iodine-131	pCi/Filter	420	373	312-447	Acceptable

2019 ERA RAD Results Iodine-131 in Milk						
Sample ID	Analysis	Units	Result	Ref Value	Acceptance Limits	Performance Evaluation
RAD-118	Iodine-131	pCi/L	24.1	29.6	24.6 – 34.6	Not Acceptable
RAD-119	Iodine-131	pCi/L	21.4	23.9	19.8 - 28.4	Acceptable

7.0 REFERENCES

7.0 REFERENCES

1. Energy Northwest, "Columbia Generating Station Final Safety Analysis Report," Section 2.3.1.1.
2. Nuclear Regulatory Commission Fact Sheet "Fact Sheet on Radiation Monitoring at Nuclear Power Plants and the "Tooth Fairy" Issue", NRC Library, www.nrc.gov/reading-rm/doc-collections/fact-sheets/.
3. The National Council on Radiation Protection and Measurements, 2006, "Cesium-137 in the Environment: Radioecology and Approaches to Assessment and Management", Report 154, NCRP, Bethesda, MD.
4. U.S. Nuclear Regulatory Commission, "Programs For Monitoring Radioactivity in the Environs of Nuclear Power Plants," Regulatory Guide 4.1, Revision 1, April 1975.
5. U.S. Nuclear Regulatory Commission, "Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Boiling Water Reactors", NUREG-1302, 1991.
6. U.S. Nuclear Regulatory Commission, "An Acceptable Radiological Environmental Monitoring Program," Assessment Branch Technical Position Revision 1, November 1979.
7. U.S. Nuclear Regulatory Commission, "Quality Assurance For Radiological Environmental Monitoring Program (Normal Operations), Effluent Streams and the Environment," Regulatory Guide 4.15, Revision 1, February 1979.
8. U.S. Nuclear Regulatory Commission, "Performance, Testing and Procedural Specifications For Thermoluminescence Dosimetry-Environmental Applications," Regulatory Guide 4.13, Revision 1, July 1977.
9. State of Washington, Energy Facility Site Evaluation Council, Resolution No. 332, approved February 21, 2012.
10. Energy Northwest Nuclear Columbia Generating Station, Operating License NPF-21, "Technical Specifications" Sections 5.5.1 and 5.6.1
11. Columbia Generating Station Offsite Dose Calculation Manual (ODCM).
12. Washington Administrative Code 173-200-040, "Water Quality Standards for Ground Water of the State of Washington - Criteria."
13. Washington Administrative Code 173-201A, "Water Quality Standards for Surface Waters of the State of Washington."
14. Code of Federal Regulations, Title 10 Part 20, "Standards for Protection against Radiation."

15. Code of Federal Regulations, Title 10 Part 50, "Domestic Licensing of Production and Utilization Facilities."
16. State of Washington, Energy Facility Site Evaluation Council, Resolution No. 300, approved September 10, 2001.
17. Nuclear Energy Institute, "Industry Ground Water Protection Initiative – Final Guidance Document", NEI 07-07, Nuclear Energy Institute, 1776 I Street N. W., Suite 400, Washington D.C.
18. State of Washington, Energy Facility Site Evaluation Council, Resolution No. 299, approved August 13, 2001.
19. PNNL, 2007, "Summary of Hydrogeology and Evaluation of Existing Groundwater Monitoring Wells for Outfalls 002 and 003 at the Columbia generating Station", PNWD-3845, Pacific Northwest National Laboratory, Richland, WA.
20. Code of Federal Regulations, Title 10 Part 72, "Licensing requirements for the independent storage of spent nuclear fuel, high-level radioactive waste, and reactor-related greater than class C waste", Subpart C, 72.44, "License conditions".
21. DOE, 2019, "Hanford Site Environmental Report for Calendar Year 2018", DOE/RL-2019-33 Rev 0, US Dept. of Energy, Richland, WA
22. US DOE, 1995, "Hanford Site Background: Evaluation of Existing Soil Radionuclide Data", DOE/RL-95-55, US Dept. of Energy, Richland, WA.
23. State of Washington, Energy Facility Site Evaluation Council, Council Order No. 874, approved January 21, 2015
24. PNNL, 2007, "Summary of Radiological Monitoring of Columbia and Snake River Sediment, 1998 through 2004", PNNL-16990, Pacific Northwest National Laboratory, Richland, WA.

8.0 ERRATA

8.0 ERRATA

Errors or omissions identified in previous year's reports are identified below.

In the 2017 and 2018 AREOR, in Section 5.1, fourth paragraph, the number of sectors were incorrectly identified for remote stations. It should have been 13 sectors and not 16.



**ENERGY
NORTHWEST**

APPENDIX A

2019 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT COLUMBIA GENERATING STATION

DATA TABLES A and B

Sample Collection Period Calendar Year 2019

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM



**Prepared by:
Energy Northwest - Environmental Services Staff
Richland, WA**

APPENDIX A - TABLE OF CONTENTS

TABLE A: ROUTINE RESULTS

- A-1.1 2019 Quarterly TLD Results
- A-1.2 2019 Quarterly TLD Results - Summary
- A-2.1 Gross Beta on Air Particulate Filters
- A-2.2 Gross Beta on Air Particulate Filters - Summary
- A-3.1 Gamma Spectrometry Results of Quarterly Air Particulate Filters
- A-3.2 Gamma Spectrometry Results of Quarterly Air Particulate Filters - Summary
- A-4.1 Gamma Spectrometry Results of Iodine-131 on Charcoal Filters
- A-4.2 Gamma Spectrometry Results of Iodine-131 on Charcoal Filters - Summary
- A-5.1 Gross Beta in Water
- A-5.2 Gross Beta in Water - Summary
- A-6.1 Tritium in Water
- A-6.2 Tritium in Water - Summary
- A-7.1 Gamma Spectrometry Results of River/Drinking Water
- A-7.2 Gamma Spectrometry Results of River/Drinking Water - Summary
- A-8.1 Gamma Spectrometry Results of Soil
- A-8.2 Gamma Spectrometry Results of Soil - Summary
- A-9.1 Gamma Spectrometry Results of Sediment
- A-9.2 Gamma Spectrometry Results of Sediment - Summary
- A-10.1 Gamma Spectrometry Results of Fish
- A-10.2 Gamma Spectrometry Results of Fish - Summary
- A-11.1 Iodine-131 in Milk
- A-11.2 Iodine-131 in Milk - Summary
- A-12.1 Gamma Spectrometry Results of Milk
- A-12.2 Gamma Spectrometry Results of Milk – Summary
- A-13.1 Gamma Spectrometry Results of Plant Discharge Water
- A-13.2 Gamma Spectrometry Results of Plant Discharge Water – Summary
- A-14.1 Gamma Spectrometry Results of Deep Ground Water
- A-14.2 Gamma Spectrometry Results of Deep Ground Water - Summary
- A-15.1 Gamma Spectrometry Results of Root Crops
- A-15.2 Gamma Spectrometry Results of Root Crops - Summary
- A-16.1 Gamma Spectrometry Results of Fruits

APPENDIX A - TABLE OF CONTENTS

TABLE A: ROUTINE RESULTS –Cont.

- A-16.2 Gamma Spectrometry Results of Fruits - Summary
- A-17.1 Gamma Spectrometry Results of Vegetables
- A-17.2 Gamma Spectrometry Results of Vegetables – Summary

TABLE B: SPECIAL INTEREST SAMPLE RESULTS

- B-1.1 2019 Quarterly Special Interest TLD Results
- B-1.2 2019 Quarterly Special Interest TLD Results - Summary
- B-2.1 Gamma Spectrometry Results of Storm Drain Water
- B-2.2 Gamma Spectrometry Results of Storm Drain Water - Summary
- B-3.1 Gross Beta in Storm Drain Water
- B-3.2 Gross Beta in Storm Drain Water - Summary
- B-4.1 Tritium in Storm Drain Water
- B-4.2 Tritium in Storm Drain Water - Summary
- B-5.1 Gross Alpha in Sanitary Waste Treatment Water
- B-5.2 Gross Alpha in Sanitary Waste Treatment Water - Summary
- B-6.1 Gross Beta in Sanitary Waste Treatment Water
- B-6.2 Gross Beta in Sanitary Waste Treatment Water - Summary
- B-7.1 Gamma Spectrometry Results of Sanitary Waste Treatment Water
- B-7.2 Gamma Spectrometry Results of Sanitary Waste Treatment Water - Summary
- B-8.1 Tritium in Sanitary Waste Treatment Water
- B-8.2 Tritium in Sanitary Waste Treatment Water – Summary
- B-9.1 Gamma Spectrometry Results of CGS Post Disposal Cooling Tower Sediment
- B-10.1 Gamma Spectrometry Results of Groundwater Monitoring Well Samples
- B-10.2 Gamma Spectrometry Results of Groundwater Monitoring Well Samples - Summary
- B-11.1 Tritium in Groundwater Monitoring Well Samples
- B-12.1 Gamma Spectrometry Results of Evaporation Pond Water
- B-13.1 Gamma Spectrometry Results of Evaporation Pond Sediment
- B-14.1 Gross Beta in Evaporation Pond Water
- B-15.1 Tritium in Evaporation Pond Water
- B-16.1 Tritium in Snow
- B-17.1 Carbon-14 in Apples

FORWARD

Since mid-1984, the results of the REMP analyses have been presented as net results calculated from total counts minus the observed background counts of the detection method. Counting results for low level samples are often within the counting error of the background determination; consequently, results can range from negative to positive values in these samples. Though most of the analytical results presented in this Appendix are below the detection limit, listing the actual calculated value, even when it is negative or below the detection limit, prevents positive biases and loss of individual results inherent in the use of "less than" (<) values. It is recommended practice to report radiological environmental data in this manner.

Most results listed in this Appendix are accompanied by a plus or minus (\pm) error value. In most cases the error value represents the two sigma counting uncertainty determined for that particular analysis. These error values are in the same units as the listed activity values. The two sigma error value represents the range that a recount of the same sample would be expected to fall within 95% of the time, based on the statistics encountered in the original count.

Also included in most cases are the analysis specific, minimum detectable activity (MDA) values. Though similar in concept to the lower limit of detection (LLD), these values are based on the statistics encountered in the specific sample count itself and not a blank determination. As such, they are an *a posteriori* (after the fact) determination where the LLD is an *a priori* (before the fact) determination. These values were included as they represent the level of activity that would have been needed to be present in the sample for a positive identification to be made.

TABLE A-1.1
2019 QUARTERLY TLD RESULTS

Results in milli-Roentgen (mR) per Standard Quarter

Station ID	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Quarterly Sum
1	20.4	21.1	21.6	21.5	84.6
2	20.8	20.7	21.1	22.0	84.4
3	18.3	19.5	20.1	20.9	78.7
4	17.3	17.9	18.3	18.9	72.5
5	18.4	18.8	19.6	19.3	76.1
6	17.5	19.0	19.4	19.8	75.7
7	19.4	19.5	20.7	21.1	80.7
8	21.0	22.1	23.1	22.6	88.7
9	18.6	18.9	19.6	19.7	76.7
10	19.7	20.0	20.4	20.7	80.8
11	19.9	20.2	20.9	22.1	83.0
12	21.0	21.1	23.6	22.1	87.9
13	20.1	20.3	20.5	22.0	82.9
14	19.6	21.5	20.5	22.5	84.0
15	20.9	22.4	21.9	23.7	88.9
16	19.8	21.6	21.0	22.8	85.2
17	19.9	22.1	21.7	22.1	85.8
18	19.4	20.4	21.3	22.0	83.1
19	19.6	21.4	21.3	22.5	84.8
20	18.7	20.8	20.5	22.5	82.5
21	18.8	19.3	19.9	20.3	78.2
22	18.8	20.2	20.6	21.5	81.2
23	19.7	20.8	21.0	22.0	83.4
24	17.8	20.9	18.9	21.5	79.1
25	20.4	21.6	21.8	23.2	87.0
40	17.6	18.1	18.0	19.0	72.7
41	19.1	20.6	20.9	22.2	82.8
42	18.5	19.7	20.1	20.8	79.1
43	20.7	20.6	21.1	21.6	83.9
44	17.6	19.0	19.4	19.3	75.3
45	19.3	19.5	20.3	20.4	79.5
46	23.1	26.1	27.1	26.8	103.1
47	19.3	19.0	20.0	20.6	78.9
49	20.5	21.3	20.3	23.0	85.1
50	20.5	21.0	21.1	22.4	85.0
51	18.7	20.0	19.8	21.5	80.0
53	20.3	21.5	20.7	22.1	84.5
54	20.4	20.5	20.2	20.8	81.9
55	20.2	20.5	21.0	20.8	82.4
56	20.4	21.3	21.1	22.2	85.1
65	18.0	19.4	20.2	20.4	78.0
71	24.6	24.0	26.5	26.6	101.8
72	22.0	22.2	24.4	24.6	93.1

TABLE A-1.1
2019 QUARTERLY TLD RESULTS

Results in milli-Roentgen (mR) per Standard Quarter

Station ID	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Quarterly Sum
73	20.6	21.4	22.2	23.4	87.5
74	21.0	21.2	22.9	24.6	89.7
75	20.2	21.2	NA	25.3	88.8
76	20.7	20.6	21.5	22.7	85.6
77	19.9	20.9	21.5	21.8	84.1
78	19.6	20.7	20.9	22.0	83.2
79	19.6	21.2	20.5	21.9	83.2
80	19.8	19.8	22.0	20.9	82.6
81	20.4	20.5	21.2	21.5	83.5
82	21.0	21.0	22.6	22.8	87.3
83	19.9	20.1	22.0	22.0	84.1
84	21.1	21.3	21.7	22.9	87.0
85	21.3	20.8	23.0	23.1	88.3
86	26.0	25.7	27.8	27.6	107.2

The TLD at Station 75 in the 3rd quarter was lost in the field.

The reported quarterly sum for this location is a normalized annual value based on the available 3 quarters of data.

TABLE A-1.2
2019 QUARTERLY TLD RESULTS- SUMMARY

Results in milli-Roentgen (mR) per Standard Quarter

Location	Average Activity	Activity Low	Activity High	Number of Samples
Quarterly Indicator TLDs	21.0	17.3	27.8	223
Quarterly Control TLDs	19.2	18.6	19.7	4

TABLE A-2.1
GROSS BETA ON AIR PARTICULATE FILTERS
 Results in pCi per Cubic Meter

Collection Period	Station 01		Station 04		Station 05	
	Result	Error	Result	Error	Result	Error
01/02/19 - 01/08/19	1.94E-02	± 8.66E-04	1.94E-02	± 8.58E-04	2.09E-02	± 9.22E-04
01/08/19 - 01/15/19	1.90E-02	± 8.14E-04	2.02E-02	± 8.32E-04	2.19E-02	± 9.02E-04
01/15/19 - 01/22/19	2.25E-02	± 8.86E-04	2.74E-02	± 9.75E-04	2.19E-02	± 9.10E-04
01/22/19 - 01/29/19	1.56E-02	± 7.33E-04	1.60E-02	± 7.41E-04	1.39E-02	± 7.26E-04
01/29/19 - 02/06/19	2.74E-02	± 9.04E-04	2.75E-02	± 9.06E-04	2.61E-02	± 9.22E-04
**02/06/19 - 02/12/19	3.51E-02	± 9.64E-04	3.37E-02	± 1.15E-03	3.67E-02	± 1.27E-03
**02/12/19 - 02/19/19	2.19E-02	± 1.23E-03	2.95E-02	± 1.01E-03	3.15E-02	± 1.10E-03
02/19/19 - 02/26/19	3.74E-02	± 1.11E-03	3.71E-02	± 1.12E-03	3.52E-02	± 1.15E-03
02/26/19 - 03/05/19	2.51E-02	± 9.39E-04	2.65E-02	± 9.51E-04	2.77E-02	± 1.02E-03
03/05/19 - 03/12/19	2.76E-02	± 9.64E-04	2.67E-02	± 9.46E-04	2.87E-02	± 1.05E-03
03/12/19 - 03/19/19	2.11E-02	± 8.67E-04	2.24E-02	± 8.88E-04	2.14E-02	± 9.33E-04
03/19/19 - 03/26/19	1.90E-02	± 8.19E-04	2.05E-02	± 8.29E-04	1.79E-02	± 8.41E-04
03/26/19 - 04/02/19	1.38E-02	± 7.11E-04	1.17E-02	± 6.45E-04	1.32E-02	± 7.44E-04
04/02/19 - 04/09/19	8.81E-03	± 6.05E-04	9.88E-03	± 6.18E-04	9.98E-03	± 6.68E-04
04/09/19 - 04/16/19	4.64E-03	± 4.51E-04	4.74E-03	± 4.45E-04	4.44E-03	± 4.64E-04
04/16/19 - 04/23/19	1.17E-02	± 6.79E-04	1.13E-02	± 6.49E-04	8.84E-03	± 6.23E-04
04/23/19 - 04/30/19	1.97E-02	± 8.62E-04	1.87E-02	± 8.16E-04	1.72E-02	± 8.49E-04
04/30/19 - 05/07/19	1.82E-02	± 8.38E-04	1.71E-02	± 7.94E-04	1.38E-02	± 7.72E-04
05/07/19 - 05/14/19	1.82E-02	± 9.04E-04	1.75E-02	± 8.16E-04	1.80E-02	± 8.85E-04
05/14/19 - 05/21/19	7.49E-03	± 6.60E-04	7.53E-03	± 5.58E-04	8.06E-03	± 6.18E-04
05/21/19 - 05/28/19	1.13E-02	± 6.80E-04	1.32E-02	± 7.14E-04	1.13E-02	± 7.25E-04
05/28/19 - 06/04/19	2.08E-02	± 9.00E-04	1.90E-02	± 8.44E-04	2.10E-02	± 8.89E-04
06/04/19 - 06/11/19	5.32E-03	± 5.04E-04	5.38E-03	± 4.86E-04	6.16E-03	± 5.29E-04
06/11/19 - 06/18/19	1.08E-02	± 6.64E-04	1.14E-02	± 6.57E-04	1.22E-02	± 6.91E-04
06/18/19 - 06/25/19	6.15E-03	± 5.14E-04	7.36E-03	± 5.42E-04	7.57E-03	± 5.55E-04
06/25/19 - 07/02/19	1.01E-02	± 6.55E-04	1.11E-02	± 6.63E-04	1.02E-02	± 6.56E-04
07/02/19 - 07/09/19	1.14E-02	± 6.83E-04	9.90E-03	± 6.26E-04	1.17E-02	± 6.78E-04
07/09/19 - 07/16/19	1.01E-02	± 6.72E-04	9.82E-03	± 6.50E-04	9.59E-03	± 6.56E-04
07/16/19 - 07/23/19	7.24E-03	± 5.85E-04	7.50E-03	± 5.75E-04	8.00E-03	± 6.05E-04
07/23/19 - 07/30/19	1.25E-02	± 7.25E-04	1.35E-02	± 7.33E-04	1.25E-02	± 7.21E-04
07/30/19 - 08/06/19	1.44E-02	± 7.73E-04	1.33E-02	± 7.21E-04	1.51E-02	± 7.82E-04
08/06/19 - 08/13/19	1.87E-02	± 8.58E-04	1.62E-02	± 7.90E-04	1.71E-02	± 8.24E-04
08/13/19 - 08/20/19	1.49E-02	± 7.91E-04	1.14E-02	± 6.84E-04	1.53E-02	± 7.91E-04
08/20/19 - 08/27/19	1.13E-02	± 6.88E-04	1.04E-02	± 6.44E-04	1.05E-02	± 6.48E-04
08/27/19 - 09/03/19	1.75E-02	± 8.37E-04	1.73E-02	± 8.14E-04	1.89E-02	± 8.63E-04
09/03/19 - 09/10/19	1.89E-02	± 8.70E-04	1.73E-02	± 8.31E-04	1.93E-02	± 8.69E-04
09/10/19 - 09/17/19	1.06E-02	± 6.69E-04	9.87E-03	± 6.49E-04	1.00E-02	± 6.44E-04
09/17/19 - 09/24/19	9.72E-03	± 6.34E-04	9.98E-03	± 6.48E-04	6.55E-03	± 5.32E-04
09/24/19 - 10/01/19	9.26E-03	± 6.08E-04	8.57E-03	± 5.95E-04	8.30E-03	± 5.82E-04
10/01/19 - 10/08/19	1.15E-02	± 6.79E-04	1.26E-02	± 7.24E-04	1.31E-02	± 7.17E-04
10/08/19 - 10/15/19	2.70E-02	± 9.92E-04	2.75E-02	± 1.02E-03	2.95E-02	± 1.04E-03
10/15/19 - 10/22/19	1.72E-02	± 8.00E-04	1.72E-02	± 8.06E-04	1.72E-02	± 8.01E-04
10/22/19 - 10/29/19	1.28E-02	± 6.87E-04	1.27E-02	± 6.85E-04	1.23E-02	± 6.69E-04
10/29/19 - 11/05/19	5.13E-02	± 1.35E-03	5.45E-02	± 1.41E-03	5.47E-02	± 1.39E-03
11/05/19 - 11/12/19	7.65E-02	± 1.70E-03	7.83E-02	± 1.75E-03	6.87E-02	± 1.88E-03
11/12/19 - 11/19/19	3.59E-02	± 1.16E-03	3.44E-02	± 1.13E-03	3.27E-02	± 1.09E-03
11/19/19 - 11/26/19	2.33E-02	± 9.45E-04	2.50E-02	± 1.02E-03	2.08E-02	± 8.91E-04
11/26/19 - 12/03/19	3.47E-02	± 1.12E-03	3.38E-02	± 1.12E-03	3.34E-02	± 1.09E-03
12/03/19 - 12/10/19	5.55E-02	± 1.42E-03	5.85E-02	± 1.48E-03	4.97E-02	± 1.33E-03
12/10/19 - 12/17/19	1.12E-02	± 6.54E-04	1.03E-02	± 6.37E-04	8.68E-03	± 5.80E-04
12/17/19 - 12/23/19	1.98E-02	± 9.23E-04	1.62E-02	± 8.34E-04	1.57E-02	± 7.91E-04
12/23/19 - 12/31/19	2.83E-02	± 9.52E-04	2.69E-02	± 9.55E-04	2.39E-02	± 8.69E-04

Average MDA for analyses in Table A-2.1 was 9.02 E-04.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-2.1
GROSS BETA ON AIR PARTICULATE FILTERS
 Results in pCi per Cubic Meter

Collection Period	Station 06		Station 07		Station 08	
	Result	Error	Result	Error	Result	Error
01/02/19 - 01/08/19	1.78E-02	± 8.36E-04	1.74E-02	± 8.48E-04	1.74E-02	± 8.74E-04
01/08/19 - 01/15/19	1.92E-02	± 8.31E-04	2.13E-02	± 8.88E-04	2.16E-02	± 9.28E-04
01/15/19 - 01/22/19	2.47E-02	± 9.41E-04	2.29E-02	± 9.29E-04	2.30E-02	± 9.66E-04
01/22/19 - 01/29/19	1.35E-02	± 6.99E-04	1.46E-02	± 7.36E-04	1.45E-02	± 7.65E-04
01/29/19 - 02/06/19	2.78E-02	± 9.29E-04	2.81E-02	± 9.49E-04	2.56E-02	± 9.49E-04
02/06/19 - 02/12/19	3.42E-02	± 1.16E-03	3.40E-02	± 1.19E-03	3.51E-02	± 1.29E-03
02/12/19 - 02/19/19	3.01E-02	± 1.06E-03	2.99E-02	± 1.06E-03	3.07E-02	± 1.12E-03
02/19/19 - 02/26/19	3.67E-02	± 1.11E-03	3.90E-02	± 1.17E-03	3.57E-02	± 1.20E-03
02/26/19 - 03/05/19	2.59E-02	± 9.86E-04	2.63E-02	± 9.93E-04	2.71E-02	± 1.04E-03
03/05/19 - 03/12/19	2.73E-02	± 9.88E-04	2.70E-02	± 9.89E-04	2.60E-02	± 1.02E-03
03/12/19 - 03/19/19	2.01E-02	± 8.60E-04	2.13E-02	± 9.06E-04	2.34E-02	± 9.85E-04
03/19/19 - 03/26/19	1.93E-02	± 8.31E-04	2.26E-02	± 9.25E-04	1.79E-02	± 8.56E-04
03/26/19 - 04/02/19	1.28E-02	± 6.93E-04	1.28E-02	± 7.18E-04	1.45E-02	± 7.87E-04
04/02/19 - 04/09/19	8.51E-03	± 5.84E-04	9.47E-03	± 6.51E-04	9.14E-03	± 6.52E-04
04/09/19 - 04/16/19	5.69E-03	± 4.97E-04	5.24E-03	± 4.93E-04	6.11E-03	± 5.38E-04
04/16/19 - 04/23/19	1.16E-02	± 6.70E-04	1.12E-02	± 6.42E-04	1.11E-02	± 6.95E-04
04/23/19 - 04/30/19	1.87E-02	± 8.41E-04	1.79E-02	± 8.22E-04	1.82E-02	± 8.73E-04
04/30/19 - 05/07/19	1.69E-02	± 8.15E-04	1.77E-02	± 8.35E-04	1.72E-02	± 8.54E-04
05/07/19 - 05/14/19	1.91E-02	± 8.72E-04	1.70E-02	± 8.36E-04	1.86E-02	± 8.93E-04
05/14/19 - 05/21/19	6.34E-03	± 5.33E-04	7.03E-03	± 5.75E-04	7.25E-03	± 5.96E-04
05/21/19 - 05/28/19	1.21E-02	± 7.05E-04	1.20E-02	± 7.31E-04	1.37E-02	± 7.88E-04
05/28/19 - 06/04/19	2.09E-02	± 9.10E-04	2.05E-02	± 9.36E-04	2.03E-02	± 8.62E-04
06/04/19 - 06/11/19	6.84E-03	± 5.56E-04	6.45E-03	± 5.73E-04	7.49E-03	± 5.51E-04
06/11/19 - 06/18/19	1.09E-02	± 6.68E-04	1.10E-02	± 7.04E-04	1.05E-02	± 6.29E-04
06/18/19 - 06/25/19	7.24E-03	± 5.53E-04	6.59E-03	± 5.20E-04	6.08E-03	± 4.97E-04
06/25/19 - 07/02/19	9.54E-03	± 6.40E-04	1.15E-02	± 6.92E-04	1.02E-02	± 6.37E-04
07/02/19 - 07/09/19	1.24E-02	± 7.11E-04	1.14E-02	± 6.81E-04	1.15E-02	± 6.63E-04
07/09/19 - 07/16/19	1.03E-02	± 6.80E-04	9.06E-03	± 6.43E-04	9.44E-03	± 6.34E-04
07/16/19 - 07/23/19	6.86E-03	± 5.73E-04	7.81E-03	± 6.03E-04	8.86E-03	± 6.14E-04
07/23/19 - 07/30/19	1.14E-02	± 7.11E-04	1.23E-02	± 7.26E-04	1.31E-02	± 7.23E-04
07/30/19 - 08/06/19	1.27E-02	± 7.31E-04	1.48E-02	± 7.88E-04	1.48E-02	± 7.55E-04
08/06/19 - 08/13/19	1.79E-02	± 8.55E-04	1.69E-02	± 8.43E-04	1.25E-02	± 6.93E-04
08/13/19 - 08/20/19	1.57E-02	± 8.14E-04	1.50E-02	± 8.18E-04	1.69E-02	± 8.15E-04
08/20/19 - 08/27/19	1.12E-02	± 6.85E-04	1.11E-02	± 7.13E-04	1.14E-02	± 6.70E-04
08/27/19 - 09/03/19	2.06E-02	± 9.07E-04	1.90E-02	± 9.05E-04	1.89E-02	± 8.54E-04
09/03/19 - 09/10/19	1.89E-02	± 8.83E-04	1.95E-02	± 8.78E-04	1.99E-02	± 8.78E-04
09/10/19 - 09/17/19	1.13E-02	± 6.89E-04	1.01E-02	± 6.62E-04	9.85E-03	± 6.29E-04
09/17/19 - 09/24/19	8.70E-03	± 5.96E-04	8.60E-03	± 6.04E-04	9.20E-03	± 6.03E-04
09/24/19 - 10/01/19	9.95E-03	± 6.57E-04	8.62E-03	± 6.02E-04	1.13E-02	± 6.58E-04
10/01/19 - 10/08/19	1.27E-02	± 7.15E-04	1.30E-02	± 7.27E-04	1.22E-02	± 6.83E-04
10/08/19 - 10/15/19	2.58E-02	± 9.81E-04	2.77E-02	± 1.01E-03	2.82E-02	± 9.92E-04
10/15/19 - 10/22/19	1.75E-02	± 8.13E-04	1.68E-02	± 8.01E-04	1.74E-02	± 7.94E-04
10/22/19 - 10/29/19	1.19E-02	± 6.55E-04	1.20E-02	± 6.68E-04	1.38E-02	± 6.92E-04
10/29/19 - 11/05/19	5.53E-02	± 1.40E-03	5.60E-02	± 1.42E-03	5.75E-02	± 1.40E-03
11/05/19 - 11/12/19	7.86E-02	± 1.73E-03	7.22E-02	± 1.67E-03	6.92E-02	± 1.58E-03
11/12/19 - 11/19/19	3.64E-02	± 1.15E-03	3.57E-02	± 1.18E-03	3.26E-02	± 1.07E-03
11/19/19 - 11/26/19	2.38E-02	± 9.76E-04	2.25E-02	± 9.58E-04	2.17E-02	± 8.74E-04
11/26/19 - 12/03/19	3.25E-02	± 1.08E-03	3.28E-02	± 1.14E-03	3.40E-02	± 1.07E-03
12/03/19 - 12/10/19	5.84E-02	± 1.46E-03	5.52E-02	± 1.47E-03	5.06E-02	± 1.31E-03
12/10/19 - 12/17/19	1.30E-02	± 6.97E-04	1.22E-02	± 7.33E-04	9.77E-03	± 5.96E-04
12/17/19 - 12/23/19	1.79E-02	± 8.55E-04	1.78E-02	± 9.33E-04	1.49E-02	± 7.55E-04
12/23/19 - 12/31/19	2.87E-02	± 9.66E-04	2.59E-02	± 9.14E-04	2.60E-02	± 8.89E-04

Average MDA for analyses in Table A-2.1 was 9.02 E-04.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-2.1
GROSS BETA ON AIR PARTICULATE FILTERS
 Results in pCi per Cubic Meter

Collection Period	Station 09		Station 21B		Station 23	
	Result	Error	Result	Error	Result	Error
01/02/19 - 01/08/19	1.54E-02	± 7.74E-04	1.86E-02	± 8.87E-04	2.17E-02	± 9.45E-04
01/08/19 - 01/15/19	1.67E-02	± 7.68E-04	2.02E-02	± 8.75E-04	2.13E-02	± 8.88E-04
01/15/19 - 01/22/19	2.31E-02	± 9.06E-04	2.64E-02	± 9.98E-04	2.63E-02	± 9.87E-04
01/22/19 - 01/29/19	1.12E-02	± 6.30E-04	1.45E-02	± 7.41E-04	1.36E-02	± 7.09E-04
01/29/19 - 02/06/19	2.48E-02	± 8.66E-04	2.75E-02	± 9.49E-04	2.85E-02	± 9.53E-04
**02/06/19 - 02/12/19	3.73E-02	± 1.24E-03	3.85E-02	± 1.27E-03	3.77E-02	± 1.04E-03
**02/12/19 - 02/19/19	3.19E-02	± 1.05E-03	3.33E-02	± 1.15E-03	2.44E-02	± 1.36E-03
02/19/19 - 02/26/19	3.31E-02	± 1.06E-03	3.54E-02	± 1.13E-03	3.57E-02	± 1.13E-03
02/26/19 - 03/05/19	2.99E-02	± 1.00E-03	2.65E-02	± 1.01E-03	2.69E-02	± 1.01E-03
03/05/19 - 03/12/19	2.87E-02	± 9.81E-04	2.89E-02	± 1.04E-03	2.85E-02	± 1.03E-03
03/12/19 - 03/19/19	1.96E-02	± 8.40E-04	2.25E-02	± 9.49E-04	2.08E-02	± 9.04E-04
03/19/19 - 03/26/19	2.11E-02	± 8.62E-04	2.02E-02	± 8.94E-04	1.73E-02	± 8.17E-04
03/26/19 - 04/02/19	1.22E-02	± 6.72E-04	1.35E-02	± 7.50E-04	1.51E-02	± 7.80E-04
04/02/19 - 04/09/19	6.99E-03	± 5.45E-04	9.78E-03	± 6.62E-04	8.86E-03	± 6.36E-04
04/09/19 - 04/16/19	4.19E-03	± 4.33E-04	5.58E-03	± 5.16E-04	5.28E-03	± 4.98E-04
04/16/19 - 04/23/19	9.87E-03	± 6.34E-04	1.13E-02	± 6.55E-04	1.11E-02	± 6.58E-04
04/23/19 - 04/30/19	1.86E-02	± 8.44E-04	1.90E-02	± 8.46E-04	1.88E-02	± 8.25E-04
04/30/19 - 05/07/19	1.64E-02	± 7.97E-04	1.76E-02	± 8.23E-04	1.69E-02	± 7.94E-04
05/07/19 - 05/14/19	1.72E-02	± 8.27E-04	1.82E-02	± 8.41E-04	1.72E-02	± 8.12E-04
05/14/19 - 05/21/19	7.09E-03	± 5.55E-04	6.62E-03	± 5.47E-04	7.05E-03	± 5.43E-04
05/21/19 - 05/28/19	1.14E-02	± 6.89E-04	1.23E-02	± 7.05E-04	1.13E-02	± 6.70E-04
05/28/19 - 06/04/19	2.05E-02	± 9.11E-04	2.08E-02	± 8.97E-04	2.19E-02	± 9.08E-04
06/04/19 - 06/11/19	6.49E-03	± 5.57E-04	7.34E-03	± 5.68E-04	6.11E-03	± 5.18E-04
06/11/19 - 06/18/19	1.11E-02	± 6.89E-04	1.12E-02	± 6.75E-04	1.20E-02	± 6.81E-04
06/18/19 - 06/25/19	7.30E-03	± 5.68E-04	6.31E-03	± 5.22E-04	6.32E-03	± 5.12E-04
06/25/19 - 07/02/19	9.77E-03	± 6.74E-04	1.01E-02	± 6.59E-04	1.06E-02	± 6.58E-04
07/02/19 - 07/09/19	1.12E-02	± 6.98E-04	1.10E-02	± 6.66E-04	1.13E-02	± 6.64E-04
07/09/19 - 07/16/19	6.92E-03	± 5.62E-04	9.95E-03	± 6.66E-04	8.86E-03	± 6.25E-04
07/16/19 - 07/23/19	9.59E-03	± 6.34E-04	8.59E-03	± 6.22E-04	7.58E-03	± 5.82E-04
07/23/19 - 07/30/19	1.17E-02	± 6.95E-04	1.35E-02	± 7.53E-04	1.01E-02	± 6.53E-04
07/30/19 - 08/06/19	1.33E-02	± 7.29E-04	1.48E-02	± 7.73E-04	1.24E-02	± 6.99E-04
08/06/19 - 08/13/19	1.76E-02	± 8.21E-04	1.69E-02	± 8.18E-04	1.82E-02	± 8.30E-04
08/13/19 - 08/20/19	1.41E-02	± 7.58E-04	1.62E-02	± 8.16E-04	1.41E-02	± 7.49E-04
08/20/19 - 08/27/19	1.16E-02	± 6.91E-04	1.25E-02	± 7.13E-04	9.77E-03	± 6.24E-04
08/27/19 - 09/03/19	1.89E-02	± 8.68E-04	2.04E-02	± 8.92E-04	1.87E-02	± 8.37E-04
09/03/19 - 09/10/19	1.68E-02	± 8.36E-04	1.95E-02	± 8.82E-04	1.91E-02	± 8.55E-04
09/10/19 - 09/17/19	9.26E-03	± 6.39E-04	1.14E-02	± 6.92E-04	9.84E-03	± 6.33E-04
09/17/19 - 09/24/19	9.22E-03	± 6.26E-04	9.43E-03	± 6.25E-04	8.53E-03	± 5.88E-04
09/24/19 - 10/01/19	8.24E-03	± 6.03E-04	1.14E-02	± 6.14E-04	8.54E-03	± 5.91E-04
10/01/19 - 10/08/19	1.24E-02	± 7.32E-04	1.41E-02	± 7.45E-04	1.32E-02	± 7.33E-04
10/08/19 - 10/15/19	2.54E-02	± 1.00E-03	2.95E-02	± 1.04E-03	2.75E-02	± 1.02E-03
10/15/19 - 10/22/19	1.56E-02	± 8.14E-04	1.70E-02	± 7.95E-04	1.88E-02	± 8.71E-04
10/22/19 - 10/29/19	1.35E-02	± 7.36E-04	1.43E-02	± 7.29E-04	1.37E-02	± 7.39E-04
10/29/19 - 11/05/19	4.61E-02	± 1.33E-03	5.32E-02	± 1.39E-03	5.56E-02	± 1.46E-03
11/05/19 - 11/12/19	7.01E-02	± 1.71E-03	7.37E-02	± 1.65E-03	7.72E-02	± 1.79E-03
11/12/19 - 11/19/19	3.63E-02	± 1.25E-03	3.28E-02	± 1.10E-03	3.34E-02	± 1.19E-03
11/19/19 - 11/26/19	2.12E-02	± 8.82E-04	2.29E-02	± 9.30E-04	2.35E-02	± 9.22E-04
11/26/19 - 12/03/19	3.52E-02	± 1.11E-03	3.50E-02	± 1.12E-03	3.35E-02	± 1.08E-03
12/03/19 - 12/10/19	5.39E-02	± 1.38E-03	5.65E-02	± 1.43E-03	5.57E-02	± 1.40E-03
12/10/19 - 12/17/19	7.57E-03	± 5.48E-04	1.09E-02	± 6.39E-04	1.20E-02	± 6.66E-04
12/17/19 - 12/23/19	1.31E-02	± 7.37E-04	1.89E-02	± 8.71E-04	1.89E-02	± 8.72E-04
12/23/19 - 12/31/19	2.72E-02	± 9.46E-04	2.82E-02	± 9.46E-04	2.73E-02	± 9.36E-04

Average MDA for analyses in Table A-2.1 was 9.02 E-04.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-2.1
GROSS BETA ON AIR PARTICULATE FILTERS
 Results in pCi per Cubic Meter

Collection Period	Station 40		Station 48		Station 57	
	Result	Error	Result	Error	Result	Error
01/02/19 - 01/08/19	2.01E-02	± 8.91E-04	1.91E-02	± 8.74E-04	1.78E-02	± 8.43E-04
01/08/19 - 01/15/19	2.04E-02	± 8.60E-04	2.25E-02	± 9.00E-04	2.04E-02	± 8.57E-04
01/15/19 - 01/22/19	2.49E-02	± 9.58E-04	2.37E-02	± 9.24E-04	2.43E-02	± 9.47E-04
01/22/19 - 01/29/19	1.48E-02	± 7.38E-04	1.54E-02	± 7.43E-04	1.45E-02	± 7.30E-04
01/29/19 - 02/06/19	2.67E-02	± 9.20E-04	2.69E-02	± 9.15E-04	2.88E-02	± 9.58E-04
02/06/19 - 02/12/19	3.41E-02	± 1.19E-03	3.83E-02	± 1.26E-03	3.78E-02	± 1.25E-03
02/12/19 - 02/19/19	3.19E-02	± 1.07E-03	3.07E-02	± 1.05E-03	3.10E-02	± 1.09E-03
02/19/19 - 02/26/19	3.55E-02	± 1.12E-03	3.80E-02	± 1.16E-03	3.90E-02	± 1.17E-03
02/26/19 - 03/05/19	2.89E-02	± 1.01E-03	2.61E-02	± 9.54E-04	2.64E-02	± 9.82E-04
03/05/19 - 03/12/19	2.73E-02	± 9.89E-04	2.95E-02	± 1.02E-03	2.89E-02	± 9.87E-04
03/12/19 - 03/19/19	1.97E-02	± 8.61E-04	2.08E-02	± 8.79E-04	2.18E-02	± 8.84E-04
03/19/19 - 03/26/19	1.89E-02	± 8.38E-04	1.84E-02	± 8.26E-04	2.04E-02	± 8.59E-04
03/26/19 - 04/02/19	1.38E-02	± 7.30E-04	1.42E-02	± 7.45E-04	1.64E-02	± 7.84E-04
04/02/19 - 04/09/19	8.12E-03	± 5.95E-04	8.70E-03	± 6.08E-04	8.33E-03	± 5.91E-04
04/09/19 - 04/16/19	3.77E-03	± 4.23E-04	4.92E-03	± 4.65E-04	3.83E-03	± 4.19E-04
04/16/19 - 04/23/19	1.06E-02	± 6.53E-04	1.06E-02	± 6.51E-04	1.03E-02	± 6.32E-04
04/23/19 - 04/30/19	1.72E-02	± 8.13E-04	1.68E-02	± 8.08E-04	1.62E-02	± 7.82E-04
04/30/19 - 05/07/19	1.79E-02	± 8.39E-04	1.82E-02	± 8.50E-04	1.61E-02	± 8.00E-04
05/07/19 - 05/14/19	1.81E-02	± 8.55E-04	1.81E-02	± 8.59E-04	1.68E-02	± 8.35E-04
05/14/19 - 05/21/19	6.91E-03	± 5.61E-04	6.93E-03	± 5.64E-04	7.67E-03	± 5.95E-04
05/21/19 - 05/28/19	1.20E-02	± 7.15E-04	1.20E-02	± 7.11E-04	1.22E-02	± 6.98E-04
05/28/19 - 06/04/19	1.99E-02	± 8.94E-04	1.96E-02	± 8.89E-04	2.02E-02	± 8.90E-04
06/04/19 - 06/11/19	6.45E-03	± 5.55E-04	6.30E-03	± 5.49E-04	6.99E-03	± 5.57E-04
06/11/19 - 06/18/19	1.14E-02	± 6.93E-04	1.07E-02	± 6.79E-04	1.15E-02	± 6.88E-04
06/18/19 - 06/25/19	8.26E-03	± 5.99E-04	8.33E-03	± 5.81E-04	7.02E-03	± 5.50E-04
06/25/19 - 07/02/19	1.07E-02	± 6.70E-04	1.10E-02	± 6.87E-04	1.18E-02	± 7.16E-04
07/02/19 - 07/09/19	1.02E-02	± 6.44E-04	1.04E-02	± 9.02E-04	1.04E-02	± 6.63E-04
07/09/19 - 07/16/19	8.55E-03	± 6.24E-04	8.94E-03	± 6.38E-04	1.07E-02	± 6.99E-04
07/16/19 - 07/23/19	9.90E-03	± 6.59E-04	7.47E-03	± 6.03E-04	8.29E-03	± 6.26E-04
07/23/19 - 07/30/19	1.38E-02	± 7.57E-04	1.27E-02	± 7.48E-04	1.20E-02	± 7.31E-04
07/30/19 - 08/06/19	1.53E-02	± 7.88E-04	1.42E-02	± 7.71E-04	1.51E-02	± 8.08E-04
08/06/19 - 08/13/19	1.68E-02	± 8.24E-04	1.83E-02	± 8.67E-04	1.89E-02	± 8.90E-04
08/13/19 - 08/20/19	1.49E-02	± 7.89E-04	1.59E-02	± 8.26E-04	1.57E-02	± 8.34E-04
08/20/19 - 08/27/19	1.15E-02	± 6.88E-04	1.12E-02	± 6.96E-04	1.15E-02	± 7.20E-04
08/27/19 - 09/03/19	1.94E-02	± 8.81E-04	1.94E-02	± 8.98E-04	1.89E-02	± 9.10E-04
09/03/19 - 09/10/19	1.67E-02	± 8.25E-04	2.05E-02	± 9.28E-04	1.86E-02	± 8.42E-04
09/10/19 - 09/17/19	1.11E-02	± 6.75E-04	8.95E-03	± 6.43E-04	9.85E-03	± 6.34E-04
09/17/19 - 09/24/19	8.34E-03	± 5.91E-04	9.47E-03	± 6.48E-04	1.07E-02	± 6.54E-04
09/24/19 - 10/01/19	9.20E-03	± 6.11E-04	9.75E-03	± 6.58E-04	8.04E-03	± 5.67E-04
10/01/19 - 10/08/19	1.23E-02	± 7.01E-04	1.49E-02	± 8.04E-04	1.45E-02	± 7.51E-04
10/08/19 - 10/15/19	2.85E-02	± 1.02E-03	3.05E-02	± 1.11E-03	2.86E-02	± 1.02E-03
10/15/19 - 10/22/19	1.86E-02	± 8.36E-04	1.79E-02	± 8.71E-04	1.93E-02	± 8.58E-04
10/22/19 - 10/29/19	1.33E-02	± 6.93E-04	1.27E-02	± 7.19E-04	1.34E-02	± 7.08E-04
10/29/19 - 11/05/19	5.75E-02	± 1.43E-03	5.60E-02	± 1.48E-03	5.72E-02	± 1.44E-03
11/05/19 - 11/12/19	6.95E-02	± 1.61E-03	7.13E-02	± 1.73E-03	7.74E-02	± 1.75E-03
11/12/19 - 11/19/19	3.19E-02	± 1.07E-03	3.56E-02	± 1.23E-03	3.56E-02	± 1.21E-03
11/19/19 - 11/26/19	2.19E-02	± 9.07E-04	2.31E-02	± 9.18E-04	2.25E-02	± 9.70E-04
11/26/19 - 12/03/19	3.47E-02	± 1.11E-03	3.53E-02	± 1.11E-03	3.54E-02	± 1.20E-03
12/03/19 - 12/10/19	5.07E-02	± 1.34E-03	5.43E-02	± 1.39E-03	6.04E-02	± 1.59E-03
12/10/19 - 12/17/19	1.08E-02	± 6.30E-04	1.00E-02	± 6.18E-04	1.20E-02	± 6.82E-04
12/17/19 - 12/23/19	1.72E-02	± 8.20E-04	1.75E-02	± 8.48E-04	1.88E-02	± 9.26E-04
12/23/19 - 12/31/19	2.48E-02	± 8.87E-04	2.67E-02	± 9.35E-04	2.85E-02	± 1.02E-03

Average MDA for analyses in Table A-2.1 was 9.02 E-04.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-2.2
GROSS BETA ON AIR PARTICULATE FILTERS - SUMMARY
 Results in pCi per cubic meter

LOCATION	Average Activity	Activity Low	Activity High	Number of Samples	Number of Positive IDs
Gross Beta Indicators	2.00E-02	3.77E-03	7.86E-02	572	572
Gross Beta Controls	1.90E-02	4.19E-03	7.01E-02	52	52

TABLE A-3.1
GAMMA SPECTROMETRY RESULTS OF QUARTERLY AIR PARTICULATE FILTERS

Results in pCi/cubic meter, results decay corrected for decay during sample collection period

Location and Quarter			Station 1	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.10E-01 ±	1.60E-02	9.44E-03
K-40		4.25E-03 ±	5.04E-03	1.41E-02
MN-54		-7.68E-05 ±	7.14E-04	1.00E-03
FE-59		0.00E+00 ±	1.71E-03	8.40E-03
CO-60		4.47E-04 ±	3.38E-04	4.71E-04
ZN-65		7.29E-04 ±	5.96E-04	8.95E-04
ZRNB-95		0.00E+00 ±	4.69E-04	2.94E-03
CS-134		0.00E+00 ±	1.31E-04	9.44E-04
CS-137		4.80E-04 ±	3.93E-04	8.54E-04
BALA140		0.00E+00 ±	2.26E-03	2.45E-02
RU-106		7.01E-04 ±	4.73E-03	7.06E-03

Location and Quarter			Station 1	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.36E-01 ±	1.80E-02	9.43E-03
K-40		-8.48E-05 ±	9.87E-03	1.47E-02
MN-54		-6.56E-04 ±	1.11E-03	1.48E-03
FE-59		1.63E-03 ±	2.82E-03	3.81E-03
CO-60		-5.67E-05 ±	9.04E-04	1.28E-03
ZN-65		5.38E-04 ±	2.14E-03	2.95E-03
ZRNB-95		-7.72E-04 ±	2.31E-03	3.29E-03
CS-134		3.63E-05 ±	6.68E-04	9.76E-04
CS-137		1.75E-04 ±	7.59E-04	1.10E-03
BALA140		6.50E-03 ±	1.07E-02	1.40E-02
RU-106		7.77E-04 ±	6.51E-03	9.54E-03

Location and Quarter			Station 1	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.50E-01 ±	2.25E-02	1.46E-02
K-40		9.19E-03 ±	8.36E-03	1.11E-02
MN-54		-3.30E-04 ±	8.89E-04	1.23E-03
FE-59		-1.48E-03 ±	5.05E-03	7.03E-03
CO-60		-1.99E-04 ±	9.29E-04	1.28E-03
ZN-65		1.14E-04 ±	1.72E-03	2.50E-03
ZRNB-95		4.88E-04 ±	2.06E-03	3.06E-03
CS-134		-5.60E-04 ±	9.95E-04	1.36E-03
CS-137		2.61E-04 ±	7.50E-04	1.07E-03
BALA140		8.66E-03 ±	3.25E-02	4.64E-02
RU-106		-4.84E-03 ±	1.01E-02	1.40E-02

Location and Quarter			Station 1	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	7.02E-02 ±	1.16E-02	7.81E-03
K-40		2.49E-03 ±	6.15E-03	9.83E-03
MN-54		-3.58E-05 ±	4.42E-04	6.74E-04
FE-59		1.10E-03 ±	1.94E-03	2.69E-03
CO-60		-1.74E-04 ±	6.16E-04	9.11E-04
ZN-65		-3.57E-04 ±	1.28E-03	1.82E-03
ZRNB-95		-1.85E-04 ±	1.29E-03	1.92E-03
CS-134		-2.50E-04 ±	6.03E-04	8.65E-04
CS-137		2.65E-04 ±	5.48E-04	7.67E-04
BALA140		-1.28E-02 ±	1.96E-02	2.48E-02
RU-106		-2.83E-03 ±	5.50E-03	7.87E-03

Location and Quarter			Station 4	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	8.63E-02 ±	1.44E-02	1.04E-02
K-40		6.79E-03 ±	7.10E-03	8.34E-03
MN-54		-3.02E-05 ±	6.97E-04	9.86E-04
FE-59		2.08E-03 ±	1.58E-03	2.19E-03
CO-60		2.52E-04 ±	2.52E-04	4.63E-04
ZN-65		9.57E-04 ±	6.77E-04	1.91E-03
ZRNB-95		1.92E-04 ±	1.67E-03	2.42E-03
CS-134		0.00E+00 ±	9.11E-05	7.75E-04
CS-137		0.00E+00 ±	2.20E-04	8.97E-04
BALA140		0.00E+00 ±	3.16E-03	2.42E-02
RU-106		1.90E-03 ±	4.26E-03	6.15E-03

Location and Quarter			Station 4	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.13E-01 ±	1.58E-02	9.05E-03
K-40		1.10E-03 ±	1.15E-02	1.62E-02
MN-54		1.89E-05 ±	8.73E-04	1.25E-03
FE-59		-2.45E-04 ±	3.92E-03	5.53E-03
CO-60		2.50E-04 ±	7.26E-04	1.00E-03
ZN-65		-2.00E-04 ±	1.75E-03	2.48E-03
ZRNB-95		1.32E-03 ±	1.08E-03	2.47E-03
CS-134		1.35E-04 ±	6.63E-04	9.51E-04
CS-137		-4.99E-04 ±	1.03E-03	1.42E-03
BALA140		-1.77E-03 ±	1.24E-02	1.72E-02
RU-106		-3.25E-03 ±	6.94E-03	9.71E-03

Location and Quarter			Station 4	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.50E-01 ±	1.84E-02	7.85E-03
K-40		2.97E-03 ±	8.26E-03	1.22E-02
MN-54		-3.84E-05 ±	5.78E-04	8.62E-04
FE-59		6.69E-05 ±	3.28E-03	4.97E-03
CO-60		-7.87E-05 ±	6.23E-04	9.46E-04
ZN-65		-2.66E-04 ±	1.20E-03	1.75E-03
ZRNB-95		-7.06E-04 ±	2.11E-03	3.00E-03
CS-134		-1.44E-04 ±	5.60E-04	8.20E-04
CS-137		1.88E-04 ±	4.69E-04	6.92E-04
BALA140		9.92E-03 ±	2.39E-02	3.37E-02
RU-106		-3.49E-04 ±	4.81E-03	7.32E-03

Location and Quarter			Station 4	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	6.60E-02 ±	1.12E-02	7.16E-03
K-40		4.35E-03 ±	7.69E-03	1.14E-02
MN-54		-3.72E-05 ±	5.13E-04	7.73E-04
FE-59		7.99E-04 ±	2.59E-03	3.71E-03
CO-60		2.39E-04 ±	2.80E-04	4.17E-04
ZN-65		-3.14E-04 ±	1.60E-03	2.27E-03
ZRNB-95		-4.81E-04 ±	1.38E-03	2.00E-03
CS-134		-2.07E-04 ±	6.22E-04	8.99E-04
CS-137		6.37E-05 ±	5.58E-04	8.40E-04
BALA140		-5.80E-03 ±	1.35E-02	1.80E-02
RU-106		-3.19E-03 ±	6.02E-03	8.59E-03

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

TABLE A-3.1
GAMMA SPECTROMETRY RESULTS OF QUARTERLY AIR PARTICULATE FILTERS

Results in pCi/cubic meter, results decay corrected for decay during sample collection period

Location and Quarter			Station 5	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.15E-01 ±	1.72E-02	1.07E-02
K-40	+	1.47E-02 ±	6.44E-03	5.16E-03
MN-54		0.00E+00 ±	3.79E-04	1.10E-03
FE-59		2.33E-03 ±	1.76E-03	2.45E-03
CO-60		1.17E-05 ±	6.13E-04	9.10E-04
ZN-65		6.68E-05 ±	1.11E-03	1.68E-03
ZRNB-95		7.10E-04 ±	1.70E-03	2.39E-03
CS-134		7.20E-05 ±	5.90E-04	8.66E-04
CS-137		0.00E+00 ±	2.74E-04	1.00E-03
BALA140		0.00E+00 ±	2.50E-03	2.71E-02
RU-106		-1.93E-04 ±	5.71E-03	8.57E-03

Location and Quarter			Station 5	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.27E-01 ±	1.90E-02	1.39E-02
K-40		7.96E-03 ±	8.30E-03	1.14E-02
MN-54		-1.76E-04 ±	9.12E-04	1.28E-03
FE-59		-2.69E-04 ±	4.29E-03	6.06E-03
CO-60		-2.45E-04 ±	1.08E-03	1.47E-03
ZN-65		8.93E-04 ±	1.51E-03	2.03E-03
ZRNB-95		-5.24E-04 ±	2.18E-03	3.15E-03
CS-134		-5.91E-04 ±	1.05E-03	1.43E-03
CS-137		2.67E-04 ±	7.50E-04	1.07E-03
BALA140		4.86E-04 ±	1.33E-02	1.89E-02
RU-106		-3.16E-03 ±	8.53E-03	1.20E-02

Location and Quarter			Station 5	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.54E-01 ±	2.24E-02	1.33E-02
K-40		3.32E-04 ±	8.32E-03	1.28E-02
MN-54		-2.95E-04 ±	9.99E-04	1.38E-03
FE-59		2.28E-03 ±	3.95E-03	5.34E-03
CO-60		1.68E-04 ±	5.55E-04	8.09E-04
ZN-65		-6.47E-04 ±	2.03E-03	2.80E-03
ZRNB-95		4.86E-04 ±	2.28E-03	3.36E-03
CS-134		-2.54E-04 ±	9.06E-04	1.27E-03
CS-137		-4.29E-05 ±	7.14E-04	1.05E-03
BALA140		5.73E-03 ±	4.56E-02	6.36E-02
RU-106		-4.32E-03 ±	8.57E-03	1.19E-02

Location and Quarter			Station 5	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	6.57E-02 ±	1.12E-02	7.30E-03
K-40		-2.81E-04 ±	8.63E-03	1.30E-02
MN-54		3.65E-05 ±	5.03E-04	7.57E-04
FE-59		1.13E-03 ±	1.99E-03	2.76E-03
CO-60		-2.99E-04 ±	7.37E-04	1.04E-03
ZN-65		3.08E-04 ±	1.30E-03	1.86E-03
ZRNB-95		2.83E-04 ±	1.20E-03	1.78E-03
CS-134		-2.08E-05 ±	4.93E-04	7.42E-04
CS-137		-3.12E-05 ±	3.88E-04	6.08E-04
BALA140		-1.77E-03 ±	1.27E-02	1.77E-02
RU-106		9.42E-04 ±	2.81E-03	4.33E-03

Location and Quarter			Station 6	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.25E-01 ±	1.67E-02	8.38E-03
K-40		4.37E-03 ±	9.18E-03	1.16E-02
MN-54		2.21E-04 ±	5.52E-04	7.67E-04
FE-59		1.61E-03 ±	3.06E-03	4.04E-03
CO-60		6.57E-04 ±	4.16E-04	1.05E-03
ZN-65		0.00E+00 ±	2.50E-04	2.48E-03
ZRNB-95		-2.82E-04 ±	1.76E-03	2.53E-03
CS-134		-1.35E-04 ±	5.60E-04	8.11E-04
CS-137		-1.62E-04 ±	7.25E-04	1.02E-03
BALA140		0.00E+00 ±	3.32E-03	2.54E-02
RU-106		2.17E-03 ±	3.80E-03	5.43E-03

Location and Quarter			Station 6	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.28E-01 ±	1.60E-02	1.06E-02
K-40		-1.75E-03 ±	6.81E-03	1.14E-02
MN-54		-1.11E-04 ±	6.10E-04	8.89E-04
FE-59		-1.43E-03 ±	3.85E-03	5.22E-03
CO-60		2.39E-04 ±	4.50E-04	6.59E-04
ZN-65		5.83E-05 ±	9.06E-04	1.41E-03
ZRNB-95		0.00E+00 ±	0.00E+00	2.24E-03
CS-134		2.01E-04 ±	4.50E-04	6.53E-04
CS-137		-1.21E-04 ±	5.63E-04	8.38E-04
BALA140		1.53E-03 ±	9.07E-03	1.29E-02
RU-106		-6.78E-04 ±	5.44E-03	8.11E-03

Location and Quarter			Station 6	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.42E-01 ±	2.15E-02	1.29E-02
K-40		2.77E-03 ±	1.04E-02	1.48E-02
MN-54		-4.23E-04 ±	1.10E-03	1.50E-03
FE-59		9.52E-05 ±	6.03E-03	8.58E-03
CO-60		2.02E-04 ±	7.82E-04	1.10E-03
ZN-65		5.50E-04 ±	1.82E-03	2.55E-03
ZRNB-95		3.33E-04 ±	1.82E-03	2.78E-03
CS-134		-4.11E-04 ±	8.28E-04	1.15E-03
CS-137		1.77E-04 ±	7.67E-04	1.11E-03
BALA140		5.07E-03 ±	3.38E-02	4.98E-02
RU-106		-1.23E-03 ±	8.40E-03	1.21E-02

Location and Quarter			Station 6	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	6.42E-02 ±	1.20E-02	9.01E-03
K-40		6.85E-03 ±	5.90E-03	8.84E-03
MN-54		-3.67E-05 ±	5.53E-04	8.24E-04
FE-59		-1.19E-03 ±	3.75E-03	5.16E-03
CO-60		-1.78E-04 ±	6.30E-04	9.32E-04
ZN-65		7.56E-04 ±	8.31E-04	1.07E-03
ZRNB-95		1.18E-03 ±	1.09E-03	1.39E-03
CS-134		8.31E-05 ±	3.74E-04	5.66E-04
CS-137		2.17E-04 ±	4.92E-04	7.19E-04
BALA140		-9.00E-03 ±	1.90E-02	2.48E-02
RU-106		-2.57E-03 ±	5.50E-03	7.92E-03

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

TABLE A-3.1
GAMMA SPECTROMETRY RESULTS OF QUARTERLY AIR PARTICULATE FILTERS

Results in pCi/cubic meter, results decay corrected for decay during sample collection period

Location and Quarter			Station 7	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	8.86E-02 ±	1.51E-02	1.03E-02
K-40		5.21E-03 ±	9.62E-03	1.20E-02
MN-54		0.00E+00 ±	9.85E-05	6.02E-04
FE-59		-8.10E-04 ±	4.98E-03	6.62E-03
CO-60		2.84E-04 ±	6.55E-04	8.84E-04
ZN-65		1.30E-04 ±	1.52E-03	2.17E-03
ZRNB-95		4.60E-04 ±	1.85E-03	2.63E-03
CS-134		1.92E-04 ±	5.40E-04	7.76E-04
CS-137		0.00E+00 ±	2.38E-04	1.06E-03
BALA140		-6.11E-04 ±	1.20E-02	1.67E-02
RU-106		-1.87E-03 ±	7.18E-03	1.03E-02

Location and Quarter			Station 7	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.27E-01 ±	1.84E-02	1.17E-02
K-40		4.86E-04 ±	1.01E-02	1.49E-02
MN-54		-2.06E-05 ±	8.89E-04	1.28E-03
FE-59		2.01E-04 ±	4.91E-03	6.82E-03
CO-60		-2.72E-04 ±	9.47E-04	1.29E-03
ZN-65		-1.47E-03 ±	2.64E-03	3.46E-03
ZRNB-95		9.12E-04 ±	2.06E-03	2.93E-03
CS-134		-4.74E-04 ±	8.48E-04	1.17E-03
CS-137		-1.33E-04 ±	7.78E-04	1.13E-03
BALA140		-6.30E-03 ±	1.95E-02	2.53E-02
RU-106		-2.75E-03 ±	7.48E-03	1.06E-02

Location and Quarter			Station 7	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.77E-01 ±	2.52E-02	1.60E-02
K-40		4.45E-03 ±	1.20E-02	1.65E-02
MN-54		-2.64E-04 ±	1.10E-03	1.53E-03
FE-59		8.79E-04 ±	5.21E-03	7.43E-03
CO-60		-5.41E-04 ±	1.14E-03	1.49E-03
ZN-65		-8.83E-04 ±	2.38E-03	3.23E-03
ZRNB-95		0.00E+00 ±	3.67E-04	3.83E-03
CS-134		2.36E-04 ±	4.43E-04	6.33E-04
CS-137		-1.34E-04 ±	6.31E-04	9.30E-04
BALA140		-1.96E-02 ±	6.23E-02	8.22E-02
RU-106		4.16E-04 ±	7.37E-03	1.08E-02

Location and Quarter			Station 7	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	6.10E-02 ±	1.23E-02	9.92E-03
K-40		9.14E-03 ±	8.45E-03	1.16E-02
MN-54		3.26E-04 ±	5.68E-04	7.95E-04
FE-59		0.00E+00 ±	5.42E-04	2.00E-03
CO-60		-1.33E-04 ±	6.50E-04	9.73E-04
ZN-65		-9.92E-04 ±	2.07E-03	2.81E-03
ZRNB-95		-1.03E-03 ±	2.08E-03	2.90E-03
CS-134		-7.05E-05 ±	5.43E-04	8.06E-04
CS-137		2.51E-04 ±	5.38E-04	7.81E-04
BALA140		-4.08E-03 ±	1.39E-02	1.94E-02
RU-106		2.42E-03 ±	5.14E-03	7.44E-03

Location and Quarter			Station 8	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.01E-01 ±	1.39E-02	7.21E-03
K-40		1.08E-02 ±	7.01E-03	1.53E-02
MN-54		1.79E-04 ±	5.17E-04	7.35E-04
FE-59		3.92E-04 ±	2.23E-03	3.30E-03
CO-60		5.49E-05 ±	6.43E-04	9.17E-04
ZN-65		-2.61E-04 ±	1.42E-03	2.00E-03
ZRNB-95		-2.03E-04 ±	1.37E-03	2.04E-03
CS-134		2.40E-04 ±	5.20E-04	7.29E-04
CS-137		8.50E-05 ±	4.03E-04	6.06E-04
BALA140		-2.33E-03 ±	1.34E-02	1.77E-02
RU-106		-9.10E-04 ±	5.00E-03	7.30E-03

Location and Quarter			Station 8	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.33E-01 ±	1.61E-02	9.43E-03
K-40		6.58E-03 ±	8.18E-03	1.17E-02
MN-54		-4.09E-04 ±	7.02E-04	9.71E-04
FE-59		1.47E-03 ±	1.20E-03	1.81E-03
CO-60		1.19E-04 ±	4.34E-04	6.79E-04
ZN-65		-3.80E-04 ±	1.36E-03	1.94E-03
ZRNB-95		1.92E-04 ±	1.33E-03	1.99E-03
CS-134		-3.85E-04 ±	6.88E-04	9.72E-04
CS-137		-1.83E-04 ±	6.13E-04	9.01E-04
BALA140		-1.05E-03 ±	9.25E-03	1.33E-02
RU-106		-1.69E-03 ±	6.34E-03	9.24E-03

Location and Quarter			Station 8	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.80E-01 ±	2.34E-02	1.22E-02
K-40		9.05E-03 ±	9.41E-03	1.24E-02
MN-54		1.43E-04 ±	8.32E-04	1.18E-03
FE-59		-3.63E-03 ±	7.84E-03	1.02E-02
CO-60		2.58E-04 ±	7.50E-04	1.03E-03
ZN-65		5.47E-05 ±	1.90E-03	2.72E-03
ZRNB-95		1.58E-04 ±	2.18E-03	3.29E-03
CS-134		-1.06E-04 ±	6.56E-04	9.49E-04
CS-137		-5.98E-04 ±	1.10E-03	1.51E-03
BALA140		5.81E-03 ±	4.62E-02	6.46E-02
RU-106		3.70E-03 ±	8.04E-03	1.12E-02

Location and Quarter			Station 8	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	5.81E-02 ±	1.07E-02	7.65E-03
K-40		4.28E-03 ±	6.22E-03	9.47E-03
MN-54		-1.73E-04 ±	6.52E-04	9.32E-04
FE-59		-1.39E-03 ±	3.61E-03	4.92E-03
CO-60		-4.43E-04 ±	7.86E-04	1.07E-03
ZN-65		-8.83E-04 ±	1.97E-03	2.66E-03
ZRNB-95		7.46E-04 ±	1.38E-03	1.94E-03
CS-134		-1.10E-04 ±	7.26E-04	1.25E-03
CS-137		1.46E-04 ±	3.78E-04	5.64E-04
BALA140		2.16E-03 ±	1.28E-02	1.82E-02
RU-106		1.11E-03 ±	5.73E-03	8.42E-03

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

TABLE A-3.1
GAMMA SPECTROMETRY RESULTS OF QUARTERLY AIR PARTICULATE FILTERS

Results in pCi/cubic meter, results decay corrected for decay during sample collection period

Location and Quarter			Station 9	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.02E-01 ±	1.57E-02	1.06E-02
K-40	0.00E+00 ±	5.70E-03	2.55E-02	
MN-54	-1.69E-04 ±	7.28E-04	1.00E-03	
FE-59	-2.04E-04 ±	3.80E-03	5.27E-03	
CO-60	2.03E-04 ±	6.00E-04	8.29E-04	
ZN-65	3.66E-04 ±	4.22E-04	8.98E-04	
ZRNB-95	-1.38E-04 ±	1.90E-03	2.74E-03	
CS-134	1.97E-04 ±	3.45E-04	4.93E-04	
CS-137	0.00E+00 ±	1.58E-04	8.27E-04	
BALA140	-4.15E-03 ±	2.05E-02	2.57E-02	
RU-106	-1.23E-03 ±	5.34E-03	7.81E-03	

Location and Quarter			Station 9	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.27E-01 ±	1.51E-02	7.24E-03
K-40	2.11E-03 ±	6.42E-03	1.04E-02	
MN-54	-1.87E-04 ±	7.04E-04	1.01E-03	
FE-59	-1.59E-03 ±	3.55E-03	4.80E-03	
CO-60	1.90E-04 ±	5.70E-04	8.30E-04	
ZN-65	-1.02E-03 ±	1.81E-03	2.43E-03	
ZRNB-95	1.13E-03 ±	1.19E-03	1.57E-03	
CS-134	4.80E-05 ±	4.62E-04	6.97E-04	
CS-137	1.93E-04 ±	4.11E-04	6.06E-04	
BALA140	6.92E-04 ±	9.07E-03	1.32E-02	
RU-106	2.86E-04 ±	4.17E-03	6.42E-03	

Location and Quarter			Station 9	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.46E-01 ±	2.26E-02	1.52E-02
K-40	3.84E-03 ±	8.97E-03	1.30E-02	
MN-54	-1.07E-04 ±	7.89E-04	1.14E-03	
FE-59	-3.60E-03 ±	8.86E-03	1.15E-02	
CO-60	1.56E-04 ±	9.19E-04	1.28E-03	
ZN-65	-4.28E-04 ±	2.25E-03	3.13E-03	
ZRNB-95	6.61E-04 ±	2.35E-03	3.43E-03	
CS-134	-1.10E-04 ±	7.54E-04	1.08E-03	
CS-137	8.68E-05 ±	6.42E-04	9.51E-04	
BALA140	2.37E-02 ±	3.91E-02	5.11E-02	
RU-106	-2.42E-03 ±	7.49E-03	1.07E-02	

Location and Quarter			Station 9	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	7.14E-02 ±	1.51E-02	1.22E-02
K-40	2.02E-03 ±	1.01E-02	1.46E-02	
MN-54	-2.79E-04 ±	9.21E-04	1.28E-03	
FE-59	1.87E-03 ±	3.23E-03	4.36E-03	
CO-60	8.47E-05 ±	9.06E-04	1.27E-03	
ZN-65	1.92E-04 ±	1.92E-03	2.73E-03	
ZRNB-95	-1.41E-04 ±	2.29E-03	3.39E-03	
CS-134	-2.54E-04 ±	7.27E-04	1.03E-03	
CS-137	3.48E-04 ±	8.04E-04	1.13E-03	
BALA140	-1.20E-02 ±	3.13E-02	4.04E-02	
RU-106	3.93E-04 ±	6.68E-03	9.84E-03	

Location and Quarter			Station 21B	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	9.94E-02 ±	1.58E-02	9.77E-03
K-40	5.36E-03 ±	9.89E-03	1.24E-02	
MN-54	2.96E-04 ±	4.58E-04	6.20E-04	
FE-59	1.07E-03 ±	3.16E-03	4.37E-03	
CO-60	-1.75E-04 ±	1.08E-03	1.43E-03	
ZN-65	2.01E-04 ±	1.14E-03	1.68E-03	
ZRNB-95	1.95E-04 ±	1.64E-03	2.41E-03	
CS-134	1.26E-04 ±	4.32E-04	6.40E-04	
CS-137	-7.21E-06 ±	6.89E-04	1.00E-03	
BALA140	-6.58E-04 ±	1.29E-02	1.80E-02	
RU-106	1.54E-03 ±	5.31E-03	7.77E-03	

Location and Quarter			Station 21B	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.39E-01 ±	1.83E-02	9.85E-03
K-40	7.28E-03 ±	9.44E-03	1.29E-02	
MN-54	-3.11E-04 ±	1.11E-03	1.52E-03	
FE-59	-2.09E-03 ±	5.04E-03	6.65E-03	
CO-60	-2.65E-04 ±	9.22E-04	1.26E-03	
ZN-65	-9.53E-04 ±	2.68E-03	3.57E-03	
ZRNB-95	6.35E-04 ±	1.82E-03	2.63E-03	
CS-134	-2.14E-04 ±	7.43E-04	1.05E-03	
CS-137	-6.18E-04 ±	1.17E-03	1.60E-03	
BALA140	4.74E-04 ±	1.30E-02	1.84E-02	
RU-106	3.82E-04 ±	7.16E-03	1.05E-02	

Location and Quarter			Station 21B	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.77E-01 ±	2.53E-02	1.74E-02
K-40	2.13E-03 ±	8.58E-03	1.28E-02	
MN-54	-3.57E-04 ±	1.06E-03	1.46E-03	
FE-59	-9.33E-05 ±	4.83E-03	7.10E-03	
CO-60	-9.76E-05 ±	1.03E-03	1.42E-03	
ZN-65	3.65E-04 ±	1.07E-03	1.59E-03	
ZRNB-95	8.14E-04 ±	1.58E-03	2.30E-03	
CS-134	-3.62E-05 ±	7.36E-04	1.07E-03	
CS-137	4.19E-04 ±	8.67E-04	1.21E-03	
BALA140	1.80E-02 ±	3.74E-02	5.05E-02	
RU-106	1.98E-03 ±	7.60E-03	1.09E-02	

Location and Quarter			Station 21B	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	6.41E-02 ±	1.36E-02	1.10E-02
K-40	-5.30E-03 ±	1.26E-02	1.77E-02	
MN-54	-3.95E-04 ±	1.05E-03	1.43E-03	
FE-59	1.02E-03 ±	3.94E-03	5.53E-03	
CO-60	-3.36E-04 ±	1.14E-03	1.51E-03	
ZN-65	-1.83E-03 ±	3.02E-03	3.91E-03	
ZRNB-95	1.18E-03 ±	2.01E-03	2.81E-03	
CS-134	1.04E-04 ±	6.79E-04	9.78E-04	
CS-137	-4.56E-04 ±	8.58E-04	1.19E-03	
BALA140	1.15E-03 ±	2.57E-02	3.53E-02	
RU-106	2.62E-03 ±	7.13E-03	1.01E-02	

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

TABLE A-3.1
GAMMA SPECTROMETRY RESULTS OF QUARTERLY AIR PARTICULATE FILTERS

Results in pCi/cubic meter, results decay corrected for decay during sample collection period

Location and Quarter			Station 23	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	9.57E-02 ±	1.33E-02	7.51E-03
K-40		7.13E-03 ±	3.82E-03	8.15E-03
MN-54		1.23E-04 ±	3.95E-04	5.76E-04
FE-59		-1.22E-04 ±	2.02E-03	3.08E-03
CO-60		2.55E-04 ±	2.28E-04	3.76E-04
ZN-65		0.00E+00 ±	3.89E-04	2.11E-03
ZRNB-95		3.79E-04 ±	1.30E-03	1.91E-03
CS-134		1.18E-04 ±	4.03E-04	5.84E-04
CS-137		0.00E+00 ±	1.55E-04	6.37E-04
BALA140		-1.26E-03 ±	1.25E-02	1.67E-02
RU-106		-2.82E-04 ±	3.76E-03	5.68E-03

Location and Quarter			Station 23	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.16E-01 ±	1.47E-02	8.70E-03
K-40		2.56E-03 ±	5.13E-03	8.86E-03
MN-54		1.81E-04 ±	5.20E-04	7.52E-04
FE-59		-1.89E-04 ±	2.35E-03	3.52E-03
CO-60		-2.78E-04 ±	6.45E-04	9.31E-04
ZN-65		-7.63E-04 ±	1.49E-03	2.04E-03
ZRNB-95		-1.26E-03 ±	2.21E-03	3.03E-03
CS-134		-6.21E-05 ±	5.37E-04	7.97E-04
CS-137		-9.96E-05 ±	5.83E-04	8.68E-04
BALA140		3.51E-04 ±	6.50E-03	1.01E-02
RU-106		-2.16E-03 ±	5.21E-03	7.56E-03

Location and Quarter			Station 23	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.39E-01 ±	1.86E-02	1.15E-02
K-40		5.56E-03 ±	6.77E-03	1.01E-02
MN-54		-3.82E-04 ±	7.01E-04	9.75E-04
FE-59		7.42E-04 ±	3.44E-03	5.01E-03
CO-60		4.34E-05 ±	5.30E-04	8.11E-04
ZN-65		2.24E-04 ±	1.36E-03	1.98E-03
ZRNB-95		-2.36E-04 ±	1.80E-03	2.65E-03
CS-134		-1.32E-04 ±	4.91E-04	7.24E-04
CS-137		-3.05E-04 ±	5.99E-04	8.59E-04
BALA140		-3.80E-02 ±	5.88E-02	7.45E-02
RU-106		2.77E-03 ±	6.18E-03	8.88E-03

Location and Quarter			Station 23	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	6.52E-02 ±	1.47E-02	1.34E-02
K-40		3.92E-03 ±	5.28E-03	8.56E-03
MN-54		-1.22E-04 ±	8.90E-04	1.26E-03
FE-59		-5.25E-03 ±	8.25E-03	1.04E-02
CO-60		-5.56E-05 ±	8.87E-04	1.25E-03
ZN-65		-1.08E-03 ±	2.22E-03	2.96E-03
ZRNB-95		-2.80E-04 ±	2.29E-03	3.37E-03
CS-134		-5.29E-04 ±	9.41E-04	1.29E-03
CS-137		0.00E+00 ±	0.00E+00	9.84E-04
BALA140		6.75E-03 ±	2.28E-02	3.09E-02
RU-106		-3.09E-03 ±	9.19E-03	1.29E-02

Location and Quarter			Station 40	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.18E-01 ±	1.75E-02	1.13E-02
K-40		3.89E-03 ±	6.93E-03	8.86E-03
MN-54		2.26E-04 ±	5.63E-04	7.83E-04
FE-59		-8.15E-04 ±	5.01E-03	6.67E-03
CO-60		0.00E+00 ±	1.34E-04	1.15E-03
ZN-65		1.47E-03 ±	1.36E-03	1.61E-03
ZRNB-95		8.14E-04 ±	1.67E-03	2.32E-03
CS-134		-2.57E-04 ±	7.04E-04	9.90E-04
CS-137		-6.88E-05 ±	4.28E-04	6.44E-04
BALA140		1.18E-02 ±	7.92E-03	2.11E-02
RU-106		0.00E+00 ±	2.76E-03	1.06E-02

Location and Quarter			Station 40	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.22E-01 ±	1.52E-02	9.16E-03
K-40		6.72E-03 ±	8.97E-03	1.26E-02
MN-54		0.00E+00 ±	2.14E-04	7.84E-04
FE-59		-5.48E-04 ±	3.07E-03	4.38E-03
CO-60		4.48E-05 ±	5.47E-04	8.36E-04
ZN-65		-2.98E-04 ±	1.49E-03	2.12E-03
ZRNB-95		6.76E-04 ±	5.12E-04	7.12E-04
CS-134		1.02E-04 ±	4.72E-04	7.03E-04
CS-137		-2.49E-04 ±	5.44E-04	7.90E-04
BALA140		-5.72E-04 ±	7.12E-03	1.10E-02
RU-106		-2.31E-03 ±	5.54E-03	8.02E-03

Location and Quarter			Station 40	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.59E-01 ±	2.32E-02	1.45E-02
K-40		9.43E-03 ±	9.81E-03	1.30E-02
MN-54		-1.92E-04 ±	1.00E-03	1.40E-03
FE-59		2.34E-03 ±	4.05E-03	5.48E-03
CO-60		1.98E-04 ±	7.68E-04	1.08E-03
ZN-65		1.11E-03 ±	1.88E-03	2.51E-03
ZRNB-95		-1.65E-04 ±	2.28E-03	3.43E-03
CS-134		-5.74E-04 ±	1.02E-03	1.39E-03
CS-137		8.68E-05 ±	7.11E-04	1.04E-03
BALA140		1.40E-02 ±	3.70E-02	5.15E-02
RU-106		-3.62E-03 ±	9.18E-03	1.28E-02

Location and Quarter			Station 40	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	6.27E-02 ±	1.48E-02	1.39E-02
K-40		1.11E-03 ±	1.06E-02	1.51E-02
MN-54		-3.12E-04 ±	8.74E-04	1.21E-03
FE-59		-7.19E-04 ±	5.95E-03	8.08E-03
CO-60		-3.85E-04 ±	8.99E-04	1.20E-03
ZN-65		3.62E-04 ±	1.60E-03	2.27E-03
ZRNB-95		2.68E-04 ±	1.68E-03	2.52E-03
CS-134		-3.42E-04 ±	8.36E-04	1.16E-03
CS-137		-2.45E-04 ±	7.88E-04	1.12E-03
BALA140		-2.28E-03 ±	2.96E-02	3.97E-02
RU-106		-2.67E-03 ±	6.45E-03	9.13E-03

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

TABLE A-3.1
GAMMA SPECTROMETRY RESULTS OF QUARTERLY AIR PARTICULATE FILTERS

Results in pCi/cubic meter, results decay corrected for decay during sample collection period

Location and Quarter			Station 48	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.07E-01 ±	1.62E-02	1.09E-02
K-40		6.61E-03 ±	4.18E-03	1.06E-02
MN-54		0.00E+00 ±	1.92E-04	1.15E-03
FE-59		0.00E+00 ±	2.05E-03	7.50E-03
CO-60		1.44E-04 ±	6.08E-04	8.59E-04
ZN-65		6.97E-04 ±	1.19E-03	1.60E-03
ZRNB-95		6.84E-04 ±	1.64E-03	2.30E-03
CS-134		-1.19E-04 ±	6.07E-04	8.77E-04
CS-137		3.41E-04 ±	4.75E-04	6.39E-04
BALA140		3.27E-03 ±	1.34E-02	1.79E-02
RU-106		7.31E-04 ±	3.56E-03	5.49E-03

Location and Quarter			Station 48	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.23E-01 ±	1.74E-02	1.00E-02
K-40		-2.33E-03 ±	1.19E-02	1.73E-02
MN-54		7.22E-04 ±	7.65E-04	9.86E-04
FE-59		1.01E-03 ±	2.73E-03	3.90E-03
CO-60		1.41E-05 ±	8.92E-04	1.27E-03
ZN-65		-8.59E-04 ±	2.37E-03	3.19E-03
ZRNB-95		1.04E-03 ±	1.09E-03	1.41E-03
CS-134		-2.16E-04 ±	7.82E-04	1.11E-03
CS-137		2.61E-04 ±	6.10E-04	8.75E-04
BALA140		-1.08E-02 ±	2.16E-02	2.74E-02
RU-106		-4.26E-03 ±	9.59E-03	1.33E-02

Location and Quarter			Station 48	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.45E-01 ±	1.99E-02	1.18E-02
K-40		5.73E-03 ±	1.03E-02	1.44E-02
MN-54		1.27E-04 ±	5.97E-04	8.80E-04
FE-59		-3.00E-04 ±	3.72E-03	5.57E-03
CO-60		-1.43E-04 ±	6.97E-04	1.04E-03
ZN-65		4.89E-04 ±	8.74E-04	1.25E-03
ZRNB-95		-1.05E-03 ±	2.51E-03	3.53E-03
CS-134		-2.35E-04 ±	6.69E-04	9.66E-04
CS-137		2.08E-04 ±	4.67E-04	6.89E-04
BALA140		1.36E-03 ±	2.52E-02	3.93E-02
RU-106		1.54E-03 ±	2.99E-03	4.48E-03

Location and Quarter			Station 48	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	5.41E-02 ±	1.15E-02	9.07E-03
K-40		3.60E-03 ±	8.63E-03	1.26E-02
MN-54		-1.16E-04 ±	6.80E-04	9.86E-04
FE-59		-1.31E-03 ±	4.10E-03	5.65E-03
CO-60		-2.60E-04 ±	7.63E-04	1.09E-03
ZN-65		-5.32E-04 ±	1.69E-03	2.36E-03
ZRNB-95		0.00E+00 ±	6.83E-04	2.20E-03
CS-134		3.27E-05 ±	5.18E-04	7.78E-04
CS-137		1.13E-04 ±	3.13E-04	4.83E-04
BALA140		0.00E+00 ±	4.23E-03	1.10E-02
RU-106		5.30E-04 ±	4.79E-03	7.26E-03

Location and Quarter			Station 57	1st Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	9.12E-02 ±	1.47E-02	8.82E-03
K-40		-4.40E-04 ±	1.22E-02	1.58E-02
MN-54		1.20E-04 ±	6.53E-04	9.22E-04
FE-59		7.55E-04 ±	4.10E-03	5.57E-03
CO-60		2.21E-05 ±	8.18E-04	1.14E-03
ZN-65		8.87E-04 ±	6.71E-04	9.34E-04
ZRNB-95		0.00E+00 ±	3.52E-04	2.87E-03
CS-134		-1.70E-05 ±	5.03E-04	7.55E-04
CS-137		-1.23E-04 ±	7.27E-04	1.03E-03
BALA140		3.94E-03 ±	4.55E-03	9.67E-03
RU-106		2.92E-03 ±	5.24E-03	7.36E-03

Location and Quarter			Station 57	2nd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.31E-01 ±	1.51E-02	6.14E-03
K-40		2.82E-03 ±	7.51E-03	1.14E-02
MN-54		-2.61E-04 ±	7.80E-04	1.10E-03
FE-59		4.43E-04 ±	3.02E-03	4.33E-03
CO-60		1.48E-04 ±	5.60E-04	8.26E-04
ZN-65		-6.88E-04 ±	1.52E-03	2.10E-03
ZRNB-95		9.55E-05 ±	1.03E-03	1.59E-03
CS-134		5.32E-06 ±	5.03E-04	7.60E-04
CS-137		1.79E-04 ±	5.73E-04	8.43E-04
BALA140		-5.67E-03 ±	1.61E-02	2.13E-02
RU-106		7.98E-04 ±	4.02E-03	6.12E-03

Location and Quarter			Station 57	3rd Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.73E-01 ±	2.48E-02	1.57E-02
K-40		3.36E-03 ±	9.12E-03	1.33E-02
MN-54		7.23E-04 ±	8.16E-04	1.06E-03
FE-59		-4.38E-03 ±	8.47E-03	1.09E-02
CO-60		2.18E-04 ±	5.87E-04	8.39E-04
ZN-65		4.69E-04 ±	1.52E-03	2.18E-03
ZRNB-95		-5.09E-04 ±	2.99E-03	4.34E-03
CS-134		2.26E-04 ±	6.36E-04	9.08E-04
CS-137		1.78E-04 ±	6.52E-04	9.51E-04
BALA140		2.46E-02 ±	4.05E-02	5.29E-02
RU-106		1.65E-03 ±	8.52E-03	1.22E-02

Location and Quarter			Station 57	4th Q 2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	8.11E-02 ±	1.38E-02	9.68E-03
K-40		1.31E-03 ±	7.46E-03	1.17E-02
MN-54		-1.55E-04 ±	7.28E-04	1.05E-03
FE-59		-2.80E-03 ±	5.51E-03	7.27E-03
CO-60		2.99E-04 ±	3.07E-04	4.29E-04
ZN-65		2.47E-04 ±	2.01E-03	3.55E-03
ZRNB-95		-4.27E-04 ±	2.00E-03	2.87E-03
CS-134		-4.10E-04 ±	1.25E-03	2.11E-03
CS-137		1.64E-04 ±	6.13E-04	9.04E-04
BALA140		1.21E-03 ±	1.58E-02	2.29E-02
RU-106		9.47E-04 ±	5.13E-03	7.67E-03

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

TABLE A-3.2
GAMMA SPECTROMETRY RESULTS OF QUARTERLY AIR PARTICULATE FILTERS - SUMMARY

Results in pCi/cubic meter, corrected for decay during collection period

Nuclide		Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
BE-7	Ind	1.13E-01	5.41E-02	1.80E-01	1.06E-02	44	44
BE-7	Cntl	1.12E-01	7.14E-02	1.46E-01	1.13E-02	4	4
K-40	Ind	4.24E-03	-5.30E-03	1.47E-02	1.22E-02	44	1
K-40	Cntl	1.99E-03	0.00E+00	3.84E-03	1.59E-02	4	0
MN-54	Ind	-5.17E-05	-6.56E-04	7.23E-04	1.04E-03	44	0
MN-54	Cntl	-1.86E-04	-2.79E-04	-1.07E-04	1.11E-03	4	0
FE-59	Ind	-1.27E-04	-5.25E-03	2.34E-03	5.50E-03	44	0
FE-59	Cntl	-8.82E-04	-3.60E-03	1.87E-03	6.49E-03	4	0
CO-60	Ind	-1.08E-06	-5.41E-04	6.57E-04	9.96E-04	44	0
CO-60	Cntl	1.58E-04	8.47E-05	2.03E-04	1.05E-03	4	0
ZN-65	Ind	-4.50E-05	-1.83E-03	1.47E-03	2.25E-03	44	0
ZN-65	Cntl	-2.23E-04	-1.02E-03	3.66E-04	2.30E-03	4	0
ZRNB-95	Ind	1.39E-04	-1.26E-03	1.32E-03	2.58E-03	44	0
ZRNB-95	Cntl	3.78E-04	-1.41E-04	1.13E-03	2.78E-03	4	0
CS-134	Ind	-1.13E-04	-5.91E-04	2.40E-04	9.54E-04	44	0
CS-134	Cntl	-3.00E-05	-2.54E-04	1.97E-04	8.25E-04	4	0
CS-137	Ind	1.02E-05	-6.18E-04	4.80E-04	9.29E-04	44	0
CS-137	Cntl	1.57E-04	0.00E+00	3.48E-04	8.79E-04	4	0
BALA140	Ind	1.91E-04	-3.80E-02	2.46E-02	2.91E-02	44	0
BALA140	Cntl	2.06E-03	-1.20E-02	2.37E-02	3.26E-02	4	0
RU-106	Ind	-4.47E-04	-4.84E-03	3.70E-03	8.96E-03	44	0
RU-106	Cntl	-7.42E-04	-2.42E-03	3.93E-04	8.68E-03	4	0

TABLE A-4.1
GAMMA SPECTROMETRY RESULTS OF IODINE-131 ON CHARCOAL FILTERS

Results in pCi/cubic meter, corrected for decay during collection period

Collection	Period	Station 1				Station 4					
		RQ	Activity	Error	MDA	RQ	Activity	Error	MDA		
1/2/2019 -	1/8/2019		3.82E-03	±	1.20E-02	1.77E-02		3.78E-03	±	1.19E-02	1.75E-02
1/8/2019 -	1/15/2019		2.85E-03	±	1.08E-02	1.60E-02		2.81E-03	±	1.06E-02	1.58E-02
1/15/2019 -	1/22/2019		3.07E-04	±	1.12E-02	1.69E-02		3.06E-04	±	1.12E-02	1.69E-02
1/22/2019 -	1/29/2019		7.81E-03	±	1.07E-02	1.50E-02		7.75E-03	±	1.06E-02	1.49E-02
1/29/2019 -	2/6/2019		2.85E-03	±	1.14E-02	1.67E-02		2.83E-03	±	1.13E-02	1.66E-02
**2/6/2019 -	2/12/2019		-4.63E-03	±	1.15E-02	1.65E-02		7.86E-03	±	1.33E-02	1.89E-02
**2/12/2019 -	2/19/2019		0.00E+00	±	8.92E-03	4.37E-02		0.00E+00	±	5.21E-03	2.55E-02
2/19/2019 -	2/26/2019		3.86E-03	±	1.12E-02	1.64E-02		3.93E-03	±	1.14E-02	1.67E-02
2/26/2019 -	3/5/2019		-7.36E-03	±	1.86E-02	2.64E-02		-7.14E-03	±	1.80E-02	2.56E-02
3/5/2019 -	3/12/2019		-2.66E-03	±	1.42E-02	2.07E-02		-2.65E-03	±	1.41E-02	2.07E-02
3/12/2019 -	3/19/2019		3.26E-03	±	1.30E-02	1.90E-02		3.21E-03	±	1.28E-02	1.88E-02
3/19/2019 -	3/26/2019		-4.34E-03	±	1.02E-02	1.53E-02		-4.14E-03	±	9.73E-03	1.45E-02
3/26/2019 -	4/2/2019		1.17E-03	±	8.08E-03	1.27E-02		1.12E-03	±	7.75E-03	1.22E-02
4/2/2019 -	4/9/2019		8.28E-04	±	9.26E-03	1.45E-02		7.88E-04	±	8.81E-03	1.38E-02
4/9/2019 -	4/16/2019		7.77E-03	±	8.60E-03	1.22E-02		7.46E-03	±	8.25E-03	1.17E-02
4/16/2019 -	4/23/2019		-2.71E-03	±	1.15E-02	1.74E-02		-2.57E-03	±	1.09E-02	1.65E-02
4/23/2019 -	4/30/2019		-2.49E-03	±	9.49E-03	1.45E-02		-2.36E-03	±	8.98E-03	1.38E-02
4/30/2019 -	5/7/2019		5.53E-03	±	7.81E-03	1.14E-02		5.29E-03	±	7.47E-03	1.09E-02
5/7/2019 -	5/14/2019		8.58E-04	±	1.02E-02	1.60E-02		7.35E-04	±	8.72E-03	1.37E-02
5/14/2019 -	5/21/2019		-7.57E-03	±	1.75E-02	2.58E-02		-5.71E-03	±	1.32E-02	1.95E-02
5/21/2019 -	5/28/2019		-1.27E-03	±	1.27E-02	1.94E-02		-1.22E-03	±	1.22E-02	1.86E-02
5/28/2019 -	6/4/2019		4.05E-03	±	1.23E-02	1.84E-02		3.86E-03	±	1.17E-02	1.75E-02
6/4/2019 -	6/11/2019		5.41E-03	±	1.07E-02	1.59E-02		5.05E-03	±	1.00E-02	1.48E-02
6/11/2019 -	6/18/2019		2.43E-03	±	1.13E-02	1.73E-02		2.28E-03	±	1.06E-02	1.62E-02
6/18/2019 -	6/25/2019		-3.53E-03	±	1.42E-02	2.13E-02		-3.37E-03	±	1.36E-02	2.04E-02
6/25/2019 -	7/2/2019		5.25E-03	±	9.91E-03	1.47E-02		5.00E-03	±	9.44E-03	1.40E-02
7/2/2019 -	7/9/2019		-8.50E-03	±	1.65E-02	2.41E-02		-8.10E-03	±	1.57E-02	2.30E-02
7/9/2019 -	7/16/2019		7.05E-04	±	1.33E-02	2.03E-02		6.80E-04	±	1.28E-02	1.96E-02
7/16/2019 -	7/23/2019		1.18E-04	±	1.33E-02	2.04E-02		1.13E-04	±	1.27E-02	1.95E-02
7/23/2019 -	7/30/2019		-2.81E-03	±	1.34E-02	2.02E-02		-2.70E-03	±	1.29E-02	1.95E-02
7/30/2019 -	8/6/2019		4.22E-04	±	1.83E-02	2.78E-02		3.99E-04	±	1.73E-02	2.63E-02
8/6/2019 -	8/13/2019		-4.86E-03	±	1.69E-02	2.52E-02		-4.66E-03	±	1.62E-02	2.42E-02
8/13/2019 -	8/20/2019		1.17E-03	±	1.40E-02	2.13E-02		1.11E-03	±	1.32E-02	2.02E-02
8/20/2019 -	8/27/2019		6.68E-03	±	1.10E-02	1.62E-02		6.33E-03	±	1.05E-02	1.53E-02
8/27/2019 -	9/3/2019		1.05E-03	±	1.08E-02	1.67E-02		1.01E-03	±	1.04E-02	1.61E-02
9/3/2019 -	9/10/2019		-6.36E-03	±	1.42E-02	2.10E-02		-6.23E-03	±	1.39E-02	2.06E-02
9/10/2019 -	9/17/2019		2.28E-04	±	1.21E-02	1.87E-02		2.29E-04	±	1.21E-02	1.87E-02
9/17/2019 -	9/24/2019		-7.76E-03	±	1.51E-02	2.21E-02		-7.91E-03	±	1.54E-02	2.25E-02
9/24/2019 -	10/1/2019		-7.90E-03	±	1.53E-02	2.24E-02		-8.02E-03	±	1.56E-02	2.28E-02
10/1/2019 -	10/8/2019		-1.77E-03	±	1.23E-02	1.87E-02		-1.86E-03	±	1.28E-02	1.95E-02
10/8/2019 -	10/15/2019		3.49E-03	±	1.29E-02	1.94E-02		3.59E-03	±	1.33E-02	2.00E-02
10/15/2019 -	10/22/2019		-2.93E-03	±	1.26E-02	1.90E-02		-2.95E-03	±	1.27E-02	1.91E-02
10/22/2019 -	10/29/2019		-2.86E-03	±	1.39E-02	2.09E-02		-2.89E-03	±	1.40E-02	2.11E-02
10/29/2019 -	11/5/2019		3.79E-03	±	1.38E-02	2.06E-02		3.85E-03	±	1.40E-02	2.09E-02
11/5/2019 -	11/12/2019		3.13E-03	±	1.14E-02	1.72E-02		3.22E-03	±	1.17E-02	1.77E-02
11/12/2019 -	11/19/2019		-4.31E-03	±	1.78E-02	2.66E-02		-4.27E-03	±	1.76E-02	2.64E-02
11/19/2019 -	11/26/2019		-8.01E-04	±	1.14E-02	1.76E-02		-8.69E-04	±	1.24E-02	1.91E-02
11/26/2019 -	12/3/2019		-5.09E-03	±	1.41E-02	2.10E-02		-5.25E-03	±	1.46E-02	2.16E-02
12/3/2019 -	12/10/2019		-5.50E-04	±	1.13E-02	1.75E-02		-5.61E-04	±	1.16E-02	1.78E-02
12/10/2019 -	12/17/2019		-1.31E-03	±	1.10E-02	1.69E-02		-1.34E-03	±	1.12E-02	1.72E-02
12/17/2019 -	12/23/2019		-5.44E-03	±	1.44E-02	2.14E-02		-5.68E-03	±	1.50E-02	2.23E-02
12/23/2019 -	12/31/2019		-1.11E-03	±	1.69E-02	2.57E-02		-1.17E-03	±	1.79E-02	2.72E-02

RQ= Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-4.1
GAMMA SPECTROMETRY RESULTS OF IODINE-131 ON CHARCOAL FILTERS

Results in pCi/cubic meter, corrected for decay during collection period

Collection	Period	Station 5				Station 6					
		RQ	Activity	Error	MDA	RQ	Activity	Error	MDA		
1/2/2019 -	1/8/2019		4.15E-03	±	1.30E-02	1.92E-02		3.94E-03	±	1.24E-02	1.82E-02
1/8/2019 -	1/15/2019		3.08E-03	±	1.17E-02	1.72E-02		2.94E-03	±	1.12E-02	1.65E-02
1/15/2019 -	1/22/2019		3.31E-04	±	1.21E-02	1.82E-02		3.15E-04	±	1.15E-02	1.74E-02
1/22/2019 -	1/29/2019		8.40E-03	±	1.15E-02	1.61E-02		8.08E-03	±	1.11E-02	1.55E-02
1/29/2019 -	2/6/2019		3.10E-03	±	1.24E-02	1.81E-02		2.96E-03	±	1.18E-02	1.73E-02
2/6/2019 -	2/12/2019		8.72E-03	±	1.47E-02	2.09E-02		7.84E-03	±	1.32E-02	1.88E-02
2/12/2019 -	2/19/2019		0.00E+00	±	5.78E-03	2.83E-02		0.00E+00	±	5.59E-03	2.74E-02
2/19/2019 -	2/26/2019		4.42E-03	±	1.28E-02	1.87E-02		3.89E-03	±	1.13E-02	1.65E-02
2/26/2019 -	3/5/2019		-7.87E-03	±	1.99E-02	2.83E-02		-7.84E-03	±	1.98E-02	2.81E-02
3/5/2019 -	3/12/2019		-3.05E-03	±	1.62E-02	2.37E-02		-2.83E-03	±	1.50E-02	2.20E-02
3/12/2019 -	3/19/2019		3.71E-03	±	1.48E-02	2.17E-02		3.36E-03	±	1.34E-02	1.96E-02
3/19/2019 -	3/26/2019		-4.83E-03	±	1.14E-02	1.70E-02		-4.41E-03	±	1.04E-02	1.55E-02
3/26/2019 -	4/2/2019		1.32E-03	±	9.11E-03	1.43E-02		1.19E-03	±	8.22E-03	1.29E-02
4/2/2019 -	4/9/2019		8.96E-04	±	1.00E-02	1.57E-02		7.97E-04	±	8.91E-03	1.39E-02
4/9/2019 -	4/16/2019		8.36E-03	±	9.25E-03	1.31E-02		7.98E-03	±	8.83E-03	1.25E-02
4/16/2019 -	4/23/2019		-2.93E-03	±	1.24E-02	1.88E-02		-2.67E-03	±	1.13E-02	1.71E-02
4/23/2019 -	4/30/2019		-2.75E-03	±	1.05E-02	1.60E-02		-2.49E-03	±	9.49E-03	1.45E-02
4/30/2019 -	5/7/2019		6.05E-03	±	8.54E-03	1.25E-02		5.60E-03	±	7.90E-03	1.15E-02
5/7/2019 -	5/14/2019		8.40E-04	±	9.96E-03	1.57E-02		7.77E-04	±	9.22E-03	1.45E-02
5/14/2019 -	5/21/2019		-6.52E-03	±	1.50E-02	2.22E-02		-5.96E-03	±	1.38E-02	2.03E-02
5/21/2019 -	5/28/2019		-1.40E-03	±	1.40E-02	2.14E-02		-1.27E-03	±	1.27E-02	1.95E-02
5/28/2019 -	6/4/2019		3.91E-03	±	1.18E-02	1.78E-02		4.11E-03	±	1.24E-02	1.87E-02
6/4/2019 -	6/11/2019		5.27E-03	±	1.04E-02	1.55E-02		5.45E-03	±	1.08E-02	1.60E-02
6/11/2019 -	6/18/2019		2.35E-03	±	1.09E-02	1.66E-02		2.45E-03	±	1.14E-02	1.74E-02
6/18/2019 -	6/25/2019		-3.42E-03	±	1.38E-02	2.07E-02		-3.54E-03	±	1.43E-02	2.14E-02
6/25/2019 -	7/2/2019		5.13E-03	±	9.69E-03	1.44E-02		5.24E-03	±	9.89E-03	1.47E-02
7/2/2019 -	7/9/2019		-8.26E-03	±	1.60E-02	2.34E-02		-8.53E-03	±	1.65E-02	2.42E-02
7/9/2019 -	7/16/2019		6.98E-04	±	1.31E-02	2.01E-02		7.14E-04	±	1.34E-02	2.06E-02
7/16/2019 -	7/23/2019		1.17E-04	±	1.31E-02	2.02E-02		1.19E-04	±	1.33E-02	2.05E-02
7/23/2019 -	7/30/2019		-2.77E-03	±	1.32E-02	2.00E-02		-2.87E-03	±	1.37E-02	2.07E-02
7/30/2019 -	8/6/2019		4.14E-04	±	1.79E-02	2.73E-02		4.25E-04	±	1.84E-02	2.80E-02
8/6/2019 -	8/13/2019		-4.83E-03	±	1.67E-02	2.50E-02		-4.94E-03	±	1.71E-02	2.56E-02
8/13/2019 -	8/20/2019		1.16E-03	±	1.38E-02	2.10E-02		1.19E-03	±	1.42E-02	2.16E-02
8/20/2019 -	8/27/2019		6.44E-03	±	1.06E-02	1.56E-02		6.71E-03	±	1.11E-02	1.63E-02
8/27/2019 -	9/3/2019		1.04E-03	±	1.07E-02	1.66E-02		1.06E-03	±	1.09E-02	1.68E-02
9/3/2019 -	9/10/2019		-6.22E-03	±	1.39E-02	2.05E-02		-6.53E-03	±	1.46E-02	2.16E-02
9/10/2019 -	9/17/2019		2.25E-04	±	1.19E-02	1.84E-02		2.31E-04	±	1.22E-02	1.89E-02
9/17/2019 -	9/24/2019		-7.61E-03	±	1.48E-02	2.17E-02		-7.58E-03	±	1.47E-02	2.16E-02
9/24/2019 -	10/1/2019		-7.92E-03	±	1.54E-02	2.25E-02		-8.55E-03	±	1.66E-02	2.43E-02
10/1/2019 -	10/8/2019		-1.77E-03	±	1.23E-02	1.87E-02		-1.82E-03	±	1.26E-02	1.91E-02
10/8/2019 -	10/15/2019		3.47E-03	±	1.29E-02	1.94E-02		3.56E-03	±	1.32E-02	1.99E-02
10/15/2019 -	10/22/2019		-2.91E-03	±	1.25E-02	1.88E-02		-2.94E-03	±	1.26E-02	1.91E-02
10/22/2019 -	10/29/2019		-2.80E-03	±	1.36E-02	2.05E-02		-2.80E-03	±	1.36E-02	2.05E-02
10/29/2019 -	11/5/2019		3.75E-03	±	1.36E-02	2.03E-02		3.73E-03	±	1.36E-02	2.02E-02
11/5/2019 -	11/12/2019		4.33E-03	±	1.58E-02	2.39E-02		3.15E-03	±	1.15E-02	1.73E-02
11/12/2019 -	11/19/2019		-4.20E-03	±	1.73E-02	2.59E-02		-4.18E-03	±	1.73E-02	2.58E-02
11/19/2019 -	11/26/2019		-7.91E-04	±	1.13E-02	1.74E-02		-8.38E-04	±	1.19E-02	1.84E-02
11/26/2019 -	12/3/2019		-4.99E-03	±	1.39E-02	2.06E-02		-5.10E-03	±	1.42E-02	2.10E-02
12/3/2019 -	12/10/2019		-5.40E-04	±	1.11E-02	1.72E-02		-5.50E-04	±	1.13E-02	1.75E-02
12/10/2019 -	12/17/2019		-1.29E-03	±	1.08E-02	1.66E-02		-1.31E-03	±	1.10E-02	1.69E-02
12/17/2019 -	12/23/2019		-5.37E-03	±	1.42E-02	2.11E-02		-5.52E-03	±	1.46E-02	2.17E-02
12/23/2019 -	12/31/2019		-1.09E-03	±	1.66E-02	2.52E-02		-1.12E-03	±	1.71E-02	2.60E-02

RQ= Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-4.1
GAMMA SPECTROMETRY RESULTS OF IODINE-131 ON CHARCOAL FILTERS

Results in pCi/cubic meter, corrected for decay during collection period

Collection	Period	Station 7				Station 8			
		RQ	Activity	Error	MDA	RQ	Activity	Error	MDA
1/2/2019 -	1/8/2019	6.61E-03	±	1.07E-02	1.53E-02	7.12E-03	±	1.15E-02	1.65E-02
1/8/2019 -	1/15/2019	1.29E-02	±	1.20E-02	1.61E-02	1.39E-02	±	1.28E-02	1.73E-02
1/15/2019 -	1/22/2019	3.64E-03	±	1.24E-02	1.82E-02	3.88E-03	±	1.32E-02	1.94E-02
1/22/2019 -	1/29/2019	6.65E-03	±	1.38E-02	1.98E-02	7.12E-03	±	1.48E-02	2.12E-02
1/29/2019 -	2/6/2019	4.43E-03	±	1.42E-02	2.06E-02	4.86E-03	±	1.56E-02	2.26E-02
2/6/2019 -	2/12/2019	8.21E-03	±	1.39E-02	1.97E-02	0.00E+00	±	4.31E-03	3.16E-02
2/12/2019 -	2/19/2019	4.42E-03	±	1.64E-02	2.37E-02	4.75E-03	±	1.75E-02	2.54E-02
2/19/2019 -	2/26/2019	-9.88E-03	±	1.86E-02	2.62E-02	-1.14E-02	±	2.14E-02	3.02E-02
2/26/2019 -	3/5/2019	4.54E-03	±	1.12E-02	1.64E-02	4.87E-03	±	1.20E-02	1.76E-02
3/5/2019 -	3/12/2019	-1.05E-03	±	1.66E-02	2.45E-02	-1.17E-03	±	1.84E-02	2.71E-02
3/12/2019 -	3/19/2019	-3.54E-03	±	1.53E-02	2.23E-02	-3.82E-03	±	1.65E-02	2.41E-02
3/19/2019 -	3/26/2019	-1.54E-03	±	1.21E-02	1.85E-02	-1.64E-03	±	1.29E-02	1.97E-02
3/26/2019 -	4/2/2019	-5.80E-03	±	1.23E-02	1.83E-02	-6.20E-03	±	1.32E-02	1.95E-02
4/2/2019 -	4/9/2019	-3.08E-03	±	1.13E-02	1.71E-02	-3.19E-03	±	1.17E-02	1.77E-02
4/9/2019 -	4/16/2019	-4.41E-03	±	1.10E-02	1.65E-02	-4.58E-03	±	1.15E-02	1.72E-02
4/16/2019 -	4/23/2019	2.82E-03	±	8.63E-03	1.32E-02	3.30E-03	±	1.01E-02	1.54E-02
4/23/2019 -	4/30/2019	1.67E-03	±	7.78E-03	1.22E-02	1.84E-03	±	8.59E-03	1.35E-02
4/30/2019 -	5/7/2019	3.84E-03	±	1.05E-02	1.58E-02	4.10E-03	±	1.12E-02	1.69E-02
5/7/2019 -	5/14/2019	4.09E-03	±	8.04E-03	1.21E-02	4.26E-03	±	8.38E-03	1.26E-02
5/14/2019 -	5/21/2019	3.91E-03	±	1.33E-02	2.00E-02	4.05E-03	±	1.38E-02	2.08E-02
5/21/2019 -	5/28/2019	5.03E-03	±	1.00E-02	1.50E-02	5.18E-03	±	1.03E-02	1.55E-02
5/28/2019 -	6/4/2019	-4.40E-03	±	1.33E-02	2.00E-02	-3.81E-03	±	1.15E-02	1.73E-02
6/4/2019 -	6/11/2019	-8.41E-03	±	1.69E-02	2.48E-02	-7.19E-03	±	1.45E-02	2.12E-02
6/11/2019 -	6/18/2019	-7.38E-03	±	1.45E-02	2.13E-02	-6.32E-03	±	1.24E-02	1.82E-02
6/18/2019 -	6/25/2019	7.98E-04	±	1.22E-02	1.87E-02	7.76E-04	±	1.18E-02	1.82E-02
6/25/2019 -	7/2/2019	-2.33E-04	±	1.16E-02	1.79E-02	-2.20E-04	±	1.09E-02	1.69E-02
7/2/2019 -	7/9/2019	3.28E-03	±	1.19E-02	1.81E-02	3.08E-03	±	1.12E-02	1.70E-02
7/9/2019 -	7/16/2019	2.89E-03	±	1.28E-02	1.94E-02	2.73E-03	±	1.20E-02	1.83E-02
7/16/2019 -	7/23/2019	4.59E-03	±	1.39E-02	2.08E-02	4.31E-03	±	1.31E-02	1.96E-02
7/23/2019 -	7/30/2019	2.63E-03	±	1.08E-02	1.65E-02	2.47E-03	±	1.02E-02	1.55E-02
7/30/2019 -	8/6/2019	-7.08E-03	±	1.89E-02	2.80E-02	-6.51E-03	±	1.74E-02	2.57E-02
8/6/2019 -	8/13/2019	1.31E-03	±	1.61E-02	2.46E-02	1.19E-03	±	1.46E-02	2.23E-02
8/13/2019 -	8/20/2019	-8.17E-03	±	1.59E-02	2.33E-02	-7.31E-03	±	1.42E-02	2.09E-02
8/20/2019 -	8/27/2019	1.27E-03	±	1.32E-02	2.02E-02	1.12E-03	±	1.16E-02	1.78E-02
8/27/2019 -	9/3/2019	-5.57E-03	±	1.47E-02	2.19E-02	-5.00E-03	±	1.32E-02	1.97E-02
9/3/2019 -	9/10/2019	4.92E-03	±	1.18E-02	1.76E-02	4.81E-03	±	1.16E-02	1.72E-02
9/10/2019 -	9/17/2019	-3.97E-03	±	1.35E-02	2.02E-02	-3.73E-03	±	1.26E-02	1.90E-02
9/17/2019 -	9/24/2019	1.73E-03	±	1.37E-02	2.08E-02	1.63E-03	±	1.29E-02	1.97E-02
9/24/2019 -	10/1/2019	2.08E-03	±	1.17E-02	1.78E-02	1.98E-03	±	1.11E-02	1.69E-02
10/1/2019 -	10/8/2019	2.77E-03	±	1.09E-02	1.66E-02	2.60E-03	±	1.02E-02	1.55E-02
10/8/2019 -	10/15/2019	5.65E-03	±	1.11E-02	1.65E-02	5.31E-03	±	1.05E-02	1.55E-02
10/15/2019 -	10/22/2019	1.49E-03	±	1.11E-02	1.71E-02	1.41E-03	±	1.05E-02	1.63E-02
10/22/2019 -	10/29/2019	2.75E-03	±	9.98E-03	1.52E-02	2.63E-03	±	9.54E-03	1.45E-02
10/29/2019 -	11/5/2019	-5.79E-03	±	1.37E-02	2.03E-02	-5.46E-03	±	1.30E-02	1.91E-02
11/5/2019 -	11/12/2019	-7.34E-03	±	1.67E-02	2.46E-02	-6.79E-03	±	1.55E-02	2.28E-02
11/12/2019 -	11/19/2019	-3.81E-03	±	1.66E-02	2.50E-02	-3.43E-03	±	1.50E-02	2.25E-02
11/19/2019 -	11/26/2019	-4.53E-03	±	1.62E-02	2.42E-02	-3.91E-03	±	1.40E-02	2.09E-02
11/26/2019 -	12/3/2019	-6.18E-03	±	1.61E-02	2.39E-02	-5.26E-03	±	1.37E-02	2.03E-02
12/3/2019 -	12/10/2019	2.02E-03	±	1.07E-02	1.64E-02	1.76E-03	±	9.31E-03	1.43E-02
12/10/2019 -	12/17/2019	3.76E-03	±	1.32E-02	1.99E-02	3.11E-03	±	1.09E-02	1.65E-02
12/17/2019 -	12/23/2019	6.48E-03	±	1.42E-02	2.12E-02	5.18E-03	±	1.14E-02	1.69E-02
12/23/2019 -	12/31/2019	4.47E-03	±	1.52E-02	2.29E-02	4.21E-03	±	1.43E-02	2.16E-02

RQ= Results Qualifer. If blank, result is less than detection limit. If "+", result is above detection limit.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-4.1
GAMMA SPECTROMETRY RESULTS OF IODINE-131 ON CHARCOAL FILTERS

Results in pCi/cubic meter, corrected for decay during collection period

Collection	Period	Station 9				Station 21B					
		RQ	Activity	Error	MDA	RQ	Activity	Error	MDA		
1/2/2019 -	1/8/2019		6.29E-03	±	1.02E-02	1.46E-02		6.72E-03	±	1.09E-02	1.56E-02
1/8/2019 -	1/15/2019		1.22E-02	±	1.13E-02	1.52E-02		1.32E-02	±	1.22E-02	1.63E-02
1/15/2019 -	1/22/2019		3.44E-03	±	1.18E-02	1.73E-02		3.69E-03	±	1.26E-02	1.85E-02
1/22/2019 -	1/29/2019		6.24E-03	±	1.30E-02	1.86E-02		6.75E-03	±	1.40E-02	2.01E-02
1/29/2019 -	2/6/2019		4.18E-03	±	1.34E-02	1.94E-02		4.55E-03	±	1.46E-02	2.11E-02
2/6/2019 -	2/12/2019		0.00E+00	±	3.71E-03	2.72E-02		0.00E+00	±	3.80E-03	2.78E-02
2/12/2019 -	2/19/2019		4.01E-03	±	1.48E-02	2.15E-02		4.64E-03	±	1.71E-02	2.48E-02
2/19/2019 -	2/26/2019		-9.64E-03	±	1.82E-02	2.56E-02		-1.03E-02	±	1.94E-02	2.73E-02
2/26/2019 -	3/5/2019		4.08E-03	±	1.01E-02	1.47E-02		4.65E-03	±	1.15E-02	1.68E-02
3/5/2019 -	3/12/2019		-9.75E-04	±	1.53E-02	2.26E-02		-1.09E-03	±	1.71E-02	2.52E-02
3/12/2019 -	3/19/2019		-3.29E-03	±	1.42E-02	2.08E-02		-3.68E-03	±	1.59E-02	2.32E-02
3/19/2019 -	3/26/2019		-1.42E-03	±	1.12E-02	1.71E-02		-1.59E-03	±	1.25E-02	1.92E-02
3/26/2019 -	4/2/2019		-5.33E-03	±	1.13E-02	1.68E-02		-6.02E-03	±	1.28E-02	1.90E-02
4/2/2019 -	4/9/2019		-2.80E-03	±	1.03E-02	1.56E-02		-3.12E-03	±	1.14E-02	1.73E-02
4/9/2019 -	4/16/2019		-4.09E-03	±	1.02E-02	1.53E-02		-4.53E-03	±	1.13E-02	1.70E-02
4/16/2019 -	4/23/2019		3.03E-03	±	9.28E-03	1.42E-02		2.91E-03	±	8.91E-03	1.36E-02
4/23/2019 -	4/30/2019		1.69E-03	±	7.89E-03	1.24E-02		1.66E-03	±	7.74E-03	1.21E-02
4/30/2019 -	5/7/2019		3.76E-03	±	1.03E-02	1.55E-02		3.76E-03	±	1.03E-02	1.55E-02
5/7/2019 -	5/14/2019		3.94E-03	±	7.74E-03	1.17E-02		3.89E-03	±	7.65E-03	1.15E-02
5/14/2019 -	5/21/2019		3.64E-03	±	1.24E-02	1.86E-02		3.70E-03	±	1.26E-02	1.89E-02
5/21/2019 -	5/28/2019		4.72E-03	±	9.42E-03	1.41E-02		4.63E-03	±	9.26E-03	1.38E-02
5/28/2019 -	6/4/2019		-4.16E-03	±	1.26E-02	1.89E-02		-4.02E-03	±	1.22E-02	1.83E-02
6/4/2019 -	6/11/2019		-8.01E-03	±	1.61E-02	2.36E-02		-7.68E-03	±	1.55E-02	2.27E-02
6/11/2019 -	6/18/2019		-7.03E-03	±	1.38E-02	2.02E-02		-6.82E-03	±	1.33E-02	1.96E-02
6/18/2019 -	6/25/2019		8.62E-04	±	1.31E-02	2.02E-02		8.30E-04	±	1.26E-02	1.94E-02
6/25/2019 -	7/2/2019		-2.49E-04	±	1.24E-02	1.92E-02		-2.34E-04	±	1.16E-02	1.80E-02
7/2/2019 -	7/9/2019		3.51E-03	±	1.28E-02	1.93E-02		3.26E-03	±	1.19E-02	1.79E-02
7/9/2019 -	7/16/2019		2.72E-03	±	1.20E-02	1.82E-02		2.85E-03	±	1.26E-02	1.91E-02
7/16/2019 -	7/23/2019		4.31E-03	±	1.31E-02	1.96E-02		4.52E-03	±	1.37E-02	2.05E-02
7/23/2019 -	7/30/2019		2.50E-03	±	1.03E-02	1.57E-02		2.61E-03	±	1.07E-02	1.64E-02
7/30/2019 -	8/6/2019		-6.64E-03	±	1.77E-02	2.62E-02		-6.78E-03	±	1.81E-02	2.68E-02
8/6/2019 -	8/13/2019		1.22E-03	±	1.49E-02	2.28E-02		1.25E-03	±	1.52E-02	2.33E-02
8/13/2019 -	8/20/2019		-7.44E-03	±	1.45E-02	2.12E-02		-7.60E-03	±	1.48E-02	2.17E-02
8/20/2019 -	8/27/2019		1.16E-03	±	1.20E-02	1.84E-02		1.16E-03	±	1.20E-02	1.84E-02
8/27/2019 -	9/3/2019		-5.15E-03	±	1.36E-02	2.03E-02		-5.09E-03	±	1.35E-02	2.00E-02
9/3/2019 -	9/10/2019		5.06E-03	±	1.22E-02	1.82E-02		4.95E-03	±	1.19E-02	1.78E-02
9/10/2019 -	9/17/2019		-3.99E-03	±	1.35E-02	2.03E-02		-3.90E-03	±	1.32E-02	1.98E-02
9/17/2019 -	9/24/2019		1.76E-03	±	1.39E-02	2.11E-02		1.71E-03	±	1.35E-02	2.06E-02
9/24/2019 -	10/1/2019		2.16E-03	±	1.21E-02	1.85E-02		1.73E-03	±	9.70E-03	1.48E-02
10/1/2019 -	10/8/2019		2.87E-03	±	1.13E-02	1.72E-02		2.71E-03	±	1.06E-02	1.62E-02
10/8/2019 -	10/15/2019		6.00E-03	±	1.18E-02	1.75E-02		5.61E-03	±	1.11E-02	1.64E-02
10/15/2019 -	10/22/2019		1.63E-03	±	1.21E-02	1.87E-02		1.45E-03	±	1.08E-02	1.67E-02
10/22/2019 -	10/29/2019		2.99E-03	±	1.08E-02	1.65E-02		2.82E-03	±	1.02E-02	1.56E-02
10/29/2019 -	11/5/2019		-6.27E-03	±	1.49E-02	2.20E-02		-5.85E-03	±	1.39E-02	2.05E-02
11/5/2019 -	11/12/2019		-7.99E-03	±	1.82E-02	2.68E-02		-7.01E-03	±	1.60E-02	2.35E-02
11/12/2019 -	11/19/2019		-4.17E-03	±	1.82E-02	2.74E-02		-3.57E-03	±	1.56E-02	2.35E-02
11/19/2019 -	11/26/2019		-4.07E-03	±	1.46E-02	2.17E-02		-4.19E-03	±	1.50E-02	2.24E-02
11/26/2019 -	12/3/2019		-5.48E-03	±	1.43E-02	2.12E-02		-5.60E-03	±	1.46E-02	2.17E-02
12/3/2019 -	12/10/2019		1.84E-03	±	9.69E-03	1.49E-02		1.85E-03	±	9.78E-03	1.51E-02
12/10/2019 -	12/17/2019		3.23E-03	±	1.14E-02	1.71E-02		3.24E-03	±	1.14E-02	1.72E-02
12/17/2019 -	12/23/2019		5.50E-03	±	1.21E-02	1.80E-02		5.41E-03	±	1.19E-02	1.77E-02
12/23/2019 -	12/31/2019		4.56E-03	±	1.55E-02	2.34E-02		4.39E-03	±	1.50E-02	2.25E-02

RQ= Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-4.1
GAMMA SPECTROMETRY RESULTS OF IODINE-131 ON CHARCOAL FILTERS

Results in pCi/cubic meter, corrected for decay during collection period

Collection	Period	Station 23				Station 40			
		RQ	Activity	Error	MDA	RQ	Activity	Error	MDA
1/2/2019 -	1/8/2019	-5.06E-03	±	1.57E-02	2.27E-02	-5.05E-03	±	1.56E-02	2.27E-02
1/8/2019 -	1/15/2019	1.15E-03	±	1.19E-02	1.80E-02	1.12E-03	±	1.17E-02	1.76E-02
1/15/2019 -	1/22/2019	5.04E-03	±	1.18E-02	1.72E-02	4.99E-03	±	1.17E-02	1.70E-02
1/22/2019 -	1/29/2019	2.28E-03	±	1.21E-02	1.80E-02	2.27E-03	±	1.21E-02	1.79E-02
1/29/2019 -	2/6/2019	-9.88E-04	±	1.15E-02	1.71E-02	-9.82E-04	±	1.14E-02	1.70E-02
**2/6/2019 -	2/12/2019	-5.05E-03	±	1.25E-02	1.80E-02	0.00E+00	±	3.55E-03	2.60E-02
**2/12/2019 -	2/19/2019	-3.47E-03	±	3.00E-02	4.38E-02	-1.93E-03	±	1.67E-02	2.43E-02
2/19/2019 -	2/26/2019	-1.84E-03	±	1.32E-02	1.96E-02	-1.82E-03	±	1.31E-02	1.94E-02
2/26/2019 -	3/5/2019	3.23E-03	±	1.34E-02	1.98E-02	3.03E-03	±	1.26E-02	1.86E-02
3/5/2019 -	3/12/2019	-4.79E-03	±	1.43E-02	2.08E-02	-4.67E-03	±	1.39E-02	2.03E-02
3/12/2019 -	3/19/2019	4.42E-03	±	1.38E-02	2.02E-02	4.23E-03	±	1.32E-02	1.93E-02
3/19/2019 -	3/26/2019	9.35E-03	±	6.76E-03	1.40E-02	8.96E-03	±	6.48E-03	1.40E-02
3/26/2019 -	4/2/2019	-3.61E-03	±	1.35E-02	2.04E-02	-3.43E-03	±	1.29E-02	1.94E-02
4/2/2019 -	4/9/2019	7.51E-03	±	7.16E-03	9.80E-03	7.15E-03	±	6.82E-03	9.32E-03
4/9/2019 -	4/16/2019	1.50E-03	±	1.02E-02	1.60E-02	1.41E-03	±	9.61E-03	1.50E-02
4/16/2019 -	4/23/2019	0.00E+00	±	2.72E-03	1.95E-02	0.00E+00	±	2.82E-03	2.02E-02
4/23/2019 -	4/30/2019	8.70E-04	±	2.36E-03	5.40E-03	9.18E-04	±	2.49E-03	5.70E-03
4/30/2019 -	5/7/2019	5.45E-04	±	2.41E-03	5.88E-03	5.77E-04	±	2.55E-03	6.22E-03
5/7/2019 -	5/14/2019	5.85E-03	±	6.45E-03	9.08E-03	6.20E-03	±	6.84E-03	9.62E-03
5/14/2019 -	5/21/2019	3.44E-03	±	1.10E-02	1.66E-02	3.66E-03	±	1.16E-02	1.76E-02
5/21/2019 -	5/28/2019	-9.51E-04	±	1.27E-02	1.95E-02	-1.02E-03	±	1.36E-02	2.10E-02
5/28/2019 -	6/4/2019	1.03E-02	±	1.02E-02	1.43E-02	1.09E-02	±	1.09E-02	1.52E-02
6/4/2019 -	6/11/2019	-7.52E-03	±	1.46E-02	2.14E-02	-8.11E-03	±	1.58E-02	2.31E-02
6/11/2019 -	6/18/2019	-3.93E-03	±	1.19E-02	1.79E-02	-4.19E-03	±	1.27E-02	1.90E-02
6/18/2019 -	6/25/2019	-2.53E-03	±	1.34E-02	2.03E-02	-2.68E-03	±	1.42E-02	2.15E-02
6/25/2019 -	7/2/2019	2.96E-03	±	1.30E-02	1.97E-02	3.01E-03	±	1.33E-02	2.00E-02
7/2/2019 -	7/9/2019	4.87E-03	±	9.59E-03	1.43E-02	5.00E-03	±	9.85E-03	1.47E-02
7/9/2019 -	7/16/2019	5.34E-03	±	1.37E-02	2.04E-02	5.47E-03	±	1.41E-02	2.09E-02
7/16/2019 -	7/23/2019	-3.80E-04	±	1.35E-02	2.08E-02	-3.89E-04	±	1.38E-02	2.13E-02
7/23/2019 -	7/30/2019	0.00E+00	±	2.26E-03	1.83E-02	0.00E+00	±	2.30E-03	1.87E-02
7/30/2019 -	8/6/2019	-4.14E-03	±	1.64E-02	2.47E-02	-4.33E-03	±	1.72E-02	2.58E-02
8/6/2019 -	8/13/2019	-1.43E-03	±	1.19E-02	1.84E-02	-1.51E-03	±	1.26E-02	1.94E-02
8/13/2019 -	8/20/2019	5.36E-03	±	1.52E-02	2.26E-02	5.58E-03	±	1.58E-02	2.36E-02
8/20/2019 -	8/27/2019	3.54E-03	±	1.08E-02	1.63E-02	3.70E-03	±	1.13E-02	1.71E-02
8/27/2019 -	9/3/2019	-1.22E-03	±	1.22E-02	1.87E-02	-1.31E-03	±	1.31E-02	2.00E-02
9/3/2019 -	9/10/2019	1.90E-03	±	1.20E-02	1.83E-02	1.98E-03	±	1.25E-02	1.90E-02
9/10/2019 -	9/17/2019	-1.45E-03	±	1.20E-02	1.83E-02	-1.48E-03	±	1.22E-02	1.87E-02
9/17/2019 -	9/24/2019	-7.18E-03	±	1.40E-02	2.06E-02	-7.35E-03	±	1.44E-02	2.11E-02
9/24/2019 -	10/1/2019	-5.67E-03	±	1.39E-02	2.06E-02	-5.64E-03	±	1.38E-02	2.05E-02
10/1/2019 -	10/8/2019	-6.25E-03	±	1.36E-02	2.00E-02	-6.02E-03	±	1.31E-02	1.93E-02
10/8/2019 -	10/15/2019	-1.78E-03	±	1.23E-02	1.88E-02	-1.70E-03	±	1.18E-02	1.80E-02
10/15/2019 -	10/22/2019	-3.02E-03	±	1.62E-02	2.44E-02	-2.82E-03	±	1.51E-02	2.27E-02
10/22/2019 -	10/29/2019	5.40E-03	±	1.19E-02	1.78E-02	4.89E-03	±	1.08E-02	1.61E-02
10/29/2019 -	11/5/2019	-5.53E-03	±	1.57E-02	2.33E-02	-5.07E-03	±	1.44E-02	2.13E-02
11/5/2019 -	11/12/2019	-8.45E-03	±	1.68E-02	2.48E-02	-7.53E-03	±	1.50E-02	2.21E-02
11/12/2019 -	11/19/2019	1.51E-03	±	1.33E-02	2.04E-02	1.30E-03	±	1.14E-02	1.76E-02
11/19/2019 -	11/26/2019	6.57E-03	±	1.07E-02	1.57E-02	6.75E-03	±	1.10E-02	1.62E-02
11/26/2019 -	12/3/2019	3.07E-03	±	1.41E-02	2.11E-02	3.11E-03	±	1.42E-02	2.14E-02
12/3/2019 -	12/10/2019	-2.47E-03	±	1.16E-02	1.76E-02	-2.48E-03	±	1.17E-02	1.77E-02
12/10/2019 -	12/17/2019	-5.73E-03	±	1.41E-02	2.08E-02	-5.69E-03	±	1.40E-02	2.07E-02
12/17/2019 -	12/23/2019	-3.53E-03	±	1.68E-02	2.54E-02	-3.47E-03	±	1.66E-02	2.50E-02
12/23/2019 -	12/31/2019	-4.48E-03	±	1.65E-02	2.48E-02	-4.44E-03	±	1.64E-02	2.46E-02

RQ= Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-4.1
GAMMA SPECTROMETRY RESULTS OF IODINE-131 ON CHARCOAL FILTERS

Results in pCi/cubic meter, corrected for decay during collection period

Collection	Period	Station 48				Station 57			
		RQ	Activity	Error	MDA	RQ	Activity	Error	MDA
1/2/2019 -	1/8/2019	-4.99E-03	±	1.54E-02	2.24E-02	-4.85E-03	±	1.50E-02	2.18E-02
1/8/2019 -	1/15/2019	1.11E-03	±	1.16E-02	1.75E-02	1.11E-03	±	1.16E-02	1.75E-02
1/15/2019 -	1/22/2019	4.90E-03	±	1.15E-02	1.67E-02	5.00E-03	±	1.18E-02	1.71E-02
1/22/2019 -	1/29/2019	2.22E-03	±	1.18E-02	1.75E-02	2.26E-03	±	1.20E-02	1.78E-02
1/29/2019 -	2/6/2019	-9.59E-04	±	1.11E-02	1.66E-02	-9.82E-04	±	1.14E-02	1.70E-02
2/6/2019 -	2/12/2019	5.84E-03	±	1.40E-02	2.03E-02	5.86E-03	±	1.41E-02	2.04E-02
2/12/2019 -	2/19/2019	-1.95E-03	±	1.69E-02	2.47E-02	-2.07E-03	±	1.79E-02	2.61E-02
2/19/2019 -	2/26/2019	-1.81E-03	±	1.30E-02	1.93E-02	-1.78E-03	±	1.28E-02	1.90E-02
2/26/2019 -	3/5/2019	2.99E-03	±	1.24E-02	1.83E-02	3.12E-03	±	1.29E-02	1.91E-02
3/5/2019 -	3/12/2019	-4.57E-03	±	1.36E-02	1.98E-02	-4.37E-03	±	1.30E-02	1.90E-02
3/12/2019 -	3/19/2019	4.20E-03	±	1.31E-02	1.92E-02	4.06E-03	±	1.27E-02	1.85E-02
3/19/2019 -	3/26/2019	9.00E-03	±	6.51E-03	1.40E-02	8.83E-03	±	6.39E-03	1.40E-02
3/26/2019 -	4/2/2019	-3.48E-03	±	1.30E-02	1.97E-02	-3.37E-03	±	1.26E-02	1.91E-02
4/2/2019 -	4/9/2019	7.12E-03	±	6.79E-03	9.28E-03	6.98E-03	±	6.66E-03	9.10E-03
4/9/2019 -	4/16/2019	1.39E-03	±	9.50E-03	1.48E-02	1.36E-03	±	9.28E-03	1.45E-02
4/16/2019 -	4/23/2019	0.00E+00	±	2.80E-03	2.00E-02	0.00E+00	±	2.72E-03	1.95E-02
4/23/2019 -	4/30/2019	9.20E-04	±	2.50E-03	5.71E-03	8.94E-04	±	2.43E-03	5.55E-03
4/30/2019 -	5/7/2019	5.87E-04	±	2.60E-03	6.33E-03	5.81E-04	±	2.57E-03	6.26E-03
5/7/2019 -	5/14/2019	6.25E-03	±	6.89E-03	9.70E-03	6.31E-03	±	6.96E-03	9.79E-03
5/14/2019 -	5/21/2019	3.66E-03	±	1.16E-02	1.76E-02	3.77E-03	±	1.20E-02	1.81E-02
5/21/2019 -	5/28/2019	-1.02E-03	±	1.35E-02	2.08E-02	-9.69E-04	±	1.29E-02	1.98E-02
5/28/2019 -	6/4/2019	1.09E-02	±	1.09E-02	1.52E-02	1.07E-02	±	1.06E-02	1.49E-02
6/4/2019 -	6/11/2019	-8.09E-03	±	1.57E-02	2.30E-02	-7.85E-03	±	1.53E-02	2.24E-02
6/11/2019 -	6/18/2019	-4.19E-03	±	1.27E-02	1.90E-02	-4.13E-03	±	1.25E-02	1.88E-02
6/18/2019 -	6/25/2019	-2.54E-03	±	1.34E-02	2.04E-02	-2.67E-03	±	1.41E-02	2.14E-02
6/25/2019 -	7/2/2019	3.09E-03	±	1.36E-02	2.05E-02	3.15E-03	±	1.39E-02	2.10E-02
7/2/2019 -	7/9/2019	8.81E-03	±	1.74E-02	2.59E-02	5.23E-03	±	1.03E-02	1.53E-02
7/9/2019 -	7/16/2019	5.48E-03	±	1.41E-02	2.10E-02	5.66E-03	±	1.46E-02	2.17E-02
7/16/2019 -	7/23/2019	-4.02E-04	±	1.43E-02	2.20E-02	-4.06E-04	±	1.44E-02	2.22E-02
7/23/2019 -	7/30/2019	0.00E+00	±	2.37E-03	1.93E-02	0.00E+00	±	2.41E-03	1.96E-02
7/30/2019 -	8/6/2019	-4.45E-03	±	1.76E-02	2.65E-02	-4.58E-03	±	1.81E-02	2.73E-02
8/6/2019 -	8/13/2019	-1.54E-03	±	1.29E-02	1.98E-02	-1.58E-03	±	1.32E-02	2.03E-02
8/13/2019 -	8/20/2019	5.78E-03	±	1.64E-02	2.44E-02	5.97E-03	±	1.69E-02	2.52E-02
8/20/2019 -	8/27/2019	3.85E-03	±	1.17E-02	1.77E-02	4.04E-03	±	1.23E-02	1.86E-02
8/27/2019 -	9/3/2019	-1.35E-03	±	1.35E-02	2.06E-02	-1.41E-03	±	1.41E-02	2.16E-02
9/3/2019 -	9/10/2019	2.07E-03	±	1.31E-02	1.99E-02	1.87E-03	±	1.18E-02	1.80E-02
9/10/2019 -	9/17/2019	-1.58E-03	±	1.30E-02	1.99E-02	-1.44E-03	±	1.19E-02	1.82E-02
9/17/2019 -	9/24/2019	-7.84E-03	±	1.53E-02	2.25E-02	-7.23E-03	±	1.41E-02	2.08E-02
9/24/2019 -	10/1/2019	-6.16E-03	±	1.51E-02	2.24E-02	-5.49E-03	±	1.35E-02	1.99E-02
10/1/2019 -	10/8/2019	-6.70E-03	±	1.45E-02	2.14E-02	-6.03E-03	±	1.31E-02	1.93E-02
10/8/2019 -	10/15/2019	-1.90E-03	±	1.32E-02	2.01E-02	-1.70E-03	±	1.18E-02	1.80E-02
10/15/2019 -	10/22/2019	-3.18E-03	±	1.70E-02	2.57E-02	-2.88E-03	±	1.55E-02	2.33E-02
10/22/2019 -	10/29/2019	5.48E-03	±	1.21E-02	1.80E-02	5.05E-03	±	1.11E-02	1.66E-02
10/29/2019 -	11/5/2019	-5.70E-03	±	1.62E-02	2.40E-02	-5.19E-03	±	1.47E-02	2.18E-02
11/5/2019 -	11/12/2019	-8.61E-03	±	1.72E-02	2.52E-02	-8.01E-03	±	1.60E-02	2.35E-02
11/12/2019 -	11/19/2019	1.52E-03	±	1.34E-02	2.07E-02	1.46E-03	±	1.28E-02	1.98E-02
11/19/2019 -	11/26/2019	6.60E-03	±	1.08E-02	1.58E-02	7.48E-03	±	1.22E-02	1.79E-02
11/26/2019 -	12/3/2019	3.06E-03	±	1.40E-02	2.11E-02	3.58E-03	±	1.64E-02	2.46E-02
12/3/2019 -	12/10/2019	-2.50E-03	±	1.17E-02	1.78E-02	-2.94E-03	±	1.38E-02	2.10E-02
12/10/2019 -	12/17/2019	-5.83E-03	±	1.43E-02	2.12E-02	-6.01E-03	±	1.47E-02	2.18E-02
12/17/2019 -	12/23/2019	-3.55E-03	±	1.69E-02	2.56E-02	-3.81E-03	±	1.82E-02	2.74E-02
12/23/2019 -	12/31/2019	-4.57E-03	±	1.69E-02	2.53E-02	-5.10E-03	±	1.88E-02	2.83E-02

RQ= Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

**Collection Period for ST-1 and 23: 2/6/19-2/15/19 and 2/15/19-2/19/19 due to inclement weather.

TABLE A-4.2
GAMMA SPECTROMETRY RESULTS OF IODINE-131 ON CHARCOAL FILTERS - SUMMARY

Results in pCi per cubic meter, corrected for decay during collection period

Nuclide		Activity	Low	High	MDA	Samples	Positive IDs
I-131	Ind	5.61E-05	-1.14E-02	1.39E-02	1.92E-02	572	0
I-131	Cntl	3.26E-04	-9.64E-03	1.22E-02	1.91E-02	52	0

TABLE A-5.1
GROSS BETA IN WATER
Results in pCi per liter

Collection Period	ST- 26 River/Drinking Cntl				ST- 29 River/Drinking Ind			
	RQ	Activity	Error	MDA	RQ	Activity	Error	MDA
12/31/18 - 01/31/19		3.52E-01 ±	6.14E-01	2.15E+00		1.17E+00 ±	6.67E-01	2.16E+00
01/31/19 - 03/04/19		-1.14E-01 ±	6.32E-01	2.25E+00		1.42E-01 ±	6.27E-01	2.25E+00
03/04/19 - 04/01/19		-5.46E-03 ±	6.45E-01	2.33E+00		-2.78E-01 ±	6.81E-01	2.42E+00
04/01/19 - 05/01/19		-1.38E+00 ±	7.75E-01	2.48E+00		6.96E-01 ±	7.13E-01	2.43E+00
05/01/19 - 05/30/19		-8.56E-01 ±	6.42E-01	2.11E+00		3.73E-01 ±	6.07E-01	2.11E+00
05/30/19 - 07/01/19		-5.23E-02 ±	6.57E-01	2.36E+00		-1.31E-01 ±	6.63E-01	2.36E+00
07/01/19 - 07/31/19		4.94E-01 ±	5.87E-01	2.01E+00		8.09E-01 ±	6.10E-01	2.02E+00
07/31/19 - 08/29/19		4.17E-01 ±	6.59E-01	2.22E+00		1.76E-01 ±	6.58E-01	2.35E+00
08/29/19 - 10/01/19		3.61E-01 ±	4.27E-01	1.42E+00		1.80E+00 ±	6.47E-01	1.89E+00
10/01/19 - 11/04/19		-1.67E-01 ±	6.71E-01	2.38E+00		-4.29E-01 ±	6.83E-01	2.38E+00
11/04/19 - 12/02/19		-4.10E-01 ±	6.10E-01	2.11E+00		6.40E-01 ±	6.30E-01	2.10E+00
12/02/19 - 01/02/20		-5.78E-01 ±	6.11E-01	2.08E+00		-4.90E-01 ±	5.97E-01	2.07E+00

Collection Period	ST- 27 CW Discharge			
	RQ	Activity	Error	MDA
12/31/18 - 01/31/19	+	4.45E+00 ±	9.56E-01	2.55E+00
01/31/19 - 03/04/19	+	9.60E+00 ±	1.23E+00	2.65E+00
03/04/19 - 04/01/19	+	4.83E+00 ±	1.08E+00	2.94E+00
04/01/19 - 05/01/19	+	7.06E+00 ±	1.21E+00	2.99E+00
05/01/19 - 05/30/19		1.59E-01 ±	6.79E-01	2.34E+00
05/30/19 - 07/01/19		6.09E-01 ±	7.06E-01	2.41E+00
07/01/19 - 07/31/19	+	2.90E+00 ±	7.77E-01	2.17E+00
07/31/19 - 08/29/19	+	6.17E+00 ±	1.11E+00	2.74E+00
08/29/19 - 10/01/19	+	3.00E+00 ±	6.82E-01	1.72E+00
10/01/19 - 11/04/19	+	6.12E+00 ±	1.16E+00	3.00E+00
11/04/19 - 12/02/19		1.51E+00 ±	7.55E-01	2.34E+00
12/02/19 - 01/02/20		9.15E-01 ±	7.33E-01	2.38E+00

TABLE A-5.2
GROSS BETA IN WATER - SUMMARY
Results in pCi per liter

Location	Average Activity	Activity Low	Activity High	Number of Samples	Number of Positive IDs
					Positive
ST- 26 Control	-1.61E-01	-1.38E+00	4.94E-01	12	0
ST- 29 Indicator	3.73E-01	-4.90E-01	1.80E+00	12	0
ST- 27 Discharge	3.94E+00	1.59E-01	9.60E+00	12	8

TABLE A-6.1
TRITIUM IN WATER
 Results in pCi per liter, MDA for all samples is 300 pCi/l

Station	Description	Collection Period		RQ	Activity	Error
26	River/Drinking Control	12/31/18	-	04/01/19	1.68E+02	\pm 9.43E+01
		04/01/19	-	07/01/19	1.43E+02	\pm 8.97E+01
		07/01/19	-	10/01/19	6.87E+01	\pm 9.14E+01
		10/01/19	-	01/02/20	2.12E+02	\pm 9.24E+01
29	River/Drinking Indicator	12/31/18	-	04/01/19	9.87E+01	\pm 9.14E+01
		04/01/19	-	07/01/19	1.46E+02	\pm 8.96E+01
		07/01/19	-	10/01/19	1.09E+02	\pm 9.47E+01
		10/01/19	-	01/02/20	1.46E+02	\pm 9.18E+01
27	Plant Discharge	12/31/18	-	04/01/19	1.45E+02	\pm 9.32E+01
		04/01/19	-	07/01/19	1.51E+02	\pm 8.98E+01
		07/01/19	-	10/01/19	1.28E+02	\pm 9.47E+01
		10/01/19	-	01/02/20	1.65E+02	\pm 9.20E+01
31	Ground Water Well 1	03/06/19			-1.44E+02	\pm 9.36E+01
		06/03/19			1.82E+02	\pm 9.06E+01
		09/17/19			-2.14E+01	\pm 9.97E+01
		12/04/19			4.45E+01	\pm 8.59E+01
32	Ground Water Well 2	03/06/19			1.14E+02	\pm 8.90E+01
		06/03/19			9.29E+01	\pm 8.63E+01
		09/17/19			-2.08E+01	\pm 9.70E+01
		12/04/19			4.05E+01	\pm 8.84E+01
52	Ground Water Well 3	03/04/19			1.64E+02	\pm 9.32E+01
		06/03/19			1.47E+02	\pm 8.85E+01
		09/17/19			2.42E+01	\pm 9.79E+01
		12/05/19			1.48E+02	\pm 8.84E+01

TABLE A-6.2
TRITIUM IN WATER - Summary
 Results in pCi per liter

Location Description	Average Activity	Activity Low	Activity High	Number of Samples	Number of Positive IDs
River/Drinking Control	1.48E+02	6.87E+01	2.12E+02	4	0
River/Drinking Indicator	1.25E+02	9.87E+01	1.46E+02	4	0
Discharge Indicator	1.47E+02	1.28E+02	1.65E+02	4	0
Ground Water Indicator	6.43E+01	-1.44E+02	1.82E+02	12	0

Quarterly tritium values reported for ST-26, 27, and 29 are average of monthly analysis values.

RQ=Results Qualifier. If blank, result is less than detection limit. If "+", result is above the detection limit.

Table A-7.1
GAMMA SPECTROMETRY RESULTS OF RIVER/DRINKING WATER
Station 26 - Control Station 29 - Indicator
Results in pCi/liter, corrected for decay during collection period

Location ST-26 collected 1/31/2019					Location ST-26 collected 3/4/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		7.60E+01 ±	4.69E+01	9.92E+01	K-40		1.47E+01 ±	3.66E+01	5.19E+01
CR-51		-3.32E+01 ±	5.64E+01	7.91E+01	CR-51		1.78E+01 ±	2.69E+01	3.74E+01
MN-54		2.47E+00 ±	3.96E+00	5.20E+00	MN-54		8.59E-01 ±	2.89E+00	3.80E+00
CO-58		-1.41E+00 ±	5.63E+00	7.58E+00	CO-58		-8.12E-01 ±	3.22E+00	4.24E+00
FE-59		0.00E+00 ±	4.70E+00	2.23E+01	FE-59		1.29E-01 ±	9.49E+00	1.22E+01
CO-60		3.30E+00 ±	4.43E+00	5.50E+00	CO-60		3.55E-01 ±	2.35E+00	3.09E+00
ZN-65		-2.04E+00 ±	1.09E+01	1.45E+01	ZN-65		-6.03E-01 ±	5.96E+00	7.81E+00
ZRNB-95		5.03E+00 ±	6.67E+00	8.86E+00	ZRNB-95		1.98E+00 ±	5.14E+00	6.93E+00
I-131		6.28E+00 ±	1.38E+01	1.98E+01	I-131		1.06E+00 ±	7.09E+00	1.02E+01
CS-134		-9.50E-02 ±	4.52E+00	6.49E+00	CS-134		1.97E-01 ±	2.40E+00	3.37E+00
CS-137		0.00E+00 ±	1.59E+00	7.89E+00	CS-137		1.71E+00 ±	2.40E+00	3.16E+00
BALA140		2.43E+00 ±	1.58E+01	2.04E+01	BALA140		-1.42E+00 ±	8.13E+00	1.02E+01
BI-214		3.58E+00 ±	1.22E+01	1.65E+01	BI-214		5.75E+00 ±	3.95E+00	9.82E+00
Location ST-26 collected 4/1/2019					Location ST-26 collected 5/1/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		3.30E+01 ±	3.92E+01	6.94E+01	K-40		1.79E+01 ±	3.99E+01	5.47E+01
CR-51		-1.17E+00 ±	2.88E+01	4.13E+01	CR-51		8.47E+00 ±	2.75E+01	3.89E+01
MN-54		-1.42E+00 ±	3.45E+00	4.47E+00	MN-54		8.39E-01 ±	2.83E+00	3.71E+00
CO-58		-7.25E-02 ±	3.33E+00	4.43E+00	CO-58		-1.39E+00 ±	3.56E+00	4.62E+00
FE-59		0.00E+00 ±	5.09E+00	1.32E+01	FE-59		-4.33E-01 ±	7.25E+00	9.51E+00
CO-60		2.22E-02 ±	3.06E+00	3.97E+00	CO-60		0.00E+00 ±	1.38E+00	4.58E+00
ZN-65		2.40E-01 ±	5.56E+00	7.37E+00	ZN-65		-2.12E+00 ±	6.81E+00	8.71E+00
ZRNB-95		-4.42E+00 ±	6.76E+00	8.86E+00	ZRNB-95		-3.82E+00 ±	6.50E+00	8.56E+00
I-131		1.55E+00 ±	6.28E+00	8.98E+00	I-131		6.79E+00 ±	6.44E+00	8.76E+00
CS-134		-6.71E-01 ±	2.74E+00	3.79E+00	CS-134		2.09E+00 ±	2.07E+00	2.73E+00
CS-137		-2.00E+00 ±	3.52E+00	4.63E+00	CS-137		-7.98E-01 ±	3.11E+00	4.18E+00
BALA140		-4.08E+00 ±	9.31E+00	1.13E+01	BALA140		0.00E+00 ±	2.46E+00	1.24E+01
BI-214		1.36E+00 ±	7.11E+00	1.02E+01	BI-214		3.69E+00 ±	6.79E+00	9.68E+00
Location ST-26 collected 5/30/2019					Location ST-26 collected 7/1/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		6.65E+00 ±	4.81E+01	6.90E+01	K-40		1.46E+01 ±	4.63E+01	6.62E+01
CR-51		9.05E-01 ±	3.42E+01	5.04E+01	CR-51		-1.29E+01 ±	3.56E+01	5.17E+01
MN-54		-2.31E+00 ±	3.90E+00	5.27E+00	MN-54		-2.13E+00 ±	3.60E+00	4.88E+00
CO-58		-1.15E+00 ±	3.65E+00	5.04E+00	CO-58		-4.54E-01 ±	3.62E+00	5.06E+00
FE-59		1.99E+00 ±	8.29E+00	1.12E+01	FE-59		3.58E+00 ±	1.04E+01	1.37E+01
CO-60		-1.93E+00 ±	3.51E+00	4.84E+00	CO-60		4.77E-01 ±	3.08E+00	4.29E+00
ZN-65		-2.01E-01 ±	7.15E+00	9.83E+00	ZN-65		1.75E+00 ±	6.42E+00	8.74E+00
ZRNB-95		8.06E-01 ±	6.08E+00	8.52E+00	ZRNB-95		1.99E-01 ±	5.70E+00	8.07E+00
I-131		-6.18E+00 ±	1.23E+01	1.77E+01	I-131		-2.25E-01 ±	9.25E+00	1.37E+01
CS-134		8.80E-01 ±	3.64E+00	6.16E+00	CS-134		-7.94E-01 ±	3.08E+00	4.37E+00
CS-137		-1.15E+00 ±	3.32E+00	4.72E+00	CS-137		-2.00E+00 ±	3.76E+00	5.26E+00
BALA140		2.58E+00 ±	8.85E+00	1.15E+01	BALA140		-5.82E+00 ±	1.08E+01	1.36E+01
BI-214	+	1.38E+01 ±	6.53E+00	7.85E+00	BI-214		3.60E+00 ±	7.53E+00	1.09E+01

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

Table A-7.1
GAMMA SPECTROMETRY RESULTS OF RIVER/DRINKING WATER
Station 26 - Control Station 29 - Indicator
Results in pCi/liter, corrected for decay during collection period

Location ST-26 collected 7/31/2019					Location ST-26 collected 8/29/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		-5.07E+01 ±	4.03E+01	6.12E+01	K-40		-6.21E+00 ±	3.38E+01	5.23E+01
CR-51		8.76E+00 ±	3.28E+01	4.74E+01	CR-51		1.14E+01 ±	3.45E+01	4.98E+01
MN-54		-1.41E-01 ±	3.24E+00	4.33E+00	MN-54		-1.51E+00 ±	3.20E+00	4.21E+00
CO-58		3.89E-01 ±	2.91E+00	4.03E+00	CO-58		2.46E-01 ±	3.13E+00	4.35E+00
FE-59		-1.39E+00 ±	1.02E+01	1.30E+01	FE-59		1.08E+00 ±	1.08E+01	1.39E+01
CO-60		4.48E-01 ±	3.13E+00	4.02E+00	CO-60		4.68E-01 ±	2.97E+00	3.82E+00
ZN-65		-1.85E+00 ±	6.57E+00	8.53E+00	ZN-65		-1.45E+00 ±	6.53E+00	8.52E+00
ZRNB-95		3.26E+00 ±	5.22E+00	7.04E+00	ZRNB-95		2.59E+00 ±	6.14E+00	8.35E+00
I-131		-7.52E-01 ±	8.01E+00	1.17E+01	I-131		-6.83E+00 ±	1.31E+01	1.88E+01
CS-134		-1.92E+00 ±	3.41E+00	4.58E+00	CS-134		-1.90E+00 ±	3.38E+00	4.54E+00
CS-137		-1.96E+00 ±	3.51E+00	4.72E+00	CS-137		-7.38E-01 ±	3.43E+00	4.68E+00
BALA140		-2.42E+00 ±	8.14E+00	1.01E+01	BALA140		-9.28E+00 ±	1.37E+01	1.65E+01
BI-214		5.07E+00 ±	6.91E+00	9.79E+00	BI-214		-2.37E+00 ±	6.46E+00	9.55E+00
Location ST-26 collected 10/1/2019					Location ST-26 collected 11/4/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		4.03E+01 ±	3.70E+01	5.13E+01	K-40		-1.85E+00 ±	4.27E+01	6.09E+01
CR-51		1.49E+00 ±	3.57E+01	5.08E+01	CR-51		1.53E+01 ±	3.71E+01	5.20E+01
MN-54		4.93E-01 ±	3.23E+00	4.38E+00	MN-54		-1.82E+00 ±	3.71E+00	4.90E+00
CO-58		5.78E-01 ±	3.58E+00	4.84E+00	CO-58		-1.67E+00 ±	3.70E+00	4.92E+00
FE-59		1.87E+00 ±	1.00E+01	1.30E+01	FE-59		5.01E+00 ±	9.15E+00	1.16E+01
CO-60		-9.77E-01 ±	3.68E+00	4.73E+00	CO-60		7.48E-01 ±	2.99E+00	3.90E+00
ZN-65		-3.99E+00 ±	7.49E+00	9.65E+00	ZN-65		2.00E+00 ±	8.20E+00	1.40E+01
ZRNB-95		2.15E+00 ±	5.62E+00	7.76E+00	ZRNB-95		2.19E+00 ±	5.71E+00	7.89E+00
I-131		2.15E+00 ±	9.94E+00	1.41E+01	I-131		-9.06E-01 ±	1.11E+01	1.58E+01
CS-134		-2.18E+00 ±	3.74E+00	5.04E+00	CS-134		-1.94E+00 ±	5.05E+00	8.43E+00
CS-137		-2.85E-01 ±	3.21E+00	4.48E+00	CS-137		-2.11E+00 ±	3.78E+00	5.12E+00
BALA140		-7.18E+00 ±	1.09E+01	1.32E+01	BALA140		5.05E+00 ±	7.80E+00	9.63E+00
BI-214		7.22E+00 ±	9.57E+00	1.32E+01	BI-214	+	2.87E+01 ±	8.68E+00	1.05E+01
Location ST-26 collected 12/2/2019					Location ST-26 collected 1/2/2020				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		1.11E+01 ±	3.04E+01	4.64E+01	K-40		6.11E+00 ±	3.94E+01	5.62E+01
CR-51		-1.01E+01 ±	3.68E+01	5.18E+01	CR-51		-2.18E+01 ±	4.11E+01	5.72E+01
MN-54		1.65E+00 ±	2.57E+00	3.40E+00	MN-54		-1.31E+00 ±	3.39E+00	4.51E+00
CO-58		-2.37E+00 ±	3.96E+00	5.21E+00	CO-58		1.85E+00 ±	3.41E+00	4.51E+00
FE-59		-1.87E+00 ±	1.07E+01	1.38E+01	FE-59		-2.35E+00 ±	1.12E+01	1.45E+01
CO-60		7.05E-01 ±	3.22E+00	4.18E+00	CO-60		2.23E+00 ±	2.53E+00	3.13E+00
ZN-65		-5.60E+00 ±	8.78E+00	1.12E+01	ZN-65		-4.42E+00 ±	8.66E+00	1.11E+01
ZRNB-95		-9.44E-01 ±	6.05E+00	8.43E+00	ZRNB-95		0.00E+00 ±	4.30E+00	9.26E+00
I-131		2.20E+00 ±	9.64E+00	1.36E+01	I-131		-7.36E+00 ±	1.35E+01	1.88E+01
CS-134		-2.40E-01 ±	4.10E+00	6.95E+00	CS-134		-1.07E+00 ±	3.21E+00	4.39E+00
CS-137		3.86E+00 ±	3.17E+00	4.13E+00	CS-137		-2.11E+00 ±	3.66E+00	4.94E+00
BALA140		-6.95E+00 ±	1.05E+01	1.27E+01	BALA140		1.81E+00 ±	8.55E+00	1.10E+01
BI-214	+	2.38E+01 ±	7.21E+00	7.92E+00	BI-214		-1.40E+00 ±	7.96E+00	1.15E+01

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

Table A-7.1
GAMMA SPECTROMETRY RESULTS OF RIVER/DRINKING WATER
Station 26 - Control Station 29 - Indicator
Results in pCi/liter, corrected for decay during collection period

Location ST-29 collected 1/31/2019					Location ST-29 collected 3/4/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40	+	4.17E+01 ±	1.89E+01	2.35E+01	K-40		7.22E+00 ±	4.33E+01	5.91E+01
CR-51		9.38E-03 ±	3.19E-02	4.44E-02	CR-51		-3.28E+00 ±	2.85E+01	4.08E+01
MN-54		-6.56E-01 ±	1.05E+00	1.33E+00	MN-54		-4.29E-01 ±	2.86E+00	3.79E+00
CO-58		-4.16E-02 ±	2.11E-01	2.71E-01	CO-58		-1.16E+00 ±	3.89E+00	5.06E+00
FE-59		-1.08E-01 ±	1.66E-01	2.00E-01	FE-59		5.97E+00 ±	9.54E+00	1.17E+01
CO-60		4.66E-01 ±	1.39E+00	1.69E+00	CO-60		-2.43E-01 ±	3.06E+00	3.95E+00
ZN-65		6.49E-01 ±	1.62E+00	2.02E+00	ZN-65		3.74E+00 ±	5.54E+00	6.96E+00
ZRNB-95		8.34E-02 ±	2.89E-01	3.81E-01	ZRNB-95		4.13E+00 ±	5.18E+00	6.75E+00
I-131		1.36E-11 ±	7.93E-11	1.11E-10	I-131		-9.63E-01 ±	8.80E+00	1.26E+01
CS-134		-3.78E-01 ±	1.10E+00	1.48E+00	CS-134		2.09E+00 ±	2.17E+00	2.87E+00
CS-137		-1.76E-01 ±	1.31E+00	1.74E+00	CS-137		0.00E+00 ±	4.67E-01	4.52E+00
BALA140		-5.62E-07 ±	1.61E-06	1.92E-06	BALA140		0.00E+00 ±	2.43E+00	1.25E+01
BI-214		2.31E+00 ±	4.18E+00	5.13E+00	BI-214		3.72E+00 ±	8.03E+00	9.86E+00
Location ST- 29 collected 4/1/2019					Location ST-29 collected 5/1/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		5.81E+00 ±	4.25E+01	5.82E+01	K-40		3.70E+01 ±	3.59E+01	4.93E+01
CR-51		-1.52E+00 ±	2.98E+01	4.25E+01	CR-51		2.80E+00 ±	3.47E+01	4.95E+01
MN-54		2.32E+00 ±	2.73E+00	3.45E+00	MN-54		-2.00E+00 ±	3.43E+00	4.39E+00
CO-58		8.23E-01 ±	3.12E+00	4.11E+00	CO-58		1.93E+00 ±	2.68E+00	3.44E+00
FE-59		1.24E-01 ±	9.15E+00	1.18E+01	FE-59		3.27E+00 ±	8.45E+00	1.07E+01
CO-60		1.52E+00 ±	2.43E+00	3.02E+00	CO-60		2.31E+00 ±	2.27E+00	2.70E+00
ZN-65		1.65E+00 ±	5.58E+00	7.23E+00	ZN-65		-3.52E+00 ±	7.89E+00	9.95E+00
ZRNB-95		1.73E+00 ±	4.96E+00	6.70E+00	ZRNB-95		-8.54E-01 ±	6.07E+00	8.27E+00
I-131		2.99E-01 ±	7.57E+00	1.09E+01	I-131		-5.77E+00 ±	1.45E+01	2.04E+01
CS-134		6.18E-01 ±	2.63E+00	3.64E+00	CS-134		1.96E-01 ±	2.60E+00	3.64E+00
CS-137		1.05E+00 ±	2.49E+00	3.34E+00	CS-137		1.90E-01 ±	2.87E+00	3.93E+00
BALA140		5.19E+00 ±	5.96E+00	7.05E+00	BALA140		0.00E+00 ±	1.38E+00	1.85E+01
BI-214		0.00E+00 ±	6.58E+00	1.38E+01	BI-214		8.05E-02 ±	1.43E+00	1.01E+01
Location ST-29 collected 5/30/2019					Location ST-29 collected 7/1/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		2.67E+01 ±	3.54E+01	5.03E+01	K-40		1.78E+00 ±	4.32E+01	6.06E+01
CR-51		3.68E+00 ±	3.51E+01	4.99E+01	CR-51		2.67E+01 ±	3.54E+01	4.89E+01
MN-54		6.99E-01 ±	2.80E+00	3.79E+00	MN-54		7.53E-01 ±	2.93E+00	3.95E+00
CO-58		1.33E+00 ±	3.31E+00	4.43E+00	CO-58		-1.13E-01 ±	3.67E+00	5.00E+00
FE-59		1.23E+01 ±	8.29E+00	1.39E+01	FE-59		-8.36E+00 ±	1.31E+01	1.63E+01
CO-60		1.69E+00 ±	3.14E+00	3.98E+00	CO-60		-6.41E-01 ±	3.67E+00	4.74E+00
ZN-65		-2.37E+00 ±	7.46E+00	9.74E+00	ZN-65		-2.45E+00 ±	7.61E+00	9.93E+00
ZRNB-95		-3.52E+00 ±	6.73E+00	9.16E+00	ZRNB-95		1.99E+00 ±	5.16E+00	7.17E+00
I-131		-7.81E+00 ±	1.43E+01	1.99E+01	I-131		-4.16E+00 ±	1.54E+01	2.17E+01
CS-134		-2.08E+00 ±	3.85E+00	5.19E+00	CS-134		-1.53E+00 ±	3.49E+00	4.74E+00
CS-137		-9.32E-01 ±	3.32E+00	4.58E+00	CS-137		1.01E+00 ±	3.33E+00	4.58E+00
BALA140		-1.15E+00 ±	1.06E+01	1.35E+01	BALA140		-9.35E-02 ±	1.08E+01	1.40E+01
BI-214		2.93E+00 ±	8.91E+00	1.25E+01	BI-214		-1.26E-01 ±	8.40E+00	1.20E+01

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

Table A-7.1
GAMMA SPECTROMETRY RESULTS OF RIVER/DRINKING WATER
Station 26 - Control Station 29 - Indicator
Results in pCi/liter, corrected for decay during collection period

Location ST-29 collected 7/31/2019					Location ST-29 collected 8/31/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40	+	1.07E+02 ±	3.95E+01	3.70E+01	K-40		5.60E+00 ±	4.36E+01	6.08E+01
CR-51		-2.00E+01 ±	4.01E+01	5.78E+01	CR-51		2.04E+00 ±	3.98E+01	5.66E+01
MN-54		-1.64E+00 ±	3.68E+00	5.03E+00	MN-54		1.77E+00 ±	3.50E+00	4.62E+00
CO-58		0.00E+00 ±	0.00E+00	4.43E+00	CO-58		-1.58E+00 ±	3.75E+00	5.00E+00
FE-59		2.97E+00 ±	9.52E+00	1.27E+01	FE-59		-5.01E-01 ±	1.06E+01	1.39E+01
CO-60		-2.48E-01 ±	2.73E+00	3.95E+00	CO-60		1.03E-01 ±	3.26E+00	4.29E+00
ZN-65		0.00E+00 ±	4.13E+00	1.01E+01	ZN-65		-3.80E+00 ±	7.58E+00	9.78E+00
ZRNB-95		0.00E+00 ±	2.24E+00	8.67E+00	ZRNB-95		-2.03E-01 ±	5.42E+00	7.70E+00
I-131		8.12E+00 ±	1.09E+01	1.56E+01	I-131		3.30E+00 ±	1.70E+01	2.42E+01
CS-134		-9.33E-01 ±	3.19E+00	4.52E+00	CS-134		-1.89E+00 ±	3.98E+00	6.64E+00
CS-137		3.71E-01 ±	3.13E+00	4.51E+00	CS-137		7.39E-01 ±	3.70E+00	5.10E+00
BALA140		6.25E-01 ±	8.05E+00	1.09E+01	BALA140		7.20E-01 ±	1.05E+01	1.38E+01
BI-214		7.00E+00 ±	8.20E+00	1.16E+01	BI-214	+	1.72E+01 ±	6.37E+00	7.19E+00

Location ST-29 collected 10/1/2019					Location ST-29 collected 11/4/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		2.44E+01 ±	3.44E+01	4.86E+01	K-40		4.31E+00 ±	4.58E+01	6.62E+01
CR-51		1.06E+01 ±	3.24E+01	4.56E+01	CR-51		2.39E+01 ±	3.34E+01	4.79E+01
MN-54		-2.91E-01 ±	3.30E+00	4.46E+00	MN-54		9.95E-01 ±	2.36E+00	3.27E+00
CO-58		-2.18E+00 ±	3.87E+00	5.09E+00	CO-58		-4.51E-01 ±	3.03E+00	4.27E+00
FE-59		2.85E-01 ±	9.04E+00	1.19E+01	FE-59		-7.08E+00 ±	1.17E+01	1.51E+01
CO-60		1.10E+00 ±	2.77E+00	3.56E+00	CO-60		-2.30E-02 ±	2.84E+00	4.04E+00
ZN-65		-5.53E+00 ±	8.66E+00	1.10E+01	ZN-65		-9.35E-01 ±	7.90E+00	1.07E+01
ZRNB-95		-2.51E+00 ±	5.84E+00	8.01E+00	ZRNB-95		-4.07E+00 ±	7.16E+00	9.70E+00
I-131		-2.89E+00 ±	9.60E+00	1.35E+01	I-131		-1.55E+00 ±	9.79E+00	1.44E+01
CS-134		-1.81E+00 ±	3.35E+00	4.53E+00	CS-134		1.35E+00 ±	3.84E+00	6.45E+00
CS-137		-2.00E+00 ±	3.72E+00	5.04E+00	CS-137		2.22E+00 ±	3.29E+00	4.57E+00
BALA140		3.71E+00 ±	8.50E+00	1.06E+01	BALA140		-2.02E+00 ±	9.51E+00	1.24E+01
BI-214		4.43E+00 ±	7.44E+00	1.05E+01	BI-214	+	2.06E+01 ±	5.31E+00	6.04E+00

Location ST-29 collected 12/2/2019					Location ST-29 collected 1/2/2020				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		4.04E+01 ±	3.79E+01	5.37E+01	K-40		2.81E+01 ±	4.13E+01	5.69E+01
CR-51		-6.36E+00 ±	3.33E+01	4.89E+01	CR-51		1.91E+01 ±	3.74E+01	5.23E+01
MN-54		-1.32E+00 ±	2.91E+00	3.99E+00	MN-54		1.66E+00 ±	2.95E+00	3.90E+00
CO-58		-3.26E-01 ±	3.06E+00	4.31E+00	CO-58		9.47E-01 ±	3.57E+00	4.81E+00
FE-59		5.40E+00 ±	9.55E+00	1.24E+01	FE-59		-2.58E+00 ±	1.12E+01	1.44E+01
CO-60		-3.32E-01 ±	2.80E+00	3.99E+00	CO-60		2.34E-01 ±	3.30E+00	4.33E+00
ZN-65		4.21E-01 ±	5.08E+00	7.11E+00	ZN-65		-3.91E+00 ±	7.78E+00	1.00E+01
ZRNB-95		3.44E+00 ±	5.33E+00	7.24E+00	ZRNB-95		1.99E+00 ±	5.57E+00	7.72E+00
I-131		2.01E+00 ±	1.19E+01	1.75E+01	I-131		1.34E+00 ±	1.32E+01	1.88E+01
CS-134		-1.76E+00 ±	3.93E+00	6.57E+00	CS-134		3.87E-01 ±	3.39E+00	4.67E+00
CS-137		2.69E-01 ±	3.03E+00	4.37E+00	CS-137		8.41E-01 ±	3.08E+00	4.27E+00
BALA140		3.53E-01 ±	1.12E+01	1.47E+01	BALA140		-1.76E+00 ±	1.09E+01	1.38E+01
BI-214	+	1.73E+01 ±	4.86E+00	5.58E+00	BI-214		-1.12E+01 ±	7.34E+00	1.13E+01

TABLE A-7.2
GAMMA SPECTROMETRY RESULTS OF RIVER/DRINKING WATER - SUMMARY

Station 26 - Control Station 29 - Indicator

Results in pCi/liter, corrected for decay during collection period

Nuclide		Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
K-40	Ind	2.75E+01	1.78E+00	1.07E+02	5.20E+01	12	2
K-40	Cntl	1.35E+01	-5.07E+01	7.60E+01	6.16E+01	12	0
CR-51	Ind	4.80E+00	-2.00E+01	2.67E+01	4.51E+01	12	0
CR-51	Cntl	-1.26E+00	-3.32E+01	1.78E+01	5.07E+01	12	0
MN-54	Ind	1.55E-01	-2.00E+00	2.32E+00	3.83E+00	12	0
MN-54	Cntl	-3.60E-01	-2.31E+00	2.47E+00	4.42E+00	12	0
CO-58	Ind	-6.84E-02	-2.18E+00	1.93E+00	4.19E+00	12	0
CO-58	Cntl	-5.22E-01	-2.37E+00	1.85E+00	4.90E+00	12	0
FE-59	Ind	9.77E-01	-8.36E+00	1.23E+01	1.21E+01	12	0
FE-59	Cntl	6.36E-01	-2.35E+00	5.01E+00	1.35E+01	12	0
CO-60	Ind	4.94E-01	-6.41E-01	2.31E+00	3.69E+00	12	0
CO-60	Cntl	4.88E-01	-1.93E+00	3.30E+00	4.17E+00	12	0
ZN-65	Ind	-1.34E+00	-5.53E+00	3.74E+00	8.72E+00	12	0
ZN-65	Cntl	-1.52E+00	-5.60E+00	2.00E+00	9.99E+00	12	0
ZRNB-95	Ind	-6.82E-02	-5.53E+00	4.13E+00	7.54E+00	12	0
ZRNB-95	Cntl	2.40E-01	-4.42E+00	5.03E+00	8.37E+00	12	0
I-131	Ind	-6.73E-01	-7.81E+00	8.12E+00	1.58E+01	12	0
I-131	Cntl	-1.85E-01	-7.36E+00	6.79E+00	1.43E+01	12	0
CS-134	Ind	-4.78E-01	-2.08E+00	2.09E+00	4.58E+00	12	0
CS-134	Cntl	-6.37E-01	-2.18E+00	2.09E+00	5.07E+00	12	0
CS-137	Ind	2.98E-01	-2.00E+00	2.22E+00	4.21E+00	12	0
CS-137	Cntl	-6.31E-01	-2.11E+00	3.86E+00	4.83E+00	12	0
BALA140	Ind	4.64E-01	-2.02E+00	5.19E+00	1.18E+01	12	0
BALA140	Cntl	-2.11E+00	-9.28E+00	5.05E+00	1.27E+01	12	0
BI-214	Ind	5.35E+00	-1.12E+01	2.06E+01	9.63E+00	12	3
BI-214	Cntl	7.73E+00	-2.37E+00	2.87E+01	1.06E+01	12	3

TABLE A-8.1
GAMMA SPECTROMETRY RESULTS OF SOIL
 Results in pCi/kilogram

Location and Date			Station 7	6/11/2019
Nuclide	RQ	Activity	Error	MDA
BE-7		9.37E+01 ±	2.70E+02	3.83E+02
K-40	+	1.35E+04 ±	1.03E+03	4.19E+02
CR-51	-	1.54E+01 ±	2.39E+02	3.56E+02
MN-54		1.40E+01 ±	2.96E+01	4.09E+01
CO-58	-	3.48E+00 ±	2.86E+01	4.06E+01
FE-59		2.91E+00 ±	9.06E+01	1.22E+02
CO-60	-	1.57E+01 ±	4.19E+01	5.57E+01
ZN-65		1.94E+01 ±	1.00E+02	1.70E+02
ZRNB-95		4.70E+00 ±	4.96E+01	7.06E+01
CS-134	-	1.67E+01 ±	5.95E+01	9.98E+01
CS-137	+	8.78E+01 ±	3.71E+01	4.06E+01
BALA140	-	1.54E+01 ±	4.23E+01	5.48E+01
BI-214	+	6.36E+02 ±	8.99E+01	7.30E+01

Location and Date			Station ST-48	6/11/2019
Nuclide	RQ	Activity	Error	MDA
BE-7		1.71E+02 ±	3.22E+02	4.37E+02
K-40	+	1.70E+04 ±	1.14E+03	3.57E+02
CR-51	-	1.02E+02 ±	3.40E+02	4.77E+02
MN-54		1.95E+01 ±	3.13E+01	4.14E+01
CO-58	-	2.05E+00 ±	3.25E+01	4.45E+01
FE-59	-	1.32E+01 ±	1.09E+02	1.40E+02
CO-60		3.34E+01 ±	2.86E+01	3.42E+01
ZN-65	-	6.02E+01 ±	1.12E+02	1.87E+02
ZRNB-95	-	7.96E+00 ±	6.52E+01	8.84E+01
CS-134	-	2.24E+01 ±	6.15E+01	1.03E+02
CS-137		6.66E+01 ±	4.37E+01	7.42E+01
BALA140	-	4.07E+01 ±	5.82E+01	7.06E+01
BI-214	+	5.98E+02 ±	9.93E+01	9.62E+01

Location and Date			Station ST-8	6/11/2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.01E+03 ±	3.29E+02	3.66E+02
K-40	+	1.82E+04 ±	1.43E+03	4.71E+02
CR-51	-	1.97E+02 ±	4.02E+02	5.82E+02
MN-54		2.33E+01 ±	3.91E+01	5.37E+01
CO-58	-	1.39E+01 ±	4.23E+01	5.91E+01
FE-59	-	2.72E+01 ±	1.21E+02	1.63E+02
CO-60		3.09E+01 ±	3.77E+01	4.90E+01
ZN-65	-	1.45E+01 ±	1.32E+02	2.27E+02
ZRNB-95		1.51E+01 ±	7.94E+01	1.12E+02
CS-134	-	2.69E+01 ±	8.45E+01	1.42E+02
CS-137	+	9.47E+01 ±	3.98E+01	4.59E+01
BALA140	-	3.02E+01 ±	6.02E+01	7.73E+01
BI-214	+	7.43E+02 ±	1.23E+02	1.13E+02

Location and Date			Station 9A	6/11/2019
Nuclide	RQ	Activity	Error	MDA
BE-7	+	8.27E+02 ±	3.63E+02	4.18E+02
K-40	+	1.58E+04 ±	1.24E+03	3.45E+02
CR-51	-	7.34E+01 ±	4.22E+02	5.98E+02
MN-54		1.26E+00 ±	5.02E+01	6.86E+01
CO-58	-	2.04E+01 ±	4.70E+01	6.28E+01
FE-59	-	2.02E+01 ±	1.23E+02	1.60E+02
CO-60		4.32E+01 ±	6.37E+01	7.93E+01
ZN-65	-	6.10E+01 ±	1.41E+02	2.37E+02
ZRNB-95		3.56E+01 ±	8.21E+01	1.10E+02
CS-134	-	2.37E+01 ±	8.19E+01	1.37E+02
CS-137	+	8.58E+01 ±	3.66E+01	4.39E+01
BALA140		2.03E+01 ±	4.27E+01	5.44E+01
BI-214	+	9.10E+02 ±	1.22E+02	9.85E+01

Location and Date			Station 23	6/11/2019
Nuclide	RQ	Activity	Error	MDA
BE-7		9.95E+01 ±	2.90E+02	4.13E+02
K-40	+	1.42E+04 ±	1.11E+03	3.27E+02
CR-51	-	3.50E+01 ±	3.17E+02	4.67E+02
MN-54	-	3.58E+00 ±	3.82E+01	5.24E+01
CO-58		1.91E+01 ±	2.55E+01	3.37E+01
FE-59		2.47E+01 ±	8.47E+01	1.11E+02
CO-60	-	5.23E+00 ±	3.91E+01	5.18E+01
ZN-65	-	5.80E+01 ±	1.13E+02	1.89E+02
ZRNB-95	-	1.42E+01 ±	5.89E+01	8.28E+01
CS-134	-	1.52E+01 ±	5.75E+01	9.68E+01
CS-137		2.76E+01 ±	5.19E+01	7.04E+01
BALA140	-	3.18E+01 ±	5.79E+01	7.14E+01
BI-214	+	4.14E+02 ±	8.88E+01	9.09E+01

TABLE A-8.2
GAMMA SPECTROMETRY RESULTS OF SOIL - SUMMARY
 Results in pCi/kilogram

Nuclide		Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
BE-7	Ind	3.44E+02	9.37E+01	1.01E+03	4.00E+02	4	1
BE-7	Cntl	8.27E+02	8.27E+02	8.27E+02	4.18E+02	1	1
K-40	Ind	1.57E+04	1.35E+04	1.82E+04	3.93E+02	4	4
K-40	Cntl	1.58E+04	1.58E+04	1.58E+04	3.45E+02	1	1
CR-51	Ind	-8.73E+01	-1.97E+02	-1.54E+01	4.71E+02	4	0
CR-51	Cntl	-7.34E+01	-7.34E+01	-7.34E+01	5.98E+02	1	0
MN-54	Ind	1.33E+01	-3.58E+00	2.33E+01	4.71E+01	4	0
MN-54	Cntl	-1.26E+00	-1.26E+00	-1.26E+00	6.86E+01	1	0
CO-58	Ind	-9.92E-02	-1.39E+01	1.91E+01	4.45E+01	4	0
CO-58	Cntl	-2.04E+01	-2.04E+01	-2.04E+01	6.28E+01	1	0
FE-59	Ind	-3.22E+00	-2.72E+01	2.47E+01	1.34E+02	4	0
FE-59	Cntl	-2.02E+01	-2.02E+01	-2.02E+01	1.60E+02	1	0
CO-60	Ind	1.09E+01	-1.57E+01	3.34E+01	4.77E+01	4	0
CO-60	Cntl	-4.32E+01	-4.32E+01	-4.32E+01	7.93E+01	1	0
ZN-65	Ind	-2.83E+01	-6.02E+01	1.94E+01	1.93E+02	4	0
ZN-65	Cntl	-6.10E+01	-6.10E+01	-6.10E+01	2.37E+02	1	0
ZRNB-95	Ind	-5.84E-01	-1.42E+01	1.51E+01	8.84E+01	4	0
ZRNB-95	Cntl	3.56E+01	3.56E+01	3.56E+01	1.10E+02	1	0
CS-134	Ind	-2.03E+01	-2.69E+01	-1.52E+01	1.10E+02	4	0
CS-134	Cntl	-2.37E+01	-2.37E+01	-2.37E+01	1.37E+02	1	0
CS-137	Ind	6.91E+01	2.76E+01	9.47E+01	5.78E+01	4	2
CS-137	Cntl	8.58E+01	8.58E+01	8.58E+01	4.39E+01	1	1
BALAB140	Ind	-2.95E+01	-4.07E+01	-1.54E+01	6.85E+01	4	0
BALAB140	Cntl	2.03E+01	2.03E+01	2.03E+01	5.44E+01	1	0
BI-214	Ind	5.98E+02	4.14E+02	7.43E+02	9.32E+01	4	4
BI-214	Cntl	9.10E+02	9.10E+02	9.10E+02	9.85E+01	1	1

TABLE A-9.1
GAMMA SPECTROMETRY RESULTS OF SEDIMENT

Results in pCi/kilogram dry material

Station 34 Downstream Indicator

Location & Date			Station 34	4/18/2019	Location & Date			Station 34	10/7/2019
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BE-7		7.94E+00 ±	2.77E+02	3.88E+02	BE-7		5.68E+01 ±	2.81E+02	4.02E+02
K-40	+	1.65E+04 ±	1.08E+03	3.00E+02	K-40	+	1.35E+04 ±	9.91E+02	3.32E+02
CR-51		1.17E+00 ±	2.72E+02	3.90E+02	CR-51		-1.80E+02 ±	3.54E+02	5.11E+02
MN-54		1.05E+01 ±	3.02E+01	3.96E+01	MN-54		2.26E+00 ±	3.09E+01	4.38E+01
CO-58		-8.79E+00 ±	2.97E+01	3.92E+01	CO-58		-2.38E+00 ±	2.92E+01	4.17E+01
FE-59		0.00E+00 ±	4.01E+01	1.35E+02	FE-59		6.70E+01 ±	7.81E+01	9.90E+01
CO-60		2.32E+01 ±	2.52E+01	2.96E+01	CO-60		2.44E+01 ±	2.86E+01	3.67E+01
ZN-65		7.53E+00 ±	7.60E+01	9.58E+01	ZN-65		-4.94E+01 ±	1.09E+02	1.82E+02
ZRNB-95		1.73E+01 ±	5.23E+01	6.87E+01	ZRNB-95		1.46E+01 ±	5.65E+01	7.90E+01
CS-134		2.47E+01 ±	2.05E+01	2.58E+01	CS-134		-1.74E+01 ±	5.94E+01	9.94E+01
CS-137	+	8.41E+01 ±	3.75E+01	4.41E+01	CS-137	+	1.40E+02 ±	3.31E+01	3.18E+01
BALA140		-1.20E+01 ±	4.85E+01	5.91E+01	BALA140		-3.11E+01 ±	6.24E+01	7.98E+01
BI-214	+	4.91E+02 ±	8.68E+01	8.53E+01	BI-214	+	6.57E+02 ±	9.17E+01	7.82E+01

Station 33 Upstream Control

Location & Date			Station 33	4/18/2019	Location & Date			Station 33	10/7/2019
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BE-7		8.05E+01 ±	2.50E+02	3.45E+02	BE-7		-4.36E+01 ±	3.36E+02	4.80E+02
K-40	+	1.61E+04 ±	1.03E+03	2.74E+02	K-40	+	1.57E+04 ±	1.11E+03	3.85E+02
CR-51		-6.55E+01 ±	2.76E+02	3.91E+02	CR-51		2.95E+01 ±	2.84E+02	4.21E+02
MN-54		1.63E+01 ±	2.40E+01	3.08E+01	MN-54		5.89E+00 ±	3.26E+01	4.57E+01
CO-58		-1.35E+00 ±	2.90E+01	3.88E+01	CO-58		2.24E+01 ±	2.27E+01	2.99E+01
FE-59		2.37E+01 ±	8.91E+01	1.09E+02	FE-59		-4.80E+01 ±	1.19E+02	1.55E+02
CO-60		0.00E+00 ±	2.10E+01	4.90E+01	CO-60		-4.31E+00 ±	3.63E+01	4.98E+01
ZN-65		2.70E+01 ±	6.54E+01	8.11E+01	ZN-65		-2.11E+01 ±	9.78E+01	1.67E+02
ZRNB-95		2.07E+01 ±	5.21E+01	6.79E+01	ZRNB-95		-4.36E+00 ±	6.12E+01	8.65E+01
CS-134		2.78E+00 ±	2.67E+01	3.63E+01	CS-134		-3.87E+00 ±	5.86E+01	9.89E+01
CS-137		3.46E+01 ±	3.42E+01	4.39E+01	CS-137		1.76E+01 ±	4.89E+01	6.68E+01
BALA140		0.00E+00 ±	4.01E+00	5.44E+01	BALA140		-2.46E+01 ±	6.05E+01	7.84E+01
BI-214	+	5.94E+02 ±	9.09E+01	8.08E+01	BI-214	+	6.20E+02 ±	9.20E+01	8.30E+01

TABLE A-9.2
GAMMA SPECTROMETRY RESULTS OF SEDIMENT - SUMMARY
 Results in pCi/kilogram dry material

Nuclide		Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
BE-7	Ind	3.24E+01	7.94E+00	5.68E+01	3.95E+02	2	0
BE-7	Cntl	1.84E+01	-4.36E+01	8.05E+01	4.13E+02	2	0
K-40	Ind	1.50E+04	1.35E+04	1.65E+04	3.16E+02	2	2
K-40	Cntl	1.59E+04	1.57E+04	1.61E+04	3.29E+02	2	2
CR-51	Ind	-8.96E+01	-1.80E+02	1.17E+00	4.51E+02	2	0
CR-51	Cntl	-1.80E+01	-6.55E+01	2.95E+01	4.06E+02	2	0
MN-54	Ind	6.39E+00	2.26E+00	1.05E+01	4.17E+01	2	0
MN-54	Cntl	1.11E+01	5.89E+00	1.63E+01	3.83E+01	2	0
CO-58	Ind	-5.59E+00	-8.79E+00	-2.38E+00	4.04E+01	2	0
CO-58	Cntl	1.05E+01	-1.35E+00	2.24E+01	3.43E+01	2	0
FE-59	Ind	3.35E+01	0.00E+00	6.70E+01	1.17E+02	2	0
FE-59	Cntl	-1.21E+01	-4.80E+01	2.37E+01	1.32E+02	2	0
CO-60	Ind	2.38E+01	2.32E+01	2.44E+01	3.31E+01	2	0
CO-60	Cntl	-2.15E+00	-4.31E+00	0.00E+00	4.94E+01	2	0
ZN-65	Ind	-2.10E+01	-4.94E+01	7.53E+00	1.39E+02	2	0
ZN-65	Cntl	2.93E+00	-2.11E+01	2.70E+01	1.24E+02	2	0
ZRNB-95	Ind	1.60E+01	1.46E+01	1.73E+01	7.38E+01	2	0
ZRNB-95	Cntl	8.17E+00	-4.36E+00	2.07E+01	7.72E+01	2	0
CS-134	Ind	3.64E+00	-1.74E+01	2.47E+01	6.26E+01	2	0
CS-134	Cntl	-5.48E-01	-3.87E+00	2.78E+00	6.76E+01	2	0
CS-137	Ind	1.12E+02	8.41E+01	1.40E+02	3.79E+01	2	2
CS-137	Cntl	2.61E+01	1.76E+01	3.46E+01	5.53E+01	2	0
BALAB140	Ind	-2.15E+01	-3.11E+01	-1.20E+01	6.95E+01	2	0
BALAB140	Cntl	-1.23E+01	-2.46E+01	0.00E+00	6.64E+01	2	0
BI-214	Ind	5.74E+02	4.91E+02	6.57E+02	8.17E+01	2	2
BI-214	Cntl	6.07E+02	5.94E+02	6.20E+02	8.19E+01	2	2

TABLE A-10.1
GAMMA SPECTROMETRY RESULTS OF FISH
 Station 30 Columbia River - Station 38 Snake River
 Results in pCi/kilogram (wet)

Location & Species	Collection Date	Nuclide	RQ	Activity	Error	MDA
Walleye Station 30 Indicator	08/15/19	K-40	+	3.94E+03	± 3.45E+02	2.03E+02
		MN-54		6.37E+00	± 1.52E+01	2.02E+01
		CO-58		3.61E+00	± 2.06E+01	2.77E+01
		FE-59		9.66E+00	± 6.48E+01	8.36E+01
		CO-60		7.17E+00	± 1.46E+01	1.85E+01
		ZN-65		-2.34E+01	± 4.16E+01	5.32E+01
		ZRNB-95		-2.03E+01	± 3.95E+01	5.21E+01
		CS-134		-6.85E+00	± 1.75E+01	2.37E+01
		CS-137		8.14E+00	± 1.85E+01	2.51E+01
		Bi-214		2.02E+01	± 4.17E+01	5.83E+01
Bass Station 30 Indicator	07/22/19	K-40	+	4.60E+03	± 4.30E+02	3.29E+02
		MN-54		-9.66E-01	± 2.00E+01	2.78E+01
		CO-58		-1.28E+01	± 2.67E+01	3.61E+01
		FE-59		2.44E+01	± 6.62E+01	8.60E+01
		CO-60		-1.14E+01	± 2.21E+01	3.00E+01
		ZN-65		-1.77E+01	± 4.94E+01	6.54E+01
		ZRNB-95		1.97E+00	± 3.99E+01	5.54E+01
		CS-134		-1.18E+01	± 2.65E+01	4.41E+01
		CS-137		1.48E+01	± 1.81E+01	2.49E+01
		Bi-214	+	1.53E+02	± 4.23E+01	4.95E+01
Salmon Station 30 Indicator	10/22/19	K-40	+	3.06E+03	± 3.92E+02	2.63E+02
		MN-54		3.82E+00	± 1.36E+01	1.95E+01
		CO-58		-6.57E+00	± 2.41E+01	3.38E+01
		FE-59		2.60E+01	± 5.22E+01	7.00E+01
		CO-60		-1.37E+01	± 2.31E+01	3.10E+01
		ZN-65		1.76E+01	± 3.63E+01	4.93E+01
		ZRNB-95		-3.34E+00	± 3.70E+01	5.31E+01
		CS-134		-2.63E+00	± 1.66E+01	2.40E+01
		CS-137		5.32E+00	± 2.13E+01	3.06E+01
		Bi-214		3.44E+01	± 3.97E+01	5.70E+01

TABLE A-10.1
GAMMA SPECTROMETRY RESULTS OF FISH
 Station 30 Columbia River - Station 38 Snake River
 Results in pCi/kilogram (wet)

Location & Species	Collection Date	Nuclide	RQ	Activity	Error	MDA
Bass Station 38 Control	07/28/19	K-40	+	4.29E+03	±	4.13E+02
		MN-54		-5.03E+00	±	2.05E+01
		CO-58		9.23E+00	±	2.10E+01
		FE-59		2.66E+01	±	5.45E+01
		CO-60		5.44E+00	±	2.07E+01
		ZN-65		5.35E+00	±	4.06E+01
		ZRNB-95		9.02E-01	±	3.48E+01
		CS-134		1.04E+01	±	2.31E+01
		CS-137		1.31E+01	±	1.98E+01
		Bi-214	+	1.13E+02	±	3.66E+01
Walleye Station 38 Control	07/30/19	K-40	+	3.39E+03	±	3.49E+02
		MN-54		6.84E+00	±	1.63E+01
		CO-58		-4.67E+00	±	1.72E+01
		FE-59		-2.23E+01	±	5.42E+01
		CO-60		7.70E+00	±	1.70E+01
		ZN-65		1.96E+00	±	3.88E+01
		ZRNB-95		-1.95E-01	±	2.91E+01
		CS-134		4.82E+00	±	2.07E+01
		CS-137		1.16E+01	±	1.81E+01
		Bi-214	+	1.13E+02	±	3.60E+01
Salmon Station 38 Control	10/22/19	K-40	+	3.26E+03	±	4.10E+02
		MN-54		-4.79E-01	±	1.87E+01
		CO-58		1.37E+00	±	2.31E+01
		FE-59		-1.58E+01	±	8.03E+01
		CO-60		-7.18E+00	±	2.43E+01
		ZN-65		0.00E+00	±	2.76E+01
		ZRNB-95		2.10E+01	±	3.80E+01
		CS-134		-7.65E+00	±	2.37E+01
		CS-137		1.03E+01	±	1.74E+01
		Bi-214		2.92E+01	±	5.60E+01

TABLE A-10.2
GAMMA SPECTROMETRY RESULTS OF FISH - SUMMARY
 Results in pCi/kilogram (wet)

Nuclide		Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
K-40	Ind	3.87E+03	3.06E+03	4.60E+03	2.65E+02	3	3
K-40	Cntl	3.65E+03	3.26E+03	4.29E+03	2.76E+02	3	3
MN-54	Ind	3.07E+00	-9.66E-01	6.37E+00	2.25E+01	3	0
MN-54	Cntl	4.43E-01	-5.03E+00	6.84E+00	2.53E+01	3	0
CO-58	Ind	-5.26E+00	-1.28E+01	3.61E+00	3.25E+01	3	0
CO-58	Cntl	1.98E+00	-4.67E+00	9.23E+00	2.80E+01	3	0
FE-59	Ind	2.00E+01	9.66E+00	2.60E+01	7.99E+01	3	0
FE-59	Cntl	-3.85E+00	-2.23E+01	2.66E+01	8.15E+01	3	0
CO-60	Ind	-5.98E+00	-1.37E+01	7.17E+00	2.65E+01	3	0
CO-60	Cntl	1.99E+00	-7.18E+00	7.70E+00	2.69E+01	3	0
ZN-65	Ind	-7.83E+00	-2.34E+01	1.76E+01	5.60E+01	3	0
ZN-65	Cntl	2.43E+00	0.00E+00	5.35E+00	4.95E+01	3	0
ZRNB-95	Ind	-7.21E+00	-2.03E+01	1.97E+00	5.35E+01	3	0
ZRNB-95	Cntl	7.25E+00	-1.95E-01	2.10E+01	4.65E+01	3	0
CS-134	Ind	-7.10E+00	-1.18E+01	-2.63E+00	3.06E+01	3	0
CS-134	Cntl	2.53E+00	-7.65E+00	1.04E+01	3.54E+01	3	0
CS-137	Ind	9.42E+00	5.32E+00	1.48E+01	2.69E+01	3	0
CS-137	Cntl	1.16E+01	1.03E+01	1.31E+01	2.53E+01	3	0
Bi-214	Ind	6.92E+01	2.02E+01	1.53E+02	5.50E+01	3	1
Bi-214	Cntl	8.50E+01	2.92E+01	1.13E+02	5.44E+01	3	2

TABLE A-11.1
IODINE-131 IN MILK

Results in pCi/liter, decay corrected to sample collection time

Collection Date	Stations 36 & 36B Indicators				Station 9B Control			
	RQ	I-131 Activity	Error	I-131 MDA	RQ	I-131 Activity	Error	I-131 MDA
01/15/19		-6.91E-03 ±	3.08E-01	3.60E-01		6.77E-02 ±	2.16E-04	3.72E-01
02/12/19		4.34E-02 ±	2.83E-01	3.31E-01		8.36E-02 ±	2.88E-04	4.81E-01
03/12/19		1.46E-02 ±	3.55E-01	4.98E-01		1.95E-01 ±	5.24E-04	3.09E-01
04/09/19		1.58E-03 ±	2.62E-01	3.08E-01		-4.63E-02 ±	1.39E-04	3.50E-01
04/23/19		-3.51E-02 ±	2.16E-01	3.13E-01		-1.68E-01 ±	5.31E-04	3.65E-01
05/07/19		8.44E-02 ±	2.62E-01	3.06E-01		-9.33E-02 ±	2.95E-04	3.67E-01
**05/21/19		-1.49E-01 ±	5.28E-01	6.14E-01		1.48E-01 ±	3.88E-04	3.74E-01
06/04/19		-1.49E-01 ±	2.83E-01	4.05E-01		-1.11E-01 ±	3.85E-04	4.04E-01
**06/18/19		2.50E-01 ±	3.50E-01	4.99E-01		-1.10E-01 ±	3.68E-04	3.87E-01
07/09/19		-1.68E-01 ±	3.38E-01	3.91E-01		-3.89E-02 ±	1.08E-04	4.01E-01
**07/23/19		1.27E-02 ±	2.99E-01	3.50E-01		3.78E-02 ±	8.63E-05	3.31E-01
08/06/19		-2.05E-02 ±	3.24E-01	3.78E-01		-3.33E-02 ±	8.70E-05	3.78E-01
**08/20/19		1.36E-01 ±	4.47E-01	5.20E-01		-7.03E-02 ±	2.02E-04	4.15E-01
09/03/19		1.00E-01 ±	2.60E-01	3.73E-01		-1.42E-01 ±	4.78E-04	3.90E-01
**09/24/19		-5.02E-02 ±	2.64E-01	3.82E-01		-2.41E-02 ±	7.86E-05	3.82E-01
10/15/19		1.41E-01 ±	3.17E-01	3.67E-01		4.32E-02 ±	1.14E-04	3.82E-01
11/12/19		5.26E-02 ±	2.50E-01	3.62E-01		1.58E-01 ±	4.37E-04	3.95E-01
12/10/19		-5.84E-02 ±	2.63E-01	3.81E-01		1.73E-02 ±	5.47E-05	3.69E-01

**Collection Date for ST-36B

TABLE A-11.2
IODINE-131 IN MILK - SUMMARY

Results in pCi/liter, decay corrected to sample collection time

Station	Average Activity	Activity Low	Activity High	Average MDA	Number Samples	Number Positive IDs
Indicator- ST 36 & 36B	1.11E-02	-1.68E-01	2.50E-01	3.97E-01	18	0
Control - ST-9B	-4.77E-03	-1.68E-01	1.95E-01	3.81E-01	18	0

TABLE A-12.1
GAMMA SPECTROMETRY RESULTS OF MILK
STATION 36 & 36B - Indicators
Results in pCi/liter

Location & Date					Station 36	1/15/2019	Location & Date					Station 36	2/12/2019
Nuclide	RQ	Activity	Error	MDA			Nuclide	RQ	Activity	Error	MDA		
BA-133		2.26E+00 ±	4.37E+00	6.21E+00			BA-133		1.71E+00 ±	4.86E+00	6.99E+00		
CO-60		1.11E+00 ±	5.38E+00	7.02E+00			CO-60		4.78E+00 ±	2.47E+00	5.10E+00		
ZN-65		-5.00E+00 ±	1.33E+01	1.70E+01			ZN-65		-1.11E+00 ±	1.12E+01	1.50E+01		
MN-54		3.74E+00 ±	4.14E+00	5.23E+00			MN-54		-2.04E+00 ±	5.99E+00	7.89E+00		
CS-134		0.00E+00 ±	2.19E+00	8.42E+00			CS-134		2.81E-01 ±	4.81E+00	6.84E+00		
CS-137		4.00E-01 ±	5.18E+00	7.20E+00			CS-137		6.03E+00 ±	4.94E+00	6.19E+00		
BALA140		-5.70E-01 ±	6.13E+00	8.01E+00			BALA140		-1.07E+00 ±	7.54E+00	9.63E+00		
K-40	+	1.55E+03 ±	1.49E+02	6.98E+01			K-40	+	1.43E+03 ±	1.50E+02	8.25E+01		
FE-59		-5.32E+00 ±	1.75E+01	2.20E+01			FE-59		3.30E+00 ±	1.15E+01	1.50E+01		
ZRNB-95		3.68E+00 ±	6.40E+00	8.65E+00			ZRNB-95		-8.58E-01 ±	9.42E+00	1.31E+01		
BE-7		-7.17E-01 ±	3.66E+01	5.23E+01			BE-7		1.52E+01 ±	3.30E+01	4.59E+01		
Location & Date					Station 36	3/12/2019	Location & Date					Station 36	4/9/2019
Nuclide	RQ	Activity	Error	MDA			Nuclide	RQ	Activity	Error	MDA		
BA-133		-3.01E-01 ±	4.74E+00	6.99E+00			BA-133		9.31E-02 ±	4.73E+00	7.20E+00		
CO-60		-1.59E+00 ±	6.93E+00	8.86E+00			CO-60		-1.56E-01 ±	6.76E+00	9.02E+00		
ZN-65		1.03E+01 ±	6.61E+00	1.25E+01			ZN-65		6.64E+00 ±	9.05E+00	1.17E+01		
MN-54		1.81E+00 ±	4.84E+00	6.43E+00			MN-54		-9.53E-01 ±	5.03E+00	6.94E+00		
CS-134		-3.19E+00 ±	5.47E+00	7.45E+00			CS-134		-1.18E+00 ±	4.38E+00	6.35E+00		
CS-137		3.46E-01 ±	4.95E+00	6.93E+00			CS-137		-1.96E+00 ±	5.15E+00	7.18E+00		
BALA140		7.72E-01 ±	4.04E+00	5.61E+00			BALA140		0.00E+00 ±	7.96E-01	8.14E+00		
K-40	+	1.37E+03 ±	1.45E+02	7.33E+01			K-40	+	1.51E+03 ±	1.53E+02	7.93E+01		
FE-59		3.34E+00 ±	1.16E+01	1.52E+01			FE-59		-7.16E-01 ±	1.44E+01	1.93E+01		
ZRNB-95		2.40E+00 ±	7.23E+00	1.00E+01			ZRNB-95		0.00E+00 ±	4.25E+00	1.03E+01		
BE-7		0.00E+00 ±	1.50E+01	6.08E+01			BE-7		-4.49E+00 ±	3.14E+01	4.62E+01		
Location & Date					Station 36	4/23/2019	Location & Date					Station 36	5/7/2019
Nuclide	RQ	Activity	Error	MDA			Nuclide	RQ	Activity	Error	MDA		
BA-133		-2.55E+00 ±	6.08E+00	8.61E+00			BA-133		7.22E-01 ±	4.29E+00	6.49E+00		
CO-60		-2.13E+00 ±	6.65E+00	8.44E+00			CO-60		0.00E+00 ±	3.83E+00	1.33E+01		
ZN-65		-5.29E-01 ±	1.23E+01	1.62E+01			ZN-65		9.22E+00 ±	7.15E+00	1.37E+01		
MN-54		-1.65E+00 ±	5.17E+00	6.86E+00			MN-54		-1.78E+00 ±	4.95E+00	6.73E+00		
CS-134		8.04E-01 ±	3.98E+00	5.65E+00			CS-134		2.34E+00 ±	3.20E+00	4.48E+00		
CS-137		1.76E+00 ±	4.02E+00	5.50E+00			CS-137		0.00E+00 ±	1.04E+00	7.21E+00		
BALA140		1.40E+00 ±	5.19E+00	6.77E+00			BALA140		0.00E+00 ±	1.56E+00	9.06E+00		
K-40	+	1.39E+03 ±	1.45E+02	7.86E+01			K-40	+	1.48E+03 ±	1.49E+02	7.71E+01		
FE-59		1.16E+00 ±	1.23E+01	1.62E+01			FE-59		5.57E+00 ±	8.95E+00	1.16E+01		
ZRNB-95		6.29E-02 ±	7.10E+00	1.01E+01			ZRNB-95		2.01E+00 ±	5.65E+00	8.11E+00		
BE-7		-2.02E+01 ±	3.95E+01	5.42E+01			BE-7		-6.20E+00 ±	3.29E+01	4.80E+01		

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

TABLE A-12.1
GAMMA SPECTROMETRY RESULTS OF MILK
STATION 36 & 36B - Indicators
Results in pCi/liter

Location & Date					Station 36B	5/21/2019	Location & Date					Station 36	6/4/2019
Nuclide	RQ	Activity	Error	MDA			Nuclide	RQ	Activity	Error	MDA		
BA-133		-2.99E+00 ±	7.17E+00	1.01E+01			BA-133		-3.62E+00 ±	8.24E+00	1.16E+01		
CO-60		2.23E+00 ±	5.47E+00	7.16E+00			CO-60		-1.01E+00 ±	6.21E+00	8.25E+00		
ZN-65		2.89E+00 ±	1.35E+01	1.80E+01			ZN-65		-3.19E+00 ±	1.34E+01	1.79E+01		
MN-54		-1.38E-01 ±	5.41E+00	7.55E+00			MN-54		2.94E+00 ±	4.97E+00	6.64E+00		
CS-134		-1.87E-01 ±	5.50E+00	7.76E+00			CS-134		-1.86E-01 ±	5.68E+00	8.01E+00		
CS-137		-4.61E-01 ±	5.72E+00	8.14E+00			CS-137		1.60E+00 ±	5.65E+00	7.92E+00		
BALA140		3.61E+00 ±	5.87E+00	7.40E+00			BALA140		1.42E+00 ±	5.48E+00	7.29E+00		
K-40	+	1.53E+03 ±	1.50E+02	6.60E+01			K-40	+	1.32E+03 ±	1.41E+02	7.19E+01		
FE-59		-2.64E+00 ±	1.79E+01	2.35E+01			FE-59		-4.78E+00 ±	1.79E+01	2.32E+01		
ZRNB-95		7.91E-01 ±	9.41E+00	1.34E+01			ZRNB-95		-2.35E+00 ±	9.45E+00	1.33E+01		
BE-7		-9.69E+00 ±	4.63E+01	6.66E+01			BE-7		-8.10E+00 ±	4.16E+01	6.01E+01		
Location & Date					Station 36B	6/18/2019	Location & Date					Station 36	7/9/2019
Nuclide	RQ	Activity	Error	MDA			Nuclide	RQ	Activity	Error	MDA		
BA-133		3.99E-01 ±	5.57E+00	8.35E+00			BA-133		-3.09E+00 ±	7.20E+00	1.05E+01		
CO-60		4.12E+00 ±	3.99E+00	5.20E+00			CO-60		2.73E-01 ±	5.26E+00	7.48E+00		
ZN-65		2.73E+00 ±	1.05E+01	1.45E+01			ZN-65		-1.03E-01 ±	1.34E+01	1.85E+01		
MN-54		1.72E+00 ±	4.50E+00	6.32E+00			MN-54		-2.10E+00 ±	5.29E+00	7.35E+00		
CS-134		1.62E+00 ±	4.73E+00	6.77E+00			CS-134		4.73E-01 ±	4.75E+00	6.90E+00		
CS-137		-2.00E+00 ±	5.95E+00	8.51E+00			CS-137		1.66E+00 ±	5.13E+00	7.39E+00		
BALA140		1.17E+00 ±	6.51E+00	8.77E+00			BALA140		2.69E+00 ±	4.44E+00	5.82E+00		
K-40	+	1.96E+03 ±	1.69E+02	7.30E+01			K-40	+	1.44E+03 ±	1.52E+02	9.43E+01		
FE-59		-9.64E+00 ±	1.75E+01	2.27E+01			FE-59		-7.39E+00 ±	1.70E+01	2.22E+01		
ZRNB-95		-5.14E+00 ±	9.63E+00	1.32E+01			ZRNB-95		-2.87E+00 ±	9.77E+00	1.36E+01		
BE-7		2.77E+00 ±	4.03E+01	6.07E+01			BE-7		-2.33E+01 ±	4.21E+01	6.13E+01		
Location & Date					Station 36B	7/23/2019	Location & Date					Station 36	8/6/2019
Nuclide	RQ	Activity	Error	MDA			Nuclide	RQ	Activity	Error	MDA		
BA-133		-3.05E+00 ±	6.40E+00	9.23E+00			BA-133		2.63E+00 ±	7.52E+00	1.27E+01		
CO-60		-1.31E+00 ±	5.88E+00	7.55E+00			CO-60		3.16E+00 ±	3.79E+00	5.13E+00		
ZN-65		-1.99E+00 ±	1.12E+01	1.47E+01			ZN-65		-9.29E+00 ±	1.49E+01	1.97E+01		
MN-54		-9.48E-01 ±	4.93E+00	6.64E+00			MN-54		4.23E-01 ±	4.69E+00	6.73E+00		
CS-134		-7.77E-01 ±	4.43E+00	6.11E+00			CS-134		2.38E-01 ±	4.56E+00	6.68E+00		
CS-137		-3.18E+00 ±	6.03E+00	8.15E+00			CS-137		1.17E+00 ±	5.19E+00	7.53E+00		
BALA140		-6.39E-01 ±	5.86E+00	7.56E+00			BALA140		1.16E+00 ±	6.43E+00	8.66E+00		
K-40	+	1.54E+03 ±	1.29E+02	7.77E+01			K-40	+	1.25E+03 ±	1.36E+02	7.99E+01		
FE-59		-5.81E+00 ±	1.58E+01	1.99E+01			FE-59		-1.38E-01 ±	1.35E+01	1.86E+01		
ZRNB-95		1.68E+00 ±	7.28E+00	1.01E+01			ZRNB-95		-3.26E+00 ±	1.04E+01	1.44E+01		
BE-7		-1.68E+01 ±	3.72E+01	5.22E+01			BE-7		0.00E+00 ±	1.38E+01	4.96E+01		

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

TABLE A-12.1
GAMMA SPECTROMETRY RESULTS OF MILK
STATION 36 & 36B - Indicators
Results in pCi/liter

Location & Date					Station 36B	8/20/2019	Location & Date					Station 36	9/3/2019
Nuclide	RQ	Activity	Error	MDA			Nuclide	RQ	Activity	Error	MDA		
BA-133		-2.86E+00 ±	6.50E+00	9.48E+00			BA-133		-2.35E+00 ±	6.03E+00	8.84E+00		
CO-60		-3.01E+00 ±	6.26E+00	8.59E+00			CO-60		6.63E-01 ±	6.36E+00	8.84E+00		
ZN-65		1.68E+00 ±	1.04E+01	1.46E+01			ZN-65		-4.54E+00 ±	1.48E+01	2.00E+01		
MN-54		1.07E+00 ±	4.64E+00	6.58E+00			MN-54		-6.62E-01 ±	5.27E+00	7.50E+00		
CS-134		-1.76E+00 ±	4.94E+00	7.06E+00			CS-134		-3.46E+00 ±	6.19E+00	8.67E+00		
CS-137		-3.23E+00 ±	6.13E+00	8.64E+00			CS-137		-2.98E+00 ±	6.08E+00	8.61E+00		
BALA140		1.73E+00 ±	3.31E+00	4.54E+00			BALA140		-1.44E+00 ±	7.34E+00	9.78E+00		
K-40	+	1.32E+03 ±	1.42E+02	8.22E+01			K-40	+	1.63E+03 ±	1.61E+02	8.96E+01		
FE-59		5.89E+00 ±	1.05E+01	1.39E+01			FE-59		-4.75E+00 ±	1.53E+01	2.05E+01		
ZRNB-95		-6.04E+00 ±	1.07E+01	1.46E+01			ZRNB-95		-7.56E-01 ±	8.69E+00	1.24E+01		
BE-7		-2.25E+01 ±	4.61E+01	6.71E+01			BE-7		-2.02E+01 ±	4.40E+01	6.44E+01		
Location & Date					Station 36B	9/24/2019	Location & Date					Station 36	10/15/2019
Nuclide	RQ	Activity	Error	MDA			Nuclide	RQ	Activity	Error	MDA		
BA-133		-3.30E+00 ±	7.59E+00	1.07E+01			BA-133		-3.03E+00 ±	6.58E+00	9.27E+00		
CO-60		8.77E-01 ±	6.14E+00	8.18E+00			CO-60		-8.06E-01 ±	6.02E+00	7.97E+00		
ZN-65		-5.57E+00 ±	1.64E+01	2.14E+01			ZN-65		-9.66E+00 ±	1.54E+01	1.97E+01		
MN-54		-4.02E+00 ±	6.69E+00	8.84E+00			MN-54		-2.33E+00 ±	6.36E+00	8.53E+00		
CS-134		-2.21E+00 ±	6.58E+00	9.04E+00			CS-134		-2.03E+00 ±	5.78E+00	7.95E+00		
CS-137		2.27E-01 ±	4.94E+00	7.12E+00			CS-137		-1.87E+00 ±	5.72E+00	7.95E+00		
BALA140		-7.87E-02 ±	6.07E+00	8.22E+00			BALA140		-4.61E-01 ±	5.97E+00	8.01E+00		
K-40	+	2.00E+03 ±	1.75E+02	8.02E+01			K-40	+	1.48E+03 ±	1.46E+02	7.69E+01		
FE-59		-9.78E+00 ±	1.82E+01	2.30E+01			FE-59		-3.36E+00 ±	1.58E+01	2.06E+01		
ZRNB-95		-2.33E+00 ±	1.08E+01	1.51E+01			ZRNB-95		-3.61E-01 ±	7.67E+00	1.11E+01		
BE-7		-1.25E+01 ±	4.16E+01	5.97E+01			BE-7		1.58E+01 ±	3.39E+01	4.83E+01		
Location & Date					Station 36	11/12/2019	Location & Date					Station 36	12/10/2019
Nuclide	RQ	Activity	Error	MDA			Nuclide	RQ	Activity	Error	MDA		
BA-133		-3.14E-01 ±	7.26E+00	1.24E+01			BA-133		-3.12E+00 ±	7.61E+00	1.11E+01		
CO-60		1.64E+00 ±	4.49E+00	5.97E+00			CO-60		-9.04E-01 ±	6.21E+00	8.83E+00		
ZN-65		-1.84E+00 ±	1.33E+01	1.78E+01			ZN-65		-4.53E+00 ±	1.48E+01	2.00E+01		
MN-54		1.40E+00 ±	3.80E+00	5.24E+00			MN-54		-3.59E+00 ±	6.13E+00	8.36E+00		
CS-134		-3.44E+00 ±	5.96E+00	8.08E+00			CS-134		-2.31E+00 ±	5.68E+00	8.06E+00		
CS-137		0.00E+00 ±	1.55E+00	7.69E+00			CS-137		2.58E+00 ±	5.03E+00	7.17E+00		
BALA140		1.33E+00 ±	5.14E+00	6.84E+00			BALA140		-5.60E-01 ±	5.91E+00	8.15E+00		
K-40	+	1.38E+03 ±	1.39E+02	6.97E+01			K-40	+	1.44E+03 ±	1.59E+02	1.02E+02		
FE-59		-1.54E+01 ±	2.40E+01	2.98E+01			FE-59		-1.72E+00 ±	1.66E+01	2.24E+01		
ZRNB-95		-4.00E+00 ±	8.65E+00	1.20E+01			ZRNB-95		7.54E-01 ±	8.36E+00	1.20E+01		
BE-7		1.37E+01 ±	3.57E+01	5.11E+01			BE-7		-1.37E+01 ±	3.94E+01	5.83E+01		

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

TABLE A-12.1
GAMMA SPECTROMETRY RESULTS OF MILK
STATION 9B - Control
 Results in pCi/liter

Collection Date: 1/15/2019					Collection Date: 2/12/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BA-133		2.77E+00 ±	4.83E+00	6.83E+00	BA-133		-2.74E+00 ±	5.90E+00	8.35E+00
CO-60		1.18E+00 ±	5.71E+00	7.46E+00	CO-60		1.43E+00 ±	4.98E+00	6.52E+00
ZN-65		0.00E+00 ±	3.54E+00	2.15E+01	ZN-65		1.39E+00 ±	1.03E+01	1.38E+01
MN-54		0.00E+00 ±	2.70E+00	7.94E+00	MN-54		-8.85E-01 ±	5.92E+00	7.91E+00
CS-134		-1.19E+00 ±	4.35E+00	5.95E+00	CS-134		0.00E+00 ±	3.18E+00	6.63E+00
CS-137		1.89E+00 ±	4.56E+00	6.22E+00	CS-137		-7.30E-01 ±	5.50E+00	7.60E+00
BALA140		0.00E+00 ±	1.63E+00	7.21E+00	BALA140		3.33E+00 ±	4.58E+00	5.66E+00
K-40	+	1.40E+03 ±	1.46E+02	7.35E+01	K-40	+	1.38E+03 ±	1.53E+02	9.37E+01
FE-59		-1.60E+00 ±	1.45E+01	1.89E+01	FE-59		0.00E+00 ±	3.65E+00	2.49E+01
ZRNB-95		1.20E+00 ±	7.08E+00	9.98E+00	ZRNB-95		1.33E+00 ±	8.18E+00	1.14E+01
BE-7		9.92E+00 ±	3.43E+01	4.83E+01	BE-7		2.99E+01 ±	3.33E+01	4.43E+01

Collection Date: 3/12/2019					Collection Date: 4/9/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BA-133		-8.01E-01 ±	5.21E+00	7.58E+00	BA-133		-7.28E-01 ±	4.88E+00	7.13E+00
CO-60		-1.59E-01 ±	4.80E+00	6.50E+00	CO-60		3.57E+00 ±	4.42E+00	5.42E+00
ZN-65		6.66E+00 ±	1.18E+01	1.50E+01	ZN-65		-5.50E-01 ±	1.11E+01	1.48E+01
MN-54		1.34E+00 ±	4.78E+00	6.42E+00	MN-54		2.28E-01 ±	4.29E+00	5.93E+00
CS-134		-7.48E-01 ±	4.67E+00	6.61E+00	CS-134		1.86E+00 ±	4.72E+00	6.56E+00
CS-137		0.00E+00 ±	2.34E+00	8.74E+00	CS-137		-1.48E+00 ±	5.00E+00	6.86E+00
BALA140		0.00E+00 ±	1.20E+00	1.22E+01	BALA140		0.00E+00 ±	1.14E+00	1.06E+01
K-40	+	1.35E+03 ±	1.45E+02	7.78E+01	K-40	+	1.34E+03 ±	1.46E+02	8.21E+01
FE-59		3.46E+00 ±	1.33E+01	1.72E+01	FE-59		9.21E+00 ±	1.36E+01	1.69E+01
ZRNB-95		2.39E+00 ±	7.22E+00	1.00E+01	ZRNB-95		-1.24E+00 ±	9.36E+00	1.29E+01
BE-7		-1.91E+01 ±	4.30E+01	5.92E+01	BE-7		8.27E+00 ±	2.71E+01	3.87E+01

Collection Date: 4/23/2019					Collection Date: 5/7/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BA-133		-2.10E+00 ±	5.74E+00	8.18E+00	BA-133		-1.54E+00 ±	5.13E+00	7.60E+00
CO-60		1.04E+00 ±	4.00E+00	5.37E+00	CO-60		0.00E+00 ±	1.19E+00	1.04E+01
ZN-65		-2.99E+00 ±	1.20E+01	1.57E+01	ZN-65		-3.35E+00 ±	1.21E+01	1.61E+01
MN-54		2.07E+00 ±	4.09E+00	5.41E+00	MN-54		2.46E-01 ±	3.99E+00	5.66E+00
CS-134		-1.19E+00 ±	4.78E+00	6.70E+00	CS-134		1.38E+00 ±	3.54E+00	5.11E+00
CS-137		1.62E+00 ±	4.42E+00	6.06E+00	CS-137		-2.08E-01 ±	4.36E+00	6.31E+00
BALA140		2.65E-01 ±	5.21E+00	7.03E+00	BALA140		6.70E-02 ±	3.51E+00	5.21E+00
K-40	+	1.33E+03 ±	1.45E+02	8.17E+01	K-40	+	1.49E+03 ±	1.49E+02	7.62E+01
FE-59		0.00E+00 ±	4.07E+00	2.28E+01	FE-59		3.82E+00 ±	1.04E+01	1.38E+01
ZRNB-95		0.00E+00 ±	2.91E+00	1.17E+01	ZRNB-95		0.00E+00 ±	2.06E+00	1.28E+01
BE-7		1.49E+00 ±	3.93E+01	5.59E+01	BE-7		-7.09E+00 ±	3.06E+01	4.48E+01

TABLE A-12.1
GAMMA SPECTROMETRY RESULTS OF MILK
STATION 9B - Control
 Results in pCi/liter

Collection Date: 5/21/2019					Collection Date: 6/4/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BA-133		-3.17E+00 ±	7.49E+00	1.06E+01	BA-133		-3.21E+00 ±	7.22E+00	1.05E+01
CO-60		-3.06E+00 ±	7.96E+00	1.02E+01	CO-60		-2.84E+00 ±	6.61E+00	9.05E+00
ZN-65		-2.67E+00 ±	1.35E+01	1.80E+01	ZN-65		-8.12E+00 ±	1.47E+01	1.95E+01
MN-54		2.30E+00 ±	3.95E+00	5.33E+00	MN-54		2.15E-01 ±	4.18E+00	6.08E+00
CS-134		4.12E+00 ±	4.63E+00	6.17E+00	CS-134		-2.85E+00 ±	6.51E+00	1.09E+01
CS-137		-2.30E-01 ±	4.96E+00	7.16E+00	CS-137		1.71E-01 ±	5.17E+00	7.63E+00
BALAN-140		-1.21E+00 ±	7.10E+00	9.31E+00	BALAN-140		1.95E+00 ±	3.35E+00	4.52E+00
K-40	+	1.50E+03 ±	1.56E+02	8.78E+01	K-40	+	1.49E+03 ±	1.51E+02	8.63E+01
FE-59		1.32E+00 ±	1.43E+01	1.92E+01	FE-59		5.61E-01 ±	1.38E+01	1.90E+01
ZRN-95		-2.77E+00 ±	8.63E+00	1.22E+01	ZRN-95		-2.21E+00 ±	9.44E+00	1.33E+01
BE-7		2.73E+00 ±	3.79E+01	5.57E+01	BE-7		3.61E+00 ±	3.63E+01	5.49E+01
Collection Date: 6/18/2019					Collection Date: 7/9/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BA-133		-2.94E+00 ±	7.13E+00	1.01E+01	BA-133		-3.40E+00 ±	7.60E+00	1.07E+01
CO-60		-2.52E+00 ±	7.49E+00	9.66E+00	CO-60		3.27E+00 ±	5.23E+00	6.68E+00
ZN-65		-7.47E+00 ±	1.48E+01	1.92E+01	ZN-65		-6.32E+00 ±	1.34E+01	1.75E+01
MN-54		6.38E-01 ±	5.97E+00	8.21E+00	MN-54		-9.88E-01 ±	5.99E+00	8.18E+00
CS-134		-3.57E+00 ±	6.20E+00	8.42E+00	CS-134		2.55E+00 ±	4.47E+00	6.12E+00
CS-137		2.28E-01 ±	5.91E+00	8.42E+00	CS-137		1.72E+00 ±	4.82E+00	6.75E+00
BALAN-140		5.59E-01 ±	4.45E+00	6.21E+00	BALAN-140		-3.78E-01 ±	6.55E+00	8.70E+00
K-40	+	1.18E+03 ±	1.36E+02	8.07E+01	K-40	+	1.08E+03 ±	1.29E+02	8.03E+01
FE-59		2.76E+00 ±	1.43E+01	1.89E+01	FE-59		4.79E+00 ±	1.17E+01	1.54E+01
ZRN-95		1.96E+00 ±	6.98E+00	1.00E+01	ZRN-95		-3.70E+00 ±	9.31E+00	1.29E+01
BE-7		1.26E+01 ±	4.10E+01	5.89E+01	BE-7		8.49E+00 ±	3.67E+01	5.32E+01
Collection Date: 7/23/2019					Collection Date: 8/6/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BA-133		-3.29E+00 ±	7.55E+00	1.10E+01	BA-133		-1.01E+00 ±	5.03E+00	7.36E+00
CO-60		-2.78E-01 ±	6.27E+00	8.84E+00	CO-60		1.20E+00 ±	4.62E+00	5.99E+00
ZN-65		-1.73E+00 ±	1.18E+01	1.64E+01	ZN-65		5.86E+00 ±	9.57E+00	1.23E+01
MN-54		1.99E+00 ±	4.67E+00	6.52E+00	MN-54		8.66E-01 ±	4.48E+00	6.04E+00
CS-134		8.53E-01 ±	3.87E+00	5.67E+00	CS-134		-1.26E+00 ±	4.20E+00	5.75E+00
CS-137		-2.23E+00 ±	5.81E+00	8.31E+00	CS-137		1.42E+00 ±	4.61E+00	6.35E+00
BALAN-140		-3.38E-01 ±	5.40E+00	7.62E+00	BALAN-140		2.36E+00 ±	5.77E+00	7.22E+00
K-40	+	1.43E+03 ±	1.52E+02	9.00E+01	K-40	+	1.31E+03 ±	1.17E+02	7.39E+01
FE-59		-9.90E+00 ±	1.60E+01	2.08E+01	FE-59		3.53E+00 ±	1.35E+01	1.73E+01
ZRN-95		3.82E+00 ±	6.19E+00	8.58E+00	ZRN-95		-1.12E+00 ±	6.92E+00	9.66E+00
BE-7		-8.65E+00 ±	3.89E+01	5.81E+01	BE-7		-1.13E+01 ±	3.64E+01	5.14E+01

TABLE A-12.1
GAMMA SPECTROMETRY RESULTS OF MILK
STATION 9B - Control
 Results in pCi/liter

Collection Date: 8/20/2019					Collection Date: 9/3/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BA-133		-2.91E+00 ±	5.85E+00	8.44E+00	BA-133		-4.01E+00 ±	9.24E+00	1.29E+01
CO-60		4.07E+00 ±	4.69E+00	5.78E+00	CO-60		-2.36E+00 ±	7.19E+00	9.32E+00
ZN-65		-8.71E+00 ±	1.37E+01	1.75E+01	ZN-65		-8.23E+00 ±	1.64E+01	2.12E+01
MN-54		1.53E+00 ±	4.51E+00	6.04E+00	MN-54		1.24E+00 ±	5.51E+00	7.55E+00
CS-134		-3.07E+00 ±	5.48E+00	7.39E+00	CS-134		4.12E+00 ±	4.34E+00	5.75E+00
CS-137		1.80E+00 ±	5.05E+00	6.92E+00	CS-137		-9.22E-01 ±	5.15E+00	7.33E+00
BALAN140		-4.98E+00 ±	7.45E+00	9.06E+00	BALAN140		5.68E-01 ±	4.52E+00	6.31E+00
K-40	+	1.57E+03 ±	1.31E+02	7.82E+01	K-40	+	1.39E+03 ±	1.48E+02	7.96E+01
FE-59		1.82E+00 ±	1.30E+01	1.68E+01	FE-59		7.79E+00 ±	1.17E+01	1.50E+01
ZRNB-95		1.19E+00 ±	7.87E+00	1.10E+01	ZRNB-95		-1.19E+00 ±	9.15E+00	1.30E+01
BE-7		-2.21E+01 ±	4.15E+01	5.79E+01	BE-7		-1.15E+01 ±	4.14E+01	5.96E+01
Collection Date: 9/24/2019					Collection Date: 10/15/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BA-133		-3.11E+00 ±	7.15E+00	1.01E+01	BA-133		-3.12E+00 ±	6.98E+00	9.82E+00
CO-60		1.87E+00 ±	5.32E+00	7.02E+00	CO-60		1.57E+00 ±	5.38E+00	7.10E+00
ZN-65		-1.63E+00 ±	1.47E+01	1.96E+01	ZN-65		-3.77E+00 ±	1.43E+01	1.89E+01
MN-54		-6.33E-01 ±	6.44E+00	8.82E+00	MN-54		3.12E+00 ±	3.73E+00	4.88E+00
CS-134		-3.73E+00 ±	6.46E+00	8.76E+00	CS-134		1.71E-01 ±	4.69E+00	6.65E+00
CS-137		-1.58E+00 ±	6.07E+00	8.49E+00	CS-137		2.85E+00 ±	5.05E+00	6.93E+00
BALAN140		1.50E+00 ±	6.29E+00	8.27E+00	BALAN140		1.55E-01 ±	4.24E+00	6.01E+00
K-40	+	1.39E+03 ±	1.49E+02	8.56E+01	K-40	+	1.36E+03 ±	1.35E+02	6.03E+01
FE-59		9.24E+00 ±	1.48E+01	1.88E+01	FE-59		-1.22E+00 ±	1.41E+01	1.88E+01
ZRNB-95		0.00E+00 ±	3.89E+00	1.19E+01	ZRNB-95		7.31E-01 ±	6.76E+00	9.84E+00
BE-7		1.70E+01 ±	3.64E+01	5.18E+01	BE-7		-2.35E+01 ±	4.23E+01	5.95E+01
Collection Date: 11/12/2019					Collection Date: 12/10/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BA-133		-2.65E+00 ±	7.53E+00	1.27E+01	BA-133		-3.71E+00 ±	8.74E+00	1.47E+01
CO-60		-1.75E-01 ±	5.25E+00	7.13E+00	CO-60		-5.59E-01 ±	6.47E+00	8.61E+00
ZN-65		-1.09E+01 ±	1.72E+01	2.20E+01	ZN-65		5.20E+00 ±	1.28E+01	1.69E+01
MN-54		4.37E+00 ±	4.12E+00	5.25E+00	MN-54		-4.19E+00 ±	6.97E+00	9.19E+00
CS-134		-3.60E+00 ±	6.24E+00	8.45E+00	CS-134		3.42E+00 ±	6.83E+00	1.14E+01
CS-137		-3.36E+00 ±	6.50E+00	8.88E+00	CS-137		1.57E+00 ±	6.19E+00	8.65E+00
BALAN140		-1.57E+00 ±	6.95E+00	9.05E+00	BALAN140		-5.49E-01 ±	5.31E+00	7.24E+00
K-40	+	1.28E+03 ±	1.37E+02	7.80E+01	K-40	+	1.41E+03 ±	1.48E+02	8.40E+01
FE-59		6.43E+00 ±	1.29E+01	1.67E+01	FE-59		-1.47E+01 ±	2.31E+01	2.87E+01
ZRNB-95		-1.47E+00 ±	9.36E+00	1.32E+01	ZRNB-95		6.56E+00 ±	7.75E+00	1.04E+01
BE-7		7.90E+00 ±	3.91E+01	5.66E+01	BE-7		5.91E+00 ±	3.81E+01	5.55E+01

TABLE A-12.2
GAMMA SPECTROMETRY RESULTS OF MILK - SUMMARY
 Results in pCi/liter

Nuclide		Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
BA-133	Ind	-1.20E+00	-3.62E+00	2.63E+00	8.77E+00	18	0
BA-133	Cntl	-2.32E+00	-4.01E+00	2.77E+00	9.18E+00	18	0
CO-60	Ind	4.40E-01	-3.01E+00	4.78E+00	7.83E+00	18	0
CO-60	Cntl	4.04E-01	-3.06E+00	4.07E+00	7.21E+00	18	0
ZN-65	Ind	-7.72E-01	-9.66E+00	1.03E+01	1.68E+01	18	0
ZN-65	Cntl	-2.63E+00	-1.09E+01	6.66E+00	1.66E+01	18	0
MN-54	Ind	-3.94E-01	-4.02E+00	3.74E+00	7.02E+00	18	0
MN-54	Cntl	7.48E-01	-4.19E+00	4.37E+00	6.39E+00	18	0
CS-134	Ind	-8.31E-01	-3.46E+00	2.34E+00	7.24E+00	18	0
CS-134	Cntl	-1.52E-01	-3.73E+00	4.12E+00	6.79E+00	18	0
CS-137	Ind	4.99E-03	-3.23E+00	6.03E+00	7.50E+00	18	0
CS-137	Cntl	1.40E-01	-3.36E+00	2.85E+00	7.03E+00	18	0
BALAB140	Ind	5.81E-01	-1.44E+00	3.61E+00	7.68E+00	18	0
BALAB140	Cntl	9.63E-02	-4.98E+00	3.33E+00	7.23E+00	18	0
K-40	Ind	1.50E+03	1.25E+03	2.00E+03	7.91E+01	18	18
K-40	Cntl	1.37E+03	1.08E+03	1.57E+03	7.63E+01	18	18
FE-59	Ind	-2.90E+00	-1.54E+01	5.89E+00	2.00E+01	18	0
FE-59	Cntl	1.52E+00	-1.47E+01	9.24E+00	1.79E+01	18	0
ZRNB-95	Ind	-9.22E-01	-6.04E+00	3.68E+00	1.20E+01	18	0
ZRNB-95	Cntl	3.04E-01	-3.70E+00	6.56E+00	1.08E+01	18	0
BE-7	Ind	-6.16E+00	-2.33E+01	1.58E+01	5.59E+01	18	0
BE-7	Cntl	2.47E-01	-2.35E+01	2.99E+01	5.08E+01	18	0

Table A-13.1
GAMMA SPECTROMETRY RESULTS OF PLANT DISCHARGE WATER
STATION 27 - Plant Discharge Water Indicator
 Results in pCi/liter, corrected for decay during collection period

Location ST-27 collected 1/31/2019					Location ST-27 collected 3/4/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		-5.64E+00 ±	6.12E+01	7.53E+01	K-40		2.82E+01 ±	3.47E+01	4.90E+01
CR-51		5.17E+00 ±	4.29E+01	6.36E+01	CR-51		-9.62E+00 ±	3.35E+01	4.73E+01
MN-54		4.14E+00 ±	3.33E+00	4.17E+00	MN-54		2.32E-01 ±	3.05E+00	4.05E+00
CO-58		-1.47E+00 ±	4.64E+00	6.27E+00	CO-58		8.20E-01 ±	2.77E+00	3.67E+00
FE-59		-8.29E+00 ±	1.87E+01	2.31E+01	FE-59		4.57E-01 ±	9.04E+00	1.17E+01
CO-60		5.66E-01 ±	3.94E+00	5.12E+00	CO-60		6.43E-01 ±	2.65E+00	3.41E+00
ZN-65		0.00E+00 ±	1.78E+00	1.34E+01	ZN-65		-3.63E+00 ±	8.12E+00	1.02E+01
ZRNB-95		-2.24E+00 ±	8.40E+00	1.14E+01	ZRNB-95		7.54E-01 ±	5.82E+00	7.93E+00
I-131		-3.51E+00 ±	1.66E+01	2.37E+01	I-131		-2.18E+00 ±	8.82E+00	1.25E+01
CS-134		0.00E+00 ±	1.95E+00	4.72E+00	CS-134		-1.98E-01 ±	2.62E+00	3.66E+00
CS-137		2.75E-01 ±	3.64E+00	5.17E+00	CS-137		-1.12E-01 ±	2.82E+00	3.86E+00
BALA140		3.67E+00 ±	1.46E+01	1.80E+01	BALA140		5.05E+00 ±	6.57E+00	7.87E+00
BI-214		0.00E+00 ±	8.45E+00	1.77E+01	BI-214		1.52E+00 ±	4.38E+00	9.95E+00
Location ST-27 collected 4/1/2019					Location ST-27 collected 5/1/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		2.34E+01 ±	4.29E+01	5.78E+01	K-40		2.46E+01 ±	4.48E+01	6.28E+01
CR-51		1.27E+01 ±	2.63E+01	3.69E+01	CR-51		-8.70E+00 ±	2.92E+01	4.28E+01
MN-54		0.00E+00 ±	7.91E-01	5.16E+00	MN-54		5.99E-01 ±	2.47E+00	3.39E+00
CO-58		-6.73E-01 ±	3.05E+00	4.04E+00	CO-58		5.11E-01 ±	2.47E+00	3.42E+00
FE-59		7.09E+00 ±	8.01E+00	9.65E+00	FE-59		3.23E+00 ±	9.59E+00	1.24E+01
CO-60		1.33E+00 ±	2.96E+00	3.70E+00	CO-60		1.49E+00 ±	2.75E+00	3.52E+00
ZN-65		4.33E+00 ±	5.23E+00	6.48E+00	ZN-65		2.54E-01 ±	6.73E+00	9.04E+00
ZRNB-95		1.28E-01 ±	5.45E+00	7.50E+00	ZRNB-95		-5.96E-01 ±	5.28E+00	7.47E+00
I-131		9.63E-01 ±	7.06E+00	1.01E+01	I-131		-4.30E+00 ±	7.98E+00	1.15E+01
CS-134		4.74E-01 ±	2.47E+00	3.45E+00	CS-134		-2.16E-01 ±	2.32E+00	3.37E+00
CS-137		-4.64E-01 ±	3.01E+00	4.08E+00	CS-137		2.51E+00 ±	2.37E+00	3.12E+00
BALA140		-6.60E-01 ±	7.50E+00	9.46E+00	BALA140		0.00E+00 ±	1.03E+00	1.22E+01
BI-214		4.19E+00 ±	5.90E+00	1.03E+01	BI-214		5.01E+00 ±	6.49E+00	9.37E+00
Location ST-27 collected 5/30/2019					Location ST-27 collected 7/1/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		1.58E+00 ±	4.17E+01	5.96E+01	K-40		4.41E+01 ±	4.49E+01	6.28E+01
CR-51		-5.19E+00 ±	3.81E+01	5.40E+01	CR-51		-1.19E+00 ±	4.01E+01	5.91E+01
MN-54		-1.31E+00 ±	3.38E+00	4.50E+00	MN-54		7.29E-01 ±	2.96E+00	4.14E+00
CO-58		1.24E+00 ±	3.73E+00	5.00E+00	CO-58		-1.09E+00 ±	4.19E+00	5.79E+00
FE-59		1.11E+00 ±	1.01E+01	1.32E+01	FE-59		3.77E+00 ±	9.65E+00	1.28E+01
CO-60		-1.76E+00 ±	4.12E+00	5.22E+00	CO-60		1.47E-01 ±	3.27E+00	4.57E+00
ZN-65		-2.91E-01 ±	7.12E+00	9.50E+00	ZN-65		-2.07E-01 ±	7.34E+00	1.01E+01
ZRNB-95		5.94E-01 ±	5.83E+00	8.20E+00	ZRNB-95		2.35E+00 ±	5.72E+00	7.91E+00
I-131		5.05E-01 ±	1.07E+01	1.53E+01	I-131		-9.04E+00 ±	1.75E+01	2.52E+01
CS-134		-1.98E+00 ±	3.60E+00	4.87E+00	CS-134		-1.71E+00 ±	3.37E+00	4.71E+00
CS-137		2.03E+00 ±	3.76E+00	5.09E+00	CS-137		-3.94E-02 ±	3.01E+00	4.38E+00
BALA140		7.45E+00 ±	7.58E+00	9.03E+00	BALA140		1.05E+00 ±	8.71E+00	1.18E+01
BI-214		1.53E+00 ±	8.30E+00	1.19E+01	BI-214		2.46E+00 ±	8.39E+00	1.21E+01

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

Page 1 of 2

Table A-13.1
GAMMA SPECTROMETRY RESULTS OF PLANT DISCHARGE WATER
STATION 27 - Plant Discharge Water Indicator
 Results in pCi/liter, corrected for decay during collection period

Location ST-27 collected 7/31/2019					Location ST-27 collected 8/31/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		3.00E+01 ±	4.56E+01	6.42E+01	K-40		2.00E+01 ±	4.33E+01	6.28E+01
CR-51		2.83E-01 ±	3.16E+01	4.66E+01	CR-51		1.76E-01 ±	4.13E+01	6.09E+01
MN-54		-8.94E-01 ±	3.43E+00	4.73E+00	MN-54		9.40E-01 ±	3.05E+00	4.24E+00
CO-58		1.88E+00 ±	3.29E+00	4.49E+00	CO-58		-1.23E-01 ±	3.53E+00	5.00E+00
FE-59		-1.82E+00 ±	1.03E+01	1.38E+01	FE-59		-2.02E+00 ±	1.07E+01	1.43E+01
CO-60		-9.00E-01 ±	3.61E+00	5.04E+00	CO-60		1.82E+00 ±	3.12E+00	4.20E+00
ZN-65		-1.08E+00 ±	6.66E+00	9.10E+00	ZN-65		-5.19E-02 ±	6.75E+00	9.35E+00
ZRNB-95		2.33E+00 ±	6.06E+00	8.35E+00	ZRNB-95		-3.70E+00 ±	7.71E+00	1.05E+01
I-131		2.49E-01 ±	8.74E+00	1.29E+01	I-131		3.07E+00 ±	1.66E+01	2.44E+01
CS-134		-1.96E+00 ±	4.03E+00	6.73E+00	CS-134		-1.30E-01 ±	3.19E+00	4.58E+00
CS-137		-1.71E+00 ±	3.38E+00	4.75E+00	CS-137		1.08E+00 ±	3.06E+00	4.36E+00
BALA140		6.72E+00 ±	5.64E+00	1.04E+01	BALA140		2.51E+00 ±	1.05E+01	1.39E+01
BI-214	+	1.16E+01 ±	5.14E+00	6.59E+00	BI-214		5.95E+00 ±	7.55E+00	1.07E+01
Location ST-27 collected 10/1/2019					Location ST-27 collected 11/4/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		3.67E+01 ±	4.36E+01	6.47E+01	K-40		-2.34E+01 ±	4.09E+01	6.01E+01
CR-51		7.44E-01 ±	3.30E+01	4.88E+01	CR-51		-1.68E+01 ±	3.46E+01	4.97E+01
MN-54		-8.24E-01 ±	3.49E+00	4.83E+00	MN-54		-2.89E-01 ±	3.04E+00	4.07E+00
CO-58		-1.15E+00 ±	3.73E+00	5.15E+00	CO-58		1.94E+00 ±	3.06E+00	4.13E+00
FE-59		-2.15E+00 ±	1.05E+01	1.39E+01	FE-59		4.45E+00 ±	9.89E+00	1.24E+01
CO-60		9.93E-01 ±	3.18E+00	4.24E+00	CO-60		7.39E-01 ±	2.90E+00	3.71E+00
ZN-65		3.56E-01 ±	7.05E+00	9.69E+00	ZN-65		-4.16E+00 ±	7.26E+00	9.26E+00
ZRNB-95		2.83E+00 ±	6.35E+00	8.71E+00	ZRNB-95		-2.99E+00 ±	6.45E+00	8.73E+00
I-131		1.13E+00 ±	1.00E+01	1.48E+01	I-131		1.56E-01 ±	8.85E+00	1.30E+01
CS-134		-4.21E-01 ±	3.25E+00	4.64E+00	CS-134		-1.70E+00 ±	3.02E+00	4.06E+00
CS-137		4.93E-01 ±	3.00E+00	4.32E+00	CS-137		7.82E-01 ±	3.25E+00	4.43E+00
BALA140		-4.04E+00 ±	1.03E+01	1.32E+01	BALA140		0.00E+00 ±	4.00E+00	1.05E+01
BI-214		3.92E+00 ±	7.59E+00	1.12E+01	BI-214		2.98E+00 ±	7.31E+00	1.04E+01
Location ST-27 collected 12/2/2019					Location ST-27 collected 1/2/2020				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		4.20E+00 ±	4.22E+01	5.90E+01	K-40		2.46E+01 ±	3.64E+01	5.16E+01
CR-51		3.97E+00 ±	3.59E+01	5.08E+01	CR-51		1.53E+01 ±	3.59E+01	5.03E+01
MN-54		2.22E-01 ±	3.20E+00	4.34E+00	MN-54		-1.75E-01 ±	3.41E+00	4.62E+00
CO-58		-1.22E+00 ±	3.37E+00	4.51E+00	CO-58		-2.25E+00 ±	4.16E+00	5.48E+00
FE-59		1.01E+00 ±	9.20E+00	1.20E+01	FE-59		4.84E+00 ±	8.64E+00	1.10E+01
CO-60		1.37E+00 ±	2.19E+00	2.80E+00	CO-60		2.44E+00 ±	2.74E+00	3.38E+00
ZN-65		-4.92E+00 ±	8.36E+00	1.07E+01	ZN-65		-3.79E-01 ±	6.15E+00	8.27E+00
ZRNB-95		2.73E+00 ±	4.91E+00	6.72E+00	ZRNB-95		-4.69E+00 ±	7.54E+00	1.02E+01
I-131		3.02E+00 ±	9.12E+00	1.28E+01	I-131		3.67E+00 ±	1.21E+01	1.71E+01
CS-134		0.00E+00 ±	6.89E-01	4.25E+00	CS-134		1.54E+00 ±	3.19E+00	4.34E+00
CS-137		-9.86E-01 ±	3.39E+00	4.66E+00	CS-137		1.75E+00 ±	3.25E+00	4.42E+00
BALA140		-1.62E+00 ±	8.72E+00	1.11E+01	BALA140		-1.43E+00 ±	1.18E+01	1.49E+01
BI-214		4.99E+00 ±	8.27E+00	1.16E+01	BI-214		-1.11E+01 ±	7.77E+00	1.18E+01

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

Page 2 of 2

TABLE A-13.2
GAMMA SPECTROMETRY RESULTS OF PLANT DISCHARGE WATER - SUMMARY

Results in pCi/liter, corrected for decay during collection period

Nuclide	Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
K-40	1.74E+01	-2.34E+01	4.41E+01	6.08E+01	12	0
CR-51	-2.69E-01	-1.68E+01	1.53E+01	5.09E+01	12	0
MN-54	2.81E-01	-1.31E+00	4.14E+00	4.35E+00	12	0
CO-58	-1.33E-01	-2.25E+00	1.94E+00	4.74E+00	12	0
FE-59	9.73E-01	-8.29E+00	7.09E+00	1.34E+01	12	0
CO-60	7.40E-01	-1.76E+00	2.44E+00	4.08E+00	12	0
ZN-65	-8.15E-01	-4.92E+00	4.33E+00	9.60E+00	12	0
ZRNB-95	-4.15E-01	-4.69E+00	2.73E+00	8.71E+00	12	0
I-131	-5.22E-01	-9.04E+00	3.67E+00	1.61E+01	12	0
CS-134	-5.25E-01	-1.98E+00	1.54E+00	4.45E+00	12	0
CS-137	4.68E-01	-1.71E+00	2.51E+00	4.39E+00	12	0
BALA140	1.56E+00	-4.04E+00	7.45E+00	1.19E+01	12	0
BI-214	2.75E+00	-1.11E+01	1.16E+01	1.11E+01	12	1

Table A-14.1
GAMMA SPECTROMETRY RESULTS OF DEEP GROUND WATER
Deep Ground Water Wells - Stations 31, 32, and 52

Results in pCi/liter

Location ST-31 collected 3/6/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		6.06E+01 ±	8.01E+01	1.09E+02
CR-51		5.74E+00 ±	5.25E+01	7.44E+01
MN-54		-1.12E+00 ±	7.03E+00	9.19E+00
CO-58		0.00E+00 ±	1.29E+00	8.00E+00
FE-59		-6.94E+00 ±	1.69E+01	2.09E+01
CO-60		3.95E+00 ±	5.91E+00	7.07E+00
ZN-65		2.11E+00 ±	1.27E+01	1.61E+01
ZRNB-95		5.23E+00 ±	1.05E+01	1.36E+01
I-131		-5.92E+00 ±	7.74E+00	1.07E+01
CS-134		-2.61E+00 ±	7.49E+00	9.89E+00
CS-137		6.67E+00 ±	6.18E+00	7.89E+00
BALA140		1.23E+00 ±	7.45E+00	9.09E+00
BI-214	+	1.79E+02 ±	2.54E+01	2.62E+01

Location ST-31 collected 6/3/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		4.10E+01 ±	8.73E+01	1.19E+02
CR-51		6.57E+00 ±	5.78E+01	8.17E+01
MN-54		-5.97E-01 ±	6.79E+00	9.17E+00
CO-58		7.10E-01 ±	6.24E+00	8.45E+00
FE-59		3.34E+00 ±	1.76E+01	2.26E+01
CO-60		-1.53E+00 ±	7.53E+00	9.67E+00
ZN-65		-1.58E+00 ±	1.54E+01	2.63E+01
ZRNB-95		2.67E+00 ±	1.25E+01	1.67E+01
I-131		-2.53E+00 ±	8.57E+00	1.20E+01
CS-134		-4.48E+00 ±	1.10E+01	1.84E+01
CS-137		-5.42E+00 ±	9.25E+00	1.25E+01
BALA140		1.99E+00 ±	6.25E+00	7.99E+00
BI-214	+	6.25E+01 ±	2.08E+01	2.52E+01

Location ST-31 collected 9/17/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		7.95E+01 ±	8.62E+01	1.20E+02
CR-51		-1.74E+01 ±	6.55E+01	9.54E+01
MN-54		2.39E+00 ±	6.22E+00	8.57E+00
CO-58		0.00E+00 ±	2.63E+00	9.05E+00
FE-59		-1.29E+01 ±	2.17E+01	2.78E+01
CO-60		1.68E+00 ±	6.31E+00	8.66E+00
ZN-65		-1.18E+01 ±	1.84E+01	2.42E+01
ZRNB-95		7.35E+00 ±	1.12E+01	1.52E+01
I-131		6.21E+00 ±	1.20E+01	1.74E+01
CS-134		1.07E+00 ±	6.46E+00	9.21E+00
CS-137		-4.70E+00 ±	8.62E+00	1.20E+01
BALA140		7.95E+00 ±	1.01E+01	1.26E+01
BI-214		1.59E+01 ±	1.88E+01	2.65E+01

Location ST-31 collected 12/4/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		9.04E+01 ±	8.19E+01	1.10E+02
CR-51		-1.10E+01 ±	6.83E+01	9.61E+01
MN-54		2.33E+00 ±	7.15E+00	9.52E+00
CO-58		5.46E+00 ±	6.50E+00	8.43E+00
FE-59		6.82E+00 ±	1.65E+01	2.11E+01
CO-60		4.45E-01 ±	6.29E+00	8.24E+00
ZN-65		-9.88E+00 ±	2.04E+01	3.40E+01
ZRNB-95		1.49E+00 ±	1.27E+01	1.71E+01
I-131		-1.35E+00 ±	1.11E+01	1.57E+01
CS-134		6.12E+00 ±	1.16E+01	1.92E+01
CS-137		-5.22E+00 ±	8.89E+00	1.20E+01
BALA140		-6.98E+00 ±	1.20E+01	1.47E+01
BI-214	+	1.03E+02 ±	2.03E+01	2.40E+01

Location ST-32 collected 3/6/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		5.41E+01 ±	9.15E+01	1.21E+02
CR-51		-5.35E+01 ±	7.04E+01	9.70E+01
MN-54		2.88E+00 ±	6.89E+00	8.89E+00
CO-58		3.98E+00 ±	6.81E+00	8.72E+00
FE-59		-1.23E+01 ±	2.17E+01	2.64E+01
CO-60		0.00E+00 ±	1.40E+00	1.21E+01
ZN-65		1.92E+00 ±	1.45E+01	1.82E+01
ZRNB-95		1.12E+00 ±	1.21E+01	1.60E+01
I-131		-3.96E+00 ±	1.09E+01	1.53E+01
CS-134		2.88E+00 ±	7.01E+00	9.25E+00
CS-137		-2.70E+00 ±	8.15E+00	1.08E+01
BALA140		8.16E+00 ±	8.98E+00	1.03E+01
BI-214	+	3.95E+02 ±	3.23E+01	2.63E+01

Location ST-32 collected 6/3/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		1.40E+02 ±	8.99E+01	1.60E+02
CR-51		-1.76E+01 ±	6.35E+01	9.22E+01
MN-54		4.13E+00 ±	6.03E+00	8.14E+00
CO-58		-9.94E-01 ±	6.92E+00	9.62E+00
FE-59		1.54E+01 ±	1.32E+01	1.62E+01
CO-60		-4.72E+00 ±	8.54E+00	1.15E+01
ZN-65		-7.09E+00 ±	1.97E+01	3.32E+01
ZRNB-95		2.08E+00 ±	1.09E+01	1.52E+01
I-131		3.56E+00 ±	9.15E+00	1.33E+01
CS-134		-1.42E+00 ±	1.27E+01	2.14E+01
CS-137		3.95E-01 ±	7.10E+00	1.02E+01
BALA140		7.53E+00 ±	8.09E+00	9.93E+00
BI-214	+	1.47E+02 ±	2.13E+01	2.23E+01

Table A-14.1
GAMMA SPECTROMETRY RESULTS OF DEEP GROUND WATER
Deep Ground Water Wells - Stations 31, 32, and 52

Results in pCi/liter

Location ST-32 collected				9/17/2019
Nuclide	RQ	Activity	Error	MDA
K-40		5.18E+01 ±	8.17E+01	1.13E+02
CR-51		2.64E+00 ±	7.16E+01	1.01E+02
MN-54		-2.47E+00 ±	8.39E+00	1.11E+01
CO-58		-1.21E-01 ±	7.52E+00	1.02E+01
FE-59		-3.10E+00 ±	2.02E+01	2.60E+01
CO-60		-2.58E+00 ±	8.04E+00	1.02E+01
ZN-65		-3.85E+00 ±	1.84E+01	3.11E+01
ZRNB-95		-8.76E+00 ±	1.48E+01	1.93E+01
I-131		1.10E+00 ±	1.49E+01	2.12E+01
CS-134		-5.51E-01 ±	1.18E+01	1.98E+01
CS-137		3.24E+00 ±	8.21E+00	1.12E+01
BALA140		-6.06E+00 ±	1.33E+01	1.64E+01
BI-214	+	1.07E+02 ±	2.28E+01	2.50E+01

Location ST-32 collected				12/4/2019
Nuclide	RQ	Activity	Error	MDA
K-40		6.47E+01 ±	1.07E+02	1.44E+02
CR-51		3.75E+00 ±	6.91E+01	1.01E+02
MN-54		-1.97E+00 ±	7.99E+00	1.10E+01
CO-58		4.04E+00 ±	7.31E+00	9.92E+00
FE-59		5.21E-01 ±	1.62E+01	2.20E+01
CO-60		-5.10E-01 ±	8.03E+00	1.10E+01
ZN-65		2.03E+00 ±	2.62E+01	4.43E+01
ZRNB-95		-7.04E-01 ±	1.26E+01	1.75E+01
I-131		1.27E+00 ±	1.09E+01	1.60E+01
CS-134		5.17E+00 ±	1.78E+01	2.96E+01
CS-137		-5.91E+00 ±	1.04E+01	1.45E+01
BALA140		6.73E-01 ±	4.55E+00	8.37E+00
BI-214	+	4.00E+02 ±	3.19E+01	2.51E+01

Location ST-52 collected				3/4/2019
Nuclide	RQ	Activity	Error	MDA
K-40		7.33E+01 ±	7.76E+01	1.06E+02
CR-51		-1.34E+01 ±	5.37E+01	7.59E+01
MN-54		3.13E-01 ±	5.38E+00	7.18E+00
CO-58		5.55E+00 ±	5.46E+00	6.82E+00
FE-59		0.00E+00 ±	3.78E+00	2.28E+01
CO-60		-2.43E+00 ±	7.70E+00	9.35E+00
ZN-65		2.06E+00 ±	1.23E+01	1.55E+01
ZRNB-95		0.00E+00 ±	4.91E+00	1.71E+01
I-131		-6.86E-01 ±	8.00E+00	1.14E+01
CS-134		5.20E+00 ±	5.19E+00	6.66E+00
CS-137		5.84E+00 ±	5.82E+00	7.47E+00
BALA140		4.18E+00 ±	9.67E+00	1.15E+01
BI-214	+	3.63E+01 ±	1.66E+01	2.23E+01

Location ST-52 collected				6/3/2019
Nuclide	RQ	Activity	Error	MDA
K-40		5.96E+01 ±	8.43E+01	1.15E+02
CR-51		7.70E+00 ±	5.95E+01	8.40E+01
MN-54		1.12E-01 ±	7.40E+00	1.00E+01
CO-58		-1.36E+00 ±	6.36E+00	8.56E+00
FE-59		1.18E-01 ±	1.55E+01	2.03E+01
CO-60		3.98E+00 ±	6.04E+00	7.58E+00
ZN-65		-3.61E+00 ±	1.63E+01	2.12E+01
ZRNB-95		4.23E+00 ±	1.22E+01	1.62E+01
I-131		2.02E+00 ±	8.42E+00	1.19E+01
CS-134		-5.76E+00 ±	9.46E+00	1.27E+01
CS-137		1.71E+00 ±	7.71E+00	1.06E+01
BALA140		-5.51E-01 ±	9.22E+00	1.18E+01
BI-214		2.53E+01 ±	2.13E+01	2.88E+01

Location ST-52 collected				9/17/2019
Nuclide	RQ	Activity	Error	MDA
K-40		2.55E+01 ±	9.14E+01	1.30E+02
CR-51		6.00E+00 ±	6.17E+01	9.07E+01
MN-54		-3.98E-01 ±	6.45E+00	9.04E+00
CO-58		-3.37E+00 ±	7.57E+00	1.03E+01
FE-59		-4.03E+00 ±	2.01E+01	2.65E+01
CO-60		6.64E-01 ±	6.75E+00	9.30E+00
ZN-65		4.78E-01 ±	1.39E+01	1.91E+01
ZRNB-95		-4.79E+00 ±	1.39E+01	1.91E+01
I-131		-4.26E-01 ±	1.29E+01	1.91E+01
CS-134		4.68E+00 ±	6.71E+00	9.30E+00
CS-137		-6.71E-01 ±	7.17E+00	1.03E+01
BALA140		-9.94E+00 ±	1.50E+01	1.87E+01
BI-214		-1.87E+01 ±	1.72E+01	2.60E+01

Location ST-52 collected				12/5/2019
Nuclide	RQ	Activity	Error	MDA
K-40		6.50E+01 ±	8.67E+01	1.17E+02
CR-51		-1.59E+01 ±	6.58E+01	9.25E+01
MN-54		-3.65E+00 ±	8.09E+00	1.07E+01
CO-58		3.09E+00 ±	6.08E+00	8.06E+00
FE-59		1.59E+01 ±	1.40E+01	1.68E+01
CO-60		-5.04E+00 ±	8.18E+00	1.02E+01
ZN-65		1.33E+00 ±	1.37E+01	1.82E+01
ZRNB-95		-3.17E+00 ±	1.26E+01	1.68E+01
I-131		-8.87E-01 ±	1.00E+01	1.43E+01
CS-134		-2.20E+00 ±	7.98E+00	1.09E+01
CS-137		4.00E+00 ±	7.03E+00	9.53E+00
BALA140		-7.61E+00 ±	1.19E+01	1.44E+01
BI-214		-3.57E+00 ±	1.96E+01	2.78E+01

TABLE A-14.2
GAMMA SPECTROMETRY RESULTS OF DEEP GROUND WATER - SUMMARY

Results in pCi/liter

Nuclide	Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
K-40	6.72E+01	2.55E+01	1.40E+02	1.22E+02	12	0
CR-51	-8.03E+00	-5.35E+01	7.70E+00	9.02E+01	12	0
MN-54	1.63E-01	-3.65E+00	4.13E+00	9.37E+00	12	0
CO-58	1.41E+00	-3.37E+00	5.55E+00	8.85E+00	12	0
FE-59	2.31E-01	-1.29E+01	1.59E+01	2.25E+01	12	0
CO-60	-5.07E-01	-5.04E+00	3.98E+00	9.57E+00	12	0
ZN-65	-2.32E+00	-1.18E+01	2.11E+00	2.51E+01	12	0
ZRNB-95	7.34E-01	-8.76E+00	7.35E+00	1.65E+01	12	0
I-131	-1.35E-01	-5.92E+00	6.21E+00	1.49E+01	12	0
CS-134	6.75E-01	-5.76E+00	6.12E+00	1.47E+01	12	0
CS-137	-2.30E-01	-5.91E+00	6.67E+00	1.07E+01	12	0
BALA140	4.71E-02	-9.94E+00	8.16E+00	1.21E+01	12	0
BI-214	1.21E+02	-1.87E+01	4.00E+02	2.55E+01	12	8

TABLE A-15.1
GAMMA SPECTROMETRY RESULTS OF ROOT CROPS

Results in pCi/kilogram (wet)

Station 37B is Indicator - Station 9C is Control

Station 37B Onion collected					7/9/2019
Nuclide	RQ	Activity	Error	MDA	
K-40	+	1.26E+03	± 2.25E+02	2.08E+02	
MN-54		5.42E+00	± 1.25E+01	1.66E+01	
CO-58		5.14E+00	± 1.02E+01	1.36E+01	
FE-59		-6.71E+00	± 3.09E+01	4.00E+01	
CO-60		-5.74E+00	± 1.48E+01	1.89E+01	
ZN-65		-2.44E+00	± 2.84E+01	3.75E+01	
ZRNB-95		7.15E+00	± 1.86E+01	2.49E+01	
I-131		-2.70E+00	± 1.38E+01	1.95E+01	
CS-134		-6.67E+00	± 1.36E+01	1.85E+01	
CS-137		-8.57E+00	± 1.54E+01	2.08E+01	
BALA140		-3.26E+00	± 1.62E+01	2.05E+01	

Station 37B Potato collected					7/9/2019
Nuclide	RQ	Activity	Error	MDA	
K-40	+	3.81E+03	± 3.49E+02	1.32E+02	
MN-54		2.10E+00	± 9.94E+00	1.38E+01	
CO-58		3.50E+00	± 7.73E+00	1.07E+01	
FE-59		1.06E+01	± 2.49E+01	3.29E+01	
CO-60		3.17E+00	± 1.05E+01	1.40E+01	
ZN-65		-1.98E+01	± 3.15E+01	4.06E+01	
ZRNB-95		-8.66E-01	± 1.76E+01	2.55E+01	
I-131		2.04E+00	± 9.18E+00	1.34E+01	
CS-134		3.65E+00	± 9.88E+00	1.38E+01	
CS-137		-4.48E+00	± 1.09E+01	1.53E+01	
BALA140		7.41E+00	± 5.25E+00	1.48E+01	

Station 37B Potato collected					8/28/2019
Nuclide	RQ	Activity	Error	MDA	
K-40	+	4.33E+03	± 4.02E+02	1.58E+02	
MN-54		-5.67E-01	± 9.85E+00	1.45E+01	
CO-58		3.35E+00	± 9.43E+00	1.35E+01	
FE-59		5.49E+00	± 2.89E+01	4.01E+01	
CO-60		6.46E-01	± 9.75E+00	1.42E+01	
ZN-65		-9.44E+00	± 2.80E+01	3.85E+01	
ZRNB-95		4.82E+00	± 1.72E+01	2.46E+01	
I-131		2.29E-01	± 8.83E+00	1.35E+01	
CS-134		-5.48E-01	± 9.79E+00	1.46E+01	
CS-137		-7.43E+00	± 1.32E+01	1.87E+01	
BALA140		-1.21E+01	± 1.90E+01	2.41E+01	

Station 37B Onion collected					8/28/2019
Nuclide	RQ	Activity	Error	MDA	
K-40	+	1.15E+03	± 2.41E+02	2.06E+02	
MN-54		-6.10E+00	± 1.35E+01	1.82E+01	
CO-58		1.77E+00	± 9.04E+00	1.33E+01	
FE-59		9.68E+00	± 3.28E+01	4.35E+01	
CO-60		-4.78E+00	± 1.58E+01	2.08E+01	
ZN-65		5.58E+00	± 1.85E+01	2.58E+01	
ZRNB-95		-3.04E+00	± 1.56E+01	2.28E+01	
I-131		-6.26E-01	± 9.56E+00	1.45E+01	
CS-134		-3.34E+00	± 9.10E+00	1.29E+01	
CS-137		-4.73E+00	± 1.24E+01	1.74E+01	
BALA140		7.31E+00	± 9.76E+00	1.23E+01	

Station 37B Potato collected					9/18/2019
Nuclide	RQ	Activity	Error	MDA	
K-40	+	3.63E+03	± 3.25E+02	1.33E+02	
MN-54		4.81E+00	± 6.64E+00	9.08E+00	
CO-58		2.69E+00	± 8.05E+00	1.15E+01	
FE-59		1.24E+01	± 2.89E+01	3.85E+01	
CO-60		3.94E+00	± 9.06E+00	1.23E+01	
ZN-65		8.80E+00	± 2.18E+01	2.98E+01	
ZRNB-95		5.44E+00	± 1.23E+01	1.75E+01	
I-131		-4.58E-01	± 1.09E+01	1.66E+01	
CS-134		2.94E+00	± 7.20E+00	1.04E+01	
CS-137		-3.61E+00	± 9.05E+00	1.31E+01	
BALA140		3.41E+00	± 8.21E+00	1.16E+01	

Station 37B Onion collected					9/18/2019
Nuclide	RQ	Activity	Error	MDA	
K-40	+	1.61E+03	± 2.15E+02	1.22E+02	
MN-54		-1.33E+00	± 7.32E+00	1.07E+01	
CO-58		4.09E+00	± 6.18E+00	8.57E+00	
FE-59		2.76E+00	± 1.88E+01	2.69E+01	
CO-60		-4.62E+00	± 1.11E+01	1.48E+01	
ZN-65		6.31E+00	± 1.81E+01	2.52E+01	
ZRNB-95		8.67E+00	± 8.58E+00	1.11E+01	
I-131		-1.94E+00	± 1.03E+01	1.56E+01	
CS-134		2.83E+00	± 6.69E+00	9.70E+00	
CS-137		3.05E+00	± 8.32E+00	1.21E+01	
BALA140		-2.03E-01	± 1.05E+01	1.54E+01	

Station 37B Onion collected					10/3/2019
Nuclide	RQ	Activity	Error	MDA	
K-40	+	9.42E+02	± 1.36E+02	7.83E+01	
MN-54		-3.06E-01	± 6.32E+00	8.89E+00	
CO-58		1.19E+00	± 5.13E+00	7.24E+00	
FE-59		3.89E+00	± 1.13E+01	1.56E+01	
CO-60		5.88E+00	± 5.35E+00	6.72E+00	
ZN-65		-2.96E-01	± 1.25E+01	1.76E+01	
ZRNB-95		4.27E+00	± 7.30E+00	1.02E+01	
I-131		1.58E+00	± 5.57E+00	8.23E+00	
CS-134		-2.48E+00	± 6.24E+00	8.67E+00	
CS-137		-6.07E-01	± 6.64E+00	9.54E+00	
BALA140		0.00E+00	± 1.31E+00	4.83E+00	

Station 37B Potato collected					10/3/2019
Nuclide	RQ	Activity	Error	MDA	
K-40	+	3.46E+03	± 2.78E+02	9.01E+01	
MN-54		2.93E+00	± 6.71E+00	9.16E+00	
CO-58		3.56E-01	± 7.36E+00	1.04E+01	
FE-59		-8.87E+00	± 2.90E+01	3.74E+01	
CO-60		1.63E+00	± 8.73E+00	1.17E+01	
ZN-65		2.53E+00	± 1.86E+01	2.52E+01	
ZRNB-95		6.19E-01	± 1.20E+01	1.75E+01	
I-131		1.37E+00	± 9.07E+00	1.32E+01	
CS-134		-4.36E+00	± 7.63E+00	1.04E+01	
CS-137		-5.50E+00	± 1.00E+01	1.37E+01	
BALA140		2.39E+00	± 6.35E+00	8.83E+00	

TABLE A-15.1
GAMMA SPECTROMETRY RESULTS OF ROOT CROPS

Results in pCi/kilogram (wet)

Station 37B is Indicator - Station 9C is Control

Station 9C Onion collected 7/12/2019					Station 9C Potato collected 8/16/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40	+	1.12E+03 ±	1.91E+02	1.76E+02	K-40	+	4.54E+03 ±	3.67E+02	1.07E+02
MN-54		3.57E+00 ±	1.16E+01	1.56E+01	MN-54		3.45E+00 ±	8.95E+00	1.23E+01
CO-58		5.80E+00 ±	1.12E+01	1.49E+01	CO-58		8.37E+00 ±	8.48E+00	1.09E+01
FE-59		2.42E+01 ±	2.60E+01	3.19E+01	FE-59		-1.55E+01 ±	3.97E+01	5.08E+01
CO-60		1.20E+00 ±	1.22E+01	1.60E+01	CO-60		2.96E+00 ±	9.78E+00	1.31E+01
ZN-65		-7.99E+00 ±	2.79E+01	3.65E+01	ZN-65		-1.35E+01 ±	3.11E+01	4.06E+01
ZRNB-95		-3.72E+00 ±	2.50E+01	3.36E+01	ZRNB-95		3.26E+00 ±	1.53E+01	2.20E+01
I-131		-1.20E+00 ±	1.84E+01	2.62E+01	I-131		-6.37E+00 ±	1.19E+01	1.67E+01
CS-134		-7.81E+00 ±	1.68E+01	2.80E+01	CS-134		7.57E-01 ±	9.01E+00	1.29E+01
CS-137		-2.62E+00 ±	1.42E+01	1.96E+01	CS-137		-6.97E+00 ±	1.30E+01	1.78E+01
BALA140		-3.87E+00 ±	1.92E+01	2.44E+01	BALA140		-1.45E+00 ±	1.01E+01	1.41E+01
Station 9C Potato collected 9/13/2019									
Nuclide	RQ	Activity	Error	MDA					
K-40	+	3.87E+03 ±	3.99E+02	1.59E+02					
MN-54		4.11E+00 ±	1.22E+01	1.69E+01					
CO-58		-3.28E+00 ±	1.36E+01	1.94E+01					
FE-59		-1.29E+01 ±	4.70E+01	6.15E+01					
CO-60		3.81E+00 ±	1.21E+01	1.64E+01					
ZN-65		1.60E+01 ±	2.64E+01	3.47E+01					
ZRNB-95		-9.09E+00 ±	2.49E+01	3.49E+01					
I-131		-3.05E+00 ±	1.64E+01	2.46E+01					
CS-134		-1.53E+00 ±	1.13E+01	1.62E+01					
CS-137		-7.53E+00 ±	1.43E+01	1.97E+01					
BALA140		4.93E+00 ±	1.67E+01	2.25E+01					

TABLE A - 15.2
GAMMA SPECTROMETRY RESULTS OF ROOT CROPS - SUMMARY

Results in pCi/kilogram (wet)

Nuclide		Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
K-40	Ind	2.52E+03	9.42E+02	4.33E+03	1.41E+02	8	8
K-40	Cntl	3.17E+03	1.12E+03	4.54E+03	1.48E+02	3	3
MN-54	Ind	8.69E-01	-6.10E+00	5.42E+00	1.26E+01	8	0
MN-54	Cntl	3.71E+00	3.45E+00	4.11E+00	1.49E+01	3	0
CO-58	Ind	2.76E+00	3.56E-01	5.14E+00	1.11E+01	8	0
CO-58	Cntl	3.63E+00	-3.28E+00	8.37E+00	1.50E+01	3	0
FE-59	Ind	3.66E+00	-8.87E+00	1.24E+01	3.44E+01	8	0
FE-59	Cntl	-1.41E+00	-1.55E+01	2.42E+01	4.81E+01	3	0
CO-60	Ind	1.48E-02	-5.74E+00	5.88E+00	1.42E+01	8	0
CO-60	Cntl	2.66E+00	1.20E+00	3.81E+00	1.52E+01	3	0
ZN-65	Ind	-1.10E+00	-1.98E+01	8.80E+00	3.00E+01	8	0
ZN-65	Cntl	-1.84E+00	-1.35E+01	1.60E+01	3.72E+01	3	0
ZRNB-95	Ind	3.38E+00	-3.04E+00	8.67E+00	1.93E+01	8	0
ZRNB-95	Cntl	-3.18E+00	-9.09E+00	3.26E+00	3.02E+01	3	0
I-131	Ind	-6.39E-02	-2.70E+00	2.04E+00	1.43E+01	8	0
I-131	Cntl	-3.54E+00	-6.37E+00	-1.20E+00	2.25E+01	3	0
CS-134	Ind	-9.97E-01	-6.67E+00	3.65E+00	1.24E+01	8	0
CS-134	Cntl	-2.86E+00	-7.81E+00	7.57E-01	1.90E+01	3	0
CS-137	Ind	-3.98E+00	-8.57E+00	3.05E+00	1.51E+01	8	0
CS-137	Cntl	-5.71E+00	-7.53E+00	-2.62E+00	1.90E+01	3	0
BALA140	Ind	6.24E-01	-1.21E+01	7.41E+00	1.41E+01	8	0
BALA140	Cntl	-1.32E-01	-3.87E+00	4.93E+00	2.03E+01	3	0

TABLE A-16.1
GAMMA SPECTROMETRY RESULTS OF FRUITS
Results in pCi/kilogram (wet)

Station 37 is Indicator - Station 9C is Control

Station 37 Apricots collected			6/24/2019	
Nuclide	RQ	Activity	Error	MDA
K-40	-9.71E+01	+	5.55E+02	9.27E+02
MN-54	4.85E+00	+	1.60E+01	2.13E+01
CO-58	-1.86E+00	+	1.52E+01	2.07E+01
FE-59	-3.54E+01	+	5.96E+01	7.41E+01
CO-60	1.20E+01	+	1.52E+01	1.88E+01
ZN-65	-7.80E+00	+	3.75E+01	4.90E+01
ZRNB-95	-1.48E+01	+	3.25E+01	4.30E+01
I-131	-3.29E+00	+	3.26E+01	4.62E+01
CS-134	-6.51E+00	+	1.93E+01	3.24E+01
CS-137	5.71E+00	+	1.62E+01	2.22E+01
BALA140	-3.82E+00	+	2.48E+01	3.19E+01

Station 37 Apricots collected			7/5/2019	
Nuclide	RQ	Activity	Error	MDA
K-40	+	2.44E+03	±	2.48E+02
MN-54	-1.32E+00	+	1.05E+01	1.47E+01
CO-58	-5.43E+00	+	1.17E+01	1.59E+01
FE-59	5.15E+00	+	2.61E+01	3.49E+01
CO-60	-3.42E+00	+	1.15E+01	1.60E+01
ZN-65	6.37E-01	+	2.38E+01	3.26E+01
ZRNB-95	-1.77E+00	+	1.74E+01	2.44E+01
I-131	-5.65E+00	+	1.58E+01	2.30E+01
CS-134	1.01E+00	+	1.23E+01	2.10E+01
CS-137	1.69E+00	+	1.13E+01	1.62E+01
BALA140	-6.75E+00	+	1.79E+01	2.30E+01

Station 37 Peaches collected			7/18/2019	
Nuclide	RQ	Activity	MDA	
K-40	+	1.62E+03	±	2.29E+02
MN-54	-4.77E+00	+	1.17E+01	1.61E+01
CO-58	-4.19E+00	+	1.19E+01	1.64E+01
FE-59	3.79E+00	+	3.40E+01	4.54E+01
CO-60	-4.61E+00	+	1.24E+01	1.73E+01
ZN-65	-1.58E+01	+	3.20E+01	4.23E+01
ZRNB-95	9.95E+00	+	1.88E+01	2.57E+01
I-131	-3.56E-01	+	1.80E+01	2.66E+01
CS-134	-7.61E+00	+	1.33E+01	1.86E+01
CS-137	7.90E+00	+	1.23E+01	1.72E+01
BALA140	-7.86E+00	+	2.08E+01	2.68E+01

Station 37 Apples collected			8/27/2019	
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.29E+03	±	2.27E+02
MN-54	-1.98E+00	+	1.22E+01	1.71E+01
CO-58	-8.44E+00	+	1.42E+01	1.93E+01
FE-59	3.64E+00	+	2.41E+01	3.33E+01
CO-60	-1.17E+00	+	1.04E+01	1.51E+01
ZN-65	-1.92E-01	+	2.50E+01	3.46E+01
ZRNB-95	-1.17E+01	+	2.30E+01	3.14E+01
I-131	9.17E-01	+	2.02E+01	3.01E+01
CS-134	-5.74E-01	+	1.09E+01	1.58E+01
CS-137	2.96E+00	+	1.27E+01	1.82E+01
BALA140	5.26E+00	+	1.78E+01	2.36E+01

Station 37 Watermelon collected			9/13/2019	
Nuclide	RQ	Activity	Error	MDA
K-40	+	8.74E+02	±	1.54E+02
MN-54	-3.99E-01	+	6.48E+00	9.59E+00
CO-58	-1.22E+00	+	6.25E+00	9.16E+00
FE-59	5.48E-01	+	2.98E+00	1.01E+01
CO-60	-2.81E+00	+	9.03E+00	1.23E+01
ZN-65	6.85E+00	+	1.37E+01	1.90E+01
ZRNB-95	-7.06E-01	+	1.15E+01	1.70E+01
I-131	8.87E-01	+	7.80E+00	1.20E+01
CS-134	2.04E+00	+	5.07E+00	7.44E+00
CS-137	-1.33E+00	+	8.16E+00	1.20E+01
BALA140	3.04E+00	+	7.32E+00	1.03E+01

Station 37 White wine grapes collected			9/17/2019	
Nuclide	RQ	Activity	Error	MDA
K-40	+	2.81E+03	±	2.94E+02
MN-54	-8.60E-01	+	9.40E+00	1.32E+01
CO-58	0.00E+00	+	3.17E+00	1.21E+01
FE-59	3.12E+00	+	2.59E+01	3.51E+01
CO-60	-2.45E+00	+	1.24E+01	1.66E+01
ZN-65	-1.48E+01	+	3.20E+01	4.17E+01
ZRNB-95	4.08E+00	+	1.27E+01	1.83E+01
I-131	-2.67E-01	+	8.51E+00	1.29E+01
CS-134	-4.62E+00	+	1.26E+01	2.13E+01
CS-137	-1.88E+00	+	1.09E+01	1.55E+01
BALA140	4.52E+00	+	7.77E+00	1.02E+01

Station 37 Red wine grapes collected			10/1/2019	
Nuclide	RQ	Activity	Error	MDA
K-40	+	2.45E+03	±	2.30E+02
MN-54	-3.06E+00	+	8.89E+00	1.20E+01
CO-58	1.24E+00	+	7.89E+00	1.09E+01
FE-59	-1.60E+00	+	2.52E+01	3.35E+01
CO-60	4.56E-01	+	7.49E+00	1.02E+01
ZN-65	-7.26E+00	+	2.21E+01	2.90E+01
ZRNB-95	-3.01E+00	+	1.19E+01	1.70E+01
I-131	-8.90E-01	+	1.01E+01	1.48E+01
CS-134	1.61E+00	+	4.82E+00	6.87E+00
CS-137	-1.32E+00	+	7.44E+00	1.06E+01
BALA140	-4.74E+00	+	1.41E+01	1.82E+01

Station 9C Cherries collected			7/12/2019	
Nuclide	RQ	Activity	Error	MDA
K-40	+	3.27E+03	±	3.61E+02
MN-54	1.07E+00	+	1.60E+01	2.25E+01
CO-58	8.46E+00	+	1.44E+01	1.97E+01
FE-59	-3.86E+01	+	6.04E+01	7.72E+01
CO-60	-8.19E+00	+	1.82E+01	2.52E+01
ZN-65	-2.76E+01	+	4.52E+01	5.94E+01
ZRNB-95	1.04E+01	+	3.08E+01	4.24E+01
I-131	-3.82E+00	+	2.29E+01	3.37E+01
CS-134	5.61E+00	+	1.92E+01	3.24E+01
CS-137	-8.88E+00	+	1.90E+01	2.68E+01
BALA140	-8.15E+00	+	2.76E+01	3.57E+01

TABLE A-16.1
GAMMA SPECTROMETRY RESULTS OF FRUITS
 Results in pCi/kilogram (wet)

Station 37 is Indicator - Station 9C is Control

Nuclide	Station 9C Peaches collected			8/16/2019	Station 9C Apples collected			9/13/2019	
	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40	+	1.68E+03 ±	2.32E+02	2.01E+02	K-40	+	9.34E+02 ±	2.12E+02	1.86E+02
MN-54		1.89E+00 ±	9.68E+00	1.36E+01	MN-54		-3.65E+00 ±	1.15E+01	1.64E+01
CO-58		2.29E+00 ±	1.01E+01	1.41E+01	CO-58		2.49E+00 ±	8.85E+00	1.29E+01
FE-59		-1.44E+01 ±	3.82E+01	4.98E+01	FE-59		-6.28E+00 ±	3.31E+01	4.59E+01
CO-60		2.31E+00 ±	1.10E+01	1.53E+01	CO-60		5.32E+00 ±	9.39E+00	1.27E+01
ZN-65		-1.56E+01 ±	3.07E+01	4.06E+01	ZN-65		3.88E+00 ±	2.61E+01	3.70E+01
ZRNB-95		-1.39E+01 ±	2.40E+01	3.25E+01	ZRNB-95		1.08E+00 ±	1.75E+01	2.60E+01
I-131		-7.91E+00 ±	1.52E+01	2.19E+01	I-131		5.48E+00 ±	1.10E+01	1.64E+01
CS-134		-2.09E+00 ±	1.20E+01	1.71E+01	CS-134		-2.14E+00 ±	1.02E+01	1.50E+01
CS-137		7.15E+00 ±	1.36E+01	1.90E+01	CS-137		6.58E+00 ±	9.93E+00	1.41E+01
BALA140		-6.22E+00 ±	1.68E+01	2.17E+01	BALA140		-2.47E+00 ±	1.77E+01	2.47E+01

TABLE A - 16.2

GAMMA SPECTROMETRY RESULTS OF FRUITS - SUMMARY

Results in pCi/kilogram (wet)

Nuclide		Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
K-40	Ind	1.63E+03	-9.71E+01	2.81E+03	2.64E+02	7	6
K-40	Cntl	1.96E+03	9.34E+02	3.27E+03	2.15E+02	3	3
MN-54	Ind	-1.08E+00	-4.77E+00	4.85E+00	1.49E+01	7	0
MN-54	Cntl	-2.30E-01	-3.65E+00	1.89E+00	1.75E+01	3	0
CO-58	Ind	-2.84E+00	-8.44E+00	1.24E+00	1.49E+01	7	0
CO-58	Cntl	4.41E+00	2.29E+00	8.46E+00	1.56E+01	3	0
FE-59	Ind	-2.96E+00	-3.54E+01	5.15E+00	3.81E+01	7	0
FE-59	Cntl	-1.97E+01	-3.86E+01	-6.28E+00	5.76E+01	3	0
CO-60	Ind	-2.86E-01	-4.61E+00	1.20E+01	1.52E+01	7	0
CO-60	Cntl	-1.86E-01	-8.19E+00	5.32E+00	1.77E+01	3	0
ZN-65	Ind	-5.48E+00	-1.58E+01	6.85E+00	3.55E+01	7	0
ZN-65	Cntl	-1.31E+01	-2.76E+01	3.88E+00	4.57E+01	3	0
ZRNB-95	Ind	-2.56E+00	-1.48E+01	9.95E+00	2.53E+01	7	0
ZRNB-95	Cntl	-7.85E-01	-1.39E+01	1.04E+01	3.36E+01	3	0
I-131	Ind	-1.24E+00	-5.65E+00	9.17E-01	2.37E+01	7	0
I-131	Cntl	-2.08E+00	-7.91E+00	5.48E+00	2.40E+01	3	0
CS-134	Ind	-2.09E+00	-7.61E+00	2.04E+00	1.76E+01	7	0
CS-134	Cntl	4.60E-01	-2.14E+00	5.61E+00	2.15E+01	3	0
CS-137	Ind	1.96E+00	-1.88E+00	7.90E+00	1.60E+01	7	0
CS-137	Cntl	1.61E+00	-8.88E+00	7.15E+00	2.00E+01	3	0
BALA140	Ind	-1.48E+00	-7.86E+00	5.26E+00	2.06E+01	7	0
BALA140	Cntl	-5.61E+00	-8.15E+00	-2.47E+00	2.74E+01	3	0

TABLE A-17.1
GAMMA SPECTROMETRY RESULTS OF VEGETABLES

Results in pCi/kilogram (wet)

Stations 37, 48G and 104 are Indicators - Station 9C is Control

Station 37 Broad Leaf Vegetable collected				
Nuclide	RQ	Activity	Error	MDA
K-40	+	5.57E+03 ±	5.29E+02	2.29E+02
MN-54		6.07E+00 ±	1.12E+01	1.58E+01
CO-58		-2.33E+00 ±	1.45E+01	2.09E+01
FE-59		5.23E-01 ±	4.78E+01	6.66E+01
CO-60		-1.13E+01 ±	2.32E+01	3.05E+01
ZN-65		-8.94E+00 ±	3.72E+01	5.16E+01
ZRNB-95		-2.69E+00 ±	2.75E+01	3.97E+01
I-131		6.24E+00 ±	1.44E+01	2.15E+01
CS-134		3.76E+00 ±	9.00E+00	1.32E+01
CS-137		1.64E+00 ±	1.33E+01	1.99E+01
BALA140		6.89E-01 ±	1.28E+01	1.99E+01

Station 37 Tomatoes collected				
Nuclide	RQ	Activity	Error	MDA
K-40	+	2.00E+03 ±	2.20E+02	1.48E+02
MN-54		-9.30E+00 ±	1.51E+01	1.97E+01
CO-58		-2.79E+00 ±	1.38E+01	1.85E+01
FE-59		2.31E+01 ±	2.48E+01	3.05E+01
CO-60		4.07E+00 ±	1.21E+01	1.55E+01
ZN-65		-1.58E+01 ±	3.11E+01	4.00E+01
ZRNB-95		-1.79E+00 ±	2.25E+01	3.04E+01
I-131		1.25E+01 ±	1.43E+01	1.97E+01
CS-134		-8.14E+00 ±	1.68E+01	2.80E+01
CS-137		-9.19E+00 ±	1.56E+01	2.11E+01
BALA140		1.11E+01 ±	1.11E+01	2.05E+01

Station 37 Cabbage collected				
Nuclide	RQ	Activity	Error	MDA
K-40	+	2.68E+03 ±	3.86E+02	2.14E+02
MN-54		-4.83E+00 ±	1.64E+01	2.27E+01
CO-58		-7.87E+00 ±	1.99E+01	2.78E+01
FE-59		-2.93E+00 ±	4.82E+01	6.60E+01
CO-60		-3.42E+00 ±	1.60E+01	2.20E+01
ZN-65		-2.33E+01 ±	4.83E+01	6.34E+01
ZRNB-95		1.21E+01 ±	2.23E+01	3.14E+01
I-131		-1.72E+00 ±	1.46E+01	2.25E+01
CS-134		-5.47E+00 ±	1.66E+01	2.32E+01
CS-137		-1.14E+01 ±	2.13E+01	2.92E+01
BALA140		2.21E+00 ±	1.48E+01	2.17E+01

Station 104 Broad Leaf Vegetable collected				
Nuclide	RQ	Activity	Error	MDA
K-40	+	3.62E+03 ±	3.24E+02	1.30E+02
MN-54		-9.72E-01 ±	9.61E+00	1.34E+01
CO-58		-2.35E+00 ±	9.95E+00	1.37E+01
FE-59		-2.07E+00 ±	3.26E+01	4.32E+01
CO-60		2.43E-01 ±	1.09E+01	1.48E+01
ZN-65		-1.15E+01 ±	3.12E+01	4.07E+01
ZRNB-95		-4.71E+00 ±	1.77E+01	2.50E+01
I-131		3.64E-01 ±	9.73E+00	1.45E+01
CS-134		-3.93E+00 ±	9.80E+00	1.35E+01
CS-137		-5.26E+00 ±	1.14E+01	1.58E+01
BALA140		-2.46E+00 ±	1.07E+01	1.47E+01

Station 37 Broad Leaf Vegetable collected				
Nuclide	RQ	Activity	Error	MDA
K-40	+	6.75E+03 ±	3.45E+02	1.86E+02
MN-54		4.06E-01 ±	1.25E+01	1.66E+01
CO-58		-5.91E+00 ±	1.46E+01	1.90E+01
FE-59		-1.08E+01 ±	4.16E+01	5.18E+01
CO-60		-5.14E+00 ±	1.40E+01	1.74E+01
ZN-65		-1.39E+01 ±	3.11E+01	3.94E+01
ZRNB-95		-1.68E+01 ±	2.82E+01	3.66E+01
I-131		4.42E+00 ±	3.15E+01	4.39E+01
CS-134		4.67E-01 ±	1.49E+01	2.50E+01
CS-137		-7.12E+00 ±	1.33E+01	1.78E+01
BALA140		-7.81E+00 ±	2.58E+01	3.15E+01

Station 37 Broad Leaf Vegetable collected				
Nuclide	RQ	Activity	Error	MDA
K-40	+	6.29E+03 ±	7.21E+02	3.76E+02
MN-54		3.71E+00 ±	2.04E+01	2.98E+01
CO-58		3.74E+00 ±	2.32E+01	3.35E+01
FE-59		2.48E+00 ±	7.02E+01	9.83E+01
CO-60		0.00E+00 ±	1.21E+01	3.84E+01
ZN-65		-1.15E+01 ±	6.03E+01	8.40E+01
ZRNB-95		-4.31E+00 ±	4.40E+01	6.35E+01
I-131		9.32E+00 ±	1.87E+01	2.79E+01
CS-134		9.92E-01 ±	2.20E+01	3.27E+01
CS-137		2.44E+00 ±	2.27E+01	3.40E+01
BALA140		1.50E+01 ±	1.22E+01	1.84E+01

Station 37 Bell Peppers collected				
Nuclide	RQ	Activity	Error	MDA
K-40	+	2.30E+03 ±	3.27E+02	3.09E+02
MN-54		9.15E+00 ±	1.87E+01	2.45E+01
CO-58		-8.32E+00 ±	2.15E+01	2.83E+01
FE-59		1.82E+01 ±	4.69E+01	5.93E+01
CO-60		-4.14E+00 ±	1.99E+01	2.54E+01
ZN-65		-1.79E+01 ±	4.47E+01	5.75E+01
ZRNB-95		-1.79E+01 ±	3.82E+01	5.01E+01
I-131		-6.69E+00 ±	2.85E+01	3.99E+01
CS-134		-5.99E+00 ±	2.65E+01	4.43E+01
CS-137		-1.16E+01 ±	2.29E+01	3.09E+01
BALA140		1.07E+00 ±	2.74E+01	3.47E+01

Station 37 Tomatoes collected				
Nuclide	RQ	Activity	Error	MDA
K-40	+	2.82E+03 ±	2.84E+02	1.22E+02
MN-54		-3.10E+00 ±	9.27E+00	1.31E+01
CO-58		-6.70E+00 ±	1.16E+01	1.59E+01
FE-59		2.44E+00 ±	2.61E+01	3.63E+01
CO-60		2.12E+00 ±	8.93E+00	1.24E+01
ZN-65		-1.22E+01 ±	2.85E+01	3.82E+01
ZRNB-95		-7.08E+00 ±	1.73E+01	2.41E+01
I-131		1.73E+00 ±	1.01E+01	1.53E+01
CS-134		-4.37E+00 ±	1.22E+01	2.07E+01
CS-137		4.97E+00 ±	1.11E+01	1.58E+01
BALA140		-1.81E+00 ±	1.30E+01	1.81E+01

TABLE A-17.1
GAMMA SPECTROMETRY RESULTS OF VEGETABLES

Results in pCi/kilogram (wet)

Stations 37, 48G and 104 are Indicators - Station 9C is Control

Station 37 Cucumber collected					Station 37 Broad Leaf Vegetable collected				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40	+	2.20E+03 ±	2.65E+02	1.52E+02	K-40	+	6.65E+03 ±	6.20E+02	2.59E+02
MN-54		4.63E-02 ±	1.04E+00	3.42E+00	MN-54		-4.79E+00 ±	2.04E+01	2.80E+01
CO-58		-1.42E+00 ±	6.68E+00	9.85E+00	CO-58		-1.46E+01 ±	2.47E+01	3.27E+01
FE-59		-1.31E+01 ±	3.25E+01	4.31E+01	FE-59		1.25E+01 ±	6.26E+01	8.25E+01
CO-60		-3.92E+00 ±	1.06E+01	1.43E+01	CO-60		-2.08E+01 ±	3.24E+01	4.06E+01
ZN-65		-1.60E+01 ±	3.45E+01	4.59E+01	ZN-65		-1.72E+00 ±	5.14E+01	6.97E+01
ZRNB-95		-2.47E+00 ±	1.76E+01	2.52E+01	ZRNB-95		-3.16E+00 ±	2.76E+01	4.03E+01
I-131		-5.96E+00 ±	1.20E+01	1.76E+01	I-131		-4.97E+00 ±	2.27E+01	3.30E+01
CS-134		6.68E-01 ±	1.17E+01	2.02E+01	CS-134		-5.75E+00 ±	1.80E+01	2.51E+01
CS-137		-4.83E+00 ±	9.73E+00	1.39E+01	CS-137		8.80E-01 ±	1.73E+01	2.52E+01
BALA140		4.61E+00 ±	8.82E+00	1.21E+01	BALA140		-1.95E+01 ±	3.18E+01	3.99E+01
Station 48G Broad Leaf Vegetable collected					Station 9C Broad Leaf Vegetable collected				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40	+	5.97E+03 ±	4.80E+02	3.32E+02	K-40	+	1.17E+04 ±	8.38E+02	4.16E+02
MN-54		1.10E+01 ±	2.20E+01	2.89E+01	MN-54		-3.30E+00 ±	2.63E+01	3.68E+01
CO-58		-3.36E+00 ±	2.29E+01	3.04E+01	CO-58		-1.77E+01 ±	3.30E+01	4.48E+01
FE-59		7.48E+00 ±	5.19E+01	6.62E+01	FE-59		2.21E+00 ±	8.11E+01	1.08E+02
CO-60		1.26E+01 ±	1.89E+01	2.35E+01	CO-60		-2.24E+01 ±	3.72E+01	4.93E+01
ZN-65		-3.00E+01 ±	5.32E+01	6.76E+01	ZN-65		-1.87E+01 ±	6.84E+01	9.17E+01
ZRNB-95		1.66E+01 ±	3.49E+01	4.59E+01	ZRNB-95		1.90E+01 ±	4.23E+01	5.81E+01
I-131		-1.18E+00 ±	2.19E+01	3.08E+01	I-131		6.15E+00 ±	3.17E+01	4.68E+01
CS-134		-1.58E+01 ±	2.59E+01	3.47E+01	CS-134		4.00E+00 ±	2.71E+01	3.86E+01
CS-137		-1.65E+01 ±	2.79E+01	3.75E+01	CS-137		1.36E+01 ±	2.71E+01	3.82E+01
BALA140		-2.19E+01 ±	3.19E+01	3.84E+01	BALA140		7.12E+00 ±	2.99E+01	4.00E+01
Station 9C Broad Leaf Vegetable collected					Station 9C Bell Peppers collected				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40	+	4.90E+03 ±	5.25E+02	2.63E+02	K-40	+	1.94E+03 ±	2.55E+02	2.15E+02
MN-54		-1.02E+01 ±	2.22E+01	2.97E+01	MN-54		-7.91E-01 ±	1.16E+01	1.64E+01
CO-58		5.92E+00 ±	1.46E+01	2.01E+01	CO-58		-5.23E+00 ±	1.35E+01	1.86E+01
FE-59		-1.60E+01 ±	5.27E+01	6.95E+01	FE-59		-2.95E+01 ±	4.61E+01	5.89E+01
CO-60		-1.21E+01 ±	2.66E+01	3.41E+01	CO-60		2.33E-01 ±	1.13E+01	1.60E+01
ZN-65		8.63E+00 ±	3.84E+01	5.23E+01	ZN-65		-1.15E+01 ±	3.18E+01	5.38E+01
ZRNB-95		-1.66E+01 ±	3.35E+01	4.64E+01	ZRNB-95		1.61E+01 ±	1.98E+01	2.65E+01
I-131		5.31E-01 ±	2.15E+01	3.17E+01	I-131		-3.85E+00 ±	1.60E+01	2.35E+01
CS-134		-4.81E+00 ±	1.61E+01	2.26E+01	CS-134		-7.88E+00 ±	1.90E+01	3.18E+01
CS-137		9.99E+00 ±	1.75E+01	2.41E+01	CS-137		-6.36E+00 ±	1.44E+01	2.03E+01
BALA140		-7.70E+00 ±	2.92E+01	3.83E+01	BALA140		-1.65E-01 ±	1.59E+01	2.15E+01

TABLE A - 17.2
GAMMA SPECTROMETRY RESULTS OF VEGETABLES - SUMMARY

Results in pCi/kilogram (wet)

Nuclide		Average	Activity	Activity	Average	Number of	Number of
K-40	Ind	4.26E+03	2.00E+03	6.75E+03	2.23E+02	11	11
K-40	Cntl	6.19E+03	1.94E+03	1.17E+04	2.98E+02	3	3
MN-54	Ind	6.73E-01	-9.30E+00	1.10E+01	1.96E+01	11	0
MN-54	Cntl	-4.76E+00	-1.02E+01	-7.91E-01	2.76E+01	3	0
CO-58	Ind	-4.72E+00	-1.46E+01	3.74E+00	2.28E+01	11	0
CO-58	Cntl	-5.67E+00	-1.77E+01	5.92E+00	2.78E+01	3	0
FE-59	Ind	3.45E+00	-1.31E+01	2.31E+01	5.85E+01	11	0
FE-59	Cntl	-1.44E+01	-2.95E+01	2.21E+00	7.89E+01	3	0
CO-60	Ind	-2.70E+00	-2.08E+01	1.26E+01	2.32E+01	11	0
CO-60	Cntl	-1.14E+01	-2.24E+01	2.33E-01	3.31E+01	3	0
ZN-65	Ind	-1.48E+01	-3.00E+01	-1.72E+00	5.44E+01	11	0
ZN-65	Cntl	-7.20E+00	-1.87E+01	8.63E+00	6.59E+01	3	0
ZRNB-95	Ind	-2.93E+00	-1.79E+01	1.66E+01	3.75E+01	11	0
ZRNB-95	Cntl	6.16E+00	-1.66E+01	1.90E+01	4.37E+01	3	0
I-131	Ind	1.28E+00	-6.69E+00	1.25E+01	2.61E+01	11	0
I-131	Cntl	9.44E-01	-3.85E+00	6.15E+00	3.40E+01	3	0
CS-134	Ind	-3.96E+00	-1.58E+01	3.76E+00	2.55E+01	11	0
CS-134	Cntl	-2.90E+00	-7.88E+00	4.00E+00	3.10E+01	3	0
CS-137	Ind	-5.09E+00	-1.65E+01	4.97E+00	2.37E+01	11	0
CS-137	Cntl	5.73E+00	-6.36E+00	1.36E+01	2.75E+01	3	0
BALA140	Ind	-1.71E+00	-2.19E+01	1.50E+01	2.45E+01	11	0
BALA140	Cntl	-2.47E-01	-7.70E+00	7.12E+00	3.33E+01	3	0

TABLE B-1.1
2019 QUARTERLY SPECIAL INTEREST TLD RESULTS

Results in milli-Roentgen (mR) per Standard Quarter

Station ID	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Quarterly Sum
58	18.7	19.7	19.2	21.9	79.5
88	25.8	22.4	25.9	27.2	101.4
89	26.4	23.4	27.0	27.5	104.3
119B	21.3	20.4	21.2	23.8	86.7
119Ctrl	21.2	21.1	22.5	23.8	88.6
121	74.9	50.2	74.6	77.8	277.5
122	34.0	33.6	35.4	35.8	138.8
123 (ISFSI)	81.2	80.4	79.7	87.4	328.8
124 (ISFSI)	97.0	96.6	96.1	100.5	390.2
125 (ISFSI)	73.8	71.5	74.6	72.7	292.6
126 (ISFSI)	114.2	107.0	113.1	108.8	443.0
127 (ISFSI)	86.7	84.7	89.1	85.3	345.8
128 (ISFSI)	141.9	133.6	135.5	131.9	542.9
129 (ISFSI)	103.8	98.4	105.7	100.3	408.3
130 (ISFSI)	149.2	143.8	139.2	142.0	574.3
131 (ISFSI)	64.8	59.0	64.3	63.8	251.9
136B(ISFSI)	201.1	184.9	186.4	180.0	752.4
137B (ISFSI)	191.7	181.3	184.4	172.2	729.6
138B (ISFSI)	100.0	93.6	98.9	94.2	386.7
150 (Site 1)	19.5	19.1	19.1	20.0	77.7
151 (Site 4)	17.3	18.2	19.5	19.5	74.6
155	24.8	25.0	26.1	26.5	102.4
156	26.6	28.4	28.7	29.4	113.1

TABLE B-1.2
2019 QUARTERLY SPECIAL INTEREST TLD RESULTS- SUMMARY

Results in milli-Roentgen (mR) per Standard Quarter

Location	Average Activity	Activity Low	Activity High	Number of Samples
ISFSI Quarterly Ind	113.5	59.0	201.1	48
SITE 1 & 4 Quarterly Ind	19.0	17.3	20.0	8
Quarterly Control TLDs	19.2	18.6	19.7	4

Stations 58, 88, and 89 were established in 2009 to monitor exposure from remediation work at the DOE 618-11 burial site.

Station 121 results high due to location being near the turbine building. Staion 122 results influenced by ISFSI.

Quarterly Control TLD location is ST-9. See Table A-1.1.

Stations 130 and 131 were added to the ISFSI fence in the 1st quarter 2017.

Table B - 2.1
GAMMA SPECTROMETRY RESULTS OF STORM DRAIN WATER
STATION 101B

Results in pCi/liter, corrected for decay during collection period

Location ST-101B collected 1/31/2019					Location ST-101B collected 3/1/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		0.00E+00 ±	2.57E+01	7.92E+01	K-40		0.00E+00 ±	6.32E+02	5.96E+01
CR-51		3.70E+01 ±	4.47E+01	6.15E+01	CR-51		-1.03E+01 ±	3.34E+01	4.71E+01
MN-54		1.24E+00 ±	2.83E+00	3.69E+00	MN-54		5.31E-01 ±	3.08E+00	4.06E+00
CO-58		-1.07E+00 ±	4.41E+00	5.77E+00	CO-58		1.12E-01 ±	2.98E+00	4.01E+00
FE-59		-7.28E+00 ±	1.61E+01	1.99E+01	FE-59		-9.22E-01 ±	1.09E+01	1.39E+01
CO-60		9.16E-01 ±	2.70E+00	3.43E+00	CO-60		-1.11E+00 ±	3.74E+00	4.68E+00
ZN-65		-2.30E+00 ±	6.76E+00	8.67E+00	ZN-65		4.49E+00 ±	5.64E+00	7.01E+00
ZRNB-95		-3.40E+00 ±	8.37E+00	1.11E+01	ZRNB-95		-1.22E+00 ±	5.89E+00	7.98E+00
I-131		-1.17E+01 ±	4.62E+01	6.55E+01	I-131		1.66E-01 ±	9.30E+00	1.34E+01
CS-134		-4.02E-01 ±	2.62E+00	3.65E+00	CS-134		2.18E+00 ±	2.53E+00	3.38E+00
CS-137		-2.61E+00 ±	3.81E+00	4.97E+00	CS-137		-6.56E-01 ±	3.02E+00	4.08E+00
BALA140		-6.78E-01 ±	1.88E+01	2.43E+01	BALA140		5.38E+00 ±	4.61E+00	9.01E+00
BI-214		1.77E+00 ±	7.42E+00	1.06E+01	BI-214		9.16E+00 ±	8.02E+00	1.09E+01
Location ST-101B collected 4/1/2019					Location ST-101B collected 5/1/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		5.14E+01 ±	4.64E+01	6.27E+01	K-40		1.63E+01 ±	3.47E+01	5.00E+01
CR-51		-6.21E-01 ±	2.89E+01	4.29E+01	CR-51		1.37E+01 ±	2.78E+01	3.91E+01
MN-54		-1.58E+00 ±	3.53E+00	4.68E+00	MN-54		1.14E+00 ±	3.14E+00	4.10E+00
CO-58		4.42E-01 ±	2.76E+00	3.80E+00	CO-58		-9.36E-01 ±	3.16E+00	4.17E+00
FE-59		-4.34E+00 ±	1.15E+01	1.47E+01	FE-59		3.01E+00 ±	9.91E+00	1.25E+01
CO-60		-1.56E+00 ±	3.78E+00	4.81E+00	CO-60		1.60E+00 ±	2.99E+00	3.71E+00
ZN-65		-2.76E+00 ±	6.66E+00	8.71E+00	ZN-65		1.72E+00 ±	5.82E+00	7.53E+00
ZRNB-95		-1.01E+00 ±	5.06E+00	7.14E+00	ZRNB-95		3.41E+00 ±	4.72E+00	6.21E+00
I-131		1.89E+00 ±	7.84E+00	1.16E+01	I-131		3.28E+00 ±	1.11E+01	1.58E+01
CS-134		-1.07E+00 ±	2.52E+00	3.58E+00	CS-134		-9.94E-01 ±	3.06E+00	4.20E+00
CS-137		1.08E+00 ±	2.51E+00	3.48E+00	CS-137		-1.49E+00 ±	3.22E+00	4.27E+00
BALA140		1.06E+00 ±	7.01E+00	9.21E+00	BALA140		4.08E+00 ±	8.15E+00	1.01E+01
BI-214		4.74E+00 ±	6.71E+00	9.68E+00	BI-214		3.68E+00 ±	6.31E+00	9.76E+00
Location ST-101B collected 5/30/2019					Location ST-101B collected 7/1/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		1.02E+00 ±	3.91E+01	5.61E+01	K-40		1.58E+01 ±	3.91E+01	5.52E+01
CR-51		-7.55E-01 ±	3.73E+01	5.31E+01	CR-51		-1.84E+01 ±	3.56E+01	4.96E+01
MN-54		9.22E-01 ±	2.99E+00	4.01E+00	MN-54		2.24E+00 ±	2.43E+00	3.14E+00
CO-58		-3.72E-01 ±	3.72E+00	5.04E+00	CO-58		6.42E-01 ±	3.16E+00	4.28E+00
FE-59		2.01E+00 ±	8.19E+00	1.07E+01	FE-59		2.69E+00 ±	7.96E+00	1.03E+01
CO-60		6.16E-01 ±	3.29E+00	4.28E+00	CO-60		1.93E+00 ±	2.99E+00	3.76E+00
ZN-65		-2.76E+00 ±	6.85E+00	8.93E+00	ZN-65		-5.43E+00 ±	8.52E+00	1.09E+01
ZRNB-95		3.08E+00 ±	4.95E+00	6.75E+00	ZRNB-95		-1.50E+00 ±	6.67E+00	9.23E+00
I-131		8.24E+00 ±	1.05E+01	1.46E+01	I-131		2.60E+00 ±	9.37E+00	1.32E+01
CS-134		-4.57E-01 ±	3.21E+00	4.43E+00	CS-134		9.93E-01 ±	3.17E+00	4.34E+00
CS-137		-2.13E+00 ±	3.75E+00	5.07E+00	CS-137		7.28E-01 ±	3.21E+00	4.44E+00
BALA140		1.69E+00 ±	7.10E+00	9.24E+00	BALA140		-7.04E+00 ±	1.13E+01	1.37E+01
BI-214		8.31E-01 ±	7.95E+00	1.14E+01	BI-214		-1.36E+01 ±	8.43E+00	1.27E+01

Table B - 2.1
GAMMA SPECTROMETRY RESULTS OF STORM DRAIN WATER
STATION 101B

Results in pCi/liter, corrected for decay during collection period

Location ST-101B collected 7/31/2019					Location ST-101B collected 8/29/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		-2.28E+01 ±	4.91E+01	7.23E+01	K-40		-1.63E+01 ±	4.18E+01	6.13E+01
CR-51		6.03E+00 ±	3.23E+01	4.74E+01	CR-51		-4.12E+00 ±	3.71E+01	5.39E+01
MN-54		2.06E-01 ±	2.96E+00	4.17E+00	MN-54		-1.32E+00 ±	3.58E+00	4.72E+00
CO-58		-5.69E-01 ±	3.30E+00	4.62E+00	CO-58		4.94E-01 ±	3.04E+00	4.21E+00
FE-59		7.12E+00 ±	7.64E+00	9.61E+00	FE-59		3.92E+00 ±	1.01E+01	1.28E+01
CO-60		4.87E-01 ±	3.15E+00	4.39E+00	CO-60	+	8.58E+00 ±	2.41E+00	2.93E+00
ZN-65		7.11E-01 ±	6.66E+00	9.16E+00	ZN-65		3.93E-01 ±	6.42E+00	8.46E+00
ZRNB-95		3.19E+00 ±	5.26E+00	7.17E+00	ZRNB-95		2.02E+00 ±	5.95E+00	8.14E+00
I-131		-1.00E+00 ±	8.62E+00	1.27E+01	I-131		1.98E+00 ±	1.22E+01	1.78E+01
CS-134		-7.30E-01 ±	2.96E+00	4.22E+00	CS-134		-1.69E+00 ±	3.49E+00	5.82E+00
CS-137		-2.10E+00 ±	3.90E+00	5.45E+00	CS-137		-8.15E-01 ±	3.64E+00	4.96E+00
BALA140		-1.61E+00 ±	8.18E+00	1.07E+01	BALA140		3.23E+00 ±	9.72E+00	1.21E+01
BI-214		-1.35E+00 ±	7.89E+00	1.16E+01	BI-214	+	1.50E+01 ±	4.60E+00	5.62E+00
Location ST-101B collected 10/1/2019					Location ST-101B collected 10/31/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		3.24E+01 ±	4.02E+01	5.76E+01	K-40		1.77E+01 ±	4.04E+01	5.62E+01
CR-51		-1.35E+01 ±	3.51E+01	5.09E+01	CR-51		-5.41E+00 ±	4.28E+01	6.03E+01
MN-54		-1.28E+00 ±	3.20E+00	4.40E+00	MN-54		1.32E-01 ±	3.25E+00	4.41E+00
CO-58		2.22E-01 ±	3.66E+00	5.13E+00	CO-58		-6.47E-01 ±	3.55E+00	4.79E+00
FE-59		1.84E+00 ±	9.30E+00	1.25E+01	FE-59		-2.61E+00 ±	1.03E+01	1.33E+01
CO-60		8.18E-01 ±	3.18E+00	4.36E+00	CO-60		8.55E-01 ±	3.25E+00	4.19E+00
ZN-65		9.75E-01 ±	7.15E+00	9.75E+00	ZN-65		3.45E-01 ±	7.65E+00	1.32E+01
ZRNB-95		2.14E+00 ±	5.96E+00	8.23E+00	ZRNB-95		-1.90E-01 ±	5.81E+00	8.19E+00
I-131		-7.14E-01 ±	9.71E+00	1.43E+01	I-131		-3.54E+00 ±	1.31E+01	1.85E+01
CS-134		-8.68E-01 ±	3.13E+00	4.44E+00	CS-134		5.98E-01 ±	5.17E+00	8.69E+00
CS-137		1.04E+00 ±	3.14E+00	4.47E+00	CS-137		-2.42E+00 ±	4.05E+00	5.46E+00
BALA140		5.48E+00 ±	8.56E+00	1.08E+01	BALA140		5.01E+00 ±	8.71E+00	1.08E+01
BI-214		6.42E+00 ±	7.21E+00	1.02E+01	BI-214	+	4.31E+01 ±	9.60E+00	1.07E+01
Location ST-101B collected 12/2/2019					Location ST-101B collected 1/2/2020				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		4.94E+01 ±	4.30E+01	6.01E+01	K-40		4.71E+00 ±	4.41E+01	6.47E+01
CR-51		1.94E+00 ±	3.41E+01	5.03E+01	CR-51		8.84E+00 ±	3.50E+01	5.12E+01
MN-54		-6.17E-01 ±	3.58E+00	4.97E+00	MN-54		-5.12E-01 ±	3.10E+00	4.33E+00
CO-58		-1.15E-01 ±	3.59E+00	5.06E+00	CO-58		-5.83E-01 ±	3.22E+00	4.52E+00
FE-59		2.24E+00 ±	8.78E+00	1.18E+01	FE-59		2.87E+00 ±	8.54E+00	1.14E+01
CO-60		2.87E-01 ±	3.27E+00	4.55E+00	CO-60		2.85E+00 ±	2.12E+00	4.18E+00
ZN-65		-4.93E+00 ±	9.95E+00	1.31E+01	ZN-65		2.28E+00 ±	6.14E+00	8.31E+00
ZRNB-95		-4.59E+00 ±	8.03E+00	1.09E+01	ZRNB-95		-1.43E+00 ±	6.21E+00	8.65E+00
I-131		2.22E+00 ±	9.55E+00	1.40E+01	I-131		3.19E-01 ±	1.12E+01	1.66E+01
CS-134		-1.25E+00 ±	4.53E+00	7.62E+00	CS-134		-1.21E+00 ±	3.14E+00	4.43E+00
CS-137		-5.70E-01 ±	3.46E+00	4.96E+00	CS-137		5.27E-01 ±	2.97E+00	4.28E+00
BALA140		1.11E+00 ±	7.80E+00	1.04E+01	BALA140		8.76E-02 ±	9.05E+00	1.21E+01
BI-214	+	1.92E+01 ±	7.23E+00	9.54E+00	BI-214		3.34E+00 ±	8.35E+00	1.20E+01

TABLE B-2.2
GAMMA SPECTROMETRY RESULTS OF STORM DRAIN WATER - SUMMARY
STATION 101B

Results in pCi/liter, corrected for decay during collection period

Nuclide	Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
K-40	1.25E+01	-2.28E+01	5.14E+01	6.12E+01	12	0
CR-51	1.22E+00	-1.84E+01	3.70E+01	5.06E+01	12	0
MN-54	9.21E-02	-1.58E+00	2.24E+00	4.22E+00	12	0
CO-58	-1.98E-01	-1.07E+00	6.42E-01	4.62E+00	12	0
FE-59	8.80E-01	-7.28E+00	7.12E+00	1.28E+01	12	0
CO-60	1.36E+00	-1.56E+00	8.58E+00	4.11E+00	12	1
ZN-65	-6.05E-01	-5.43E+00	4.49E+00	9.48E+00	12	0
ZRNB-95	-5.50E-02	-4.59E+00	3.41E+00	8.43E+00	12	0
I-131	3.09E-01	-1.17E+01	8.24E+00	1.90E+01	12	0
CS-134	-4.08E-01	-1.69E+00	2.18E+00	4.90E+00	12	0
CS-137	-7.84E-01	-2.61E+00	1.08E+00	4.66E+00	12	0
BALA140	1.48E+00	-7.04E+00	5.48E+00	1.19E+01	12	0
BI-214	7.70E+00	-1.36E+01	4.31E+01	1.04E+01	12	3

TABLE B-3.1
GROSS BETA IN STORM DRAIN WATER
Results in pCi/liter

Location	Collection Period	RQ	Activity	Error	MDA
ST-101B	12/31/18 - 01/31/19		1.78E+00	± 6.90E-01	2.10E+00
	01/31/19 - 03/01/19		1.29E+00	± 6.83E-01	2.16E+00
	03/01/19 - 04/01/19		6.25E-02	± 7.06E-01	2.48E+00
	04/01/19 - 05/01/19		1.61E+00	± 8.03E-01	2.44E+00
	05/01/19 - 05/30/19		4.01E-02	± 5.84E-01	2.13E+00
	05/30/19 - 07/01/19		2.75E+00	± 1.05E+00	3.20E+00
	07/01/19 - 07/31/19		1.14E+00	± 6.44E-01	2.06E+00
	07/31/19 - 08/29/19	+	2.57E+00	± 8.37E-01	2.46E+00
	08/29/19 - 10/01/19	+	3.62E+00	± 6.86E-01	1.59E+00
	10/01/19 - 10/31/19		2.35E+00	± 8.34E-01	2.51E+00
	10/31/19 - 12/02/19		1.06E+00	± 6.48E-01	2.12E+00
	12/02/19 - 01/02/20		1.30E+00	± 6.50E-01	2.06E+00

TABLE B-3.2
GROSS BETA IN STORM DRAIN WATER - SUMMARY
Results in pCi/liter

Average Activity	Activity Low	Activity High	Number of Samples	Number of Positive IDs
1.63E+00	4.01E-02	3.62E+00	12	2

TABLE B-4.1
TRITIUM IN STORM DRAIN WATER
Results in pCi/liter

Location	Collection Period	RQ	Activity	Error
ST-101B	12/31/18 - 01/31/19	+	9.97E+03	± 2.49E+02
	01/31/19 - 03/01/19	+	1.24E+04	± 2.75E+02
	03/01/19 - 04/01/19	+	7.37E+03	± 2.20E+02
	04/01/19 - 05/01/19	+	3.19E+03	± 1.54E+02
	05/01/19 - 05/30/19	+	3.01E+02	± 9.37E+01
	05/30/19 - 07/01/19		1.97E+02	± 9.40E+01
	07/01/19 - 07/31/19	+	1.07E+03	± 1.16E+02
	07/31/19 - 08/29/19	+	2.13E+03	± 1.45E+02
	08/29/19 - 10/01/19	+	1.67E+03	± 1.32E+02
	10/01/19 - 10/31/19	+	7.31E+02	± 1.07E+02
	10/31/19 - 12/02/19	+	1.14E+04	± 2.62E+02
	12/02/19 - 01/02/20	+	9.05E+03	± 2.39E+02

TABLE B-4.2
TRITIUM IN STORM DRAIN WATER - SUMMARY
Results in pCi/liter

Average Activity	Activity Low	Activity High	Number of Samples	Number of Positive IDs
4.96E+03	1.97E+02	1.24E+04	12	11

TABLE B-5.1
GROSS ALPHA IN SANITARY WASTE TREATMENT WATER
 Results in pCi/liter
STATION 102B - SWTF Headworks

Collection Period	RQ	Activity	Error	MDA
12/31/18 - 01/31/19	-	-1.26E+00	±	1.32E+00 4.80E+00
01/31/19 - 03/01/19	-	5.20E+00	±	1.53E+00 4.93E+00
03/01/19 - 04/01/19	-	-1.91E+00	±	1.80E+00 6.05E+00
04/01/19 - 05/01/19	-	-1.67E+00	±	2.04E+00 6.94E+00
05/01/19 - 05/30/19	-	1.71E+00	±	1.03E+00 3.41E+00
05/30/19 - 07/01/19	-	9.56E-01	±	1.02E+00 3.44E+00
07/01/19 - 07/31/19	-	-2.70E+00	±	8.54E-01 2.95E+00
07/31/19 - 08/29/19	-	-1.13E+00	±	8.93E-01 3.66E+00
08/29/19 - 10/01/19	-	-2.75E-01	±	1.20E+00 5.01E+00
10/01/19 - 10/31/19	-	-1.78E-16	±	5.53E-01 2.46E+00
10/31/19 - 12/02/19	-	5.50E-02	±	3.61E-01 1.64E+00
12/02/19 - 01/02/20	-	-1.47E-16	±	4.55E-01 2.03E+00

TABLE B-5.2
GROSS ALPHA IN SANITARY WASTE TREATMENT WATER - SUMMARY
 Results in pCi/liter

Location	Average Activity	Activity Low	Activity High	Number of Samples	Number of Positive IDs
ST-102B	-8.59E-02	-2.70E+00	5.20E+00	12	0

TABLE B-6.1
GROSS BETA IN SANITARY WASTE TREATMENT WATER
 Results in pCi/liter
STATION 102B - SWTF Headworks

Collection Period	RQ	Activity	Error	MDA
12/31/18 - 01/31/19	+	1.61E+01	±	1.78E+00 3.60E+00
01/31/19 - 03/01/19	+	2.12E+01	±	1.24E+00 2.58E+00
03/01/19 - 04/01/19	+	8.67E+00	±	1.31E+00 3.98E+00
04/01/19 - 05/01/19	+	1.82E+01	±	1.24E+00 3.37E+00
05/01/19 - 05/30/19	+	2.10E+01	±	1.33E+00 3.54E+00
05/30/19 - 07/01/19	+	1.62E+01	±	1.27E+00 3.55E+00
07/01/19 - 07/31/19	+	1.15E+01	±	8.30E-01 2.05E+00
07/31/19 - 08/29/19	+	1.06E+01	±	9.36E-01 2.44E+00
08/29/19 - 10/01/19	+	1.18E+01	±	1.73E+00 3.56E+00
10/01/19 - 10/31/19	+	1.09E+01	±	1.24E+00 2.67E+00
10/31/19 - 12/02/19	-	9.25E-01	±	6.33E-01 2.10E+00
12/02/19 - 01/02/20	+	5.12E+00	±	8.62E-01 2.12E+00

TABLE B-6.2
GROSS BETA IN SANITARY WASTE TREATMENT WATER - SUMMARY
 Results in pCi/liter

Location	Average Activity	Activity Low	Activity High	Number of Samples	Number of Positive IDs
ST-102B	1.27E+01	9.25E-01	2.12E+01	12	11

Table B-7.1
GAMMA SPECTROMETRY RESULTS OF SANITARY WASTE TREATMENT WATER
STATION 102B

Results in pCi/liter, corrected for decay during collection period

Location ST-102B collected				1/31/2019
Nuclide	RQ	Activity	Error	MDA
K-40	+	6.15E+01 ±	2.31E+01	2.64E+01
CR-51		-1.55E+01 ±	2.80E+01	3.86E+01
MN-54		-3.80E-01 ±	1.60E+00	2.04E+00
CO-58		-6.34E-02 ±	2.03E+00	2.62E+00
FE-59		6.81E+00 ±	5.92E+00	6.97E+00
CO-60		-7.78E-02 ±	1.54E+00	1.90E+00
ZN-65		1.60E-01 ±	3.19E+00	4.03E+00
ZRNB-95		-7.87E-01 ±	3.67E+00	4.84E+00
I-131		-1.76E+01 ±	3.13E+01	4.33E+01
CS-134		1.24E+00 ±	1.33E+00	1.77E+00
CS-137		1.13E+00 ±	1.38E+00	1.78E+00
BALA140		-4.43E+00 ±	1.46E+01	1.74E+01
BI-214		6.11E-01 ±	4.22E+00	5.31E+00

Location ST-102B collected				3/1/2019
Nuclide	RQ	Activity	Error	MDA
K-40	+	7.50E+01 ±	5.20E+01	6.66E+01
CR-51		-2.41E+01 ±	4.41E+01	6.09E+01
MN-54		1.98E+00 ±	3.80E+00	4.83E+00
CO-58		3.89E-02 ±	3.98E+00	5.17E+00
FE-59		2.48E+00 ±	1.05E+01	1.29E+01
CO-60		2.79E+00 ±	3.87E+00	4.55E+00
ZN-65		-1.61E+00 ±	8.71E+00	1.06E+01
ZRNB-95		3.67E+00 ±	7.56E+00	9.62E+00
I-131		-1.19E+01 ±	1.30E+01	1.78E+01
CS-134		-1.17E+00 ±	4.03E+00	5.28E+00
CS-137		3.18E-01 ±	3.89E+00	5.16E+00
BALA140		0.00E+00 ±	3.79E+00	1.38E+01
BI-214		3.15E+00 ±	1.16E+01	1.48E+01

Location ST-102B collected				4/1/2019
Nuclide	RQ	Activity	Error	MDA
K-40	+	9.80E+01 ±	4.44E+01	5.59E+01
CR-51		6.31E+00 ±	3.84E+01	5.37E+01
MN-54		1.49E-01 ±	3.51E+00	4.54E+00
CO-58		1.91E-01 ±	3.64E+00	4.72E+00
FE-59		-3.37E+00 ±	1.16E+01	1.42E+01
CO-60		2.80E+00 ±	3.25E+00	3.80E+00
ZN-65		-2.02E+00 ±	7.73E+00	9.44E+00
ZRNB-95		-2.24E+00 ±	7.46E+00	9.54E+00
I-131		-2.77E+00 ±	1.12E+01	1.57E+01
CS-134		-1.00E+00 ±	3.98E+00	5.22E+00
CS-137		1.57E+00 ±	3.52E+00	4.61E+00
BALA140		0.00E+00 ±	1.79E+00	1.23E+01
BI-214		3.58E+00 ±	5.33E+00	1.25E+01

Location ST-102B collected				5/1/2019
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.22E+02 ±	4.45E+01	5.53E+01
CR-51		1.70E+01 ±	4.59E+01	6.40E+01
MN-54		-2.04E+00 ±	3.99E+00	5.06E+00
CO-58		-4.83E-01 ±	4.20E+00	5.43E+00
FE-59		-1.84E+00 ±	1.23E+01	1.52E+01
CO-60		3.57E+00 ±	3.02E+00	4.63E+00
ZN-65		-1.49E+00 ±	8.32E+00	1.02E+01
ZRNB-95		5.45E+00 ±	7.14E+00	9.00E+00
I-131		7.75E+00 ±	2.45E+01	3.41E+01
CS-134		2.52E+00 ±	3.38E+00	4.37E+00
CS-137		8.24E-01 ±	3.50E+00	4.63E+00
BALA140		0.00E+00 ±	1.06E+00	2.01E+01
BI-214		0.00E+00 ±	7.44E+00	1.61E+01

Location ST-102B collected				5/30/2019
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.20E+02 ±	4.73E+01	6.01E+01
CR-51		8.58E+00 ±	4.31E+01	6.23E+01
MN-54		5.34E-01 ±	3.40E+00	4.66E+00
CO-58		-5.34E-01 ±	3.83E+00	5.24E+00
FE-59		4.83E+00 ±	9.78E+00	1.26E+01
CO-60		-1.58E+00 ±	3.60E+00	4.92E+00
ZN-65		-1.55E+00 ±	8.30E+00	1.40E+01
ZRNB-95		4.04E+00 ±	6.98E+00	9.39E+00
I-131		1.99E+00 ±	1.41E+01	2.04E+01
CS-134		-2.26E+00 ±	4.95E+00	8.21E+00
CS-137		-1.93E+00 ±	3.80E+00	5.29E+00
BALA140		-1.47E+00 ±	9.84E+00	1.26E+01
BI-214	+	3.39E+01 ±	6.64E+00	7.67E+00

Location ST-102B collected				7/1/2019
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.14E+02 ±	5.45E+01	6.80E+01
CR-51		1.01E+01 ±	4.51E+01	6.51E+01
MN-54		2.18E+00 ±	3.79E+00	5.09E+00
CO-58		-6.54E-01 ±	4.37E+00	5.98E+00
FE-59		-7.96E+00 ±	1.31E+01	1.67E+01
CO-60		3.58E+00 ±	3.85E+00	4.95E+00
ZN-65		-1.08E+00 ±	8.17E+00	1.09E+01
ZRNB-95		-2.45E+00 ±	8.15E+00	1.11E+01
I-131		6.21E+00 ±	1.20E+01	1.72E+01
CS-134		-4.03E-01 ±	5.03E+00	8.43E+00
CS-137		-2.59E+00 ±	4.54E+00	6.29E+00
BALA140		-1.29E+00 ±	1.04E+01	1.33E+01
BI-214	+	3.84E+01 ±	7.65E+00	8.83E+00

Table B-7.1
GAMMA SPECTROMETRY RESULTS OF SANITARY WASTE TREATMENT WATER
STATION 102B

Results in pCi/liter, corrected for decay during collection period

Location ST-102B collected 7/31/2019				
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.36E+02 ±	5.48E+01	7.01E+01
CR-51		2.53E+01 ±	5.44E+01	7.53E+01
MN-54		-1.33E+00 ±	5.21E+00	6.84E+00
CO-58		8.40E-01 ±	4.99E+00	6.61E+00
FE-59		-3.98E+00 ±	1.45E+01	1.82E+01
CO-60		-1.59E+00 ±	5.08E+00	6.35E+00
ZN-65		-6.13E+00 ±	1.18E+01	1.50E+01
ZRNB-95		1.36E+00 ±	9.61E+00	1.27E+01
I-131		9.97E+00 ±	1.39E+01	1.91E+01
CS-134		-3.25E+00 ±	6.18E+00	1.03E+01
CS-137		2.23E+00 ±	5.42E+00	7.29E+00
BALA140		-2.92E+00 ±	1.18E+01	1.45E+01
BI-214	+	4.34E+01 ±	8.97E+00	1.07E+01

Location ST-102B collected 8/29/2019				
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.64E+02 ±	5.49E+01	6.30E+01
CR-51		6.09E+00 ±	5.19E+01	7.24E+01
MN-54		-2.70E+00 ±	4.70E+00	6.11E+00
CO-58		-1.27E+00 ±	4.79E+00	6.30E+00
FE-59		-5.31E+00 ±	1.38E+01	1.72E+01
CO-60		2.18E+00 ±	3.60E+00	4.47E+00
ZN-65		-6.32E+00 ±	9.38E+00	1.19E+01
ZRNB-95		6.32E+00 ±	7.86E+00	1.02E+01
I-131		7.87E+00 ±	1.67E+01	2.31E+01
CS-134		3.01E-01 ±	5.47E+00	9.15E+00
CS-137		-2.04E+00 ±	4.71E+00	6.33E+00
BALA140		-7.21E+00 ±	1.30E+01	1.57E+01
BI-214	+	4.21E+01 ±	1.11E+01	1.22E+01

Location ST-102B collected 10/1/2019				
Nuclide	RQ	Activity	Error	MDA
K-40	+	2.39E+02 ±	4.45E+01	3.77E+01
CR-51		-2.39E+01 ±	4.98E+01	7.14E+01
MN-54		-1.21E+00 ±	3.90E+00	5.28E+00
CO-58		-1.41E+00 ±	4.28E+00	5.81E+00
FE-59		3.33E+00 ±	1.07E+01	1.38E+01
CO-60		-8.11E-01 ±	3.55E+00	4.82E+00
ZN-65		-2.74E+00 ±	8.58E+00	1.13E+01
ZRNB-95		-3.67E+00 ±	7.88E+00	1.06E+01
I-131		-1.97E+00 ±	1.73E+01	2.51E+01
CS-134		-3.02E-01 ±	4.79E+00	8.02E+00
CS-137		-4.03E-01 ±	3.68E+00	5.20E+00
BALA140		-9.07E+00 ±	1.35E+01	1.66E+01
BI-214	+	2.82E+01 ±	7.54E+00	9.18E+00

Location ST-102B collected 10/31/2019				
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.48E+02 ±	5.25E+01	6.13E+01
CR-51		1.83E+00 ±	5.34E+01	7.46E+01
MN-54		-3.10E+00 ±	4.83E+00	6.26E+00
CO-58		2.80E+00 ±	4.59E+00	5.98E+00
FE-59		4.62E+00 ±	1.11E+01	1.39E+01
CO-60		-3.45E+00 ±	5.06E+00	6.22E+00
ZN-65		-7.28E+00 ±	1.08E+01	1.36E+01
ZRNB-95		-8.50E-01 ±	9.00E+00	1.19E+01
I-131		-1.32E+00 ±	1.80E+01	2.52E+01
CS-134		-1.65E+00 ±	5.84E+00	9.73E+00
CS-137		7.49E-01 ±	4.34E+00	5.89E+00
BALA140		-4.36E+00 ±	1.27E+01	1.55E+01
BI-214	+	5.63E+01 ±	1.04E+01	1.11E+01

Location ST-102B collected 12/2/2019				
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.80E+02 ±	5.45E+01	6.50E+01
CR-51		4.54E+00 ±	4.71E+01	6.82E+01
MN-54		-1.24E+00 ±	4.01E+00	5.44E+00
CO-58		-1.65E+00 ±	4.51E+00	6.11E+00
FE-59		-2.69E+00 ±	1.28E+01	1.65E+01
CO-60		-5.74E-01 ±	3.98E+00	5.36E+00
ZN-65		0.00E+00 ±	5.46E+00	1.61E+01
ZRNB-95		2.48E+00 ±	7.69E+00	1.04E+01
I-131		5.32E-01 ±	1.40E+01	2.03E+01
CS-134		-9.95E-01 ±	5.36E+00	8.95E+00
CS-137		2.70E+00 ±	4.05E+00	5.60E+00
BALA140		-8.76E+00 ±	1.30E+01	1.60E+01
BI-214	+	2.35E+01 ±	9.35E+00	1.19E+01

Location ST-102B collected 1/2/2020				
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.23E+02 ±	5.14E+01	6.53E+01
CR-51		9.92E-01 ±	4.92E+01	7.14E+01
MN-54		3.65E-01 ±	4.03E+00	5.51E+00
CO-58		-2.62E+00 ±	4.77E+00	6.42E+00
FE-59		5.60E+00 ±	1.21E+01	1.55E+01
CO-60		-2.99E+00 ±	3.87E+00	5.23E+00
ZN-65		-5.65E-01 ±	8.23E+00	1.10E+01
ZRNB-95		1.80E+00 ±	7.82E+00	1.07E+01
I-131		-9.66E+00 ±	1.85E+01	2.65E+01
CS-134		-1.29E+00 ±	4.96E+00	8.28E+00
CS-137		-2.60E+00 ±	4.65E+00	6.45E+00
BALA140		-9.14E-01 ±	1.27E+01	1.62E+01
BI-214	+	2.87E+01 ±	7.38E+00	8.68E+00

TABLE B-7.2
GAMMA SPECTROMETRY RESULTS OF SANITARY WASTE TREATMENT WATER - SUMMARY
STATION 102B

Results in pCi/liter, corrected for decay during collection period

Nuclide	Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
K-40	1.32E+02	6.15E+01	2.39E+02	5.79E+01	12	12
CR-51	1.44E+00	-2.41E+01	2.53E+01	6.48E+01	12	0
MN-54	-5.67E-01	-3.10E+00	2.18E+00	5.14E+00	12	0
CO-58	-4.02E-01	-2.62E+00	2.80E+00	5.53E+00	12	0
FE-59	2.10E-01	-7.96E+00	6.81E+00	1.45E+01	12	0
CO-60	3.20E-01	-3.45E+00	3.58E+00	4.77E+00	12	0
ZN-65	-2.55E+00	-7.28E+00	1.60E-01	1.15E+01	12	0
ZRNB-95	1.34E+00	-2.74E+00	6.32E+00	1.01E+01	12	0
I-131	-9.10E-01	-1.76E+01	9.97E+00	2.40E+01	12	0
CS-134	-6.88E-01	-3.25E+00	2.52E+00	7.30E+00	12	0
CS-137	-4.16E-03	-2.60E+00	2.70E+00	5.38E+00	12	0
BALA140	-3.37E+00	-9.07E+00	0.00E+00	1.53E+01	12	0
BI-214	2.52E+01	0.00E+00	5.63E+01	1.07E+01	12	8

TABLE B-8.1
TRITIUM IN SANITARY WASTE TREATMENT WATER

Results in pCi/liter, MDA for all samples is 300 pCi/liter

Station	Description	Collection Period			RQ	Activity	Error
102B	SWTF Headworks	12/31/18	-	01/31/19		1.48E+02	<u>+</u> 9.32E+01
		01/31/19	-	03/01/19		1.50E+02	<u>+</u> 9.25E+01
		03/01/19	-	04/01/19		1.01E+02	<u>+</u> 9.31E+01
		04/01/19	-	05/01/19		1.02E+02	<u>+</u> 8.96E+01
		05/01/19	-	05/30/19		-1.38E+02	<u>+</u> 9.36E+01
		05/30/19	-	07/01/19		1.45E+02	<u>+</u> 9.14E+01
		07/01/19	-	07/31/19		9.18E+01	<u>+</u> 9.20E+01
		07/31/19	-	08/29/19		1.13E+00	<u>+</u> 6.16E+01
		08/29/19	-	10/01/19		8.05E+01	<u>+</u> 9.48E+01
		10/01/19	-	10/31/19		1.40E+02	<u>+</u> 9.05E+01
		10/31/19	-	12/02/19		2.39E+02	<u>+</u> 9.18E+01
		12/02/19	-	01/02/20		1.11E+02	<u>+</u> 9.35E+01

TABLE B-8.2
TRITIUM IN SANITARY WASTE TREATMENT WATER - SUMMARY

Results in pCi/liter

Station	Description	Average Activity	Activity Low	Activity High	Number of Samples	Number of Positive IDs
102B	SWTF Headworks	9.76E+01	-1.38E+02	2.39E+02	12	0

TABLE B-9.1
GAMMA SPECTROMETRY RESULTS OF CGS POST DISPOSAL COOLING TOWER SEDIMENT

Results in pCi/kilogram dry material

Location & Date			119B	6/20/2019	Location & Date			119B	11/11/2019
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.76E+04 ±	1.13E+03	4.89E+02	BE-7	+	3.17E+03 ±	6.23E+02	5.73E+02
K-40	+	9.93E+03 ±	1.01E+03	4.02E+02	K-40	+	1.10E+04 ±	1.23E+03	5.82E+02
CR-51		1.69E+02 ±	5.07E+02	7.41E+02	CR-51		1.41E+02 ±	4.63E+02	6.84E+02
MN-54		-5.21E+00 ±	4.28E+01	6.08E+01	MN-54		1.59E+01 ±	4.96E+01	6.98E+01
CO-58		-1.51E+01 ±	4.88E+01	6.81E+01	CO-58		0.00E+00 ±	1.71E+01	6.73E+01
FE-59		4.43E+01 ±	1.03E+02	1.39E+02	FE-59		-9.15E+01 ±	1.93E+02	2.52E+02
CO-60		2.63E+01 ±	4.80E+01	6.34E+01	CO-60	+	2.29E+02 ±	4.39E+01	3.48E+01
ZN-65		1.66E+00 ±	1.19E+02	2.06E+02	ZN-65		-7.43E+01 ±	1.64E+02	2.77E+02
ZRNB-95		1.66E+01 ±	6.89E+01	9.80E+01	ZRNB-95		3.76E+01 ±	7.18E+01	1.00E+02
CS-134		-2.20E+01 ±	7.07E+01	1.19E+02	CS-134		2.37E+01 ±	8.08E+01	1.36E+02
CS-137		7.47E+01 ±	5.92E+01	7.69E+01	CS-137	+	1.61E+02 ±	6.45E+01	7.24E+01
BALA140		-8.26E+01 ±	1.27E+02	1.60E+02	BALA140		-4.43E+01 ±	9.57E+01	1.24E+02
BI-214	+	5.49E+02 ±	9.73E+01	9.00E+01	BI-214	+	5.79E+02 ±	1.25E+02	1.25E+02

TABLE B-10.1
GAMMA SPECTROMETRY RESULTS OF GROUNDWATER MONITORING SAMPLES
 Results in pCi/liter

Station MW-3 collected					1/29/2019	Station MW-10 collected					1/30/2019
Nuclide	RQ	Activity	Error	MDA		Nuclide	RQ	Activity	Error	MDA	
K-40		4.27E+01 ±	1.01E+02	1.33E+02		K-40		8.91E+01 ±	8.78E+01	1.15E+02	
MN-54		-1.40E+00 ±	7.46E+00	9.71E+00		MN-54		1.15E+00 ±	7.22E+00	9.43E+00	
CO-58		7.73E-01 ±	7.67E+00	1.00E+01		CO-58		-1.08E+00 ±	7.00E+00	9.21E+00	
FE-59		2.37E+00 ±	1.80E+01	2.26E+01		FE-59		9.24E+00 ±	1.85E+01	2.29E+01	
CO-60		-2.84E+00 ±	8.96E+00	1.08E+01		CO-60		-2.36E+00 ±	8.97E+00	1.08E+01	
ZN-65		-1.08E+01 ±	1.99E+01	2.40E+01		ZN-65		0.00E+00 ±	6.77E+00	2.39E+01	
ZRNB-95		6.63E+00 ±	1.17E+01	1.50E+01		ZRNB-95		-1.07E+01 ±	1.61E+01	2.05E+01	
I-131		3.30E+00 ±	7.53E+00	1.05E+01		I-131		-3.22E+00 ±	1.95E+01	2.76E+01	
CS-134		-3.91E+00 ±	8.76E+00	1.15E+01		CS-134		-4.74E-01 ±	6.77E+00	9.08E+00	
CS-137		6.64E+00 ±	7.64E+00	9.88E+00		CS-137		-1.49E+00 ±	7.63E+00	1.02E+01	
BALA140		3.99E+00 ±	7.65E+00	9.05E+00		BALA140		-2.93E-01 ±	1.71E+01	2.08E+01	
BI-214	+	6.48E+02 ±	4.02E+01	2.78E+01		BI-214	+	1.77E+02 ±	2.54E+01	2.56E+01	
Station MW-5 collected					1/29/2019	Station MW-11 collected					1/30/2019
Nuclide	RQ	Activity	Error	MDA		Nuclide	RQ	Activity	Error	MDA	
K-40		8.47E+01 ±	8.46E+01	1.12E+02		K-40		4.15E+01 ±	7.56E+01	1.06E+02	
MN-54		2.02E+00 ±	6.33E+00	8.24E+00		MN-54		2.17E+00 ±	5.99E+00	7.80E+00	
CO-58		-5.14E+00 ±	7.68E+00	9.75E+00		CO-58		1.92E+00 ±	6.71E+00	8.77E+00	
FE-59		-1.11E+01 ±	2.13E+01	2.59E+01		FE-59		5.73E+00 ±	1.73E+01	2.18E+01	
CO-60		3.42E+00 ±	6.29E+00	7.59E+00		CO-60		0.00E+00 ±	2.22E+00	9.77E+00	
ZN-65		-2.85E+00 ±	1.49E+01	1.86E+01		ZN-65		-1.03E+01 ±	1.77E+01	2.15E+01	
ZRNB-95		0.00E+00 ±	5.61E+00	1.87E+01		ZRNB-95		-5.04E+00 ±	1.35E+01	1.74E+01	
I-131		-4.82E+00 ±	7.73E+00	1.07E+01		I-131		5.96E+00 ±	1.74E+01	2.46E+01	
CS-134		2.74E+00 ±	7.07E+00	9.34E+00		CS-134		3.45E+00 ±	6.24E+00	8.20E+00	
CS-137		-2.38E+00 ±	7.17E+00	9.55E+00		CS-137		-3.18E-02 ±	6.51E+00	8.86E+00	
BALA140		3.70E+00 ±	8.56E+00	1.02E+01		BALA140		0.00E+00 ±	8.26E+00	2.32E+01	
BI-214	+	1.76E+02 ±	2.47E+01	2.59E+01		BI-214	+	2.62E+01 ±	1.79E+01	2.40E+01	
Station MW-6 collected					1/29/2019	Station MW-12 collected					1/30/2019
Nuclide	RQ	Activity	Error	MDA		Nuclide	RQ	Activity	Error	MDA	
K-40		4.27E+01 ±	8.51E+01	1.15E+02		K-40		6.43E+01 ±	8.92E+01	1.19E+02	
MN-54		-2.10E+00 ±	7.30E+00	9.47E+00		MN-54		3.34E+00 ±	6.34E+00	8.16E+00	
CO-58		-2.24E+00 ±	6.94E+00	9.02E+00		CO-58		-4.51E-01 ±	7.33E+00	9.71E+00	
FE-59		-1.04E+01 ±	1.99E+01	2.44E+01		FE-59		6.83E+00 ±	1.57E+01	1.98E+01	
CO-60		0.00E+00 ±	1.85E+00	1.15E+01		CO-60		-3.73E-01 ±	6.89E+00	8.58E+00	
ZN-65		-2.74E+00 ±	1.30E+01	1.63E+01		ZN-65		-1.00E+00 ±	1.34E+01	1.70E+01	
ZRNB-95		-2.22E+00 ±	1.21E+01	1.58E+01		ZRNB-95		-1.80E+00 ±	1.41E+01	1.85E+01	
I-131		-2.19E+00 ±	1.01E+01	1.43E+01		I-131		-1.58E+01 ±	3.78E+01	5.30E+01	
CS-134		-2.80E+00 ±	7.45E+00	9.82E+00		CS-134		-3.72E-01 ±	6.62E+00	8.90E+00	
CS-137		-2.19E+00 ±	7.89E+00	1.05E+01		CS-137		1.88E+00 ±	6.62E+00	8.86E+00	
BALA140		-5.03E+00 ±	1.33E+01	1.57E+01		BALA140		1.08E+01 ±	1.86E+01	2.22E+01	
BI-214	+	9.58E+01 ±	2.20E+01	2.48E+01		BI-214	+	5.34E+01 ±	1.98E+01	2.46E+01	
Station MW-9 collected					1/30/2019	Station MW-13 collected					1/29/2019
Nuclide	RQ	Activity	Error	MDA		Nuclide	RQ	Activity	Error	MDA	
K-40		8.95E+00 ±	8.00E+01	1.12E+02		K-40		5.74E+01 ±	8.60E+01	1.15E+02	
MN-54		-5.04E+00 ±	7.88E+00	1.00E+01		MN-54		0.00E+00 ±	3.62E+00	1.07E+01	
CO-58		1.97E-01 ±	6.39E+00	8.48E+00		CO-58		6.94E+00 ±	6.44E+00	8.01E+00	
FE-59		5.21E-01 ±	1.80E+01	2.29E+01		FE-59		-7.37E+00 ±	2.00E+01	2.47E+01	
CO-60		1.65E-01 ±	6.45E+00	8.08E+00		CO-60		-3.71E+01 ±	6.86E+00	8.53E+00	
ZN-65		4.08E+00 ±	1.42E+01	1.76E+01		ZN-65		6.97E+00 ±	1.27E+01	1.56E+01	
ZRNB-95		-2.59E+00 ±	1.22E+01	1.60E+01		ZRNB-95		0.00E+00 ±	2.18E+00	1.95E+01	
I-131		2.96E+00 ±	1.03E+01	1.46E+01		I-131		-6.21E-01 ±	9.44E+00	1.35E+01	
CS-134		2.88E-01 ±	6.04E+00	8.15E+00		CS-134		4.72E-01 ±	7.27E+00	9.72E+00	
CS-137		4.57E+00 ±	6.05E+00	7.89E+00		CS-137		-3.68E+00 ±	8.08E+00	1.07E+01	
BALA140		4.70E+00 ±	1.06E+01	1.26E+01		BALA140		-1.48E+00 ±	1.24E+01	1.50E+01	
BI-214	+	1.04E+02 ±	2.01E+01	2.27E+01		BI-214	+	1.78E+02 ±	2.56E+01	2.56E+01	

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

Page 1 of 5

TABLE B-10.1
GAMMA SPECTROMETRY RESULTS OF GROUNDWATER MONITORING SAMPLES
 Results in pCi/liter

Station MW-14 collected 1/29/2019					Station MW-MW-9 collected 5/7/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		3.66E+00 ±	8.28E+01	1.15E+02	K-40		2.98E+01 ±	9.67E+01	1.33E+02
MN-54		2.17E+00 ±	6.73E+00	8.74E+00	MN-54		3.76E+00 ±	6.21E+00	8.19E+00
CO-58		9.85E-01 ±	6.44E+00	8.48E+00	CO-58		0.00E+00 ±	2.89E+00	8.89E+00
FE-59		2.71E+00 ±	1.56E+01	1.98E+01	FE-59		-8.28E+00 ±	2.00E+01	2.54E+01
CO-60		-1.24E-01 ±	6.84E+00	8.53E+00	CO-60		5.73E+00 ±	5.46E+00	6.62E+00
ZN-65		-6.01E+00 ±	1.53E+01	1.89E+01	ZN-65		5.13E+00 ±	1.01E+01	1.32E+01
ZRNB-95		8.52E+00 ±	1.04E+01	1.32E+01	ZRNB-95		3.56E+00 ±	9.65E+00	1.34E+01
I-131		5.77E+00 ±	9.82E+00	1.37E+01	I-131		3.01E+00 ±	9.02E+00	1.32E+01
CS-134		2.91E+00 ±	5.97E+00	7.88E+00	CS-134		-2.67E+00 ±	6.95E+00	9.47E+00
CS-137		-1.59E+00 ±	7.26E+00	9.72E+00	CS-137		-5.92E-01 ±	6.67E+00	9.31E+00
BALA140		0.00E+00 ±	8.56E-01	1.35E+01	BALA140		5.14E-01 ±	9.11E+00	1.16E+01
BI-214	+	7.61E+01 ±	1.95E+01	2.38E+01	BI-214	+	1.43E+02 ±	2.11E+01	2.21E+01
Station MW-MW-3 collected 4/30/2019					Station MW-MW-10 collected 5/7/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		6.06E+01 ±	8.01E+01	1.09E+02	K-40		1.12E+02 ±	8.61E+01	1.12E+02
MN-54		-9.63E-01 ±	7.17E+00	9.37E+00	MN-54		6.61E-01 ±	6.65E+00	8.74E+00
CO-58		-5.88E-01 ±	7.12E+00	9.33E+00	CO-58		0.00E+00 ±	4.09E+00	8.48E+00
FE-59		-2.85E+00 ±	1.73E+01	2.18E+01	FE-59		3.86E+00 ±	1.47E+01	1.87E+01
CO-60		3.46E+00 ±	8.09E+00	9.73E+00	CO-60		-1.40E+00 ±	7.30E+00	8.96E+00
ZN-65		7.88E+00 ±	1.37E+01	1.67E+01	ZN-65		-9.42E+00 ±	1.65E+01	2.00E+01
ZRNB-95		4.26E+00 ±	1.21E+01	1.56E+01	ZRNB-95		-1.73E-01 ±	1.21E+01	1.60E+01
I-131		-2.64E+00 ±	8.02E+00	1.12E+01	I-131		-1.07E+01 ±	1.29E+01	1.77E+01
CS-134		-2.29E+00 ±	7.96E+00	1.05E+01	CS-134		-2.52E+00 ±	7.36E+00	9.72E+00
CS-137		2.83E+00 ±	7.44E+00	9.88E+00	CS-137		3.46E+00 ±	6.13E+00	8.10E+00
BALA140		0.00E+00 ±	2.46E+00	1.43E+01	BALA140		0.00E+00 ±	3.43E+00	1.60E+01
BI-214	+	3.85E+02 ±	3.14E+01	2.59E+01	BI-214	+	7.03E+01 ±	2.12E+01	2.50E+01
Station MW-MW-5 collected 4/30/2019					Station MW-MW-11 collected 5/7/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		8.47E+01 ±	8.46E+01	1.12E+02	K-40		6.51E+01 ±	8.34E+01	1.12E+02
MN-54		2.32E+00 ±	5.91E+00	7.68E+00	MN-54		4.16E+00 ±	6.38E+00	8.15E+00
CO-58		-1.43E+00 ±	6.74E+00	8.82E+00	CO-58		-1.92E+00 ±	7.22E+00	9.39E+00
FE-59		1.54E+00 ±	1.62E+01	2.06E+01	FE-59		1.46E+01 ±	1.48E+01	1.76E+01
CO-60		5.03E+00 ±	5.07E+00	5.91E+00	CO-60		-2.68E+00 ±	7.73E+00	9.37E+00
ZN-65		7.91E+00 ±	1.33E+01	1.63E+01	ZN-65		-3.72E-01 ±	1.40E+01	1.77E+01
ZRNB-95		-9.67E-01 ±	1.08E+01	1.43E+01	ZRNB-95		8.24E+00 ±	1.05E+01	1.33E+01
I-131		-1.62E+00 ±	9.19E+00	1.31E+01	I-131		-3.85E+00 ±	1.17E+01	1.65E+01
CS-134		-1.44E+00 ±	6.68E+00	8.90E+00	CS-134		1.29E+00 ±	6.87E+00	9.16E+00
CS-137		-1.18E+00 ±	6.57E+00	8.86E+00	CS-137		2.06E+00 ±	6.62E+00	8.86E+00
BALA140		-4.44E+00 ±	1.27E+01	1.50E+01	BALA140		0.00E+00 ±	3.34E+00	1.81E+01
BI-214		2.10E+01 ±	1.88E+01	2.53E+01	BI-214	+	8.43E+01 ±	2.13E+01	2.53E+01
Station MW-6 collected 4/30/2019					Station MW-MW-12 collected 5/7/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		8.22E+01 ±	9.21E+01	1.27E+02	K-40		9.38E+01 ±	8.60E+01	1.18E+02
MN-54		-9.73E-01 ±	8.01E+00	1.11E+01	MN-54		3.11E+00 ±	5.86E+00	7.78E+00
CO-58		5.81E-01 ±	6.40E+00	8.94E+00	CO-58		4.19E+00 ±	4.34E+00	5.58E+00
FE-59		-7.56E+00 ±	1.74E+01	2.26E+01	FE-59		-2.39E+00 ±	1.69E+01	2.21E+01
CO-60		1.29E-01 ±	6.64E+00	9.21E+00	CO-60		1.33E+00 ±	5.47E+00	7.18E+00
ZN-65		6.60E+00 ±	2.06E+01	3.47E+01	ZN-65		6.82E+00 ±	8.12E+00	1.03E+01
ZRNB-95		6.39E+00 ±	1.21E+01	1.65E+01	ZRNB-95		5.63E+00 ±	9.09E+00	1.24E+01
I-131		1.36E+00 ±	7.66E+00	1.12E+01	I-131		5.66E+00 ±	9.23E+00	1.33E+01
CS-134		3.92E+00 ±	1.50E+01	2.50E+01	CS-134		-4.78E+00 ±	7.06E+00	9.49E+00
CS-137		-5.41E+00 ±	9.18E+00	1.28E+01	CS-137		-3.85E+00 ±	7.22E+00	9.80E+00
BALA140		3.48E+00 ±	8.37E+00	1.07E+01	BALA140		0.00E+00 ±	9.74E-01	1.92E+01
BI-214	+	2.55E+02 ±	2.73E+01	2.50E+01	BI-214	+	7.41E+01 ±	1.93E+01	2.31E+01

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

Page 2 of 5

TABLE B-10.1
GAMMA SPECTROMETRY RESULTS OF GROUNDWATER MONITORING SAMPLES
 Results in pCi/liter

Station MW-MW-13 collected 4/30/2019					Station MW-6 collected 7/30/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		7.13E+01 ±	9.35E+01	1.27E+02	K-40		4.62E+01 ±	1.06E+02	1.44E+02
MN-54		4.28E-01 ±	6.16E+00	8.40E+00	MN-54		1.76E+00 ±	6.64E+00	9.17E+00
CO-58		-2.38E+00 ±	6.63E+00	8.87E+00	CO-58		-4.58E+00 ±	7.73E+00	1.04E+01
FE-59		9.57E+00 ±	1.31E+01	1.64E+01	FE-59		-2.45E-01 ±	1.69E+01	2.27E+01
CO-60		0.00E+00 ±	3.11E+00	1.12E+01	CO-60		-1.25E+00 ±	7.30E+00	1.01E+01
ZN-65		1.23E+01 ±	1.01E+01	1.23E+01	ZN-65		-8.59E+00 ±	2.32E+01	3.88E+01
ZRNB-95		-2.13E+00 ±	1.06E+01	1.48E+01	ZRNB-95		2.70E+00 ±	1.18E+01	1.63E+01
I-131		-3.82E+00 ±	8.99E+00	1.31E+01	I-131		9.59E-01 ±	6.97E+00	1.02E+01
CS-134		1.78E+00 ±	5.74E+00	7.90E+00	CS-134		-4.44E+00 ±	1.50E+01	2.49E+01
CS-137		1.78E+00 ±	6.48E+00	8.97E+00	CS-137		-5.03E+00 ±	8.75E+00	1.22E+01
BALA140		0.00E+00 ±	1.74E+00	1.50E+01	BALA140		2.28E+00 ±	8.65E+00	1.12E+01
BI-214	+	9.30E+01 ±	2.02E+01	2.18E+01	BI-214	+	2.33E+02 ±	2.44E+01	2.16E+01
Station MW-MW-14 collected 4/30/2019					Station MW-9 collected 8/6/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		3.01E+01 ±	8.73E+01	1.19E+02	K-40		2.05E+01 ±	9.21E+01	1.26E+02
MN-54		-4.04E-01 ±	7.14E+00	9.37E+00	MN-54		-2.15E+00 ±	7.56E+00	1.01E+01
CO-58		1.52E+00 ±	5.95E+00	7.80E+00	CO-58		-3.67E+00 ±	7.59E+00	1.00E+01
FE-59		1.31E+01 ±	1.33E+01	1.59E+01	FE-59		-1.73E+00 ±	1.92E+01	2.48E+01
CO-60		3.29E-01 ±	7.21E+00	8.94E+00	CO-60		-1.58E+00 ±	7.97E+00	1.02E+01
ZN-65		0.00E+00 ±	8.49E+00	2.22E+01	ZN-65		-5.11E+00 ±	1.92E+01	3.24E+01
ZRNB-95		-4.48E+00 ±	1.35E+01	1.75E+01	ZRNB-95		-7.94E+00 ±	1.37E+01	1.80E+01
I-131		-7.92E-01 ±	7.63E+00	1.08E+01	I-131		1.42E+00 ±	1.17E+01	1.66E+01
CS-134		-3.91E-01 ±	7.48E+00	1.00E+01	CS-134		1.23E+00 ±	1.11E+01	1.86E+01
CS-137		1.46E+00 ±	6.44E+00	8.67E+00	CS-137		-4.19E+00 ±	8.44E+00	1.14E+01
BALA140		1.40E+00 ±	8.11E+00	9.84E+00	BALA140		2.29E+00 ±	9.11E+00	1.16E+01
BI-214	+	3.22E+02 ±	3.02E+01	2.59E+01	BI-214	+	8.56E+01 ±	2.05E+01	2.43E+01
Station MW-3 collected 7/30/2019					Station MW-10 collected 8/6/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		1.15E+02 ±	7.44E+01	1.35E+02	K-40		6.26E+01 ±	9.35E+01	1.30E+02
MN-54		-4.78E+00 ±	8.61E+00	1.13E+01	MN-54		-3.77E+00 ±	7.05E+00	9.59E+00
CO-58		-1.71E+00 ±	7.47E+00	1.00E+01	CO-58		2.89E+00 ±	6.36E+00	8.72E+00
FE-59		-4.55E+00 ±	1.99E+01	2.54E+01	FE-59		8.62E+00 ±	1.40E+01	1.82E+01
CO-60		2.28E+00 ±	7.80E+00	9.95E+00	CO-60		8.23E-01 ±	7.00E+00	9.59E+00
ZN-65		-3.68E+00 ±	2.12E+01	3.59E+01	ZN-65		6.12E+00 ±	1.39E+01	2.35E+01
ZRNB-95		-7.98E+00 ±	1.56E+01	2.04E+01	ZRNB-95		-7.21E-01 ±	1.17E+01	1.64E+01
I-131		4.17E-01 ±	1.21E+01	1.72E+01	I-131		-6.47E+00 ±	1.25E+01	1.80E+01
CS-134		1.38E+00 ±	1.31E+01	2.20E+01	CS-134		-2.43E+00 ±	1.02E+01	1.72E+01
CS-137		-3.05E+00 ±	8.06E+00	1.10E+01	CS-137		-4.34E-01 ±	6.76E+00	9.74E+00
BALA140		-9.11E+00 ±	1.51E+01	1.83E+01	BALA140		3.74E+00 ±	7.31E+00	9.53E+00
BI-214	+	1.76E+02 ±	2.35E+01	2.41E+01	BI-214	+	6.30E+01 ±	1.74E+01	2.13E+01
Station MW-5 collected 7/30/2019					Station MW-11 collected 8/6/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40	+	1.61E+02 ±	7.88E+01	1.05E+02	K-40		9.77E+01 ±	8.23E+01	1.10E+02
MN-54		-9.91E-01 ±	6.89E+00	9.58E+00	MN-54		-6.80E-01 ±	7.60E+00	1.02E+01
CO-58		2.47E+00 ±	6.07E+00	8.37E+00	CO-58		3.94E-01 ±	7.04E+00	9.53E+00
FE-59		-1.34E-01 ±	1.67E+01	2.27E+01	FE-59		-2.63E+00 ±	1.90E+01	2.45E+01
CO-60		6.53E+00 ±	5.90E+00	7.59E+00	CO-60		-5.50E+00 ±	8.21E+00	1.02E+01
ZN-65		-1.06E+01 ±	1.90E+01	3.17E+01	ZN-65		-3.87E+00 ±	1.70E+01	2.89E+01
ZRNB-95		-1.08E+00 ±	1.19E+01	1.66E+01	ZRNB-95		-3.25E+00 ±	1.38E+01	1.84E+01
I-131		-4.64E+00 ±	1.17E+01	1.70E+01	I-131		-1.22E+00 ±	1.31E+01	1.86E+01
CS-134		-3.86E+00 ±	1.05E+01	1.76E+01	CS-134		-4.84E+00 ±	1.13E+01	1.88E+01
CS-137		-3.87E+00 ±	7.77E+00	1.09E+01	CS-137		3.43E+00 ±	7.53E+00	1.02E+01
BALA140		6.50E-01 ±	1.13E+01	1.49E+01	BALA140		2.91E+00 ±	1.01E+01	1.28E+01
BI-214	+	6.33E+01 ±	1.80E+01	2.18E+01	BI-214	+	6.08E+01 ±	1.99E+01	2.48E+01

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

Page 3 of 5

TABLE B-10.1
GAMMA SPECTROMETRY RESULTS OF GROUNDWATER MONITORING SAMPLES

Results in pCi/liter

Station MW-12 collected				8/6/2019
Nuclide	RQ	Activity	Error	MDA
K-40		4.88E+01 ±	8.98E+01	1.22E+02
MN-54		-1.10E+00 ±	7.24E+00	9.73E+00
CO-58		-3.33E+00 ±	8.20E+00	1.08E+01
FE-59		1.67E+00 ±	1.77E+01	2.30E+01
CO-60		9.41E-01 ±	6.33E+00	8.25E+00
ZN-65		-1.13E+01 ±	1.95E+01	3.24E+01
ZRNB-95		5.28E+00 ±	1.28E+01	1.70E+01
I-131		2.62E+00 ±	1.42E+01	2.01E+01
CS-134		-4.93E+00 ±	1.09E+01	1.82E+01
CS-137		0.00E+00 ±	5.41E-05	1.04E+01
BALA140		-7.28E+00 ±	1.36E+01	1.68E+01
BI-214	+	4.33E+01 ±	2.06E+01	2.58E+01

Station MW-MW-5 collected				10/15/2019
Nuclide	RQ	Activity	Error	MDA
K-40		6.01E+01 ±	8.64E+01	1.17E+02
MN-54		1.59E+00 ±	6.60E+00	8.86E+00
CO-58		-3.10E+00 ±	7.58E+00	1.00E+01
FE-59		-3.80E+00 ±	1.82E+01	2.34E+01
CO-60		2.62E+00 ±	6.95E+00	8.86E+00
ZN-65		-6.11E+00 ±	1.69E+01	2.85E+01
ZRNB-95		-7.38E+00 ±	1.48E+01	1.95E+01
I-131		-5.85E+00 ±	1.44E+01	2.02E+01
CS-134		-4.58E+00 ±	9.92E+00	1.65E+01
CS-137		3.81E+00 ±	6.73E+00	9.13E+00
BALA140		3.58E-01 ±	1.04E+01	1.34E+01
BI-214	+	3.59E+01 ±	1.63E+01	2.20E+01

Station MW-13 collected				7/30/2019
Nuclide	RQ	Activity	Error	MDA
K-40		3.57E+01 ±	8.50E+01	1.17E+02
MN-54		2.49E+00 ±	7.29E+00	9.69E+00
CO-58		-1.81E+00 ±	7.77E+00	1.04E+01
FE-59		3.13E+00 ±	1.79E+01	2.31E+01
CO-60		2.47E-01 ±	7.01E+00	9.14E+00
ZN-65		-8.72E+00 ±	1.86E+01	3.11E+01
ZRNB-95		3.79E+00 ±	1.14E+01	1.53E+01
I-131		-7.56E+00 ±	1.35E+01	1.88E+01
CS-134		-4.81E+00 ±	1.17E+01	1.95E+01
CS-137		4.22E+00 ±	7.30E+00	9.87E+00
BALA140		-3.92E+00 ±	1.26E+01	1.57E+01
BI-214	+	7.50E+01 ±	2.04E+01	2.42E+01

Station MW-MW-6 collected				10/15/2019
Nuclide	RQ	Activity	Error	MDA
K-40		3.86E+01 ±	8.72E+01	1.19E+02
MN-54		2.61E-01 ±	7.47E+00	1.01E+01
CO-58		2.71E+00 ±	7.46E+00	9.90E+00
FE-59		2.27E-01 ±	1.90E+01	2.46E+01
CO-60		1.63E+00 ±	7.96E+00	1.02E+01
ZN-65		-1.08E+01 ±	2.38E+01	3.98E+01
ZRNB-95		-1.48E+00 ±	1.46E+01	1.95E+01
I-131		-2.88E+00 ±	8.90E+00	1.24E+01
CS-134		4.40E+00 ±	1.57E+01	2.61E+01
CS-137		-6.10E+00 ±	9.85E+00	1.32E+01
BALA140		-6.71E-01 ±	1.03E+01	1.29E+01
BI-214	+	2.81E+02 ±	2.91E+01	2.69E+01

Station MW-14 collected				7/30/2019
Nuclide	RQ	Activity	Error	MDA
K-40		5.27E+01 ±	8.60E+01	1.17E+02
MN-54		-9.48E-01 ±	7.34E+00	9.87E+00
CO-58		1.60E-01 ±	7.83E+00	1.06E+01
FE-59		-3.22E+00 ±	1.84E+01	2.38E+01
CO-60		1.78E+00 ±	6.65E+00	8.56E+00
ZN-65		-1.06E+01 ±	1.82E+01	3.03E+01
ZRNB-95		-5.99E+00 ±	1.38E+01	1.83E+01
I-131		-1.79E+00 ±	1.48E+01	2.10E+01
CS-134		2.84E+00 ±	1.04E+01	1.75E+01
CS-137		5.72E-01 ±	7.47E+00	1.04E+01
BALA140		-3.79E-01 ±	1.21E+01	1.55E+01
BI-214	+	4.56E+01 ±	2.25E+01	2.74E+01

Station MW-MW-9 collected				10/23/2019
Nuclide	RQ	Activity	Error	MDA
K-40		4.93E+01 ±	8.20E+01	1.18E+02
MN-54		-4.34E+00 ±	7.65E+00	1.04E+01
CO-58		-2.43E+00 ±	7.02E+00	9.66E+00
FE-59		1.66E+01 ±	1.51E+01	1.86E+01
CO-60		1.09E+00 ±	7.02E+00	9.59E+00
ZN-65		-6.57E+00 ±	2.00E+01	3.38E+01
ZRNB-95		-1.41E+00 ±	1.21E+01	1.68E+01
I-131		-1.82E+00 ±	1.03E+01	1.50E+01
CS-134		-4.16E+00 ±	1.24E+01	2.07E+01
CS-137		-3.67E+00 ±	7.91E+00	1.11E+01
BALA140		-8.30E+00 ±	1.25E+01	1.56E+01
BI-214	+	1.25E+02 ±	2.09E+01	2.27E+01

Station MW-MW-3 collected				10/15/2019
Nuclide	RQ	Activity	Error	MDA
K-40	+	2.41E+02 ±	7.78E+01	7.02E+01
MN-54		3.01E-01 ±	7.46E+00	1.01E+01
CO-58		-8.96E-01 ±	7.32E+00	9.85E+00
FE-59		-8.61E+00 ±	2.06E+01	2.60E+01
CO-60		3.66E+00 ±	6.54E+00	8.25E+00
ZN-65		1.60E+00 ±	1.94E+01	3.30E+01
ZRNB-95		6.68E+00 ±	1.08E+01	1.43E+01
I-131		-1.15E+00 ±	1.25E+01	1.76E+01
CS-134		-5.26E+00 ±	1.35E+01	2.24E+01
CS-137		-5.58E+00 ±	9.47E+00	1.27E+01
BALA140		-5.14E+00 ±	1.27E+01	1.57E+01
BI-214	+	1.42E+02 ±	2.30E+01	2.45E+01

Station MW-MW-10 collected				10/23/2019
Nuclide	RQ	Activity	Error	MDA
K-40		1.24E+02 ±	9.19E+01	1.58E+02
MN-54		-1.35E+00 ±	7.40E+00	9.92E+00
CO-58		-9.28E-01 ±	7.38E+00	9.92E+00
FE-59		-1.22E+00 ±	1.73E+01	2.25E+01
CO-60		-1.53E+00 ±	6.37E+00	8.24E+00
ZN-65		-8.85E+00 ±	1.86E+01	3.12E+01
ZRNB-95		-2.64E+00 ±	1.30E+01	1.74E+01
I-131		-5.18E-01 ±	1.05E+01	1.50E+01
CS-134		-4.49E+00 ±	1.13E+01	1.89E+01
CS-137		2.29E+00 ±	8.85E+00	1.21E+01
BALA140		-1.31E+00 ±	1.27E+01	1.59E+01
BI-214	+	7.81E+01 ±	2.10E+01	2.47E+01

RQ = Results Qualifier. If blank, result is less than detection limit. If "+", result is above detection limit.

Page 4 of 5

TABLE B-10.1
GAMMA SPECTROMETRY RESULTS OF GROUNDWATER MONITORING SAMPLES
 Results in pCi/liter

Station MW-MW-11 collected 10/22/2019					Station MW-MW-13 collected 10/15/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		8.84E+01 ±	8.39E+01	1.13E+02	K-40		3.13E+01 ±	8.68E+01	1.19E+02
MN-54		-2.80E+00 ±	7.80E+00	1.03E+01	MN-54		4.82E+00 ±	6.64E+00	8.67E+00
CO-58		4.57E+00 ±	6.56E+00	8.58E+00	CO-58		6.32E+00 ±	5.82E+00	7.43E+00
FE-59		8.77E-01 ±	1.52E+01	2.01E+01	FE-59		-3.70E+00 ±	1.77E+01	2.28E+01
CO-60		-2.92E+00 ±	8.83E+00	1.12E+01	CO-60		1.88E+00 ±	6.89E+00	8.85E+00
ZN-65		5.39E+00 ±	1.78E+01	3.00E+01	ZN-65		-9.91E+00 ±	1.94E+01	3.24E+01
ZRNB-95		-7.11E+00 ±	1.42E+01	1.87E+01	ZRNB-95		-3.89E+00 ±	1.46E+01	1.94E+01
I-131		-5.11E-01 ±	1.22E+01	1.73E+01	I-131		4.71E+00 ±	1.10E+01	1.54E+01
CS-134		1.34E+00 ±	1.14E+01	1.92E+01	CS-134		-4.77E+00 ±	1.18E+01	1.97E+01
CS-137		-4.76E+00 ±	9.08E+00	1.23E+01	CS-137		-1.33E+00 ±	8.86E+00	1.22E+01
BALA140		5.15E-01 ±	1.10E+01	1.41E+01	BALA140		-1.54E+00 ±	1.05E+01	1.33E+01
BI-214	+	1.03E+02 ±	2.06E+01	2.36E+01	BI-214	+	8.09E+01 ±	2.22E+01	2.59E+01
Station MW-MW-12 collected 10/22/2019					Station MW-14 collected 10/15/2019				
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
K-40		7.00E+01 ±	9.78E+01	1.34E+02	K-40	+	2.00E+02 ±	8.19E+01	1.06E+02
MN-54		2.19E+00 ±	6.20E+00	8.55E+00	MN-54		2.57E+00 ±	7.18E+00	9.84E+00
CO-58		3.96E+00 ±	6.61E+00	8.98E+00	CO-58		1.21E+00 ±	5.66E+00	7.93E+00
FE-59		7.25E+00 ±	1.63E+01	2.13E+01	FE-59		1.19E+00 ±	1.66E+01	2.23E+01
CO-60		-2.33E+00 ±	6.06E+00	8.66E+00	CO-60		-2.11E+00 ±	6.82E+00	9.59E+00
ZN-65		-3.62E+00 ±	1.62E+01	2.77E+01	ZN-65		-3.65E+00 ±	1.80E+01	3.07E+01
ZRNB-95		4.01E+00 ±	1.09E+01	1.51E+01	ZRNB-95		2.50E+00 ±	1.23E+01	1.70E+01
I-131		1.11E+00 ±	1.19E+01	1.75E+01	I-131		-4.67E-01 ±	1.11E+01	1.63E+01
CS-134		-3.96E+00 ±	1.10E+01	1.84E+01	CS-134		8.58E-01 ±	1.15E+01	1.94E+01
CS-137		2.92E+00 ±	6.78E+00	9.57E+00	CS-137		-3.24E+00 ±	7.73E+00	1.09E+01
BALA140		-9.86E-01 ±	1.15E+01	1.51E+01	BALA140		-6.37E+00 ±	1.25E+01	1.58E+01
BI-214	+	8.27E+01 ±	1.99E+01	2.21E+01	BI-214	+	1.11E+02 ±	2.11E+01	2.22E+01

Table B-10.2
GAMMA SPECTROMETRY RESULTS OF GROUNDWATER MONITORING SAMPLES - SUMMARY
 Results in pCi/liter

Nuclide	Average Activity	Activity Low	Activity High	Average MDA	Number of Samples	Number of Positive IDs
K-40	7.24E+01	3.66E+00	2.41E+02	1.19E+02	36	3
MN-54	2.08E-01	-5.04E+00	4.82E+00	9.36E+00	36	0
CO-58	1.14E-01	-5.14E+00	6.94E+00	9.13E+00	36	0
FE-59	8.33E-01	-1.11E+01	1.66E+01	2.21E+01	36	0
CO-60	4.36E-01	-5.50E+00	6.53E+00	9.12E+00	36	0
ZN-65	-2.35E+00	-1.13E+01	1.23E+01	2.52E+01	36	0
ZRNB-95	-3.56E-01	-1.07E+01	8.52E+00	1.67E+01	36	0
I-131	-1.27E+00	-1.58E+01	5.96E+00	1.69E+01	36	0
CS-134	-1.26E+00	-5.26E+00	4.40E+00	1.50E+01	36	0
CS-137	-6.04E-01	-6.10E+00	6.64E+00	1.03E+01	36	0
BALA140	-4.14E-01	-9.11E+00	1.08E+01	1.47E+01	36	0
BI-214	1.35E+02	2.10E+01	6.48E+02	2.43E+01	36	35

TABLE B-11.1
TRITIUM IN GROUNDWATER MONITORING WELL SAMPLES
 Results in pCi/liter

Location	Collection Date	RQ	Activity	Error
MW-3	07/30/19	+	6.46E+02	\pm 1.07E+02
	10/15/19	+	5.43E+02	\pm 1.03E+02
	01/29/19	+	7.63E+02	\pm 1.11E+02
	04/30/19	+	7.33E+02	\pm 1.05E+02
MW-5	07/30/19	+	1.19E+04	\pm 2.69E+02
	10/15/19	+	1.15E+04	\pm 2.66E+02
	01/29/19	+	1.26E+04	\pm 2.78E+02
	04/30/19	+	1.20E+04	\pm 2.68E+02
MW-6	07/30/19	+	5.01E+03	\pm 1.86E+02
	10/15/19	+	5.12E+03	\pm 1.88E+02
	01/29/19	+	4.82E+03	\pm 1.85E+02
	04/30/19	+	5.04E+03	\pm 1.84E+02
MW-9	01/30/19		1.59E+02	\pm 9.52E+01
	05/07/19	+	3.53E+02	\pm 9.86E+01
	08/06/19		2.91E+02	\pm 9.57E+01
	10/23/19	+	3.30E+02	\pm 9.73E+01
MW-10	01/30/19		2.39E+02	\pm 9.73E+01
	05/07/19	+	3.95E+02	\pm 9.85E+01
	08/06/19	+	4.30E+02	\pm 9.97E+01
	10/23/19		2.79E+02	\pm 9.52E+01
MW-11	01/30/19	+	1.05E+03	\pm 1.18E+02
	05/07/19	+	1.09E+03	\pm 1.17E+02
	08/06/19	+	1.26E+03	\pm 1.20E+02
	10/23/19	+	1.05E+03	\pm 1.14E+02
MW-12	01/30/19	+	3.70E+02	\pm 1.01E+02
	05/07/19	+	5.44E+02	\pm 1.03E+02
	08/06/19	+	4.75E+02	\pm 1.00E+02
	10/23/19	+	5.15E+02	\pm 1.01E+02
MW-13	07/30/19	+	1.02E+04	\pm 2.49E+02
	10/15/19	+	9.99E+03	\pm 2.50E+02
	01/29/19	+	9.81E+03	\pm 2.48E+02
	04/30/19	+	9.98E+03	\pm 2.45E+02
MW-14	07/30/19		2.03E+02	\pm 9.51E+01
	10/15/19		2.15E+02	\pm 9.51E+01
	01/29/19		1.72E+02	\pm 9.53E+01
	04/30/19		2.71E+02	\pm 9.24E+01

Table B-12.1
GAMMA SPECTROMETRY RESULTS OF EVAPORATION POND WATER
 Results in pCi/liter

Location EVP-1A collected 4/25/2019				
Nuclide	RQ	Activity	Error	MDA
K-40	+	1.48E+02 ±	7.37E+01	9.59E+01
CR-51	-	1.54E+00 ±	4.95E+01	7.08E+01
MN-54		4.66E+00 ±	5.49E+00	6.94E+00
CO-58		2.10E+00 ±	5.20E+00	6.80E+00
FE-59		6.05E+00 ±	1.42E+01	1.77E+01
CO-60		1.61E+00 ±	6.94E+00	8.52E+00
ZN-65		5.73E+00 ±	9.91E+00	1.23E+01
ZRNB-95		8.89E-01 ±	1.14E+01	1.51E+01
I-131	-	1.15E+00 ±	8.12E+00	1.16E+01
CS-134		1.86E+00 ±	6.69E+00	8.89E+00
CS-137		5.91E+00 ±	6.13E+00	7.89E+00
BALA140		-4.12E+00 ±	1.07E+01	1.27E+01
BI-214		1.00E+01 ±	1.19E+01	2.31E+01

Location EVP-1B collected 4/25/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		5.63E+01 ±	8.04E+01	1.15E+02
CR-51		3.27E+01 ±	4.18E+01	5.97E+01
MN-54		-1.90E+00 ±	6.38E+00	8.56E+00
CO-58		4.90E+00 ±	4.71E+00	6.01E+00
FE-59		-2.24E+00 ±	1.59E+01	2.07E+01
CO-60		3.46E+00 ±	4.76E+00	5.99E+00
ZN-65		-6.90E+00 ±	1.48E+01	1.92E+01
ZRNB-95		2.09E+00 ±	9.87E+00	1.38E+01
I-131		2.27E+00 ±	6.92E+00	1.01E+01
CS-134		1.94E+00 ±	5.54E+00	7.62E+00
CS-137		-4.24E+00 ±	7.69E+00	1.04E+01
BALA140		0.00E+00 ±	7.82E-01	1.42E+01
BI-214		1.16E+01 ±	1.55E+01	2.17E+01

Location EVP 2 collected 4/25/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		8.25E+01 ±	7.24E+01	1.01E+02
CR-51		3.77E+01 ±	5.20E+01	7.19E+01
MN-54		1.66E+00 ±	6.34E+00	8.29E+00
CO-58		2.55E-01 ±	5.86E+00	7.79E+00
FE-59		-1.99E+00 ±	1.65E+01	2.10E+01
CO-60		1.36E+00 ±	6.92E+00	8.52E+00
ZN-65		5.88E+00 ±	1.13E+01	1.40E+01
ZRNB-95		1.05E+01 ±	1.06E+01	1.32E+01
I-131	-	1.66E+00 ±	7.49E+00	1.07E+01
CS-134		6.82E+00 ±	5.52E+00	6.98E+00
CS-137		-2.60E+00 ±	7.05E+00	9.38E+00
BALA140		-7.25E-01 ±	1.00E+01	1.22E+01
BI-214		6.40E+00 ±	1.65E+01	2.32E+01

Location EVP 3 collected 4/25/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		6.78E+01 ±	8.74E+01	1.21E+02
CR-51		-1.03E+01 ±	4.45E+01	6.54E+01
MN-54		-2.00E+00 ±	6.83E+00	9.15E+00
CO-58		0.00E+00 ±	3.72E+00	8.30E+00
FE-59		6.10E+00 ±	1.24E+01	1.59E+01
CO-60		3.33E+00 ±	5.22E+00	6.61E+00
ZN-65		6.51E+00 ±	1.01E+01	1.31E+01
ZRNB-95		8.72E-01 ±	9.53E+00	1.35E+01
I-131		-5.82E+00 ±	8.70E+00	1.25E+01
CS-134		-5.66E-01 ±	6.33E+00	8.77E+00
CS-137		-3.75E+00 ±	6.60E+00	8.97E+00
BALA140		2.24E+00 ±	5.48E+00	7.00E+00
BI-214		1.35E+01 ±	1.51E+01	2.10E+01

Location EVP 4 collected 4/25/2019				
Nuclide	RQ	Activity	Error	MDA
K-40		8.94E+01 ±	6.91E+01	9.65E+01
CR-51		7.89E+00 ±	5.11E+01	7.26E+01
MN-54		-6.26E-01 ±	6.45E+00	8.50E+00
CO-58		3.53E-01 ±	6.44E+00	8.51E+00
FE-59		-8.46E+00 ±	1.87E+01	2.31E+01
CO-60		1.90E+00 ±	6.58E+00	8.08E+00
ZN-65		-6.93E+00 ±	1.48E+01	1.82E+01
ZRNB-95		5.56E+00 ±	1.03E+01	1.33E+01
I-131		-3.74E+00 ±	9.42E+00	1.32E+01
CS-134		0.00E+00 ±	1.98E+00	9.48E+00
CS-137		-1.59E+00 ±	7.26E+00	9.72E+00
BALA140		-2.84E+00 ±	9.97E+00	1.20E+01
BI-214	+	4.34E+01 ±	1.95E+01	2.44E+01

TABLE B-13.1
GAMMA SPECTROMETRY RESULTS OF EVAPORATION POND SEDIMENT

Results in pCi/kilogram dry material

Location & Date			EVP-3	9/9/2019	Location & Date			EVP-4	9/9/2019
Nuclide	RQ	Activity	Error	MDA	Nuclide	RQ	Activity	Error	MDA
BE-7	+	1.75E+03 ±	5.29E+02	5.60E+02	BE-7	+	1.09E+04 ±	1.53E+03	1.09E+03
K-40	+	1.49E+04 ±	1.20E+03	4.05E+02	K-40	+	4.14E+03 ±	9.36E+02	7.56E+02
CR-51		5.51E+02 ±	8.70E+02	1.26E+03	CR-51		4.09E+02 ±	1.55E+03	2.31E+03
MN-54		-2.90E+01 ±	4.82E+01	6.56E+01	MN-54		9.92E+00 ±	2.07E+01	3.91E+01
CO-58		-2.42E+00 ±	5.34E+01	7.69E+01	CO-58		2.54E+01 ±	6.59E+01	9.56E+01
FE-59		1.98E+01 ±	2.17E+02	2.95E+02	FE-59		-3.32E+01 ±	2.91E+02	4.13E+02
CO-60		8.48E+00 ±	3.08E+01	4.33E+01	CO-60		-1.90E+01 ±	5.13E+01	8.92E+01
ZN-65		-5.54E+01 ±	1.41E+02	2.39E+02	ZN-65		1.21E+01 ±	9.97E+01	1.49E+02
ZRNB-95		4.40E+00 ±	1.23E+02	1.75E+02	ZRNB-95		6.46E+01 ±	1.57E+02	2.22E+02
CS-134		-1.57E+01 ±	6.68E+01	1.13E+02	CS-134		8.29E+00 ±	6.17E+01	9.09E+01
CS-137		2.17E+00 ±	4.93E+01	6.92E+01	CS-137		2.01E+01 ±	7.05E+01	9.97E+01
BALA140		-6.93E+00 ±	3.59E+02	5.27E+02	BALA140		7.30E+02 ±	4.63E+02	1.17E+03
BI-214	+	5.91E+02 ±	1.03E+02	9.17E+01	BI-214		-9.33E+00 ±	1.50E+02	2.28E+02

TABLE B-14.1
GROSS BETA IN EVAPORATION POND WATER
 Results in pCi/liter

Collection					
Location	Date	RQ	Activity	Error	MDA
Evaporation Pond 1A	04/25/19		2.33E+00	±	8.05E-01
Evaporation Pond 1B	04/25/19		9.74E-01	±	6.57E-01
Evaporation Pond 2	04/25/19		-8.13E-01	±	6.62E-01
Evaporation Pond 3	04/25/19		5.29E-01	±	6.48E-01
Evaporation Pond 4	04/25/19		4.56E-01	±	6.53E-01

TABLE B-15.1
TRITIUM IN EVAPORATION POND WATER
 Results in pCi/liter, LLD is 300 pCi/liter

Collection				
Location	Date	RQ	Activity	Error
Evaporation Pond 1A	04/25/19		1.71E+02	±
Evaporation Pond 1B	04/25/19		1.32E+02	±
Evaporation Pond 2	04/25/19		1.55E+02	±
Evaporation Pond 3	04/25/19		2.55E+02	±
Evaporation Pond 4	04/25/19	+	1.51E+03	±

TABLE B-16.1
TRITIUM IN SNOW
 Results in pCi/liter, LLD is 300 pCi/liter

Location	Sector	Distance from Collection		RQ	Activity	Error
		CGS, miles	Date			
ST-101B	ENE	0.22	03/13/19		1.49E+02 ±	9.18E+01
ST-119	S	0.31	03/13/19		2.92E+02 ±	9.67E+01
ST-155	NW	0.30	03/13/19		1.91E+02 ±	9.51E+01
ST-76	ESE	0.42	03/13/19		1.99E+02 ±	9.47E+01
ST-81	SW	0.74	03/13/19		2.08E+02 ±	9.40E+01
ST-88	WNW	0.17	03/13/19		2.76E+02 ±	9.77E+01

TABLE B-17.1
CARBON 14 IN APPLES
 Results in pCi/gram wet mass

Location	Distance from CGS, miles	Sector from CGS	Sample Type	Collection				Error	MDA
				Date	RQ	Activity			
St-37	4.3	ESE	Ind	8/27/2019		3.40E-01	±	5.40E-01	9.60E-01
St-37	4.3	ESE	Ind	8/27/2019		1.30E-01	±	5.40E-01	9.60E-01
St-37	4.3	ESE	Ind	8/27/2019		2.70E-01	±	5.20E-01	9.60E-01
Kennewick	23.00	SSE	Cntl	9/13/2019		8.40E-01	±	5.70E-01	9.60E-01
Basin City	12.00	NE	Ind	9/13/2019		9.00E-02	±	5.50E-01	9.60E-01
Mattawa	34.5	WNW	Cntl	9/13/2019		3.80E-01	±	5.30E-01	9.60E-01
Basin City	12	NE	Ind	9/13/2019		2.60E-01	±	5.30E-01	9.60E-01

The first three sample results were a blind triplicate analysis of the same sample

Ind = Indicator location. Cntl = Control location.

RQ=Results Qualifier. If blank, results is less than detection limit. If "+", result is above the detection limit.

Page 1 of 1