

May 10, 2022

Docket Nos.: 50-321 50-348 50-424
50-366 50-364 50-425

NL-22-0344

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D. C. 20555-0001

Edwin I. Hatch Nuclear Plant – Units 1 & 2
Joseph M. Farley Nuclear Plant – Units 1 & 2
Vogtle Electric Generating Plant – Units 1 & 2
Annual Radiological Environmental Operating Reports for 2021

Ladies and Gentlemen:

In accordance with section 5.6.2 of the referenced plants' Technical Specifications, Southern Nuclear Operating Company hereby submits the Annual Radiological Environmental Operating Reports for 2021.

This letter contains no NRC commitments. If you have any questions, please contact Ryan Joyce at 205.992.6468.

Respectfully submitted,



Cheryl A. Gayheart
Regulatory Affairs Director

CAG/kgj/cg

Enclosures: 1. Hatch Annual Radiological Environmental Operating Report for 2021
2. Farley Annual Radiological Environmental Operating Report for 2021
3. Vogtle Annual Radiological Environmental Operating Report for 2021

cc: Regional Administrator, Region II
NRR Project Manager – Farley, Hatch, Vogtle 1 & 2
Senior Resident Inspector – Farley, Hatch, Vogtle 1 & 2
State of Alabama Department of Public Health, Office of Radiation
Control State of Georgia Department of Natural Resources
American Nuclear Insurers
RType: CGA02.001

**Edwin I. Hatch Nuclear Plant – Units 1 & 2
Joseph M. Farley Nuclear Plant – Units 1 & 2
Vogtle Electric Generating Plant – Units 1 & 2
Annual Radiological Environmental Operating Reports for 2021**

Enclosure 1

Hatch Annual Radiological Environmental Operating Report for 2021

**EDWIN I. HATCH NUCLEAR PLANT
2021 ANNUAL RADIOLOGICAL ENVIRONMENTAL
OPERATING REPORT**



This page intentionally left blank.

TABLE OF CONTENTS

1	Introduction	1
2	REMP Description	2
3	Results Summary	7
	3.1 Airborne Particulates	14
	3.1.1 Gross Beta	14
	3.1.2 Gamma Particulates.....	16
	3.2 Direct Radiation	16
	3.3 Biological Media.....	19
	3.3.1 Milk	19
	3.3.2 Vegetation.....	19
	3.3.3 Fish	19
	3.3.4 Biological Media Summary	20
	3.4 Surface Water	21
	3.5 Sediment	21
	3.6 Interlaboratory Comparison Program	22
4	Survey Summaries	25
	4.1 Land Use Census	25
	4.2 Altamaha River Survey	25
	4.3 Meteorological Report Summary	26
5	Conclusions	27

Tables

Table 2-1. Summary Description of Radiological Environmental Monitoring Program	3
Table 2-2. Radiological Environmental Sampling Locations	5
Table 3-1. Radiological Environmental Monitoring Program Annual Summary.....	9
Table 3-2. Reporting Levels (RL).....	12
Table 3-3. Anomalies and Deviations from Radiological Environmental Monitoring Program ..	13
Table 3-4. Average Weekly Gross Beta Air Concentration	15
Table 3-5. Average Quarterly Exposure from Direct Radiation (Historical)	17
Table 3-6. Interlaboratory Comparison Limits.....	22
Table 3-7. Interlaboratory Comparison Summary	23
Table 4-1. Land Use Census Results.....	25

Figures

Figure 3-1. Average Weekly Gross Beta Air Concentration	15
Figure 3-2. Average Quarterly Exposure from Direct Radiation	18
Figure 3-3. 2021 Average Exposure from Direct Radiation	18
Figure 3-4. 2021 Biological Media Average Cs-137 Concentrations.....	20
Figure 3-5. Average Annual Tritium Concentrations in River Water	21



Appendix A – Maps

A-1 – REMP Stations in Plant Vicinity

A-2 – REMP Stations within 10 Miles

Appendix B – Errata

Appendix C – Data



LIST OF ACRONYMS

AREOR	Annual Radiological Environmental Operating Report
BWR	Boiling Water Reactor
CL	Confidence Level
GPC	Georgia Power Company
GPCEL	Georgia Power Company Environmental Laboratory
HNP	Edwin I. Hatch Nuclear Plant
ICP	Interlaboratory Comparison Program
MDC	Minimum Detectable Concentration
MDD	Minimum Detectable Difference
MWt	MegaWatts Thermal
NA	Not Applicable
NDM	No Detectable Measurement(s)
NEI	Nuclear Energy Institute
NRC	Nuclear Regulatory Commission
ODCM	Offsite Dose Calculation Manual
OSLD	Optically Stimulated Luminescence
REMP	Radiological Environmental Monitoring Program
RL	Reporting Level
RM	River Mile
SNC	Southern Nuclear Operating Company
TLD	Thermoluminescent Dosimeter
TS	Technical Specification



1 INTRODUCTION

The Radiological Environmental Monitoring Program (REMP) was conducted in accordance with Chapter 4 of the Offsite Dose Calculation Manual (ODCM). The REMP activities for 2021 are reported herein in accordance with Technical Specification (TS) Section 5.6.2 and ODCM Section 7.1.

The objectives of the REMP were to:

- 1) Determine the levels of radiation and the concentrations of radioactivity in the environs and;
- 2) Assess the radiological impact (if any) to the environment due to the operation of the Edwin I. Hatch Nuclear Plant (HNP).

The assessments included comparisons between the results of analyses of samples obtained at locations where radiological levels were not expected to be affected by plant operation (control stations), areas of higher population (community stations), and at locations where radiological levels were more likely to be affected by plant operation (indicator stations), as well as comparisons between preoperational and operational sample results.

HNP is owned by Georgia Power Company (GPC), Oglethorpe Power Corporation, the Municipal Electric Authority of Georgia, and Dalton Utilities. The plant is located in Appling County, Georgia on the southwest side of the Altamaha River near Baxley, Georgia. Unit 1, a General Electric Company Boiling Water Reactor (BWR) with a licensed core thermal output of 924 MegaWatts (MWt), began commercial operation on December 31, 1975. Unit 2, also a General Electric Company BWR rated for 924 MWt, began commercial operation on September 5, 1979.

The pre-operational stage of the REMP began with the establishment and activation of the environmental monitoring stations in January of 1972. The operational stage of the REMP began on September 12, 1974 with Unit 1 initial criticality.

- A description of the REMP is provided in Section 2 of this report
- Section 3 provides a summary of the results, an assessment of any radiological impacts to the environment, and the results from the interlaboratory comparison
- A summary of the land use census and the river survey are included in Section 4
- Conclusions are included in Section 5



2 REMP DESCRIPTION

The following section provides a description of the sampling and laboratory protocols associated with the REMP. Table 2-1 provides a summary of the sample types to be collected and the analyses to be performed in order to monitor the airborne, direct radiation, waterborne and ingestion pathways, and also summarizes the collection and analysis frequencies (in accordance with ODCM Section 4.2). Table 2-2 provides specific information regarding the station locations, their proximity to the plant, and exposure pathways. Additionally, Appendix A of this report provides Maps A-1 through A-3 that depict the georeferenced location of sampling stations. Appendix B contains any Errata from previous reports, no Errata was identified for inclusion in this 2021 report. Analytical results for each of the analyzed REMP sampling points are provided in Appendix C.

Beginning in October 2017 and continuing through 2021, a contractor through Southern Nuclear Operating Company (SNC) provided services for the collection of most of the REMP samples, only fish samples were collected by the Alabama Power Company and analyzed by the Georgia Power Company Environmental Lab (GPCEL) in Atlanta, Georgia. The GPCEL analyzed all REMP samples.



Table 2-1. Summary Description of Radiological Environmental Monitoring Program

Exposure Pathway and/or Sample	Approximate Number of Sample Locations	Sampling/Collection Frequency	Type/Frequency of Analysis
Direct Radiation	37 routine monitoring stations	Quarterly	Gamma dose/Quarterly
Airborne Radioiodine and Particulates	Samples from six locations:	Continuous sampler operation with sample collection weekly	Particulate sampler: Analyze for gross beta radioactivity not less than 24 hours following filter change/Weekly; perform gamma isotopic analysis on affected sample when gross beta activity is 10 times the yearly mean of control samples. Perform gamma isotopic analysis on composite sample (by location)/Quarterly. Radioiodine canister: I-131 analysis/Weekly
Waterborne			
Surface	One sample upriver One sample downriver	Composite sample over one month period ¹	Gamma isotopic analysis ² /Monthly Composite for tritium analysis/Quarterly
Drinking ^{3,4}	One sample of river water near the intake and one sample of finished water from each of one to three of the nearest water supplies which could be affected by HNP discharges.	River water collected near the intake will be a composite sample; the finished water will be a grab sample. These samples will be collected monthly unless the calculated dose due to consumption of the water is greater than 1 mrem/year; then the collection will be biweekly. The collections may revert to monthly should the calculated doses become less than 1 mrem/year.	I-131 analysis on each sample when biweekly collections are required. Gross beta and gamma isotopic analysis on each sample; composite (by location) for tritium analysis/Quarterly.
Shoreline Sediment	Two	Semiannually	Gamma isotopic analysis ² /Semiannually
Ingestion			
Milk ⁵	One	Bimonthly	Gamma isotopic analysis ^{2,7} /Bimonthly



Table 2-1. Summary Description of Radiological Environmental Monitoring Program

Exposure Pathway and/or Sample	Approximate Number of Sample Locations	Sampling/Collection Frequency	Type/Frequency of Analysis
Fish or Clams ⁶	Two	Semiannually during spawning season	Gamma isotopic analysis ² on edible portions /Semiannually
Grass or Leafy Vegetation	Three	Monthly during growing season	Gamma isotopic analysis ^{2,7} /Monthly
<p>Notes:</p> <p>¹Composite sample aliquots were collected at time intervals were are very short (e.g., hourly) relative to the compositing period (e.g., monthly) to ensure obtaining a representative sample.</p> <p>²Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.</p> <p>³If it is found that river water downstream of the plant is used for drinking, drinking water samples will be collected and analyzed as specified herein.</p> <p>⁴A survey shall be conducted annually at least 50 river miles downstream of the plant to identify those who use water from the Altamaha River for drinking.</p> <p>⁵Up to three sampling locations within five miles and in different sectors will be used as available. In addition, one or more control locations beyond 10 miles will be used.</p> <p>⁶Commercially or recreationally important fish may be sampled. Clams may be sampled if difficulties are encountered in obtaining sufficient fish samples.</p> <p>⁷If the gamma isotopic analysis is not sensitive enough to meet the Minimum Detectable Concentration (MDC) for I-131, a separate analysis for I-131 may be performed.</p>			



Table 2-2. Radiological Environmental Sampling Locations

Station Number	Station Type	Descriptive Location	Direction ¹	Distance (miles) ¹	Radiation Sample Type
064	Other	Roadside Park	WNW	0.8	Direct
101	Indicator	Inner Ring	N	1.9	Direct
102	Indicator	Inner Ring	NNE	2.5	Direct
103	Indicator	Inner Ring	NE	1.8	Airborne, Direct
104	Indicator	Inner Ring	ENE	1.6	Direct
105	Indicator	Inner Ring	E	3.7	Direct
106	Indicator	Inner Ring	ESE	1.1	Direct, Vegetation
107	Indicator	Inner Ring	SE	1.2	Airborne, Direct
108	Indicator	Inner Ring	SSE	1.6	Direct
109	Indicator	Inner Ring	S	0.9	Direct
110	Indicator	Inner Ring	SSW	1.0	Direct
111	Indicator	Inner Ring	SW	0.9	Direct
112	Indicator	Inner Ring	WSW	1.0	Airborne, Direct, Vegetation
113	Indicator	Inner Ring	W	1.1	Direct
114	Indicator	Inner Ring	WNW	1.2	Direct
115	Indicator	Inner Ring	NW	1.1	Direct
116	Indicator	Inner Ring	NNW	2.0 ⁴	Airborne, Direct
170	Control	Upstream	WNW	**2	River ³
172	Indicator	Downstream	E	**2	River ³
201	Other	Outer Ring	N	5.0	Direct
202	Other	Outer Ring	NNE	4.9	Direct
203	Other	Outer Ring	NE	5.0	Direct
204	Other	Outer Ring	ENE	5.0	Direct
205	Other	Outer Ring	E	7.2	Direct
206	Other	Outer Ring	ESE	4.8	Direct
207	Other	Outer Ring	SE	4.3	Direct
208	Other	Outer Ring	SSE	4.8	Direct
209	Other	Outer Ring	S	4.4	Direct
210	Other	Outer Ring	SSW	4.3	Direct
211	Other	Outer Ring	SW	4.7	Direct
212	Other	Outer Ring	WSW	4.4	Direct
213	Other	Outer Ring	W	4.3	Direct
214	Other	Outer Ring	WNW	5.4	Direct
215	Other	Outer Ring	NW	4.4	Direct
216	Other	Outer Ring	NNW	4.8	Direct
301	Other	Toombs Central School	N	8.0	Direct



Table 2-2. Radiological Environmental Sampling Locations

Station Number	Station Type	Descriptive Location	Direction ¹	Distance (miles) ¹	Radiation Sample Type
304	Control	State Prison	ENE	11.2	Airborne, Direct
304	Control	State Prison	ENE	10.3	Milk
309	Control	Baxley Substation	S	10.0	Airborne, Direct
416	Control	Emergency News Center	NNW	21.0	Direct, Vegetation

Notes:

¹Direction and distance were determined from the main stack.

²Station 170 was located approximately 0.6 river miles upstream of the intake structure for river water, 1.1 river miles for sediment and clams, and 1.5 river miles for fish.

Station 172 was located approximately 3.0 river miles downstream of the discharge structure for river water, sediment and clams, and 1.7 river miles for fish.

The locations from which river water and sediment may be taken can be sharply defined. However, the sampling locations for clams often have to be extended over a wide area to obtain a sufficient quantity. High water adds to the difficulty in obtaining clam samples and may also make an otherwise suitable location for sediment sampling unavailable. A stretch of the river of a few miles or so was generally needed to obtain adequate fish samples. The mile locations given above represent approximations of the locations where samples were collected.

³River (fish or clams, shoreline sediment, and surface water)

⁴This station was shifted approximately 0.4 miles due to a highway widening project. Sector did not change. Map A-1 shows the new station location.



3 RESULTS SUMMARY

Included in this section are statistical evaluations of the laboratory results, comparison of the results by media, and a summary of the anomalies and deviations. Overall, 1553 analyses were performed across nine exposure pathways. Tables and figures are provided throughout this section to provide an enhanced presentation of the information.

In recent history, man-made nuclides have been released into the environment and have resulted in wide spread distribution of radionuclides across the globe. For example, atmospheric nuclear weapons tests from the mid-1940s through 1980 distributed man-made nuclides around the world. The most recent atmospheric tests in the 1970s and in 1980 have had a significant impact upon the radiological concentrations found in the environment prior to and during pre-operation, and through early operation. Some long-lived radionuclides, such as Cs-137, continue to be detected and a portion of these detections are believed to be attributed to the nuclear weapons tests.

Additionally, data associated with certain radiological effects created by off-site events have been removed from the historical evaluation, this includes: the nuclear atmospheric weapon test in the fall of 1980, the Chernobyl incident in the spring of 1986 and the Fukushima accident in the spring of 2011.

As indicated in ODCM 7.1.2.1, the results for naturally occurring radionuclides that are also found in plant effluents must be reported along with man-made radionuclides. Historically, the radionuclide Be-7, which occurs abundantly in nature, is often detected in REMP samples, and occasionally detected in the plant's liquid and gaseous effluents. In 2021, Be-7 was not detected in plant effluents and therefore it was not included in this report. When it is detected in plant effluents and REMP samples, it is also included in the REMP results.

As part of the data evaluation process, SNC considered the impact of the non-plant associated nuclides along with a statistical evaluation of the REMP data. The statistical evaluations included within this report include the Minimum Detectable Concentration (MDC), the Minimum Detectable Difference (MDD), and Chauvenet's Criterion as described below.

Minimum Detectable Concentration

The minimum detectable concentration is defined as an estimate of the true concentration of an analyte required to give a specified high probability that the measured response will be greater than the critical value.

Minimum Detectable Difference

The Minimum Detectable Difference (MDD) compares the lowest significant difference (between the means) of a control station, versus an indicator station or a community station, that can be determined statistically at the 99% Confidence Level (CL). A difference



in mean values which was less than the MDD was considered to be statistically indiscernible. The MDD is used to evaluate the statistical proximity between the indicator/community and control sample results, but generally, any results that are less than the MDC and/or Reporting Levels (RL) are considered to have minimal impact on the surrounding environs.

Chauvenet's Criterion

All results were tested for conformance with Chauvenet's Criterion (G. D. Chase and J. L. Rabinowitz, Principles of Radioisotope Methodology, Burgess Publishing Company, 1962, pages 87-90) to identify values which differed from the mean of a set by a statistically significant amount. Identified outliers were investigated to determine the reason(s) for the difference. If equipment malfunction or other valid physical reasons were identified as causing the variation, the anomalous result was excluded from the data set as non-representative.

Table 3-1 summarizes and evaluates the annual results for the indicator stations against the control and community stations (where applicable) and as appropriate, results were evaluated against the MDCs (listed in Table 3-1) and RLs (listed in Table 3-2). The required MDCs were achieved during laboratory sample analysis. The 2021 results were compared with previous results, including those obtained during pre-operation. No data points were excluded for violating Chauvenet's Criterion.



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Units)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
Airborne Particulates (fCi/m3)	Gross Beta 311	10	22.1 4.3 to 48.4 (211/211)	Inner Ring SE 1.2 mi. (Indicator)	23 11.4 to 39.4 (51/51)		21.6 9.4 to 39.4 (104/104)
	Gamma Isotopic 24						
	Be-7	24					
	I-131	70	NDM(c)		NDM		NDM
	Cs-134	50	NDM		NDM		NDM
	Cs-137	60	NDM		NDM		NDM
Airborne Radioiodine (fCi/m3)	I-131 310	70	NDM		NDM	NDM	NDM
Direct Radiation (mR/91 days)	Gamma Dose 148		12.3 8.8 to 22.3 (64/64)	Inner Ring NW 1.1 mi.	19.4 17.3 to 22.3 (4/4)	12.2 8.8 to 19.3 (72/72)	11.6 9.7 to 14.3 (12/12)
Milk (pCi/l)	Gamma Isotopic 26						
	I-131	1			NDM		NDM
	Cs-134	15			NDM		NDM
	Cs-137	18			NDM		NDM
	Ba-140	60			NDM		NDM
	La-140	15				NDM	NDM
Vegetation (pCi/kg-wet)	Gamma Isotopic 34						
	Be-7						
	I-131	60	NDM				NDM
	Cs-134	60	NDM				NDM



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Units)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
	Cs-137	80	12.9 0 to 60.5 (7/22)	Inner Ring ESE 1.1 mi. Indicator	60.5 0 to 60.5 (1/12)		52.8 0 to 52.8 (1/12)
River Water (pCi/l)	Gamma Isotopic 24						
	Mn-54	15	NDM		NDM		NDM
	Fe-59	30	NDM		NDM		NDM
	Co-58	15	NDM		NDM		NDM
	Co-60	15	NDM		NDM		NDM
	Zn-65	30	NDM		NDM		NDM
	Zr-95	30	NDM		NDM		NDM
	Nb-95	15	NDM		NDM		NDM
	I-131	15(d)	NDM		NDM		NDM
	Cs-134	15	NDM		NDM		NDM
	Cs-137	18	NDM		NDM		NDM
	Ba-140	60	NDM		NDM		NDM
	La-140	15	NDM		NDM		NDM
	Tritium 6	3000 (e)	151.4 0 to 356 (2/3)	Downstream E ~ 3.0 RM from intake Indicator	151.4 0 to 356 (2/3)		115 0 to 115 (1/3)
Fish (pCi/kg-wet)	Gamma Isotopic 6						
	Be-7	655(d)	NDM				NDM
	Mn-54	130	NDM				NDM
	Fe-59	260	NDM				NDM



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Units)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
	Co-58	130	NDM				NDM
	Co-60	130	NDM				NDM
	Zn-65	260	NDM				NDM
	Cs-134	130	NDM				NDM
	Cs-137	150	NDM				NDM
Sediment (pCi/kg-dry)	Gamma Isotopic 4						
	Cs-134	150	NDM				NDM
	Cs-137	180	NDM				NDM

Notes:

- (a) The MDC is defined in ODCM 10.1. Except as noted otherwise, the values listed in this column are the detection capabilities required by ODCM Table 4-3. The values listed in this column are a priori (before the fact) MDCs. In practice, the a posteriori (after the fact) MDCs are generally lower than the values listed.
 - (b) Mean and range were based upon detectable measurements only. The fraction of all measurements at a specified location that are detectable is placed in parenthesis.
 - (c) No Detectable Measurement(s) (NDM).
 - (d) If a drinking water pathway were to exist, a MDC of 1pCi/L would have been used.
 - (e) If a drinking water pathway were to exist, a MDC of 2000 pCi/L would have been used.
- Not Applicable (NA) (sample not required)



Table 3-2. Reporting Levels (RL)

Analysis	Water (pCi/l)	Airborne Particulate or Gases (fCi/m ³)	Fish (pCi/kg-wet)	Milk (pCi/l)	Grass or Leafy Vegetation (pCi/kg-wet)
H-3	20,000 ^a				
Mn-54	1,000		30,000		
Fe-59	400		10,000		
Co-58	1,000		30,000		
Co-60	300		10,000		
Zn-65	300		20,000		
Zr-95	400				
Nb-95	700				
I-131	2 ^b	900		3	100
Cs-134	30	10,000	1,000	60	1,000
Cs-137	50	20,000	2,000	70	2,000
Ba-140	200			300	
La-140	100			400	
^a This is the 40 CFR 141 value for drinking water samples. If no drinking water pathway exists, a value of 30,000 may be used. ^b If no drinking water pathway exists, a value of 20 pCi/l may be used.					

In accordance with ODCM 4.1.1.2.1, deviations from the required sampling schedule were permitted, if samples were unobtainable due to hazardous conditions, unavailability, inclement weather, equipment malfunction or other just reasons. Deviations from conducting the REMP sampling (as described in Table 2-1) are summarized in Table 3-3 along with their causes and resolution.



Table 3-3. Anomalies and Deviations from Radiological Environmental Monitoring Program

Collection Period	Affected Samples	Anomaly (A)* or Deviation (D)**	Cause	Resolution
02/15/21-02/21/22	Grass plot 106	No sample collected	Sample station did not have grass available due to weather conditions.	Annual ryegrass had been planted.
05/10/21-05/17/21	Station 112	Partial sample collected.	Station lost power during sample period. 55 hours of sample was collected.	GPC contacted to restore power. Line was tested, break was located, and service returned.
05/31/21-06/07/21	Station 112	Partial sample collected.	Station lost power during sample period. 108 hours of sample was collected.	GPC contacted to restore power. Line was tested, break was located, and service returned.
07/06/21-07/12/21	Station 103	Partial sample collected.	Station collected 86 hours of sample before power was lost.	Altamaha EMC contacted to restore power. Switch/disconnect was closed and power restored.
11/22/21-11/29/22	Grass Plot 106	No sample collected	Sample station did not have grass available due to weather conditions.	Annual ryegrass had been planted.
<p>* An anomaly is considered a non-standard sample that still meets sampling criteria outlined in SNC and Georgia Power Lab procedures. ** A deviation is a sample result that is not recorded due to not meeting scheduling and/or procedural requirements as outlined by SNC and Georgia Power Labs</p>				



3.1 Airborne Particulates

As specified in Table 2-1, airborne particulate filters and charcoal canisters were collected weekly at four indicator stations (Stations 103, 107, 112 and 116) which encircle the plant at the site periphery and at two control stations (Station 304 and 309) which is approximately 10 miles from the main stack. At each sampling location containing a filter and cartridge series, air was continuously drawn through a glass fiber filter to retain airborne particulate and an activated charcoal canister was placed in series with the particulate filter in order to adsorb radioiodine.

3.1.1 Gross Beta

As provided in Table 3-1, the 2021 annual average weekly gross beta activity was 22.1 fCi/m³ for the indicator stations. It was 0.5 fCi/m³ greater than the control station average of 21.6 fCi/m³ for the year. The difference was less than the calculated MDD of 1.00 fCi/m³, so the difference was not statistically discernable.


Average Air Gross Beta historical data (Table 3-4) is graphed to show trends associated with a prevalent exposure pathway (Figure 3-1). In general, there was close agreement between the results for the indicator, control and community stations. This close agreement supports the position that the plant was not contributing significantly to the gross beta concentrations in air.



Table 3-4. Average Weekly Gross Beta Air Concentration

Period	Indicator (fCi/m3)	Control (fCi/m3)	Period	Indicator (fCi/m3)	Control (fCi/m3)
Pre-op	140	140	1998	20.0	20.5
1974	87	90	1999	21.3	21.3
1975	85	90	2000	23.6	23.9
1976	135	139	2001	21.5	21.0
1977	239	247	2002	19.3	19.2
1978	130	137	2003	18.8	18.2
1979	38	39	2004	21.4	21.3
1980	49	48	2005	19.7	19.4
1981	191	203	2006	24.9	24.7
1982	33	34	2007	24.4	24.3
1983	31	30	2008	21.8	22.5
1984	26	28	2009	21.2	21.4
1985	22	21	2010	23.1	24.0
1986	36	38	2011	23.5	25.1
1987	23	22	2012	23.7	22.7
1988	22.6	21.7	2013	21.3	20.3
1989	18.4	17.8	2014	22.0	22.3
1990	19.3	18.7	2015	19.1	19.6
1991	18.1	18	2016	21.4	21.6
1992	18.5	18.4	2017	19.7	19.9
1993	20.4	20.7	2018	20.8	21.2
1994	19.5	19.7	2019	22.1	21.3
1995	21.7	21.7	2020	21.1	20.7
1996	21.3	21.4	2021	22.1	21.6
1997	20.3	20.7			

Figure 3-1. Average Weekly Gross Beta Air Concentration

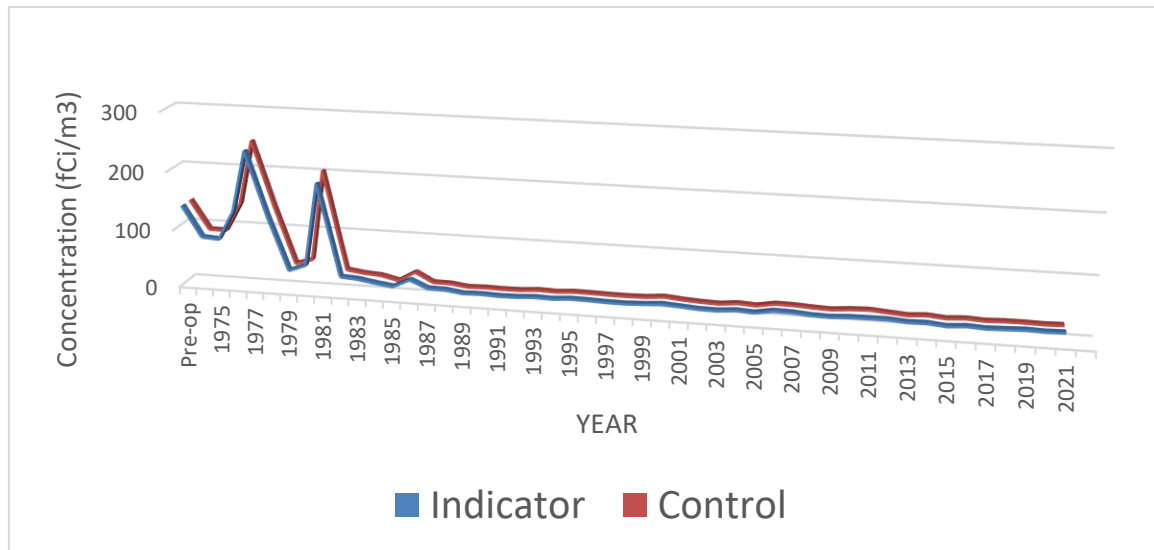

3.1.2 Gamma Particulates

During 2021, no man-made radionuclides were detected from the gamma isotopic analysis of the quarterly composites of the air particulate filter.

Airborne Radioiodine - I-131 was not detected in the air cartridges at either the indicator or control stations in 2021. Historically, gamma isotopes have been detected as a result of offsite events. On only one occasion since 1986, has a man-made radionuclide been detected in a quarterly composite. A small amount of Cs-137 (1.7 fCi/m³) was identified in the first quarter of 1991 at Station 304. The MDC and RL for Cs-137 in air are 60 and 20,000 fCi/m³, respectively.

3.2 Direct Radiation

In 2021, direct (external) radiation was measured with Optically Stimulated Luminescent dosimeters (OSLD) by placing two OSLD badges at each station. The gamma dose at each station was reported as the average reading of the two badges. The badges were analyzed on a quarterly basis. An inspection was performed near mid-quarter for offsite badges to ensure that the badges were on-station and to replace any missing or damaged badges.

Two direct radiation stations were established in each of the 16 compass sectors, to form two concentric rings. The inner ring (Stations 101 through 116) was located near the plant perimeter as shown in Map A-1 in Appendix A and the outer ring (Stations 201 through 216) was located at distances of four to five miles from the plant as shown in Map A-2 in Appendix A. The stations in the East sector were a few additional miles away with regards to the other stations in their respective rings due to large swamps making normal access extremely difficult. The 16 stations forming the inner ring were designated as the indicator stations. The two-ring configuration of stations was established in accordance with NRC Branch Technical Position "An Acceptable Radiological Environmental Monitoring Program", Revision 1, November 1979. The three control stations (Nos. 304, 309 and 416) were located at distances greater than 10 miles from the plant as shown in Map A-2. The mean and range values presented in the "Other" column in Table 3-1 includes the outer ring stations (stations 201 through 216) as well as stations 064 and 301, which monitor special interest areas. Station 064 was located at the onsite roadside park, while Station 301 was located near the Toombs Central School. Station 210, in the outer ring, was located near the Altamaha School (the only other nearby school).

As provided in Table 3-1, the 2021 average quarterly exposure at the indicator stations (inner ring) was 12.3 mR with a range of 8.8 to 22.3 mR. The indicator station average was 0.7 mR greater than the control station average (11.6 mR with a range of 9.7 to 14.3 mR). The difference was less than the calculated MDD of 0.74 mR, so the difference was not statistically discernible.

The quarterly exposures acquired at the community/other (outer ring) stations during 2021 ranged from 8.8 to 19.3 mR with an average of 12.2 mR which was greater than the control station average by 0.6 mR. The difference was less than the calculated MDD of 0.63 mR, so the



difference was not statistically discernible. Average Direct Radiation historical data (Table 3-5) is graphed to show trends associated with a prevalent exposure pathway (Figure 3-2). The decrease between 1991 and 1992 values was attributed to a change in Thermoluminescent Dosimeters (TLDs) from Teledyne to Panasonic. It should be noted however that the differences between indicator and control and outer ring values did not change. The increase shown in 2010 reflected issues with the aging Panasonic TLD reader. The close agreement between the station groups has supported the position that the plant was not contributing significantly to direct radiation in the environment.

Figure 3-3 below provides a more detailed view of the 2021 values. The values for the special interest areas detailed below, indicate that Plant Hatch did not significantly contribute to direct radiation at those areas.

Table 3-5. Average Quarterly Exposure from Direct Radiation (Historical)

Period	Indicator (mR)	Control (mR)	Outer Ring (mR)		Period	Indicator (mR)	Control (mR)	Outer Ring (mR)
Pre-op	22.3	23.0	NA		1998	12.1	12.3	12.3
1974	23.2	25.6	NA		1999	12.8	13.2	13.0
1975	10.0	10.5	NA		2000	13.6	13.3	13.3
1976	8.18	6.90	NA		2001	12.0	12.1	11.8
1977	7.31	6.52	NA		2002	11.7	11.7	11.5
1978	6.67	6.01	NA		2003	11.4	11.4	11.4
1979	5.16	6.77	NA		2004	12.2	12.4	12.2
1980	4.44	5.04	4.42		2005	12.1	12.5	12.0
1981	5.90	5.70	5.70		2006	12.4	11.9	11.8
1982	12.3	12.0	11.3		2007	12.8	12.5	12.6
1983	11.4	11.3	10.6		2008	13.0	12.3	12.4
1984	13.3	12.9	11.9		2009	12.4	12.2	12.2
1985	14.7	14.7	13.7		2010	15.8	15.6	16.0
1986	15.0	14.0	14.5		2011	19.7	19.1	19.2
1987	14.9	14.6	15.3		2012	14.4	13.6	14.1
1988	15.0	14.7	15.2		2013	12.7	10.2	12.4
1989	16.4	18.0	16.5		2014	12.0	11.7	11.8
1990	14.9	13.9	14.7		2015	12.1	11.7	12.1
1991	15.1	13.7	15.6		2016	12.1	11.0	11.3
1992	11.9	10.9	12.3		2017	12.5	11.5	12.1
1993	11.6	10.7	11.5		2018	11.4	11.3	11.1
1994	11.0	10.7	11.2		2019	11.4	11.5	11.1
1995	11.5	10.8	11.3		2020	12.7	12.6	12.5
1996	11.6	11.3	11.6		2021	12.3	11.6	12.2
1997	12.3	11.8	12.3					



Figure 3-2. Average Quarterly Exposure from Direct Radiation


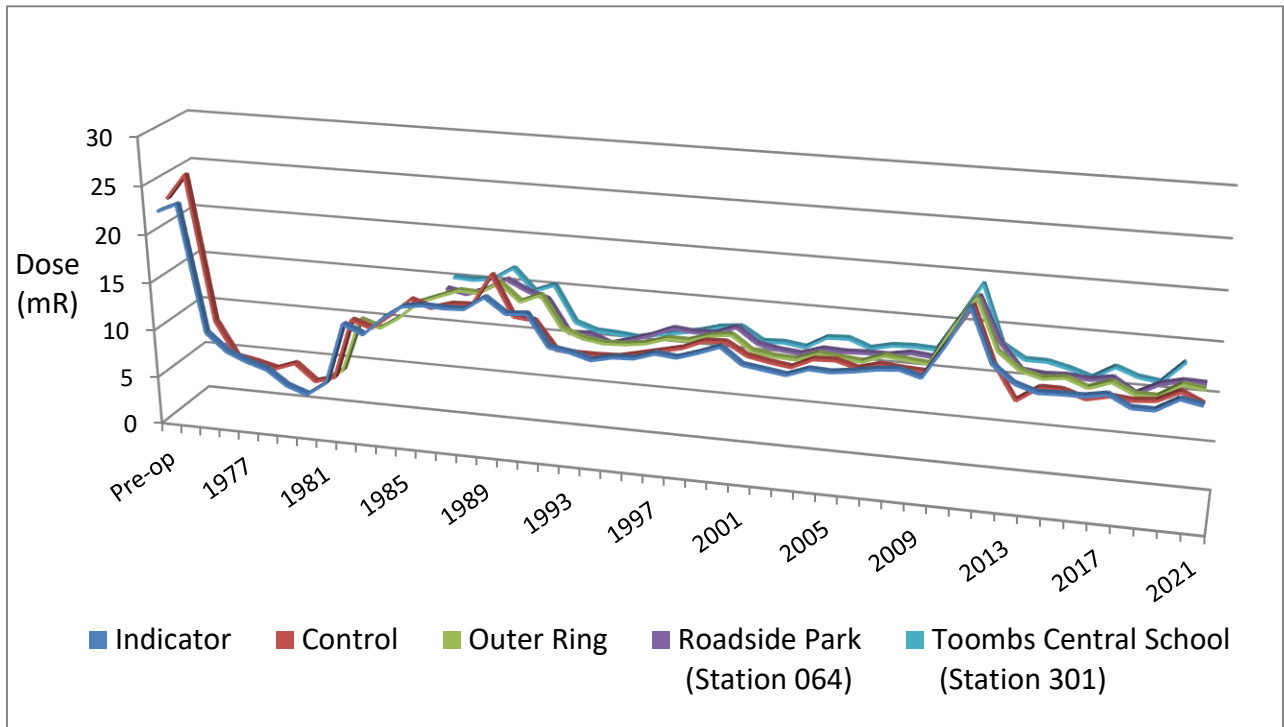


Figure 3-3. 2021 Average Exposure from Direct Radiation

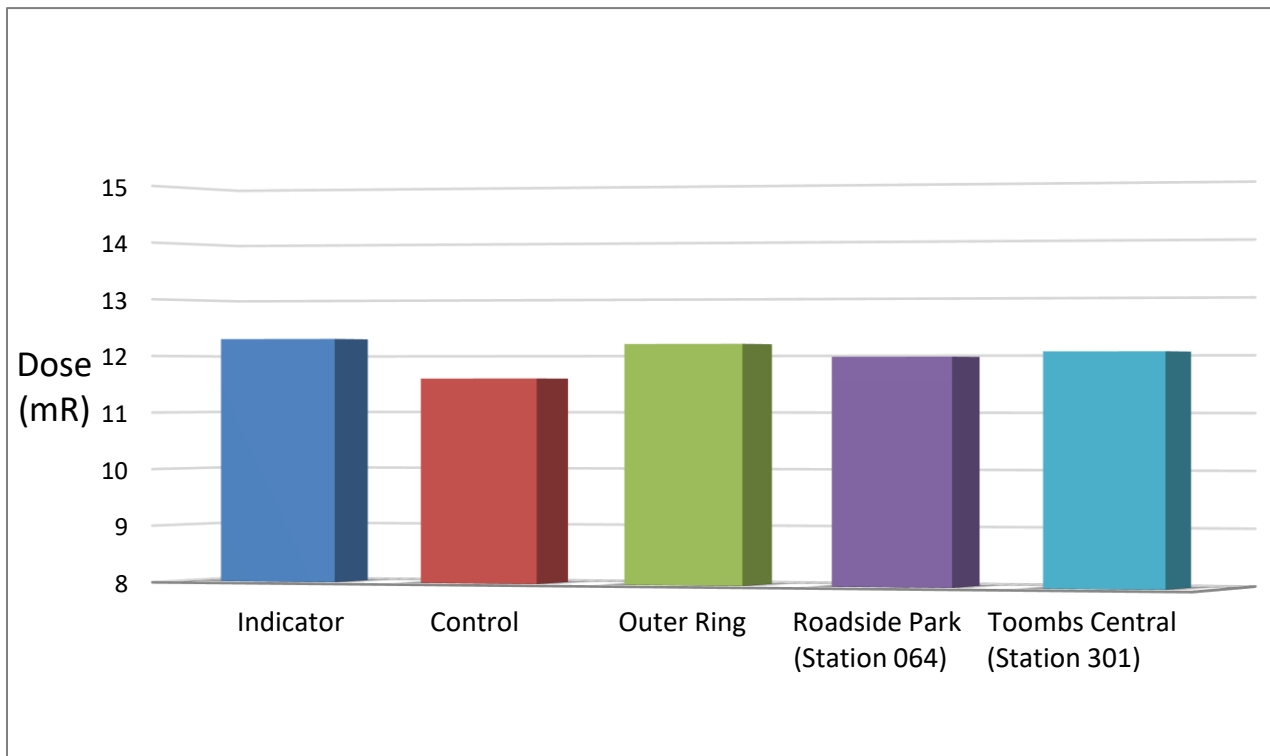

3.3 Biological Media

Cs-137 was the only radionuclide analyzed across all three biological mediums. As indicated in Figure 3-4, the Cs-137 activity levels were below the respective MDCs and well below that of the respective RLs for each sample media for both the indicator and control stations.

3.3.1 Milk

In accordance with Tables 2-1 and 2-2, milk samples were collected semi-monthly from Station 304 (the state prison dairy) which was a control station located more than 10 miles from the plant. Since 1989, efforts to locate a reliable milk sample source within five miles of the plant have been unsuccessful and the 2021 land census did not identify a milk animal within five miles of the plant.

Gamma isotopic (including I-131 and Cs-137) analyses were performed on each collected milk sample and there were no detectable results for gamma isotopes.

3.3.2 Vegetation

In accordance with Tables 2-1 and 2-2, vegetation (forage) samples were collected monthly for gamma isotopic analyses at two indicator locations near the site boundary (Stations 106 and 112) and at one control station located about 21 miles from the plant (Station 416). Cs-137 was detected in both the indicator (average of 12.9 pCi/kg-wet) and control station samples (average of 52.8 pCi/kg-wet). The MDD does not apply since the indicator average is less than that of the control average. The values are well below the MDC and RL for Cs-137 and are therefore not considered as an impact to the environment. Historically, the man-made radionuclide Cs-137 is periodically identified in vegetation samples and is generally attributed to offsite sources (such as weapons testing, Chernobyl, and Fukushima).

While Cs-137 and I-131 were periodically found in vegetation samples during pre-operation, the historical trends and the relationship between the indicator and control stations demonstrate that plant operations were having no adverse impact to the environment. The sample results have consistently been below the MDC and the RL for Cs-137 (80 and 2000 pCi/kg-wet, respectively).

During 2021, outside of Cs-137, no man-made gamma isotopes were detected in any Hatch REMP vegetation samples.

3.3.3 Fish

Fish samples were collected in accordance with the ODCM (as indicated in Table 2-1). For the semi-annual collections, the control location (Station 170) was located upriver of the plant intake




structure, and the indicator location (Station 172) was located downriver of the plant discharge structure.

Cs-137 was detected in one sample at the indicator location. The indicator sample value was 14.4 pCi/kg. Cs-137 is not typically detected in fish samples at Plant Hatch; however due to the aforementioned atmospheric persistence of Cs-137, this result is not likely related to plant operations. This result is also well below the MDC of 150 pCi/kg.

3.3.4 Biological Media Summary

There were no statistical differences, trends, or anomalies associated with the 2021 biological media samples when compared to historical data. Figure 3-4 below, details the 2021 Cs-137 concentration compared to the MDC.

Figure 3-4. 2021 Biological Media Average Cs-137 Concentrations

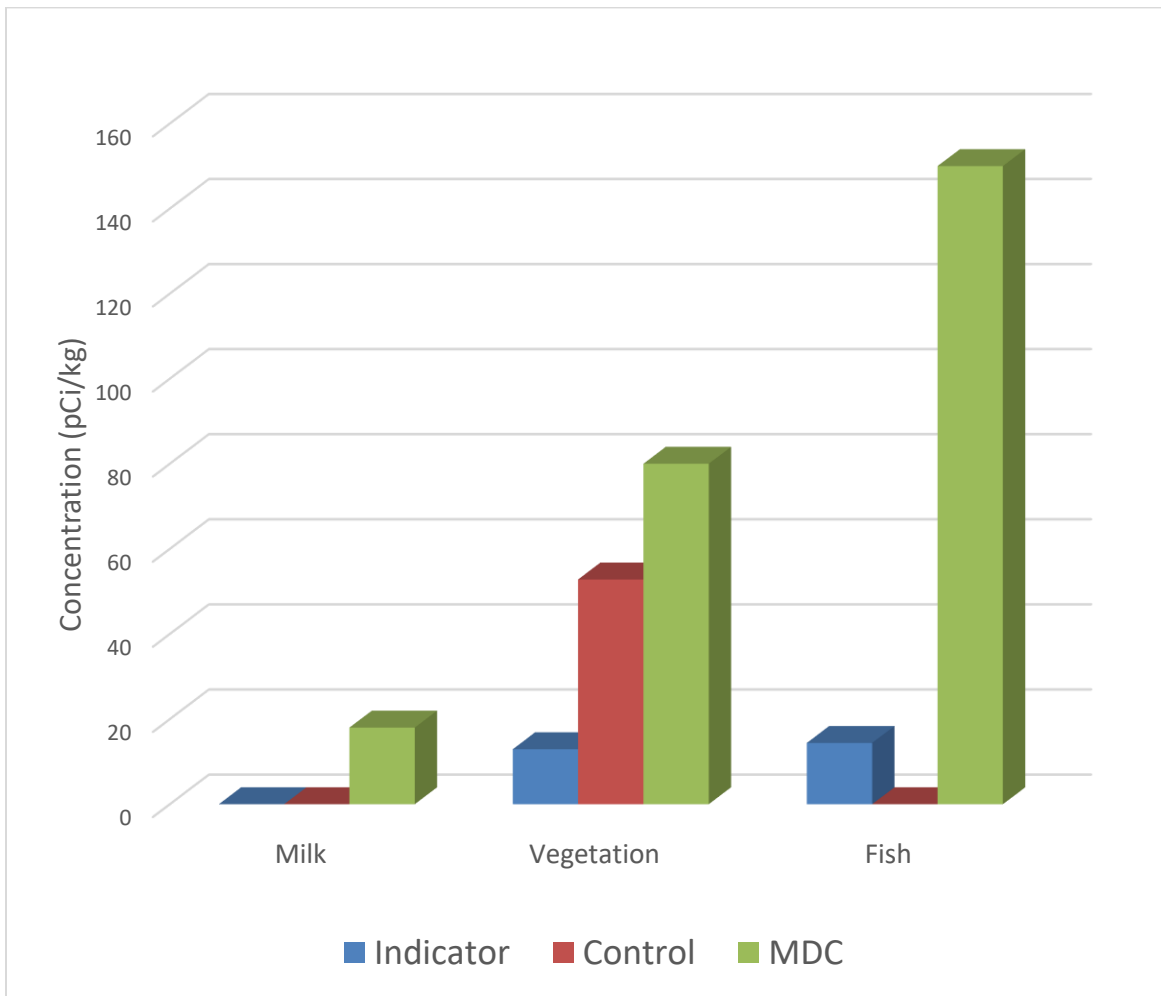


3.4 Surface Water

Composite river water samples were collected monthly at one upstream control location and at one downstream indicator location (shown on Map A-3 in Appendix A). The details of the sampling protocols are outlined in Tables 2-1 and Table 2-2. A gamma isotopic analysis was conducted on each monthly sample. The monthly aliquots were combined to form quarterly composite samples in order to be analyzed for tritium.

As provided in Table 3-1, there were no positive results during 2021 from the gamma isotopic analysis of the river water samples. Also indicated in Table 3-1, the average tritium concentration found at the indicator station was 151.4 pCi/l which was 113.1 pCi/l more than the average at the control station (38.3 pCi/l). The difference was less than the calculated MDD of 227.5 pCi/l, so the difference was not statistically discernible. Figure 3-5 below details the 2021 historical average tritium concentrations in river water.

Figure 3-5. Average Annual Tritium Concentrations in River Water

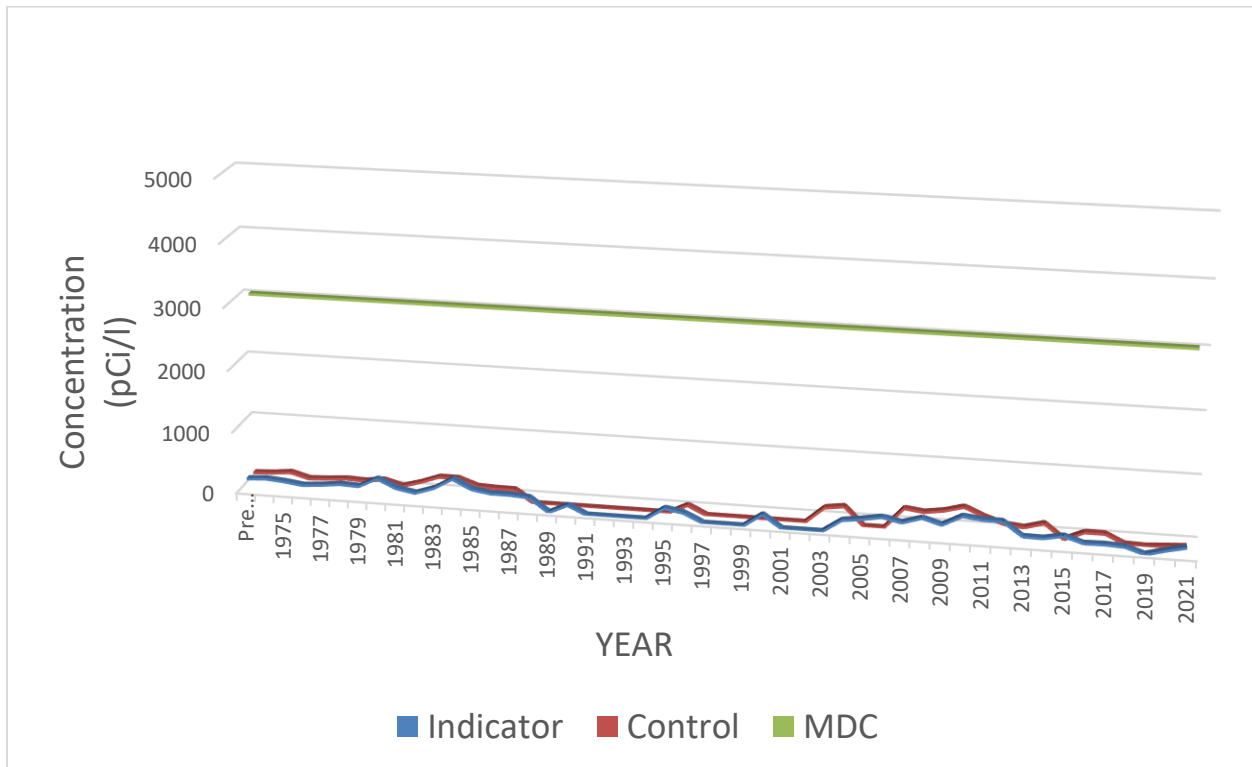

3.5 Sediment

Sediment was collected along the shoreline of the Altamaha River in the spring and fall at the upstream control station (No. 170) and the downstream indicator station (No. 172). A gamma isotopic analysis was performed on each sample. There were no man-made radionuclides detected in sediment samples.



3.6 Interlaboratory Comparison Program

In accordance with ODCM 4.1.3, GPCEL participated in an Interlaboratory Comparison Program (ICP) which satisfied the requirements of Regulatory Guide 4.15, Revision 1, "Quality Assurance for Radiological Monitoring Programs (Normal Operations) - Effluent Streams and the Environment", February 1979. The ICP included the required determinations (sample medium/radionuclide combinations) included in the REMP.

The ICP was conducted by Eckert & Ziegler Analytics, Inc. (EZA) of Atlanta, Georgia. EZA has a documented Quality Assurance (QA) program and the capability to prepare Quality Control (QC) materials traceable to the National Institute of Standards and Technology. The ICP is a third-party blind testing program which provided a means to ensure independent checks were performed on the accuracy and precision of the measurements of radioactive materials in environmental sample matrices. EZA supplied the crosscheck samples to GPCEL which performed routine laboratory analyses. Each of the specified analyses was performed three times.

The accuracy of each result was measured by the normalized deviation, which is the ratio of the reported average less the known value to the total error. An investigation is undertaken whenever the absolute value of the normalized deviation is greater than three or whenever the coefficient of variation was greater than 15% for all radionuclides other than Fe-59. For Fe-59, an investigation is undertaken when the coefficient of variation exceeds the values shown on Table 3-6 below:

Table 3-6. Interlaboratory Comparison Limits

Nuclide	Concentration *	Percent Coefficient of Variation
Fe-59	<80	25
	>80	15
* For air filters, concentration units are pCi/filter. For all other media, concentration units are pCi/liter (pCi/l).		

As required by ODCM 4.1.3.3 and 7.1.2.3, a summary of the results of the GPCEL's participation in the ICP is provided in Table 3-7 for:

- gross beta and gamma isotopic analyses of an air filter
- gamma isotopic analyses of milk samples
- gross beta, tritium and gamma isotopic analyses of water samples

The 2021 analyses included tritium, gross beta and gamma emitting radionuclides in different matrices. The results for all analyses were within acceptable limits for accuracy.



Table 3-7. Interlaboratory Comparison Summary

Analysis or Radionuclide	Date Prepared	Reported Average	Known Value	Standard Deviation EL	Uncertainty Analytics (1S)	Percent Coefficient of Variation	Normalized Deviation
I-131 ANALYSIS OF AN AIR CARTRIDGE (pCi/cartridge)							
I-131	3/11/2021	89.7	88.1	2.51	1.47	5.60	0.31
GAMMA ISOTOPIC ANALYSIS OF AN AIR FILTER (pCi/filter)							
Ce-141	9/9/2021	123	116	6.27	1.94	7.25	0.82
Co-58		127	119	4.52	1.99	5.65	1.15
Co-60		151	147	1.76	2.45	4.05	0.66
Cs-134		98.6	94.3	3.56	1.58	5.20	0.83
Cs-137		121	113	4.02	1.89	5.44	1.23
Fe-59		107	103	4.72	1.72	6.82	0.52
Mn-54		144	130	2.83	2.17	4.67	2.12
Zn-65		176	155	7.60	2.59	6.48	1.85
GROSS BETA ANALYSIS OF AN AIR FILTER (PCI/FILTER)							
Gross Beta	6/3/2021	123	130	3.91	2.17	4.22	1.35
GAMMA ISOTOPIC ANALYSIS OF A MILK SAMPLE (PCI/LITER)							
Ce-141	9/9/2021	123	114	3.91	1.91	7.3	0.96
Co-58		125	118	5.49	1.97	7.33	0.79
Co-60		155	145	6.18	2.42	6.19	1.05
Cs-134		95.3	93.1	4.43	1.56	6.96	0.33
Cs-137		121	112	5.89	1.87	7.61	0.94
Fe-59		107	102	3.32	1.70	8.17	0.55
I-131		89.5	85.6	9.22	1.43	13.01	0.33
Mn-54		140	128	4.27	2.14	6.40	1.32
Zn-65		170	153	11.54	2.56	9.70	1.01
GROSS BETA ANALYSIS OF WATER SAMPLE (PCI/LITER)							
Gross Beta	6/3/2021	214	258	27.58	4.31	13.79	1.51
	12/2/2021	304	281	6.10	4.69	4.06	-1.87



Table 3-7. Interlaboratory Comparison Summary

Analysis or Radionuclide	Date Prepared	Reported Average	Known Value	Standard Deviation EL	Uncertainty Analytics (1S)	Percent Coefficient of Variation	Normalized Deviation
GAMMA ISOTOPIC ANALYSIS OF WATER SAMPLES (PCI/LITER)							
Ce-141	6/3/2021	187	180	8.62	3.00	7.38	-0.51
Co-58		187	179	9.64	2.98	7.36	-0.56
Co-60		225	215	4.96	3.59	4.95	-0.89
Cs-134		212	213	4.69	3.56	4.86	0.14
Cs-137		192	188	4.00	3.13	5.59	-0.41
Fe-59		178	183	7.52	3.06	7.55	0.36
I-131		95.7	92.0	5.79	1.54	10.44	-0.37
Mn-54		264	249	12.79	4.16	6.82	-0.84
Zn-65		319	300	17.65	5.01	7.77	-0.78
TRITIUM ANALYSIS OF WATER SAMPLES (PCI/LITER)							
H-3	9/9/2021	10800	11700	428.02	195	4.75	-1.66
GAMMA ISOTOPIC ANALYSIS OF VEGETATION SAMPLES (PCI/KG)							
Ce-141	6/3/2021	162	148	9.93	2.48	10.42	0.85
Co-58		164	147	13.6	2.46	11.45	-0.92
Co-60		179	177	8.64	2.96	7.81	-0.16
Cs-134		180	176	11.0	2.93	8.19	-0.28
Cs-137		170	155	7.90	2.58	8.71	-0.98
Fe-59		152	151	12.7	2.52	13.65	-0.07
Mn-54		230	205	13.4	3.43	8.65	-1.27
Zn-65		275	247	28.7	4.13	13.73	-0.73



4 SURVEY SUMMARIES

4.1 Land Use Census

In accordance with ODCM 4.1.2, a land use census was conducted in December 2021 that circumscribed each of the 16 compass sectors within a five-mile radius in order to verify the locations of the nearest radiological receptor. The land use census results are tabulated in Table 4-1. The 2021 land uses census results, shown in Table 4-1, indicated that a revision to the ODCM will not be required.

Table 4-1. Land Use Census Results

Sector	Residence	Milk Animal*	Beef Cattle	Garden**
Distance in Miles to the Nearest Location in Each Sector				
N	2.0	None	None	3.8
NNE	2.9	None	None	None
NE	3.3	None	4.7	3.1
ENE	4.2	None	4.1	None
E	3.0	None	None	None
ESE	3.8	None	None	None
SE	1.8	None	2.4	None
SSE	2.0	None	3.6	2.2
S	1.0	None	2.5	1.0
SSW	1.3	None	2.1	2.5
SW	1.1	None	2.6	1.6
WSW	1.0	None	3.6	2.0
W	1.1	None	2.7	1.1
WNW	1.1	None	None	None
NW	3.6	None	4.5	None
NNW	1.8	None	2.8	2.9
*A milk animal is a cow or goat producing milk for human consumption.				
**A garden of greater than 500 square feet producing broad leaf vegetation.				

4.2 Altamaha River Survey

A survey of the Altamaha River downstream of the plant for approximately 50 miles (approximately river miles 66.5 to 117.0) was conducted in the summer of 2021 to identify any new withdrawal of water from the river for drinking, irrigation, or construction purposes.



Correspondence from the Georgia Environmental Protection Division (EPD) on December 8, 2021, indicated that no new agricultural or drinking water withdrawal permits had been issued at that time.

4.3 Meteorological Report Summary

A consultant analyzes the meteorological tower data collected throughout the year and compares it to previous results. In 2021, the meteorological tower results were comparable to previous years, precipitation amounts (72.75”) and wind direction (from south-southwest at 10m, from the northeast at 60m, from the south-southwest at the 100m, and southwest at the 45m on the backup tower) were also similar. Additionally, the meteorological data meets the quality requirements, therefore, no changes to REMP monitoring locations are warranted.



5 CONCLUSIONS

This report has confirmed SNCs conformance with the requirements of Chapter 4 of the ODCM and the objectives were to:

- 1) Determine the levels of radiation and the concentrations of radioactivity in the environs and;
- 2) Assess the radiological impact (if any) to the environment due to the operation of the HNP.

Based on the 2021 activities associated with the REMP, SNC offers the following conclusions:


- Samples were collected and there were no deviations or anomalies that negatively affected the quality of the REMP
- Land use census and river survey did not require any changes
- Analytical results were below reporting levels
- These values were consistent with historical results which indicate no adverse radiological environmental impacts associated with the operation of HNP



APPENDIX A

Maps



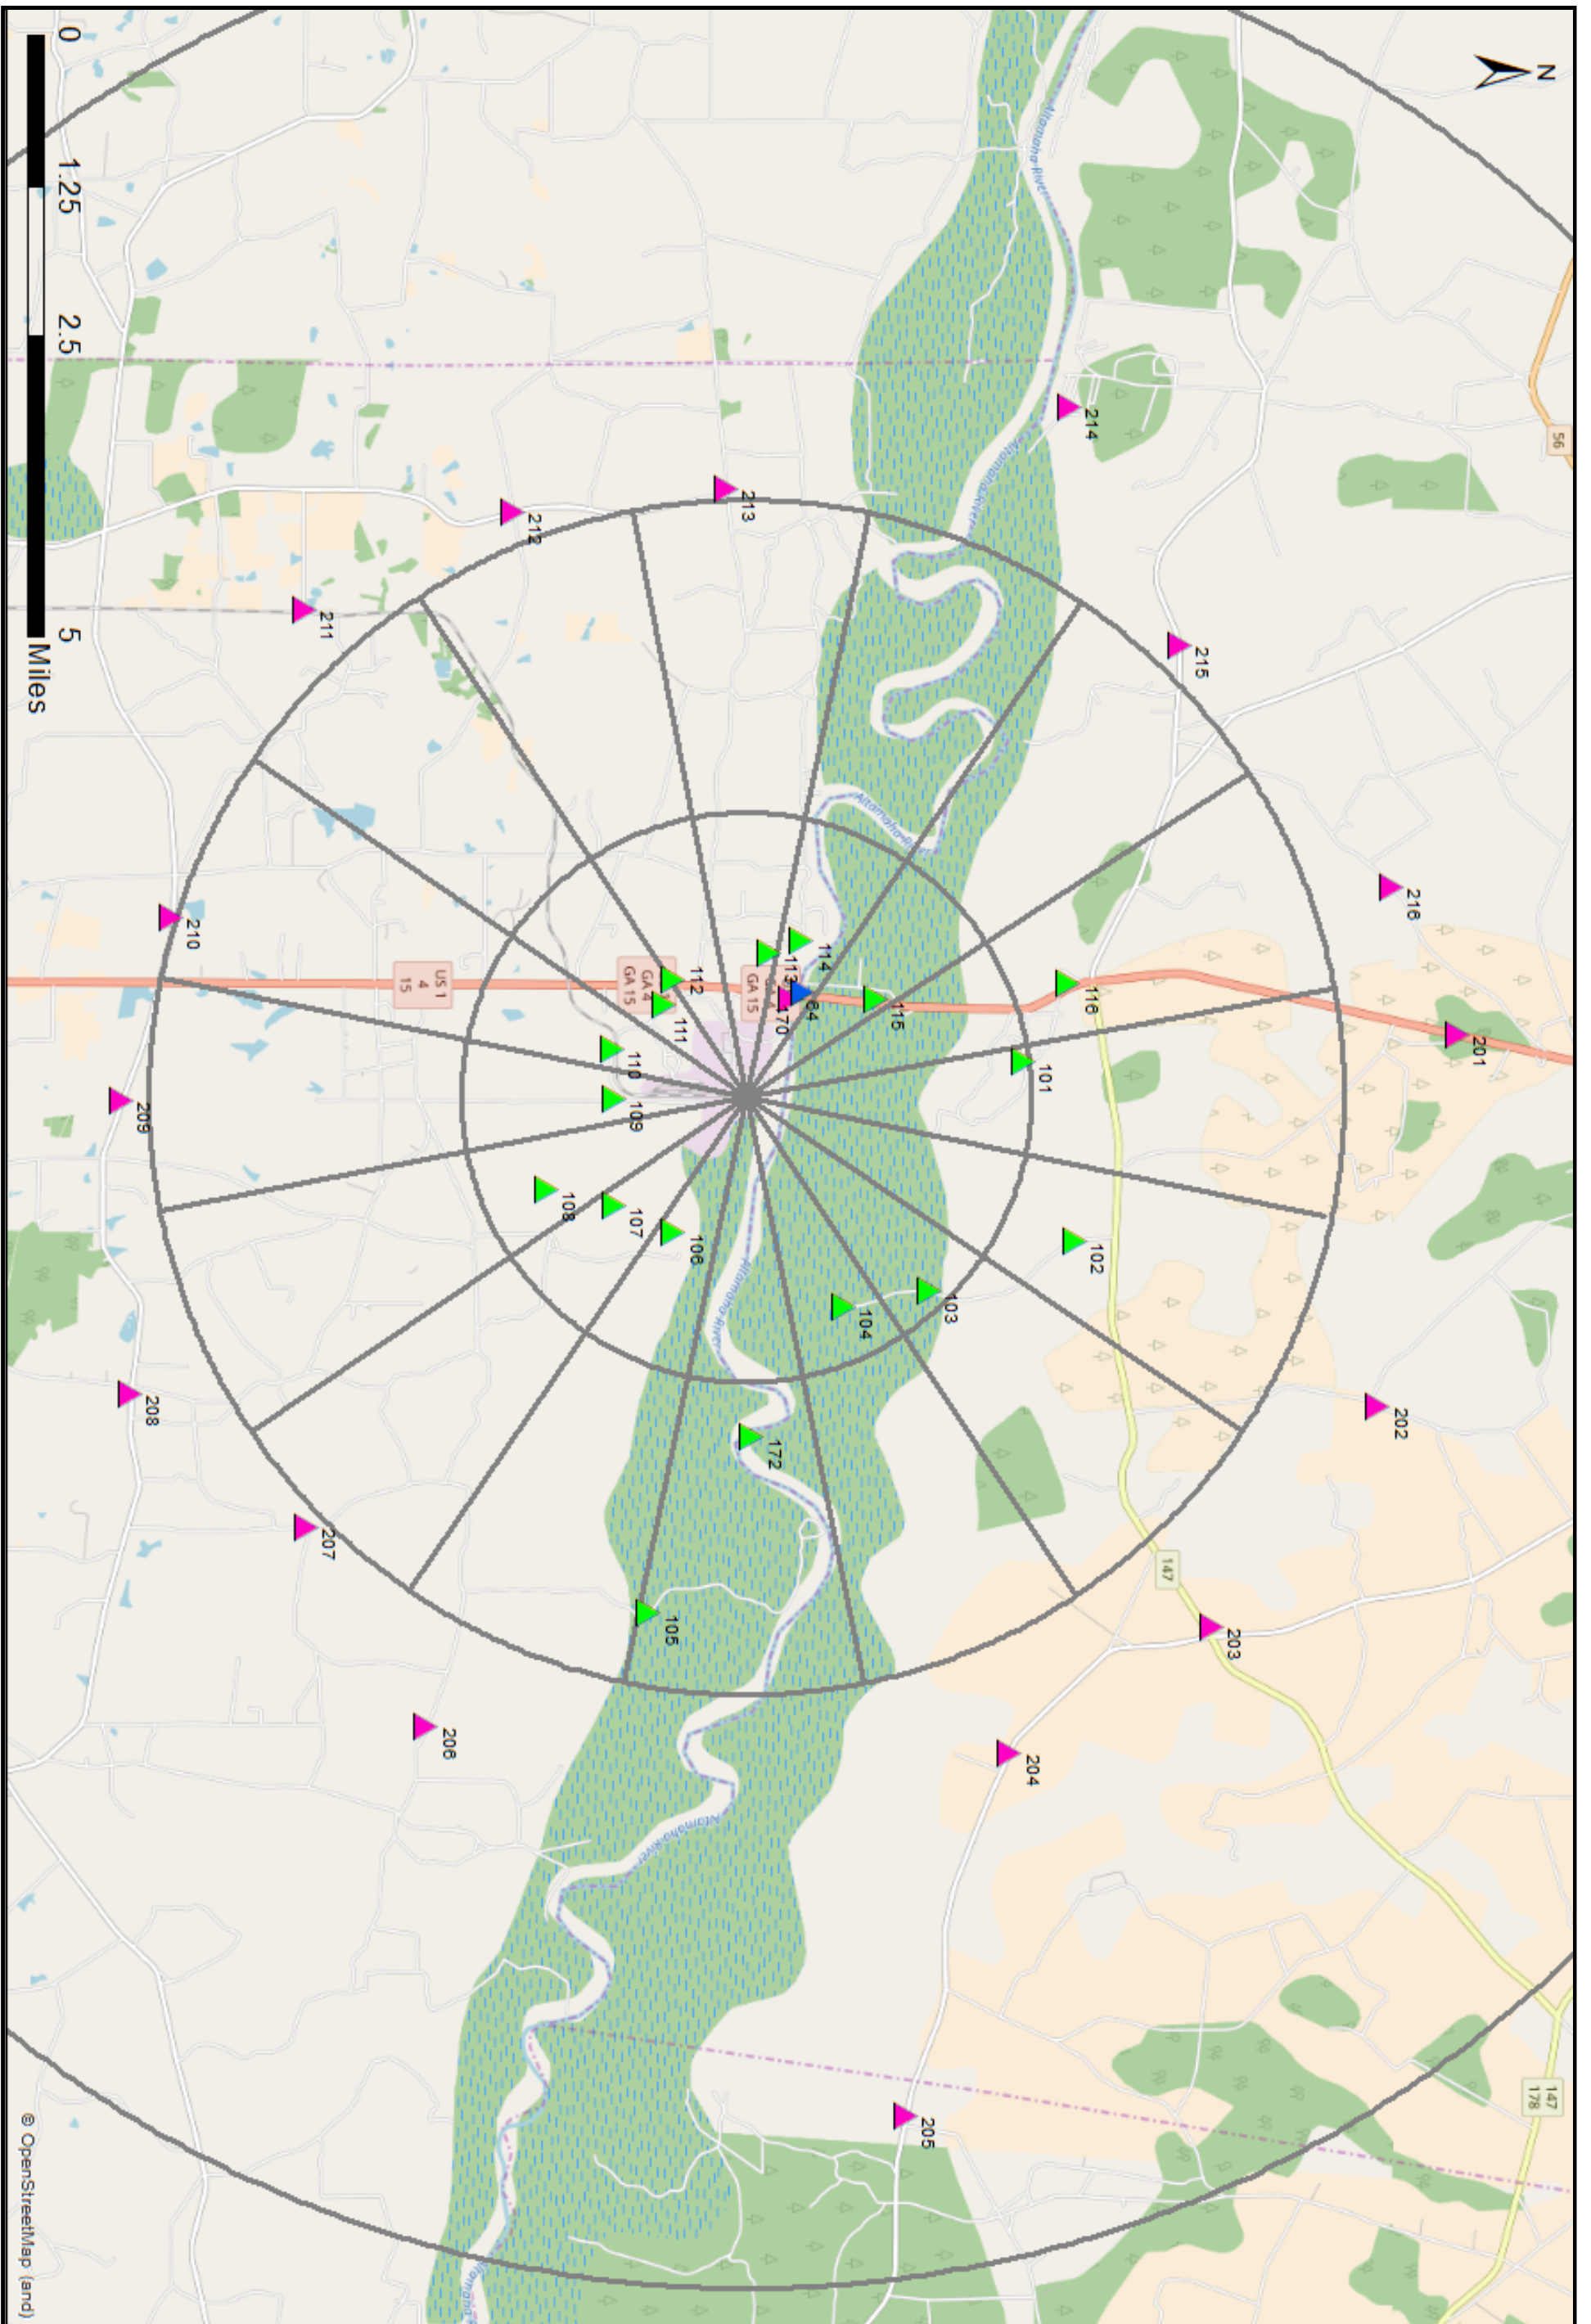

Legend:


Indicator Stations -	
Control Stations -	
Other Stations -	

Edwin I. Hatch Nuclear Plant
 2021 Annual Radiological Environmental Report
 REMP Stations in Plant Vicinity



Drawn by:	C. Groce
April 20, 2022	

Appendix A
 Map A-1

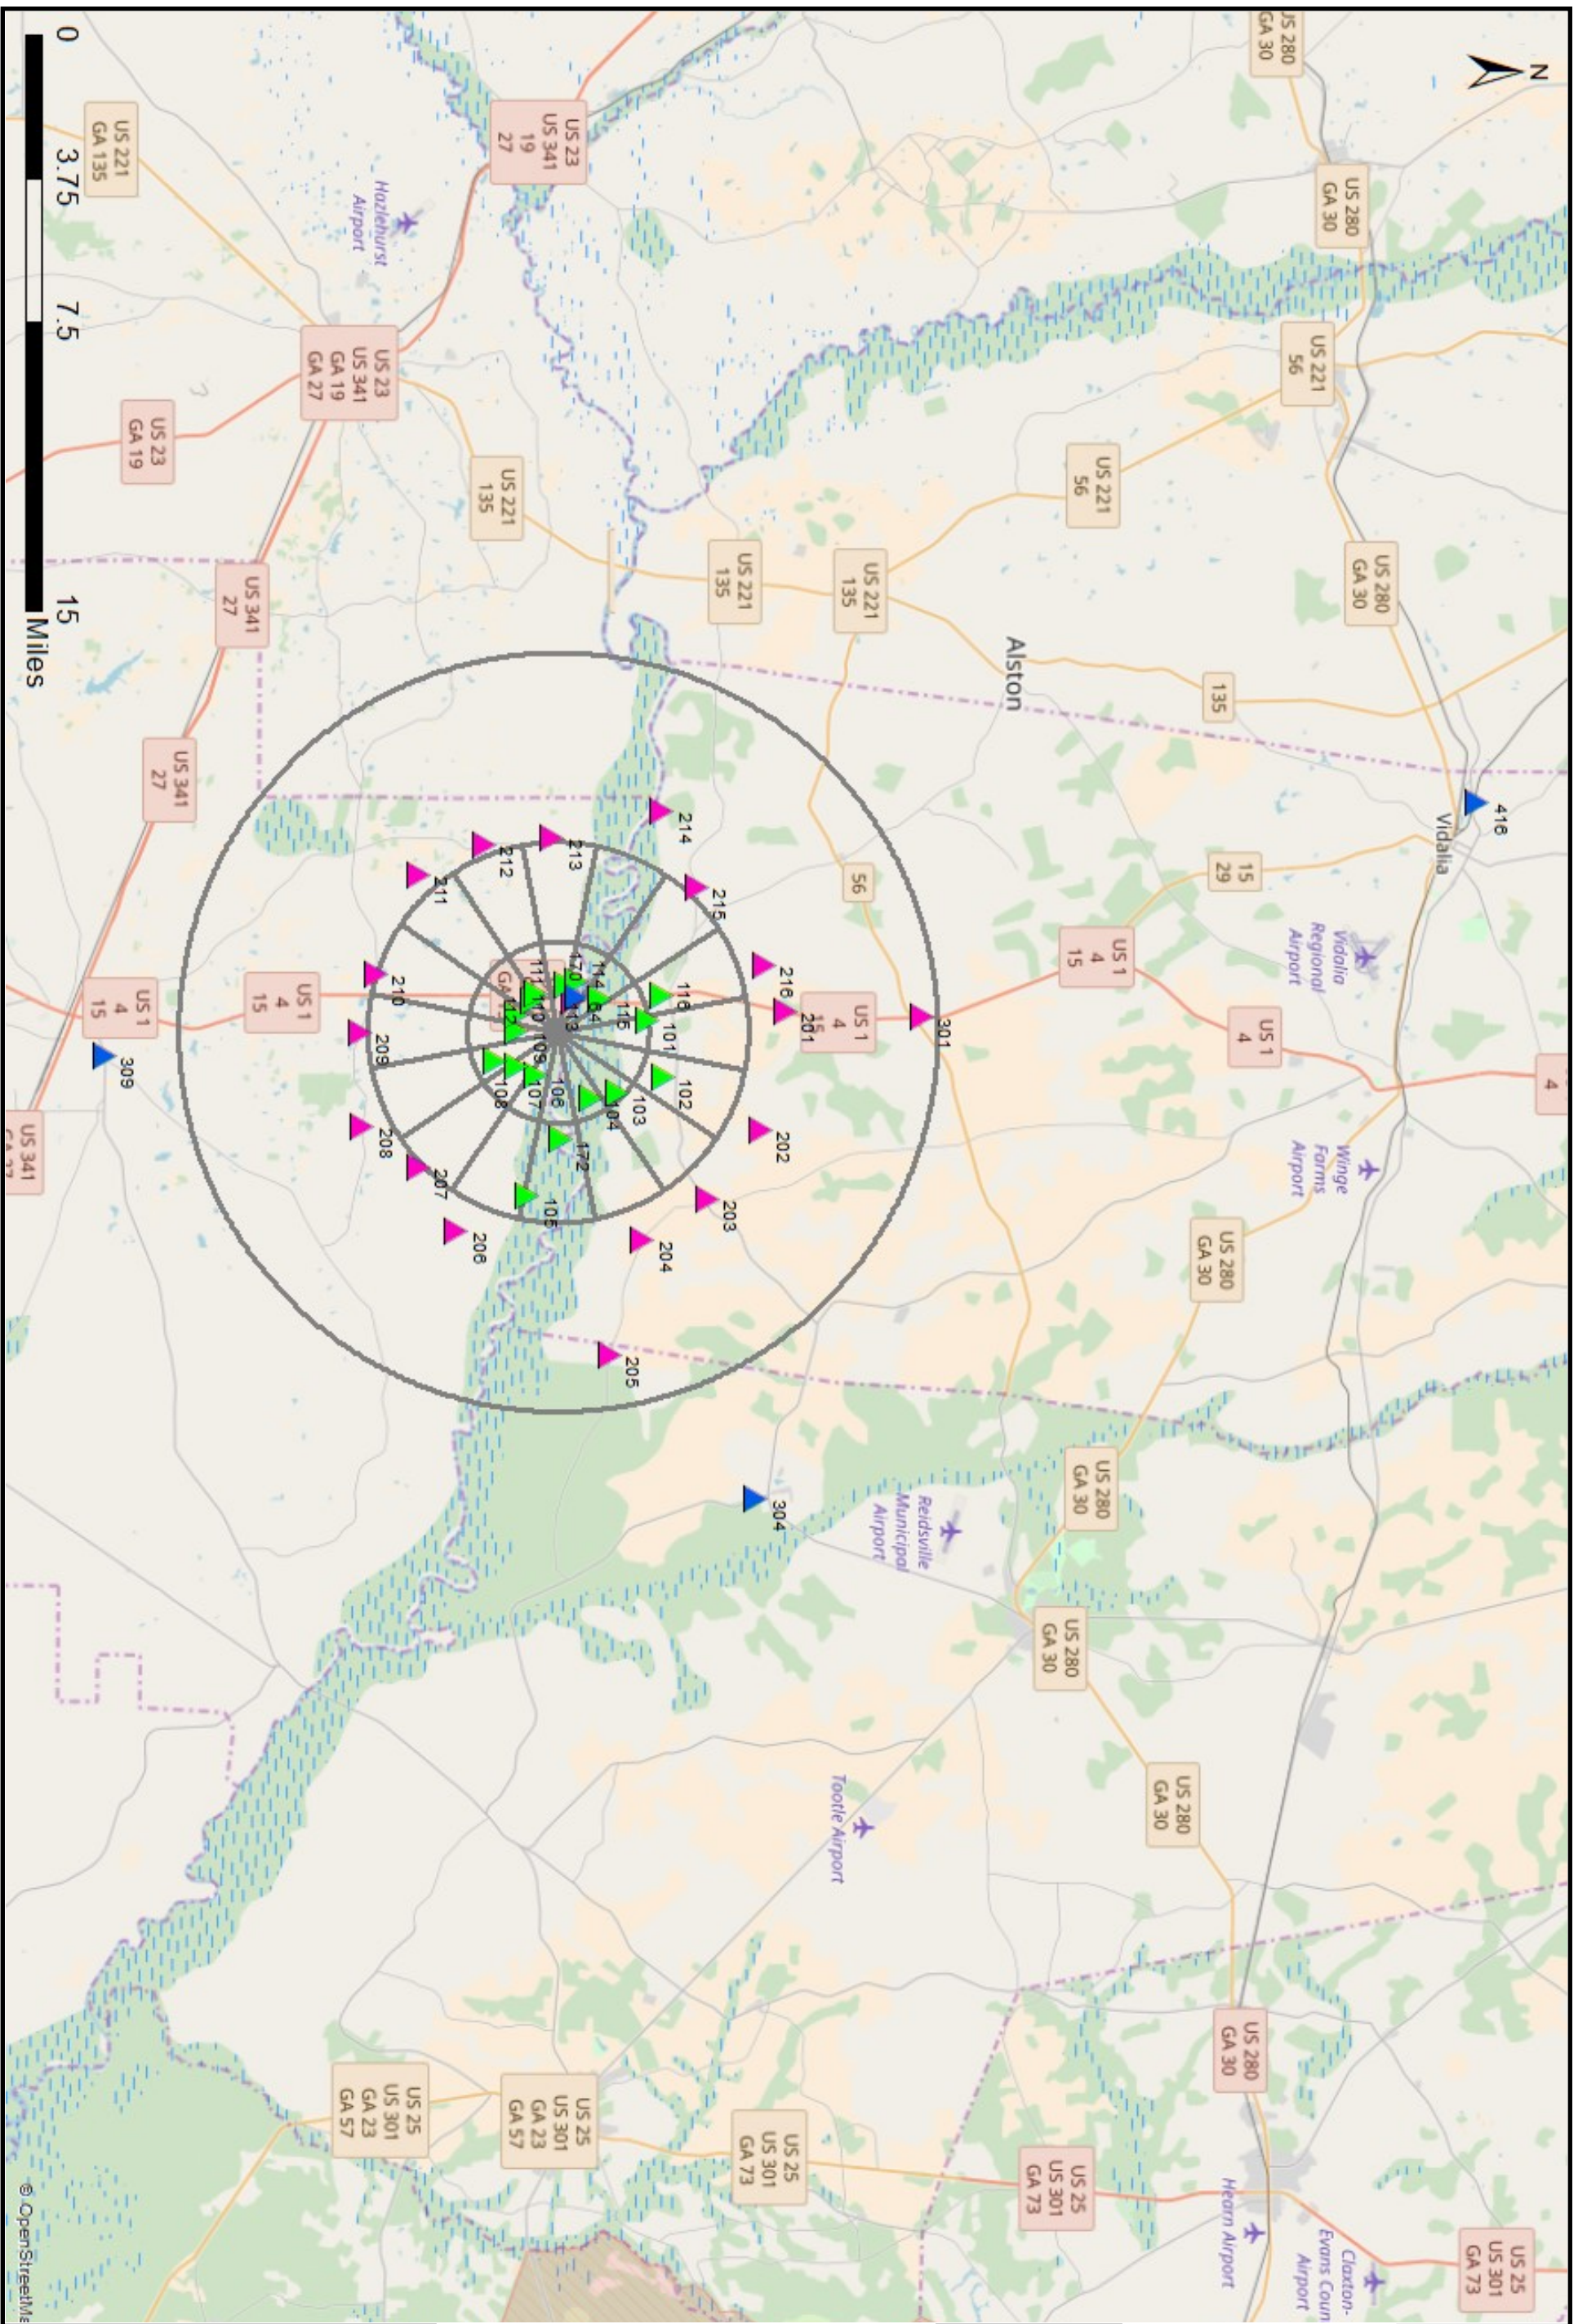

Legend:	
Indicator Stations -	
Control Stations -	
Other Stations -	

Edwin I. Hatch Nuclear Plant
 2021 Annual Radiological Environmental Report
 REMP Stations within 10 miles



Drawn by:	C. Groce
April 20, 2022	

Appendix A
 Map A-2

This page intentionally left blank.

APPENDIX B

Errata



There were no errata for the 2021 report.



APPENDIX C

Data

The following pages contain the individual data points from the 2021 reporting year. The units for the data points varies by media, as follows:

- Airborne Radioiodine and Particulates/Water/Milk – picocuries/liter (pCi/l)
- Sediment/Vegetation/Fish – picocuries/kilogram (pCi/kg)
- Direct Radiation – millirem (mR)



cust_id	profile_name	analyte_name	cust_sample_id	collect_date	result	result_units	lab_sample_id
Hatch	Charcoal Ct	I-131	103	1/4/2021		0 pCi/m3	127932001
Hatch	Air Filters	Gross Beta	103	1/4/2021		0.01451 pCi/m3	127931001
Hatch	Air Filters	Gross Beta	103	1/11/2021		0.02702 pCi/m3	128029001
Hatch	Charcoal Ct	I-131	103	1/11/2021		0 pCi/m3	128030001
Hatch	Air Filters	Gross Beta	103	1/19/2021		0.02369 pCi/m3	128177001
Hatch	Charcoal Ct	I-131	103	1/19/2021		0 pCi/m3	128178001
Hatch	Charcoal Ct	I-131	103	1/25/2021		0 pCi/m3	128294001
Hatch	Air Filters	Gross Beta	103	1/25/2021		0.02274 pCi/m3	128293001
Hatch	Charcoal Ct	I-131	103	2/1/2021		0 pCi/m3	128354001
Hatch	Air Filters	Gross Beta	103	2/1/2021		0.02069 pCi/m3	128353001
Hatch	Air Filters	Gross Beta	103	2/8/2021		0.01922 pCi/m3	128429001
Hatch	Charcoal Ct	I-131	103	2/8/2021		0 pCi/m3	128430001
Hatch	Air Filters	Gross Beta	103	2/15/2021		0.009746 pCi/m3	128567001
Hatch	Charcoal Ct	I-131	103	2/15/2021		0 pCi/m3	128568001
Hatch	Charcoal Ct	I-131	103	2/22/2021		0 pCi/m3	128649001
Hatch	Air Filters	Gross Beta	103	2/22/2021		0.02438 pCi/m3	128648001
Hatch	Air Filters	Gross Beta	103	3/1/2021		0.0255 pCi/m3	128759001
Hatch	Charcoal Ct	I-131	103	3/1/2021		0 pCi/m3	128760001
Hatch	Air Filters	Gross Beta	103	3/8/2021		0.02421 pCi/m3	128842001
Hatch	Charcoal Ct	I-131	103	3/8/2021		0 pCi/m3	128843001
Hatch	Charcoal Ct	I-131	103	3/15/2021		0 pCi/m3	128929001
Hatch	Air Filters	Gross Beta	103	3/15/2021		0.02772 pCi/m3	128928001
Hatch	Air Filters	Gross Beta	103	3/22/2021		0.02409 pCi/m3	128997001
Hatch	Charcoal Ct	I-131	103	3/22/2021		0 pCi/m3	128998001
Hatch	Milk Gamma	Cs-137	GSP	1/5/2021		0 pCi/L	127930001
Hatch	Milk Gamma	Cs-134	GSP	1/5/2021		0 pCi/L	127930001
Hatch	Air Filters	Gross Beta	103	3/29/2021		0.01705 pCi/m3	129040001
Hatch	Charcoal Ct	I-131	103	3/29/2021		0 pCi/m3	129041001
Hatch	Milk Gamma	Be-7	GSP	1/5/2021		0 pCi/L	127930001
Hatch	Air Qtr Comp	I-131	103	3/29/2021		0 pCi/m3	129160001
Hatch	Air Filters	Gross Beta	103	4/5/2021		0.02575 pCi/m3	129117001
Hatch	Charcoal Ct	I-131	103	4/5/2021		0 pCi/m3	129118001
Hatch	Charcoal Ct	I-131	103	4/13/2021		0 pCi/m3	129177001
Hatch	Air Filters	Gross Beta	103	4/13/2021		0.02793 pCi/m3	129176001
Hatch	Air Filters	Gross Beta	103	4/19/2021		0.03036 pCi/m3	129255001
Hatch	Charcoal Ct	I-131	103	4/19/2021		0 pCi/m3	129256001
Hatch	Charcoal Ct	I-131	103	4/26/2021		0 pCi/m3	129301001
Hatch	Air Filters	Gross Beta	103	4/26/2021		0.02739 pCi/m3	129300001
Hatch	Charcoal Ct	I-131	103	5/3/2021		0 pCi/m3	129369001
Hatch	Air Filters	Gross Beta	103	5/3/2021		0.02412 pCi/m3	129368001
Hatch	Air Filters	Gross Beta	103	5/10/2021		0.0256 pCi/m3	129447001
Hatch	Charcoal Ct	I-131	103	5/10/2021		0 pCi/m3	129448001
Hatch	Charcoal Ct	I-131	103	5/18/2021		0 pCi/m3	129518001
Hatch	Air Filters	Gross Beta	103	5/18/2021		0.02181 pCi/m3	129517001
Hatch	Charcoal Ct	I-131	103	5/24/2021		0 pCi/m3	129599001
Hatch	Air Filters	Gross Beta	103	5/24/2021		0.02212 pCi/m3	129598001
Hatch	Air Filters	Gross Beta	103	6/1/2021		0.02583 pCi/m3	129659001
Hatch	Charcoal Ct	I-131	103	6/1/2021		0 pCi/m3	129660001
Hatch	Charcoal Ct	I-131	103	6/7/2021		0 pCi/m3	129778001
Hatch	Air Filters	Gross Beta	103	6/7/2021		0.01416 pCi/m3	129777001
Hatch	Charcoal Ct	I-131	103	6/14/2021		0 pCi/m3	129920001
Hatch	Air Filters	Gross Beta	103	6/14/2021		0.01473 pCi/m3	129919001
Hatch	Air Filters	Gross Beta	103	6/21/2021		0.0261 pCi/m3	130020001
Hatch	Charcoal Ct	I-131	103	6/21/2021		0 pCi/m3	130021001
Hatch	Air Qtr Comp	I-131	103	6/28/2021		0 pCi/m3	130248001
Hatch	Milk Gamma	K-40	GSP	1/5/2021		995.1 pCi/L	127930001
Hatch	Milk Gamma	Cs-137	GSP	1/19/2021		0 pCi/L	128176001
Hatch	Milk Gamma	Cs-134	GSP	1/19/2021		0 pCi/L	128176001
Hatch	Air Filters	Gross Beta	103	6/28/2021		0.01959 pCi/m3	130141001
Hatch	Charcoal Ct	I-131	103	6/28/2021		0 pCi/m3	130142001
Hatch	Charcoal Ct	I-131	103	7/6/2021		0 pCi/m3	130195001
Hatch	Air Filters	Gross Beta	103	7/6/2021		0.01283 pCi/m3	130194001
Hatch	Air Filters	Gross Beta	103	7/12/2021		0.01632 pCi/m3	130292001
Hatch	Charcoal Ct	I-131	103	7/12/2021		0 pCi/m3	130293001
Hatch	Air Filters	Gross Beta	103	7/19/2021		0.01845 pCi/m3	130424001
Hatch	Charcoal Ct	I-131	103	7/19/2021		0 pCi/m3	130425001
Hatch	Charcoal Ct	I-131	103	7/26/2021		0 pCi/m3	130494001
Hatch	Air Filters	Gross Beta	103	7/26/2021		0.0181 pCi/m3	130493001
Hatch	Air Filters	Gross Beta	103	8/2/2021		0.02461 pCi/m3	130588001
Hatch	Charcoal Ct	I-131	103	8/2/2021		0 pCi/m3	130589001
Hatch	Charcoal Ct	I-131	103	8/10/2021		0 pCi/m3	130713001
Hatch	Air Filters	Gross Beta	103	8/10/2021		0.01682 pCi/m3	130711001
Hatch	Charcoal Ct	I-131	103	8/16/2021		0 pCi/m3	130842001
Hatch	Air Filters	Gross Beta	103	8/16/2021		0.01814 pCi/m3	130841001
Hatch	Charcoal Ct	I-131	103	8/23/2021		0 pCi/m3	130990001
Hatch	Air Filters	Gross Beta	103	8/23/2021		0.01522 pCi/m3	130989001
Hatch	Air Filters	Gross Beta	103	8/30/2021		0.02316 pCi/m3	131044001
Hatch	Charcoal Ct	I-131	103	8/30/2021		0 pCi/m3	131045001
Hatch	Charcoal Ct	I-131	103	9/7/2021		0 pCi/m3	131155001
Hatch	Air Filters	Gross Beta	103	9/7/2021		0.0275 pCi/m3	131154001
Hatch	Charcoal Ct	I-131	103	9/13/2021		0 pCi/m3	131244001
Hatch	Air Filters	Gross Beta	103	9/13/2021		0.02876 pCi/m3	131243001
Hatch	Charcoal Ct	I-131	103	9/20/2021		0 pCi/m3	131335001
Hatch	Air Filters	Gross Beta	103	9/20/2021		0.02079 pCi/m3	131334001
Hatch	Milk Gamma	Be-7	GSP	1/19/2021		0 pCi/L	128176001
Hatch	Milk Gamma	K-40	GSP	1/19/2021		1348.2 pCi/L	128176001

Hatch	Charcoal Ct	I-131	103	9/27/2021	0 pCi/m3	131446001
Hatch	Vegetation	Be-7	106	1/25/2021	12388 pCi/Kg	128296003
Hatch	Air Qtr Comp	I-131	103	9/27/2021	0 pCi/m3	131792001
Hatch	Air Filters	Gross Beta	103	9/27/2021	0.01925 pCi/m3	131444001
Hatch	Air Filters	Gross Beta	103	10/5/2021	0.04577 pCi/m3	131546001
Hatch	Charcoal Ct	I-131	103	10/5/2021	0 pCi/m3	131547001
Hatch	Charcoal Ct	I-131	103	10/11/2021	0 pCi/m3	131631001
Hatch	Air Filters	Gross Beta	103	10/11/2021	0.01783 pCi/m3	131630001
Hatch	Air Filters	Gross Beta	103	10/18/2021	0.02604 pCi/m3	131713001
Hatch	Charcoal Ct	I-131	103	10/18/2021	0 pCi/m3	131715001
Hatch	Air Filters	Gross Beta	103	10/25/2021	0.036 pCi/m3	131815001
Hatch	Charcoal Ct	I-131	103	10/25/2021	0 pCi/m3	131816001
Hatch	Air Filters	Gross Beta	103	11/1/2021	0.01547 pCi/m3	131847001
Hatch	Charcoal Ct	I-131	103	11/1/2021	0 pCi/m3	131848001
Hatch	Air Filters	Gross Beta	103	11/8/2021	0.02466 pCi/m3	131943001
Hatch	Charcoal Ct	I-131	103	11/8/2021	0 pCi/m3	131944001
Hatch	Charcoal Ct	I-131	103	11/16/2021	0 pCi/m3	131996001
Hatch	Air Filters	Gross Beta	103	11/16/2021	0.02673 pCi/m3	131995001
Hatch	Air Filters	Gross Beta	103	11/22/2021	0.02106 pCi/m3	132024001
Hatch	Charcoal Ct	I-131	103	11/22/2021	0 pCi/m3	132025001
Hatch	Charcoal Ct	I-131	103	11/30/2021	0 pCi/m3	132103001
Hatch	Air Filters	Gross Beta	103	11/30/2021	0.02522 pCi/m3	132101001
Hatch	Air Filters	Gross Beta	103	12/6/2021	0.0484 pCi/m3	132153001
Hatch	Charcoal Ct	I-131	103	12/6/2021	0 pCi/m3	132154001
Hatch	Air Filters	Gross Beta	103	12/13/2021	0.02224 pCi/m3	132203001
Hatch	Charcoal Ct	I-131	103	12/13/2021	0 pCi/m3	132204001
Hatch	Air Filters	Gross Beta	103	12/20/2021	0.01387 pCi/m3	132264001
Hatch	Charcoal Ct	I-131	103	12/20/2021	0 pCi/m3	132266001
Hatch	Vegetation	Cs-134	106	1/25/2021	0 pCi/Kg	128296003
Hatch	Vegetation	K-40	106	1/25/2021	785.51 pCi/Kg	128296003
Hatch	Air Filters	Gross Beta	103	12/27/2021	0.02749 pCi/m3	132327001
Hatch	Vegetation	Cs-137	106	1/25/2021	37.252 pCi/Kg	128296003
Hatch	Air Qtr Comp	I-131	103	12/27/2021	0 pCi/m3	132405001
Hatch	Charcoal Ct	I-131	103	12/27/2021	0 pCi/m3	132328001
Hatch	Vegetation	K-40	112	1/25/2021	1255 pCi/Kg	128296002
Hatch	Vegetation	Be-7	112	1/25/2021	5670.4 pCi/Kg	128296002
Hatch	Vegetation	Cs-134	112	1/25/2021	0 pCi/Kg	128296002
Hatch	Vegetation	Cs-137	112	1/25/2021	0 pCi/Kg	128296002
Hatch	Vegetation	Cs-134	416	1/25/2021	0 pCi/Kg	128296001
Hatch	Vegetation	Be-7	416	1/25/2021	7883.5 pCi/Kg	128296001
Hatch	Vegetation	K-40	416	1/25/2021	6318.8 pCi/Kg	128296001
Hatch	Vegetation	Cs-137	416	1/25/2021	0 pCi/Kg	128296001
Hatch	River Water	Co-58	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	Co-60	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	Cs-134	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	Cs-137	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	Be-7	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	K-40	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	Cs-134	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Cs-137	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Be-7	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	K-40	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Co-58	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Co-60	172	1/26/2021	0 pCi/L	128295002
Hatch	Milk Gamma	Cs-137	GSP	2/2/2021	0 pCi/L	128355001
Hatch	Milk Gamma	Be-7	GSP	2/2/2021	0 pCi/L	128355001
Hatch	Milk Gamma	Cs-134	GSP	2/2/2021	0 pCi/L	128355001
Hatch	Milk Gamma	K-40	GSP	2/2/2021	1515.9 pCi/L	128355001
Hatch	Milk Gamma	Cs-137	GSP	2/16/2021	0 pCi/L	128610001
Hatch	Milk Gamma	K-40	GSP	2/16/2021	1462.8 pCi/L	128610001
Hatch	Milk Gamma	Be-7	GSP	2/16/2021	0 pCi/L	128610001
Hatch	Milk Gamma	Cs-134	GSP	2/16/2021	0 pCi/L	128610001
Hatch	Vegetation	Cs-134	112	2/22/2021	0 pCi/Kg	128651002
Hatch	Vegetation	Be-7	112	2/22/2021	4877.1 pCi/Kg	128651002
Hatch	Vegetation	K-40	112	2/22/2021	4477.7 pCi/Kg	128651002
Hatch	Vegetation	Cs-137	112	2/22/2021	0 pCi/Kg	128651002
Hatch	Vegetation	Cs-134	416	2/22/2021	0 pCi/Kg	128651001
Hatch	Vegetation	Be-7	416	2/22/2021	2244.2 pCi/Kg	128651001
Hatch	Vegetation	K-40	416	2/22/2021	5466.3 pCi/Kg	128651001
Hatch	Vegetation	Cs-137	416	2/22/2021	0 pCi/Kg	128651001
Hatch	River Water	K-40	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Cs-134	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Cs-137	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Be-7	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Co-58	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Co-60	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Co-58	170	2/23/2021	0 pCi/L	128650001
Hatch	River Water	Co-60	170	2/23/2021	0 pCi/L	128650001
Hatch	River Water	Cs-134	170	2/23/2021	0 pCi/L	128650001
Hatch	River Water	Cs-137	170	2/23/2021	0 pCi/L	128650001
Hatch	River Water	Be-7	170	2/23/2021	0 pCi/L	128650001
Hatch	River Water	K-40	170	2/23/2021	0 pCi/L	128650001
Hatch	Milk Gamma	Cs-137	GSP	3/2/2021	0 pCi/L	128758001
Hatch	Milk Gamma	K-40	GSP	3/2/2021	843.37 pCi/L	128758001
Hatch	Charcoal Ct	I-131	107	1/4/2021	0 pCi/m3	127932002
Hatch	Air Filters	Gross Beta	107	1/4/2021	0.01761 pCi/m3	127931002
Hatch	Air Filters	Gross Beta	107	1/11/2021	0.0282 pCi/m3	128029002

Hatch	Charcoal Ct	I-131	107	1/11/2021	0 pCi/m3	128030002
Hatch	Air Filters	Gross Beta	107	1/19/2021	0.02419 pCi/m3	128177002
Hatch	Charcoal Ct	I-131	107	1/19/2021	0 pCi/m3	128178002
Hatch	Charcoal Ct	I-131	107	1/25/2021	0 pCi/m3	128294002
Hatch	Air Filters	Gross Beta	107	1/25/2021	0.02479 pCi/m3	128293002
Hatch	Charcoal Ct	I-131	107	2/1/2021	0 pCi/m3	128354002
Hatch	Air Filters	Gross Beta	107	2/1/2021	0.02326 pCi/m3	128353002
Hatch	Air Filters	Gross Beta	107	2/8/2021	0.01693 pCi/m3	128429002
Hatch	Charcoal Ct	I-131	107	2/8/2021	0 pCi/m3	128430002
Hatch	Charcoal Ct	I-131	107	2/15/2021	0 pCi/m3	128568002
Hatch	Air Filters	Gross Beta	107	2/15/2021	0.009167 pCi/m3	128567002
Hatch	Charcoal Ct	I-131	107	2/22/2021	0 pCi/m3	128649002
Hatch	Air Filters	Gross Beta	107	2/22/2021	0.02195 pCi/m3	128648002
Hatch	Charcoal Ct	I-131	107	3/1/2021	0 pCi/m3	128760002
Hatch	Air Filters	Gross Beta	107	3/1/2021	0.02082 pCi/m3	128759002
Hatch	Air Filters	Gross Beta	107	3/8/2021	0.02028 pCi/m3	128842002
Hatch	Charcoal Ct	I-131	107	3/8/2021	0 pCi/m3	128843002
Hatch	Air Filters	Gross Beta	107	3/15/2021	0.02413 pCi/m3	128928002
Hatch	Charcoal Ct	I-131	107	3/15/2021	0 pCi/m3	128929002
Hatch	Air Filters	Gross Beta	107	3/22/2021	0.02062 pCi/m3	128997002
Hatch	Charcoal Ct	I-131	107	3/22/2021	0 pCi/m3	128998002
Hatch	Milk Gamma	Be-7	GSP	3/2/2021	0 pCi/L	128758001
Hatch	Air Filters	Gross Beta	107	3/29/2021	0.01554 pCi/m3	129040002
Hatch	Charcoal Ct	I-131	107	3/29/2021	0 pCi/m3	129041002
Hatch	Milk Gamma	Cs-134	GSP	3/2/2021	0 pCi/L	128758001
Hatch	Air Qtr Comp	I-131	107	3/29/2021	0 pCi/m3	129160002
Hatch	Milk Gamma	Cs-137	GSP	3/16/2021	0 pCi/L	128930001
Hatch	Air Filters	Gross Beta	107	4/5/2021	0.0248 pCi/m3	129117002
Hatch	Charcoal Ct	I-131	107	4/5/2021	0 pCi/m3	129118002
Hatch	Air Filters	Gross Beta	107	4/13/2021	0.02754 pCi/m3	129176002
Hatch	Charcoal Ct	I-131	107	4/13/2021	0 pCi/m3	129177002
Hatch	Air Filters	Gross Beta	107	4/19/2021	0.02838 pCi/m3	129255002
Hatch	Charcoal Ct	I-131	107	4/19/2021	0 pCi/m3	129256002
Hatch	Charcoal Ct	I-131	107	4/26/2021	0 pCi/m3	129301002
Hatch	Air Filters	Gross Beta	107	4/26/2021	0.02471 pCi/m3	129300002
Hatch	Charcoal Ct	I-131	107	5/3/2021	0 pCi/m3	129369002
Hatch	Air Filters	Gross Beta	107	5/3/2021	0.02389 pCi/m3	129368002
Hatch	Charcoal Ct	I-131	107	5/10/2021	0 pCi/m3	129448002
Hatch	Air Filters	Gross Beta	107	5/10/2021	0.02044 pCi/m3	129447002
Hatch	Charcoal Ct	I-131	107	5/18/2021	0 pCi/m3	129518002
Hatch	Air Filters	Gross Beta	107	5/18/2021	0.01905 pCi/m3	129517002
Hatch	Air Filters	Gross Beta	107	5/24/2021	0.01994 pCi/m3	129598002
Hatch	Charcoal Ct	I-131	107	5/24/2021	0 pCi/m3	129599002
Hatch	Air Filters	Gross Beta	107	6/1/2021	0.02056 pCi/m3	129659002
Hatch	Charcoal Ct	I-131	107	6/1/2021	0 pCi/m3	129660002
Hatch	Air Filters	Gross Beta	107	6/7/2021	0.00968 pCi/m3	129777002
Hatch	Charcoal Ct	I-131	107	6/7/2021	0 pCi/m3	129778002
Hatch	Charcoal Ct	I-131	107	6/14/2021	0 pCi/m3	129920002
Hatch	Air Filters	Gross Beta	107	6/14/2021	0.01332 pCi/m3	129919002
Hatch	Charcoal Ct	I-131	107	6/21/2021	0 pCi/m3	130021002
Hatch	Air Filters	Gross Beta	107	6/21/2021	0.02189 pCi/m3	130020002
Hatch	Charcoal Ct	I-131	107	6/28/2021	0 pCi/m3	130142002
Hatch	Air Filters	Gross Beta	107	6/28/2021	0.004265 pCi/m3	130141002
Hatch	Milk Gamma	K-40	GSP	3/16/2021	519.4 pCi/L	128930001
Hatch	Milk Gamma	Be-7	GSP	3/16/2021	0 pCi/L	128930001
Hatch	Milk Gamma	Cs-134	GSP	3/16/2021	0 pCi/L	128930001
Hatch	Air Qtr Comp	I-131	107	6/28/2021	0 pCi/m3	130248002
Hatch	Charcoal Ct	I-131	107	7/6/2021	0 pCi/m3	130195002
Hatch	Air Filters	Gross Beta	107	7/6/2021	0.01744 pCi/m3	130194002
Hatch	Charcoal Ct	I-131	107	7/12/2021	0 pCi/m3	130293002
Hatch	Air Filters	Gross Beta	107	7/12/2021	0.01491 pCi/m3	130292002
Hatch	Charcoal Ct	I-131	107	7/19/2021	0 pCi/m3	130425002
Hatch	Air Filters	Gross Beta	107	7/19/2021	0.01521 pCi/m3	130424002
Hatch	Charcoal Ct	I-131	107	7/26/2021	0 pCi/m3	130494002
Hatch	Air Filters	Gross Beta	107	7/26/2021	0.02043 pCi/m3	130493002
Hatch	Air Filters	Gross Beta	107	8/2/2021	0.02523 pCi/m3	130588002
Hatch	Charcoal Ct	I-131	107	8/2/2021	0 pCi/m3	130589002
Hatch	Air Filters	Gross Beta	107	8/10/2021	0.0163 pCi/m3	130711002
Hatch	Charcoal Ct	I-131	107	8/10/2021	0 pCi/m3	130713002
Hatch	Air Filters	Gross Beta	107	8/16/2021	0.01573 pCi/m3	130841002
Hatch	Charcoal Ct	I-131	107	8/16/2021	0 pCi/m3	130842002
Hatch	Air Filters	Gross Beta	107	8/23/2021	0.0117 pCi/m3	130989002
Hatch	Charcoal Ct	I-131	107	8/23/2021	0 pCi/m3	130990002
Hatch	Air Filters	Gross Beta	107	8/30/2021	0.01905 pCi/m3	131044002
Hatch	Charcoal Ct	I-131	107	8/30/2021	0 pCi/m3	131045002
Hatch	Air Filters	Gross Beta	107	9/7/2021	0.02379 pCi/m3	131154002
Hatch	Charcoal Ct	I-131	107	9/7/2021	0 pCi/m3	131155002
Hatch	Charcoal Ct	I-131	107	9/13/2021	0 pCi/m3	131244002
Hatch	Air Filters	Gross Beta	107	9/13/2021	0.02904 pCi/m3	131243002
Hatch	Air Filters	Gross Beta	107	9/20/2021	0.02034 pCi/m3	131334002
Hatch	Charcoal Ct	I-131	107	9/20/2021	0 pCi/m3	131335002
Hatch	River Water	Be-7	172	3/23/2021	0 pCi/L	128987002
Hatch	River Water	K-40	172	3/23/2021	0 pCi/L	128987002
Hatch	Air Filters	Gross Beta	107	9/27/2021	0.0164 pCi/m3	131444002
Hatch	Air Qtr Comp	I-131	107	9/27/2021	0 pCi/m3	131792002
Hatch	Charcoal Ct	I-131	107	9/27/2021	0 pCi/m3	131446002
Hatch	River Water	Co-58	172	3/23/2021	0 pCi/L	128987002

Hatch	Air Filters	Gross Beta	107	10/5/2021	0.04543 pCi/m3	131546002
Hatch	Charcoal Ct	I-131	107	10/5/2021	0 pCi/m3	131547002
Hatch	Charcoal Ct	I-131	107	10/11/2021	0 pCi/m3	131631002
Hatch	Air Filters	Gross Beta	107	10/11/2021	0.01607 pCi/m3	131630002
Hatch	Air Filters	Gross Beta	107	10/18/2021	0.02097 pCi/m3	131713002
Hatch	Charcoal Ct	I-131	107	10/18/2021	0 pCi/m3	131715002
Hatch	Air Filters	Gross Beta	107	10/25/2021	0.03316 pCi/m3	131815002
Hatch	Charcoal Ct	I-131	107	10/25/2021	0 pCi/m3	131816002
Hatch	Charcoal Ct	I-131	107	11/1/2021	0 pCi/m3	131848002
Hatch	Air Filters	Gross Beta	107	11/1/2021	0.01397 pCi/m3	131847002
Hatch	Air Filters	Gross Beta	107	11/8/2021	0.02394 pCi/m3	131943002
Hatch	Charcoal Ct	I-131	107	11/8/2021	0 pCi/m3	131944002
Hatch	Charcoal Ct	I-131	107	11/16/2021	0 pCi/m3	131996002
Hatch	Air Filters	Gross Beta	107	11/16/2021	0.02541 pCi/m3	131995002
Hatch	Air Filters	Gross Beta	107	11/22/2021	0.0202 pCi/m3	132024002
Hatch	Charcoal Ct	I-131	107	11/22/2021	0 pCi/m3	132025002
Hatch	Charcoal Ct	I-131	107	11/30/2021	0 pCi/m3	132103002
Hatch	Air Filters	Gross Beta	107	11/30/2021	0.0232 pCi/m3	132101002
Hatch	Air Filters	Gross Beta	107	12/6/2021	0.04244 pCi/m3	132153002
Hatch	Charcoal Ct	I-131	107	12/6/2021	0 pCi/m3	132154002
Hatch	Charcoal Ct	I-131	107	12/13/2021	0 pCi/m3	132204002
Hatch	Air Filters	Gross Beta	107	12/13/2021	0.02574 pCi/m3	132203002
Hatch	Charcoal Ct	I-131	107	12/20/2021	0 pCi/m3	132266002
Hatch	Air Filters	Gross Beta	107	12/20/2021	0.01601 pCi/m3	132264002
Hatch	Charcoal Ct	I-131	107	12/27/2021	0 pCi/m3	132328002
Hatch	Air Qtr Comp	I-131	107	12/27/2021	0 pCi/m3	132405002
Hatch	River Water	Co-60	172	3/23/2021	0 pCi/L	128987002
Hatch	River Water	Cs-134	172	3/23/2021	0 pCi/L	128987002
Hatch	River Water	Cs-137	172	3/23/2021	0 pCi/L	128987002
Hatch	Air Filters	Gross Beta	107	12/27/2021	0.02465 pCi/m3	132327002
Hatch	Air Filters	Gross Beta	112	1/4/2021	0.01527 pCi/m3	127931003
Hatch	Charcoal Ct	I-131	112	1/4/2021	0 pCi/m3	127932003
Hatch	Air Filters	Gross Beta	112	1/11/2021	0.02911 pCi/m3	128029003
Hatch	Charcoal Ct	I-131	112	1/11/2021	0 pCi/m3	128030003
Hatch	Air Filters	Gross Beta	112	1/19/2021	0.02399 pCi/m3	128177003
Hatch	Charcoal Ct	I-131	112	1/19/2021	0 pCi/m3	128178003
Hatch	Air Filters	Gross Beta	112	1/25/2021	0.02194 pCi/m3	128293003
Hatch	Charcoal Ct	I-131	112	1/25/2021	0 pCi/m3	128294003
Hatch	River Water	Cs-134	170	3/23/2021	0 pCi/L	128987001
Hatch	River Water	Cs-137	170	3/23/2021	0 pCi/L	128987001
Hatch	River Water	Be-7	170	3/23/2021	0 pCi/L	128987001
Hatch	River Water	K-40	170	3/23/2021	0 pCi/L	128987001
Hatch	River Water	Co-58	170	3/23/2021	0 pCi/L	128987001
Hatch	Air Filters	Gross Beta	112	2/1/2021	0.02257 pCi/m3	128353003
Hatch	Charcoal Ct	I-131	112	2/1/2021	0 pCi/m3	128354003
Hatch	Air Filters	Gross Beta	112	2/8/2021	0.01618 pCi/m3	128429003
Hatch	Charcoal Ct	I-131	112	2/8/2021	0 pCi/m3	128430003
Hatch	Air Filters	Gross Beta	112	2/15/2021	0.01076 pCi/m3	128567003
Hatch	Charcoal Ct	I-131	112	2/15/2021	0 pCi/m3	128568003
Hatch	Air Filters	Gross Beta	112	2/22/2021	0.02318 pCi/m3	128648003
Hatch	Charcoal Ct	I-131	112	2/22/2021	0 pCi/m3	128649003
Hatch	River Water	Co-60	170	3/23/2021	0 pCi/L	128987001
Hatch	Air Qtr Comp	Cs-137	112	3/29/2021	0 pCi/m3	129160003
Hatch	Air Qtr Comp	Be-7	112	3/29/2021	0.09442 pCi/m3	129160003
Hatch	Air Qtr Comp	Cs-134	112	3/29/2021	0 pCi/m3	129160003
Hatch	Air Qtr Comp	Cs-137	107	3/29/2021	0 pCi/m3	129160002
Hatch	Air Filters	Gross Beta	112	3/1/2021	0.02413 pCi/m3	128759003
Hatch	Charcoal Ct	I-131	112	3/1/2021	0 pCi/m3	128760003
Hatch	Charcoal Ct	I-131	112	3/8/2021	0 pCi/m3	128843003
Hatch	Air Filters	Gross Beta	112	3/8/2021	0.02142 pCi/m3	128842003
Hatch	Charcoal Ct	I-131	112	3/15/2021	0 pCi/m3	128929003
Hatch	Air Filters	Gross Beta	112	3/15/2021	0.02753 pCi/m3	128928003
Hatch	Air Filters	Gross Beta	112	3/22/2021	0.02089 pCi/m3	128997003
Hatch	Charcoal Ct	I-131	112	3/22/2021	0 pCi/m3	128998003
Hatch	Air Qtr Comp	Cs-134	107	3/29/2021	0 pCi/m3	129160002
Hatch	Air Qtr Comp	Be-7	107	3/29/2021	0.06655 pCi/m3	129160002
Hatch	Air Filters	Gross Beta	112	3/29/2021	0.01552 pCi/m3	129040003
Hatch	Charcoal Ct	I-131	112	3/29/2021	0 pCi/m3	129041003
Hatch	Air Qtr Comp	I-131	112	3/29/2021	0 pCi/m3	129160003
Hatch	Air Qtr Comp	Be-7	309	3/29/2021	0.08633 pCi/m3	129160006
Hatch	Air Qtr Comp	Cs-137	309	3/29/2021	0 pCi/m3	129160006
Hatch	Air Qtr Comp	Cs-134	309	3/29/2021	0 pCi/m3	129160006
Hatch	Air Qtr Comp	Cs-137	304	3/29/2021	0 pCi/m3	129160005
Hatch	Air Qtr Comp	Cs-134	304	3/29/2021	0 pCi/m3	129160005
Hatch	Air Qtr Comp	Be-7	304	3/29/2021	0.07768 pCi/m3	129160005
Hatch	Air Filters	Gross Beta	112	4/5/2021	0.02344 pCi/m3	129117003
Hatch	Charcoal Ct	I-131	112	4/5/2021	0 pCi/m3	129118003
Hatch	Air Filters	Gross Beta	112	4/13/2021	0.02642 pCi/m3	129176003
Hatch	Charcoal Ct	I-131	112	4/13/2021	0 pCi/m3	129177003
Hatch	Air Filters	Gross Beta	112	4/19/2021	0.02673 pCi/m3	129255003
Hatch	Charcoal Ct	I-131	112	4/19/2021	0 pCi/m3	129256003
Hatch	Charcoal Ct	I-131	112	4/26/2021	0 pCi/m3	129301003
Hatch	Air Filters	Gross Beta	112	4/26/2021	0.02245 pCi/m3	129300003
Hatch	Air Qtr Comp	Be-7	103	3/29/2021	0.09098 pCi/m3	129160001
Hatch	Air Qtr Comp	Cs-137	103	3/29/2021	0 pCi/m3	129160001
Hatch	Air Qtr Comp	Cs-134	103	3/29/2021	0 pCi/m3	129160001
Hatch	Air Qtr Comp	Be-7	116	3/29/2021	0.1206 pCi/m3	129160004

Hatch	Air Qtr Comp	Cs-137	116	3/29/2021	0 pCi/m3	129160004
Hatch	Charcoal Ct	I-131	112	5/3/2021	0 pCi/m3	129369003
Hatch	Air Filters	Gross Beta	112	5/3/2021	0.02805 pCi/m3	129368003
Hatch	Air Filters	Gross Beta	112	5/10/2021	0.02067 pCi/m3	129447003
Hatch	Charcoal Ct	I-131	112	5/10/2021	0 pCi/m3	129448003
Hatch	Air Filters	Gross Beta	112	5/18/2021	0.01725 pCi/m3	129517003
Hatch	Charcoal Ct	I-131	112	5/18/2021	0 pCi/m3	129518003
Hatch	Charcoal Ct	I-131	112	6/1/2021	0 pCi/m3	129660003
Hatch	Air Filters	Gross Beta	112	6/1/2021	0.02612 pCi/m3	129659003
Hatch	Air Qtr Comp	Cs-134	116	3/29/2021	0 pCi/m3	129160004
Hatch	Vegetation	Cs-134	416	3/29/2021	0 pCi/Kg	129042001
Hatch	Vegetation	Be-7	416	3/29/2021	217.72 pCi/Kg	129042001
Hatch	Vegetation	K-40	416	3/29/2021	5468.3 pCi/Kg	129042001
Hatch	Vegetation	Cs-137	416	3/29/2021	0 pCi/Kg	129042001
Hatch	Charcoal Ct	I-131	112	6/7/2021	0 pCi/m3	129778003
Hatch	Air Filters	Gross Beta	112	6/7/2021	0.01224 pCi/m3	129777003
Hatch	Air Filters	Gross Beta	112	6/14/2021	0.01625 pCi/m3	129919003
Hatch	Charcoal Ct	I-131	112	6/14/2021	0 pCi/m3	129920003
Hatch	Air Filters	Gross Beta	112	6/21/2021	0.02337 pCi/m3	130020003
Hatch	Charcoal Ct	I-131	112	6/21/2021	0 pCi/m3	130021003
Hatch	Air Filters	Gross Beta	112	6/28/2021	0.01327 pCi/m3	130141003
Hatch	Air Qtr Comp	I-131	112	6/28/2021	0 pCi/m3	130248003
Hatch	Milk Gamma	Cs-137	GSP	3/30/2021	0 pCi/L	129043001
Hatch	Milk Gamma	Cs-134	GSP	3/30/2021	0 pCi/L	129043001
Hatch	Milk Gamma	Be-7	GSP	3/30/2021	0 pCi/L	129043001
Hatch	Charcoal Ct	I-131	112	6/28/2021	0 pCi/m3	130142003
Hatch	Milk Gamma	K-40	GSP	3/30/2021	1512 pCi/L	129043001
Hatch	Vegetation	Be-7	112	3/30/2021	1430.1 pCi/Kg	129042002
Hatch	Vegetation	K-40	112	3/30/2021	4798.3 pCi/Kg	129042002
Hatch	Vegetation	Cs-134	112	3/30/2021	0 pCi/Kg	129042002
Hatch	Vegetation	Cs-137	112	3/30/2021	0 pCi/Kg	129042002
Hatch	Charcoal Ct	I-131	112	7/6/2021	0 pCi/m3	130195003
Hatch	Air Filters	Gross Beta	112	7/6/2021	0.01627 pCi/m3	130194003
Hatch	Charcoal Ct	I-131	112	7/12/2021	0 pCi/m3	130293003
Hatch	Air Filters	Gross Beta	112	7/12/2021	0.01585 pCi/m3	130292003
Hatch	Air Filters	Gross Beta	112	7/19/2021	0.01477 pCi/m3	130424003
Hatch	Charcoal Ct	I-131	112	7/19/2021	0 pCi/m3	130425003
Hatch	Air Filters	Gross Beta	112	7/26/2021	0.01726 pCi/m3	130493003
Hatch	Charcoal Ct	I-131	112	7/26/2021	0 pCi/m3	130494003
Hatch	Vegetation	Be-7	106	3/30/2021	1978 pCi/Kg	129042003
Hatch	Vegetation	K-40	106	3/30/2021	4044.5 pCi/Kg	129042003
Hatch	Vegetation	Cs-134	106	3/30/2021	0 pCi/Kg	129042003
Hatch	Vegetation	Cs-137	106	3/30/2021	16.792 pCi/Kg	129042003
Hatch	Milk Gamma	Cs-137	GSP	4/13/2021	0 pCi/L	129175001
Hatch	Charcoal Ct	I-131	112	8/2/2021	0 pCi/m3	130589003
Hatch	Air Filters	Gross Beta	112	8/2/2021	0.02251 pCi/m3	130588003
Hatch	Air Filters	Gross Beta	112	8/10/2021	0.01651 pCi/m3	130711003
Hatch	Charcoal Ct	I-131	112	8/10/2021	0 pCi/m3	130713003
Hatch	Charcoal Ct	I-131	112	8/16/2021	0 pCi/m3	130842003
Hatch	Air Filters	Gross Beta	112	8/16/2021	0.01796 pCi/m3	130841003
Hatch	Charcoal Ct	I-131	112	8/23/2021	0 pCi/m3	130990003
Hatch	Air Filters	Gross Beta	112	8/23/2021	0.01021 pCi/m3	130989003
Hatch	Charcoal Ct	I-131	112	8/30/2021	0 pCi/m3	131045003
Hatch	Air Filters	Gross Beta	112	8/30/2021	0.02093 pCi/m3	131044003
Hatch	Milk Gamma	K-40	GSP	4/13/2021	1443.3 pCi/L	129175001
Hatch	Milk Gamma	Be-7	GSP	4/13/2021	0 pCi/L	129175001
Hatch	Milk Gamma	Cs-134	GSP	4/13/2021	0 pCi/L	129175001
Hatch	River Water	Be-7	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	K-40	172	4/20/2021	0 pCi/L	129249002
Hatch	Charcoal Ct	I-131	112	9/7/2021	0 pCi/m3	131155003
Hatch	Air Filters	Gross Beta	112	9/7/2021	0.02313 pCi/m3	131154003
Hatch	Air Filters	Gross Beta	112	9/13/2021	0.03315 pCi/m3	131243003
Hatch	Charcoal Ct	I-131	112	9/13/2021	0 pCi/m3	131244003
Hatch	Charcoal Ct	I-131	112	9/20/2021	0 pCi/m3	131335003
Hatch	Air Filters	Gross Beta	112	9/20/2021	0.02061 pCi/m3	131334003
Hatch	Air Qtr Comp	I-131	112	9/27/2021	0 pCi/m3	131792003
Hatch	River Water	Co-58	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	Co-60	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	Cs-134	172	4/20/2021	0 pCi/L	129249002
Hatch	Charcoal Ct	I-131	112	9/27/2021	0 pCi/m3	131446003
Hatch	Air Filters	Gross Beta	112	9/27/2021	0.01616 pCi/m3	131444003
Hatch	River Water	Cs-137	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	Co-58	170	4/20/2021	0 pCi/L	129249001
Hatch	River Water	Co-60	170	4/20/2021	0 pCi/L	129249001
Hatch	River Water	Cs-134	170	4/20/2021	0 pCi/L	129249001
Hatch	River Water	Cs-137	170	4/20/2021	0 pCi/L	129249001
Hatch	Charcoal Ct	I-131	112	10/5/2021	0 pCi/m3	131547003
Hatch	Air Filters	Gross Beta	112	10/5/2021	0.04139 pCi/m3	131546003
Hatch	Air Filters	Gross Beta	112	10/11/2021	0.0172 pCi/m3	131630003
Hatch	Charcoal Ct	I-131	112	10/11/2021	0 pCi/m3	131631003
Hatch	Air Filters	Gross Beta	112	10/18/2021	0.02184 pCi/m3	131713003
Hatch	Charcoal Ct	I-131	112	10/18/2021	0 pCi/m3	131715003
Hatch	Charcoal Ct	I-131	112	10/25/2021	0 pCi/m3	131816003
Hatch	Air Filters	Gross Beta	112	10/25/2021	0.03314 pCi/m3	131815003
Hatch	River Water	Be-7	170	4/20/2021	0 pCi/L	129249001
Hatch	River Water	K-40	170	4/20/2021	0 pCi/L	129249001
Hatch	Vegetation	Cs-134	112	4/26/2021	0 pCi/Kg	129302002

Hatch	Vegetation	K-40	112	4/26/2021	5758.2 pCi/Kg	129302002
Hatch	Milk Gamma	I-131	GSP	1/5/2021	0 pCi/L	127930001
Hatch	Charcoal Ct	I-131	112	11/1/2021	0 pCi/m3	131848003
Hatch	Air Filters	Gross Beta	112	11/1/2021	0.01377 pCi/m3	131847003
Hatch	Air Filters	Gross Beta	112	11/8/2021	0.02235 pCi/m3	131943003
Hatch	Charcoal Ct	I-131	112	11/8/2021	0 pCi/m3	131944003
Hatch	Charcoal Ct	I-131	112	11/16/2021	0 pCi/m3	131996003
Hatch	Air Filters	Gross Beta	112	11/16/2021	0.02293 pCi/m3	131995003
Hatch	Air Filters	Gross Beta	112	11/22/2021	0.02146 pCi/m3	132024003
Hatch	Charcoal Ct	I-131	112	11/22/2021	0 pCi/m3	132025003
Hatch	Air Filters	Gross Beta	112	11/30/2021	0.02231 pCi/m3	132101003
Hatch	Charcoal Ct	I-131	112	11/30/2021	0 pCi/m3	132103003
Hatch	Vegetation	Be-7	112	4/26/2021	2687.7 pCi/Kg	129302002
Hatch	Vegetation	Cs-137	112	4/26/2021	0 pCi/Kg	129302002
Hatch	Milk Gamma	I-131	GSP	1/19/2021	0 pCi/L	128176001
Hatch	Vegetation	Cs-134	106	4/26/2021	0 pCi/Kg	129302003
Hatch	Milk Gamma	I-131	GSP	2/2/2021	0 pCi/L	128355001
Hatch	Charcoal Ct	I-131	112	12/6/2021	0 pCi/m3	132154003
Hatch	Air Filters	Gross Beta	112	12/6/2021	0.04246 pCi/m3	132153003
Hatch	Charcoal Ct	I-131	112	12/13/2021	0 pCi/m3	132204003
Hatch	Air Filters	Gross Beta	112	12/13/2021	0.02478 pCi/m3	132203003
Hatch	Charcoal Ct	I-131	112	12/20/2021	0 pCi/m3	132266003
Hatch	Air Filters	Gross Beta	112	12/20/2021	0.01547 pCi/m3	132264003
Hatch	Charcoal Ct	I-131	112	12/27/2021	0 pCi/m3	132328003
Hatch	Vegetation	Be-7	106	4/26/2021	1709.9 pCi/Kg	129302003
Hatch	Air Qtr Comp	I-131	112	12/27/2021	0 pCi/m3	132405003
Hatch	Vegetation	K-40	106	4/26/2021	4793 pCi/Kg	129302003
Hatch	Vegetation	Cs-137	106	4/26/2021	0 pCi/Kg	129302003
Hatch	Air Filters	Gross Beta	112	12/27/2021	0.02439 pCi/m3	132327003
Hatch	Milk Gamma	I-131	GSP	2/16/2021	0 pCi/L	128610001
Hatch	Fish	Cs-137	170 Bass	4/26/2021	0 pCi/Kg	129298002
Hatch	Fish	Cs-137	170 Mullet	4/26/2021	0 pCi/Kg	129298003
Hatch	Milk Gamma	I-131	GSP	3/2/2021	0 pCi/L	128758001
Hatch	Fish	Cs-137	170 Sucker	4/26/2021	0 pCi/Kg	129298001
Hatch	Air Filters	Gross Beta	116	1/4/2021	0.02324 pCi/m3	127931004
Hatch	Charcoal Ct	I-131	116	1/4/2021	0 pCi/m3	127932004
Hatch	Air Filters	Gross Beta	116	1/11/2021	0.02915 pCi/m3	128029004
Hatch	Charcoal Ct	I-131	116	1/11/2021	0 pCi/m3	128030004
Hatch	Air Filters	Gross Beta	116	1/19/2021	0.02421 pCi/m3	128177004
Hatch	Charcoal Ct	I-131	116	1/19/2021	0 pCi/m3	128178004
Hatch	Air Filters	Gross Beta	116	1/25/2021	0.02531 pCi/m3	128293004
Hatch	Charcoal Ct	I-131	116	1/25/2021	0 pCi/m3	128294004
Hatch	Charcoal Ct	I-131	116	2/1/2021	0 pCi/m3	128354004
Hatch	Air Filters	Gross Beta	116	2/1/2021	0.02109 pCi/m3	128353004
Hatch	Charcoal Ct	I-131	116	2/8/2021	0 pCi/m3	128430004
Hatch	Air Filters	Gross Beta	116	2/8/2021	0.0194 pCi/m3	128429004
Hatch	Charcoal Ct	I-131	116	2/15/2021	0 pCi/m3	128568004
Hatch	Air Filters	Gross Beta	116	2/15/2021	0.01186 pCi/m3	128567004
Hatch	Charcoal Ct	I-131	116	2/22/2021	0 pCi/m3	128649004
Hatch	Air Filters	Gross Beta	116	2/22/2021	0.02418 pCi/m3	128648004
Hatch	Air Filters	Gross Beta	116	3/1/2021	0.02522 pCi/m3	128759004
Hatch	Charcoal Ct	I-131	116	3/1/2021	0 pCi/m3	128760004
Hatch	Charcoal Ct	I-131	116	3/8/2021	0 pCi/m3	128843004
Hatch	Air Filters	Gross Beta	116	3/8/2021	0.02542 pCi/m3	128842004
Hatch	Air Filters	Gross Beta	116	3/15/2021	0.0286 pCi/m3	128928004
Hatch	Charcoal Ct	I-131	116	3/15/2021	0 pCi/m3	128929004
Hatch	Air Filters	Gross Beta	116	3/22/2021	0.02314 pCi/m3	128997004
Hatch	Charcoal Ct	I-131	116	3/22/2021	0 pCi/m3	128998004
Hatch	Fish	Cs-134	170 Bass	4/26/2021	0 pCi/Kg	129298002
Hatch	Fish	Co-60	170 Bass	4/26/2021	0 pCi/Kg	129298002
Hatch	Fish	Co-58	170 Bass	4/26/2021	0 pCi/Kg	129298002
Hatch	Air Filters	Gross Beta	116	3/29/2021	0.0176 pCi/m3	129040004
Hatch	Air Qtr Comp	I-131	116	3/29/2021	0 pCi/m3	129160004
Hatch	Charcoal Ct	I-131	116	3/29/2021	0 pCi/m3	129041004
Hatch	Charcoal Ct	I-131	116	4/5/2021	0 pCi/m3	129118004
Hatch	Air Filters	Gross Beta	116	4/5/2021	0.02657 pCi/m3	129117004
Hatch	Air Filters	Gross Beta	116	4/13/2021	0.03305 pCi/m3	129176004
Hatch	Charcoal Ct	I-131	116	4/13/2021	0 pCi/m3	129177004
Hatch	Charcoal Ct	I-131	116	4/19/2021	0 pCi/m3	129256004
Hatch	Air Filters	Gross Beta	116	4/19/2021	0.02703 pCi/m3	129255004
Hatch	Air Filters	Gross Beta	116	4/26/2021	0.02897 pCi/m3	129300004
Hatch	Charcoal Ct	I-131	116	4/26/2021	0 pCi/m3	129301004
Hatch	Charcoal Ct	I-131	116	5/3/2021	0 pCi/m3	129369004
Hatch	Air Filters	Gross Beta	116	5/3/2021	0.02708 pCi/m3	129368004
Hatch	Air Filters	Gross Beta	116	5/10/2021	0.02478 pCi/m3	129447004
Hatch	Charcoal Ct	I-131	116	5/10/2021	0 pCi/m3	129448004
Hatch	Charcoal Ct	I-131	116	5/18/2021	0 pCi/m3	129518004
Hatch	Air Filters	Gross Beta	116	5/18/2021	0.02136 pCi/m3	129517004
Hatch	Charcoal Ct	I-131	116	5/24/2021	0 pCi/m3	129599003
Hatch	Air Filters	Gross Beta	116	5/24/2021	0.02187 pCi/m3	129598003
Hatch	Air Filters	Gross Beta	116	6/1/2021	0.02694 pCi/m3	129659004
Hatch	Charcoal Ct	I-131	116	6/1/2021	0 pCi/m3	129660004
Hatch	Air Filters	Gross Beta	116	6/7/2021	0.01241 pCi/m3	129777004
Hatch	Charcoal Ct	I-131	116	6/7/2021	0 pCi/m3	129778004
Hatch	Charcoal Ct	I-131	116	6/14/2021	0 pCi/m3	129920004
Hatch	Air Filters	Gross Beta	116	6/14/2021	0.01453 pCi/m3	129919004
Hatch	Charcoal Ct	I-131	116	6/21/2021	0 pCi/m3	130021004

Hatch	Air Filters	Gross Beta	116	6/21/2021	0.02349 pCi/m3	130020004
Hatch	Air Qtr Comp	I-131	116	6/28/2021	0 pCi/m3	130248004
Hatch	Fish	K-40	170 Bass	4/26/2021	2966.8 pCi/Kg	129298002
Hatch	Fish	Be-7	170 Bass	4/26/2021	0 pCi/Kg	129298002
Hatch	Fish	Be-7	170 Mullet	4/26/2021	0 pCi/Kg	129298003
Hatch	Air Filters	Gross Beta	116	6/28/2021	0.01639 pCi/m3	130141004
Hatch	Charcoal Ct	I-131	116	6/28/2021	0 pCi/m3	130142004
Hatch	Charcoal Ct	I-131	116	7/6/2021	0 pCi/m3	130195004
Hatch	Air Filters	Gross Beta	116	7/6/2021	0.01746 pCi/m3	130194004
Hatch	Charcoal Ct	I-131	116	7/12/2021	0 pCi/m3	130293004
Hatch	Air Filters	Gross Beta	116	7/12/2021	0.01128 pCi/m3	130292004
Hatch	Charcoal Ct	I-131	116	7/19/2021	0 pCi/m3	130425004
Hatch	Air Filters	Gross Beta	116	7/19/2021	0.01858 pCi/m3	130424004
Hatch	Air Filters	Gross Beta	116	7/26/2021	0.01696 pCi/m3	130493004
Hatch	Charcoal Ct	I-131	116	7/26/2021	0 pCi/m3	130494004
Hatch	Air Filters	Gross Beta	116	8/2/2021	0.02847 pCi/m3	130588004
Hatch	Charcoal Ct	I-131	116	8/2/2021	0 pCi/m3	130589004
Hatch	Air Filters	Gross Beta	116	8/10/2021	0.01608 pCi/m3	130711004
Hatch	Charcoal Ct	I-131	116	8/10/2021	0 pCi/m3	130713004
Hatch	Air Filters	Gross Beta	116	8/16/2021	0.01576 pCi/m3	130841004
Hatch	Charcoal Ct	I-131	116	8/16/2021	0 pCi/m3	130842004
Hatch	Air Filters	Gross Beta	116	8/23/2021	0.01358 pCi/m3	130989004
Hatch	Charcoal Ct	I-131	116	8/23/2021	0 pCi/m3	130990004
Hatch	Charcoal Ct	I-131	116	8/30/2021	0 pCi/m3	131045004
Hatch	Air Filters	Gross Beta	116	8/30/2021	0.02285 pCi/m3	131044004
Hatch	Charcoal Ct	I-131	116	9/7/2021	0 pCi/m3	131155004
Hatch	Air Filters	Gross Beta	116	9/7/2021	0.02772 pCi/m3	131154004
Hatch	Air Filters	Gross Beta	116	9/13/2021	0.03106 pCi/m3	131243004
Hatch	Charcoal Ct	I-131	116	9/13/2021	0 pCi/m3	131244004
Hatch	Air Filters	Gross Beta	116	9/20/2021	0.02188 pCi/m3	131334004
Hatch	Charcoal Ct	I-131	116	9/20/2021	0 pCi/m3	131335004
Hatch	Fish	Co-58	170 Mullet	4/26/2021	0 pCi/Kg	129298003
Hatch	Fish	Co-60	170 Mullet	4/26/2021	0 pCi/Kg	129298003
Hatch	Air Filters	Gross Beta	116	9/27/2021	0.01475 pCi/m3	131444004
Hatch	Air Qtr Comp	I-131	116	9/27/2021	0 pCi/m3	131792004
Hatch	Fish	Cs-134	170 Mullet	4/26/2021	0 pCi/Kg	129298003
Hatch	Charcoal Ct	I-131	116	9/27/2021	0 pCi/m3	131446004
Hatch	Charcoal Ct	I-131	116	10/5/2021	0 pCi/m3	131547004
Hatch	Air Filters	Gross Beta	116	10/5/2021	0.04371 pCi/m3	131546004
Hatch	Charcoal Ct	I-131	116	10/11/2021	0 pCi/m3	131631004
Hatch	Air Filters	Gross Beta	116	10/11/2021	0.017 pCi/m3	131630004
Hatch	Air Filters	Gross Beta	116	10/18/2021	0.02041 pCi/m3	131713004
Hatch	Charcoal Ct	I-131	116	10/18/2021	0 pCi/m3	131715004
Hatch	Air Filters	Gross Beta	116	10/25/2021	0.03165 pCi/m3	131815004
Hatch	Charcoal Ct	I-131	116	10/25/2021	0 pCi/m3	131816004
Hatch	Air Filters	Gross Beta	116	11/1/2021	0.01356 pCi/m3	131847004
Hatch	Charcoal Ct	I-131	116	11/1/2021	0 pCi/m3	131848004
Hatch	Air Filters	Gross Beta	116	11/8/2021	0.02149 pCi/m3	131943004
Hatch	Charcoal Ct	I-131	116	11/8/2021	0 pCi/m3	131944004
Hatch	Charcoal Ct	I-131	116	11/16/2021	0 pCi/m3	131996004
Hatch	Air Filters	Gross Beta	116	11/16/2021	0.02473 pCi/m3	131995004
Hatch	Air Filters	Gross Beta	116	11/22/2021	0.01597 pCi/m3	132024004
Hatch	Charcoal Ct	I-131	116	11/22/2021	0 pCi/m3	132025004
Hatch	Charcoal Ct	I-131	116	11/30/2021	0 pCi/m3	132103004
Hatch	Air Filters	Gross Beta	116	11/30/2021	0.02478 pCi/m3	132101004
Hatch	Charcoal Ct	I-131	116	12/6/2021	0 pCi/m3	132154004
Hatch	Air Filters	Gross Beta	116	12/6/2021	0.04183 pCi/m3	132153004
Hatch	Charcoal Ct	I-131	116	12/13/2021	0 pCi/m3	132204004
Hatch	Air Filters	Gross Beta	116	12/13/2021	0.02706 pCi/m3	132203004
Hatch	Air Filters	Gross Beta	116	12/20/2021	0.01413 pCi/m3	132264004
Hatch	Charcoal Ct	I-131	116	12/20/2021	0 pCi/m3	132266004
Hatch	Air Qtr Comp	I-131	116	12/27/2021	0 pCi/m3	132405004
Hatch	Air Filters	Gross Beta	116	12/27/2021	0.02117 pCi/m3	132327004
Hatch	Fish	K-40	170 Mullet	4/26/2021	3293.3 pCi/Kg	129298003
Hatch	Fish	Co-58	170 Sucker	4/26/2021	0 pCi/Kg	129298001
Hatch	Charcoal Ct	I-131	116	12/27/2021	0 pCi/m3	132328004
Hatch	Fish	Co-60	170 Sucker	4/26/2021	0 pCi/Kg	129298001
Hatch	River Water	Fe-59	170	1/26/2021	0 pCi/L	128295001
Hatch	Fish	Cs-134	170 Sucker	4/26/2021	0 pCi/Kg	129298001
Hatch	Fish	Be-7	170 Sucker	4/26/2021	0 pCi/Kg	129298001
Hatch	River Water	Zn-65	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	Zr-95	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	Nb-95	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	I-131	170	1/26/2021	0 pCi/L	128295001
Hatch	Fish	K-40	170 Sucker	4/26/2021	3557.9 pCi/Kg	129298001
Hatch	Vegetation	Cs-134	416	4/26/2021	0 pCi/Kg	129302001
Hatch	River Water	La-140	170	1/26/2021	0 pCi/L	128295001
Hatch	Vegetation	Be-7	416	4/26/2021	14297 pCi/Kg	129302001
Hatch	Vegetation	K-40	416	4/26/2021	3767.6 pCi/Kg	129302001
Hatch	River Water	Mn-54	170	1/26/2021	0 pCi/L	128295001
Hatch	River Water	Fe-59	170	2/23/2021	0 pCi/L	128650001
Hatch	Vegetation	Cs-137	416	4/26/2021	52.823 pCi/Kg	129302001
Hatch	Fish	Cs-137	172 Bass	4/26/2021	0 pCi/Kg	129298005
Hatch	River Water	Zn-65	170	2/23/2021	0 pCi/L	128650001
Hatch	River Water	Zr-95	170	2/23/2021	0 pCi/L	128650001
Hatch	River Water	Nb-95	170	2/23/2021	0 pCi/L	128650001
Hatch	River Water	I-131	170	2/23/2021	0 pCi/L	128650001

Hatch	Fish	Cs-137	172 Mullet	4/26/2021	0 pCi/Kg	129298006
Hatch	Fish	Cs-137	172 Sucker	4/26/2021	0 pCi/Kg	129298004
Hatch	River Water	La-140	170	2/23/2021	0 pCi/L	128650001
Hatch	Fish	Be-7	172 Bass	4/26/2021	0 pCi/Kg	129298005
Hatch	Fish	Cs-134	172 Bass	4/26/2021	0 pCi/Kg	129298005
Hatch	River Water	Mn-54	170	2/23/2021	0 pCi/L	128650001
Hatch	H-3 Water	Tritium	170	3/23/2021	0 pCi/L	129222001
Hatch	River Water	I-131	170	3/23/2021	0 pCi/L	128987001
Hatch	Fish	Co-60	172 Bass	4/26/2021	0 pCi/Kg	129298005
Hatch	Fish	Co-58	172 Bass	4/26/2021	0 pCi/Kg	129298005
Hatch	River Water	La-140	170	3/23/2021	0 pCi/L	128987001
Hatch	Fish	K-40	172 Bass	4/26/2021	3328.7 pCi/Kg	129298005
Hatch	Fish	K-40	172 Mullet	4/26/2021	3666.1 pCi/Kg	129298006
Hatch	River Water	Mn-54	170	3/23/2021	0 pCi/L	128987001
Hatch	River Water	Fe-59	170	3/23/2021	0 pCi/L	128987001
Hatch	Fish	Be-7	172 Mullet	4/26/2021	0 pCi/Kg	129298006
Hatch	Fish	Cs-134	172 Mullet	4/26/2021	0 pCi/Kg	129298006
Hatch	River Water	Zn-65	170	3/23/2021	0 pCi/L	128987001
Hatch	River Water	Zr-95	170	3/23/2021	0 pCi/L	128987001
Hatch	River Water	Nb-95	170	3/23/2021	0 pCi/L	128987001
Hatch	River Water	Fe-59	170	4/20/2021	0 pCi/L	129249001
Hatch	Fish	Co-60	172 Mullet	4/26/2021	0 pCi/Kg	129298006
Hatch	Fish	Co-58	172 Mullet	4/26/2021	0 pCi/Kg	129298006
Hatch	River Water	Zn-65	170	4/20/2021	0 pCi/L	129249001
Hatch	River Water	Zr-95	170	4/20/2021	0 pCi/L	129249001
Hatch	River Water	Nb-95	170	4/20/2021	0 pCi/L	129249001
Hatch	River Water	I-131	170	4/20/2021	0 pCi/L	129249001
Hatch	Fish	Be-7	172 Sucker	4/26/2021	0 pCi/Kg	129298004
Hatch	Fish	Cs-134	172 Sucker	4/26/2021	0 pCi/Kg	129298004
Hatch	River Water	La-140	170	4/20/2021	0 pCi/L	129249001
Hatch	Fish	Co-60	172 Sucker	4/26/2021	0 pCi/Kg	129298004
Hatch	Fish	Co-58	172 Sucker	4/26/2021	0 pCi/Kg	129298004
Hatch	River Water	Mn-54	170	4/20/2021	0 pCi/L	129249001
Hatch	Fish	K-40	172 Sucker	4/26/2021	4091.3 pCi/Kg	129298004
Hatch	Milk Gamma	Cs-137	GSP	4/27/2021	0 pCi/L	129310001
Hatch	Milk Gamma	Be-7	GSP	4/27/2021	0 pCi/L	129310001
Hatch	Milk Gamma	K-40	GSP	4/27/2021	448.13 pCi/L	129310001
Hatch	Milk Gamma	Cs-134	GSP	4/27/2021	0 pCi/L	129310001
Hatch	River Water	Nb-95	170	5/17/2021	0 pCi/L	129519001
Hatch	River Water	I-131	170	5/17/2021	0 pCi/L	129519001
Hatch	Sediment	K-40	170	5/4/2021	5260.3 pCi/Kg	129370001
Hatch	Sediment	Co-58	170	5/4/2021	0 pCi/Kg	129370001
Hatch	River Water	La-140	170	5/17/2021	0 pCi/L	129519001
Hatch	Sediment	Be-7	170	5/4/2021	0 pCi/Kg	129370001
Hatch	Sediment	Cs-137	170	5/4/2021	0 pCi/Kg	129370001
Hatch	River Water	Zr-95	170	5/17/2021	0 pCi/L	129519001
Hatch	River Water	Zn-65	170	5/17/2021	0 pCi/L	129519001
Hatch	Sediment	Cs-134	170	5/4/2021	0 pCi/Kg	129370001
Hatch	Sediment	Co-60	170	5/4/2021	0 pCi/Kg	129370001
Hatch	River Water	Fe-59	170	5/17/2021	0 pCi/L	129519001
Hatch	River Water	Mn-54	170	5/17/2021	0 pCi/L	129519001
Hatch	River Water	I-131	170	6/29/2021	0 pCi/L	130143001
Hatch	Sediment	K-40	172	5/4/2021	5553.9 pCi/Kg	129370002
Hatch	Sediment	Be-7	172	5/4/2021	207.14 pCi/Kg	129370002
Hatch	River Water	La-140	170	6/29/2021	0 pCi/L	130143001
Hatch	Sediment	Cs-134	172	5/4/2021	0 pCi/Kg	129370002
Hatch	Sediment	Co-60	172	5/4/2021	0 pCi/Kg	129370002
Hatch	River Water	Mn-54	170	6/29/2021	0 pCi/L	130143001
Hatch	River Water	Fe-59	170	6/29/2021	0 pCi/L	130143001
Hatch	Sediment	Cs-137	172	5/4/2021	0 pCi/Kg	129370002
Hatch	Sediment	Co-58	172	5/4/2021	0 pCi/Kg	129370002
Hatch	River Water	Zn-65	170	6/29/2021	0 pCi/L	130143001
Hatch	River Water	Zr-95	170	6/29/2021	0 pCi/L	130143001
Hatch	River Water	Nb-95	170	6/29/2021	0 pCi/L	130143001
Hatch	H-3 Water	Tritium	170	6/29/2021	0 pCi/L	130440001
Hatch	River Water	Fe-59	170	7/26/2021	0 pCi/L	130495001
Hatch	Milk Gamma	Cs-137	GSP	5/11/2021	0 pCi/L	129443001
Hatch	Milk Gamma	Be-7	GSP	5/11/2021	0 pCi/L	129443001
Hatch	River Water	Zn-65	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	Zr-95	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	I-131	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	Nb-95	170	7/26/2021	0 pCi/L	130495001
Hatch	Milk Gamma	Cs-134	GSP	5/11/2021	0 pCi/L	129443001
Hatch	Milk Gamma	K-40	GSP	5/11/2021	889.98 pCi/L	129443001
Hatch	River Water	La-140	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	Be-7	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	K-40	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	Mn-54	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	I-131	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Cs-137	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	Cs-134	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	Co-60	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	La-140	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Co-58	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	Mn-54	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Fe-59	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Cs-134	170	5/17/2021	0 pCi/L	129519001

Hatch	River Water	Cs-137	170	5/17/2021	0 pCi/L	129519001
Hatch	River Water	Zn-65	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Zr-95	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Nb-95	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Be-7	170	5/17/2021	0 pCi/L	129519001
Hatch	River Water	K-40	170	5/17/2021	0 pCi/L	129519001
Hatch	River Water	Zn-65	170	9/20/2021	0 pCi/L	131372001
Hatch	River Water	Zr-95	170	9/20/2021	0 pCi/L	131372001
Hatch	River Water	Nb-95	170	9/20/2021	0 pCi/L	131372001
Hatch	River Water	I-131	170	9/20/2021	0 pCi/L	131372001
Hatch	River Water	Co-60	170	5/17/2021	0 pCi/L	129519001
Hatch	River Water	Co-58	170	5/17/2021	0 pCi/L	129519001
Hatch	River Water	La-140	170	9/20/2021	0 pCi/L	131372001
Hatch	Milk Gamma	Cs-137	GSP	5/25/2021	0 pCi/L	129603001
Hatch	Milk Gamma	K-40	GSP	5/25/2021	1475 pCi/L	129603001
Hatch	River Water	Mn-54	170	9/20/2021	0 pCi/L	131372001
Hatch	River Water	Fe-59	170	9/20/2021	0 pCi/L	131372001
Hatch	H-3 Water	Tritium	170	9/20/2021	115 pCi/L	131709001
Hatch	River Water	Mn-54	170	10/18/2021	0 pCi/L	131691001
Hatch	River Water	Fe-59	170	10/18/2021	0 pCi/L	131691001
Hatch	Milk Gamma	Be-7	GSP	5/25/2021	0 pCi/L	129603001
Hatch	Milk Gamma	Cs-134	GSP	5/25/2021	0 pCi/L	129603001
Hatch	River Water	Zn-65	170	10/18/2021	0 pCi/L	131691001
Hatch	River Water	Zr-95	170	10/18/2021	0 pCi/L	131691001
Hatch	River Water	Nb-95	170	10/18/2021	0 pCi/L	131691001
Hatch	Vegetation	K-40	416	6/1/2021	3243.5 pCi/Kg	129661001
Hatch	River Water	I-131	170	10/18/2021	0 pCi/L	131691001
Hatch	Vegetation	Be-7	416	6/1/2021	2663.8 pCi/Kg	129661001
Hatch	Vegetation	Cs-134	416	6/1/2021	0 pCi/Kg	129661001
Hatch	River Water	La-140	170	10/18/2021	0 pCi/L	131691001
Hatch	Vegetation	Cs-137	416	6/1/2021	0 pCi/Kg	129661001
Hatch	Vegetation	Be-7	112	6/1/2021	1407.6 pCi/Kg	129661002
Hatch	Vegetation	K-40	112	6/1/2021	5477 pCi/Kg	129661002
Hatch	Vegetation	Cs-134	112	6/1/2021	0 pCi/Kg	129661002
Hatch	Vegetation	Cs-137	112	6/1/2021	0 pCi/Kg	129661002
Hatch	River Water	Nb-95	170	11/30/2021	0 pCi/L	132099001
Hatch	River Water	I-131	170	11/30/2021	0 pCi/L	132099001
Hatch	Vegetation	Cs-134	106	6/1/2021	0 pCi/Kg	129661003
Hatch	Vegetation	Be-7	106	6/1/2021	2792.1 pCi/Kg	129661003
Hatch	River Water	La-140	170	11/30/2021	0 pCi/L	132099001
Hatch	Vegetation	K-40	106	6/1/2021	6875.9 pCi/Kg	129661003
Hatch	Vegetation	Cs-137	106	6/1/2021	36.97 pCi/Kg	129661003
Hatch	River Water	Zr-95	170	11/30/2021	0 pCi/L	132099001
Hatch	River Water	Zn-65	170	11/30/2021	0 pCi/L	132099001
Hatch	Milk Gamma	Cs-137	GSP	6/7/2021	0 pCi/L	129794001
Hatch	River Water	Fe-59	170	11/30/2021	0 pCi/L	132099001
Hatch	Milk Gamma	Cs-134	GSP	6/7/2021	0 pCi/L	129794001
Hatch	River Water	Mn-54	170	11/30/2021	0 pCi/L	132099001
Hatch	River Water	I-131	170	12/28/2021	0 pCi/L	132308001
Hatch	Milk Gamma	K-40	GSP	6/7/2021	1436.6 pCi/L	129794001
Hatch	Milk Gamma	Be-7	GSP	6/7/2021	0 pCi/L	129794001
Hatch	River Water	La-140	170	12/28/2021	0 pCi/L	132308001
Hatch	Milk Gamma	Cs-137	GSP	6/21/2021	0 pCi/L	130019001
Hatch	Milk Gamma	Cs-134	GSP	6/21/2021	0 pCi/L	130019001
Hatch	River Water	Mn-54	170	12/28/2021	0 pCi/L	132308001
Hatch	River Water	Fe-59	170	12/28/2021	0 pCi/L	132308001
Hatch	Milk Gamma	K-40	GSP	6/21/2021	1310.7 pCi/L	130019001
Hatch	Milk Gamma	Be-7	GSP	6/21/2021	0 pCi/L	130019001
Hatch	River Water	Zn-65	170	12/28/2021	0 pCi/L	132308001
Hatch	River Water	Zr-95	170	12/28/2021	0 pCi/L	132308001
Hatch	River Water	Nb-95	170	12/28/2021	0 pCi/L	132308001
Hatch	Vegetation	K-40	416	6/28/2021	1886.2 pCi/Kg	130144001
Hatch	Vegetation	Be-7	416	6/28/2021	503.42 pCi/Kg	130144001
Hatch	Fish	Mn-54	170 Common Carp	10/25/2021	0 pCi/Kg	131796003
Hatch	Fish	Fe-59	170 Common Carp	10/25/2021	0 pCi/Kg	131796003
Hatch	Vegetation	Cs-134	416	6/28/2021	0 pCi/Kg	130144001
Hatch	Vegetation	Cs-137	416	6/28/2021	0 pCi/Kg	130144001
Hatch	Fish	Zn-65	170 Common Carp	10/25/2021	0 pCi/Kg	131796003
Hatch	Air Qtr Comp	Cs-134	116	6/28/2021	0 pCi/m3	130248004
Hatch	Milk Gamma	I-131	GSP	3/16/2021	0 pCi/L	128930001
Hatch	Milk Gamma	I-131	GSP	3/30/2021	0 pCi/L	129043001
Hatch	Air Qtr Comp	Cs-137	116	6/28/2021	0 pCi/m3	130248004
Hatch	Fish	Zn-65	170 Bass	4/26/2021	0 pCi/Kg	129298002
Hatch	Air Qtr Comp	Be-7	116	6/28/2021	0.08581 pCi/m3	130248004
Hatch	Air Qtr Comp	Cs-134	112	6/28/2021	0 pCi/m3	130248003
Hatch	Fish	Fe-59	170 Bass	4/26/2021	0 pCi/Kg	129298002
Hatch	Air Qtr Comp	Cs-137	112	6/28/2021	0 pCi/m3	130248003
Hatch	Fish	Mn-54	170 Bass	4/26/2021	0 pCi/Kg	129298002
Hatch	Air Qtr Comp	Be-7	112	6/28/2021	0.112 pCi/m3	130248003
Hatch	Vegetation	Be-7	112	6/28/2021	1340.8 pCi/Kg	130144002
Hatch	Vegetation	K-40	112	6/28/2021	3300.5 pCi/Kg	130144002
Hatch	Milk Gamma	I-131	GSP	4/13/2021	0 pCi/L	129175001
Hatch	Vegetation	Cs-134	112	6/28/2021	0 pCi/Kg	130144002
Hatch	Fish	Zn-65	170 Bass	10/25/2021	0 pCi/Kg	131796002
Hatch	Vegetation	Cs-137	112	6/28/2021	0 pCi/Kg	130144002
Hatch	Air Qtr Comp	Be-7	107	6/28/2021	0.08936 pCi/m3	130248002
Hatch	Fish	Fe-59	170 Bass	10/25/2021	0 pCi/Kg	131796002

Hatch	Fish	Mn-54	170 Bass	10/25/2021	0 pCi/Kg	131796002
Hatch	Air Qtr Comp	Cs-137	107	6/28/2021	0 pCi/m3	130248002
Hatch	Fish	Fe-59	170 Catfish	10/25/2021	0 pCi/Kg	131796001
Hatch	Fish	Mn-54	170 Catfish	10/25/2021	0 pCi/Kg	131796001
Hatch	Air Qtr Comp	Cs-134	107	6/28/2021	0 pCi/m3	130248002
Hatch	Vegetation	Cs-134	106	6/28/2021	0 pCi/Kg	130144003
Hatch	Fish	Zn-65	170 Catfish	10/25/2021	0 pCi/Kg	131796001
Hatch	Vegetation	Be-7	106	6/28/2021	2551.8 pCi/Kg	130144003
Hatch	Milk Gamma	I-131	GSP	4/27/2021	0 pCi/L	129310001
Hatch	Vegetation	K-40	106	6/28/2021	4358.3 pCi/Kg	130144003
Hatch	Vegetation	Cs-137	106	6/28/2021	0 pCi/Kg	130144003
Hatch	Fish	Fe-59	170 Mullet	4/26/2021	0 pCi/Kg	129298003
Hatch	Air Qtr Comp	Cs-134	309	6/28/2021	0 pCi/m3	130248006
Hatch	Air Qtr Comp	Cs-137	309	6/28/2021	0 pCi/m3	130248006
Hatch	Fish	Zn-65	170 Mullet	4/26/2021	0 pCi/Kg	129298003
Hatch	Air Qtr Comp	Be-7	309	6/28/2021	0.1094 pCi/m3	130248006
Hatch	Air Qtr Comp	Cs-137	304	6/28/2021	0 pCi/m3	130248005
Hatch	Milk Gamma	I-131	GSP	5/11/2021	0 pCi/L	129443001
Hatch	Fish	Mn-54	170 Mullet	4/26/2021	0 pCi/Kg	129298003
Hatch	Fish	Mn-54	170 Sucker	4/26/2021	0 pCi/Kg	129298001
Hatch	Fish	Fe-59	170 Sucker	4/26/2021	0 pCi/Kg	129298001
Hatch	Air Qtr Comp	Cs-134	304	6/28/2021	0 pCi/m3	130248005
Hatch	Air Qtr Comp	Be-7	304	6/28/2021	0.1007 pCi/m3	130248005
Hatch	Fish	Zn-65	170 Sucker	4/26/2021	0 pCi/Kg	129298001
Hatch	Air Qtr Comp	Cs-134	103	6/28/2021	0 pCi/m3	130248001
Hatch	Air Qtr Comp	Cs-137	103	6/28/2021	0 pCi/m3	130248001
Hatch	Milk Gamma	I-131	GSP	5/25/2021	0 pCi/L	129603001
Hatch	Air Qtr Comp	Be-7	103	6/28/2021	0.09741 pCi/m3	130248001
Hatch	River Water	Zr-95	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Nb-95	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	I-131	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Co-58	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	Co-60	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	La-140	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Cs-134	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	Cs-137	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	Mn-54	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Fe-59	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Be-7	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	K-40	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	Zn-65	172	1/26/2021	0 pCi/L	128295002
Hatch	River Water	Cs-134	170	6/29/2021	0 pCi/L	130143001
Hatch	River Water	Cs-137	170	6/29/2021	0 pCi/L	130143001
Hatch	River Water	Be-7	170	6/29/2021	0 pCi/L	130143001
Hatch	River Water	La-140	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	K-40	170	6/29/2021	0 pCi/L	130143001
Hatch	River Water	Mn-54	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Fe-59	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Co-58	170	6/29/2021	0 pCi/L	130143001
Hatch	River Water	Co-60	170	6/29/2021	0 pCi/L	130143001
Hatch	River Water	Zn-65	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Zr-95	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	Nb-95	172	2/23/2021	0 pCi/L	128650002
Hatch	River Water	I-131	172	2/23/2021	0 pCi/L	128650002
Hatch	Milk Gamma	Cs-137	GSP	7/6/2021	0 pCi/L	130193001
Hatch	Milk Gamma	Cs-134	GSP	7/6/2021	0 pCi/L	130193001
Hatch	River Water	Mn-54	172	3/23/2021	0 pCi/L	128987002
Hatch	River Water	Fe-59	172	3/23/2021	0 pCi/L	128987002
Hatch	Milk Gamma	Be-7	GSP	7/6/2021	0 pCi/L	130193001
Hatch	Milk Gamma	K-40	GSP	7/6/2021	338.63 pCi/L	130193001
Hatch	River Water	Zn-65	172	3/23/2021	0 pCi/L	128987002
Hatch	River Water	Zr-95	172	3/23/2021	0 pCi/L	128987002
Hatch	River Water	Nb-95	172	3/23/2021	0 pCi/L	128987002
Hatch	River Water	I-131	172	3/23/2021	0 pCi/L	128987002
Hatch	Milk Gamma	Cs-137	GSP	7/20/2021	0 pCi/L	130427001
Hatch	Milk Gamma	Be-7	GSP	7/20/2021	0 pCi/L	130427001
Hatch	River Water	La-140	172	3/23/2021	0 pCi/L	128987002
Hatch	H-3 Water	Tritium	172	3/23/2021	98.3 pCi/L	129222002
Hatch	River Water	La-140	172	4/20/2021	0 pCi/L	129249002
Hatch	Milk Gamma	K-40	GSP	7/20/2021	411.75 pCi/L	130427001
Hatch	Milk Gamma	Cs-134	GSP	7/20/2021	0 pCi/L	130427001
Hatch	River Water	Mn-54	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	Fe-59	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	Cs-134	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	Cs-137	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	Zn-65	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	Zr-95	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	Nb-95	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	I-131	172	4/20/2021	0 pCi/L	129249002
Hatch	River Water	Be-7	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	K-40	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	Co-58	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	Co-60	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	Co-58	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	Co-60	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	Cs-134	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	Cs-137	170	7/26/2021	0 pCi/L	130495001

Hatch	River Water	La-140	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	Be-7	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	K-40	170	7/26/2021	0 pCi/L	130495001
Hatch	River Water	Zr-95	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	Nb-95	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	I-131	172	5/17/2021	0 pCi/L	129519002
Hatch	River Water	Mn-54	172	5/17/2021	0 pCi/L	129519002
Hatch	Vegetation	Cs-134	112	7/26/2021	0 pCi/Kg	130496002
Hatch	Vegetation	Be-7	112	7/26/2021	2065.4 pCi/Kg	130496002
Hatch	River Water	Zn-65	172	5/17/2021	0 pCi/L	129519002
Hatch	Vegetation	K-40	112	7/26/2021	3941.2 pCi/Kg	130496002
Hatch	Vegetation	Cs-137	112	7/26/2021	0 pCi/Kg	130496002
Hatch	River Water	Fe-59	172	5/17/2021	0 pCi/L	129519002
Hatch	H-3 Water	Tritium	172	6/29/2021	0 pCi/L	130440002
Hatch	River Water	Mn-54	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	Fe-59	172	6/29/2021	0 pCi/L	130143002
Hatch	Vegetation	K-40	106	7/26/2021	3270.1 pCi/Kg	130496003
Hatch	Vegetation	Be-7	106	7/26/2021	2876.8 pCi/Kg	130496003
Hatch	River Water	Zn-65	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	Zr-95	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	Nb-95	172	6/29/2021	0 pCi/L	130143002
Hatch	River Water	I-131	172	6/29/2021	0 pCi/L	130143002
Hatch	Vegetation	Cs-134	106	7/26/2021	0 pCi/Kg	130496003
Hatch	Vegetation	Cs-137	106	7/26/2021	34.38 pCi/Kg	130496003
Hatch	River Water	La-140	172	6/29/2021	0 pCi/L	130143002
Hatch	Vegetation	Cs-134	416	7/26/2021	0 pCi/Kg	130496001
Hatch	Vegetation	Be-7	416	7/26/2021	3107.5 pCi/Kg	130496001
Hatch	River Water	Zr-95	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	Nb-95	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	I-131	172	7/26/2021	0 pCi/L	130495002
Hatch	Vegetation	K-40	416	7/26/2021	3956.7 pCi/Kg	130496001
Hatch	Vegetation	Cs-137	416	7/26/2021	0 pCi/Kg	130496001
Hatch	River Water	La-140	172	7/26/2021	0 pCi/L	130495002
Hatch	Milk Gamma	Cs-137	GSP	8/3/2021	0 pCi/L	130591001
Hatch	Milk Gamma	Be-7	GSP	8/3/2021	0 pCi/L	130591001
Hatch	River Water	Mn-54	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	Fe-59	172	7/26/2021	0 pCi/L	130495002
Hatch	Milk Gamma	Cs-134	GSP	8/3/2021	0 pCi/L	130591001
Hatch	Milk Gamma	K-40	GSP	8/3/2021	408.1 pCi/L	130591001
Hatch	River Water	Zn-65	172	7/26/2021	0 pCi/L	130495002
Hatch	River Water	La-140	172	8/23/2021	0 pCi/L	130951002
Hatch	Milk Gamma	Cs-137	GSP	8/17/2021	0 pCi/L	130840001
Hatch	Milk Gamma	K-40	GSP	8/17/2021	2171.2 pCi/L	130840001
Hatch	River Water	Mn-54	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	Fe-59	172	8/23/2021	0 pCi/L	130951002
Hatch	Milk Gamma	Be-7	GSP	8/17/2021	0 pCi/L	130840001
Hatch	Milk Gamma	Cs-134	GSP	8/17/2021	0 pCi/L	130840001
Hatch	River Water	Zn-65	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	Zr-95	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	Nb-95	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	I-131	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	Be-7	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	K-40	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	Co-58	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	Co-60	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	La-140	172	9/21/2021	0 pCi/L	131372002
Hatch	River Water	Cs-134	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	Cs-137	172	8/23/2021	0 pCi/L	130951002
Hatch	River Water	Mn-54	172	9/21/2021	0 pCi/L	131372002
Hatch	River Water	Fe-59	172	9/21/2021	0 pCi/L	131372002
Hatch	River Water	Cs-134	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Cs-137	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Zn-65	172	9/21/2021	0 pCi/L	131372002
Hatch	River Water	Zr-95	172	9/21/2021	0 pCi/L	131372002
Hatch	River Water	I-131	172	9/21/2021	0 pCi/L	131372002
Hatch	River Water	Nb-95	172	9/21/2021	0 pCi/L	131372002
Hatch	H-3 Water	Tritium	172	9/21/2021	356 pCi/L	131709002
Hatch	River Water	Be-7	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	K-40	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	I-131	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	Nb-95	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	Zr-95	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	Zn-65	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	Co-58	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Co-60	170	8/23/2021	0 pCi/L	130951001
Hatch	River Water	Fe-59	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	Mn-54	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	La-140	172	10/18/2021	0 pCi/L	131691002
Hatch	Vegetation	K-40	112	8/30/2021	3916.1 pCi/Kg	131046002
Hatch	Vegetation	Be-7	112	8/30/2021	2832.7 pCi/Kg	131046002
Hatch	Vegetation	Cs-134	112	8/30/2021	0 pCi/Kg	131046002
Hatch	Vegetation	Cs-137	112	8/30/2021	0 pCi/Kg	131046002
Hatch	Vegetation	K-40	106	8/30/2021	3065 pCi/Kg	131046003
Hatch	Vegetation	Be-7	106	8/30/2021	3476.4 pCi/Kg	131046003
Hatch	Vegetation	Cs-134	106	8/30/2021	0 pCi/Kg	131046003
Hatch	Vegetation	Cs-137	106	8/30/2021	0 pCi/Kg	131046003
Hatch	Vegetation	Cs-134	416	8/30/2021	0 pCi/Kg	131046001

Hatch	Vegetation	Be-7	416		8/30/2021	1670.7 pCi/Kg	131046001
Hatch	Vegetation	K-40	416		8/30/2021	3999.9 pCi/Kg	131046001
Hatch	Vegetation	Cs-137	416		8/30/2021	0 pCi/Kg	131046001
Hatch	River Water	Mn-54	172		12/1/2021	0 pCi/L	132099002
Hatch	River Water	Fe-59	172		12/1/2021	0 pCi/L	132099002
Hatch	River Water	Zr-95	172		12/1/2021	0 pCi/L	132099002
Hatch	Milk Gamma	Cs-137	GSP		8/31/2021	0 pCi/L	131042001
Hatch	Milk Gamma	Be-7	GSP		8/31/2021	0 pCi/L	131042001
Hatch	River Water	Zn-65	172		12/1/2021	0 pCi/L	132099002
Hatch	River Water	Nb-95	172		12/1/2021	0 pCi/L	132099002
Hatch	River Water	I-131	172		12/1/2021	0 pCi/L	132099002
Hatch	Milk Gamma	K-40	GSP		8/31/2021	342.28 pCi/L	131042001
Hatch	Milk Gamma	Cs-134	GSP		8/31/2021	0 pCi/L	131042001
Hatch	River Water	La-140	172		12/1/2021	0 pCi/L	132099002
Hatch	Milk Gamma	Cs-137	GSP		9/14/2021	0 pCi/L	131224001
Hatch	Milk Gamma	Be-7	GSP		9/14/2021	0 pCi/L	131224001
Hatch	Milk Gamma	Cs-134	GSP		9/14/2021	0 pCi/L	131224001
Hatch	River Water	Mn-54	172		12/28/2021	0 pCi/L	132308002
Hatch	River Water	Fe-59	172		12/28/2021	0 pCi/L	132308002
Hatch	Milk Gamma	K-40	GSP		9/14/2021	341.17 pCi/L	131224001
Hatch	River Water	Co-58	170		9/20/2021	0 pCi/L	131372001
Hatch	River Water	Zn-65	172		12/28/2021	0 pCi/L	132308002
Hatch	River Water	Zr-95	172		12/28/2021	0 pCi/L	132308002
Hatch	River Water	Nb-95	172		12/28/2021	0 pCi/L	132308002
Hatch	River Water	I-131	172		12/28/2021	0 pCi/L	132308002
Hatch	River Water	Co-60	170		9/20/2021	0 pCi/L	131372001
Hatch	River Water	Cs-137	170		9/20/2021	0 pCi/L	131372001
Hatch	River Water	La-140	172		12/28/2021	0 pCi/L	132308002
Hatch	Fish	Mn-54	172 Common Carp		10/25/2021	0 pCi/Kg	131796005
Hatch	River Water	Cs-134	170		9/20/2021	0 pCi/L	131372001
Hatch	River Water	Be-7	170		9/20/2021	0 pCi/L	131372001
Hatch	Milk Gamma	I-131	GSP		6/7/2021	0 pCi/L	129794001
Hatch	River Water	K-40	170		9/20/2021	0 pCi/L	131372001
Hatch	Fish	Zn-65	172 Common Carp		10/25/2021	0 pCi/Kg	131796005
Hatch	River Water	Cs-134	172		9/21/2021	0 pCi/L	131372002
Hatch	River Water	Cs-137	172		9/21/2021	0 pCi/L	131372002
Hatch	Fish	Fe-59	172 Common Carp		10/25/2021	0 pCi/Kg	131796005
Hatch	Fish	Mn-54	172 Bass		4/26/2021	0 pCi/Kg	129298005
Hatch	River Water	Be-7	172		9/21/2021	0 pCi/L	131372002
Hatch	Milk Gamma	I-131	GSP		6/21/2021	0 pCi/L	130019001
Hatch	Fish	Fe-59	172 Bass		4/26/2021	0 pCi/Kg	129298005
Hatch	River Water	K-40	172		9/21/2021	0 pCi/L	131372002
Hatch	Fish	Zn-65	172 Bass		4/26/2021	0 pCi/Kg	129298005
Hatch	River Water	Co-58	172		9/21/2021	0 pCi/L	131372002
Hatch	River Water	Co-60	172		9/21/2021	0 pCi/L	131372002
Hatch	Air Qtr Comp	Cs-134	112		9/27/2021	0 pCi/m3	131792003
Hatch	Fish	Mn-54	172 Bass		10/25/2021	0 pCi/Kg	131796006
Hatch	Fish	Fe-59	172 Bass		10/25/2021	0 pCi/Kg	131796006
Hatch	Air Qtr Comp	Cs-137	112		9/27/2021	0 pCi/m3	131792003
Hatch	Air Qtr Comp	Be-7	112		9/27/2021	0.08195 pCi/m3	131792003
Hatch	Fish	Zn-65	172 Bass		10/25/2021	0 pCi/Kg	131796006
Hatch	Vegetation	Cs-134	112		9/27/2021	0 pCi/Kg	131447002
Hatch	Milk Gamma	I-131	GSP		7/6/2021	0 pCi/L	130193001
Hatch	Vegetation	Be-7	112		9/27/2021	3260.1 pCi/Kg	131447002
Hatch	Vegetation	K-40	112		9/27/2021	3895.6 pCi/Kg	131447002
Hatch	Vegetation	Cs-137	112		9/27/2021	0 pCi/Kg	131447002
Hatch	Air Qtr Comp	Cs-134	107		9/27/2021	0 pCi/m3	131792002
Hatch	Milk Gamma	I-131	GSP		7/20/2021	0 pCi/L	130427001
Hatch	Air Qtr Comp	Cs-137	107		9/27/2021	0 pCi/m3	131792002
Hatch	Fish	Zn-65	172 Mullet		4/26/2021	0 pCi/Kg	129298006
Hatch	Air Qtr Comp	Be-7	107		9/27/2021	0.09653 pCi/m3	131792002
Hatch	Vegetation	Cs-134	106		9/27/2021	0 pCi/Kg	131447003
Hatch	Fish	Fe-59	172 Mullet		4/26/2021	0 pCi/Kg	129298006
Hatch	Fish	Mn-54	172 Mullet		4/26/2021	0 pCi/Kg	129298006
Hatch	Vegetation	Be-7	106		9/27/2021	2241.8 pCi/Kg	131447003
Hatch	Vegetation	K-40	106		9/27/2021	1753.4 pCi/Kg	131447003
Hatch	Vegetation	Cs-137	106		9/27/2021	60.546 pCi/Kg	131447003
Hatch	Fish	Zn-65	172 Mullet		10/25/2021	0 pCi/Kg	131796007
Hatch	Air Qtr Comp	Cs-134	309		9/27/2021	0 pCi/m3	131792006
Hatch	Air Qtr Comp	Cs-137	309		9/27/2021	0 pCi/m3	131792006
Hatch	Fish	Fe-59	172 Mullet		10/25/2021	0 pCi/Kg	131796007
Hatch	Fish	Mn-54	172 Mullet		10/25/2021	0 pCi/Kg	131796007
Hatch	Milk Gamma	I-131	GSP		8/3/2021	0 pCi/L	130591001
Hatch	Air Qtr Comp	Be-7	309		9/27/2021	0.07963 pCi/m3	131792006
Hatch	Milk Gamma	I-131	GSP		8/17/2021	0 pCi/L	130840001
Hatch	Air Qtr Comp	Cs-137	304		9/27/2021	0 pCi/m3	131792005
Hatch	Fish	Zn-65	172 Sucker		4/26/2021	0 pCi/Kg	129298004
Hatch	Air Qtr Comp	Cs-134	304		9/27/2021	0 pCi/m3	131792005
Hatch	Air Qtr Comp	Be-7	304		9/27/2021	0.09363 pCi/m3	131792005
Hatch	Fish	Fe-59	172 Sucker		4/26/2021	0 pCi/Kg	129298004
Hatch	Fish	Mn-54	172 Sucker		4/26/2021	0 pCi/Kg	129298004
Hatch	Air Qtr Comp	Cs-137	103		9/27/2021	0 pCi/m3	131792001
Hatch	Air Qtr Comp	Be-7	103		9/27/2021	0.06937 pCi/m3	131792001
Hatch	Air Qtr Comp	Cs-134	103		9/27/2021	0 pCi/m3	131792001
Hatch	Milk Gamma	I-131	GSP		8/31/2021	0 pCi/L	131042001
Hatch	Air Qtr Comp	Cs-134	116		9/27/2021	0 pCi/m3	131792004
Hatch	Fish	Zn-65	172 Sucker		10/25/2021	0 pCi/Kg	131796004

Hatch	Air Qtr Comp	Cs-137	116	9/27/2021	0 pCi/m3	131792004
Hatch	Air Qtr Comp	Be-7	116	9/27/2021	0.1108 pCi/m3	131792004
Hatch	Fish	Fe-59	172 Sucker	10/25/2021	0 pCi/Kg	131796004
Hatch	Fish	Mn-54	172 Sucker	10/25/2021	0 pCi/Kg	131796004
Hatch	Charcoal Ct	I-131	304	1/4/2021	0 pCi/m3	127932005
Hatch	Air Filters	Gross Beta	304	1/4/2021	0.01933 pCi/m3	127931005
Hatch	Air Filters	Gross Beta	304	1/11/2021	0.02952 pCi/m3	128029005
Hatch	Charcoal Ct	I-131	304	1/11/2021	0 pCi/m3	128030005
Hatch	Air Filters	Gross Beta	304	1/19/2021	0.0243 pCi/m3	128177005
Hatch	Charcoal Ct	I-131	304	1/19/2021	0 pCi/m3	128178005
Hatch	Air Filters	Gross Beta	304	1/25/2021	0.02238 pCi/m3	128293005
Hatch	Charcoal Ct	I-131	304	1/25/2021	0 pCi/m3	128294005
Hatch	Charcoal Ct	I-131	304	2/1/2021	0 pCi/m3	128354005
Hatch	Air Filters	Gross Beta	304	2/1/2021	0.02275 pCi/m3	128353005
Hatch	Air Filters	Gross Beta	304	2/8/2021	0.01831 pCi/m3	128429005
Hatch	Charcoal Ct	I-131	304	2/8/2021	0 pCi/m3	128430005
Hatch	Charcoal Ct	I-131	304	2/15/2021	0 pCi/m3	128568005
Hatch	Air Filters	Gross Beta	304	2/15/2021	0.009444 pCi/m3	128567005
Hatch	Charcoal Ct	I-131	304	2/22/2021	0 pCi/m3	128649005
Hatch	Air Filters	Gross Beta	304	2/22/2021	0.02162 pCi/m3	128648005
Hatch	Air Filters	Gross Beta	304	3/1/2021	0.01985 pCi/m3	128759005
Hatch	Charcoal Ct	I-131	304	3/1/2021	0 pCi/m3	128760005
Hatch	Charcoal Ct	I-131	304	3/8/2021	0 pCi/m3	128843005
Hatch	Air Filters	Gross Beta	304	3/8/2021	0.02153 pCi/m3	128842005
Hatch	Air Filters	Gross Beta	304	3/15/2021	0.02732 pCi/m3	128928005
Hatch	Charcoal Ct	I-131	304	3/15/2021	0 pCi/m3	128929005
Hatch	Air Filters	Gross Beta	304	3/22/2021	0.02016 pCi/m3	128997005
Hatch	Charcoal Ct	I-131	304	3/22/2021	0 pCi/m3	128998005
Hatch	Vegetation	Cs-134	416	9/27/2021	0 pCi/Kg	131447001
Hatch	Vegetation	Be-7	416	9/27/2021	1248 pCi/Kg	131447001
Hatch	Charcoal Ct	I-131	304	3/29/2021	0 pCi/m3	129041005
Hatch	Air Qtr Comp	I-131	304	3/29/2021	0 pCi/m3	129160005
Hatch	Air Filters	Gross Beta	304	3/29/2021	0.01424 pCi/m3	129040005
Hatch	Vegetation	K-40	416	9/27/2021	3884.7 pCi/Kg	131447001
Hatch	Charcoal Ct	I-131	304	4/5/2021	0 pCi/m3	129118005
Hatch	Air Filters	Gross Beta	304	4/5/2021	0.02399 pCi/m3	129117005
Hatch	Charcoal Ct	I-131	304	4/13/2021	0 pCi/m3	129177005
Hatch	Air Filters	Gross Beta	304	4/13/2021	0.02837 pCi/m3	129176005
Hatch	Air Filters	Gross Beta	304	4/19/2021	0.03173 pCi/m3	129255005
Hatch	Charcoal Ct	I-131	304	4/19/2021	0 pCi/m3	129256005
Hatch	Charcoal Ct	I-131	304	4/26/2021	0 pCi/m3	129301005
Hatch	Air Filters	Gross Beta	304	4/26/2021	0.02702 pCi/m3	129300005
Hatch	Charcoal Ct	I-131	304	5/3/2021	0 pCi/m3	129369005
Hatch	Air Filters	Gross Beta	304	5/3/2021	0.02777 pCi/m3	129368005
Hatch	Air Filters	Gross Beta	304	5/10/2021	0.02288 pCi/m3	129447005
Hatch	Charcoal Ct	I-131	304	5/10/2021	0 pCi/m3	129448005
Hatch	Air Filters	Gross Beta	304	5/18/2021	0.02304 pCi/m3	129517005
Hatch	Charcoal Ct	I-131	304	5/18/2021	0 pCi/m3	129518005
Hatch	Air Filters	Gross Beta	304	5/24/2021	0.01726 pCi/m3	129598004
Hatch	Charcoal Ct	I-131	304	5/24/2021	0 pCi/m3	129599004
Hatch	Charcoal Ct	I-131	304	6/1/2021	0 pCi/m3	129660005
Hatch	Air Filters	Gross Beta	304	6/1/2021	0.02565 pCi/m3	129659005
Hatch	Air Filters	Gross Beta	304	6/7/2021	0.01193 pCi/m3	129777005
Hatch	Charcoal Ct	I-131	304	6/7/2021	0 pCi/m3	129778005
Hatch	Air Filters	Gross Beta	304	6/14/2021	0.01142 pCi/m3	129919005
Hatch	Charcoal Ct	I-131	304	6/14/2021	0 pCi/m3	129920005
Hatch	Charcoal Ct	I-131	304	6/21/2021	0 pCi/m3	130021005
Hatch	Air Filters	Gross Beta	304	6/21/2021	0.02354 pCi/m3	130020005
Hatch	Charcoal Ct	I-131	304	6/28/2021	0 pCi/m3	130142005
Hatch	Vegetation	Cs-137	416	9/27/2021	0 pCi/Kg	131447001
Hatch	Milk Gamma	Cs-137	GSP	9/28/2021	0 pCi/L	131426001
Hatch	Air Qtr Comp	I-131	304	6/28/2021	0 pCi/m3	130248005
Hatch	Milk Gamma	Cs-134	GSP	9/28/2021	0 pCi/L	131426001
Hatch	Air Filters	Gross Beta	304	6/28/2021	0.01592 pCi/m3	130141005
Hatch	Charcoal Ct	I-131	304	7/6/2021	0 pCi/m3	130195005
Hatch	Air Filters	Gross Beta	304	7/6/2021	0.01637 pCi/m3	130194005
Hatch	Charcoal Ct	I-131	304	7/12/2021	0 pCi/m3	130293005
Hatch	Air Filters	Gross Beta	304	7/12/2021	0.01104 pCi/m3	130292005
Hatch	Air Filters	Gross Beta	304	7/19/2021	0.01455 pCi/m3	130424005
Hatch	Charcoal Ct	I-131	304	7/19/2021	0 pCi/m3	130425005
Hatch	Charcoal Ct	I-131	304	7/26/2021	0 pCi/m3	130494005
Hatch	Air Filters	Gross Beta	304	7/26/2021	0.0181 pCi/m3	130493005
Hatch	Air Filters	Gross Beta	304	8/2/2021	0.02419 pCi/m3	130588005
Hatch	Charcoal Ct	I-131	304	8/2/2021	0 pCi/m3	130589005
Hatch	Charcoal Ct	I-131	304	8/10/2021	0 pCi/m3	130713005
Hatch	Air Filters	Gross Beta	304	8/10/2021	0.01962 pCi/m3	130711005
Hatch	Air Filters	Gross Beta	304	8/16/2021	0.01423 pCi/m3	130841005
Hatch	Charcoal Ct	I-131	304	8/16/2021	0 pCi/m3	130842005
Hatch	Air Filters	Gross Beta	304	8/23/2021	0.01259 pCi/m3	130989005
Hatch	Charcoal Ct	I-131	304	8/23/2021	0 pCi/m3	130990005
Hatch	Charcoal Ct	I-131	304	8/30/2021	0 pCi/m3	131045005
Hatch	Air Filters	Gross Beta	304	8/30/2021	0.0228 pCi/m3	131044005
Hatch	Charcoal Ct	I-131	304	9/7/2021	0 pCi/m3	131155005
Hatch	Air Filters	Gross Beta	304	9/7/2021	0.02616 pCi/m3	131154005
Hatch	Charcoal Ct	I-131	304	9/13/2021	0 pCi/m3	131244005
Hatch	Air Filters	Gross Beta	304	9/13/2021	0.02633 pCi/m3	131243005
Hatch	Air Filters	Gross Beta	304	9/20/2021	0.02037 pCi/m3	131334005

Hatch	Charcoal Ct	I-131	304	9/20/2021	0 pCi/m3	131335005
Hatch	Charcoal Ct	I-131	304	9/27/2021	0 pCi/m3	131446005
Hatch	Milk Gamma	K-40	GSP	9/28/2021	314.72 pCi/L	131426001
Hatch	Milk Gamma	Be-7	GSP	9/28/2021	0 pCi/L	131426001
Hatch	Air Qtr Comp	I-131	304	9/27/2021	0 pCi/m3	131792005
Hatch	Milk Gamma	Cs-137	GSP	10/12/2021	0 pCi/L	131615001
Hatch	Air Filters	Gross Beta	304	9/27/2021	0.01723 pCi/m3	131444005
Hatch	Charcoal Ct	I-131	304	10/5/2021	0 pCi/m3	131547005
Hatch	Air Filters	Gross Beta	304	10/5/2021	0.03943 pCi/m3	131546005
Hatch	Charcoal Ct	I-131	304	10/11/2021	0 pCi/m3	131631005
Hatch	Air Filters	Gross Beta	304	10/11/2021	0.01598 pCi/m3	131630005
Hatch	Charcoal Ct	I-131	304	10/18/2021	0 pCi/m3	131715005
Hatch	Air Filters	Gross Beta	304	10/18/2021	0.02402 pCi/m3	131713005
Hatch	Air Filters	Gross Beta	304	10/25/2021	0.02973 pCi/m3	131815005
Hatch	Charcoal Ct	I-131	304	10/25/2021	0 pCi/m3	131816005
Hatch	Air Filters	Gross Beta	304	11/1/2021	0.01329 pCi/m3	131847005
Hatch	Charcoal Ct	I-131	304	11/1/2021	0 pCi/m3	131848005
Hatch	Charcoal Ct	I-131	304	11/8/2021	0 pCi/m3	131944005
Hatch	Air Filters	Gross Beta	304	11/8/2021	0.02571 pCi/m3	131943005
Hatch	Air Filters	Gross Beta	304	11/16/2021	0.0216 pCi/m3	131995005
Hatch	Charcoal Ct	I-131	304	11/16/2021	0 pCi/m3	131996005
Hatch	Charcoal Ct	I-131	304	11/22/2021	0 pCi/m3	132025005
Hatch	Air Filters	Gross Beta	304	11/22/2021	0.01926 pCi/m3	132024005
Hatch	Air Filters	Gross Beta	304	11/30/2021	0.0249 pCi/m3	132101005
Hatch	Charcoal Ct	I-131	304	11/30/2021	0 pCi/m3	132103005
Hatch	Air Filters	Gross Beta	304	12/6/2021	0.03917 pCi/m3	132153005
Hatch	Charcoal Ct	I-131	304	12/6/2021	0 pCi/m3	132154005
Hatch	Charcoal Ct	I-131	304	12/13/2021	0 pCi/m3	132204005
Hatch	Air Filters	Gross Beta	304	12/13/2021	0.02502 pCi/m3	132203005
Hatch	Air Filters	Gross Beta	304	12/20/2021	0.01312 pCi/m3	132264005
Hatch	Charcoal Ct	I-131	304	12/20/2021	0 pCi/m3	132266005
Hatch	Milk Gamma	Be-7	GSP	10/12/2021	0 pCi/L	131615001
Hatch	Charcoal Ct	I-131	304	12/27/2021	0 pCi/m3	132328005
Hatch	Air Filters	Gross Beta	304	12/27/2021	0.02127 pCi/m3	132327005
Hatch	Air Qtr Comp	I-131	304	12/27/2021	0 pCi/m3	132405005
Hatch	Milk Gamma	K-40	GSP	10/12/2021	276.16 pCi/L	131615001
Hatch	Milk Gamma	Cs-134	GSP	10/12/2021	0 pCi/L	131615001
Hatch	Charcoal Ct	I-131	309	1/4/2021	0 pCi/m3	127932006
Hatch	Air Filters	Gross Beta	309	1/4/2021	0.01522 pCi/m3	127931006
Hatch	Charcoal Ct	I-131	309	1/11/2021	0 pCi/m3	128030006
Hatch	Air Filters	Gross Beta	309	1/11/2021	0.02654 pCi/m3	128029006
Hatch	Air Filters	Gross Beta	309	1/19/2021	0.02577 pCi/m3	128177006
Hatch	Charcoal Ct	I-131	309	1/19/2021	0 pCi/m3	128178006
Hatch	Charcoal Ct	I-131	309	1/25/2021	0 pCi/m3	128294006
Hatch	Air Filters	Gross Beta	309	1/25/2021	0.02219 pCi/m3	128293006
Hatch	Charcoal Ct	I-131	309	2/1/2021	0 pCi/m3	128354006
Hatch	Air Filters	Gross Beta	309	2/1/2021	0.02058 pCi/m3	128353006
Hatch	Air Filters	Gross Beta	309	2/8/2021	0.0174 pCi/m3	128429006
Hatch	Charcoal Ct	I-131	309	2/8/2021	0 pCi/m3	128430006
Hatch	Air Filters	Gross Beta	309	2/15/2021	0.01152 pCi/m3	128567006
Hatch	Charcoal Ct	I-131	309	2/15/2021	0 pCi/m3	128568006
Hatch	Air Filters	Gross Beta	309	2/22/2021	0.02004 pCi/m3	128648006
Hatch	Charcoal Ct	I-131	309	2/22/2021	0 pCi/m3	128649006
Hatch	Air Filters	Gross Beta	309	3/1/2021	0.02189 pCi/m3	128759006
Hatch	Charcoal Ct	I-131	309	3/1/2021	0 pCi/m3	128760006
Hatch	Charcoal Ct	I-131	309	3/8/2021	0 pCi/m3	128843006
Hatch	Air Filters	Gross Beta	309	3/8/2021	0.02562 pCi/m3	128842006
Hatch	Air Filters	Gross Beta	309	3/15/2021	0.02618 pCi/m3	128928006
Hatch	Charcoal Ct	I-131	309	3/15/2021	0 pCi/m3	128929006
Hatch	Charcoal Ct	I-131	309	3/22/2021	0 pCi/m3	128998006
Hatch	Air Filters	Gross Beta	309	3/22/2021	0.02129 pCi/m3	128997006
Hatch	Charcoal Ct	I-131	309	3/29/2021	0 pCi/m3	129041006
Hatch	Air Qtr Comp	I-131	309	3/29/2021	0 pCi/m3	129160006
Hatch	Air Filters	Gross Beta	309	3/29/2021	0.01538 pCi/m3	129040006
Hatch	River Water	Cs-134	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	Cs-137	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	Co-60	172	10/18/2021	0 pCi/L	131691002
Hatch	Charcoal Ct	I-131	309	4/5/2021	0 pCi/m3	129118006
Hatch	Air Filters	Gross Beta	309	4/5/2021	0.02391 pCi/m3	129117006
Hatch	Air Filters	Gross Beta	309	4/13/2021	0.02677 pCi/m3	129176006
Hatch	Charcoal Ct	I-131	309	4/13/2021	0 pCi/m3	129177006
Hatch	Air Filters	Gross Beta	309	4/19/2021	0.03198 pCi/m3	129255006
Hatch	Charcoal Ct	I-131	309	4/19/2021	0 pCi/m3	129256006
Hatch	Air Filters	Gross Beta	309	4/26/2021	0.02369 pCi/m3	129300006
Hatch	Charcoal Ct	I-131	309	4/26/2021	0 pCi/m3	129301006
Hatch	Charcoal Ct	I-131	309	5/3/2021	0 pCi/m3	129369006
Hatch	Air Filters	Gross Beta	309	5/3/2021	0.02835 pCi/m3	129368006
Hatch	Charcoal Ct	I-131	309	5/10/2021	0 pCi/m3	129448006
Hatch	Air Filters	Gross Beta	309	5/10/2021	0.02239 pCi/m3	129447006
Hatch	Air Filters	Gross Beta	309	5/18/2021	0.02 pCi/m3	129517006
Hatch	Charcoal Ct	I-131	309	5/18/2021	0 pCi/m3	129518006
Hatch	Air Filters	Gross Beta	309	5/24/2021	0.01989 pCi/m3	129598005
Hatch	Charcoal Ct	I-131	309	5/24/2021	0 pCi/m3	129599005
Hatch	Air Filters	Gross Beta	309	6/1/2021	0.02607 pCi/m3	129659006
Hatch	Charcoal Ct	I-131	309	6/1/2021	0 pCi/m3	129660006
Hatch	Air Filters	Gross Beta	309	6/7/2021	0.01328 pCi/m3	129777006
Hatch	Charcoal Ct	I-131	309	6/7/2021	0 pCi/m3	129778006

Hatch	Charcoal Ct	I-131	309	6/14/2021	0 pCi/m3	129920006
Hatch	Air Filters	Gross Beta	309	6/14/2021	0.01267 pCi/m3	129919006
Hatch	Charcoal Ct	I-131	309	6/21/2021	0 pCi/m3	130021006
Hatch	Air Filters	Gross Beta	309	6/21/2021	0.02384 pCi/m3	130020006
Hatch	Air Qtr Comp	I-131	309	6/28/2021	0 pCi/m3	130248006
Hatch	River Water	Co-58	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	Be-7	172	10/18/2021	0 pCi/L	131691002
Hatch	River Water	K-40	172	10/18/2021	0 pCi/L	131691002
Hatch	Air Filters	Gross Beta	309	6/28/2021	0.01577 pCi/m3	130141006
Hatch	Charcoal Ct	I-131	309	6/28/2021	0 pCi/m3	130142006
Hatch	Air Filters	Gross Beta	309	7/6/2021	0.0134 pCi/m3	130194006
Hatch	Charcoal Ct	I-131	309	7/6/2021	0 pCi/m3	130195006
Hatch	Air Filters	Gross Beta	309	7/12/2021	0.01579 pCi/m3	130292006
Hatch	Charcoal Ct	I-131	309	7/12/2021	0 pCi/m3	130293006
Hatch	Air Filters	Gross Beta	309	7/19/2021	0.0181 pCi/m3	130424006
Hatch	Charcoal Ct	I-131	309	7/19/2021	0 pCi/m3	130425006
Hatch	Charcoal Ct	I-131	309	7/26/2021	0 pCi/m3	130494006
Hatch	Air Filters	Gross Beta	309	7/26/2021	0.01629 pCi/m3	130493006
Hatch	Air Filters	Gross Beta	309	8/2/2021	0.02697 pCi/m3	130588006
Hatch	Charcoal Ct	I-131	309	8/2/2021	0 pCi/m3	130589006
Hatch	Air Filters	Gross Beta	309	8/10/2021	0.01733 pCi/m3	130711006
Hatch	Charcoal Ct	I-131	309	8/10/2021	0 pCi/m3	130713006
Hatch	Air Filters	Gross Beta	309	8/16/2021	0.01701 pCi/m3	130841006
Hatch	Charcoal Ct	I-131	309	8/16/2021	0 pCi/m3	130842006
Hatch	Air Filters	Gross Beta	309	8/23/2021	0.01568 pCi/m3	130989006
Hatch	Charcoal Ct	I-131	309	8/23/2021	0 pCi/m3	130990006
Hatch	Air Filters	Gross Beta	309	8/30/2021	0.02315 pCi/m3	131044006
Hatch	Charcoal Ct	I-131	309	8/30/2021	0 pCi/m3	131045006
Hatch	Charcoal Ct	I-131	309	9/7/2021	0 pCi/m3	131155006
Hatch	Air Filters	Gross Beta	309	9/7/2021	0.02645 pCi/m3	131154006
Hatch	Charcoal Ct	I-131	309	9/13/2021	0 pCi/m3	131244006
Hatch	Air Filters	Gross Beta	309	9/13/2021	0.03286 pCi/m3	131243006
Hatch	Charcoal Ct	I-131	309	9/20/2021	0 pCi/m3	131335006
Hatch	Air Filters	Gross Beta	309	9/20/2021	0.01941 pCi/m3	131334006
Hatch	River Water	Co-58	170	10/18/2021	0 pCi/L	131691001
Hatch	Charcoal Ct	I-131	309	9/27/2021	0 pCi/m3	131446006
Hatch	Air Filters	Gross Beta	309	9/27/2021	0.0176 pCi/m3	131444006
Hatch	Air Qtr Comp	I-131	309	9/27/2021	0 pCi/m3	131792006
Hatch	River Water	Co-60	170	10/18/2021	0 pCi/L	131691001
Hatch	River Water	K-40	170	10/18/2021	0 pCi/L	131691001
Hatch	Air Filters	Gross Beta	309	10/5/2021	0.03937 pCi/m3	131546006
Hatch	Charcoal Ct	I-131	309	10/5/2021	0 pCi/m3	131547006
Hatch	Charcoal Ct	I-131	309	10/11/2021	0 pCi/m3	131631006
Hatch	Air Filters	Gross Beta	309	10/11/2021	0.01363 pCi/m3	131630006
Hatch	Charcoal Ct	I-131	309	10/18/2021	0 pCi/m3	131715006
Hatch	Air Filters	Gross Beta	309	10/18/2021	0.02415 pCi/m3	131713006
Hatch	Charcoal Ct	I-131	309	10/25/2021	0 pCi/m3	131816006
Hatch	Air Filters	Gross Beta	309	10/25/2021	0.03629 pCi/m3	131815006
Hatch	Charcoal Ct	I-131	309	11/1/2021	0 pCi/m3	131848006
Hatch	Air Filters	Gross Beta	309	11/1/2021	0.01405 pCi/m3	131847006
Hatch	Charcoal Ct	I-131	309	11/8/2021	0 pCi/m3	131944006
Hatch	Air Filters	Gross Beta	309	11/8/2021	0.02099 pCi/m3	131943006
Hatch	Charcoal Ct	I-131	309	11/16/2021	0 pCi/m3	131996006
Hatch	Air Filters	Gross Beta	309	11/16/2021	0.02135 pCi/m3	131995006
Hatch	Charcoal Ct	I-131	309	11/22/2021	0 pCi/m3	132025006
Hatch	Air Filters	Gross Beta	309	11/22/2021	0.01897 pCi/m3	132024006
Hatch	Air Filters	Gross Beta	309	11/30/2021	0.02417 pCi/m3	132101006
Hatch	Charcoal Ct	I-131	309	11/30/2021	0 pCi/m3	132103006
Hatch	Air Filters	Gross Beta	309	12/6/2021	0.03645 pCi/m3	132153006
Hatch	Charcoal Ct	I-131	309	12/6/2021	0 pCi/m3	132154006
Hatch	Charcoal Ct	I-131	309	12/13/2021	0 pCi/m3	132204006
Hatch	Air Filters	Gross Beta	309	12/13/2021	0.02549 pCi/m3	132203006
Hatch	Charcoal Ct	I-131	309	12/20/2021	0 pCi/m3	132266006
Hatch	Air Filters	Gross Beta	309	12/20/2021	0.01142 pCi/m3	132264006
Hatch	River Water	Cs-134	170	10/18/2021	0 pCi/L	131691001
Hatch	River Water	Cs-137	170	10/18/2021	0 pCi/L	131691001
Hatch	Air Filters	Gross Beta	309	12/27/2021	0.02502 pCi/m3	132327006
Hatch	Charcoal Ct	I-131	309	12/27/2021	0 pCi/m3	132328006
Hatch	River Water	Be-7	170	10/18/2021	0 pCi/L	131691001
Hatch	Air Qtr Comp	I-131	309	12/27/2021	0 pCi/m3	132405006
Hatch	Milk Gamma	I-131	GSP	9/14/2021	0 pCi/L	131224001
Hatch	Vegetation	Cs-134	112	10/25/2021	0 pCi/Kg	131817002
Hatch	Milk Gamma	I-131	GSP	9/28/2021	0 pCi/L	131426001
Hatch	Vegetation	Be-7	112	10/25/2021	3088.2 pCi/Kg	131817002
Hatch	Vegetation	K-40	112	10/25/2021	2754 pCi/Kg	131817002
Hatch	Vegetation	Cs-137	112	10/25/2021	0 pCi/Kg	131817002
Hatch	Milk Gamma	I-131	GSP	10/12/2021	0 pCi/L	131615001
Hatch	Vegetation	K-40	106	10/25/2021	2408.6 pCi/Kg	131817003
Hatch	Vegetation	Be-7	106	10/25/2021	4693.5 pCi/Kg	131817003
Hatch	Milk Gamma	I-131	GSP	10/26/2021	0 pCi/L	131794001
Hatch	Milk Gamma	I-131	GSP	11/9/2021	0 pCi/L	131932001
Hatch	Vegetation	Cs-134	106	10/25/2021	0 pCi/Kg	131817003
Hatch	Milk Gamma	I-131	GSP	11/22/2021	0 pCi/L	132017001
Hatch	Vegetation	Cs-137	106	10/25/2021	44.29 pCi/Kg	131817003
Hatch	Fish	Cs-137	170 Common Carp	10/25/2021	0 pCi/Kg	131796003
Hatch	Fish	Cs-137	170 Bass	10/25/2021	0 pCi/Kg	131796002
Hatch	Milk Gamma	I-131	GSP	12/7/2021	0 pCi/L	132141001

Hatch	Fish	Cs-137	170 Catfish	10/25/2021	0 pCi/Kg	131796001
Hatch	Fish	Be-7	170 Common Carp	10/25/2021	0 pCi/Kg	131796003
Hatch	Milk Gamma	I-131	GSP	12/20/2021	0 pCi/L	132260001
Hatch	Fish	K-40	170 Common Carp	10/25/2021	2866.2 pCi/Kg	131796003
Hatch	Fish	Co-58	170 Common Carp	10/25/2021	0 pCi/Kg	131796003
Hatch	Fish	Co-60	170 Common Carp	10/25/2021	0 pCi/Kg	131796003
Hatch	Fish	Cs-134	170 Common Carp	10/25/2021	0 pCi/Kg	131796003
Hatch	Fish	K-40	170 Bass	10/25/2021	3131.3 pCi/Kg	131796002
Hatch	Fish	Be-7	170 Bass	10/25/2021	0 pCi/Kg	131796002
Hatch	Fish	Cs-134	170 Bass	10/25/2021	0 pCi/Kg	131796002
Hatch	Fish	Co-60	170 Bass	10/25/2021	0 pCi/Kg	131796002
Hatch	Fish	Co-58	170 Bass	10/25/2021	0 pCi/Kg	131796002
Hatch	Fish	K-40	170 Catfish	10/25/2021	3077.8 pCi/Kg	131796001
Hatch	Fish	Co-58	170 Catfish	10/25/2021	0 pCi/Kg	131796001
Hatch	Fish	Co-60	170 Catfish	10/25/2021	0 pCi/Kg	131796001
Hatch	Fish	Cs-134	170 Catfish	10/25/2021	0 pCi/Kg	131796001
Hatch	Fish	Be-7	170 Catfish	10/25/2021	0 pCi/Kg	131796001
Hatch	Fish	Cs-137	172 Mullet	10/25/2021	14.4 pCi/Kg	131796007
Hatch	Fish	Cs-137	172 Common Carp	10/25/2021	0 pCi/Kg	131796005
Hatch	Fish	Cs-137	172 Bass	10/25/2021	0 pCi/Kg	131796006
Hatch	Fish	Cs-137	172 Sucker	10/25/2021	0 pCi/Kg	131796004
Hatch	Fish	K-40	172 Common Carp	10/25/2021	2963.9 pCi/Kg	131796005
Hatch	Fish	Be-7	172 Common Carp	10/25/2021	0 pCi/Kg	131796005
Hatch	Fish	Cs-134	172 Common Carp	10/25/2021	0 pCi/Kg	131796005
Hatch	Fish	Co-60	172 Common Carp	10/25/2021	0 pCi/Kg	131796005
Hatch	Fish	Co-58	172 Common Carp	10/25/2021	0 pCi/Kg	131796005
Hatch	Fish	Co-58	172 Bass	10/25/2021	0 pCi/Kg	131796006
Hatch	Fish	Co-60	172 Bass	10/25/2021	0 pCi/Kg	131796006
Hatch	Fish	Cs-134	172 Bass	10/25/2021	0 pCi/Kg	131796006
Hatch	Fish	Be-7	172 Bass	10/25/2021	0 pCi/Kg	131796006
Hatch	Fish	K-40	172 Bass	10/25/2021	3405.8 pCi/Kg	131796006
Hatch	Fish	Be-7	172 Mullet	10/25/2021	0 pCi/Kg	131796007
Hatch	Fish	K-40	172 Mullet	10/25/2021	3497.5 pCi/Kg	131796007
Hatch	Fish	Cs-134	172 Mullet	10/25/2021	0 pCi/Kg	131796007
Hatch	Fish	Co-60	172 Mullet	10/25/2021	0 pCi/Kg	131796007
Hatch	Fish	Co-58	172 Mullet	10/25/2021	0 pCi/Kg	131796007
Hatch	Fish	K-40	172 Sucker	10/25/2021	3483.9 pCi/Kg	131796004
Hatch	Fish	Be-7	172 Sucker	10/25/2021	0 pCi/Kg	131796004
Hatch	Fish	Cs-134	172 Sucker	10/25/2021	0 pCi/Kg	131796004
Hatch	Fish	Co-60	172 Sucker	10/25/2021	0 pCi/Kg	131796004
Hatch	Fish	Co-58	172 Sucker	10/25/2021	0 pCi/Kg	131796004
Hatch	Vegetation	Be-7	416	10/25/2021	3380.3 pCi/Kg	131817001
Hatch	Vegetation	K-40	416	10/25/2021	4915.3 pCi/Kg	131817001
Hatch	Vegetation	Cs-134	416	10/25/2021	0 pCi/Kg	131817001
Hatch	Vegetation	Cs-137	416	10/25/2021	0 pCi/Kg	131817001
Hatch	Milk Gamma	La-140	GSP	1/5/2021	0 pCi/L	127930001
Hatch	Milk Gamma	Cs-137	GSP	10/26/2021	0 pCi/L	131794001
Hatch	Milk Gamma	Be-7	GSP	10/26/2021	0 pCi/L	131794001
Hatch	Milk Gamma	K-40	GSP	10/26/2021	321.14 pCi/L	131794001
Hatch	Milk Gamma	Cs-134	GSP	10/26/2021	0 pCi/L	131794001
Hatch	Sediment	K-40	170	11/1/2021	4279.8 pCi/Kg	131849001
Hatch	Sediment	Be-7	170	11/1/2021	0 pCi/Kg	131849001
Hatch	Milk Gamma	La-140	GSP	1/19/2021	0 pCi/L	128176001
Hatch	Sediment	Cs-137	170	11/1/2021	0 pCi/Kg	131849001
Hatch	Sediment	Cs-134	170	11/1/2021	0 pCi/Kg	131849001
Hatch	Sediment	Co-58	170	11/1/2021	0 pCi/Kg	131849001
Hatch	Milk Gamma	La-140	GSP	2/2/2021	0 pCi/L	128355001
Hatch	Sediment	Co-60	170	11/1/2021	0 pCi/Kg	131849001
Hatch	Sediment	K-40	172	11/1/2021	4688.2 pCi/Kg	131849002
Hatch	Sediment	Be-7	172	11/1/2021	0 pCi/Kg	131849002
Hatch	Sediment	Cs-137	172	11/1/2021	0 pCi/Kg	131849002
Hatch	Sediment	Cs-134	172	11/1/2021	0 pCi/Kg	131849002
Hatch	Sediment	Co-60	172	11/1/2021	0 pCi/Kg	131849002
Hatch	Milk Gamma	La-140	GSP	2/16/2021	0 pCi/L	128610001
Hatch	Sediment	Co-58	172	11/1/2021	0 pCi/Kg	131849002
Hatch	Milk Gamma	Cs-137	GSP	11/9/2021	0 pCi/L	131932001
Hatch	Milk Gamma	K-40	GSP	11/9/2021	288.73 pCi/L	131932001
Hatch	Milk Gamma	Be-7	GSP	11/9/2021	0 pCi/L	131932001
Hatch	Milk Gamma	Cs-134	GSP	11/9/2021	0 pCi/L	131932001
Hatch	Milk Gamma	La-140	GSP	3/2/2021	0 pCi/L	128758001
Hatch	Milk Gamma	Cs-137	GSP	11/22/2021	0 pCi/L	132017001
Hatch	Milk Gamma	K-40	GSP	11/22/2021	1346.2 pCi/L	132017001
Hatch	Milk Gamma	Be-7	GSP	11/22/2021	0 pCi/L	132017001
Hatch	Milk Gamma	Cs-134	GSP	11/22/2021	0 pCi/L	132017001
Hatch	Vegetation	K-40	112	11/30/2021	3836.9 pCi/Kg	132104002
Hatch	Milk Gamma	La-140	GSP	3/16/2021	0 pCi/L	128930001
Hatch	Vegetation	Be-7	112	11/30/2021	2420.1 pCi/Kg	132104002
Hatch	Vegetation	Cs-134	112	11/30/2021	0 pCi/Kg	132104002
Hatch	Vegetation	Cs-137	112	11/30/2021	0 pCi/Kg	132104002
Hatch	River Water	Cs-134	170	11/30/2021	0 pCi/L	132099001
Hatch	River Water	Cs-137	170	11/30/2021	0 pCi/L	132099001
Hatch	River Water	Be-7	170	11/30/2021	0 pCi/L	132099001
Hatch	Milk Gamma	La-140	GSP	3/30/2021	0 pCi/L	129043001
Hatch	River Water	K-40	170	11/30/2021	0 pCi/L	132099001
Hatch	River Water	Co-60	170	11/30/2021	0 pCi/L	132099001
Hatch	River Water	Co-58	170	11/30/2021	0 pCi/L	132099001
Hatch	Vegetation	Cs-134	416	11/30/2021	0 pCi/Kg	132104001

Hatch	Milk Gamma	La-140	GSP	4/13/2021	0 pCi/L	129175001
Hatch	Vegetation	K-40	416	11/30/2021	4502.872 pCi/Kg	132104001
Hatch	Vegetation	Be-7	416	11/30/2021	3629.22 pCi/Kg	132104001
Hatch	Vegetation	Cs-137	416	11/30/2021	0 pCi/Kg	132104001
Hatch	River Water	K-40	172	12/1/2021	0 pCi/L	132099002
Hatch	River Water	Co-58	172	12/1/2021	0 pCi/L	132099002
Hatch	Milk Gamma	La-140	GSP	4/27/2021	0 pCi/L	129310001
Hatch	River Water	Co-60	172	12/1/2021	0 pCi/L	132099002
Hatch	River Water	Cs-134	172	12/1/2021	0 pCi/L	132099002
Hatch	River Water	Cs-137	172	12/1/2021	0 pCi/L	132099002
Hatch	River Water	Be-7	172	12/1/2021	0 pCi/L	132099002
Hatch	Milk Gamma	La-140	GSP	5/11/2021	0 pCi/L	129443001
Hatch	Vegetation	I-131	106	1/25/2021	0 pCi/Kg	128296003
Hatch	Milk Gamma	Cs-137	GSP	12/7/2021	0 pCi/L	132141001
Hatch	Vegetation	I-131	106	3/30/2021	0 pCi/Kg	129042003
Hatch	Milk Gamma	Be-7	GSP	12/7/2021	0 pCi/L	132141001
Hatch	Milk Gamma	K-40	GSP	12/7/2021	1436 pCi/L	132141001
Hatch	Milk Gamma	Cs-134	GSP	12/7/2021	0 pCi/L	132141001
Hatch	Milk Gamma	La-140	GSP	5/25/2021	0 pCi/L	129603001
Hatch	Vegetation	I-131	106	4/26/2021	0 pCi/Kg	129302003
Hatch	Milk Gamma	Cs-137	GSP	12/20/2021	0 pCi/L	132260001
Hatch	Vegetation	I-131	106	6/1/2021	0 pCi/Kg	129661003
Hatch	Vegetation	I-131	106	6/28/2021	0 pCi/Kg	130144003
Hatch	Milk Gamma	Be-7	GSP	12/20/2021	0 pCi/L	132260001
Hatch	Vegetation	I-131	106	7/26/2021	0 pCi/Kg	130496003
Hatch	Milk Gamma	K-40	GSP	12/20/2021	1348.8 pCi/L	132260001
Hatch	Milk Gamma	Cs-134	GSP	12/20/2021	0 pCi/L	132260001
Hatch	Milk Gamma	La-140	GSP	6/7/2021	0 pCi/L	129794001
Hatch	Milk Gamma	La-140	GSP	6/21/2021	0 pCi/L	130019001
Hatch	Vegetation	I-131	106	8/30/2021	0 pCi/Kg	131046003
Hatch	Air Qtr Comp	Be-7	112	12/27/2021	0.09602 pCi/m3	132405003
Hatch	Vegetation	I-131	106	9/27/2021	0 pCi/Kg	131447003
Hatch	Air Qtr Comp	Cs-137	112	12/27/2021	0 pCi/m3	132405003
Hatch	Air Qtr Comp	Cs-134	112	12/27/2021	0 pCi/m3	132405003
Hatch	Vegetation	I-131	106	10/25/2021	0 pCi/Kg	131817003
Hatch	Vegetation	K-40	112	12/27/2021	3155.2 pCi/Kg	132310002
Hatch	Vegetation	I-131	106	12/27/2021	0 pCi/Kg	132310003
Hatch	Milk Gamma	La-140	GSP	7/6/2021	0 pCi/L	130193001
Hatch	Vegetation	Be-7	112	12/27/2021	4123.6 pCi/Kg	132310002
Hatch	Vegetation	Cs-134	112	12/27/2021	0 pCi/Kg	132310002
Hatch	Vegetation	I-131	112	1/25/2021	0 pCi/Kg	128296002
Hatch	Milk Gamma	La-140	GSP	7/20/2021	0 pCi/L	130427001
Hatch	Vegetation	Cs-137	112	12/27/2021	0 pCi/Kg	132310002
Hatch	Air Qtr Comp	Cs-134	107	12/27/2021	0 pCi/m3	132405002
Hatch	Vegetation	I-131	112	2/22/2021	0 pCi/Kg	128651002
Hatch	Air Qtr Comp	Cs-137	107	12/27/2021	0 pCi/m3	132405002
Hatch	Air Qtr Comp	Be-7	107	12/27/2021	0.1063 pCi/m3	132405002
Hatch	Milk Gamma	La-140	GSP	8/3/2021	0 pCi/L	130591001
Hatch	Vegetation	I-131	112	3/30/2021	0 pCi/Kg	129042002
Hatch	Vegetation	K-40	106	12/27/2021	1476.4 pCi/Kg	132310003
Hatch	Vegetation	I-131	112	4/26/2021	0 pCi/Kg	129302002
Hatch	Vegetation	Be-7	106	12/27/2021	4552.9 pCi/Kg	132310003
Hatch	Vegetation	Cs-134	106	12/27/2021	0 pCi/Kg	132310003
Hatch	Milk Gamma	La-140	GSP	8/17/2021	0 pCi/L	130840001
Hatch	Vegetation	Cs-137	106	12/27/2021	28.102 pCi/Kg	132310003
Hatch	Vegetation	I-131	112	6/1/2021	0 pCi/Kg	129661002
Hatch	Vegetation	I-131	112	6/28/2021	0 pCi/Kg	130144002
Hatch	Air Qtr Comp	Cs-137	309	12/27/2021	0 pCi/m3	132405006
Hatch	Milk Gamma	La-140	GSP	8/31/2021	0 pCi/L	131042001
Hatch	Air Qtr Comp	Be-7	309	12/27/2021	0.09113 pCi/m3	132405006
Hatch	Air Qtr Comp	Cs-134	309	12/27/2021	0 pCi/m3	132405006
Hatch	Vegetation	I-131	112	7/26/2021	0 pCi/Kg	130496002
Hatch	Air Qtr Comp	Be-7	304	12/27/2021	0.08281 pCi/m3	132405005
Hatch	Vegetation	I-131	112	8/30/2021	0 pCi/Kg	131046002
Hatch	Air Qtr Comp	Cs-134	304	12/27/2021	0 pCi/m3	132405005
Hatch	Milk Gamma	La-140	GSP	9/14/2021	0 pCi/L	131224001
Hatch	Vegetation	I-131	112	9/27/2021	0 pCi/Kg	131447002
Hatch	Air Qtr Comp	Cs-137	304	12/27/2021	0 pCi/m3	132405005
Hatch	Vegetation	I-131	112	10/25/2021	0 pCi/Kg	131817002
Hatch	Air Qtr Comp	Cs-134	103	12/27/2021	0 pCi/m3	132405001
Hatch	Air Qtr Comp	Cs-137	103	12/27/2021	0 pCi/m3	132405001
Hatch	Vegetation	I-131	112	11/30/2021	0 pCi/Kg	132104002
Hatch	Air Qtr Comp	Be-7	103	12/27/2021	0.07971 pCi/m3	132405001
Hatch	Air Qtr Comp	Cs-137	116	12/27/2021	0 pCi/m3	132405004
Hatch	Milk Gamma	La-140	GSP	9/28/2021	0 pCi/L	131426001
Hatch	Vegetation	I-131	112	12/27/2021	0 pCi/Kg	132310002
Hatch	Milk Gamma	La-140	GSP	10/12/2021	0 pCi/L	131615001
Hatch	Air Qtr Comp	Cs-134	116	12/27/2021	0 pCi/m3	132405004
Hatch	Air Qtr Comp	Be-7	116	12/27/2021	0.07664 pCi/m3	132405004
Hatch	Vegetation	I-131	416	1/25/2021	0 pCi/Kg	128296001
Hatch	Vegetation	Be-7	416	12/27/2021	1625.1 pCi/Kg	132310001
Hatch	Vegetation	I-131	416	2/22/2021	0 pCi/Kg	128651001
Hatch	Vegetation	Cs-134	416	12/27/2021	0 pCi/Kg	132310001
Hatch	Vegetation	K-40	416	12/27/2021	4882.7 pCi/Kg	132310001
Hatch	Milk Gamma	La-140	GSP	10/26/2021	0 pCi/L	131794001
Hatch	Vegetation	Cs-137	416	12/27/2021	0 pCi/Kg	132310001
Hatch	Vegetation	I-131	416	3/29/2021	0 pCi/Kg	129042001

Hatch	Vegetation	I-131	416	4/26/2021	0 pCi/Kg	129302001
Hatch	River Water	Be-7	172	12/28/2021	0 pCi/L	132308002
Hatch	River Water	K-40	172	12/28/2021	0 pCi/L	132308002
Hatch	Milk Gamma	La-140	GSP	11/9/2021	0 pCi/L	131932001
Hatch	Vegetation	I-131	416	6/1/2021	0 pCi/Kg	129661001
Hatch	River Water	Co-58	172	12/28/2021	0 pCi/L	132308002
Hatch	Vegetation	I-131	416	6/28/2021	0 pCi/Kg	130144001
Hatch	River Water	Co-60	172	12/28/2021	0 pCi/L	132308002
Hatch	River Water	Cs-134	172	12/28/2021	0 pCi/L	132308002
Hatch	Milk Gamma	La-140	GSP	11/22/2021	0 pCi/L	132017001
Hatch	Vegetation	I-131	416	7/26/2021	0 pCi/Kg	130496001
Hatch	River Water	Cs-137	172	12/28/2021	0 pCi/L	132308002
Hatch	Vegetation	I-131	416	8/30/2021	0 pCi/Kg	131046001
Hatch	Milk Gamma	La-140	GSP	12/7/2021	0 pCi/L	132141001
Hatch	River Water	Cs-134	170	12/28/2021	0 pCi/L	132308001
Hatch	River Water	Cs-137	170	12/28/2021	0 pCi/L	132308001
Hatch	Vegetation	I-131	416	9/27/2021	0 pCi/Kg	131447001
Hatch	River Water	Be-7	170	12/28/2021	0 pCi/L	132308001
Hatch	Vegetation	I-131	416	10/25/2021	0 pCi/Kg	131817001
Hatch	Milk Gamma	La-140	GSP	12/20/2021	0 pCi/L	132260001
Hatch	River Water	K-40	170	12/28/2021	0 pCi/L	132308001
Hatch	River Water	Co-58	170	12/28/2021	0 pCi/L	132308001
Hatch	Vegetation	I-131	416	11/30/2021	0 pCi/Kg	132104001
Hatch	River Water	Co-60	170	12/28/2021	0 pCi/L	132308001
Hatch	Vegetation	I-131	416	12/27/2021	0 pCi/Kg	132310001

This page intentionally left blank.

**Edwin I. Hatch Nuclear Plant – Units 1 & 2
Joseph M. Farley Nuclear Plant – Units 1 & 2
Vogtle Electric Generating Plant – Units 1 & 2
Annual Radiological Environmental Operating Reports for 2021**

Enclosure 2

Farley Annual Radiological Environmental Operating Report for 2021

**JOSEPH M. FARLEY NUCLEAR PLANT
2021 ANNUAL RADIOLOGICAL ENVIRONMENTAL
OPERATING REPORT**



This page intentionally left blank.

TABLE OF CONTENTS

1	Introduction	1
2	REMP Description.....	2
3	Results Summary.....	8
	3.1 Airborne Particulates	16
	3.1.1 Gross Beta	16
	3.1.2 Gamma Particulates and Airborne Radioiodine	18
	3.2 Direct Radiation	18
	3.3 Biological Media.....	21
	3.3.1 Milk	21
	3.3.2 Vegetation.....	21
	3.3.3 Fish	21
	3.3.3.1 Bottom Feeding Species.....	21
	3.3.3.2 Game Species	22
	3.3.4 Biological Media Summary	22
	3.4 Off-site Groundwater.....	22
	3.5 River (Surface) Water.....	22
	3.6 Sediment.....	23
	3.7 Interlaboratory Comparison Program	24
4	Survey Summaries.....	27
	4.1 Land Use Census	27
	4.2 Chattahoochee River Survey.....	27
	4.3 Meteorological Report Summary	28
5	Conclusions.....	29

Tables

Table 2-1. Summary Description of Radiological Environmental Monitoring Program	3
Table 2-2. Radiological Environmental Sampling Locations	6
Table 3-1. Radiological Environmental Monitoring Program Annual Summary.....	10
Table 3-2. Reporting Levels (RL).....	14
Table 3-3. Anomalies and Deviations from Radiological Environmental Monitoring Program ..	15
Table 3-4. Average Weekly Gross Beta Air Concentration	16
Table 3-5. Average Quarterly Exposure from Direct Radiation (Historical)	19
Table 3-6. Interlaboratory Comparison Limits.....	24
Table 3-7. Interlaboratory Comparison Summary.....	25
Table 4-1. Land Use Census Results.....	27

Figures

Figure 3-1. Average Weekly Gross Beta Air Concentration.....	17
Figure 3-2. Average Quarterly Exposure from Direct Radiation.....	20
Figure 3-3. 2021 Average Exposure from Direct Radiation in Select Locations	20
Figure 3-4. 2021 Average Tritium Concentrations in River and Off-site Groundwater.....	23



Appendix A – Maps

- A-1 – REMP Stations in Plant Vicinity
- A-2 – REMP Stations within 10 Miles
- A-3 – Extended REMP Stations

Appendix B – Errata



LIST OF ACRONYMS

ADEM	Alabama Department of Environmental Management
APC	Alabama Power Company
GA EPD	State of Georgia Environmental Protection Division
FNP	Joseph M. Farley Nuclear Plant
GPCEL	Georgia Power Company Environmental Laboratory
ICP	Interlaboratory Comparison Program
MDC	Minimum Detectable Concentration
MDD	Minimum Detectable Difference
MWe	MegaWatts Thermal
NA	Not Applicable
NDM	No Detectable Measurement(s)
NEI	Nuclear Energy Institute
NRC	Nuclear Regulatory Commission
ODCM	Offsite Dose Calculation Manual
OSL	Optically Stimulated Luminescence
PWR	Pressurized Water Reactor
REMP	Radiological Environmental Monitoring Program
RL	Reporting Level
RM	River Mile
SNC	Southern Nuclear Operating Company
TLD	Thermoluminescent Dosimeter
TS	Technical Specification



1 INTRODUCTION

The Radiological Environmental Monitoring Program (REMP) was conducted in accordance with Chapter 4 of the Offsite Dose Calculation Manual (ODCM). The REMP activities for 2021 were reported herein in accordance with Technical Specification (TS) 5.6.2 and ODCM 7.1.

The objectives of the REMP were to:

- 1) Determine the levels of radiation and the concentrations of radioactivity in the environs and;
- 2) Assess the radiological impact (if any) to the environment due to the operation of the Joseph M. Farley Nuclear Plant (FNP).

The assessments included comparisons between results of analyses of samples obtained at locations where radiological levels were not expected to be affected by plant operation (control stations), areas of higher population (community stations), and at locations where radiological levels were more likely to be affected by plant operation (indicator stations), as well as comparisons between preoperational and operational sample results.

FNP is owned by Alabama Power Company (APC) and operated by Southern Nuclear Operating Company (SNC). The plant is located in Houston County, Alabama approximately fifteen miles east of Dothan, Alabama on the west bank of the Chattahoochee River. Unit 1, a Westinghouse Electric Corporation Pressurized Water Reactor (PWR) with a licensed core thermal power output of 2775 MegaWatts thermal (MWt), achieved initial criticality on August 9, 1977 and was declared "commercial" on December 1, 1977. Unit 2, also a 2775 MWt Westinghouse PWR, achieved initial criticality on May 8, 1981 and was declared "commercial" on July 30, 1981.

The preoperational stage of the REMP began with initial sample collections in January of 1975. The transition from the preoperational to the operational stage of the REMP was marked by Unit 1 initial criticality.

- A description of the REMP is provided in Section 2 of this report
- Section 3 provides a summary of the results, an assessment of any radiological impacts to the environment, and the results from the Interlaboratory Comparison
- A summary of the land use census and the river survey are included in Section 4
- Conclusions are included in Section 5



2 REMP DESCRIPTION

The following section provides a description of the sampling and laboratory protocols associated with the REMP. Table 2-1 provides a summary of the sample types to be collected and the analyses to be performed in order to monitor the airborne, direct radiation, waterborne and ingestion pathways, and also summarizes the collection and analysis frequencies (in accordance with ODCM Section 4.2). Table 2-2 provides specific information regarding the station locations, their proximity to the plant, and exposure pathways. Additionally, Appendix A of this report provides Maps A-1 through A-4 that depict the georeferenced location of sampling stations. Any Errata from previous reports are provided in Appendix B.

Plant personnel collected most samples, while others were collected by Alabama Power Company Environmental Affairs field team. The Georgia Power Environmental Laboratory (GPCEL) analyzed all REMP samples.



Table 2-1. Summary Description of Radiological Environmental Monitoring Program

Exposure Pathway and/or	Number of Representative Samples and Sample Locations	Sampling/Collection Frequency	Type/Frequency of Analysis
Direct Radiation	40 routine monitoring stations with two or more dosimeters placed as follows: An inner ring of stations, one in each compass sector in the general area of the site boundary; An outer ring of stations, one in each compass sector at approximately 5 miles from the site; and Special interest areas, such as population centers, nearby recreation areas, and control stations	Quarterly	Gamma dose/Quarterly
Airborne Radioiodine and Particulates ¹	Samples from nine locations: Three locations close to the site boundary in different sectors; Three community stations; within 8 miles Two control locations near population centers, approximately 15 and 18 miles away	Continuous sampler operation with sample collection weekly	Particulate sampler: Analyze for gross beta radioactivity \geq 24 hours following filter change / Weekly. Perform gamma isotopic analysis on each sample when gross beta activity is $>$ 10 times the yearly mean of control samples. Perform gamma isotopic analysis on composite sample (by location)/Quarterly. Radioiodine canister: I-131 analysis/Weekly (One community station)
Waterborne			
Surface ³	One sample upriver One sample downriver	Composite sample over one month period ⁴	Gamma isotopic analysis ² /Monthly Composite for tritium analysis/Quarterly
Groundwater	Off-site monitoring includes one indicator station and one control station	Quarterly	Off-site wells are analyzed only for Gamma Isotopic, I-131, & tritium



Table 2-1. Summary Description of Radiological Environmental Monitoring Program

Exposure Pathway and/or	Number of Representative Samples and Sample Locations	Sampling/Collection Frequency	Type/Frequency of Analysis
Shoreline Sediment ⁷	One sample from downriver area with existing or potential recreational value One sample from upriver area with existing or potential recreational value	Semiannually	Gamma isotopic analysis ² /Semiannually
Ingestion			
Milk ⁵	Two samples from milking animals at control locations at a distance of about 5 miles or more	Bimonthly	Gamma isotopic analysis ^{2,6} /Bimonthly
Fish ⁸	One bottom feeding fish and one game fish both upstream and downstream	Semiannually During spring/fall spawning season	Gamma isotopic analysis ² on edible portions/ Semiannually
Grass or Leafy Vegetation	One sample from two onsite locations near the site boundary in different sectors One sample from a control location at an approximate distance of 18 miles	Monthly during growing season	Gamma isotopic analysis ^{2,6} /Monthly



Table 2-1. Summary Description of Radiological Environmental Monitoring Program

Exposure Pathway and/or	Number of Representative Samples and Sample Locations	Sampling/Collection Frequency	Type/Frequency of Analysis
<p>Notes:</p> <p>¹Airborne particulate sample filters were analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air particulate samples was greater than 10 times the yearly mean of control samples, gamma isotopic analysis was performed on the individual samples.</p> <p>²Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.</p> <p>³Upriver sample was taken at a distance beyond significant influence of the discharge. Downriver samples were taken beyond but near the mixing zone.</p> <p>⁴Composite sample aliquots were collected at time intervals that were very short (e.g., hourly) relative to the compositing period (e.g., monthly) to ensure obtaining a representative sample.</p> <p>⁵A milking animal is a cow or goat producing milk for human consumption, no milk animals were found within five miles of the plant, a control sample not collected since 2009.</p> <p>⁶If the gamma isotopic analysis is not sensitive enough to meet the Minimum Detectable Concentration (MDC) for I-131, a separate analysis for I-131 may be performed.</p> <p>⁷These collections were normally made at river mile 41.3 for the indicator station and river mile 47.8 for the control station; however, due to river bottom sediment shifting caused by high flows, dredging, etc., collections may be made from river mile 40 to 42 for the indicator station and from river mile 47 to 49 for the control station.</p> <p>⁸ Since several miles of river water may be needed to obtain adequate fish samples, these river mile positions represent the approximate locations from which the fish are taken. Collections for the indicator station should be from river mile 37.5 to 42.5 and for the control station from river mile 47 to 52.</p>			



Table 2-2. Radiological Environmental Sampling Locations

Station Number	Station Type	Descriptive Location	Direction ¹	Distance (miles) ¹	Radiation Sample Type
0501	Indicator	River Intake Structure (Spare)	ESE	0.8	Airborne
0701	Indicator	South-southeast Perimeter	SSE	1.0	Airborne
1101	Indicator	Plant Entrance	WSW	0.9	Airborne
1601	Indicator	North Perimeter	N	0.8	Airborne
0215	Control	Blakely GA	NE	15	Airborne, Direct
0718 ²	Control	Neals Landing, FL	SSE	18	Airborne, Direct
1218	Control	Dothan, AL	W	18	Airborne, Direct, Vegetation
0703	Community	GA Pacific Paper Co.	SSE	3	Airborne, Direct
1108	Community	Ashford, AL	WSW	8	Airborne
1605	Community	Columbia, AL	N	5	Airborne, Direct
0101	Indicator	Plant Perimeter	NNE	0.9	Direct
0201	Indicator	Plant Perimeter	NE	1.0	Direct
0301	Indicator	Plant Perimeter	ENE	0.9	Direct
0401	Indicator	Plant Perimeter	E	0.8	Direct
0501	Indicator	Plant Perimeter	ESE	0.8	Direct
0601	Indicator	Plant Perimeter	SE	1.1	Direct
0701	Indicator	Plant Perimeter	SSE	1.0	Direct, Vegetation
0801	Indicator	Plant Perimeter	S	1.0	Direct
0901	Indicator	Plant Perimeter	SSW	1.0	Direct
1001	Indicator	Plant Perimeter	SW	0.9	Direct
1101	Indicator	Plant Perimeter	WSW	0.9	Direct
1201	Indicator	Plant Perimeter	W	0.8	Direct
1301	Indicator	Plant Perimeter	WNW	0.8	Direct
1401	Indicator	Plant Perimeter	NW	1.1	Direct
1501	Indicator	Plant Perimeter	NNW	0.9	Direct
1601	Indicator	Plant Perimeter	N	0.8	Direct, Vegetation
1215	Control	Dothan, AL	W	15	Direct
1311	Control	Webb, AL	W	11	Direct
1612	Control	Haleburg, AL	WNW	12	Direct
1001	Community	Whatley Residence	SW	12	Direct
1108	Community	Ashford, AL	WSW	8.0	Direct
WRI	Indicator	Downstream of plant discharge, approximately RM 40	S	3.0	River Water
WRB	Control	Upstream of plant intake, approximately RM 47	NNE	3.0	River Water
WGI-07	Indicator	Paper Mill Well	SSE	4.0	Groundwater
WGB-10	Control	Whatley Residence	SW	1.2	Groundwater



Table 2-2. Radiological Environmental Sampling Locations

Station Number	Station Type	Descriptive Location	Direction ¹	Distance (miles) ¹	Radiation Sample Type
RSI	Indicator	Downstream of plant discharge at Smith's Bend (RM 41)	S	4.0	Sediment
RSB	Control	Upstream of plant intake at Andrews Lock and Dam (RM 48)	N	4.0	Sediment
FGI & FGB	Indicator	Downstream of plant discharge at Smith's Bend (RM 41)	S	4.0	Fish
FGB & FBB	Control	Upstream of plant intake at Andrews Lock and Dam (RM 48)	N	4.0	Fish
0104	Community	Early Co., GA	NNE	4.0	Direct
0204	Community	Early Co., GA	NE	4.0	Direct
0304	Community	Early Co., GA	ENE	4.0	Direct
0405	Community	Early Co., GA	E	5.0	Direct
0505	Community	Early Co., GA	ESE	5.0	Direct
0605	Community	Early Co., GA	SE	5.0	Direct
0805	Community	Houston Co., AL	S	5.0	Direct
0904	Community	Houston Co., AL	SSW	4.0	Direct
1005	Community	Houston Co., AL	SW	5.0	Direct
1104	Community	Houston Co., AL	WSW	4.0	Direct
1204	Community	Houston Co., AL	W	4.0	Direct
1304	Community	Houston Co., AL	WNW	4.0	Direct
1404	Community	Houston Co., AL	NW	4.0	Direct
1504	Community	Houston Co., AL	NNW	4.0	Direct

Notes:
¹Direction and distance were determined as the mid-point between the Unit 1 and Unit 2 vent stacks.
²Spare, per the ODCM



3 RESULTS SUMMARY

Included in this section are statistical evaluations of the laboratory results, comparison of the results by media, and a summary of the anomalies and deviations. Overall, 1662 analyses were performed across nine exposure pathways. Tables and figures are provided throughout this section to provide an enhanced presentation of the information.

In recent history, man-made nuclides have been released into the environment and have resulted in widespread distribution of radionuclides across the globe. For example, atmospheric nuclear weapons tests from the mid-1940s through 1980 distributed man-made nuclides around the world. The most recent atmospheric tests in the 1970s and in 1980 have had a significant impact upon the radiological concentrations found in the environment prior to and during pre-operation, and through early operation. Some long-lived radionuclides, such as Cs-137, continue to be detected and a portion of these detections are believed to be attributed to the nuclear weapons tests.

Additionally, data associated with certain radiological effects created by off-site events have been removed from the historical evaluation, this includes: the nuclear atmospheric weapon test in the fall of 1980, the Chernobyl incident in the spring of 1986 and the Fukushima accident in the spring of 2011.

As indicated in ODCM 7.1.2.1, the results for naturally occurring radionuclides that are also found in plant effluents must be reported along with man-made radionuclides. Historically, the radionuclide Be-7, which occurs abundantly in nature, is often detected in REMP samples, and occasionally detected in the plant's liquid and gaseous effluents. When it is detected in effluents and REMP samples, it is also included in the REMP results. In 2021, Be-7 was not detected in any plant effluents and therefore it was not included in this report.

As part of the data evaluation process, SNC considered the impact of the non-plant associated nuclides along with a statistical evaluation of the REMP data. The statistical evaluations included within this report include the Minimum Detectable Concentration (MDC), the Minimum Detectable Difference (MDD), and Chauvenet's Criterion as described below.

Minimum Detectable Concentration

The minimum detectable concentration is defined as an estimate of the true concentration of an analyte required to give a specified high probability that the measured response will be greater than the critical value.



Minimum Detectable Difference

The Minimum Detectable Difference (MDD) compares the lowest significant difference (between the means) of a control station versus an indicator or a community station, that can be determined statistically at the 99% Confidence Level (CL). A difference in mean values which was less than the MDD was considered statistically indiscernible. The MDD is used to evaluate the statistical proximity between the indicator/community and control sample results, but generally, any results that are less than the MDC and/or Reporting Levels (RL) are considered to have minimal impact on the surrounding environs.

Chauvenet's Criterion

All results were tested for conformance with Chauvenet's Criterion (G. D. Chase and J. L. Rabinowitz, Principles of Radioisotope Methodology, Burgess Publishing Company, 1962, pages 87-90) to identify values which differed from the mean of a set by a statistically significant amount. Identified outliers were investigated to determine the reason(s) for the difference. If equipment malfunction or other valid physical reasons were identified as causing the variation, the anomalous result was excluded from the data set as non-representative.

Table 3-1 summarizes and evaluates the annual results for the indicator stations against the control and community stations (where applicable) and as appropriate, results were evaluated against the MDCs (listed in Table 3-1) and RLs (listed in Table 3-2). The required MDCs were achieved during laboratory sample analysis. The 2021 results were compared with previous results, including those obtained during pre-operation. No data points were excluded for violating Chauvenet's Criterion.



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Locations Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
Airborne Particulates (fCi/m3)	Gross Beta 431	10	17.07 3.6 to 33 (171/171)	Columbia, AL N 5 mi. Community	25.6 6.2 to 29.6 (52/52)	19.1 4.5 to 42.6 (156/156)	16.2 4 to 33.3 (104/104)
	Gamma Isotopic						
	Be-7						
	I-131 34	70	NDM(c)		NDM	NDM	NDM
	Cs-134 34	50	NDM		NDM	NDM	NDM
	Cs-137 34	60	NDM		NDM	NDM	NDM
Airborne Radioiodine(fCi/m3)	I-131 326	70	NDM		NDM	NDM	NDM
Direct Radiation (mR/91 days)	Gamma Dose 160		16.9 12.1 to 27.5 (64/64)	Plant Perimeter, E 0.8 mi Indicator	24.88 23.1 to 27.5 (4/4)	14.4 11.8 to 18.1 (72/72)	17.5 12.7 to 23.8 (24/24)
Milk (pCi/l)	Gamma Isotopic 0						
	I-131	1					
	Cs-134	15					
	Cs-137	18					
	Ba-140	60					
	La-140	15					
Vegetation (pCi/kg-wet)	Gamma Isotopic 33						



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Locations Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
	Be-7 33						
	I-131 33	60	NDM				NDM
	Cs-134 33	60	NDM				NDM
	Cs-137 33	80	0.6 0.0 to 12.9 (1/22)	North Perimeter N 0.8 mi, Indicator	12.9 0-12.9 (1/11)		NDM
River Water (pCi/l)	Gamma Isotopic 26						
	Mn-54	15	NDM		NDM	NDM	NDM
	Fe-59	30	NDM		NDM	NDM	NDM
	Co-58	15	NDM		NDM	NDM	NDM
	Co-60	15	NDM		NDM	NDM	NDM
	Zn-65	30	NDM		NDM	NDM	NDM
	Zr-95	30	NDM		NDM	NDM	NDM
	Nb-95	15	NDM		NDM	NDM	NDM
	I-131	15	NDM		NDM	NDM	NDM
	Cs-134	15	NDM		NDM	NDM	NDM
	Cs-137	18	NDM		NDM		
	Ba-140	60	NDM		NDM		
	La-140	15	NDM		NDM		
	Tritium 8	3000	140.3 136 to 162 (3/4)	Paper Mill (RM 40) Indicator	140.3 136 to 162 (3/4)		NDM
Off-site Groundwater	Gamma Isotopic 8						



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Locations Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
	Mn-54	15	NDM		NDM		NDM
	Fe-59	30	NDM		NDM		NDM
	Co-58	15	NDM		NDM		NDM
	Co-60	15	NDM		NDM		NDM
	Zn-65	30	NDM		NDM		NDM
	Zr-95	30	NDM		NDM		NDM
	Nb-95	15	NDM		NDM		NDM
	I-131	15	NDM		NDM		NDM
	Cs-134	15	NDM		NDM		NDM
	Cs-137	18	NDM		NDM		NDM
	Ba-140	60	NDM		NDM		NDM
	La-140	15	NDM		NDM		NDM
	Tritium 8	2000	NDM		NDM		NDM
Bottom Feeding Fish (pCi/kg-wet)	Gamma Isotopic 4						
	Mn-54	130	NDM		NDM		NDM
	Fe-59	260	NDM		NDM		NDM
	Co-58	130	NDM		NDM		NDM
	Co-60	130	NDM		NDM		NDM
	Zn-65	260	NDM		NDM		NDM
	Cs-134	130	NDM		NDM		NDM
	Cs-137	150	NDM		NDM		NDM
Game Fish (pCi/kg-wet)	Gamma Isotopic 4						
	Mn-54	130	NDM		NDM		NDM
	Fe-59	260	NDM		NDM		NDM



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Locations Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
	Co-58	130	NDM		NDM		NDM
	Co-60	130	NDM		NDM		NDM
	Zn-65	260	NDM		NDM		NDM
	Cs-134	130	NDM		NDM		NDM
	Cs-137	150	NDM	N/A	NDM		NDM
Sediment (pCi/kg-dry)	Gamma Isotopic 4						
	Co-60	70	NDM		NDM		NDM
	Cs-134	150	NDM		NDM		NDM
	Cs-137	180	NDM		NDM		NDM

Notes:

- (a) The MDC is defined in ODCM 10.1. Except as noted otherwise, the values listed in this column are the detection capabilities required by ODCM Table 4-3. The values listed in this column are a priori (before the fact) MDCs. In practice, the a posteriori (after the fact) MDCs are generally lower than the values listed.
- (b) Mean and range were based upon detectable measurements only. The fraction of all measurements at a specified location that are detectable is placed in parenthesis.
- (c) No Detectable Measurement(s) (NDM).
- (d) The Georgia Power Company Environmental Laboratory has determined that this value may be routinely attained under normal conditions. No value is provided in ODCM Table 4-3.
- (e) Item 3 of ODCM Table 4-1 implies that an I-131 analysis is not required to be performed on water samples when the dose calculated from the consumption of water is less than 1 mrem per year. However, I-131 analyses have been performed on the finished drinking water samples.
- (f) "Other" stations, as identified in the "Station Type" column of Table 2-2, are "Community" and/or "Special" stations.

Not Applicable (NA) (sample not required)



Table 3-2. Reporting Levels (RL)

Analysis	Water (pCi/l)	Airborne Particulate or Gases (fCi/m ³)	Fish (pCi/kg-wet)	Milk (pCi/l)	Grass or Leafy Vegetation (pCi/kg-wet)
H-3	20,000 ^a				
Mn-54	1,000		30,000		
Fe-59	400		10,000		
Co-58	1,000		30,000		
Co-60	300		10,000		
Zn-65	300		20,000		
Zr-95	400				
Nb-95	700				
I-131	2 ^b	900		3	100
Cs-134	30	10,000	1,000	60	1,000
Cs-137	50	20,000	2,000	70	2,000
Ba-140	200			300	
La-140	100			400	

^a This is the 40 CFR 141 value for drinking water samples. If no drinking water pathway exists, a value of 30,000 may be used.

^b If no drinking water pathway exists, a value of 20 pCi/l may be used.

In accordance with ODCM 4.1.1.2.1, deviations from the required sampling schedule were permitted, if samples were unobtainable due to hazardous conditions, unavailability, inclement weather, equipment malfunction or other just reasons. Deviations from conducting the REMP sampling (as described in Table 2-1) are summarized in Table 3-3 along with their causes and resolutions.



Table 3-3. Anomalies and Deviations from Radiological Environmental Monitoring Program

Collection Period	Affected Samples	Anomaly (A)* or Deviation (D)**	Cause	Resolution
03-10-21 to 03-17-21	Air sample PI-1101/II-1101 0.9 mile - N	(A) Non-representative sample of airborne particulate and radioiodine	Lost 25.5 hours of weekly sample collection due to temporary loss of station power during implementation of plant design change	Station returned to normal operation after power was restored to sampling equipment.
04-20-21 to 04-27-21	Air sample PI-1601/II-1601 0.8 mile - N	(A) Non-representative sample of airborne particulate and radioiodine	Lost 13.2 hours of weekly sample collection due to sampling equipment having tripped off during storm event.	Station returned to normal operation after power was restored to sampling equipment.
04-20-21 to 04-27-21	Air sample PC-1108 8.0 miles - WSW	(A) Non-representative sample of airborne particulate and radioiodine	Lost 79.2 hours of weekly sample collection due to sampling equipment having tripped off during storm event.	Station returned to normal operation after power was restored to sampling equipment.
06-01-21 to 06-29-21	Surface Water sample Indicator station (WRI) Georgia-Pacific Paper Co. Intake Structure (Chattahoochee River Mile - 40)	(D) Non-representative sample of surface water gamma isotopic and tritium	Lost 112 monthly composite sample aliquots while river intake pumps were secured during cold shutdown of the Georgia-Pacific Paper Mill	Composite sampler resumed operation at start of next collection period, 06-29-21, after river intake pumps were returned to service.
07-27-21 to 08-03-21, and 08-03-21 to 08-10-21	Air sample PI-1101/II-1101 0.9 mile - N	(D) Non-representative sample of airborne particulate and radioiodine	Lost 241 hours of weekly sample collection due to equipment failure of the station's air sampling pump.	Station resumed normal operation after new sample pump was installed and returned to service.
08-17-21 to 08-24-21	Air sample PC-0703/IC-0703 3.0 miles - SSE	(A) Non-representative sample of airborne particulate and radioiodine	Lost 19.5 hours of weekly sample collection due to sampling equipment having tripped off during storm event.	Station returned to normal operation after power was restored to sampling equipment.
<p>* An anomaly is considered a non-standard sample that still meets sampling criteria outlined in SNC and Georgia Power Labs procedures. ** A deviation is a sample result that is not recorded due to not meeting scheduling and/or procedural requirements as outlined by SNC and Georgia Power Labs</p>				



3.1 Airborne

As specified in Table 2-1, airborne particulate filters are collected weekly at four indicator stations (Stations 0501, 0701, 1101, and 1601) which encircle the plant at the site periphery, at three community stations (0703, 1108, and 1605) approximately three to eight miles from the plant, and at two control stations (0215 and 1218) which range from approximately 15 to 18 miles from the plant. An activated charcoal canister is also placed in series with the particulate filter at each station, except for community stations 1108 and 1605. At each location, air is continuously drawn through a glass fiber filter to retain airborne particulates and, as appropriate, an activated charcoal canister to adsorb radioiodine. The charcoal canister at community station 0703 in Cedar Springs, GA is used for comparison purposes with the Georgia Environmental Protection Division (EPD).

3.1.1 Gross Beta

As provided in Table 3-1, the 2021 annual average weekly gross beta activity was 17.1 fCi/m³ for the indicator stations. It was greater than the control station average of 16.2 fCi/m³ for the year. The difference was less than the calculated MDD of 2.0 fCi/L, so the difference was not statistically discernible. The 2021 annual average weekly gross beta activity at the community stations was 19.1 fCi/m³ which was 2.9 fCi/m³ more than the control station average. The difference was more than the calculated MDD of 2.3 fCi/L, so the difference was statistically discernible, however based on the relationship between the indicator and the control stations this statistical difference is not considered related to plant operations

Average Air Gross Beta historical data (Table 3-4) is graphed to show trends associated with a prevalent exposure pathway (Figure 3-1). In general, there was a close agreement between the results for the indicator, control and community stations. This close agreement supports the position that the plant was not contributing significantly to the gross beta concentrations in air.

Table 3-4. Average Weekly Gross Beta Air Concentration


Period	Indicator (fCi/m ³)	Control (fCi/m ³)	Community (fCi/m ³)		Period	Indicator (fCi/m ³)	Control (fCi/m ³)	Community (fCi/m ³)
Pre-op	90	92	91		1999	20.5	22.1	25.2
1977	205	206	206		2000	20.9	20.8	23.6
1978	125	115	115		2001	16.3	17.2	17.3
1979	27.3	27.3	28.7		2002	16.8	18	16.8
1980	29.7	28.1	29.2		2003	19.1	19.3	19.9
1981	121	115	115		2004	22.0	21.3	22.4
1982	20.0	20.4	21.0		2005	18.4	19.3	19.0
1983	15.5	14.1	14.5		2006	16.1	17.5	16.8
1984	10.2	12.6	10.5		2007	14.5	18.9	17.3
1985	9.0	9.6	10.3		2008	16.7	20.6	18.0
1986	10.5	15.8	12.5		2009	16.2	16.3	17.3



Table 3-4. Average Weekly Gross Beta Air Concentration

Period	Indicator (fCi/m3)	Control (fCi/m3)	Community (fCi/m3)	Period	Indicator (fCi/m3)	Control (fCi/m3)	Community (fCi/m3)
1987	9.0	11.0	17.0	2010	21.2	17.5	18.2
1988	8	8	10	2011	20.9	14.5	18.2
1989	7	7	8	2012	18.0	17.3	18.9
1990	10	10	10	2013	16.7	18.7	16.1
1991	9	10	8	2014	17.7	19.1	18.5
1992	15	17.9	18.5	2015	13.4	15.9	16.8
1993	19.1	22.3	22.4	2016	18.7	18.8	19.9
1994	19.0	20.0	19.0	2017	20.7	18.9	22.1
1995	21.7	22.9	21.6	2018	18.1	16.9	18.3
1996	20.3	22.3	23.5	2019	17.5	17.7	18.1
1997	21.1	21.6	22.4	2020	16.1	14.4	17.1
1998	20.6	19.3	22.0	2021	17.1	16.2	19.1

Figure 3-1. Average Weekly Gross Beta Air Concentration

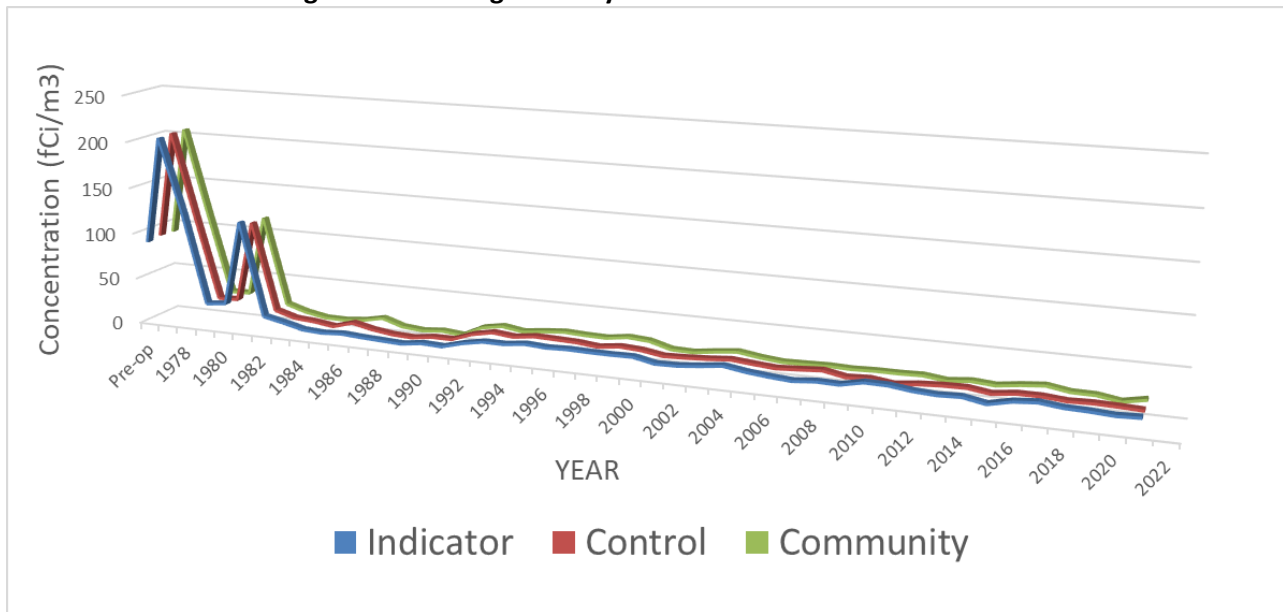

3.1.2 Gamma Particulates and Airborne Radioiodine

During 2021, no radionuclides were detected from the gamma isotopic analysis of the quarterly composites of the air particulate filters other than Be-7, as discussed previously, Be-7 is a naturally occurring isotope and was not released from plant operations and is therefore not further evaluated here.

I-131 was not detected in the air cartridges at either the indicator or control stations in 2021. Historically, gamma isotopes have been detected as a result of offsite events. During pre-operation, Cs-137 was occasionally detected.

3.2 Direct Radiation

In 2021, direct (external) radiation was measured with Optically Stimulated Luminescent (OSL) dosimeters by placing two OSL badges at each station. The gamma dose at each station was reported as the average reading of the two badges. The badges were analyzed on a quarterly basis. An inspection was performed near mid-quarter for offsite badges to ensure that the badges were on-station and to replace any missing or damaged badges.

Two direct radiation stations were established in each of the 16 compass sectors, to form two concentric rings. The inner ring (Stations 0101 through 1601) was located near the plant perimeter as shown in Map A-1 in Appendix A and the outer ring (Stations 0104 through 1605) was located at approximately 5 miles (varying distances) from the plant as shown in Map A-2 in Appendix A. The 16 stations forming the inner ring were designated as the indicator stations. The two-ring configuration of stations was established in accordance with NRC Branch Technical Position "An Acceptable Radiological Environmental Monitoring Program", Revision 1, November 1979. The six control stations (Stations 0215, 0718, 1215, 1218, 1311 and 1612) were located at varying distances greater than 10 miles from the plant as shown in Map A-3 in Appendix A. Monitored special interest areas consist of the following: Station 1001 which was the nearest residence to the plant, and Station 1108 in the town of Ashford, Alabama. The mean and range values presented in the "Other" column in Table 3-1 includes the outer ring stations (stations 0104 through 1605) as well as stations 1001 and 1108.

As provided in Table 3-1, the 2021 average quarterly exposure at the indicator stations (inner ring) was 16.9 mR with a range of 12.1 to 27.5 mR. The 2021 average quarterly exposure at the control station average was 17.5 mR with a range 12.7 mR to 23.8 mR. The MDD was not calculated because the control average was higher than the indicator average. These values are consistent with historical readings, where the indicator and control are closely correlated.

The quarterly exposures acquired at the community/other (outer ring) stations during 2021 ranged from 11.1 -18.1 mR with an average of 14.4 mR which was 3.1 mR less than that of the control stations (17.5 mR). The MDD does not apply since the average is less than that of the control average.



Average Direct Radiation historical data (Table 3-5) is graphed to show trends associated with a prevalent exposure pathway (Figure 3-2). The decrease between 1991 and 1992 values was attributed to a change in Thermoluminescent Dosimeters (TLDs) from Teledyne to Panasonic. It should be noted however that the differences between indicator and control and outer ring values did not change. The increase shown in 2010 reflected issues with the aging Panasonic TLD reader. The close agreement between the station groups has supported the position that the plant was not contributing significantly to direct radiation in the environment.

Figure 3-3 provides a more detailed view of the 2021 values. The values for the indicator and special interest areas detailed below indicate that Plant Farley did not significantly contribute to direct radiation at those areas.

Table 3-5. Average Quarterly Exposure from Direct Radiation (Historical)

Period	Indicator (mR)	Control (mR)	Outer Ring (mR)		Period	Indicator (mR)	Control (mR)	Outer Ring (mR)
Pre-op	12.6	11.4	10.1		1999	14.7	13.4	12.6
1977	10.6	12.2	10.6		2000	15.5	14.1	13.5
1978	15	13.5	12		2001	14.9	13.4	12.7
1979	20.3	18.7	15.2		2002	14.1	12.6	11.9
1980	21.9	21.6	18.5		2003	15.2	13.6	12.9
1981	16.5	14.9	14.5		2004	14.3	12.9	12.1
1982	15.5	14.7	13		2005	14.7	13.4	12.5
1983	20.2	20.2	17.4		2006	15.2	13.6	12.9
1984	18.3	16.9	15.3		2007	14.6	13.3	12.5
1985	21.9	22	18		2008	15.0	13.7	12.9
1986	17.8	17.7	15.1		2009	15.2	13.6	12.8
1987	20.8	20.0	18.0		2010	17.8	16.7	15.5
1988	21.5	19.9	18.5		2011	21.0	19.9	18.4
1989	18.0	16.2	15.3		2012	17.4	15.8	14.7
1990	18.9	16.4	15.8		2013	16.5	15.1	13.8
1991	18.4	16.1	16.1		2014	16.7	15.7	14.1
1992	16.1	13.6	13.5		2015	17.1	15.6	14.4
1993	17.4	15.9	15.6		2016	16.3	15.2	13.9
1994	15.0	13.0	12.0		2017	16.9	16.9	14.2
1995	14.0	12.5	11.8		2018	16.3	16.7	13.7
1996	14.2	12.7	11.9		2019	15.2	15.2	12.8
1997	15.3	13.9	11.9		2020	17.2	17.3	14.4
1998	16.2	14.6	13.9		2021	16.9	17.5	14.4



Figure 3-2. Average Quarterly Exposure from Direct Radiation


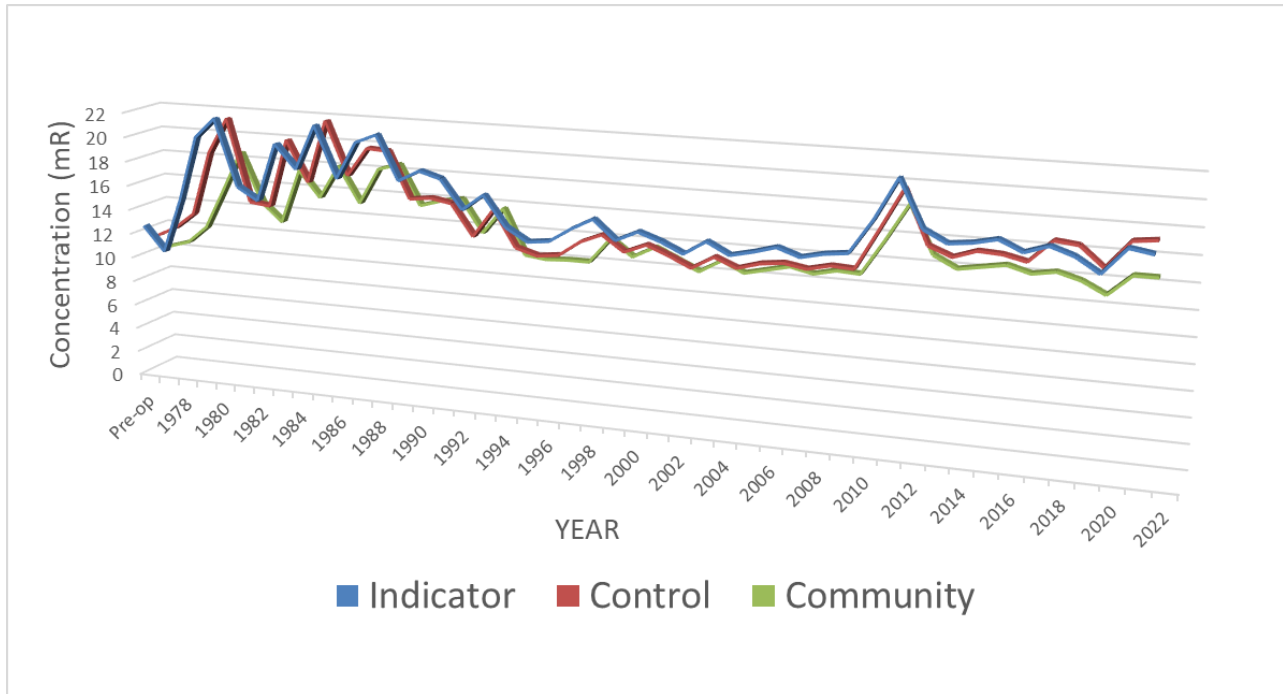


Figure 3-3. 2021 Average Exposure from Direct Radiation in Select Locations

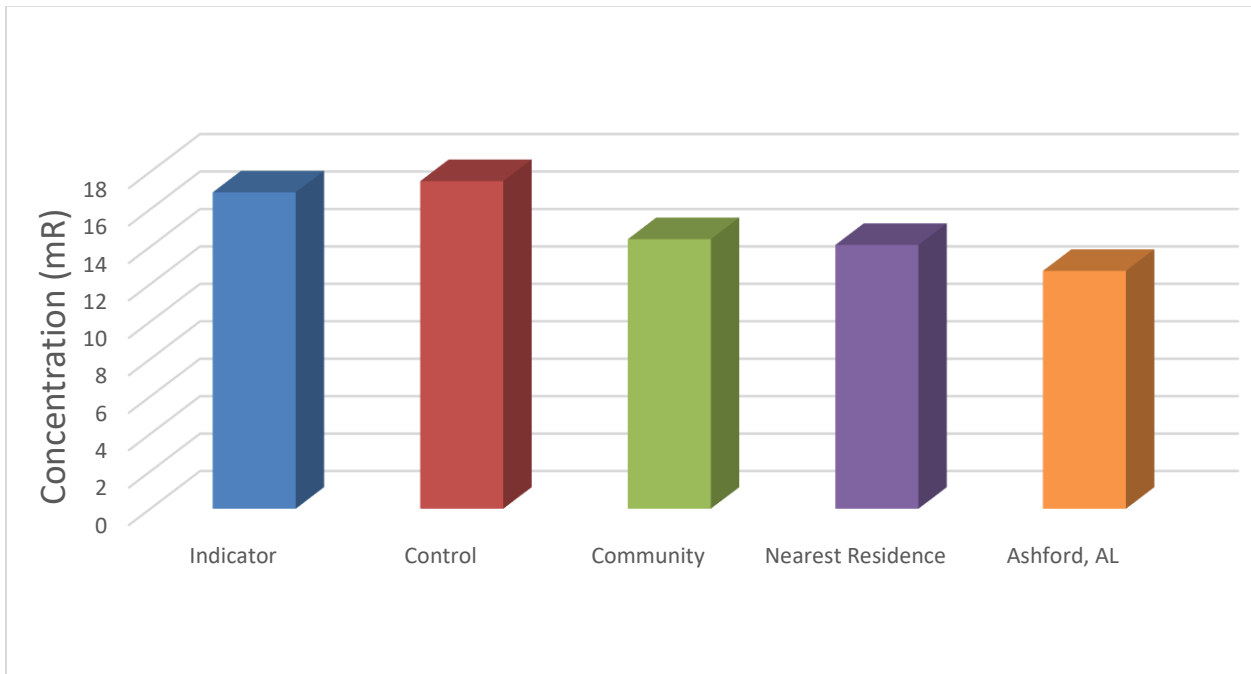

3.3 Biological Media

Cs-137 was the only radionuclide detected in one of the three biological media. As indicated in Figure 3-4, the Cs-137 activity levels were below the respective MDCs and well below that of the respective RLs for each sample media for both the indicator and control stations.

3.3.1 Milk

Milk samples had been collected biweekly from a control location until the end of 2009 when the dairy would no longer provide samples. No indicator station (a location within five miles of the plant) has been available for milk sampling since 1987. As discussed in Section 4.0, no milk animals were found within five miles of the plant during the 2021 land use census and no milk sampling was performed during the reporting year.

3.3.2 Vegetation

In accordance with Table 2-1 and 2-2, forage (vegetation) samples were collected every four weeks at two indicator stations on the plant perimeter, and at one control station located approximately 18 miles west of the plant in Dothan, Alabama. The man-made radionuclide Cs-137 were periodically identified in vegetation samples and was generally attributed to offsite sources (such as weapons testing, Chernobyl, and Fukushima).

During 2021, Cs-137 was identified in one sample at the indicator station, FI-1601-M1 (Dothan, Alabama). The indicator station average (and single value) was 12.92 pCi/L (no range, with only one positive). This average was based only on the detectable values; all other results were below detection limits. No environmental concerns were noted since the results were well below the RL of 2,000 pCi/L for Cs-137 in vegetation.

Be-7 was also detected in vegetation during 2021, but was not released in plant effluents throughout the year. This further illustrates the presence of naturally-occurring Be-7 present in the surrounding environment.

3.3.3 Fish

In accordance with Table 2-1, two types of fish (bottom-feeding and game) were collected on a semiannually basis from the Chattahoochee River at a control station several miles upstream of the plant intake structure and at an indicator station a few miles downstream of the plant discharge structure. These locations are shown in Map A-3 in Appendix A.

3.3.3.1 Bottom Feeding Species

No radionuclides were identified from the control or indicator samples in 2021.



3.3.3.2 Game Species

No radionuclides were identified from the control or indicator samples in 2021.

3.3.4 Biological Media Summary

There were no statistical differences, trends, or anomalies associated with the 2021 biological media samples when compared to historical data. Cs-137 was occasionally present in biological media, as with previous sample results; however, any detections were consistently below both the RL. No other reportable radionuclides were found from the gamma isotopic analysis of biological media samples in 2021.

3.4 Off-site Groundwater

There were no true indicator sources of offsite ground water near Plant Farley. A well, located approximately four miles south-southeast of the plant on the east bank of the Chattahoochee River, serves Georgia Pacific Paper Company as a source of potable water. This well was designated as the indicator station. A deep well located about 1.2 miles southwest of the plant supplies water to the Whatley residence. This well was designated as the control station. Samples were collected quarterly and analyzed for gamma isotopic, I-131 and tritium as specified in Table 2-1. In 2021, there were no radionuclides detected in any of the ground water samples from either sample station, apart from tritium.

Since 2004, tritium has been identified at very low concentrations (near the instrument detection level) and close to environmental background levels in off-site groundwater. Any values has historically represented background conditions for tritium in drinking water and were not attributable to plant activity.

3.5 River (Surface) Water

Composite river water samples were collected monthly at one upstream control location and one downstream indicator location (shown on Map A-2). The details of the sampling protocols are outlined in Tables 2-1 and Table 2-2. A gamma isotopic analysis was conducted on each monthly sample. The monthly aliquots were combined in the lab to form quarterly composite samples in order to be analyzed for tritium.


As provided in Table 3-1, there were no positive results during 2021 from the gamma isotopic analysis of the river water samples. Tritium was detected in three out of the four quarterly composites at the indicator station, with an average of 140.3 pCi/L (range of 136 to 162). Tritium in the control stations had no detectible measurements. The positive tritium results for the indicator were less than the MDC and RL limits (2,000 pCi/l and 20,000 pCi/l, respectively) for tritium in a drinking water supply source. No MDD was calculated because of the level of negative



values. These values represent background conditions for tritium in drinking water and were not attributable to plant activity. Also, note that negative values in radionuclide activity represent contamination factors (e.g. laboratory equipment) subtracted from the laboratory result.

Figure 3-4 below details the 2021 average tritium concentrations across both water mediums.

Figure 3-4. 2021 Average Tritium Concentrations in River and Off-site Groundwater

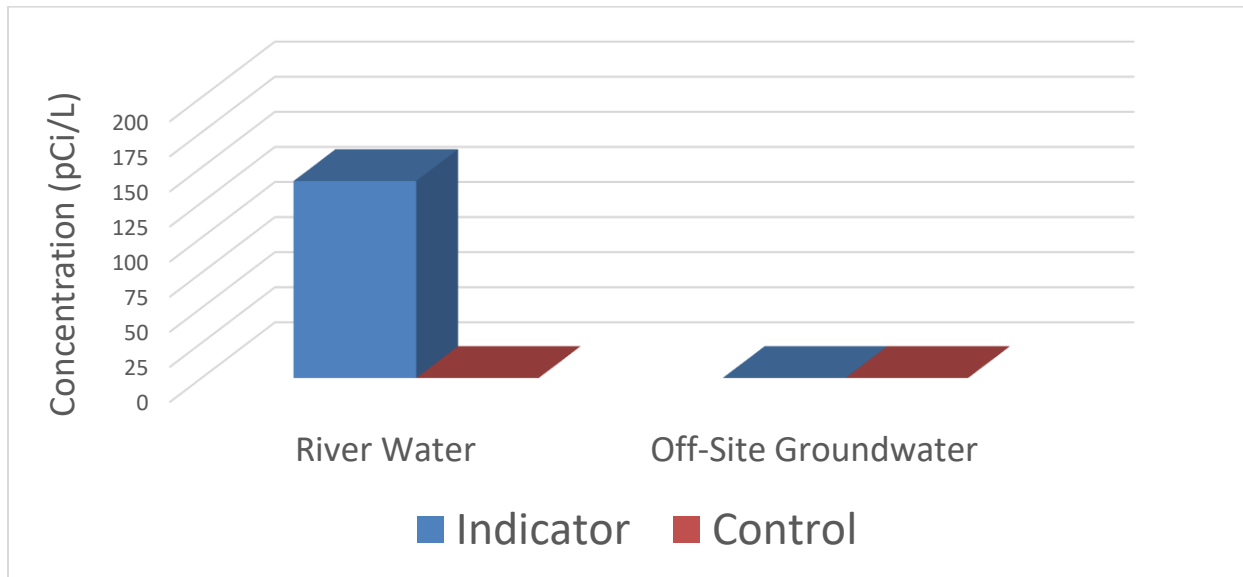

3.6 Sediment

Sediment was collected along the shoreline of the Chattahoochee River in the spring and fall at a control station that was approximately four miles upstream of the intake structure and at an indicator station that was approximately two miles downstream of the discharge structure as shown in Map A-3. A gamma isotopic analysis was performed on each sample. There were no reportable radionuclides detected in sediment samples in 2021.



3.7 Interlaboratory Comparison Program

In accordance with ODCM 4.1.3, GPCEL participated in an Interlaboratory Comparison Program (ICP) which satisfied the requirements of Regulatory Guide 4.15, Revision 1, "Quality Assurance for Radiological Monitoring Programs (Normal Operations) - Effluent Streams and the Environment", February 1979. The ICP included the required determinations (sample medium/radionuclide combinations) included in the REMP.

The ICP was conducted by Eckert & Ziegler Analytics, Inc. (EZA) of Atlanta, Georgia. EZA has a documented Quality Assurance (QA) program and the capability to prepare Quality Control (QC) materials traceable to the National Institute of Standards and Technology. The ICP is a third-party blind testing program which provided a means to ensure independent checks were performed on the accuracy and precision of the measurements of radioactive materials in environmental sample matrices. EZA supplied the crosscheck samples to GPCEL which performed routine laboratory analyses. Each of the specified analyses was performed three times.

The accuracy of each result was measured by the normalized deviation, which is the ratio of the reported average less the known value to the total error. An investigation is undertaken whenever the absolute value of the normalized deviation is greater than three or whenever the coefficient of variation was greater than 15% for all radionuclides other than Fe-59. For Fe-59, an investigation is undertaken when the coefficient of variation exceeds the values shown on Table 3-6 below:

Table 3-6. Interlaboratory Comparison Limits

Nuclide	Concentration *	Percent Coefficient of Variation
Fe-59	<80	25
	>80	15
* For air filters, concentration units are pCi/filter. For all other media, concentration units are pCi/liter (pCi/l).		

As required by ODCM 4.1.3.3 and 7.1.2.3, a summary of the results of the GPCEL's participation in the ICP is provided in Table 3-7 for:

- gross beta and gamma isotopic analyses of an air filter
- gamma isotopic analyses of milk samples
- gross beta, tritium and gamma isotopic analyses of water samples

The 2021 analyses included tritium, gross beta and gamma emitting radionuclides in different matrices. The results for all analyses were within acceptable limits for accuracy.



Table 3-7. Interlaboratory Comparison Summary

Analysis or Radionuclide	Date Prepared	Reported Average	Known Value	Standard Deviation EL	Uncertainty Analytics (1S)	Percent Coefficient of Variation	Normalized Deviation
I-131 ANALYSIS OF AN AIR CARTRIDGE (pCi/cartridge)							
I-131	3/11/2021	89.7	88.1	2.51	1.47	5.60	0.31
GAMMA ISOTOPIC ANALYSIS OF AN AIR FILTER (pCi/filter)							
Ce-141	9/9/2021	123	116	6.27	1.94	7.25	0.82
Co-58		127	119	4.52	1.99	5.65	1.15
Co-60		151	147	1.76	2.45	4.05	0.66
Cs-134		98.6	94.3	3.56	1.58	5.20	0.83
Cs-137		121	113	4.02	1.89	5.44	1.23
Fe-59		107	103	4.72	1.72	6.82	0.52
Mn-54		144	130	2.83	2.17	4.67	2.12
Zn-65		176	155	7.60	2.59	6.48	1.85
GROSS BETA ANALYSIS OF AN AIR FILTER (PCI/FILTER)							
Gross Beta	6/3/2021	123	130	3.91	2.17	4.22	1.35
GAMMA ISOTOPIC ANALYSIS OF A MILK SAMPLE (PCI/LITER)							
Ce-141	9/9/2021	123	114	3.91	1.91	7.3	0.96
Co-58		125	118	5.49	1.97	7.33	0.79
Co-60		155	145	6.18	2.42	6.19	1.05
Cs-134		95.3	93.1	4.43	1.56	6.96	0.33
Cs-137		121	112	5.89	1.87	7.61	0.94
Fe-59		107	102	3.32	1.70	8.17	0.55
I-131		89.5	85.6	9.22	1.43	13.01	0.33
Mn-54		140	128	4.27	2.14	6.40	1.32
Zn-65		170	153	11.54	2.56	9.70	1.01
GROSS BETA ANALYSIS OF WATER SAMPLE (PCI/LITER)							
Gross Beta	6/3/2021	214	258	27.58	4.31	13.79	1.51
	12/2/2021	304	281	6.10	4.69	4.06	-1.87



Table 3-7. Interlaboratory Comparison Summary

Analysis or Radionuclide	Date Prepared	Reported Average	Known Value	Standard Deviation EL	Uncertainty Analytics (1S)	Percent Coefficient of Variation	Normalized Deviation
GAMMA ISOTOPIC ANALYSIS OF WATER SAMPLES (PCI/LITER)							
Ce-141	6/3/2021	187	180	8.62	3.00	7.38	-0.51
Co-58		187	179	9.64	2.98	7.36	-0.56
Co-60		225	215	4.96	3.59	4.95	-0.89
Cs-134		212	213	4.69	3.56	4.86	0.14
Cs-137		192	188	4.00	3.13	5.59	-0.41
Fe-59		178	183	7.52	3.06	7.55	0.36
I-131		95.7	92.0	5.79	1.54	10.44	-0.37
Mn-54		264	249	12.79	4.16	6.82	-0.84
Zn-65		319	300	17.65	5.01	7.77	-0.78
TRITIUM ANALYSIS OF WATER SAMPLES (PCI/LITER)							
H-3	9/9/2021	10800	11700	428.02	195	4.75	-1.66
GAMMA ISOTOPIC ANALYSIS OF VEGETATION SAMPLES (PCI/KG)							
Ce-141	6/3/2021	162	148	9.93	2.48	10.42	0.85
Co-58		164	147	13.6	2.46	11.45	-0.92
Co-60		179	177	8.64	2.96	7.81	-0.16
Cs-134		180	176	11.0	2.93	8.19	-0.28
Cs-137		170	155	7.90	2.58	8.71	-0.98
Fe-59		152	151	12.7	2.52	13.65	-0.07
Mn-54		230	205	13.4	3.43	8.65	-1.27
Zn-65		275	247	28.7	4.13	13.73	-0.73



4 SURVEY SUMMARIES

4.1 Land Use Census

In accordance with ODCM 4.1.2, a land use census was conducted in December 2021 that circumscribed each of the 16 compass sectors within a five mile radius in order to verify the locations of the nearest radiological receptor. A milk animal is a cow or goat producing milk for human consumption. The census results are tabulated in Table 4.1. The 2021 land use census indicated that there were no changes to the nearest location for any of the categories in any of the sectors when compared to the 2020 census, nor were any milk animals located within a five-mile radius.

Table 4-1. Land Use Census Results

Sector	Residence	Milk Animal
Distance in Miles to the Nearest Location in Each Sector		
N	2.6	None
NNE	2.5	None
NE	2.4	None
ENE	2.4	None
E	2.8	None
ESE	3.0	None
SE	3.4	None
SSE	None (>5.0)	None
S	4.3	None
SSW	2.9	None
SW	1.2	None
WSW	2.4	None
W	1.3	None
WNW	2.1	None
NW	1.5	None
NNW	3.4	None

4.2 Chattahoochee River Survey

A previous river survey performed for Plant Farley identified a potential use of water from the Chattahoochee River, downstream of the plant discharge at approximately 2 miles. In July 2013, the Georgia Department of Natural Resources issued a farm use permit to withdraw from the Chattahoochee River to the Nature Conservancy of Georgia. The Nature Conservancy of Georgia leases property along the river for agricultural and grazing purposes to a private farm family, and water from the river could potentially be used for crop irrigation. At the time of this report, no water has been withdrawn and used for crop irrigation by the landowners.



In the fall of 2021, the Georgia Environmental Protection Division (EPD), Alabama Department of Environmental Management (ADEM) and Alabama Department of Economic and Community Affairs (ADECA) were contacted to request any information about river use permits that had been issued in the area near the plant. No additional withdrawal permits or intake locations had been added at the time of the survey.

4.3 Meteorological Report Summary

A consultant analyzes the meteorological tower data collected throughout the year and compares it to previous results. In 2021, the meteorological tower results were comparable to previous years, precipitation amounts (73.74”) and wind direction (from southwest at 10m) were also similar.



5 CONCLUSIONS

This report has confirmed SNCs conformance with the requirements of Chapter 4 of the ODCM and the objectives were to:

- 1) Determine the levels of radiation and the concentrations of radioactivity in the environs; and
- 2) Assess the radiological impact (if any) to the environment due to the operation of the FNP.

Based on the 2021 activities associated with the REMP, SNC offers the following conclusions:

- Samples were collected and there were no deviations or anomalies that negatively affected the quality of the REMP
- Land use census and river survey did not reveal any changes
- Analytical results were below reporting levels
- These values were consistent with historical results which indicate no adverse radiological environmental impacts associated with the operation of FNP




This page intentionally left blank.

APPENDIX A

Maps



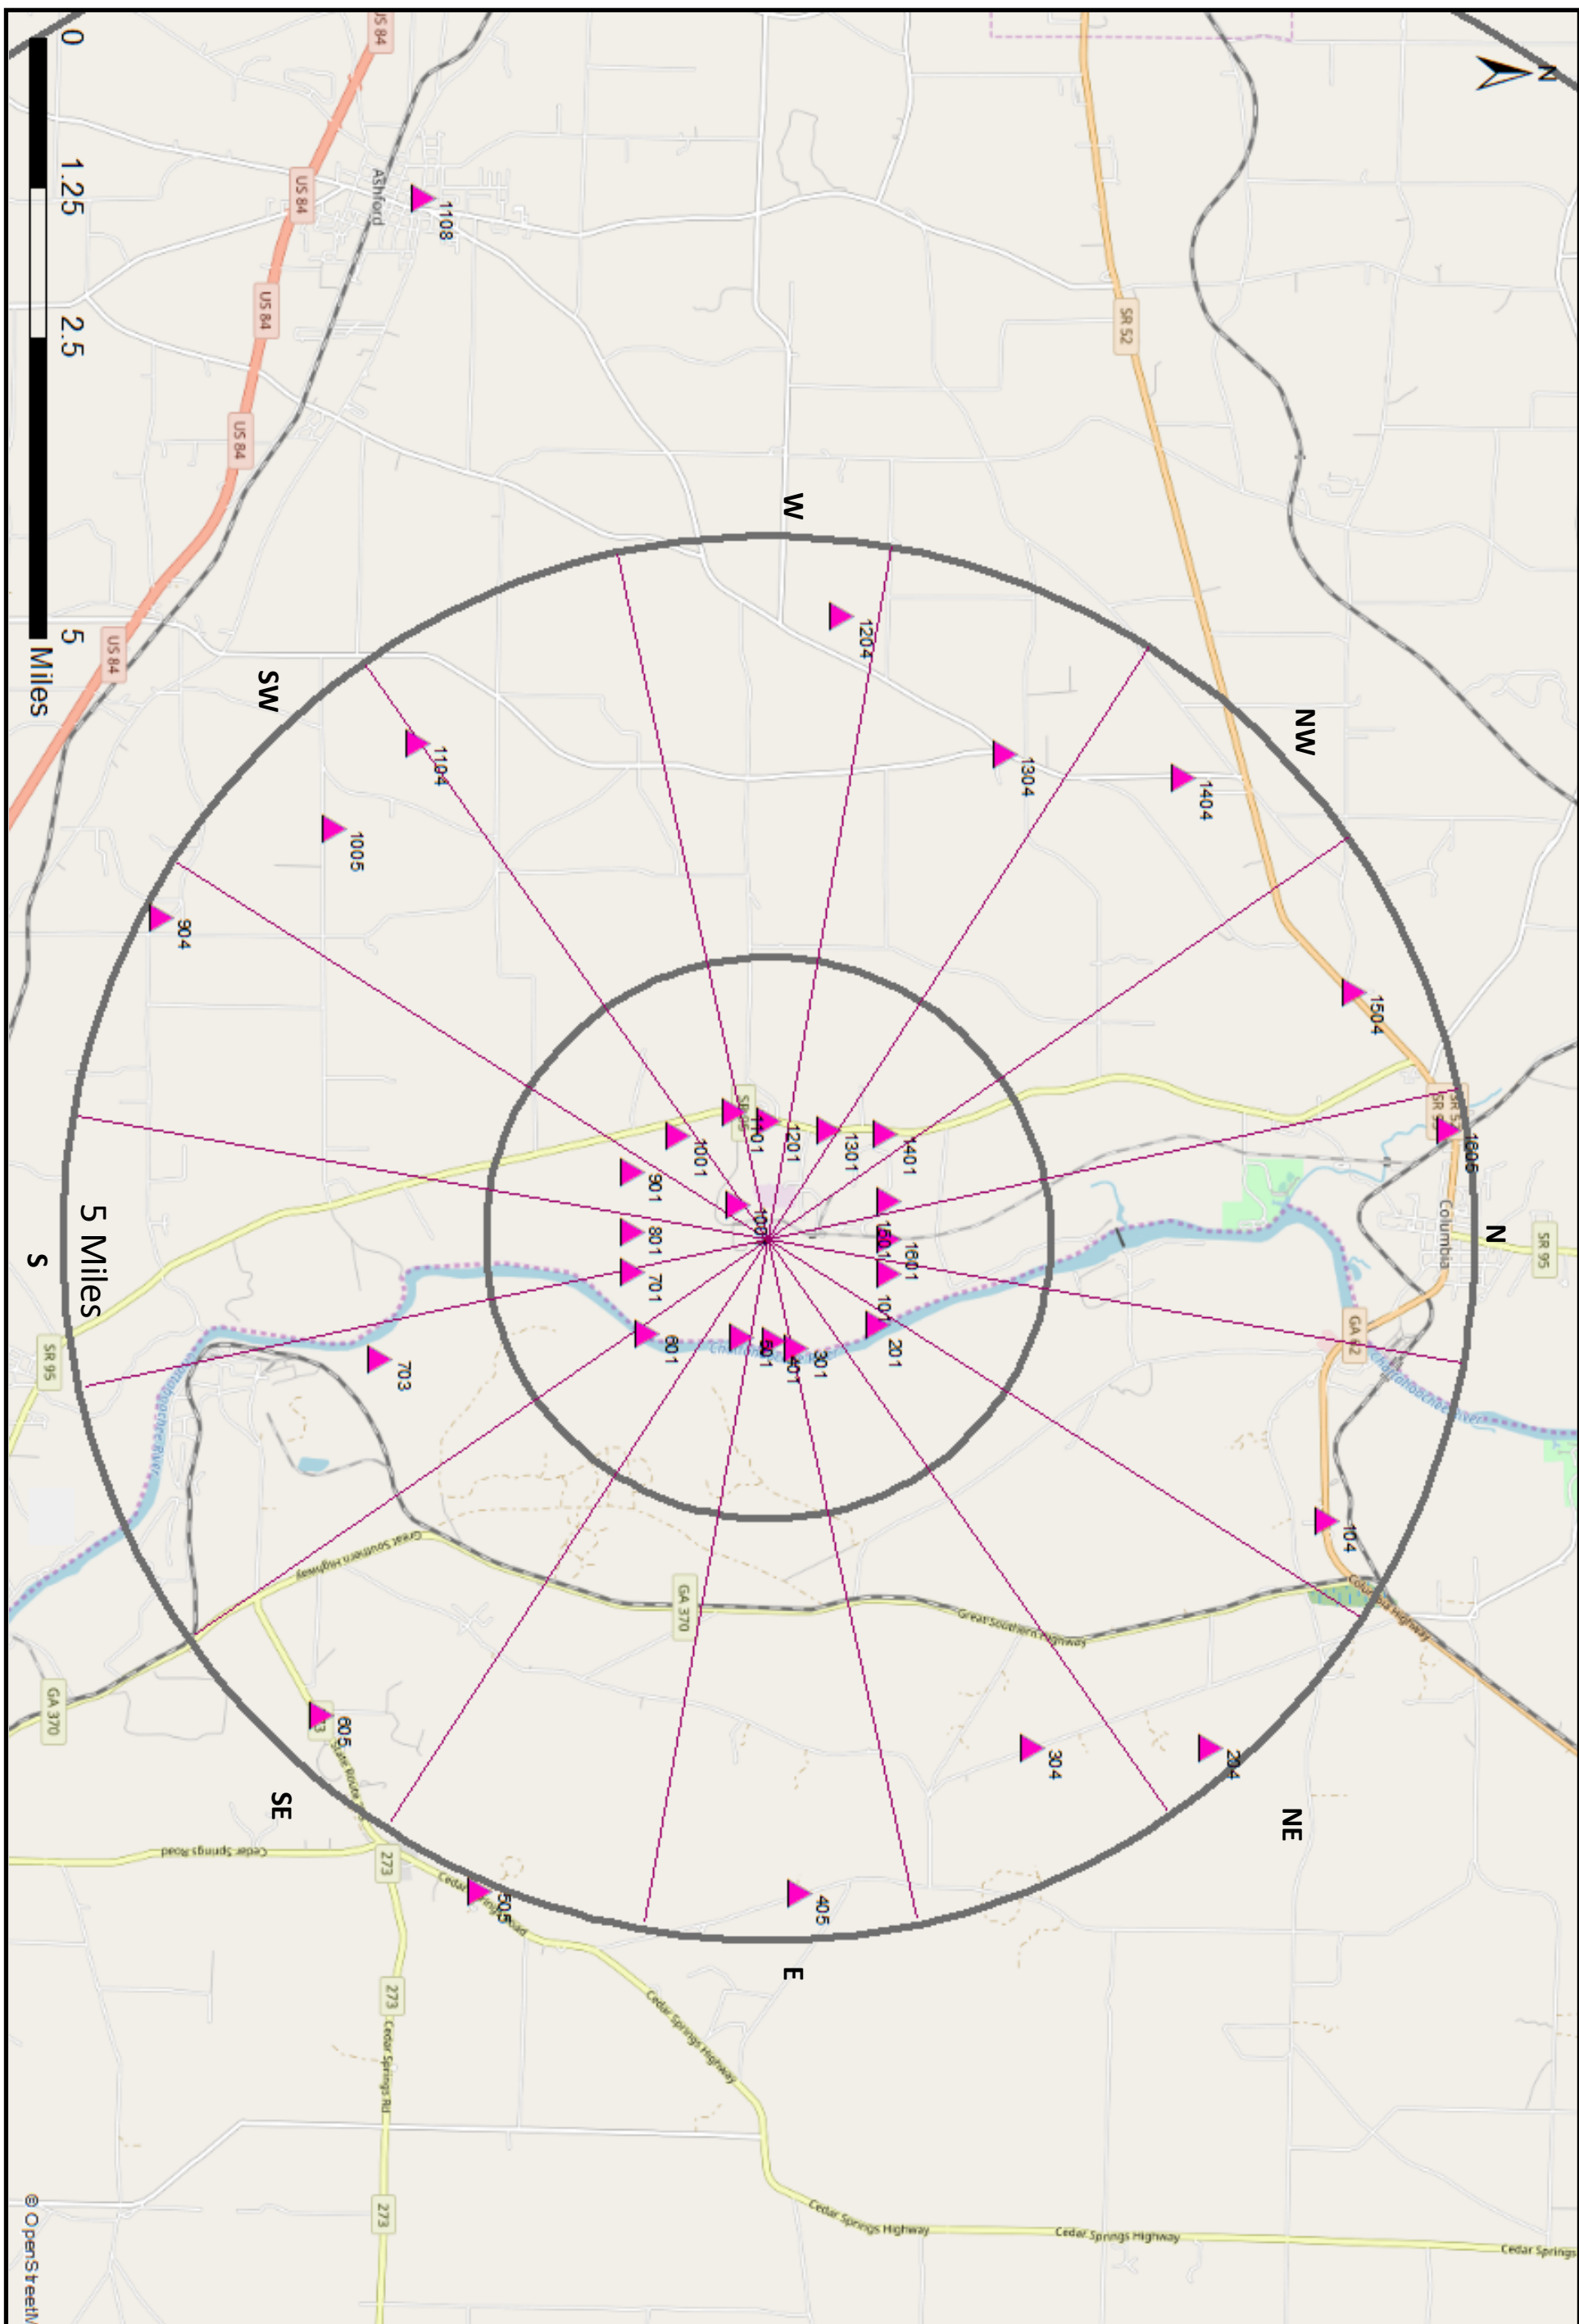

Legend:

Indicator Stations - 


Joseph M. Farley Nuclear Plant
 2021 Radiological Environmental Report REMP
 Stations in Plant Vicinity



Drawn by: C. Groce

April 20, 2022

Appendix A
 Map A-1

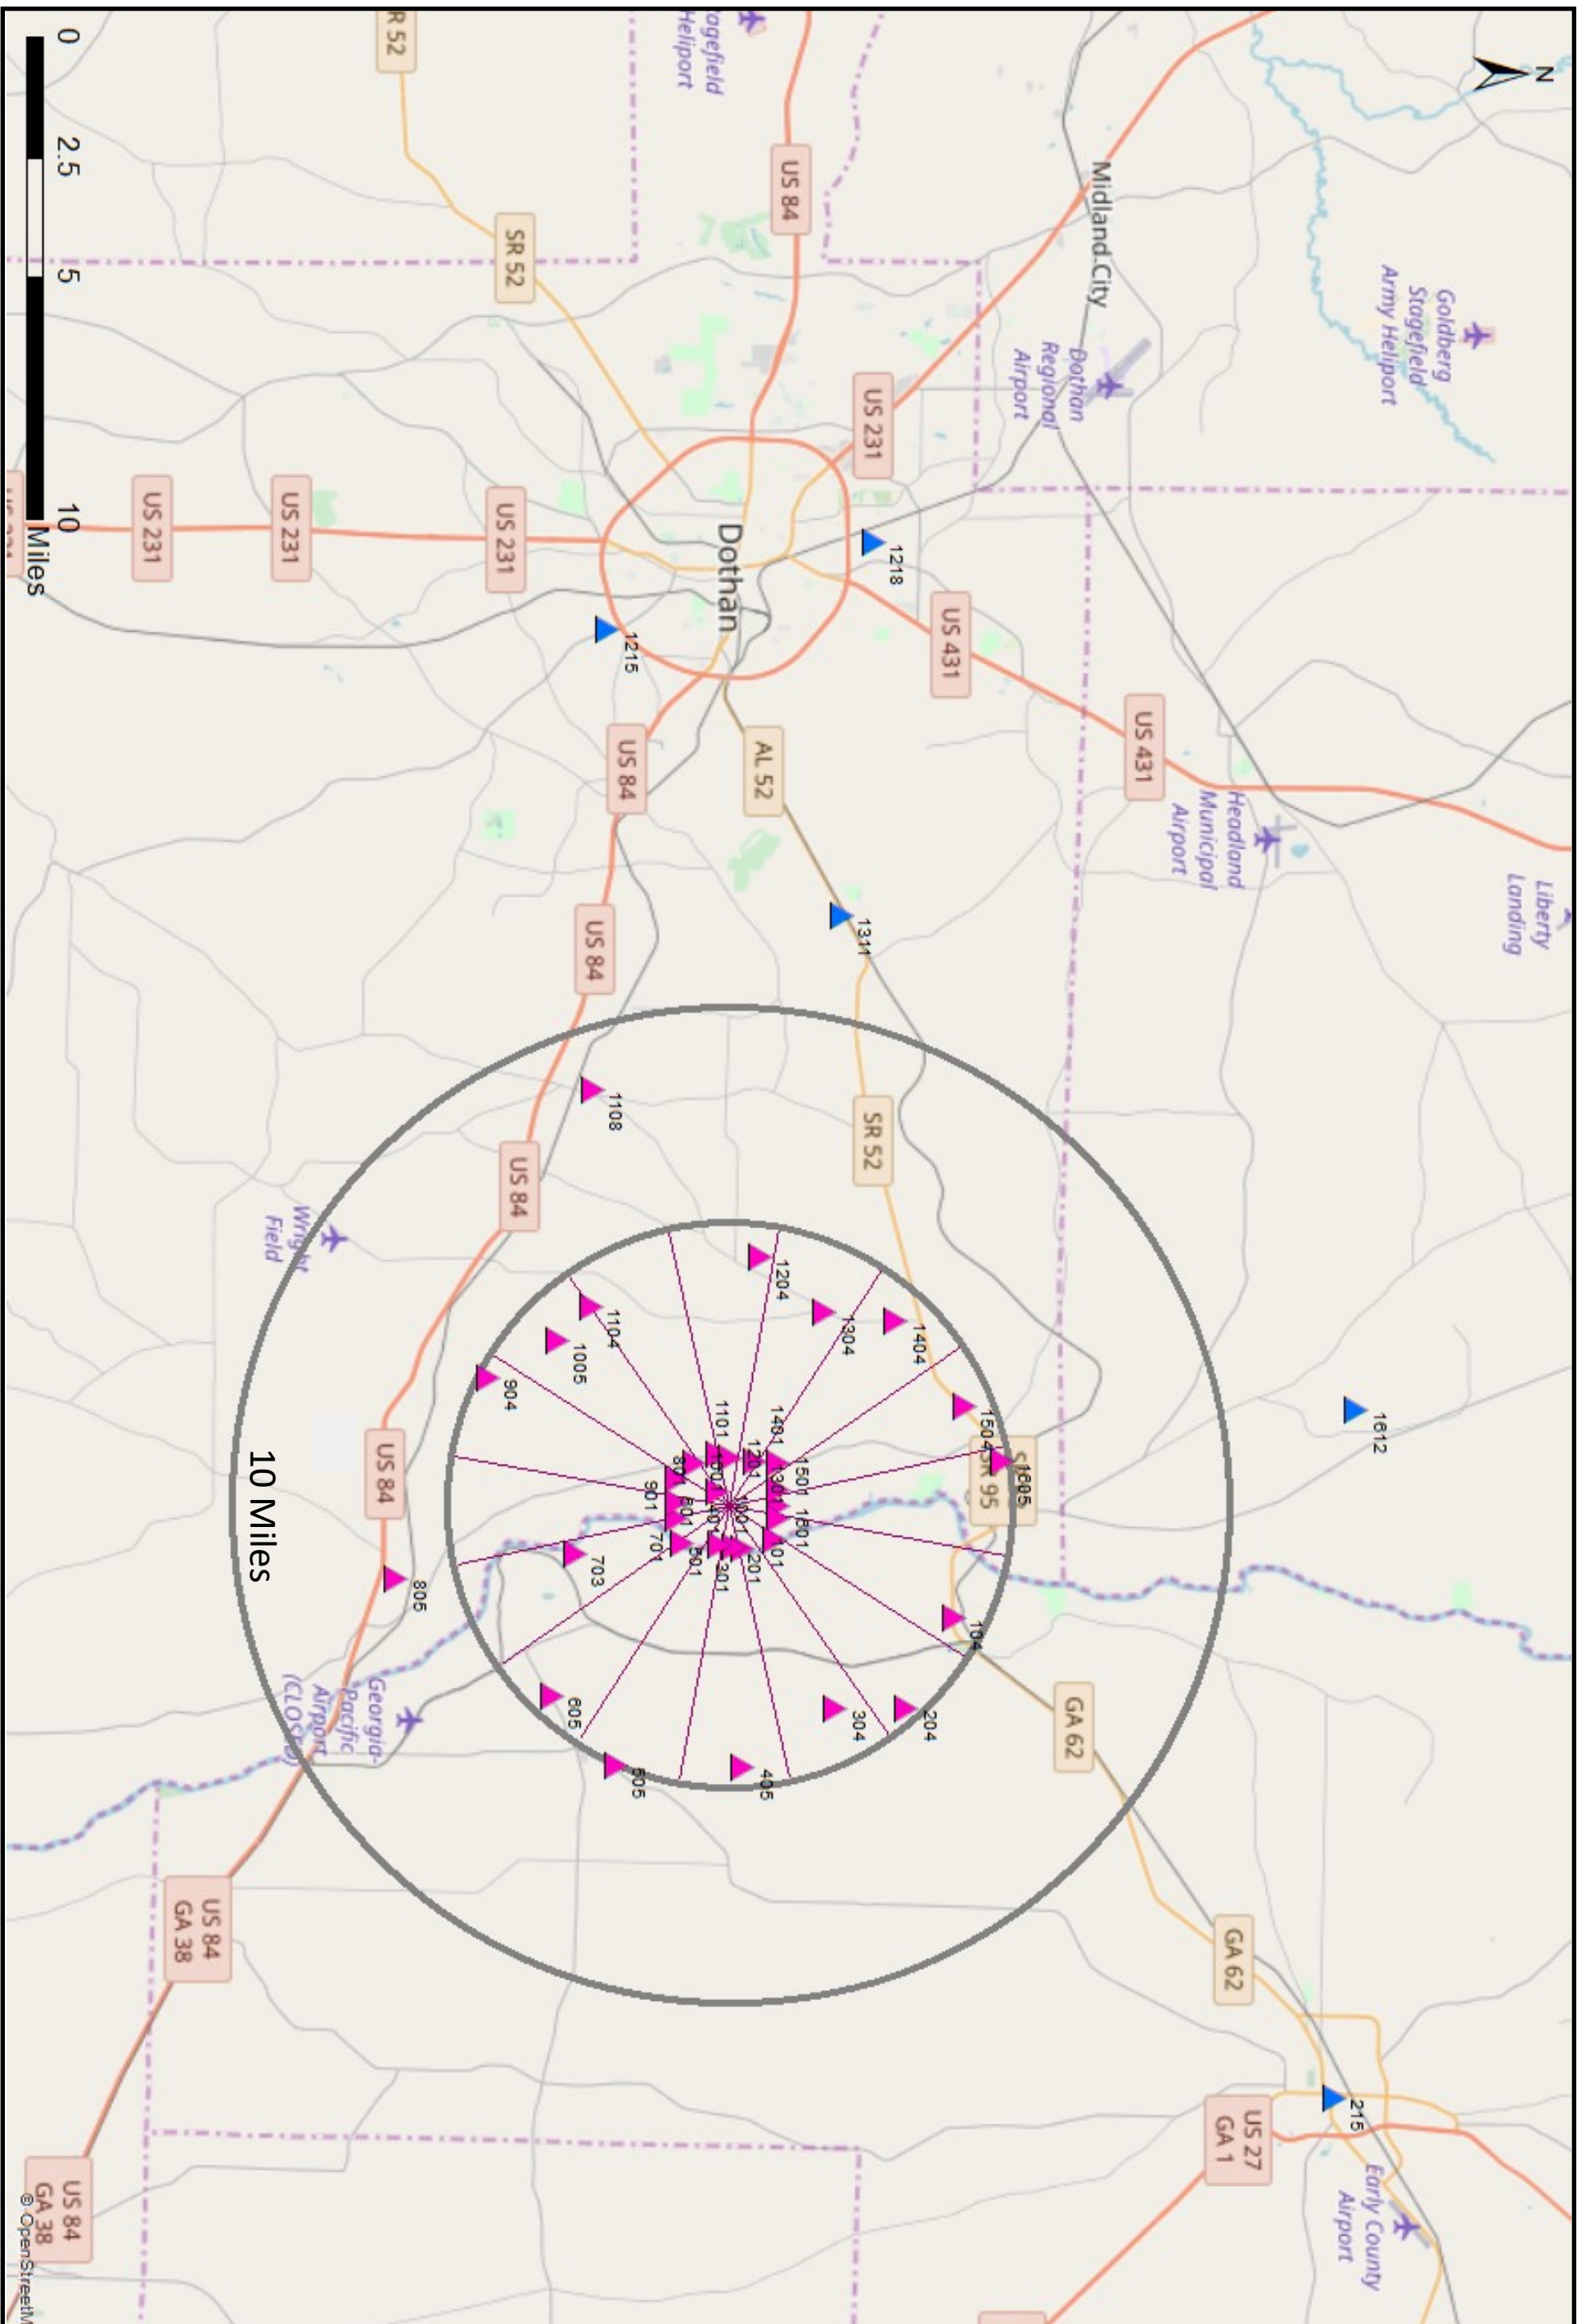


Legend:	
Indicator Stations -	
Control Stations -	

Joseph M. Farley Nuclear Plant
 2021 Radiological Environmental Report REMP
 Stations Within 10 Miles




Drawn by:	C. Groce
April 20, 2022	

Appendix A
 Map A-2

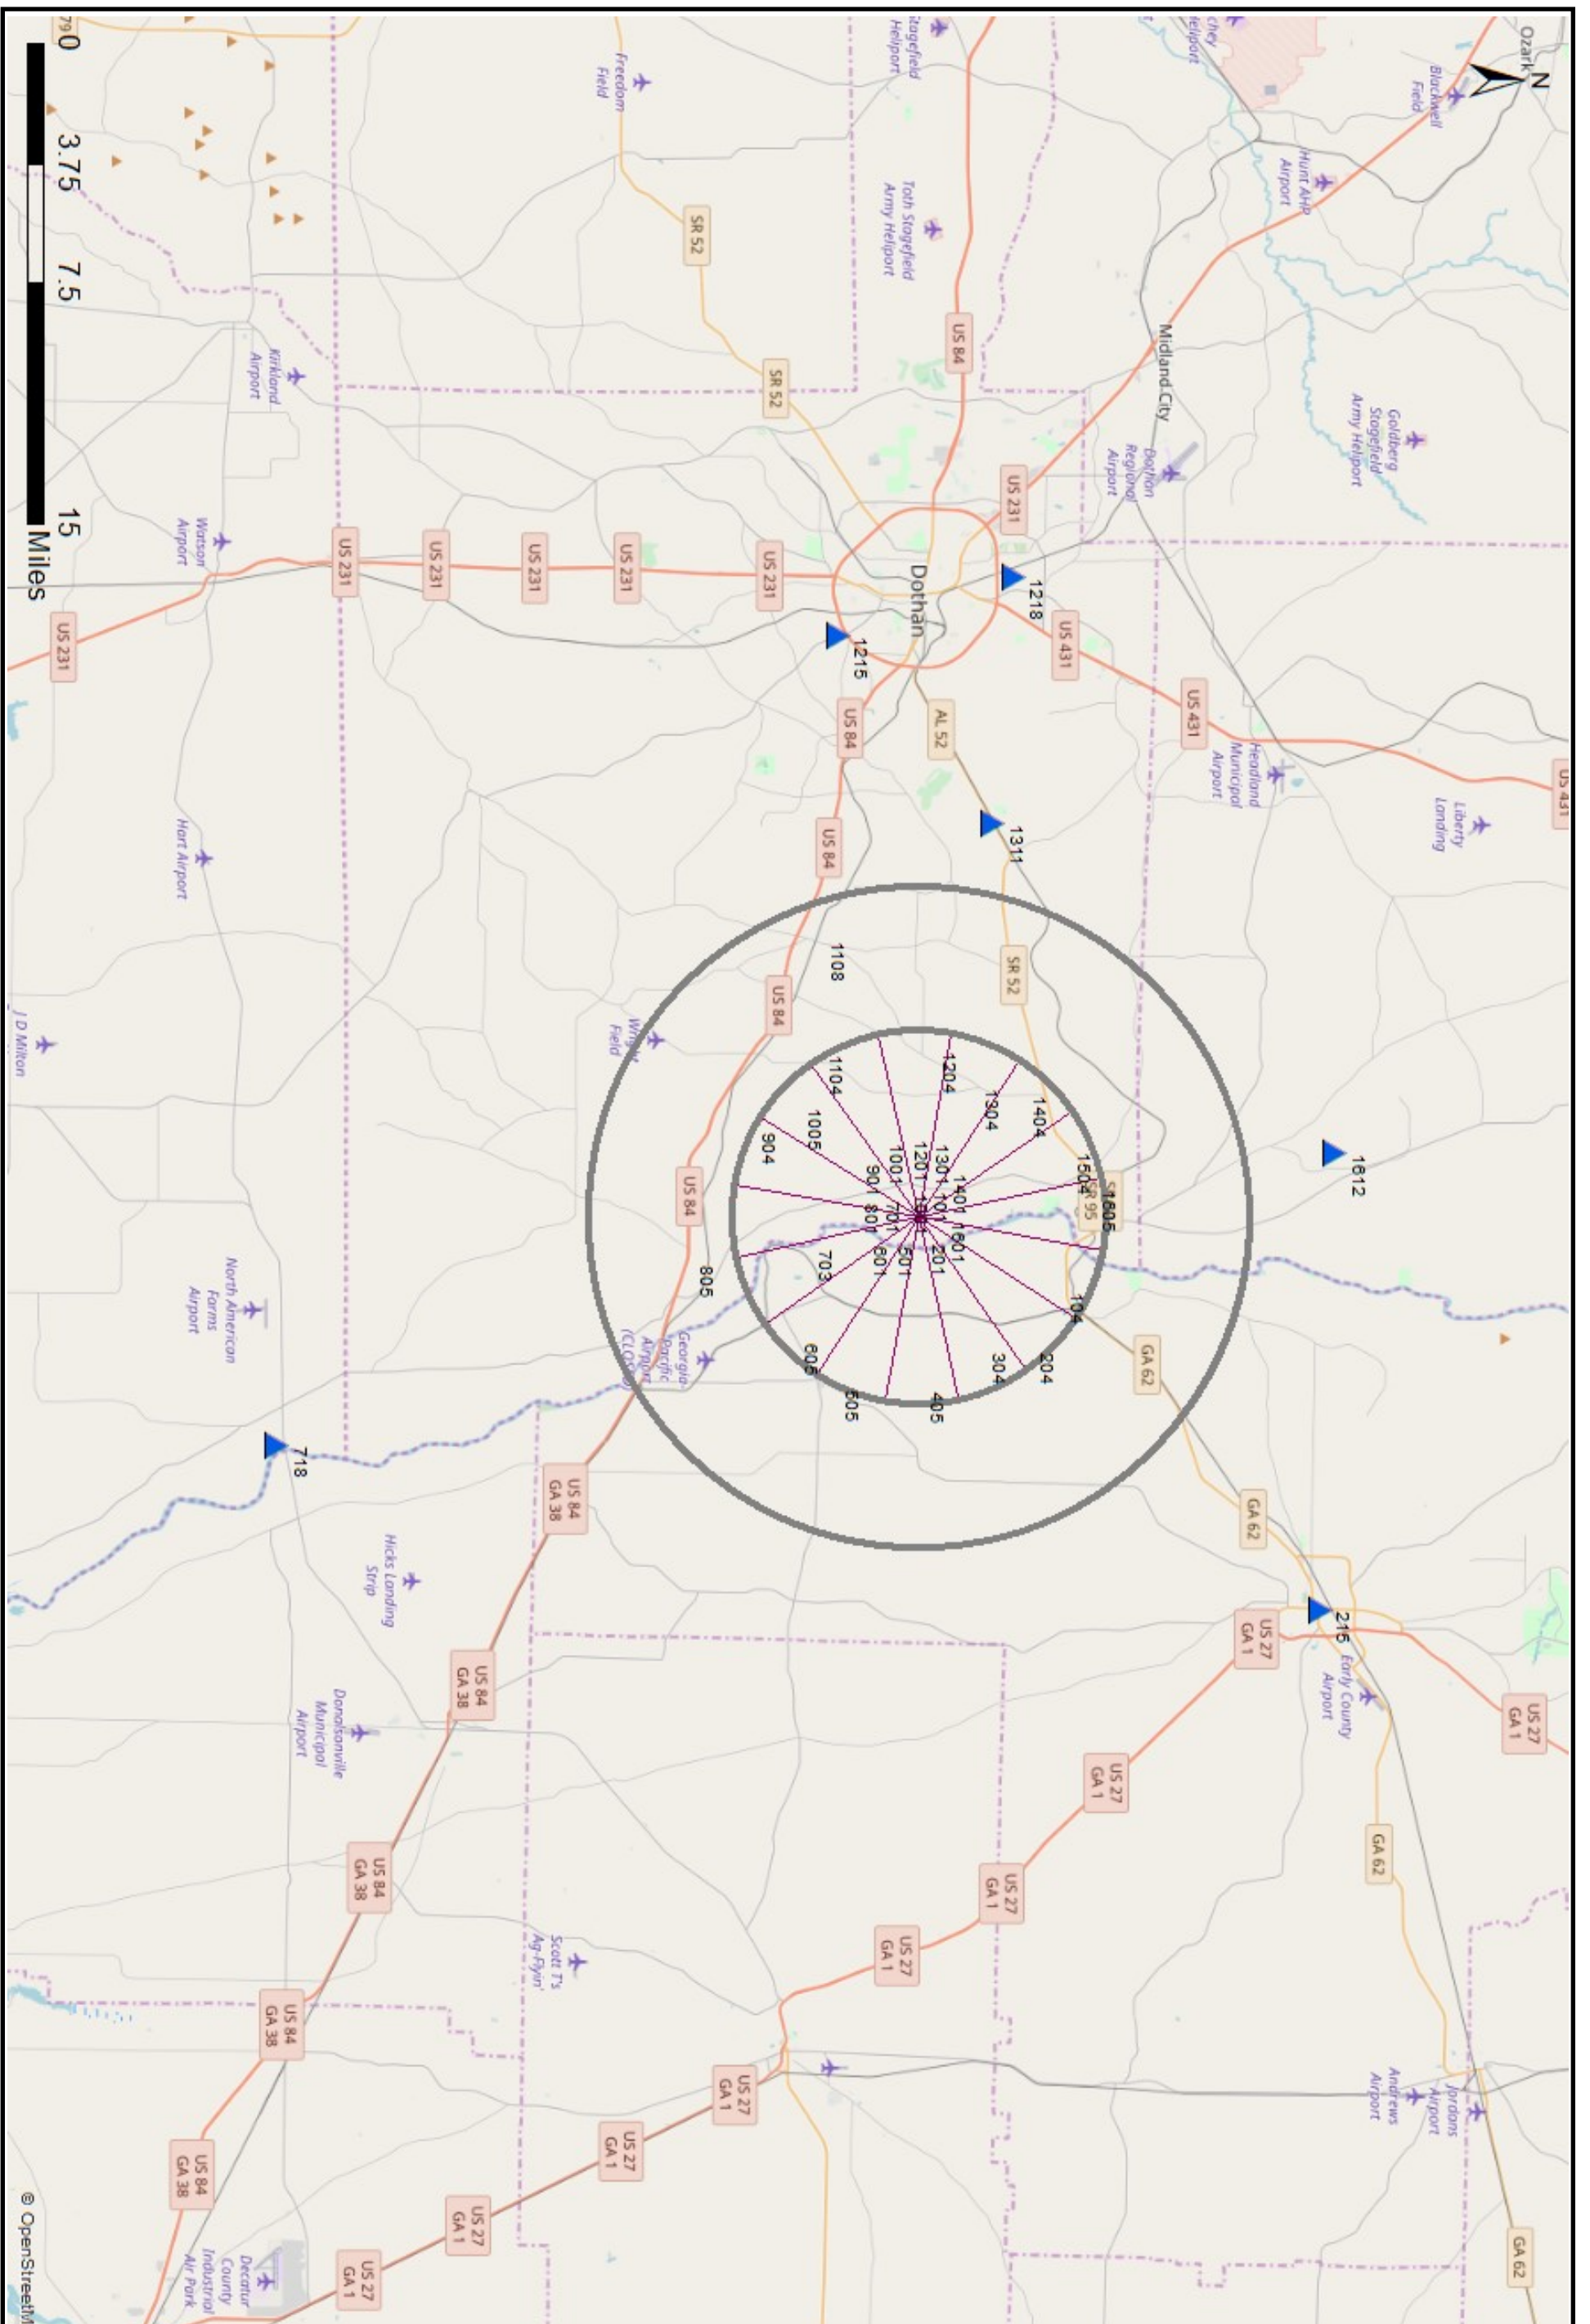

Legend:

Control Stations - 

Joseph M. Farley Nuclear Plant
 2021 Radiological Environmental Report REMP
 Extended Station Locations



Drawn by: C. Groce

April 20, 2022

Appendix A
 Map A-3

This page intentionally left blank.

APPENDIX B

Errata



There are no errata for the 2021 reporting year.



**Edwin I. Hatch Nuclear Plant – Units 1 & 2
Joseph M. Farley Nuclear Plant – Units 1 & 2
Vogtle Electric Generating Plant – Units 1 & 2
Annual Radiological Environmental Operating Reports for 2021**

Enclosure 3

Vogtle Annual Radiological Environmental Operating Report for 2021

**VOGTLE ELECTRIC GENERATING PLANT
2021 ANNUAL RADIOLOGICAL ENVIRONMENTAL
OPERATING REPORT**



This page intentionally left blank.

TABLE OF CONTENTS

1	Introduction	1
2	REMP Description	2
3	Results Summary	9
3.1	Airborne Particulates	18
3.1.1	Gross Beta	18
3.1.2	Gamma Particulates and Airborne Radioiodine	20
3.2	Direct Radiation	20
3.3	Biological Media	23
3.3.1	Milk	23
3.3.2	Vegetation	23
3.3.3	Fish	23
3.3.3.1	Anadromous Species	24
3.3.3.2	Commercially or Recreationally Important Species	24
3.3.4	Biological Media Summary	24
3.4	Drinking Water	25
3.5	River Water	26
3.6	Sediment	27
3.7	Interlaboratory Comparison Program	28
4	Survey Summaries	31
4.1	Land Use Census	31
4.2	Savannah River Survey	31
4.3	Meteorological Report Summary	32
5	Conclusions	33

Tables

Table 2-1.	Summary Description of Radiological Environmental Monitoring Program	3
Table 2-2.	Radiological Environmental Sampling Locations	6
Table 3-1.	Radiological Environmental Monitoring Program Annual Summary	11
Table 3-2.	Reporting Levels (RL)	16
Table 3-3.	Anomalies and Deviations from Radiological Environmental Monitoring Program ..	17
Table 3-4.	Average Weekly Gross Beta Air Concentration	19
Table 3-5.	Average Quarterly Exposure from Direct Radiation	21
Table 3-6.	Interlaboratory Comparison Limits	28
Table 3-7.	Interlaboratory Comparison Summary	29
Table 4-1.	Land Use Census Results	31

Figures

Figure 3-1.	Average Weekly Gross Beta Air Concentration	19
Figure 3-2.	Average Quarterly Exposure from Direct Radiation	22
Figure 3-3.	2018 Average Exposure from Direct Radiation	22
Figure 3-4.	2018 Biological Media Average Cs-137 Concentrations	24



Figure 3-5. 2018 Average Gross Beta Concentration in Raw and Finished Drinking Water..... 25
Figure 3-6. 2018 Average Tritium Concentrations in River, Raw Drinking, and Finished Drinking
Water 27

Appendix A – Maps

- A-1 – REMP Stations in Plant Vicinity
- A-2 – REMP Stations within 10 Miles
- A-3 – Extended REMP Stations

Appendix B – Errata

Appendix C – Data



LIST OF ACRONYMS

EPA	Environmental Protection Agency
GPC	Georgia Power Company
GPCEL	Georgia Power Company Environmental Laboratory
ICP	Interlaboratory Comparison Program
MDC	Minimum Detectable Concentration
MDD	Minimum Detectable Difference
MWt	MegaWatts Thermal
NA	Not Applicable
NDM	No Detectable Measurement(s)
NEI	Nuclear Energy Institute
NRC	Nuclear Regulatory Commission
ODCM	Offsite Dose Calculation Manual
OSL	Optically Stimulated Luminescence
PWR	Pressurized Water Reactor
REMP	Radiological Environmental Monitoring Program
RL	Reporting Level
RM	River Mile
SNC	Southern Nuclear Operating Company
SRS	Savannah River Site
TLD	Thermoluminescent Dosimeter
TS	Technical Specification
VEGP	Alvin W. Vogtle Electric Generating Plant



1 INTRODUCTION

The Radiological Environmental Monitoring Program (REMP) was conducted in accordance with Chapter 4 of the Offsite Dose Calculation Manual (ODCM). The REMP activities for 2021 were reported herein in accordance with Technical Specification (TS) 5.6.2 and ODCM 7.1.

The objectives of the REMP were to:

- 1) Determine the levels of radiation and the concentrations of radioactivity in the environs and;
- 2) Assess the radiological impact (if any) to the environment due to the operation of the Alvin W. Vogtle Electric Generating Plant (VEGP).

The assessments included comparisons between results of analyses of samples obtained at locations where radiological levels were not expected to be affected by plant operation (control stations), areas of higher population (community stations), and at locations where radiological levels were more likely to be affected by plant operation (indicator stations), as well as comparisons between preoperational and operational sample results.

VEGP is owned by Georgia Power Company (GPC), Oglethorpe Power Corporation, the Municipal Electric Authority of Georgia, and the City of Dalton, Georgia. It is located on the southwest side of the Savannah River approximately 23 river miles upstream from the intersection of the Savannah River and U.S. Highway 301. The site is in the eastern sector of Burke County, Georgia, across the river from Barnwell County, South Carolina. The VEGP site is directly across the Savannah River from the Department of Energy Savannah River Site (SRS). Unit 1, a Westinghouse Electric Corporation Pressurized Water Reactor (PWR), with a licensed core thermal power of 3,626 MegaWatts (MWt), received its operating license on January 16, 1987 and commercial operation started on May 31, 1987. Unit 2, also a Westinghouse PWR rated for 3,626 MWt, received its operating license on February 9, 1989 and began commercial operation on May 19, 1989. Both units were relicensed on June 3, 2009.

The pre-operational stage of the REMP began with initial sample collections in August of 1981. The transition from the pre-operational to the operational stage of the REMP occurred as Unit 1 reached initial criticality on March 9, 1987.

- A description of the REMP is provided in Section 2 of this report
- Section 3 provides a summary of the results, an assessment of any radiological impacts to the environment, and the results from the interlaboratory comparison
- A summary of the land use census and the river survey are included in Section 4
- Conclusions are included in Section 5



2 REMP DESCRIPTION

The following section provides a description of the sampling and laboratory protocols associated with the REMP. Table 2-1 provides a summary of the sample types to be collected and the analyses to be performed in order to monitor the airborne, direct radiation, waterborne and ingestion pathways, and also summarizes the collection and analysis frequencies (in accordance with ODCM Section 4.2). Table 2-2 provides specific information regarding the station locations, their proximity to the plant, and exposure pathways. Additionally, Appendix A of this report provides Maps A-1 through A-4 that depict the georeferenced location of sampling stations are. Any Errata from previous reports are provided in Appendix B. All data points resulting from REMP sampling are provided in Appendix C.

During 2021 a contractor through Southern Nuclear Operating Company (SNC) provided services for the collection of all of the REMP samples. The Georgia Power Central Environmental Laboratory (GPCEL) analyzed all REMP samples.



Table 2-1. Summary Description of Radiological Environmental Monitoring Program

Exposure Pathway and/or	Number of Representative Samples and Sample Locations	Sampling/Collection Frequency	Type/Frequency of Analysis
Direct Radiation	40 routine monitoring stations with two or more dosimeters placed as follows: An inner ring of stations, one in each compass sector in the general area of the site boundary; An outer ring of stations, one in each compass sector at approximately five miles from the site; and Special interest areas, such as population centers, nearby recreation areas, and control stations	Quarterly	Gamma dose/Quarterly
Airborne Radioiodine and Particulates ¹	Samples from seven locations: Five locations close to the site boundary in different sectors; A community having the highest calculated annual average ground level D/Q; A control location near a population center at a distance of about 14 miles	Continuous sampler operation with sample collection weekly, or more frequently if required by dust loading	Radioiodine canister: I-131 analysis, weekly Particulate sampler: Gross beta analysis ¹ following filter change and gamma isotopic analysis ² of composite (by location) /Quarterly
Waterborne			
Surface ³	One sample upriver Two samples downriver	Composite sample over one month period ⁴	Gamma isotopic analysis ² , monthly Composite for tritium analysis/Quarterly



Table 2-1. Summary Description of Radiological Environmental Monitoring Program

Exposure Pathway and/or	Number of Representative Samples and Sample Locations	Sampling/Collection Frequency	Type/Frequency of Analysis
Drinking	Two samples at each of the three nearest water treatment plants that could be affected by plant discharges Two samples at a control location	Composite sample of river water near the intake of each water treatment plant over two week period ⁴ when I-131 analysis is required for each sample; monthly composite otherwise; and grab sample of finished water at each water treatment plant every two weeks or monthly, as appropriate	I-131 analysis on each sample when the dose calculated for the consumption of the water is greater than 1 mrem per year ⁵ . Composite for gross beta and gamma isotopic analysis ² on raw water/Monthly. Gross beta, gamma isotopic and I-131 analyses on grab sample of finished water/Monthly. Composite for tritium analysis on raw and finished water/Quarterly
Shoreline Sediment	One sample from downriver area with existing or potential recreational value One sample from upriver area with existing or potential recreational value	Semiannually	Gamma isotopic analysis ² /Semiannually
Ingestion			
Milk	Two samples from milking animals ⁶ at control locations at a distance of about 10 miles or more	Bimonthly	Gamma isotopic analysis ^{2,7} /Bimonthly
Fish	At least one sample of any commercially or recreationally important species near the plant discharge At least one sample of any commercially or recreationally important species in an area not influenced by plant discharges At least one sample of any anadromous species near the plant discharge	Semiannually During spring spawning season	Gamma isotopic analysis ² on edible portions/Semiannually Gamma isotopic analysis ² on edible portions/Annually.
Grass or Leafy Vegetation	One sample from two onsite locations near the site boundary in different sectors One sample from a control location at a distance of about 17 miles	Monthly during growing season	Gamma isotopic analysis ^{2,7} Monthly



Table 2-1. Summary Description of Radiological Environmental Monitoring Program

Exposure Pathway and/or	Number of Representative Samples and Sample Locations	Sampling/Collection Frequency	Type/Frequency of Analysis
<p>Notes:</p> <p>¹Airborne particulate sample filters were analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air particulate samples was greater than 10 times the yearly mean of control samples, gamma isotopic analysis was performed on the individual samples.</p> <p>²Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.</p> <p>³Upriver sample was taken at a distance beyond significant influence of the discharge. Downriver samples were taken beyond but near the mixing zone.</p> <p>⁴Composite sample aliquots were collected at time intervals that were very short (e.g., hourly) relative to the compositing period (e.g., monthly) to ensure obtaining a representative sample.</p> <p>⁵The dose was calculated for the maximum organ and age group, using the methodology and parameters in the ODCM.</p> <p>⁶A milking animal is a cow or goat producing milk for human consumption.</p> <p>⁷If the gamma isotopic analysis is not sensitive enough to meet the Minimum Detectable Concentration (MDC) for I-131, a separate analysis for I-131 may be performed.</p>			



Table 2-2. Radiological Environmental Sampling Locations

Station Number	Station Type	Descriptive Location	Direction ¹	Distance (miles) ¹	Radiation Sample Type
1	Indicator	River Bank	N	1.1	Direct
2	Indicator	River Bank	NNE	0.8	Direct
3	Indicator	Discharge Area	NE	0.6	Airborne
3	Indicator	River Bank	NE	0.7	Direct
4	Indicator	River Bank	ENE	0.8	Direct
5	Indicator	River Bank	E	1.0	Direct
6	Indicator	Plant Wilson	ESE	1.1	Direct
7	Indicator	Simulator Building	SE	1.7	Airborne, Direct, Vegetation
8	Indicator	River Road	SSE	1.1	Direct
9	Indicator	River Road	S	1.1	Direct
10	Indicator	Met Tower	SSW	0.9	Airborne
10	Indicator	River Road	SSW	1.1	Direct
11	Indicator	River Road	SW	1.2	Direct
12	Indicator	River Road	WSW	1.2	Airborne, Direct
13	Indicator	River Road	W	1.3	Direct
14	Indicator	River Road	WNW	1.8	Direct
15	Indicator	Hancock Landing Road	NW	1.5	Direct, Vegetation
16	Indicator	Hancock Landing Road	NNW	1.4	Airborne, Direct
17	Other	Sav. River Site (SRS), River Road	N	5.4	Direct
18	Other	SRS, D Area	NNE	5.0	Direct
19	Other	SRS, Road A.13	NE	4.6	Direct
20	Other	SRS, Road A.13.1	ENE	4.8	Direct
21	Other	SRS, Road A.17	E	5.3	Direct
22	Other	River Bank	ESE	5.2	Direct



Table 2-2. Radiological Environmental Sampling Locations

Station Number	Station Type	Descriptive Location	Direction ¹	Distance (miles) ¹	Radiation Sample Type
23	Other	River Road	SE	4.6	Direct
24	Other	Chance Road	SSE	4.9	Direct
25	Other	Chance Road near Highway 23	S	5.2	Direct
26	Other	Highway 23 and Ebenezer Church Road	SSW	4.6	Direct
27	Other	Highway 23 opposite Boll Weevil Road	SW	4.7	Direct
28	Other	Thomas Road	WSW	5.0	Direct
29	Other	Claxton-Lively Road	W	5.1	Direct
30	Other	Nathaniel Howard Road	WNW	5.0	Direct
31	Other	River Road at Allen's Chapel Fork	NW	5.0	Direct
32	Other	River Bank	NNW	4.7	Direct
35	Other	Girard	SSE	6.6	Airborne, Direct
36	Control	GPC Waynesboro Op. HQ	WSW	13.9	Airborne, Direct
37	Control	Substation, Waynesboro, GA	WSW	16.7	Direct, Vegetation
43	Other	Employee's Rec. Center	SW	2.2	Direct
47	Control	Oak Grove Church	SE	10.4	Direct
48	Control	McBean Cemetery	NW	10.2	Direct
51	Control	SGA School, Sardis, GA	S	11.0	Direct
52	Control	Oglethorpe Substation; Alexander, GA	SW	10.7	Direct
80	Control	Augusta Water Treatment Plant	NNW	29.0	Drinking Water ²
81	Control	Sav. River	N	2.5	Fish ³ Sediment ⁴
82	Control	Sav. River (RM 151.2)	NNE	0.8	River Water
83	Indicator	Sav. River (RM 150.4)	ENE	0.8	River Water Sediment ⁴
84	Other	Sav. River (RM 149.5)	ESE	1.6	River Water
85	Indicator	Sav. River	ESE	4.3	Fish ³
87	Indicator	Beaufort-Jasper County Water Treatment Plant	SE	76	Drinking Water ⁵



Table 2-2. Radiological Environmental Sampling Locations

Station Number	Station Type	Descriptive Location	Direction ¹	Distance (miles) ¹	Radiation Sample Type
88	Indicator	Cherokee Hill Water Treatment Plant, Port Wentworth, GA	SSE	72	Drinking Water ⁶
89	Indicator	Purrysburg Water Treatment Plant; Purrysburg, SC	SSE	76	Drinking Water ⁷
98	Control	W.C. Dixon Dairy	SE	9.8	Milk ⁸
101	Indicator	Girard Dairy	S	5.5	Milk ⁸
102	Control	Seven Oaks Dairy/Milky Way Dairy	W	7.5/16.0	Milk ⁸

Notes:

¹Direction and distance were determined from a point midway between the two reactors.

²The intake for the Augusta Water Treatment Plant was located on the Augusta Canal. The entrance to the canal was at River Mile (RM) 207 on the Savannah River. The canal effectively parallels the river. The intake to the pumping station was about 4 miles down the canal.

³A 5-mile stretch of the river was generally needed to obtain adequate fish samples. Samples were normally gathered between RM 153 and 158 for upriver collections and between RM 144 and 149.4 for downriver collections.

⁴Sediment was collected at locations with existing or potential recreational value. Because high water, shifting of the river bottom, or other reasons could cause a suitable location for sediment collections to become unavailable or unsuitable, a stretch of the river between RM 148.5 and 150.5 was designated for downriver collections while a stretch between RM 153 and 154 was designated for upriver collections. In practice, collections were normally made at RM 150.2 for downriver collections and RM 153.3 for upriver collections.

⁵DELETED THIS SAMPLE LOCATION IN 2014 (LDCR 2014004) The intake for the Beaufort-Jasper County Water Treatment Plant was located at the end of canal that began at RM 39.3 on the Savannah River. This intake was about 16 miles by line of sight down the canal from its beginning on the Savannah River.

⁶The intake for the Cherokee Hill Water Treatment Plant was located on Abercorn Creek which is about one and a quarter creek miles from its mouth on the Savannah River at RM 29.

⁷The intake for the Purrysburg Water Treatment Plant was located on the same canal as the Beaufort-Jasper Water Treatment Plant. The Purrysburg intake was closer to the Savannah River at the beginning of the canal.

⁸Girard Dairy was considered an indicator station since it is the closest dairy to the plant (~5.5 miles). Dixon Dairy went out of business in June 2009 and Seven Oaks Dairy (~7.5 miles) was added as a replacement and was considered a control station even though a control station is typically 10 miles or greater. Milky Way Dairy was identified and added to the ODCM in 2015 to replace Seven Oaks since it is at 16.0 miles from the plant.



3 RESULTS SUMMARY

Included in this section are statistical evaluations of the laboratory results, comparison of the results by media, and a summary of the anomalies and deviations. Overall, 2,907 analyses were performed across nine exposure pathways. Tables and figures are provided throughout this section to provide an enhanced presentation of the information.

In recent history, man-made nuclides have been released into the environment and have resulted in wide spread distribution of radionuclides across the globe. For example, atmospheric nuclear weapons tests from the mid-1940s through 1980 distributed man-made nuclides around the world. The most recent atmospheric tests in the 1970s and in 1980 have had a significant impact upon the radiological concentrations found in the environment prior to and during pre-operation, and through early operation. Some long-lived radionuclides, such as Cs-137, continue to be detected and a portion of these detections are believed to be attributed to the nuclear weapons tests.

Additionally, data associated with certain radiological effects created by off-site events have been removed from the historical evaluation, this includes: the nuclear atmospheric weapon test in the fall of 1980; the Chernobyl incident in the spring of 1986; abnormal releases from the Savannah River Site (SRS) during 1987 and 1991; and the Fukushima event in the spring of 2011.

As indicated in ODCM 7.1.2.1, the results for naturally occurring radionuclides that are also found in plant effluents must be reported along with man-made radionuclides. Historically, the radionuclide Be-7, which occurs abundantly in nature, is often detected in REMP samples, and occasionally detected in the plant's liquid and gaseous effluents. When it is detected in effluents and REMP samples, it is also included in the REMP results. In 2021, Be-7 was not detected in any plant effluents and therefore it was not included in this report.

As part of the data evaluation process, SNC considered the impact of the non-plant associated nuclides along with a statistical evaluation of the REMP data. The statistical evaluations included within this report include the Minimum Detectable Concentration (MDC), the Minimum Detectable Difference (MDD), and Chauvenet's Criterion as described below.

Minimum Detectable Concentration

The minimum detectable concentration is defined as an estimate of the true concentration of an analyte required to give a specified high probability that the measured response will be greater than the critical value.



Minimum Detectable Difference

The Minimum Detectable Difference (MDD) compares the lowest significant difference (between the means) of a control station, versus an indicator station or a community station, that can be determined statistically at the 99% Confidence Level. A difference in mean values which was less than the MDD was considered to be statistically indiscernible. The MDD is used to evaluate the statistical proximity between the indicator/community and control sample results, but generally, any results that are less than the MDC and/or Reporting Levels (RL) are considered to have minimal impact on the surrounding environs.

Chauvenet's Criterion

All results were tested for conformance with Chauvenet's Criterion (G. D. Chase and J. L. Rabinowitz, Principles of Radioisotope Methodology, Burgess Publishing Company, 1962, pages 87-90) to identify values which differed from the mean of a set by a statistically significant amount. Identified outliers were investigated to determine the reason(s) for the difference. If equipment malfunction or other valid physical reasons were identified as causing the variation, the anomalous result was excluded from the data set as non-representative.

Table 3-1 summarizes and evaluates the annual results for the indicator stations against the control and community stations (where applicable) and as appropriate, results were evaluated against the MDCs (listed in Table 3-1) and RLs (listed in Table 3-2). The required MDCs were achieved during laboratory sample analysis. The 2021 results were compared with previous results, including those obtained during pre-operation. No data points were excluded for violating Chauvenet's Criterion.



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Location Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
Airborne Particulates (fCi/m3)	Gross Beta 363	10	23 9.3-50 (255/255)	River Road WSW 1.2 mi.	23.7 12.5-50 (51/51)	20.5 7.6-45.8 (51/51)	23.1 9.2-48.2 (51/51)
	Gamma Isotopic 28						
	I-131	70	NDM(c)		NDM	NDM	NDM
	Cs-134	50	NDM		NDM	NDM	NDM
	Cs-137	60	NDM		NDM	NDM	NDM
Airborne Radioiodine (fCi/m3)	I-131 357	70	NDM		NDM	NDM	NDM
Direct Radiation (mR/91 days)	Gamma Dose 157		8.7 4.3-13.4 (64/64)	SRS, Road A.13.1 ENE 4.8 mi.	15.2 13.9-16.4 (4/4)	9.4 4.7-16.4 (72/72)	8.3 4.8-12.6 (24/24)
Milk (pCi/l)	Gamma Isotopic 48						
	I-131	1	NDM		NDM		NDM
	Cs-134	15	NDM		NDM		NDM
	Cs-137	18	1.5 0.9-2.1 (5/24)	Girard Dairy S 5.5 mi	1.6 0.9-2.1 (5/24)		1.6 1.5-1.7 (4/21)
	Ba-140	60	NDM		NDM		NDM
	La-140	15	NDM		NDM		NDM
Vegetation (pCi/kg-wet)	Gamma Isotopic 30						



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Location Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
	I-131	60	NDM		NDM		NDM
	Cs-134	60	NDM		NDM		NDM
	Cs-137	80	NDM		NDM		NDM
River Water (pCi/l)	Gamma Isotopic 33						
	Be-7	124(d)	NDM		NDM	NDM	NDM
	Mn-54	15	NDM		NDM	NDM	NDM
	Fe-59	30	NDM		NDM	NDM	NDM
	Co-58	15	NDM		NDM	NDM	NDM
	Co-60	15	NDM		NDM	NDM	NDM
	Zn-65	30	NDM		NDM	NDM	NDM
	Zr-95	30	NDM		NDM	NDM	NDM
	Nb-95	15	NDM		NDM	NDM	NDM
	I-131	1	NDM		NDM	NDM	NDM
	Cs-134	15	NDM		NDM	NDM	NDM
	Cs-137	18	NDM		NDM	NDM	NDM
	Ba-140	60	NDM		NDM	NDM	NDM
	La-140	15	NDM		NDM	NDM	NDM
	Tritium 11	2000	612 192-1400 (4/4)	612 192-1400 (4/4)	Savannah River (RM 150.4) ENE 0.8 mi	612 192-1400 (4/4)	305 145-595 (4/4)
Raw Water Near Intakes to Water Treatment Plants (pCi/l)	Gross Beta 36	4	3.5 0.8-13.9 (20/20)	Cherokee Hill Water Treatment Plant, Port Wentworth, GA SSE 72 mi.	4.3 0.8-13.9 (12/12)		2.9 1-5.7 (11/12)
	Gamma Isotopic 36						



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Location Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
	Be-7	124(d)	NDM		NDM		NDM
	Mn-54	15	NDM		NDM		NDM
	Fe-59	30	NDM		NDM		NDM
	Co-58	15	NDM		NDM		NDM
	Co-60	15	NDM		NDM		NDM
	Zn-65	30	NDM		NDM		NDM
	Zr-95	30	NDM		NDM		NDM
	Nb-95	15	NDM		NDM		NDM
	I-131	1	NDM		NDM		NDM
	Cs-134	15	NDM		NDM		NDM
	Cs-137	18	NDM		NDM		NDM
	Ba-140	60	NDM		NDM		NDM
	La-140	15	NDM		NDM		NDM
	Tritium 12	2000	280 167-566 (8/8)	Cherokee Hill Water Treatment Plant, Port Wentworth, GA SSE 72	302 167-405 (4/4)		177 90.6-279 (4/4)
Finished Water at Water Treatment Plants (pCi/l)	Gross Beta 36	4	3.3 0.8-6.8 (30/30)	Augusta Water Treatment Plant NNW 29 mi.	3.59 1.7—6.8 (10/10)		2.6 1-4.2 (10/12)
	Gamma Isotopic 36						
	Be-7	124(d)	NDM		NDM		NDM
	Mn-54	15	NDM		NDM		NDM
	Fe-59	30	NDM		NDM		NDM
	Co-58	15	NDM		NDM		NDM
	Co-60	15	NDM		NDM		NDM
	Zn-65	30	NDM		NDM		NDM



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Location Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
	Zr-95	30	NDM		NDM		NDM
	Nb-95	15	NDM		NDM		NDM
	I-131	1	NDM		NDM		NDM
	Cs-134	15	NDM		NDM		NDM
	Cs-137	18	NDM		NDM		NDM
	Ba-140	60	NDM		NDM		NDM
	La-140	15	NDM		NDM		NDM
	Tritium 12	2000	339 145-1050 (8/8)	Purrysburg Water Treatment Plant; Purrysburg, SC SSE 76 m	434 145-486 (4/4)		155 0-170 (3/4)
Anadromous Fish (pCi/kg-wet)	Gamma Isotopic 0						
	Be-7	655(d)			NA		NDM
	Mn-54	130			NA		NDM
	Fe-59	260			NA		NDM
	Co-58	130			NA		NDM
	Co-60	130			NA		NDM
	Zn-65	260			NA		NDM
	Cs-134	130			NA		NDM
Cs-137	150			NA		NDM	
Fish (pCi/kg-wet)	Gamma Isotopic 12						
	Be-7	655(d)	NDM				NDM
	Mn-54	130	NDM				NDM
	Fe-59	260	NDM				NDM
	Co-58	130	NDM				NDM



Table 3-1. Radiological Environmental Monitoring Program Annual Summary

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Minimum Detectable Concentration (MDC) (a)	Indicator Location Mean (b), Range (Fraction)	Location with the Highest Annual Mean		Other Stations (f) Mean (b), Range (Fraction)	Control Locations Mean (b), Range (Fraction)
				Name Distance and Direction	Mean (b), Range (Fraction)		
	Co-60	130	NDM				NDM
	Zn-65	260	NDM				NDM
	Cs-134	130	NDM				NDM
	Cs-137	150	56.1 0-82.5 1/2	Savannah River, ESE, 4.3 mi.	56.1 0-82.5 1/2		136.3 0-136.3 2/2
Sediment (pCi/kg-dry)	Gamma Isotopic 4						
	Co-58	N/A	NDM				NDM
	Co-60	N/A	NDM				NDM
	Cs-134	150	NDM				NDM
	Cs-137	180	94.4 82.2-106.7 2/2	Savannah River, ESE, 4.3 mi.	94.4 0-33.3 2/2		33.3 0-33.3 1/2

Notes:

(a) The MDC is defined in ODCM 10.1. Except as noted otherwise, the values listed in this column are the detection capabilities required by ODCM Table 4-3. The values listed in this column are a priori (before the fact) MDCs. In practice, the a posteriori (after the fact) MDCs are generally lower than the values listed.

(b) Mean and range were based upon detectable measurements only. The fraction of all measurements at a specified location that are detectable is placed in parenthesis.

(c) No Detectable Measurement(s) (NDM).

(d) The Georgia Power Company Environmental Laboratory has determined that this value may be routinely attained under normal conditions. No value is provided in ODCM Table 4-3.

(e) Item 3 of ODCM Table 4-1 implies that an I-131 analysis was not required to be performed on water samples when the dose calculated from the consumption of water was less than 1 mrem per year. However, I-131 analyses were performed on the finished drinking water samples.

(f) "Other" stations, as identified in the "Station Type" column of Table 2-2, are "Community" and/or "Special" stations.

Not Applicable (NA) (sample or analysis not required)



Table 3-2. Reporting Levels (RL)

Analysis	Water (pCi/l)	Airborne Particulate or Gases (fCi/m3)	Fish (pCi/kg-wet)	Milk (pCi/l)	Grass or Leafy Vegetation (pCi/kg-wet)
H-3	20,000 ^a				
Mn-54	1,000		30,000		
Fe-59	400		10,000		
Co-58	1,000		30,000		
Co-60	300		10,000		
Zn-65	300		20,000		
Zr-95	400				
Nb-95	700				
I-131	2 ^b	900		3	100
Cs-134	30	10,000	1,000	60	1,000
Cs-137	50	20,000	2,000	70	2,000
Ba-140	200			300	
La-140	100			400	

^a This is the 40 CFR 141 value for drinking water samples. If no drinking water pathway exists, a value of 30,000 may be used.

^b If no drinking water pathway exists, a value of 20 pCi/l may be used.

In accordance with ODCM 4.1.1.2.1, deviations from the required sampling schedule were permitted, if samples were unobtainable due to hazardous conditions, unavailability, inclement weather, equipment malfunction or other just reasons. Deviations from conducting the REMP sampling (as described in Table 2-1) are summarized in Table 3-3 along with their causes and resolution.



Table 3-3. Anomalies and Deviations from Radiological Environmental Monitoring Program

Collection Period	Affected Samples	Anomaly (A)* or Deviation (D)**	Cause	Resolution
02-23-2021	Grass sample	Unable to obtain samples	Grass killed by freezing temperatures and heavy rains	Will re-plant the plots again once the weather clears up and becomes warmer
03-16-2021	OSLD	Unable to obtain samples	OSLD at station Number 24 was not in the holder and could not be located	OSLD holder was reenforced where it was attached oak tree and next quarters OSLD was put in place
04-18-2021	OSLD	Unable to obtain samples	OSLD at station Number 24 was not in the holder and could not be located	OSLD holder was reenforced where it was attached oak tree and next quarters OSLD was put in place
10-12-2021	OSLD	Unable to obtain samples	OSLD at station Number 25 was not in the holder and could not be located	OSLD holder was reenforced in its location and next quarters put in place
02-23-2021	Grass sample	Unable to obtain samples	Grass killed by freezing temperatures and heavy rains	Will re-plant the plots again once the weather clears up and becomes warmer

* An anomaly is considered a non-standard sample that still meets sampling criteria outlined in SNC and Georgia Power Labs procedures.

** A deviation is a sample result that is not recorded due to not meeting scheduling and/or procedural requirements as outlined by SNC and Georgia Power Labs



3.1 Airborne Particulates

As specified in Table 2-1, airborne particulate filters and charcoal canisters were collected weekly at five indicator stations (Stations 3, 7, 10, 12 and 16) which encircle the plant at the site periphery, at a nearby community station (Station 35) approximately seven miles from the plant, and at a control station (Station 36) approximately 14 miles from the plant. At each sampling location containing a filter and cartridge series, air was continuously drawn through a glass fiber filter to retain airborne particulate and an activated charcoal canister was placed in series with the particulate filter to adsorb radioiodine.

3.1.1 Gross Beta

As provided in Table 3-1, the 2021 annual average weekly gross beta activity at the indicator stations was 23 fCi/m³. It was 0.1 fCi/m³ less than the control station average of 23.1 fCi/m³. The MDD was not calculated as the control average was higher.

The 2021 annual average weekly gross beta activity at the Girard community station was 20.5 fCi/m³ which was 2.6 fCi/m³ less than the control station average (23.1 fCi/m³). The MDD was not calculated as the control average was higher.


Average Air Gross Beta historical data (Table 3-4) is graphed to show trends associated with a prevalent exposure pathway (Figure 3-1). In general, there was close agreement between the results for the indicator, control and community stations. This close agreement supports the position that the plant was not contributing significantly to the gross beta concentrations in air.



Table 3-4. Average Weekly Gross Beta Air Concentration

Period	Indicator (fCi/m3)	Control (fCi/m3)	Community (fCi/m3)	Period	Indicator (fCi/m3)	Control (fCi/m3)	Community (fCi/m3)
Pre-op	22.9	22.1	21.9	2004	21.6	22.8	21.4
1987	26.3	23.6	22.3	2005	20.5	20.4	19.4
1988	24.7	23.7	22.8	2006	25.5	24.6	24.3
1989	19.1	18.2	18.8	2007	27.3	25.1	26.5
1990	19.6	19.4	18.8	2008	24.0	23.2	23.7
1991	19.3	19.2	18.6	2009	23.0	22.4	22.5
1992	18.7	19.3	18.0	2010	25.8	24.4	25.5
1993	21.2	21.4	20.3	2011	25.8	25.1	24.6
1994	20.1	20.3	19.8	2012	25.9	25.2	26.1
1995	21.1	20.7	20.7	2013	22.9	23.9	22.2
1996	23.3	21.0	20.0	2014	24.1	23.4	23.5
1997	20.6	20.6	19.0	2015	21.5	20.8	20.8
1998	22.7	22.4	20.9	2016	23.5	22.8	21.7
1999	22.5	21.9	22.2	2017	23.2	21.6	22.5
2000	24.5	21.5	21.1	2018	21.4	21.7	19.2
2001	22.4	22.0	22.7	2019	24.3	23.8	24
2002	19.9	18.9	18.6	2020	22.5	21.0	20.6
2003	19.4	20.5	18.3	2021	23	23.1	20.5

Figure 3-1. Historic Average Weekly Gross Beta Air Concentration

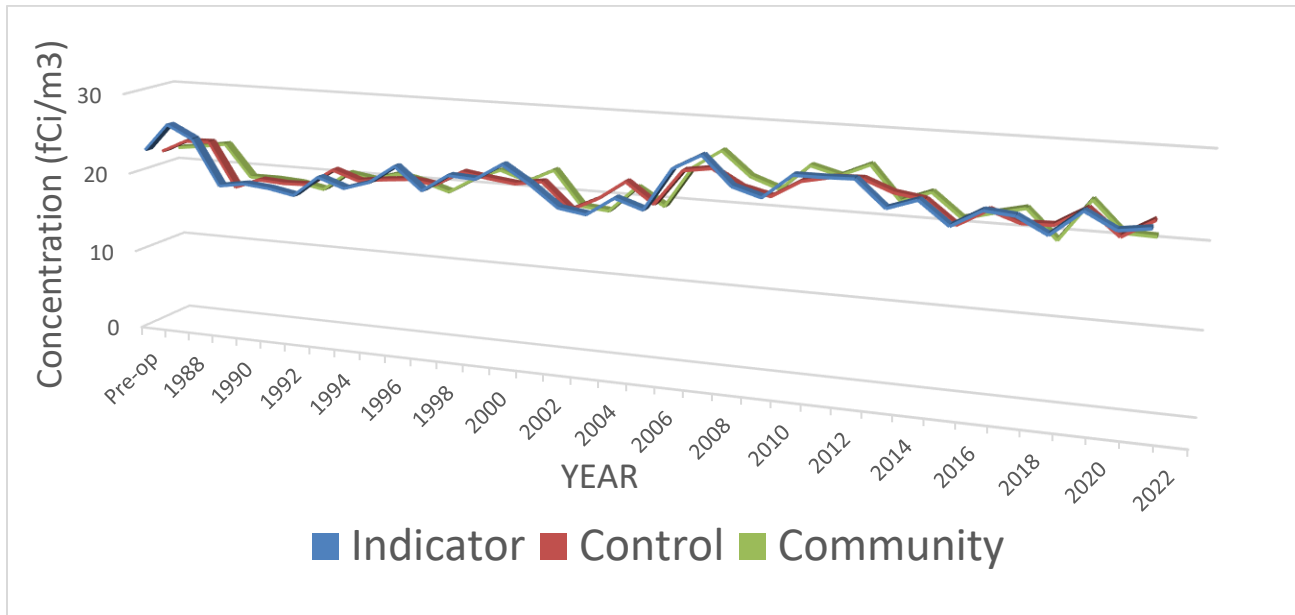

3.1.2 Gamma Particulates and Airborne Radioiodine

During 2021, no man-made radionuclides were detected from the gamma isotopic analysis of the quarterly composites of the air particulate filters. Historically, gamma isotopes were detected as a result of offsite events. During pre-operation, Cs-134, Cs-137 and I-131 were occasionally detected. In 1987, Cs-137 was found in one indicator composite at a concentration of 1.7 fCi/m³.

Additionally, I-131 was also detected after the Fukushima incident in 2011, the highest I-131 result in 2011 was 93.8 fCi/m³, which was approximately 10% of the RL. During 2018, no I-131 was detected in the air cartridges at either the indicator or control stations.

3.2 Direct Radiation

In 2021, direct (external) radiation was measured with Optically Stimulated Luminescent dosimeters (OSLD) by placing two OSLD badges at each station. The gamma dose at each station was reported as the average reading of the two badges. The badges were analyzed on a quarterly basis. An inspection was performed near mid-quarter for offsite badges to ensure that the badges were on-station and to replace any missing or damaged badges.

Two direct radiation stations were established in each of the 16 compass sectors, to form two concentric rings. The inner ring (Stations 1 through 16) was located near the plant perimeter as shown in Map A-1 in Appendix A and the outer ring (Stations 17 through 32) was located at a distance of approximately five miles from the plant as shown in Map A-2 in Appendix A. The 16 stations forming the inner ring were designated as the indicator stations. The two ring configuration of stations was established in accordance with NRC Branch Technical Position "An Acceptable Radiological Environmental Monitoring Program", Revision 1, November 1979. The six control stations (Stations 36, 37, 47, 48, 51 and 52) were located at distances greater than 10 miles from the plant as shown in Map A-3 in Appendix A. Monitored special interest areas include Station 35 at the town of Girard and Station 43 at the employee recreational area (Rec Center). The mean and range values presented in the "Other" column in Table 3-1 includes the outer ring stations (stations 17 through 32) as well as stations 35 and 43.

As provided in Table 3-1, the 2021 average quarterly exposure at the indicator stations (inner ring) was 8.7 mR with a range of 4.3 to 13.4 mR. The indicator station average was 0.4 mR greater than the control station average (8.3 mR with a range of 4.8 to 12.6 mR). The difference was less than the calculated MDD of 1.4 mR, so the difference was not statistically discernible. Over the operational history, the annual average quarterly exposures have shown little variation between the indicator and control stations. In select cases, the OSLD samples had extended exposure timeframes from collection to analysis in 2021. As such, the appropriate background exposure was subtracted from the result. However, the correlation between the indicator and control stations remains consistent with historical data.



The quarterly exposures acquired at the community/other (outer ring) stations during 2021 ranged from 4.7 to 16.4 mR with an average of 9.4 mR which was 1.1 mR higher than the control station average. The calculated MDD was 1.4 mR, which indicated that there was no discernible statistical difference between the two data sets.

Average Direct Radiation historical data (Table 3-5) is graphed to show trends associated with this exposure pathway (Figure 3-2). The decrease between 1991 and 1992 values is attributed to a change in Thermoluminescent Dosimeters (TLDs) from Teledyne to Panasonic. It should be noted however that the differences between indicator and control and outer ring values did not change. The increase shown in 2010 reflected issues with the aging Panasonic TLD reader. The close agreement between the station groups has supported the position that the plant was not contributing significantly to direct radiation in the environment.

Figure 3-3 below provides a more detailed view of the 2021 values. The values for the special interest areas (Girard and the Rec Center) detailed below indicate that Plant Vogtle did not significantly contribute to direct radiation at those areas.

Table 3-5. Average Quarterly Exposure from Direct Radiation

Period	Indicator (mR)	Control (mR)	Outer Ring (mR)		Period	Indicator (mR)	Control (mR)	Outer Ring (mR)
Pre-op	15.3	16.5	14.7		2004	12.4	12.2	12.3
1987	17.6	17.9	16.7		2005	12.5	13.2	12.9
1988	16.8	16.1	16.0		2006	13.1	12.9	13.0
1989	17.9	18.4	17.2		2007	13.0	12.5	12.7
1990	16.9	16.6	16.3		2008	13.3	13.0	13.1
1991	16.9	17.1	16.7		2009	13.1	13.6	13.3
1992	12.3	12.5	12.1		2010	16.2	16.7	16.6
1993	12.4	12.4	12.1		2011	13.9	13.9	14.0
1994	12.3	12.1	11.9		2012	14.4	14.3	14.2
1995	12.0	12.5	12.3		2013	13.1	13.2	13.6
1996	12.3	12.2	12.3		2014	11.6	12.3	12.0
1997	13.0	13.0	13.1		2015	12.5	12.3	12.6
1998	12.3	12.7	12.4		2016	11.5	11.5	11.5
1999	13.6	13.5	13.4		2017	11.4	11.4	11.9
2000	13.5	13.6	13.5		2018	10.1	10.6	10.7
2001	12.9	13.0	12.9		2019	10.0	10.3	10.4
2002	12.8	12.9	12.6		2020	10.2	11.3	11.4
2003	12.2	12.5	12.4		2021	8.7	8.3	9.4



Figure 3-2. Average Quarterly Exposure from Direct Radiation


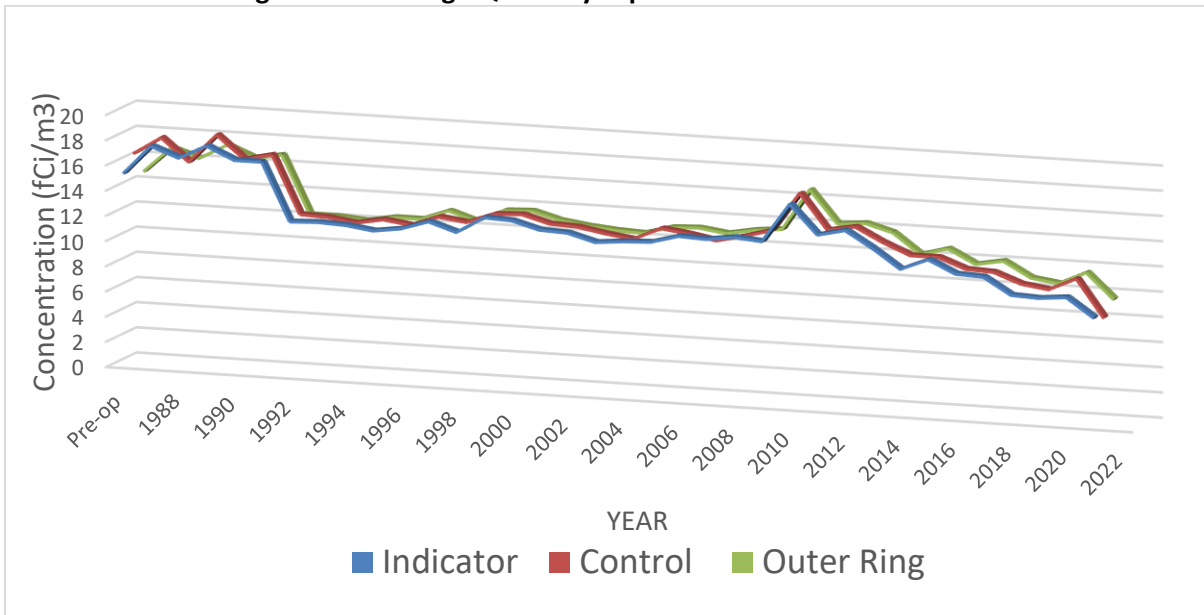


Figure 3-3. 2021 Average Exposure from Direct Radiation

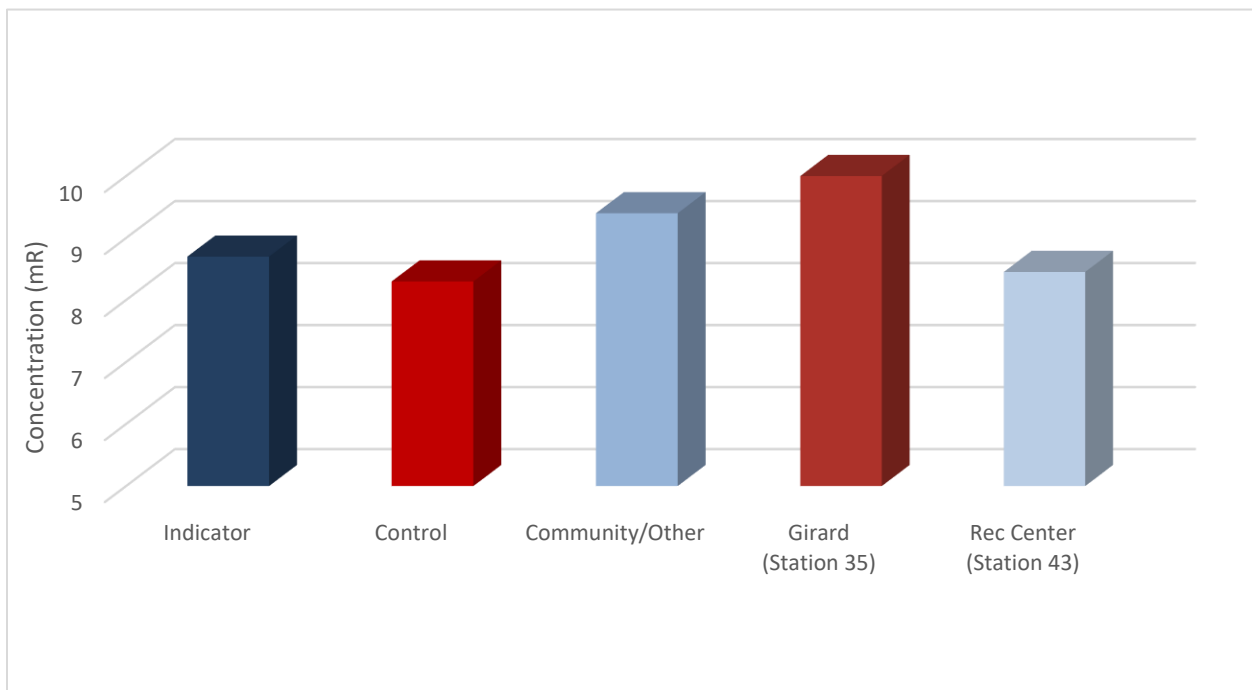

3.3 Biological Media

Cs-137 was the only radionuclide detected in two of the three biological media (milk and fish). As indicated in Figure 3-4, the Cs-137 activity levels were below the respective MDCs and well below that of the respective RLs for each sample media for both the indicator and control stations.

3.3.1 Milk

In accordance with Tables 2-1 and 2-2, milk samples were collected semi-monthly from two locations (until Girard stopped milk production in the fourth quarter): the Girard Dairy (Station 101) which was considered an indicator station because it is approximately 5.5 miles from Vogtle (ideally, a milk indicator station would be less than 5 miles from the plant); and the Milky Way Dairy (Station 102, at 16.0 miles from the plant) is the control location. No milk animal was found within five miles of Plant Vogtle during the 2021 land use census.

Gamma isotopic (including I-131 and Cs-137) analyses were performed on each collected milk sample and there were no detectable results for gamma isotopes other than Cs-137, which was detected in 8 of 24 indicator samples (1.5 pCi/l average) and 3 of 24 control samples (1.6 pCi/l average). No MDD was applied because the indicator was less than the control. Figure 3-4 provides the 2021 Cs-137 concentration in milk.

3.3.2 Vegetation

In accordance with Tables 2-1 and 2-2, vegetation samples were collected monthly for gamma isotopic analyses at two indicator locations near the site boundary (Stations 7 and 15) and at one control station located about 17 miles WSW from the plant (Station 37). The man-made radionuclide Cs-137 was periodically identified in vegetation samples and was generally attributed to offsite sources (such as weapons testing, Chernobyl, and Fukushima). Cs-137 was not detected in any samples collected in 2021 (indicator or control).

While Cs-137 and I-131 were periodically found and Co-60 was discovered once in vegetation samples during pre-operation, the historical trends and the relationship between the indicator and control stations have demonstrated that plant operations were having no adverse impact to the environment. The sample results were consistently well below the MDC and the RL for Cs-137 (80 and 2000 pCi/kg-wet, respectively).

During 2021, there were also no other gamma isotopes detected in any Vogtle REMP vegetation samples.

3.3.3 Fish

Fish samples were collected in accordance with the ODCM (as indicated in Table 2-1). For the semiannual collections, the control location (Station 81) extends from approximately two to



seven miles upriver of the plant intake structure, and the indicator location (Station 85) extends from about 1.4 to seven miles downriver of the plant discharge structure.

3.3.3.1 Anadromous Species

In accordance with Table 2-1, for anadromous species, all fish sampled were considered indicator stations. Anadromous fish were not caught during 2021. As such, there were no samples analyzed.


3.3.3.2 Commercially or Recreationally Important Species

As provided in Table 3-1, Cs-137 was found in the semiannual collections of commercially or recreationally important species of fish (for both indicator and control). The indicator station averaged a Cs-137 concentration of 56.1 ranging from 0 to 82.5 pCi/kg-wet (detected in three samples), and 136.3 pCi/kg-wet at the control station (detected in one sample). No MDD was applied because the indicator was less than the control. All detected values were well below the MDC for Cs-137 in fish (150 pCi/kg-wet). No other gamma nuclides were discovered in 2021.

3.3.4 Biological Media Summary

There were no statistical differences, trends, or anomalies associated with the 2021 biological media samples when compared to historical data. Figure 3-4 below, details the 2021 Cs-137 concentrations in the three media types.

Figure 3-4. 2021 Biological Media Average Cs-137 Concentrations

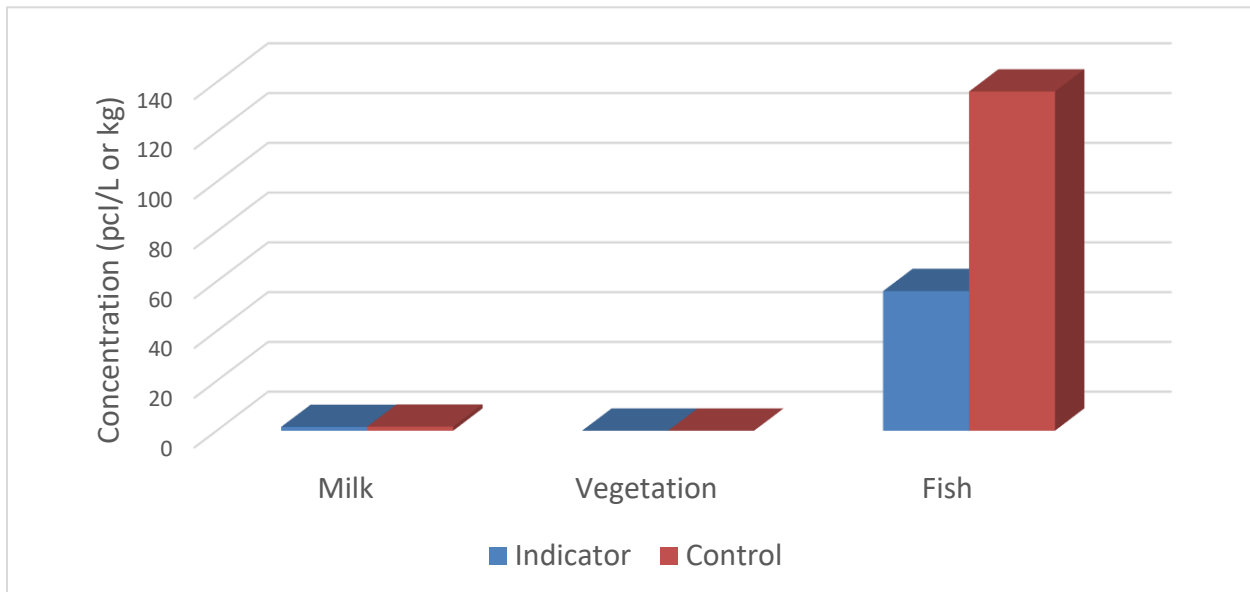

3.4 Drinking Water

Samples were collected at an upstream control location and at three downstream indicator locations (shown on Map A-3) and further described in Table 2-2.

Monthly water samples were taken near the intake of each water treatment plant (raw drinking water) using automatic composite samplers. Additionally, monthly grab samples of the processed water effluent from the treatment plants (finished drinking water) were collected. Monthly aliquots from the raw and processed drinking water were analyzed for gross beta and gamma isotopic activity. The monthly aliquots were also combined to form quarterly composites in order to be analyzed for tritium.

For 2021, the indicator station average gross beta concentration in the *raw* drinking water was 3.5 pCi/L which was greater than the average gross beta concentration at the control station (2.9 pCi/L), but less than the MDD of 1.0 pCi/L, so there is no statistical difference between the locations. Historically, the close agreement between the gross beta values of the indicator stations and the control station has supported that there was no significant gross beta contribution from the plant effluents. The required MDC for gross beta in water was 4.0 pCi/L; there was no RL for gross beta in water.

For 2021, the indicator station average gross beta concentration in the *finished* drinking water was 3.3 pCi/L which is more than the average at the control station (2.6 pCi/L), but less than the MDD of 0.7pCi/L, so there is no statistical difference between the locations. Figure 3-5 show the relationship between the average indicator station and average control station for 2021 in comparison to the MDC.


As provided in Table 3-1, there were no positive results during 2021 from the gamma isotopic analysis of the raw and finished drinking water samples.

Regarding tritium, the average raw drinking water indicator concentration was 280 pCi/L which was 103 pCi/L greater than the average concentration found at the control station (177 pCi/L). This difference does exceed the MDD of 113 pCi/L, which would indicate a difference that is statistically discernible, however all detected values were less than the MDC for drinking water of 2,000 pCi/L, and these values were consistent with past results.

The finished drinking water average tritium concentration at the indicator stations during 2021 was 339 pCi/L which was 184 pCi/L greater than the average concentration found at the control station (155 pCi/L). The MDD was calculated at 240 pCi/L between the indicator and control stations, indicating a statistical difference. However, the averages were below the MDC for drinking water and the values were consistent with past results, coupled with the raw sample results, there does not appear to be an impact from plant operations. Figure 3-6 shows the tritium values in the drinking water compared to river water.



Figure 3-5. 2021 Average Gross Beta Concentration in Raw and Finished Drinking Water

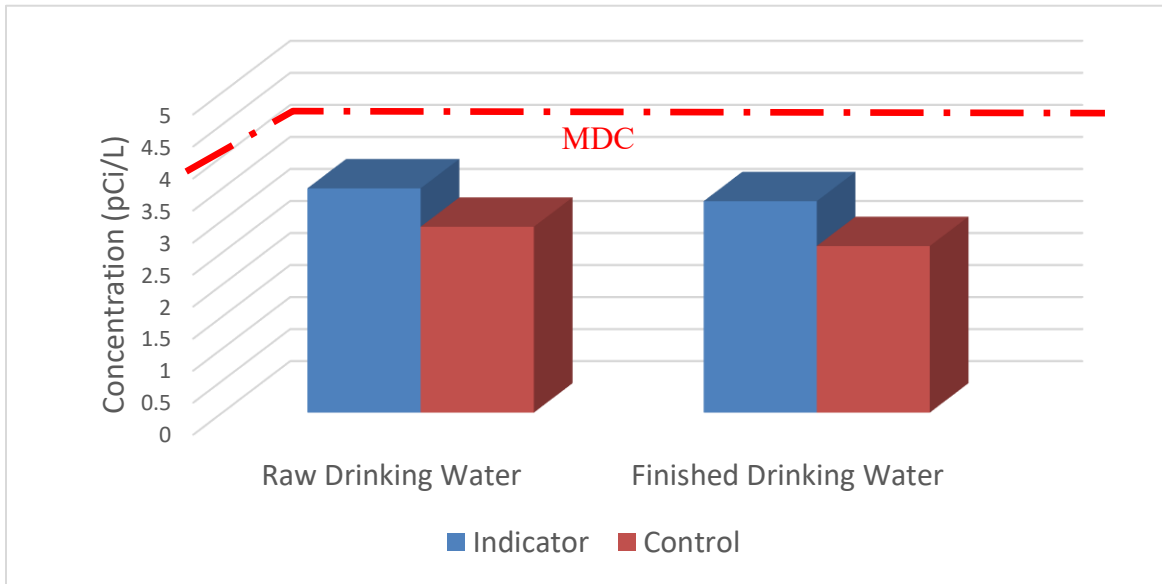

3.5 River Water


Composite river water samples were collected monthly at an upstream control location and at two downstream indicator locations (shown on Map A-3). The details of the sampling protocols are outlined in Tables 2-1 and Table 2-2. A gamma isotopic analysis was conducted on each monthly sample. The monthly aliquots were combined to form quarterly composite samples in order to be analyzed for tritium.

As provided in Table 3-1, there were no positive results during 2021 from the gamma isotopic analysis of the river water samples. Also indicated in Table 3-1, the average tritium concentration found at the indicator station was 612 pCi/L which was 411 pCi/L greater than the average at the control station (201 pCi/L). The river water tritium MDD was calculated to be 440 pCi/L, so the difference was statistically discernible. This increased tritium could likely be attributed to plant activity from Vogtle and other upstream dischargers. Tritium was released regularly from the plant during normal operations, but always at levels that would not impact the MDC or RL.

At the “Other” river water sampling station (Station 84), the results ranged from 145 pCi/L to 595 pCi/L with an average of 305 pCi/L. The difference between the Station 84 and the control station was 104 pCi/L. The MDD was calculated to be 219 pCi/L, so the difference was not statistically discernible. Additionally, tritium was released regularly from the plant during normal operations, but always at levels that would not impact the MDC or RL. Historically, the relationship between the indicator/control stations and Station 84 has remained consistent. Figure 3-6 below details the 2021 average tritium concentrations across the three water sample types.



Figure 3-6. 2021 Average Tritium Concentrations in River, Raw Drinking, and Finished Drinking Water

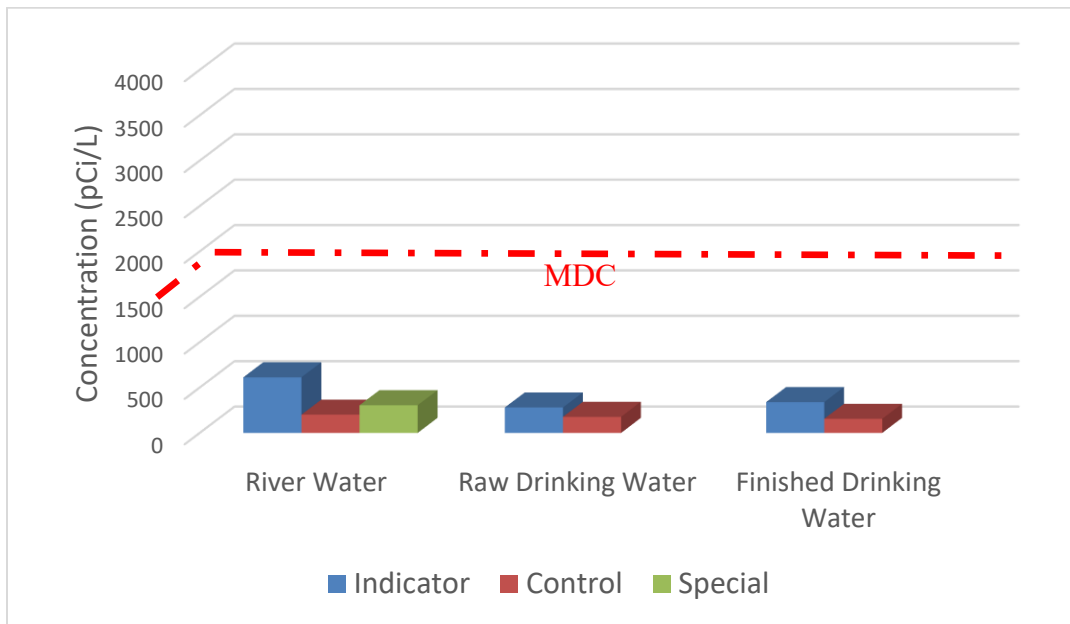

3.6 Sediment

Sediment was collected along the shoreline of the Savannah River in the spring and fall at Stations 81 and 83. Station 81 was a control station located about 2.5 miles upriver of the plant intake structure while Station 83 was an indicator station located about 0.6 miles downriver of the plant discharge structure. A gamma isotopic analysis was performed on each sample. The radionuclides detected in 2021 samples were Be-7 and Cs-137. Though Be-7 was detected in sediment, it will not be discussed within this report, because it was not detected in plant effluents and likely represents naturally occurring and/or background conditions.

For Cs-137, the average concentration at the indicator station during 2021 was 94.4 pCi/kg-dry which was 61.1 pCi/kg-dry greater than that at the control station (33.3 pCi/kg-dry). The concentration of Cs-137 found at the indicator and control stations could be attributed to plant effluents or to other facilities that release radioactive effluents upstream of the sample location. There are not enough sample points to calculate a MDD value; however, both the indicator and control values for Cs-137 were less than the MDC of 180 pCi/kg-dry and therefore no impact to the environment was indicated.

There were no other radionuclides detected in the 2021 sediment samples.



3.7 Interlaboratory Comparison Program

In accordance with ODCM 4.1.3, GPCEL participated in an Interlaboratory Comparison Program (ICP) which satisfied the requirements of Regulatory Guide 4.15, Revision 1, "Quality Assurance for Radiological Monitoring Programs (Normal Operations) - Effluent Streams and the Environment", February 1979. The ICP included the required determinations (sample medium/radionuclide combinations) included in the REMP.

The ICP was conducted by Eckert & Ziegler Analytics, Inc. (EZA) of Atlanta, Georgia. EZA has a documented Quality Assurance (QA) program and the capability to prepare Quality Control (QC) materials traceable to the National Institute of Standards and Technology. The ICP is a third-party blind testing program which provided a means to ensure independent checks were performed on the accuracy and precision of the measurements of radioactive materials in environmental sample matrices. EZA supplied the crosscheck samples to GPCEL which performed routine laboratory analyses. Each of the specified analyses was performed three times.

The accuracy of each result was measured by the normalized deviation, which is the ratio of the reported average less the known value to the total error. An investigation is undertaken whenever the absolute value of the normalized deviation is greater than three or whenever the coefficient of variation was greater than 15% for all radionuclides other than Fe-59. For Fe-59, an investigation is undertaken when the coefficient of variation exceeds the values shown on Table 3-6 below:

Table 3-6. Interlaboratory Comparison Limits

Nuclide	Concentration *	Percent Coefficient of Variation
Fe-59	<80	25
	>80	15
* For air filters, concentration units are pCi/filter. For all other media, concentration units are pCi/liter (pCi/l).		

As required by ODCM 4.1.3.3 and 7.1.2.3, a summary of the results of the GPCEL's participation in the ICP is provided in Table 3-7 for:

- gross beta and gamma isotopic analyses of an air filter
- gamma isotopic analyses of milk samples
- gross beta, tritium and gamma isotopic analyses of water samples

The 2021 analyses included tritium, gross beta and gamma emitting radio-nuclides in different matrices. The results for all analyses were within acceptable limits for accuracy.



Table 3-7. Interlaboratory Comparison Summary

Analysis or Radionuclide	Date Prepared	Reported Average	Known Value	Standard Deviation EL	Uncertainty Analytics (1S)	Percent Coefficient of Variation	Normalized Deviation
I-131 ANALYSIS OF AN AIR CARTRIDGE (pCi/cartridge)							
I-131	3/11/2021	89.7	88.1	2.51	1.47	5.60	0.31
GAMMA ISOTOPIC ANALYSIS OF AN AIR FILTER (pCi/filter)							
Ce-141	9/9/2021	123	116	6.27	1.94	7.25	0.82
Co-58		127	119	4.52	1.99	5.65	1.15
Co-60		151	147	1.76	2.45	4.05	0.66
Cs-134		98.6	94.3	3.56	1.58	5.20	0.83
Cs-137		121	113	4.02	1.89	5.44	1.23
Fe-59		107	103	4.72	1.72	6.82	0.52
Mn-54		144	130	2.83	2.17	4.67	2.12
Zn-65		176	155	7.60	2.59	6.48	1.85
GROSS BETA ANALYSIS OF AN AIR FILTER (PCI/FILTER)							
Gross Beta	6/3/2021	123	130	3.91	2.17	4.22	1.35
GAMMA ISOTOPIC ANALYSIS OF A MILK SAMPLE (PCI/LITER)							
Ce-141	9/9/2021	123	114	3.91	1.91	7.3	0.96
Co-58		125	118	5.49	1.97	7.33	0.79
Co-60		155	145	6.18	2.42	6.19	1.05
Cs-134		95.3	93.1	4.43	1.56	6.96	0.33
Cs-137		121	112	5.89	1.87	7.61	0.94
Fe-59		107	102	3.32	1.70	8.17	0.55
I-131		89.5	85.6	9.22	1.43	13.01	0.33
Mn-54		140	128	4.27	2.14	6.40	1.32
Zn-65		170	153	11.54	2.56	9.70	1.01
GROSS BETA ANALYSIS OF WATER SAMPLE (PCI/LITER)							
Gross Beta	6/3/2021	214	258	27.58	4.31	13.79	1.51
	12/2/2021	304	281	6.10	4.69	4.06	-1.87
GAMMA ISOTOPIC ANALYSIS OF WATER SAMPLES (PCI/LITER)							



Table 3-7. Interlaboratory Comparison Summary

Analysis or Radionuclide	Date Prepared	Reported Average	Known Value	Standard Deviation EL	Uncertainty Analytics (1S)	Percent Coefficient of Variation	Normalized Deviation
Ce-141	6/3/2021	187	180	8.62	3.00	7.38	-0.51
Co-58		187	179	9.64	2.98	7.36	-0.56
Co-60		225	215	4.96	3.59	4.95	-0.89
Cs-134		212	213	4.69	3.56	4.86	0.14
Cs-137		192	188	4.00	3.13	5.59	-0.41
Fe-59		178	183	7.52	3.06	7.55	0.36
I-131		95.7	92.0	5.79	1.54	10.44	-0.37
Mn-54		264	249	12.79	4.16	6.82	-0.84
Zn-65		319	300	17.65	5.01	7.77	-0.78
TRITIUM ANALYSIS OF WATER SAMPLES (PCI/LITER)							
H-3	9/9/2021	10800	11700	428.02	195	4.75	-1.66
GAMMA ISOTOPIC ANALYSIS OF VEGETATION SAMPLES (PCI/KG)							
Ce-141	6/3/2021	162	148	9.93	2.48	10.42	0.85
Co-58		164	147	13.6	2.46	11.45	-0.92
Co-60		179	177	8.64	2.96	7.81	-0.16
Cs-134		180	176	11.0	2.93	8.19	-0.28
Cs-137		170	155	7.90	2.58	8.71	-0.98
Fe-59		152	151	12.7	2.52	13.65	-0.07
Mn-54		230	205	13.4	3.43	8.65	-1.27
Zn-65		275	247	28.7	4.13	13.73	-0.73



4 SURVEY SUMMARIES

4.1 Land Use Census

In accordance with ODCM 4.1.2, a land use census was conducted in the fall of 2021 to verify the locations of the nearest radiological receptor within five miles. The census results, shown in Table 4-1, indicated no major changes from 2020, therefore, a revision to the ODCM will not be required.

Table 4-1. Land Use Census Results

Sector	Residence	Milk Animal*	Beef Cattle	Garden**
Distance in Miles to the Nearest Location in Each Sector				
N	1.4	None	None	None
NNE	None	None	None	None
NE	None	None	None	None
ENE	None	None	None	None
E	None	None	None	None
ESE	4.2	None	None	None
SE	4.3	None	4.9	None
SSE	4.7	None	4.7	None
S	4.4	None	None	None
SSW	4.7	None	4.7	None
SW	3.1	None	4.4	None
WSW	2.6	None	2.7	None
W	3.4	None	4.7	4.1
WNW	1.9	None	None	None
NW	1.5	None	1.8	None
NNW	1.5	None	None	None
*A milk animal is a cow or goat producing milk for human consumption. **A garden of greater than 500 square feet producing broad leaf vegetation. Note: Land within SRS was excluded from the census.				

4.2 Savannah River Survey

A survey of the Savannah River downstream of the plant for approximately 100 miles (approximately river miles 44.7 to 151.2) was conducted on October 29, 2021 to identify any new withdrawal of water from the river for drinking, irrigation, or construction purposes. No new usage was visually identified. These results were verified with both the Georgia Department of



Natural Resources and the South Carolina Department of Health and Environmental Control (SC DEHEC) in October 2021. Each of these agencies confirmed that no water withdrawal permits for drinking, irrigation, or construction purposes had been issued for this stretch of the Savannah River.

4.3 Meteorological Report Summary

A consultant analyzes the meteorological tower data collected throughout the year and compares it to previous results. In 2021, the meteorological tower results were comparable to previous years, precipitation amounts (60.76") and wind direction (from southwest at 10m, from the southwest at 60m) were also similar.



5 CONCLUSIONS

This report has confirmed SNCs conformance with the requirements of Chapter 4 of the ODCM and the objectives were to:

- 1) Determine the levels of radiation and the concentrations of radioactivity in the environs and;
- 2) Assess the radiological impact (if any) to the environment due to the operation of the VEGP.

Based on the 2021 activities associated with the REMP, SNC offers the following conclusions:

- Samples were collected and there were no deviations or anomalies that negatively affected the quality of the REMP
- Land use census and river survey did not reveal any significant changes
- Analytical results were below reporting levels
- These values were consistent with historical results, which indicate no adverse radiological environmental impacts associated with the operation of VEGP




This page intentionally left blank.

APPENDIX A

Maps



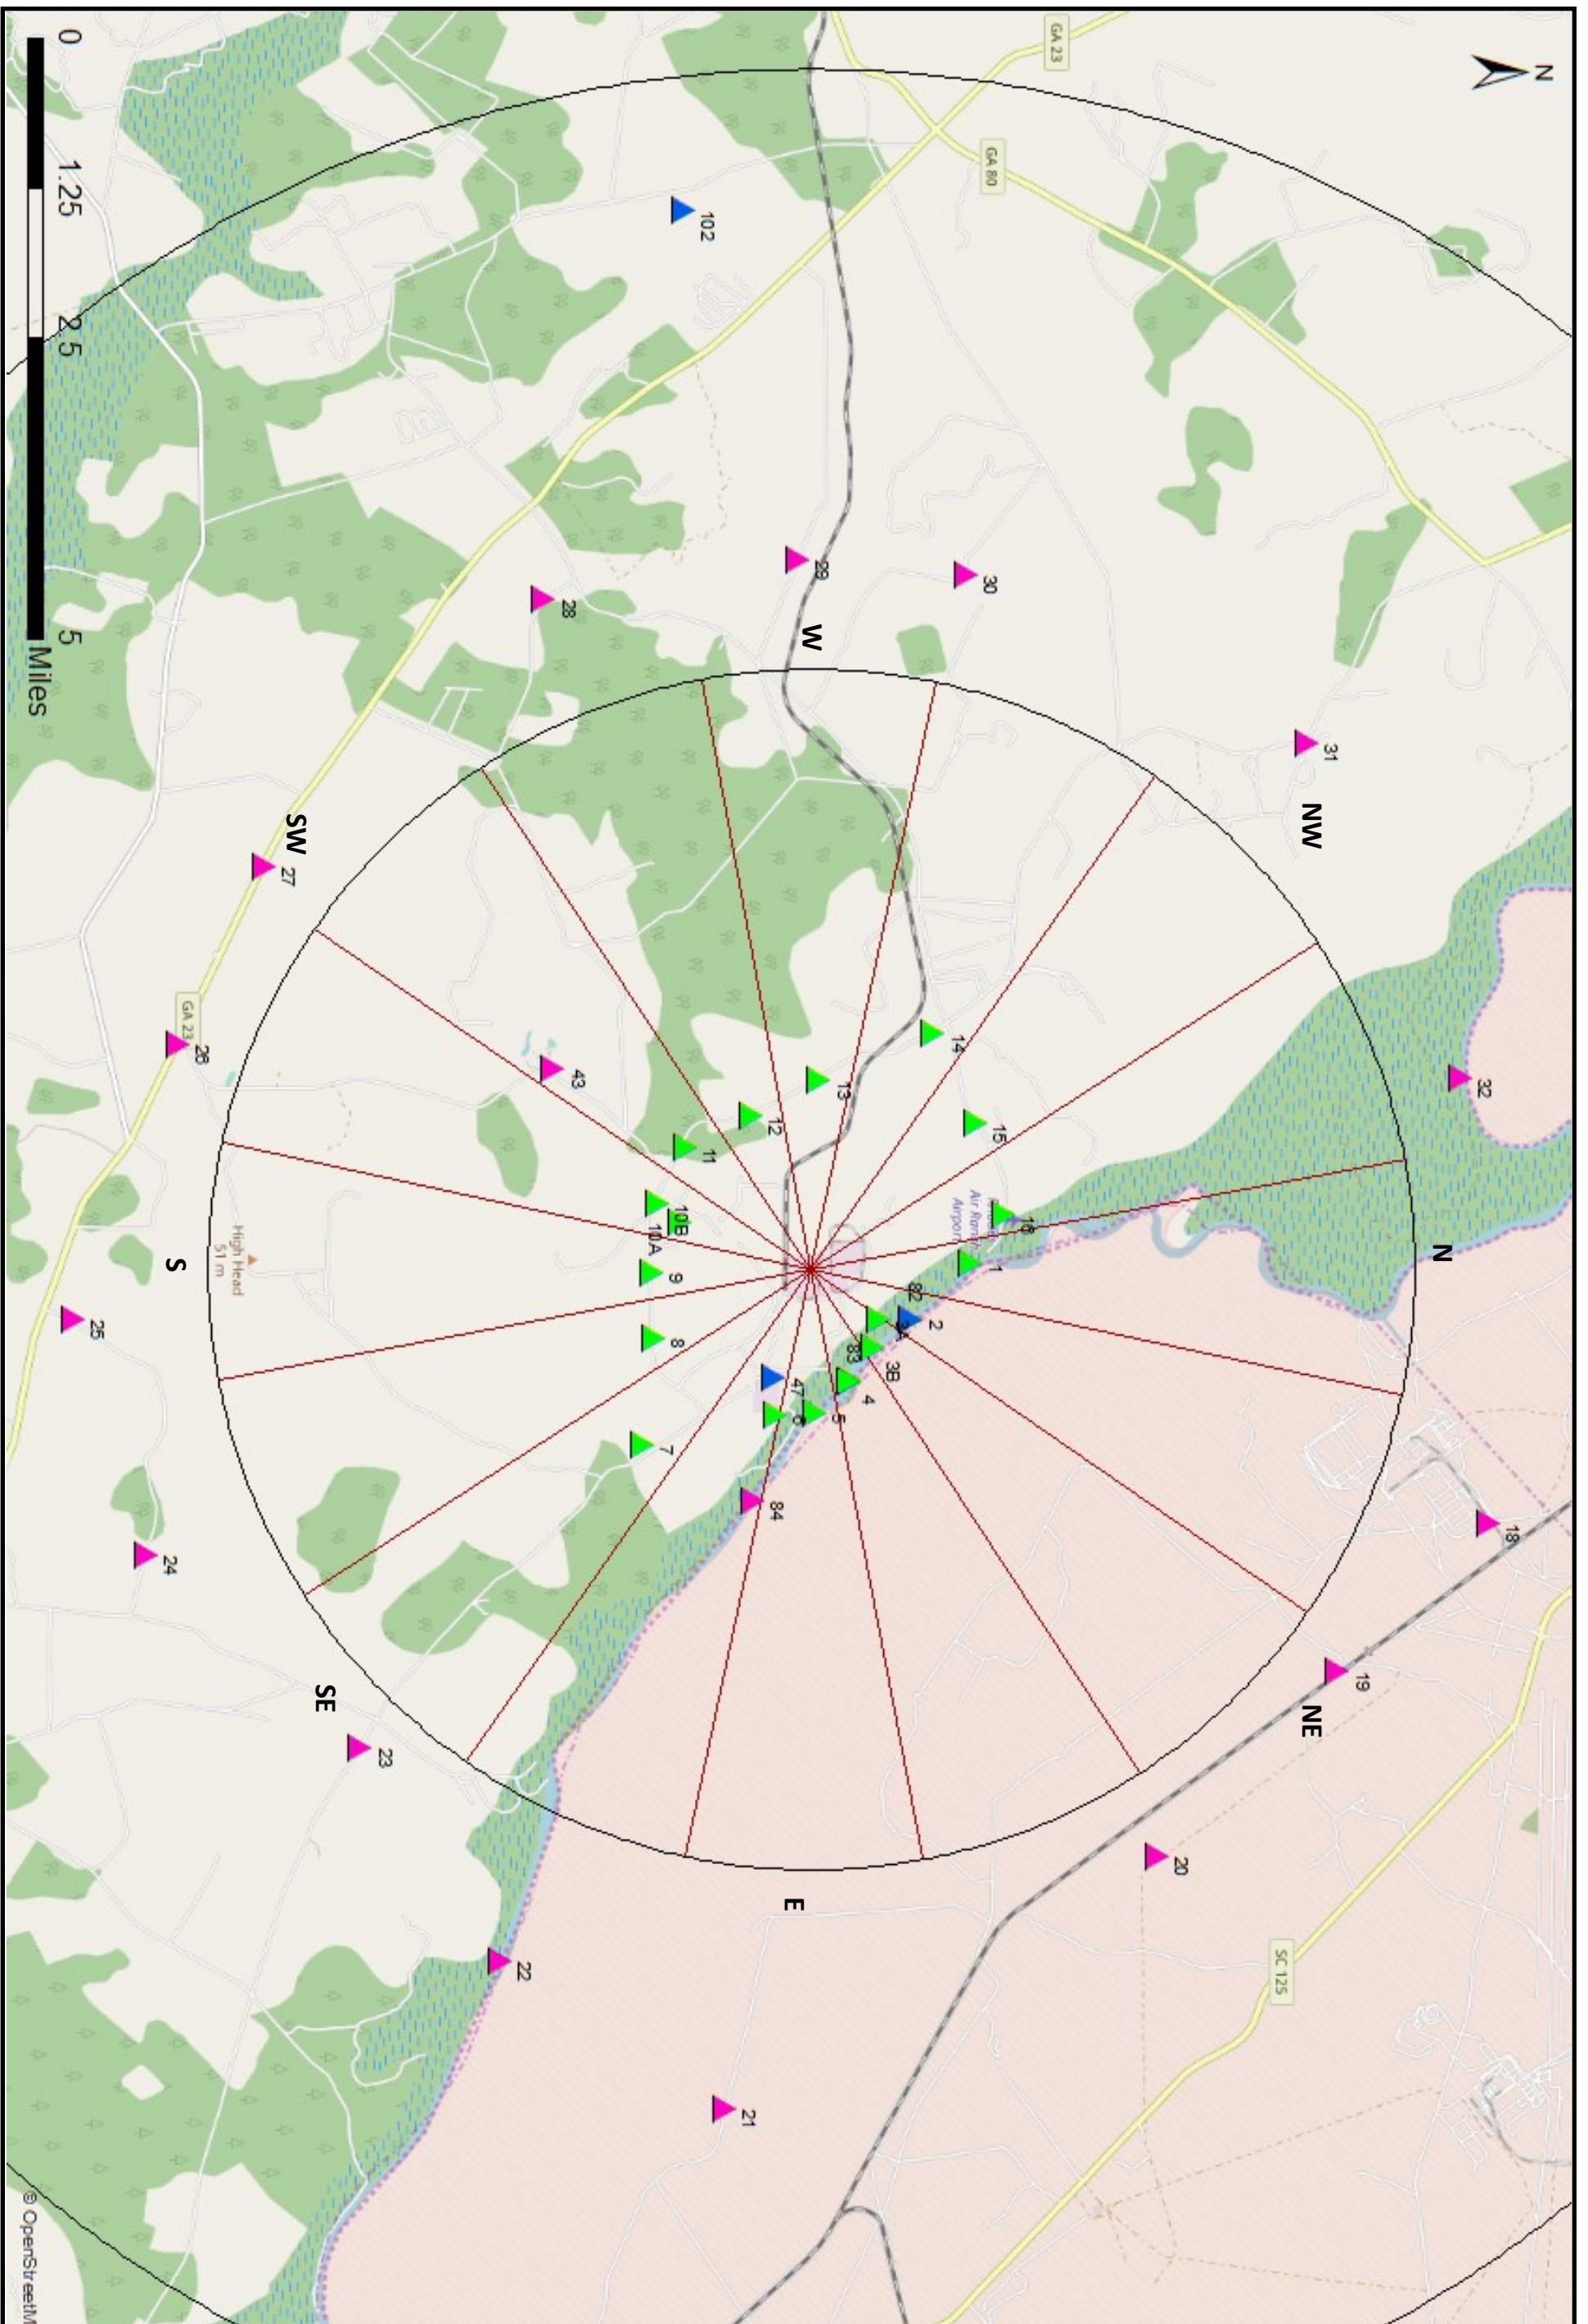


Legend:	
Indicator Stations -	
Control Stations -	
Other Stations -	





Vogtle Electric Generating Plant
 2021 Annual Radiological Environmental Report
 REMP Stations in Plant Vicinity

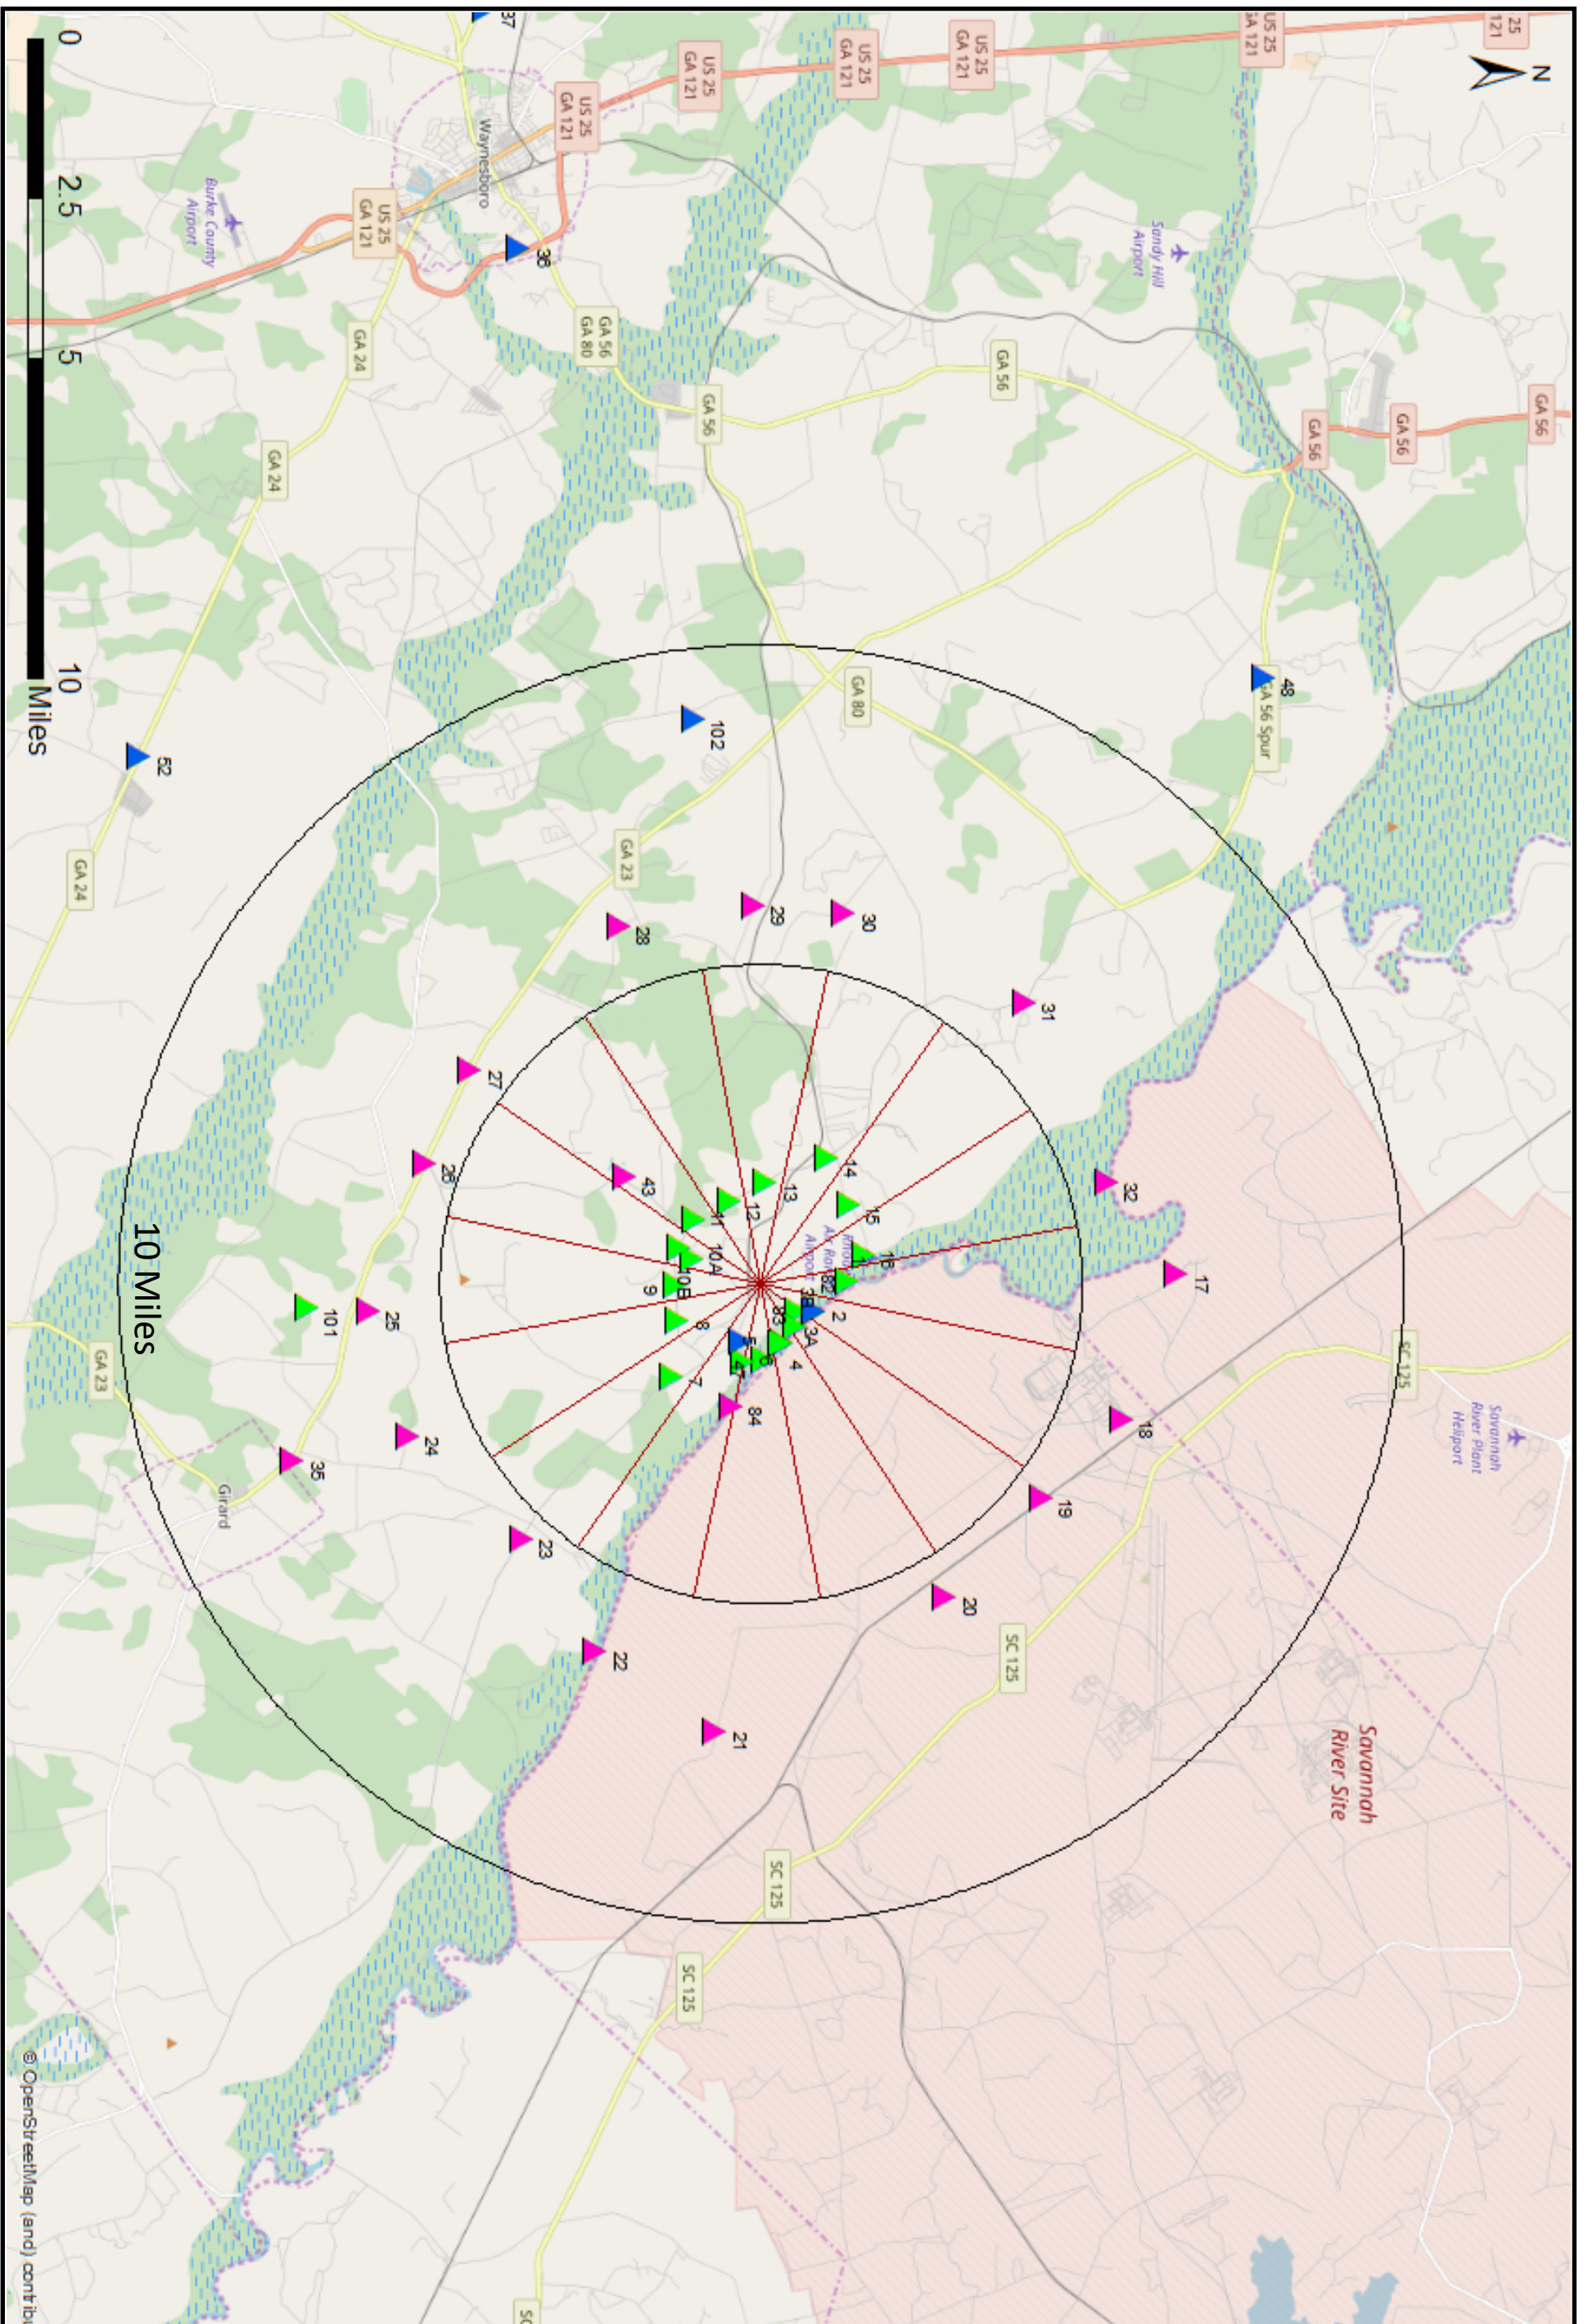

Drawn by:	C. Groce
April 19, 2022	

Appendix A
 Map A-1



Legend:	
Indicator Stations -	
Control Stations -	
Other Stations -	

Vogtle Electric Generating Plant
 2021 Annual Radiological Environmental Report
 REMP Stations within 10 miles




Drawn by:

C. Groce

Appendix A
 Map A-2

April 19, 2022

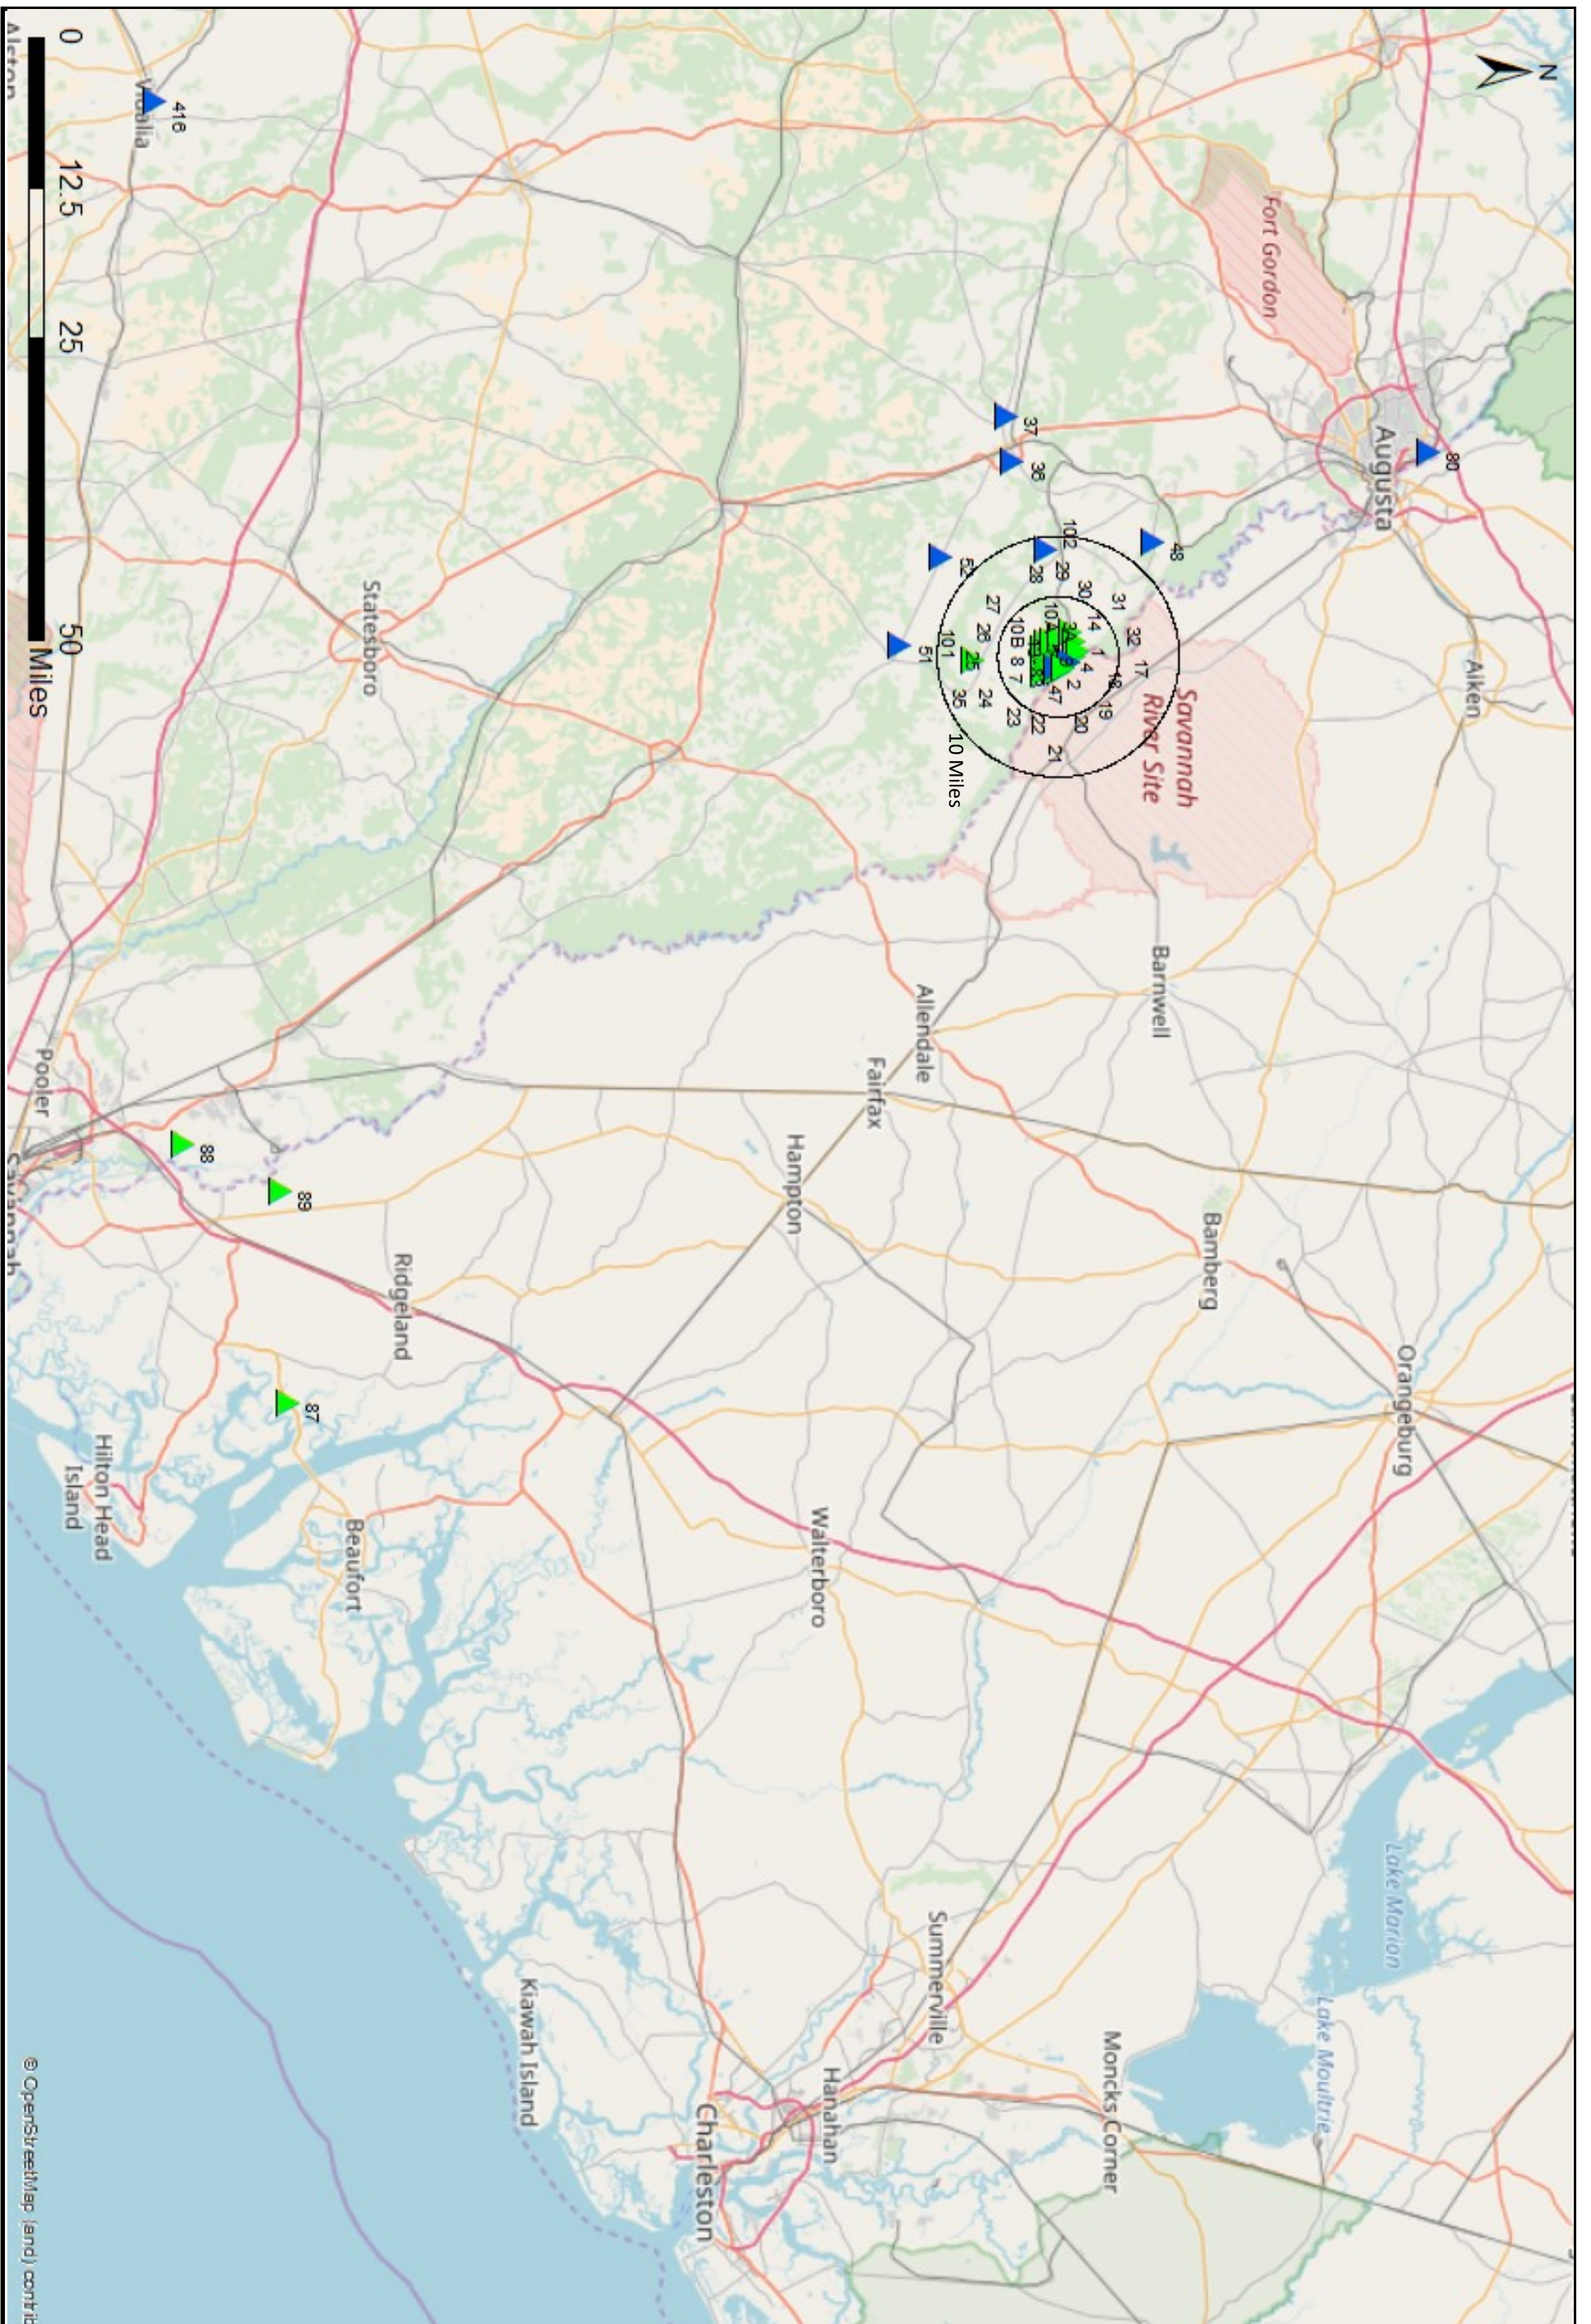

Legend:	
Indicator Stations -	
Control Stations -	
Other Stations -	

Vogtle Electric Generating Plant
 2021 Annual Radiological Environmental Report
 Extended REMP Stations



Drawn by:

C. Groce

Appendix A
 Map A-3

April 19, 2022

This page intentionally left blank.

APPENDIX B

Errata



There are no errata for the 2021 reporting year.



APPENDIX C

Data

The following pages contain the individual data points from the 2021 reporting year. The units for the data points varies by media, as follows:

- Airborne Radioiodine and Particulates/Water/Milk – picocuries/liter (pCi/l)
- Sediment/Vegetation/Fish – picocuries/kilogram (pCi/kg)
- Direct Radiation – millirem (mR)



cust_id	profile_name	analyte_name	cust_sample_id	collect_date	result	result_units	lab_sample_id	revised date
Vogtle	DW - Gamma	Co-58	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	Co-60	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	Zn-65	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	Zr-95	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	I-131	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	Cs-134	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	Cs-137	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	Ba-140	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	La-140	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	Be-7	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	K-40	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	Fe-59	RAUC	1/5/2021		0 pCi/L	127929001	1/5/2021
Vogtle	DW - Gamma	Co-58	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	Co-60	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	Zn-65	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	Zr-95	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	I-131	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	Cs-134	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	Cs-137	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	Ba-140	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	La-140	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	Be-7	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	K-40	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	Fe-59	FAUC	1/5/2021		0 pCi/L	127929002	1/5/2021
Vogtle	DW - Gamma	K-40	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	La-140	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	Co-60	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	Fe-59	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	Co-58	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	Zn-65	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	Zr-95	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	I-131	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	Cs-134	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	Cs-137	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	Ba-140	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	Be-7	FPUR	1/5/2021		0 pCi/L	127929006	1/5/2021
Vogtle	DW - Gamma	K-40	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	Fe-59	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	Co-58	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	Co-60	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	Zn-65	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	Zr-95	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	Cs-134	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	I-131	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	Cs-137	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	Ba-140	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	La-140	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	Be-7	RPUR	1/5/2021		0 pCi/L	127929005	1/5/2021
Vogtle	DW - Gamma	I-131	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	Cs-134	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	Cs-137	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	Ba-140	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	Water H-3	Tritium	1495	1/19/2021		216 pCi/L	128371001	1/19/2021
Vogtle	DW - Gamma	La-140	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	Be-7	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	K-40	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	Fe-59	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	Co-58	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	Co-60	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	Zn-65	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	Zr-95	FPOR	1/5/2021		0 pCi/L	127929004	1/5/2021
Vogtle	DW - Gamma	I-131	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	Cs-134	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	Cs-137	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	Ba-140	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	La-140	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	Be-7	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	K-40	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	Fe-59	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	Co-58	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	Co-60	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	Zn-65	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	DW - Gamma	Zr-95	RPOR	1/5/2021		0 pCi/L	127929003	1/5/2021
Vogtle	Charcoal Ct	I-131	WAY	1/5/2021		0 pCi/m3	127934001	1/5/2021
Vogtle	Charcoal Ct	I-131	GIR	1/5/2021		0 pCi/m3	127934002	1/5/2021
Vogtle	Charcoal Ct	I-131	SIM	1/5/2021		0 pCi/m3	127934003	1/5/2021
Vogtle	Charcoal Ct	I-131	RRD	1/5/2021		0 pCi/m3	127934006	1/5/2021
Vogtle	Charcoal Ct	I-131	HAN	1/5/2021		0 pCi/m3	127934007	1/5/2021
Vogtle	Charcoal Ct	I-131	MET	1/5/2021		0 pCi/m3	127934005	1/5/2021
Vogtle	Charcoal Ct	I-131	DIS	1/5/2021		0 pCi/m3	127934004	1/5/2021
Vogtle	Milk Gamma	Cs-137	GIR	1/12/2021		1.3705 pCi/L	128032002	1/12/2021
Vogtle	Milk Gamma	I-131	GIR	1/12/2021		0 pCi/L	128032002	1/12/2021
Vogtle	Milk Gamma	Cs-134	GIR	1/12/2021		0 pCi/L	128032002	1/12/2021

Vogtle	Milk Gamma	Ba-140	GIR	1/12/2021	0 pCi/L	128032002	1/12/2021
Vogtle	Milk Gamma	K-40	GIR	1/12/2021	1415.5 pCi/L	128032002	1/12/2021
Vogtle	Milk Gamma	Be-7	GIR	1/12/2021	0 pCi/L	128032002	1/12/2021
Vogtle	Milk Gamma	La-140	GIR	1/12/2021	0 pCi/L	128032002	1/12/2021
Vogtle	Charcoal Ct	I-131	GIR	1/12/2021	0 pCi/m3	128042002	1/12/2021
Vogtle	Charcoal Ct	I-131	WAY	1/12/2021	0 pCi/m3	128042001	1/12/2021
Vogtle	Milk Gamma	I-131	Milky Way	1/12/2021	0 pCi/L	128032001	1/12/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	1/12/2021	0 pCi/L	128032001	1/12/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	1/12/2021	0 pCi/L	128032001	1/12/2021
Vogtle	Milk Gamma	La-140	Milky Way	1/12/2021	0 pCi/L	128032001	1/12/2021
Vogtle	Milk Gamma	Be-7	Milky Way	1/12/2021	0 pCi/L	128032001	1/12/2021
Vogtle	Milk Gamma	K-40	Milky Way	1/12/2021	1437.8 pCi/L	128032001	1/12/2021
Vogtle	Water H-3	Tritium	1495	4/13/2021	263 pCi/L	129221003	4/13/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	1/12/2021	0 pCi/L	128032001	1/12/2021
Vogtle	Charcoal Ct	I-131	HAN	1/12/2021	0 pCi/m3	128042007	1/12/2021
Vogtle	Charcoal Ct	I-131	RRD	1/12/2021	0 pCi/m3	128042006	1/12/2021
Vogtle	Charcoal Ct	I-131	SIM	1/12/2021	0 pCi/m3	128042003	1/12/2021
Vogtle	Charcoal Ct	I-131	MET	1/12/2021	0 pCi/m3	128042005	1/12/2021
Vogtle	Charcoal Ct	I-131	DIS	1/12/2021	0 pCi/m3	128042004	1/12/2021
Vogtle	Charcoal Ct	I-131	WAY	1/19/2021	0 pCi/m3	128182001	1/19/2021
Vogtle	Charcoal Ct	I-131	GIR	1/19/2021	0 pCi/m3	128182002	1/19/2021
Vogtle	Charcoal Ct	I-131	HAN	1/19/2021	0 pCi/m3	128182007	1/19/2021
Vogtle	Charcoal Ct	I-131	RRD	1/19/2021	0 pCi/m3	128182006	1/19/2021
Vogtle	Charcoal Ct	I-131	SIM	1/19/2021	0 pCi/m3	128182003	1/19/2021
Vogtle	Charcoal Ct	I-131	MET	1/19/2021	0 pCi/m3	128182005	1/19/2021
Vogtle	Charcoal Ct	I-131	DIS	1/19/2021	0 pCi/m3	128182004	1/19/2021
Vogtle	River Water	Zr-95	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	I-131	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	Cs-134	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	Cs-137	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	Ba-140	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	La-140	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	Be-7	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	K-40	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	Fe-59	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	Co-58	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	Co-60	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	Zn-65	1495	1/19/2021	0 pCi/L	128180002	1/19/2021
Vogtle	River Water	Cs-137	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	Ba-140	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	Be-7	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	K-40	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	La-140	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	Fe-59	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	Co-58	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	Co-60	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	Zn-65	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	Zr-95	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	Water H-3	Tritium	1495	7/13/2021	145 pCi/L	130439001	7/13/2021
Vogtle	River Water	I-131	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	River Water	Cs-134	1504	1/19/2021	0 pCi/L	128180001	1/19/2021
Vogtle	Milk Gamma	Cs-137	GIR	1/26/2021	1.5484 pCi/L	128251002	1/26/2021
Vogtle	Milk Gamma	I-131	GIR	1/26/2021	0 pCi/L	128251002	1/26/2021
Vogtle	Milk Gamma	K-40	GIR	1/26/2021	1449.7 pCi/L	128251002	1/26/2021
Vogtle	Milk Gamma	Ba-140	GIR	1/26/2021	0 pCi/L	128251002	1/26/2021
Vogtle	Milk Gamma	Cs-134	GIR	1/26/2021	0 pCi/L	128251002	1/26/2021
Vogtle	Milk Gamma	La-140	GIR	1/26/2021	0 pCi/L	128251002	1/26/2021
Vogtle	Milk Gamma	Be-7	GIR	1/26/2021	0 pCi/L	128251002	1/26/2021
Vogtle	Charcoal Ct	I-131	GIR	1/26/2021	0 pCi/m3	128276002	1/26/2021
Vogtle	Vegetation	I-131	WAY	1/26/2021	0 pCi/Kg	128277001	1/26/2021
Vogtle	Vegetation	Be-7	WAY	1/26/2021	1604.6 pCi/Kg	128277001	1/26/2021
Vogtle	Vegetation	K-40	WAY	1/26/2021	5122.7 pCi/Kg	128277001	1/26/2021
Vogtle	Vegetation	Cs-134	WAY	1/26/2021	0 pCi/Kg	128277001	1/26/2021
Vogtle	Vegetation	Cs-137	WAY	1/26/2021	0 pCi/Kg	128277001	1/26/2021
Vogtle	Charcoal Ct	I-131	WAY	1/26/2021	0 pCi/m3	128276001	1/26/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	1/26/2021	0 pCi/L	128251001	1/26/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	1/26/2021	0 pCi/L	128251001	1/26/2021
Vogtle	Milk Gamma	La-140	Milky Way	1/26/2021	0 pCi/L	128251001	1/26/2021
Vogtle	Milk Gamma	Be-7	Milky Way	1/26/2021	0 pCi/L	128251001	1/26/2021
Vogtle	Milk Gamma	K-40	Milky Way	1/26/2021	1510.1 pCi/L	128251001	1/26/2021
Vogtle	Milk Gamma	I-131	Milky Way	1/26/2021	0 pCi/L	128251001	1/26/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	1/26/2021	0 pCi/L	128251001	1/26/2021
Vogtle	Vegetation	I-131	HAN	1/26/2021	0 pCi/Kg	128277003	1/26/2021
Vogtle	Vegetation	K-40	HAN	1/26/2021	3826.3 pCi/Kg	128277003	1/26/2021
Vogtle	Vegetation	Be-7	HAN	1/26/2021	1753.9 pCi/Kg	128277003	1/26/2021
Vogtle	Vegetation	Cs-134	HAN	1/26/2021	0 pCi/Kg	128277003	1/26/2021
Vogtle	Vegetation	Cs-137	HAN	1/26/2021	0 pCi/Kg	128277003	1/26/2021
Vogtle	Charcoal Ct	I-131	HAN	1/26/2021	0 pCi/m3	128276007	1/26/2021
Vogtle	Charcoal Ct	I-131	RRD	1/26/2021	0 pCi/m3	128276006	1/26/2021
Vogtle	Charcoal Ct	I-131	SIM	1/26/2021	0 pCi/m3	128276003	1/26/2021
Vogtle	Vegetation	Be-7	SIM	1/26/2021	1081.1 pCi/Kg	128277002	1/26/2021
Vogtle	Water H-3	Tritium	1495	10/19/2021	595 pCi/L	131708003	10/19/2021
Vogtle	Vegetation	K-40	SIM	1/26/2021	5974 pCi/Kg	128277002	1/26/2021
Vogtle	Vegetation	Cs-137	SIM	1/26/2021	0 pCi/Kg	128277002	1/26/2021
Vogtle	Vegetation	Cs-134	SIM	1/26/2021	0 pCi/Kg	128277002	1/26/2021

Vogtle	Milk Gamma	Cs-134	GIR	2/9/2021	0 pCi/L	128451002	2/9/2021
Vogtle	Milk Gamma	Ba-140	GIR	2/9/2021	0 pCi/L	128451002	2/9/2021
Vogtle	Milk Gamma	La-140	GIR	2/9/2021	0 pCi/L	128451002	2/9/2021
Vogtle	Milk Gamma	Be-7	GIR	2/9/2021	0 pCi/L	128451002	2/9/2021
Vogtle	Milk Gamma	K-40	GIR	2/9/2021	1457.8 pCi/L	128451002	2/9/2021
Vogtle	Milk Gamma	Cs-137	GIR	2/9/2021	0 pCi/L	128451002	2/9/2021
Vogtle	Water H-3	Tritium	1504	4/13/2021	192 pCi/L	129221002	4/13/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	2/9/2021	1.6772 pCi/L	128451001	2/9/2021
Vogtle	Milk Gamma	I-131	Milky Way	2/9/2021	0 pCi/L	128451001	2/9/2021
Vogtle	Milk Gamma	Be-7	Milky Way	2/9/2021	0 pCi/L	128451001	2/9/2021
Vogtle	Milk Gamma	La-140	Milky Way	2/9/2021	0 pCi/L	128451001	2/9/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	2/9/2021	0 pCi/L	128451001	2/9/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	2/9/2021	0 pCi/L	128451001	2/9/2021
Vogtle	Milk Gamma	K-40	Milky Way	2/9/2021	1386.1 pCi/L	128451001	2/9/2021
Vogtle	Charcoal Ct	I-131	GIR	2/9/2021	0 pCi/m3	128459002	2/9/2021
Vogtle	Charcoal Ct	I-131	HAN	2/9/2021	0 pCi/m3	128459007	2/9/2021
Vogtle	Charcoal Ct	I-131	RRD	2/9/2021	0 pCi/m3	128459006	2/9/2021
Vogtle	Charcoal Ct	I-131	SIM	2/9/2021	0 pCi/m3	128459003	2/9/2021
Vogtle	Charcoal Ct	I-131	MET	2/9/2021	0 pCi/m3	128459005	2/9/2021
Vogtle	Charcoal Ct	I-131	DIS	2/9/2021	0 pCi/m3	128459004	2/9/2021
Vogtle	River Water	Cs-134	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	Cs-137	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	Ba-140	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	La-140	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	Be-7	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	K-40	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	Fe-59	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	Co-58	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	Co-60	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	Zn-65	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	Zr-95	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	I-131	1495	2/9/2021	0 pCi/L	128452003	2/9/2021
Vogtle	River Water	Co-58	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	Co-60	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	Zn-65	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	Zr-95	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	I-131	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	Cs-134	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	Cs-137	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	Ba-140	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	La-140	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	Be-7	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	K-40	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	Fe-59	1504	2/9/2021	0 pCi/L	128452002	2/9/2021
Vogtle	River Water	Fe-59	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	Co-58	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	Co-60	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	Zn-65	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	Zr-95	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	I-131	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	Cs-134	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	Cs-137	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	Ba-140	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	La-140	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	River Water	Be-7	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	Water H-3	Tritium	1504	7/13/2021	532 pCi/L	130439002	7/13/2021
Vogtle	River Water	K-40	1512	2/9/2021	0 pCi/L	128452001	2/9/2021
Vogtle	Charcoal Ct	I-131	DIS	2/15/2021	0 pCi/m3	128535004	2/15/2021
Vogtle	Charcoal Ct	I-131	MET	2/15/2021	0 pCi/m3	128535005	2/15/2021
Vogtle	Charcoal Ct	I-131	SIM	2/15/2021	0 pCi/m3	128535003	2/15/2021
Vogtle	Charcoal Ct	I-131	GIR	2/15/2021	0 pCi/m3	128535002	2/15/2021
Vogtle	Charcoal Ct	I-131	WAY	2/15/2021	0 pCi/m3	128535001	2/15/2021
Vogtle	Charcoal Ct	I-131	HAN	2/15/2021	0 pCi/m3	128535007	2/15/2021
Vogtle	Charcoal Ct	I-131	RRD	2/15/2021	0 pCi/m3	128535006	2/15/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	2/23/2021	0 pCi/L	128640001	2/23/2021
Vogtle	Milk Gamma	I-131	Milky Way	2/23/2021	0 pCi/L	128640001	2/23/2021
Vogtle	Milk Gamma	K-40	Milky Way	2/23/2021	1402 pCi/L	128640001	2/23/2021
Vogtle	Milk Gamma	Be-7	Milky Way	2/23/2021	0 pCi/L	128640001	2/23/2021
Vogtle	Milk Gamma	La-140	Milky Way	2/23/2021	0 pCi/L	128640001	2/23/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	2/23/2021	0 pCi/L	128640001	2/23/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	2/23/2021	0 pCi/L	128640001	2/23/2021
Vogtle	Charcoal Ct	I-131	WAY	2/23/2021	0 pCi/m3	128644001	2/23/2021
Vogtle	Milk Gamma	Cs-134	GIR	2/23/2021	0 pCi/L	128640002	2/23/2021
Vogtle	Milk Gamma	I-131	GIR	2/23/2021	0 pCi/L	128640002	2/23/2021
Vogtle	Milk Gamma	K-40	GIR	2/23/2021	1375 pCi/L	128640002	2/23/2021
Vogtle	Milk Gamma	Ba-140	GIR	2/23/2021	0 pCi/L	128640002	2/23/2021
Vogtle	Milk Gamma	La-140	GIR	2/23/2021	0 pCi/L	128640002	2/23/2021
Vogtle	Milk Gamma	Be-7	GIR	2/23/2021	0 pCi/L	128640002	2/23/2021
Vogtle	Milk Gamma	Cs-137	GIR	2/23/2021	0 pCi/L	128640002	2/23/2021
Vogtle	Charcoal Ct	I-131	GIR	2/23/2021	0 pCi/m3	128644002	2/23/2021
Vogtle	Charcoal Ct	I-131	SIM	2/23/2021	0 pCi/m3	128644003	2/23/2021
Vogtle	Charcoal Ct	I-131	HAN	2/23/2021	0 pCi/m3	128644007	2/23/2021
Vogtle	Charcoal Ct	I-131	RRD	2/23/2021	0 pCi/m3	128644006	2/23/2021
Vogtle	Charcoal Ct	I-131	MET	2/23/2021	0 pCi/m3	128644005	2/23/2021
Vogtle	Charcoal Ct	I-131	DIS	2/23/2021	0 pCi/m3	128644004	2/23/2021

Vogtle	Milk Gamma	La-140	GIR	3/9/2021	0 pCi/L	128857002	3/9/2021
Vogtle	Milk Gamma	Cs-134	GIR	3/9/2021	0 pCi/L	128857002	3/9/2021
Vogtle	Milk Gamma	I-131	GIR	3/9/2021	0 pCi/L	128857002	3/9/2021
Vogtle	Milk Gamma	Cs-137	GIR	3/9/2021	0 pCi/L	128857002	3/9/2021
Vogtle	Charcoal Ct	I-131	WAY	3/9/2021	0 pCi/m3	128864001	3/9/2021
Vogtle	Milk Gamma	Be-7	Milky Way	3/9/2021	0 pCi/L	128857001	3/9/2021
Vogtle	Milk Gamma	La-140	Milky Way	3/9/2021	0 pCi/L	128857001	3/9/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	3/9/2021	0 pCi/L	128857001	3/9/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	3/9/2021	0 pCi/L	128857001	3/9/2021
Vogtle	Milk Gamma	I-131	Milky Way	3/9/2021	0 pCi/L	128857001	3/9/2021
Vogtle	Milk Gamma	K-40	Milky Way	3/9/2021	1403.5 pCi/L	128857001	3/9/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	3/9/2021	0 pCi/L	128857001	3/9/2021
Vogtle	Charcoal Ct	I-131	HAN	3/9/2021	0 pCi/m3	128864007	3/9/2021
Vogtle	Charcoal Ct	I-131	RRD	3/9/2021	0 pCi/m3	128864006	3/9/2021
Vogtle	Charcoal Ct	I-131	SIM	3/9/2021	0 pCi/m3	128864003	3/9/2021
Vogtle	Charcoal Ct	I-131	MET	3/9/2021	0 pCi/m3	128864005	3/9/2021
Vogtle	Charcoal Ct	I-131	DIS	3/9/2021	0 pCi/m3	128864004	3/9/2021
Vogtle	River Water	Zr-95	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	I-131	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	Cs-134	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	Cs-137	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	Ba-140	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	La-140	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	Be-7	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	K-40	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	Fe-59	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	Co-58	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	Co-60	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	River Water	Zn-65	1495	3/9/2021	0 pCi/L	128858003	3/9/2021
Vogtle	Water H-3	Tritium	1512	7/13/2021	209 pCi/L	130439003	7/13/2021
Vogtle	River Water	Fe-59	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	Co-58	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	Co-60	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	Zn-65	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	Zr-95	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	I-131	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	Cs-134	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	Cs-137	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	Ba-140	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	La-140	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	Be-7	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	K-40	1504	3/9/2021	0 pCi/L	128858002	3/9/2021
Vogtle	River Water	Zn-65	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	Zr-95	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	I-131	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	Water H-3	Tritium	1512	10/19/2021	233 pCi/L	131708001	10/19/2021
Vogtle	River Water	Ba-140	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	La-140	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	Be-7	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	K-40	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	Fe-59	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	Co-58	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	Cs-134	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	Cs-137	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	River Water	Co-60	1512	3/9/2021	0 pCi/L	128858001	3/9/2021
Vogtle	Charcoal Ct	I-131	GIR	3/16/2021	0 pCi/m3	128932002	3/16/2021
Vogtle	Charcoal Ct	I-131	WAY	3/16/2021	0 pCi/m3	128932001	3/16/2021
Vogtle	Charcoal Ct	I-131	HAN	3/16/2021	0 pCi/m3	128932007	3/16/2021
Vogtle	Charcoal Ct	I-131	RRD	3/16/2021	0 pCi/m3	128932006	3/16/2021
Vogtle	Charcoal Ct	I-131	SIM	3/16/2021	0 pCi/m3	128932003	3/16/2021
Vogtle	Charcoal Ct	I-131	MET	3/16/2021	0 pCi/m3	128932005	3/16/2021
Vogtle	Charcoal Ct	I-131	GIR	3/23/2021	0 pCi/m3	129000002	3/23/2021
Vogtle	Milk Gamma	I-131	GIR	3/23/2021	0 pCi/L	128986002	3/23/2021
Vogtle	Milk Gamma	Cs-134	GIR	3/23/2021	0 pCi/L	128986002	3/23/2021
Vogtle	Milk Gamma	Ba-140	GIR	3/23/2021	0 pCi/L	128986002	3/23/2021
Vogtle	Milk Gamma	La-140	GIR	3/23/2021	0 pCi/L	128986002	3/23/2021
Vogtle	Milk Gamma	Be-7	GIR	3/23/2021	0 pCi/L	128986002	3/23/2021
Vogtle	Milk Gamma	K-40	GIR	3/23/2021	1318.1 pCi/L	128986002	3/23/2021
Vogtle	Milk Gamma	Cs-137	GIR	3/23/2021	0 pCi/L	128986002	3/23/2021
Vogtle	Charcoal Ct	I-131	WAY	3/23/2021	0 pCi/m3	129000001	3/23/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	3/23/2021	1.5632 pCi/L	128986001	3/23/2021
Vogtle	Milk Gamma	K-40	Milky Way	3/23/2021	1395.7 pCi/L	128986001	3/23/2021
Vogtle	Milk Gamma	Be-7	Milky Way	3/23/2021	0 pCi/L	128986001	3/23/2021
Vogtle	Milk Gamma	La-140	Milky Way	3/23/2021	0 pCi/L	128986001	3/23/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	3/23/2021	0 pCi/L	128986001	3/23/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	3/23/2021	0 pCi/L	128986001	3/23/2021
Vogtle	Milk Gamma	I-131	Milky Way	3/23/2021	0 pCi/L	128986001	3/23/2021
Vogtle	Charcoal Ct	I-131	HAN	3/23/2021	0 pCi/m3	129000007	3/23/2021
Vogtle	Charcoal Ct	I-131	RRD	3/23/2021	0 pCi/m3	129000006	3/23/2021
Vogtle	Charcoal Ct	I-131	SIM	3/23/2021	0 pCi/m3	129000003	3/23/2021
Vogtle	Charcoal Ct	I-131	MET	3/23/2021	0 pCi/m3	129000005	3/23/2021
Vogtle	Charcoal Ct	I-131	DIS	3/23/2021	0 pCi/m3	129000004	3/23/2021
Vogtle	Charcoal Ct	I-131	GIR	3/30/2021	0 pCi/m3	129045002	3/30/2021
Vogtle	Air Qtr Comp	I-131	GIR	3/30/2021	0 pCi/m3	129162002	3/30/2021
Vogtle	Air Qtr Comp	Cs-134	GIR	3/30/2021	0 pCi/m3	129162002	3/30/2021

Vogtle	Air Qtr Comp	Cs-137	GIR	3/30/2021	0 pCi/m3	129162002	3/30/2021
Vogtle	Air Qtr Comp	Be-7	GIR	3/30/2021	0.0873 pCi/m3	129162002	3/30/2021
Vogtle	Air Qtr Comp	I-131	WAY	3/30/2021	0 pCi/m3	129162001	3/30/2021
Vogtle	Air Qtr Comp	Cs-134	WAY	3/30/2021	0 pCi/m3	129162001	3/30/2021
Vogtle	Air Qtr Comp	Cs-137	WAY	3/30/2021	0 pCi/m3	129162001	3/30/2021
Vogtle	Air Qtr Comp	Be-7	WAY	3/30/2021	0.07382 pCi/m3	129162001	3/30/2021
Vogtle	Charcoal Ct	I-131	WAY	3/30/2021	0 pCi/m3	129045001	3/30/2021
Vogtle	Vegetation	I-131	WAY	3/30/2021	0 pCi/Kg	129046001	3/30/2021
Vogtle	Vegetation	Cs-134	WAY	3/30/2021	0 pCi/Kg	129046001	3/30/2021
Vogtle	Vegetation	Cs-137	WAY	3/30/2021	0 pCi/Kg	129046001	3/30/2021
Vogtle	Vegetation	Be-7	WAY	3/30/2021	378.23 pCi/Kg	129046001	3/30/2021
Vogtle	Vegetation	K-40	WAY	3/30/2021	4609.6 pCi/Kg	129046001	3/30/2021
Vogtle	Vegetation	Cs-134	HAN	3/30/2021	0 pCi/Kg	129046003	3/30/2021
Vogtle	Vegetation	Be-7	HAN	3/30/2021	599.51 pCi/Kg	129046003	3/30/2021
Vogtle	Vegetation	K-40	HAN	3/30/2021	5689.4 pCi/Kg	129046003	3/30/2021
Vogtle	Vegetation	I-131	HAN	3/30/2021	0 pCi/Kg	129046003	3/30/2021
Vogtle	Vegetation	Cs-137	HAN	3/30/2021	0 pCi/Kg	129046003	3/30/2021
Vogtle	Air Qtr Comp	I-131	HAN	3/30/2021	0 pCi/m3	129162007	3/30/2021
Vogtle	Air Qtr Comp	Cs-134	HAN	3/30/2021	0 pCi/m3	129162007	3/30/2021
Vogtle	Air Qtr Comp	Cs-137	HAN	3/30/2021	0 pCi/m3	129162007	3/30/2021
Vogtle	Air Qtr Comp	Be-7	HAN	3/30/2021	0.08291 pCi/m3	129162007	3/30/2021
Vogtle	Charcoal Ct	I-131	HAN	3/30/2021	0 pCi/m3	129045007	3/30/2021
Vogtle	Air Qtr Comp	Cs-134	RRD	3/30/2021	0 pCi/m3	129162006	3/30/2021
Vogtle	Air Qtr Comp	Cs-137	RRD	3/30/2021	0 pCi/m3	129162006	3/30/2021
Vogtle	Air Qtr Comp	Be-7	RRD	3/30/2021	0.09405 pCi/m3	129162006	3/30/2021
Vogtle	Charcoal Ct	I-131	RRD	3/30/2021	0 pCi/m3	129045006	3/30/2021
Vogtle	Air Qtr Comp	I-131	RRD	3/30/2021	0 pCi/m3	129162006	3/30/2021
Vogtle	Air Qtr Comp	I-131	SIM	3/30/2021	0 pCi/m3	129162003	3/30/2021
Vogtle	Air Qtr Comp	Cs-134	SIM	3/30/2021	0 pCi/m3	129162003	3/30/2021
Vogtle	Air Qtr Comp	Cs-137	SIM	3/30/2021	0 pCi/m3	129162003	3/30/2021
Vogtle	Air Qtr Comp	Be-7	SIM	3/30/2021	0.09267 pCi/m3	129162003	3/30/2021
Vogtle	Charcoal Ct	I-131	SIM	3/30/2021	0 pCi/m3	129045003	3/30/2021
Vogtle	Vegetation	I-131	SIM	3/30/2021	0 pCi/Kg	129046002	3/30/2021
Vogtle	Vegetation	Cs-134	SIM	3/30/2021	0 pCi/Kg	129046002	3/30/2021
Vogtle	Vegetation	Cs-137	SIM	3/30/2021	0 pCi/Kg	129046002	3/30/2021
Vogtle	Vegetation	Be-7	SIM	3/30/2021	368.47 pCi/Kg	129046002	3/30/2021
Vogtle	Vegetation	K-40	SIM	3/30/2021	5243.3 pCi/Kg	129046002	3/30/2021
Vogtle	Air Qtr Comp	I-131	MET	3/30/2021	0 pCi/m3	129162005	3/30/2021
Vogtle	Air Qtr Comp	Cs-137	MET	3/30/2021	0 pCi/m3	129162005	3/30/2021
Vogtle	Air Qtr Comp	Cs-134	MET	3/30/2021	0 pCi/m3	129162005	3/30/2021
Vogtle	Air Qtr Comp	Be-7	MET	3/30/2021	0.06166 pCi/m3	129162005	3/30/2021
Vogtle	Charcoal Ct	I-131	MET	3/30/2021	0 pCi/m3	129045005	3/30/2021
Vogtle	Air Qtr Comp	Cs-134	DIS	3/30/2021	0 pCi/m3	129162004	3/30/2021
Vogtle	Air Qtr Comp	Cs-137	DIS	3/30/2021	0 pCi/m3	129162004	3/30/2021
Vogtle	Air Qtr Comp	Be-7	DIS	3/30/2021	0.1155 pCi/m3	129162004	3/30/2021
Vogtle	Charcoal Ct	I-131	DIS	3/30/2021	0 pCi/m3	129045004	3/30/2021
Vogtle	Air Qtr Comp	I-131	DIS	3/30/2021	0 pCi/m3	129162004	3/30/2021
Vogtle	Charcoal Ct	I-131	DIS	4/5/2021	0 pCi/m3	129120004	4/5/2021
Vogtle	Charcoal Ct	I-131	MET	4/5/2021	0 pCi/m3	129120005	4/5/2021
Vogtle	Charcoal Ct	I-131	SIM	4/5/2021	0 pCi/m3	129120003	4/5/2021
Vogtle	Charcoal Ct	I-131	RRD	4/5/2021	0 pCi/m3	129120006	4/5/2021
Vogtle	Charcoal Ct	I-131	HAN	4/5/2021	0 pCi/m3	129120007	4/5/2021
Vogtle	Charcoal Ct	I-131	WAY	4/5/2021	0 pCi/m3	129120001	4/5/2021
Vogtle	Charcoal Ct	I-131	GIR	4/5/2021	0 pCi/m3	129120002	4/5/2021
Vogtle	DW - Gamma	Be-7	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	K-40	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	Fe-59	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	Co-58	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	Co-60	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	Zn-65	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	Zr-95	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	I-131	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	Cs-134	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	Cs-137	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	Ba-140	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	La-140	FAUC	4/6/2021	0 pCi/L	129106002	4/6/2021
Vogtle	DW - Gamma	I-131	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	DW - Gamma	Cs-134	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	DW - Gamma	Cs-137	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	DW - Gamma	Ba-140	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	DW - Gamma	La-140	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	1/5/2021	0.01828 pCi/m3	127933004	1/5/2021
Vogtle	DW - Gamma	Be-7	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	1/12/2021	0.03078 pCi/m3	128041004	1/12/2021
Vogtle	DW - Gamma	K-40	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	1/19/2021	0.02481 pCi/m3	128181004	1/19/2021
Vogtle	DW - Gamma	Fe-59	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	1/26/2021	0.02235 pCi/m3	128275004	1/26/2021
Vogtle	Air Filters	Gross Beta	DIS	2/1/2021	0.02178 pCi/m3	128356004	2/1/2021
Vogtle	DW - Gamma	Co-58	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	2/9/2021	0.01507 pCi/m3	128458004	2/9/2021
Vogtle	DW - Gamma	Co-60	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	DW - Gamma	Zn-65	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	2/15/2021	0.01064 pCi/m3	128534004	2/15/2021
Vogtle	DW - Gamma	Zr-95	RAUC	4/6/2021	0 pCi/L	129106001	4/6/2021

Vogtle	Air Filters	Gross Beta	DIS	2/23/2021	0.02139 pCi/m3	128643004	2/23/2021
Vogtle	Air Filters	Gross Beta	DIS	3/2/2021	0.02257 pCi/m3	128782004	3/2/2021
Vogtle	Air Filters	Gross Beta	DIS	3/9/2021	0.02535 pCi/m3	128863004	3/9/2021
Vogtle	DW - Gamma	Cs-134	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	3/23/2021	0.01796 pCi/m3	128999004	3/23/2021
Vogtle	DW - Gamma	Cs-137	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	DW - Gamma	Ba-140	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	DW - Gamma	La-140	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	DW - Gamma	Be-7	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	DW - Gamma	K-40	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	3/30/2021	0.01597 pCi/m3	129044004	3/30/2021
Vogtle	DW - Gamma	Fe-59	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	4/5/2021	0.02271 pCi/m3	129119004	4/5/2021
Vogtle	Air Filters	Gross Beta	DIS	4/13/2021	0.02601 pCi/m3	129199004	4/13/2021
Vogtle	DW - Gamma	Co-58	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	DW - Gamma	Co-60	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	4/20/2021	0.02685 pCi/m3	129250004	4/20/2021
Vogtle	Air Filters	Gross Beta	DIS	4/27/2021	0.02568 pCi/m3	129295004	4/27/2021
Vogtle	DW - Gamma	Zn-65	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	DW - Gamma	Zr-95	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	5/3/2021	0.02657 pCi/m3	129366004	5/3/2021
Vogtle	Air Filters	Gross Beta	DIS	5/11/2021	0.02128 pCi/m3	129445004	5/11/2021
Vogtle	DW - Gamma	I-131	FPUR	4/6/2021	0 pCi/L	129106006	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	5/18/2021	0.01962 pCi/m3	129520004	5/18/2021
Vogtle	DW - Gamma	K-40	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	5/25/2021	0.02865 pCi/m3	129573004	5/25/2021
Vogtle	Air Filters	Gross Beta	DIS	6/1/2021	0.0236 pCi/m3	129657004	6/1/2021
Vogtle	DW - Gamma	Fe-59	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	6/8/2021	0.01433 pCi/m3	129797004	6/8/2021
Vogtle	Air Filters	Gross Beta	DIS	6/15/2021	0.01544 pCi/m3	129928004	6/15/2021
Vogtle	DW - Gamma	Co-58	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	DW - Gamma	Co-60	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	6/22/2021	0.0232 pCi/m3	130036004	6/22/2021
Vogtle	DW - Gamma	Zn-65	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	6/29/2021	0.01845 pCi/m3	130145004	6/29/2021
Vogtle	DW - Gamma	Zr-95	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	DW - Gamma	I-131	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	DW - Gamma	Cs-134	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	7/6/2021	0.01467 pCi/m3	130206004	7/6/2021
Vogtle	DW - Gamma	Cs-137	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	7/12/2021	0.01377 pCi/m3	130290004	7/12/2021
Vogtle	DW - Gamma	La-140	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	DW - Gamma	Ba-140	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	7/19/2021	0.01359 pCi/m3	130422004	7/19/2021
Vogtle	Air Filters	Gross Beta	DIS	7/27/2021	0.02021 pCi/m3	130527004	7/27/2021
Vogtle	DW - Gamma	Be-7	RPUR	4/6/2021	0 pCi/L	129106005	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	8/3/2021	0.02642 pCi/m3	130595004	8/3/2021
Vogtle	DW - Gamma	Co-58	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	DW - Gamma	Co-60	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	8/10/2021	0.01514 pCi/m3	130719004	8/10/2021
Vogtle	DW - Gamma	Zn-65	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	8/17/2021	0.01485 pCi/m3	130835004	8/17/2021
Vogtle	Air Filters	Gross Beta	DIS	8/24/2021	0.01178 pCi/m3	130902004	8/24/2021
Vogtle	DW - Gamma	Zr-95	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	8/31/2021	0.025 pCi/m3	131012004	8/31/2021
Vogtle	DW - Gamma	I-131	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	9/7/2021	0.02593 pCi/m3	131125004	9/7/2021
Vogtle	Air Filters	Gross Beta	DIS	9/14/2021	0.02805 pCi/m3	131254004	9/14/2021
Vogtle	DW - Gamma	Cs-134	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	9/21/2021	0.01584 pCi/m3	131332004	9/21/2021
Vogtle	DW - Gamma	Cs-137	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	9/28/2021	0.02627 pCi/m3	131422004	9/28/2021
Vogtle	DW - Gamma	Ba-140	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	DW - Gamma	La-140	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	DW - Gamma	Be-7	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	DW - Gamma	K-40	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	DW - Gamma	Fe-59	FPOR	4/6/2021	0 pCi/L	129106004	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	10/5/2021	0.04045 pCi/m3	131549004	10/5/2021
Vogtle	Air Filters	Gross Beta	DIS	10/12/2021	0.01526 pCi/m3	131616004	10/12/2021
Vogtle	DW - Gamma	Cs-137	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	10/19/2021	0.0271 pCi/m3	131695004	10/19/2021
Vogtle	DW - Gamma	Ba-140	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	10/24/2021	0.04352 pCi/m3	131756004	10/24/2021
Vogtle	DW - Gamma	La-140	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	11/1/2021	0.01748 pCi/m3	131853004	11/1/2021
Vogtle	DW - Gamma	Be-7	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	11/9/2021	0.02398 pCi/m3	131941004	11/9/2021
Vogtle	DW - Gamma	K-40	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	11/16/2021	0.02533 pCi/m3	131993004	11/16/2021
Vogtle	DW - Gamma	Fe-59	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	11/22/2021	0.02094 pCi/m3	132036004	11/22/2021
Vogtle	DW - Gamma	Co-58	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	11/29/2021	0.02329 pCi/m3	132085004	11/29/2021
Vogtle	DW - Gamma	Zn-65	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	12/7/2021	0.04653 pCi/m3	132155004	12/7/2021

Vogtle	DW - Gamma	Co-60	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	12/13/2021	0.02452 pCi/m3	132220004	12/13/2021
Vogtle	DW - Gamma	Zr-95	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Air Filters	Gross Beta	DIS	12/21/2021	0.01896 pCi/m3	132273004	12/21/2021
Vogtle	DW - Gamma	I-131	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	DW - Gamma	Cs-134	RPOR	4/6/2021	0 pCi/L	129106003	4/6/2021
Vogtle	Charcoal Ct	I-131	GIR	4/13/2021	0 pCi/m3	129200002	4/13/2021
Vogtle	Milk Gamma	Ba-140	GIR	4/13/2021	0 pCi/L	129183002	4/13/2021
Vogtle	Air Filters	Gross Beta	DIS	12/28/2021	0.02691 pCi/m3	132323004	12/28/2021
Vogtle	Milk Gamma	La-140	GIR	4/13/2021	0 pCi/L	129183002	4/13/2021
Vogtle	Milk Gamma	Be-7	GIR	4/13/2021	0 pCi/L	129183002	4/13/2021
Vogtle	Milk Gamma	K-40	GIR	4/13/2021	1375.4 pCi/L	129183002	4/13/2021
Vogtle	Milk Gamma	Cs-134	GIR	4/13/2021	0 pCi/L	129183002	4/13/2021
Vogtle	Milk Gamma	I-131	GIR	4/13/2021	0 pCi/L	129183002	4/13/2021
Vogtle	Milk Gamma	Cs-137	GIR	4/13/2021	0 pCi/L	129183002	4/13/2021
Vogtle	Charcoal Ct	I-131	WAY	4/13/2021	0 pCi/m3	129200001	4/13/2021
Vogtle	Milk Gamma	Be-7	Milky Way	4/13/2021	0 pCi/L	129183001	4/13/2021
Vogtle	Milk Gamma	La-140	Milky Way	4/13/2021	0 pCi/L	129183001	4/13/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	4/13/2021	0 pCi/L	129183001	4/13/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	4/13/2021	0 pCi/L	129183001	4/13/2021
Vogtle	Milk Gamma	I-131	Milky Way	4/13/2021	0 pCi/L	129183001	4/13/2021
Vogtle	Milk Gamma	K-40	Milky Way	4/13/2021	1405 pCi/L	129183001	4/13/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	1/5/2021	0 pCi/L	127928002	1/5/2021
Vogtle	DW - Beta	Gross Beta	FAUC	1/5/2021	2.681 pCi/L	127928002	1/5/2021
Vogtle	Water H-3	Tritium	FAUC	1/5/2021	133 pCi/L	128365002	1/5/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	4/13/2021	0 pCi/L	129183001	4/13/2021
Vogtle	DW - Beta	Gross Beta	FAUC	2/2/2021	2.129 pCi/L	128358002	2/2/2021
Vogtle	Charcoal Ct	I-131	HAN	4/13/2021	0 pCi/m3	129200007	4/13/2021
Vogtle	Charcoal Ct	I-131	RDR	4/13/2021	0 pCi/m3	129200006	4/13/2021
Vogtle	Charcoal Ct	I-131	SIM	4/13/2021	0 pCi/m3	129200003	4/13/2021
Vogtle	Charcoal Ct	I-131	MET	4/13/2021	0 pCi/m3	129200005	4/13/2021
Vogtle	Charcoal Ct	I-131	DIS	4/13/2021	0 pCi/m3	129200004	4/13/2021
Vogtle	River Water	Cs-137	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	Ba-140	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	La-140	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	Be-7	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	K-40	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	Fe-59	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	Co-58	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	Co-60	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	2/2/2021	0 pCi/L	128358002	2/2/2021
Vogtle	River Water	Zn-65	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	Zr-95	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	I-131	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	Cs-134	1495	4/13/2021	0 pCi/L	129185003	4/13/2021
Vogtle	River Water	I-131	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	La-140	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	Cs-134	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	Cs-137	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	Ba-140	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	Be-7	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	K-40	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	Fe-59	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	3/2/2021	0 pCi/L	128780002	3/2/2021
Vogtle	DW - Beta	Gross Beta	FAUC	3/2/2021	2.221 pCi/L	128780002	3/2/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	4/6/2021	0 pCi/L	129105002	4/6/2021
Vogtle	DW - Beta	Gross Beta	FAUC	4/6/2021	1.668 pCi/L	129105002	4/6/2021
Vogtle	River Water	Co-58	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	Co-60	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	Water H-3	Tritium	FAUC	4/6/2021	170 pCi/L	129220002	4/6/2021
Vogtle	River Water	Zn-65	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	Zr-95	1504	4/13/2021	0 pCi/L	129185002	4/13/2021
Vogtle	River Water	Fe-59	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	Co-58	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	Co-60	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	Zn-65	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	Zr-95	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	Be-7	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	K-40	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	I-131	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	Cs-134	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	Cs-137	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	5/4/2021	0 pCi/L	129363002	5/4/2021
Vogtle	DW - Beta	Gross Beta	FAUC	5/4/2021	0.9738 pCi/L	129363002	5/4/2021
Vogtle	River Water	Ba-140	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	River Water	La-140	1512	4/13/2021	0 pCi/L	129185001	4/13/2021
Vogtle	Sediment	Cs-134	1533	4/13/2021	0 pCi/Kg	129184002	4/13/2021
Vogtle	Sediment	Cs-137	1533	4/13/2021	0 pCi/Kg	129184002	4/13/2021
Vogtle	Sediment	Be-7	1533	4/13/2021	0 pCi/Kg	129184002	4/13/2021
Vogtle	Sediment	K-40	1533	4/13/2021	14130 pCi/Kg	129184002	4/13/2021
Vogtle	Sediment	Co-60	1533	4/13/2021	0 pCi/Kg	129184002	4/13/2021
Vogtle	Sediment	Co-58	1533	4/13/2021	0 pCi/Kg	129184002	4/13/2021
Vogtle	Sediment	Co-58	1502	4/13/2021	0 pCi/Kg	129184001	4/13/2021
Vogtle	Sediment	K-40	1502	4/13/2021	13218 pCi/Kg	129184001	4/13/2021
Vogtle	Sediment	Be-7	1502	4/13/2021	2411.8 pCi/Kg	129184001	4/13/2021

Vogtle	Sediment	Cs-137	1502	4/13/2021	82.224 pCi/Kg	129184001	4/13/2021
Vogtle	Sediment	Cs-134	1502	4/13/2021	0 pCi/Kg	129184001	4/13/2021
Vogtle	Sediment	Co-60	1502	4/13/2021	0 pCi/Kg	129184001	4/13/2021
Vogtle	Charcoal Ct	I-131	GIR	4/20/2021	0 pCi/m3	129251002	4/20/2021
Vogtle	Charcoal Ct	I-131	WAY	4/20/2021	0 pCi/m3	129251001	4/20/2021
Vogtle	Charcoal Ct	I-131	HAN	4/20/2021	0 pCi/m3	129251007	4/20/2021
Vogtle	Charcoal Ct	I-131	RRD	4/20/2021	0 pCi/m3	129251006	4/20/2021
Vogtle	Charcoal Ct	I-131	SIM	4/20/2021	0 pCi/m3	129251003	4/20/2021
Vogtle	Charcoal Ct	I-131	MET	4/20/2021	0 pCi/m3	129251005	4/20/2021
Vogtle	Charcoal Ct	I-131	DIS	4/20/2021	0 pCi/m3	129251004	4/20/2021
Vogtle	Milk Gamma	I-131	GIR	4/27/2021	0 pCi/L	129294002	4/27/2021
Vogtle	DW - Beta	Gross Beta	FAUC	6/1/2021	3.958 pCi/L	129655002	6/1/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	6/1/2021	0 pCi/L	129655002	6/1/2021
Vogtle	Milk Gamma	Cs-134	GIR	4/27/2021	0 pCi/L	129294002	4/27/2021
Vogtle	Milk Gamma	Ba-140	GIR	4/27/2021	0 pCi/L	129294002	4/27/2021
Vogtle	Milk Gamma	La-140	GIR	4/27/2021	0 pCi/L	129294002	4/27/2021
Vogtle	Milk Gamma	Be-7	GIR	4/27/2021	0 pCi/L	129294002	4/27/2021
Vogtle	Milk Gamma	K-40	GIR	4/27/2021	1384.8 pCi/L	129294002	4/27/2021
Vogtle	Milk Gamma	Cs-137	GIR	4/27/2021	0 pCi/L	129294002	4/27/2021
Vogtle	Charcoal Ct	I-131	GIR	4/27/2021	0 pCi/m3	129296002	4/27/2021
Vogtle	Vegetation	Cs-134	WAY	4/27/2021	0 pCi/Kg	129299001	4/27/2021
Vogtle	Vegetation	Cs-137	WAY	4/27/2021	0 pCi/Kg	129299001	4/27/2021
Vogtle	Vegetation	Be-7	WAY	4/27/2021	263.94 pCi/Kg	129299001	4/27/2021
Vogtle	Vegetation	K-40	WAY	4/27/2021	4277.9 pCi/Kg	129299001	4/27/2021
Vogtle	Vegetation	I-131	WAY	4/27/2021	0 pCi/Kg	129299001	4/27/2021
Vogtle	Charcoal Ct	I-131	WAY	4/27/2021	0 pCi/m3	129296001	4/27/2021
Vogtle	Milk Gamma	K-40	Milky Way	4/27/2021	1374.8 pCi/L	129294001	4/27/2021
Vogtle	Milk Gamma	Be-7	Milky Way	4/27/2021	0 pCi/L	129294001	4/27/2021
Vogtle	Milk Gamma	La-140	Milky Way	4/27/2021	0 pCi/L	129294001	4/27/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	4/27/2021	0 pCi/L	129294001	4/27/2021
Vogtle	Water H-3	Tritium	FAUC	7/6/2021	0 pCi/L	130438002	7/6/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	7/6/2021	0 pCi/L	130196002	7/6/2021
Vogtle	DW - Beta	Gross Beta	FAUC	7/6/2021	2.972 pCi/L	130196002	7/6/2021
Vogtle	Milk Gamma	I-131	Milky Way	4/27/2021	0 pCi/L	129294001	4/27/2021
Vogtle	DW - Beta	Gross Beta	FAUC	8/3/2021	4.203 pCi/L	130593002	8/3/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	8/3/2021	0 pCi/L	130593002	8/3/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	4/27/2021	0 pCi/L	129294001	4/27/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	4/27/2021	0 pCi/L	129294001	4/27/2021
Vogtle	Charcoal Ct	I-131	HAN	4/27/2021	0 pCi/m3	129296007	4/27/2021
Vogtle	Vegetation	K-40	HAN	4/27/2021	4514 pCi/Kg	129299003	4/27/2021
Vogtle	Vegetation	I-131	HAN	4/27/2021	0 pCi/Kg	129299003	4/27/2021
Vogtle	Vegetation	Be-7	HAN	4/27/2021	727.5 pCi/Kg	129299003	4/27/2021
Vogtle	Vegetation	Cs-134	HAN	4/27/2021	0 pCi/Kg	129299003	4/27/2021
Vogtle	Vegetation	Cs-137	HAN	4/27/2021	0 pCi/Kg	129299003	4/27/2021
Vogtle	Fish	K-40	1535 Bass	4/27/2021	3742 pCi/Kg	129297001	4/27/2021
Vogtle	Fish	K-40	1535 Sucker	4/27/2021	3248 pCi/Kg	129297002	4/27/2021
Vogtle	Fish	Cs-137	1535 Bass	4/27/2021	136.31 pCi/Kg	129297001	4/27/2021
Vogtle	Fish	Be-7	1535 Bass	4/27/2021	0 pCi/Kg	129297001	4/27/2021
Vogtle	Fish	Be-7	1535 Sucker	4/27/2021	0 pCi/Kg	129297002	4/27/2021
Vogtle	Fish	Co-58	1535 Bass	4/27/2021	0 pCi/Kg	129297001	4/27/2021
Vogtle	DW - Beta	Gross Beta	FAUC	9/7/2021	3.481 pCi/L	131123002	9/7/2021
Vogtle	Fish	Co-58	1535 Sucker	4/27/2021	0 pCi/Kg	129297002	4/27/2021
Vogtle	Fish	Zn-65	1535 Bass	4/27/2021	0 pCi/Kg	129297001	4/27/2021
Vogtle	Fish	Cs-134	1535 Bass	4/27/2021	0 pCi/Kg	129297001	4/27/2021
Vogtle	Fish	Co-60	1535 Bass	4/27/2021	0 pCi/Kg	129297001	4/27/2021
Vogtle	Fish	Fe-59	1535 Bass	4/27/2021	0 pCi/Kg	129297001	4/27/2021
Vogtle	Fish	Co-60	1535 Sucker	4/27/2021	0 pCi/Kg	129297002	4/27/2021
Vogtle	Fish	Cs-134	1535 Sucker	4/27/2021	0 pCi/Kg	129297002	4/27/2021
Vogtle	Fish	Zn-65	1535 Sucker	4/27/2021	0 pCi/Kg	129297002	4/27/2021
Vogtle	Fish	Fe-59	1535 Sucker	4/27/2021	0 pCi/Kg	129297002	4/27/2021
Vogtle	Fish	Cs-137	1535 Sucker	4/27/2021	0 pCi/Kg	129297002	4/27/2021
Vogtle	Charcoal Ct	I-131	RRD	4/27/2021	0 pCi/m3	129296006	4/27/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	9/7/2021	0 pCi/L	131123002	9/7/2021
Vogtle	Charcoal Ct	I-131	SIM	4/27/2021	0 pCi/m3	129296003	4/27/2021
Vogtle	Vegetation	K-40	SIM	4/27/2021	4492.8 pCi/Kg	129299002	4/27/2021
Vogtle	Vegetation	I-131	SIM	4/27/2021	0 pCi/Kg	129299002	4/27/2021
Vogtle	Vegetation	Be-7	SIM	4/27/2021	1168.8 pCi/Kg	129299002	4/27/2021
Vogtle	Vegetation	Cs-137	SIM	4/27/2021	0 pCi/Kg	129299002	4/27/2021
Vogtle	Vegetation	Cs-134	SIM	4/27/2021	0 pCi/Kg	129299002	4/27/2021
Vogtle	Charcoal Ct	I-131	MET	4/27/2021	0 pCi/m3	129296005	4/27/2021
Vogtle	Charcoal Ct	I-131	DIS	4/27/2021	0 pCi/m3	129296004	4/27/2021
Vogtle	Fish	K-40	1492-1478 Sucker	4/27/2021	4188.9 pCi/Kg	129297004	4/27/2021
Vogtle	Fish	K-40	1492-1478 Mullet	4/27/2021	3812.2 pCi/Kg	129297006	4/27/2021
Vogtle	Fish	K-40	1492-1478 Bass	4/27/2021	3747.3 pCi/Kg	129297005	4/27/2021
Vogtle	Fish	K-40	1492-1478 Carp	4/27/2021	3419.1 pCi/Kg	129297003	4/27/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	10/5/2021	0 pCi/L	131519002	10/5/2021
Vogtle	DW - Beta	Gross Beta	FAUC	10/5/2021	2.917 pCi/L	131519002	10/5/2021
Vogtle	Fish	Cs-137	1492-1478 Bass	4/27/2021	82.509 pCi/Kg	129297005	4/27/2021
Vogtle	Fish	Be-7	1492-1478 Bass	4/27/2021	0 pCi/Kg	129297005	4/27/2021
Vogtle	Water H-3	Tritium	FAUC	10/5/2021	163 pCi/L	131707002	10/5/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	11/2/2021	0 pCi/L	131850002	11/2/2021
Vogtle	DW - Beta	Gross Beta	FAUC	11/2/2021	0.9658 pCi/L	131850002	11/2/2021
Vogtle	Fish	Be-7	1492-1478 Carp	4/27/2021	0 pCi/Kg	129297003	4/27/2021
Vogtle	Fish	Be-7	1492-1478 Mullet	4/27/2021	0 pCi/Kg	129297006	4/27/2021
Vogtle	Fish	Be-7	1492-1478 Sucker	4/27/2021	0 pCi/Kg	129297004	4/27/2021

Vogtle	Fish	Fe-59	1492-1478 Bass	4/27/2021	0 pCi/Kg	129297005	4/27/2021
Vogtle	Fish	Zn-65	1492-1478 Bass	4/27/2021	0 pCi/Kg	129297005	4/27/2021
Vogtle	Fish	Cs-134	1492-1478 Bass	4/27/2021	0 pCi/Kg	129297005	4/27/2021
Vogtle	Fish	Co-58	1492-1478 Bass	4/27/2021	0 pCi/Kg	129297005	4/27/2021
Vogtle	Fish	Fe-59	1492-1478 Carp	4/27/2021	0 pCi/Kg	129297003	4/27/2021
Vogtle	Fish	Co-58	1492-1478 Carp	4/27/2021	0 pCi/Kg	129297003	4/27/2021
Vogtle	Fish	Co-58	1492-1478 Mullet	4/27/2021	0 pCi/Kg	129297006	4/27/2021
Vogtle	Fish	Zn-65	1492-1478 Carp	4/27/2021	0 pCi/Kg	129297003	4/27/2021
Vogtle	Fish	Cs-134	1492-1478 Carp	4/27/2021	0 pCi/Kg	129297003	4/27/2021
Vogtle	Fish	Co-58	1492-1478 Sucker	4/27/2021	0 pCi/Kg	129297004	4/27/2021
Vogtle	Fish	Fe-59	1492-1478 Mullet	4/27/2021	0 pCi/Kg	129297006	4/27/2021
Vogtle	Fish	Zn-65	1492-1478 Mullet	4/27/2021	0 pCi/Kg	129297006	4/27/2021
Vogtle	Fish	Cs-134	1492-1478 Mullet	4/27/2021	0 pCi/Kg	129297006	4/27/2021
Vogtle	Fish	Fe-59	1492-1478 Sucker	4/27/2021	0 pCi/Kg	129297004	4/27/2021
Vogtle	Fish	Zn-65	1492-1478 Sucker	4/27/2021	0 pCi/Kg	129297004	4/27/2021
Vogtle	Fish	Cs-134	1492-1478 Sucker	4/27/2021	0 pCi/Kg	129297004	4/27/2021
Vogtle	Fish	Co-60	1492-1478 Bass	4/27/2021	0 pCi/Kg	129297005	4/27/2021
Vogtle	Fish	Co-60	1492-1478 Carp	4/27/2021	0 pCi/Kg	129297003	4/27/2021
Vogtle	Fish	Co-60	1492-1478 Mullet	4/27/2021	0 pCi/Kg	129297006	4/27/2021
Vogtle	Fish	Co-60	1492-1478 Sucker	4/27/2021	0 pCi/Kg	129297004	4/27/2021
Vogtle	DW - Beta	Gross Alpha	FAUC	12/8/2021	0 pCi/L	132149002	12/8/2021
Vogtle	DW - Beta	Gross Beta	FAUC	12/8/2021	3.368 pCi/L	132149002	12/8/2021
Vogtle	Fish	Cs-137	1492-1478 Carp	4/27/2021	0 pCi/Kg	129297003	4/27/2021
Vogtle	Water H-3	Tritium	FPOR	1/5/2021	155 pCi/L	128365004	1/5/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	1/5/2021	0 pCi/L	127928004	1/5/2021
Vogtle	DW - Beta	Gross Beta	FPOR	1/5/2021	2.014 pCi/L	127928004	1/5/2021
Vogtle	Fish	Cs-137	1492-1478 Mullet	4/27/2021	0 pCi/Kg	129297006	4/27/2021
Vogtle	Fish	Cs-137	1492-1478 Sucker	4/27/2021	0 pCi/Kg	129297004	4/27/2021
Vogtle	Charcoal Ct	I-131	DIS	5/3/2021	0 pCi/m3	129367004	5/3/2021
Vogtle	Charcoal Ct	I-131	MET	5/3/2021	0 pCi/m3	129367005	5/3/2021
Vogtle	Charcoal Ct	I-131	SIM	5/3/2021	0 pCi/m3	129367003	5/3/2021
Vogtle	Charcoal Ct	I-131	RRD	5/3/2021	0 pCi/m3	129367006	5/3/2021
Vogtle	Charcoal Ct	I-131	HAN	5/3/2021	0 pCi/m3	129367007	5/3/2021
Vogtle	Charcoal Ct	I-131	WAY	5/3/2021	0 pCi/m3	129367001	5/3/2021
Vogtle	DW - Gamma	Fe-59	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	Co-58	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	Zn-65	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	Co-60	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	Zr-95	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Beta	Gross Beta	FPOR	2/2/2021	1.205 pCi/L	128358004	2/2/2021
Vogtle	DW - Gamma	I-131	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	Cs-134	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	Cs-137	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	Ba-140	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	La-140	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	Be-7	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	K-40	RAUC	5/4/2021	0 pCi/L	129364001	5/4/2021
Vogtle	DW - Gamma	Fe-59	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	Co-58	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	Co-60	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	Zn-65	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	Zr-95	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	2/2/2021	0 pCi/L	128358004	2/2/2021
Vogtle	DW - Gamma	I-131	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	Cs-134	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	Cs-137	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	Ba-140	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	La-140	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	Be-7	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	K-40	FAUC	5/4/2021	0 pCi/L	129364002	5/4/2021
Vogtle	DW - Gamma	Zn-65	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	Zr-95	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	I-131	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	Cs-134	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	Cs-137	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	3/1/2021	0 pCi/L	128780004	3/1/2021
Vogtle	DW - Beta	Gross Beta	FPOR	3/1/2021	4.401 pCi/L	128780004	3/1/2021
Vogtle	DW - Beta	Gross Beta	FPOR	4/6/2021	2.266 pCi/L	129105004	4/6/2021
Vogtle	DW - Gamma	Ba-140	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	Water H-3	Tritium	FPOR	4/6/2021	192 pCi/L	129220004	4/6/2021
Vogtle	DW - Gamma	La-140	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	Be-7	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	K-40	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	Fe-59	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	Co-58	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	Co-60	FPUR	5/4/2021	0 pCi/L	129364006	5/4/2021
Vogtle	DW - Gamma	Fe-59	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	Co-58	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	Co-60	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	Zn-65	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	Zr-95	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	4/6/2021	0 pCi/L	129105004	4/6/2021
Vogtle	DW - Gamma	I-131	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	Cs-134	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	Cs-137	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021

Vogtle	DW - Gamma	Ba-140	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	La-140	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	Be-7	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	K-40	RPUR	5/4/2021	0 pCi/L	129364005	5/4/2021
Vogtle	DW - Gamma	Fe-59	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	Co-58	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	Co-60	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	Zn-65	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	Zr-95	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Beta	Gross Beta	FPOR	5/4/2021	0.8425 pCi/L	129363004	5/4/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	5/4/2021	0 pCi/L	129363004	5/4/2021
Vogtle	DW - Gamma	I-131	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	Cs-134	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	Cs-137	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	Ba-140	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	La-140	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	Be-7	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	K-40	FPOR	5/4/2021	0 pCi/L	129364004	5/4/2021
Vogtle	DW - Gamma	Co-58	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	6/1/2021	0 pCi/L	129655004	6/1/2021
Vogtle	DW - Beta	Gross Beta	FPOR	6/1/2021	3.102 pCi/L	129655004	6/1/2021
Vogtle	DW - Gamma	Co-60	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	Zn-65	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	Zr-95	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	I-131	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	Cs-134	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	Cs-137	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	Ba-140	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	La-140	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	Be-7	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	K-40	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	DW - Gamma	Fe-59	RPOR	5/4/2021	0 pCi/L	129364003	5/4/2021
Vogtle	Charcoal Ct	I-131	GIR	5/4/2021	0 pCi/m3	129367002	5/4/2021
Vogtle	Milk Gamma	K-40	GIR	5/11/2021	1329.7 pCi/L	129444002	5/11/2021
Vogtle	Milk Gamma	Be-7	GIR	5/11/2021	0 pCi/L	129444002	5/11/2021
Vogtle	Milk Gamma	La-140	GIR	5/11/2021	0 pCi/L	129444002	5/11/2021
Vogtle	Milk Gamma	Ba-140	GIR	5/11/2021	0 pCi/L	129444002	5/11/2021
Vogtle	Milk Gamma	I-131	GIR	5/11/2021	0 pCi/L	129444002	5/11/2021
Vogtle	Water H-3	Tritium	FPOR	7/5/2021	145 pCi/L	130438004	7/5/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	7/5/2021	0 pCi/L	130196004	7/5/2021
Vogtle	DW - Beta	Gross Beta	FPOR	7/5/2021	3.751 pCi/L	130196004	7/5/2021
Vogtle	Milk Gamma	Cs-134	GIR	5/11/2021	0 pCi/L	129444002	5/11/2021
Vogtle	Milk Gamma	Cs-137	GIR	5/11/2021	0 pCi/L	129444002	5/11/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	5/11/2021	0 pCi/L	129444001	5/11/2021
Vogtle	Milk Gamma	I-131	Milky Way	5/11/2021	0 pCi/L	129444001	5/11/2021
Vogtle	Milk Gamma	K-40	Milky Way	5/11/2021	1408.4 pCi/L	129444001	5/11/2021
Vogtle	Milk Gamma	Be-7	Milky Way	5/11/2021	0 pCi/L	129444001	5/11/2021
Vogtle	Milk Gamma	La-140	Milky Way	5/11/2021	0 pCi/L	129444001	5/11/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	5/11/2021	0 pCi/L	129444001	5/11/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	5/11/2021	0 pCi/L	129444001	5/11/2021
Vogtle	Charcoal Ct	I-131	GIR	5/11/2021	0 pCi/m3	129446002	5/11/2021
Vogtle	Charcoal Ct	I-131	WAY	5/11/2021	0 pCi/m3	129446001	5/11/2021
Vogtle	Charcoal Ct	I-131	HAN	5/11/2021	0 pCi/m3	129446007	5/11/2021
Vogtle	Charcoal Ct	I-131	RRD	5/11/2021	0 pCi/m3	129446006	5/11/2021
Vogtle	Charcoal Ct	I-131	SIM	5/11/2021	0 pCi/m3	129446003	5/11/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	8/3/2021	0 pCi/L	130593004	8/3/2021
Vogtle	DW - Beta	Gross Beta	FPOR	8/3/2021	6.312 pCi/L	130593004	8/3/2021
Vogtle	DW - Beta	Gross Beta	FPOR	9/7/2021	2.782 pCi/L	131123004	9/7/2021
Vogtle	Charcoal Ct	I-131	MET	5/11/2021	0 pCi/m3	129446005	5/11/2021
Vogtle	Charcoal Ct	I-131	DIS	5/11/2021	0 pCi/m3	129446004	5/11/2021
Vogtle	Charcoal Ct	I-131	GIR	5/18/2021	0 pCi/m3	129521002	5/18/2021
Vogtle	Charcoal Ct	I-131	WAY	5/18/2021	0 pCi/m3	129521001	5/18/2021
Vogtle	Charcoal Ct	I-131	HAN	5/18/2021	0 pCi/m3	129521007	5/18/2021
Vogtle	Charcoal Ct	I-131	RRD	5/18/2021	0 pCi/m3	129521006	5/18/2021
Vogtle	Charcoal Ct	I-131	SIM	5/18/2021	0 pCi/m3	129521003	5/18/2021
Vogtle	Charcoal Ct	I-131	MET	5/18/2021	0 pCi/m3	129521005	5/18/2021
Vogtle	Charcoal Ct	I-131	DIS	5/18/2021	0 pCi/m3	129521004	5/18/2021
Vogtle	River Water	Co-58	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	Co-60	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	Zn-65	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	Zr-95	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	9/7/2021	0 pCi/L	131123004	9/7/2021
Vogtle	Water H-3	Tritium	FPOR	10/5/2021	486 pCi/L	131707004	10/5/2021
Vogtle	River Water	I-131	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	Cs-134	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	Cs-137	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	Ba-140	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	La-140	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	Be-7	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	K-40	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	Fe-59	1495	5/18/2021	0 pCi/L	129522003	5/18/2021
Vogtle	River Water	Cs-134	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	Cs-137	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	Ba-140	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	10/5/2021	0 pCi/L	131519004	10/5/2021

Vogtle	DW - Beta	Gross Beta	FPOR	10/5/2021	4.427 pCi/L	131519004	10/5/2021
Vogtle	River Water	La-140	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	Be-7	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	DW - Beta	Gross Beta	FPOR	11/2/2021	1.904 pCi/L	131850004	11/2/2021
Vogtle	River Water	K-40	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	Co-58	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	Fe-59	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	Co-60	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	Zn-65	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	Zr-95	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	I-131	1504	5/18/2021	0 pCi/L	129522002	5/18/2021
Vogtle	River Water	Be-7	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	K-40	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	Fe-59	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	Co-60	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	11/2/2021	0 pCi/L	131850004	11/2/2021
Vogtle	River Water	Co-58	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	Zn-65	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	Zr-95	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	I-131	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	Cs-134	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	Cs-137	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	Ba-140	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	River Water	La-140	1512	5/18/2021	0 pCi/L	129522001	5/18/2021
Vogtle	Milk Gamma	Cs-134	GIR	5/25/2021	0 pCi/L	129570002	5/25/2021
Vogtle	DW - Beta	Gross Alpha	FPOR	12/8/2021	0 pCi/L	132149004	12/8/2021
Vogtle	DW - Beta	Gross Beta	FPOR	12/8/2021	3.467 pCi/L	132149004	12/8/2021
Vogtle	Milk Gamma	Ba-140	GIR	5/25/2021	0 pCi/L	129570002	5/25/2021
Vogtle	Milk Gamma	La-140	GIR	5/25/2021	0 pCi/L	129570002	5/25/2021
Vogtle	Milk Gamma	Be-7	GIR	5/25/2021	0 pCi/L	129570002	5/25/2021
Vogtle	Milk Gamma	K-40	GIR	5/25/2021	1355.3 pCi/L	129570002	5/25/2021
Vogtle	Milk Gamma	I-131	GIR	5/25/2021	0 pCi/L	129570002	5/25/2021
Vogtle	Milk Gamma	Cs-137	GIR	5/25/2021	0 pCi/L	129570002	5/25/2021
Vogtle	Charcoal Ct	I-131	GIR	5/25/2021	0 pCi/m3	129574002	5/25/2021
Vogtle	Charcoal Ct	I-131	WAY	5/25/2021	0 pCi/m3	129574001	5/25/2021
Vogtle	Vegetation	Cs-134	WAY	5/25/2021	0 pCi/Kg	129571001	5/25/2021
Vogtle	Vegetation	Cs-137	WAY	5/25/2021	0 pCi/Kg	129571001	5/25/2021
Vogtle	Vegetation	I-131	WAY	5/25/2021	0 pCi/Kg	129571001	5/25/2021
Vogtle	Vegetation	K-40	WAY	5/25/2021	5564 pCi/Kg	129571001	5/25/2021
Vogtle	Vegetation	Be-7	WAY	5/25/2021	0 pCi/Kg	129571001	5/25/2021
Vogtle	Milk Gamma	I-131	Milky Way	5/25/2021	0 pCi/L	129570001	5/25/2021
Vogtle	Milk Gamma	K-40	Milky Way	5/25/2021	1380.4 pCi/L	129570001	5/25/2021
Vogtle	Milk Gamma	Be-7	Milky Way	5/25/2021	0 pCi/L	129570001	5/25/2021
Vogtle	Milk Gamma	La-140	Milky Way	5/25/2021	0 pCi/L	129570001	5/25/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	5/25/2021	0 pCi/L	129570001	5/25/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	1/5/2021	0 pCi/L	127928006	1/5/2021
Vogtle	DW - Beta	Gross Beta	FPUR	1/5/2021	5.843 pCi/L	127928006	1/5/2021
Vogtle	Water H-3	Tritium	FPUR	1/5/2021	179 pCi/L	128365006	1/5/2021
Vogtle	DW - Beta	Gross Beta	FPUR	2/2/2021	1.83 pCi/L	128358006	2/2/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	5/25/2021	0 pCi/L	129570001	5/25/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	5/25/2021	0 pCi/L	129570001	5/25/2021
Vogtle	Vegetation	Be-7	HAN	5/25/2021	863.13 pCi/Kg	129571003	5/25/2021
Vogtle	Vegetation	K-40	HAN	5/25/2021	5445 pCi/Kg	129571003	5/25/2021
Vogtle	Vegetation	Cs-134	HAN	5/25/2021	0 pCi/Kg	129571003	5/25/2021
Vogtle	Vegetation	I-131	HAN	5/25/2021	0 pCi/Kg	129571003	5/25/2021
Vogtle	Vegetation	Cs-137	HAN	5/25/2021	0 pCi/Kg	129571003	5/25/2021
Vogtle	Charcoal Ct	I-131	HAN	5/25/2021	0 pCi/m3	129574007	5/25/2021
Vogtle	Charcoal Ct	I-131	RRD	5/25/2021	0 pCi/m3	129574006	5/25/2021
Vogtle	Charcoal Ct	I-131	SIM	5/25/2021	0 pCi/m3	129574003	5/25/2021
Vogtle	Vegetation	I-131	SIM	5/25/2021	0 pCi/Kg	129571002	5/25/2021
Vogtle	Vegetation	Cs-137	SIM	5/25/2021	0 pCi/Kg	129571002	5/25/2021
Vogtle	Vegetation	Cs-134	SIM	5/25/2021	0 pCi/Kg	129571002	5/25/2021
Vogtle	Vegetation	K-40	SIM	5/25/2021	4238.1 pCi/Kg	129571002	5/25/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	2/2/2021	0 pCi/L	128358006	2/2/2021
Vogtle	Vegetation	Be-7	SIM	5/25/2021	148.25 pCi/Kg	129571002	5/25/2021
Vogtle	Charcoal Ct	I-131	MET	5/25/2021	0 pCi/m3	129574005	5/25/2021
Vogtle	Charcoal Ct	I-131	DIS	5/25/2021	0 pCi/m3	129574004	5/25/2021
Vogtle	DW - Gamma	Zn-65	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	Zr-95	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	I-131	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	Cs-134	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	Cs-137	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	Ba-140	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	La-140	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	Be-7	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	K-40	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	3/1/2021	0 pCi/L	128780006	3/1/2021
Vogtle	DW - Beta	Gross Beta	FPUR	3/1/2021	4.755 pCi/L	128780006	3/1/2021
Vogtle	DW - Beta	Gross Beta	FPUR	4/6/2021	1.772 pCi/L	129105006	4/6/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	4/6/2021	0 pCi/L	129105006	4/6/2021
Vogtle	DW - Gamma	Fe-59	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	Co-58	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	Co-60	RAUC	6/1/2021	0 pCi/L	129656001	6/1/2021
Vogtle	DW - Gamma	Zr-95	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	I-131	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021

Vogtle	DW - Gamma	Cs-134	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	Cs-137	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	Ba-140	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	La-140	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	Be-7	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	K-40	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	Fe-59	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	Water H-3	Tritium	FPUR	4/6/2021	188 pCi/L	129220006	4/6/2021
Vogtle	DW - Gamma	Co-58	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	Co-60	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	Zn-65	FAUC	6/1/2021	0 pCi/L	129656002	6/1/2021
Vogtle	DW - Gamma	I-131	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	Cs-134	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	Cs-137	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	Ba-140	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	La-140	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	Be-7	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	K-40	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	Fe-59	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	Co-58	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Beta	Gross Beta	FPUR	5/4/2021	1.68 pCi/L	129363006	5/4/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	5/4/2021	0 pCi/L	129363006	5/4/2021
Vogtle	DW - Gamma	Co-60	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	Zn-65	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	Zr-95	FPUR	6/1/2021	0 pCi/L	129656006	6/1/2021
Vogtle	DW - Gamma	I-131	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Cs-134	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Cs-137	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Ba-140	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	La-140	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Be-7	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	6/1/2021	0 pCi/L	129655006	6/1/2021
Vogtle	DW - Beta	Gross Beta	FPUR	6/1/2021	2.351 pCi/L	129655006	6/1/2021
Vogtle	DW - Gamma	K-40	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Fe-59	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Co-58	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Co-60	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Zn-65	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Zr-95	RPUR	6/1/2021	0 pCi/L	129656005	6/1/2021
Vogtle	DW - Gamma	Fe-59	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	Co-58	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	Co-60	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	Zn-65	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	Zr-95	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	I-131	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	Cs-134	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	Cs-137	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	Ba-140	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	Water H-3	Tritium	FPUR	7/5/2021	319 pCi/L	130438006	7/5/2021
Vogtle	DW - Beta	Gross Beta	FPUR	7/5/2021	3.689 pCi/L	130196006	7/5/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	7/5/2021	0 pCi/L	130196006	7/5/2021
Vogtle	DW - Gamma	La-140	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	Be-7	FPOR	6/1/2021	0 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	K-40	FPOR	6/1/2021	42.858 pCi/L	129656004	6/1/2021
Vogtle	DW - Gamma	I-131	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	Cs-134	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	Cs-137	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	Ba-140	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	La-140	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	Be-7	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	K-40	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	Fe-59	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	Co-58	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	Co-60	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	8/3/2021	0 pCi/L	130593006	8/3/2021
Vogtle	DW - Beta	Gross Beta	FPUR	8/3/2021	6.843 pCi/L	130593006	8/3/2021
Vogtle	DW - Beta	Gross Beta	FPUR	9/7/2021	4.462 pCi/L	131123006	9/7/2021
Vogtle	DW - Gamma	Zn-65	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	DW - Gamma	Zr-95	RPOR	6/1/2021	0 pCi/L	129656003	6/1/2021
Vogtle	Charcoal Ct	I-131	GIR	6/1/2021	0 pCi/m3	129658002	6/1/2021
Vogtle	Charcoal Ct	I-131	WAY	6/1/2021	0 pCi/m3	129658001	6/1/2021
Vogtle	Charcoal Ct	I-131	HAN	6/1/2021	0 pCi/m3	129658007	6/1/2021
Vogtle	Charcoal Ct	I-131	RRD	6/1/2021	0 pCi/m3	129658006	6/1/2021
Vogtle	Charcoal Ct	I-131	SIM	6/1/2021	0 pCi/m3	129658003	6/1/2021
Vogtle	Charcoal Ct	I-131	MET	6/1/2021	0 pCi/m3	129658005	6/1/2021
Vogtle	Charcoal Ct	I-131	DIS	6/1/2021	0 pCi/m3	129658004	6/1/2021
Vogtle	Charcoal Ct	I-131	GIR	6/8/2021	0 pCi/m3	129798002	6/8/2021
Vogtle	Milk Gamma	Cs-137	GIR	6/8/2021	2.0678 pCi/L	129795002	6/8/2021
Vogtle	Milk Gamma	K-40	GIR	6/8/2021	1350.7 pCi/L	129795002	6/8/2021
Vogtle	Milk Gamma	Be-7	GIR	6/8/2021	0 pCi/L	129795002	6/8/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	9/7/2021	0 pCi/L	131123006	9/7/2021
Vogtle	Milk Gamma	I-131	GIR	6/8/2021	0 pCi/L	129795002	6/8/2021
Vogtle	Milk Gamma	Cs-134	GIR	6/8/2021	0 pCi/L	129795002	6/8/2021
Vogtle	Milk Gamma	Ba-140	GIR	6/8/2021	0 pCi/L	129795002	6/8/2021
Vogtle	Milk Gamma	La-140	GIR	6/8/2021	0 pCi/L	129795002	6/8/2021

Vogtle	Charcoal Ct	I-131	WAY	6/8/2021	0 pCi/m3	129798001	6/8/2021
Vogtle	Milk Gamma	Be-7	Milky Way	6/8/2021	0 pCi/L	129795001	6/8/2021
Vogtle	Milk Gamma	La-140	Milky Way	6/8/2021	0 pCi/L	129795001	6/8/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	6/8/2021	0 pCi/L	129795001	6/8/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	6/8/2021	0 pCi/L	129795001	6/8/2021
Vogtle	Milk Gamma	I-131	Milky Way	6/8/2021	0 pCi/L	129795001	6/8/2021
Vogtle	Milk Gamma	K-40	Milky Way	6/8/2021	1346 pCi/L	129795001	6/8/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	6/8/2021	0 pCi/L	129795001	6/8/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	10/5/2021	0 pCi/L	131519006	10/5/2021
Vogtle	DW - Beta	Gross Beta	FPUR	10/5/2021	5.151 pCi/L	131519006	10/5/2021
Vogtle	Charcoal Ct	I-131	HAN	6/8/2021	0 pCi/m3	129798007	6/8/2021
Vogtle	Charcoal Ct	I-131	RRD	6/8/2021	0 pCi/m3	129798006	6/8/2021
Vogtle	Water H-3	Tritium	FPUR	10/5/2021	1050 pCi/L	131707006	10/5/2021
Vogtle	DW - Beta	Gross Beta	FPUR	11/2/2021	2.412 pCi/L	131850006	11/2/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	11/2/2021	0 pCi/L	131850006	11/2/2021
Vogtle	Charcoal Ct	I-131	SIM	6/8/2021	0 pCi/m3	129798003	6/8/2021
Vogtle	Charcoal Ct	I-131	MET	6/8/2021	0 pCi/m3	129798005	6/8/2021
Vogtle	Charcoal Ct	I-131	DIS	6/8/2021	0 pCi/m3	129798004	6/8/2021
Vogtle	River Water	Fe-59	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	Co-58	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	Co-60	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	Zn-65	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	Zr-95	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	I-131	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	Cs-134	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	Cs-137	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	Ba-140	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	La-140	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	Be-7	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	K-40	1495	6/8/2021	0 pCi/L	129796003	6/8/2021
Vogtle	River Water	Zn-65	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	Zr-95	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	I-131	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	Cs-134	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	Cs-137	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	DW - Beta	Gross Alpha	FPUR	12/8/2021	0 pCi/L	132149006	12/8/2021
Vogtle	DW - Beta	Gross Beta	FPUR	12/8/2021	2.296 pCi/L	132149006	12/8/2021
Vogtle	River Water	Ba-140	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	La-140	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	Be-7	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	K-40	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	Fe-59	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	Air Filters	Gross Beta	GIR	1/5/2021	0.01767 pCi/m3	127933002	1/5/2021
Vogtle	River Water	Co-58	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	Co-60	1504	6/8/2021	0 pCi/L	129796002	6/8/2021
Vogtle	River Water	Zn-65	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	River Water	Zr-95	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	River Water	I-131	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	River Water	Cs-134	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	Air Filters	Gross Beta	GIR	1/12/2021	0.02565 pCi/m3	128041002	1/12/2021
Vogtle	River Water	Cs-137	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	River Water	Ba-140	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	Air Filters	Gross Beta	GIR	1/19/2021	0.02558 pCi/m3	128181002	1/19/2021
Vogtle	River Water	La-140	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	River Water	Be-7	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	River Water	K-40	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	River Water	Fe-59	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	River Water	Co-58	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	River Water	Co-60	1512	6/8/2021	0 pCi/L	129796001	6/8/2021
Vogtle	Air Filters	Gross Beta	GIR	1/26/2021	0.02636 pCi/m3	128275002	1/26/2021
Vogtle	Charcoal Ct	I-131	GIR	6/15/2021	0 pCi/m3	129929002	6/15/2021
Vogtle	Air Filters	Gross Beta	GIR	2/1/2021	0.02175 pCi/m3	128356002	2/1/2021
Vogtle	Charcoal Ct	I-131	WAY	6/15/2021	0 pCi/m3	129929001	6/15/2021
Vogtle	Charcoal Ct	I-131	HAN	6/15/2021	0 pCi/m3	129929007	6/15/2021
Vogtle	Charcoal Ct	I-131	RRD	6/15/2021	0 pCi/m3	129929006	6/15/2021
Vogtle	Charcoal Ct	I-131	SIM	6/15/2021	0 pCi/m3	129929003	6/15/2021
Vogtle	Charcoal Ct	I-131	MET	6/15/2021	0 pCi/m3	129929005	6/15/2021
Vogtle	Charcoal Ct	I-131	DIS	6/15/2021	0 pCi/m3	129929004	6/15/2021
Vogtle	Milk Gamma	La-140	GIR	6/22/2021	0 pCi/L	130034002	6/22/2021
Vogtle	Milk Gamma	Be-7	GIR	6/22/2021	0 pCi/L	130034002	6/22/2021
Vogtle	Air Filters	Gross Beta	GIR	2/9/2021	0.01652 pCi/m3	128458002	2/9/2021
Vogtle	Milk Gamma	K-40	GIR	6/22/2021	1297.4 pCi/L	130034002	6/22/2021
Vogtle	Air Filters	Gross Beta	GIR	2/15/2021	0.01156 pCi/m3	128534002	2/15/2021
Vogtle	Milk Gamma	I-131	GIR	6/22/2021	0 pCi/L	130034002	6/22/2021
Vogtle	Milk Gamma	Cs-134	GIR	6/22/2021	0 pCi/L	130034002	6/22/2021
Vogtle	Milk Gamma	Ba-140	GIR	6/22/2021	0 pCi/L	130034002	6/22/2021
Vogtle	Milk Gamma	Cs-137	GIR	6/22/2021	0 pCi/L	130034002	6/22/2021
Vogtle	Charcoal Ct	I-131	GIR	6/22/2021	0 pCi/m3	130042002	6/22/2021
Vogtle	Charcoal Ct	I-131	WAY	6/22/2021	0 pCi/m3	130042001	6/22/2021
Vogtle	Milk Gamma	K-40	Milky Way	6/22/2021	1406.9 pCi/L	130034001	6/22/2021
Vogtle	Milk Gamma	Be-7	Milky Way	6/22/2021	0 pCi/L	130034001	6/22/2021
Vogtle	Air Filters	Gross Beta	GIR	2/23/2021	0.01812 pCi/m3	128643002	2/23/2021
Vogtle	Milk Gamma	La-140	Milky Way	6/22/2021	0 pCi/L	130034001	6/22/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	6/22/2021	0 pCi/L	130034001	6/22/2021
Vogtle	Air Filters	Gross Beta	GIR	3/2/2021	0.02425 pCi/m3	128782002	3/2/2021

Vogtle	Air Filters	Gross Beta	GIR	3/9/2021	0.02555 pCi/m3	128863002	3/9/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	6/22/2021	0 pCi/L	130034001	6/22/2021
Vogtle	Milk Gamma	I-131	Milky Way	6/22/2021	0 pCi/L	130034001	6/22/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	6/22/2021	0 pCi/L	130034001	6/22/2021
Vogtle	Charcoal Ct	I-131	HAN	6/22/2021	0 pCi/m3	130042007	6/22/2021
Vogtle	Charcoal Ct	I-131	RRD	6/22/2021	0 pCi/m3	130042006	6/22/2021
Vogtle	Charcoal Ct	I-131	SIM	6/22/2021	0 pCi/m3	130042003	6/22/2021
Vogtle	Charcoal Ct	I-131	MET	6/22/2021	0 pCi/m3	130042005	6/22/2021
Vogtle	Charcoal Ct	I-131	DIS	6/22/2021	0 pCi/m3	130042004	6/22/2021
Vogtle	Air Filters	Gross Beta	GIR	3/16/2021	0.02628 pCi/m3	128931002	3/16/2021
Vogtle	Air Qtr Comp	I-131	GIR	6/29/2021	0 pCi/m3	130249002	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	3/23/2021	0.01964 pCi/m3	128999002	3/23/2021
Vogtle	Air Qtr Comp	Cs-134	GIR	6/29/2021	0 pCi/m3	130249002	6/29/2021
Vogtle	Air Qtr Comp	Cs-137	GIR	6/29/2021	0 pCi/m3	130249002	6/29/2021
Vogtle	Air Qtr Comp	Be-7	GIR	6/29/2021	0.09487 pCi/m3	130249002	6/29/2021
Vogtle	Charcoal Ct	I-131	GIR	6/29/2021	0 pCi/m3	130146002	6/29/2021
Vogtle	Air Qtr Comp	Cs-134	WAY	6/29/2021	0 pCi/m3	130249001	6/29/2021
Vogtle	Air Qtr Comp	I-131	WAY	6/29/2021	0 pCi/m3	130249001	6/29/2021
Vogtle	Charcoal Ct	I-131	WAY	6/29/2021	0 pCi/m3	130146001	6/29/2021
Vogtle	Air Qtr Comp	Be-7	WAY	6/29/2021	0.1069 pCi/m3	130249001	6/29/2021
Vogtle	Air Qtr Comp	Cs-137	WAY	6/29/2021	0 pCi/m3	130249001	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	3/30/2021	0.01655 pCi/m3	129044002	3/30/2021
Vogtle	Vegetation	Be-7	WAY	6/29/2021	198.41 pCi/Kg	130147001	6/29/2021
Vogtle	Vegetation	K-40	WAY	6/29/2021	3924 pCi/Kg	130147001	6/29/2021
Vogtle	Vegetation	Cs-134	WAY	6/29/2021	0 pCi/Kg	130147001	6/29/2021
Vogtle	Vegetation	I-131	WAY	6/29/2021	0 pCi/Kg	130147001	6/29/2021
Vogtle	Vegetation	Cs-137	WAY	6/29/2021	0 pCi/Kg	130147001	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	4/5/2021	0.02624 pCi/m3	129119002	4/5/2021
Vogtle	Vegetation	Cs-134	HAN	6/29/2021	0 pCi/Kg	130147003	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	4/13/2021	0.0286 pCi/m3	129199002	4/13/2021
Vogtle	Vegetation	I-131	HAN	6/29/2021	0 pCi/Kg	130147003	6/29/2021
Vogtle	Vegetation	Be-7	HAN	6/29/2021	1261.7 pCi/Kg	130147003	6/29/2021
Vogtle	Vegetation	K-40	HAN	6/29/2021	2642 pCi/Kg	130147003	6/29/2021
Vogtle	Vegetation	Cs-137	HAN	6/29/2021	0 pCi/Kg	130147003	6/29/2021
Vogtle	Charcoal Ct	I-131	HAN	6/29/2021	0 pCi/m3	130146007	6/29/2021
Vogtle	Air Qtr Comp	Cs-137	HAN	6/29/2021	0 pCi/m3	130249007	6/29/2021
Vogtle	Air Qtr Comp	Cs-134	HAN	6/29/2021	0 pCi/m3	130249007	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	4/20/2021	0.02989 pCi/m3	129250002	4/20/2021
Vogtle	Air Qtr Comp	I-131	HAN	6/29/2021	0 pCi/m3	130249007	6/29/2021
Vogtle	Air Qtr Comp	Be-7	HAN	6/29/2021	0.08807 pCi/m3	130249007	6/29/2021
Vogtle	Air Qtr Comp	I-131	RRD	6/29/2021	0 pCi/m3	130249006	6/29/2021
Vogtle	Air Qtr Comp	Cs-134	RRD	6/29/2021	0 pCi/m3	130249006	6/29/2021
Vogtle	Air Qtr Comp	Cs-137	RRD	6/29/2021	0 pCi/m3	130249006	6/29/2021
Vogtle	Air Qtr Comp	Be-7	RRD	6/29/2021	0.1245 pCi/m3	130249006	6/29/2021
Vogtle	Charcoal Ct	I-131	RRD	6/29/2021	0 pCi/m3	130146006	6/29/2021
Vogtle	Air Qtr Comp	Be-7	SIM	6/29/2021	0.1074 pCi/m3	130249003	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	4/27/2021	0.02394 pCi/m3	129295002	4/27/2021
Vogtle	Charcoal Ct	I-131	SIM	6/29/2021	0 pCi/m3	130146003	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	5/4/2021	0.02209 pCi/m3	129366002	5/4/2021
Vogtle	Air Qtr Comp	Cs-137	SIM	6/29/2021	0 pCi/m3	130249003	6/29/2021
Vogtle	Air Qtr Comp	Cs-134	SIM	6/29/2021	0 pCi/m3	130249003	6/29/2021
Vogtle	Air Qtr Comp	I-131	SIM	6/29/2021	0 pCi/m3	130249003	6/29/2021
Vogtle	Vegetation	Cs-137	SIM	6/29/2021	0 pCi/Kg	130147002	6/29/2021
Vogtle	Vegetation	I-131	SIM	6/29/2021	0 pCi/Kg	130147002	6/29/2021
Vogtle	Vegetation	K-40	SIM	6/29/2021	4198.1 pCi/Kg	130147002	6/29/2021
Vogtle	Vegetation	Be-7	SIM	6/29/2021	365.62 pCi/Kg	130147002	6/29/2021
Vogtle	Vegetation	Cs-134	SIM	6/29/2021	0 pCi/Kg	130147002	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	5/11/2021	0.02547 pCi/m3	129445002	5/11/2021
Vogtle	Air Qtr Comp	I-131	MET	6/29/2021	0 pCi/m3	130249005	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	5/18/2021	0.0218 pCi/m3	129520002	5/18/2021
Vogtle	Air Qtr Comp	Cs-134	MET	6/29/2021	0 pCi/m3	130249005	6/29/2021
Vogtle	Air Qtr Comp	Cs-137	MET	6/29/2021	0 pCi/m3	130249005	6/29/2021
Vogtle	Air Qtr Comp	Be-7	MET	6/29/2021	0.08622 pCi/m3	130249005	6/29/2021
Vogtle	Charcoal Ct	I-131	MET	6/29/2021	0 pCi/m3	130146005	6/29/2021
Vogtle	Charcoal Ct	I-131	DIS	6/29/2021	0 pCi/m3	130146004	6/29/2021
Vogtle	Air Qtr Comp	I-131	DIS	6/29/2021	0 pCi/m3	130249004	6/29/2021
Vogtle	Air Qtr Comp	Cs-134	DIS	6/29/2021	0 pCi/m3	130249004	6/29/2021
Vogtle	Air Qtr Comp	Cs-137	DIS	6/29/2021	0 pCi/m3	130249004	6/29/2021
Vogtle	Air Qtr Comp	Be-7	DIS	6/29/2021	0.07968 pCi/m3	130249004	6/29/2021
Vogtle	Air Filters	Gross Beta	GIR	5/25/2021	0.02197 pCi/m3	129573002	5/25/2021
Vogtle	Air Filters	Gross Beta	GIR	6/1/2021	0.01965 pCi/m3	129657002	6/1/2021
Vogtle	DW - Gamma	I-131	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	DW - Gamma	Cs-134	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	6/8/2021	0.007774 pCi/m3	129797002	6/8/2021
Vogtle	DW - Gamma	Cs-137	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	DW - Gamma	Ba-140	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	DW - Gamma	La-140	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	DW - Gamma	Be-7	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	DW - Gamma	K-40	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	DW - Gamma	Fe-59	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	6/15/2021	0.008468 pCi/m3	129928002	6/15/2021
Vogtle	DW - Gamma	Co-58	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	DW - Gamma	Co-60	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	DW - Gamma	Zn-65	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021
Vogtle	DW - Gamma	Zr-95	FPOR	7/5/2021	0 pCi/L	130197004	7/5/2021

Vogtle	DW - Gamma	Co-58	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	DW - Gamma	Co-60	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	DW - Gamma	Zn-65	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	DW - Gamma	Zr-95	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	6/22/2021	0.02327 pCi/m3	130036002	6/22/2021
Vogtle	Air Filters	Gross Beta	GIR	6/29/2021	0.01517 pCi/m3	130145002	6/29/2021
Vogtle	DW - Gamma	I-131	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	DW - Gamma	Cs-134	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	DW - Gamma	Cs-137	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	DW - Gamma	Ba-140	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	DW - Gamma	La-140	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	7/6/2021	0.01581 pCi/m3	130206002	7/6/2021
Vogtle	DW - Gamma	Be-7	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	7/12/2021	0.01368 pCi/m3	130290002	7/12/2021
Vogtle	DW - Gamma	K-40	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	DW - Gamma	Fe-59	RPOR	7/5/2021	0 pCi/L	130197003	7/5/2021
Vogtle	DW - Gamma	Fe-59	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	DW - Gamma	Co-58	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	DW - Gamma	Co-60	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	7/19/2021	0.01331 pCi/m3	130422002	7/19/2021
Vogtle	DW - Gamma	Zn-65	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	DW - Gamma	Zr-95	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	7/27/2021	0.0197 pCi/m3	130527002	7/27/2021
Vogtle	DW - Gamma	I-131	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	DW - Gamma	Cs-134	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	DW - Gamma	Cs-137	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	DW - Gamma	Ba-140	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	DW - Gamma	La-140	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	DW - Gamma	Be-7	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	DW - Gamma	K-40	FPUR	7/5/2021	0 pCi/L	130197006	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	8/3/2021	0.02794 pCi/m3	130595002	8/3/2021
Vogtle	DW - Gamma	Zn-65	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	Zr-95	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	I-131	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	Cs-134	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	K-40	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	Fe-59	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	8/10/2021	0.0159 pCi/m3	130719002	8/10/2021
Vogtle	Air Filters	Gross Beta	GIR	8/17/2021	0.01506 pCi/m3	130835002	8/17/2021
Vogtle	DW - Gamma	Co-58	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	Air Filters	Gross Beta	GIR	8/24/2021	0.01269 pCi/m3	130902002	8/24/2021
Vogtle	DW - Gamma	Co-60	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	Cs-137	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	Ba-140	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	La-140	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	Be-7	RPUR	7/5/2021	0 pCi/L	130197005	7/5/2021
Vogtle	DW - Gamma	Fe-59	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	DW - Gamma	Co-58	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	DW - Gamma	Co-60	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	Air Filters	Gross Beta	GIR	8/31/2021	0.02533 pCi/m3	131012002	8/31/2021
Vogtle	DW - Gamma	Zn-65	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	Air Filters	Gross Beta	GIR	9/7/2021	0.02438 pCi/m3	131125002	9/7/2021
Vogtle	Air Filters	Gross Beta	GIR	9/14/2021	0.02399 pCi/m3	131254002	9/14/2021
Vogtle	DW - Gamma	Zr-95	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	DW - Gamma	I-131	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	DW - Gamma	Cs-134	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	DW - Gamma	Cs-137	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	DW - Gamma	Ba-140	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	DW - Gamma	La-140	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	DW - Gamma	Be-7	FAUC	7/6/2021	0 pCi/L	130197002	7/6/2021
Vogtle	Air Filters	Gross Beta	GIR	9/21/2021	0.01509 pCi/m3	131332002	9/21/2021
Vogtle	DW - Gamma	K-40	FAUC	7/6/2021	34.914 pCi/L	130197002	7/6/2021
Vogtle	DW - Gamma	Fe-59	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	DW - Gamma	Co-58	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	DW - Gamma	Co-60	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	DW - Gamma	Zn-65	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	DW - Gamma	Zr-95	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	DW - Gamma	I-131	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	DW - Gamma	Cs-134	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	Air Filters	Gross Beta	GIR	9/28/2021	0.01493 pCi/m3	131422002	9/28/2021
Vogtle	DW - Gamma	Cs-137	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	DW - Gamma	Ba-140	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	DW - Gamma	La-140	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	DW - Gamma	Be-7	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	Air Filters	Gross Beta	GIR	10/5/2021	0.01818 pCi/m3	131549002	10/5/2021
Vogtle	DW - Gamma	K-40	RAUC	7/6/2021	0 pCi/L	130197001	7/6/2021
Vogtle	Air Filters	Gross Beta	GIR	10/12/2021	0.00757 pCi/m3	131616002	10/12/2021
Vogtle	Charcoal Ct	I-131	WAY	7/6/2021	0 pCi/m3	130207001	7/6/2021
Vogtle	Charcoal Ct	I-131	GIR	7/6/2021	0 pCi/m3	130207002	7/6/2021
Vogtle	Charcoal Ct	I-131	HAN	7/6/2021	0 pCi/m3	130207007	7/6/2021
Vogtle	Charcoal Ct	I-131	RRD	7/6/2021	0 pCi/m3	130207006	7/6/2021
Vogtle	Charcoal Ct	I-131	SIM	7/6/2021	0 pCi/m3	130207003	7/6/2021
Vogtle	Charcoal Ct	I-131	MET	7/6/2021	0 pCi/m3	130207005	7/6/2021
Vogtle	Charcoal Ct	I-131	DIS	7/6/2021	0 pCi/m3	130207004	7/6/2021
Vogtle	Charcoal Ct	I-131	DIS	7/12/2021	0 pCi/m3	130291004	7/12/2021

Vogtle	Air Filters	Gross Beta	GIR	10/19/2021	0.01706 pCi/m3	131695002	10/19/2021
Vogtle	Charcoal Ct	I-131	SIM	7/12/2021	0 pCi/m3	130291003	7/12/2021
Vogtle	Air Filters	Gross Beta	GIR	10/24/2021	0.02124 pCi/m3	131756002	10/24/2021
Vogtle	Charcoal Ct	I-131	MET	7/12/2021	0 pCi/m3	130291005	7/12/2021
Vogtle	Charcoal Ct	I-131	RRD	7/12/2021	0 pCi/m3	130291006	7/12/2021
Vogtle	Charcoal Ct	I-131	HAN	7/12/2021	0 pCi/m3	130291007	7/12/2021
Vogtle	Charcoal Ct	I-131	WAY	7/12/2021	0 pCi/m3	130291001	7/12/2021
Vogtle	Charcoal Ct	I-131	GIR	7/12/2021	0 pCi/m3	130291002	7/12/2021
Vogtle	Milk Gamma	K-40	GIR	7/13/2021	1292.1 pCi/L	130284002	7/13/2021
Vogtle	Milk Gamma	I-131	GIR	7/13/2021	0 pCi/L	130284002	7/13/2021
Vogtle	Milk Gamma	Cs-134	GIR	7/13/2021	0 pCi/L	130284002	7/13/2021
Vogtle	Air Filters	Gross Beta	GIR	11/1/2021	0.009931 pCi/m3	131853002	11/1/2021
Vogtle	Milk Gamma	Ba-140	GIR	7/13/2021	0 pCi/L	130284002	7/13/2021
Vogtle	Milk Gamma	La-140	GIR	7/13/2021	0 pCi/L	130284002	7/13/2021
Vogtle	Milk Gamma	Be-7	GIR	7/13/2021	0 pCi/L	130284002	7/13/2021
Vogtle	Milk Gamma	Cs-137	GIR	7/13/2021	0 pCi/L	130284002	7/13/2021
Vogtle	Milk Gamma	Be-7	Milky Way	7/13/2021	0 pCi/L	130284001	7/13/2021
Vogtle	Milk Gamma	La-140	Milky Way	7/13/2021	0 pCi/L	130284001	7/13/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	7/13/2021	0 pCi/L	130284001	7/13/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	7/13/2021	0 pCi/L	130284001	7/13/2021
Vogtle	Air Filters	Gross Beta	GIR	11/9/2021	0.02375 pCi/m3	131941002	11/9/2021
Vogtle	Milk Gamma	I-131	Milky Way	7/13/2021	0 pCi/L	130284001	7/13/2021
Vogtle	Air Filters	Gross Beta	GIR	11/16/2021	0.0259 pCi/m3	131993002	11/16/2021
Vogtle	Air Filters	Gross Beta	GIR	11/22/2021	0.02061 pCi/m3	132036002	11/22/2021
Vogtle	Milk Gamma	K-40	Milky Way	7/13/2021	1343.9 pCi/L	130284001	7/13/2021
Vogtle	Air Filters	Gross Beta	GIR	11/29/2021	0.02401 pCi/m3	132085002	11/29/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	7/13/2021	0 pCi/L	130284001	7/13/2021
Vogtle	River Water	Be-7	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	K-40	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	Fe-59	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	Co-58	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	Co-60	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	Zn-65	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	Air Filters	Gross Beta	GIR	12/7/2021	0.04583 pCi/m3	132155002	12/7/2021
Vogtle	River Water	Zr-95	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	Air Filters	Gross Beta	GIR	12/13/2021	0.024 pCi/m3	132220002	12/13/2021
Vogtle	River Water	I-131	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	Cs-134	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	Cs-137	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	Ba-140	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	La-140	1495	7/13/2021	0 pCi/L	130285003	7/13/2021
Vogtle	River Water	Co-58	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	Co-60	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	Zn-65	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	Zr-95	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	I-131	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	Cs-134	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	Cs-137	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	Ba-140	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	Air Filters	Gross Beta	GIR	12/21/2021	0.01587 pCi/m3	132273002	12/21/2021
Vogtle	River Water	La-140	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	Be-7	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	K-40	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	Air Filters	Gross Beta	GIR	12/28/2021	0.02582 pCi/m3	132323002	12/28/2021
Vogtle	River Water	Fe-59	1504	7/13/2021	0 pCi/L	130285002	7/13/2021
Vogtle	River Water	K-40	1512	7/13/2021	139.81 pCi/L	130285001	7/13/2021
Vogtle	Air Filters	Gross Beta	HAN	1/5/2021	0.02463 pCi/m3	127933007	1/5/2021
Vogtle	River Water	Fe-59	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	Air Filters	Gross Beta	HAN	1/12/2021	0.02783 pCi/m3	128041007	1/12/2021
Vogtle	River Water	Co-58	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	Air Filters	Gross Beta	HAN	1/19/2021	0.0282 pCi/m3	128181007	1/19/2021
Vogtle	River Water	Co-60	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	River Water	Zn-65	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	River Water	Zr-95	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	River Water	I-131	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	Air Filters	Gross Beta	HAN	1/26/2021	0.02231 pCi/m3	128275007	1/26/2021
Vogtle	River Water	Cs-134	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	Air Filters	Gross Beta	HAN	2/1/2021	0.02002 pCi/m3	128356007	2/1/2021
Vogtle	River Water	Cs-137	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	River Water	Ba-140	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	Air Filters	Gross Beta	HAN	2/9/2021	0.01859 pCi/m3	128458007	2/9/2021
Vogtle	River Water	La-140	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	Air Filters	Gross Beta	HAN	2/15/2021	0.01539 pCi/m3	128534007	2/15/2021
Vogtle	River Water	Be-7	1512	7/13/2021	0 pCi/L	130285001	7/13/2021
Vogtle	Air Filters	Gross Beta	HAN	2/23/2021	0.02342 pCi/m3	128643007	2/23/2021
Vogtle	Charcoal Ct	I-131	DIS	7/19/2021	0 pCi/m3	130423004	7/19/2021
Vogtle	Air Filters	Gross Beta	HAN	3/2/2021	0.02448 pCi/m3	128782007	3/2/2021
Vogtle	Air Filters	Gross Beta	HAN	3/9/2021	0.02346 pCi/m3	128863007	3/9/2021
Vogtle	Charcoal Ct	I-131	MET	7/19/2021	0 pCi/m3	130423005	7/19/2021
Vogtle	Air Filters	Gross Beta	HAN	3/16/2021	0.02785 pCi/m3	128931007	3/16/2021
Vogtle	Charcoal Ct	I-131	SIM	7/19/2021	0 pCi/m3	130423003	7/19/2021
Vogtle	Air Filters	Gross Beta	HAN	3/23/2021	0.01712 pCi/m3	128999007	3/23/2021
Vogtle	Charcoal Ct	I-131	RRD	7/19/2021	0 pCi/m3	130423006	7/19/2021
Vogtle	Charcoal Ct	I-131	HAN	7/19/2021	0 pCi/m3	130423007	7/19/2021
Vogtle	Charcoal Ct	I-131	WAY	7/19/2021	0 pCi/m3	130423001	7/19/2021

Vogtle	Charcoal Ct	I-131	GIR	7/19/2021	0 pCi/m3	130423002	7/19/2021
Vogtle	Charcoal Ct	I-131	GIR	7/27/2021	0 pCi/m3	130528002	7/27/2021
Vogtle	Milk Gamma	Cs-137	GIR	7/27/2021	1.6063 pCi/L	130521002	7/27/2021
Vogtle	Milk Gamma	Cs-134	GIR	7/27/2021	0 pCi/L	130521002	7/27/2021
Vogtle	Milk Gamma	I-131	GIR	7/27/2021	0 pCi/L	130521002	7/27/2021
Vogtle	Milk Gamma	K-40	GIR	7/27/2021	1292.5 pCi/L	130521002	7/27/2021
Vogtle	Milk Gamma	Be-7	GIR	7/27/2021	0 pCi/L	130521002	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	3/30/2021	0.02069 pCi/m3	129044007	3/30/2021
Vogtle	Milk Gamma	La-140	GIR	7/27/2021	0 pCi/L	130521002	7/27/2021
Vogtle	Milk Gamma	Ba-140	GIR	7/27/2021	0 pCi/L	130521002	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	4/5/2021	0.02357 pCi/m3	129119007	4/5/2021
Vogtle	Charcoal Ct	I-131	WAY	7/27/2021	0 pCi/m3	130528001	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	4/13/2021	0.02895 pCi/m3	129199007	4/13/2021
Vogtle	Vegetation	Cs-137	WAY	7/27/2021	0 pCi/Kg	130529001	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	4/20/2021	0.02814 pCi/m3	129250007	4/20/2021
Vogtle	Air Filters	Gross Beta	HAN	4/27/2021	0.02458 pCi/m3	129295007	4/27/2021
Vogtle	Vegetation	Cs-134	WAY	7/27/2021	0 pCi/Kg	130529001	7/27/2021
Vogtle	Vegetation	I-131	WAY	7/27/2021	0 pCi/Kg	130529001	7/27/2021
Vogtle	Vegetation	K-40	WAY	7/27/2021	4522.1 pCi/Kg	130529001	7/27/2021
Vogtle	Vegetation	Be-7	WAY	7/27/2021	507.62 pCi/Kg	130529001	7/27/2021
Vogtle	Milk Gamma	La-140	Milky Way	7/27/2021	0 pCi/L	130521001	7/27/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	7/27/2021	0 pCi/L	130521001	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	5/3/2021	0.02563 pCi/m3	129366007	5/3/2021
Vogtle	Milk Gamma	I-131	Milky Way	7/27/2021	0 pCi/L	130521001	7/27/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	7/27/2021	0 pCi/L	130521001	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	5/11/2021	0.02284 pCi/m3	129445007	5/11/2021
Vogtle	Air Filters	Gross Beta	HAN	5/18/2021	0.02046 pCi/m3	129520007	5/18/2021
Vogtle	Milk Gamma	K-40	Milky Way	7/27/2021	1319.7 pCi/L	130521001	7/27/2021
Vogtle	Milk Gamma	Be-7	Milky Way	7/27/2021	0 pCi/L	130521001	7/27/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	7/27/2021	0 pCi/L	130521001	7/27/2021
Vogtle	Charcoal Ct	I-131	HAN	7/27/2021	0 pCi/m3	130528007	7/27/2021
Vogtle	Vegetation	K-40	HAN	7/27/2021	4727.9 pCi/Kg	130529003	7/27/2021
Vogtle	Vegetation	I-131	HAN	7/27/2021	0 pCi/Kg	130529003	7/27/2021
Vogtle	Vegetation	Be-7	HAN	7/27/2021	728.04 pCi/Kg	130529003	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	5/25/2021	0.02305 pCi/m3	129573007	5/25/2021
Vogtle	Vegetation	Cs-134	HAN	7/27/2021	0 pCi/Kg	130529003	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	6/1/2021	0.02607 pCi/m3	129657007	6/1/2021
Vogtle	Air Filters	Gross Beta	HAN	6/8/2021	0.01103 pCi/m3	129797007	6/8/2021
Vogtle	Vegetation	Cs-137	HAN	7/27/2021	0 pCi/Kg	130529003	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	6/15/2021	0.01475 pCi/m3	129928007	6/15/2021
Vogtle	Charcoal Ct	I-131	RRD	7/27/2021	0 pCi/m3	130528006	7/27/2021
Vogtle	Air Filters	Gross Beta	HAN	6/22/2021	0.02224 pCi/m3	130036007	6/22/2021
Vogtle	Charcoal Ct	I-131	SIM	7/27/2021	0 pCi/m3	130528003	7/27/2021
Vogtle	Vegetation	K-40	SIM	7/27/2021	4686.3 pCi/Kg	130529002	7/27/2021
Vogtle	Vegetation	I-131	SIM	7/27/2021	0 pCi/Kg	130529002	7/27/2021
Vogtle	Vegetation	Be-7	SIM	7/27/2021	578.28 pCi/Kg	130529002	7/27/2021
Vogtle	Vegetation	Cs-137	SIM	7/27/2021	0 pCi/Kg	130529002	7/27/2021
Vogtle	Vegetation	Cs-134	SIM	7/27/2021	0 pCi/Kg	130529002	7/27/2021
Vogtle	Charcoal Ct	I-131	MET	7/27/2021	0 pCi/m3	130528005	7/27/2021
Vogtle	Charcoal Ct	I-131	DIS	7/27/2021	0 pCi/m3	130528004	7/27/2021
Vogtle	DW - Gamma	I-131	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	DW - Gamma	Cs-134	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	6/29/2021	0.01493 pCi/m3	130145007	6/29/2021
Vogtle	DW - Gamma	Cs-137	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	7/6/2021	0.01297 pCi/m3	130206007	7/6/2021
Vogtle	DW - Gamma	Ba-140	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	7/12/2021	0.01774 pCi/m3	130290007	7/12/2021
Vogtle	DW - Gamma	La-140	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	7/19/2021	0.01445 pCi/m3	130422007	7/19/2021
Vogtle	DW - Gamma	Be-7	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	DW - Gamma	K-40	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	7/27/2021	0.01808 pCi/m3	130527007	7/27/2021
Vogtle	DW - Gamma	Fe-59	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	DW - Gamma	Co-58	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	DW - Gamma	Co-60	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	DW - Gamma	Zn-65	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	DW - Gamma	Zr-95	FPUR	8/3/2021	0 pCi/L	130592006	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	8/3/2021	0.03137 pCi/m3	130595007	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	8/10/2021	0.02153 pCi/m3	130719007	8/10/2021
Vogtle	Air Filters	Gross Beta	HAN	8/17/2021	0.01631 pCi/m3	130835007	8/17/2021
Vogtle	DW - Gamma	Fe-59	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	8/24/2021	0.01326 pCi/m3	130902007	8/24/2021
Vogtle	DW - Gamma	Co-58	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	DW - Gamma	Co-60	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	DW - Gamma	Zn-65	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	DW - Gamma	Zr-95	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	DW - Gamma	I-131	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	8/31/2021	0.02515 pCi/m3	131012007	8/31/2021
Vogtle	Air Filters	Gross Beta	HAN	9/7/2021	0.02579 pCi/m3	131125007	9/7/2021
Vogtle	DW - Gamma	Cs-134	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	DW - Gamma	Cs-137	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	9/14/2021	0.0309 pCi/m3	131254007	9/14/2021
Vogtle	DW - Gamma	Ba-140	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	9/21/2021	0.01857 pCi/m3	131332007	9/21/2021
Vogtle	DW - Gamma	La-140	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021

Vogtle	Air Filters	Gross Beta	HAN	9/28/2021	0.02487 pCi/m3	131422007	9/28/2021
Vogtle	DW - Gamma	Be-7	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	DW - Gamma	K-40	RPUR	8/3/2021	0 pCi/L	130592005	8/3/2021
Vogtle	DW - Gamma	Fe-59	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	DW - Gamma	Co-58	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	DW - Gamma	Co-60	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	DW - Gamma	Zn-65	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	DW - Gamma	Zr-95	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	DW - Gamma	I-131	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	10/5/2021	0.03877 pCi/m3	131549007	10/5/2021
Vogtle	DW - Gamma	Cs-134	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	10/12/2021	0.01632 pCi/m3	131616007	10/12/2021
Vogtle	DW - Gamma	Cs-137	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	10/19/2021	0.02503 pCi/m3	131695007	10/19/2021
Vogtle	DW - Gamma	Ba-140	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	DW - Gamma	La-140	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	DW - Gamma	Be-7	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	DW - Gamma	K-40	RAUC	8/3/2021	0 pCi/L	130592001	8/3/2021
Vogtle	DW - Gamma	Fe-59	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	10/24/2021	0.03966 pCi/m3	131756007	10/24/2021
Vogtle	DW - Gamma	Co-58	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	11/1/2021	0.01704 pCi/m3	131853007	11/1/2021
Vogtle	Air Filters	Gross Beta	HAN	11/9/2021	0.02393 pCi/m3	131941007	11/9/2021
Vogtle	DW - Gamma	Co-60	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	DW - Gamma	Zn-65	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	11/16/2021	0.02957 pCi/m3	131993007	11/16/2021
Vogtle	DW - Gamma	Zr-95	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	11/22/2021	0.02642 pCi/m3	132036007	11/22/2021
Vogtle	Air Filters	Gross Beta	HAN	11/29/2021	0.02898 pCi/m3	132085007	11/29/2021
Vogtle	DW - Gamma	I-131	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	DW - Gamma	Cs-134	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	DW - Gamma	Cs-137	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	DW - Gamma	Ba-140	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	DW - Gamma	La-140	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	DW - Gamma	Be-7	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	12/7/2021	0.0414 pCi/m3	132155007	12/7/2021
Vogtle	Air Filters	Gross Beta	HAN	12/13/2021	0.0208 pCi/m3	132220007	12/13/2021
Vogtle	DW - Gamma	K-40	FPOR	8/3/2021	0 pCi/L	130592004	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	12/21/2021	0.01718 pCi/m3	132273007	12/21/2021
Vogtle	DW - Gamma	K-40	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	Air Filters	Gross Beta	HAN	12/28/2021	0.02477 pCi/m3	132323007	12/28/2021
Vogtle	DW - Gamma	Fe-59	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	DW - Gamma	Co-58	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	DW - Gamma	Co-60	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	DW - Gamma	Zn-65	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	1/5/2021	0.01852 pCi/m3	127933005	1/5/2021
Vogtle	DW - Gamma	Zr-95	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	DW - Gamma	I-131	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	1/12/2021	0.02845 pCi/m3	128041005	1/12/2021
Vogtle	Air Filters	Gross Beta	MET	1/19/2021	0.02647 pCi/m3	128181005	1/19/2021
Vogtle	Air Filters	Gross Beta	MET	1/26/2021	0.02081 pCi/m3	128275005	1/26/2021
Vogtle	DW - Gamma	Cs-134	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	2/1/2021	0.0232 pCi/m3	128356005	2/1/2021
Vogtle	DW - Gamma	Cs-137	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	2/9/2021	0.01802 pCi/m3	128458005	2/9/2021
Vogtle	DW - Gamma	Ba-140	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	2/15/2021	0.009348 pCi/m3	128534005	2/15/2021
Vogtle	DW - Gamma	La-140	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	DW - Gamma	Be-7	FAUC	8/3/2021	0 pCi/L	130592002	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	2/23/2021	0.01816 pCi/m3	128643005	2/23/2021
Vogtle	Air Filters	Gross Beta	MET	3/2/2021	0.02534 pCi/m3	128782005	3/2/2021
Vogtle	Air Filters	Gross Beta	MET	3/9/2021	0.02347 pCi/m3	128863005	3/9/2021
Vogtle	DW - Gamma	Fe-59	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	3/16/2021	0.02402 pCi/m3	128931005	3/16/2021
Vogtle	DW - Gamma	Co-58	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	DW - Gamma	Co-60	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	3/23/2021	0.01888 pCi/m3	128999005	3/23/2021
Vogtle	DW - Gamma	Zn-65	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	DW - Gamma	Zr-95	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	DW - Gamma	I-131	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	DW - Gamma	Cs-134	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	3/30/2021	0.01592 pCi/m3	129044005	3/30/2021
Vogtle	Air Filters	Gross Beta	MET	4/5/2021	0.02362 pCi/m3	129119005	4/5/2021
Vogtle	DW - Gamma	Cs-137	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	4/13/2021	0.02791 pCi/m3	129199005	4/13/2021
Vogtle	DW - Gamma	Ba-140	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	DW - Gamma	La-140	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	4/20/2021	0.02819 pCi/m3	129250005	4/20/2021
Vogtle	DW - Gamma	Be-7	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	4/27/2021	0.02176 pCi/m3	129295005	4/27/2021
Vogtle	DW - Gamma	K-40	RPOR	8/3/2021	0 pCi/L	130592003	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	5/3/2021	0.02794 pCi/m3	129366005	5/3/2021
Vogtle	Charcoal Ct	I-131	GIR	8/3/2021	0 pCi/m3	130596002	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	5/11/2021	0.01912 pCi/m3	129445005	5/11/2021
Vogtle	Charcoal Ct	I-131	WAY	8/3/2021	0 pCi/m3	130596001	8/3/2021

Vogtle	Air Filters	Gross Beta	MET	5/18/2021	0.02076 pCi/m3	129520005	5/18/2021
Vogtle	Air Filters	Gross Beta	MET	5/25/2021	0.02924 pCi/m3	129573005	5/25/2021
Vogtle	Charcoal Ct	I-131	HAN	8/3/2021	0 pCi/m3	130596007	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	6/1/2021	0.02394 pCi/m3	129657005	6/1/2021
Vogtle	Charcoal Ct	I-131	RRD	8/3/2021	0 pCi/m3	130596006	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	6/8/2021	0.01243 pCi/m3	129797005	6/8/2021
Vogtle	Charcoal Ct	I-131	SIM	8/3/2021	0 pCi/m3	130596003	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	6/15/2021	0.0136 pCi/m3	129928005	6/15/2021
Vogtle	Charcoal Ct	I-131	MET	8/3/2021	0 pCi/m3	130596005	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	6/22/2021	0.02234 pCi/m3	130036005	6/22/2021
Vogtle	Charcoal Ct	I-131	DIS	8/3/2021	0 pCi/m3	130596004	8/3/2021
Vogtle	Air Filters	Gross Beta	MET	6/29/2021	0.01314 pCi/m3	130145005	6/29/2021
Vogtle	Milk Gamma	Cs-137	GIR	8/10/2021	1.4669 pCi/L	130706002	8/10/2021
Vogtle	Milk Gamma	I-131	GIR	8/10/2021	0 pCi/L	130706002	8/10/2021
Vogtle	Milk Gamma	K-40	GIR	8/10/2021	1331.3 pCi/L	130706002	8/10/2021
Vogtle	Milk Gamma	Be-7	GIR	8/10/2021	0 pCi/L	130706002	8/10/2021
Vogtle	Milk Gamma	La-140	GIR	8/10/2021	0 pCi/L	130706002	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	7/6/2021	0.01355 pCi/m3	130206005	7/6/2021
Vogtle	Milk Gamma	Ba-140	GIR	8/10/2021	0 pCi/L	130706002	8/10/2021
Vogtle	Milk Gamma	Cs-134	GIR	8/10/2021	0 pCi/L	130706002	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	7/12/2021	0.01137 pCi/m3	130290005	7/12/2021
Vogtle	Air Filters	Gross Beta	MET	7/19/2021	0.01465 pCi/m3	130422005	7/19/2021
Vogtle	Charcoal Ct	I-131	GIR	8/10/2021	0 pCi/m3	130722002	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	7/27/2021	0.01733 pCi/m3	130527005	7/27/2021
Vogtle	Charcoal Ct	I-131	WAY	8/10/2021	0 pCi/m3	130722001	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	8/3/2021	0.0302 pCi/m3	130595005	8/3/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	8/10/2021	1.4904 pCi/L	130706001	8/10/2021
Vogtle	Milk Gamma	I-131	Milky Way	8/10/2021	0 pCi/L	130706001	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	8/10/2021	0.01921 pCi/m3	130719005	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	8/17/2021	0.01511 pCi/m3	130835005	8/17/2021
Vogtle	Milk Gamma	K-40	Milky Way	8/10/2021	1290.1 pCi/L	130706001	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	8/24/2021	0.0135 pCi/m3	130902005	8/24/2021
Vogtle	Milk Gamma	Be-7	Milky Way	8/10/2021	0 pCi/L	130706001	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	8/31/2021	0.0261 pCi/m3	131012005	8/31/2021
Vogtle	Milk Gamma	La-140	Milky Way	8/10/2021	0 pCi/L	130706001	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	9/7/2021	0.02391 pCi/m3	131125005	9/7/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	8/10/2021	0 pCi/L	130706001	8/10/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	8/10/2021	0 pCi/L	130706001	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	9/14/2021	0.02592 pCi/m3	131254005	9/14/2021
Vogtle	Charcoal Ct	I-131	HAN	8/10/2021	0 pCi/m3	130722007	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	9/21/2021	0.01926 pCi/m3	131332005	9/21/2021
Vogtle	Charcoal Ct	I-131	RRD	8/10/2021	0 pCi/m3	130722006	8/10/2021
Vogtle	Charcoal Ct	I-131	SIM	8/10/2021	0 pCi/m3	130722003	8/10/2021
Vogtle	Charcoal Ct	I-131	MET	8/10/2021	0 pCi/m3	130722005	8/10/2021
Vogtle	Charcoal Ct	I-131	DIS	8/10/2021	0 pCi/m3	130722004	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	9/28/2021	0.0244 pCi/m3	131422005	9/28/2021
Vogtle	Air Filters	Gross Beta	MET	10/5/2021	0.03887 pCi/m3	131549005	10/5/2021
Vogtle	River Water	Fe-59	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	10/12/2021	0.01704 pCi/m3	131616005	10/12/2021
Vogtle	River Water	Co-58	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	10/19/2021	0.0308 pCi/m3	131695005	10/19/2021
Vogtle	River Water	Co-60	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	River Water	Zn-65	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	10/24/2021	0.04266 pCi/m3	131756005	10/24/2021
Vogtle	River Water	Zr-95	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	11/1/2021	0.01632 pCi/m3	131853005	11/1/2021
Vogtle	Air Filters	Gross Beta	MET	11/9/2021	0.02366 pCi/m3	131941005	11/9/2021
Vogtle	River Water	I-131	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	11/16/2021	0.02266 pCi/m3	131993005	11/16/2021
Vogtle	Air Filters	Gross Beta	MET	11/22/2021	0.02327 pCi/m3	132036005	11/22/2021
Vogtle	River Water	Cs-134	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	11/29/2021	0.02537 pCi/m3	132085005	11/29/2021
Vogtle	River Water	Cs-137	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	River Water	Ba-140	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	12/7/2021	0.04577 pCi/m3	132155005	12/7/2021
Vogtle	River Water	La-140	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	12/13/2021	0.02286 pCi/m3	132220005	12/13/2021
Vogtle	Air Filters	Gross Beta	MET	12/21/2021	0.01773 pCi/m3	132273005	12/21/2021
Vogtle	River Water	Be-7	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	River Water	K-40	1495	8/10/2021	0 pCi/L	130725003	8/10/2021
Vogtle	Air Filters	Gross Beta	MET	12/28/2021	0.02542 pCi/m3	132323005	12/28/2021
Vogtle	River Water	I-131	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Cs-134	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Cs-137	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Ba-140	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	La-140	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Be-7	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	K-40	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Fe-59	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Co-58	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Co-60	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Zn-65	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Zr-95	1504	8/10/2021	0 pCi/L	130725002	8/10/2021
Vogtle	River Water	Cs-134	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	Cs-137	1512	8/10/2021	0 pCi/L	130725001	8/10/2021

Vogtle	River Water	Ba-140	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	La-140	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	Be-7	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	K-40	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	Co-58	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	Fe-59	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	Co-60	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	Zn-65	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	Zr-95	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	River Water	I-131	1512	8/10/2021	0 pCi/L	130725001	8/10/2021
Vogtle	Charcoal Ct	I-131	GIR	8/17/2021	0 pCi/m3	130836002	8/17/2021
Vogtle	Charcoal Ct	I-131	WAY	8/17/2021	0 pCi/m3	130836001	8/17/2021
Vogtle	Charcoal Ct	I-131	HAN	8/17/2021	0 pCi/m3	130836007	8/17/2021
Vogtle	Charcoal Ct	I-131	RRD	8/17/2021	0 pCi/m3	130836006	8/17/2021
Vogtle	Charcoal Ct	I-131	SIM	8/17/2021	0 pCi/m3	130836003	8/17/2021
Vogtle	Charcoal Ct	I-131	MET	8/17/2021	0 pCi/m3	130836005	8/17/2021
Vogtle	Charcoal Ct	I-131	DIS	8/17/2021	0 pCi/m3	130836004	8/17/2021
Vogtle	Charcoal Ct	I-131	GIR	8/24/2021	0 pCi/m3	130903002	8/24/2021
Vogtle	Milk Gamma	K-40	GIR	8/24/2021	1289.8 pCi/L	130901002	8/24/2021
Vogtle	Milk Gamma	Be-7	GIR	8/24/2021	0 pCi/L	130901002	8/24/2021
Vogtle	Milk Gamma	I-131	GIR	8/24/2021	0 pCi/L	130901002	8/24/2021
Vogtle	Milk Gamma	Cs-134	GIR	8/24/2021	0 pCi/L	130901002	8/24/2021
Vogtle	Milk Gamma	Ba-140	GIR	8/24/2021	0 pCi/L	130901002	8/24/2021
Vogtle	Milk Gamma	La-140	GIR	8/24/2021	0 pCi/L	130901002	8/24/2021
Vogtle	Milk Gamma	Cs-137	GIR	8/24/2021	0 pCi/L	130901002	8/24/2021
Vogtle	Charcoal Ct	I-131	WAY	8/24/2021	0 pCi/m3	130903001	8/24/2021
Vogtle	Milk Gamma	I-131	Milky Way	8/24/2021	0 pCi/L	130901001	8/24/2021
Vogtle	Milk Gamma	K-40	Milky Way	8/24/2021	1267.4 pCi/L	130901001	8/24/2021
Vogtle	Milk Gamma	Be-7	Milky Way	8/24/2021	0 pCi/L	130901001	8/24/2021
Vogtle	Milk Gamma	La-140	Milky Way	8/24/2021	0 pCi/L	130901001	8/24/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	8/24/2021	0 pCi/L	130901001	8/24/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	8/24/2021	0 pCi/L	130901001	8/24/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	8/24/2021	0 pCi/L	130901001	8/24/2021
Vogtle	Charcoal Ct	I-131	HAN	8/24/2021	0 pCi/m3	130903007	8/24/2021
Vogtle	Charcoal Ct	I-131	RRD	8/24/2021	0 pCi/m3	130903006	8/24/2021
Vogtle	Charcoal Ct	I-131	SIM	8/24/2021	0 pCi/m3	130903003	8/24/2021
Vogtle	Charcoal Ct	I-131	MET	8/24/2021	0 pCi/m3	130903005	8/24/2021
Vogtle	Charcoal Ct	I-131	DIS	8/24/2021	0 pCi/m3	130903004	8/24/2021
Vogtle	Charcoal Ct	I-131	GIR	8/31/2021	0 pCi/m3	131015002	8/31/2021
Vogtle	Vegetation	Cs-134	WAY	8/31/2021	0 pCi/Kg	131019001	8/31/2021
Vogtle	Vegetation	I-131	WAY	8/31/2021	0 pCi/Kg	131019001	8/31/2021
Vogtle	Vegetation	Cs-137	WAY	8/31/2021	0 pCi/Kg	131019001	8/31/2021
Vogtle	Vegetation	Be-7	WAY	8/31/2021	904.64 pCi/Kg	131019001	8/31/2021
Vogtle	Vegetation	K-40	WAY	8/31/2021	4328.3 pCi/Kg	131019001	8/31/2021
Vogtle	Charcoal Ct	I-131	WAY	8/31/2021	0 pCi/m3	131015001	8/31/2021
Vogtle	Vegetation	Cs-134	HAN	8/31/2021	0 pCi/Kg	131019003	8/31/2021
Vogtle	Vegetation	I-131	HAN	8/31/2021	0 pCi/Kg	131019003	8/31/2021
Vogtle	Vegetation	K-40	HAN	8/31/2021	3265.6 pCi/Kg	131019003	8/31/2021
Vogtle	Vegetation	Be-7	HAN	8/31/2021	0 pCi/Kg	131019003	8/31/2021
Vogtle	Vegetation	Cs-137	HAN	8/31/2021	0 pCi/Kg	131019003	8/31/2021
Vogtle	Charcoal Ct	I-131	HAN	8/31/2021	0 pCi/m3	131015007	8/31/2021
Vogtle	Charcoal Ct	I-131	RRD	8/31/2021	0 pCi/m3	131015006	8/31/2021
Vogtle	Charcoal Ct	I-131	SIM	8/31/2021	0 pCi/m3	131015003	8/31/2021
Vogtle	Vegetation	Cs-137	SIM	8/31/2021	0 pCi/Kg	131019002	8/31/2021
Vogtle	Vegetation	Cs-134	SIM	8/31/2021	0 pCi/Kg	131019002	8/31/2021
Vogtle	Vegetation	I-131	SIM	8/31/2021	0 pCi/Kg	131019002	8/31/2021
Vogtle	Vegetation	K-40	SIM	8/31/2021	3588.9 pCi/Kg	131019002	8/31/2021
Vogtle	Vegetation	Be-7	SIM	8/31/2021	984.47 pCi/Kg	131019002	8/31/2021
Vogtle	Charcoal Ct	I-131	MET	8/31/2021	0 pCi/m3	131015005	8/31/2021
Vogtle	Charcoal Ct	I-131	DIS	8/31/2021	0 pCi/m3	131015004	8/31/2021
Vogtle	DW - Gamma	Cs-134	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	Cs-137	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	Ba-140	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	La-140	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	Be-7	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	K-40	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	Fe-59	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	Co-58	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	Co-60	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	Zn-65	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	Zr-95	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	I-131	RAUC	9/7/2021	0 pCi/L	131129001	9/7/2021
Vogtle	DW - Gamma	Cs-134	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	Cs-137	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	Ba-140	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	La-140	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	K-40	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	Be-7	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	Fe-59	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	Co-58	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	Co-60	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	Zn-65	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	Zr-95	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	I-131	FAUC	9/7/2021	0 pCi/L	131129002	9/7/2021
Vogtle	DW - Gamma	Fe-59	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021

Vogtle	DW - Gamma	Co-58	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	Co-60	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	Zn-65	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	Zr-95	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	I-131	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	Cs-134	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	Cs-137	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	Ba-140	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	La-140	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	Be-7	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	K-40	FPUR	9/7/2021	0 pCi/L	131129006	9/7/2021
Vogtle	DW - Gamma	Fe-59	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	Co-58	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	Co-60	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	Zn-65	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	Zr-95	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	I-131	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	Cs-134	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	Cs-137	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	Ba-140	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	La-140	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	Be-7	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	K-40	RPUR	9/7/2021	0 pCi/L	131129005	9/7/2021
Vogtle	DW - Gamma	Cs-137	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	Ba-140	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	La-140	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	Be-7	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	K-40	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	Fe-59	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	Co-58	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	Co-60	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	Zn-65	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	Zr-95	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	I-131	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	Cs-134	FPOR	9/7/2021	0 pCi/L	131129004	9/7/2021
Vogtle	DW - Gamma	Co-60	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	Zn-65	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	Zr-95	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	I-131	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	Cs-134	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	Cs-137	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	Ba-140	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	La-140	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	Be-7	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	K-40	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	Fe-59	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	DW - Gamma	Co-58	RPOR	9/7/2021	0 pCi/L	131129003	9/7/2021
Vogtle	Charcoal Ct	I-131	GIR	9/7/2021	0 pCi/m3	131126002	9/7/2021
Vogtle	Charcoal Ct	I-131	WAY	9/7/2021	0 pCi/m3	131126001	9/7/2021
Vogtle	Charcoal Ct	I-131	HAN	9/7/2021	0 pCi/m3	131126007	9/7/2021
Vogtle	Charcoal Ct	I-131	RRD	9/7/2021	0 pCi/m3	131126006	9/7/2021
Vogtle	Charcoal Ct	I-131	SIM	9/7/2021	0 pCi/m3	131126003	9/7/2021
Vogtle	Charcoal Ct	I-131	MET	9/7/2021	0 pCi/m3	131126005	9/7/2021
Vogtle	Charcoal Ct	I-131	DIS	9/7/2021	0 pCi/m3	131126004	9/7/2021
Vogtle	Charcoal Ct	I-131	GIR	9/14/2021	0 pCi/m3	131255002	9/14/2021
Vogtle	Milk Gamma	Cs-134	GIR	9/14/2021	0 pCi/L	131225002	9/14/2021
Vogtle	Milk Gamma	Ba-140	GIR	9/14/2021	0 pCi/L	131225002	9/14/2021
Vogtle	Milk Gamma	La-140	GIR	9/14/2021	0 pCi/L	131225002	9/14/2021
Vogtle	Milk Gamma	Be-7	GIR	9/14/2021	0 pCi/L	131225002	9/14/2021
Vogtle	Milk Gamma	K-40	GIR	9/14/2021	1335.1 pCi/L	131225002	9/14/2021
Vogtle	Milk Gamma	I-131	GIR	9/14/2021	0 pCi/L	131225002	9/14/2021
Vogtle	Milk Gamma	Cs-137	GIR	9/14/2021	0 pCi/L	131225002	9/14/2021
Vogtle	Charcoal Ct	I-131	WAY	9/14/2021	0 pCi/m3	131255001	9/14/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	9/14/2021	0 pCi/L	131225001	9/14/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	9/14/2021	0 pCi/L	131225001	9/14/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	9/14/2021	0 pCi/L	131225001	9/14/2021
Vogtle	Milk Gamma	La-140	Milky Way	9/14/2021	0 pCi/L	131225001	9/14/2021
Vogtle	Milk Gamma	Be-7	Milky Way	9/14/2021	0 pCi/L	131225001	9/14/2021
Vogtle	Milk Gamma	K-40	Milky Way	9/14/2021	1248.2 pCi/L	131225001	9/14/2021
Vogtle	Milk Gamma	I-131	Milky Way	9/14/2021	0 pCi/L	131225001	9/14/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	1/5/2021	0 pCi/L	127928001	1/5/2021
Vogtle	DW - Beta	Gross Beta	RAUC	1/5/2021	2.181 pCi/L	127928001	1/5/2021
Vogtle	Water H-3	Tritium	RAUC	1/5/2021	182 pCi/L	128365001	1/5/2021
Vogtle	Charcoal Ct	I-131	HAN	9/14/2021	0 pCi/m3	131255007	9/14/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	2/2/2021	0 pCi/L	128358001	2/2/2021
Vogtle	DW - Beta	Gross Beta	RAUC	2/2/2021	1.86 pCi/L	128358001	2/2/2021
Vogtle	Charcoal Ct	I-131	RRD	9/14/2021	0 pCi/m3	131255006	9/14/2021
Vogtle	Charcoal Ct	I-131	SIM	9/14/2021	0 pCi/m3	131255003	9/14/2021
Vogtle	Charcoal Ct	I-131	MET	9/14/2021	0 pCi/m3	131255005	9/14/2021
Vogtle	Charcoal Ct	I-131	DIS	9/14/2021	0 pCi/m3	131255004	9/14/2021
Vogtle	River Water	Co-58	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	Fe-59	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	Co-60	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	Zn-65	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	Zr-95	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021

Vogtle	River Water	I-131	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	Cs-134	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	Cs-137	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	Ba-140	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	La-140	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	Be-7	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	K-40	149.5	9/14/2021	0 pCi/L	131226003	9/14/2021
Vogtle	River Water	Fe-59	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	Co-58	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	Co-60	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	Zn-65	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	Zr-95	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	La-140	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	Be-7	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	K-40	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	I-131	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	DW - Beta	Gross Beta	RAUC	3/2/2021	2.774 pCi/L	128780001	3/2/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	3/2/2021	0 pCi/L	128780001	3/2/2021
Vogtle	DW - Beta	Gross Beta	RAUC	4/6/2021	1.047 pCi/L	129105001	4/6/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	4/6/2021	0 pCi/L	129105001	4/6/2021
Vogtle	River Water	Cs-134	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	Cs-137	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	Ba-140	150.4	9/14/2021	0 pCi/L	131226002	9/14/2021
Vogtle	River Water	Co-60	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	Zn-65	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	Be-7	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	K-40	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	Fe-59	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	Zr-95	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	I-131	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	Cs-134	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	Water H-3	Tritium	RAUC	4/6/2021	158 pCi/L	129220001	4/6/2021
Vogtle	River Water	Cs-137	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	Ba-140	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	La-140	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	River Water	Co-58	151.2	9/14/2021	0 pCi/L	131226001	9/14/2021
Vogtle	Charcoal Ct	I-131	GIR	9/21/2021	0 pCi/m3	131333002	9/21/2021
Vogtle	Charcoal Ct	I-131	WAY	9/21/2021	0 pCi/m3	131333001	9/21/2021
Vogtle	Charcoal Ct	I-131	HAN	9/21/2021	0 pCi/m3	131333007	9/21/2021
Vogtle	Charcoal Ct	I-131	RRD	9/21/2021	0 pCi/m3	131333006	9/21/2021
Vogtle	Charcoal Ct	I-131	SIM	9/21/2021	0 pCi/m3	131333003	9/21/2021
Vogtle	Charcoal Ct	I-131	MET	9/21/2021	0 pCi/m3	131333005	9/21/2021
Vogtle	Charcoal Ct	I-131	DIS	9/21/2021	0 pCi/m3	131333004	9/21/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	9/28/2021	0 pCi/L	131466001	9/28/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	9/28/2021	0 pCi/L	131466001	9/28/2021
Vogtle	Milk Gamma	La-140	Milky Way	9/28/2021	0 pCi/L	131466001	9/28/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	5/4/2021	0 pCi/L	129363001	5/4/2021
Vogtle	DW - Beta	Gross Beta	RAUC	5/4/2021	2.561 pCi/L	129363001	5/4/2021
Vogtle	Milk Gamma	Be-7	Milky Way	9/28/2021	0 pCi/L	131466001	9/28/2021
Vogtle	Milk Gamma	K-40	Milky Way	9/28/2021	1265.1 pCi/L	131466001	9/28/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	9/28/2021	0 pCi/L	131466001	9/28/2021
Vogtle	Milk Gamma	I-131	Milky Way	9/28/2021	0 pCi/L	131466001	9/28/2021
Vogtle	Milk Gamma	K-40	GIR	9/28/2021	1334 pCi/L	131466002	9/28/2021
Vogtle	Milk Gamma	Be-7	GIR	9/28/2021	0 pCi/L	131466002	9/28/2021
Vogtle	Milk Gamma	La-140	GIR	9/28/2021	0 pCi/L	131466002	9/28/2021
Vogtle	Milk Gamma	Ba-140	GIR	9/28/2021	0 pCi/L	131466002	9/28/2021
Vogtle	Milk Gamma	Cs-134	GIR	9/28/2021	0 pCi/L	131466002	9/28/2021
Vogtle	Milk Gamma	I-131	GIR	9/28/2021	0 pCi/L	131466002	9/28/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	6/1/2021	0 pCi/L	129655001	6/1/2021
Vogtle	DW - Beta	Gross Beta	RAUC	6/1/2021	2.591 pCi/L	129655001	6/1/2021
Vogtle	Milk Gamma	Cs-137	GIR	9/28/2021	0 pCi/L	131466002	9/28/2021
Vogtle	Air Qtr Comp	I-131	GIR	9/28/2021	0 pCi/m3	131790002	9/28/2021
Vogtle	Charcoal Ct	I-131	GIR	9/28/2021	0 pCi/m3	131423002	9/28/2021
Vogtle	Air Qtr Comp	Be-7	GIR	9/28/2021	0.09732 pCi/m3	131790002	9/28/2021
Vogtle	Air Qtr Comp	Cs-137	GIR	9/28/2021	0 pCi/m3	131790002	9/28/2021
Vogtle	Air Qtr Comp	Cs-134	GIR	9/28/2021	0 pCi/m3	131790002	9/28/2021
Vogtle	Air Qtr Comp	Be-7	WAY	9/28/2021	0.09105 pCi/m3	131790001	9/28/2021
Vogtle	Air Qtr Comp	Cs-137	WAY	9/28/2021	0 pCi/m3	131790001	9/28/2021
Vogtle	Air Qtr Comp	Cs-134	WAY	9/28/2021	0 pCi/m3	131790001	9/28/2021
Vogtle	Air Qtr Comp	I-131	WAY	9/28/2021	0 pCi/m3	131790001	9/28/2021
Vogtle	Charcoal Ct	I-131	WAY	9/28/2021	0 pCi/m3	131423001	9/28/2021
Vogtle	Vegetation	Cs-134	WAY	9/28/2021	0 pCi/Kg	131424001	9/28/2021
Vogtle	Vegetation	Cs-137	WAY	9/28/2021	0 pCi/Kg	131424001	9/28/2021
Vogtle	Vegetation	Be-7	WAY	9/28/2021	2946 pCi/Kg	131424001	9/28/2021
Vogtle	Vegetation	K-40	WAY	9/28/2021	3408.1 pCi/Kg	131424001	9/28/2021
Vogtle	Vegetation	I-131	WAY	9/28/2021	0 pCi/Kg	131424001	9/28/2021
Vogtle	Charcoal Ct	I-131	HAN	9/28/2021	0 pCi/m3	131423007	9/28/2021
Vogtle	Air Qtr Comp	Be-7	HAN	9/28/2021	0.05755 pCi/m3	131790007	9/28/2021
Vogtle	Water H-3	Tritium	RAUC	7/6/2021	90.6 pCi/L	130438001	7/6/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	7/6/2021	0 pCi/L	130196001	7/6/2021
Vogtle	DW - Beta	Gross Beta	RAUC	7/6/2021	3.145 pCi/L	130196001	7/6/2021
Vogtle	Air Qtr Comp	Cs-137	HAN	9/28/2021	0 pCi/m3	131790007	9/28/2021
Vogtle	Air Qtr Comp	Cs-134	HAN	9/28/2021	0 pCi/m3	131790007	9/28/2021
Vogtle	Air Qtr Comp	I-131	HAN	9/28/2021	0 pCi/m3	131790007	9/28/2021
Vogtle	Vegetation	I-131	HAN	9/28/2021	0 pCi/Kg	131424003	9/28/2021

Vogtle	Vegetation	Cs-134	HAN	9/28/2021	0 pCi/Kg	131424003	9/28/2021
Vogtle	Vegetation	Be-7	HAN	9/28/2021	660.9 pCi/Kg	131424003	9/28/2021
Vogtle	Vegetation	K-40	HAN	9/28/2021	4728.1 pCi/Kg	131424003	9/28/2021
Vogtle	Vegetation	Cs-137	HAN	9/28/2021	0 pCi/Kg	131424003	9/28/2021
Vogtle	Charcoal Ct	I-131	RRD	9/28/2021	0 pCi/m3	131423006	9/28/2021
Vogtle	Air Qtr Comp	Be-7	RRD	9/28/2021	0.07995 pCi/m3	131790006	9/28/2021
Vogtle	Air Qtr Comp	Cs-137	RRD	9/28/2021	0 pCi/m3	131790006	9/28/2021
Vogtle	Air Qtr Comp	Cs-134	RRD	9/28/2021	0 pCi/m3	131790006	9/28/2021
Vogtle	Air Qtr Comp	I-131	RRD	9/28/2021	0 pCi/m3	131790006	9/28/2021
Vogtle	Charcoal Ct	I-131	SIM	9/28/2021	0 pCi/m3	131423003	9/28/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	8/3/2021	0 pCi/L	130593001	8/3/2021
Vogtle	DW - Beta	Gross Beta	RAUC	8/3/2021	5.699 pCi/L	130593001	8/3/2021
Vogtle	Air Qtr Comp	Be-7	SIM	9/28/2021	0.05786 pCi/m3	131790003	9/28/2021
Vogtle	DW - Beta	Gross Beta	RAUC	9/7/2021	1.951 pCi/L	131123001	9/7/2021
Vogtle	Air Qtr Comp	Cs-137	SIM	9/28/2021	0 pCi/m3	131790003	9/28/2021
Vogtle	Air Qtr Comp	Cs-134	SIM	9/28/2021	0 pCi/m3	131790003	9/28/2021
Vogtle	Air Qtr Comp	I-131	SIM	9/28/2021	0 pCi/m3	131790003	9/28/2021
Vogtle	Vegetation	Cs-137	SIM	9/28/2021	0 pCi/Kg	131424002	9/28/2021
Vogtle	Vegetation	I-131	SIM	9/28/2021	0 pCi/Kg	131424002	9/28/2021
Vogtle	Vegetation	Cs-134	SIM	9/28/2021	0 pCi/Kg	131424002	9/28/2021
Vogtle	Vegetation	Be-7	SIM	9/28/2021	1192.4 pCi/Kg	131424002	9/28/2021
Vogtle	Vegetation	K-40	SIM	9/28/2021	4910.3 pCi/Kg	131424002	9/28/2021
Vogtle	Charcoal Ct	I-131	MET	9/28/2021	0 pCi/m3	131423005	9/28/2021
Vogtle	Air Qtr Comp	Be-7	MET	9/28/2021	0.08555 pCi/m3	131790005	9/28/2021
Vogtle	Air Qtr Comp	Cs-137	MET	9/28/2021	0 pCi/m3	131790005	9/28/2021
Vogtle	Air Qtr Comp	Cs-134	MET	9/28/2021	0 pCi/m3	131790005	9/28/2021
Vogtle	Air Qtr Comp	I-131	MET	9/28/2021	0 pCi/m3	131790005	9/28/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	9/7/2021	0 pCi/L	131123001	9/7/2021
Vogtle	Air Qtr Comp	I-131	DIS	9/28/2021	0 pCi/m3	131790004	9/28/2021
Vogtle	Air Qtr Comp	Cs-134	DIS	9/28/2021	0 pCi/m3	131790004	9/28/2021
Vogtle	Air Qtr Comp	Be-7	DIS	9/28/2021	0.08937 pCi/m3	131790004	9/28/2021
Vogtle	Charcoal Ct	I-131	DIS	9/28/2021	0 pCi/m3	131423004	9/28/2021
Vogtle	Air Qtr Comp	Cs-137	DIS	9/28/2021	0 pCi/m3	131790004	9/28/2021
Vogtle	DW - Gamma	I-131	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	Cs-134	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	Cs-137	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	Ba-140	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	La-140	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	Be-7	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	10/5/2021	0 pCi/L	131519001	10/5/2021
Vogtle	DW - Beta	Gross Beta	RAUC	10/5/2021	4.744 pCi/L	131519001	10/5/2021
Vogtle	DW - Gamma	K-40	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	Water H-3	Tritium	RAUC	10/5/2021	279 pCi/L	131707001	10/5/2021
Vogtle	DW - Beta	Gross Beta	RAUC	11/2/2021	1.877 pCi/L	131850001	11/2/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	11/2/2021	0 pCi/L	131850001	11/2/2021
Vogtle	DW - Gamma	Fe-59	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	Co-58	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	Co-60	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	Zn-65	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	Zr-95	FPUR	10/5/2021	0 pCi/L	131520006	10/5/2021
Vogtle	DW - Gamma	Zn-65	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	Zr-95	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	I-131	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	Cs-134	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	Cs-137	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	Ba-140	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	La-140	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	Be-7	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	K-40	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	Fe-59	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	Co-58	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	Co-60	RPUR	10/5/2021	0 pCi/L	131520005	10/5/2021
Vogtle	DW - Gamma	Co-58	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	Co-60	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	Zn-65	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	Zr-95	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Beta	Gross Alpha	RAUC	12/8/2021	0 pCi/L	132149001	12/8/2021
Vogtle	DW - Beta	Gross Beta	RAUC	12/8/2021	4.294 pCi/L	132149001	12/8/2021
Vogtle	DW - Gamma	I-131	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	Cs-134	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	Cs-137	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	Ba-140	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	La-140	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	Be-7	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	K-40	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	Fe-59	FPOR	10/5/2021	0 pCi/L	131520004	10/5/2021
Vogtle	DW - Gamma	Fe-59	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	Co-58	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	Co-60	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	Zn-65	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	Zr-95	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	I-131	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	Cs-134	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	1/5/2021	0 pCi/L	127928003	1/5/2021
Vogtle	DW - Beta	Gross Beta	RPOR	1/5/2021	1.755 pCi/L	127928003	1/5/2021

Vogtle	Water H-3	Tritium	RPOR	1/5/2021	197 pCi/L	128365003	1/5/2021
Vogtle	DW - Beta	Gross Beta	RPOR	2/2/2021	2.318 pCi/L	128358003	2/2/2021
Vogtle	DW - Gamma	Cs-137	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	Ba-140	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	La-140	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	Be-7	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	K-40	RPOR	10/5/2021	0 pCi/L	131520003	10/5/2021
Vogtle	DW - Gamma	Cs-137	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	Ba-140	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	La-140	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	Be-7	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	K-40	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	Fe-59	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	Co-58	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	Co-60	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	2/2/2021	0 pCi/L	128358003	2/2/2021
Vogtle	DW - Gamma	Zn-65	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	Zr-95	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	I-131	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	Cs-134	RAUC	10/5/2021	0 pCi/L	131520001	10/5/2021
Vogtle	DW - Gamma	K-40	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Gamma	Fe-59	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Gamma	Co-58	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Gamma	Co-60	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Gamma	Zn-65	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Gamma	Zr-95	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	3/1/2021	0 pCi/L	128780003	3/1/2021
Vogtle	DW - Beta	Gross Beta	RPOR	3/1/2021	3.212 pCi/L	128780003	3/1/2021
Vogtle	DW - Gamma	I-131	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	Water H-3	Tritium	RPOR	4/6/2021	167 pCi/L	129220003	4/6/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	4/6/2021	0 pCi/L	129105003	4/6/2021
Vogtle	DW - Beta	Gross Beta	RPOR	4/6/2021	3.527 pCi/L	129105003	4/6/2021
Vogtle	DW - Gamma	Cs-134	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Gamma	Cs-137	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Gamma	Ba-140	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Gamma	La-140	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	DW - Gamma	Be-7	FAUC	10/5/2021	0 pCi/L	131520002	10/5/2021
Vogtle	Charcoal Ct	I-131	GIR	10/5/2021	0 pCi/m3	131550002	10/5/2021
Vogtle	Charcoal Ct	I-131	WAY	10/5/2021	0 pCi/m3	131550001	10/5/2021
Vogtle	Charcoal Ct	I-131	HAN	10/5/2021	0 pCi/m3	131550007	10/5/2021
Vogtle	Charcoal Ct	I-131	RRD	10/5/2021	0 pCi/m3	131550006	10/5/2021
Vogtle	Charcoal Ct	I-131	SIM	10/5/2021	0 pCi/m3	131550003	10/5/2021
Vogtle	Charcoal Ct	I-131	MET	10/5/2021	0 pCi/m3	131550005	10/5/2021
Vogtle	Charcoal Ct	I-131	DIS	10/5/2021	0 pCi/m3	131550004	10/5/2021
Vogtle	Charcoal Ct	I-131	GIR	10/12/2021	0 pCi/m3	131617002	10/12/2021
Vogtle	Milk Gamma	K-40	GIR	10/12/2021	1328.6 pCi/L	131614002	10/12/2021
Vogtle	Milk Gamma	Be-7	GIR	10/12/2021	0 pCi/L	131614002	10/12/2021
Vogtle	Milk Gamma	La-140	GIR	10/12/2021	0 pCi/L	131614002	10/12/2021
Vogtle	Milk Gamma	Ba-140	GIR	10/12/2021	0 pCi/L	131614002	10/12/2021
Vogtle	Milk Gamma	Cs-134	GIR	10/12/2021	0 pCi/L	131614002	10/12/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	5/4/2021	0 pCi/L	129363003	5/4/2021
Vogtle	DW - Beta	Gross Beta	RPOR	5/4/2021	0.7595 pCi/L	129363003	5/4/2021
Vogtle	Milk Gamma	I-131	GIR	10/12/2021	0 pCi/L	131614002	10/12/2021
Vogtle	Milk Gamma	Cs-137	GIR	10/12/2021	0 pCi/L	131614002	10/12/2021
Vogtle	Charcoal Ct	I-131	WAY	10/12/2021	0 pCi/m3	131617001	10/12/2021
Vogtle	Milk Gamma	I-131	Milky Way	10/12/2021	0 pCi/L	131614001	10/12/2021
Vogtle	Milk Gamma	K-40	Milky Way	10/12/2021	1303 pCi/L	131614001	10/12/2021
Vogtle	Milk Gamma	Be-7	Milky Way	10/12/2021	0 pCi/L	131614001	10/12/2021
Vogtle	Milk Gamma	La-140	Milky Way	10/12/2021	0 pCi/L	131614001	10/12/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	10/12/2021	0 pCi/L	131614001	10/12/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	10/12/2021	0 pCi/L	131614001	10/12/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	10/12/2021	0 pCi/L	131614001	10/12/2021
Vogtle	Charcoal Ct	I-131	HAN	10/12/2021	0 pCi/m3	131617007	10/12/2021
Vogtle	Charcoal Ct	I-131	RRD	10/12/2021	0 pCi/m3	131617006	10/12/2021
Vogtle	Charcoal Ct	I-131	SIM	10/12/2021	0 pCi/m3	131617003	10/12/2021
Vogtle	Charcoal Ct	I-131	MET	10/12/2021	0 pCi/m3	131617005	10/12/2021
Vogtle	Charcoal Ct	I-131	DIS	10/12/2021	0 pCi/m3	131617004	10/12/2021
Vogtle	Charcoal Ct	I-131	GIR	10/19/2021	0 pCi/m3	131696002	10/19/2021
Vogtle	Charcoal Ct	I-131	WAY	10/19/2021	0 pCi/m3	131696001	10/19/2021
Vogtle	Charcoal Ct	I-131	HAN	10/19/2021	0 pCi/m3	131696007	10/19/2021
Vogtle	Charcoal Ct	I-131	RRD	10/19/2021	0 pCi/m3	131696006	10/19/2021
Vogtle	Charcoal Ct	I-131	SIM	10/19/2021	0 pCi/m3	131696003	10/19/2021
Vogtle	Charcoal Ct	I-131	MET	10/19/2021	0 pCi/m3	131696005	10/19/2021
Vogtle	Charcoal Ct	I-131	DIS	10/19/2021	0 pCi/m3	131696004	10/19/2021
Vogtle	River Water	Cs-134	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	Cs-137	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	6/1/2021	0 pCi/L	129655003	6/1/2021
Vogtle	DW - Beta	Gross Beta	RPOR	6/1/2021	7.271 pCi/L	129655003	6/1/2021
Vogtle	DW - Beta	Gross Beta	RPOR	7/5/2021	2.38 pCi/L	130196003	7/5/2021
Vogtle	Water H-3	Tritium	RPOR	7/5/2021	262 pCi/L	130438003	7/5/2021
Vogtle	River Water	Ba-140	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	La-140	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	Be-7	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	K-40	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	Fe-59	1495	10/19/2021	0 pCi/L	131693003	10/19/2021

Vogtle	River Water	Co-58	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	Co-60	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	Zn-65	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	Zr-95	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	I-131	1495	10/19/2021	0 pCi/L	131693003	10/19/2021
Vogtle	River Water	K-40	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	7/5/2021	0 pCi/L	130196003	7/5/2021
Vogtle	River Water	Fe-59	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	Co-58	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	Co-60	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	Zn-65	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	Zr-95	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	I-131	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	Cs-134	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	Cs-137	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	Ba-140	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	La-140	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	River Water	Be-7	1504	10/19/2021	0 pCi/L	131693002	10/19/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	8/3/2021	0 pCi/L	130593003	8/3/2021
Vogtle	DW - Beta	Gross Beta	RPOR	8/3/2021	4.676 pCi/L	130593003	8/3/2021
Vogtle	River Water	Co-60	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	Zn-65	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	Zr-95	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	I-131	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	Cs-134	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	Cs-137	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	Ba-140	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	La-140	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	Be-7	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	K-40	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	Fe-59	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	River Water	Co-58	1512	10/19/2021	0 pCi/L	131693001	10/19/2021
Vogtle	Charcoal Ct	I-131	GIR	10/24/2021	0 pCi/m3	131757002	10/24/2021
Vogtle	Charcoal Ct	I-131	WAY	10/24/2021	0 pCi/m3	131757001	10/24/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	9/7/2021	0 pCi/L	131123003	9/7/2021
Vogtle	DW - Beta	Gross Beta	RPOR	9/7/2021	4.254 pCi/L	131123003	9/7/2021
Vogtle	DW - Beta	Gross Beta	RPOR	10/5/2021	5.09 pCi/L	131519003	10/5/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	10/5/2021	0 pCi/L	131519003	10/5/2021
Vogtle	Vegetation	I-131	WAY	10/24/2021	0 pCi/Kg	131739001	10/24/2021
Vogtle	Vegetation	Cs-134	WAY	10/24/2021	0 pCi/Kg	131739001	10/24/2021
Vogtle	Vegetation	Be-7	WAY	10/24/2021	1539.6 pCi/Kg	131739001	10/24/2021
Vogtle	Vegetation	Cs-137	WAY	10/24/2021	0 pCi/Kg	131739001	10/24/2021
Vogtle	Vegetation	K-40	WAY	10/24/2021	5519.5 pCi/Kg	131739001	10/24/2021
Vogtle	Vegetation	K-40	HAN	10/24/2021	6162.4 pCi/Kg	131739003	10/24/2021
Vogtle	Vegetation	Be-7	HAN	10/24/2021	1587 pCi/Kg	131739003	10/24/2021
Vogtle	Vegetation	Cs-134	HAN	10/24/2021	0 pCi/Kg	131739003	10/24/2021
Vogtle	Vegetation	I-131	HAN	10/24/2021	0 pCi/Kg	131739003	10/24/2021
Vogtle	Vegetation	Cs-137	HAN	10/24/2021	0 pCi/Kg	131739003	10/24/2021
Vogtle	Charcoal Ct	I-131	HAN	10/24/2021	0 pCi/m3	131757007	10/24/2021
Vogtle	Charcoal Ct	I-131	RRD	10/24/2021	0 pCi/m3	131757006	10/24/2021
Vogtle	Charcoal Ct	I-131	SIM	10/24/2021	0 pCi/m3	131757003	10/24/2021
Vogtle	Vegetation	Cs-137	SIM	10/24/2021	0 pCi/Kg	131739002	10/24/2021
Vogtle	Water H-3	Tritium	RPOR	10/5/2021	405 pCi/L	131707003	10/5/2021
Vogtle	Vegetation	Cs-134	SIM	10/24/2021	0 pCi/Kg	131739002	10/24/2021
Vogtle	Vegetation	I-131	SIM	10/24/2021	0 pCi/Kg	131739002	10/24/2021
Vogtle	Vegetation	Be-7	SIM	10/24/2021	1284.9 pCi/Kg	131739002	10/24/2021
Vogtle	Vegetation	K-40	SIM	10/24/2021	6146.1 pCi/Kg	131739002	10/24/2021
Vogtle	Charcoal Ct	I-131	DIS	10/24/2021	0 pCi/m3	131757004	10/24/2021
Vogtle	Charcoal Ct	I-131	MET	10/24/2021	0 pCi/m3	131757005	10/24/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	10/25/2021	0 pCi/L	131876001	10/25/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	10/25/2021	0 pCi/L	131876001	10/25/2021
Vogtle	Milk Gamma	I-131	Milky Way	10/25/2021	0 pCi/L	131876001	10/25/2021
Vogtle	Milk Gamma	K-40	Milky Way	10/25/2021	1476.2 pCi/L	131876001	10/25/2021
Vogtle	Milk Gamma	Be-7	Milky Way	10/25/2021	0 pCi/L	131876001	10/25/2021
Vogtle	Milk Gamma	La-140	Milky Way	10/25/2021	0 pCi/L	131876001	10/25/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	10/25/2021	0 pCi/L	131876001	10/25/2021
Vogtle	Milk Gamma	Ba-140	GIR	10/25/2021	0 pCi/L	131876002	10/25/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	11/2/2021	0 pCi/L	131850003	11/2/2021
Vogtle	DW - Beta	Gross Beta	RPOR	11/2/2021	13.89 pCi/L	131850003	11/2/2021
Vogtle	DW - Beta	Gross Alpha	RPOR	12/8/2021	0 pCi/L	132149003	12/8/2021
Vogtle	DW - Beta	Gross Beta	RPOR	12/8/2021	3.014 pCi/L	132149003	12/8/2021
Vogtle	Milk Gamma	La-140	GIR	10/25/2021	0 pCi/L	131876002	10/25/2021
Vogtle	Milk Gamma	Be-7	GIR	10/25/2021	0 pCi/L	131876002	10/25/2021
Vogtle	Milk Gamma	K-40	GIR	10/25/2021	1335 pCi/L	131876002	10/25/2021
Vogtle	Milk Gamma	I-131	GIR	10/25/2021	0 pCi/L	131876002	10/25/2021
Vogtle	Milk Gamma	Cs-134	GIR	10/25/2021	0 pCi/L	131876002	10/25/2021
Vogtle	Milk Gamma	Cs-137	GIR	10/25/2021	0 pCi/L	131876002	10/25/2021
Vogtle	Fish	K-40	1535 Bass	10/26/2021	3958.8 pCi/Kg	131797001	10/26/2021
Vogtle	Fish	K-40	1481 Sucker	10/26/2021	3750.5 pCi/Kg	131797006	10/26/2021
Vogtle	Fish	K-40	1535 Sucker	10/26/2021	3502.1 pCi/Kg	131797003	10/26/2021
Vogtle	Fish	K-40	1535 Carp	10/26/2021	3473.7 pCi/Kg	131797002	10/26/2021
Vogtle	Fish	K-40	1481 Bass	10/26/2021	3422.2 pCi/Kg	131797004	10/26/2021
Vogtle	Fish	K-40	1481 Carp	10/26/2021	2815.4 pCi/Kg	131797005	10/26/2021
Vogtle	Fish	Cs-137	1481 Bass	10/26/2021	64.424 pCi/Kg	131797004	10/26/2021
Vogtle	Fish	Cs-137	1481 Sucker	10/26/2021	21.308 pCi/Kg	131797006	10/26/2021

Vogtle	Fish	Zn-65	1481 Bass	10/26/2021	0 pCi/Kg	131797004	10/26/2021
Vogtle	Fish	Be-7	1481 Bass	10/26/2021	0 pCi/Kg	131797004	10/26/2021
Vogtle	Fish	Be-7	1481 Carp	10/26/2021	0 pCi/Kg	131797005	10/26/2021
Vogtle	Fish	Fe-59	1481 Bass	10/26/2021	0 pCi/Kg	131797004	10/26/2021
Vogtle	Fish	Be-7	1481 Sucker	10/26/2021	0 pCi/Kg	131797006	10/26/2021
Vogtle	Fish	Cs-134	1481 Bass	10/26/2021	0 pCi/Kg	131797004	10/26/2021
Vogtle	Fish	Zn-65	1481 Carp	10/26/2021	0 pCi/Kg	131797005	10/26/2021
Vogtle	Fish	Cs-134	1481 Carp	10/26/2021	0 pCi/Kg	131797005	10/26/2021
Vogtle	Fish	Fe-59	1481 Carp	10/26/2021	0 pCi/Kg	131797005	10/26/2021
Vogtle	Fish	Be-7	1535 Bass	10/26/2021	0 pCi/Kg	131797001	10/26/2021
Vogtle	Fish	Zn-65	1481 Sucker	10/26/2021	0 pCi/Kg	131797006	10/26/2021
Vogtle	Fish	Cs-134	1481 Sucker	10/26/2021	0 pCi/Kg	131797006	10/26/2021
Vogtle	Fish	Be-7	1535 Carp	10/26/2021	0 pCi/Kg	131797002	10/26/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	1/5/2021	0 pCi/L	127928005	1/5/2021
Vogtle	DW - Beta	Gross Beta	RPUR	1/5/2021	1.166 pCi/L	127928005	1/5/2021
Vogtle	Water H-3	Tritium	RPUR	1/5/2021	185 pCi/L	128365005	1/5/2021
Vogtle	Fish	Fe-59	1481 Sucker	10/26/2021	0 pCi/Kg	131797006	10/26/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	2/2/2021	0 pCi/L	128358005	2/2/2021
Vogtle	DW - Beta	Gross Beta	RPUR	2/2/2021	2.273 pCi/L	128358005	2/2/2021
Vogtle	Fish	Be-7	1535 Sucker	10/26/2021	0 pCi/Kg	131797003	10/26/2021
Vogtle	Fish	Co-58	1481 Bass	10/26/2021	0 pCi/Kg	131797004	10/26/2021
Vogtle	Fish	Co-58	1481 Carp	10/26/2021	0 pCi/Kg	131797005	10/26/2021
Vogtle	Fish	Co-58	1481 Sucker	10/26/2021	0 pCi/Kg	131797006	10/26/2021
Vogtle	Fish	Co-58	1535 Bass	10/26/2021	0 pCi/Kg	131797001	10/26/2021
Vogtle	Fish	Co-58	1535 Carp	10/26/2021	0 pCi/Kg	131797002	10/26/2021
Vogtle	Fish	Co-58	1535 Sucker	10/26/2021	0 pCi/Kg	131797003	10/26/2021
Vogtle	Fish	Co-60	1481 Bass	10/26/2021	0 pCi/Kg	131797004	10/26/2021
Vogtle	Fish	Co-60	1481 Carp	10/26/2021	0 pCi/Kg	131797005	10/26/2021
Vogtle	Fish	Co-60	1481 Sucker	10/26/2021	0 pCi/Kg	131797006	10/26/2021
Vogtle	Fish	Fe-59	1535 Bass	10/26/2021	0 pCi/Kg	131797001	10/26/2021
Vogtle	Fish	Co-60	1535 Bass	10/26/2021	0 pCi/Kg	131797001	10/26/2021
Vogtle	Fish	Co-60	1535 Carp	10/26/2021	0 pCi/Kg	131797002	10/26/2021
Vogtle	Fish	Zn-65	1535 Bass	10/26/2021	0 pCi/Kg	131797001	10/26/2021
Vogtle	Fish	Cs-134	1535 Bass	10/26/2021	0 pCi/Kg	131797001	10/26/2021
Vogtle	Fish	Co-60	1535 Sucker	10/26/2021	0 pCi/Kg	131797003	10/26/2021
Vogtle	Fish	Fe-59	1535 Carp	10/26/2021	0 pCi/Kg	131797002	10/26/2021
Vogtle	Fish	Zn-65	1535 Carp	10/26/2021	0 pCi/Kg	131797002	10/26/2021
Vogtle	Fish	Cs-134	1535 Carp	10/26/2021	0 pCi/Kg	131797002	10/26/2021
Vogtle	Fish	Cs-134	1535 Sucker	10/26/2021	0 pCi/Kg	131797003	10/26/2021
Vogtle	Fish	Zn-65	1535 Sucker	10/26/2021	0 pCi/Kg	131797003	10/26/2021
Vogtle	Fish	Fe-59	1535 Sucker	10/26/2021	0 pCi/Kg	131797003	10/26/2021
Vogtle	DW - Beta	Gross Beta	RPUR	3/1/2021	3.416 pCi/L	128780005	3/1/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	3/1/2021	0 pCi/L	128780005	3/1/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	4/6/2021	0 pCi/L	129105005	4/6/2021
Vogtle	DW - Beta	Gross Beta	RPUR	4/6/2021	2.284 pCi/L	129105005	4/6/2021
Vogtle	Fish	Cs-137	1481 Carp	10/26/2021	0 pCi/Kg	131797005	10/26/2021
Vogtle	Fish	Cs-137	1535 Bass	10/26/2021	0 pCi/Kg	131797001	10/26/2021
Vogtle	Fish	Cs-137	1535 Carp	10/26/2021	0 pCi/Kg	131797002	10/26/2021
Vogtle	Fish	Cs-137	1535 Sucker	10/26/2021	0 pCi/Kg	131797003	10/26/2021
Vogtle	Charcoal Ct	I-131	DIS	11/1/2021	0 pCi/m3	131854004	11/1/2021
Vogtle	Charcoal Ct	I-131	SIM	11/1/2021	0 pCi/m3	131854003	11/1/2021
Vogtle	Charcoal Ct	I-131	MET	11/1/2021	0 pCi/m3	131854005	11/1/2021
Vogtle	Charcoal Ct	I-131	RRD	11/1/2021	0 pCi/m3	131854006	11/1/2021
Vogtle	Charcoal Ct	I-131	HAN	11/1/2021	0 pCi/m3	131854007	11/1/2021
Vogtle	Charcoal Ct	I-131	WAY	11/1/2021	0 pCi/m3	131854001	11/1/2021
Vogtle	Charcoal Ct	I-131	GIR	11/1/2021	0 pCi/m3	131854002	11/1/2021
Vogtle	DW - Gamma	I-131	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	Cs-134	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	Water H-3	Tritium	RPUR	4/6/2021	269 pCi/L	129220005	4/6/2021
Vogtle	DW - Gamma	Cs-137	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	Ba-140	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	La-140	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	Be-7	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	K-40	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	Fe-59	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	Co-58	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	Co-60	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	Zn-65	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	Zr-95	RAUC	11/2/2021	0 pCi/L	131851001	11/2/2021
Vogtle	DW - Gamma	Ba-140	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Gamma	La-140	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	5/4/2021	0 pCi/L	129363005	5/4/2021
Vogtle	DW - Beta	Gross Beta	RPUR	5/4/2021	1.387 pCi/L	129363005	5/4/2021
Vogtle	DW - Gamma	Be-7	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Gamma	K-40	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Gamma	Fe-59	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Gamma	Co-58	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Gamma	Co-60	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Gamma	Zn-65	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Gamma	Zr-95	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	6/1/2021	0 pCi/L	129655005	6/1/2021
Vogtle	DW - Beta	Gross Beta	RPUR	6/1/2021	2.94 pCi/L	129655005	6/1/2021
Vogtle	DW - Gamma	I-131	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Gamma	Cs-134	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021
Vogtle	DW - Gamma	Cs-137	FAUC	11/2/2021	0 pCi/L	131851002	11/2/2021

Vogtle	DW - Gamma	Co-60	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	Zn-65	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	Zr-95	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	I-131	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	Cs-134	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	Cs-137	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	Ba-140	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	Water H-3	Tritium	RPUR	7/5/2021	188 pCi/L	130438005	7/5/2021
Vogtle	DW - Gamma	La-140	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	Be-7	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	K-40	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	Fe-59	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	Co-58	FPUR	11/2/2021	0 pCi/L	131851006	11/2/2021
Vogtle	DW - Gamma	La-140	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	Be-7	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	K-40	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Beta	Gross Beta	RPUR	7/5/2021	2.454 pCi/L	130196005	7/5/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	7/5/2021	0 pCi/L	130196005	7/5/2021
Vogtle	DW - Beta	Gross Beta	RPUR	8/3/2021	4.415 pCi/L	130593005	8/3/2021
Vogtle	DW - Gamma	Fe-59	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	Co-58	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	Co-60	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	Zn-65	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	Zr-95	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	I-131	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	Cs-134	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	Cs-137	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	Ba-140	RPUR	11/2/2021	0 pCi/L	131851005	11/2/2021
Vogtle	DW - Gamma	Fe-59	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	Co-58	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	8/3/2021	0 pCi/L	130593005	8/3/2021
Vogtle	DW - Beta	Gross Beta	RPUR	9/7/2021	3.843 pCi/L	131123005	9/7/2021
Vogtle	DW - Gamma	Co-60	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	Zn-65	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	Zr-95	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	I-131	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	Cs-134	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	Cs-137	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	Ba-140	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	La-140	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	Be-7	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	K-40	FPOR	11/2/2021	0 pCi/L	131851004	11/2/2021
Vogtle	DW - Gamma	Co-58	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	Co-60	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	Zn-65	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	9/7/2021	0 pCi/L	131123005	9/7/2021
Vogtle	Water H-3	Tritium	RPUR	10/5/2021	566 pCi/L	131707005	10/5/2021
Vogtle	DW - Gamma	Zr-95	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	I-131	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	Cs-134	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	Cs-137	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	Ba-140	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	La-140	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	Be-7	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	K-40	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	DW - Gamma	Fe-59	RPOR	11/2/2021	0 pCi/L	131851003	11/2/2021
Vogtle	Milk Gamma	Cs-137	GIR	11/9/2021	1.629 pCi/L	131911002	11/9/2021
Vogtle	Milk Gamma	La-140	GIR	11/9/2021	0 pCi/L	131911002	11/9/2021
Vogtle	Milk Gamma	K-40	GIR	11/9/2021	1349.9 pCi/L	131911002	11/9/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	10/5/2021	0 pCi/L	131519005	10/5/2021
Vogtle	DW - Beta	Gross Beta	RPUR	10/5/2021	4.376 pCi/L	131519005	10/5/2021
Vogtle	DW - Beta	Gross Beta	RPUR	11/2/2021	1.46 pCi/L	131850005	11/2/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	11/2/2021	0 pCi/L	131850005	11/2/2021
Vogtle	Milk Gamma	Be-7	GIR	11/9/2021	0 pCi/L	131911002	11/9/2021
Vogtle	Milk Gamma	Ba-140	GIR	11/9/2021	0 pCi/L	131911002	11/9/2021
Vogtle	Milk Gamma	Cs-134	GIR	11/9/2021	0 pCi/L	131911002	11/9/2021
Vogtle	Milk Gamma	I-131	GIR	11/9/2021	0 pCi/L	131911002	11/9/2021
Vogtle	Charcoal Ct	I-131	GIR	11/9/2021	0 pCi/m3	131942002	11/9/2021
Vogtle	Charcoal Ct	I-131	WAY	11/9/2021	0 pCi/m3	131942001	11/9/2021
Vogtle	Milk Gamma	I-131	Milky Way	11/9/2021	0 pCi/L	131911001	11/9/2021
Vogtle	Milk Gamma	K-40	Milky Way	11/9/2021	1416.5 pCi/L	131911001	11/9/2021
Vogtle	Milk Gamma	Be-7	Milky Way	11/9/2021	0 pCi/L	131911001	11/9/2021
Vogtle	Milk Gamma	La-140	Milky Way	11/9/2021	0 pCi/L	131911001	11/9/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	11/9/2021	0 pCi/L	131911001	11/9/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	11/9/2021	0 pCi/L	131911001	11/9/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	11/9/2021	0 pCi/L	131911001	11/9/2021
Vogtle	Charcoal Ct	I-131	HAN	11/9/2021	0 pCi/m3	131942007	11/9/2021
Vogtle	Charcoal Ct	I-131	RRD	11/9/2021	0 pCi/m3	131942006	11/9/2021
Vogtle	Charcoal Ct	I-131	SIM	11/9/2021	0 pCi/m3	131942003	11/9/2021
Vogtle	DW - Beta	Gross Alpha	RPUR	12/8/2021	0 pCi/L	132149005	12/8/2021
Vogtle	DW - Beta	Gross Beta	RPUR	12/8/2021	2.072 pCi/L	132149005	12/8/2021
Vogtle	Charcoal Ct	I-131	MET	11/9/2021	0 pCi/m3	131942005	11/9/2021
Vogtle	Charcoal Ct	I-131	DIS	11/9/2021	0 pCi/m3	131942004	11/9/2021
Vogtle	River Water	Cs-137	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	River Water	Ba-140	1495	11/9/2021	0 pCi/L	131913003	11/9/2021

Vogtle	River Water	La-140	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	River Water	Be-7	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	River Water	K-40	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	River Water	Fe-59	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	River Water	Co-58	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	River Water	Co-60	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	River Water	Zn-65	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	1/5/2021	0.01939 pCi/m3	127933006	1/5/2021
Vogtle	River Water	Zr-95	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	1/12/2021	0.02632 pCi/m3	128041006	1/12/2021
Vogtle	Air Filters	Gross Beta	RRD	1/19/2021	0.02908 pCi/m3	128181006	1/19/2021
Vogtle	River Water	I-131	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	River Water	Cs-134	1495	11/9/2021	0 pCi/L	131913003	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	1/26/2021	0.02013 pCi/m3	128275006	1/26/2021
Vogtle	Sediment	Cs-137	1533	11/9/2021	33.294 pCi/Kg	131914002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	2/1/2021	0.02059 pCi/m3	128356006	2/1/2021
Vogtle	Sediment	Be-7	1533	11/9/2021	332.96 pCi/Kg	131914002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	2/9/2021	0.01627 pCi/m3	128458006	2/9/2021
Vogtle	Air Filters	Gross Beta	RRD	2/15/2021	0.0125 pCi/m3	128534006	2/15/2021
Vogtle	Sediment	K-40	1533	11/9/2021	15622 pCi/Kg	131914002	11/9/2021
Vogtle	Sediment	Cs-134	1533	11/9/2021	0 pCi/Kg	131914002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	2/23/2021	0.02158 pCi/m3	128643006	2/23/2021
Vogtle	Air Filters	Gross Beta	RRD	3/2/2021	0.02428 pCi/m3	128782006	3/2/2021
Vogtle	Sediment	Co-60	1533	11/9/2021	0 pCi/Kg	131914002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	3/9/2021	0.02214 pCi/m3	128863006	3/9/2021
Vogtle	Sediment	Co-58	1533	11/9/2021	0 pCi/Kg	131914002	11/9/2021
Vogtle	River Water	Cs-134	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	3/16/2021	0.02628 pCi/m3	128931006	3/16/2021
Vogtle	Air Filters	Gross Beta	RRD	3/23/2021	0.01943 pCi/m3	128999006	3/23/2021
Vogtle	River Water	Cs-137	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	River Water	Ba-140	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	River Water	La-140	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	River Water	Be-7	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	River Water	K-40	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	3/30/2021	0.01549 pCi/m3	129044006	3/30/2021
Vogtle	River Water	Fe-59	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	4/5/2021	0.02613 pCi/m3	129119006	4/5/2021
Vogtle	Air Filters	Gross Beta	RRD	4/13/2021	0.03308 pCi/m3	129199006	4/13/2021
Vogtle	River Water	Co-58	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	River Water	Co-60	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	4/20/2021	0.03096 pCi/m3	129250006	4/20/2021
Vogtle	River Water	Zn-65	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	4/27/2021	0.02373 pCi/m3	129295006	4/27/2021
Vogtle	Air Filters	Gross Beta	RRD	5/3/2021	0.02569 pCi/m3	129366006	5/3/2021
Vogtle	River Water	Zr-95	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	5/11/2021	0.02108 pCi/m3	129445006	5/11/2021
Vogtle	Air Filters	Gross Beta	RRD	5/18/2021	0.02274 pCi/m3	129520006	5/18/2021
Vogtle	River Water	I-131	1504	11/9/2021	0 pCi/L	131913002	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	5/25/2021	0.02692 pCi/m3	129573006	5/25/2021
Vogtle	River Water	Cs-137	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	6/1/2021	0.02281 pCi/m3	129657006	6/1/2021
Vogtle	River Water	Ba-140	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	6/8/2021	0.01446 pCi/m3	129797006	6/8/2021
Vogtle	River Water	La-140	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	River Water	Be-7	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	6/15/2021	0.01631 pCi/m3	129928006	6/15/2021
Vogtle	River Water	K-40	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	6/22/2021	0.02127 pCi/m3	130036006	6/22/2021
Vogtle	River Water	Fe-59	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	River Water	Co-58	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	River Water	Co-60	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	6/29/2021	0.01561 pCi/m3	130145006	6/29/2021
Vogtle	River Water	Zn-65	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	River Water	Zr-95	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	7/6/2021	0.01478 pCi/m3	130206006	7/6/2021
Vogtle	Air Filters	Gross Beta	RRD	7/12/2021	0.01248 pCi/m3	130290006	7/12/2021
Vogtle	River Water	I-131	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	7/19/2021	0.01405 pCi/m3	130422006	7/19/2021
Vogtle	River Water	Cs-134	1512	11/9/2021	0 pCi/L	131913001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	7/27/2021	0.02241 pCi/m3	130527006	7/27/2021
Vogtle	Air Filters	Gross Beta	RRD	8/3/2021	0.02954 pCi/m3	130595006	8/3/2021
Vogtle	Sediment	K-40	1502	11/9/2021	15857 pCi/Kg	131914001	11/9/2021
Vogtle	Sediment	Be-7	1502	11/9/2021	443.98 pCi/Kg	131914001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	8/10/2021	0.02202 pCi/m3	130719006	8/10/2021
Vogtle	Air Filters	Gross Beta	RRD	8/17/2021	0.01769 pCi/m3	130835006	8/17/2021
Vogtle	Sediment	Cs-137	1502	11/9/2021	106.65 pCi/Kg	131914001	11/9/2021
Vogtle	Sediment	Cs-134	1502	11/9/2021	0 pCi/Kg	131914001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	8/24/2021	0.0143 pCi/m3	130902006	8/24/2021
Vogtle	Air Filters	Gross Beta	RRD	8/31/2021	0.02688 pCi/m3	131012006	8/31/2021
Vogtle	Sediment	Co-60	1502	11/9/2021	0 pCi/Kg	131914001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	9/7/2021	0.02476 pCi/m3	131125006	9/7/2021
Vogtle	Sediment	Co-58	1502	11/9/2021	0 pCi/Kg	131914001	11/9/2021
Vogtle	Air Filters	Gross Beta	RRD	9/14/2021	0.02821 pCi/m3	131254006	9/14/2021
Vogtle	Charcoal Ct	I-131	DIS	11/16/2021	0 pCi/m3	131994004	11/16/2021
Vogtle	Charcoal Ct	I-131	MET	11/16/2021	0 pCi/m3	131994005	11/16/2021

Vogtle	Air Filters	Gross Beta	RRD	9/21/2021	0.02295 pCi/m3	131332006	9/21/2021
Vogtle	Charcoal Ct	I-131	SIM	11/16/2021	0 pCi/m3	131994003	11/16/2021
Vogtle	Charcoal Ct	I-131	RRD	11/16/2021	0 pCi/m3	131994006	11/16/2021
Vogtle	Charcoal Ct	I-131	HAN	11/16/2021	0 pCi/m3	131994007	11/16/2021
Vogtle	Charcoal Ct	I-131	GIR	11/16/2021	0 pCi/m3	131994002	11/16/2021
Vogtle	Charcoal Ct	I-131	WAY	11/16/2021	0 pCi/m3	131994001	11/16/2021
Vogtle	Air Filters	Gross Beta	RRD	9/28/2021	0.02691 pCi/m3	131422006	9/28/2021
Vogtle	Charcoal Ct	I-131	WAY	11/22/2021	0 pCi/m3	132037001	11/22/2021
Vogtle	Air Filters	Gross Beta	RRD	10/5/2021	0.04014 pCi/m3	131549006	10/5/2021
Vogtle	Air Filters	Gross Beta	RRD	10/12/2021	0.01345 pCi/m3	131616006	10/12/2021
Vogtle	Charcoal Ct	I-131	HAN	11/22/2021	0 pCi/m3	132037007	11/22/2021
Vogtle	Air Filters	Gross Beta	RRD	10/19/2021	0.028 pCi/m3	131695006	10/19/2021
Vogtle	Charcoal Ct	I-131	RRD	11/22/2021	0 pCi/m3	132037006	11/22/2021
Vogtle	Air Filters	Gross Beta	RRD	10/24/2021	0.03852 pCi/m3	131756006	10/24/2021
Vogtle	Charcoal Ct	I-131	SIM	11/22/2021	0 pCi/m3	132037003	11/22/2021
Vogtle	Air Filters	Gross Beta	RRD	11/1/2021	0.0195 pCi/m3	131853006	11/1/2021
Vogtle	Charcoal Ct	I-131	MET	11/22/2021	0 pCi/m3	132037005	11/22/2021
Vogtle	Charcoal Ct	I-131	DIS	11/22/2021	0 pCi/m3	132037004	11/22/2021
Vogtle	Air Filters	Gross Beta	RRD	11/9/2021	0.02421 pCi/m3	131941006	11/9/2021
Vogtle	Charcoal Ct	I-131	GIR	11/22/2021	0 pCi/m3	132037002	11/22/2021
Vogtle	Air Filters	Gross Beta	RRD	11/16/2021	0.0268 pCi/m3	131993006	11/16/2021
Vogtle	Charcoal Ct	I-131	DIS	11/29/2021	0 pCi/m3	132086004	11/29/2021
Vogtle	Air Filters	Gross Beta	RRD	11/22/2021	0.02637 pCi/m3	132036006	11/22/2021
Vogtle	Air Filters	Gross Beta	RRD	11/29/2021	0.02303 pCi/m3	132085006	11/29/2021
Vogtle	Charcoal Ct	I-131	MET	11/29/2021	0 pCi/m3	132086005	11/29/2021
Vogtle	Charcoal Ct	I-131	SIM	11/29/2021	0 pCi/m3	132086003	11/29/2021
Vogtle	Air Filters	Gross Beta	RRD	12/7/2021	0.05 pCi/m3	132155006	12/7/2021
Vogtle	Air Filters	Gross Beta	RRD	12/13/2021	0.02634 pCi/m3	132220006	12/13/2021
Vogtle	Charcoal Ct	I-131	RRD	11/29/2021	0 pCi/m3	132086006	11/29/2021
Vogtle	Charcoal Ct	I-131	HAN	11/29/2021	0 pCi/m3	132086007	11/29/2021
Vogtle	Air Filters	Gross Beta	RRD	12/21/2021	0.02002 pCi/m3	132273006	12/21/2021
Vogtle	Charcoal Ct	I-131	WAY	11/29/2021	0 pCi/m3	132086001	11/29/2021
Vogtle	Charcoal Ct	I-131	GIR	11/29/2021	0 pCi/m3	132086002	11/29/2021
Vogtle	Milk Gamma	I-131	GIR	11/30/2021	0 pCi/L	132084002	11/30/2021
Vogtle	Milk Gamma	Cs-134	GIR	11/30/2021	0 pCi/L	132084002	11/30/2021
Vogtle	Milk Gamma	Ba-140	GIR	11/30/2021	0 pCi/L	132084002	11/30/2021
Vogtle	Air Filters	Gross Beta	RRD	12/28/2021	0.02951 pCi/m3	132323006	12/28/2021
Vogtle	Air Filters	Gross Beta	SIM	1/5/2021	0.01856 pCi/m3	127933003	1/5/2021
Vogtle	Milk Gamma	La-140	GIR	11/30/2021	0 pCi/L	132084002	11/30/2021
Vogtle	Milk Gamma	Be-7	GIR	11/30/2021	0 pCi/L	132084002	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	1/12/2021	0.02885 pCi/m3	128041003	1/12/2021
Vogtle	Air Filters	Gross Beta	SIM	1/19/2021	0.0268 pCi/m3	128181003	1/19/2021
Vogtle	Milk Gamma	K-40	GIR	11/30/2021	1353 pCi/L	132084002	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	1/26/2021	0.02122 pCi/m3	128275003	1/26/2021
Vogtle	Milk Gamma	Cs-137	GIR	11/30/2021	0 pCi/L	132084002	11/30/2021
Vogtle	Vegetation	Be-7	WAY	11/30/2021	585.8 pCi/Kg	132087001	11/30/2021
Vogtle	Vegetation	Cs-137	WAY	11/30/2021	0 pCi/Kg	132087001	11/30/2021
Vogtle	Vegetation	Cs-134	WAY	11/30/2021	0 pCi/Kg	132087001	11/30/2021
Vogtle	Vegetation	I-131	WAY	11/30/2021	0 pCi/Kg	132087001	11/30/2021
Vogtle	Vegetation	K-40	WAY	11/30/2021	7445.3 pCi/Kg	132087001	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	2/1/2021	0.02096 pCi/m3	128356003	2/1/2021
Vogtle	Milk Gamma	K-40	Milky Way	11/30/2021	1467.6 pCi/L	132084001	11/30/2021
Vogtle	Milk Gamma	Be-7	Milky Way	11/30/2021	0 pCi/L	132084001	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	2/9/2021	0.01892 pCi/m3	128458003	2/9/2021
Vogtle	Milk Gamma	La-140	Milky Way	11/30/2021	0 pCi/L	132084001	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	2/15/2021	0.01061 pCi/m3	128534003	2/15/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	11/30/2021	0 pCi/L	132084001	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	2/23/2021	0.02401 pCi/m3	128643003	2/23/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	11/30/2021	0 pCi/L	132084001	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	3/2/2021	0.02434 pCi/m3	128782003	3/2/2021
Vogtle	Air Filters	Gross Beta	SIM	3/9/2021	0.02717 pCi/m3	128863003	3/9/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	11/30/2021	0 pCi/L	132084001	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	3/16/2021	0.02506 pCi/m3	128931003	3/16/2021
Vogtle	Milk Gamma	I-131	Milky Way	11/30/2021	0 pCi/L	132084001	11/30/2021
Vogtle	Vegetation	Cs-134	HAN	11/30/2021	0 pCi/Kg	132087003	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	3/23/2021	0.01929 pCi/m3	128999003	3/23/2021
Vogtle	Vegetation	I-131	HAN	11/30/2021	0 pCi/Kg	132087003	11/30/2021
Vogtle	Vegetation	Be-7	HAN	11/30/2021	657.03 pCi/Kg	132087003	11/30/2021
Vogtle	Vegetation	K-40	HAN	11/30/2021	8691.3 pCi/Kg	132087003	11/30/2021
Vogtle	Vegetation	Cs-137	HAN	11/30/2021	0 pCi/Kg	132087003	11/30/2021
Vogtle	Air Filters	Gross Beta	SIM	3/30/2021	0.01814 pCi/m3	129044003	3/30/2021
Vogtle	Vegetation	Cs-137	SIM	11/30/2021	0 pCi/Kg	132087002	11/30/2021
Vogtle	Vegetation	Cs-134	SIM	11/30/2021	0 pCi/Kg	132087002	11/30/2021
Vogtle	Vegetation	I-131	SIM	11/30/2021	0 pCi/Kg	132087002	11/30/2021
Vogtle	Vegetation	Be-7	SIM	11/30/2021	234.55 pCi/Kg	132087002	11/30/2021
Vogtle	Vegetation	K-40	SIM	11/30/2021	8690.1 pCi/Kg	132087002	11/30/2021
Vogtle	Charcoal Ct	I-131	DIS	12/7/2021	0 pCi/m3	132156004	12/7/2021
Vogtle	Charcoal Ct	I-131	MET	12/7/2021	0 pCi/m3	132156005	12/7/2021
Vogtle	Air Filters	Gross Beta	SIM	4/5/2021	0.02225 pCi/m3	129119003	4/5/2021
Vogtle	Charcoal Ct	I-131	SIM	12/7/2021	0 pCi/m3	132156003	12/7/2021
Vogtle	Air Filters	Gross Beta	SIM	4/13/2021	0.02875 pCi/m3	129199003	4/13/2021
Vogtle	Air Filters	Gross Beta	SIM	4/20/2021	0.03176 pCi/m3	129250003	4/20/2021
Vogtle	Charcoal Ct	I-131	RRD	12/7/2021	0 pCi/m3	132156006	12/7/2021
Vogtle	Air Filters	Gross Beta	SIM	4/27/2021	0.02635 pCi/m3	129295003	4/27/2021
Vogtle	Charcoal Ct	I-131	HAN	12/7/2021	0 pCi/m3	132156007	12/7/2021

Vogtle	Charcoal Ct	I-131	WAY	12/7/2021	0 pCi/m3	132156001	12/7/2021
Vogtle	Charcoal Ct	I-131	GIR	12/7/2021	0 pCi/m3	132156002	12/7/2021
Vogtle	DW - Gamma	Ba-140	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	DW - Gamma	La-140	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	DW - Gamma	Be-7	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	DW - Gamma	K-40	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	5/3/2021	0.02823 pCi/m3	129366003	5/3/2021
Vogtle	Air Filters	Gross Beta	SIM	5/11/2021	0.02372 pCi/m3	129445003	5/11/2021
Vogtle	Air Filters	Gross Beta	SIM	5/18/2021	0.02098 pCi/m3	129520003	5/18/2021
Vogtle	DW - Gamma	Fe-59	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	DW - Gamma	Co-58	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	5/25/2021	0.03069 pCi/m3	129573003	5/25/2021
Vogtle	DW - Gamma	Co-60	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	DW - Gamma	Zn-65	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	DW - Gamma	Zr-95	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	DW - Gamma	I-131	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	DW - Gamma	Cs-134	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	6/1/2021	0.02488 pCi/m3	129657003	6/1/2021
Vogtle	Air Filters	Gross Beta	SIM	6/8/2021	0.01462 pCi/m3	129797003	6/8/2021
Vogtle	DW - Gamma	Cs-137	FAUC	12/8/2021	0 pCi/L	132150002	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	6/15/2021	0.01725 pCi/m3	129928003	6/15/2021
Vogtle	DW - Gamma	Zn-65	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	DW - Gamma	Zr-95	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	6/22/2021	0.02203 pCi/m3	130036003	6/22/2021
Vogtle	DW - Gamma	I-131	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	DW - Gamma	Cs-134	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	DW - Gamma	Cs-137	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	DW - Gamma	Ba-140	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	6/29/2021	0.01597 pCi/m3	130145003	6/29/2021
Vogtle	DW - Gamma	La-140	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	DW - Gamma	Be-7	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	DW - Gamma	K-40	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	DW - Gamma	Fe-59	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	7/6/2021	0.01444 pCi/m3	130206003	7/6/2021
Vogtle	DW - Gamma	Co-58	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	7/12/2021	0.01581 pCi/m3	130290003	7/12/2021
Vogtle	DW - Gamma	Co-60	RAUC	12/8/2021	0 pCi/L	132150001	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	7/19/2021	0.01753 pCi/m3	130422003	7/19/2021
Vogtle	DW - Gamma	Zr-95	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	7/27/2021	0.01881 pCi/m3	130527003	7/27/2021
Vogtle	DW - Gamma	I-131	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	DW - Gamma	Cs-134	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	DW - Gamma	Cs-137	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	DW - Gamma	Ba-140	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	DW - Gamma	La-140	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	DW - Gamma	Be-7	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	8/3/2021	0.02997 pCi/m3	130595003	8/3/2021
Vogtle	Air Filters	Gross Beta	SIM	8/10/2021	0.02021 pCi/m3	130719003	8/10/2021
Vogtle	DW - Gamma	K-40	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	8/17/2021	0.01778 pCi/m3	130835003	8/17/2021
Vogtle	Air Filters	Gross Beta	SIM	8/24/2021	0.0146 pCi/m3	130902003	8/24/2021
Vogtle	DW - Gamma	Fe-59	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	DW - Gamma	Co-58	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	8/31/2021	0.02741 pCi/m3	131012003	8/31/2021
Vogtle	DW - Gamma	Co-60	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	DW - Gamma	Zn-65	FPUR	12/8/2021	0 pCi/L	132150006	12/8/2021
Vogtle	DW - Gamma	Ba-140	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	DW - Gamma	Zr-95	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	DW - Gamma	La-140	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	9/7/2021	0.02317 pCi/m3	131125003	9/7/2021
Vogtle	DW - Gamma	Be-7	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	DW - Gamma	K-40	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	9/14/2021	0.02745 pCi/m3	131254003	9/14/2021
Vogtle	Air Filters	Gross Beta	SIM	9/21/2021	0.01804 pCi/m3	131332003	9/21/2021
Vogtle	DW - Gamma	Fe-59	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	9/28/2021	0.027 pCi/m3	131422003	9/28/2021
Vogtle	DW - Gamma	Co-58	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	DW - Gamma	Co-60	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	DW - Gamma	Zn-65	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	DW - Gamma	I-131	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	DW - Gamma	Cs-134	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	DW - Gamma	Cs-137	RPUR	12/8/2021	0 pCi/L	132150005	12/8/2021
Vogtle	DW - Gamma	Zn-65	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	DW - Gamma	Zr-95	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	10/5/2021	0.03998 pCi/m3	131549003	10/5/2021
Vogtle	DW - Gamma	I-131	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	10/12/2021	0.01309 pCi/m3	131616003	10/12/2021
Vogtle	Air Filters	Gross Beta	SIM	10/19/2021	0.02971 pCi/m3	131695003	10/19/2021
Vogtle	DW - Gamma	Cs-134	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	10/24/2021	0.04059 pCi/m3	131756003	10/24/2021
Vogtle	DW - Gamma	Cs-137	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	DW - Gamma	Ba-140	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	DW - Gamma	La-140	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	DW - Gamma	Be-7	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	DW - Gamma	K-40	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021

Vogtle	DW - Gamma	Fe-59	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	11/1/2021	0.01555 pCi/m3	131853003	11/1/2021
Vogtle	Air Filters	Gross Beta	SIM	11/9/2021	0.02932 pCi/m3	131941003	11/9/2021
Vogtle	DW - Gamma	Co-58	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	DW - Gamma	Co-60	FPOR	12/8/2021	0 pCi/L	132150004	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	11/16/2021	0.02543 pCi/m3	131993003	11/16/2021
Vogtle	Air Filters	Gross Beta	SIM	11/22/2021	0.02485 pCi/m3	132036003	11/22/2021
Vogtle	DW - Gamma	Fe-59	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	11/29/2021	0.02319 pCi/m3	132085003	11/29/2021
Vogtle	DW - Gamma	Co-58	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	DW - Gamma	Co-60	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	DW - Gamma	Zn-65	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	DW - Gamma	Zr-95	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	DW - Gamma	I-131	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	12/7/2021	0.0476 pCi/m3	132155003	12/7/2021
Vogtle	Air Filters	Gross Beta	SIM	12/13/2021	0.02829 pCi/m3	132220003	12/13/2021
Vogtle	DW - Gamma	Cs-134	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	12/21/2021	0.02301 pCi/m3	132273003	12/21/2021
Vogtle	DW - Gamma	Cs-137	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	Air Filters	Gross Beta	SIM	12/28/2021	0.02722 pCi/m3	132323003	12/28/2021
Vogtle	DW - Gamma	Ba-140	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	DW - Gamma	La-140	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	DW - Gamma	Be-7	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	DW - Gamma	K-40	RPOR	12/8/2021	0 pCi/L	132150003	12/8/2021
Vogtle	Charcoal Ct	I-131	DIS	12/13/2021	0 pCi/m3	132221004	12/13/2021
Vogtle	Charcoal Ct	I-131	MET	12/13/2021	0 pCi/m3	132221005	12/13/2021
Vogtle	Air Filters	Gross Beta	WAY	1/5/2021	0.018 pCi/m3	127933001	1/5/2021
Vogtle	Charcoal Ct	I-131	SIM	12/13/2021	0 pCi/m3	132221003	12/13/2021
Vogtle	Air Filters	Gross Beta	WAY	1/12/2021	0.02501 pCi/m3	128041001	1/12/2021
Vogtle	Charcoal Ct	I-131	RRD	12/13/2021	0 pCi/m3	132221006	12/13/2021
Vogtle	Air Filters	Gross Beta	WAY	1/19/2021	0.02529 pCi/m3	128181001	1/19/2021
Vogtle	Charcoal Ct	I-131	HAN	12/13/2021	0 pCi/m3	132221007	12/13/2021
Vogtle	Charcoal Ct	I-131	WAY	12/13/2021	0 pCi/m3	132221001	12/13/2021
Vogtle	Charcoal Ct	I-131	GIR	12/13/2021	0 pCi/m3	132221002	12/13/2021
Vogtle	Milk Gamma	I-131	Milky Way	12/14/2021	0 pCi/L	132216001	12/14/2021
Vogtle	Milk Gamma	K-40	Milky Way	12/14/2021	1487.6 pCi/L	132216001	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	1/26/2021	0.0193 pCi/m3	128275001	1/26/2021
Vogtle	Milk Gamma	Be-7	Milky Way	12/14/2021	0 pCi/L	132216001	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	2/1/2021	0.01654 pCi/m3	128356001	2/1/2021
Vogtle	Milk Gamma	La-140	Milky Way	12/14/2021	0 pCi/L	132216001	12/14/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	12/14/2021	0 pCi/L	132216001	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	2/9/2021	0.01714 pCi/m3	128458001	2/9/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	12/14/2021	0 pCi/L	132216001	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	2/15/2021	0.009232 pCi/m3	128534001	2/15/2021
Vogtle	Air Filters	Gross Beta	WAY	2/23/2021	0.02106 pCi/m3	128643001	2/23/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	12/14/2021	0 pCi/L	132216001	12/14/2021
Vogtle	Milk Gamma	Cs-137	GIR	12/14/2021	1.2634 pCi/L	132216002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	3/2/2021	0.02318 pCi/m3	128782001	3/2/2021
Vogtle	Air Filters	Gross Beta	WAY	3/9/2021	0.02959 pCi/m3	128863001	3/9/2021
Vogtle	Milk Gamma	Ba-140	GIR	12/14/2021	0 pCi/L	132216002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	3/16/2021	0.02544 pCi/m3	128931001	3/16/2021
Vogtle	Milk Gamma	La-140	GIR	12/14/2021	0 pCi/L	132216002	12/14/2021
Vogtle	Milk Gamma	Be-7	GIR	12/14/2021	0 pCi/L	132216002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	3/23/2021	0.01742 pCi/m3	128999001	3/23/2021
Vogtle	Milk Gamma	K-40	GIR	12/14/2021	1377.1 pCi/L	132216002	12/14/2021
Vogtle	Milk Gamma	I-131	GIR	12/14/2021	0 pCi/L	132216002	12/14/2021
Vogtle	Milk Gamma	Cs-134	GIR	12/14/2021	0 pCi/L	132216002	12/14/2021
Vogtle	River Water	Fe-59	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	3/30/2021	0.01694 pCi/m3	129044001	3/30/2021
Vogtle	River Water	Co-58	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	River Water	Co-60	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	River Water	Zn-65	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	River Water	Zr-95	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	River Water	I-131	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	River Water	Cs-134	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	4/5/2021	0.02498 pCi/m3	129119001	4/5/2021
Vogtle	River Water	Cs-137	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	4/13/2021	0.028 pCi/m3	129199001	4/13/2021
Vogtle	River Water	Ba-140	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	4/20/2021	0.02591 pCi/m3	129250001	4/20/2021
Vogtle	River Water	La-140	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	River Water	Be-7	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	River Water	K-40	1495	12/14/2021	0 pCi/L	132217003	12/14/2021
Vogtle	River Water	Fe-59	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	4/27/2021	0.02089 pCi/m3	129295001	4/27/2021
Vogtle	River Water	Co-58	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	5/3/2021	0.02955 pCi/m3	129366001	5/3/2021
Vogtle	River Water	Zr-95	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	5/11/2021	0.02257 pCi/m3	129445001	5/11/2021
Vogtle	Air Filters	Gross Beta	WAY	5/18/2021	0.02202 pCi/m3	129520001	5/18/2021
Vogtle	River Water	I-131	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	5/25/2021	0.02791 pCi/m3	129573001	5/25/2021
Vogtle	River Water	Cs-134	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	River Water	Cs-137	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	River Water	Ba-140	1504	12/14/2021	0 pCi/L	132217002	12/14/2021

Vogtle	River Water	La-140	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	River Water	Be-7	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	6/1/2021	0.0293 pCi/m3	129657001	6/1/2021
Vogtle	River Water	K-40	1504	12/14/2021	142.43 pCi/L	132217002	12/14/2021
Vogtle	River Water	Co-60	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	6/8/2021	0.01222 pCi/m3	129797001	6/8/2021
Vogtle	Air Filters	Gross Beta	WAY	6/15/2021	0.01302 pCi/m3	129928001	6/15/2021
Vogtle	River Water	Zn-65	1504	12/14/2021	0 pCi/L	132217002	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	6/22/2021	0.02019 pCi/m3	130036001	6/22/2021
Vogtle	River Water	La-140	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	River Water	Be-7	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	River Water	K-40	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	6/29/2021	0.01802 pCi/m3	130145001	6/29/2021
Vogtle	River Water	Fe-59	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	River Water	Co-58	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	River Water	Co-60	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	River Water	Zn-65	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	River Water	Zr-95	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	River Water	I-131	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	River Water	Cs-134	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	7/6/2021	0.01528 pCi/m3	130206001	7/6/2021
Vogtle	River Water	Cs-137	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	7/12/2021	0.01546 pCi/m3	130290001	7/12/2021
Vogtle	Air Filters	Gross Beta	WAY	7/19/2021	0.01514 pCi/m3	130422001	7/19/2021
Vogtle	River Water	Ba-140	1512	12/14/2021	0 pCi/L	132217001	12/14/2021
Vogtle	Air Filters	Gross Beta	WAY	7/27/2021	0.0194 pCi/m3	130527001	7/27/2021
Vogtle	Milk Gamma	K-40	Milky Way	12/21/2021	1470.1 pCi/L	132272001	12/21/2021
Vogtle	Milk Gamma	Be-7	Milky Way	12/21/2021	0 pCi/L	132272001	12/21/2021
Vogtle	Milk Gamma	La-140	Milky Way	12/21/2021	0 pCi/L	132272001	12/21/2021
Vogtle	Milk Gamma	Ba-140	Milky Way	12/21/2021	0 pCi/L	132272001	12/21/2021
Vogtle	Milk Gamma	Cs-137	Milky Way	12/21/2021	0 pCi/L	132272001	12/21/2021
Vogtle	Milk Gamma	Cs-134	Milky Way	12/21/2021	0 pCi/L	132272001	12/21/2021
Vogtle	Milk Gamma	I-131	Milky Way	12/21/2021	0 pCi/L	132272001	12/21/2021
Vogtle	Air Filters	Gross Beta	WAY	8/3/2021	0.0246 pCi/m3	130595001	8/3/2021
Vogtle	Milk Gamma	Cs-137	GIR	12/21/2021	0.93542 pCi/L	132272002	12/21/2021
Vogtle	Air Filters	Gross Beta	WAY	8/10/2021	0.02261 pCi/m3	130719001	8/10/2021
Vogtle	Milk Gamma	K-40	GIR	12/21/2021	1375.7 pCi/L	132272002	12/21/2021
Vogtle	Air Filters	Gross Beta	WAY	8/17/2021	0.01765 pCi/m3	130835001	8/17/2021
Vogtle	Milk Gamma	I-131	GIR	12/21/2021	0 pCi/L	132272002	12/21/2021
Vogtle	Air Filters	Gross Beta	WAY	8/24/2021	0.01442 pCi/m3	130902001	8/24/2021
Vogtle	Milk Gamma	Cs-134	GIR	12/21/2021	0 pCi/L	132272002	12/21/2021
Vogtle	Milk Gamma	Ba-140	GIR	12/21/2021	0 pCi/L	132272002	12/21/2021
Vogtle	Milk Gamma	La-140	GIR	12/21/2021	0 pCi/L	132272002	12/21/2021
Vogtle	Milk Gamma	Be-7	GIR	12/21/2021	0 pCi/L	132272002	12/21/2021
Vogtle	Charcoal Ct	I-131	WAY	12/21/2021	0 pCi/m3	132274001	12/21/2021
Vogtle	Air Filters	Gross Beta	WAY	8/31/2021	0.02725 pCi/m3	131012001	8/31/2021
Vogtle	Charcoal Ct	I-131	GIR	12/21/2021	0 pCi/m3	132274002	12/21/2021
Vogtle	Air Filters	Gross Beta	WAY	9/7/2021	0.02513 pCi/m3	131125001	9/7/2021
Vogtle	Charcoal Ct	I-131	HAN	12/21/2021	0 pCi/m3	132274007	12/21/2021
Vogtle	Air Filters	Gross Beta	WAY	9/14/2021	0.02501 pCi/m3	131254001	9/14/2021
Vogtle	Charcoal Ct	I-131	RRD	12/21/2021	0 pCi/m3	132274006	12/21/2021
Vogtle	Air Filters	Gross Beta	WAY	9/21/2021	0.02199 pCi/m3	131332001	9/21/2021
Vogtle	Charcoal Ct	I-131	SIM	12/21/2021	0 pCi/m3	132274003	12/21/2021
Vogtle	Charcoal Ct	I-131	MET	12/21/2021	0 pCi/m3	132274005	12/21/2021
Vogtle	Charcoal Ct	I-131	DIS	12/21/2021	0 pCi/m3	132274004	12/21/2021
Vogtle	Air Qtr Comp	Cs-137	WAY	12/28/2021	0 pCi/m3	132406001	12/28/2021
Vogtle	Air Qtr Comp	Be-7	WAY	12/28/2021	0.0936 pCi/m3	132406001	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	9/28/2021	0.02485 pCi/m3	131422001	9/28/2021
Vogtle	Charcoal Ct	I-131	WAY	12/28/2021	0 pCi/m3	132324001	12/28/2021
Vogtle	Air Qtr Comp	Cs-134	WAY	12/28/2021	0 pCi/m3	132406001	12/28/2021
Vogtle	Air Qtr Comp	I-131	WAY	12/28/2021	0 pCi/m3	132406001	12/28/2021
Vogtle	Air Qtr Comp	Cs-137	GIR	12/28/2021	0 pCi/m3	132406002	12/28/2021
Vogtle	Air Qtr Comp	Be-7	GIR	12/28/2021	0.08143 pCi/m3	132406002	12/28/2021
Vogtle	Air Qtr Comp	I-131	GIR	12/28/2021	0 pCi/m3	132406002	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	10/5/2021	0.04207 pCi/m3	131549001	10/5/2021
Vogtle	Air Qtr Comp	Cs-134	GIR	12/28/2021	0 pCi/m3	132406002	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	10/12/2021	0.01448 pCi/m3	131616001	10/12/2021
Vogtle	Charcoal Ct	I-131	GIR	12/28/2021	0 pCi/m3	132324002	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	10/19/2021	0.02811 pCi/m3	131695001	10/19/2021
Vogtle	Charcoal Ct	I-131	SIM	12/28/2021	0 pCi/m3	132324003	12/28/2021
Vogtle	Air Qtr Comp	I-131	SIM	12/28/2021	0 pCi/m3	132406003	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	10/24/2021	0.04081 pCi/m3	131756001	10/24/2021
Vogtle	Air Qtr Comp	Be-7	SIM	12/28/2021	0.07457 pCi/m3	132406003	12/28/2021
Vogtle	Air Qtr Comp	Cs-137	SIM	12/28/2021	0 pCi/m3	132406003	12/28/2021
Vogtle	Air Qtr Comp	Cs-134	SIM	12/28/2021	0 pCi/m3	132406003	12/28/2021
Vogtle	Charcoal Ct	I-131	HAN	12/28/2021	0 pCi/m3	132324007	12/28/2021
Vogtle	Air Qtr Comp	I-131	HAN	12/28/2021	0 pCi/m3	132406007	12/28/2021
Vogtle	Air Qtr Comp	Be-7	HAN	12/28/2021	0.07349 pCi/m3	132406007	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	11/1/2021	0.019 pCi/m3	131853001	11/1/2021
Vogtle	Air Qtr Comp	Cs-137	HAN	12/28/2021	0 pCi/m3	132406007	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	11/9/2021	0.02764 pCi/m3	131941001	11/9/2021
Vogtle	Air Filters	Gross Beta	WAY	11/16/2021	0.02624 pCi/m3	131993001	11/16/2021
Vogtle	Air Qtr Comp	Cs-134	HAN	12/28/2021	0 pCi/m3	132406007	12/28/2021
Vogtle	Charcoal Ct	I-131	RRD	12/28/2021	0 pCi/m3	132324006	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	11/22/2021	0.02453 pCi/m3	132036001	11/22/2021

Vogtle	Air Qtr Comp	Be-7	RRD	12/28/2021	0.09672 pCi/m3	132406006	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	11/29/2021	0.03256 pCi/m3	132085001	11/29/2021
Vogtle	Air Qtr Comp	Cs-137	RRD	12/28/2021	0 pCi/m3	132406006	12/28/2021
Vogtle	Air Qtr Comp	Cs-134	RRD	12/28/2021	0 pCi/m3	132406006	12/28/2021
Vogtle	Air Qtr Comp	I-131	RRD	12/28/2021	0 pCi/m3	132406006	12/28/2021
Vogtle	Charcoal Ct	I-131	MET	12/28/2021	0 pCi/m3	132324005	12/28/2021
Vogtle	Air Qtr Comp	Be-7	MET	12/28/2021	0.075 pCi/m3	132406005	12/28/2021
Vogtle	Air Qtr Comp	Cs-137	MET	12/28/2021	0 pCi/m3	132406005	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	12/7/2021	0.04818 pCi/m3	132155001	12/7/2021
Vogtle	Air Qtr Comp	Cs-134	MET	12/28/2021	0 pCi/m3	132406005	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	12/13/2021	0.02581 pCi/m3	132220001	12/13/2021
Vogtle	Air Filters	Gross Beta	WAY	12/21/2021	0.01789 pCi/m3	132273001	12/21/2021
Vogtle	Air Qtr Comp	I-131	MET	12/28/2021	0 pCi/m3	132406005	12/28/2021
Vogtle	Air Qtr Comp	Cs-134	DIS	12/28/2021	0 pCi/m3	132406004	12/28/2021
Vogtle	Air Qtr Comp	I-131	DIS	12/28/2021	0 pCi/m3	132406004	12/28/2021
Vogtle	Charcoal Ct	I-131	DIS	12/28/2021	0 pCi/m3	132324004	12/28/2021
Vogtle	Air Qtr Comp	Be-7	DIS	12/28/2021	0.08925 pCi/m3	132406004	12/28/2021
Vogtle	Air Qtr Comp	Cs-137	DIS	12/28/2021	0 pCi/m3	132406004	12/28/2021
Vogtle	Air Filters	Gross Beta	WAY	12/28/2021	0.02598 pCi/m3	132323001	12/28/2021

This page intentionally left blank.