Wolf Creek 1

2Q/2006 Performance Indicators

Licensee's General Comments: none

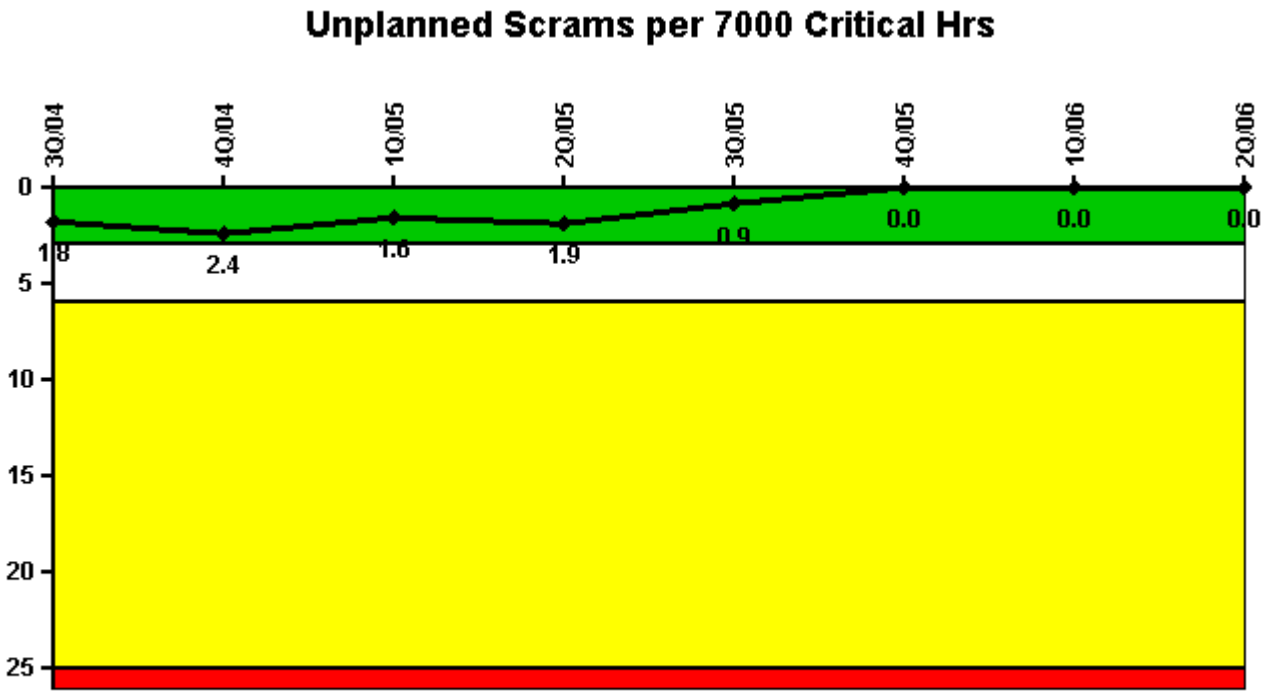

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
Unplanned scrams	1.0	1.0	0	0	0	0	0	0
Critical hours	2178.4	2190.9	1934.3	1239.4	2208.0	2209.0	2160.0	2183.0
Indicator value	**1.8**	**2.4**	**1.6**	**1.9**	**0.9**	**0**	**0**	**0**

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

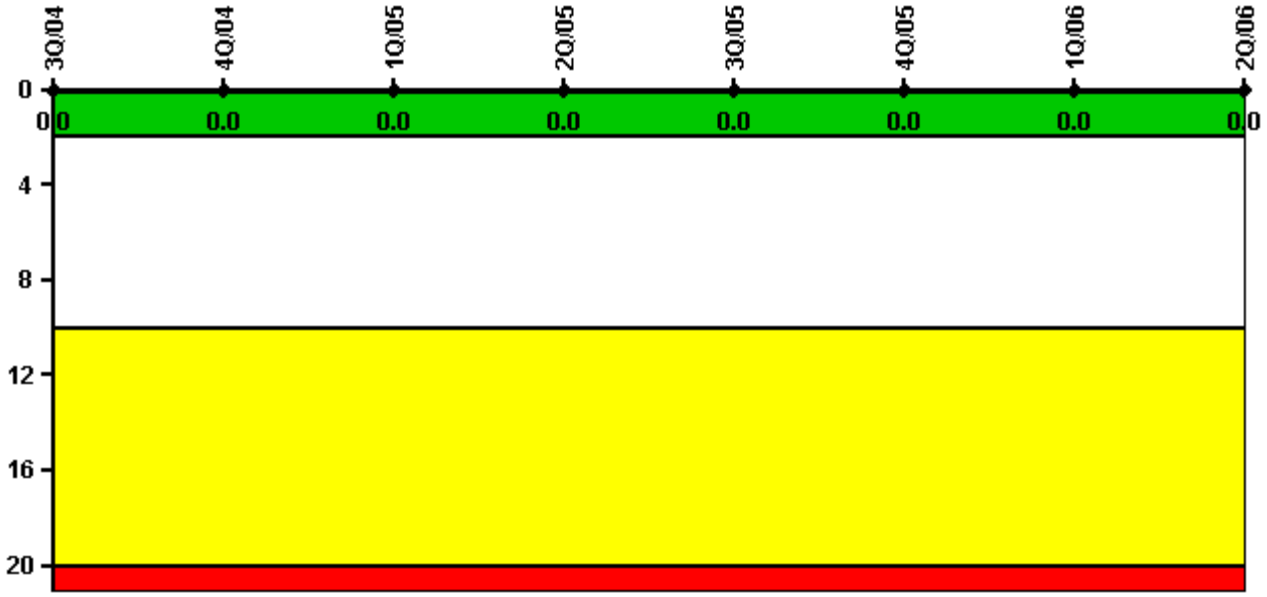

Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
Scrams	0	0	0	0	0	0	0	0
Indicator value	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

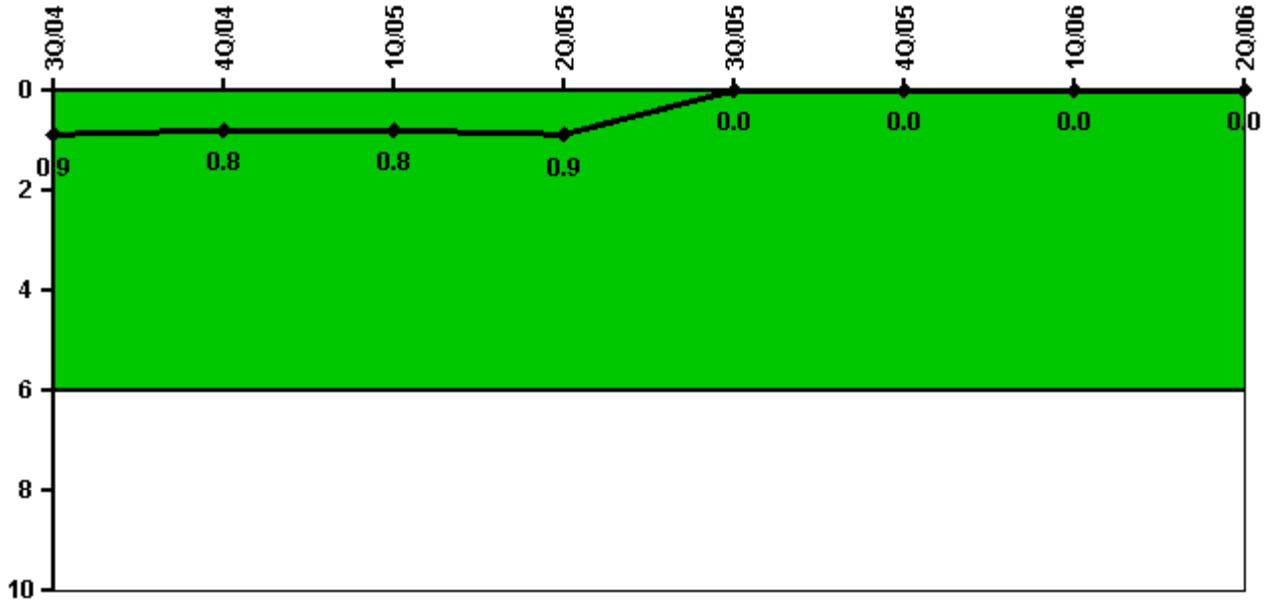

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
Unplanned power changes	1.0	0	0	0	0	0	0	0
Critical hours	2178.4	2190.9	1934.3	1239.4	2208.0	2209.0	2160.0	2183.0
Indicator value	**0.9**	**0.8**	**0.8**	**0.9**	**0**	**0**	**0**	**0**

Licensee Comments: none

Safety System Functional Failures (PWR)

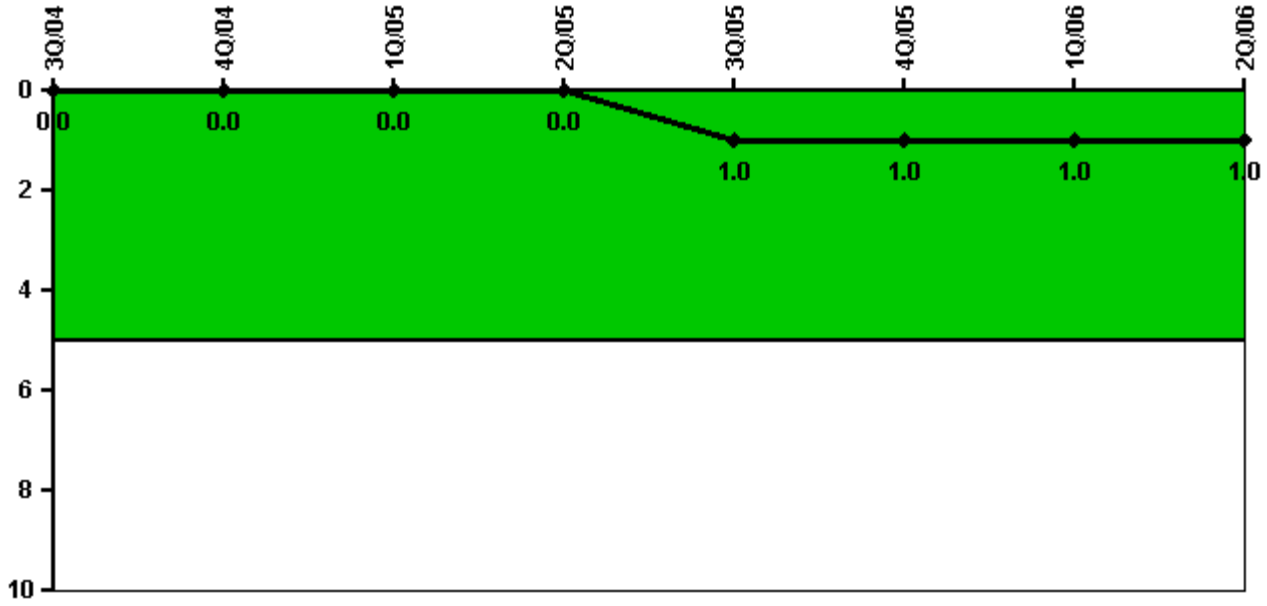

Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
Safety System Functional Failures	0	0	0	0	1	0	0	0
Indicator value	**0**	**0**	**0**	**0**	**1**	**1**	**1**	**1**

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
UAI (ΔCDF)								1.00E-06
URI (ΔCDF)								-2.70E-06
PLE								NO
Indicator value								**-1.70E-06**

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
UAI (ΔCDF)								1.10E-07
URI (ΔCDF)								-8.30E-08
PLE								NO
Indicator value								**2.70E-08**

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
UAI (ΔCDF)								3.40E-08
URI (ΔCDF)								-1.70E-07
PLE								NO
Indicator value								**-1.36E-07**

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
UAI (ΔCDF)								2.00E-07
URI (ΔCDF)								-2.70E-07
PLE								NO
Indicator value								**-7.00E-08**

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
UAI (ΔCDF)								5.30E-08
URI (ΔCDF)								7.80E-07
PLE								NO
Indicator value								**8.33E-07**

Licensee Comments: none

Reactor Coolant System Activity

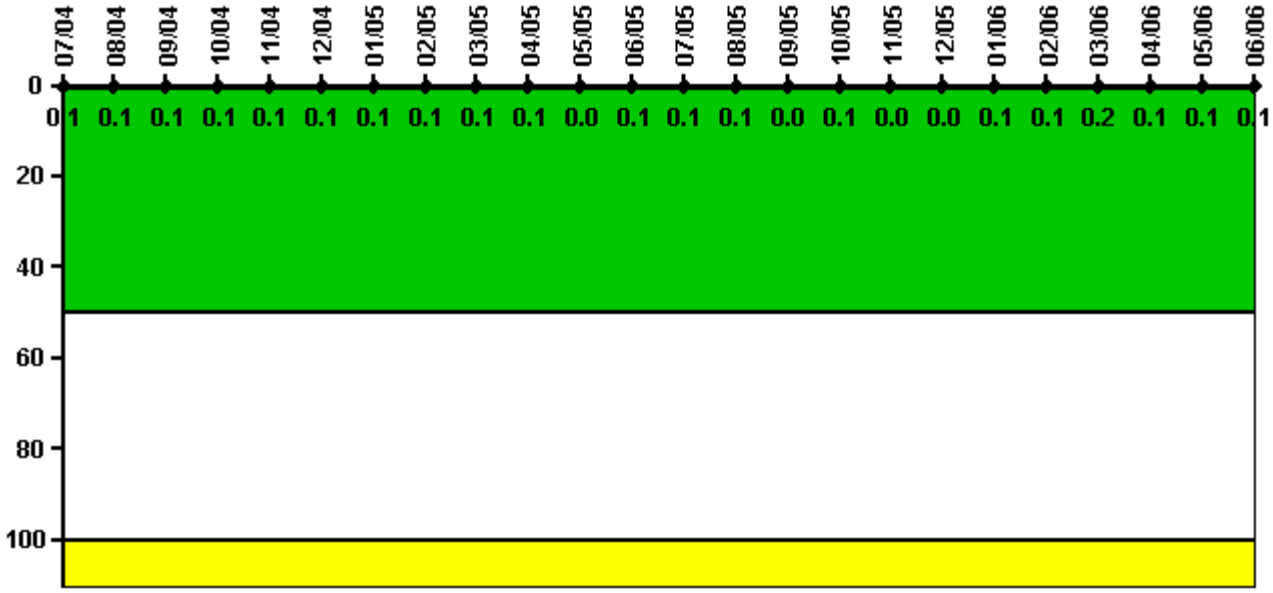

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/04	8/04	9/04	10/04	11/04	12/04	1/05	2/05	3/05	4/05	5/05	6/05
Maximum activity	0.001000	0.001000	0.001000	0.001000	0.001000	0.001000	0.001000	0.001000	0.001000	0.001000	0.000400	0.000500
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	**0.1**	**0.1**	**0.1**	**0.1**	**0.1**	**0.1**	**0.1**	**0.1**	**0.1**	**0.1**	**0**	**0.1**

Reactor Coolant System Activity	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06	4/06	5/06	6/06
Maximum activity	0.000500	0.000500	0.000400	0.000500	0.000400	0.000400	0.000500	0.000600	0.001600	0.000500	0.000800	0.000800
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	**0.1**	**0.1**	**0**	**0.1**	**0**	**0**	**0.1**	**0.1**	**0.2**	**0.1**	**0.1**	**0.1**

Licensee Comments: none

Reactor Coolant System Leakage

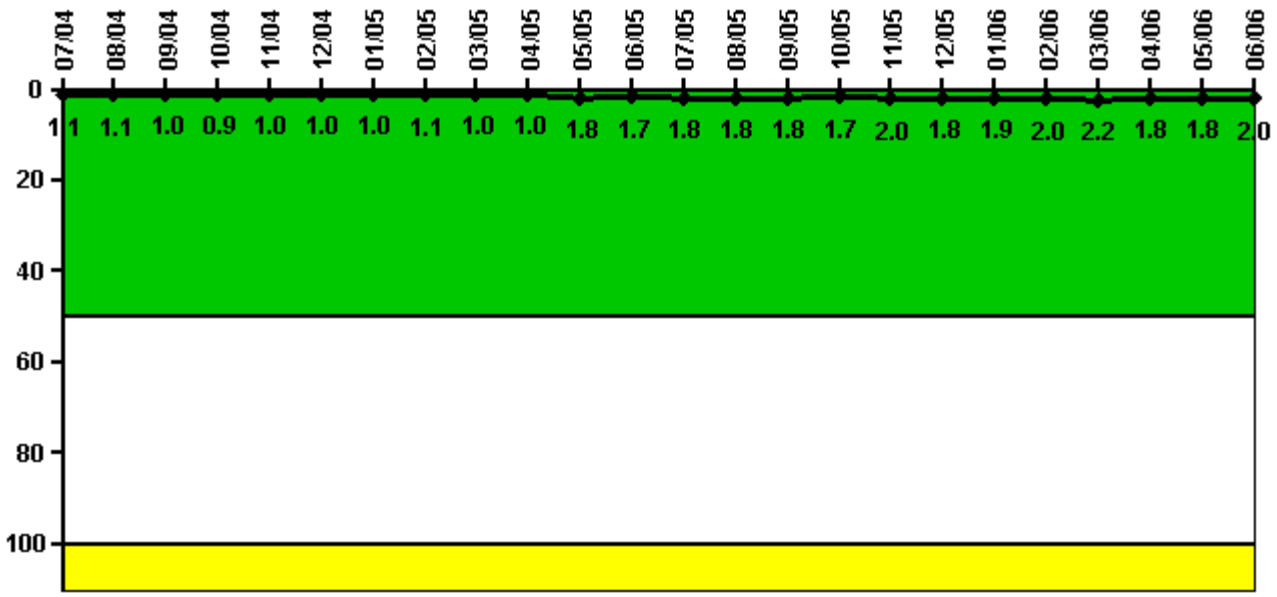

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/04	8/04	9/04	10/04	11/04	12/04	1/05	2/05	3/05	4/05	5/05	6/05
Maximum leakage	0.110	0.110	0.100	0.090	0.100	0.100	0.100	0.110	0.100	0.100	0.180	0.170
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	**1.1**	**1.1**	**1.0**	**0.9**	**1.0**	**1.0**	**1.0**	**1.1**	**1.0**	**1.0**	**1.8**	**1.7**

Reactor Coolant System Leakage	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06	4/06	5/06	6/06
Maximum leakage	0.180	0.180	0.180	0.170	0.200	0.180	0.190	0.200	0.220	0.180	0.180	0.200
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	**1.8**	**1.8**	**1.8**	**1.7**	**2.0**	**1.8**	**1.9**	**2.0**	**2.2**	**1.8**	**1.8**	**2.0**

Licensee Comments: none

Drill/Exercise Performance

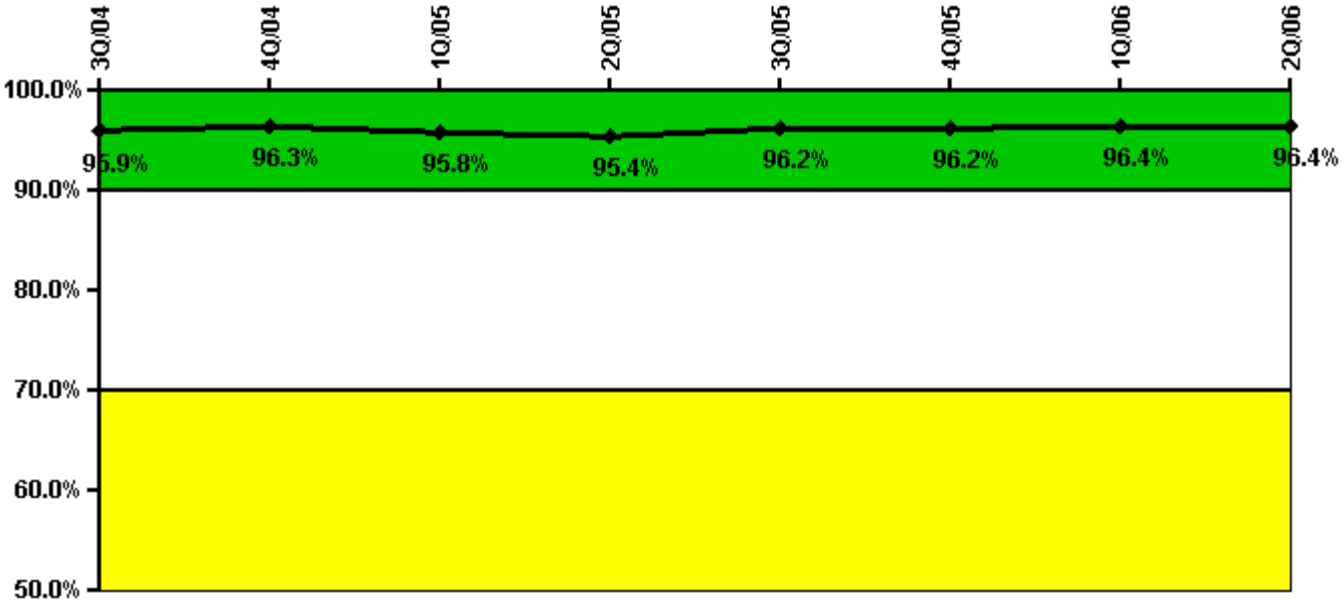

Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
Successful opportunities	28.0	48.0	19.0	15.0	49.0	80.0	20.0	39.0
Total opportunities	28.0	49.0	22.0	16.0	49.0	83.0	22.0	40.0
Indicator value	**95.9%**	**96.3%**	**95.8%**	**95.4%**	**96.2%**	**96.2%**	**96.4%**	**96.4%**

Licensee Comments: none

ERO Drill Participation

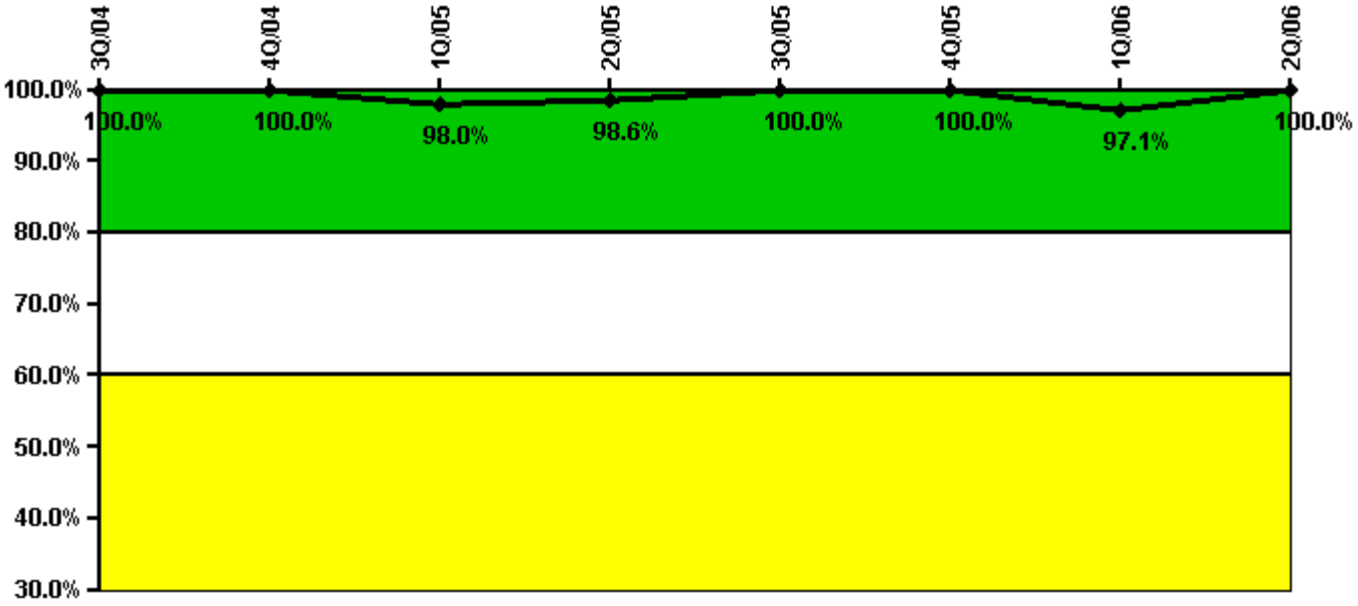

Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
Participating Key personnel	46.0	46.0	48.0	69.0	69.0	68.0	68.0	69.0
Total Key personnel	46.0	46.0	49.0	70.0	69.0	68.0	70.0	69.0
Indicator value	**100.0%**	**100.0%**	**98.0%**	**98.6%**	**100.0%**	**100.0%**	**97.1%**	**100.0%**

Licensee Comments: none

Alert & Notification System

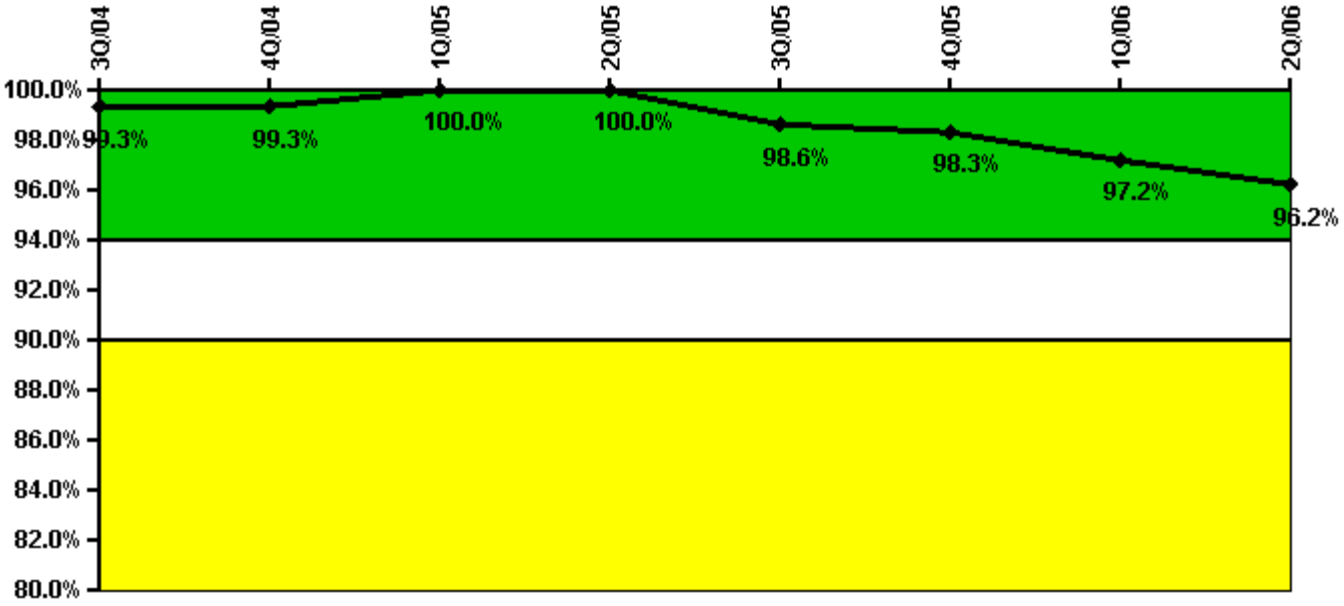

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
Successful siren-tests	77	66	77	66	73	65	74	63
Total sirens-tests	77	66	77	66	77	66	77	66
Indicator value	**99.3%**	**99.3%**	**100.0%**	**100.0%**	**98.6%**	**98.3%**	**97.2%**	**96.2%**

Licensee Comments: none

Occupational Exposure Control Effectiveness

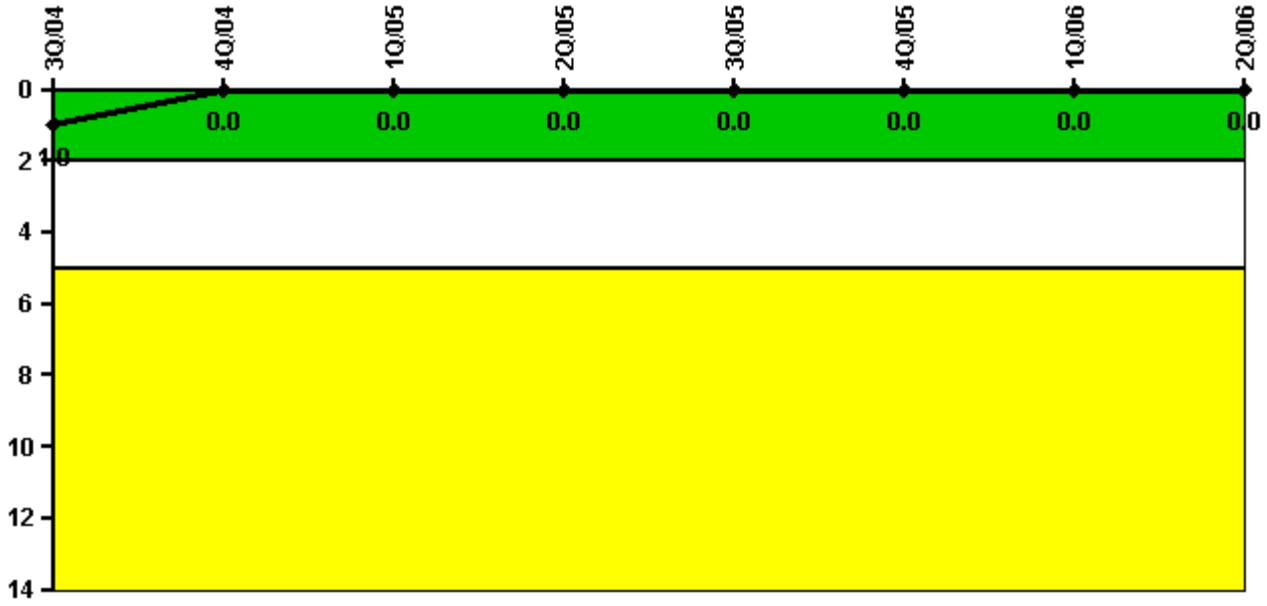

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	**1**	**0**	**0**	**0**	**0**	**0**	**0**	**0**

Licensee Comments: none

RETS/ODCM Radiological Effluent

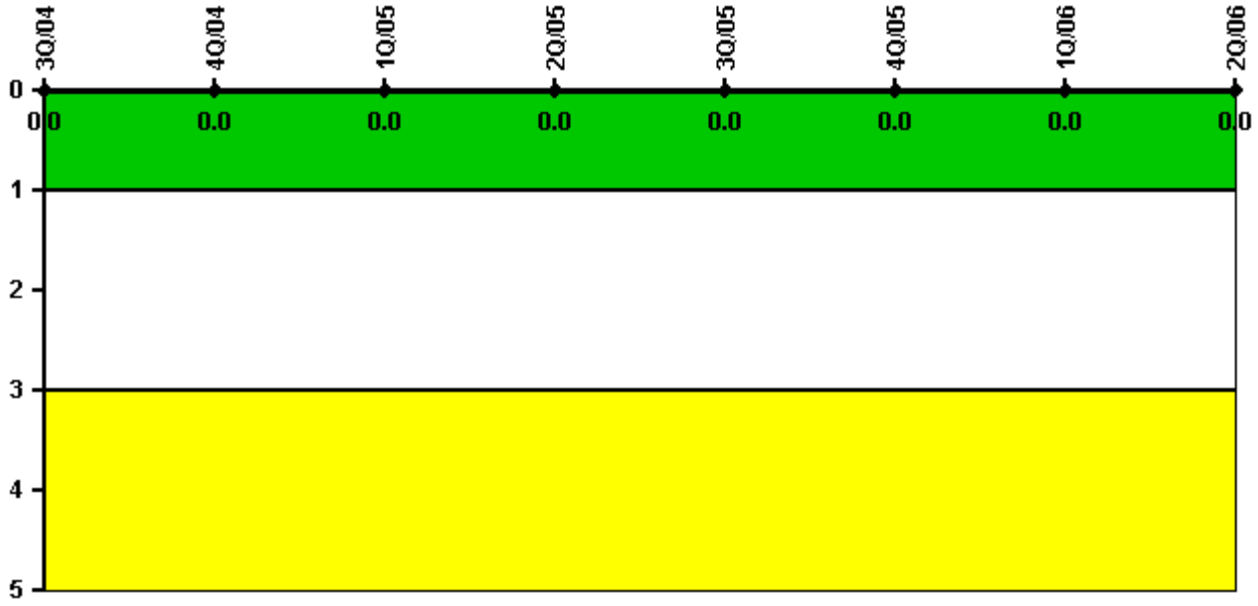

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**

Licensee Comments: none

Physical Protection information not publicly available.

Last Modified: August 2, 2006