



served on committees advising US government agencies. To illustrate my expertise, I provide more detailed information on my experience in the following three paragraphs.

5. During the period 1978-1979, I served on an international review group commissioned by the government of Lower Saxony (a state in Germany) to evaluate a proposal for a nuclear fuel cycle center at Gorleben. I led the subgroup that examined accident risks and alternative options with lower risk. One of the risk issues that I identified and analyzed was the potential for an exothermic reaction of fuel cladding in a high-density fuel pool if water is lost. I identified partial loss of water as a more severe condition than total loss of water. I identified and described alternative fuel storage options with lower risk. The Lower Saxony government accepted my findings and ruled that high-density pool storage was not an acceptable option at Gorleben. As a direct result, policy throughout Germany has been to use dry storage, rather than high-density pool storage, for away-from-reactor storage of spent fuel.


6. During the period 1986-1991, I was commissioned by environmental groups to assess the safety of the military production reactors at the Savannah River Site, and to identify and assess alternative options for the production of tritium for the US nuclear arsenal. Initially, much of the relevant information was classified or otherwise inaccessible to the public. Nevertheless, I addressed safety issues through analyses that were recognized as accurate by nuclear safety officials at the US Department of Energy (DOE). I eventually concluded that the Savannah River reactors could not meet the safety objectives set for them by DOE. DOE subsequently reached the same conclusion. The current national policy for tritium production is to employ commercial reactors, an option that I had concluded was technically attractive but problematic from the perspective of nuclear weapons proliferation.

7. In 1977, and again during the period 1996-1998, I examined the safety of nuclear fuel reprocessing and liquid high-level waste management facilities at the Sellafield site in the UK. My investigation in the latter period was supported by a consortium of local governments in Ireland and the UK, and my findings were presented at briefings in the UK and Irish parliaments. I identified safety issues that were not addressed in any publicly available literature about the Sellafield site. As a direct result of my investigation, the UK Nuclear Installations Inspectorate (NII) required the operator of the Sellafield site to conduct extensive safety analyses. These analyses, which are ongoing, have confirmed the significance of the safety issues that I identified. The publication of an interim report by NII is expected in March of 2000.

\*\*\*\*\*

I declare, under penalty of perjury, that the foregoing facts provided in my Declaration are true and correct to the best of my knowledge and belief, and that the opinions expressed herein are based on my best professional judgment.

Executed on 31 January 2000.

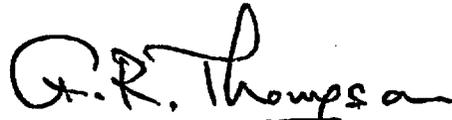  
Gordon Thompson

## INSTITUTE FOR RESOURCE AND SECURITY STUDIES

### Curriculum Vitae: GORDON R. THOMPSON

July 1999

#### Professional expertise

Consulting technical and policy analyst in the fields of energy, environment, sustainable development, and international security.

#### Education

- D.Phil. in applied mathematics, Oxford University (Balliol College), 1973.
- B.E. in mechanical engineering, University of New South Wales, Sydney, Australia, 1967.
- B.Sc. in mathematics & physics, University of New South Wales, 1966.

#### Current appointment

- Executive director, Institute for Resource & Security Studies (IRSS), Cambridge, MA.

#### Project sponsors and tasks (selected)

- Orange County, NC, 1999: assessed safety issues associated with spent fuel storage at the Harris nuclear plant.
- Government of Ireland, 1998-1999: developed framework for assessment of impacts and alternative options associated with nuclear fuel reprocessing.
- Clark University, Worcester, MA, 1998-1999: participated in review of a foundation's grant-making related to climate change.
- UN High Commissioner for Refugees, 1998: developed a strategy for conflict management in the CIS region.
- General Council of County Councils (Ireland), W Alton Jones Foundation (USA), and Nuclear Free Local Authorities (UK), 1996- 1998: assessed safety and economic issues of nuclear fuel reprocessing in the UK; assessed alternative options.
- Environmental School, Clark University, Worcester, MA, 1996: session leader at the Summer Institute, "Local Perspectives on a Global Environment".

*Curriculum Vitae for Gordon R. Thompson*  
*July 1999*

- Greenpeace Germany, Hamburg, 1995-1996: a study on war, terrorism and nuclear power plants.
- HKH Foundation, New York, and Winston Foundation for World Peace, Washington, DC, 1994-1996: studies and workshops on preventive action and its role in US national security planning.
- Carnegie Corporation of New York, Winston Foundation for World Peace, Washington, DC, and others, 1995: collaboration with the Organization for Security and Cooperation in Europe to facilitate improved coordination of activities and exchange of knowledge in the field of conflict management.
- World Bank, 1993-1994: a study on management of data describing the performance of projects funded by the Global Environment Facility (joint project of IRSS and Clark University).
- International Physicians for the Prevention of Nuclear War, 1993-1994: a study on the international control of weapons-usable fissile material.
- Government of Lower Saxony, Hannover, Germany, 1993: analysis of standards for radioactive waste disposal.
- University of Vienna (using funds supplied by the Austrian government), 1992: review of radioactive waste management at the Dukovany nuclear plant, Czech Republic.
- Sandia National Laboratories, 1992-1993: advice to the US Department of Energy's Office of Foreign Intelligence.
- US Department of Energy and Battelle Pacific Northwest Laboratories, 1991-1992: advice for the Intergovernmental Panel on Climate Change regarding the design of an information system on technologies that can limit greenhouse gas emissions (joint project of IRSS, Clark University and the Center for Strategic and International Studies).
- Winston Foundation for World Peace, Boston, MA, and other funding sources, 1992-1993: development and publication of recommendations for strengthening the International Atomic Energy Agency.
- MacArthur Foundation, Chicago, IL, W. Alton Jones Foundation, Charlottesville, VA, and other funding sources, 1984-1993: policy analysis and public education on a "global approach" to arms control and disarmament.
- Energy Research Foundation, Columbia, SC, and Peace Development Fund, Amherst, MA, 1988-1992: review of the US government's tritium production (for nuclear weapons) and its implications.
- Coalition of Environmental Groups, Toronto, Ontario (using funds supplied by Ontario Hydro under the direction of the Ontario government), 1990-1993: coordination and conduct of analysis and preparation of testimony on accident risk of nuclear power plants.
- Greenpeace International, Amsterdam, Netherlands, 1988-1990: review of probabilistic risk assessment for nuclear power plants.

*Curriculum Vitae for Gordon R. Thompson*  
*July 1999*

- Bellerive Foundation, Geneva, Switzerland, 1989-1990: planning for a June 1990 colloquium on disarmament and editing of proceedings.
- Iler Research Institute, Harrow, Ontario, 1989-1990: analysis of regulatory response to boiling-water reactor accident potential.
- Winston Foundation for World Peace, Boston, MA, and other funding sources, 1988-1989: analysis of future options for NATO (joint project of IRSS and the Institute for Peace and International Security).
- Nevada Nuclear Waste Project Office, Carson City, NV (via Clark University, Worcester, MA), 1989-1990: analyses of risk aspects of radioactive waste management and disposal.
- Ontario Nuclear Safety Review (conducted by the Ontario government), Toronto, Ontario, 1987: review of safety aspects of CANDU reactors.
- Washington Department of Ecology, Olympia, WA, 1987: analysis of risk aspects of a proposed radioactive waste repository at Hanford.
- Natural Resources Defense Council, Washington, DC, 1986-1987: preparation of testimony on hazards of the Savannah River Plant.
- Lakes Environmental Association, Bridgton, ME, 1986: analysis of federal regulations for disposal of radioactive waste.
- Greenpeace Germany, Hamburg, 1986: participation in an international study on the hazards of nuclear power plants.
- Three Mile Island Public Health Fund, Philadelphia, PA, 1983-1989: studies related to the Three Mile Island nuclear plant.
- Attorney General, Commonwealth of Massachusetts, Boston, MA, 1984-1989: analyses of the safety of the Seabrook nuclear plant.
- Union of Concerned Scientists, Cambridge, MA, 1980-1985: studies on energy demand and supply, nuclear arms control, and the safety of nuclear installations.
- Conservation Law Foundation of New England, Boston, MA, 1985: preparation of testimony on cogeneration potential at a Maine papermill.
- Town & Country Planning Association, London, UK, 1982-1984: coordination and conduct of a study on safety and radioactive waste implications of the proposed Sizewell nuclear plant.
- US Environmental Protection Agency, Washington, DC, 1980-1981: assessment of the cleanup of Three Mile Island Unit 2 nuclear plant.
- Center for Energy & Environmental Studies, Princeton University, Princeton, NJ, and Solar Energy Research Institute, Golden, CO, 1979-1980: studies on the potentials of renewable energy sources.
- Government of Lower Saxony, Hannover, FRG, 1978-1979: coordination and conduct of studies on safety aspects of the proposed Gorleben nuclear fuel cycle center.

*Curriculum Vitae for Gordon R. Thompson*  
July 1999

Other experience (selected)

- Principal investigator, project on "Exploring the Role of 'Sustainable Cities' in Preventing Climate Disruption", involving IRSS and three other organizations, 1990-1991.
- Visiting fellow, Peace Research Centre, Australian National University, 1989.
- Principal investigator, Three Mile Island emergency planning study, involving IRSS and Clark University, Worcester, MA, 1987-1989.
- Co-leadership (with Paul Walker) of a study group on nuclear weapons proliferation, Institute of Politics, Harvard University, 1981.
- Foundation (with others) of an ecological political movement in Oxford, UK, which contested the 1979 Parliamentary election.
- Conduct of cross-examination and presentation of evidence, on behalf of the Political Ecology Research Group, at the 1977 Public Inquiry into proposed expansion of the reprocessing plant at Windscale, UK.
- Conduct of research on plasma theory (while a PhD candidate), as an associate staff member, Culham Laboratory, UK Atomic Energy Authority, 1969-1973.
- Service as a design engineer on coal-fired plants, New South Wales Electricity Commission, Sydney, Australia, 1968.

Publications (selected)

- *Risks and Alternative Options Associated with Spent Fuel Storage at the Shearon Harris Nuclear Power Plant*, a report for Orange County, NC, February 1999.
- *High Level Radioactive Liquid Waste at Sellafield: Risks, Alternative Options and Lessons for Policy*, IRSS, Cambridge, MA, June 1998.
- "Science, democracy and safety: why public accountability matters", in F. Barker (ed), *Management of Radioactive Wastes: Issues for local authorities*, Thomas Telford, London, 1998.
- "Conflict Management and the OSCE" (with Paula Gutlove), *OSCE/ODIHR Bulletin*, Volume 5, Number 3, Fall 1997.
- *Safety of the Storage of Liquid High-Level Waste at Sellafield* (with Peter Taylor), Nuclear Free Local Authorities, UK, November 1996.
- *Assembling Evidence on the Effectiveness of Preventive Actions, their Benefits, and their Costs: A Guide for Preparation of Evidence*, IRSS, Cambridge, MA, August 1996.
- *War, Terrorism and Nuclear Power Plants*, Working Paper No. 165, Peace Research Centre, Australian National University, Canberra, October 1996.

*Curriculum Vitae for Gordon R. Thompson*  
July 1999

- "The Potential for Cooperation by the OSCE and Non-Governmental Actors on Conflict Management" (with Paula Gutlove), *Helsinki Monitor*, Volume 6 (1995), Number 3.
- "Potential Characteristics of Severe Reactor Accidents at Nuclear Plants", "Monitoring and Modelling Atmospheric Dispersion of Radioactivity Following a Reactor Accident" (with Richard Sclove, Ulrike Fink and Peter Taylor), "Safety Status of Nuclear Reactors and Classification of Emergency Action Levels", and "The Use of Probabilistic Risk Assessment in Emergency Response Planning for Nuclear Power Plant Accidents" (with Robert Goble), in D. Golding, J. X. Kasperson and R. E. Kasperson (eds), *Preparing for Nuclear Power Plant Accidents*, Westview Press, Boulder, CO, 1995.
- *A Data Manager for the Global Environment Facility* (with Robert Goble), Environment Department, The World Bank, June 1994.
- *Preventive Diplomacy and National Security* (with Paula Gutlove), Winston Foundation for World Peace, Washington, DC, May 1994.
- *Opportunities for International Control of Weapons-Usable Fissile Material*, ENWE Paper #1, International Physicians for the Prevention of Nuclear War, Cambridge, MA, January 1994.
- "Article III and IAEA Safeguards", in F. Barnaby and P. Ingram (eds), *Strengthening the Non-Proliferation Regime*, Oxford Research Group, Oxford, UK, December 1993.
- *Risk Implications of Potential New Nuclear Plants in Ontario* (prepared with the help of eight consultants), a report for the Coalition of Environmental Groups, Toronto, submitted to the Ontario Environmental Assessment Board, November 1992 (3 volumes).
- *Strengthening the International Atomic Energy Agency*, Working Paper No. 6, IRSS, Cambridge, MA, September 1992.
- *Design of an Information System on Technologies that can Limit Greenhouse Gas Emissions* (with Robert Goble and F. Scott Bush), Center for Strategic and International Studies, Washington, DC, May 1992.
- *Managing Nuclear Accidents: A Model Emergency Response Plan for Power Plants and Communities* (with six other authors), Westview Press, Boulder, CO, 1992.
- "Let's X-out the K" (with Steven C. Sholly), *Bulletin of the Atomic Scientists*, March 1992, pp 14-15.
- "A Worldwide Programme for Controlling Fissile Material", and "A Global Strategy for Nuclear Arms Control", in F. Barnaby (ed), *Plutonium and Security*, Macmillan Press, UK, 1992.
- *No Restart for K Reactor* (with Steven C. Sholly), Working Paper No. 4, IRSS, Cambridge, MA, October 1991.
- *Regulatory Response to the Potential for Reactor Accidents: The Example of Boiling-Water Reactors*, Working Paper No. 3, IRSS, Cambridge, MA, February 1991.

*Curriculum Vitae for Gordon R. Thompson*  
July 1999

- *Peace by Piece: New Options for International Arms Control and Disarmament*, Working Paper No. 1, IRSS, Cambridge, MA, January 1991.
- *Developing Practical Measures to Prevent Climate Disruption* (with Robert Goble), CENTED Research Report No. 6, Clark University, Worcester, MA, August 1990.
- "Treaty a Useful Relic", *Bulletin of the Atomic Scientists*, July/August 1990, pp 32-33.
- "Practical Steps for the 1990s", in Sadruddin Aga Khan (ed), *Non-Proliferation in a Disarming World*, Proceedings of the Groupe de Bellerive's 6th International Colloquium, Bellerive Foundation, Geneva, Switzerland, 1990.
- *A Global Approach to Controlling Nuclear Weapons*, Occasional Paper published by the Institute for Resource and Security Studies, October 1989.
- *IAEA Safety Targets and Probabilistic Risk Assessment* (with three other authors), Greenpeace International, Amsterdam, August 1989.
- *New Directions for NATO* (with Paul Walker and Pam Solo), published jointly by IRSS and the Institute for Peace and International Security (both of Cambridge, MA), December 1988.
- "Verifying a Halt to the Nuclear Arms Race", in F. Barnaby (ed), *A Handbook of Verification Procedures*, Macmillan Press, UK, 1990.
- "Verification of a Cutoff in the Production of Fissile Material", in F. Barnaby (ed), *A Handbook of Verification Procedures*, Macmillan Press, UK, 1990.
- "Severe Accident Potential of CANDU Reactors," Consultant's Report in *The Safety of Ontario's Nuclear Power Reactors*, Ontario Nuclear Safety Review, Toronto, February 1988.
- *Nuclear-Free Zones* (edited with David Pitt), Croom Helm Ltd, Beckenham, UK, 1987.
- *Risk Assessment Review For the Socioeconomic Impact Assessment of the Proposed High-Level Nuclear Waste Repository at Hanford Site, Washington* (edited; written with five other authors), prepared for the Washington Department of Ecology, December 1987.
- *The Nuclear Freeze Revisited* (written with Andrew Haines), Nuclear Freeze and Arms Control Research Project, Bristol, UK, November 1986. Variants of the same paper have appeared as Working Paper No. 18, Peace Research Centre, Australian National University, Canberra, February 1987, and in *ADIU Report*, University of Sussex, Brighton, UK, Jan/Feb 1987, pp 6-9.
- *International Nuclear Reactor Hazard Study* (with fifteen other authors), Greenpeace, Hamburg, Federal Republic of Germany (2 volumes), September 1986.
- "What happened at Reactor Four" (the Chernobyl reactor

*Curriculum Vitae for Gordon R. Thompson*  
July 1999

- accident), *Bulletin of the Atomic Scientists*, August/September 1986, pp 26-31.
- *The Source Term Debate: A Report by the Union of Concerned Scientists* (with Steven C. Sholly), Union of Concerned Scientists, Cambridge, MA, January 1986.
  - "Checks on the spread" (a review of three books on nuclear proliferation), *Nature*, 14 November 1985, pp 127-128.
  - Editing of *Perspectives on Proliferation*, Volume I, August 1985, published by the Proliferation Reform Project, IRSS.
  - "A Turning Point for the NPT?", *ADIU Report*, University of Sussex, Brighton, UK, Nov/Dec 1984, pp 1-4.
  - "Energy Economics", in J. Dennis (ed), *The Nuclear Almanac*, Addison-Wesley, Reading, MA, 1984.
  - "The Genesis of Nuclear Power", in J. Tirman (ed), *The Militarization of High Technology*, Ballinger, Cambridge, MA, 1984.
  - *A Second Chance: New Hampshire's Electricity Future as a Model for the Nation* (with Linzee Weld), Union of Concerned Scientists, Cambridge, MA, 1983.
  - *Safety and Waste Management Implications of the Sizewell PWR* (prepared with the help of six consultants), a report to the Town & Country Planning Association, London, UK, 1983.
  - *Utility-Scale Electrical Storage in the USA: The Prospects of Pumped Hydro, Compressed Air, and Batteries*, Princeton University report PU/CEES #120, 1981.
  - *The Prospects for Wind and Wave Power in North America*, Princeton University report PU/CEES # 117, 1981.
  - *Hydroelectric Power in the USA: Evolving to Meet New Needs*, Princeton University report PU/CEES # 115, 1981.
  - Editing and part authorship of "Potential Accidents & Their Effects", Chapter III of *Report of the Gorleben International Review*, published in German by the Government of Lower Saxony, FRG, 1979—Chapter III available in English from the Political Ecology Research Group, Oxford, UK.
  - *A Study of the Consequences to the Public of a Severe Accident at a Commercial FBR located at Kalkar, West Germany*, Political Ecology Research Group report RR-1, 1978.

*Curriculum Vitae for Gordon R. Thompson*  
*July 1999*

Expert presentations and testimony (selected)

- UK Consensus Conference on Radioactive Waste Management, 1999: provided invited testimony on information and decision-making.
- Joint Committee on Public Enterprise and Transport, Irish Parliament, 1999: provided invited testimony on nuclear fuel reprocessing and international security.
- UK and Irish Parliaments, 1998: gave members' briefings on risks and alternative options associated with nuclear fuel reprocessing in the UK.
- Center for Russian Environmental Policy, Moscow, 1996: presentation at a forum in parallel with the G-7 Nuclear Safety Summit.
- Lacey Township Zoning Board, New Jersey, 1995: testimony regarding radioactive waste management.
- Ontario Court of Justice, Toronto, Ontario, 1993: testimony regarding Canada's Nuclear Liability Act.
- Oxford Research Group, seminar on "The Plutonium Legacy", Rhodes House, Oxford, UK, 1993: presentation on nuclear safeguards.
- Defense Nuclear Facilities Safety Board, Washington, DC, 1991: testimony regarding the proposed restart of K-reactor, Savannah River Site.
- Conference to consider amending the Partial Test Ban Treaty, United Nations, New York, 1991: presentation on a global approach to arms control and disarmament.
- US Department of Energy, hearing on draft EIS for new production reactor capacity, Columbia, SC, 1991: presentation on tritium need and implications of tritium production options.
- Society for Risk Analysis, 1990 annual meeting, New Orleans, special session on nuclear emergency planning: presentation on real-time techniques for anticipating emergencies.
- Parliamentarians' Global Action, 11th Annual Parliamentary Forum, United Nations, Geneva, 1990: presentation on the potential for multilateral nuclear arms control.
- Advisory Committee on Nuclear Facility Safety, public meeting, Washington, DC, 1989: submission on public access to information and on government accountability.
- Peace Research Centre, Australian National University, seminar on "Australia and the Fourth NPT Review Conference", Canberra, 1989: proposal of a universal nuclear weapons non-proliferation regime.
- Carnegie Endowment for International Peace, Conference on "Nuclear Non-Proliferation and the Role of Private Organizations", Washington, DC, 1989: options for reform of the non-proliferation regime.
- US Department of Energy, EIS scoping hearing, Columbia, SC, 1988: appropriate scope of an EIS for new production reactor capacity.

*Curriculum Vitae for Gordon R. Thompson*  
*July 1999*

- International Physicians for the Prevention of Nuclear War, 6th and 7th Annual Congresses, Koln, FRG, 1986 and Moscow, USSR, 1987: relationships between nuclear power and the threat of nuclear war.
- County Council, Richland County, SC, 1987: implications of severe reactor accidents at the Savannah River Plant.
- Maine Land Use Regulation Commission, 1985: cogeneration potential at facilities of Great Northern Paper Company.
- Interfaith Hearings on Nuclear Issues, Toronto, Ontario, 1984: options for Canada's nuclear trade and Canada's involvement in nuclear arms control.
- Sizewell Public Inquiry, UK, 1984: safety and radioactive waste implications of the proposed Sizewell nuclear plant.
- New Hampshire Public Utilities Commission, 1983: electricity demand and supply options for New Hampshire.
- Atomic Safety & Licensing Board, US Nuclear Regulatory Commission, 1983: use of filtered venting at the Indian Point nuclear plants.
- US National Advisory Committee on Oceans and Atmosphere, 1982: implications of ocean disposal of radioactive waste.
- Environmental & Energy Study Conference, US Congress, 1982: implications of radioactive waste management.

Miscellaneous

- Married, two children.
- Extensive experience in public speaking before professional and lay audiences, and in interviews with print and broadcast journalists.
- Author of numerous newspaper, newsletter, and magazine articles and book reviews.

Contact information

Institute for Resource and Security Studies  
27 Ellsworth Avenue, Cambridge, Massachusetts 02139, USA  
Phone: (617) 491-5177 Fax: (617) 491-6904 E-mail: irss@igc.org

\*\*\*\*\*

**INSTITUTE FOR RESOURCE AND SECURITY STUDIES**  
**27 Ellsworth Avenue, Cambridge, Massachusetts 02139, USA**  
**Phone: (617) 491-5177 Fax: (617) 491-6904**  
**Electronic mail: irss@igc.apc.org**

**RISKS AND ALTERNATIVE OPTIONS  
ASSOCIATED WITH  
SPENT FUEL STORAGE  
AT THE  
SHEARON HARRIS NUCLEAR POWER PLANT**

**A report**

**prepared for**

**Orange County  
North Carolina**

**by**

**Gordon Thompson**

**February 1999**

### **Acknowledgements**

**This report was prepared as part of a program of work by the Institute for Resource and Security Studies (IRSS) pursuant to a contract between IRSS and Orange County, North Carolina. The report was written by Gordon Thompson, the executive director of IRSS.**

**The author acknowledges help with the acquisition of information and documents, from Diane Curran, David Lochbaum, Mary MacDowell and the staff of the NRC public document room in Washington, DC. Paul Thames, county engineer of Orange County, has provided efficient oversight of the contract between IRSS and Orange County. Paula Gutlove of IRSS has assisted in the preparation of this report. Gordon Thompson is solely responsible for the content of the report.**

### **Abstract**

**Orange County, North Carolina, commissioned this report because the licensee of the Shearon Harris nuclear plant has requested an amendment of its operating license. The amendment would permit the activation of two currently unused spent fuel pools at Harris.**

**This report examines the risks and alternative options associated with spent fuel storage at Harris. The report identifies a potential for severe accidents at the Harris pools. Such accidents could release to the atmosphere an amount of cesium-137 an order of magnitude larger than the release from the 1986 Chernobyl accident. A severe accident at the Harris PWR, with containment failure or bypass, can be expected to initiate a large release from the fuel pools.**

**Alternative, safer options for spent fuel management are available. These options include dry storage of spent fuel, which is a well-established practice.**

## **1. Introduction**

Carolina Power & Light Company (CP&L) requested, in December 1998, an amendment of its operating license for the Shearon Harris nuclear plant. The amendment, if granted by the Nuclear Regulatory Commission (NRC), would permit the activation of two currently unused spent fuel pools at Harris. In January 1999, Orange County commissioned this report, which examines the risks and alternative options associated with spent fuel storage at Harris.

### *Structure of this report*

This report has two major components. One component is a main report which is comparatively brief and is intended for a non-specialist audience. The second component is a set of five appendices. These appendices contain detailed, technical material and citations to technical literature. Unless otherwise indicated, discussion in the main report rests upon the more detailed discussion in the appendices.

### *What is spent fuel?*

Figure 1 shows a fuel assembly of the type that is used in the Harris reactor.<sup>1</sup> The fuel rods are 12 feet long, and the assembly is 8.4 inches square. After a fuel assembly is discharged from a reactor, it is "spent" in the sense that it can no longer be used to generate power. However, at this point in its life the assembly is much more dangerous than when it entered the reactor. It emits heat and intense radiation, and contains a large inventory of radioactive material.

### *Remainder of this report*

The remainder of this main report begins with descriptions of the Harris plant (Section 2) and CP&L's intentions regarding the fuel pools at Harris (Section 3). Then, categories of potential accident at Harris are identified (Section 4), followed by descriptions of potential design-basis (Section 5) and severe (Section 6) accidents at the Harris pools. The offsite consequences of potential pool and reactor accidents are addressed in Section 7. Alternative options for spent fuel management are presented (Section 8), followed by a discussion of regulatory processes (Section 9). Conclusions are presented in Section 10.

---

<sup>1</sup> Figure 1 is adapted from: A V Nero, *A Guidebook to Nuclear Reactors*, University of California Press, 1979, page 79.

### **3. Proposed activation of fuel pools C and D**

CP&L seeks an amendment to its operating license so that it can activate pools C and D at Harris. By activating these pools, CP&L expects to have sufficient storage capacity at its three nuclear plants to accommodate all the spent fuel discharged by the four CP&L reactors (the Harris and Robinson PWRs and the two Brunswick BWRs) through the ends of their current operating licenses.

#### *Capacity and configuration of pools C and D*

CP&L plans to install racks in pool C in three campaigns (approximately in 2000, 2005 and 2014), to create a total capacity in this pool of 3,690 fuel assemblies. Thereafter, CP&L plans to install racks in pool D in two campaigns (approximately in 2016 and at a date to be determined), to create 1,025 spaces. Thus, the ultimate capacity of pools C and D will be 4,715 fuel assemblies. The center-center distance in the racks used in these pools will be 9.0 inches for PWR fuel and 6.25 inches for BWR fuel. In pool C, the space between the outermost racks and the pool wall will be 1-2 inches.

The PWR racks in pools C and D will have a smaller center-center distance than the racks in pools A and B (9.0 inches instead of 10.5 inches). This highly compact arrangement allows more PWR fuel to be placed in a given pool area but also has adverse implications for safety.

#### *Cooling and electrical supply for pools C and D*

The water in a spent fuel pool must be cooled and cleaned. Cooling is performed by circulating pool water through heat exchangers, where its heat is transferred to a secondary cooling system. At Harris, the secondary cooling system is the component cooling water (CCW) system. When the Harris plant was designed, the intention was that pools C and D would be cooled by the CCW system for Unit 2. Also, electricity would have been supplied to the circulating pumps at pools C and D from the electrical systems of Unit 2. However, Unit 2 was never built and its CCW and electrical systems do not exist.

CP&L's current plan is to cool pools C and D by completing their partially built cooling systems and connecting those systems to the Unit 1 CCW system. Electricity will be supplied to pools C and D from the electrical systems of Unit 1. The Unit 1 CCW system already provides cooling to pools A and B and serves other, important safety functions. For example, the Unit 1 CCW system provides cooling for the residual heat removal (RHR) system and reactor coolant pumps of the Unit 1 reactor.

address this situation, CP&L proposes an "alternative plan" to demonstrate that the previously completed piping and other equipment is adequate for its purpose. Nevertheless, the cooling systems for pools C and D will not satisfy prevailing code requirements.

#### **4. Types of potential accident at the Harris plant**

Most of the radioactive material at the Harris plant is either in the reactor or in the spent fuel pools. Thus, these locations are of primary concern when one considers the potential for accidents. This report focusses on the potential for accidents in the reactor or the pools. At present, pools C and D at Harris pose no accident potential, because they are unused.

Some potential accidents could cause injury to plant personnel, without causing any offsite effects. Other potential accidents could release radioactive material beyond the plant boundary, causing offsite effects. The radioactive material could be released as an atmospheric plume, or into ground or surface waters. This report focusses on accidents that release an atmospheric plume which travels beyond the plant boundary. Such a plume will contain radioactive material in the form of gases and small particles. As the plume travels downwind, the small particles will be deposited onto land, bodies of water, structures and vegetation.

#### *Design-basis and severe accidents*

A nuclear plant is designed to accommodate the effects of a specified set of accidents, known as "design-basis" accidents. If the plant is properly designed and constructed, if its equipment and operators function in the required manner, and if external influences (e.g., earthquakes) do not exceed specified levels, then the offsite effects of a design-basis accident will be small. Design-basis accidents and their anticipated effects are described in a Final Safety Analysis Report (FSAR) prepared and regularly updated by the licensee.

In the early years of the nuclear industry, some people equated design-basis accidents with "credible" accidents. However, research and operating experience soon revealed that accidents more severe than the design basis are credible. The first systematic study of the potential for severe accidents was the Reactor Safety Study, completed and published by the NRC in 1975. "Severe" accidents are conventionally defined as accidents involving substantial damage to fuel, with or without a substantial release of radioactivity to the environment.

The Three Mile Island (TMI) reactor accident of 1979 was a demonstration of the potential for severe accidents. Soon thereafter, the NRC promulgated

## **5. Design-basis pool accidents**

The Harris FSAR considers two types of design-basis accident in the Harris fuel pools. One type of accident involves the dropping of a fuel assembly, while the other type involves the dropping of a shipping cask (but not into a fuel pool). In both cases, the FSAR estimates that the release of radioactivity would be relatively small. This report does not review the FSAR analysis.

In its license amendment application, CP&L has considered some other potential accidents, including the dropping of a rack or a fuel pool gate.<sup>2</sup> CP&L's analysis of these accident scenarios is limited in scope. Accidents of this type may be in an intermediate class of severity, and that potential class deserves further analysis.<sup>3</sup> This report focusses on the potential for severe accidents.

It should be noted that the use of pools C and D at Harris will involve many additional cask, fuel and rack movements. These additional movements will increase the cumulative probability of accidents associated with such movements.

## **6. Severe pool accidents**

Spent fuel is stored in a compact, high-density configuration in pools A and B at Harris. CP&L's proposed activation of pools C and D will involve an even higher density of storage. Such high-density configurations inhibit heat loss from the fuel if water is partially or totally lost from a pool. As a result, partial or total loss of water can lead to an exothermic (heat-producing) reaction of the fuel cladding with air or steam. Such a reaction could liberate a large amount of radioactive material from the fuel.

Thus, two questions become important. First, what circumstances could cause a partial or total loss of water? This question is addressed in Appendix C. Second, will an exothermic reaction be initiated if water is lost? That question is addressed in Appendix D.

### *Potential for loss of water*

A variety of events could cause partial or total loss of water from the Harris pools. These events deserve the level of analysis that would be provided by a thorough PRA. Performing a pool accident PRA is beyond the scope of our

---

<sup>2</sup> License amendment application, Enclosure 7.

<sup>3</sup> A potential accident in this class, which deserves analysis, would involve the placement of a low-burnup or high-enrichment PWR assembly in the racks in pools C or D.

An exothermic reaction could propagate from one set of fuel assemblies to an adjacent set of assemblies that might not otherwise suffer such a reaction. The NRC's studies of propagation are incomplete, but they acknowledge the potential for propagation.

#### *Exothermic reactions in the Harris pools*

CP&L representatives have stated that spent fuel assemblies will not be placed in pools C and D at Harris until the assemblies have aged for 5 years after discharge. However, there is nothing in CP&L's license amendment application that prohibits the placement of more recently-discharged fuel in pools C and D. In any case, preliminary analysis suggests that partial water loss could initiate an exothermic reaction in fuel aged 10 years after discharge. Thus, exothermic reactions could occur in pools C and D.

For the purpose of estimating the potential consequences of a pool accident at Harris, this report considers two scenarios for exothermic reactions. One scenario involves fuel aged up to 3 years after discharge from a reactor, while the second scenario involves fuel aged up to 9 years after discharge from a reactor. In both cases, it is assumed that the entire inventory of cesium in the affected fuel assemblies would be released to the atmosphere. This assumption is consistent with NRC studies.

#### **7. Consequences of potential pool and reactor accidents**

This report focusses on accidents that release an atmospheric plume which travels beyond the plant boundary. The consequences of such a release can be estimated by site-specific computer models. Here, a simpler approach is used, but this approach is adequate to show the nature and scale of expected consequences. The approach is described in Appendix E.

#### *The role of cesium-137*

The consequences of a pool accident can be adequately illustrated by examining a release of only one radioisotope -- cesium-137. This isotope has a half-life of 30 years and is liberally released from damaged fuel. It dominates the offsite radiation exposure from the 1986 Chernobyl accident, and is a major contributor to radiation exposure attributable to fallout from the atmospheric testing of nuclear weapons in the 1950s and 1960s.

Three atmospheric releases of cesium-137 are postulated here for the purpose of examining consequences. First, a release of about 2 million Curies (2 MCi) corresponds to the most severe reactor accident identified in the Harris IPE. Second, a release of about 20 million Curies (20 MCi) corresponds to a pool

percent for males and 34 percent for females. The shape of the dose-response function is a subject of debate.

**8. Alternative options for spent fuel management**

The present mode of spent fuel storage in Harris pools A and B poses a major hazard. This hazard will be substantially increased if pools C and D are activated. CP&L has not properly characterized the present and potential hazard, nor has the company provided a systematic assessment of alternative options.

A situation like this calls for a systematic, comprehensive assessment of alternative options and their impacts. A full range of alternatives should be identified, and their impacts and other characteristics should be assessed. Performance of such an analysis is beyond the scope of the author's current work for Orange County. An abbreviated discussion is presented here.

*Options not reviewed here*

One option would be to cease operation of CP&L's nuclear plants. That option, which could be combined with other options for storage of CP&L's present stock of spent fuel, is not reviewed here. Another set of options would employ high-density pool storage but would introduce technical measures that sought to increase the reliability of the cooling systems for some or all of the Harris pools, or to decrease the potential for safety interactions between the pools and the reactor. Independent support systems for pools C and D, as mentioned in Section 3, would be in this class of options. Such options are not reviewed here.

*Options reviewed here*

This report focusses on two classes of options for spent fuel storage. One class involves dry storage of spent fuel, using proven technology. The second class, which could complement dry storage, involves low-density storage in pools. A combination of dry storage and low-density pool storage could offer a practical, proven means of dramatically decreasing the hazard posed by high-density pool storage at Harris.

*Dry storage*

The NRC has approved a variety of designs for the dry storage of spent fuel. These designs are described in Table 1, and their current use by licensees is

### *Summary*

CP&L could employ a spent fuel storage strategy which combines dry storage with low-density pool storage. Some or all of pools A, B, C and D at Harris would be used in a low-density configuration. If appropriately designed and implemented, this strategy could dramatically reduce the hazard posed by present and proposed fuel storage arrangements at Harris.

#### **9. Addressing risks and alternatives in the regulatory arena**

Orange County has requested the NRC to hold a hearing regarding CP&L's license amendment application, and the NRC has established a Licensing Board for this case. These actions have initiated a regulatory process which has been employed many times before. A review of this process is beyond the scope of this report, but some brief observations may be helpful.


The licensing process will typically assume that regulatory decisions taken in the past were correct. Thus, the existing operations at Harris pools A and B might be held to establish a precedent for the proposed operations at pools C and D. However, this report shows that the NRC has not properly analyzed the potential for severe pool accidents at a generic level. This point may or may not influence the NRC's regulatory process, but it deserves continuing emphasis through all available channels.

At Harris, and nationwide, there is a need for a thorough assessment of the hazards associated with high-density pool storage, and of alternative options which could pose a lower hazard. Orange County would provide an important public service if it could persuade the NRC or another body to conduct such an assessment, perhaps in the form of an environmental impact statement. There has been discussion about the US Department of Energy taking title to the nation's spent fuel, while the fuel remains at plant sites. This move could provide an opportunity for a thorough assessment of risks and options, and for the adoption of safer means of fuel storage.

#### **10. Conclusions**

**C1** Given the present and proposed configuration of spent fuel storage in the Harris pools, partial or total loss of water from the pools could initiate exothermic reactions of fuel cladding, in any or all of pools A, B, C and D.

**C2** Partial or total loss of water from the Harris pools could occur through a variety of events including acts of malice, and would be an almost certain outcome of a severe reactor accident at Harris involving containment failure

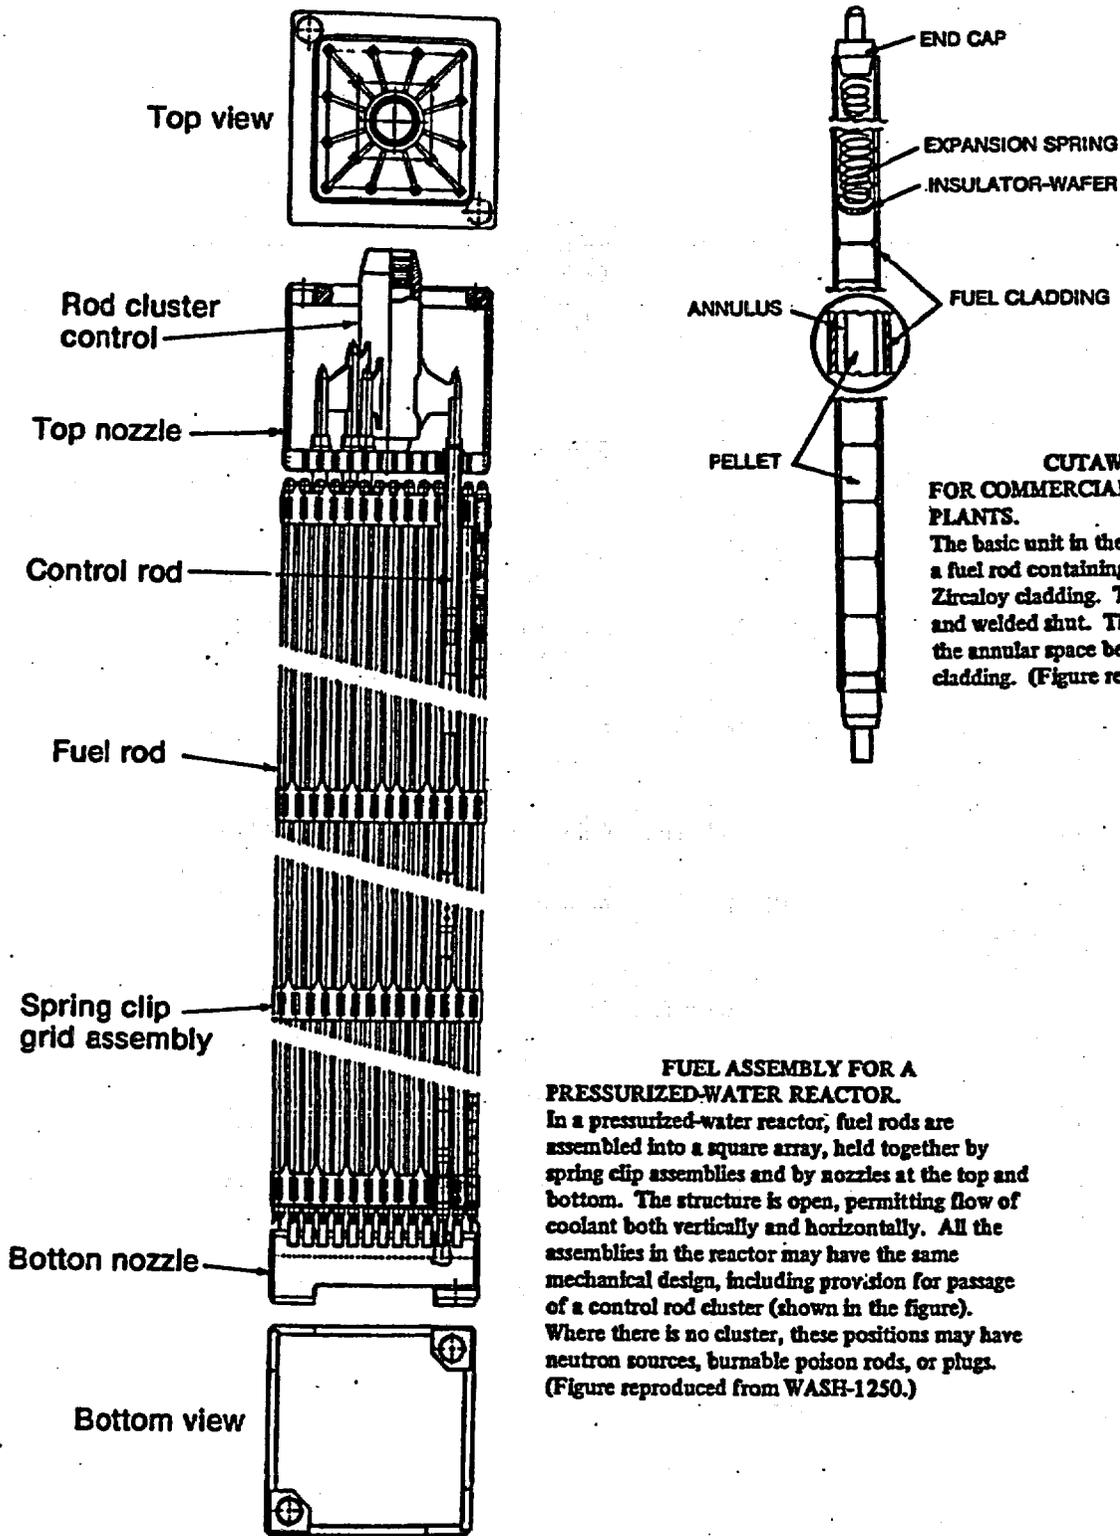

**FUEL ASSEMBLY FOR A PRESSURIZED-WATER REACTOR.**

In a pressurized-water reactor, fuel rods are assembled into a square array, held together by spring clip assemblies and by nozzles at the top and bottom. The structure is open, permitting flow of coolant both vertically and horizontally. All the assemblies in the reactor may have the same mechanical design, including provision for passage of a control rod cluster (shown in the figure). Where there is no cluster, these positions may have neutron sources, burnable poison rods, or plugs. (Figure reproduced from WASH-1250.)

Figure 1

Fuel for a pressurized-water reactor

*Risks & alternative options re. spent-fuel storage at Harris*  
*Page 17*

Reactor Name Utility	Date Issued	Vendor	Storage Model
Surry 1, 2 Virginia Electric & Power Company	07/02/1986	Generals Nuclear Systems, Incorporated	Metal Cask CASTOR V/21 TN-32 NAC-128 CASTOR X/33 MC-10
H. B. Robinson 2 Carolina Power & Light Company	08/13/1986	Transnuclear West, Incorporated	Concrete Module NUHOMS-7P
Oconee 1, 2, 3 Duke Energy Company	01/29/1990	Transnuclear West, Incorporated	Concrete Module NUHOMS-24P
Fort St. Vrain* Public Service Company of Colorado	11/04/1991	FW Energy Applications, Incorporated	Modular Vault Dry Store
Calvert Cliffs 1, 2 Baltimore Gas & Electric Company	11/25/1992	Transnuclear West, Incorporated	Concrete Module NUHOMS-24P
Palisades Consumers Energy	Under General License	Pacific Sierra Nuclear Associates	Ventilated Cask VSC-24
Prairie Island 1, 2 Northern States Power Company	10/19/1993	Transnuclear West, Incorporated	Metal Cask TN-40
Point Beach Wisconsin Electric Power Company	Under General License	Sierra Nuclear Corporation	Ventilated Cask VSC-24
Davis-Besse Toledo Edison Company	Under General License	Transnuclear West, Incorporated	Concrete Module NUHOMS-24P
Arkansas Nuclear One Energy Operations	Under General License	Sierra Nuclear Corporation	Ventilated Cask VSC-24
North Anna Virginia Electric & Power Company	06/30/98	Transnuclear West, Incorporated	Metal Cask TN-32

\*Plant undergoing decommissioning

**Table 2**

**NRC dry spent fuel storage licensees**

—  
—

**RISKS AND ALTERNATIVE OPTIONS  
ASSOCIATED WITH SPENT FUEL STORAGE AT THE  
SHEARON HARRIS NUCLEAR POWER PLANT**

**Appendix A**

**Spent fuel management at the Harris plant**

**1. Introduction**

This appendix summarizes present and proposed arrangements for managing spent fuel at the Shearon Harris plant. Carolina Power & Light Company (CP&L), the licensee for the plant, proposes to introduce new arrangements for spent fuel management. For that purpose, CP&L seeks an amendment to the plant's operating license. Unless specified otherwise, information presented here is drawn from CP&L's application to amend the Harris license, from CP&L's Final Safety Analysis Report (FSAR) for the Harris plant, or from viewgraphs shown by CP&L personnel during meetings with staff of the Nuclear Regulatory Commission (NRC).<sup>1</sup>

**2. Present and proposed spent fuel storage capacity**

The Harris plant features one pressurized-water reactor (PWR). The core of this reactor contains 157 fuel assemblies, with a center-center distance of about 8.5 inches. The Harris plant was to have four units but only the first unit was built. (A unit consists of a reactor, a turbine-generator and associated equipment.) A fuel handling building was built to serve all four units. This building contains four fuel pools (A, B, C, D), a cask loading pool and three fuel transfer canals, all interconnected but separable by gates. Figure A-1 shows a plan view of the interior of the fuel handling building.

*Pools A and B*

Pools A and B contain fuel racks, and are in regular use. CP&L says that fresh fuel, and spent fuel recently discharged from the Harris reactor, is stored in pool A. Fuel examination and repair are performed in an open space in pool

---

<sup>1</sup> Meetings between NRC staff and CP&L representatives, to discuss the proposed license amendment, were held on 3 March 1998 and 16 July 1998.

### *Summary*

Table A-1 summarizes the present and proposed storage capacity in the Harris pools. At present, pools A and B have a combined, potential capacity of 3,669 assemblies. The proposed, combined capacity of pools C and D will be 4,715 assemblies. Thus, activation of pools C and D will represent an increase of about 130 percent in the number of fuel assemblies that could be stored at Harris.

### **3. Support services for pools C and D**

The water in a spent fuel pool must be cooled and cleaned. Figure A-2 provides a schematic view of typical cooling and cleanup systems. It will be noted that pool water is circulated through heat exchangers, where its heat is transferred to a secondary cooling system. At Harris, the secondary cooling system is the component cooling water (CCW) system. Water in the secondary system is in turn circulated through heat exchangers, where its heat is transferred to a tertiary cooling system. At Harris, the tertiary cooling system is the service water (SW) system.

When the Harris plant was designed, the intention was that pools C and D would be cooled by the CCW system for the second unit. That unit was never built and its CCW system does not exist. Thus, CP&L plans to cool pools C and D by completing their partially built cooling systems and connecting those systems to the CCW system of the first unit. The Unit 1 CCW system already provides cooling to pools A and B and serves other, important safety functions. For example, the Unit 1 CCW system provides cooling for the residual heat removal (RHR) system and reactor coolant pumps of the Unit 1 reactor.

### *The original design concept for Harris*

In the Harris plant's original design concept, pools A and B would have served Units 1 and 4, while pools C and D would have served Units 2 and 3. There would have been a separate, fully-redundant, 100 percent-capacity cooling and water cleanup system for each pair of pools (A+B and C+D). Cooling of pools C and D would have been provided by the CCW system of Unit 2. Electrical power for the pumps that circulate water from the C and D pools through heat exchangers (see Figure A-2) would have been supplied by the Unit 2 electrical systems. Pools A and B would have been supported by the CCW and electrical systems of Unit 1.

*Risks & alternative options re. spent fuel storage at Harris*  
*Appendix A*  
*Page A-5*

upgrade will commence in mid-1999 and will be completed in early 2001, one year after the company expects pool C to enter service.

*Safety implications*

In order to exploit the margin in the existing CCW system so as to cool pools C and D, CP&L may be obliged to require its operators to divert some CCW flow from the RHR heat exchangers during the recirculation phase of a design-basis loss-of-coolant accident (LOCA) event at the Harris reactor.<sup>5</sup> This is a safety issue because, during the recirculation phase of a LOCA, operation of the RHR system is essential to keeping the reactor core and containment in a safe condition. CP&L's exploitation of the margin in the existing CCW system is deemed by CP&L and NRC to constitute an "unreviewed safety question".<sup>6</sup>

In Enclosure 9 of its license amendment application, CP&L provides a brief description of the analysis that it has performed to demonstrate that an additional load of 1.0 million BTU/hour is within the marginal capacity of the Unit 1 CCW system. That analysis is said by CP&L to take the form of a 10CFR50.59 Safety Evaluation. The description in Enclosure 9 raises more questions than it answers, and does not address the practical issues that affect an analysis of a cooling system's thermal margin. For example, CP&L has mentioned elsewhere that exploitation of the margin in the Unit 1 CCW system could involve changes in design assumptions that include fouling factors and tube plugging limits.<sup>7</sup> These matters are not addressed in Enclosure 9.

As background, note that the Unit 1 CCW system has two heat exchangers, each with a design heat transfer rate of 50 million BTU/hour. During the recirculation phase of a design-basis LOCA, the estimated maximum heat load to be extracted from the CCW system by the SW system is 160 million BTU/hour.<sup>8</sup> These numbers suggest that accommodating a design-basis LOCA will already exploit the margin of the CCW system, without any additional load from pools C and D.

*Lack of QA documentation*

Activation of pools C and D will require the completion of their cooling and water cleanup systems, and the connection of their cooling systems to the

---

<sup>5</sup> License amendment application, Enclosure 9.

<sup>6</sup> Ibid; Federal Register: January 13, 1999 (Volume 64, Number 8), pages 2237-2241.

<sup>7</sup> Viewgraphs for presentation by CP&L to the NRC staff, 3 March 1998.

<sup>8</sup> Harris FSAR, section 9.2, Amendment No. 40.

*Risks & alternative options re. spent fuel storage at Harris*  
*Appendix A*  
*Page A-7*

A Harris PWR assembly has a mass of 0.461 MTHM. Thus, one can estimate that a typical Harris assembly contains, at discharge,  $0.65 \times 10^5$  Curies of cesium-137. The assembly's content of cesium-137 will decline exponentially, with a half-life of 30 years. At the same age after discharge, a typical BWR assembly in the Harris pools will contain about 1/4 of the amount of cesium-137 in a Harris PWR assembly.<sup>14</sup>

*Potential stock of assemblies in the Harris pools*

Table A-2 shows CP&L's projection of the stock of assemblies in Harris pools C and D, for the purposes of bounding analysis. A CP&L representative has stated that CP&L will not ship fuel to Harris until it has aged for 3 years, and will not place fuel in pools C and D until it has aged for 5 years.<sup>15</sup> Accepting that fuel aged less than 3 years will not be shipped to Harris, one can assume, to supplement Table A-2, that the Harris pools will contain 456 BWR assemblies aged for 3 years, 172 PWR assemblies aged for 3 years, and 96 PWR assemblies aged for 1 year. Hereafter, these assumptions and Table A-2 are taken to represent the potential stock of fuel assemblies in the Harris pools.

On this basis, the Harris pools' stock of spent fuel aged 3 years or less will be 262 PWR assemblies and 456 BWR assemblies. All of this fuel might be in pools A and B, although there is nothing in CP&L's present or proposed Technical Specifications which prohibits placement of recently discharged fuel in pools C and D. On the same basis, the Harris pools' stock of spent fuel aged 9 years or less will be 784 PWR assemblies and 1,824 BWR assemblies.


*Inventory of cesium-137*

Now consider the inventory of cesium-137 in the Harris pools. Assume that a newly discharged PWR assembly contains  $0.65 \times 10^5$  Curies of cesium-137, neglect the difference between Harris and Robinson assemblies, allow for radioactive decay, and assume that a BWR assembly contains 1/4 of the amount of cesium-137 in a PWR assembly of the same age. Then, the Harris pools' stock of spent fuel aged 3 years or less will contain  $2.3 \times 10^7$  Curies (870,000 TBq) of cesium-137, with a mass of 260 kilograms. Also, the Harris pools' stock of spent fuel aged 9 years or less will contain  $7.1 \times 10^7$  Curies (2,600,000 TBq) of cesium-137, with a mass of 790 kilograms.

---

<sup>14</sup> The ratio of 1/4 derives from the parameters shown in the license amendment application, Enclosure 7, page 5-15.

<sup>15</sup> J Scarola of CP&L, presentation to Orange County Board of Commissioners, 9 February 1999.

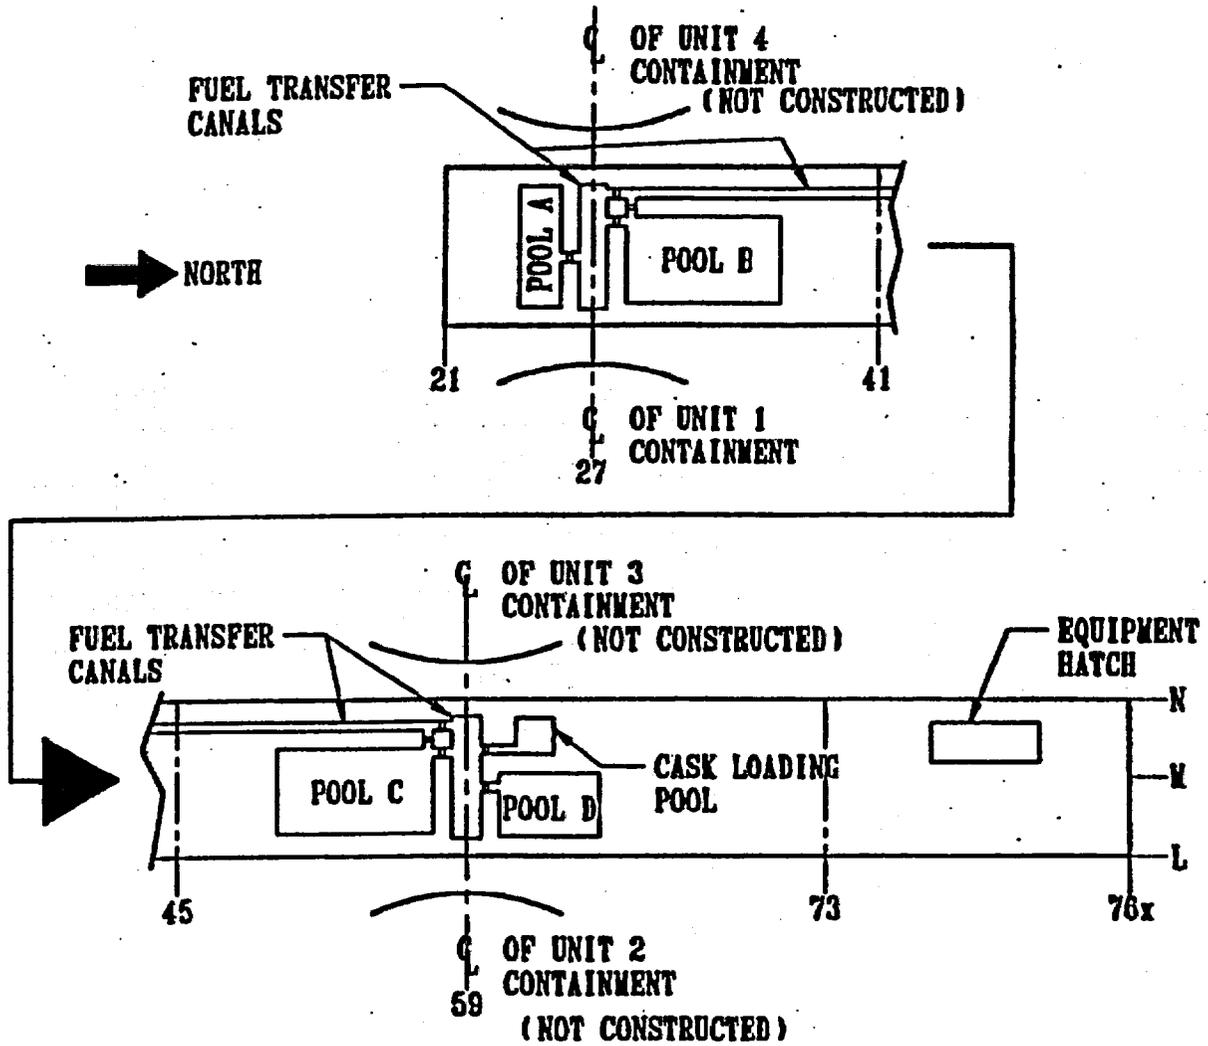

Source: License amendment application

Figure A-1

Interior of the Harris Fuel Handling Building

*Risks & alternative options re. spent fuel storage at Harris*  
*Appendix A*  
*Page A-11*

<b>Pool</b>	<b>PWR spaces</b>	<b>BWR spaces</b>	<b>Total</b>
<b>'A'</b>	<b>360</b>	<b>363</b>	<b>723</b>
<b>'B'</b>	<b>768</b>	<b>2178</b>	<b>2946</b>
<b>'C'</b>	<b>927</b>	<b>2763</b>	<b>3690</b>
<b>'D'</b>	<b>1025</b>	<b>0</b>	<b>1025</b>
<b>Total</b>	<b>3080</b>	<b>5304</b>	<b>8384</b>

**Source:** License amendment application

**Table A-1**

**Present and proposed storage capacity in the Harris pools**

—  
—

**RISKS AND ALTERNATIVE OPTIONS  
ASSOCIATED WITH SPENT FUEL STORAGE AT THE  
SHEARON HARRIS NUCLEAR POWER PLANT**

**Appendix B**

**Potential for severe accidents at the Harris reactor**

**1. Introduction**

In examining the risks associated with spent fuel storage at Harris, one must consider the potential for accidents at the Harris reactor. Such consideration is necessary for two reasons. First, a reactor accident could accompany, initiate or exacerbate a spent fuel pool accident. Second, modification of the Harris plant to increase its spent fuel storage capacity could increase the probability or consequences of accidents at the Harris reactor.

This appendix addresses the potential for severe accidents at the Harris reactor. "Severe" reactor accidents have two major defining characteristics. First, they involve substantial damage to the reactor core, with a corresponding release of radioactive material from the fuel assemblies. Second, they extend the envelope of potential accidents beyond the "design basis" accidents that were considered when US reactors were first licensed.

During a severe reactor accident, radioactive material may be released to the environment, as an atmospheric plume or by entry into ground or surface waters. The release may be large or small. In illustration, the 1979 TMI accident and the 1986 Chernobyl accident were both severe accidents, involving substantial damage to the reactor core. However, the TMI release was comparatively small and the Chernobyl release was comparatively large.

**2. Probabilistic risk assessment**

The probabilities and consequences of potential accidents at nuclear facilities can be estimated through the techniques of probabilistic risk assessment (PRA). Nuclear facility PRAs are performed at three levels. At Level 1, a PRA will estimate the probability of a specified type of accident (e.g., severe core damage at a reactor). At Level 2, which builds upon Level 1 findings, a PRA will estimate the nature of potential radioactive releases from the facility. In

operation. Figure B-1 shows core damage frequency for internal events, fires and earthquakes (seismic events). Two estimates are shown for seismic events, one drawing on an estimate of earthquake frequency by Lawrence Livermore National Laboratory, the other on an estimate by the Electric Power Research Institute (EPRI). The bars in Figure B-1 span an estimated uncertainty range from the 5th to the 95th percentile. An alternative portrayal of estimated uncertainty is provided by the probability densities shown in Figure B-2.

The authors of NUREG-1150 made a considerable effort to estimate the uncertainty associated with their findings. However, their uncertainty estimates relied heavily on expert opinion, rather than on a statistical analysis of data. Thus, the uncertainty estimates in NUREG-1150 should be viewed with caution. The reader will observe a cautionary statement attached to Figures B-1 and B-2. Finally, the NUREG-1150 findings of accident probability must be viewed as lower bounds, as explained above.

#### *Acts of malice*

Nuclear reactor PRAs do not consider malicious acts such as sabotage, terrorism or acts of war. Such acts are less susceptible to probabilistic analysis than are accident initiators such as human error. Nevertheless, sabotage and terrorism pose a significant threat to US nuclear plants.<sup>5</sup> NRC regulations oblige reactor licensees to take certain precautions against this threat, but these precautions do not preclude the possibility of successful acts of sabotage or terrorism.

The US government is increasing the level of attention and the expenditure that it devotes to the threat of terrorism. Many observers argue that greater effort is required. For example, three authors with high-level government experience have recently written:<sup>6</sup>

Long part of the Hollywood and Tom Clancy repertory of nightmarish scenarios, catastrophic terrorism has moved from far-fetched horror to a contingency that could happen next month. Although the United States still takes conventional terrorism seriously, as demonstrated by the response to the attacks on its embassies in Kenya and Tanzania in August, it is not yet prepared for the new threat of catastrophic terrorism.

---

<sup>5</sup> G Thompson, War, Terrorism and Nuclear Power Plants, Peace Research Centre, Australian National University, October 1996.

<sup>6</sup> A Carter, J Deutch and P Zelikow, "Catastrophic Terrorism", Foreign Affairs, November/December 1998, page 80.

*Risks & alternative options re. spent fuel storage at Harris*  
*Appendix B*  
*Page B-5*

The NRC has compiled and compared IPE findings for all US commercial nuclear reactors.<sup>10</sup> Some of the results are shown in Figures B-3 and B-4. Figure B-3 shows that the reported core damage frequencies tend to be significantly higher for PWRs than for boiling-water reactors (BWRs). Figure B-4 shows that the reported core damage frequencies tend to be higher for 3-loop Westinghouse (W-3) PWRs than for 2-loop and 4-loop Westinghouse PWRs and PWRs made by Combustion Engineering (CE) and Babcock & Wilcox (B&W). The Harris reactor is a 3-loop Westinghouse PWR.

From its compilation of IPE findings, the NRC concluded that sequences involving LOCAs (especially LOCAs with recirculation failure) and station blackout are major contributors to estimated core damage frequency at 3-loop Westinghouse PWRs. This conclusion is consistent with the Harris IPE findings outlined above. The NRC noted that the 3-loop Westinghouse PWRs exhibit a relatively high dependence of front-line safety systems on service water (SW), component cooling water (CCW) and heating, ventilating & air conditioning (HVAC) systems.

*IPEEE findings*

The Harris IPEEE consisted of a seismic margins analysis and a limited analysis of in-plant fires. The seismic margins analysis examined the Harris reactor's ability to withstand a review level earthquake (RLE) of 0.3g. Note that the reactor's safe shutdown earthquake (SSE) is 0.15g and its operating basis earthquake is 0.075g. According to the IPEEE, the only actions required to make the Harris reactor safe against the RLE involved housekeeping and minor modifications, and these actions have been taken. The IPEEE did not investigate the implications of an earthquake more severe than the RLE.

A limited analysis of in-plant fires appears in the IPEEE. This analysis identified four fire scenarios as significant contributors to core damage frequency. One scenario would take place in each of switchgear rooms A and B, and two scenarios would take place in the control room. The combined core damage frequency, summed over all four scenarios, would be  $1 \times 10^{-5}$  per reactor-year, but the IPEEE argues that a summation of this kind would be inaccurate without further refinement of the analysis.

Figures B-1 and B-2 illustrate the findings that can be generated by the systematic application of PRA techniques to accident sequences initiated by external events. In comparison, the Harris IPEEE is a relatively crude study.

---

<sup>10</sup> US Nuclear Regulatory Commission, Individual Plant Examination Program: Perspectives on Reactor Safety and Plant Performance, NUREG-1560 (3 vols), December 1997.

**Risks & alternative options re. spent fuel storage at Harris**  
**Appendix B**  
**Page B-7**

significant degree of containment failure or bypass, with a total probability of about  $1 \times 10^{-5}$  per reactor-year.<sup>11</sup>

#### **4. Pool-reactor interactions**

Neither CP&L nor NRC have performed an analysis to determine how a severe accident or a design-basis accident at the Harris reactor might accompany, initiate or exacerbate an accident at the Harris fuel pools, or vice versa.<sup>12</sup> Appendix C shows how a severe reactor accident could initiate a pool accident by precluding personnel access. From Appendix E it can be inferred that a pool accident could similarly preclude access to the reactor.


The Harris IPE does not analyze the implications that activation of pools C and D at Harris might have for severe accidents at the Harris reactor. Appendix A points out that activation of pools C and D will raise two safety issues that could increase the probability of core damage at Harris. First, cooling of pools C and D and a planned uprate in reactor power will place an increased heat load on the component cooling water (CCW) system of Harris Unit 1, thus adding stress to operators and equipment at Harris, potentially increasing the probability of core damage. Second, cooling of pools C and D will create an increased load on the electrical systems at Harris, thereby adding stress to operators and equipment and potentially increasing the probability of core damage. Before activation of pools C and D is permitted, these effects should be examined through a supplement to the Harris IPE.

---

<sup>11</sup> Release categories involving significant containment failure or bypass are, in descending order of estimated probability, RC-4, RC-5, RC-6, RC-1B, RC-4C and RC-3. Each of these categories involves a 100 percent release of noble gases. The CsI release fraction ranges from .001 percent (RC-6) to 59 percent (RC-5).

<sup>12</sup> As examples of literature relevant to potential safety interactions between fuel pools and reactors, see: D A Lochbaum, Nuclear Waste Disposal Crisis, PennWell Books, Tulsa, OK, 1996; and N Situ et al, Loss of Spent Fuel Pool Cooling PRA: Model and Results, INEL-96/0334, Idaho National Engineering Laboratory, September 1996.

**Risks & alternative options re. spent-fuel storage at Harris**  
**Appendix B**  
**Page B-9**

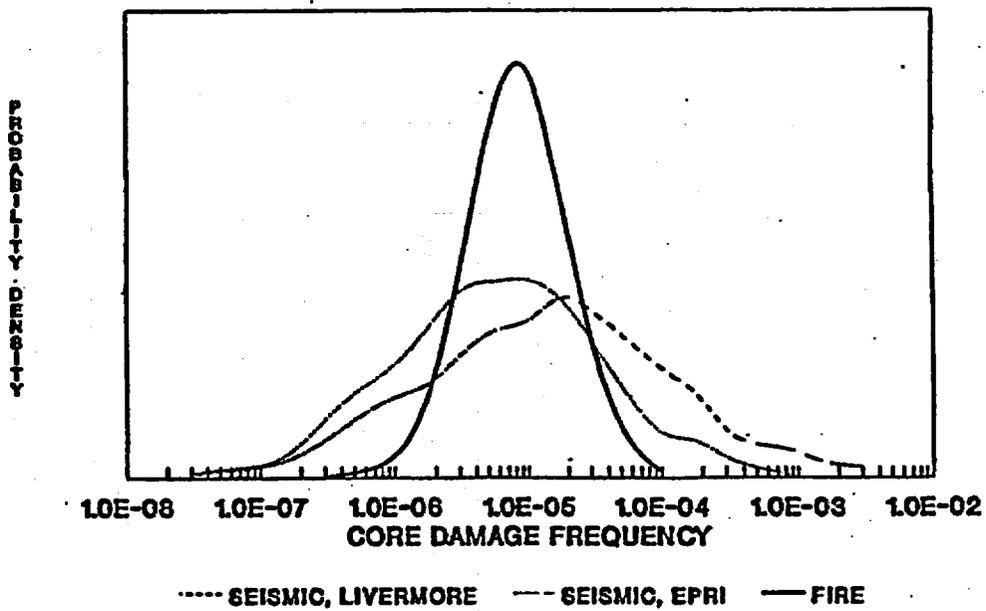


Note: As discussed in Reference 8.7, core damage frequencies below  $1E-5$  per reactor year should be viewed with caution because of the remaining uncertainties in PRA (e.g., events not considered).

Source: NUREG-1150

Figure B-2

Probability density of estimated external-events core damage frequency for the Surry PWRs

*Risks & alternative options re. spent-fuel storage at Harris*  
*Appendix B*  
*Page B-11*

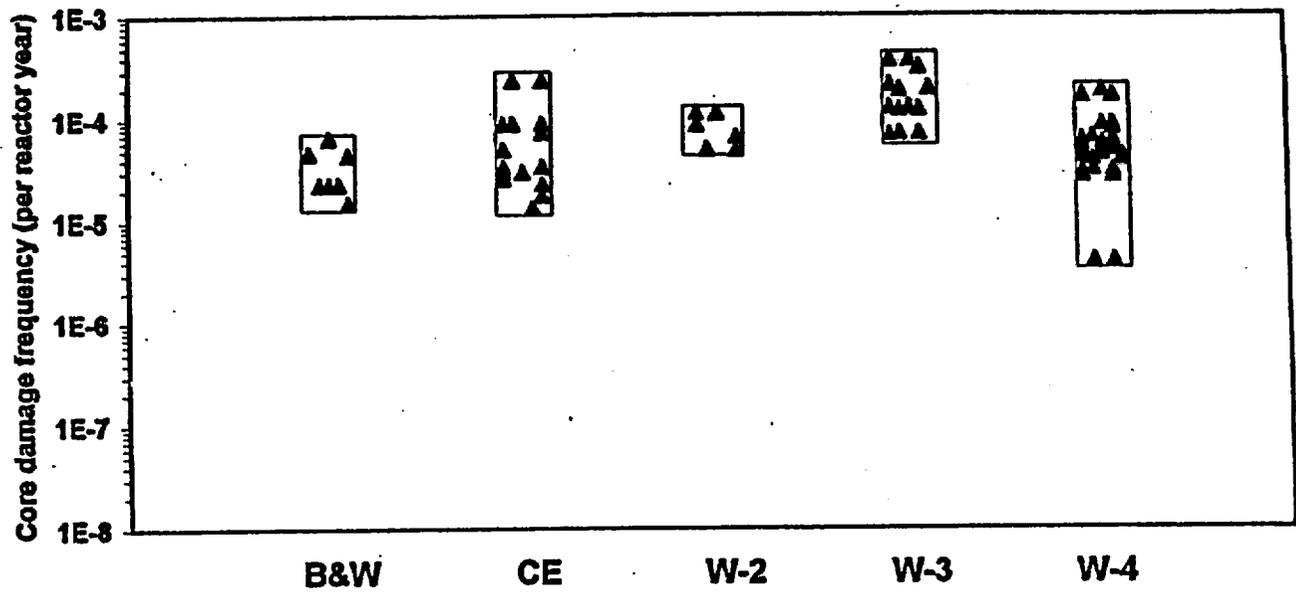

Source: NUREG-1560

Figure B-4

Core damage frequencies reported in IPEs for types of PWR

**RISKS AND ALTERNATIVE OPTIONS  
ASSOCIATED WITH SPENT FUEL STORAGE AT THE  
SHEARON HARRIS NUCLEAR POWER PLANT**

**Appendix C**

**Potential for loss of water from the Harris pools**

**1. Introduction**

This appendix considers the potential for partial or total loss of water from one or more of the Harris fuel pools. The arrangement and use of these pools are described in Appendix A. If a loss of water occurs, then exothermic reactions could occur in the affected pools, as described in Appendix D.

**2. Types of event that might cause water loss**

A variety of events, alone or in combination, might lead to partial or complete uncovering of spent fuel in the Harris pools. Relevant types of event include:

- (a) an earthquake, cask drop, aircraft crash, human error, equipment failure or sabotage event that leads to direct leakage from the pools;
- (b) siphoning of water from the pools through accident or malice;
- (c) interruption of pool cooling, leading to pool boiling and loss of water by evaporation; and
- (d) loss of water from active pools into adjacent pools or canals that have been gated off and drained.

**3. Assessing the potential for water loss: the role of PRA**

A discipline known as probabilistic risk assessment (PRA) has been developed to examine the probabilities and consequences of potential accidents at nuclear facilities. PRA techniques are most highly developed in their application to reactor accidents, but can be applied to fuel pool accidents. Appendix B describes the characteristics, strengths and limitations of PRA.

Carolina Power & Light Company (CP&L) has prepared a Level 2, internal-events PRA for the Harris reactor, in the form of an Individual Plant

this pool, the NRC sought to obtain knowledge that would be relevant to other PWRs.

### *Earthquake*

The NRC's analysis of the Robinson pool showed that there is high confidence (95 percent) of a low probability (5 percent) of structural failure of the pool in the event of an earthquake of 0.65g. A more severe earthquake could cause structural failure and water loss, and the mean probability of such an event was estimated to be  $1.8 \times 10^{-6}$  per reactor-year.

### *Cask drop*

The NRC's analysts examined a four-foot drop of a 68-ton fuel shipping cask onto the wall of the Robinson fuel pool. They estimated that the wall would suffer significant damage. Cracking of the concrete, yield of reinforcing steel, and tearing of the liner could be expected. Loss of pool water could follow. The probability of this cask drop was not estimated.

### *Relevance of these findings to Harris*

Each nuclear plant has specific design features. Thus, the findings from Robinson cannot be applied uncritically to Harris. Nevertheless, the Robinson findings suggest that the Harris fuel pools may be vulnerable to water loss in the event of a severe earthquake or a cask drop.

The Harris pools are partly below the site's grade level, and the tops of the fuel racks are at grade level. However, there are rooms and passages below the pools. Also, there are three deep cavities adjacent to the fuel handling building, where the containments for Units 2-4 were to have been constructed. Thus, the pools could drain below the tops of the fuel racks, partially or completely, if damaged by an earthquake or cask drop.

Administrative and technical measures are employed at Harris to prevent a cask drop onto a pool wall or into a pool. There is some probability that these measures will fail and a cask drop will occur. No PRA estimate of this probability is available. An NRC-sponsored analysis found the probability of structural failure from a cask drop at the Millstone and Ginna plants, prior to improvements, to be  $3 \times 10^{-5}$  per reactor-year.<sup>4</sup> After improvements, the

---

<sup>4</sup> V L Sailor et al, Severe Accidents in Spent Fuel Pools in Support of Generic Safety Issue 82, NUREG/CR-4982, July 1987, Table 2.10.

*Risks & alternative options re. spent fuel storage at Harris*  
*Appendix C*  
*Page C-5*

death within a few days. Doses above 10,000 rem will lead to failure of the central nervous system, causing death within a day.<sup>9</sup>

*Prevention of access, and its implications*

It is clear that a severe accident at the Harris reactor, accompanied by containment failure or bypass, would preclude personnel access to the plant. To this author's knowledge, CP&L has made no preparations to maintain pool cooling after such an event. It can be assumed that pool cooling would cease during the accident, and would not resume.

In CP&L's application for a license amendment to activate pools C and D at Harris, the bounding decay heat load for pools C and D is estimated to be 15.6 million BTU/hour (4.6 MW). CP&L states that the mass of water in these two pools, above the racks, will be 2.9 million pounds (1,320 tonnes). Then, CP&L estimates that the pools will begin to boil, if pool cooling systems become inoperative, after a period "in excess of 13 hours".<sup>10</sup> If we assume that cooling remains inoperative, and that 4.6 MW of heat is solely devoted to boiling off 1,320 tonnes of water, then this water will be entirely evaporated over a period of 180 hours (7.5 days). In practice, a slightly longer period will be required, accounting for heat losses.

Thus, a severe reactor accident with containment failure or bypass would lead to uncovering of spent fuel in the Harris pools, after a time delay of perhaps 10 days. Heroic efforts would be needed to restore cooling or to replace evaporated water. If these efforts involved addition of water to the pools after the fuel had been uncovered, they would run the risk of exacerbating the accident by inhibiting convective circulation of air in the pools (see Appendix D).


**6. A sabotage/terrorism event involving siphoning**

Appendix B discusses the potential for acts of malice at nuclear plants. A potential act of this kind at Harris would involve a group taking control of the fuel handling building, shutting down the pool cooling systems, and siphoning water from the pools. The consequent uncovering of fuel could initiate an exothermic reaction in recently discharged fuel within a few hours (see Appendix D). Once such a reaction was initiated, access to the fuel handling building would be precluded. Over the subsequent hours, exothermic reactions would be initiated in older fuel.

---

<sup>9</sup> B Flowers et al, Royal Commission on Environmental Pollution, Sixth Report, Cmnd. 6618, Her Majesty's Stationery Office, London, September 1976, page 23.

<sup>10</sup> License amendment application, Enclosure 7, page 5-8.

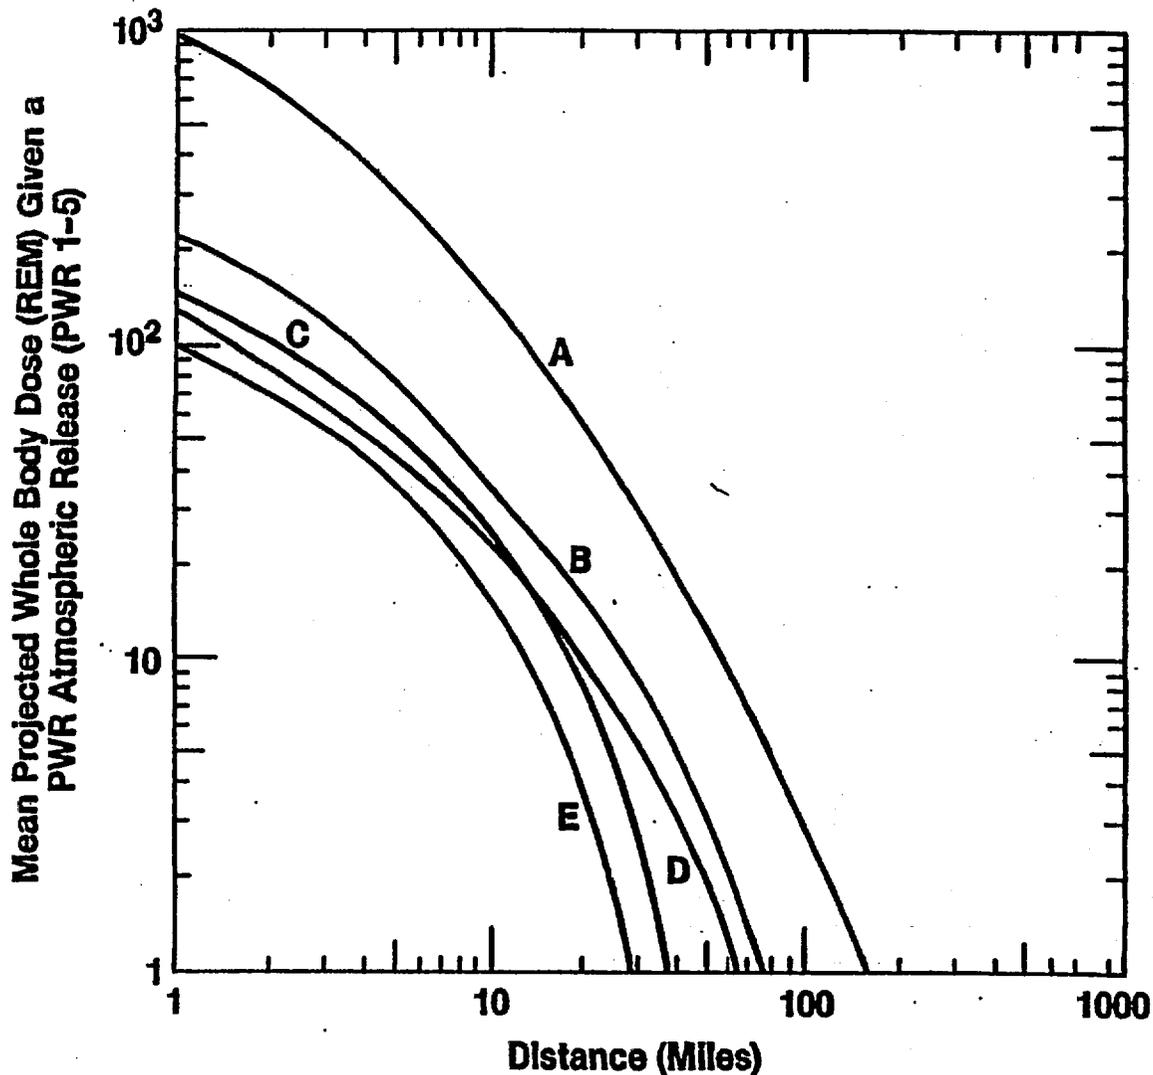

- Curve A Individual located outdoors without protection. SF's (1.0, 0.7). 1-day exposure to radionuclides on ground.
- Curve B Sheltering, SF's (0.75, 0.33), 6-hour exposure to radionuclides on ground.
- Curve C Evacuation, 5-hour delay time, 10 mph.
- Curve D Sheltering, SF's (0.5, 0.08), 6-hour exposure to radionuclides on ground.
- Curve E Evacuation, 3-hour delay time, 10 mph.

Figure C-1

Estimated whole-body dose after a severe PWR accident

**RISKS AND ALTERNATIVE OPTIONS  
ASSOCIATED WITH SPENT FUEL STORAGE AT THE  
SHEARON HARRIS NUCLEAR POWER PLANT**

**Appendix D**

**Potential for exothermic reactions in the Harris pools**

**1. Introduction**

If water is totally or partially lost from one or more of the Harris fuel pools, the potential exists for an exothermic reaction between the fuel cladding and air or steam. The cladding is a zirconium alloy that begins to react vigorously with air or steam when its temperature reaches 900-1,000 degrees C. Partial or total loss of water could cause the cladding to reach this temperature, because water is no longer available to remove decay heat from the fuel. If the cladding temperature reaches 900-1,000 degrees C and air or steam remain available, a runaway reaction can occur. Heat from the exothermic reaction can increase cladding temperature, which will in turn increase the reaction rate, resulting in a runaway reaction.

The steam-zirconium reaction will be familiar to many observers of the 1979 TMI accident. During that accident a steam-zirconium reaction contributed to the partial melting of the reactor core, and generated hydrogen gas. Accumulation of this gas in the upper part of the reactor pressure vessel was a cause of concern during the accident. Hydrogen entered the containment and exploded about 10 hours into the accident, yielding a pressure spike of 28 psig.<sup>1</sup>

The potential for a partial or total loss of water from the Harris pools is addressed in Appendix C. Here, the consequent potential for exothermic reactions is considered. Also, this appendix considers the potential for exothermic reactions to release radioactive material -- especially the radioisotope cesium-137 -- from spent fuel to the atmosphere outside the Harris plant.

---

<sup>1</sup> G Thompson, Regulatory Response to the Potential for Reactor Accidents: The Example of Boiling-Water Reactors, Institute for Resource and Security Studies, Cambridge, MA, February 1991.

*Risks & alternative options re. spent fuel storage at Harris*  
*Appendix D*  
*Page D-3*

- (a) upward convection of air (for total loss of water) or steam (for partial loss of water);
- (b) upward or downward conduction along the fuel rods and rack structure;
- (c) upward or downward thermal radiation along the narrow passages between fuel rods, and between assemblies and rack walls;
- (d) upward thermal radiation from the top of the racks to the interior of the fuel handling building;
- (e) downward thermal radiation from the bottom of the racks to the base of the pool or to residual water (if present); and
- (f) lateral conduction and thermal radiation across the racks to the pool wall.

For a fuel assembly separated from the pool wall by more than a few spaces, pathway (f) will be ineffective. Thus, only pathways (a) through (e) need to be considered. In the event of total loss of water, the effectiveness of pathway (a) will depend upon the extent of ventilation in the fuel handling building.

### 3. A scoping approach to heat transfer

To assess the effectiveness of the above-mentioned heat transfer pathways, it is appropriate to begin with a scoping analysis. Detailed calculations, especially if they involve computer modelling, must be guided by physical insight. Scoping calculations can help to provide that insight.

#### *Decay heat output*

The first parameter to be considered -- designated here as  $Q$  -- is the decay heat in a spent fuel assembly. The unit of  $Q$  is kW per metric ton of heavy metal (MTHM) in the assembly. For PWR fuel,  $Q$  is about 10 kW/MTHM for fuel aged 1 year from discharge, and about 1 kW/MTHM for fuel aged 10 years.<sup>2</sup>

#### *Upper bound of temperature rise*

Now consider a fuel pellet which is in complete thermal isolation. Due to decay heat, this pellet will experience a temperature rise of  $11Q$  degrees C per hour.<sup>3</sup> Thus, if  $Q=10$ , the temperature rise will be 110 degrees C per hour (2,640 degrees C per day). A temperature rise of  $11Q$  degrees C per hour is the

---

<sup>2</sup> For fuel burnups typical of current practice,  $Q$  will actually be 10-20 percent higher than the values shown here.

<sup>3</sup> Assuming that a uranium dioxide pellet has a specific heat of 300 J/K per kg of pellet (340 J/K per kg of HM).

### *Cooling by thermal radiation*

If residual water is present, there remains only one potentially effective mechanism of heat transfer from the mid-length of a fuel assembly -- thermal radiation along the axis of the assembly. Note that a Harris PWR assembly has an active length of 12 feet, a cross-section 8.4 inches square, and contains 264 fuel rods plus other longitudinal structures. In the Harris fuel pools, the assembly will be surrounded by continuous sheets of neutron-absorbing material (Boral), and the center-center distance in pool C will be 9.0 inches. In this configuration, axial heat transfer by thermal radiation will be strongly inhibited. However, calculations more detailed than those above are required to estimate the amount of heat that can be transferred by this pathway.

Note that downward heat transfer by radiation will increase the generation of steam from residual water, thus improving the effectiveness of convective cooling by steam. A detailed analysis should consider such effects through coupled calculations.

### *Summary*

The preceding scoping calculations show that conduction and convective cooling by steam will be relatively ineffective. These cooling mechanisms cannot prevent fuel cladding from reaching a temperature of at least 1,000 degrees C -- the initiation point for a runaway exothermic reaction -- even for fuel aged in excess of 10 years. An estimate of the effectiveness of axial radiation cooling -- the only remaining cooling mechanism if residual water is present -- would require more detailed calculations. However, this author does not expect that such calculations would show axial radiation cooling to be more effective than conduction or convective cooling by steam.

If residual water is not present, a fuel assembly can be cooled by convective circulation of air. Estimation of the effectiveness of this mechanism requires an analysis of convective circulation through the pool and the fuel handling building, reflecting practical factors such as constrictions at the base of fuel racks.

#### **4. Specifications for an adequate, practical analysis**

There has been no site-specific analysis of the potential for exothermic reactions in the Harris pools. Generic analyses have been performed for and by the US Nuclear Regulatory Commission (NRC). Before addressing the findings and adequacy of the NRC's generic analyses, let us consider the

rupture. Experiments will probably be required to support and validate the modelling.

#### *Site-specific factors*

The analysis can be strongly influenced by site-specific factors. For convective cooling by air, these factors include the detailed configuration of the racks, the pools and the fuel handling building. All relevant factors should be accounted for. This could be done through site-specific modelling. Alternatively, generic modelling could be performed across the envelope of site-specific parameters, with sensitivity analyses to show the effects of varying those parameters.

#### *Propagation of exothermic reactions to adjacent assemblies*

After an exothermic reaction has been initiated in a group of fuel assemblies, this reaction might propagate to adjacent assemblies. Due to their lower Q or to other factors, the adjacent assemblies might not otherwise suffer an exothermic reaction. An analysis of propagation should consider the potential for reactions involving not only the fuel cladding but also material (e.g., Boral) in the fuel racks. The analysis should examine the implications of clad and pellet relocation after a reacting assembly has lost its structural integrity. Those implications include the heating of adjacent assemblies and racks by direct contact, thermal radiation, convection, and the inhibition of air circulation. A bed of relocated material at the base of the pool could have all these effects.

#### 5. The 1979 Sandia study

An initial analysis of the potential for exothermic reactions was made for the NRC by Sandia Laboratories in 1979.<sup>8</sup> This was a respectable analysis as a first attempt. It considered partial drainage of a pool, although it used a crude heat transfer model to study that problem, and neglected to consider the steam-zirconium reaction. It did not address the potential for propagation of exothermic reactions to adjacent assemblies. The Sandia authors were careful to state their assumptions and to specify the technical basis for their computer modelling.

Figure D-3 illustrates the findings of the Sandia study. The three lower curves in Figure D-3 show the sensitivity of convective air cooling to the diameter of the hole in the base of the fuel racks. The next higher curve -- the

---

<sup>8</sup> A S Benjamin et al, Spent Fuel Heatup Following Loss of Water During Storage, NUREG/CR-0649, March 1979.

*Propagation of exothermic reactions*

Pursuant to a Freedom of Information request, the NRC released in 1984 a so-called draft report by MIT and Sandia authors on the propagation of an air-zirconium reaction in a fuel pool.<sup>12</sup> This document has been repeatedly cited in subsequent years, although it should properly be regarded as notes toward a draft report. Those notes were submitted to the NRC after the project ran out of funds; it was never completed.

The MIT-Sandia group concluded from computer modelling and experiments that an air-zirconium reaction in fuel assemblies could propagate to adjacent, lower-Q assemblies. They expressed the view that propagation would be quenched in regions of a pool where fuel is aged 3 years or more, but noted the presence of "large uncertainties" in their analysis.

BNL analysts subsequently reviewed these experiments and conducted their own modelling using the same code (SFUEL). In their modelling the BNL analysts chose to terminate the air-zirconium reaction when the cladding reached its melting point.<sup>13</sup> Neither the MIT-Sandia group nor the BNL group examined the implications of clad and pellet relocation after a reacting assembly has lost its structural integrity. The author is not aware of other analyses which address this problem. Thus, the specifications set forth in Section 4 for analysis of propagation have not been met.

**7. The potential for an atmospheric release of radioactive material**

Spent fuel at Harris which suffers an exothermic reaction will release radioactive material to the fuel handling building. That building is not designed as a containment structure, and is not likely to be effective in this role, given the occurrence of exothermic reactions in one or more pools. A BNL study has concluded that a reasonable, generic estimate of the release fraction of cesium isotopes, from affected fuel to the atmosphere outside the plant, is 100 percent.<sup>14</sup> This release fraction is used in Appendix E.


The amount of fuel that will suffer an exothermic reaction, given a loss of water from the Harris pools, will depend upon the particular scenario. For scenarios which involve partial uncovering of fuel, the reaction could affect fuel aged 10 or more years. For scenarios which involve total loss of water,

---

<sup>12</sup> N A Pisano et al, The Potential for Propagation of a Self-Sustaining Zirconium Oxidation Following Loss of Water in a Spent Fuel Storage Pool, Draft Report, January 1984.

<sup>13</sup> V L Sailor et al.


<sup>14</sup> Ibid.

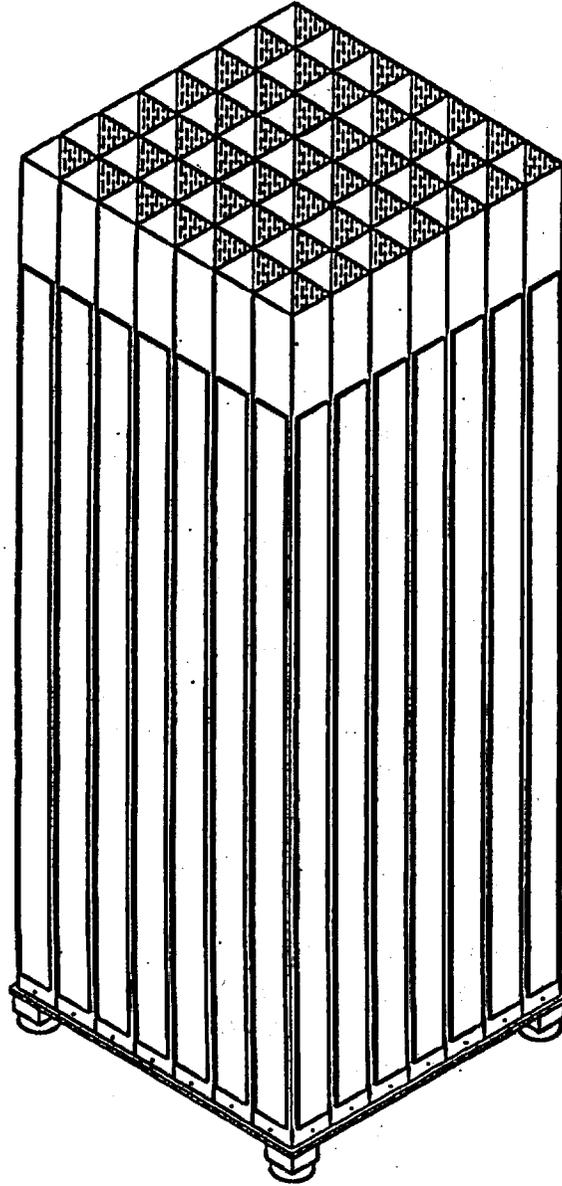

**Source: License amendment application**

**Figure D-1**

**Typical rack used in the Harris pools**

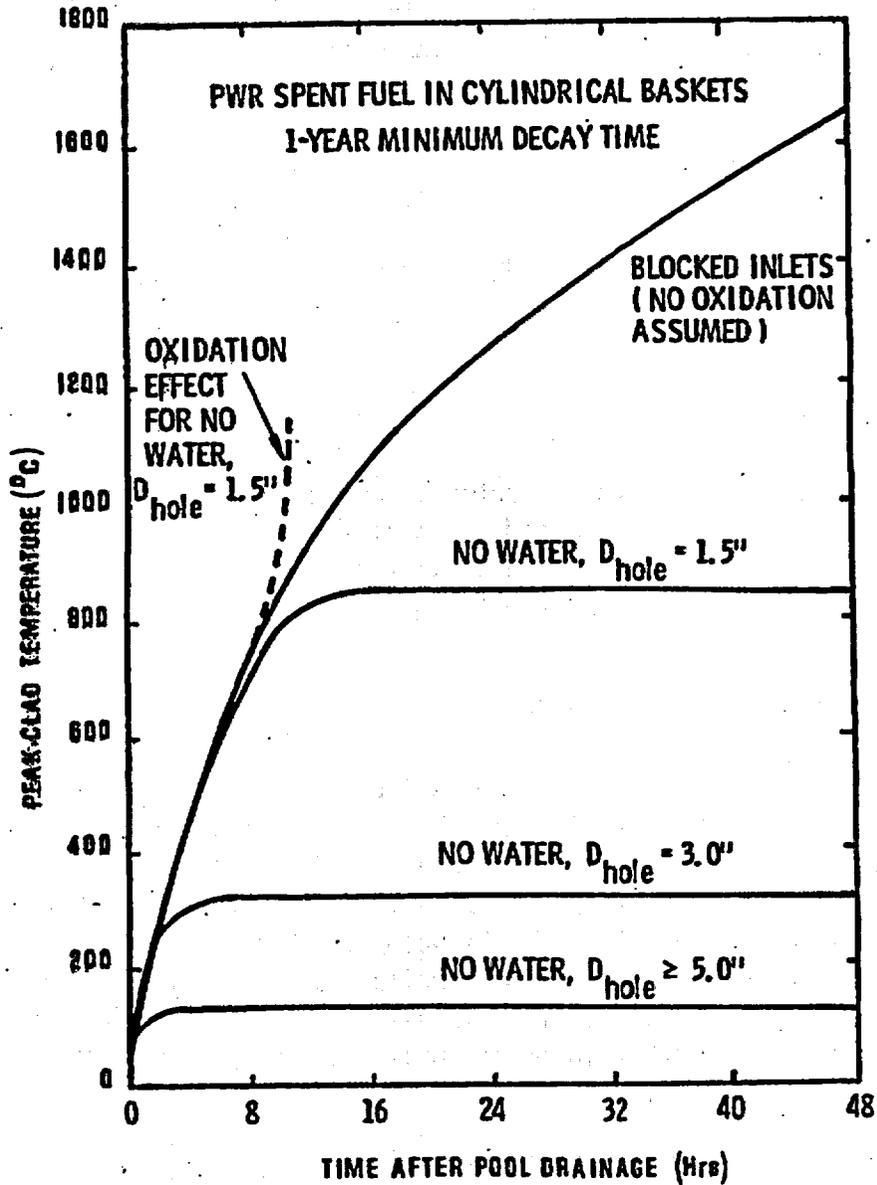

Source: NUREG/CR-0649

Figure D-3

Estimated heatup of PWR spent fuel after water loss

**RISKS AND ALTERNATIVE OPTIONS  
ASSOCIATED WITH SPENT FUEL STORAGE AT THE  
SHEARON HARRIS NUCLEAR POWER PLANT**

**Appendix E**

**Consequences of a large release of cesium-137 from Harris**

**1. Introduction**

This appendix outlines some of the potential consequences of postulated large releases of cesium-137 from the Harris plant to the atmosphere. Such consequences can be estimated by site-specific computer models. A simpler approach is used here, but this approach is adequate to show the nature and scale of expected consequences.

**2. Characteristics of postulated releases**

Two spent fuel release scenarios are postulated here. The first scenario involves a release of  $2.3 \times 10^7$  Curies (870,000 TBq) of cesium-137, with a mass of 260 kilograms.<sup>1</sup> This represents the cesium-137 inventory in Harris' stock of spent fuel aged 3 years or less, as estimated in Appendix A. The second scenario involves a release of  $7.1 \times 10^7$  Curies (2,600,000 TBq) of cesium-137, with a mass of 790 kilograms. This represents the cesium-137 inventory in Harris' stock of spent fuel aged 9 years or less. Note that all of the cesium-137 in the affected fuel is assumed to reach the atmosphere, an assumption which is explained in Appendix D.

Releases of the postulated magnitude could occur as a result of exothermic reactions in the Harris fuel pools. Appendix D discusses the potential for such reactions. Cesium-137 would not be the only radioisotope released to the atmosphere if exothermic reactions occurred in the pools. However, cesium-137 is likely to be the dominant cause of offsite radiological exposure,

---

<sup>1</sup> 1 Curie is equivalent to  $3.7 \times 10^{10}$  TBq. 1 TBq of cesium-137 is equivalent to 0.3 grams.

*Risks & alternative options re. spent fuel storage at Harris*  
*Appendix E*  
*Page E-3*

providing an internal radiation dose to a person living in the contaminated area. Absent any countermeasures, the internal dose could be of a similar magnitude to the external dose.

Figure E-1 shows the relationship between contaminated land area and the size of an atmospheric release of cesium-137. This figure is adapted from a 1979 study by Jan Beyea, then of Princeton University.<sup>5</sup> The threshold of contamination is an external dose of 10 rem over 30 years, assuming a shielding factor of 0.25 and accounting for weathering of cesium. The "typical meteorology" case in Figure E-1 assumes a wind speed of 5 m/sec, atmospheric stability in class D, a 0.01 m/sec deposition velocity, a 1,000 m mixing layer and an initial plume rise of 300 m (although the results are not sensitive to plume rise). A Gaussian, straight-line plume model was used, providing an estimate of contaminated land area that will approximate the area contaminated during a range of actual meteorological conditions. The lower and upper limits of land contamination in Figure E-1 represent a range of potential meteorological conditions.

*The threshold for land contamination*

An external exposure of 10 rem over 30 years would represent about a three-fold increase above the typical level of background radiation (which is about 0.1 rem/year). In its 1975 Reactor Safety Study, the NRC used a threshold of 10 rem over 30 years as an exposure level above which populations were assumed to be relocated from rural areas. The same study used a threshold of 25 rem over 30 years as a criterion for relocating people from urban areas, to reflect the assumed greater expense of relocating urban inhabitants.

In an actual case of land contamination in the United States, the steps taken to relocate populations and pursue other countermeasures (decontamination of surfaces, interdiction of food supplies, etc.) would reflect a variety of political, economic, cultural, legal and scientific influences. It is safe to say that few citizens would calmly accept a level of radiation exposure which substantially exceeds background levels.

*Land contamination from potential Harris releases*

Three potential Harris releases of cesium-137 are shown in Figure E-1. Releases of 70 million Curies and 20 million Curies correspond to liberation

---

<sup>5</sup> J Beyea, "The Effects of Releases to the Atmosphere of Radioactivity from Hypothetical Large-Scale Accidents at the Proposed Gorleben Waste Treatment Facility", in Chapter 3 of Report of the Gorleben International Review, presented (in German) to the Government of Lower Saxony, March 1979.

*Risks & alternative options re. spent fuel storage at Harris*  
*Appendix E*  
*Page E-5*

Note that a release during a reactor accident (e.g., release category RC-5 at Harris) will contain short-lived radioisotopes as well as cesium-137. Under certain conditions of meteorology and emergency response, the presence of these short-lived radioisotopes in the release could cause many early health effects. Spent fuel contains comparatively small amounts of short-lived radioisotopes. Thus, early health effects are comparatively unlikely if a release occurs from a spent fuel pool.

Table E-1 shows an estimate of the excess cancer mortality attributable to continuous exposure to a relatively low radiation dose rate. This estimate was made by the BEIR V committee of the National Research Council.<sup>8</sup> In Table E-1, a continuous exposure of 1 mSv/year (0.1 rem/year) is assumed to occur throughout life.<sup>9</sup> Such an exposure is estimated to increase the number of fatal cancers, above the normally expected level, by 2.5 percent for males and 3.4 percent for females, with an average of 16-18 years of life lost per excess death. If the dose-response function were linear, it would follow that continuous, lifetime exposure to 10 mSv/year (1 rem/year) would increase the number of fatal cancers by 25 percent for males and 34 percent for females. The shape of the dose-response function is a subject of ongoing debate.

If people continued to occupy urban areas contaminated with cesium-137 to an external exposure level just below 25 rem over 30 years, as was assumed in the Reactor Safety Study, their average exposure during this 30-year period would be 8 mSv/year (0.8 rem/year). An additional, internal exposure would arise from contamination of food and water. After 30 years, rates of external and internal exposure would decline, consistent with the decay of cesium-137. Note that over a period of 300 years (10 half-lives), the activity of cesium-137 will decay to one-thousandth of its initial level.

##### **5. Economic consequences of a release of radioactivity**

Computer models have been developed for estimating the economic consequences of large atmospheric releases of radioactive materials. Findings from such models have been used by the NRC to evaluate the cost-benefit ratio of introducing measures to reduce the probabilities or consequences of spent fuel pool accidents.<sup>10</sup> A review of these models, findings and cost-

---

<sup>8</sup> National Research Council, Health Effects of Exposure to Low Levels of Ionizing Radiation: BEIR V, National Academy Press, Washington, DC, 1990. Table E-1 is adapted from Table 4-2 of the BEIR V report.

<sup>9</sup> The exposure of 1 mSv/year is additional to background radiation, whose effects are accounted for in the normal expectation of cancer mortality.

<sup>10</sup> See, for example: E D Thom, Regulatory Analysis for the Resolution of Generic Issue 82, "Beyond Design Basis Accidents in Spent Fuel Pools, NUREG-1353, April 1989; and J H Jo et al,

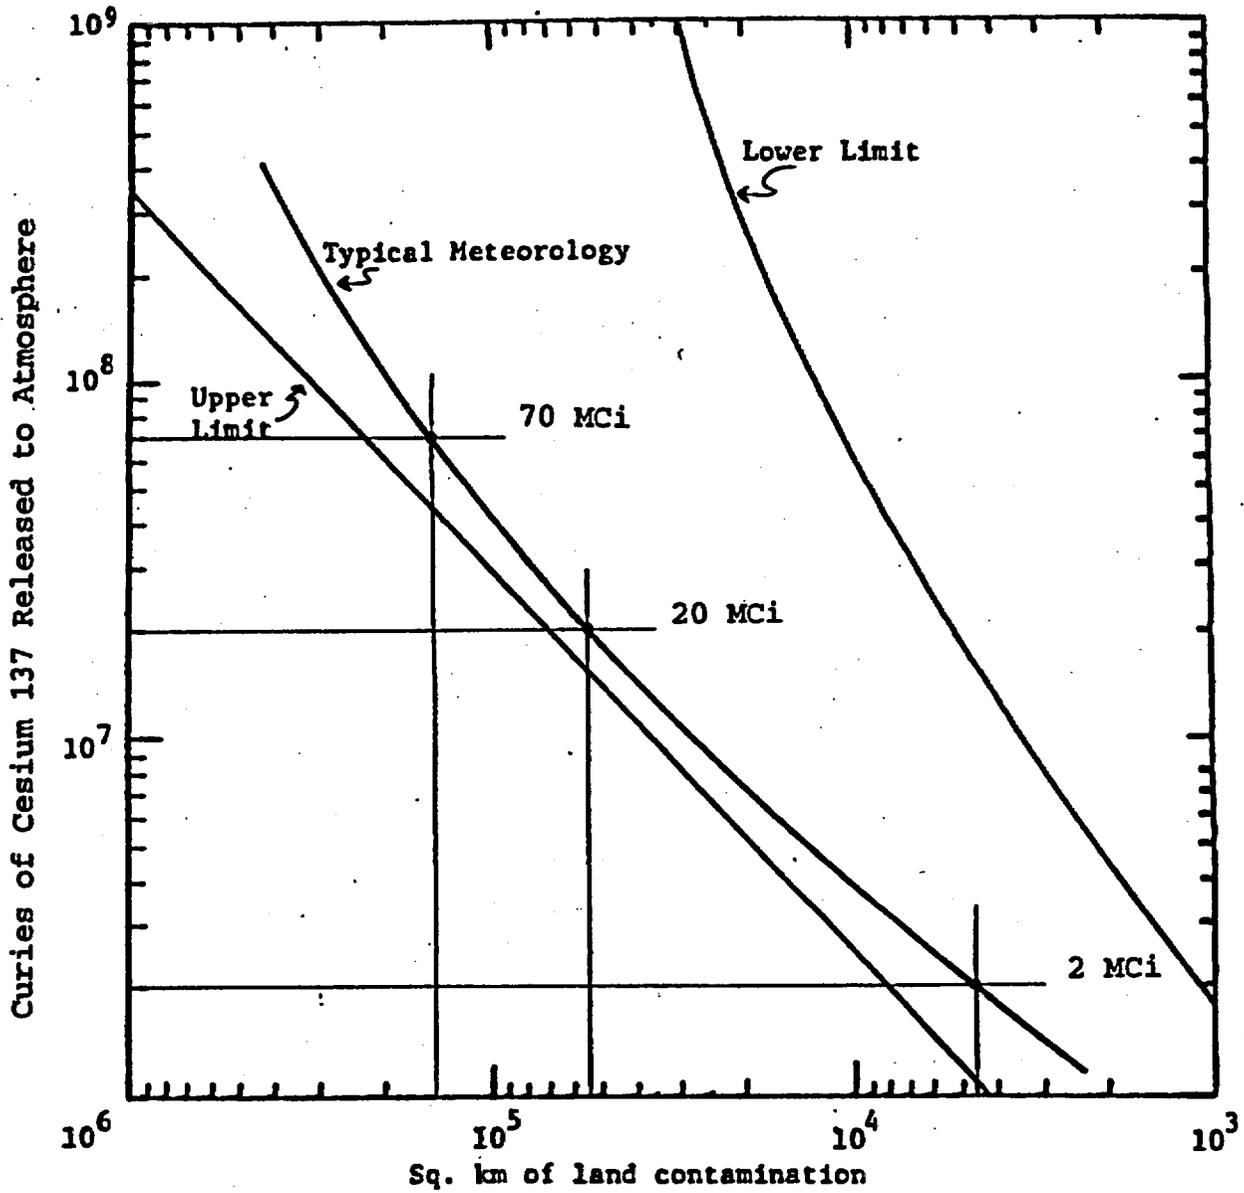


Figure E-1

Contaminated land area as a function of cesium-137 release