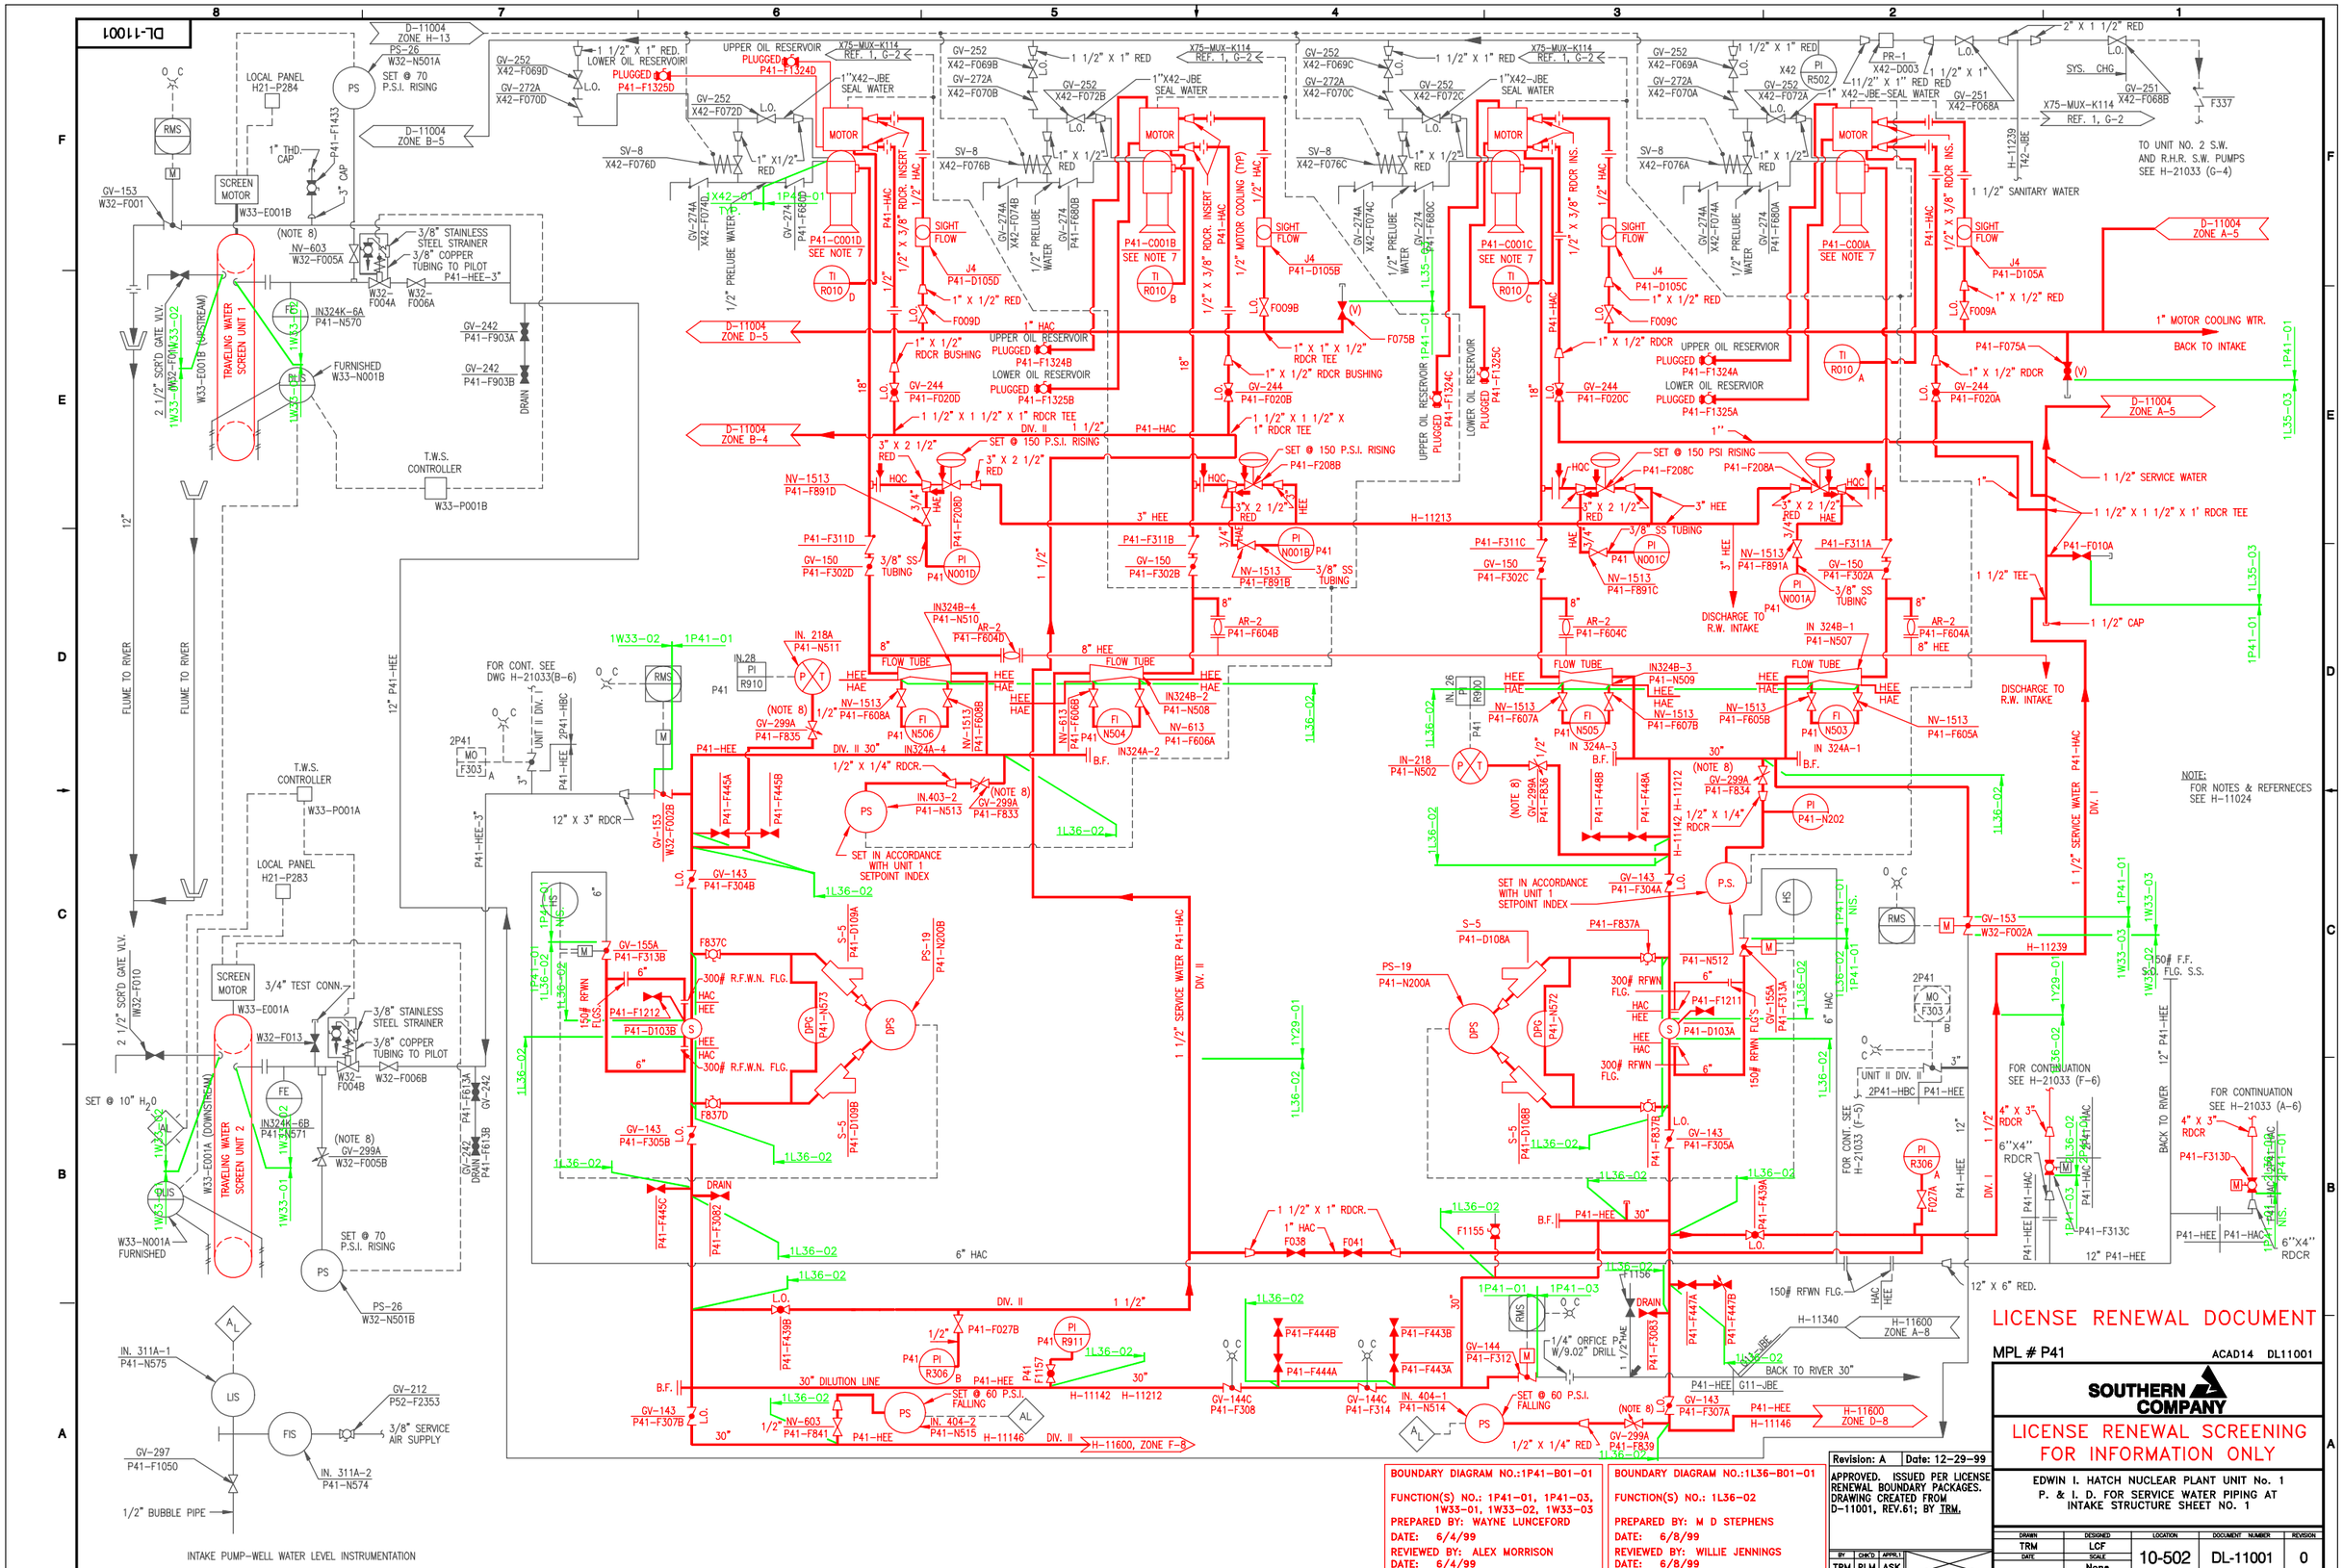
DL-11001
INTAKE PUMP-WELL WATER LEVEL INSTRUMENTATION
TO UNIT NO. 2 S.W. AND R.H.R. S.W. PUMPS SEE H-21033 (G-4)
1" MOTOR COOLING WTR.
BACK TO INTAKE
1 1/2" SERVICE WATER
1 1/2" SANITARY WATER
DISCHARGE TO R.W. INTAKE
FLUME TO RIVER
BACK TO RIVER
NOTE: FOR NOTES & REFERNECES SEE H-11024
LICENSE RENEWAL DOCUMENT
MPL # P41
ACAD14 DL11001
SOUTHERN COMPANY
LICENSE RENEWAL SCREENING FOR INFORMATION ONLY
EDWIN I. HATCH NUCLEAR PLANT UNIT No. 1
P. & I. D. FOR SERVICE WATER PIPING AT INTAKE STRUCTURE SHEET NO. 1
BOUNDARY DIAGRAM NO.:P41-B01-01
FUNCTION(S) NO.: 1P41-01, 1P41-03, 1W33-01, 1W33-02, 1W33-03
PREPARED BY: WAYNE LUNCEFORD
DATE: 6/4/99
REVIEWED BY: ALEX MORRISON
DATE: 6/4/99
BOUNDARY DIAGRAM NO.:1L36-B01-01
FUNCTION(S) NO.: 1L36-02
PREPARED BY: M D STEPHENS
DATE: 6/8/99
REVIEWED BY: WILLIE JENNINGS
DATE: 6/8/99
Revision: A
Date: 12-29-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM D-11001, REV.61; BY TRM.
TRM
RLM
ASK
TRM
LCF
None
10-502
DL-11001
0