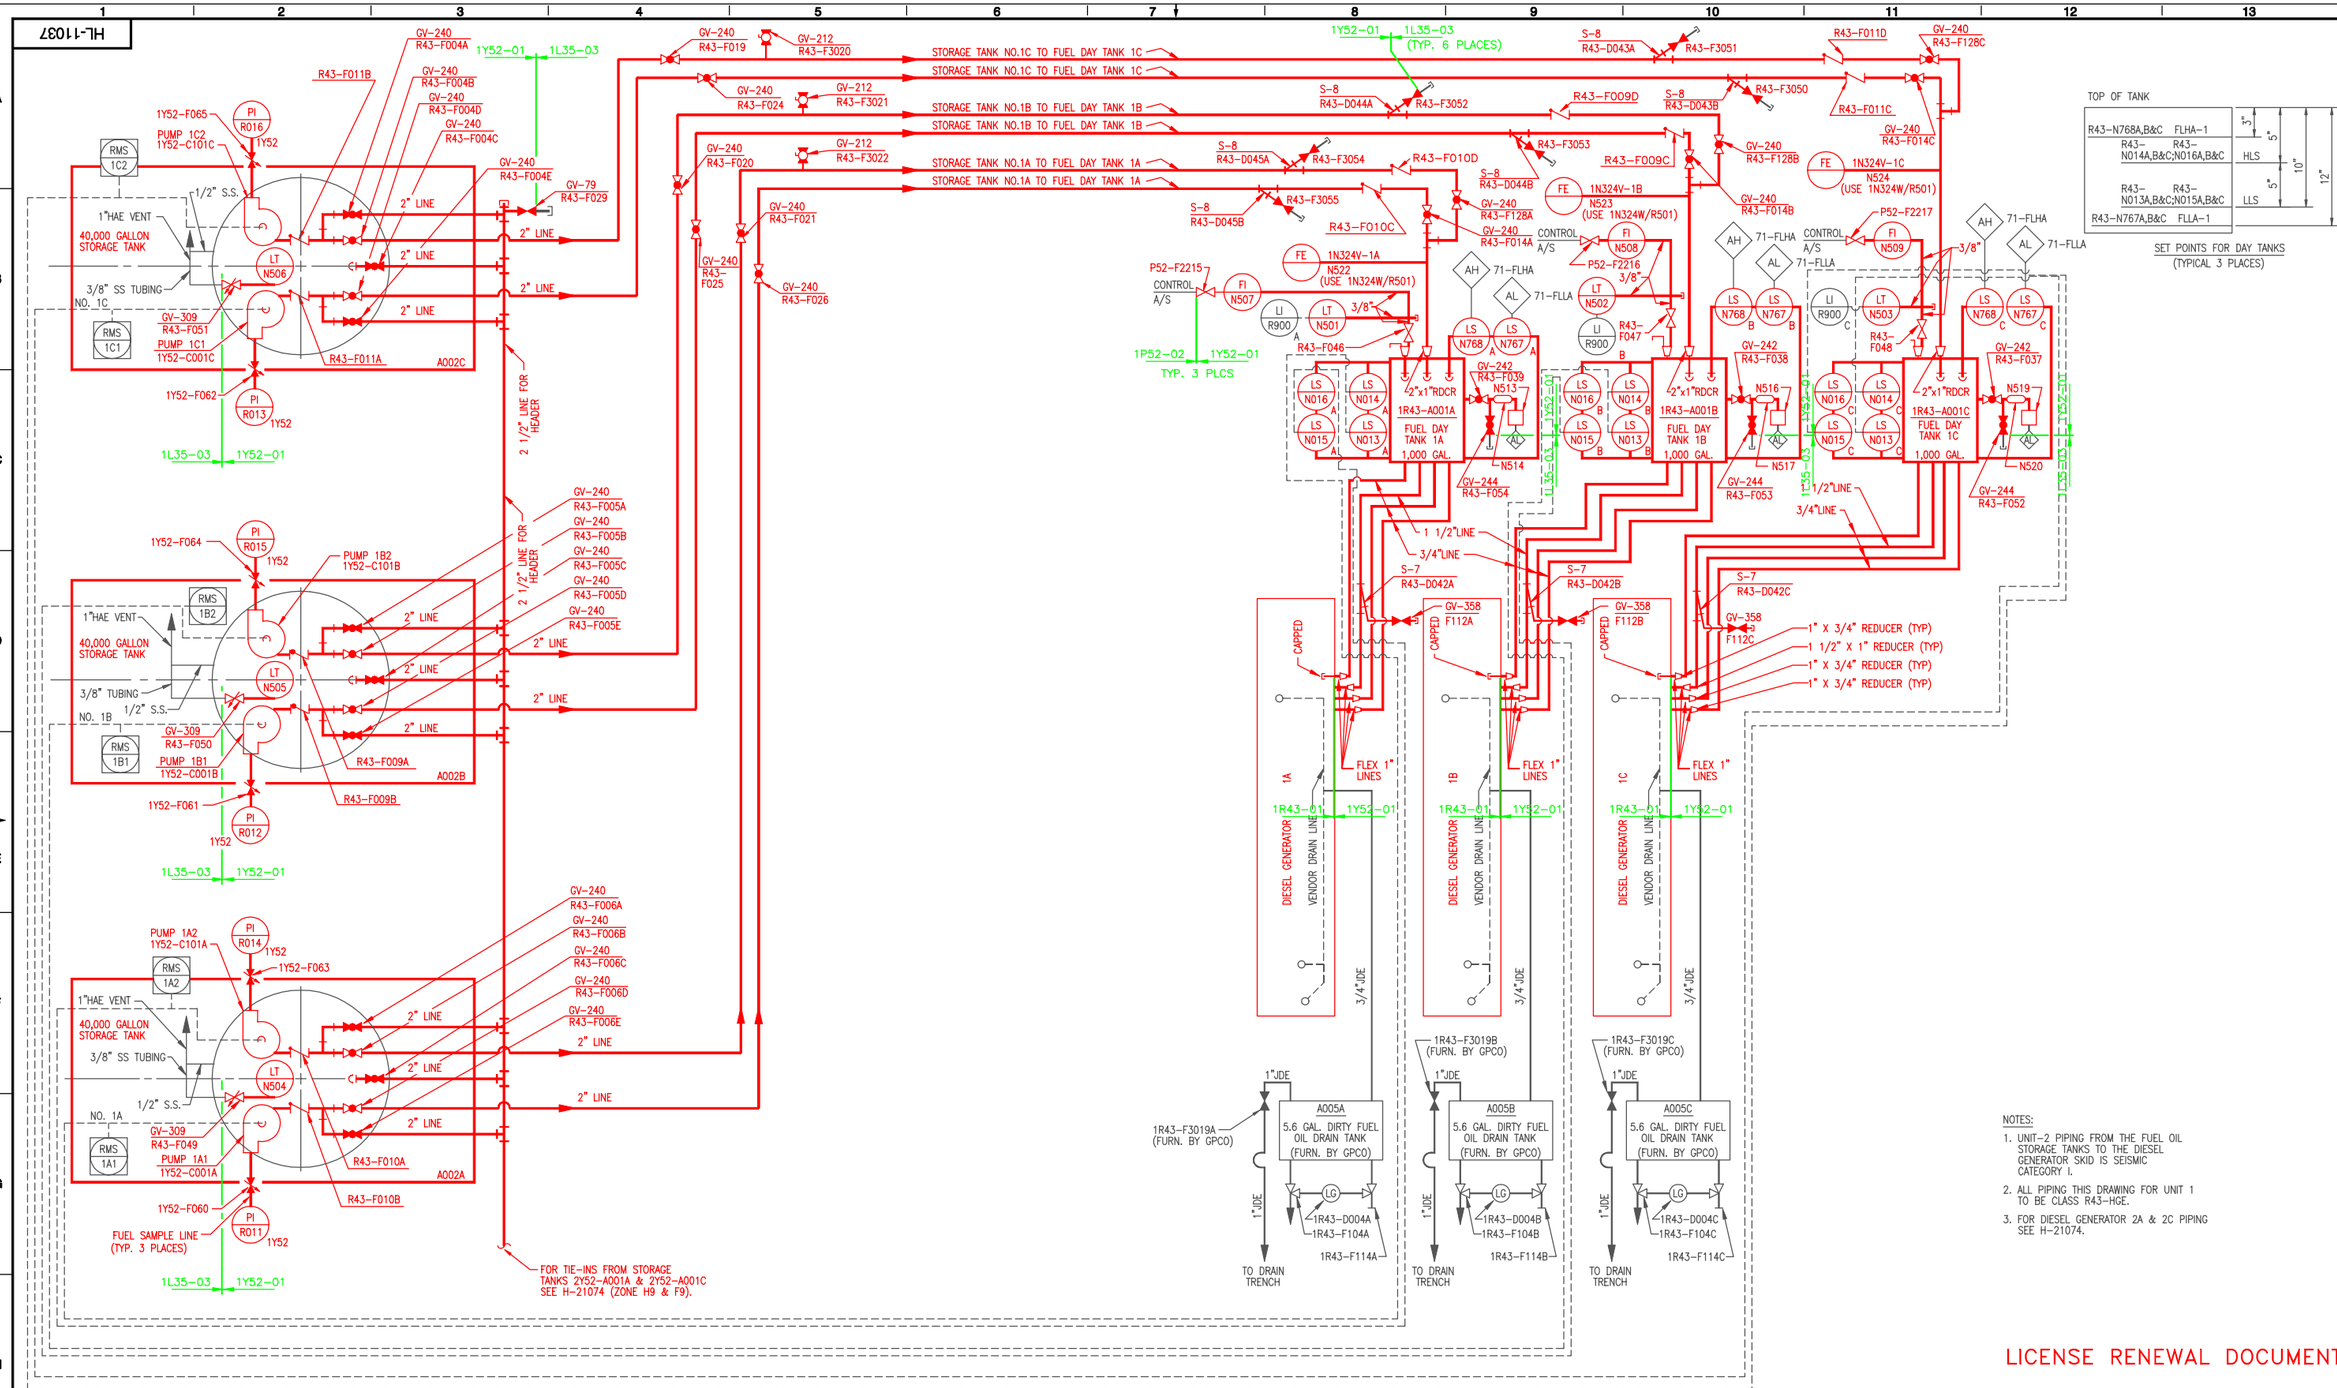

NOTES:

1. UNIT-2 PIPING FROM THE FUEL OIL STORAGE TANKS TO THE DIESEL GENERATOR SKID IS SEISMIC CATEGORY I.
2. ALL PIPING THIS DRAWING FOR UNIT 1 TO BE CLASS R43-HGE.
3. FOR DIESEL GENERATOR 2A & 2C PIPING SEE H-21074.

LICENSE RENEWAL DOCUMENT

BOUNDARY DIAGRAM NO.:1Y52-B01-01

FUNCTION(S) NO.: 1Y52-01

PREPARED BY: ALEX MORRISON
DATE: 1/28/98
REVIEWED BY: BO ROSBERG
DATE: 2/18/98

Revision: A	Date: 11-17-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11037, REV.26; BY TRM.	

BY	CHK'D	APPR'L
TRM	RLM	ASK

MPL NO. R43 | ACAD14 | HL11037

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT NO. 1 & 2
P&ID FUEL OIL DIESEL OIL SYSTEM

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-11037	A
DATE	SCALE: None			