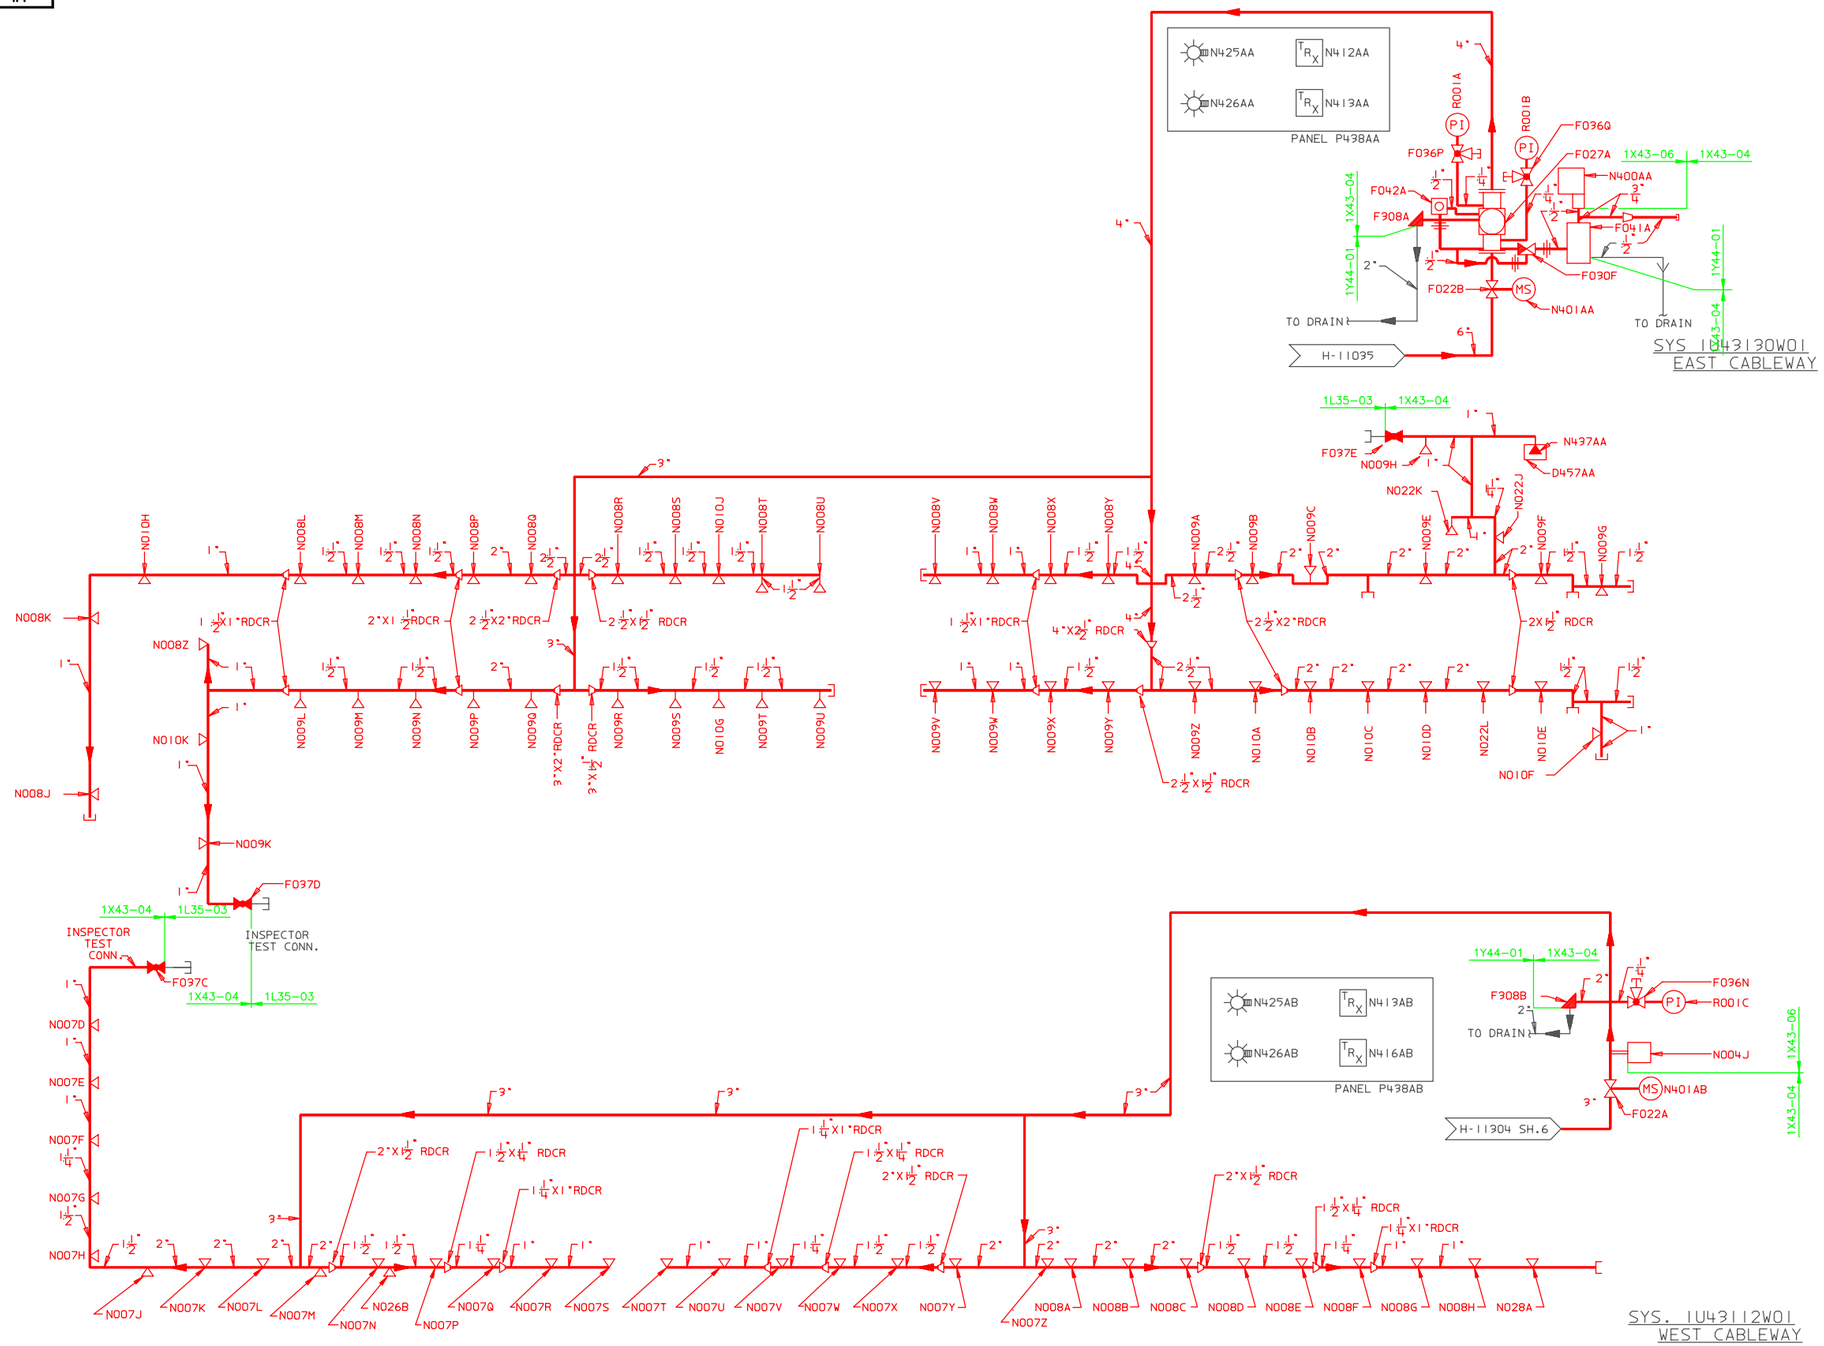

LEGEND:

- PRESSURE INDICATOR
- PRESSURE SWITCH
- MONITOR SWITCH
- ALARM VALVE
- GATE VALVE
- GLOBE VALVE (N.O.)
- ANGLE VALVE (N.C.)
- 3 WAY MULTIPORT VALVE
- CHECK VALVE
- RESTRICTION FLOW VALVE
- ADDRESSABLE INTERFACE MODULE
- INDICATING LIGHT
- RETARD CHAMBER
- FLOW SWITCH
- GLOBE VALVE (N.C.)
- SIDE OUTLET GLOBE VALVE
- DRIP FUNNEL
- UNION
- REDUCER
- FLOW DIRECTION
- CAP
- STRAINER - MODEL B-1
- SPRAY NOZZLE (CLOSED)
- PLUG

NOTES:

1. ALL MPL NO'S ARE PRECEDED BY U43

REFERENCES:

SX-11121	EAST CABLEWAY @ EL.130'-0"
SX-11954	EAST CABLEWAY @ EL.130'-0"
B-11852	FIRE PROT FCD - 1U43112W01
B-11855	FIRE PROT FCD - 1U43130W01

LICENSE RENEWAL DOCUMENT

BOUNDARY DIAGRAM NO.:1X43-B01-06

FUNCTION(S) NO.: 1X43-04
1X43-06
PREPARED BY: M D STEPHENS
DATE: 2/5/98
REVIEWED BY: ALEX MORRISON
DATE: 7/13/98

Revision: A	Date: 12-23-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11304 SH.1, REV.17; BY TRM.

BY	CHK'D	APPR.1
TRM	MDS	ASK

1U43 | ACAD14 | HL1130401

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No. 1
FIRE PROTECTION PIPING E & W
CABLEWAYS SPRINKLER SYS P&ID

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-11304 SHEET 1 OF 10	A
DATE	SCALE: None			