HL-11304
SHEET 5

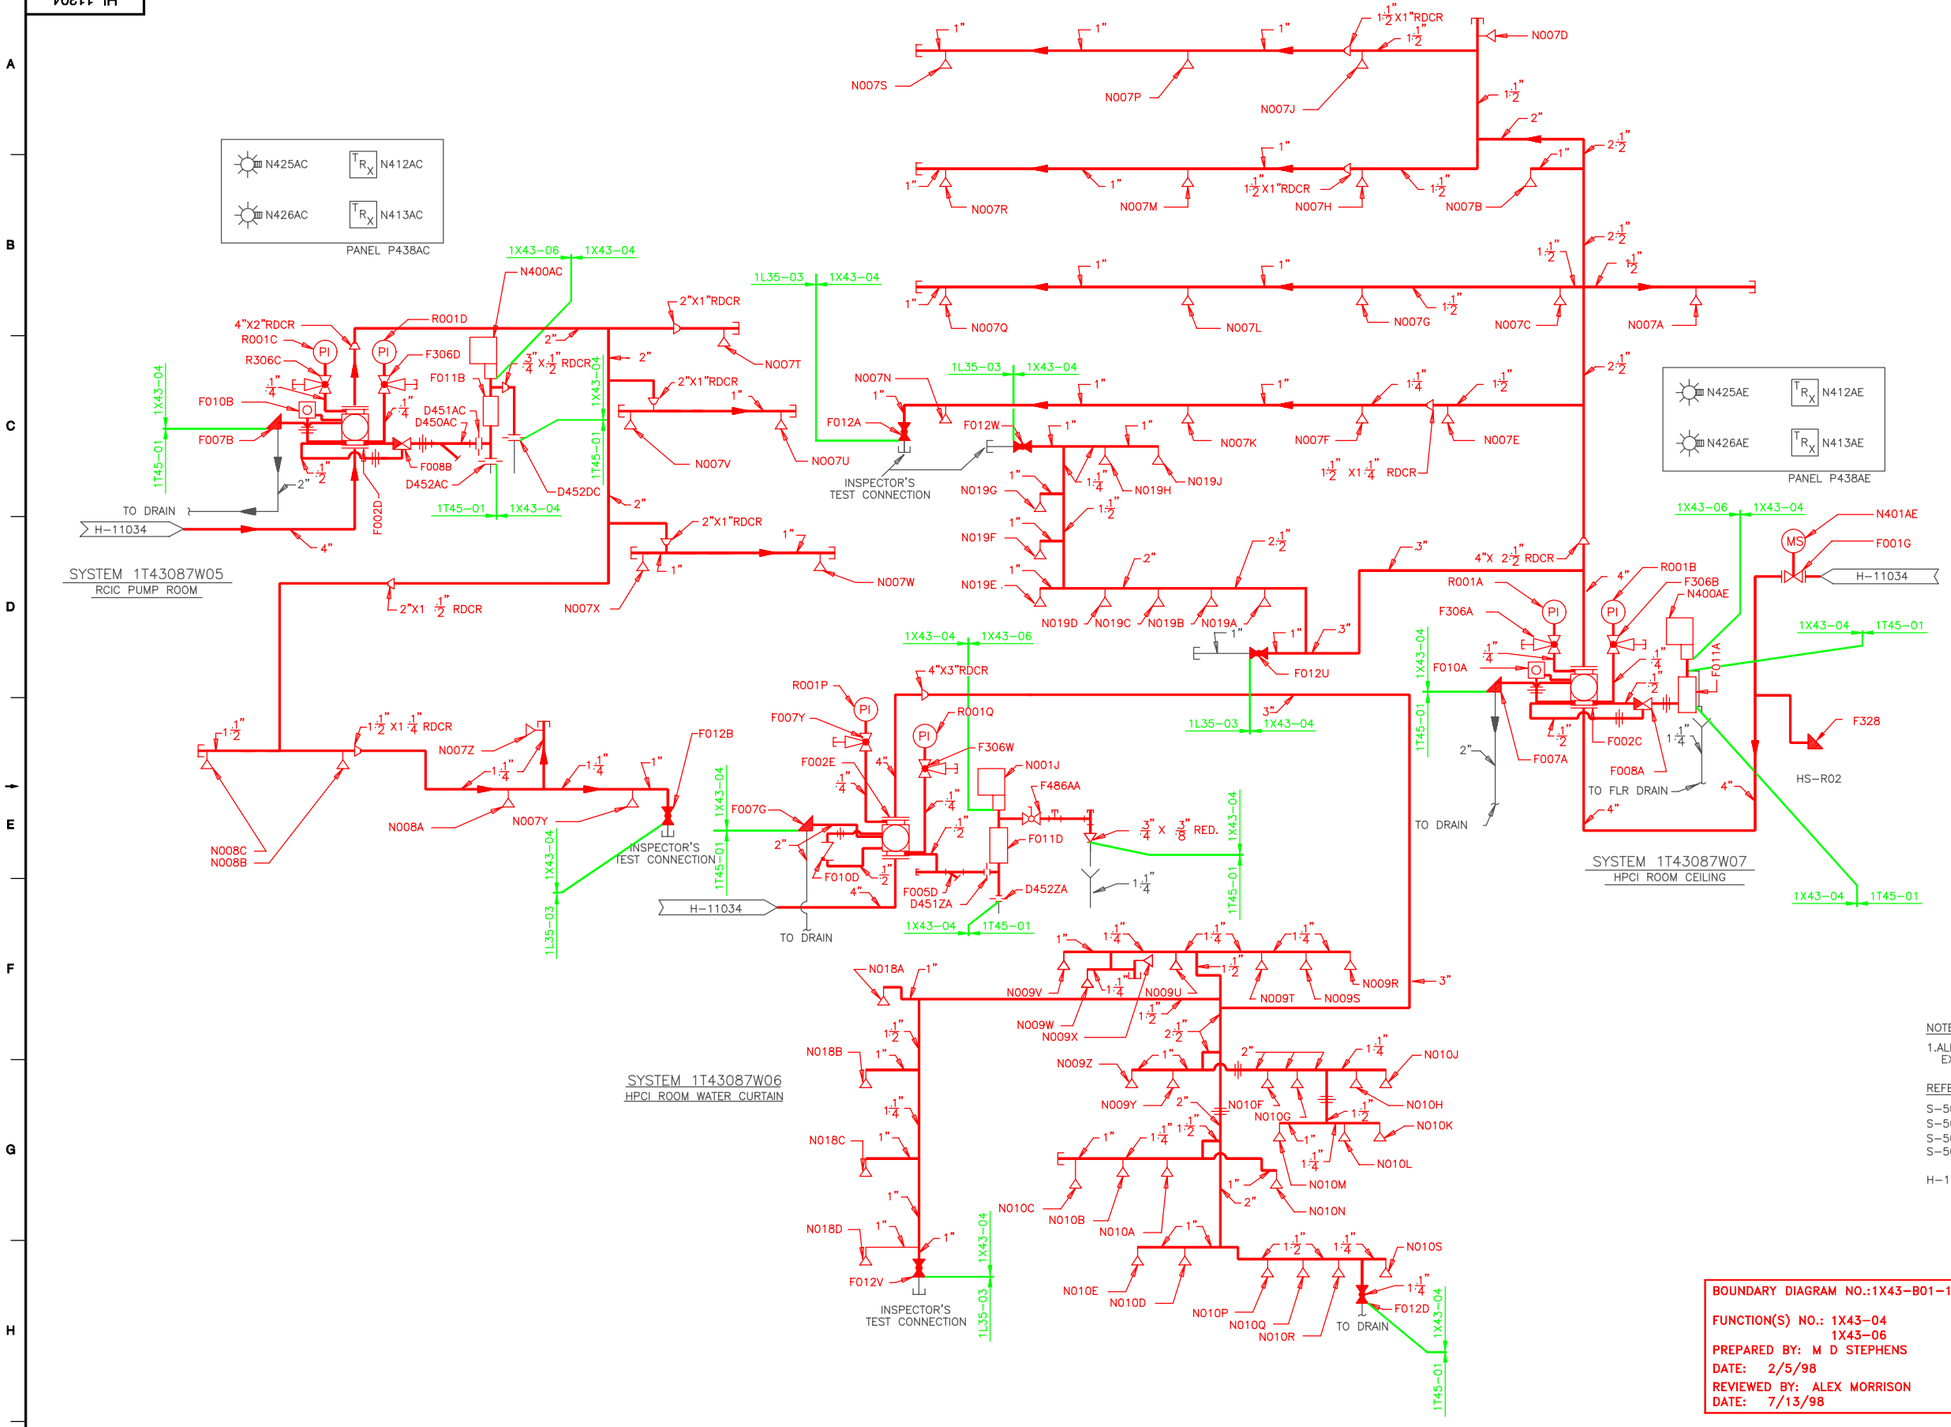

LEGEND:

- PI — PRESSURE INDICATOR
- PRESSURE SWITCH
- MS — MONITOR SWITCH
- ALARM VALVE
- GATE VALVE
- GLOBE VALVE(NC)
- ANGLE VALVE(NC)
- 3-WAY MULTIPORT VALVE
- CHECK VALVE
- RESTRICTION FLOW VALVE
- RETARD CHAMBER
- SPRINKLER HEAD (CLOSED HEAD)
- LINE REDUCER
- FLOW ARROW
- SIDE OUTLET GLOBE VALVE
- UNION
- STRAINER
- ORIFICE
- DRIP FUNNEL
- PLUG
- CAP
- TRX — ADDRESSABLE INTERFACE MODULE
- INDICATING LIGHT

NOTES:

1. ALL MPL NO.'S ON THIS DWG ARE PRECEDED BY T43 EXCEPT WHERE LISTED.

REFERENCES:

S-50167	HPCI PUMP AND TURBINE ROOM
S-50084	RCIC PUMP AND TURBINE ROOM
S-50166	ISOMETRICS FOR SEISMIC ANAL
S-50083	INTAKE STRUCT FIRE PROTECTION SYS-HPCI ROOM-WATER CURTAIN
H-11034	FIRE PROTECTION P&ID - UNIT 1 REACTOR & RADWASTE BLDGS.

BOUNDARY DIAGRAM NO.:1X43-B01-17
FUNCTION(S) NO.: 1X43-04
1X43-06
PREPARED BY: M D STEPHENS
DATE: 2/5/98
REVIEWED BY: ALEX MORRISON
DATE: 7/13/98

LICENSE RENEWAL DOCUMENT

MPL NO. 1T43 | ACAD14 | HL1130405

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

Revision: A | Date: 10-14-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11304 SH.5, REV.13; BY TRM.

BY	CHK'D	APPR'L
TRM	MDS	ASK

EDWIN I. HATCH NUCLEAR PLANT - UNIT 1 - FIRE PROTECTION - P&ID HPCI & RCIC PUMP & TURB ROOM

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-11304 SH. 5 OF 10	A
DATE	SCALE: None			