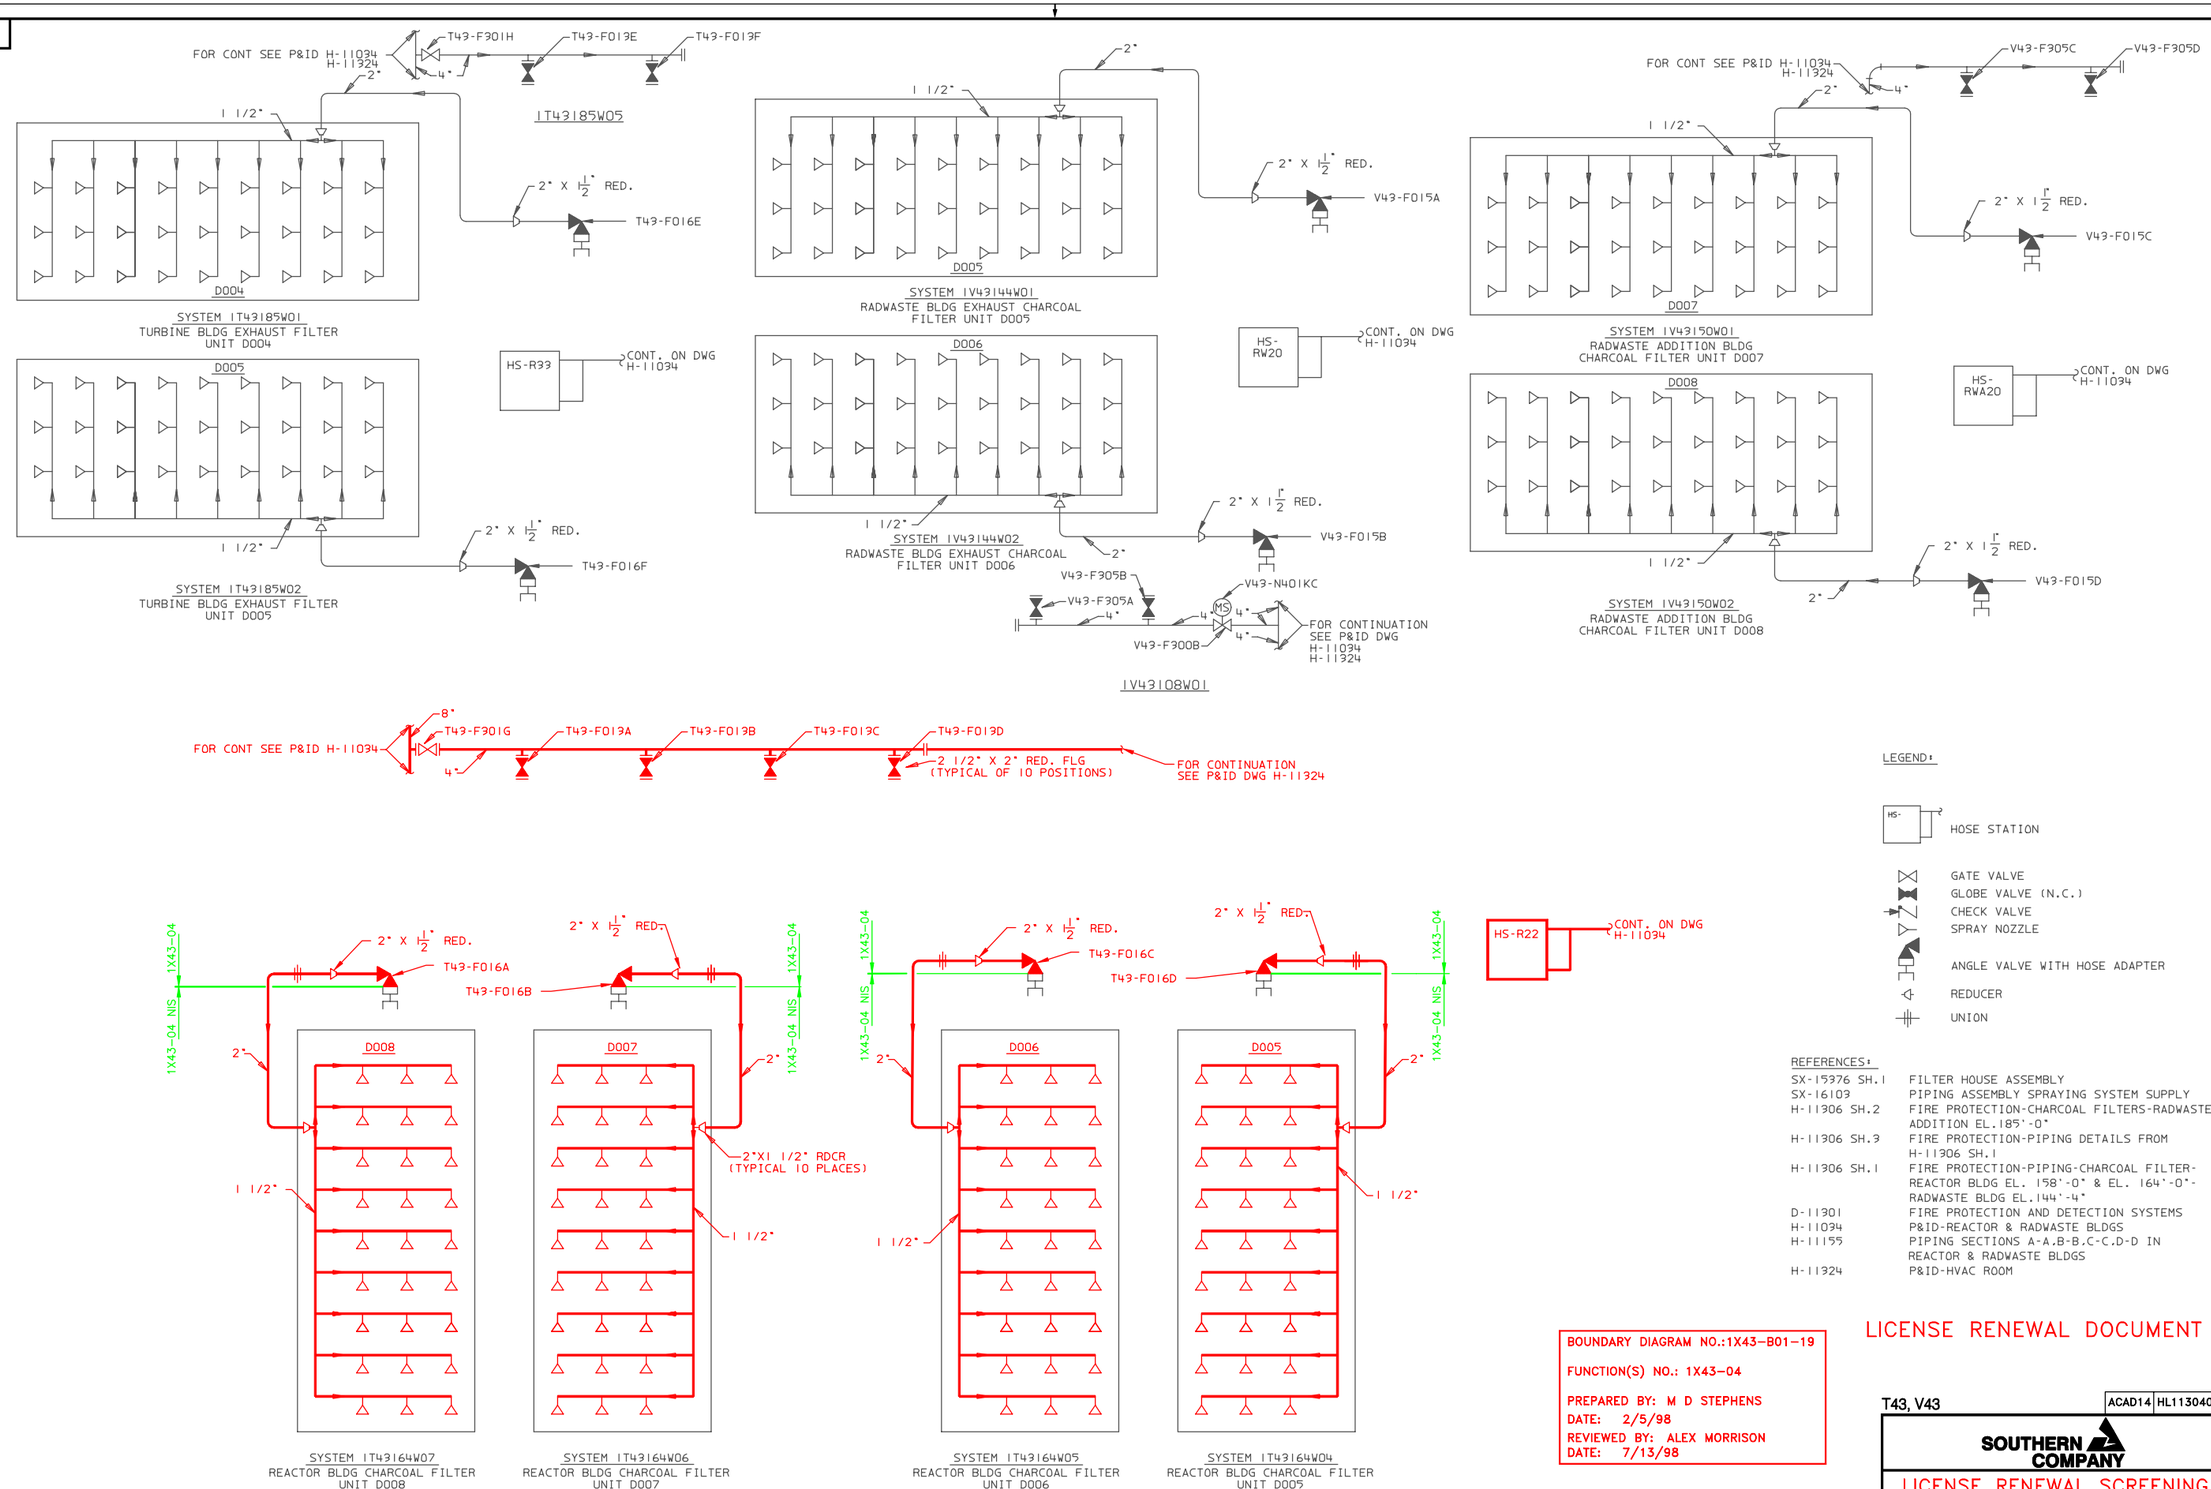

LEGEND:

- HS- HOSE STATION
- GATE VALVE
- GLOBE VALVE (N.C.)
- CHECK VALVE
- SPRAY NOZZLE
- ANGLE VALVE WITH HOSE ADAPTER
- REDUCER
- UNION

REFERENCES:

SX-15976 SH.1	FILTER HOUSE ASSEMBLY
SX-16103	PIPING ASSEMBLY SPRAYING SYSTEM SUPPLY
H-11306 SH.2	FIRE PROTECTION-CHARCOAL FILTERS-RADWASTE ADDITION EL.185'-0"
H-11306 SH.3	FIRE PROTECTION-PIPING DETAILS FROM H-11306 SH.1
H-11306 SH.1	FIRE PROTECTION-PIPING-CHARCOAL FILTER-REACTOR BLDG EL. 158'-0" & EL. 164'-0"-RADWASTE BLDG EL.144'-4"
D-11301	FIRE PROTECTION AND DETECTION SYSTEMS
H-11034	P&ID-REACTOR & RADWASTE BLDGS
H-11155	PIPING SECTIONS A-A,B-B,C-C,D-D IN REACTOR & RADWASTE BLDGS
H-11324	P&ID-HVAC ROOM

BOUNDARY DIAGRAM NO.:1X43-B01-19

FUNCTION(S) NO.: 1X43-04

PREPARED BY: M D STEPHENS
DATE: 2/5/98
REVIEWED BY: ALEX MORRISON
DATE: 7/13/98

LICENSE RENEWAL DOCUMENT

T43, V43

ACAD14 | HL1130408

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING
FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT
UNIT 1 FIRE PROT-P&ID-REAC &
RADW BLDGS CHARCOAL FLTRS

Revision: A	Date: 11-19-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11304 SH.8, REV.9; BY TRM.	

BY	CHK'D	APPR.1
TRM	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-11304 SH. 8 OF 10	A
DATE	SCALE None			