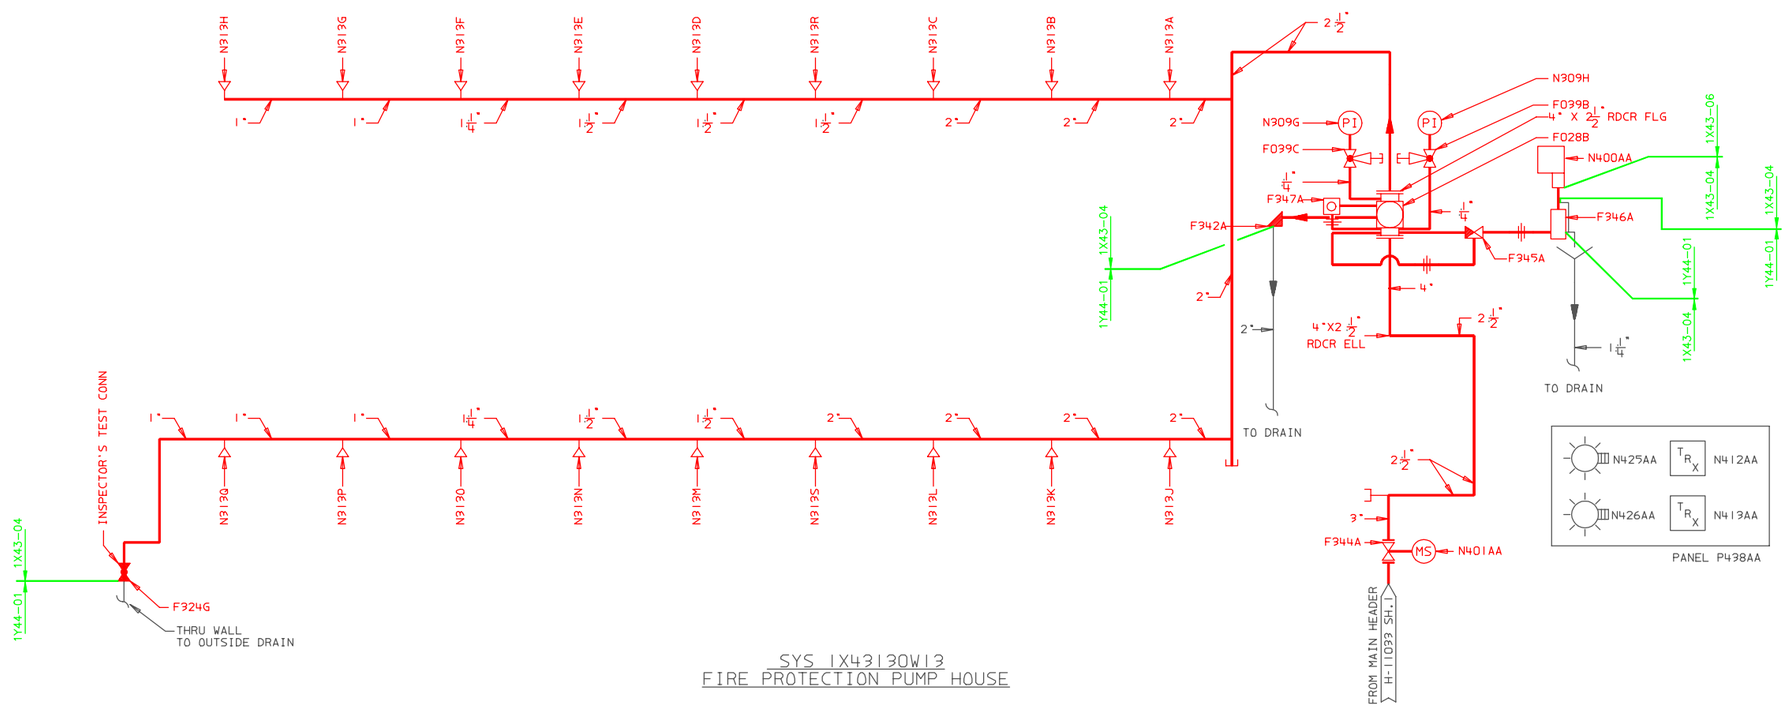

SYS 1X43130W13
FIRE PROTECTION PUMP HOUSE

LEGEND:

- DRIP FUNNEL
- FLOW DIRECTION
- CAP
- PLUG
- GLOBE VALVE (N.C.)
- PRESSURE SWITCH
- PRESSURE INDICATOR
- MONITOR SWITCH
- ALARM VALVE
- INDICATING LIGHT
- GATE VALVE (N.O.)
- SIDE OUTLET GLOBE VALVE
- ANGLE VALVE(N.C.)
- 3-WAY MULTIPORT VALVE
- CHECK VALVE
- RESTRICTION CHECK VALVE
- ADDRESSABLE INTERFACE MODULE
- RETARD CHAMBER
- SPRINKLER HEAD
- UNION

NOTES:

1. ALL MPL NO.S ON THIS DWG ARE PRECEDED BY X43.

REFERENCES:

B-11942	FIRE PROT FCD-1X43130W13
H-40279	FIRE PROT PUMPHOUSE SPRINKLER SYSTEM
D-11031	FIRE PROTECTION & DETECTION SYS

BOUNDARY DIAGRAM NO.:1X43-B01-04
FUNCTION(S) NO.: 1X43-04
1X43-06
PREPARED BY: M D STEPHENS
DATE: 2/5/98
REVIEWED BY: ALEX MORRISON
DATE: 7/13/98

LICENSE RENEWAL DOCUMENT

MPL NO. X43 | ACAD14 | HL1130410

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
FIRE PROTECTION P&ID
SPRINKLER SYS. 1FH-73
FP PUMPHOUSE

Revision: A	Date: 12-23-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11304 SH.10, REV.6; BY TRM.	

BY	CHK'D	APPR.1
TRM	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-11304 SH.10 OF 10	A
DATE	SCALE None			