HL-11326

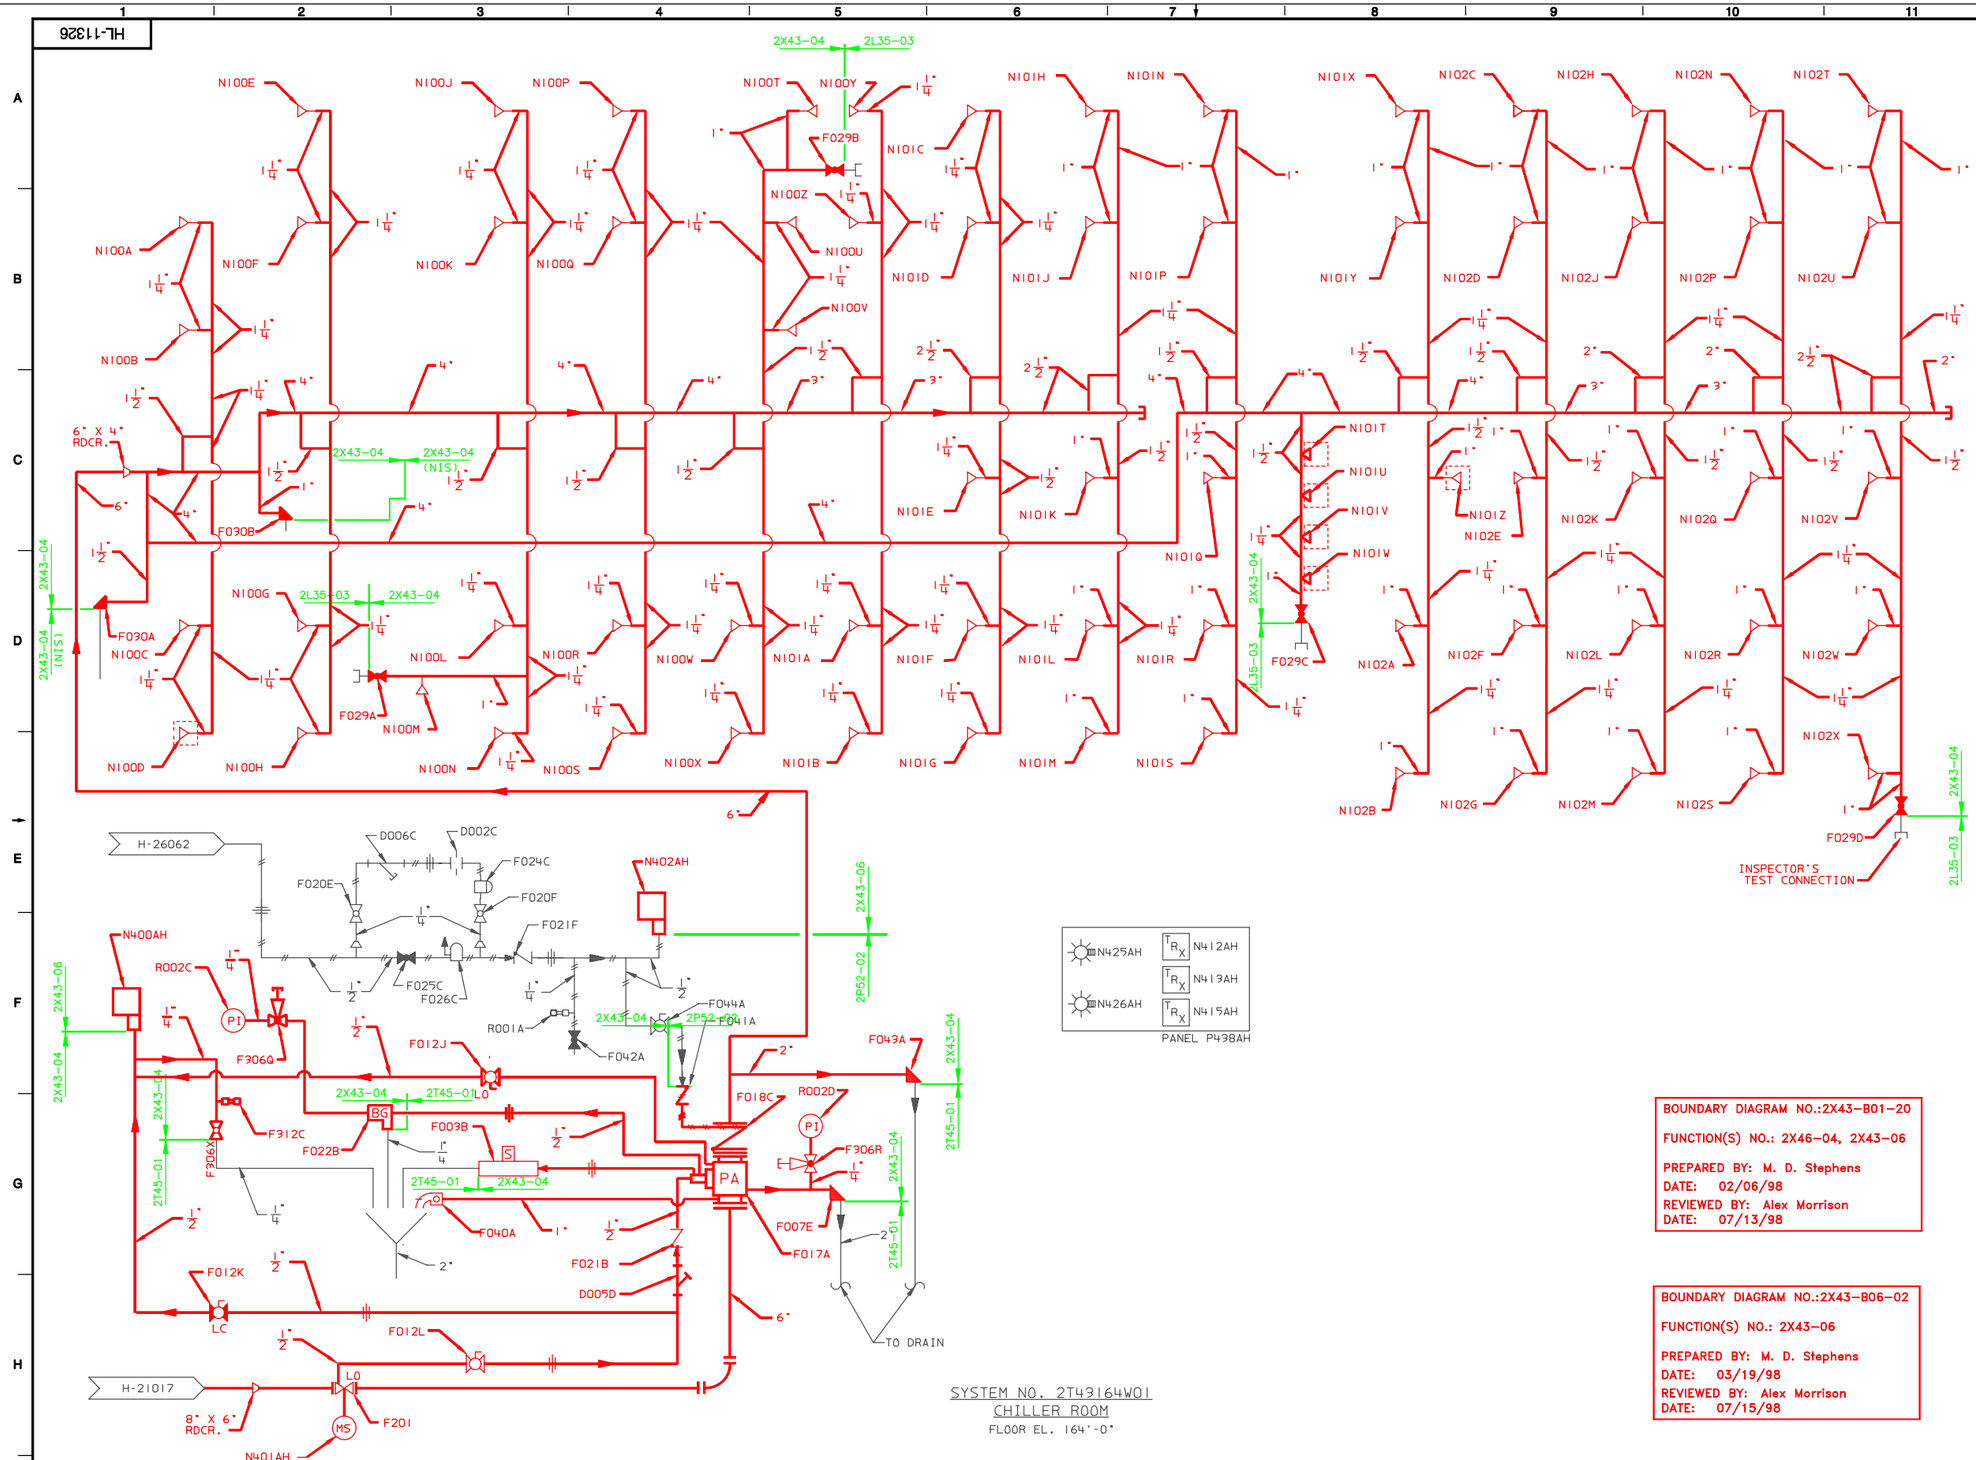

SYSTEM NO. 2T43164W01
CHILLER ROOM
FLOOR EL. 164'-0"

LEGEND:

- EA - 1 135° NOZZLE WITH BAFFLE
- PRESSURE RELIEF VALVE
- INSTRUMENT TEST CONNECTION
- PRESSURE REGULATOR
- PRESSURE SWITCH
- RESTRICTIVE ORIFICE
- BALL DRIP VALVE
- BALL VALVE (LOCK CLOSE)
- BALL VALVE (LOCK OPEN)
- EA - 1 135° NOZZLE
- PRESSURE INDICATOR
- MONITOR SWITCH
- MULTIMATIC VALVE (PREACTION)
- GATE VALVE (LOCK OPEN)
- GLOBE VALVE (NC)
- ANGLE VALVE (NC)
- CHECK VALVE
- BREAK GLASS STATION
- STRAINER
- FLOW DIRECTION
- UNION
- PLUG
- ADDRESSABLE INTERFACE MODULE
- INDICATING LIGHT
- 2 WAY SOLENOID VALVE
- GLOBE VALVE (NO)
- SIDE OUTLET GLOBE VALVE
- CAP

NOTES:

1. ALL MPL NUMBERS ARE PRECEDED BY 2T43 UNLESS NOTED OTHERWISE.

REFERENCES:

B-24620	FIRE PROTECTION FCD - SYSTEM NO. 2T43164W01
H-21017	REACTOR & RADWASTE BUILDINGS - FIRE PROTECTION SYSTEM P&ID
H-21179	REACTOR BUILDING - FIRE PROTECTION SYSTEM - SECTIONS
S-50080	FIRE PROTECTION SPRAY/SPR. SYSTEM - HVAC RM. UNIT 2 HANGER PLAN ABOVE EL. 164'-0"
S-50081	FIRE PROTECTION SPRAY/SPR. SYSTEM - ISOMETRICS - HVAC ROOM UNIT 2
S-50266	T. P. SPRAY/SPR. SYSTEM - FDMN & CRSMN HANGERS & 8" SUPPLY HANGERS - HVAC UNIT 2
SX-14522	INSTRUMENTS - FIRE PROTECTION SPRINKLER SYSTEMS

BOUNDARY DIAGRAM NO.:2X43-B01-20
FUNCTION(S) NO.: 2X46-04, 2X43-06
PREPARED BY: M. D. Stephens
DATE: 02/06/98
REVIEWED BY: Alex Morrison
DATE: 07/13/98

BOUNDARY DIAGRAM NO.:2X43-B06-02
FUNCTION(S) NO.: 2X43-06
PREPARED BY: M. D. Stephens
DATE: 03/19/98
REVIEWED BY: Alex Morrison
DATE: 07/15/98

LICENSE RENEWAL DOCUMENT

MPL NO. 2T43 | ACAD14 | HL1132601

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
FIRE PROTECTION – PIPING– P&ID
HVAC ROOM

Revision: A	Date: 10-20-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-113261, REV 8; BY BKN.	

BY	CHK'D	APPR.1
BKN	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
BKN	LCF	10-502	HL-11326	A
DATE	SCALE None			