HL-11374

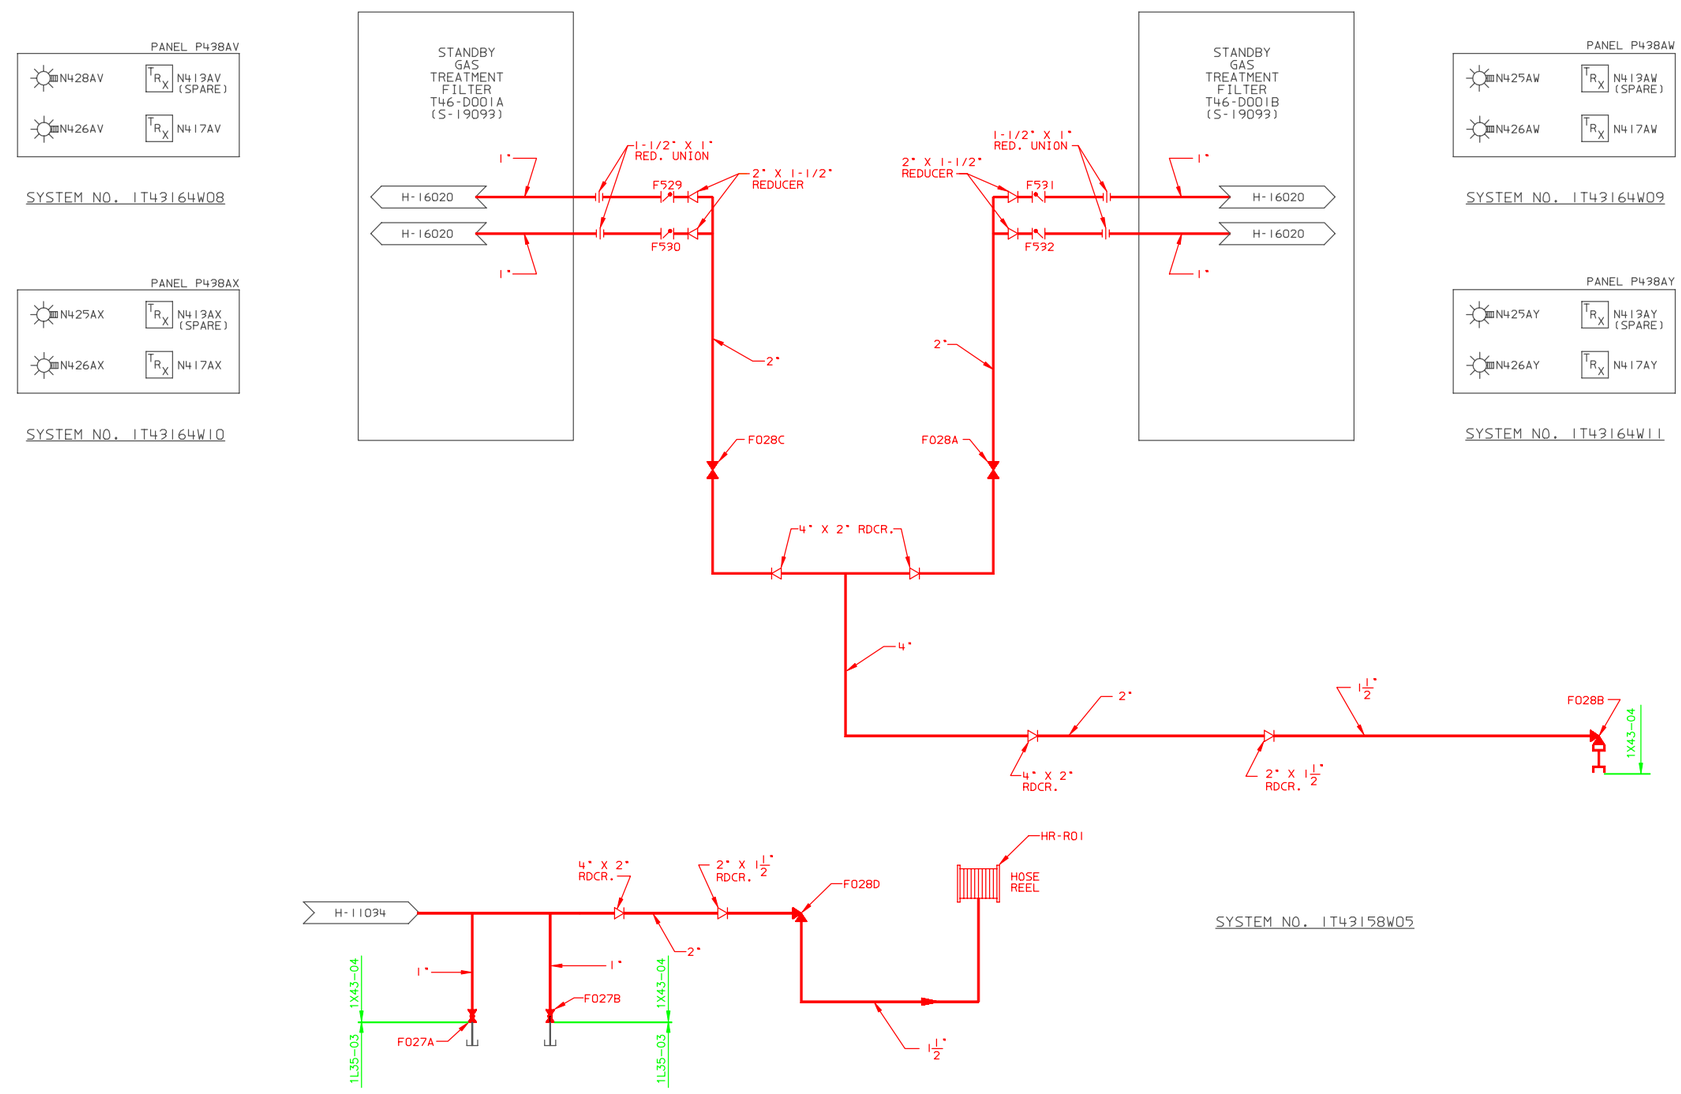

LEGEND

- O.S.&Y. VALVE (N.O.)
- GLOBE VALVE (N.C.)
- PLUG OR CAP
- MONITOR SWITCH
- ANGLE VALVE
- O.S.&Y. VALVE (N.C.)
- CHECK VALVE
- REDUCER
- HOSE COUPLING
- INDICATOR LIGHT
- ADDRESSABLE INTERFACE MODULE
- HOSE REEL

NOTES:

1. ALL MPL NUMBERS ARE PRECEDED BY 1T43 UNLESS OTHERWISE NOTED.

REFERENCES:

B-11831	FIRE PROTECTION FCD - ZONE 1T43158W05
B-11839	FIRE PROTECTION FCD - ZONE 1T43164W08
B-11840	FIRE PROTECTION FCD - ZONE 1T43164W09
B-11841	FIRE PROTECTION FCD - ZONE 1T43164W10
B-11842	FIRE PROTECTION FCD - ZONE 1T43164W11
H-11034	FIRE PROTECTION - REACTOR & RADWASTE BUILDINGS
H-11155	PIPING SECTION "A-A", "B-B", "C-C" & "D-D" IN REACTOR & RADWASTE BUILDINGS
S-19093	STAND-BY GAS SYSTEM MOD. N-192
S-50269	FIRE PROTECTION - ISOMETRIC & HANGER DETAIL TO SYSTEM 1T43164W01 & W03 HVAC ROOM N. & S. SYSTEM
S-50278	FIRE PROTECTION - SPRAY / SPRINKLER SYSTEM - 4" SUPPLY TO UNIT 1 STAND-BY GAS
SX-14522	INSTRUCTION MANUAL

BOUNDARY DIAGRAM NO.:1X43-B01-21

FUNCTION(S) NO.: 1X43-04

PREPARED BY: M D STEPHENS
DATE: 2/5/98
REVIEWED BY: ALEX MORRISON
DATE: 7/13/98

LICENSE RENEWAL DOCUMENT

1T43 | ACAD14 | HL1137401

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
FIRE PROTECTION – P&ID – STAND – BY GAS TREATMENT FILTER SYSTEM

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-11374	A
DATE	SCALE None			

Revision: A	Date: 10-26-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11374, REV.8; BY TRM.

BY	CHK'D	APPR'D
TRM	MDS	ASK