HL-11611

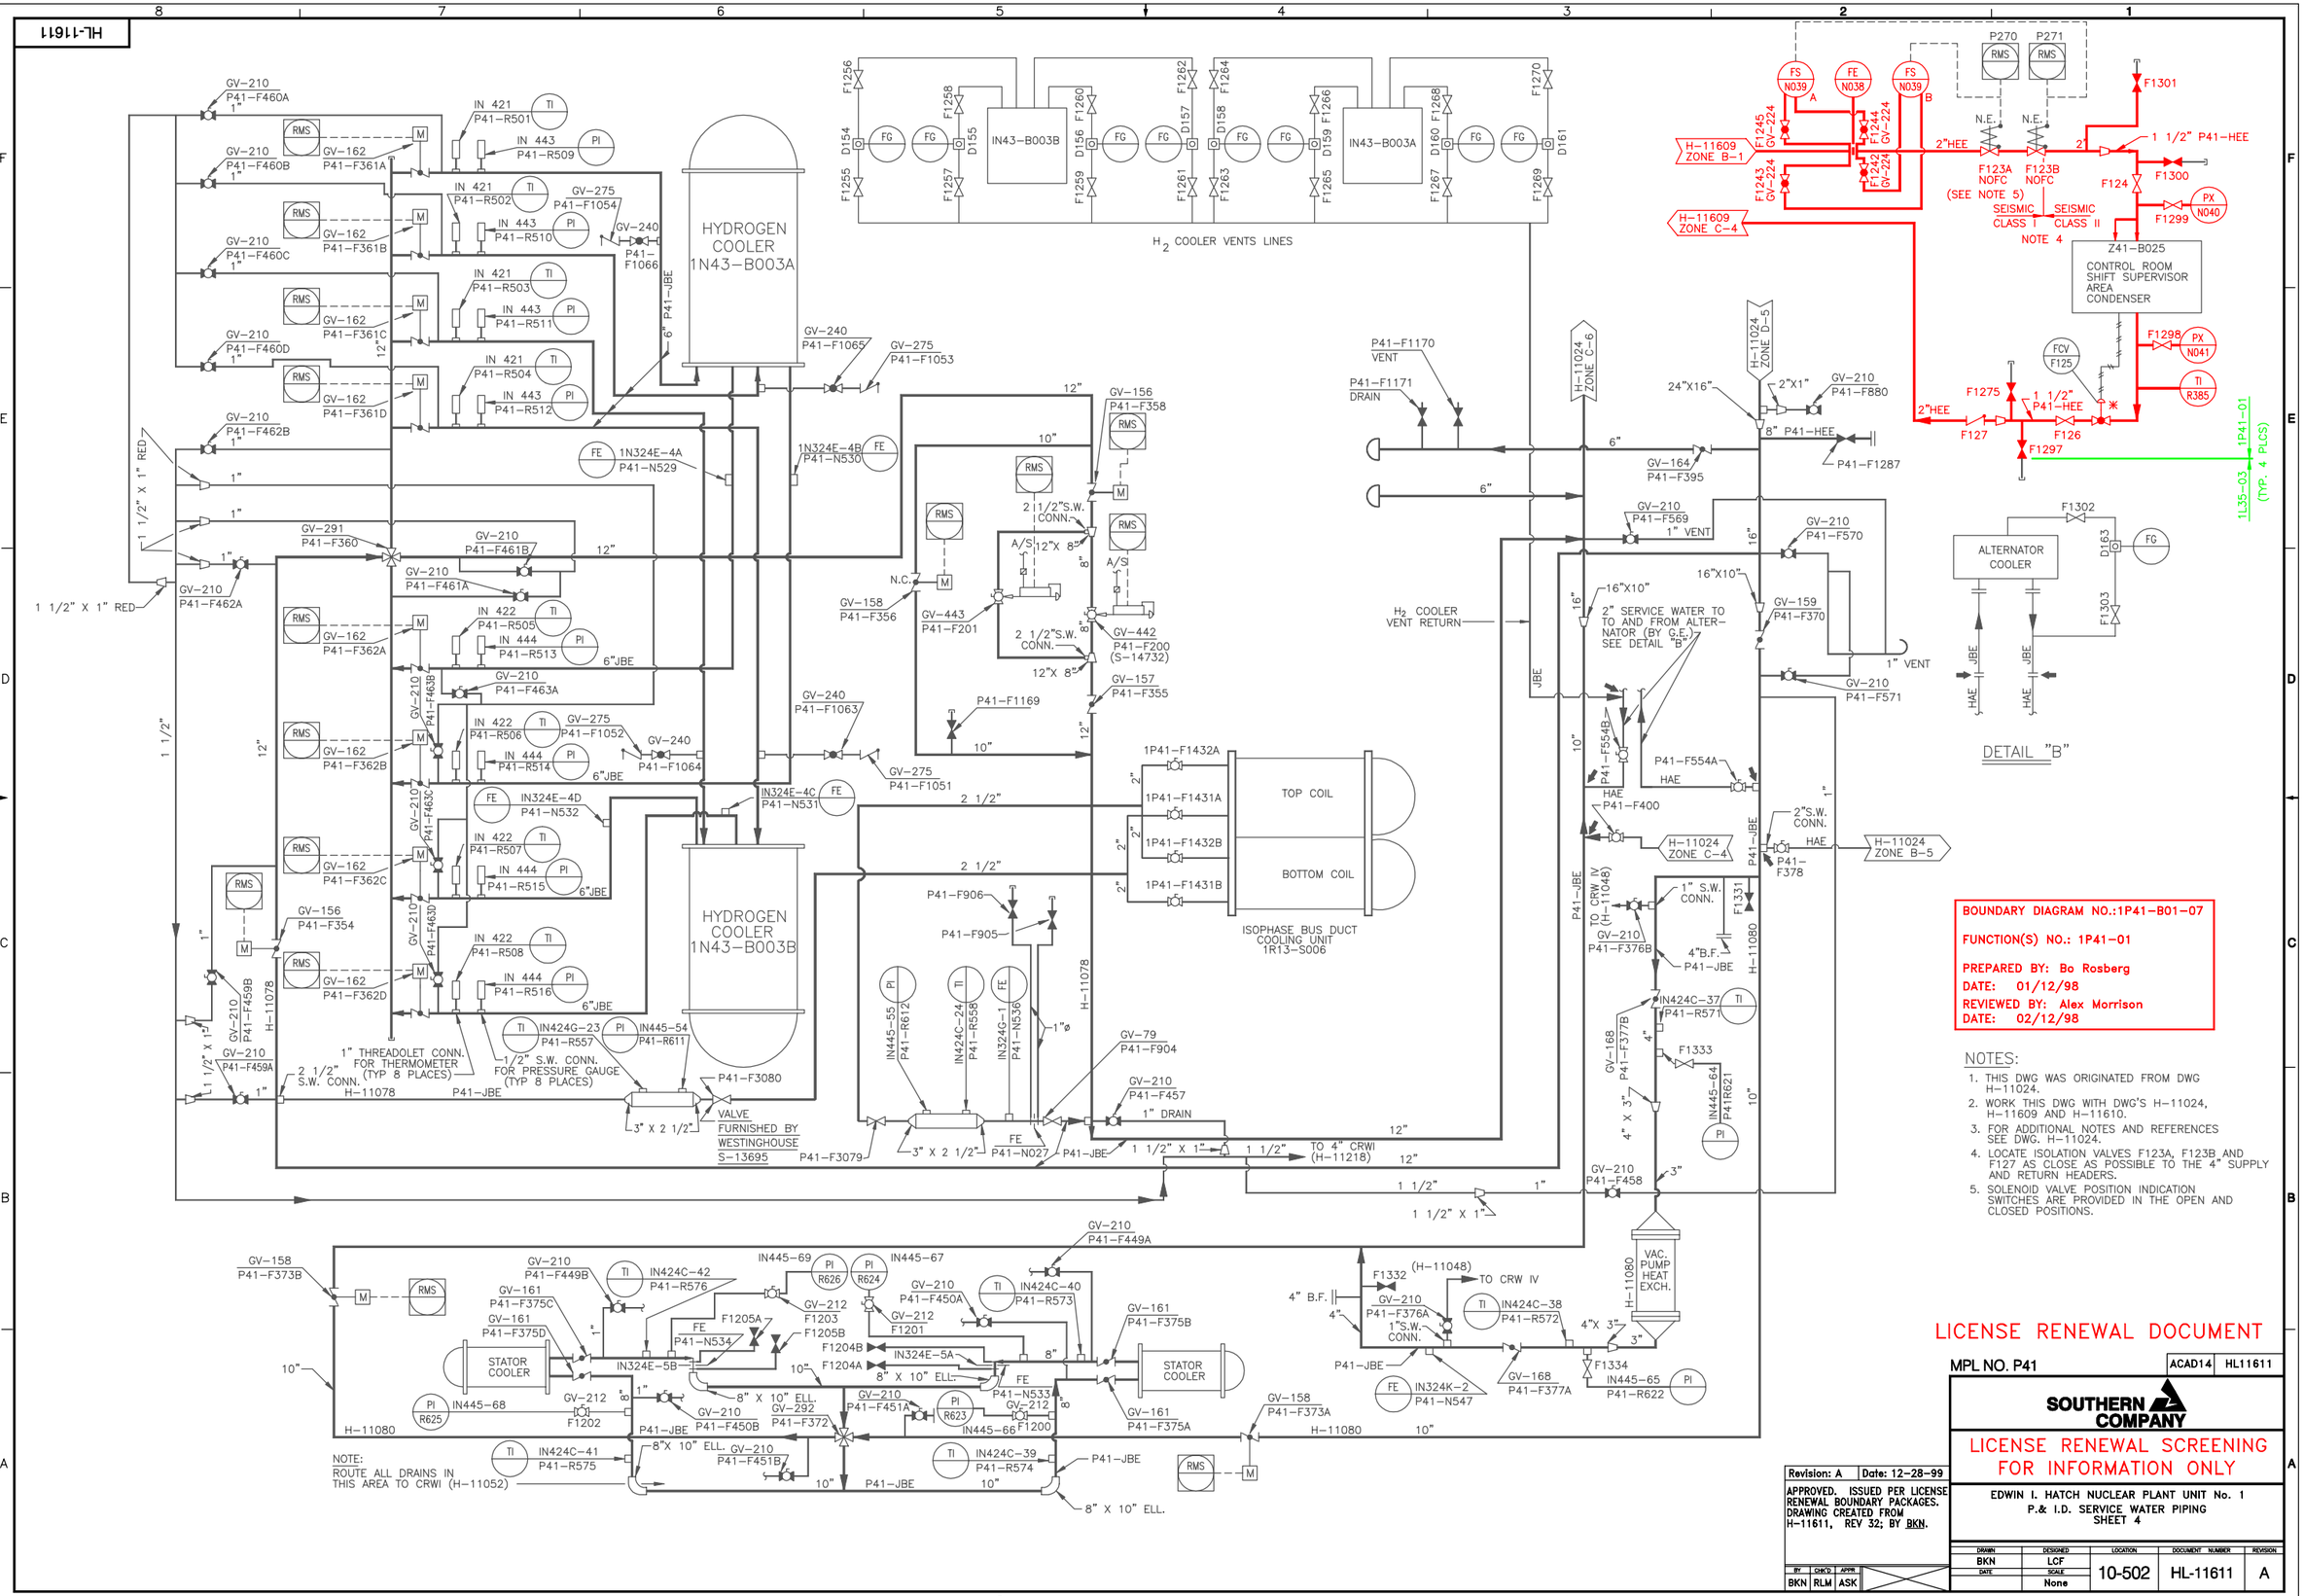

BOUNDARY DIAGRAM NO.:1P41-B01-07

FUNCTION(S) NO.: 1P41-01

PREPARED BY: Bo Rosberg

DATE: 01/12/98

REVIEWED BY: Alex Morrison

DATE: 02/12/98

NOTES:

1. THIS DWG WAS ORIGINATED FROM DWG H-11024.
2. WORK THIS DWG WITH DWG'S H-11024, H-11609 AND H-11610.
3. FOR ADDITIONAL NOTES AND REFERENCES SEE DWG. H-11024.
4. LOCATE ISOLATION VALVES F123A, F123B AND F127 AS CLOSE AS POSSIBLE TO THE 4" SUPPLY AND RETURN HEADERS.
5. SOLENOID VALVE POSITION INDICATION SWITCHES ARE PROVIDED IN THE OPEN AND CLOSED POSITIONS.

LICENSE RENEWAL DOCUMENT

MPL NO. P41

ACAD14	HL11611

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

Revision: A	Date: 12-28-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11611, REV 32; BY BKN.

BY	CHK'D	APPR
BKN	RLM	ASK

EDWIN I. HATCH NUCLEAR PLANT UNIT No. 1
P.& I.D. SERVICE WATER PIPING
SHEET 4

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
BKN	LCF	10-502	HL-11611	A
DATE	SCALE			
	None			