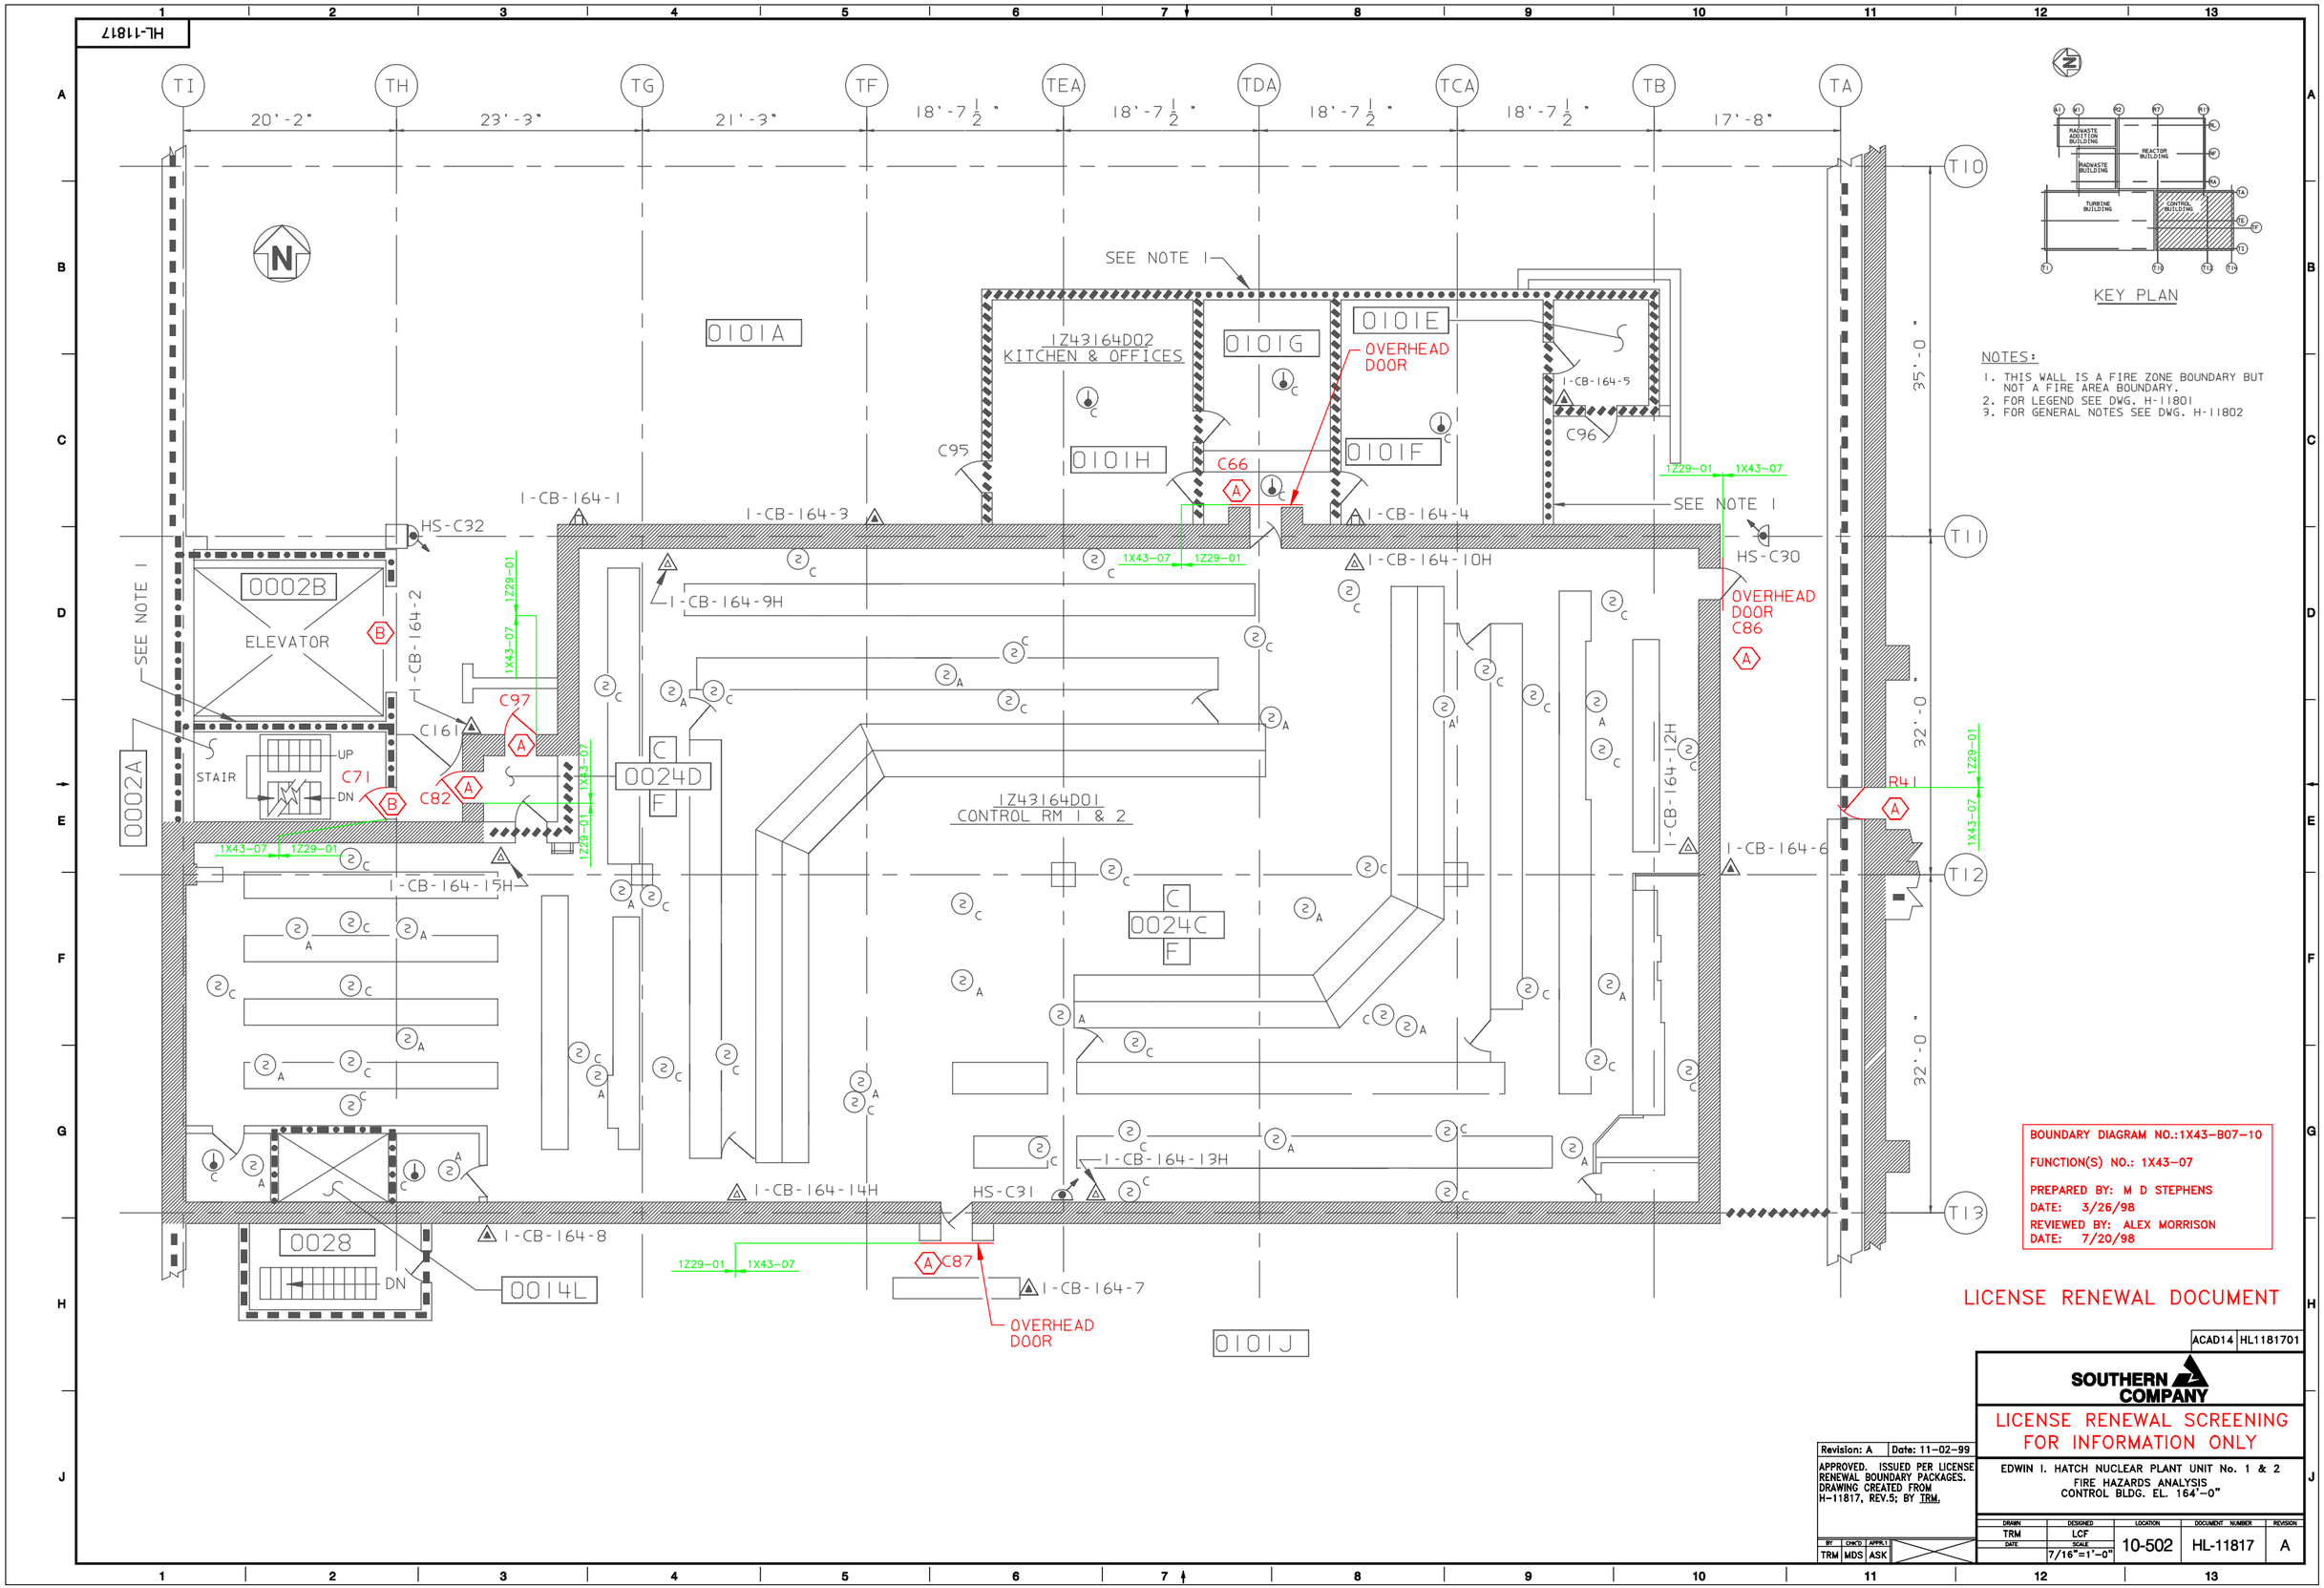
HL-11817
TI
TH
TG
TF
TEA
TDA
TCA
TB
TA
T10
T11
T12
T13
20'-2"
23'-3"
21'-3"
18'-7 1/2"
18'-7 1/2"
18'-7 1/2"
18'-7 1/2"
17'-8"
35'-0"
32'-0"
32'-0"
SEE NOTE 1
0101A
1Z43164D02
KITCHEN & OFFICES
0101G
0101E
OVERHEAD DOOR
0101H
0101F
C95
C66
C96
1-CB-164-5
1-CB-164-1
1-CB-164-3
1-CB-164-4
HS-C32
HS-C30
1-CB-164-10H
1-CB-164-9H
0002B
ELEVATOR
1-CB-164-2
C97
C161
C71
C82
STAIR
UP
DN
0002A
0024D
1Z43164D01
CONTROL RM 1 & 2
OVERHEAD DOOR
C86
1-CB-164-12H
R41
1-CB-164-6
1-CB-164-15H
0024C
1-CB-164-13H
1-CB-164-14H
HS-C31
1-CB-164-8
0028
0014L
C87
1-CB-164-7
OVERHEAD DOOR
0101J
1Z29-01
1X43-07
KEY PLAN
NOTES:
1. THIS WALL IS A FIRE ZONE BOUNDARY BUT NOT A FIRE AREA BOUNDARY.
2. FOR LEGEND SEE DWG. H-11801
3. FOR GENERAL NOTES SEE DWG. H-11802
BOUNDARY DIAGRAM NO.:1X43-B07-10
FUNCTION(S) NO.: 1X43-07
PREPARED BY: M D STEPHENS
DATE: 3/26/98
REVIEWED BY: ALEX MORRISON
DATE: 7/20/98
LICENSE RENEWAL DOCUMENT
ACAD14 HL1181701
SOUTHERN COMPANY
LICENSE RENEWAL SCREENING FOR INFORMATION ONLY
Revision: A Date: 11-02-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11817, REV.5; BY TRM.
EDWIN I. HATCH NUCLEAR PLANT UNIT No. 1 & 2
FIRE HAZARDS ANALYSIS
CONTROL BLDG. EL. 164'-0"
DRAWN TRM
DESIGNED LCF
SCALE 7/16"=1'-0"
LOCATION 10-502
DOCUMENT NUMBER HL-11817
REVISION A
BY TRM
CHK'D MDS
APPR.1 ASK