HL-11848




FIRE TANK NO.1

FIRE PROTECTION PUMP HOUSE
FLOOR PLAN AT EL. 128'-5"

FIRE TANK NO.2

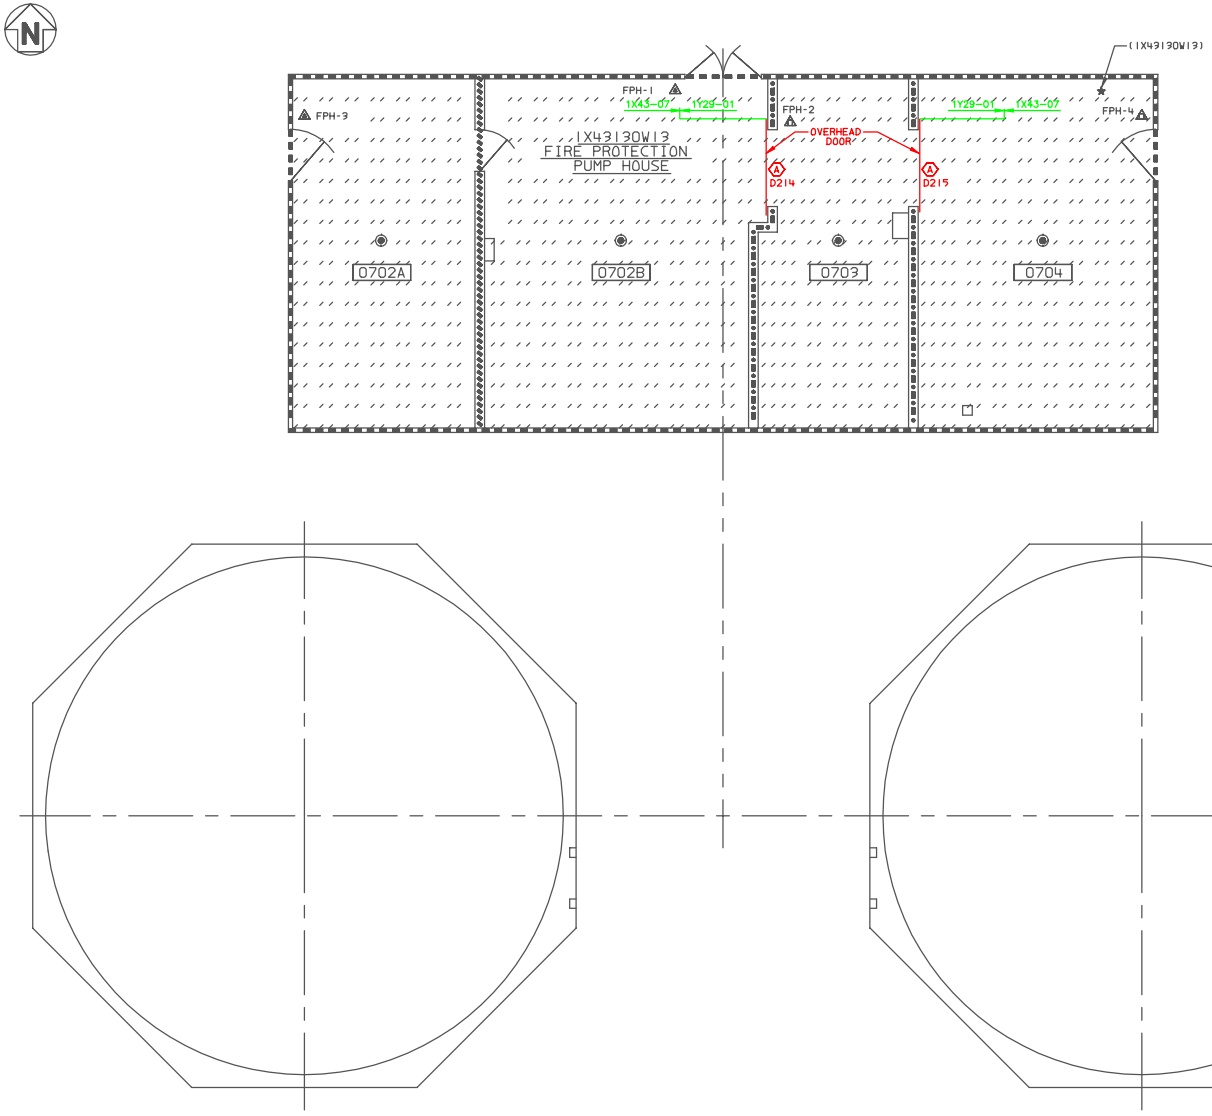


KEY PLAN

NOTES:

1. FOR LEGEND SEE DWG. H-11801
2. FOR GENERAL NOTES SEE DWG. H-11802

BOUNDARY DIAGRAM NO.:1X43-B07-19

FUNCTION(S) NO.: 1X43-07

PREPARED BY: M D STEPHENS
DATE: 3/26/98
REVIEWED BY: ALEX MORRISON
DATE: 7/20/98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11848.01

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING
FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1-2
FIRE HAZARD ANALYSIS
FIRE PROTECTION PUMP HOUSE

| Revision: A | Date: 12-22-99 |
|---|---|

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11848, REV.0; BY TRM.

| BY | CHK'D | APPR |
|---|---|---|
| TRM | MDS | ASK |

| DRAWN | DESIGNED | LOCATION | DOCUMENT NUMBER | REVISION |
|---|---|---|---|---|
| TRM | LCF | 10-502 | HL-11848 | A |
| DATE | SCALE 1/4"=1'-0" | | | |