HL-11879

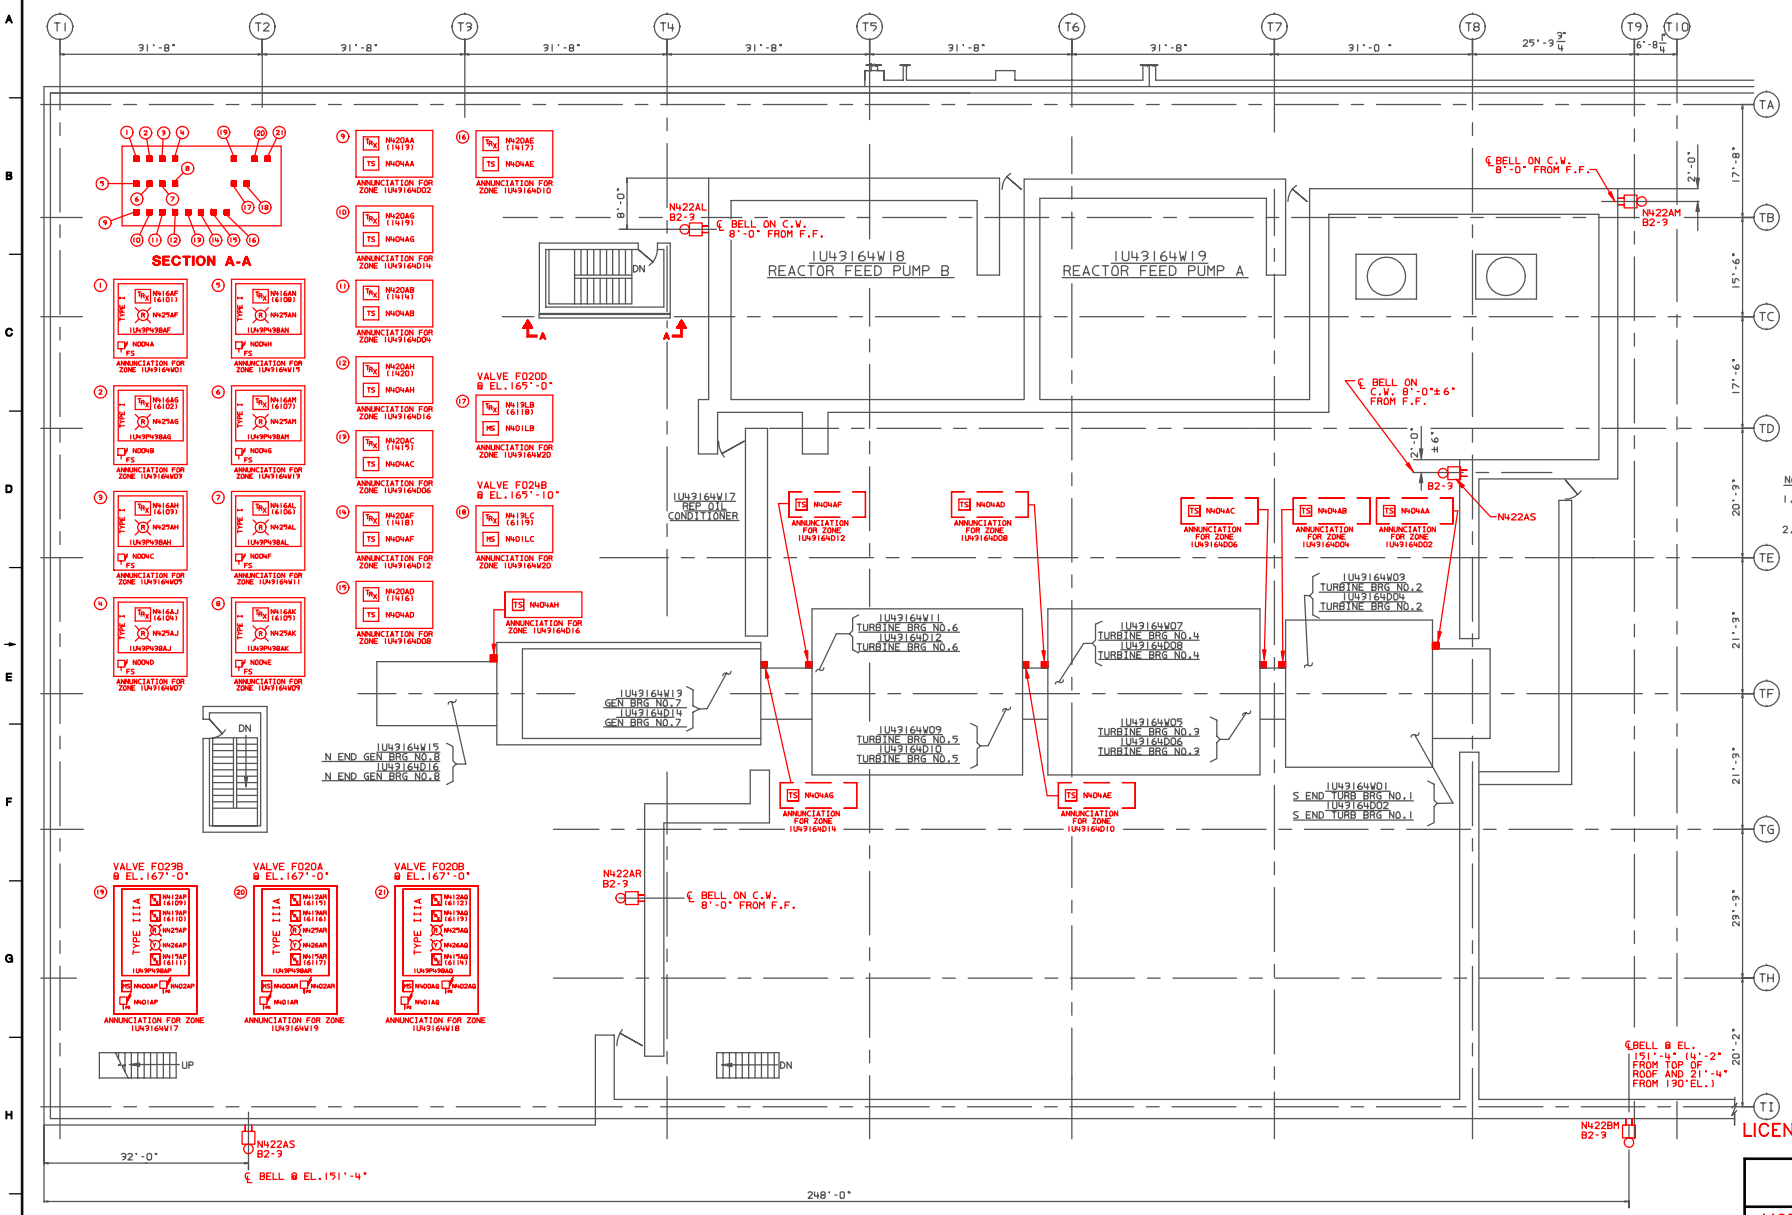

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 1U43.
2. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG. H-11807.

REFERENCES:

H-11904 FIRE PROTECTION P&ID SHT.2 OF 10
H-11807 FIRE HAZARDS ANALYSIS.
H-12692 ARCH, TURB. & CONTROL BLDGS. GENERAL PLAN AT EL.164'-0"
S-51109 REV.A FIRE PROTECTION MULTIPLEX SYSTEM O&M MANUAL
S-51110 MULTIPLEX RTU MOUNTING DETAILS
S-51111 MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

BOUNDARY DIAGRAM NO.:1X43-B06-14
FUNCTION(S) NO.: 1X43-06
PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11879

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No. 1
EQUIPMENT LAYOUT DRAWINGS
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 1U43 TURBINE BLDG. EL. 164'-0"

Revision: A	Date: 12-28-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11879, REV. 1; BY ECB	

BY	CHK'D	APPR.
ECB	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11879	A
DATE None	SCALE 1/8"=1'-0"			