HL-11882

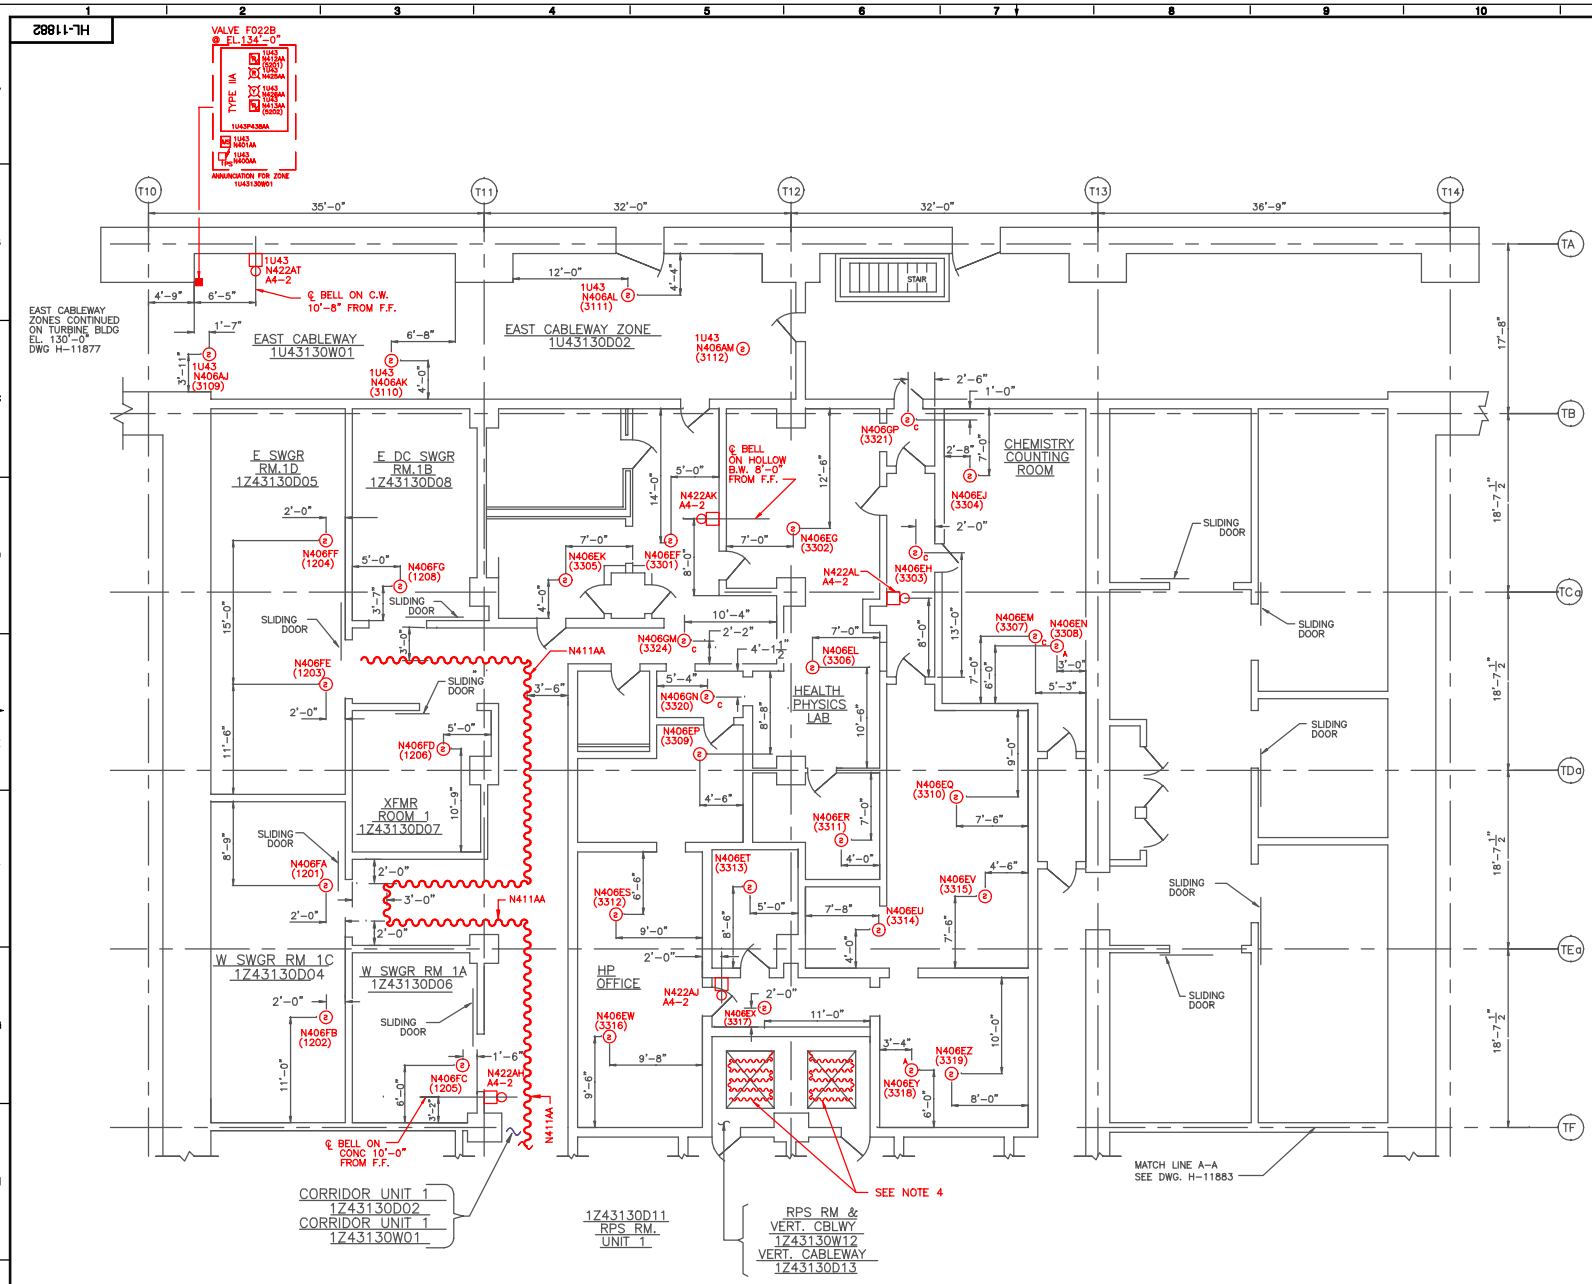

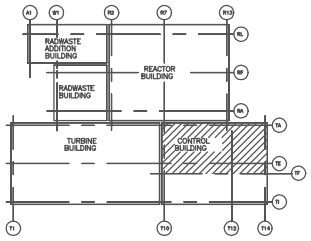

KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 1Z43.
2. UNIT 1 BELLS SHOWN. UNIT 2 BELLS MOUNTED ADJACENT. SEE DWG H-11915 FOR UNIT 2 DEVICES.
3. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11866
4. HEAT DETECTION CABLE Z43N411AB TO BE INSTALLED AROUND CABLE TRAYS AT CEILING AND AT AN INTERMEDIATE HEIGHT OF 8'-0" OFF FINISHED FLOOR IN VERTICAL CABLEWAY.
5. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG H-11815.

REFERENCES:

A-11307 SH1	FIRE PROTECTION - LINEAR SENSOR MOUNTING BRACKET FOR CABLE TRAYS
A-11307 SH2	FIRE PROTECTION - LINEAR SENSOR MOUNTING BRACKET FOR CEILING
A-11307 SH3	FIRE PROTECTION - DETAIL FOR CEILING MOUNTING
H-11304	FIRE PROTECTION P&ID SHEET 1 & 3 OF 10
H-11325	FIRE PROTECTION P&ID RPS ROOMS & CORRIDORS
H-11815	FIRE HAZARDS ANALYSIS
H-12628	ARCH. CONT. BLDG. DETAILED FLOOR PLAN EL.130'-0"
S-51109	REV A FIRE PROTECTION MULTIPLEX SYSTEM O & M MANUAL
S-51110	MULTIPLEX RTU MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

BOUNDARY DIAGRAM NO.:1X43-B06-19
FUNCTION(S) NO.: 1X43-06
PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11882

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

Revision: A | Date: 12-22-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11882, REV. 2; BY ECB

BY	DWN	APPR
ECB	MDS	ASK

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
EQUIPMENT LAYOUT DRAWINGS
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 1Z43 CONTROL BLDG. EL. 130'-0"

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11882	A
DATE	SCALE 3/16"=1'-0"			