HL-11883

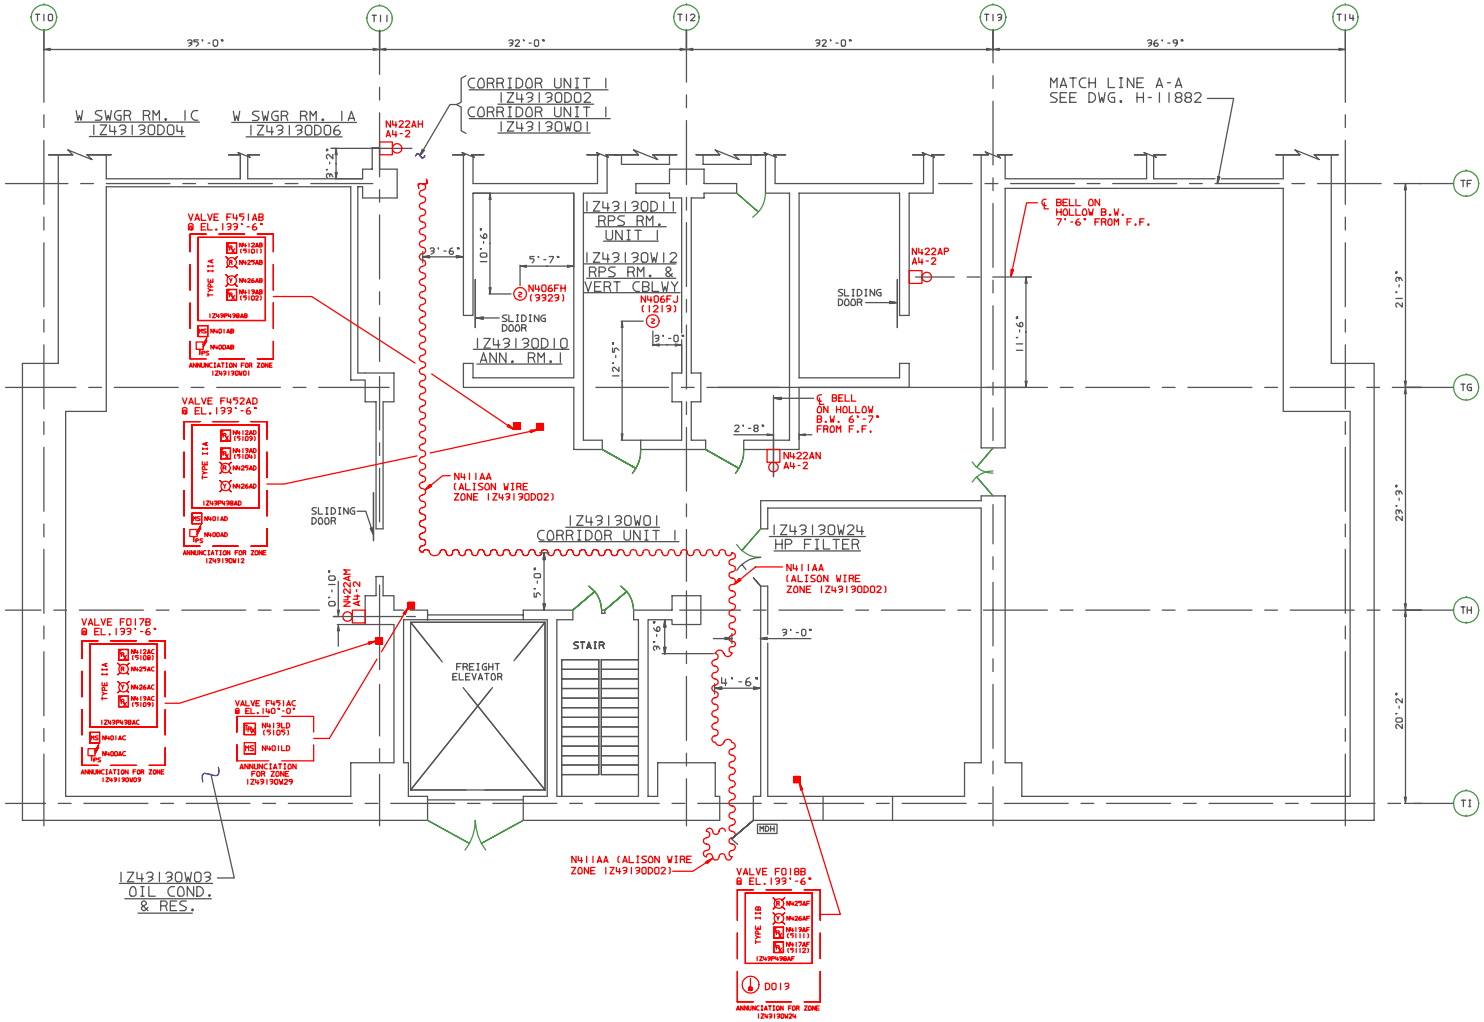

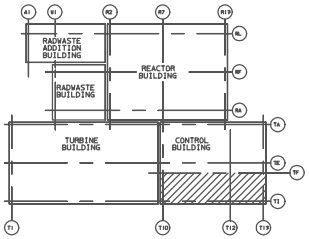

KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 1Z49.
2. UNIT 1 BELLS SHOWN. UNIT 2 BELLS MOUNTED ADJACENT. SEE DWG H-11916 FOR UNIT 2 DEVICES.
3. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11866.
4. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG. H-11815.

REFERENCES:

A-11907 SH.1	FIRE PROTECTION - LINEAR SENSOR MOUNTING BRACKET FOR CABLE TRAYS
A-11907 SH.2	FIRE PROTECTION - LINEAR SENSOR MOUNTING BRACKET FOR CEILING
A-11907 SH.2	FIRE PROTECTION - DETAIL FOR CEILING MOUNTING
H-11904	FIRE PROTECTION P&ID SHEET 1 & 9 OF 10
H-11925	FIRE PROTECTION P&ID RPS ROOMS & CORRIDORS
H-11815	FIRE HAZARDS ANALYSIS
H-12628	ARCH. CONT. BLDG. DETAILED FLOOR PLAN EL.190'-0"
H-42101	FIRE PROTECTION EQUIPMENT LAYOUT DRAWING - PROTECTOWIRE.
S-51109	REV A FIRE PROTECTION MULTIPLEX SYSTEM O & M MANUAL
S-51110	MULTIPLEX RTU MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

BOUNDARY DIAGRAM NO.:1X43-B06-20

FUNCTION(S) NO.: 1X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11883

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING
FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
EQUIPMENT LAYOUT DRAWINGS
FIRE DETETECTION/SUPPRESSION MULTIPLEX
SYS. 1Z43 CONTROL BLDG. EL. 130'-0"

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11883	A
DATE	SCALE 3/16"=1'-0"			

Revision: A	Date: 12-22-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11883, REV. 1; BY ECB	

BY	DWN	APPR
ECB	MDS	ASK