HL-11887

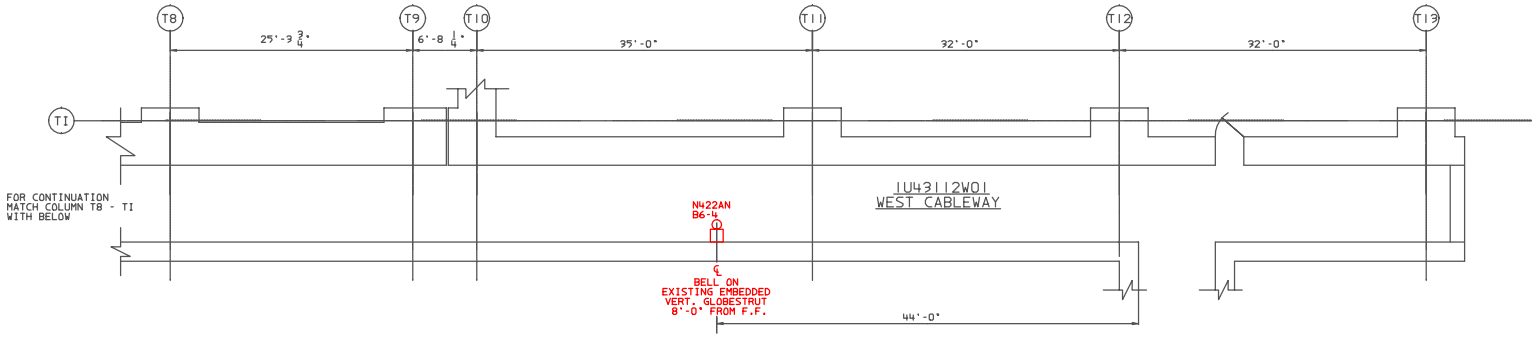

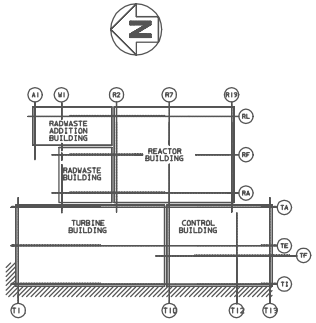

KEY PLAN

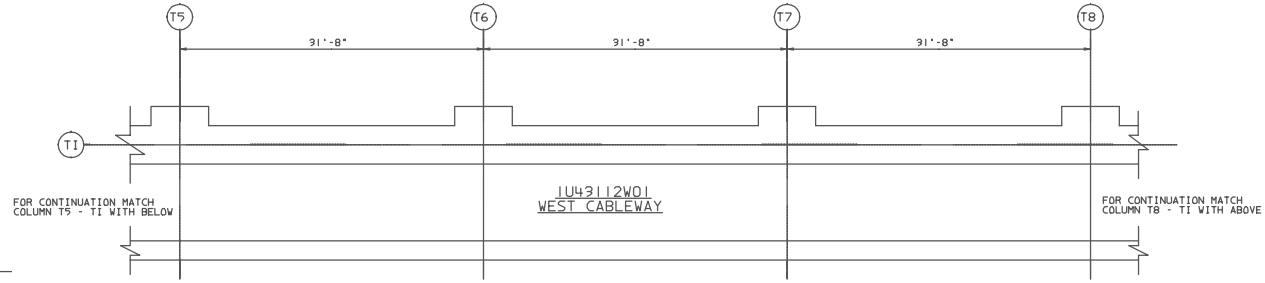

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 1U49.
2. FOR GENERAL NOTES AND LEGEND SEE DWG.H-11866
3. FOR RTU LOCATION, SEE CONTROL BUILDING EL.112'-0" DWG. H-11881
4. FOR HOSE STATION AND EXTINGUISHER LOCATIONS. SEE FHA DWG H-11804.

REFERENCES:

H-11804	FIRE HAZARDS ANALYSIS.
H-12626	TURB. & CONTROL BLDGS. GENERAL PLAN AT EL.112'-0"
S-51109	REV.A FIRE PROTECTION MULTIPLEX SYSTEM O&M MANUAL
S-51110	MULTIPLEX MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

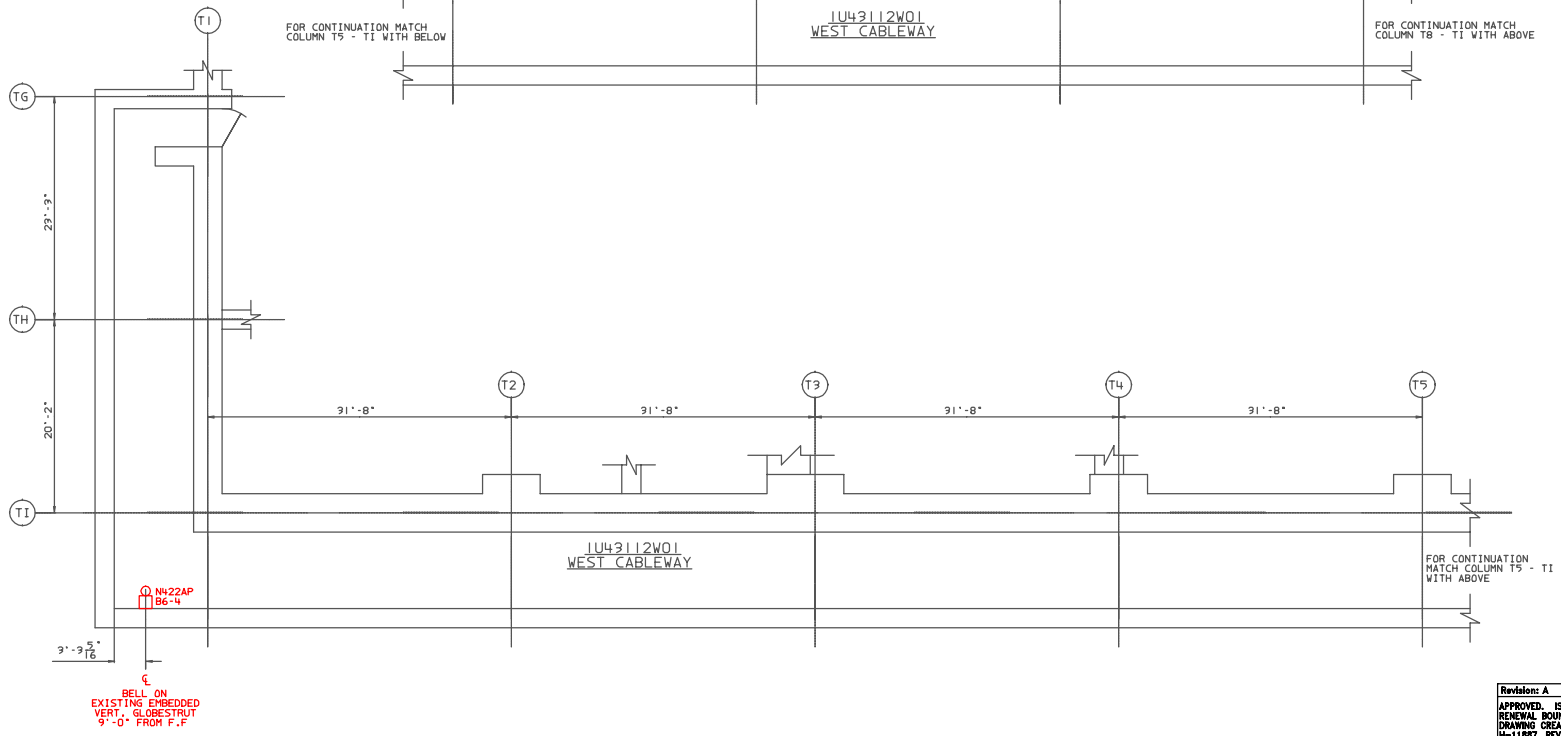

BOUNDARY DIAGRAM NO.:1X43-B06-32

FUNCTION(S) NO.: 1X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

Revision: A	Date: 12-22-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11887, REV. 1; BY ECB	

BY	DWN	APPR
ECB	MDS	ASK

ACAD14 | HL11887

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
EQUIPMENT LAYOUT DRAWINGS
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 1U43 WEST CABLEWAY EL. 112'-0"

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11887	A
DATE	SCALE 3/16"=1'-0"			