HL-11892

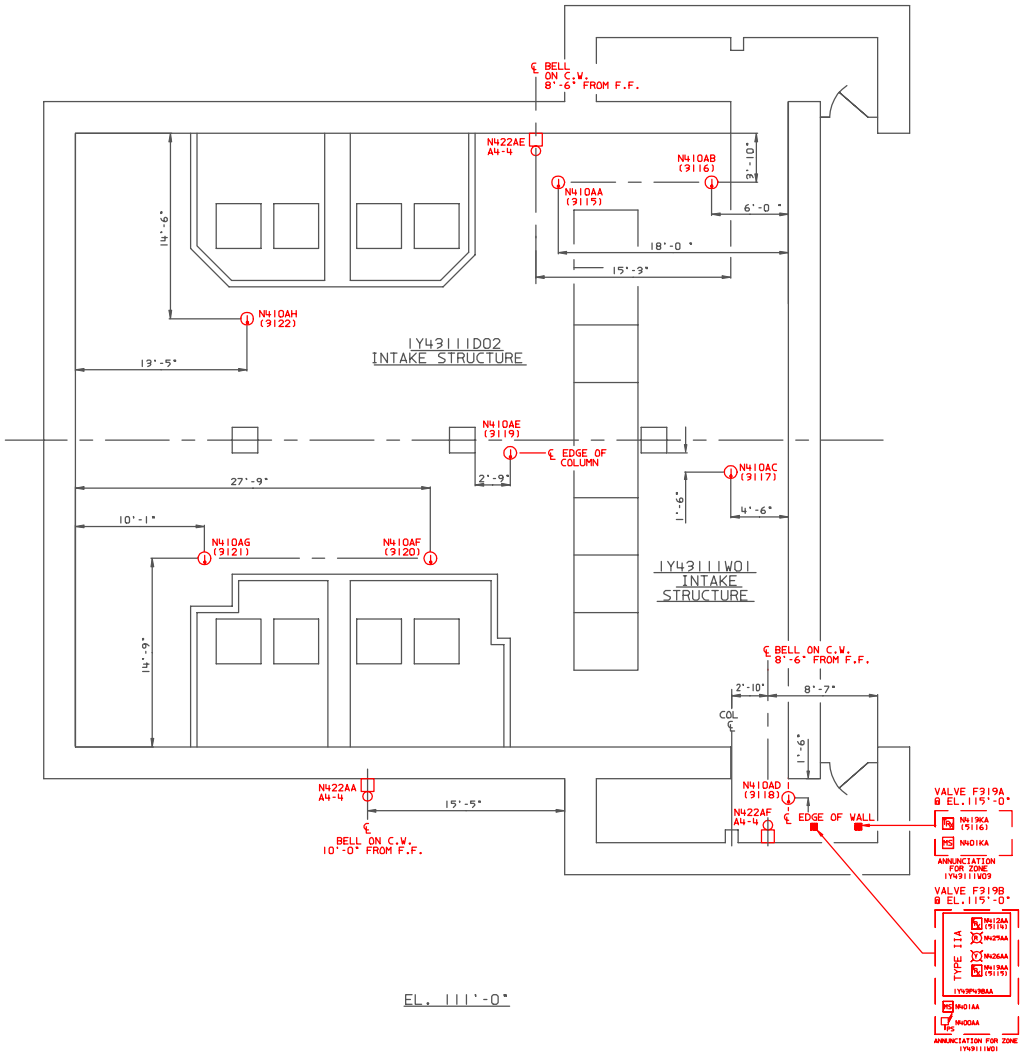



KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 1Y49.
2. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11866
3. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG H-11847.

REFERENCES:

H-11922	FIRE PROTECTION P&ID
H-11847	FIRE HAZARDS ANALYSIS
H-14871	CONDUIT & GROUNDING FIRE DET. INTAKE STRUCTURE
S-51109	REV A FIRE PROTECTION MULTIPLEX SYSTEM O & M MANUAL
S-51110	MULTIPLEX RTU MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

BOUNDARY DIAGRAM NO.:1X43-B06-17

FUNCTION(S) NO.: 1X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11892

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
EQUIPMENT LAYOUT DRAWINGS
FRIE DETECTION/SUPPRESSION MULTIPLEX
SYS. 1Y43 INTAKE STRUCTURE

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11892	A
DATE	SCALE 1/8"=1'-0"			

Revision: A	Date: 12-22-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11892, REV. 2; BY ECB	

BY	DWN	APPR
ECB	MDS	ASK