HL-11895

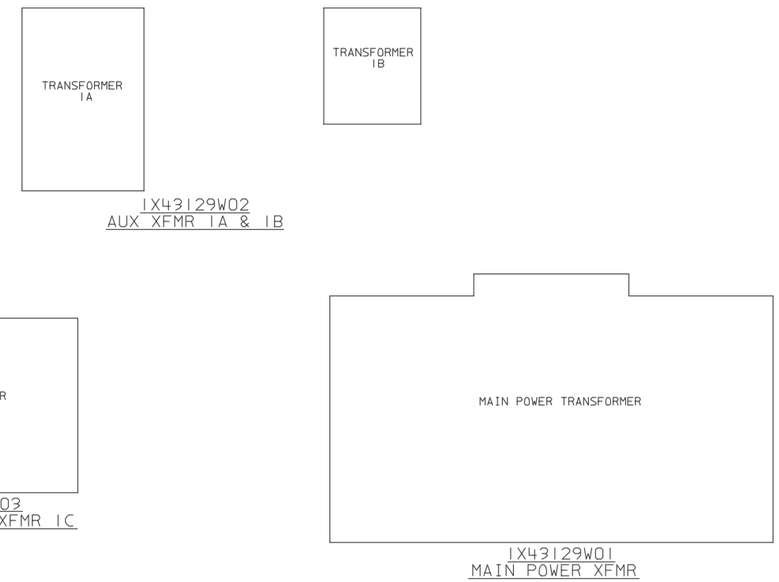



KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 1X43.
2. ZONES SHOWN ARE FOR UNIT 1.
3. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11895
4. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DRAWING H-11850.

REFERENCES:

H-11302	FIRE PROTECTION P&ID SHEET 1 THRU 4
H-11850	FIRE HAZARDS ANALYSIS
H-13869	CONDUIT PLAN - 24KV SWITCHYARD
S-51109	REV.A FIRE PROTECTION MULTIPLEX SYSTEM O&M MANUAL
S-51110	MULTIPLEX RTU MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

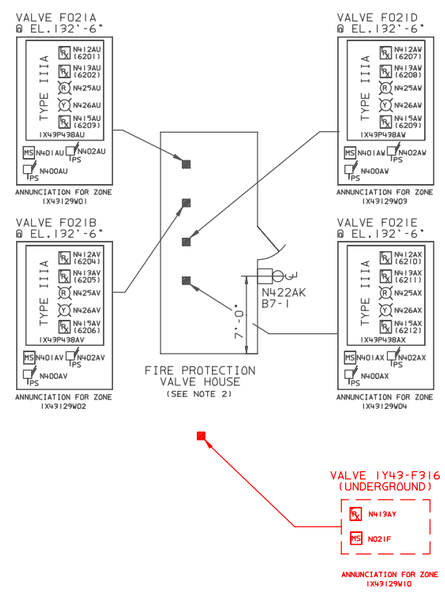

BOUNDARY DIAGRAM NO.:1X43-B06-15

FUNCTION(S) NO.: 1X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11895

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
EQUIPMENT LAYOUT DRAWINGS
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 1X43 TRANSFORMER SWITCH YARD

Revision: A	Date: 12-28-99
APPROVED, ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES DRAWING CREATED FROM H-11895, REV. 1; BY ECB	

BY	CHK'D	APPR.
ECB	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11895	A
DATE	SCALE 3/16"=1'-0"			