HL-11896

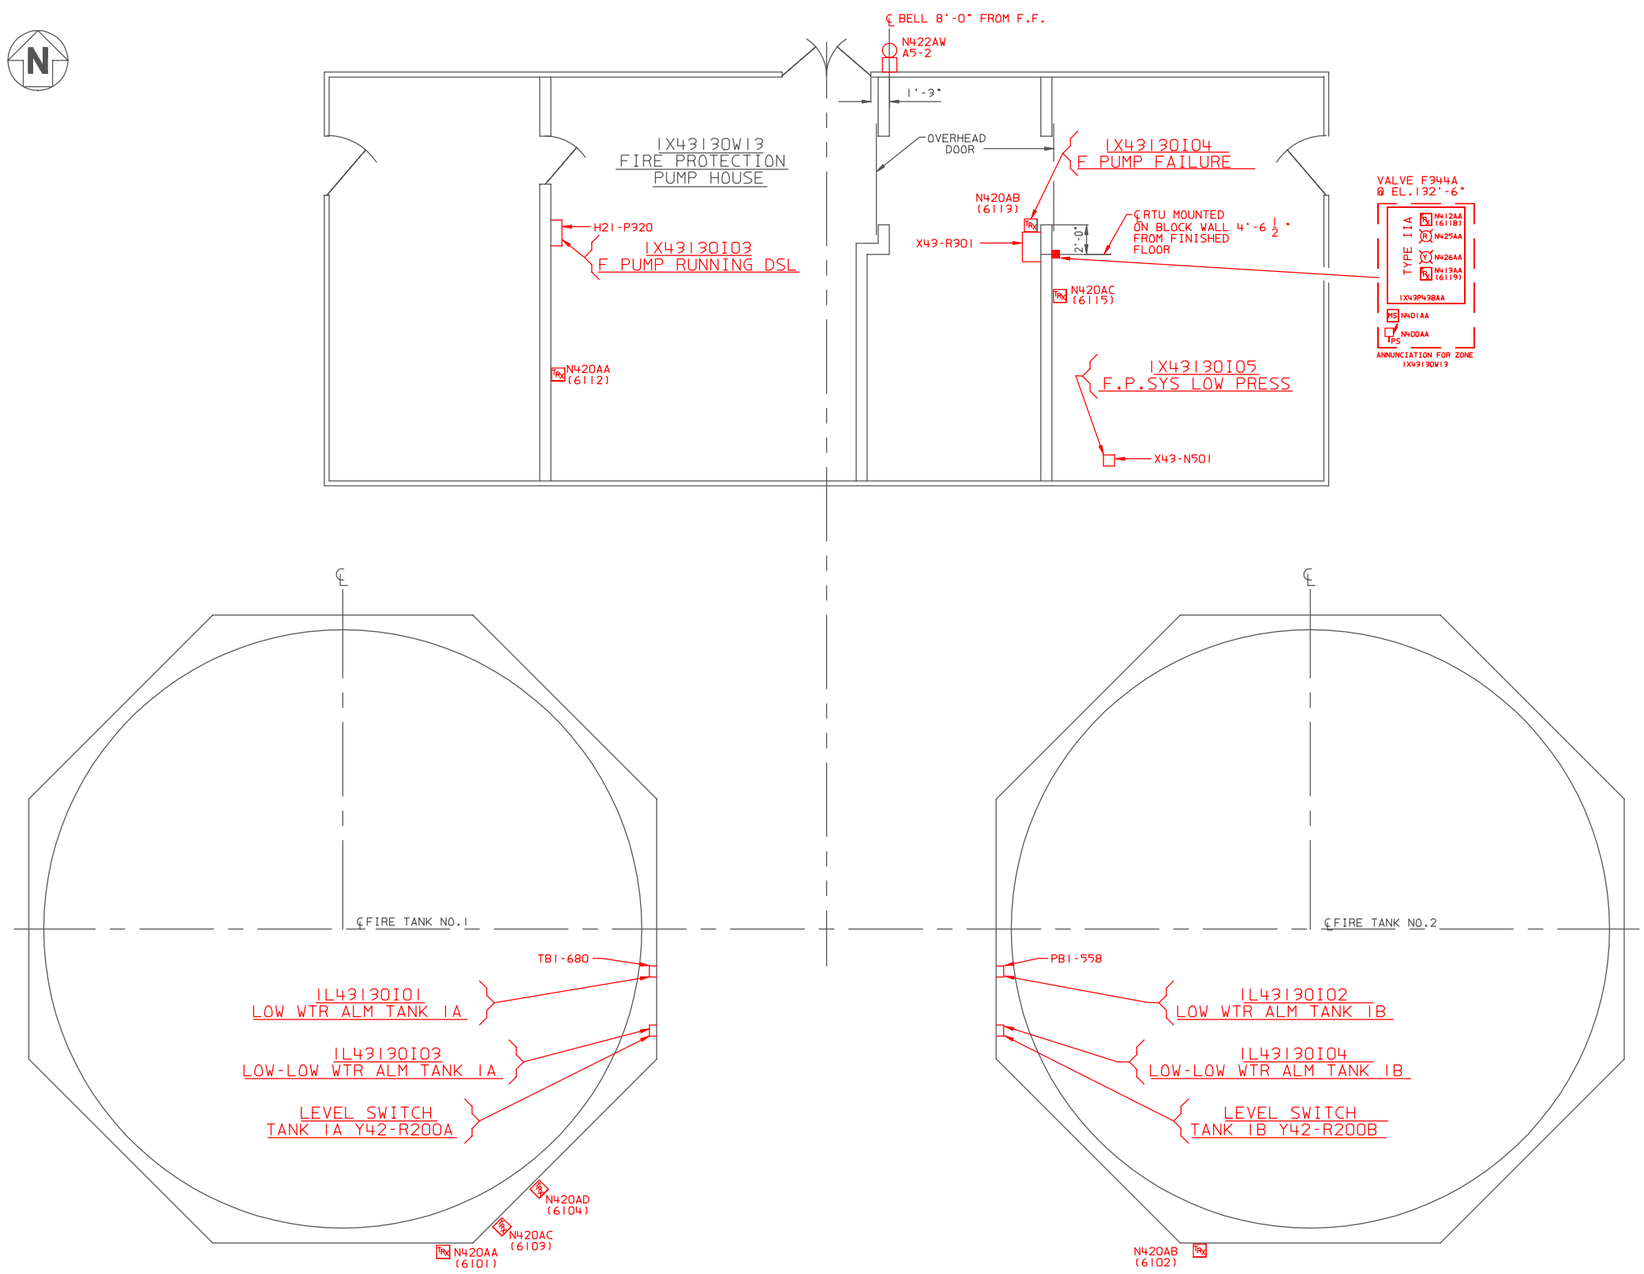

FIRE PROTECTION PUMP HOUSE
FLOOR PLAN AT EL. 128'-5"

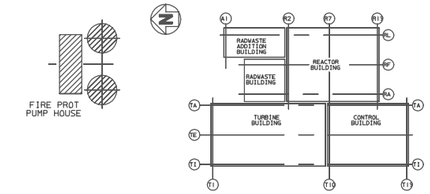

KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 1X43.
2. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11866
3. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG H-11848.

REFERENCES:

H-13009	CONDUIT GROUNDING & LIGHTING FIRE PROT. PUMP HOUSE
H-11848	FIRE HAZARDS ANALYSIS
S-51109	REV.A FIRE PROTECTION MULTIPLEX SYSTEM O&M MANUAL
S-51110	MULTIPLEX RTU MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

BOUNDARY DIAGRAM NO.:1X43-B06-6
FUNCTION(S) NO.: 1X43-06
PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11896

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING
FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
EQUIPMENT LAYOUT DRAWINGS
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS.1X43 OUT BUILDINGS

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11896	A
DATE	SCALE 1/4"=1'-0"			

Revision: A	Date: 12-22-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11896, REV. 2; BY ECB	

BY	CHK'D	APPR
ECB	MDS	ASK