HL-11900

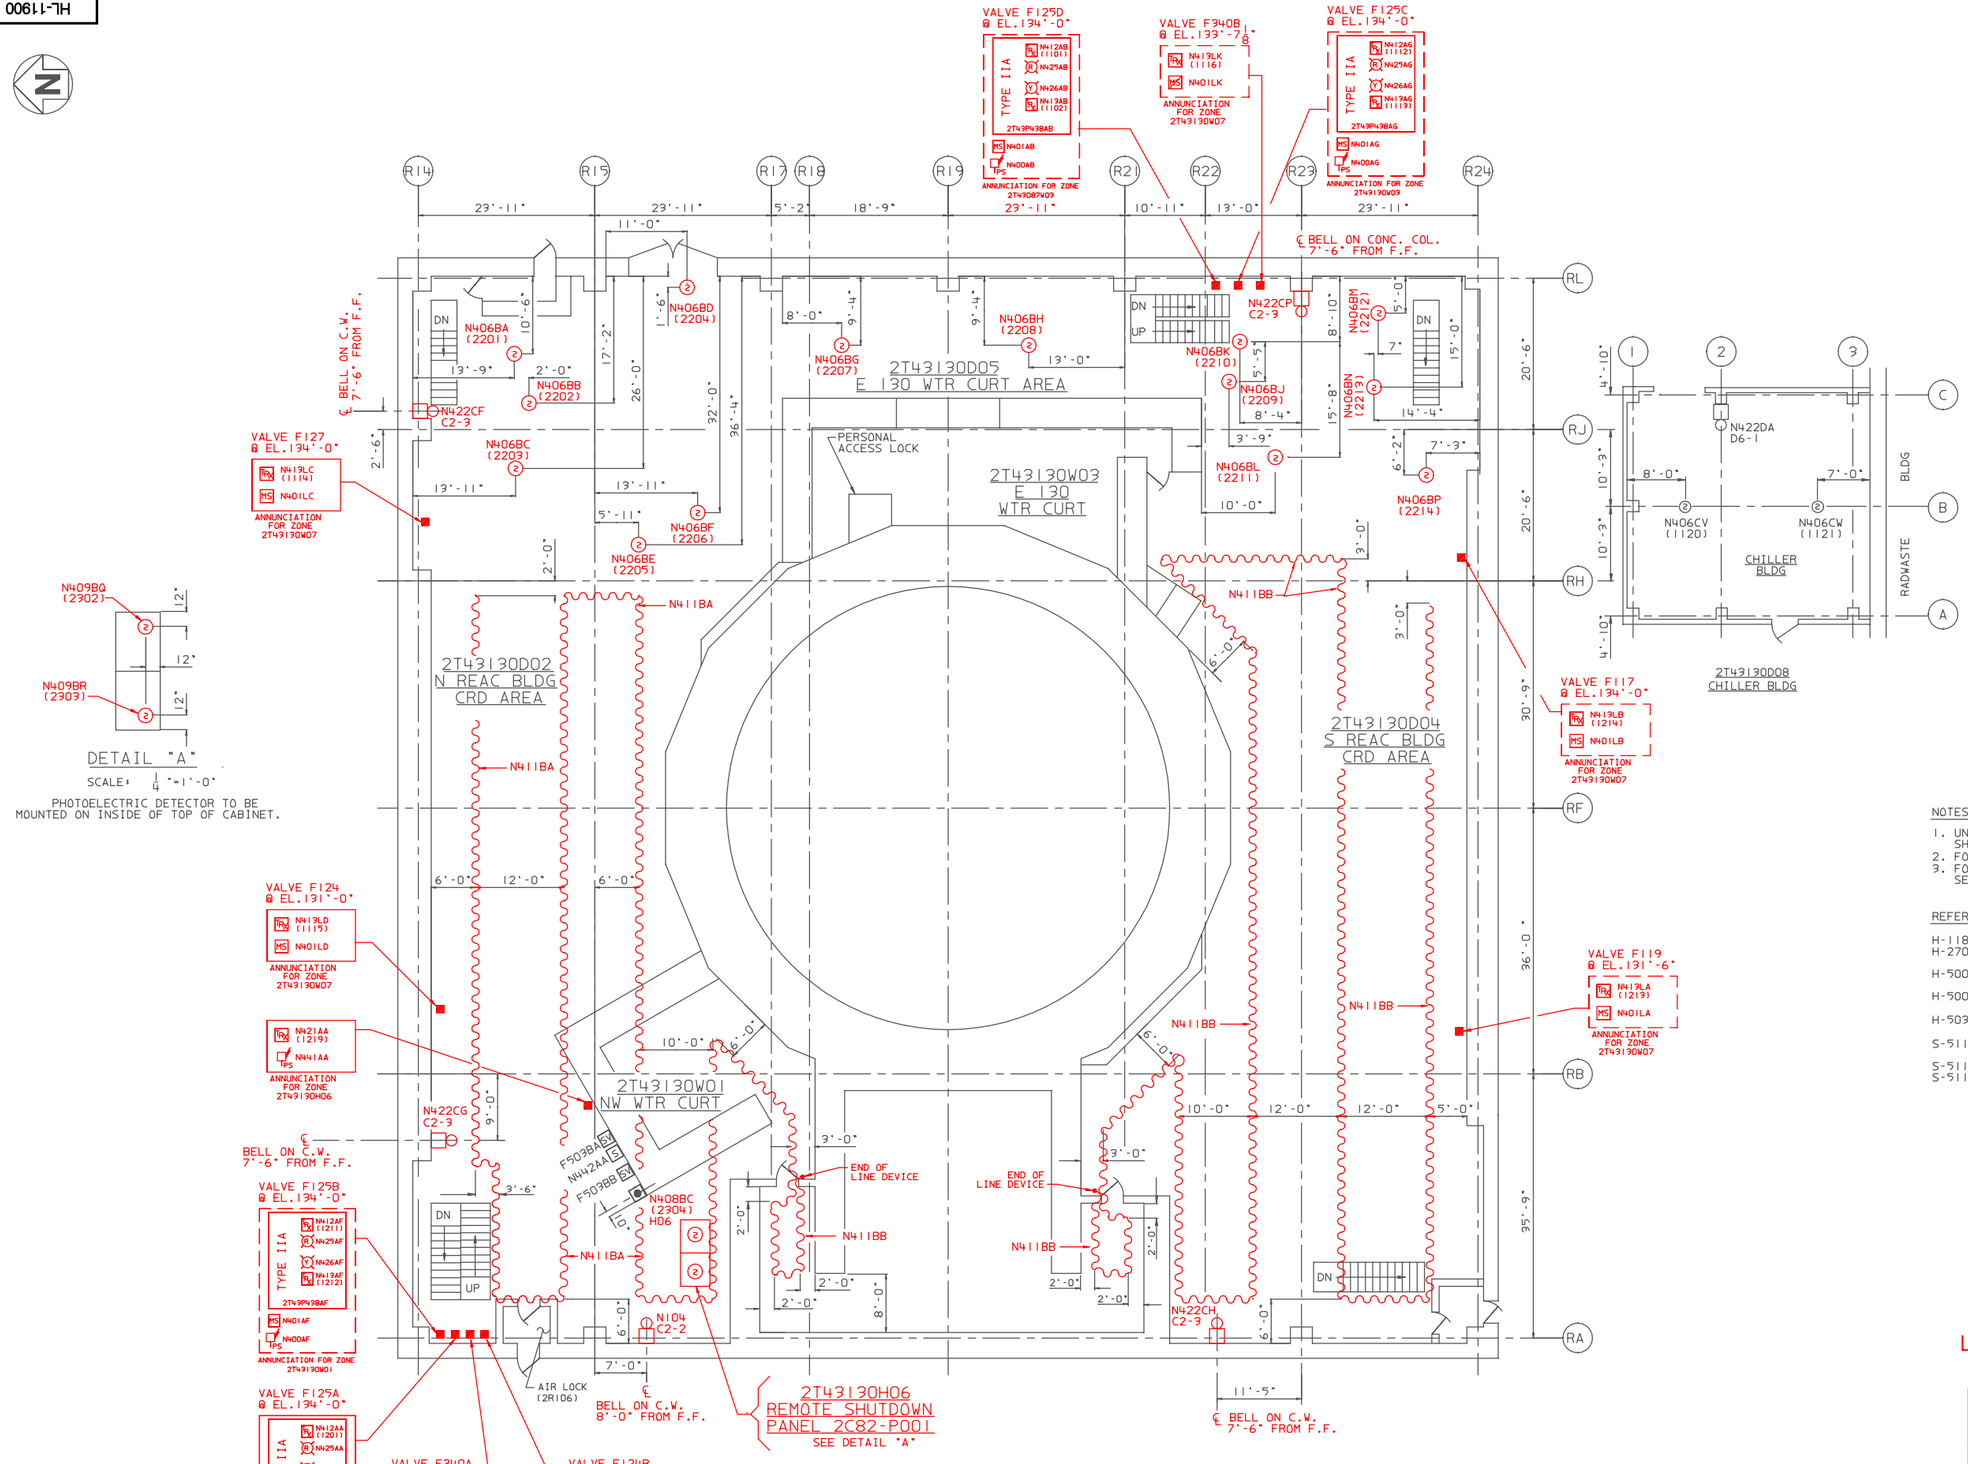



KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 2T43.
2. FOR GENERAL NOTES AND LEGEND SEE DWG.H-11866
3. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG. H-11833.

REFERENCES:

H-11833	FIRE HAZARDS ANALYSIS.
H-27004	SMOKE DETECTION. REACTOR BLDG. EL.130'-0"
H-50043	FIRE PROTECTION P&ID. REACTOR BLDG. EL.130'-0" EAST 130 WATER CURTAIN
H-50044	FIRE PROTECTION P&ID. REACTOR BLDG. EL.130'-0" NW 130 WATER CURTAIN
H-50352	FIRE PROTECTION - PROTECTOWIRE PLAN UNIT 2 REACTOR BLDG.- EL.130'-0"
S-51109	REV A FIRE PROTECTION MULTIPLEX SYSTEM O & M MANUAL
S-51110	MULTIPLEX RTU MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

BOUNDARY DIAGRAM NO.:2X43-B06-08

FUNCTION(S) NO.: 2X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14	HL11900

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
EQUIPMENT LAYOUT DRAWINGS
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 2T43 REACTOR BLDG. 130'-0"

Revision: A	Date: 12-22-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11900, REV. 1; BY ECB	

BY	CHK'D	APPR
ECB	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11900	A
DATE	SCALE 1/8"=1'-0"			