HL-11902

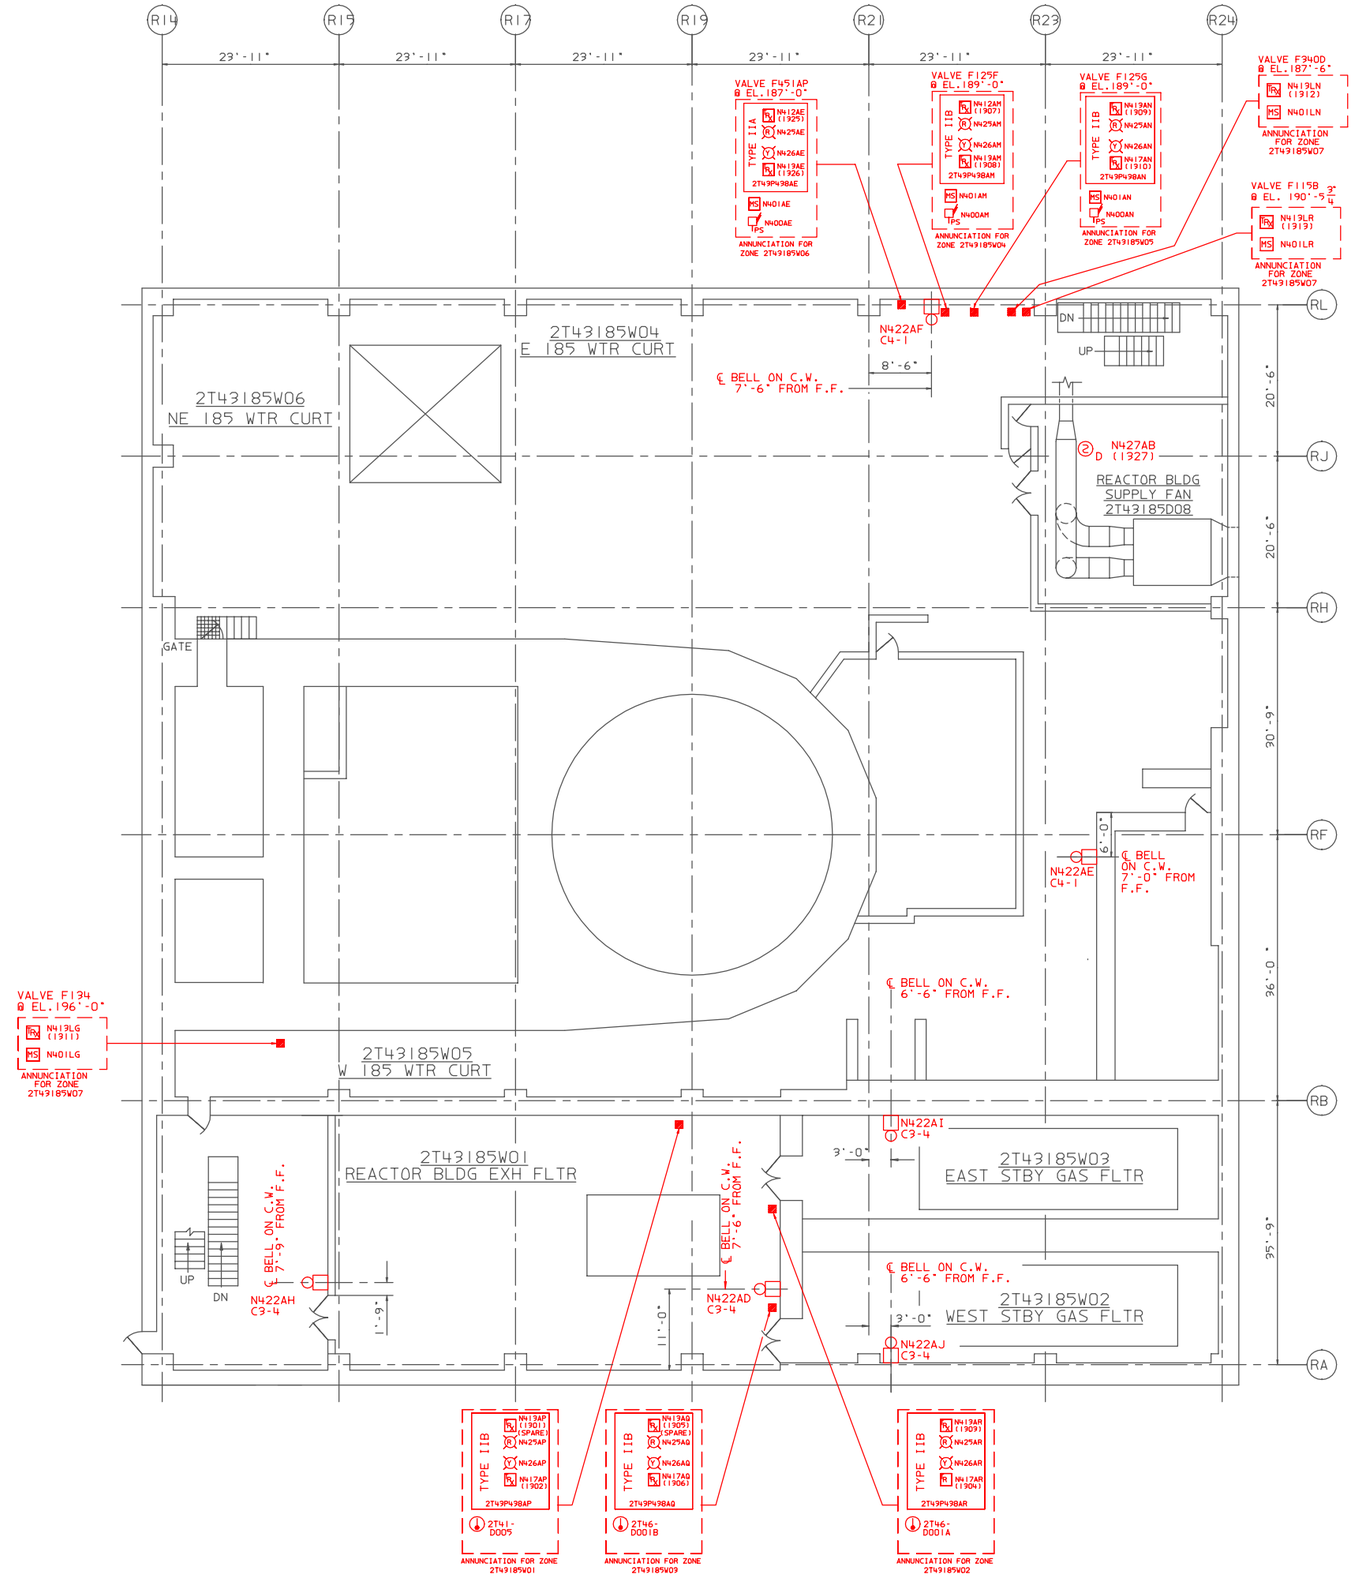





KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 2T49.
2. FOR GENERAL NOTES AND LEGEND SEE DRAWING H-11866.
3. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG. H-11835.

REFERENCES:

| | |
|---|---|
| H-11835 | FIRE HAZARDS ANALYSIS. |
| H-21178 | REACTOR BLDG. FIRE PROTECTION SYS. PARTIAL PLANS AT EL.190'-0" |
| H-25944 | ARCHITECTURAL, REACTOR BLDG. FLOOR PLAN EL.185'-0" |
| H-26255 | PLANT SERVICE WATER SYS. MISC. PLANS & SECTIONS |
| H-50046 | FIRE PROTECTION P&ID REACTOR BLDG. EL.185'-0" EAST 185 WATER CURTAIN |
| H-50047 | FIRE PROTECTION P&ID REACTOR BLDG. EL.185'-0" WEST 185 WATER CURTAIN |
| S-51109 | REV A FIRE PROTECTION MULTIPLEX SYSTEM O & M MANUAL |
| S-51110 | MULTIPLEX RTU MOUNTING DETAILS |
| S-51111 | MULTIPLEX RTU INTERNAL WIRING DIAGRAMS |

BOUNDARY DIAGRAM NO.:2X43-B06-10

FUNCTION(S) NO.: 2X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11902

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

Revision: A | Date: 12-22-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11902, REV. 1; BY ECB

| BY | CHK'D | APPR |
|---|---|---|
| ECB | MDS | ASK |

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
EQUIPMENT LAYOUT DRAWINGS.
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS.2T43 REACTOR BLDG. 185'-0"

| DRAWN | DESIGNED | LOCATION | DOCUMENT NUMBER | REVISION |
|---|---|---|---|---|
| ECB | LCF | 10-502 | HL-11902 | A |
| DATE | SCALE 1/8"=1'-0" | | | |