HL-11903

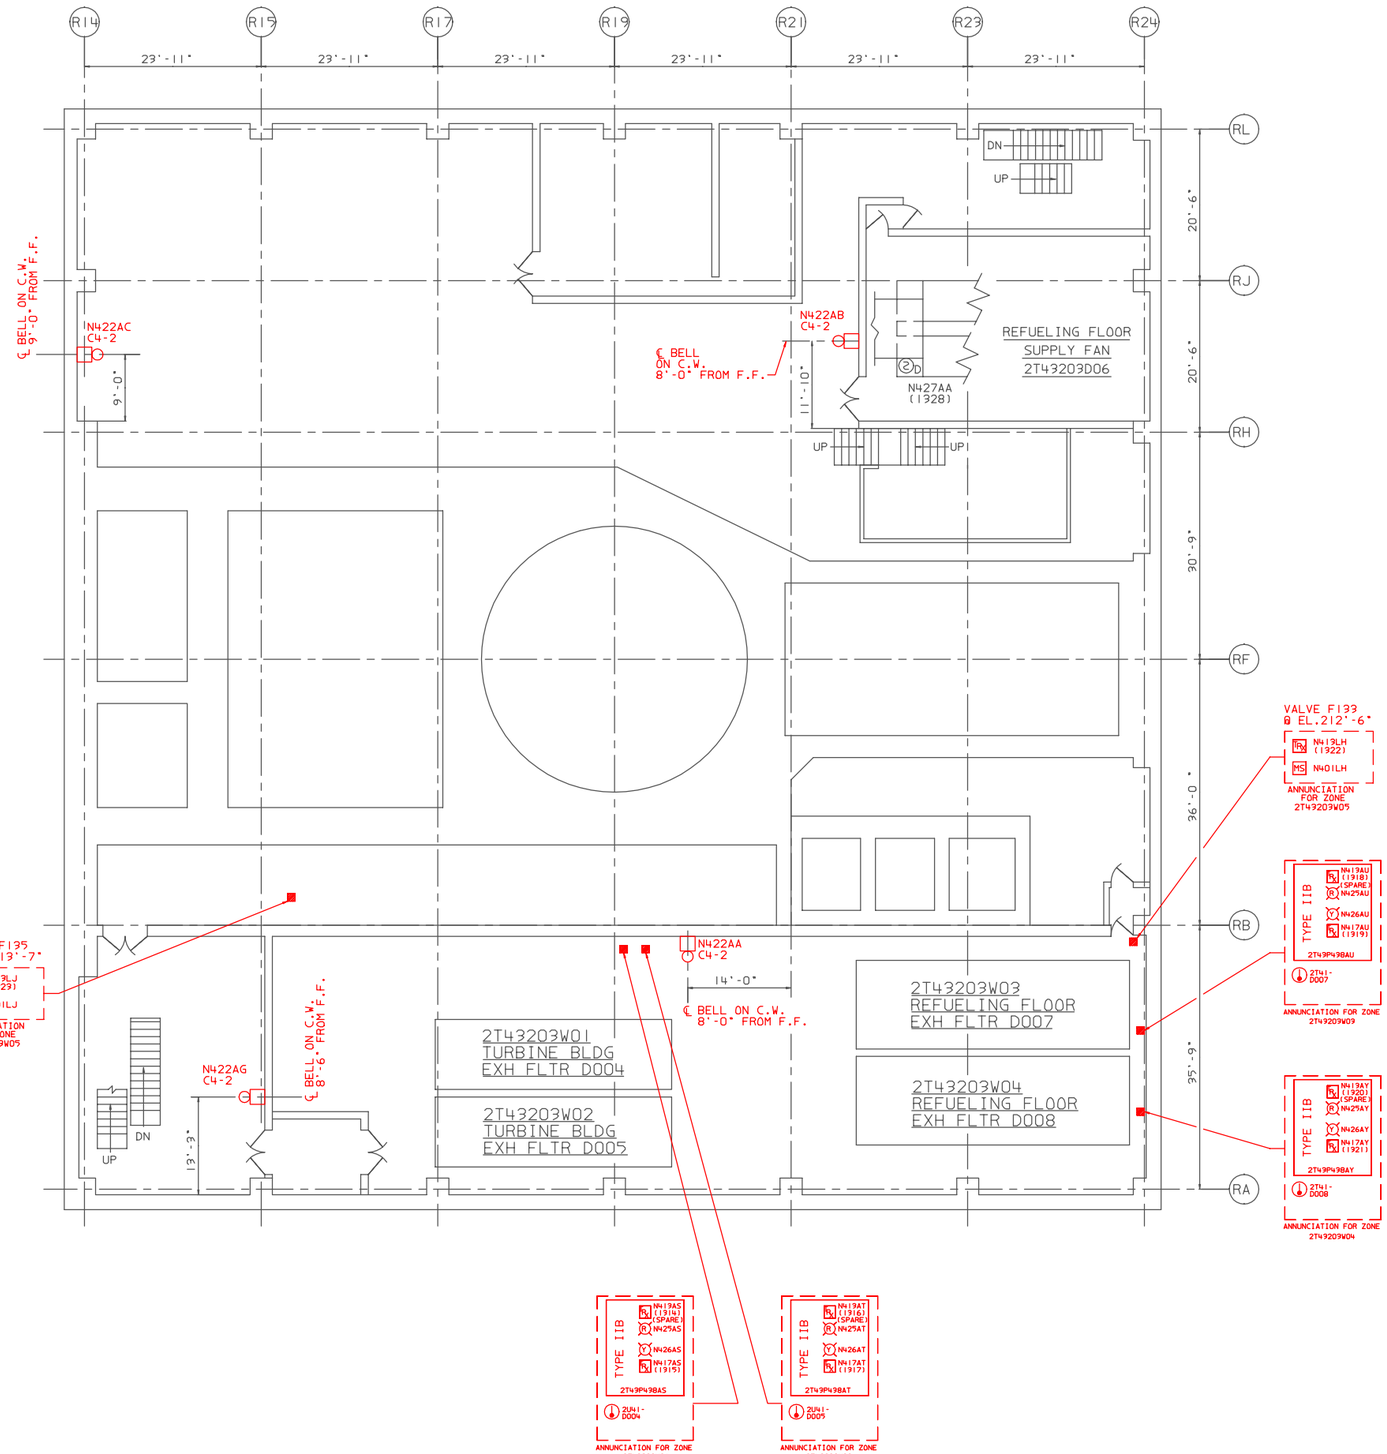



KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED,ALL MPL NUMBERS SHALL BE PREFIXED BY 2T43.
2. FOR GENERAL NOTES AND LEGEND SEE DWG H-11866.
3. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG. H-11836.

REFERENCES:

H-11836	FIRE HAZARDS ANALYSIS.
H-21178	REACTOR BLDG. FIRE PROTECTION SYS. PARTIAL PLANS AT EL.190'-0" & ABOVE
H-25945	ARCHITECTURAL, REACTOR BLDG. FLOOR PLAN EL.203'-0"
S-51109	REV A FIRE PROTECTION MULTIPLEX SYSTEM O & M MANUAL
S-51110	MULTIPLEX RTU MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

BOUNDARY DIAGRAM NO.:2X43-B06-11

FUNCTION(S) NO.: 2X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11903

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING
FOR INFORMATION ONLY

Revision: A | Date: 12-22-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11903, REV. 1; BY ECB

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
EQUIPMENT LAYOUT DRAWINGS
FIRE DETECTION/SUPRESSION MULTIPLEX
SYS. 2T43 REACTOR BLDG. 203'-0"

BY	CHK'D	APPR
ECB	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11903	A
DATE	SCALE 1/8"=1'-0"			