HL-11909

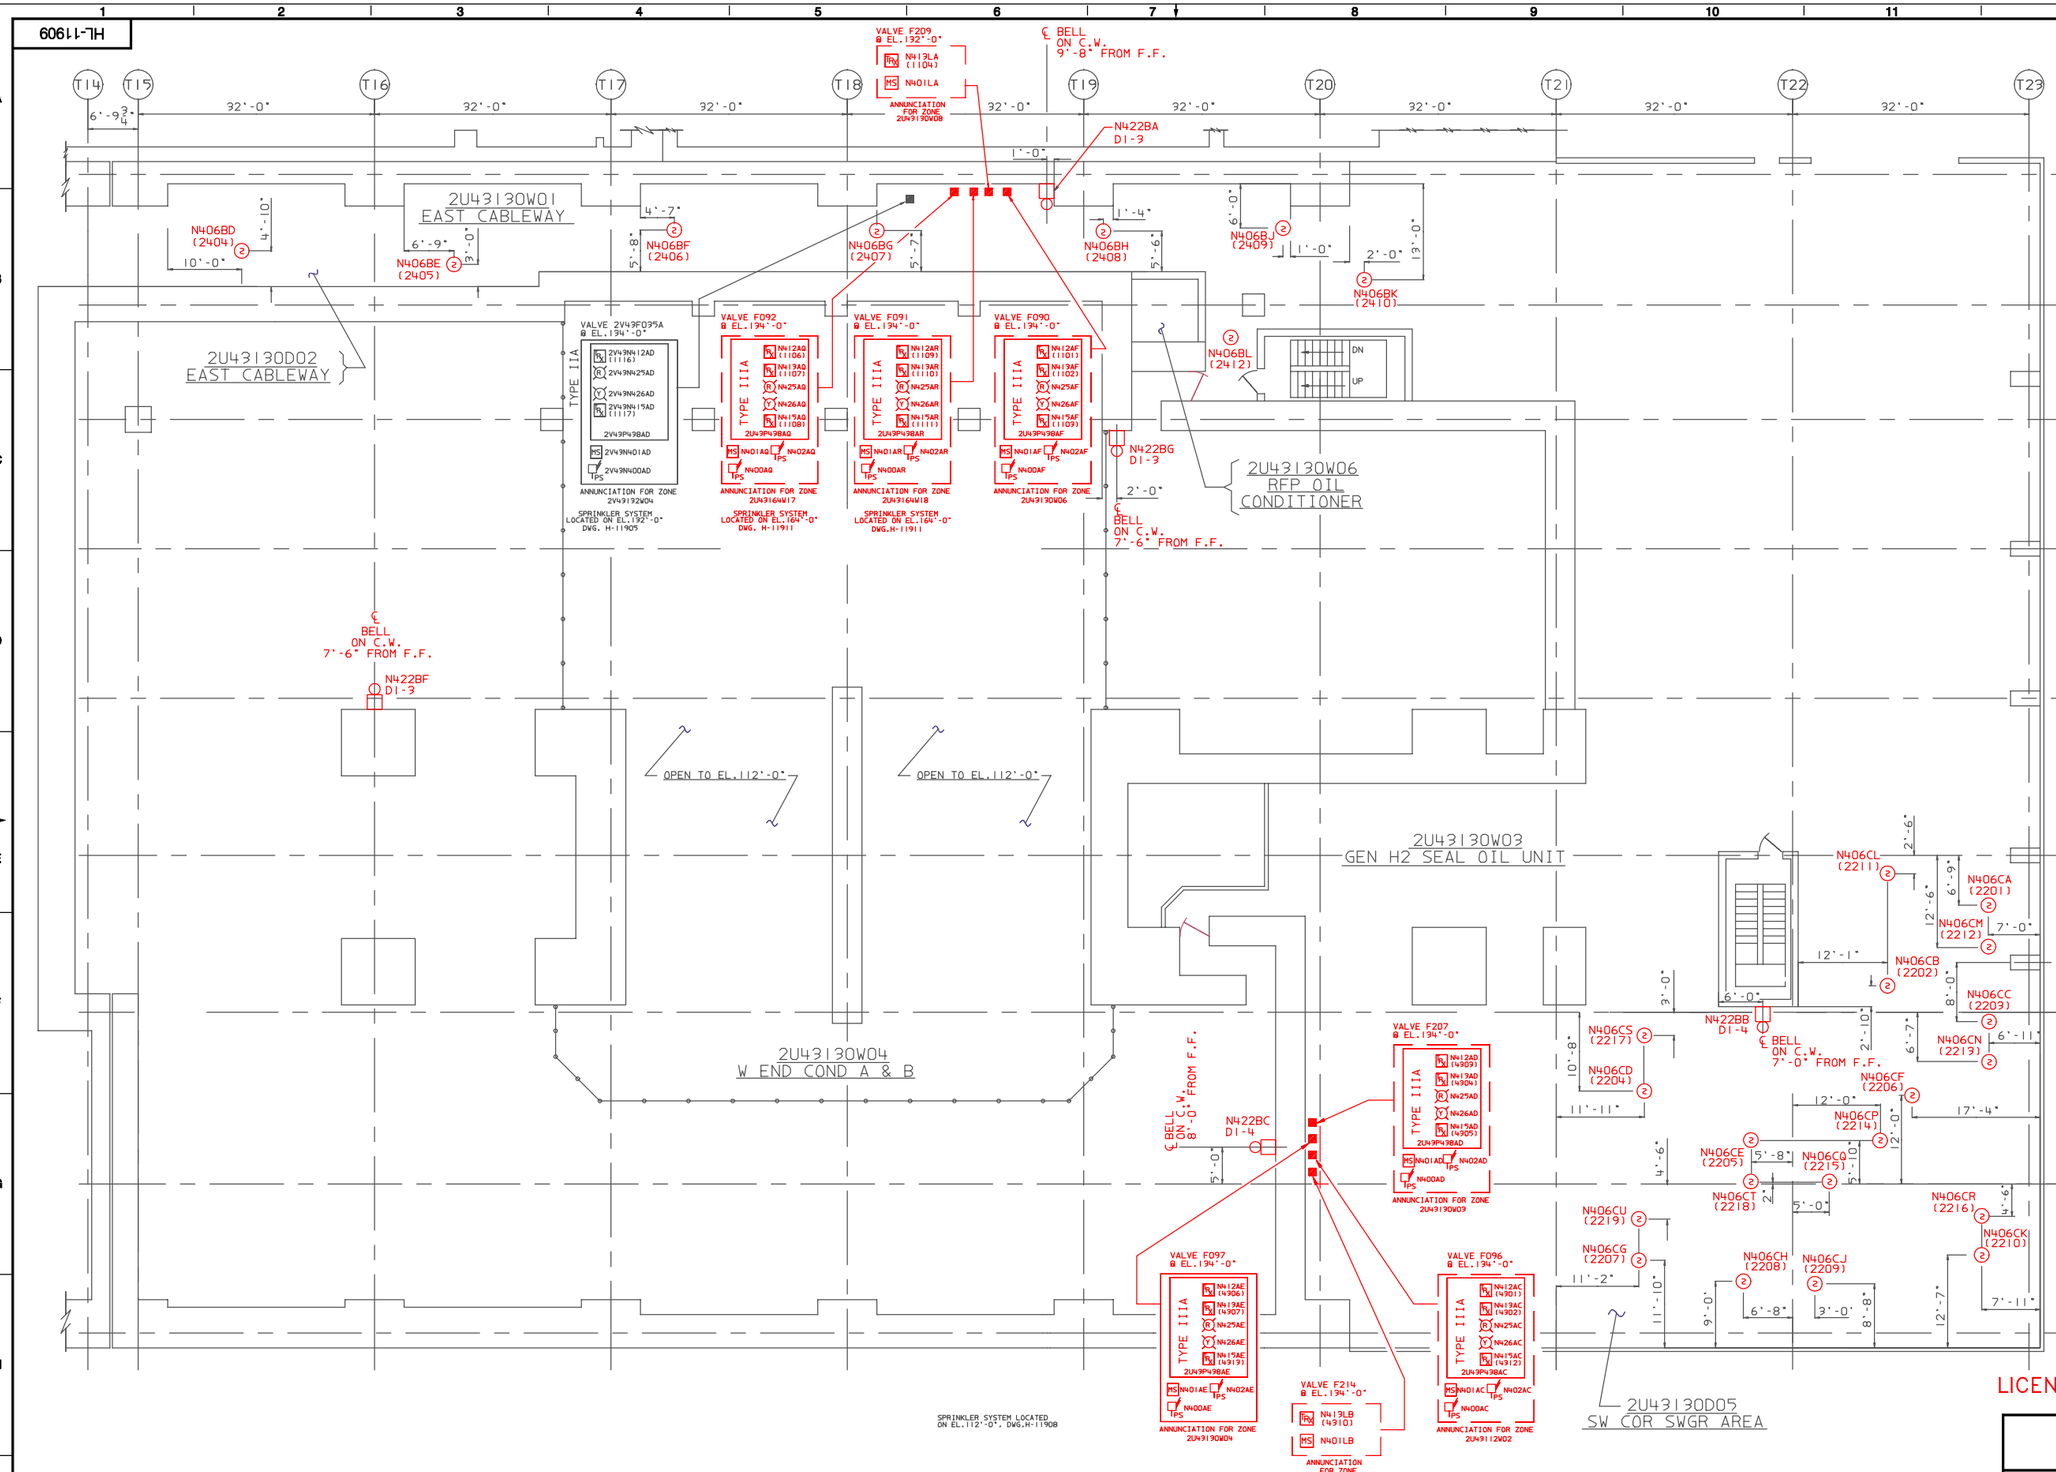

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 2U43. ALARM VALVE AND RTU LOCATED ON DWG. H-11908 EL.112'-0".
2. [2]
3. SEE ELEC. DWG. H-40178.
4. APPENDIX "R" ZONES 2106 & 2111 SHOWN ON THIS DWG.
5. FOR GENERAL NOTES AND LEGEND SEE DWG.H-11866.
6. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG. H-11821.

REFERENCES:

H-11821	FIRE HAZARDS ANALYSIS.
H-21200	TURB. BLDG. FIRE PROT. P&ID SH.3 OF 5.
H-21201	TURB. BLDG. FIRE PROT. P&ID SH.4 OF 5.
H-21202	TURB. BLDG. FIRE PROT. P&ID SH.5 OF 5.
H-22804	ARCH. TURBINE BLDG. FLOOR PLAN EL.130'-0" SH.1
H-22805	ARCH. TURBINE BLDG. FLOOR PLAN EL.130'-0" SH.2
H-26972	FIRE PIPING, RADWASTE BLDG.
H-26973	FIRE PROTECTION PIPING, RADWASTE BLDG. EL.132'-6"
SX-25800	TURB. BLDG. FIRE PROT. SPR. PLC
S-51109	REV.A FIRE PROT MULTIPLEX SYSTEM O&M MANUAL
S-51110	MULTIPLEX MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11909

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

BOUNDARY DIAGRAM NO.:2X43-B06-14

FUNCTION(S) NO.: 2X43-06

PREPARED BY: M. D. STEPHENS

DATE: 03-19-98

REVIEWED BY: ALEX MORRISON

DATE: 07-15-98

Revision: A	Date: 12-28-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11909, REV. 1; BY ECB

BY	CHK'D	APPR
ECB	MDS	ASK

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
EQUIPMENT LAYOUT DRAWINGS
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 2U43 TURBINE BLDG. EL. 130'-0"

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11909	A
DATE	SCALE 1/8"=1'-0"			