HL-11912

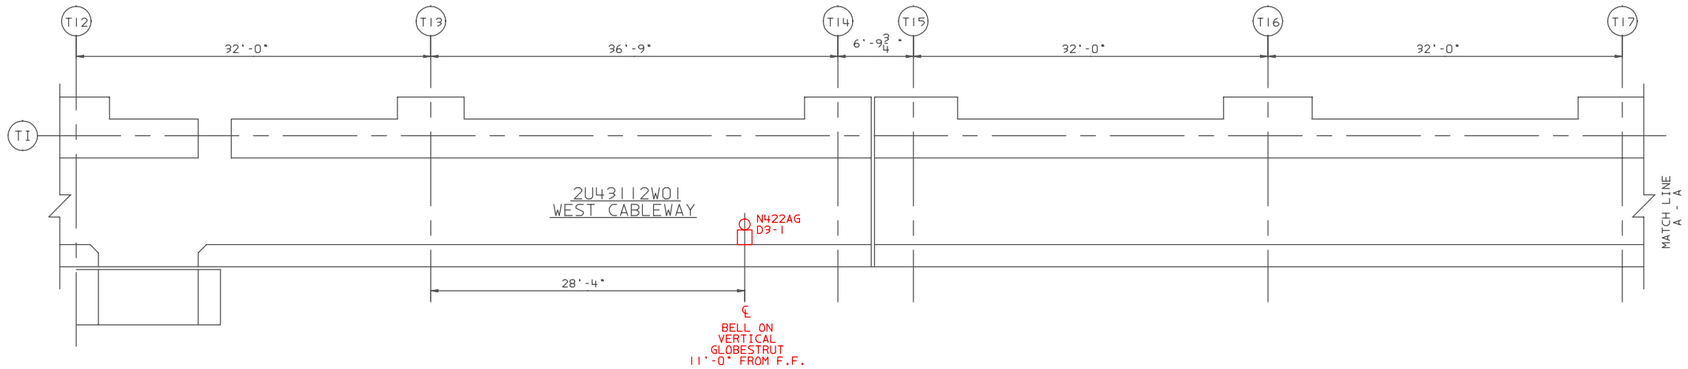


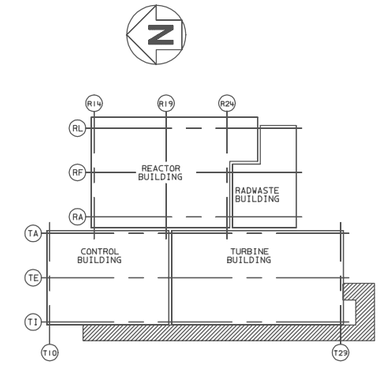


KEY PLAN

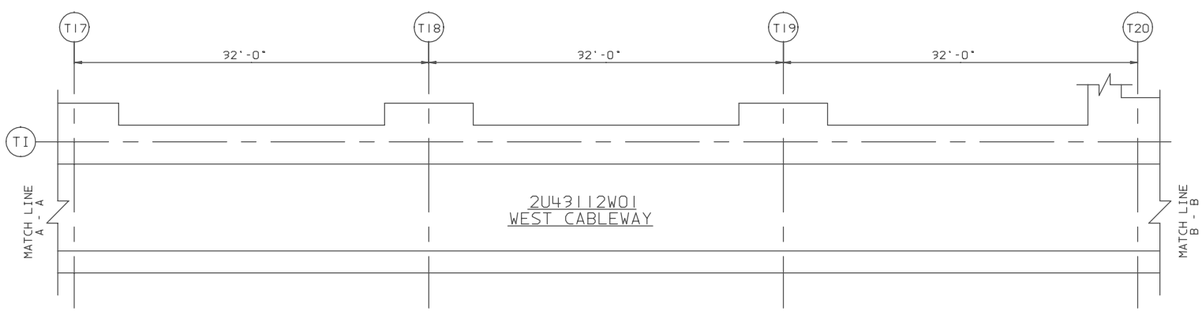


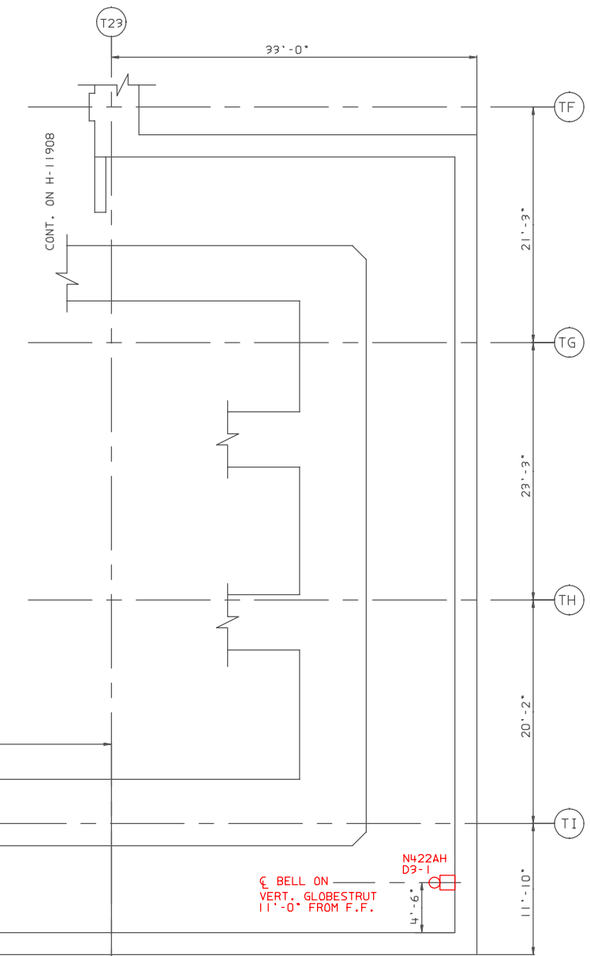


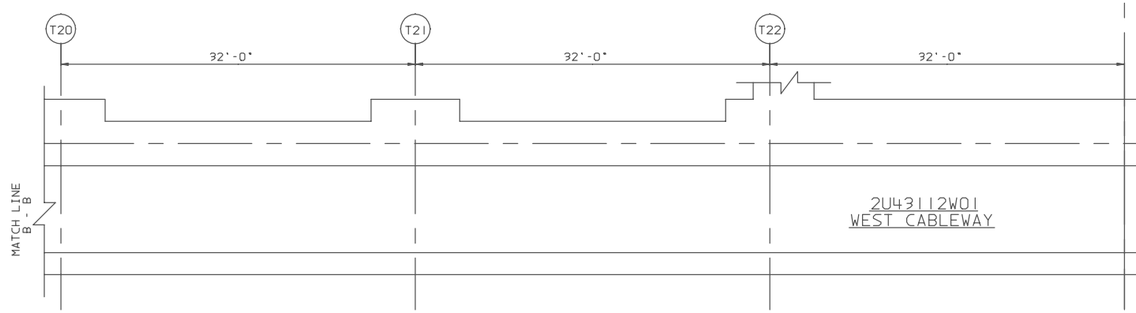


## NOTES:

1. UNLESS OTHERWISE NOTED. ALL MPL NUMBERS SHALL BE PREFIXED BY 2U43.
2. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11866.

## REFERENCES:

| | |
|---|---|
| H-25985 | ACCESS CONTROL FLOOR PLAN EL.87'-0" |
| S-51109 | REV.A FIRE PROTECTION MULTIPLEX SYSTEM O&M MANUAL |
| S-51110 | MULTIPLEX MOUNTING DETAILS |
| S-51111 | MULTIPLEX RTU INTERNAL WIRING DIAGRAMS |

LICENSE RENEWAL DOCUMENT

BOUNDARY DIAGRAM NO.:2X43-B06-12

FUNCTION(S) NO.: 2X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

| Revision: A | Date: 12-22-99 |
|---|---|
| APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11912, REV. 1; BY ECB | |

| BY | CHK'D | APPR |
|---|---|---|
| ECB | MDS | ASK |

ACAD14 | HL11912

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
EQUIPMENT LAYOUT DRAWINGS.
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 2U43 WEST CABLEWAY EL. 112'-0"

| DRAWN | DESIGNED | LOCATION | DOCUMENT NUMBER | REVISION |
|---|---|---|---|---|
| ECB | LCF | 10-502 | HL-11912 | A |
| DATE | SCALE 3/16"=1'-0" | | | |