HL-11917

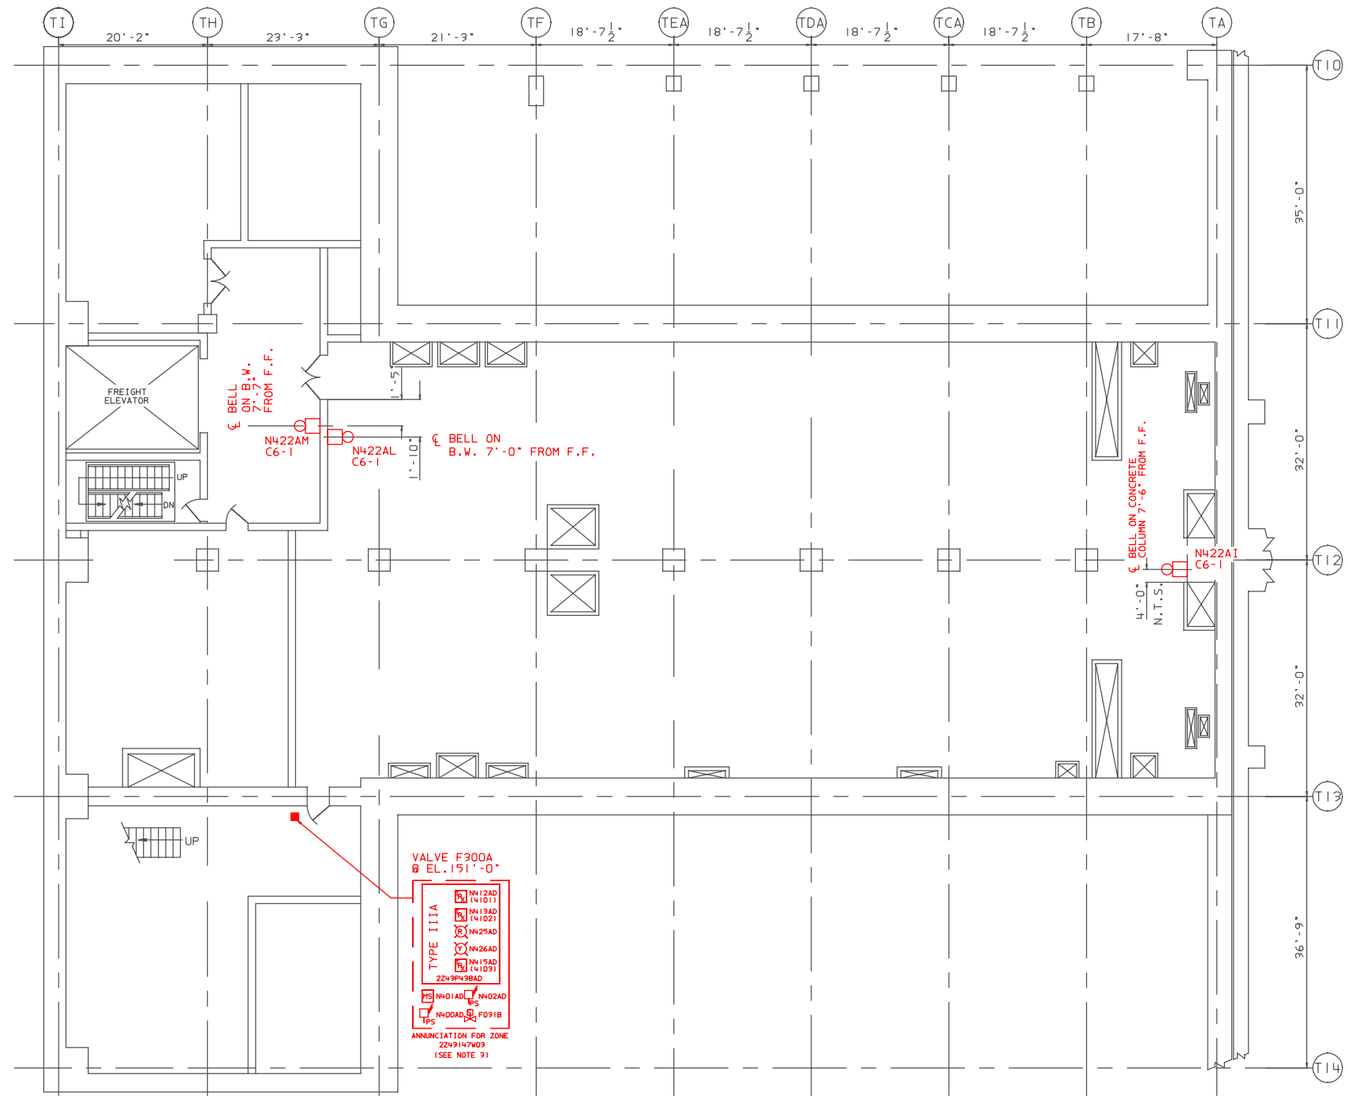



KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 2Z43.
2. UNIT 2 DEVICES SHOWN. FOR UNIT 1 DEVICES SEE DWG. H-11881 SH. 1 & 2.
3. SOLENOID VALVE F091A ACTUATED BY PROGRAMED DRY RELAY CONTACT IN SLAVE PANEL C.
4. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11866.
5. FOR CABLE SPREAD ROOM LINEAR THERMAL DETECTION (ALISON) LAYOUT SEE H-11884 SH.2.
6. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG. H-11816.

REFERENCES:

A-11307 SH.1	FIRE PROTECTION - LINEAR SENSOR MOUNTING BRACKET FOR CABLE TRAYS
A-11307 SH.2	FIRE PROTECTION - LINEAR SENSOR MOUNTING BRACKET FOR CEILING
A-11307 SH.3	FIRE PROTECTION - DETAIL FOR CEILING MOUNTING
H-11323.....	FIRE PROTECTION P&ID
H-11816.....	FIRE HAZARDS ANALYSIS.
H-12630.....	ARCH, TURB. & CONTROL BLDG. GENERAL PLAN EL.147'-0"
H-41106.....	EQUIPMENT LAYOUT DRAWING, FIRE BRIGADE EQUIPMENT ROOM, EL.147'-0", FIRE PROTECTION MULTIPLEX SYSTEM

BOUNDARY DIAGRAM NO.:2X43-B06-22

FUNCTION(S) NO.: 2X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD14 | HL11917

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

Revision: A | Date: 12-22-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11917, REV. 1; BY ECB

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
EQUIPMENT LAYOUT DRAWINGS.
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 2Z43 CONTROL BLDG. EL. 147'-0"

BY	CHK'D	APPR
ECB	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11917	A
DATE	SCALE 1/8"=1'-0"			