HL-16016

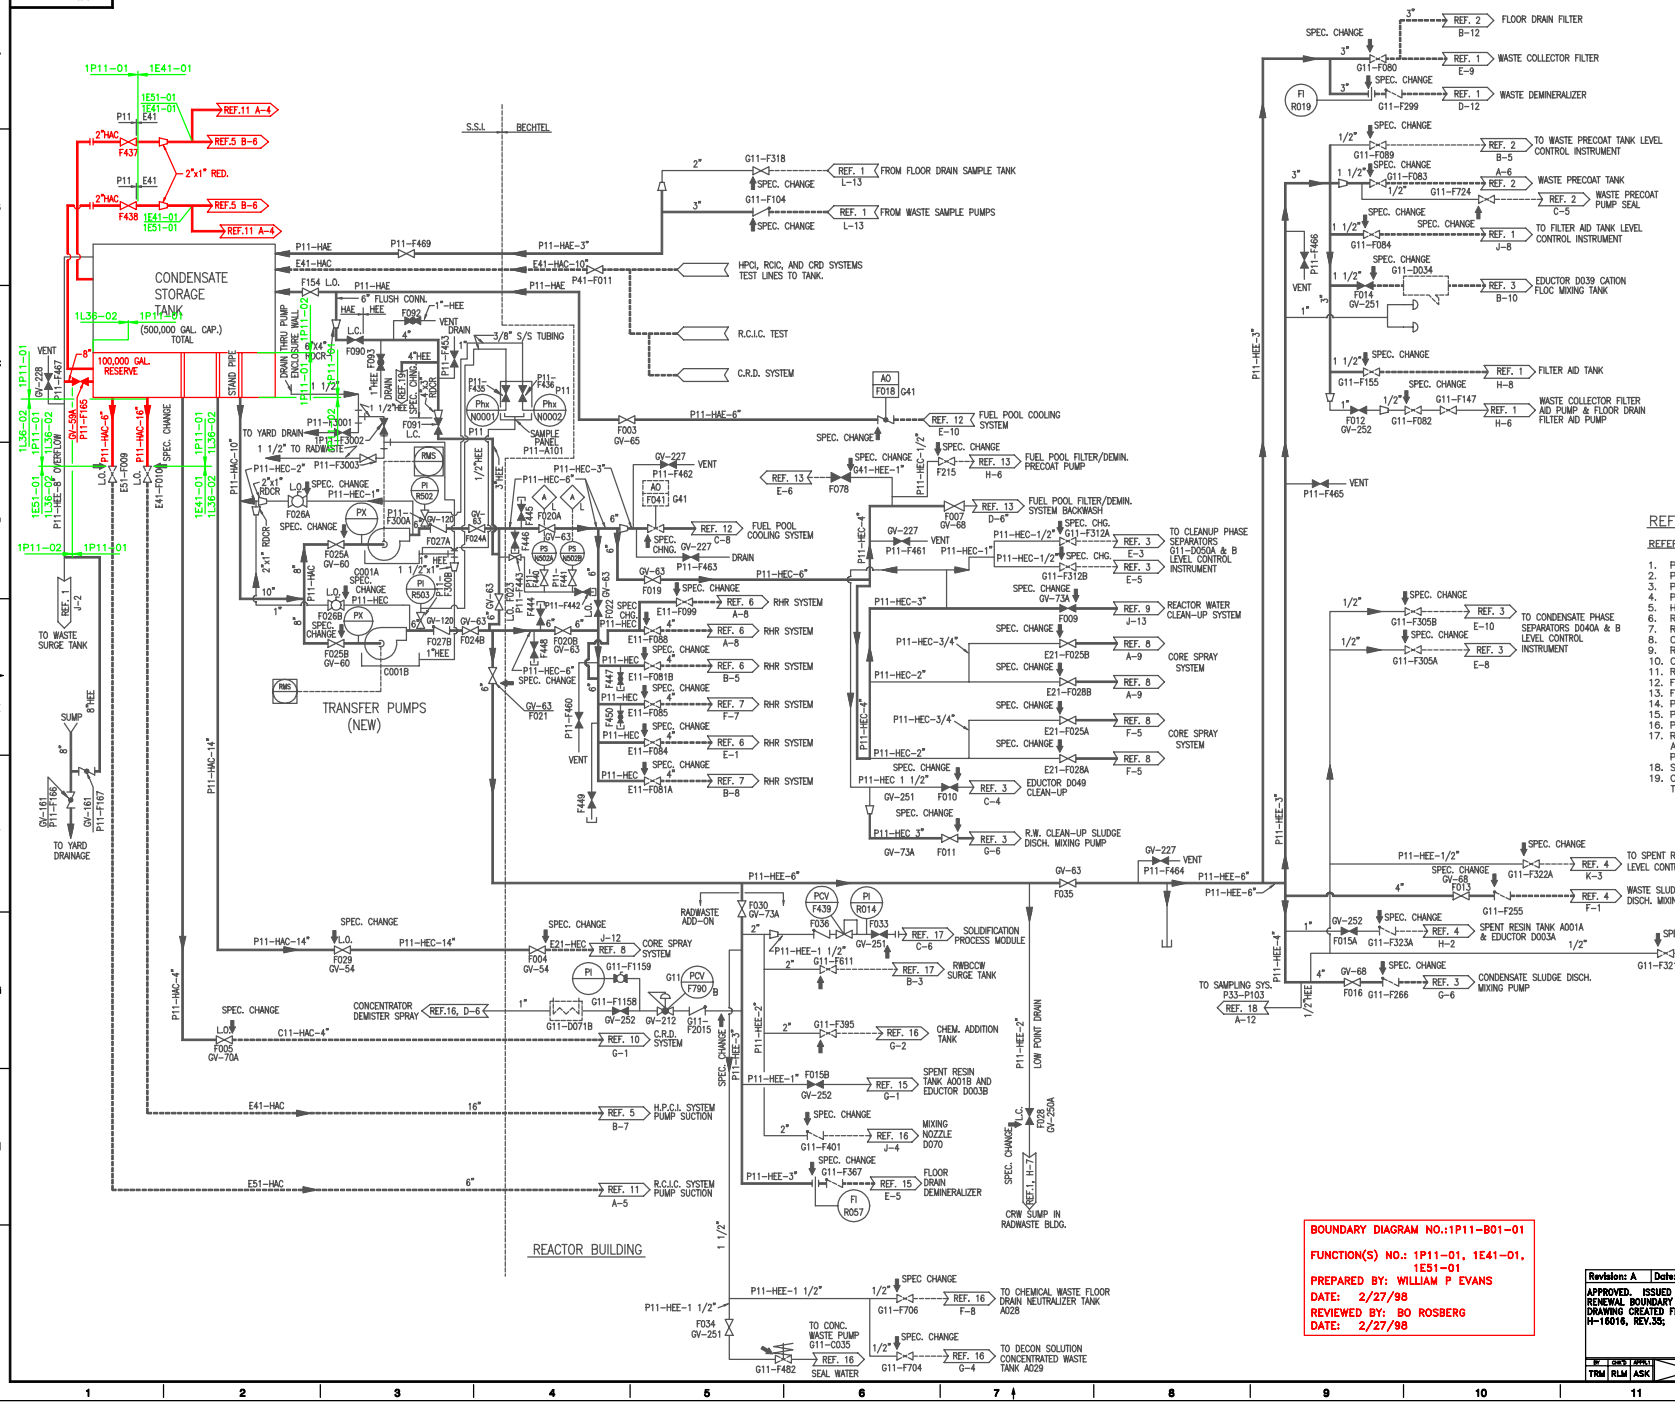

NOTES:

1. ALL SUPPLY CONNECTIONS EXCEPT FOR THE HPCI AND RCIC SYSTEM, ON THE CONDENSATE STORAGE TANK MUST CONNECT TO A STANDPIPE THAT MAINTAINS A RESERVE IN THE TANK OF 100,000 GALLONS, AT MINIMUM.
2. ALL RETURN CONNECTIONS ON THE CONDENSATE STORAGE TANK MUST CONNECT ABOVE THE 100,000 GALLON MARK.
3. WHERE GV-NO'S. ARE SHOWN THE VALVES ARE TAGGED WITH THESE NO'S. WHERE GV-NO'S. ARE NOT SHOWN, THE VALVES ARE TAGGED WITH THE MPL NO.
4. PROVIDE LOW POINT DRAIN TO DRAIN CROSS TIE PIPE AFTER USE. ROUTE DRAIN TO SUMP. VALVES MUST BE CLOSED AND LINE MUST BE DRAINED AFTER USE. HIGH POINT VENT IS REQUIRED.
5. USE FOLLOWING VALVES FOR CROSS-TIE: VALVE NO:, P11-F091 → 2P11-F030 (PEH2-138), P11-F090 → GV-70A(PEH-20).
6. THROTTLE VALVE 2P11-F094 AS REQUIRED.

REFERENCES:

REFERENCES	MPL. ITEM NO	S.S. DWG. NO
1. P.&I.D. RADWASTE SYSTEM	G11-1010	H-16177
2. P.&I.D. RADWASTE SYSTEM	G11-1010	H-16178
3. P.&I.D. RADWASTE SYSTEM	G11-1010	H-16179
4. P.&I.D. RADWASTE SYSTEM	G11-1010	H-16182
5. H.P.C.I. SYSTEM	E41-1010	H-16332
6. R.H.R. SYSTEM	E11-1010	H-16329
7. R.H.R. SYSTEM	E11-1010	H-16330
8. CORE SPRAY SYSTEM	E21-1010	H-16331
9. REACTOR CLEAN-UP SYS.	G31-1010	H-16188
10. C.R.D. SYSTEM	C11-1010	H-16064
11. R.C.I.C. SYSTEM	E51-1010	H-16334
12. FUEL POOL COOLING SYS.	G41-1010	H-16002
13. FUEL POOL COOLING SYS.	G41-1020	H-16003
14. PIPING & INSTRUMENT SYMBOLS	A41-1010	S-15051
15. P.&I.D. RADWASTE SYS.	G11-1010	H-16180
16. P.&I.D. RADWASTE SYS.	G11-1010	H-16181
17. RADWASTE BUILDING ADDITION SUPPORT SYS. P.&I.D. AND PF.	G11-1011	H-16517
18. SAMPLING SYS. P.&I.D. & PFD	P33-2010	H-16281
19. CONDENSATE & STORAGE TRANSFER SYS.	2P11-1010	H-26046

BOUNDARY DIAGRAM NO.:1L36-B01-04
FUNCTION(S) NO.: L36-02
PREPARED BY: M D STEPHENS
DATE: 6/11/98
REVIEWED BY: WILLIE JENNINGS
DATE: 7/9/98

BOUNDARY DIAGRAM NO.:1P11-B01-01
FUNCTION(S) NO.: 1P11-01, 1E41-01, 1E51-01
PREPARED BY: WILLIAM P EVANS
DATE: 2/27/98
REVIEWED BY: BO ROSBERG
DATE: 2/27/98

LICENSE RENEWAL DOCUMENT

MPL NO. P11-1010 | ACAD14 | HL16016

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No. 1
REACTOR BLDG. & RADWASTE BLDG.
CONDENSATE STORAGE & TRANS. SYS. P.&I.D.

Revision: A	Date: 10-21-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-16016, REV.33; BY TRM.	

BY	CHK'D	APPR'D
TRM	RLM	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-16016	A
DATE	SCALE: None			