HL-16173

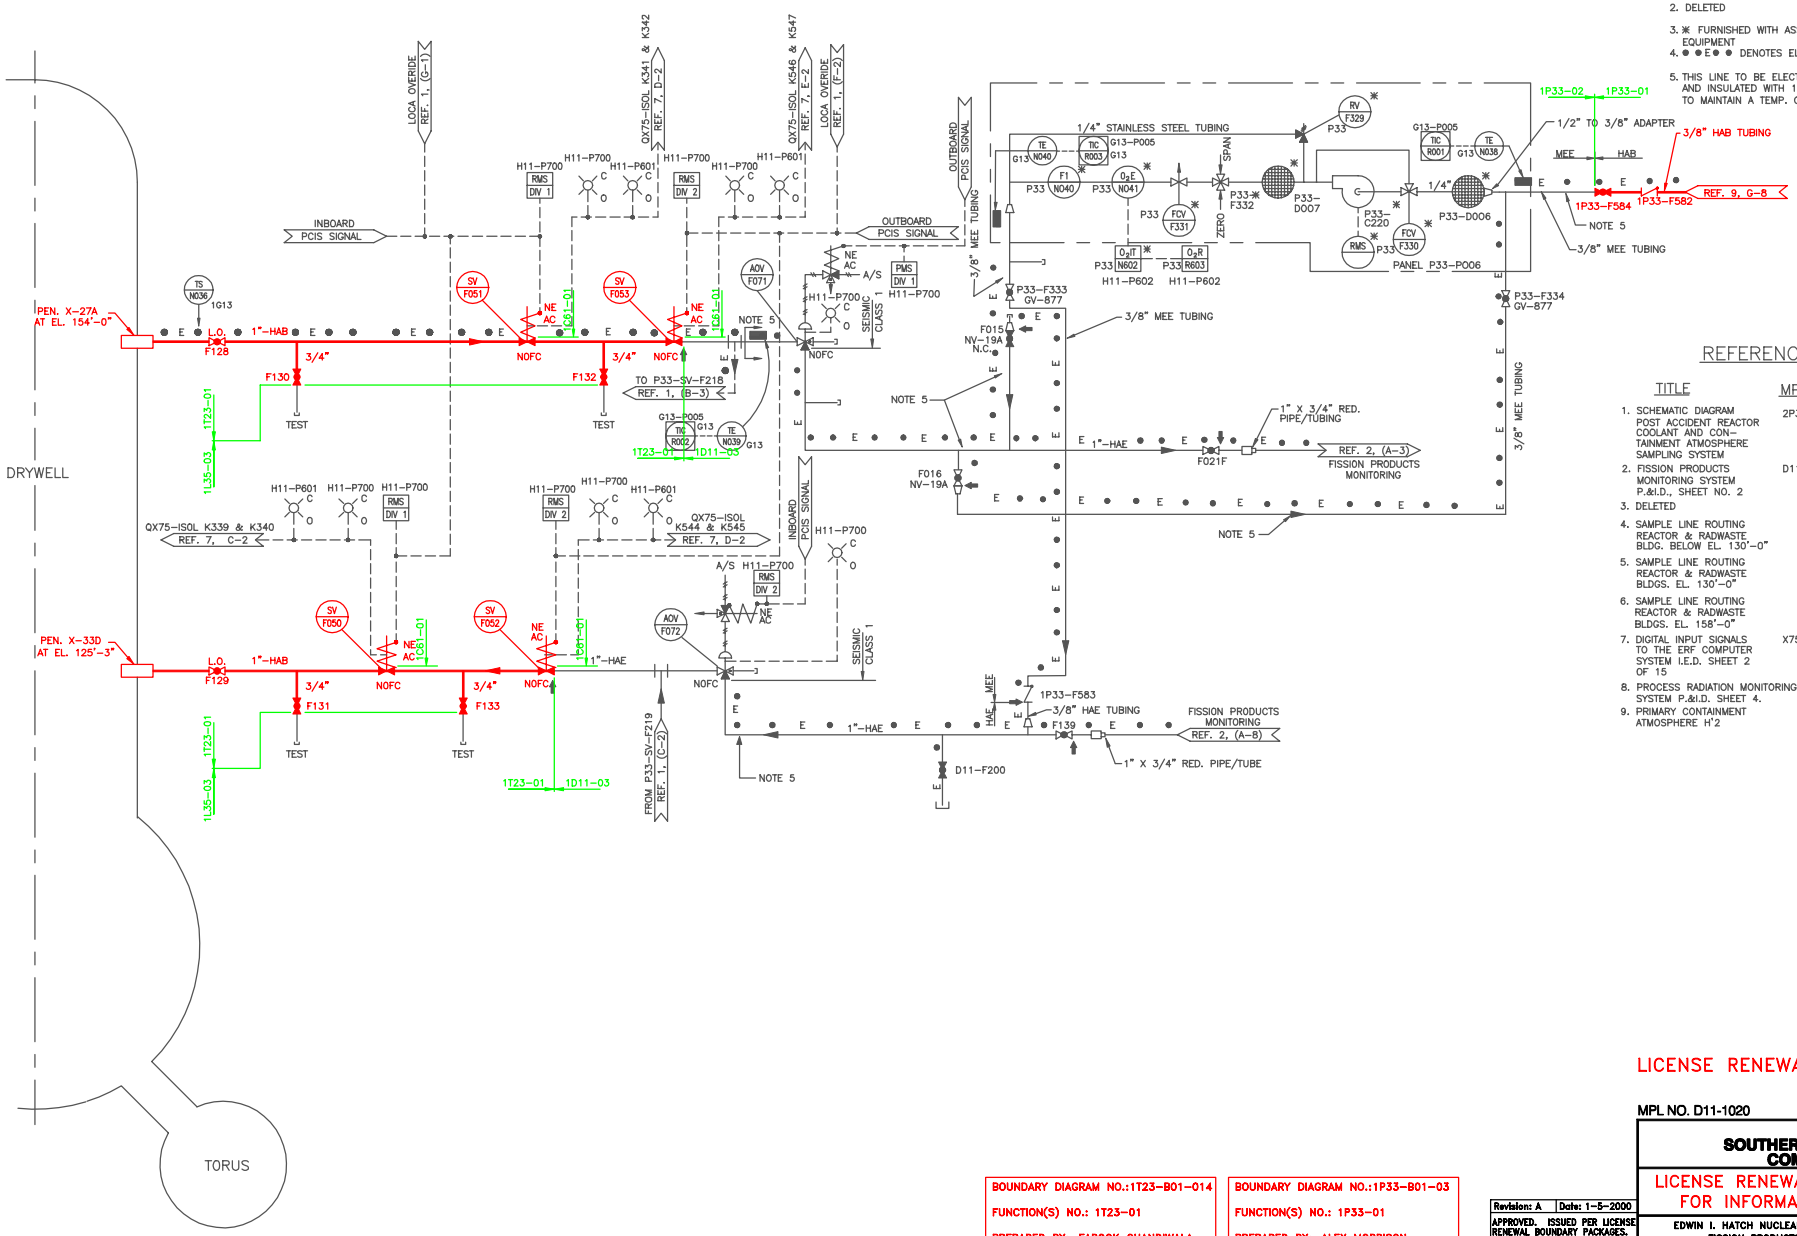

NOTES

1. ALL EQUIPMENT AND INSTRUMENT NUMBERS ARE TO BE PRECEDED BY MPL D11, UNLESS OTHERWISE NOTED
2. DELETED
3. ✱ FURNISHED WITH ASSOCIATED EQUIPMENT
4. ● ●E● ● DENOTES ELECTRICAL HEAT TRACING.
5. THIS LINE TO BE ELECTRICALLY HEAT TRACED AND INSULATED WITH 1" FIBERGLASS INSULATION TO MAINTAIN A TEMP. OF 110° F.

REFERENCES

TITLE	MPL NO	DWG NO
1. SCHEMATIC DIAGRAM POST ACCIDENT REACTOR COOLANT AND CON-TAINMENT ATMOSPHERE SAMPLING SYSTEM	2P33-1010	H-26384
2. FISSION PRODUCTS MONITORING SYSTEM P.&I.D., SHEET NO. 2	D11-1010	H-16274
3. DELETED		
4. SAMPLE LINE ROUTING REACTOR & RADWASTE BLDG. BELOW EL. 130'-0"		H-16553
5. SAMPLE LINE ROUTING REACTOR & RADWASTE BLDGS. EL. 130'-0"		H-16554
6. SAMPLE LINE ROUTING REACTOR & RADWASTE BLDGS. EL. 158'-0"		H-16556
7. DIGITAL INPUT SIGNALS TO THE ERF COMPUTER SYSTEM I.E.D. SHEET 2 OF 15	X75-1010	H-16404
8. PROCESS RADIATION MONITORING SYSTEM P.&I.D. SHEET 4.		H-16566
9. PRIMARY CONTAINMENT ATMOSPHERE H'2		H-16276

LICENSE RENEWAL DOCUMENT

MPL NO. D11-1020 | ACAD14 | HL16173

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No. 1
FISSION PRODUCTS MONITORING
SYSTEM P&ID
SHEET No.1

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-16173	A
DATE	SCALE			
	None			

BOUNDARY DIAGRAM NO.:1T23-B01-014
FUNCTION(S) NO.: 1T23-01
PREPARED BY: FAROOK CHANDIWALA
DATE: 10/20/98
REVIEWED BY: LARRY ORR
DATE: 12/8/98

BOUNDARY DIAGRAM NO.:1P33-B01-03
FUNCTION(S) NO.: 1P33-01
PREPARED BY: ALEX MORRISON
DATE: 3/9/98
REVIEWED BY: ED DAVIDSON
DATE: 5/27/98

Revision: A | Date: 1-5-2000

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-16173, REV.11; BY TRM.

BY	DWN	APPR
TRM	ED	ASK