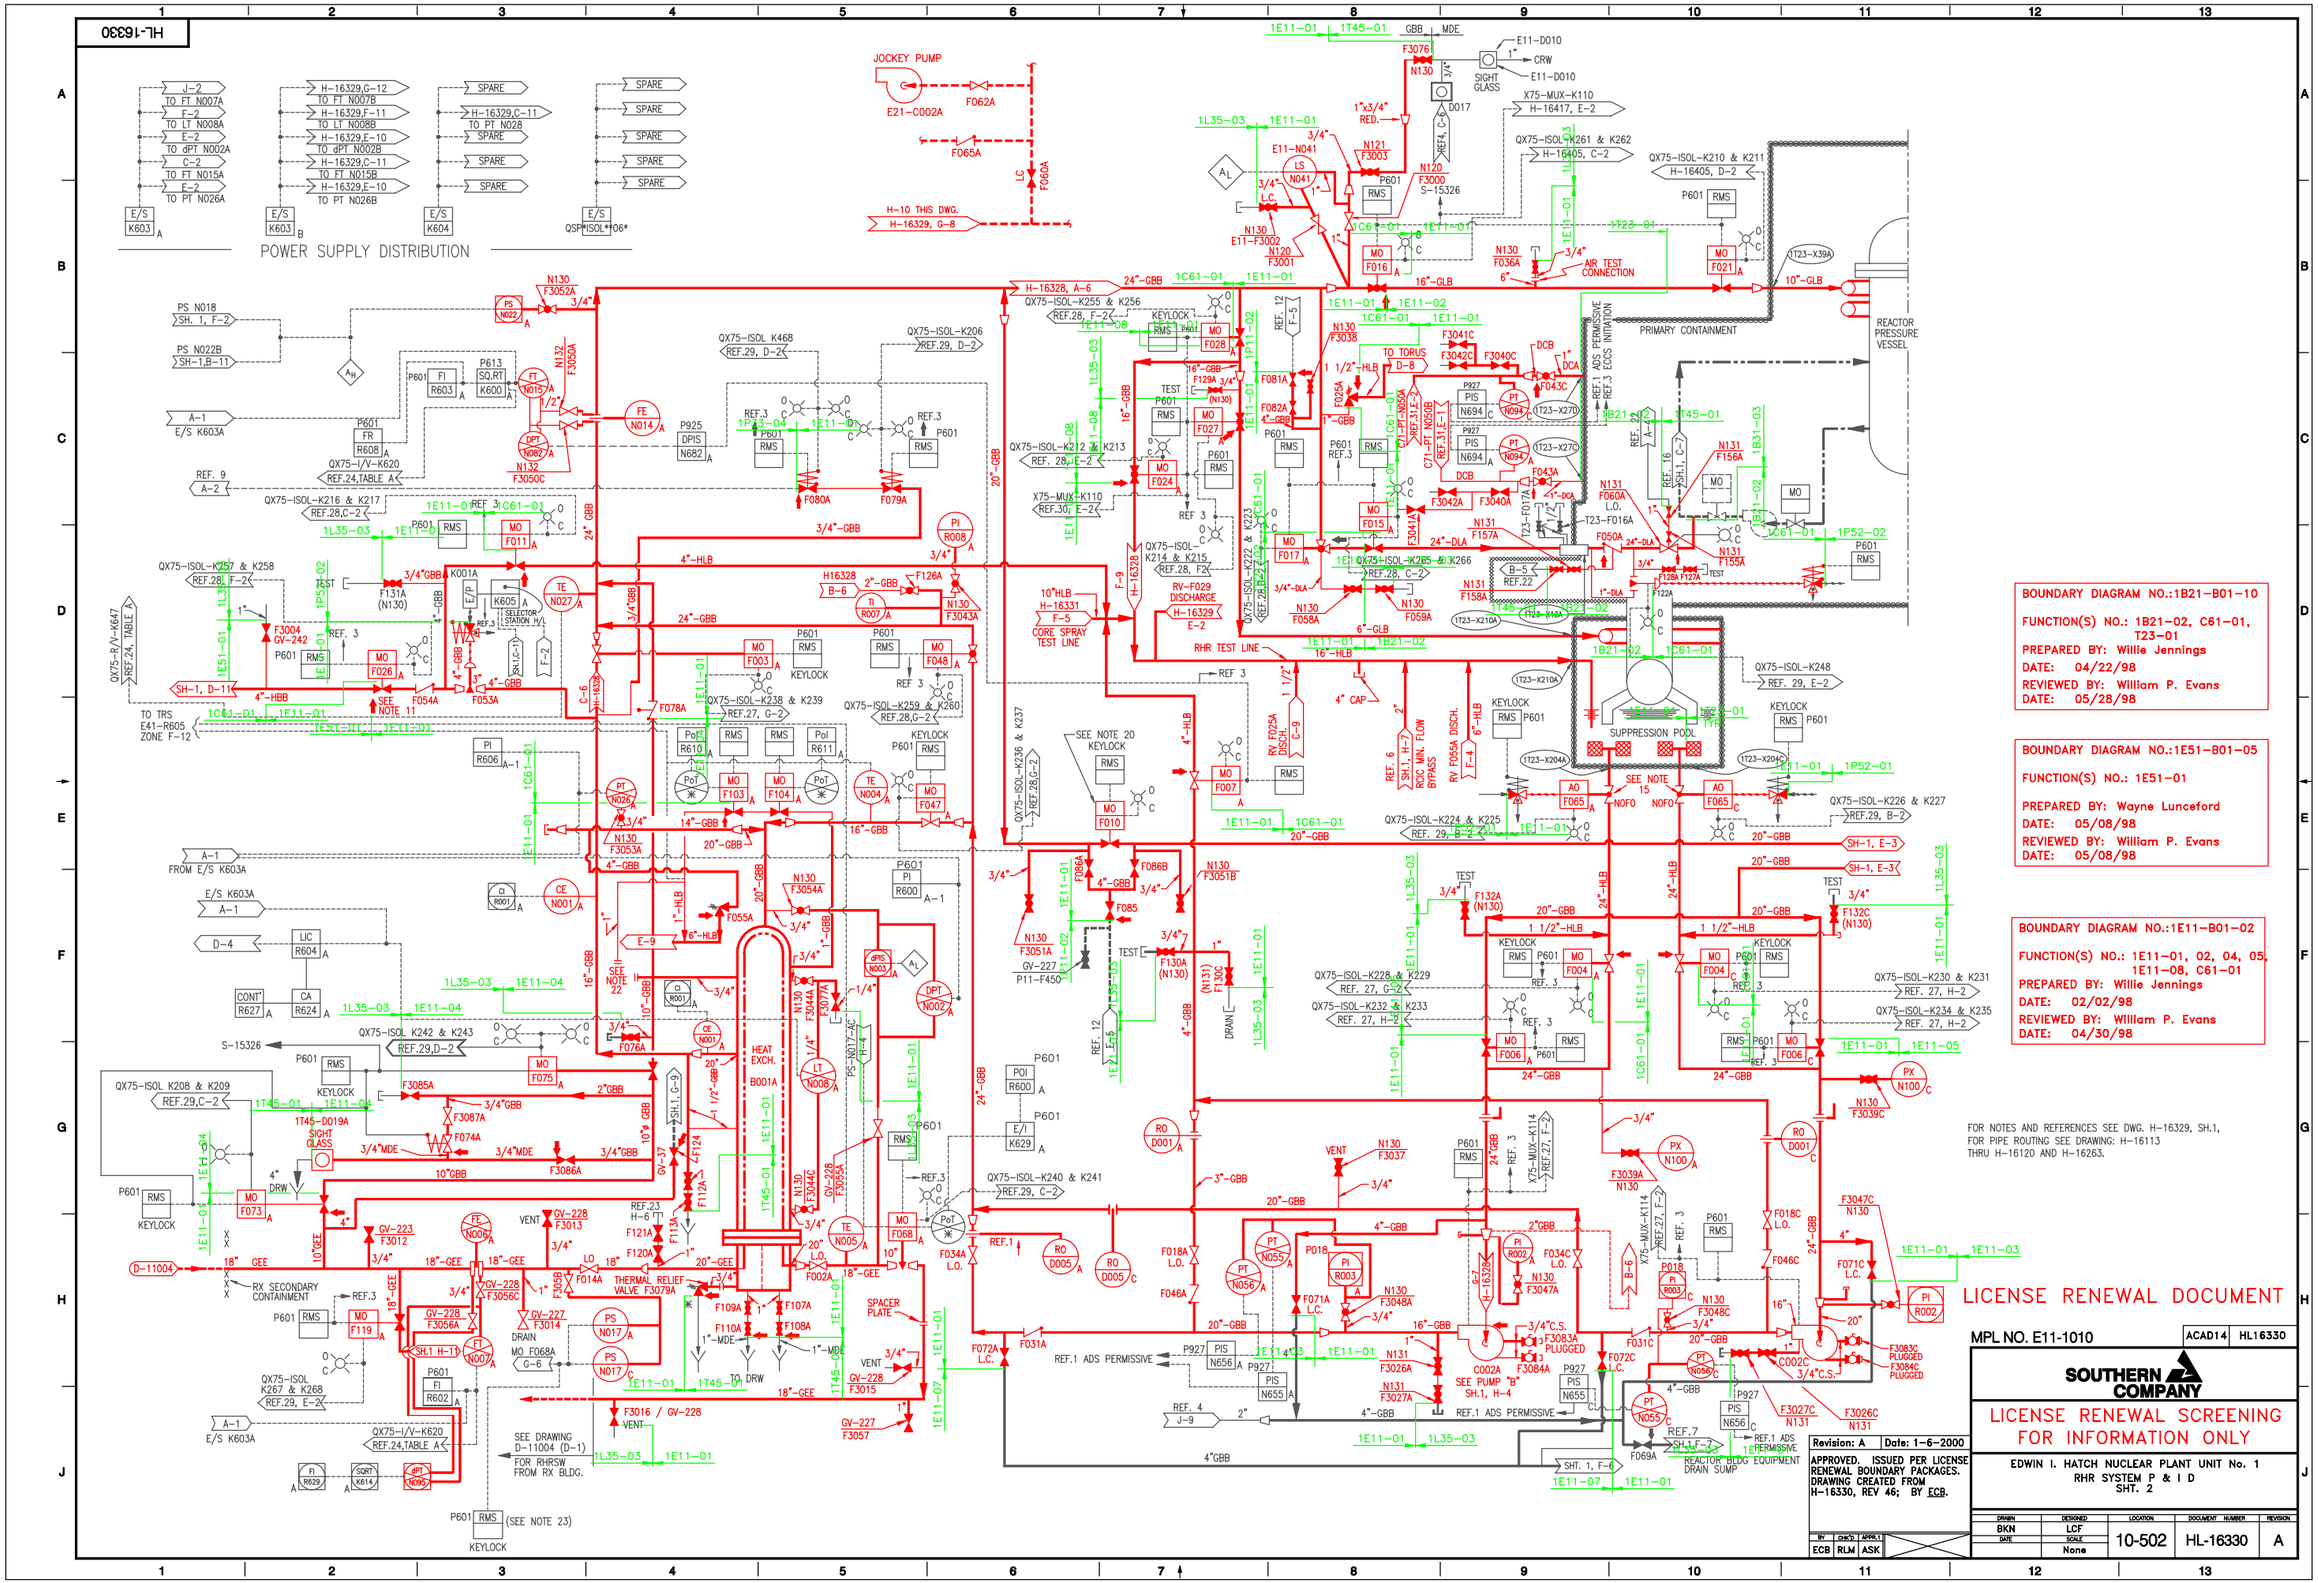
HL-16330
POWER SUPPLY DISTRIBUTION
JOCKEY PUMP
PRIMARY CONTAINMENT
REACTOR PRESSURE VESSEL
SUPPRESSION POOL
HEAT EXCH. B001A
THERMAL RELIEF VALVE F3079A
RHR TEST LINE
CORE SPRAY TEST LINE
RV-F029 DISCHARGE
REACTOR BLDG EQUIPMENT DRAIN SUMP
FOR NOTES AND REFERENCES SEE DWG. H-16329, SH.1, FOR PIPE ROUTING SEE DRAWING: H-16113 THRU H-16120 AND H-16263.
BOUNDARY DIAGRAM NO.:1B21-B01-10
FUNCTION(S) NO.: 1B21-02, C61-01, T23-01
PREPARED BY: Willie Jennings
DATE: 04/22/98
REVIEWED BY: William P. Evans
DATE: 05/28/98
BOUNDARY DIAGRAM NO.:1E51-B01-05
FUNCTION(S) NO.: 1E51-01
PREPARED BY: Wayne Lunceford
DATE: 05/08/98
REVIEWED BY: William P. Evans
DATE: 05/08/98
BOUNDARY DIAGRAM NO.:1E11-B01-02
FUNCTION(S) NO.: 1E11-01, 02, 04, 05, 1E11-08, C61-01
PREPARED BY: Willie Jennings
DATE: 02/02/98
REVIEWED BY: William P. Evans
DATE: 04/30/98
LICENSE RENEWAL DOCUMENT
MPL NO. E11-1010
ACAD14 HL16330
SOUTHERN COMPANY
LICENSE RENEWAL SCREENING FOR INFORMATION ONLY
Revision: A Date: 1-6-2000
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-16330, REV 46; BY ECB.
EDWIN I. HATCH NUCLEAR PLANT UNIT No. 1
RHR SYSTEM P & I D
SHT. 2
DRAWN BKN
DESIGNED LCF
LOCATION 10-502
DOCUMENT NUMBER HL-16330
REVISION A
SCALE None
BY ECB
CHK'D RLM
APPR. ASK