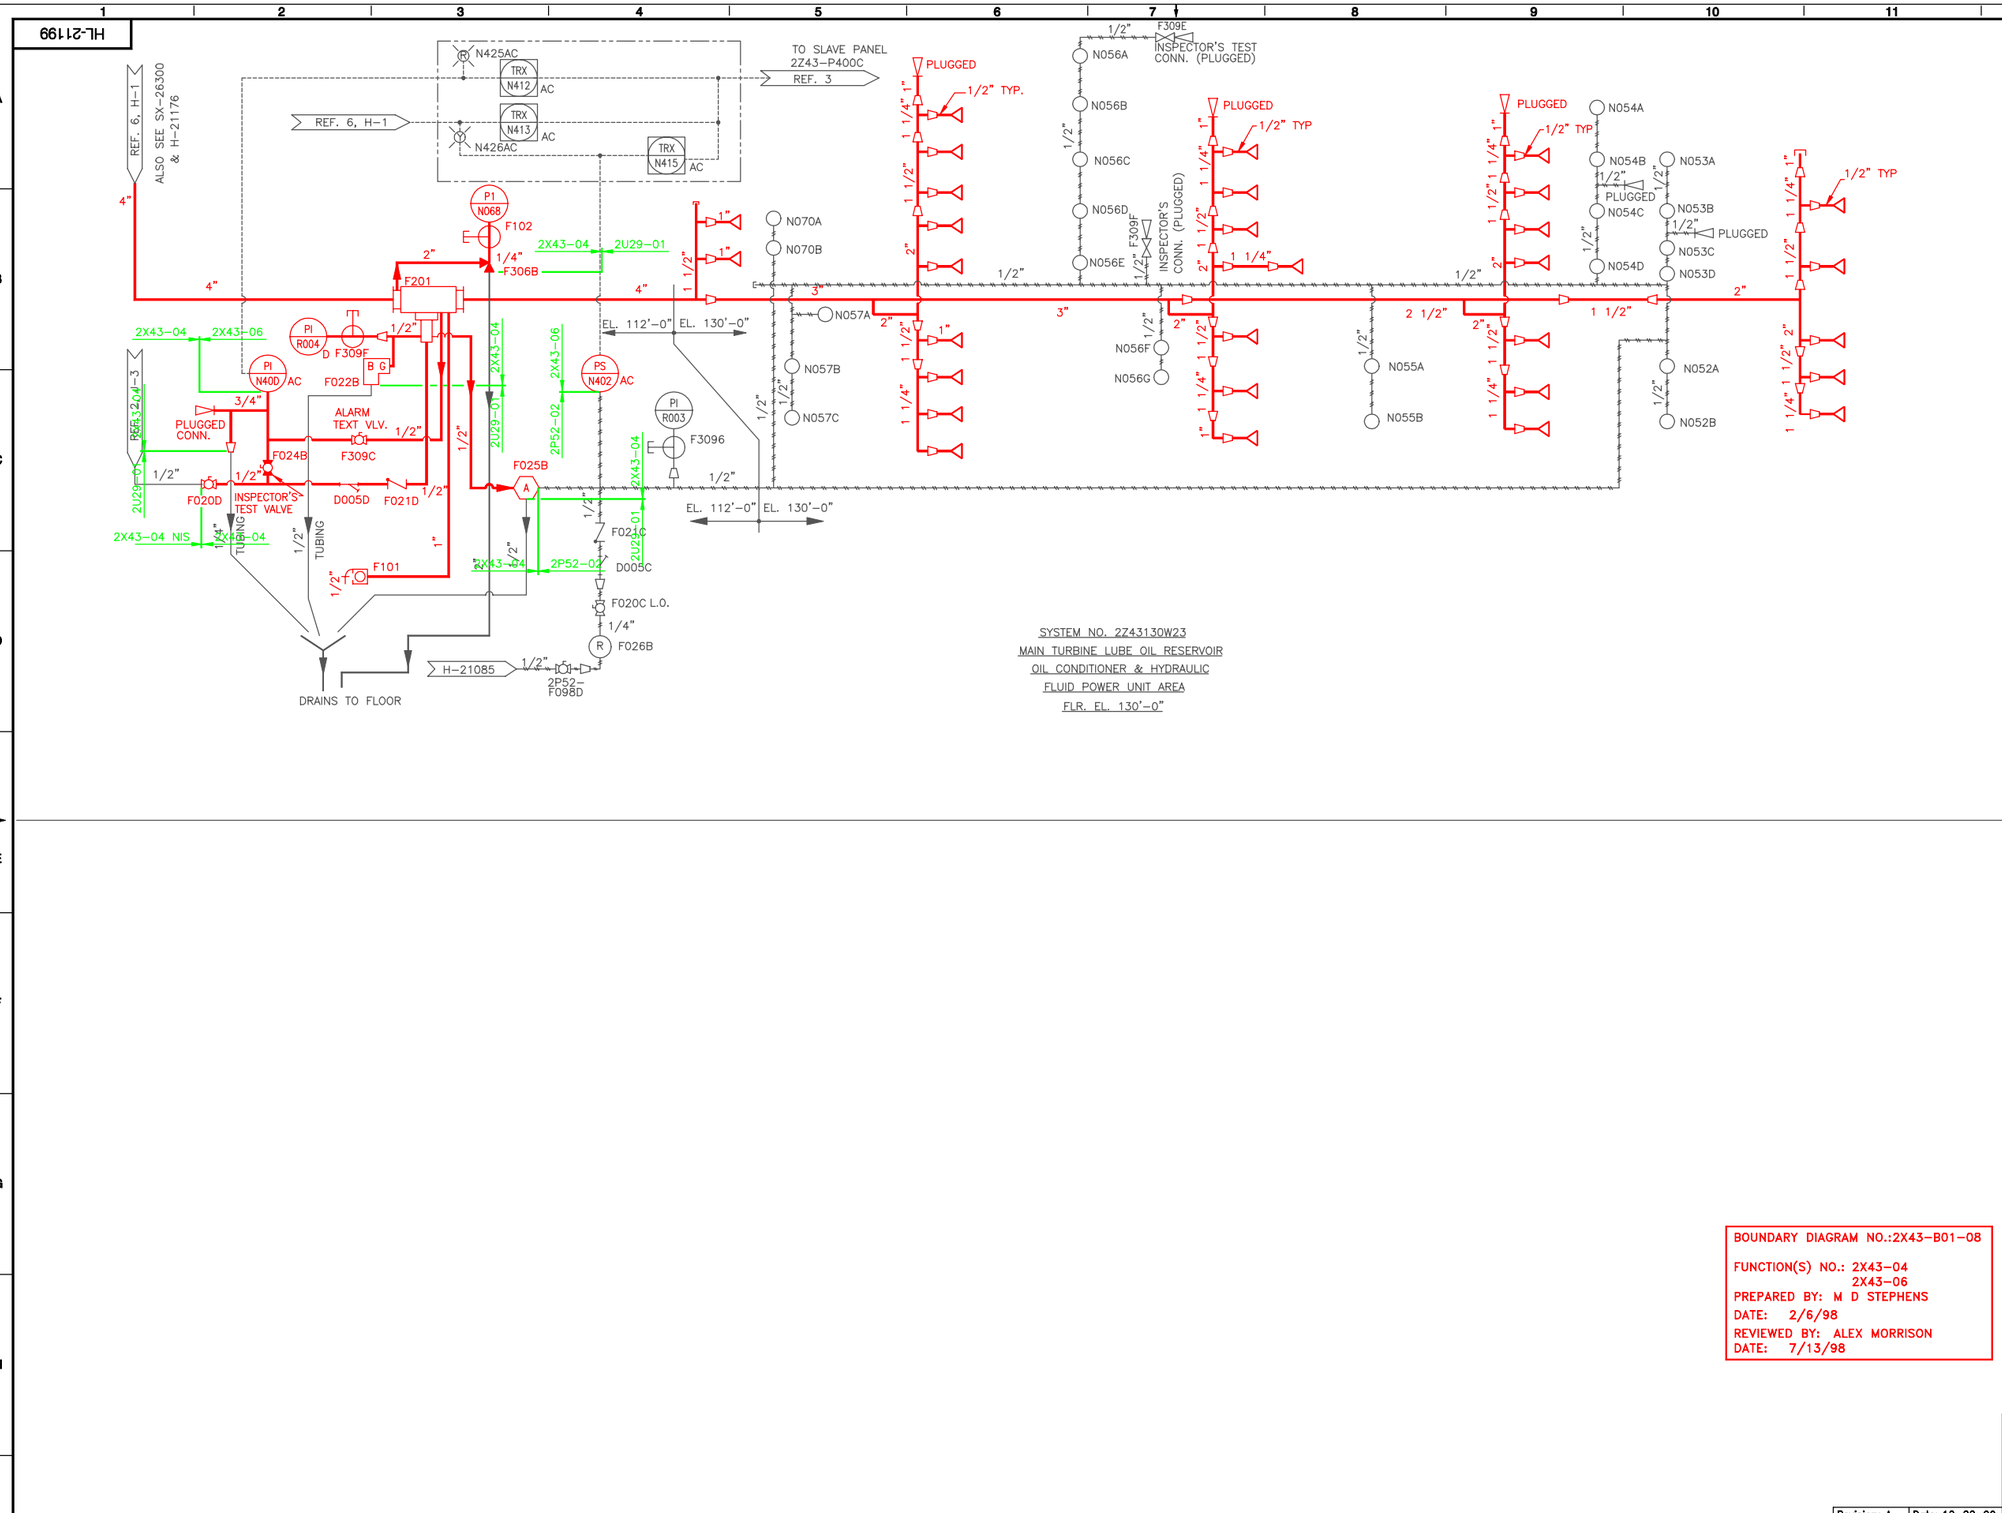

NOTES

1. 2Z43130W23 EQUIPMENT & INSTRUMENTS ARE PREFIXED WITH 2Z43 UNLESS OTHERWISE NOTED.

LEGEND

- 1/2" SPRINKLER HEAD (GRINNELL D-3 PROTECTOSPRAY NOZZLE)
- BREAK GLASS STATION
- MULTIPORT GAGE TEST VALVE
- BALL DRIP VALVE
- MULTIMATIC VALVE
- RESTRICTION CHECK VALVE
- ALARM VALVE
- RETARD CHAMBER
- PILOT HEAD (175°F)
- SPRAY NOZZLE
- DRY PILOT ACTUATOR
- REGULATOR
- ADDRESSABLE INTERFACE MODULE
- MONITOR SWITCH
- BELL
- HORN

REFERENCES

TITLE	MPL. NO	DWG. NO.
1. TURBINE BLDG. FIRE PROTECTION SYSTEM P&ID.	2U43-1010	H-21016
2. TURBINE BLDG. FIRE PROTECTION SYS. P&ID SHT. 1 OF 5.	2U43-1010 2Z43-1010	H-21198
3. FIRE PROTECTION FCD,	2Z43130W23	B-24701
4.		
5. FIRE PROT-PIPING LUBE OIL RSVR-EL. 130' & OIL STORAGE TANKS.	2Z43-1010	H-26371
6. TURBINE BLDG. FIRE PROT. SYS PLAN.	2U43-1010	H-21176
7. VALVE HEADER DETAILS		SX-26300

BOUNDARY DIAGRAM NO.:2X43-B01-08
FUNCTION(S) NO.: 2X43-04
2X43-06
PREPARED BY: M D STEPHENS
DATE: 2/6/98
REVIEWED BY: ALEX MORRISON
DATE: 7/13/98

BOUNDARY DIAGRAM NO.:2X43-B06-03
FUNCTION(S) NO.: 2X43-06
PREPARED BY: M D STEPHENS
DATE: 3/19/98
REVIEWED BY: ALEX MORRISON
DATE: 7/15/98

LICENSE RENEWAL DOCUMENT

MPL No. 2Z43-1010 | ACAD14 | HL21199

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
TURBINE BUILDING
FIRE PROTECTION SYSTEM P&ID

Revision: A	Date: 12-22-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-21199, REV.8; BY TRM.	

BY	CHK'D	APPR
TRM	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-21199	A
DATE	SCALE None			