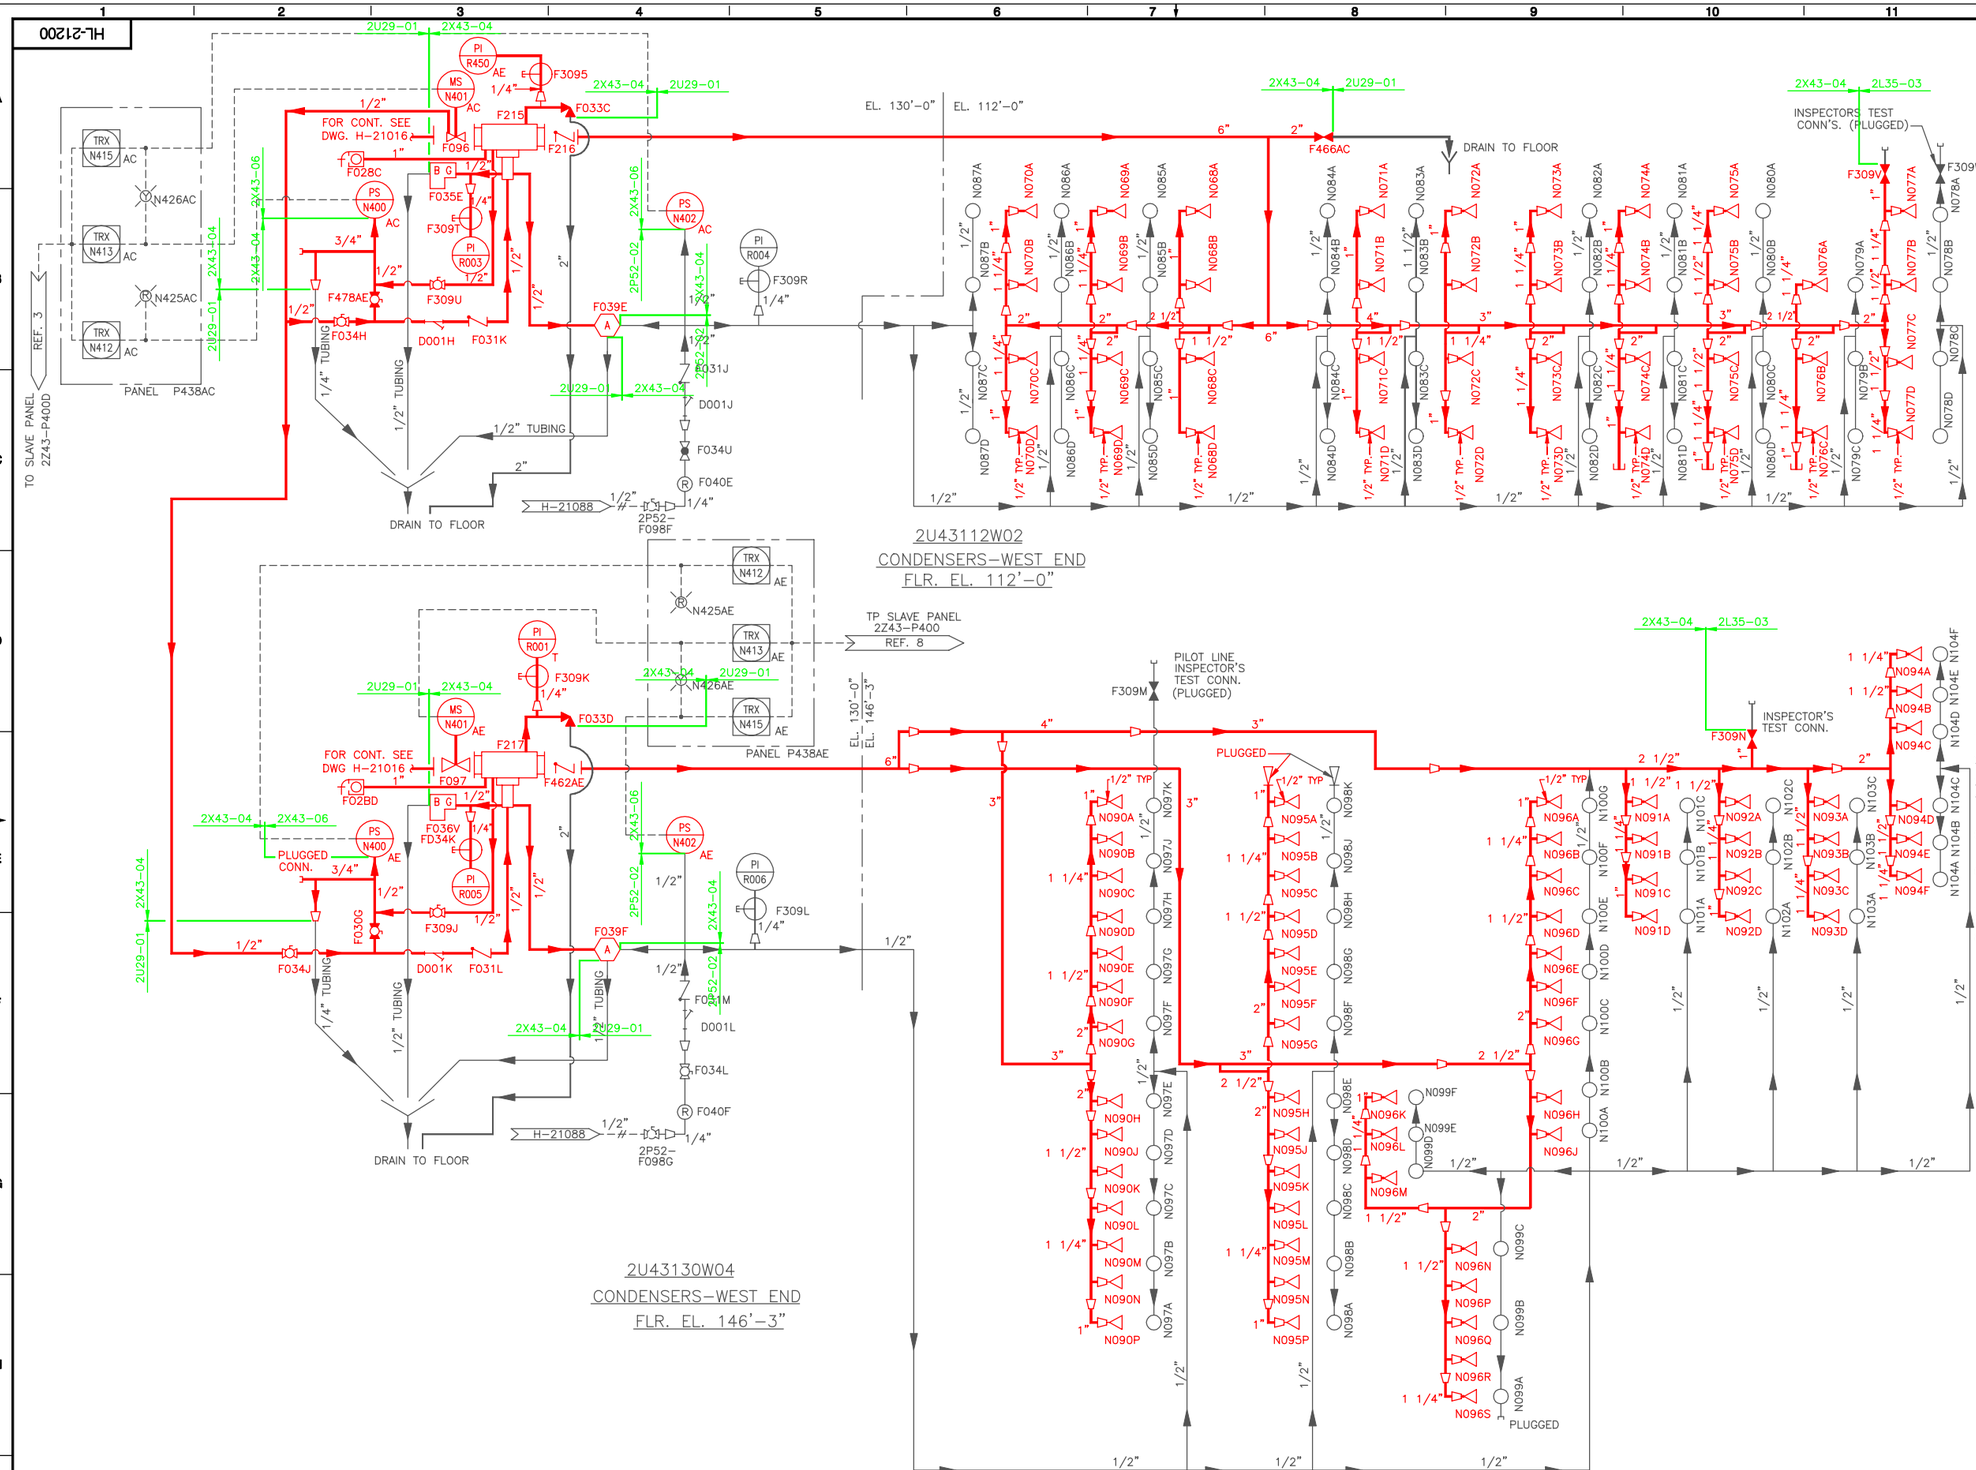

NOTES:

1. ALL EQUIPMENT & INSTRUMENTS ARE PREFIXED BY 2U43 UNLESS OTHERWISE NOTED.

LEGEND

- ANGLE GLOBE VALVE (N.C.)
- REDUCER
- GATE VALVE (N.C.)
- WARNING LIGHT
- 1/2" SPRINKLER HEAD
- BREAK GLASS STATION
- PILOT HEAD
- BALL DRIP VALVE
- MULTIMATIC VALVE
- DRY PILOT ACTUATOR
- REGULATOR
- CHECK VALVE
- MONITOR SWITCH
- PLUG VALVE
- BELL
- PLUGGED CONNECTION
- MULTI PORT GAUGE TEST VALVE
- Y-PATTERN STRAINER
- HORN
- ADDRESSABLE INTERFACE MODULE

REFERENCES:

	TITLE	MPL NO.	DWG NO.
1.	TURBINE BUILDING-FIRE PROTECTION SYSTEM-P&ID	2U43-1010	H-21016
2.	TURBINE BUILDING-FIRE PROTECTION SYSTEM -P&ID SHT. 4 OF 5	2U43-1010	H-21201
3.	FIRE PROTECTION -FCD, 2U43112W02		B-24703
4.	SYSTEM NO. 19 (2U43112W02) TURBINE BUILDING. CONDENSERS-WEST END AREA (EL. 112'-0")		SX-26304
5.	FIRE PROT. PREACTION TYPE AUTO SPR. SYS.- DOMESTIC DWG. TAKES PRECEDENCE OVER VENDOR DWG.		H-26374
			SX-26306
6.	SYSTEM NO. 20 (2U43130W04) TURBINE BLDG. CONDENSERS-WEST END AREA (EL. 146'-3")		SX-26305
			SX-26306
7.	FIRE PROTECTION - PIPING - HYDROGEN SEAL OIL UNIT		H-26374
8.	FIRE PROTECTION-FCD, 2U43130W04		B-24704

BOUNDARY DIAGRAM NO.:2X43-B01-02
FUNCTION(S) NO.: 2X43-04
2X43-06
PREPARED BY: M D STEPHENS
DATE: 2/6/98
REVIEWED BY: ALEX MORRISON
DATE: 7/13/98

BOUNDARY DIAGRAM NO.:2X43-B06-04
FUNCTION(S) NO.: 2X43-06
PREPARED BY: M D STEPHENS
DATE: 3/19/98
REVIEWED BY: ALEX MORRISON
DATE: 7/15/98

LICENSE RENEWAL DOCUMENT

MPL NO. 2U43-1010 | ACAD14 | HL21200

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
TURBINE BUILDING
FIRE PROTECTION SYSTEM P&ID SHT 3 OF 5

Revision: A	Date: 12-03-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-21200, REV.6; BY TRM.	

BY	CHK'D	APPR.
TRM	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-21200	A
DATE	SCALE None			