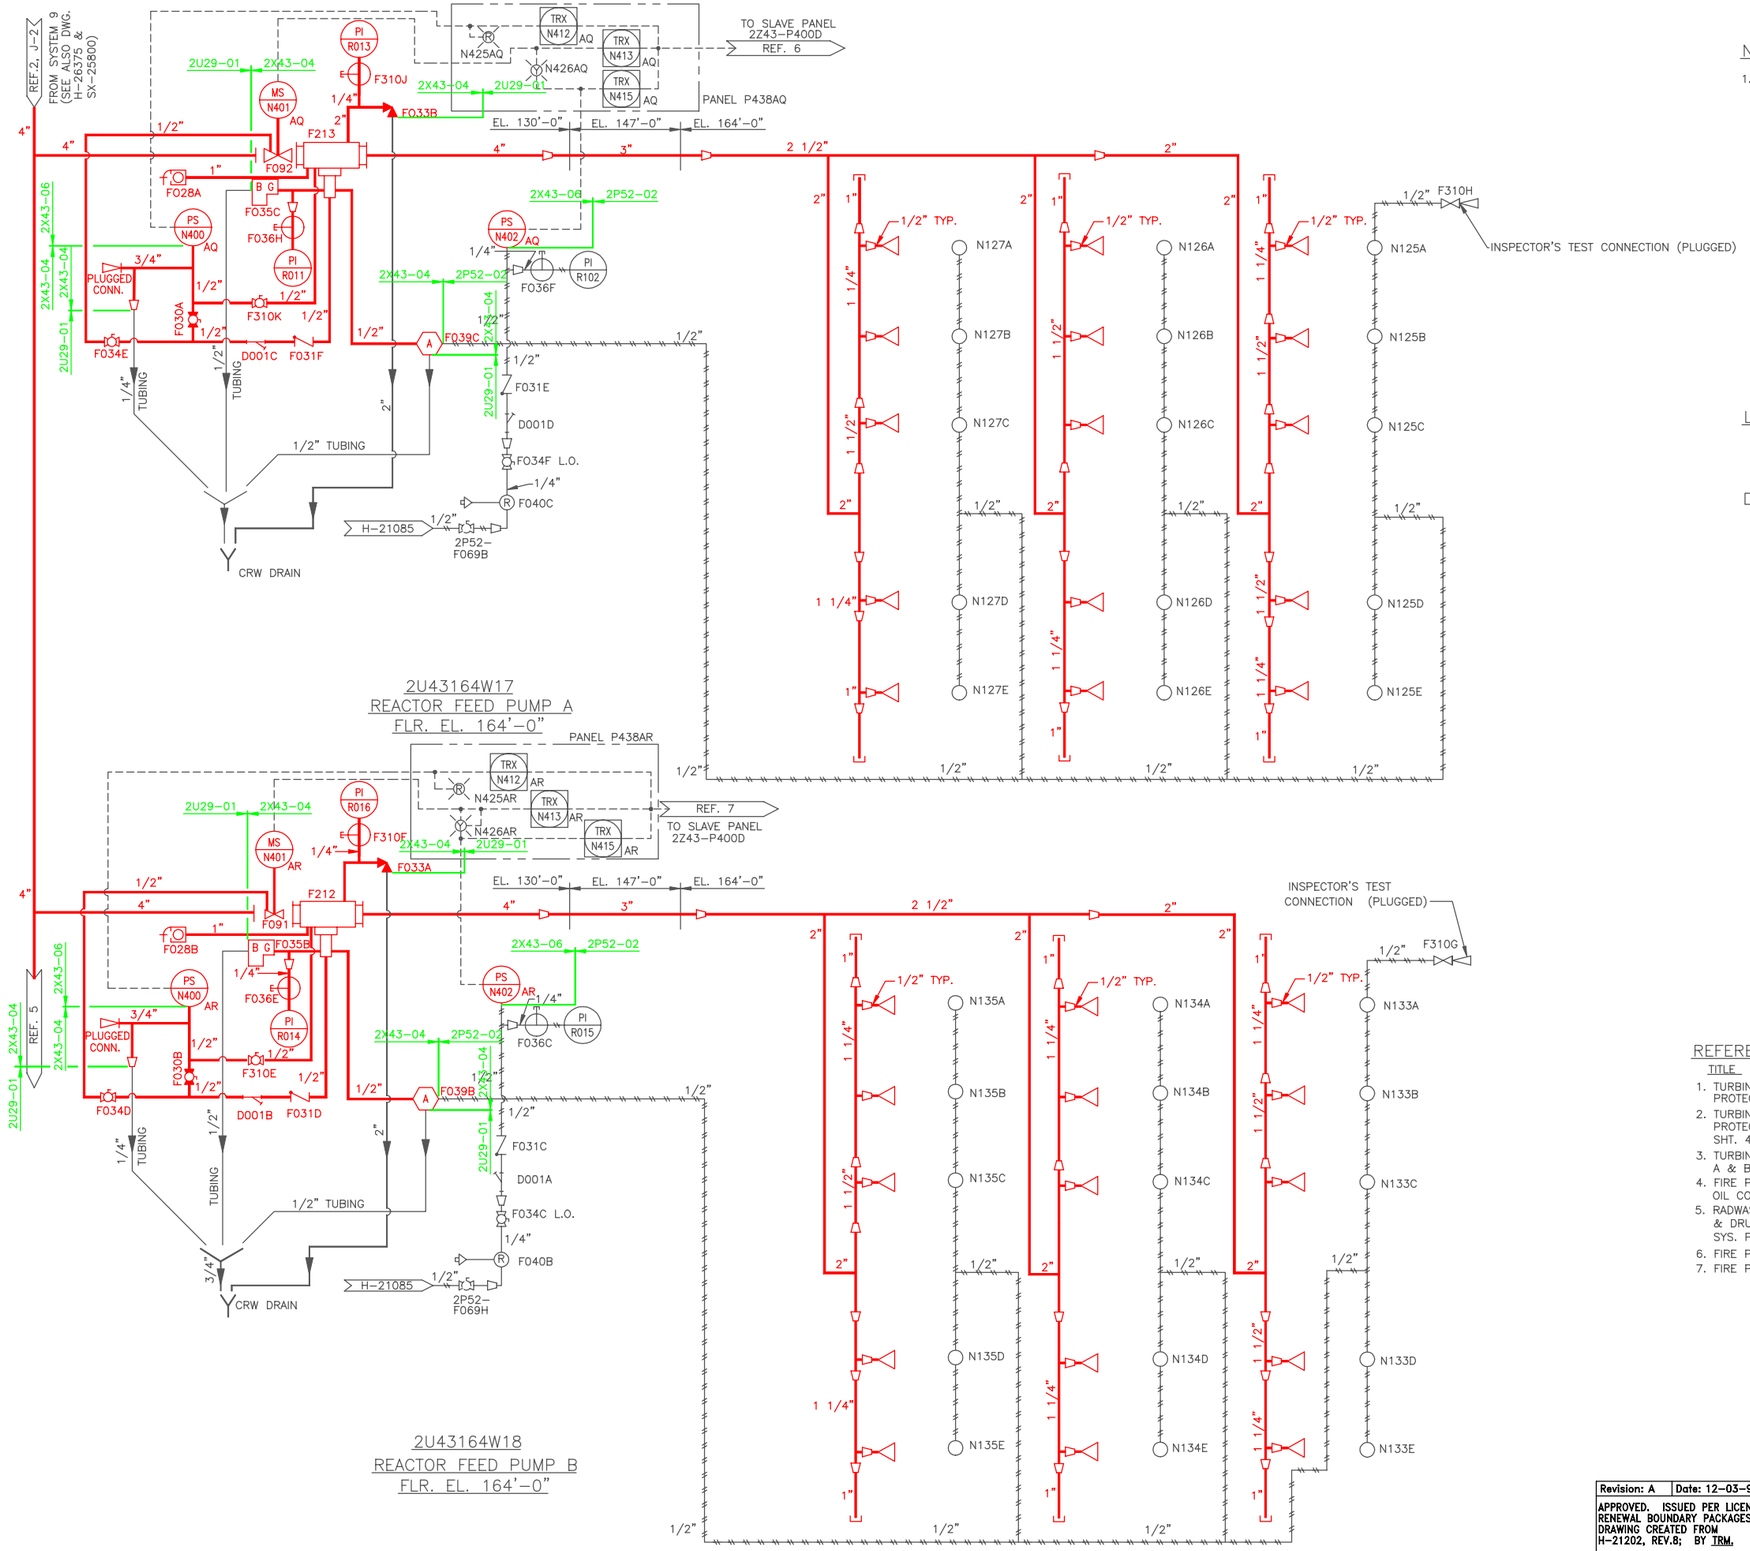

NOTES

1. ALL EQUIPMENT & INSTRUMENTS ARE PREFIXED WITH 2U43 UNLESS OTHERWISE NOTED.

BOUNDARY DIAGRAM NO.:2X43-B01-04
FUNCTION(S) NO.: 2X43-04
2X43-06
PREPARED BY: M D STEPHENS
DATE: 2/6/98
REVIEWED BY: ALEX MORRISON
DATE: 7/13/98

BOUNDARY DIAGRAM NO.:2X43-B06-06
FUNCTION(S) NO.: 2X43-06
PREPARED BY: M D STEPHENS
DATE: 3/19/98
REVIEWED BY: ALEX MORRISON
DATE: 7/15/98

LEGEND

- BALL DRIP VALVE
- MULTIMATIC VALVE
- BREAK GLASS STATION
- PILOT HEAD
- 1/2" SPRINKLER HEAD
- DRY PILOT ACTUATOR
- REGULATOR
- MONITOR SWITCH
- MULTIPORT GAUGE TEST VALVE
- ADDRESSABLE INTERFACE MODULE

REFERENCES

TITLE	MPL NO.	DWG. NO.
1. TURBINE BUILDING FIRE PROTECTION SYSTEM P&ID	2U43-1010	H-21016
2. TURBINE BUILDING FIRE PROTECTION SYSTEM P&ID SHT. 4 OF 5	2U43-1010	H-21201
3. TURBINE BLDG. R.F.P.T. A & B AREA EL. 164'.	SX-25800	
4. FIRE PROTECTION – PIPING OIL CONDITIONER AREA	H-26375	
5. RADWASTE BLDG. TRASH COMPACTOR & DRUM STORAGE AREA SPRINKLER SYS. P&ID.	H-26372	
6. FIRE PROTECTION FCD 2U43164W17	B-24657	
7. FIRE PROTECTION FCD 2U43164W18	B-24658	

LICENSE RENEWAL DOCUMENT

MPL NO. 2U43-1010 | ACAD14 | HL21202

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No. 2
TURBINE BUILDING
FIRE PROTECTION SYSTEM P&ID SHT. 5 OF 5

Revision: A	Date: 12-03-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-21202, REV.8; BY TRM.	

BY	CHK'D	APPR.
TRM	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-21202	A
DATE	SCALE None			