HL-26016

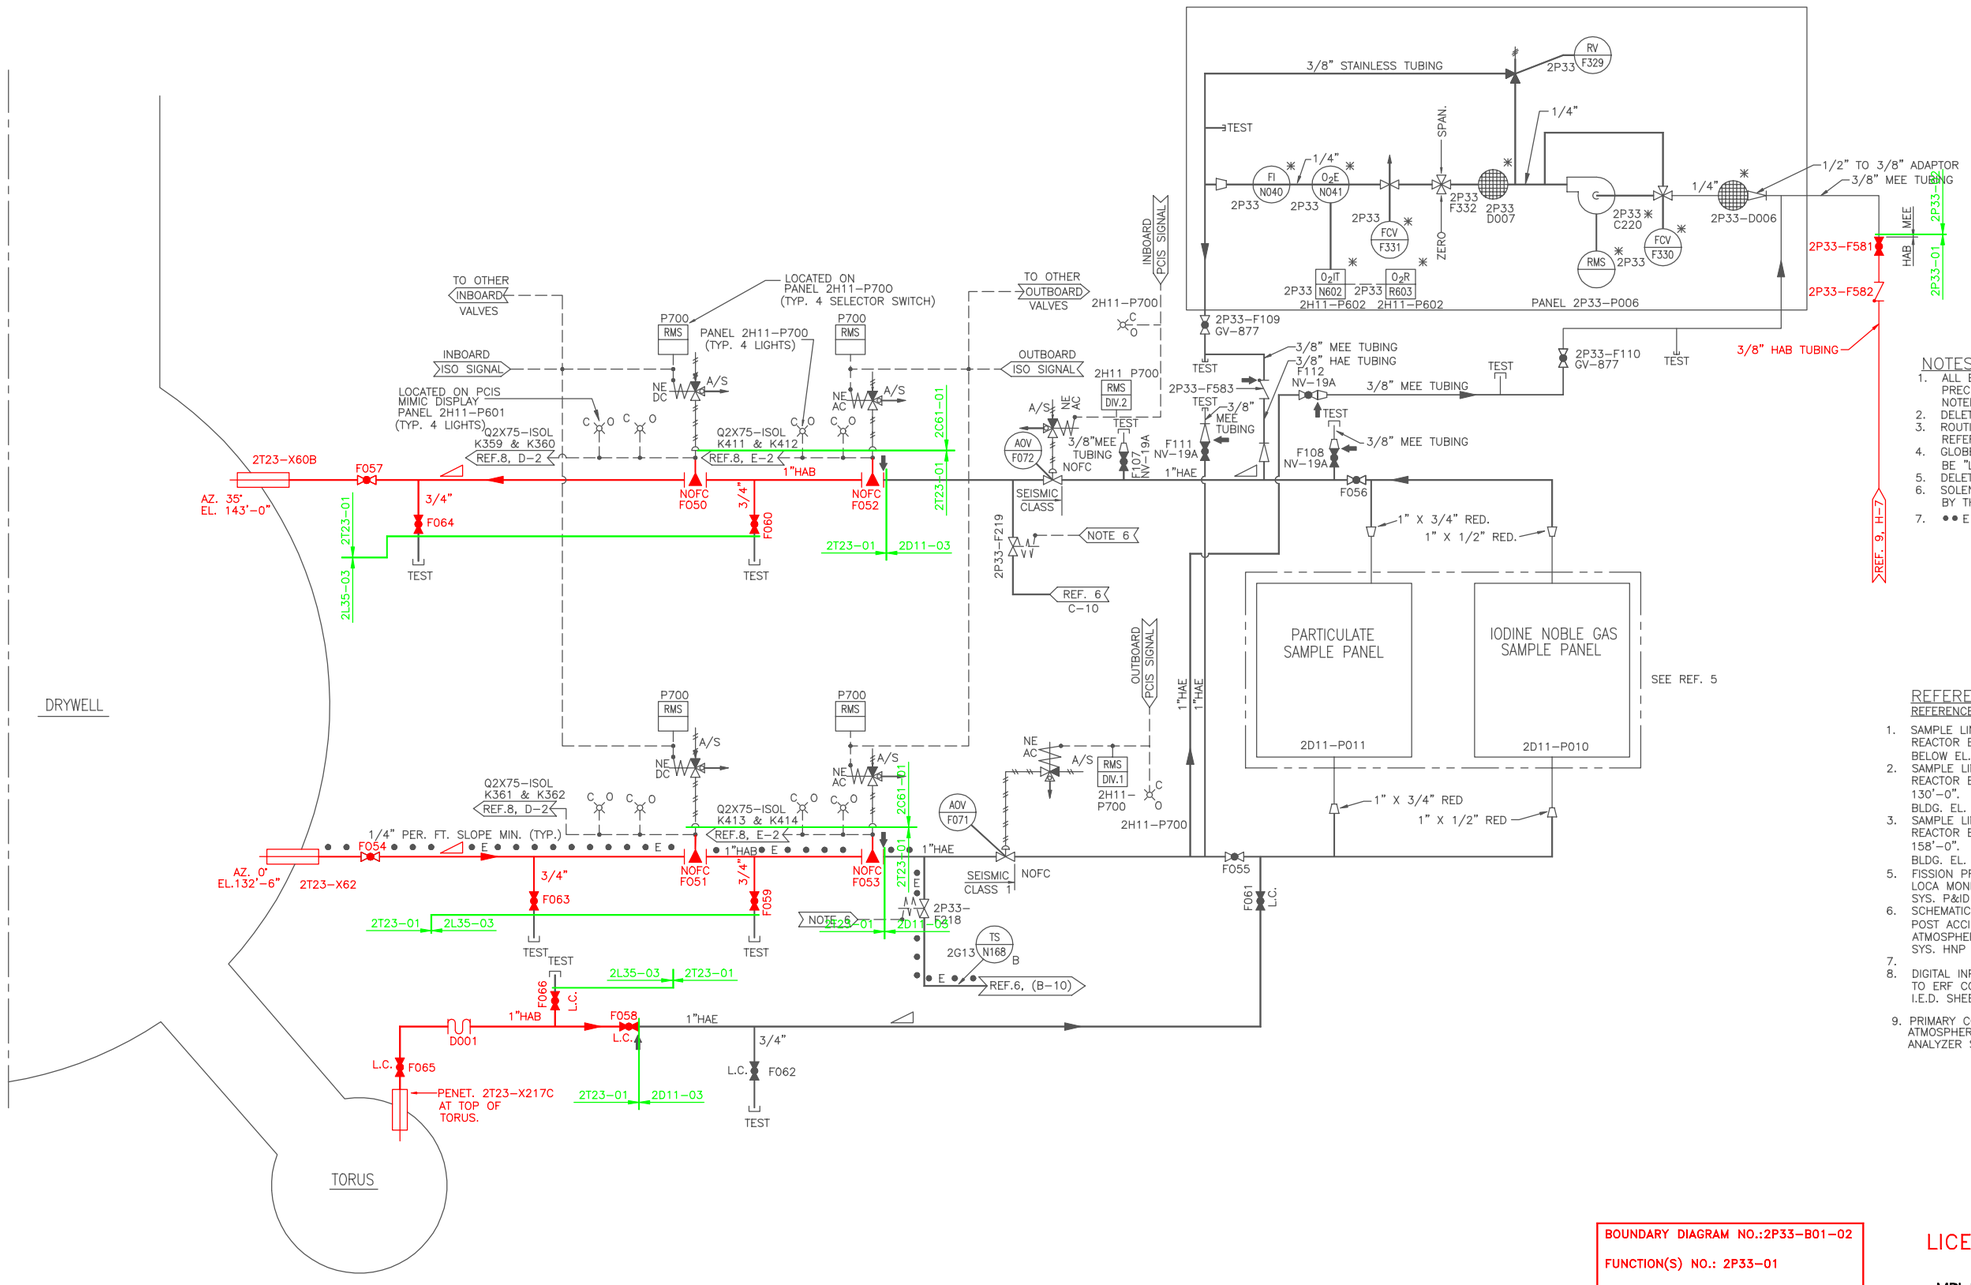


## NOTES

1. ALL EQUIPMENT & INSTRUMENT NUMBERS ARE TO BE PRECEDED BY MPL 2D11 UNLESS OTHERWISE NOTED. EXAMPLE, 2D11-AO F001.
2. DELETED
3. ROUTINGS OF SAMPLE LINES IS AS SHOWN ON REFERENCES 1, 2 & 3.
4. GLOBE VALVES F058, F061, F062, F065 & F066 SHALL BE "LOCKED" CLOSED.
5. DELETED
6. SOLENOID VALVES ARE AUTOMATICALLY CONTROLLED BY THE COMPUTER.
7. ●● E ●● DENOTES ELECTRICAL HEAT TRACING.

## REFERENCES

| | REFERENCE | MPL. NO. | SS. NO. |
|---|---|---|---|
| 1. | SAMPLE LINE ROUTINGS REACTOR BLDG. BELOW EL. 130'-0" | | H-26392 |
| 2. | SAMPLE LINE ROUTINGS REACTOR BLDG. EL. 130'-0". RADWASTE BLDG. EL. 132'-4" | | H-26394 |
| 3. | SAMPLE LINE ROUTINGS. REACTOR BLDG. EL. 158'-0". RADWASTE BLDG. EL. 164'-0". | | H-26396 |
| 5. | FISSION PRODUCTS/POST-LOCA MONITORING SYS. P&ID | 2D11-1010 | H-26017 |
| 6. | SCHEMATIC DIAGRAM FOR POST ACCIDENT R/C & CONT. ATMOSPHERE SAMPLING SYS. HNP 1 & 2 | 2P33-1010 | H-26384 |
| 7. | | | |
| 8. | DIGITAL INPUT SIGNALS TO ERF COMPUTER SYS. I.E.D. SHEET 2 OF 15 | 2X75-1010 | H-26164 |
| 9. | PRIMARY CONTAINMENT ATMOSPHERE $H_2$ & $O_2$ ANALYZER SYSTEM P&ID, SH.1 | | H-26048 |

BOUNDARY DIAGRAM NO.:2P33-B01-02
FUNCTION(S) NO.: 2P33-01
PREPARED BY: Alex Morrison
DATE: 03/09/98
REVIEWED BY: Ed Davidson
DATE: 05/27/98

BOUNDARY DIAGRAM NO.:2T23-B01-009
FUNCTION(S) NO.: 2T23-01
PREPARED BY: Farook Chandiwala
DATE: 10/20/98
REVIEWED BY: Larry Orr
DATE: 12/09/98

LICENSE RENEWAL DOCUMENT

MPL NO. 2D11-1010 | ACAD14 | HL26016

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
FISSION PRODUCTS MONITORING SYSTEM P.&I.D.

| Revision: A | Date: 1-5-2000 |
|---|---|
| APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-26016, REV 14; BY BKN. | |

| BY | CHK'D | APPR.1 |
|---|---|---|
| BKN | ED | ASK |

| DRAWN | DESIGNED | LOCATION | DOCUMENT NUMBER | REVISION |
|---|---|---|---|---|
| BKN | LCF | 10-502 | HL-26016 | A |
| DATE | SCALE None | | | |