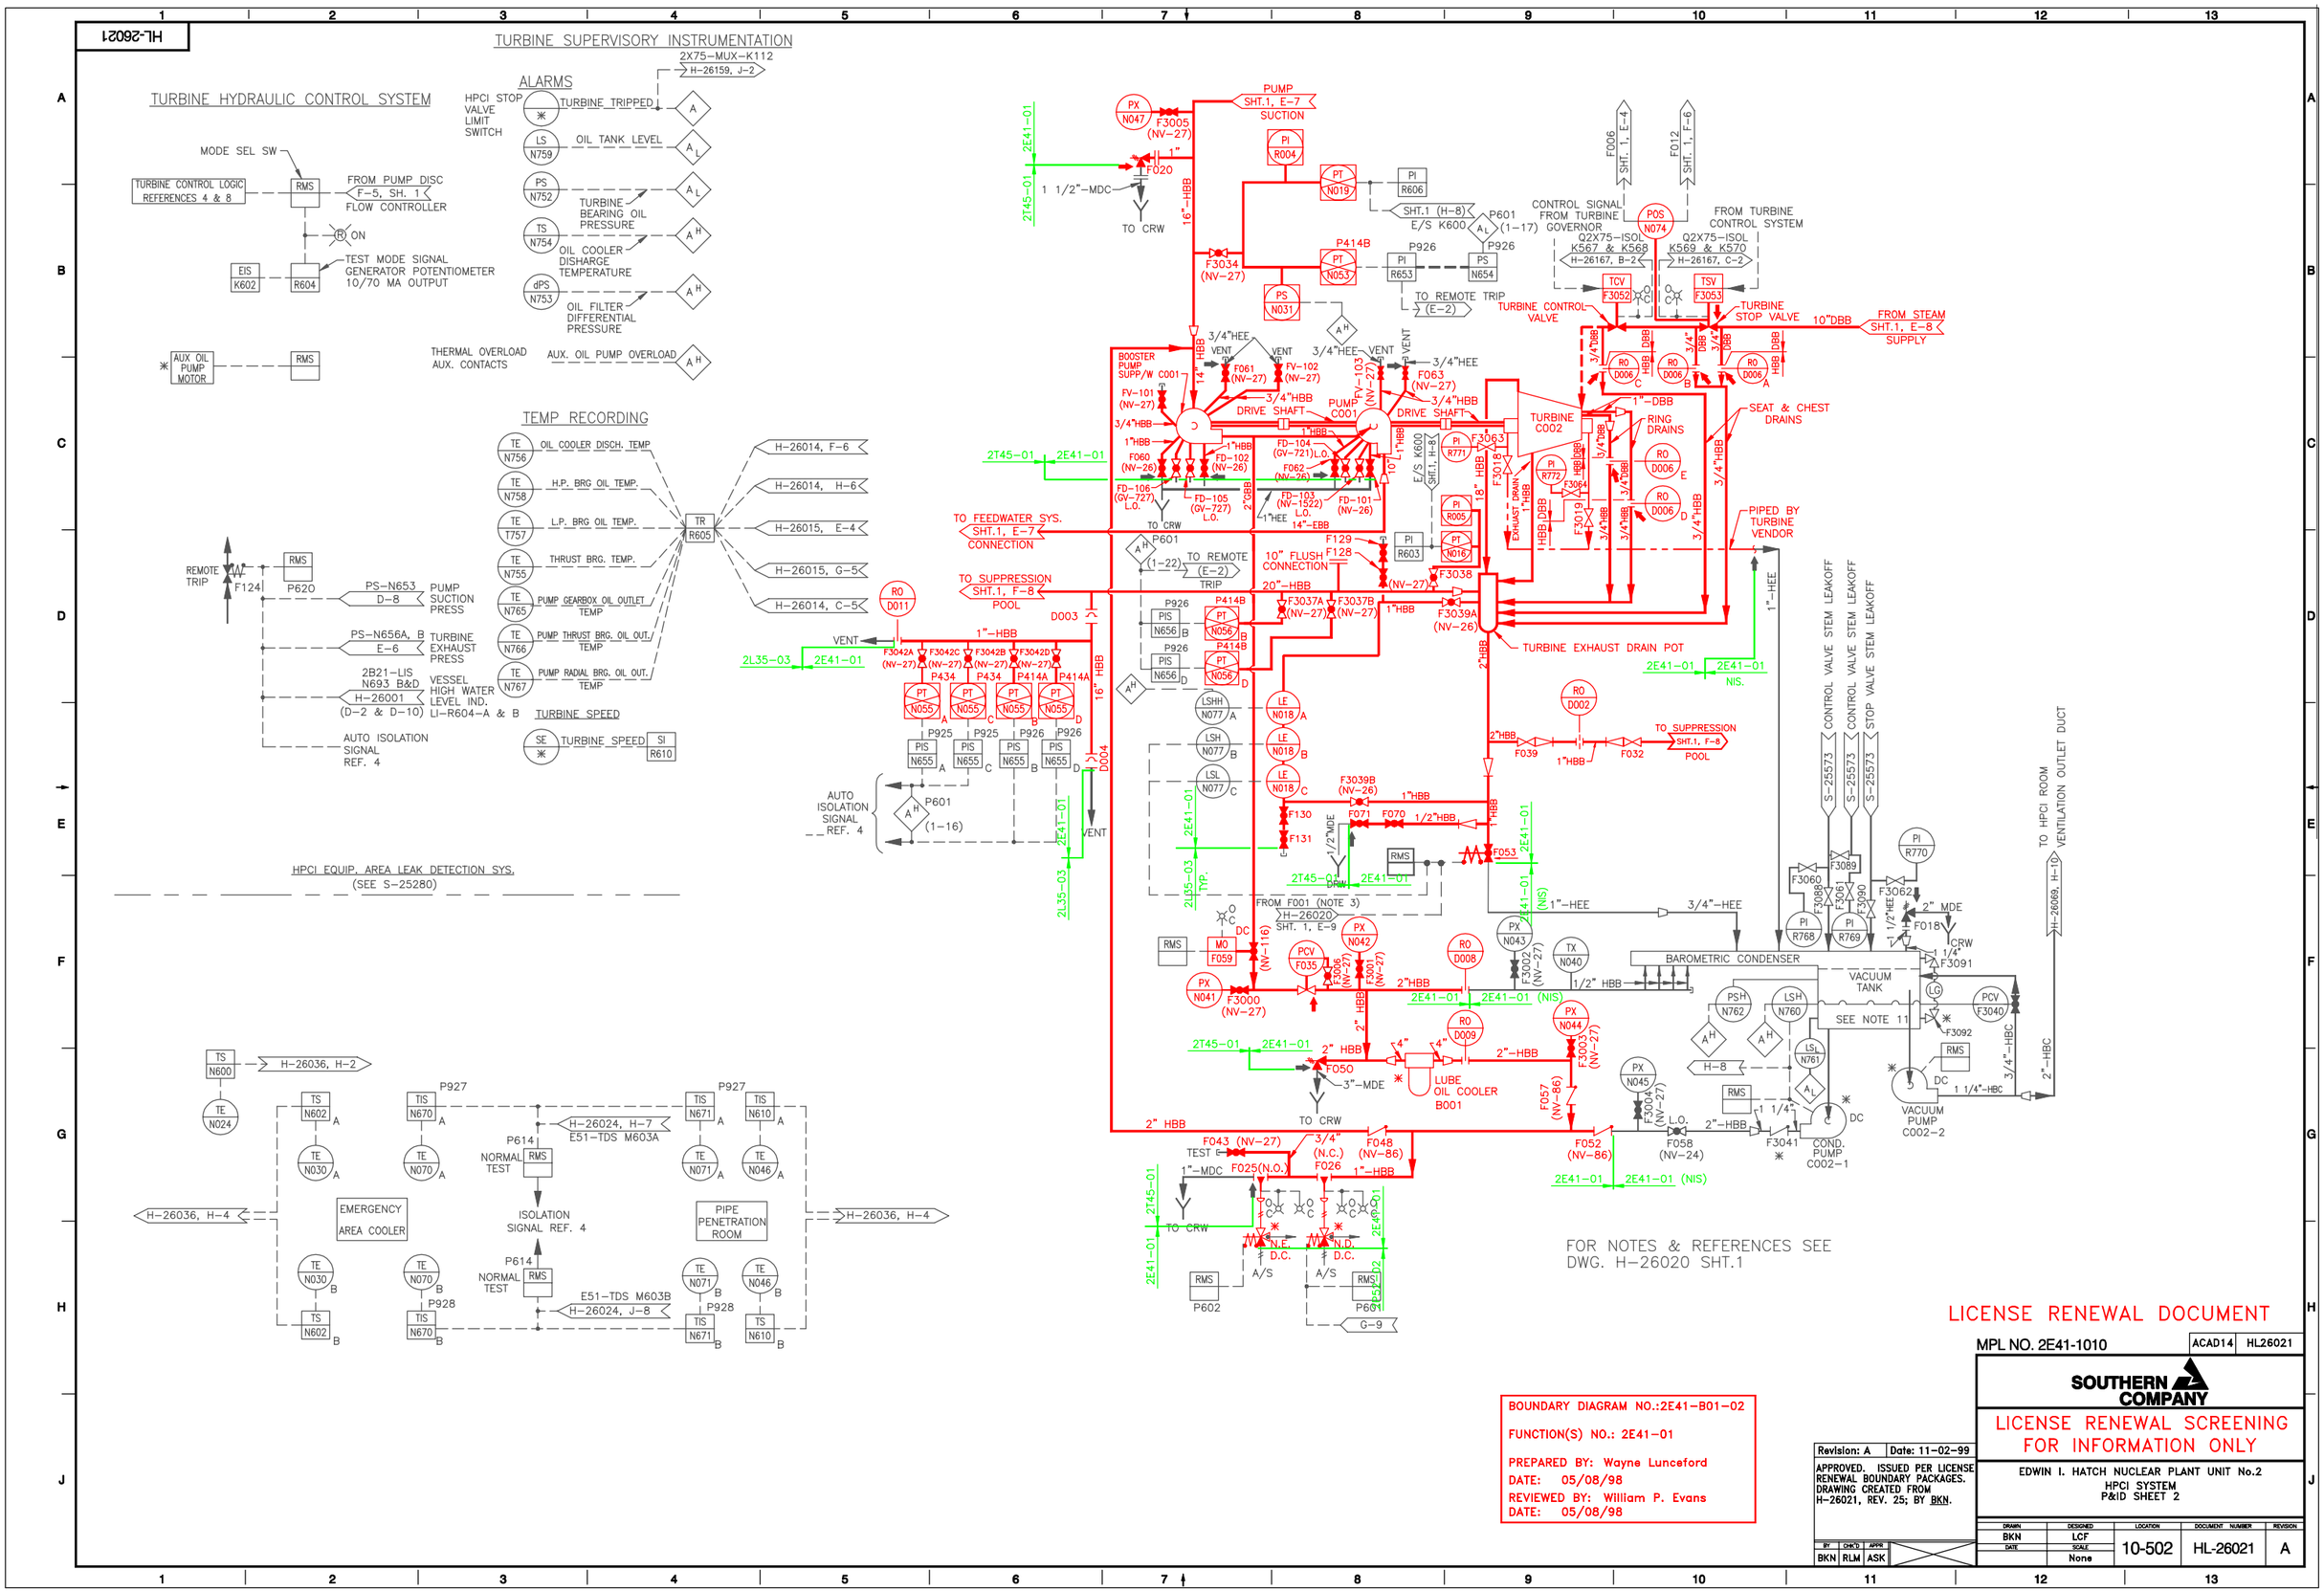
HL-26021
TURBINE SUPERVISORY INSTRUMENTATION
TURBINE HYDRAULIC CONTROL SYSTEM
ALARMS
TEMP RECORDING
TURBINE SPEED
HPCI EQUIP. AREA LEAK DETECTION SYS.
(SEE S-25280)
EMERGENCY AREA COOLER
PIPE PENETRATION ROOM
BAROMETRIC CONDENSER
VACUUM TANK
SEE NOTE 11
TURBINE EXHAUST DRAIN POT
TURBINE CONTROL VALVE
TURBINE STOP VALVE
FROM STEAM SHT.1, E-8 SUPPLY
TO FEEDWATER SYS. SHT.1, E-7 CONNECTION
TO SUPPRESSION SHT.1, F-8 POOL
TO HPCI ROOM VENTILATION OUTLET DUCT
FOR NOTES & REFERENCES SEE DWG. H-26020 SHT.1
LICENSE RENEWAL DOCUMENT
MPL NO. 2E41-1010
ACAD14 HL26021
SOUTHERN COMPANY
LICENSE RENEWAL SCREENING FOR INFORMATION ONLY
EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
HPCI SYSTEM
P&ID SHEET 2
BOUNDARY DIAGRAM NO.:2E41-B01-02
FUNCTION(S) NO.: 2E41-01
PREPARED BY: Wayne Lunceford
DATE: 05/08/98
REVIEWED BY: William P. Evans
DATE: 05/08/98
Revision: A Date: 11-02-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-26021, REV. 25; BY BKN.
BKN RLM ASK
BKN LCF 10-502 HL-26021 A
None