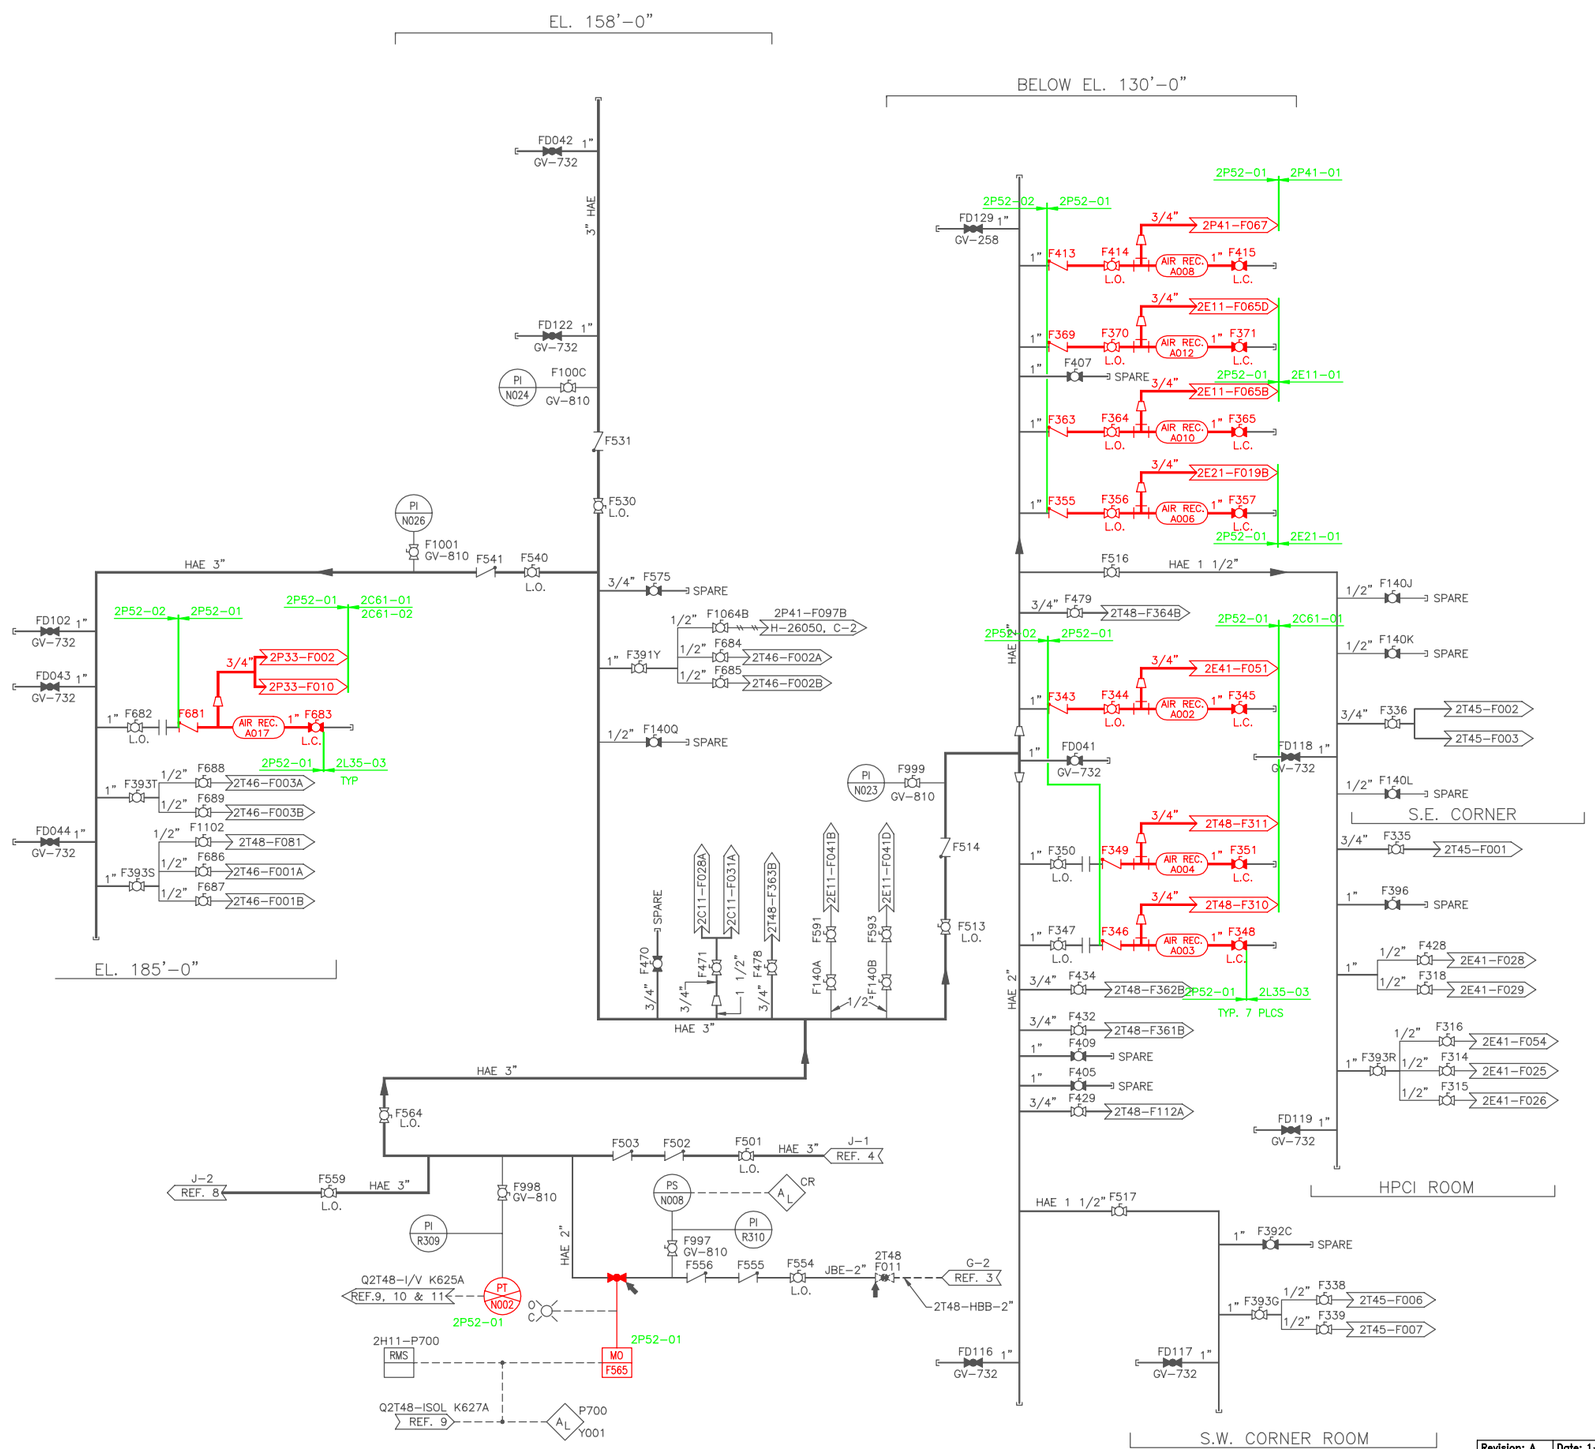

NOTES:

1. FOR NOTES AND REFERENCES SEE DWG. H-26060.
2. ALL PIPING ON THIS DWG. IS SEISMIC CLASS I NON-INTERRUPTABLE AIR.

BOUNDARY DIAGRAM NO.:2P52-B01-01

FUNCTION(S) NO.: 2P52-01

PREPARED BY: WILLIAM P EVANS
DATE: 5/4/98
REVIEWED BY: M D STEPHENS
DATE: 5/5/98

LICENSE RENEWAL DOCUMENT

MPL NO. 2P52 | ACAD14 | HL26064

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
REACTOR BUILDING SOUTH SIDE
NON-INTERRUPTABLE INST. P&ID SH.4

Revision: A | Date: 1-4-2000

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-26064, REV.15; BY TRM.

BY	CHK'D	APPR
TRM	ED	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-26064	A
DATE	SCALE: None			

HL-26064