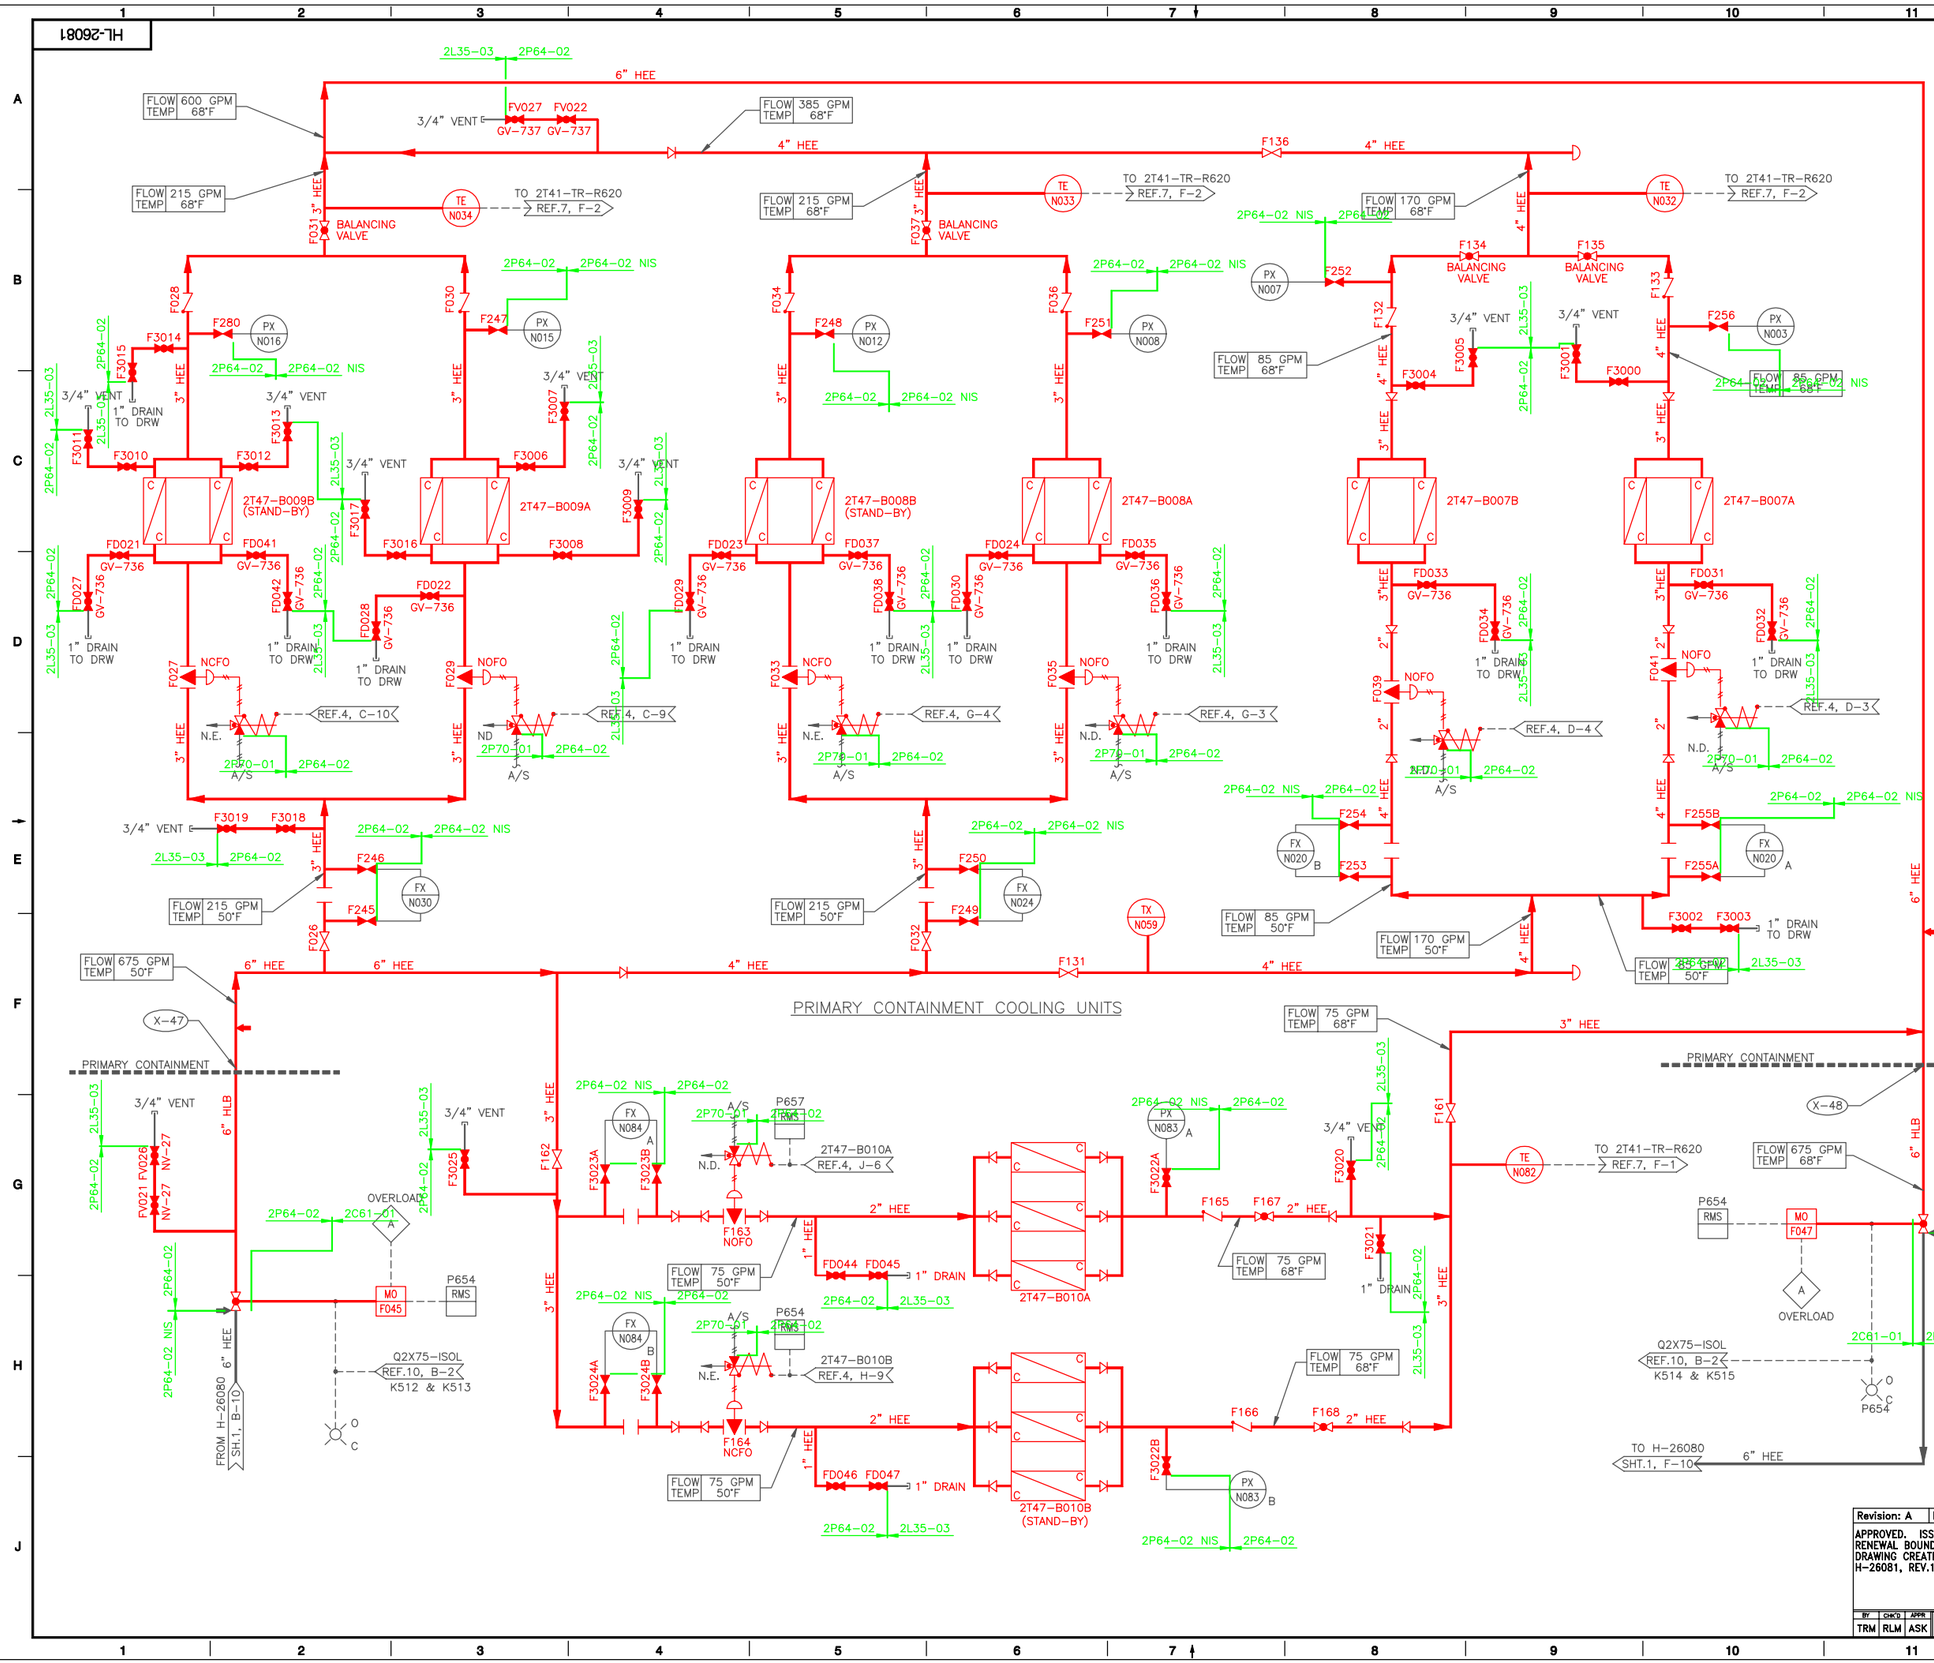

NOTE:
FOR NOTES REFER TO SHT. 1, DRAWING H-26080.

REFERENCES:

REFERENCES	MPL NO.	S.S.NO.
1. PIPING AND INSTRUMENT SYMBOLS	A42-1010	S-15051
2. REACTOR BLDG. SERVICE WATER SYS. P&ID SHT.1	2P41-1010	H-26050
3. REACTOR BLDG. VENTILATION SYS. P&ID	2T41-1010	H-26067
4. PRIMARY CONTAINMENT COOLING SYS. P&ID & P.F.D.	2T47-1010	H-26074
5. REACTOR BLDG. DEMINERALIZED WATER SYS. P&ID	2P21-1010	H-26047
6. PRIMARY CONTAINMENT CHILLED WATER SYS. P&ID & P.F.D. SHT.1	2P64-1010	H-26080
7. SAFEGUARD EQUIPMENT EMERGENCY COOLING SYS. P&ID	2T41-1010	H-26071
8. REACTOR AND RADWASTE BLDG. CHILLED WATER SYS. P&ID & P.F.D. SH. 1	2P65-1010	H-26025
9. REACTOR AND RADWASTE BLDG. CHILLED WATER SYS. P&ID & P.F.D. SHT. 2	2P65-1020	H-26008
10. DIGITAL INPUT SIGNALS TO THE ERF COMPUTER SYS. I.E.D. SHT. 8 OF 15	2X75-1010	H-26177

BOUNDARY DIAGRAM NO.:2P64-B01-01
FUNCTION(S) NO.: 2P64-02
2C61-01
PREPARED BY: WAYNE LUNCEFORD
DATE: 8/31/98
REVIEWED BY: WILLIAM P EVANS
DATE: 10/15/98

LICENSE RENEWAL DOCUMENT

MPL NO. 2P64-1010 | ACAD14 | HL26081

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No. 2
PRIMARY CONTAINMENT
CHILLED WTR. SYS. P&ID & P.F.D. SHT. 2

Revision: A	Date: 12-31-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-26081, REV.17; BY TRM.

BY	CHK'D	APPR
TRM	RLM	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-26081	A
DATE	SCALE: None			