


A
B
C
D
E
F
G
H
J

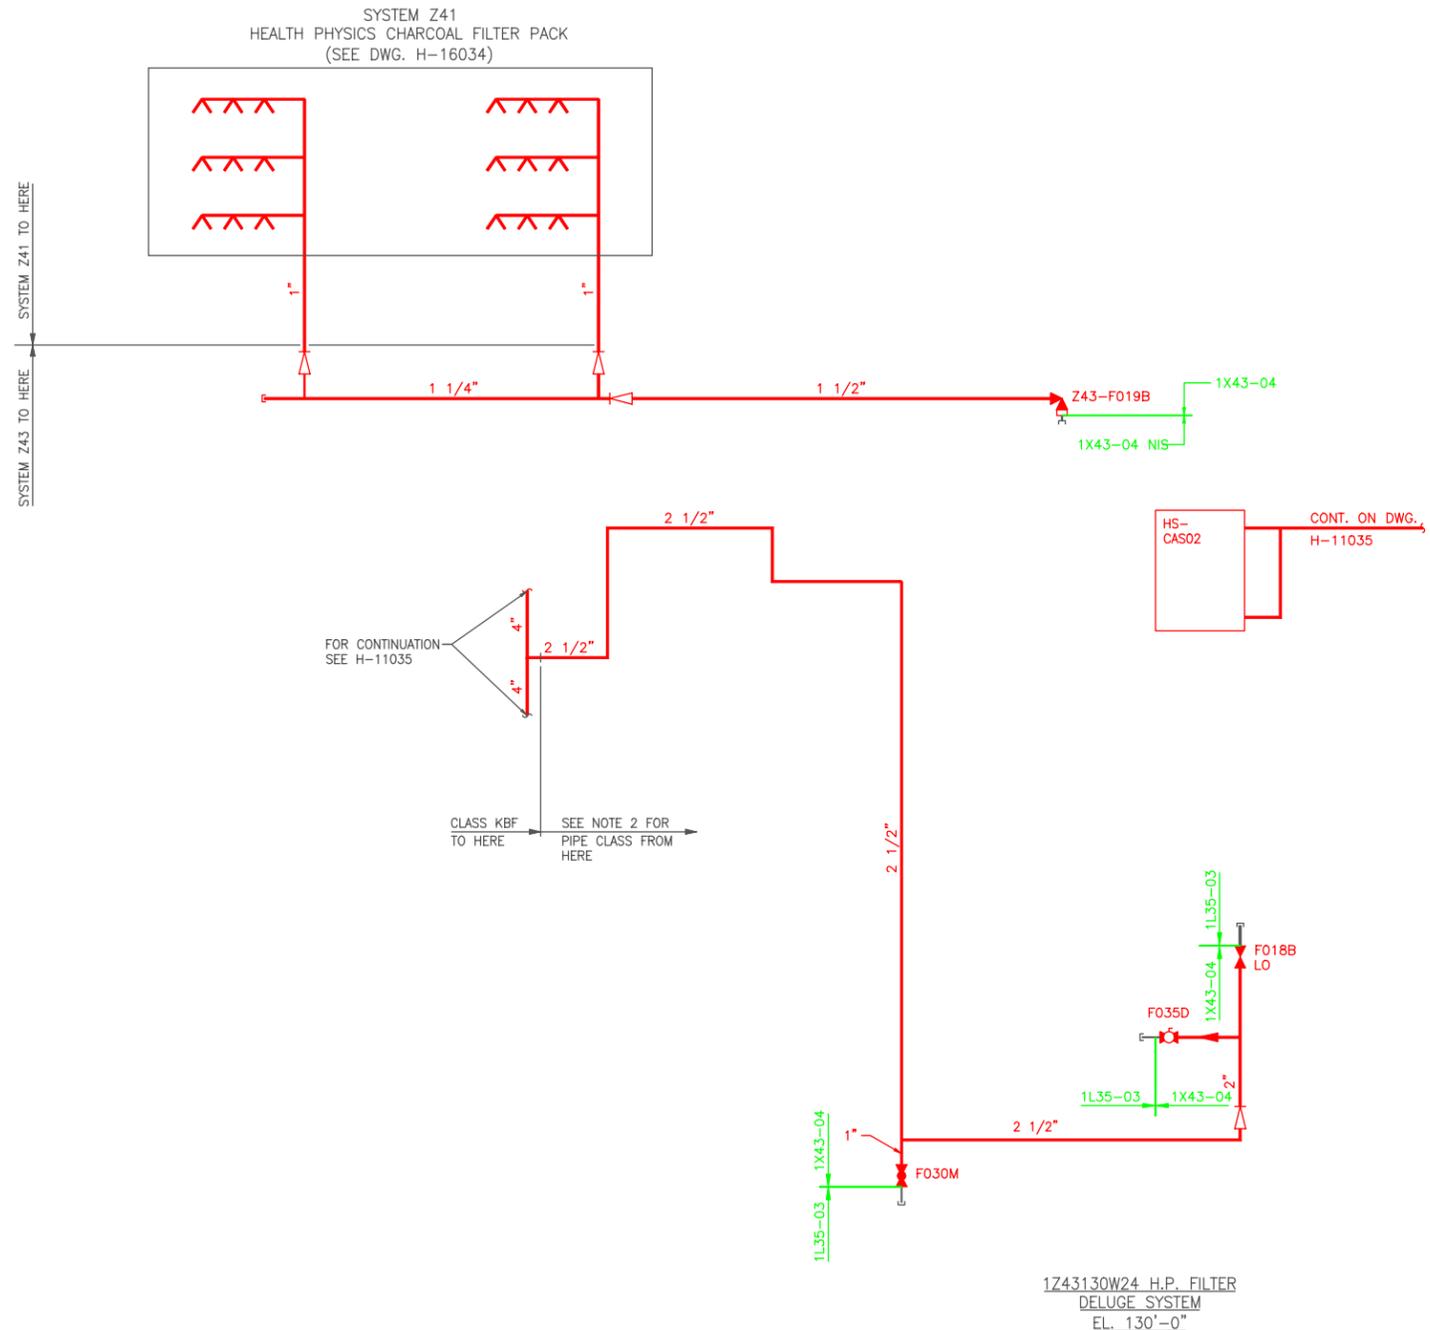

- LEGEND:**
- BALL VALVE (N.C.)
 - GLOBE VALVE (N.C.)
 - CAP
 - ANGLE VALVE WITH HOSE ADAPTER (N.C.)
 - REDUCER
 - O.S. & Y. VALVE (N.C.)

- NOTES:**
1. ALL MPL NO.S ON THIS DWG. PRECEDED BY Z43.
 2. ALL PIPE AND FITTING MATERIALS TO BE PER INQUIRY SS-6914-28.

- REFERENCES:**
- H-11035 FIRE PROTECTION-PIPING-P&ID TURBINE & CONTROL BLDGS
 - H-11031 UNIT 1-FIRE PROTECTION & DETECTION SYSTEMS ANNUNCIATION LIST
 - SX-14522 INSTRUCTION-FIRE PROTECTION SPRINKLER SYSTEM
 - S-50637 2 1/2" SUPPLY FOR CHARCOAL FILTERS CONTROL BLDG. HVAC ROOM ELV. 130'
 - H-40050 HVAC NOTES AND SYMBOLS
 - H-16034 CONTROL BUILDING RADIOCHEM HVAC.

BOUNDARY DIAGRAM NO.: 1X43-B01-11
FUNCTION(S) NO.: 1X43-04
 PREPARED BY: M.D. STEPHENS
 DATE: 02-05-98
 REVIEWED BY: ALEX MORRISON
 DATE: 07-13-98

1743130W24 H.P. FILTER
 DELUGE SYSTEM
 EL. 130'-0"

CLASS KBF TO HERE SEE NOTE 2 FOR PIPE CLASS FROM HERE

FOR CONTINUATION SEE H-11035

CONT. ON DWG. H-11035

LICENSE RENEWAL DOCUMENT

MPL NO. Z43 ACAD14 HL40133

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

Revision: A Date: 12-29-99
 APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-40133, REV. 6; BY ECB

EDWIN I. HATCH NUCLEAR PLANT No.1
 FIRE PROTECTION - PIPING P&ID - HEALTH PHYSICS

BY	CHK'D	APPR	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF				
ECB	MDS	ASK	DATE	SCALE	
			None	10-502	HL-40133 A