HL-41508

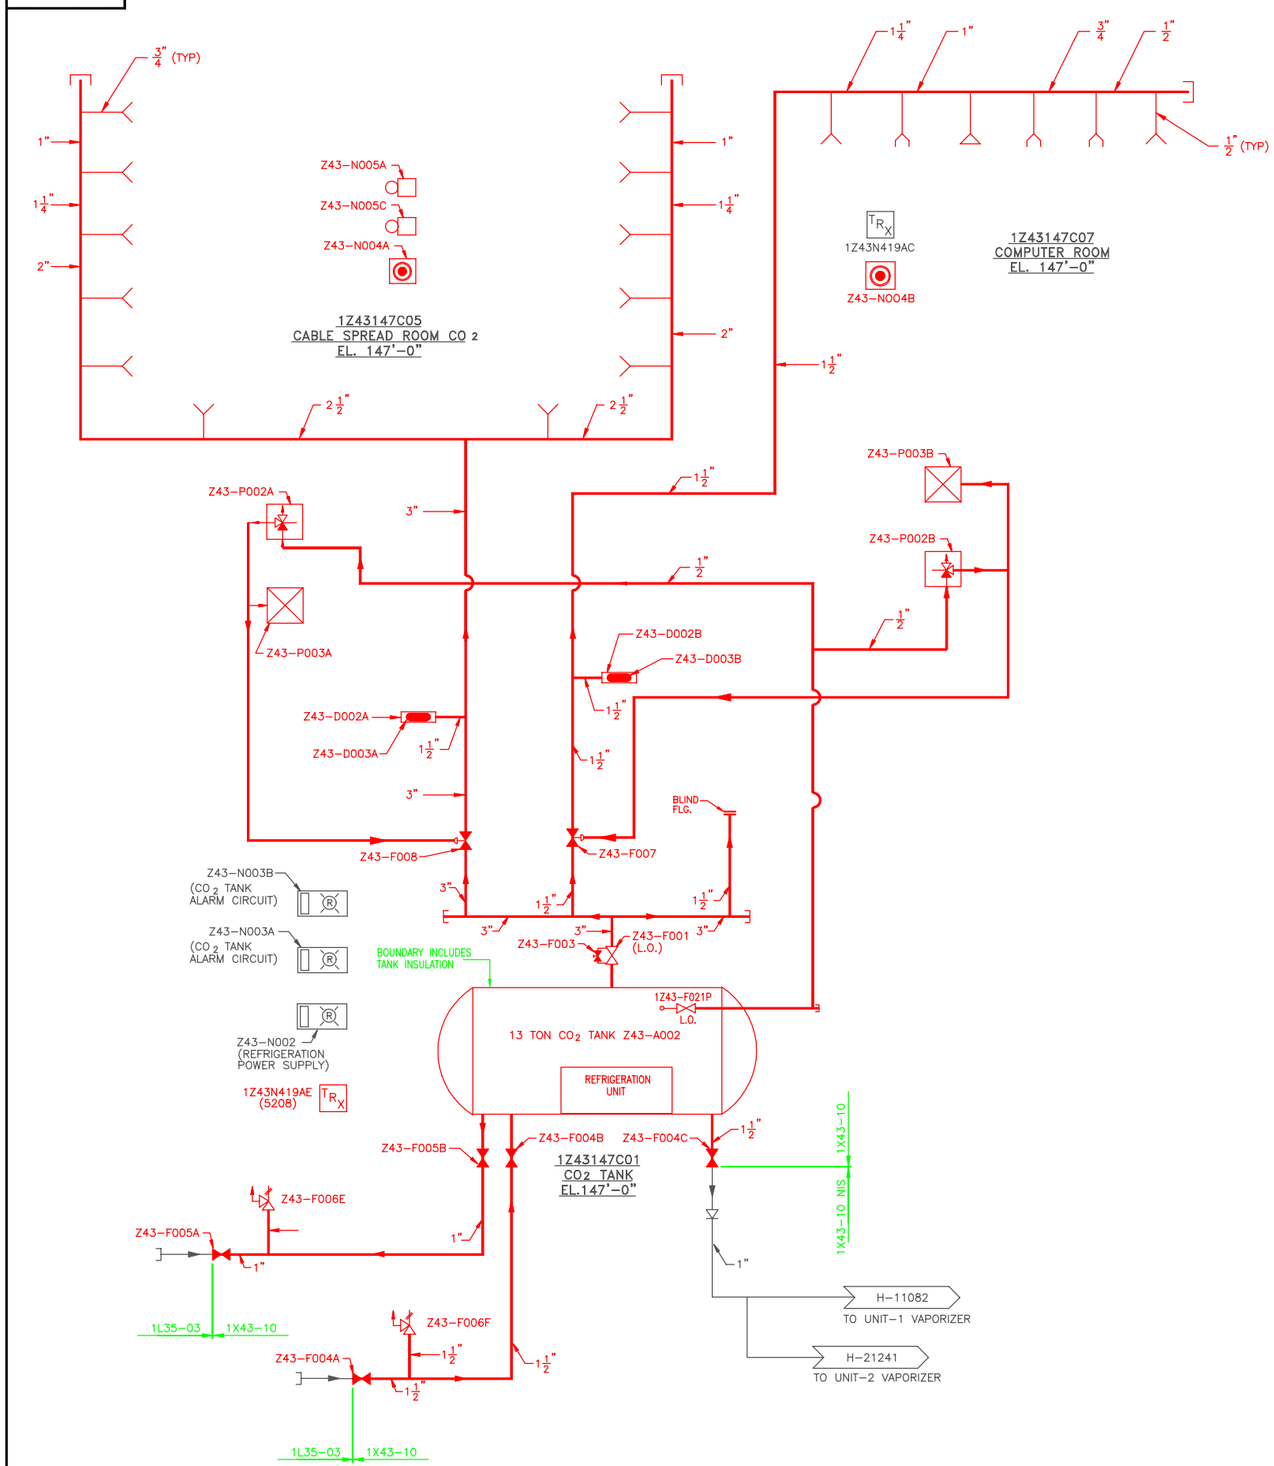

LEGEND

- ODORIZER CYLINDER W/CARTRIDGE
- PILOT CABINET
- CONTROL CABINET
- PUSHBUTTON STATION
- BELL
- REDUCER
- JET TIP NOZZLE
- WIDE ANGLE NOZZLE
- SAFETY SWITCH
- GATE VALVE
- CARDOX PRESSURE OPERATED GATE VALVE (N.C.)
- SAFETY VALVE
- PLUG
- CAP
- ADDRESSABLE INTERFACE MODULE

REFERENCES:

B-11983	FIRE PROTECTION FCD – 1Z43147C01
B-11988	FIRE PROTECTION FCD – 1Z43147C07
SX-11789	UNIT 1 & 2 VAPORIZER
SX-11785	CO_2 OPERATING & SERVICE MANUAL.
SX-11786	CO_2 SYSTEM DIAGRAM OF TURBINE AND CONTROL BUILDING.
SX-23016	GENERATOR PURGE CO_2 SYSTEM.
H-51551	

LICENSE RENEWAL DOCUMENT

BOUNDARY DIAGRAM NO.:1X43-B02-01

FUNCTION(S) NO.: 1X43-10

PREPARED BY: M D STEPHENS
DATE: 2/26/98
REVIEWED BY: ALEX MORRISON
DATE: 6/9/98

Revision: A	Date: 10-21-99

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-41508, REV.7; BY TRM.

BY	CHK'D	APPR.1
TRM	MDS	ASK

MPL NO. 1U43 & 1Z43

ACAD14	HL41508

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
TURBINE & CONTROL BUILDING – FIRE PROTECTION PIPING – CO_2 SYSTEM P&ID

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-41508	A
DATE	SCALE: None			