HL-44073

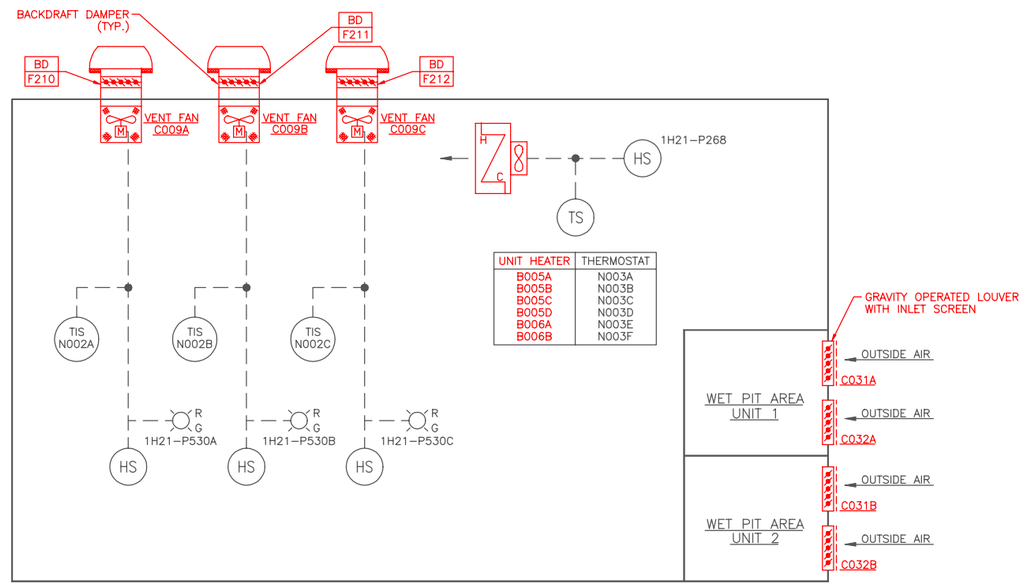

UNIT HEATER	THERMOSTAT
B005A	N003A
B005B	N003B
B005C	N003C
B005D	N003D
B006A	N003E
B006B	N003F

NOTE:

1. ALL EQUIPMENT/INSTRUMENTS ARE PREFIXED WITH 1X41, UNLESS OTHERWISE SPECIFIED

REFERENCES:

H-12610.....RIVER INTAKE STRUCTURE ARCHITECTURAL
H-12613.....RIVER INTAKE STRUCTURE PUMP ROOM - HEATING AND VENTILATION
H-13610.....ELEMENTARY DIAGRAM

LICENSE RENEWAL DOCUMENT

BOUNDARY DIAGRAM NO.:1X41-B01-01

FUNCTION(S) NO.: 1X41-01

PREPARED BY: ED DAVIDSON
DATE: 2/2/98
REVIEWED BY: BO ROSBERG
DATE: 2/19/98

Revision: A | Date: 1-4-2000

APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-44073, REV.0; BY TRM.

BY	CHK'D	APPR.1
TRM	ED	ASK

ACAD14 | HL44073

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.
RIVER INTAKE STRUCTURE
HVAC P&ID

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF	10-502	HL-44073	A
DATE	SCALE			
	None			