FOR INFORMATION ONLY

P1D- 1-DG-D20467

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS REFER TO DRAWINGS P&ID-LEGEND 1 AND P&ID LEGEND 2.

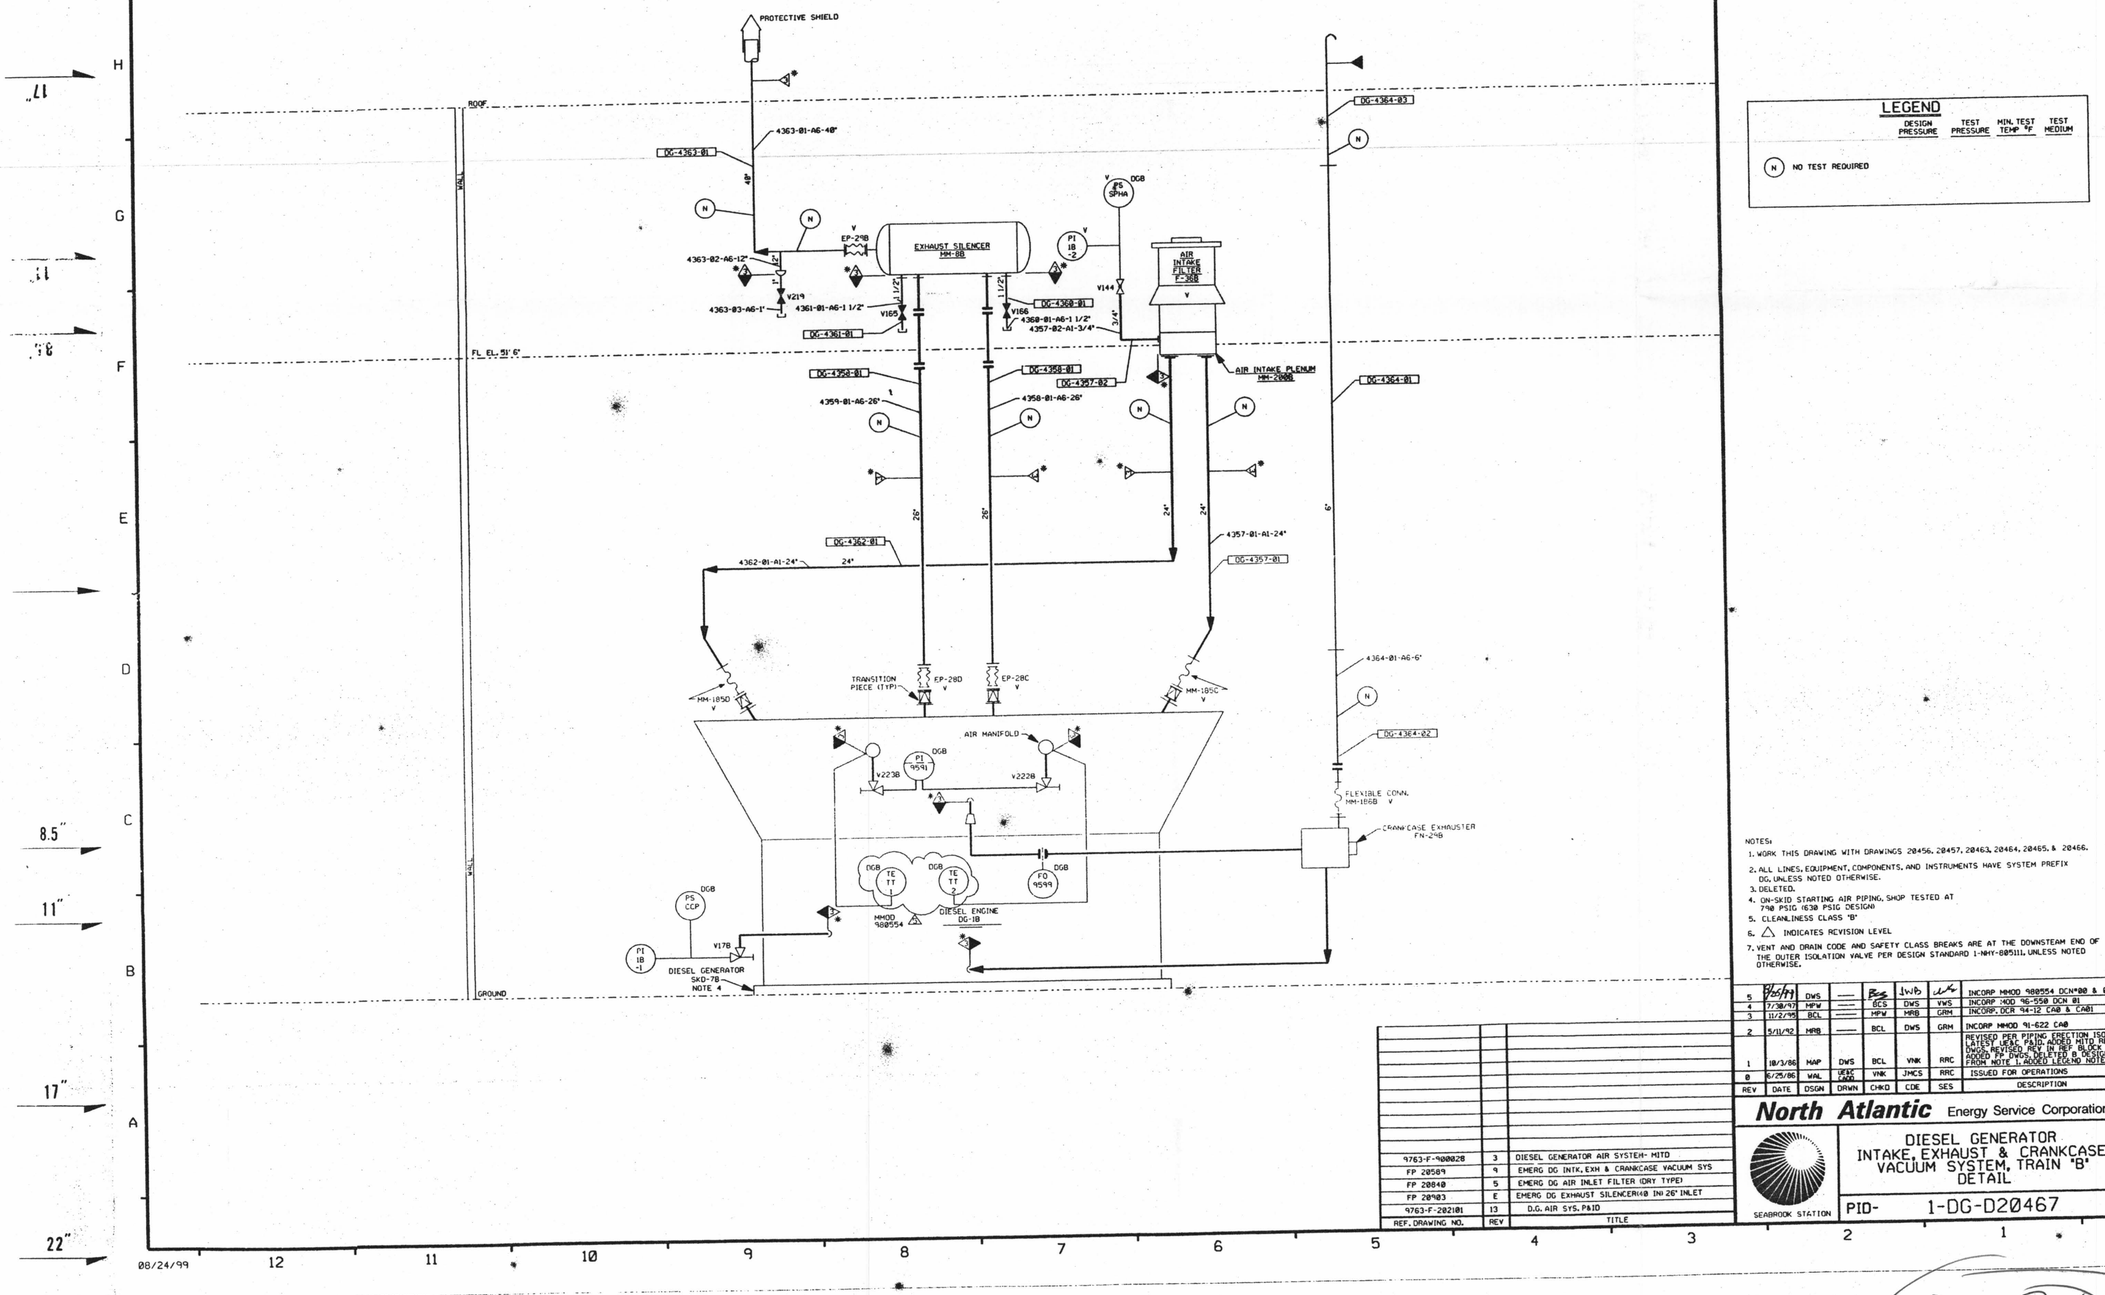

LEGEND

	DESIGN PRESSURE	TEST PRESSURE	MIN. TEST TEMP °F	TEST MEDIUM
(N) NO TEST REQUIRED				

NOTES:
1. WORK THIS DRAWING WITH DRAWINGS 20456, 20457, 20463, 20464, 20465, & 20466.
2. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS HAVE SYSTEM PREFIX DG, UNLESS NOTED OTHERWISE.
3. DELETED.
4. ON-SKID STARTING AIR PIPING, SHOP TESTED AT 790 PSIG (630 PSIG DESIGN)
5. CLEANLINESS CLASS "B"
6. △ INDICATES REVISION LEVEL
7. VENT AND DRAIN CODE AND SAFETY CLASS BREAKS ARE AT THE DOWNSTEAM END OF THE OUTER ISOLATION VALVE PER DESIGN STANDARD 1-NHY-805111, UNLESS NOTED OTHERWISE.

REF. DRAWING NO.	REV	TITLE
9763-F-900028	3	DIESEL GENERATOR AIR SYSTEM- MITD
FP 20589	9	EMERG DG INTK, EXH & CRANKCASE VACUUM SYS
FP 20840	5	EMERG DG AIR INLET FILTER (DRY TYPE)
FP 20903	E	EMERG DG EXHAUST SILENCER(4@ IN 26' INLET
9763-F-282101	13	D.G. AIR SYS. P&ID

REV	DATE	DSGN	DRWN	CHKD	CDE	SES	DESCRIPTION
5	8/25/99	DWS	——	BCS	DWS	VWS	INCORP MMOD 980554 DCN#00 & 01
4	7/30/97	MPW	——	BCS	DWS	VWS	INCORP MOD 96-550 DCN 01
3	11/2/95	BCL	——	MPW	MRB	GRM	INCORP. DCR 94-12 CA0 & CA01
2	5/11/92	MRB	——	BCL	DWS	GRM	INCORP MMOD 91-622 CA0
1	10/3/86	MAP	DWS	BCL	VNK	RRC	REVISED PER PIPING ERECTION ISO'S & LATEST ISSUE P&ID ADDED MITD REF. DWGS. REVISED REV IN REF. BLOCK AND ADDED FP DWGS. DELETED A DESIGN FROM NOTE 1, ADDED LEGEND NOTE.
0	6/25/86	WAL	DESC CAD	VNK	JMCS	RRC	ISSUED FOR OPERATIONS

North Atlantic Energy Service Corporation

SEABROOK STATION

DIESEL GENERATOR INTAKE, EXHAUST & CRANKCASE VACUUM SYSTEM, TRAIN "B" DETAIL

PID- 1-DG-D20467

08/24/99

D-30