NOTES:
1. FOR GENERAL CONCRETE NOTES SEE DWG. 4226.

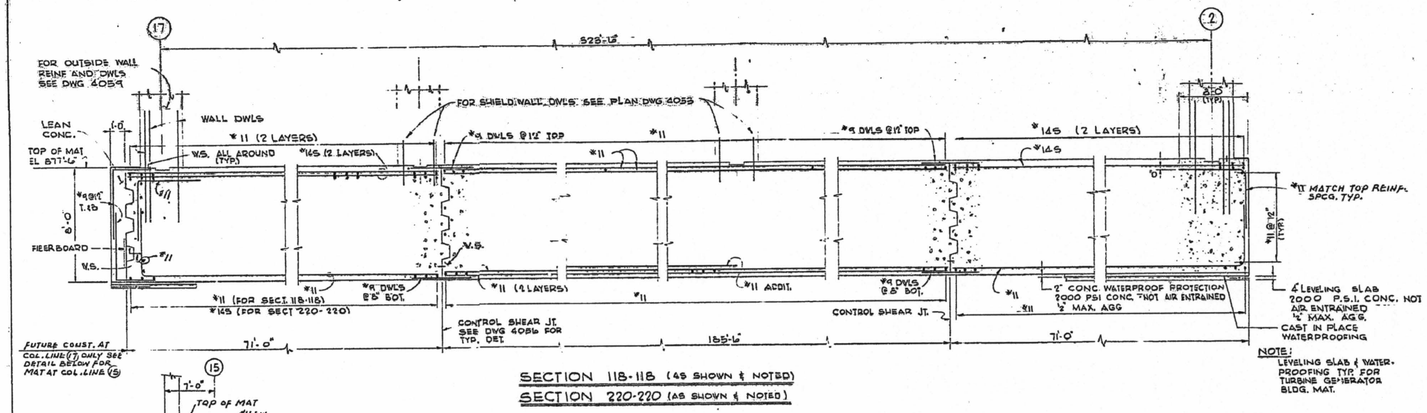

NOTE:
LEVELING SLAB & WATER-PROOFING TYP FOR TURBINE GENERATOR BLDG. MAT.

SECTION 118-118 (AS SHOWN & NOTED)
SECTION 220-220 (AS SHOWN & NOTED)



MAT AT COL. LINE (15)
CAT SECT. 220-220

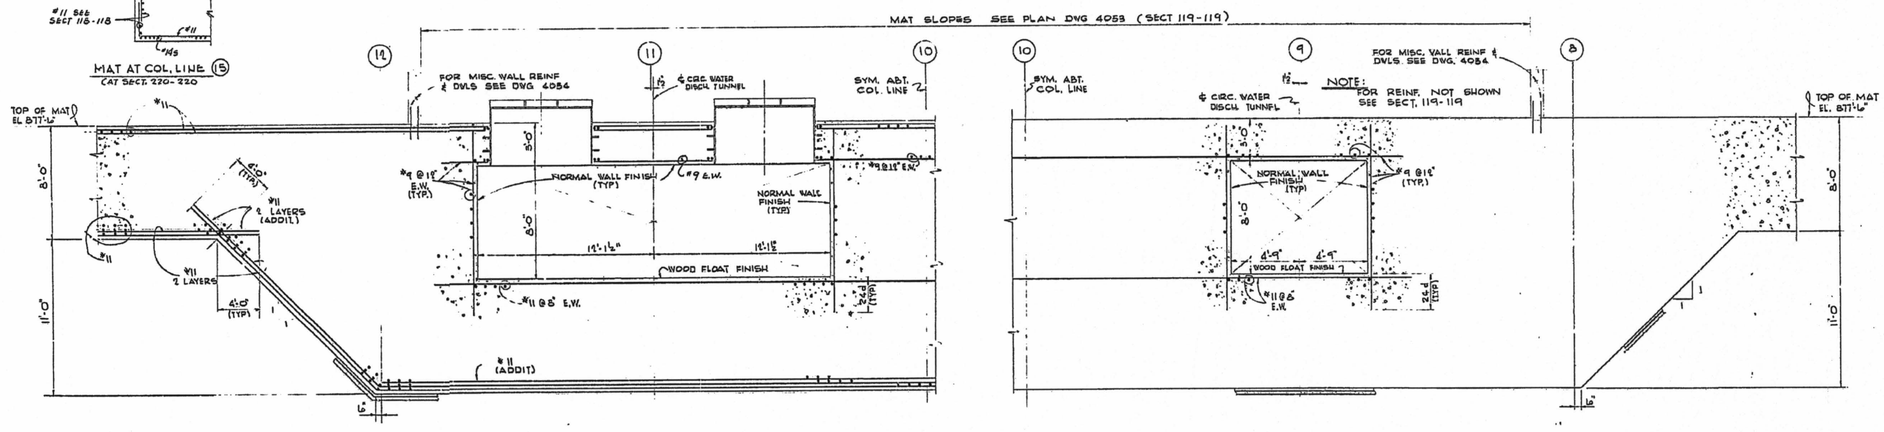

SECTION 119-119

SECTION 120-120

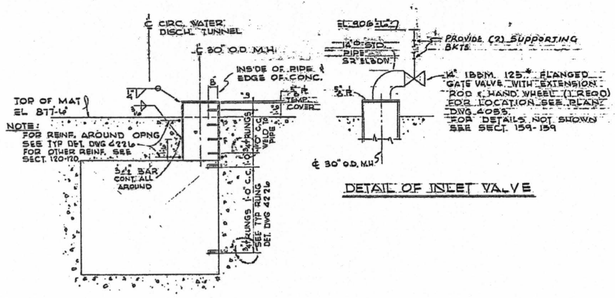

SECTION 159-159

DETAIL OF INLET VALVE

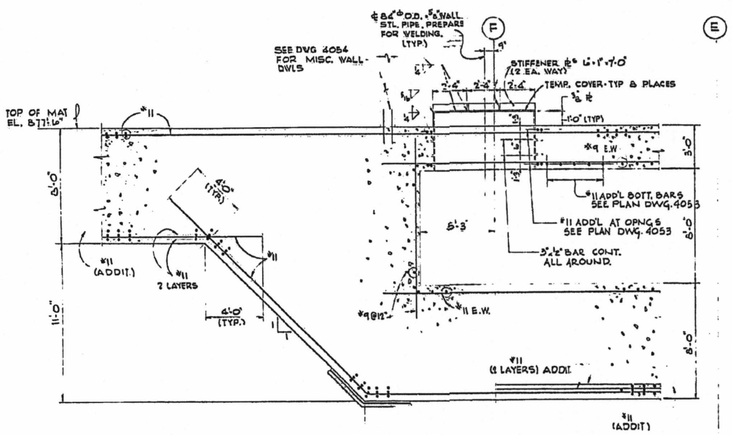

SECTION 121-121

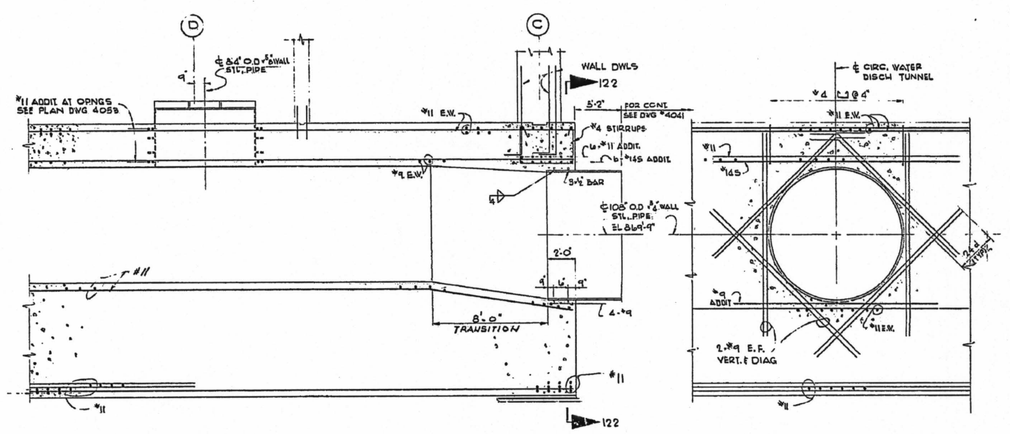

SECTION 122-122



SECTION 194-194
SCALE 1/8" = 1'-0"

NOTES:
WORK THIS DWG. WITH DWG. 4053

EXPIRES ON
STOP MAR 27 2000 STOP
NON-CONTROLLED PRINT

FILMED
RECEIVED
N.P.P.D., D.C.C.
S/N 4457

ENG. DES.	ELEC. ENG.	MECH. ENG.	CIVIL ENG.	NUC. ENGR.
CLEARED BY	[illegible]	[illegible]	[illegible]	[illegible]
DATE	9/25/68	4-25-68	4-25-68	4-20-68
REV. BY CH. DRAFTS	AL Williams/EK		4/23/68	

REV. NO.	REVISION	BY	CHKD.	APPD.	DATE
1	ADDED REINF., INLET VALVE AND FINISHES; REVISED MANHOLE & TEMP. COVERS; CLARIFIED WATERSTOPS; LEVELING SLAB & PIPE SIZES	G			
2	CLARIFIED MAT DETAILS AT SECTIONS 118-118, 119-119, 119 AND 220-220; REVISED 19" INLET VALVE AND SLAB DET. 159-159; DELETED WORK STATION DWGS AND PART OF SECT. 122-122; REVISED CONSTRUCTION JOINT ABOVE SECT. 122-122	W.A.			

REV. NO.	REVISION	BY	CHKD.	APPD.	DATE
3	CLARIFIED FIFI WALL THICKNESS DRAWING	KZ	S		
4	DRAWING RELEASED/APP. FOR CONSTRUCTION FOR X-REINF. STRENGTH ONLY	DEL	CLS	WA	1-15-68
5	DRAWING RELEASED/APPROVED FOR CONSTRUCTION; REVISED REINF AT SECT 121-121	DEL	TAT	WA	4-23-68
6					
7	REV. DIMS. @ SECT. 119-119; ADDED #11 ADDL BARS @ SECT. 121-121	TJL	RCW	AM	7-24-68
	REV. LADDER RUNG SIZE @ SECT. 159	CJM	TJL	CFK	12-6-67

BURNS AND ROE, INC.
ENGINEERS AND CONSTRUCTORS
ORADELL, N. J. HEMPSTEAD, N. Y. LOS ANGELES, CALIF.

STRUCTURAL
TURBINE GENERATOR BUILDING
FOUNDATION SECTIONS & DETAILS - SHEET No 1

CONSUMERS PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

DRAWN BY	GLASS	SQUAD LEADER	J. HIGGINS
TRACED BY		DATE	3-25-68
CHECKED BY W.O. W.O. ENGR.		SCALE	¼"=1'-0"
APPROVED FOR CONSTRUCTION		W.O.	2520
FOR CHIEF CIVIL ENGINEER	4/26/68	DWG.	4055
		REV.	17.0

D-11